

به نام خدا

# KONKUR.IN




**Forum.konkur.in**

**Club.konkur.in**

**Shop.konkur.in**

# *Fundamentals of* Heat and Mass Transfer

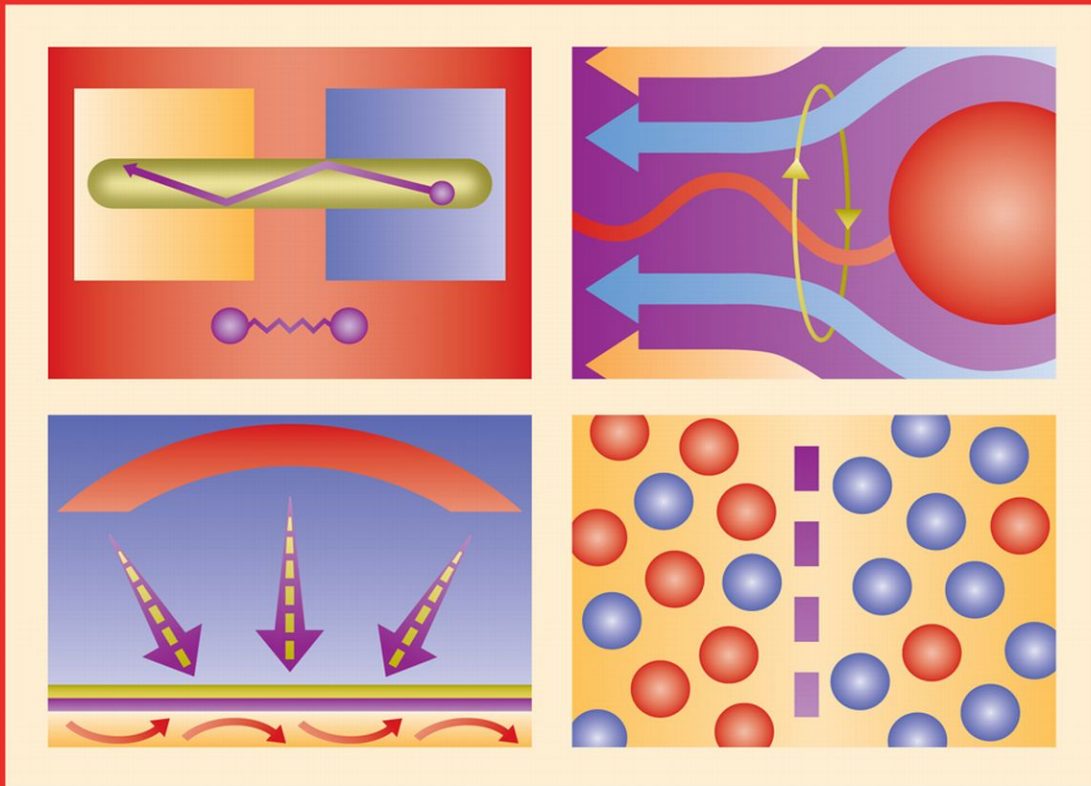

**Incropera / DeWitt / Bergman / Lavine**



SIXTH EDITION

# ***Fundamentals of Heat and Mass Transfer***

**FRANK P. INCROPERA**

*College of Engineering  
University of Notre Dame*

**DAVID P. DEWITT**

*School of Mechanical Engineering  
Purdue University*

**THEODORE L. BERGMAN**

*Department of Mechanical Engineering  
University of Connecticut*

**ADRIENNE S. LAVINE**

*Mechanical and Aerospace Engineering  
Department  
University of California, Los Angeles*



JOHN WILEY & SONS



ASSOCIATE PUBLISHER	Daniel Sayre
ACQUISITIONS EDITOR	Joseph Hayton
SENIOR PRODUCTION EDITOR	Valerie A. Vargas
MARKETING MANAGER	Phyllis Cerys
SENIOR DESIGNER	Madelyn Lesure
COVER and TEXT DESIGNER	Karin Gerdes Kincheloe
COVER ILLUSTRATIONS	Carol Grobe
SENIOR ILLUSTRATION EDITOR	Sandra Rigby
EDITORIAL ASSISTANT	Mary Morgan-McGee
MEDIA EDITOR	Stefanie Liebman
PRODUCTION SERVICES	Ingrao Associates

This book was set in 10/12 Times Roman by GGS Information Services and printed and bound by R.R. Donnelley. The cover was printed by Phoenix Color.

This book is printed on acid-free paper. ∞

Copyright © 2007 John Wiley & Sons, Inc. All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, scanning or otherwise, except as permitted under Sections 107 or 108 of the 1976 United States Copyright Act, without either the prior written permission of the Publisher, or authorization through payment of the appropriate per-copy fee to the Copyright Clearance Center, Inc. 222 Rosewood Drive, Danvers, MA 01923, website [www.copyright.com](http://www.copyright.com). Requests to the Publisher for permission should be addressed to the Permissions Department, John Wiley & Sons, Inc., 111 River Street, Hoboken, NJ 07030-5774, (201)748-6011, fax (201)748-6008, website <http://www.wiley.com/go/permissions>.

To order books or for customer service, please call 1-800-CALL WILEY (225-5945).

#### **Library of Congress Cataloging-in-Publication Data**

Incropera, Frank P.

Fundamentals of heat and mass transfer. / Frank P. Incropera . . . [et al.]. — 6th ed. / Frank P. Incropera . . . [et al].  
p. cm.

Includes bibliographical references and index.

ISBN-13: \*978-0-471-45728-2 (cloth)

ISBN-10: 0-471-45728-0 (cloth)

1. Heat—Transmission. 2. Mass transfer. I. Title.

QC320.145 2006

621.402'2—dc22

2005058360

Printed in the United States of America

10 9 8 7 6 5 4 3 2 1

# *In Memory*

---

**David P. DeWitt**

**March 2, 1934–May 17, 2005**

The year 2005 was marked by the loss of Dr. David P. DeWitt, a dear friend and colleague who contributed significantly to heat transfer technology and pedagogy throughout a distinguished 45-year career. Dave was educated as a mechanical engineer, receiving a BS degree from Duke University, an MS from MIT, and the PhD degree from Purdue University. His graduate studies at Purdue nucleated a strong interest in the fields of thermal physics and radiometry, in which he worked until illness made it impossible to continue. Dave was instrumental in developing radio-metric measurement standards at Purdue's Thermophysical Properties Research Center, eventually becoming its deputy director and president of Technometrics Inc., an optical and thermal instrument design company. In 1973 he joined Purdue's School of Mechanical Engineering at the rank of professor, where he taught and conducted research until his retirement in 2000. From 2000 to 2004, he worked in the Optical Technology Division of the National Institute of Technology and Standards.

Dave was an excellent and demanding teacher, a good researcher and a superb engineer. In our nearly thirty-year collaboration, he provided complementary skills that contributed significantly to the success of the books we have co-authored. However, it is much more on a personal than a professional level that I have my fondest memories of this very special colleague.

As co-authors, Dave and I spent thousands of hours working together on all facets of our books, typically in blocks of three to five hours. This time often involved spontaneous diversions from the task at hand, typically marked by humor or reflections on our personal lives.

Dave and I each have three daughters of comparable ages, and we would often share stories on the joys and challenges of nurturing them. It's hard to think about Dave without reflecting on the love and pride he had for his daughters (Karen, Amy, and Debbie). In 1990 Dave lost his first wife Jody due to cancer, and I witnessed first hand his personal character and strength as he supported her in battling this terrible disease. I also experienced the joy he felt in the relationship he developed with his second wife Phyllis, whom he married in 1997.

I will always remember Dave as a sensitive and kind person of good humor and generosity. Dear friend, we miss you greatly, but we are comforted by the knowledge that you are now free of pain and in a better place.

Frank P. Incropera  
Notre Dame, Indiana



# *Forward to Preface*

---

Not too long after finishing the previous editions of *Fundamentals of Heat and Mass Transfer* and *Introduction to Heat Transfer*, Dave DeWitt and I felt the need to plan for that time when we would no longer be able to add appropriate value to future editions. There were two matters of special concern. First, we were advancing in years, and the potential for disruption due to declining health or our own mortality could not be ignored. But, perhaps more pertinent to maintaining freshness and vitality to the text books, we also recognized that we were becoming ever more distant from leading-edge activities in the field.

In 2002, we concluded that we should proactively establish a succession plan involving the participation of additional co-authors. In establishing desired attributes of potential candidates, we placed high priority on the following: a record of success in teaching heat and mass transfer, active involvement with research in the field, a history of service to the heat transfer community, and the ability to *sustain* an effective collaborative relationship. A large weighting factor was attached to this last attribute, since it was believed to have contributed significantly to whatever success Dave DeWitt and I have enjoyed with the previous editions.

After reflecting long and hard on the many excellent options, Dave and I invited Ted Bergman and Adrienne Lavine, professors of Mechanical Engineering at the University of Connecticut and the University of California, Los Angeles, respectively, to join us as co-authors. We were grateful for their acceptance. Ted and Adrienne are listed as third and fourth authors for this edition, will move to first and second authors on the next edition, and will thereafter appear as sole authors.

Ted and Adrienne have worked extremely hard on the current edition, and you will see numerous enhancements from their efforts, particularly in modern applications related to subjects such as nano and biotechnology. It is therefore most appropriate for Ted and Adrienne to share their thoughts in the following preface.

Frank P. Incropera  
Notre Dame, Indiana



# *Preface*

---

Since the last edition, fundamental changes have occurred, both nationally and globally, in how engineering is practiced, with questions raised about the future of the profession. How will the practice of engineering evolve over the next decade? Will tomorrow's engineer be more valued if he is a specialist, or more handsomely rewarded if she has knowledge of greater breadth but less depth? How will engineering educators respond to changing *market forces*? Will the traditional boundaries that separate the engineering disciplines in the typical college or university remain in place?

We believe that, because technology provides the foundation for improving the standard of living of all humankind, the future of engineering is bright. But, in light of the tension between *external demand for generalization* and *intellectual satisfaction of specialization*, how will the discipline of heat transfer remain relevant? What will the value of this discipline be in the future? To what new problems will the knowledge of heat transfer be applied?

In preparing this edition, we attempted to identify emerging issues in technology and science in which heat transfer is *central* to the realization of new products in areas such as information technology, biotechnology and pharmacology, alternative energy, and nanotechnology. These new applications, along with traditional applications in energy generation, energy utilization, and manufacturing, suggest that the discipline of heat transfer is healthy. Furthermore, when applied to problems that transcend traditional boundaries, heat transfer will be a vital and *enabling discipline* of the future.

We have strived to remain true to the fundamental pedagogical approach of previous editions by retaining a rigorous and systematic methodology for problem solving, by including examples and problems that reveal the richness and beauty of the discipline, and by providing students with opportunities to meet the learning objectives.

## Approach and Organization

---

From our perspective, the four learning objectives desired in any first course in heat transfer, detailed in the previous edition, remain as follows:

1. The student should internalize the meaning of the terminology and physical principles associated with the subject.
2. The student should be able to delineate pertinent transport phenomena for any process or system involving heat transfer.
3. The student should be able to use requisite inputs for computing heat transfer rates and/or material temperatures.
4. The student should be able to develop representative models of real processes and systems and draw conclusions concerning process/system design or performance from attendant analysis.

As in the previous edition, learning objectives for each chapter are clarified to enhance the means by which they are achieved, as well as means by which achievement may be assessed. The summary of each chapter highlights key terminology and concepts developed in the chapter, and poses questions to test and enhance student comprehension.

For problems involving complex models and/or *exploratory*, *what-if*, and *parameter sensitivity* considerations, it is recommended that they be addressed by using a computational equation-solving package. To this end, the *Interactive Heat Transfer* (IHT) package developed by Intellipro, Inc. (New Brunswick, New Jersey) and available in the previous edition has been updated. The seasoned user will find the technical content of IHT to be largely unchanged, but the computational capability and features have been improved significantly. Specifically, IHT is now capable of solving 300 or more simultaneous equations. The user interface has been updated to include a full-function workspace editor with complete control over formatting of text, copy and paste functionality, an equation editor, a new graphing subsystem, and enhanced syntax checking. In addition, the software now has the capability to export IHT-specific functions (e.g. properties and correlations) as Microsoft Excel add-ins. A second software package, *Finite Element Heat Transfer* (FEHT), developed by F-Chart Software of Middleton, Wisconsin, provides enhanced capabilities for solving two-dimensional conduction heat transfer problems.

As in the previous edition, many homework problems that involve a computer-based solution appear as extensions to problems that can be solved by hand calculation. This approach is time tested and allows students to validate their computer predictions by checking the predictions with their hand solutions. They may then proceed with parametric studies that explore related design and operating conditions. Such problems are identified by enclosing the exploratory part in a red rectangle, as, for example (b), (c), or (d). This feature also allows instructors who wish to limit their assignments of computer-based problems to benefit from the richness of these problems. Solutions to problems for which the number itself is highlighted, as, for example, 1.26, should be entirely computer based.

We are aware that some instructors who use the text have not utilized IHT in their courses. We encourage our colleagues to dedicate, at a minimum, one-half hour of lecture or recitation time to demonstrate IHT as a tool for solving simultaneous equations, and for evaluating the thermophysical properties of various materials. We

have found that, once students have seen its power and ease of use, they will eagerly utilize IHT's additional features on their own. This will enable them to solve problems faster, with fewer numerical errors, thereby freeing them to concentrate on the more substantive aspects of the problems.

## What's New in the 6th Edition

---

**Problem Sets** This edition contains a significant number of new, revised, and renumbered end-of-chapter problems. Many of the new problems require relatively straightforward analyses, and many involve applications in nontraditional areas of science and technology. The solutions manual has undergone extensive revision.

**Streamlined Presentation** The text has been streamlined by moving a small amount of material to stand-alone supplemental sections that can be accessed electronically from the companion website. The supplemental sections are called out with marginal notes throughout the text. If instructors prefer to use material from the supplemental sections, it is readily available from the Wiley website (see below). Homework problem statements associated with the supplemental sections are also available electronically.

**Chapter-by-Chapter Content Changes** To help motivate the reader, Chapter 1 includes an expanded discussion of the *relevance of heat transfer*. The richness and pertinence of the topic are conveyed by discussion of *energy conversion devices* including fuel cells, applications in *information technology* and *biological* as well as *biomedical engineering*. The presentation of the *conservation of energy requirement* has been revised.

New material on *micro- and nanoscale conduction* has been included in Chapter 2. Because *in-depth* treatment of these effects would overwhelm most students, they are introduced and illustrated by describing the motion of *energy carriers* including *phonons* and *electrons*. Approximate expressions for the effective thermal conductivity of *thin films* are presented and are explained in terms of energy carrier behavior at physical boundaries. The thermal conductivity of *nanostructured* versus *conventional* materials is presented and used to demonstrate practical applications of recent nanotechnology research. Microscale-related *limitations of the heat diffusion equation* are explained. The *bioheat equation* is introduced in Chapter 3, and its similarity to the heat equation for extended surfaces is pointed out in order to facilitate its use and solution.

The Chapter 4 discussion of *conduction shape factors*, applied to multidimensional steady-state conduction, is embellished with recent results involving the *dimensionless conduction heat rate*. Although we have moved the graphical method to the supplemental material, discussion of two-dimensional *isotherm* and *heat flow line distributions* has been enhanced in order to assist students to conceptualize the conduction process. Use of the dimensionless conduction heat rate is extended to transient situations in Chapter 5. A new, *unified approach* to transient heat transfer is presented; easy-to-use *approximate solutions* associated with a range of geometries and time scales have been added. Recently, we have noted that few students use the graphical representations of the one-dimensional, transient conduction solutions (Heisler charts); most prefer to solve the approximate or exact analytical expressions.



Hence, we have relegated the graphical representations to the supplemental material. Because of the ease and frequency with which computational methods are used by students today, analytical solutions involving multidimensional effects have also been moved to the supplemental material. We have added a brief section on periodic heating and have demonstrated its relevance by presenting a modern method used to measure the thermophysical properties of nanostructured materials.

Introduction to the fundamentals of convection, included in Chapter 6, has been simplified and streamlined. The description of *turbulence* and *transition to turbulence* has been updated. Proper accounting of the *temperature-dependence of thermophysical properties* is emphasized. Derivation of the convection transfer equations is now relegated to the supplemental material.

The treatment of *external flow* in Chapter 7 is largely unchanged. Chapter 8 correlations for the *entrance regions of internal flow* have been updated, while the discussion of heat transfer enhancement has been expanded by adding correlations for flow in *curved tubes*. Microscale-related *limitations of the convective correlations* for internal flow are presented. Chapter 9 correlations for the effective thermal conductivity associated with *free convection* in enclosures have been revised in order to more directly relate these correlations to the conduction results of Chapter 3.

Presentation of *boiling heat transfer* in Chapter 10 has been modified to improve student understanding of the boiling curve by relating aspects of boiling phenomena to forced convection and free convection concepts from previous chapters. Values of the constants used in the boiling correlations have been modified to reflect the current literature. Reference to refrigerants that are no longer used has been eliminated, and replacement refrigerant properties have been added. Heat transfer correlations for *internal two-phase flow* are presented. Microscale-related *limitations of the correlations* for internal two-phase flow are discussed. A much-simplified method for solution of condensation problems is presented.

The use of the log mean temperature difference (*LMTD*) method is retained for developing correlations for concentric tube heat exchangers in Chapter 11, but, because of the flexibility of the *effectiveness-NTU* method, the LMTD-based analysis of heat exchangers of other types has been relegated to the supplemental material. Again, the supplemental sections can be accessed at the companion website. Treatment of radiation heat transfer in Chapter 12 and 13 has undergone modest revision and streamlining.

The coverage of mass transfer, Chapter 14, has been revised extensively. The chapter has been reorganized so that instructors can either cover the entire content or *seamlessly* restrict attention to mass transfer in stationary media. The latter approach is recommended if time is limited, and/or if interest is limited to mass transfer in liquids or solids. The new example problems of Chapter 14 reflect contemporary applications. Discussion of the various boundary conditions used in mass transfer has been clarified and simplified.

## Acknowledgments

---

We are immensely indebted to Frank Incropera and Dave DeWitt who entrusted us to join them as co-authors. We are especially thankful to Frank for his patience, thoughtful advice, detailed critique of our work, and kind encouragement as this edition was being developed.

Appreciation is extended to our colleagues at the University of Connecticut and UCLA who provided valuable input. Eric W. Lemmon of the National Institute of Standards and Technology is acknowledged for his generosity in providing properties of new refrigerants.

We are forever grateful to our wonderful spouses and children, Tricia, Nate, Tico, Greg, Elias, and Jacob for their love, support, and endless patience. Finally, we both extend our appreciation to Tricia Bergman who, despite all her responsibilities, somehow found the time to expertly and patiently process the solutions for the new end-of-chapter problems.

Theodore L. Bergman (tberg@engr.uconn.edu)  
Storrs, Connecticut

Adrienne S. Lavine (lavine@seas.ucla.edu)  
Los Angeles, California

## Supplemental and Website Material

---

The companion website for the text is [www.wiley.com/college/incropera](http://www.wiley.com/college/incropera). By clicking on the ‘student companion site’ link, *students* may access the answers to the homework problems and the Supplemental Sections of the text.

Material available *for instructors only* includes the instructor Solutions Manual, Powerpoint slides that can be used by instructors for lectures, and electronic versions of figures from the texts for those wishing to prepare their own materials for electronic classroom presentation. The instructor Solutions Manual is for use by instructors who are requiring use of the text for their course. *Copying or distributing all or part of the Solutions Manual in any form without the Publisher’s permission is a violation of copyright law.*

**Interactive Heat Transfer v3.0/FEHT with User’s Guide** is available either with the text or as a separate purchase. This software tool provides modeling and computational features useful in solving many problems in the text, and enables *what-if* and *exploratory analysis* of many types of heat transfer problems. The CD/booklet package is available as a stand-alone purchase from the Wiley website, [www.wiley.com](http://www.wiley.com), or through your local bookstore. Faculty interested in using this tool in their course may order the software shrinkwrapped to the text at a significant discount. Contact your local Wiley representative for details.



# Contents

---

Symbols

xxiii

## CHAPTER **I** *Introduction*

---

<b>1.1</b>	What and How?	2
<b>1.2</b>	Physical Origins and Rate Equations	3
1.2.1	Conduction	3
1.2.2	Convection	6
1.2.3	Radiation	9
1.2.4	Relationship to Thermodynamics	12
<b>1.3</b>	The Conservation of Energy Requirement	13
1.3.1	Conservation of Energy for a Control Volume	13
1.3.2	The Surface Energy Balance	25
1.3.3	Application of the Conservation Laws: Methodology	28
<b>1.4</b>	Analysis of Heat Transfer Problems: Methodology	29

1.5	Relevance of Heat Transfer	32
1.6	Units and Dimensions	35
1.7	Summary	38
	References	41
	Problems	41


**CHAPTER 2*****Introduction to Conduction*****57**

2.1	The Conduction Rate Equation	58
2.2	The Thermal Properties of Matter	60
2.2.1	Thermal Conductivity	60
2.2.2	Other Relevant Properties	67
2.3	The Heat Diffusion Equation	70
2.4	Boundary and Initial Conditions	77
2.5	Summary	81
	References	82
	Problems	82

**CHAPTER 3*****One-Dimensional, Steady-State Conduction*****95**


3.1	The Plane Wall	96
3.1.1	Temperature Distribution	96
3.1.2	Thermal Resistance	98
3.1.3	The Composite Wall	99
3.1.4	Contact Resistance	101
3.2	An Alternative Conduction Analysis	112
3.3	Radial Systems	116
3.3.1	The Cylinder	116
3.3.2	The Sphere	122
3.4	Summary of One-Dimensional Conduction Results	125
3.5	Conduction with Thermal Energy Generation	126
3.5.1	The Plane Wall	127
3.5.2	Radial Systems	132
3.5.3	Application of Resistance Concepts	137
3.6	Heat Transfer from Extended Surfaces	137
3.6.1	A General Conduction Analysis	139
3.6.2	Fins of Uniform Cross-Sectional Area	141
3.6.3	Fin Performance	147
3.6.4	Fins of Nonuniform Cross-Sectional Area	150
3.6.5	Overall Surface Efficiency	153
3.7	The Bioheat Equation	162
3.8	Summary	166
	References	168
	Problems	169

**CHAPTER 4*****Two-Dimensional, Steady-State Conduction*****201**

<b>4.1</b>	Alternative Approaches	202
<b>4.2</b>	The Method of Separation of Variables	203
<b>4.3</b>	The Conduction Shape Factor and the Dimensionless Conduction Heat Rate	207
<b>4.4</b>	Finite-Difference Equations	212
4.4.1	The Nodal Network	213
4.4.2	Finite-Difference Form of the Heat Equation	214
4.4.3	The Energy Balance Method	215
<b>4.5</b>	Solving the Finite-Difference Equations	222
4.5.1	The Matrix Inversion Method	222
4.5.2	Gauss–Seidel Iteration	223
4.5.3	Some Precautions	229
<b>4.6</b>	Summary	234
	References	235
	Problems	235
 <b>4S.1</b>	The Graphical Method	W-1
4S.1.1	Methodology of Constructing a Flux Plot	W-1
4S.1.2	Determination of the Heat Transfer Rate	W-2
4S.1.3	The Conduction Shape Factor	W-3
	References	W-6
	Problems	W-6


**CHAPTER 5*****Transient Conduction*****255**

<b>5.1</b>	The Lumped Capacitance Method	256
<b>5.2</b>	Validity of the Lumped Capacitance Method	259
<b>5.3</b>	General Lumped Capacitance Analysis	263
<b>5.4</b>	Spatial Effects	270
<b>5.5</b>	The Plane Wall with Convection	272
5.5.1	Exact Solution	272
5.5.2	Approximate Solution	273
5.5.3	Total Energy Transfer	274
5.5.4	Additional Considerations	275
<b>5.6</b>	Radial Systems with Convection	276
5.6.1	Exact Solutions	276
5.6.2	Approximate Solutions	277
5.6.3	Total Energy Transfer	277
5.6.4	Additional Considerations	278
<b>5.7</b>	The Semi-Infinite Solid	283
<b>5.8</b>	Objects with Constant Surface Temperatures or Surface Heat Fluxes	290
5.8.1	Constant Temperature Boundary Conditions	290
5.8.2	Constant Heat Flux Boundary Conditions	292
5.8.3	Approximate Solutions	293
<b>5.9</b>	Periodic Heating	299

<b>5.10</b>	Finite-Difference Methods	302
5.10.1	Discretization of the Heat Equation: The Explicit Method	302
5.10.2	Discretization of the Heat Equation: The Implicit Method	310
<b>5.11</b>	Summary	317
	References	319
	Problems	319
 <b>5S.1</b>	Graphical Representation of One-Dimensional, Transient Conduction in the Plane Wall, Long Cylinder, and Sphere	W-8
<b>5S.2</b>	Analytical Solution of Multidimensional Effects	W-13
	References	W-18
	Problems	W-18

**CHAPTER 6*****Introduction to Convection*****347**


---

<b>6.1</b>	The Convection Boundary Layers	348
6.1.1	The Velocity Boundary Layer	348
6.1.2	The Thermal Boundary Layer	349
6.1.3	The Concentration Boundary Layer	350
6.1.4	Significance of the Boundary Layers	352
<b>6.2</b>	Local and Average Convection Coefficients	352
6.2.1	Heat Transfer	352
6.2.2	Mass Transfer	353
6.2.3	The Problem of Convection	355
<b>6.3</b>	Laminar and Turbulent Flow	359
6.3.1	Laminar and Turbulent Velocity Boundary Layers	359
6.3.2	Laminar and Turbulent Thermal and Species Concentration Boundary Layers	361
<b>6.4</b>	The Boundary Layer Equations	364
6.4.1	Boundary Layer Equations for Laminar Flow	365
<b>6.5</b>	Boundary Layer Similarity: The Normalized Boundary Layer Equations	367
6.5.1	Boundary Layer Similarity Parameters	368
6.5.2	Functional Form of the Solutions	368
<b>6.6</b>	Physical Significance of the Dimensionless Parameters	374
<b>6.7</b>	Boundary Layer Analogies	377
6.7.1	The Heat and Mass Transfer Analogy	377
6.7.2	Evaporative Cooling	381
6.7.3	The Reynolds Analogy	384
<b>6.8</b>	The Convection Coefficients	385
<b>6.9</b>	Summary	385
	References	386
	Problems	387
 <b>6S.1</b>	Derivation of the Convection Transfer Equations	W-21
6S.1.1	Conservation of Mass	W-21
6S.1.2	Newton's Second Law of Motion	W-22
6S.1.3	Conservation of Energy	W-26
6S.1.4	Conservation of Species	W-28
	References	W-33
	Problems	W-33

## CHAPTER 7

### *External Flow*

401

7.1	The Empirical Method	403
7.2	The Flat Plate in Parallel Flow	405
7.2.1	Laminar Flow over an Isothermal Plate: A Similarity Solution	405
7.2.2	Turbulent Flow over an Isothermal Plate	410
7.2.3	Mixed Boundary Layer Conditions	411
7.2.4	Unheated Starting Length	412
7.2.5	Flat Plates with Constant Heat Flux Conditions	413
7.2.6	Limitations on Use of Convection Coefficients	414
7.3	Methodology for a Convection Calculation	414
7.4	The Cylinder in Cross Flow	423
7.4.1	Flow Considerations	423
7.4.2	Convection Heat and Mass Transfer	425
7.5	The Sphere	433
7.6	Flow Across Banks of Tubes	436
7.7	Impinging Jets	447
7.7.1	Hydrodynamic and Geometric Considerations	447
7.7.2	Convection Heat and Mass Transfer	449
7.8	Packed Beds	452
7.9	Summary	454
	References	456
	Problems	457

## CHAPTER 8

### *Internal Flow*

485

8.1	Hydrodynamic Considerations	486
8.1.1	Flow Conditions	486
8.1.2	The Mean Velocity	487
8.1.3	Velocity Profile in the Fully Developed Region	488
8.1.4	Pressure Gradient and Friction Factor in Fully Developed Flow	490
8.2	Thermal Considerations	491
8.2.1	The Mean Temperature	492
8.2.2	Newton's Law of Cooling	493
8.2.3	Fully Developed Conditions	493
8.3	The Energy Balance	497
8.3.1	General Considerations	497
8.3.2	Constant Surface Heat Flux	498
8.3.3	Constant Surface Temperature	501
8.4	Laminar Flow in Circular Tubes: Thermal Analysis and Convection Correlations	505
8.4.1	The Fully Developed Region	505
8.4.2	The Entry Region	512
8.5	Convection Correlations: Turbulent Flow in Circular Tubes	514
8.6	Convection Correlations: Noncircular Tubes and the Concentric Tube Annulus	518
8.7	Heat Transfer Enhancement	521



<b>8.8</b>	Microscale Internal Flow	524
8.8.1	Flow Conditions in Microscale Internal Flow	524
8.8.2	Thermal Considerations in Microscale Internal Flow	525
<b>8.9</b>	Convection Mass Transfer	528
<b>8.10</b>	Summary	531
	References	533
	Problems	534

**CHAPTER 9*****Free Convection*****559**

<b>9.1</b>	Physical Considerations	560
<b>9.2</b>	The Governing Equations	563
<b>9.3</b>	Similarity Considerations	564
<b>9.4</b>	Laminar Free Convection on a Vertical Surface	566
<b>9.5</b>	The Effects of Turbulence	568
<b>9.6</b>	Empirical Correlations: External Free Convection Flows	571
9.6.1	The Vertical Plate	571
9.6.2	Inclined and Horizontal Plates	574
9.6.3	The Long Horizontal Cylinder	579
9.6.4	Spheres	583
<b>9.7</b>	Free Convection within Parallel Plate Channels	584
9.7.1	Vertical Channels	585
9.7.2	Inclined Channels	587
<b>9.8</b>	Empirical Correlations: Enclosures	587
9.8.1	Rectangular Cavities	587
9.8.2	Concentric Cylinders	590
9.8.3	Concentric Spheres	591
<b>9.9</b>	Combined Free and Forced Convection	593
<b>9.10</b>	Convection Mass Transfer	594
<b>9.11</b>	Summary	595
	References	596
	Problems	597

**CHAPTER 10*****Boiling and Condensation*****619**


<b>10.1</b>	Dimensionless Parameters in Boiling and Condensation	620
<b>10.2</b>	Boiling Modes	621
<b>10.3</b>	Pool Boiling	622
10.3.1	The Boiling Curve	622
10.3.2	Modes of Pool Boiling	624
<b>10.4</b>	Pool Boiling Correlations	627
10.4.1	Nucleate Pool Boiling	627
10.4.2	Critical Heat Flux for Nucleate Pool Boiling	629
10.4.3	Minimum Heat Flux	629
10.4.4	Film Pool Boiling	630
10.4.5	Parametric Effects on Pool Boiling	631

<b>10.5</b>	Forced Convection Boiling	636
10.5.1	External Forced Convection Boiling	637
10.5.2	Two-Phase Flow	637
10.5.3	Two-Phase Flow in Microchannels	640
<b>10.6</b>	Condensation: Physical Mechanisms	641
<b>10.7</b>	Laminar Film Condensation on a Vertical Plate	643
<b>10.8</b>	Turbulent Film Condensation	646
<b>10.9</b>	Film Condensation on Radial Systems	651
<b>10.10</b>	Film Condensation in Horizontal Tubes	654
<b>10.11</b>	Dropwise Condensation	655
<b>10.12</b>	Summary	655
	References	656
	Problems	657

## CHAPTER 11

### Heat Exchangers

669

<b>11.1</b>	Heat Exchanger Types	670
<b>11.2</b>	The Overall Heat Transfer Coefficient	673
<b>11.3</b>	Heat Exchanger Analysis: Use of the Log Mean Temperature Difference	675
11.3.1	The Parallel-Flow Heat Exchanger	676
11.3.2	The Counterflow Heat Exchanger	679
11.3.3	Special Operating Conditions	679
<b>11.4</b>	Heat Exchanger Analysis: The Effectiveness–NTU Method	686
11.4.1	Definitions	686
11.4.2	Effectiveness–NTU Relations	688
<b>11.5</b>	Heat Exchanger Design and Performance Calculations: Using the Effectiveness–NTU Method	694
<b>11.6</b>	Compact Heat Exchangers	700
<b>11.7</b>	Summary	705
	References	706
	Problems	707
 <b>11S.1</b>	Log Mean Temperature Difference Method for Multipass and Cross-Flow Heat Exchangers	W-37
	References	W-41
	Problems	W-41

## CHAPTER 12

### Radiation: Processes and Properties

723

<b>12.1</b>	Fundamental Concepts	724
<b>12.2</b>	Radiation Intensity	727
12.2.1	Mathematical Definitions	727
12.2.2	Radiation Intensity and Its Relation to Emission	728
12.2.3	Relation to Irradiation	733
12.2.4	Relation to Radiosity	735
<b>12.3</b>	Blackbody Radiation	736
12.3.1	The Planck Distribution	737
12.3.2	Wien's Displacement Law	737

12.3.3	The Stefan-Boltzmann Law	738
12.3.4	Band Emission	739
<b>12.4</b>	Emission from Real Surfaces	744
<b>12.5</b>	Absorption, Reflection, and Transmission by Real Surfaces	752
12.5.1	Absorptivity	754
12.5.2	Reflectivity	755
12.5.3	Transmissivity	756
12.5.4	Special Considerations	757
<b>12.6</b>	Kirchhoff's Law	762
<b>12.7</b>	The Gray Surface	764
<b>12.8</b>	Environmental Radiation	770
<b>12.9</b>	Summary	776
	References	780
	Problems	780

**CHAPTER 13*****Radiation Exchange Between Surfaces* 811**

<b>13.1</b>	The View Factor	812
13.1.1	The View Factor Integral	812
13.1.2	View Factor Relations	813
<b>13.2</b>	Radiation Exchange Between Opaque, Diffuse, Gray Surfaces in an Enclosure	822
13.2.1	Net Radiation Exchange at a Surface	823
13.2.2	Radiation Exchange Between Surfaces	824
13.2.3	Blackbody Radiation Exchange	830
13.2.4	The Two-Surface Enclosure	831
13.2.5	Radiation Shields	832
13.2.6	The Reradiating Surface	835
<b>13.3</b>	Multimode Heat Transfer	839
<b>13.4</b>	Radiation Exchange with Participating Media	842
13.4.1	Volumetric Absorption	843
13.4.2	Gaseous Emission and Absorption	843
<b>13.5</b>	Summary	847
	References	849
	Problems	849

**CHAPTER 14*****Diffusion Mass Transfer* 879**

<b>14.1</b>	Physical Origins and Rate Equations	880
14.1.1	Physical Origins	880
14.1.2	Mixture Composition	881
14.1.3	Fick's Law of Diffusion	882
14.1.4	Mass Diffusivity	883
<b>14.2</b>	Mass Transfer in Nonstationary Media	885
14.2.1	Absolute and Diffusive Species Fluxes	885
14.2.2	Evaporation in a Column	888
<b>14.3</b>	The Stationary Medium Approximation	893

14.4	Conservation of Species for a Stationary Medium	894
14.4.1	Conservation of Species for a Control Volume	894
14.4.2	The Mass Diffusion Equation	894
14.4.3	Stationary Media with Specified Surface Concentrations	897
14.5	Boundary Conditions and Discontinuous Concentrations at Interfaces	900
14.5.1	Evaporation and Sublimation	901
14.5.2	Solubility of Gases in Liquids and Solids	902
14.5.3	Catalytic Surface Reactions	905
14.6	Mass Diffusion with Homogeneous Chemical Reactions	908
14.7	Transient Diffusion	911
14.8	Summary	916
	References	917
	Problems	917
<b>APPENDIX A</b>		
<b><i>Thermophysical Properties of Matter</i></b>		<b>927</b>
<b>APPENDIX B</b>		
<b><i>Mathematical Relations and Functions</i></b>		<b>959</b>
<b>APPENDIX C</b>		
<b><i>Thermal Conditions Associated with Uniform Energy Generation in One-Dimensional, Steady-State Systems</i></b>		<b>965</b>
<b>APPENDIX D</b>		
<b><i>The Convection Transfer Equations</i></b>		<b>973</b>
D.1	Conservation of Mass	974
D.2	Newton's Second Law of Motion	974
D.3	Conservation of Energy	975
D.4	Conservation of Species	976
<b>APPENDIX E</b>		
<b><i>Boundary Layer Equations for Turbulent Flow</i></b>		<b>977</b>
<b>APPENDIX F</b>		
<b><i>An Integral Laminar Boundary Layer Solution for Parallel Flow over a Flat Plate</i></b>		<b>981</b>
<b><i>Index</i></b>		<b>985</b>



# Symbols

$A$	area, m <sup>2</sup>	$\dot{E}_{st}$	rate of increase of energy stored within a control volume, W
$A_b$	area of prime (unfinned) surface, m <sup>2</sup>	$e$	thermal internal energy per unit mass, J/kg; surface roughness, m
$A_c$	cross-sectional area, m <sup>2</sup>	$F$	force, N; heat exchanger correction factor; fraction of blackbody radiation in a wavelength band; view factor
$A_{ff}$	free-flow area in compact heat exchanger core (minimum cross-sectional area available for flow through the core), m <sup>2</sup>	$Fo$	Fourier number
$A_{fr}$	heat exchanger frontal area, m <sup>2</sup>	$Fr$	Froude number
$A_p$	fin profile area, m <sup>2</sup>	$f$	friction factor; similarity variable
$A_r$	nozzle area ratio	$G$	irradiation, W/m <sup>2</sup> ; mass velocity, kg/s · m <sup>2</sup>
$a$	acceleration, m/s <sup>2</sup>	$Gr$	Grashof number
$Bi$	Biot number	$Gz$	Graetz number
$Bo$	Bond number	$g$	gravitational acceleration, m/s <sup>2</sup>
$C$	molar concentration, kmol/m <sup>3</sup> ; heat capacity rate, W/K	$g_c$	gravitational constant, 1 kg · m/N · s <sup>2</sup> or 32.17 ft · lb <sub>m</sub> /lb <sub>f</sub> · s <sup>2</sup>
$C_D$	drag coefficient	$H$	nozzle height, m; Henry's constant, bars
$C_f$	friction coefficient	$h$	convection heat transfer coefficient, W/m <sup>2</sup> · K; Planck's constant
$C_t$	thermal capacitance, J/K	$h_{fg}$	latent heat of vaporization, J/kg
$Co$	Confinement number	$h_{sf}$	latent heat of fusion, J/kg
$c$	specific heat, J/kg · K; speed of light, m/s	$h_m$	convection mass transfer coefficient, m/s
$c_p$	specific heat at constant pressure, J/kg · K	$h_{rad}$	radiation heat transfer coefficient, W/m <sup>2</sup> · K
$c_v$	specific heat at constant volume, J/kg · K	$I$	electric current, A; radiation intensity, W/m <sup>2</sup> · sr
$D$	diameter, m	$i$	electric current density, A/m <sup>2</sup> ; enthalpy per unit mass, J/kg
$D_{AB}$	binary mass diffusivity, m <sup>2</sup> /s	$J$	radiosity, W/m <sup>2</sup>
$D_b$	bubble diameter, m	$Ja$	Jakob number
$D_h$	hydraulic diameter, m	$J_i^*$	diffusive molar flux of species $i$ relative to the mixture molar average velocity, kmol/s · m <sup>2</sup>
$E$	thermal plus mechanical energy, J; electric potential, V; emissive power, W/m <sup>2</sup>		
$E^{tot}$	total energy, J		
$Ec$	Eckert number		
$\dot{E}_g$	rate of energy generation, W		
$\dot{E}_{in}$	rate of energy transfer into a control volume, W		
$\dot{E}_{out}$	rate of energy transfer out of control volume, W		

$j_i$	diffusive mass flux of species $i$ relative to the mixture mass average velocity, $\text{kg/s} \cdot \text{m}^2$	$Pe$	Peclet number ( $RePr$ )
$j_H$	Colburn $j$ factor for heat transfer	$Pr$	Prandtl number
$j_m$	Colburn $j$ factor for mass transfer	$p$	pressure, $\text{N/m}^2$
$k$	thermal conductivity, $\text{W/m} \cdot \text{K}$ ; Boltzmann's constant	$Q$	energy transfer, J
$k_0$	zero-order, homogeneous reaction rate constant, $\text{kmol/s} \cdot \text{m}^3$	$q$	heat transfer rate, W
$k_1$	first-order, homogeneous reaction rate constant, $\text{s}^{-1}$	$\dot{q}$	rate of energy generation per unit volume, $\text{W/m}^3$
$k_1''$	first-order, homogeneous reaction rate constant, $\text{m/s}$	$q'$	heat transfer rate per unit length, $\text{W/m}$
$L$	characteristic length, m	$q''$	heat flux, $\text{W/m}^2$
$Le$	Lewis number	$q^*$	dimensionless conduction heat rate
$M$	mass, kg; number of heat transfer lanes in a flux plot; reciprocal of the Fourier number for finite-difference solutions	$R$	cylinder radius, m
$\dot{M}_i$	rate of transfer of mass for species $i$ , $\text{kg/s}$	$\mathcal{R}$	universal gas constant
$\dot{M}_{i,g}$	rate of increase of mass of species $i$ due to chemical reactions, $\text{kg/s}$	$Ra$	Rayleigh number
$\dot{M}_{in}$	rate at which mass enters a control volume, $\text{kg/s}$	$Re$	Reynolds number
$\dot{M}_{out}$	rate at which mass leaves a control volume, $\text{kg/s}$	$R_e$	electric resistance, $\Omega$
$\dot{M}_{st}$	rate of increase of mass stored within a control volume, $\text{kg/s}$	$R_f$	fouling factor, $\text{m}^2 \cdot \text{K/W}$
$\mathcal{M}_i$	molecular weight of species $i$ , $\text{kg/kmol}$	$R_m$	mass transfer resistance, $\text{s/m}^3$
$m$	mass, kg	$R_{m,n}$	residual for the $m, n$ nodal point
$\dot{m}$	mass flow rate, $\text{kg/s}$	$R_t$	thermal resistance, $\text{K/W}$
$m_i$	mass fraction of species $i$ , $\rho_i/\rho$	$R_{t,c}$	thermal contact resistance, $\text{K/W}$
$N$	number of temperature increments in a flux plot; total number of tubes in a tube bank; number of surfaces in an enclosure	$R_{t,f}$	fin thermal resistance, $\text{K/W}$
$N_L, N_T$	number of tubes in longitudinal and transverse directions	$R_{t,o}$	thermal resistance of fin array, $\text{K/W}$
$Nu$	Nusselt number	$r_o$	cylinder or sphere radius, m
$NTU$	number of transfer units	$r, \phi, z$	cylindrical coordinates
$N_i$	molar transfer rate of species $i$ relative to fixed coordinates, $\text{kmol/s}$	$r, \theta, \phi$	spherical coordinates
$N_i''$	molar flux of species $i$ relative to fixed coordinates, $\text{kmol/s} \cdot \text{m}^2$	$S$	solubility, $\text{kmol/m}^3 \cdot \text{atm}$ ; shape factor for two-dimensional conduction, m; nozzle pitch, m; plate spacing, m
$\dot{N}_i$	molar rate of increase of species $i$ per unit volume due to chemical reactions, $\text{kmol/s} \cdot \text{m}^3$	$S_c$	solar constant
$\dot{N}_i''$	surface reaction rate of species $i$ , $\text{kmol/s} \cdot \text{m}^2$	$S_D, S_L, S_T$	diagonal, longitudinal, and transverse pitch of a tube bank, m
$n_i''$	mass flux of species $i$ relative to fixed coordinates, $\text{kg/s} \cdot \text{m}^2$	$Sc$	Schmidt number
$\dot{n}_i$	mass rate of increase of species $i$ per unit volume due to chemical reactions, $\text{kg/s} \cdot \text{m}^3$	$Sh$	Sherwood number
$P$	perimeter, m; general fluid property designation	$St$	Stanton number
$P_L, P_T$	dimensionless longitudinal and transverse pitch of a tube bank	$T$	temperature, K
		$t$	time, s
		$U$	overall heat transfer coefficient, $\text{W/m}^2 \cdot \text{K}$ ; internal energy, J
		$u, v, w$	mass average fluid velocity components, $\text{m/s}$
		$u^*, v^*, w^*$	molar average velocity components, $\text{m/s}$
		$V$	volume, $\text{m}^3$ ; fluid velocity, $\text{m/s}$
		$v$	specific volume, $\text{m}^3/\text{kg}$
		$W$	width of a slot nozzle, m
		$\dot{W}$	rate at which work is performed, W
		$We$	Weber number
		$X$	vapor quality
		$X, Y, Z$	components of the body force per unit volume, $\text{N/m}^3$
		$x, y, z$	rectangular coordinates, m
		$x_c$	critical location for transition to turbulence, m
		$x_{fd,c}$	concentration entry length, m
		$x_{fd,h}$	hydrodynamic entry length, m
		$x_{fd,t}$	thermal entry length, m
		$x_i$	mole fraction of species $i$ , $C_i/C$

Greek Letters

$\alpha$	thermal diffusivity, $\text{m}^2/\text{s}$ ; heat exchanger surface area per unit volume, $\text{m}^2/\text{m}^3$ ; absorptivity
$\beta$	volumetric thermal expansion coefficient, $\text{K}^{-1}$
$\Gamma$	mass flow rate per unit width in film condensation, $\text{kg/s} \cdot \text{m}$
$\delta$	hydrodynamic boundary layer thickness, m
$\delta_c$	concentration boundary layer thickness, m
$\delta_p$	thermal penetration depth, m
$\delta_t$	thermal boundary layer thickness, m
$\varepsilon$	emissivity; porosity of a packed bed; heat exchanger effectiveness
$\varepsilon_f$	fin effectiveness
$\eta$	similarity variable
$\eta_f$	fin efficiency
$\eta_o$	overall efficiency of fin array
$\theta$	zenith angle, rad; temperature difference, K
$\kappa$	absorption coefficient, $\text{m}^{-1}$
$\lambda$	wavelength, $\mu\text{m}$
$\lambda_{\text{mfp}}$	mean free path length, nm
$\mu$	viscosity, $\text{kg/s} \cdot \text{m}$
$\nu$	kinematic viscosity, $\text{m}^2/\text{s}$ ; frequency of radiation, $\text{s}^{-1}$
$\rho$	mass density, $\text{kg/m}^3$ ; reflectivity
$\sigma$	Stefan-Boltzmann constant; electrical conductivity, $1/\Omega \cdot \text{m}$ ; normal viscous stress, $\text{N/m}^2$ ; surface tension, $\text{N/m}$ ; ratio of heat exchanger minimum cross-sectional area to frontal area
$\Phi$	viscous dissipation function, $\text{s}^{-2}$
$\phi$	azimuthal angle, rad
$\psi$	stream function, $\text{m}^2/\text{s}$
$\tau$	shear stress, $\text{N/m}^2$ ; transmissivity
$\omega$	solid angle, sr; perfusion rate, $\text{s}^{-1}$

Subscripts

A, B	species in a binary mixture
abs	absorbed
am	arithmetic mean
$b$	base of an extended surface; blackbody
$c$	cross-sectional; concentration; cold fluid
cr	critical insulation thickness
cond	conduction
conv	convection
CF	counterflow

$D$	diameter; drag
dif	diffusion
$e$	excess; emission; electron
evap	evaporation
$f$	fluid properties; fin conditions; saturated liquid conditions
fc	forced convection
fd	fully developed conditions
$g$	saturated vapor conditions
$H$	heat transfer conditions
$h$	hydrodynamic; hot fluid; helical
$i$	general species designation; inner surface of an annulus; initial condition; tube inlet condition; incident radiation
$L$	based on characteristic length
$l$	saturated liquid conditions
lat	latent energy
lm	log mean condition
$M$	momentum transfer condition
$m$	mean value over a tube cross section
max	maximum fluid velocity
mfp	mean free path
$o$	center or midplane condition; tube outlet condition; outer
ph	phonon
$R$	reradiating surface
$r, \text{ref}$	reflected radiation
rad	radiation
$S$	solar conditions
$s$	surface conditions; solid properties
sat	saturated conditions
sens	sensible energy
sky	sky conditions
ss	steady state
sur	surroundings
$t$	thermal
tr	transmitted
$v$	saturated vapor conditions
$x$	local conditions on a surface
$\lambda$	spectral
$\infty$	free stream conditions

Superscripts

'	fluctuating quantity
*	molar average; dimensionless quantity

Overbar


	surface average conditions; time mean
--	---------------------------------------





# *CHAPTER* **1**

## **Introduction**

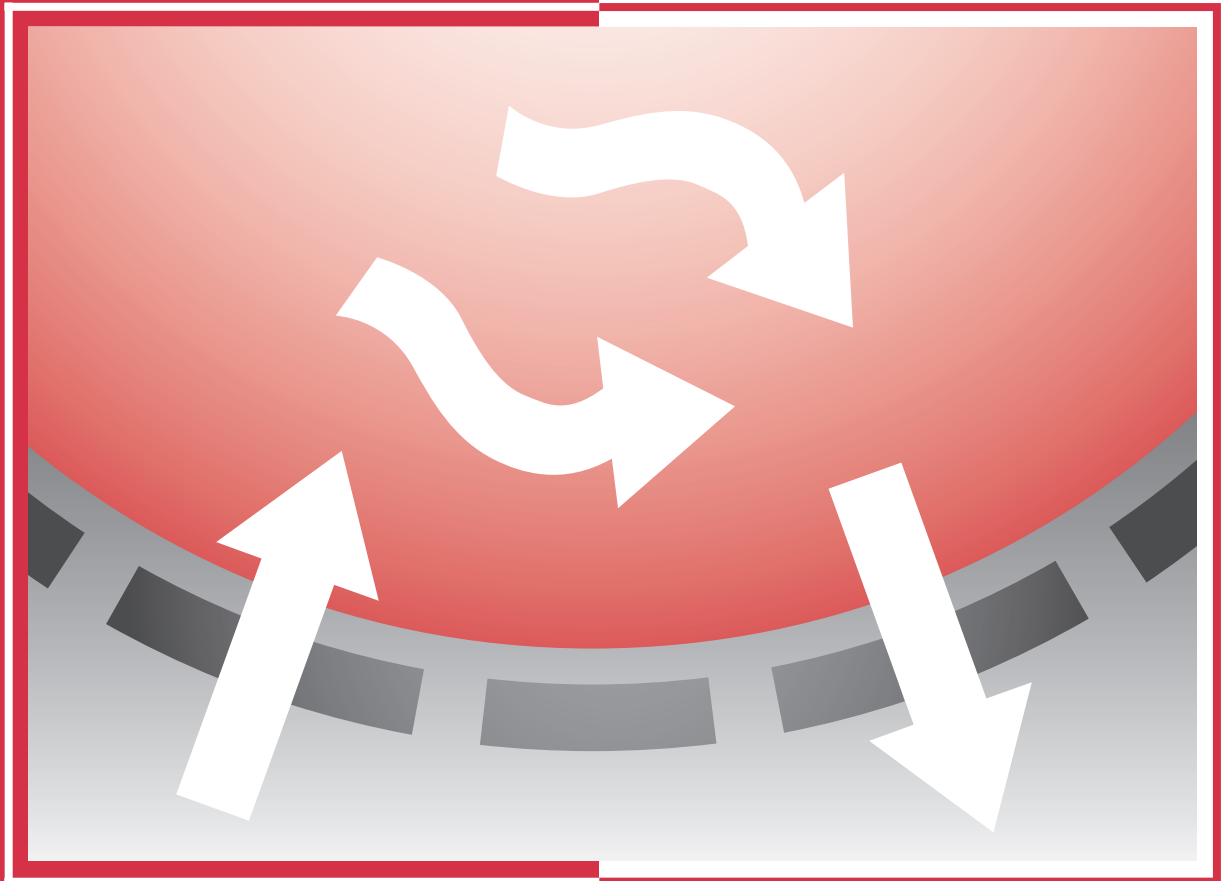

**F**rom the study of thermodynamics, you have learned that energy can be transferred by interactions of a system with its surroundings. These interactions are called work and heat. However, thermodynamics deals with the end states of the process during which an interaction occurs and provides no information concerning the nature of the interaction or the time rate at which it occurs. The objective of this text is to extend thermodynamic analysis through study of the *modes* of heat transfer and through development of relations to calculate heat transfer *rates*.

In this chapter we lay the foundation for much of the material treated in the text. We do so by raising several questions. *What is heat transfer? How is heat transferred? Why is it important?* One objective is to develop an appreciation for the fundamental concepts and principles that underlie heat transfer processes. A second objective is to illustrate the manner in which a knowledge of heat transfer may be used with the first law of thermodynamics (*conservation of energy*) to solve problems relevant to technology and society.

## 1.1


### What and How?

A simple, yet general, definition provides sufficient response to the question: What is heat transfer?

*Heat transfer (or heat) is thermal energy in transit due to a spatial temperature difference.*

Whenever there exists a temperature difference in a medium or between media, heat transfer must occur.

As shown in Figure 1.1, we refer to different types of heat transfer processes as *modes*. When a temperature gradient exists in a stationary medium, which may be a solid or a fluid, we use the term *conduction* to refer to the heat transfer that will occur across the medium. In contrast, the term *convection* refers to heat transfer that will occur between a surface and a moving fluid when they are at different

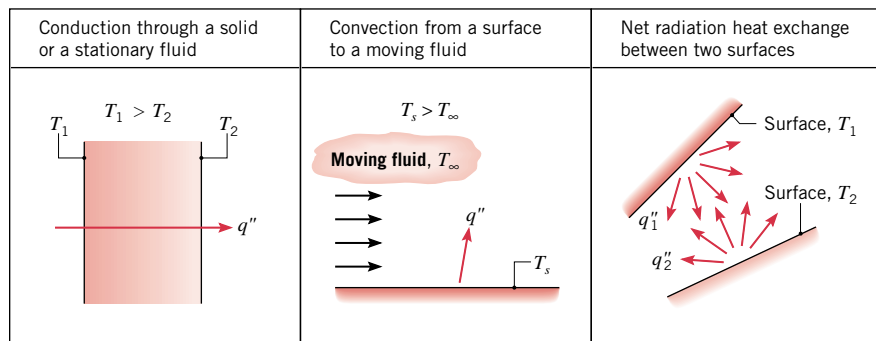

**FIGURE 1.1** Conduction, convection, and radiation heat transfer modes.

temperatures. The third mode of heat transfer is termed *thermal radiation*. All surfaces of finite temperature emit energy in the form of electromagnetic waves. Hence, in the absence of an intervening medium, there is net heat transfer by radiation between two surfaces at different temperatures.

## 1.2


### Physical Origins and Rate Equations

As engineers it is important that we understand the *physical mechanisms* which underlie the heat transfer modes and that we be able to use the rate equations that quantify the amount of energy being transferred per unit time.

#### 1.2.1 Conduction

At mention of the word *conduction*, we should immediately conjure up concepts of *atomic* and *molecular activity*, for it is processes at these levels that sustain this mode of heat transfer. Conduction may be viewed as the transfer of energy from the more energetic to the less energetic particles of a substance due to interactions between the particles.

The physical mechanism of conduction is most easily explained by considering a gas and using ideas familiar from your thermodynamics background. Consider a gas in which there exists a temperature gradient and assume that there is *no bulk, or macroscopic, motion*. The gas may occupy the space between two surfaces that are maintained at different temperatures, as shown in Figure 1.2. We associate the temperature at any point with the energy of gas molecules in proximity to the point. This energy is related to the random translational motion, as well as to the internal rotational and vibrational motions, of the molecules.

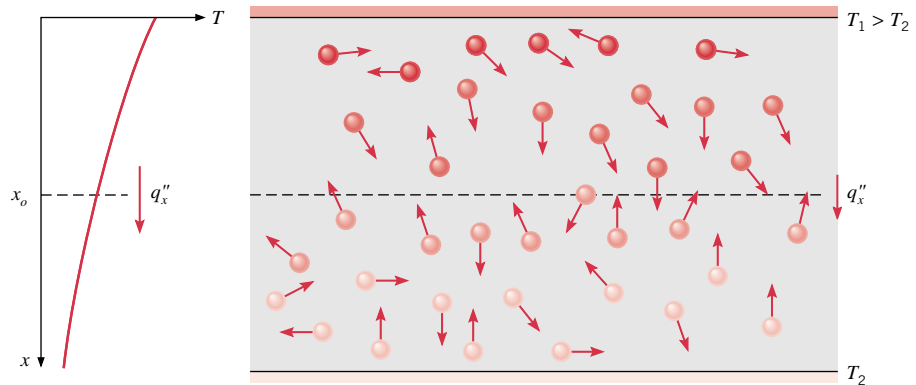


**FIGURE 1.2** Association of conduction heat transfer with diffusion of energy due to molecular activity.

Higher temperatures are associated with higher molecular energies, and when neighboring molecules collide, as they are constantly doing, a transfer of energy from the more energetic to the less energetic molecules must occur. In the presence of a temperature gradient, energy transfer by conduction must then occur in the direction of decreasing temperature. This would even be true in the absence of collisions, as is evident from Figure 1.2. The hypothetical plane at  $x_o$  is constantly being crossed by molecules from above and below due to their *random* motion. However, molecules from above are associated with a larger temperature than those from below, in which case there must be a *net* transfer of energy in the positive  $x$  direction. Collisions between molecules enhance this energy transfer. We may speak of the net transfer of energy by random molecular motion as a *diffusion* of energy.

The situation is much the same in liquids, although the molecules are more closely spaced and the molecular interactions are stronger and more frequent. Similarly, in a solid, conduction may be attributed to atomic activity in the form of lattice vibrations. The modern view is to ascribe the energy transfer to *lattice waves* induced by atomic motion. In an electrical nonconductor, the energy transfer is exclusively via these lattice waves; in a conductor it is also due to the translational motion of the free electrons. We treat the important properties associated with conduction phenomena in Chapter 2 and in Appendix A.

Examples of conduction heat transfer are legion. The exposed end of a metal spoon suddenly immersed in a cup of hot coffee will eventually be warmed due to the conduction of energy through the spoon. On a winter day there is significant energy loss from a heated room to the outside air. This loss is principally due to conduction heat transfer through the wall that separates the room air from the outside air.

It is possible to quantify heat transfer processes in terms of appropriate *rate equations*. These equations may be used to compute the amount of energy being transferred per unit time. For heat conduction, the rate equation is known as *Fourier's law*. For the one-dimensional plane wall shown in Figure 1.3, having a temperature distribution  $T(x)$ , the rate equation is expressed as



**FIGURE 1.3**  
One-dimensional heat transfer by conduction (diffusion of energy).

$$q_x'' = -k \frac{dT}{dx} \quad (1.1)$$

The *heat flux*  $q_x''$  ( $\text{W}/\text{m}^2$ ) is the heat transfer rate in the  $x$  direction *per unit area perpendicular* to the direction of transfer, and it is proportional to the *temperature gradient*,  $dT/dx$ , in this direction. The parameter  $k$  is a *transport* property known as the *thermal conductivity* ( $\text{W}/\text{m} \cdot \text{K}$ ) and is a characteristic of the wall material. The minus sign is a consequence of the fact that heat is transferred in the direction of decreasing temperature. Under the *steady-state conditions* shown in Figure 1.3, where the temperature distribution is *linear*, the temperature gradient may be expressed as

$$\frac{dT}{dx} = \frac{T_2 - T_1}{L}$$

and the heat flux is then

$$q_x'' = -k \frac{T_2 - T_1}{L}$$

or

$$q_x'' = k \frac{T_1 - T_2}{L} = k \frac{\Delta T}{L} \quad (1.2)$$

Note that this equation provides a *heat flux*, that is, the rate of heat transfer per *unit area*. The *heat rate* by conduction,  $q_x$  (W), through a plane wall of area  $A$  is then the product of the flux and the area,  $q_x = q_x'' \cdot A$ .

### EXAMPLE 1.1


The wall of an industrial furnace is constructed from 0.15-m-thick fireclay brick having a thermal conductivity of  $1.7 \text{ W/m} \cdot \text{K}$ . Measurements made during steady-state operation reveal temperatures of 1400 and 1150 K at the inner and outer surfaces, respectively. What is the rate of heat loss through a wall that is 0.5 m by 1.2 m on a side?

### SOLUTION

**Known:** Steady-state conditions with prescribed wall thickness, area, thermal conductivity, and surface temperatures.

**Find:** Wall heat loss.

**Schematic:**

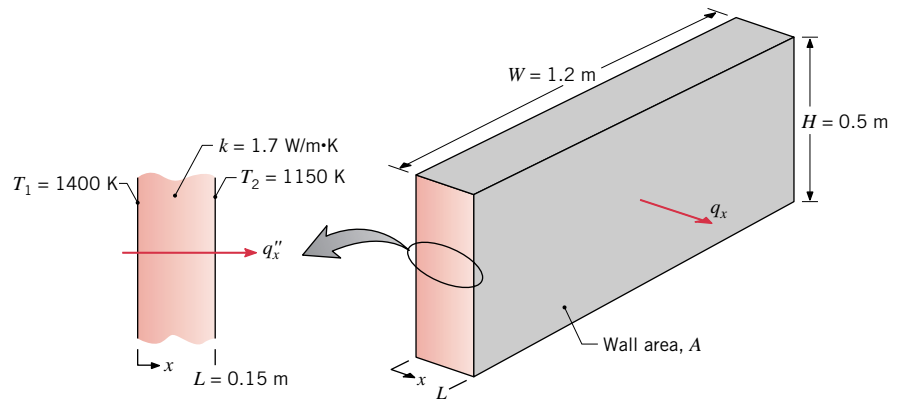

**Assumptions:**

1. Steady-state conditions.
2. One-dimensional conduction through the wall.
3. Constant thermal conductivity.

**Analysis:** Since heat transfer through the wall is by conduction, the heat flux may be determined from Fourier's law. Using Equation 1.2, we have

$$q_x'' = k \frac{\Delta T}{L} = 1.7 \text{ W/m} \cdot \text{K} \times \frac{250 \text{ K}}{0.15 \text{ m}} = 2833 \text{ W/m}^2$$

The heat flux represents the rate of heat transfer through a section of unit area, and it is uniform (invariant) across the surface of the wall. The heat loss through the wall of area  $A = H \times W$  is then

$$q_x = (HW) q_x'' = (0.5 \text{ m} \times 1.2 \text{ m}) 2833 \text{ W/m}^2 = 1700 \text{ W} \quad \triangleleft$$


**Comments:** Note the direction of heat flow and the distinction between heat flux and heat rate.

### 1.2.2 Convection

The convection heat transfer *mode* is comprised of *two mechanisms*. In addition to energy transfer due to *random molecular motion (diffusion)*, energy is also transferred by the *bulk, or macroscopic, motion* of the fluid. This fluid motion is associated with the fact that, at any instant, large numbers of molecules are moving collectively or as aggregates. Such motion, in the presence of a temperature gradient, contributes to heat transfer. Because the molecules in the aggregate retain their random motion, the total heat transfer is then due to a superposition of energy transport by the random motion of the molecules and by the bulk motion of the fluid. It is customary to use the term *convection* when referring to this cumulative transport and the term *advection* when referring to transport due to bulk fluid motion.

We are especially interested in convection heat transfer, which occurs between a fluid in motion and a bounding surface when the two are at different temperatures. Consider fluid flow over the heated surface of Figure 1.4. A consequence of the fluid–surface interaction is the development of a region in the fluid through which the velocity varies from zero at the surface to a finite value  $u_\infty$  associated with the flow. This region of the fluid is known as the *hydrodynamic, or velocity, boundary layer*. Moreover, if the surface and flow temperatures differ, there will be a region of the fluid through which the temperature varies from  $T_s$  at  $y = 0$  to  $T_\infty$  in the outer flow. This region, called the *thermal boundary layer*, may be smaller, larger, or the same size as that through which the velocity varies. In any case, if  $T_s > T_\infty$ , convection heat transfer will occur from the surface to the outer flow.

The convection heat transfer mode is sustained both by random molecular motion and by the bulk motion of the fluid within the boundary layer. The contribution due to random molecular motion (diffusion) dominates near the surface where the

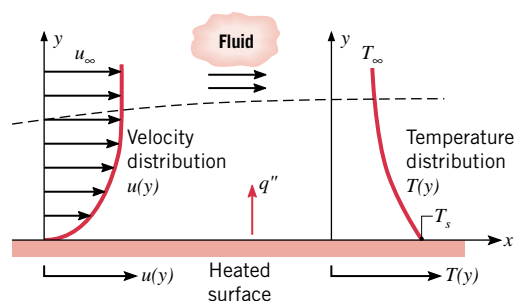


**FIGURE 1.4**  
Boundary layer development in convection heat transfer.

fluid velocity is low. In fact, at the interface between the surface and the fluid ( $y = 0$ ), the fluid velocity is zero and heat is transferred by this mechanism only. The contribution due to bulk fluid motion originates from the fact that the boundary layer *grows* as the flow progresses in the  $x$  direction. In effect, the heat that is conducted into this layer is swept downstream and is eventually transferred to the fluid outside the boundary layer. Appreciation of boundary layer phenomena is essential to understanding convection heat transfer. It is for this reason that the discipline of fluid mechanics will play a vital role in our later analysis of convection.

Convection heat transfer may be classified according to the nature of the flow. We speak of *forced convection* when the flow is caused by external means, such as by a fan, a pump, or atmospheric winds. As an example, consider the use of a fan to provide forced convection air cooling of hot electrical components on a stack of printed circuit boards (Figure 1.5a). In contrast, for *free* (or *natural*) *convection* the flow is induced by buoyancy forces, which are due to density differences caused by temperature variations in the fluid. An example is the free convection heat transfer that occurs from hot components on a vertical array of circuit boards in air (Figure 1.5b). Air that makes contact with the components experiences an increase in temperature and hence a reduction in density. Since it is now lighter than the surrounding air, buoyancy forces induce a vertical motion for which warm air ascending from the boards is replaced by an inflow of cooler ambient air.

While we have presumed *pure* forced convection in Figure 1.5a and *pure* natural convection in Figure 1.5b, conditions corresponding to *mixed* (combined) *forced* and *natural convection* may exist. For example, if velocities associated with

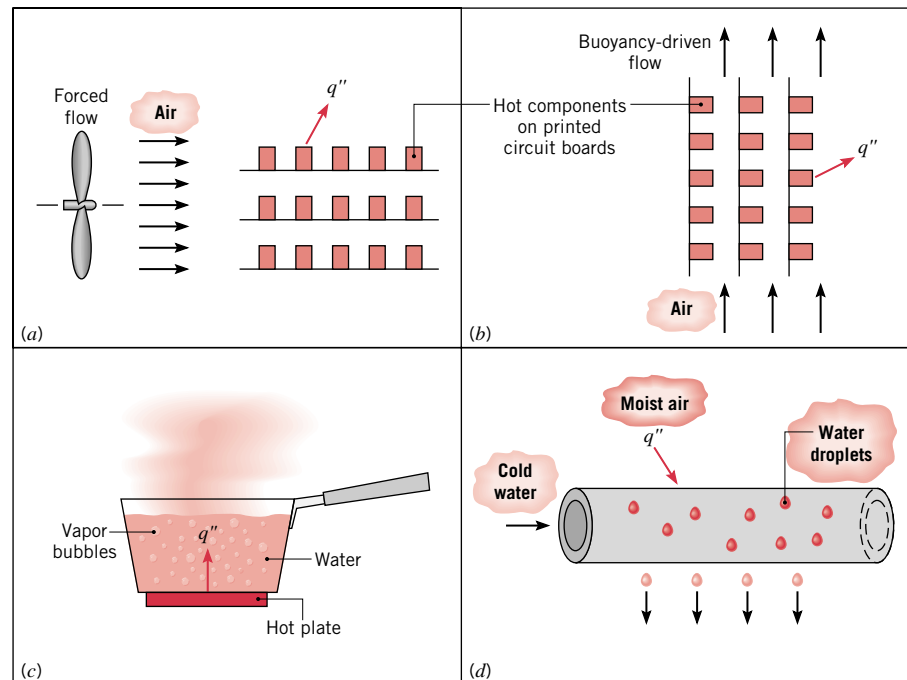

**FIGURE 1.5** Convection heat transfer processes. (a) Forced convection. (b) Natural convection. (c) Boiling. (d) Condensation.



the flow of Figure 1.5a are small and/or buoyancy forces are large, a secondary flow that is comparable to the imposed forced flow could be induced. In this case, the buoyancy-induced flow would be normal to the forced flow and could have a significant effect on convection heat transfer from the components. In Figure 1.5b, mixed convection would result if a fan were used to force air upward between the circuit boards, thereby assisting the buoyancy flow, or downward, thereby opposing the buoyancy flow.

We have described the convection heat transfer mode as energy transfer occurring within a fluid due to the combined effects of conduction and bulk fluid motion. Typically, the energy that is being transferred is the *sensible*, or internal thermal, energy of the fluid. However, there are convection processes for which there is, in addition, *latent* heat exchange. This latent heat exchange is generally associated with a phase change between the liquid and vapor states of the fluid. Two special cases of interest in this text are *boiling* and *condensation*. For example, convection heat transfer results from fluid motion induced by vapor bubbles generated at the bottom of a pan of boiling water (Figure 1.5c) or by the condensation of water vapor on the outer surface of a cold water pipe (Figure 1.5d).

Regardless of the particular nature of the convection heat transfer process, the appropriate rate equation is of the form

$$q'' = h(T_s - T_\infty) \quad (1.3a)$$

where  $q''$ , the convective *heat flux* ( $\text{W}/\text{m}^2$ ), is proportional to the difference between the surface and fluid temperatures,  $T_s$  and  $T_\infty$ , respectively. This expression is known as *Newton's law of cooling*, and the parameter  $h$  ( $\text{W}/\text{m}^2 \cdot \text{K}$ ) is termed the *convection heat transfer coefficient*. It depends on conditions in the boundary layer, which are influenced by surface geometry, the nature of the fluid motion, and an assortment of fluid thermodynamic and transport properties.

Any study of convection ultimately reduces to a study of the means by which  $h$  may be determined. Although consideration of these means is deferred to Chapter 6, convection heat transfer will frequently appear as a boundary condition in the solution of conduction problems (Chapters 2 through 5). In the solution of such problems we presume  $h$  to be known, using typical values given in Table 1.1.

**TABLE 1.1** Typical values of the convection heat transfer coefficient

Process	$h$ ( $\text{W}/\text{m}^2 \cdot \text{K}$ )
Free convection	
Gases	2–25
Liquids	50–1000
Forced convection	
Gases	25–250
Liquids	100–20,000
Convection with phase change	
Boiling or condensation	2500–100,000

When Equation 1.3a is used, the convection heat flux is presumed to be *positive* if heat is transferred *from* the surface ( $T_s > T_\infty$ ) and *negative* if heat is transferred *to* the surface ( $T_\infty > T_s$ ). However, if  $T_\infty > T_s$ , there is nothing to preclude us from expressing Newton's law of cooling as

$$q'' = h(T_\infty - T_s) \quad (1.3b)$$

in which case heat transfer is positive if it is to the surface.

### 1.2.3 Radiation

Thermal radiation is energy *emitted* by matter that is at a nonzero temperature. Although we will focus on radiation from solid surfaces, emission may also occur from liquids and gases. Regardless of the form of matter, the emission may be attributed to changes in the electron configurations of the constituent atoms or molecules. The energy of the radiation field is transported by electromagnetic waves (or alternatively, photons). While the transfer of energy by conduction or convection requires the presence of a material medium, radiation does not. In fact, radiation transfer occurs most efficiently in a vacuum.


Consider radiation transfer processes for the surface of Figure 1.6a. Radiation that is *emitted* by the surface originates from the thermal energy of matter bounded by the surface, and the rate at which energy is released per unit area ( $\text{W}/\text{m}^2$ ) is termed the surface *emissive power*  $E$ . There is an upper limit to the emissive power, which is prescribed by the *Stefan–Boltzmann law*

$$E_b = \sigma T_s^4 \quad (1.4)$$

where  $T_s$  is the *absolute temperature* (K) of the surface and  $\sigma$  is the *Stefan–Boltzmann constant* ( $\sigma = 5.67 \times 10^{-8} \text{ W}/\text{m}^2 \cdot \text{K}^4$ ). Such a surface is called an ideal radiator or *blackbody*.

The heat flux emitted by a real surface is less than that of a blackbody at the same temperature and is given by

$$E = \varepsilon \sigma T_s^4 \quad (1.5)$$

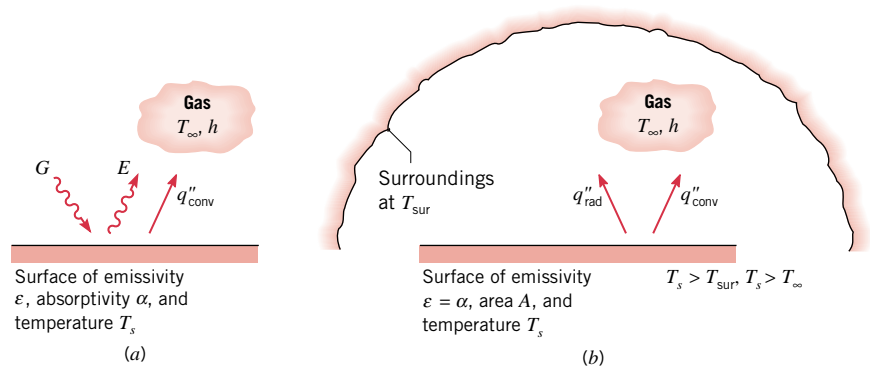

**FIGURE 1.6** Radiation exchange: (a) at a surface and (b) between a surface and large surroundings.

where  $\varepsilon$  is a radiative property of the surface termed the *emissivity*. With values in the range  $0 \leq \varepsilon \leq 1$ , this property provides a measure of how efficiently a surface emits energy relative to a blackbody. It depends strongly on the surface material and finish, and representative values are provided in Appendix A.

Radiation may also be *incident* on a surface from its surroundings. The radiation may originate from a special source, such as the sun, or from other surfaces to which the surface of interest is exposed. Irrespective of the source(s), we designate the rate at which all such radiation is incident on a unit area of the surface as the *irradiation*  $G$  (Figure 1.6a).

A portion, or all, of the irradiation may be *absorbed* by the surface, thereby increasing the thermal energy of the material. The rate at which radiant energy is absorbed per unit surface area may be evaluated from knowledge of a surface radiative property termed the *absorptivity*  $\alpha$ . That is,

$$G_{\text{abs}} = \alpha G \quad (1.6)$$

where  $0 \leq \alpha \leq 1$ . If  $\alpha < 1$  and the surface is *opaque*, portions of the irradiation are *reflected*. If the surface is *semitransparent*, portions of the irradiation may also be *transmitted*. However, while absorbed and emitted radiation increase and reduce, respectively, the thermal energy of matter, reflected and transmitted radiation have no effect on this energy. Note that the value of  $\alpha$  depends on the nature of the irradiation, as well as on the surface itself. For example, the absorptivity of a surface to solar radiation may differ from its absorptivity to radiation emitted by the walls of a furnace.

In many engineering problems (a notable exception being problems involving solar radiation or radiation from other very high temperature sources), liquids can be considered opaque, and gases can be considered transparent, to radiation heat transfer. Solids can be opaque (as is the case for metals) or *semitransparent* (as is the case for thin sheets of some polymers and some semiconducting materials).

A special case that occurs frequently involves radiation exchange between a small surface at  $T_s$  and a much larger, isothermal surface that completely surrounds the smaller one (Figure 1.6b). The *surroundings* could, for example, be the walls of a room or a furnace whose temperature  $T_{\text{sur}}$  differs from that of an enclosed surface ( $T_{\text{sur}} \neq T_s$ ). We will show in Chapter 12 that, for such a condition, the irradiation may be approximated by emission from a blackbody at  $T_{\text{sur}}$ , in which case  $G = \sigma T_{\text{sur}}^4$ . If the surface is assumed to be one for which  $\alpha = \varepsilon$  (a *gray surface*), the *net* rate of radiation heat transfer *from* the surface, expressed per unit area of the surface, is

$$q''_{\text{rad}} = \frac{q}{A} = \varepsilon E_b(T_s) - \alpha G = \varepsilon \sigma (T_s^4 - T_{\text{sur}}^4) \quad (1.7)$$

This expression provides the difference between thermal energy that is released due to radiation emission and that which is gained due to radiation absorption.

There are many applications for which it is convenient to express the net radiation heat exchange in the form

$$q_{\text{rad}} = h_r A (T_s - T_{\text{sur}}) \quad (1.8)$$

where, from Equation 1.7, the *radiation heat transfer coefficient*  $h_r$  is

$$h_r \equiv \varepsilon \sigma (T_s + T_{\text{sur}})(T_s^2 + T_{\text{sur}}^2) \quad (1.9)$$

Here we have modeled the radiation mode in a manner similar to convection. In this sense we have *linearized* the radiation rate equation, making the heat rate proportional

to a temperature difference rather than to the difference between two temperatures to the fourth power. Note, however, that  $h_r$  depends strongly on temperature, while the temperature dependence of the convection heat transfer coefficient  $h$  is generally weak.

The surfaces of Figure 1.6 may also simultaneously transfer heat by convection to an adjoining gas. For the conditions of Figure 1.6b, the total rate of heat transfer from the surface is then

$$q = q_{\text{conv}} + q_{\text{rad}} = hA(T_s - T_\infty) + \varepsilon A \sigma (T_s^4 - T_{\text{sur}}^4) \quad (1.10)$$

### EXAMPLE 1.2

An uninsulated steam pipe passes through a room in which the air and walls are at 25°C. The outside diameter of the pipe is 70 mm, and its surface temperature and emissivity are 200°C and 0.8, respectively. What are the surface emissive power and irradiation? If the coefficient associated with free convection heat transfer from the surface to the air is 15 W/m<sup>2</sup> · K, what is the rate of heat loss from the surface per unit length of pipe?


### SOLUTION

**Known:** Uninsulated pipe of prescribed diameter, emissivity, and surface temperature in a room with fixed wall and air temperatures.

**Find:**

1. Surface emissive power and irradiation.
2. Pipe heat loss per unit length,  $q'$ .

**Schematic:**

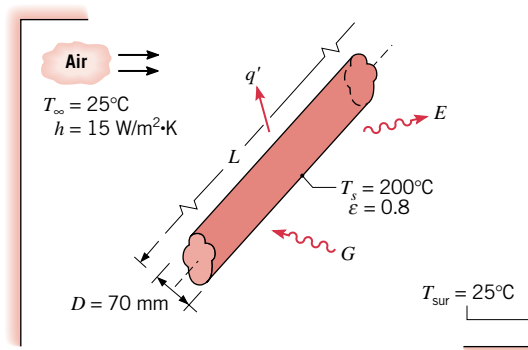

**Assumptions:**

1. Steady-state conditions.
2. Radiation exchange between the pipe and the room is between a small surface and a much larger enclosure.
3. The surface emissivity and absorptivity are equal.

**Analysis:**

1. The surface emissive power may be evaluated from Equation 1.5, while the irradiation corresponds to  $G = \sigma T_{\text{sur}}^4$ . Hence

$$E = \varepsilon \sigma T_s^4 = 0.8(5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4)(473 \text{ K})^4 = 2270 \text{ W/m}^2$$

$$G = \sigma T_{\text{sur}}^4 = 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (298 \text{ K})^4 = 447 \text{ W/m}^2$$

2. Heat loss from the pipe is by convection to the room air and by radiation exchange with the walls. Hence,  $q = q_{\text{conv}} + q_{\text{rad}}$  and from Equation 1.10, with  $A = \pi DL$ ,

$$q = h(\pi DL)(T_s - T_\infty) + \varepsilon(\pi DL)\sigma(T_s^4 - T_{\text{sur}}^4)$$

The heat loss per unit length of pipe is then

$$\begin{aligned} q' = \frac{q}{L} &= 15 \text{ W/m}^2 \cdot \text{K}(\pi \times 0.07 \text{ m})(200 - 25)^\circ\text{C} \\ &\quad + 0.8(\pi \times 0.07 \text{ m}) 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (473^4 - 298^4) \text{ K}^4 \\ q' &= 577 \text{ W/m} + 421 \text{ W/m} = 998 \text{ W/m} \end{aligned}$$

**Comments:**

1. Note that temperature may be expressed in units of  $^\circ\text{C}$  or K when evaluating the temperature difference for a convection (or conduction) heat transfer rate. However, temperature must be expressed in kelvins (K) when evaluating a radiation transfer rate.
2. The net rate of radiation heat transfer from the pipe may be expressed as

$$q'_{\text{rad}} = \pi D (E - \alpha G)$$

$$q'_{\text{rad}} = \pi \times 0.07 \text{ m} (2270 - 0.8 \times 447) \text{ W/m}^2 = 421 \text{ W/m}$$

3. In this situation the radiation and convection heat transfer rates are comparable because  $T_s$  is large compared to  $T_{\text{sur}}$  and the coefficient associated with free convection is small. For more moderate values of  $T_s$  and the larger values of  $h$  associated with forced convection, the effect of radiation may often be neglected. The radiation heat transfer coefficient may be computed from Equation 1.9, and for the conditions of this problem its value is  $h_r = 11 \text{ W/m}^2 \cdot \text{K}$ .
4. This example is provided as a tutorial session in the Interactive Heat Transfer (IHT) software accompanying your text.

**1.2.4 Relationship to Thermodynamics**

At this point it is appropriate to note the fundamental differences between heat transfer and thermodynamics. Although thermodynamics is concerned with the heat interaction and the vital role it plays in the first and second laws, it considers neither the mechanisms that provide for heat exchange nor the methods that exist for computing the *rate* of heat exchange. Thermodynamics is concerned with *equilibrium* states of matter, where an equilibrium state necessarily precludes the existence of a temperature gradient. Although thermodynamics may be used to determine the amount

of energy required in the form of heat for a system to pass from one equilibrium state to another, it does not acknowledge that *heat transfer is inherently a nonequilibrium process*. For heat transfer to occur, there must be a temperature gradient and, hence, thermodynamic nonequilibrium. The discipline of heat transfer therefore seeks to do what thermodynamics is inherently unable to do, namely, to quantify the *rate* at which heat transfer occurs in terms of the degree of thermal nonequilibrium. This is done through the rate equations for the three modes, expressed, for example, by Equations 1.2, 1.3, and 1.7.

## 1.3

### The Conservation of Energy Requirement


The subjects of thermodynamics and heat transfer are highly complementary. For example, because it treats the *rate* at which heat is transferred, the subject of heat transfer may be viewed as an extension of thermodynamics. Conversely, for many heat transfer problems, the *first law* of thermodynamics (the *law of conservation of energy*) provides a useful, often essential, tool. In anticipation of such problems, general formulations of the first law are now obtained.

#### 1.3.1 Conservation of Energy for a Control Volume

At its heart, the first law of thermodynamics is simply a statement that the total energy of a system is conserved, and therefore the only way that the amount of energy in a system can change is if energy crosses its boundaries. The first law also addresses the ways in which energy can cross the boundaries of a system. For a closed system (a region of fixed mass), there are only two: heat transfer through the boundaries and work done on or by the system. This leads to the following statement of the first law for a closed system, which will be familiar if you have taken a course in thermodynamics:

$$\Delta E_{\text{st}}^{\text{tot}} = Q - W \quad (1.11a)$$

where  $\Delta E_{\text{st}}^{\text{tot}}$  is the change in the total energy stored in the system,  $Q$  is the *net* heat transferred to the system, and  $W$  is the *net* work done by the system. This is schematically illustrated in Figure 1.7a.

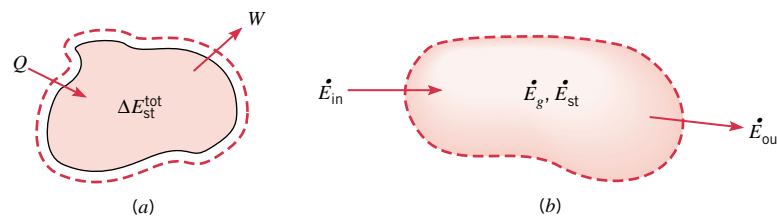

**FIGURE 1.7** Conservation of energy: (a) for a closed system over a time interval, and (b) for a control volume at an instant.

The first law can also be applied to a *control volume* (or *open system*), a region of space bounded by a *control surface* through which mass may pass. Mass entering and leaving the control volume carries energy with it; this process, termed energy advection, adds a third way in which energy can cross the boundaries of a control volume. To summarize, the first law of thermodynamics can be very simply stated as follows for both a control volume and a closed system.

### First Law of Thermodynamics over a Time Interval ( $\Delta t$ )

*The increase in the amount of energy stored in a control volume must equal the amount of energy that enters the control volume, minus the amount of energy that leaves the control volume.*

In applying this principle, it is recognized that energy can enter and leave the control volume due to heat transfer through the boundaries, work done on or by the control volume, and energy advection.

The first law of thermodynamics addresses *total* energy, which consists of kinetic and potential energies (together known as mechanical energy) and internal energy. Internal energy can be further subdivided into thermal energy (which will be defined more carefully later) and other forms of internal energy such as chemical and nuclear energy. For the study of heat transfer, we wish to focus attention on the thermal and mechanical forms of energy. We must recognize that the sum of thermal and mechanical energy is *not* conserved, because there can be conversion between other forms of energy and thermal energy. For example, if a chemical reaction occurs that decreases the amount of chemical energy in the system, it will result in an increase in the thermal energy of the system. Thus, we can think of energy conversion as resulting in *thermal energy generation* (which can be either positive or negative). So, a statement of the first law that is well suited for heat transfer analysis is:

### Thermal and Mechanical Energy Equation over a Time Interval ( $\Delta t$ )

*The increase in the amount of thermal and mechanical energy stored in the control volume must equal the amount of thermal and mechanical energy that enters the control volume, minus the amount of thermal and mechanical energy that leaves the control volume, plus the amount of thermal energy that is generated within the control volume.*

This expression applies over a *time interval*  $\Delta t$ , and all the energy terms are measured in joules. Since the first law must be satisfied at each and every *instant* of time  $t$ , we can also formulate the law on a *rate basis*. That is, at any instant, there must be a balance between all *energy rates*, as measured in joules per second (W). In words, this is expressed as:

### Thermal and Mechanical Energy Equation at an Instant ( $t$ )

*The rate of increase of thermal and mechanical energy stored in the control volume must equal the rate at which thermal and mechanical energy enter the control volume, minus the rate at which thermal and mechanical energy leave the control volume, plus the rate at which thermal energy is generated within the control volume.*

If the inflow and generation of thermal and mechanical energy exceed the outflow, there must be an increase in the amount of thermal and mechanical energy stored

(accumulated) in the control volume; if the converse is true, there will be a decrease in thermal and mechanical energy storage. If the inflow and generation equal the outflow, a *steady-state* condition must prevail such that there will be no change in the amount of thermal and mechanical energy stored in the control volume.

We will now define symbols for each of the energy terms so that the boxed statements can be rewritten as equations. We let  $E$  stand for the sum of thermal and mechanical energy (in contrast to the symbol  $E^{\text{tot}}$  for total energy). Using the subscript  $\text{st}$  to denote energy stored in the control volume, the change in thermal and mechanical energy stored over the time interval  $\Delta t$  is then  $\Delta E_{\text{st}}$ . The subscripts *in* and *out* refer to energy entering and leaving the control volume. Finally, thermal energy generation is given the symbol  $E_g$ . Thus, the first boxed statement can be written as:

$$\Delta E_{\text{st}} = E_{\text{in}} - E_{\text{out}} + E_g \quad (1.11b)$$

Next, using a dot over a term to indicate a rate, the second boxed statement becomes:

$$\dot{E}_{\text{st}} \equiv \frac{dE_{\text{st}}}{dt} = \dot{E}_{\text{in}} - \dot{E}_{\text{out}} + \dot{E}_g \quad (1.11c)$$

This expression is illustrated schematically in Figure 1.7b.

Equations 1.11b,c provide important and, in some cases, essential tools for solving heat transfer problems. Every application of the first law must begin with the identification of an appropriate control volume and its control surface, to which an analysis is subsequently applied. The first step is to indicate the control surface by drawing a dashed line. The second step is to decide whether to perform the analysis for a time interval  $\Delta t$  (Equation 1.11b) or on a rate basis (Equation 1.11c). This choice depends on the objective of the solution and the way in which information is given in the problem. The next step is to identify the energy terms that are relevant in the problem you are solving. To develop your confidence in taking this last step, the remainder of this section is devoted to clarifying the following energy terms:

- Stored thermal and mechanical energy,  $E_{\text{st}}$ .
- Thermal energy generation,  $E_g$ .
- Thermal and mechanical energy transport across the control surfaces, that is, the inflow and outflow terms,  $E_{\text{in}}$  and  $E_{\text{out}}$ .

In the statement of the first law (Equation 1.11a), the total energy,  $E^{\text{tot}}$ , consists of kinetic energy ( $\text{KE} = \frac{1}{2}mV^2$ , where  $m$  and  $V$  are mass and velocity, respectively), potential energy ( $\text{PE} = mgz$ , where  $g$  is the gravitational acceleration and  $z$  is the vertical coordinate), and *internal energy* ( $U$ ). Mechanical energy is defined as the sum of kinetic and potential energy. It will most often be the case in heat transfer problems that the changes in kinetic and potential energy are small and can be neglected. The internal energy consists of a *sensible component*, which accounts for the translational, rotational, and/or vibrational motion of the atoms/molecules comprising the matter; a *latent component*, which relates to intermolecular forces influencing phase change between solid, liquid, and vapor states; a *chemical component*, which accounts for energy stored in the chemical bonds between atoms; and a *nuclear component*, which accounts for the binding forces in the nucleus.




For the study of heat transfer, we focus attention on the sensible and latent components of the internal energy ( $U_{\text{sens}}$  and  $U_{\text{lat}}$ , respectively), which are together referred to as *thermal energy*,  $U_t$ . The sensible energy is the portion that we associate mainly with changes in temperature (although it can also depend on pressure). The latent energy is the component we associate with changes in phase. For example, if the material in the control volume changes from solid to liquid (*melting*) or from liquid to vapor (*vaporization*, *evaporation*, *boiling*), the latent energy increases. Conversely, if the phase change is from vapor to liquid (*condensation*) or from liquid to solid (*solidification*, *freezing*), the latent energy decreases. Obviously, if there is no phase change occurring, there is no change in latent energy, and this term can be neglected.

Based on the above discussion, the *stored thermal and mechanical energy* is given by  $E_{\text{st}} = \text{KE} + \text{PE} + U_t$ , where  $U_t = U_{\text{sens}} + U_{\text{lat}}$ . In many problems, the only relevant energy term will be the sensible energy, that is,  $E_{\text{st}} = U_{\text{sens}}$ .

The *energy generation term* is associated with conversion from some other form of internal energy (chemical, electrical, electromagnetic, or nuclear) to thermal energy. It is a *volumetric phenomenon*. That is, it occurs within the control volume and is generally proportional to the magnitude of this volume. For example, an exothermic chemical reaction may be occurring, converting chemical energy to thermal energy. The net effect is an increase in the thermal energy of the matter within the control volume. Another source of thermal energy is the conversion from electrical energy that occurs due to resistance heating when an electric current is passed through a conductor. That is, if an electric current  $I$  passes through a resistance  $R$  in the control volume, electrical energy is dissipated at a rate  $I^2R$ , which corresponds to the rate at which thermal energy is generated (released) within the volume. In all applications of interest in this text, if chemical, electrical, or nuclear effects exist, they are treated as sources (or *sinks*, which correspond to negative sources) of thermal energy and hence are included in the generation terms of Equations 1.11b,c.

The inflow and outflow terms are *surface phenomena*. That is, they are associated exclusively with processes occurring at the control surface and are generally proportional to the surface area. As discussed previously, the energy inflow and outflow terms include heat transfer (which can be by conduction, convection, and/or radiation) and work interactions occurring at the system boundaries (e.g., due to displacement of a boundary, a rotating shaft, and/or electromagnetic effects). For cases in which mass crosses the control volume boundary (e.g., for situations involving fluid flow), the inflow and outflow terms also include energy (thermal and mechanical) advected (carried) by mass entering and leaving the control volume. For instance, if the mass flow rate entering through the boundary is  $\dot{m}$ , then the rate at which thermal and mechanical energy enters with the flow is  $\dot{m}(u_t + \frac{1}{2}V^2 + gz)$ , where  $u_t$  is the thermal energy per unit mass.

When the first law is applied to a control volume with fluid crossing its boundary, it is customary to divide the work term into two contributions. The first contribution, termed *flow work*, is associated with work done by pressure forces moving fluid through the boundary. For a *unit mass*, the amount of work is equivalent to the product of the pressure and the specific volume of the fluid ( $pv$ ). The symbol  $\dot{W}$  is traditionally used for the *remainder* of the work term (not including flow work). If operation is under steady-state conditions ( $dE_{\text{st}}/dt = 0$ ) and there is no thermal energy generation, Equation 1.11c reduces to the following form of the steady-flow

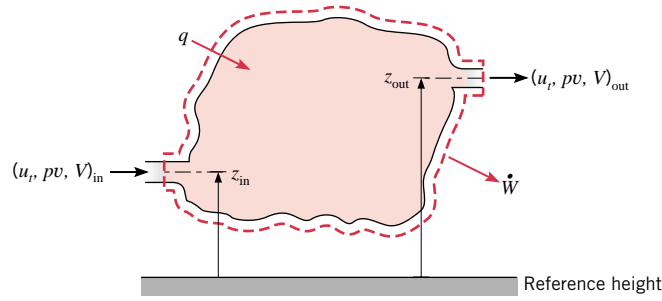

**FIGURE 1.8** Conservation of energy for a steady-flow, open system.

energy equation (see Figure 1.8) which will be familiar if you have taken a thermodynamics course:

$$\dot{m} (u_t + pv + \frac{1}{2} V^2 + gz)_{in} - \dot{m} (u_t + pv + \frac{1}{2} V^2 + gz)_{out} + q - \dot{W} = 0 \quad (1.11d)$$

Terms within the parentheses are expressed for a unit mass of fluid at the inflow and outflow locations. When multiplied by the mass flow rate  $\dot{m}$ , they yield the rate at which the corresponding form of the energy (thermal, flow work, kinetic, and potential) enters or leaves the control volume. The sum of thermal energy and flow work per unit mass may be replaced by the enthalpy per unit mass,  $i = u_t + pv$ .

In most open system applications of interest in this text, changes in latent energy between the inflow and outflow conditions of Equation 1.11d may be neglected, so the thermal energy reduces to only the sensible component. If the fluid is approximated as an *ideal gas* with *constant specific heats*, the difference in enthalpies (per unit mass) between the inlet and outlet flows may then be expressed as  $(i_{in} - i_{out}) = c_p (T_{in} - T_{out})$ , where  $c_p$  is the specific heat at constant pressure and  $T_{in}$  and  $T_{out}$  are the inlet and outlet temperatures, respectively. If the fluid is an *incompressible liquid*, its specific heats at constant pressure and volume are equal,  $c_p = c_v \equiv c$ , and for Equation 1.11d the change in sensible energy (per unit mass) reduces to  $(u_{t,in} - u_{t,out}) = c(T_{in} - T_{out})$ . Unless the pressure drop is extremely large, the difference in flow work terms,  $(pv)_{in} - (pv)_{out}$ , is negligible for a liquid.

Having already assumed steady-state conditions, no changes in latent energy, and no thermal energy generation, there are at least four cases in which further assumptions can be made to reduce Equation 1.11d to the *simplified steady-flow thermal energy equation*:

$$q = \dot{m} c_p (T_{out} - T_{in}) \quad (1.11e)$$

The right-hand side of Equation 1.11e represents the net rate of outflow of enthalpy (thermal energy plus flow work) for an ideal gas or of thermal energy for an incompressible liquid.

The first two cases for which Equation 1.11e holds can readily be verified by examining Equation 1.11d. They are:

1. An ideal gas with negligible kinetic and potential energy changes and negligible work (other than flow work).

2. An incompressible liquid with negligible kinetic and potential energy changes and negligible work, *including* flow work. As noted in the preceding discussion, flow work is negligible for an incompressible liquid provided the pressure variation is not too great.

The second pair of cases cannot be directly derived from Equation 1.11d but require further knowledge of how mechanical energy is converted into thermal energy. These cases are:

3. An ideal gas with negligible viscous dissipation and negligible pressure variation.
4. An incompressible liquid with negligible viscous dissipation.

*Viscous dissipation* is the conversion from mechanical energy to thermal energy associated with viscous forces acting in a fluid. It is only important in cases involving high-speed flow and/or highly viscous fluid. Since so many engineering applications satisfy one or more of the above four conditions, Equation 1.11e is commonly used for the analysis of heat transfer in moving fluids. It will be used in Chapter 8 in the study of convection heat transfer in internal flow.

The *mass flow rate*  $\dot{m}$  of the fluid may be expressed as  $\dot{m} = \rho VA_c$ , where  $\rho$  is the fluid density and  $A_c$  is the cross-sectional area of the channel through which the fluid flows. The *volumetric flow rate* is simply  $\dot{V} = VA_c = \dot{m}/\rho$ .

### EXAMPLE 1.3


A long conducting rod of diameter  $D$  and electrical resistance per unit length  $R'_e$  is initially in thermal equilibrium with the ambient air and its surroundings. This equilibrium is disturbed when an electrical current  $I$  is passed through the rod. Develop an equation that could be used to compute the variation of the rod temperature with time during passage of the current.

### SOLUTION

**Known:** Temperature of a rod of prescribed diameter and electrical resistance changes with time due to passage of an electrical current.

**Find:** Equation that governs temperature change with time for the rod.

**Schematic:**

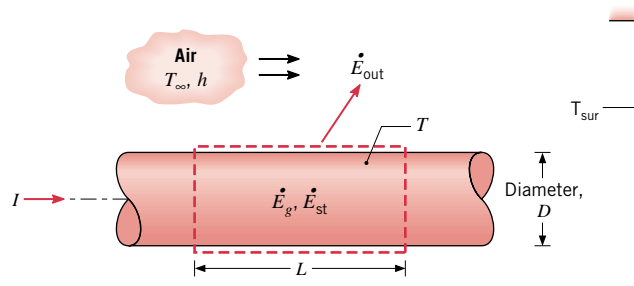

**Assumptions:**

1. At any time  $t$  the temperature of the rod is uniform.
2. Constant properties ( $\rho, c, \varepsilon = \alpha$ ).
3. Radiation exchange between the outer surface of the rod and the surroundings is between a small surface and a large enclosure.

**Analysis:** The first law of thermodynamics may often be used to determine an unknown temperature. In this case, relevant terms include heat transfer by convection and radiation from the surface, energy generation due to Ohmic heating within the conductor, and a change in thermal energy storage. Since we wish to determine the rate of change of the temperature, the first law should be applied at an instant of time. Hence, applying Equation 1.11c to a control volume of length  $L$  about the rod, it follows that

$$\dot{E}_g - \dot{E}_{\text{out}} = \dot{E}_{\text{st}}$$

where energy generation is due to the electric resistance heating,

$$\dot{E}_g = I^2 R'_e L$$

Heating occurs uniformly within the control volume and could also be expressed in terms of a volumetric heat generation rate  $\dot{q}$  (W/m<sup>3</sup>). The generation rate for the entire control volume is then  $\dot{E}_g = \dot{q}V$ , where  $\dot{q} = I^2 R'_e / (\pi D^2/4)$ . Energy outflow is due to convection and net radiation from the surface, Equations 1.3a and 1.7, respectively,

$$\dot{E}_{\text{out}} = h(\pi DL)(T - T_\infty) + \varepsilon\sigma(\pi DL)(T^4 - T_{\text{sur}}^4)$$

and the change in energy storage is due to the temperature change,

$$\dot{E}_{\text{st}} = \frac{dU_t}{dt} = \frac{d}{dt}(\rho V c T)$$

The term  $\dot{E}_{\text{st}}$  is associated with the rate of change in the internal thermal energy of the rod, where  $\rho$  and  $c$  are the mass density and the specific heat, respectively, of the rod material, and  $V$  is the volume of the rod,  $V = (\pi D^2/4)L$ . Substituting the rate equations into the energy balance, it follows that

$$I^2 R'_e L - h(\pi DL)(T - T_\infty) - \varepsilon\sigma(\pi DL)(T^4 - T_{\text{sur}}^4) = \rho c \left( \frac{\pi D^2}{4} \right) L \frac{dT}{dt}$$

Hence


$$\frac{dT}{dt} = \frac{I^2 R'_e - \pi Dh(T - T_\infty) - \pi D\varepsilon\sigma(T^4 - T_{\text{sur}}^4)}{\rho c (\pi D^2/4)} \quad \triangleleft$$

**Comments:**

1. The above equation could be solved for the time dependence of the rod temperature by integrating numerically. A steady-state condition would eventually be reached for which  $dT/dt = 0$ . The rod temperature is then determined by an algebraic equation of the form

$$\pi Dh(T - T_\infty) + \pi D\varepsilon\sigma(T^4 - T_{\text{sur}}^4) = I^2 R'_e$$

2. For fixed environmental conditions ( $h, T_\infty, T_{\text{sur}}$ ), as well as a rod of fixed geometry ( $D$ ) and properties ( $\varepsilon, R'_e$ ), the steady-state temperature depends on the rate of thermal energy generation and hence on the value of the electric current. Consider an uninsulated copper wire ( $D = 1 \text{ mm}$ ,  $\varepsilon = 0.8$ ,  $R'_e = 0.4 \Omega/\text{m}$ ) in a relatively large enclosure ( $T_{\text{sur}} = 300 \text{ K}$ ) through which cooling air is circulated ( $h = 100 \text{ W/m}^2 \cdot \text{K}$ ,  $T_\infty = 300 \text{ K}$ ). Substituting these values into the foregoing equation, the rod temperature has been computed for operating currents in the range  $0 \leq I \leq 10 \text{ A}$  and the following results were obtained:

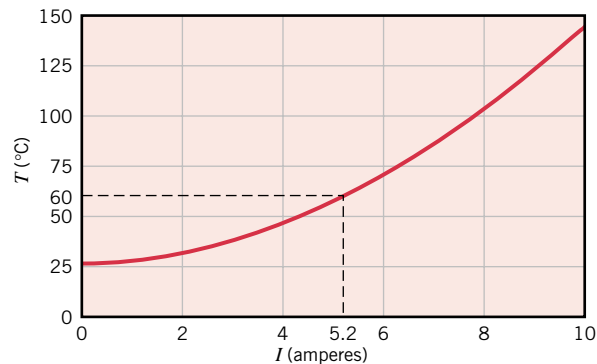

3. If a maximum operating temperature of  $T = 60^\circ\text{C}$  is prescribed for safety reasons, the current should not exceed 5.2 A. At this temperature, heat transfer by radiation (0.6 W/m) is much less than heat transfer by convection (10.4 W/m). Hence, if one wished to operate at a larger current while maintaining the rod temperature within the safety limit, the convection coefficient would have to be increased by increasing the velocity of the circulating air. For  $h = 250 \text{ W/m}^2 \cdot \text{K}$ , the maximum allowable current could be increased to 8.1 A.
4. The *Interactive Heat Transfer (IHT)* software accompanying your text is especially useful for solving equations, such as the energy balance in Comment 1, and generating the graphical results of Comment 2. To apply *IHT* for this purpose, key the energy balance into the *Workspace* using the following free-form symbol format.


$$\pi D h (T - T_{\text{inf}}) + \pi D \varepsilon \sigma (T^4 - T_{\text{sur}}^4) = I^2 R'_e$$

Next, key in the known input parameters, press *Solve*, and find  $T$ . To determine  $T$  for the operating current range,  $0 \leq I \leq 10 \text{ A}$ , use the *Explore* feature to sweep over the variable  $I$ . You may plot  $T$  vs  $I$  using the *Graph* feature and may label the plot to provide a professional appearance.

#### EXAMPLE 1.4

A *hydrogen-air* Proton Exchange Membrane (PEM) fuel cell is illustrated below. It consists of an *electrolytic membrane* sandwiched between porous *cathode* and *anode* materials, forming a very thin, three-layer *membrane electrode assembly*

(MEA). At the anode, protons and electrons are generated ( $2\text{H}_2 \rightarrow 4\text{H}^+ + 4e^-$ ), while at the cathode the protons and electrons recombine to form water ( $\text{O}_2 + 4e^- + 4\text{H}^+ \rightarrow 2\text{H}_2\text{O}$ ). The overall reaction is then  $2\text{H}_2 + \text{O}_2 \rightarrow 2\text{H}_2\text{O}$ . The dual role of the electrolytic membrane is to transfer hydrogen ions and serve as a barrier to electron transfer, forcing the electrons to the electrical load that is external to the fuel cell.

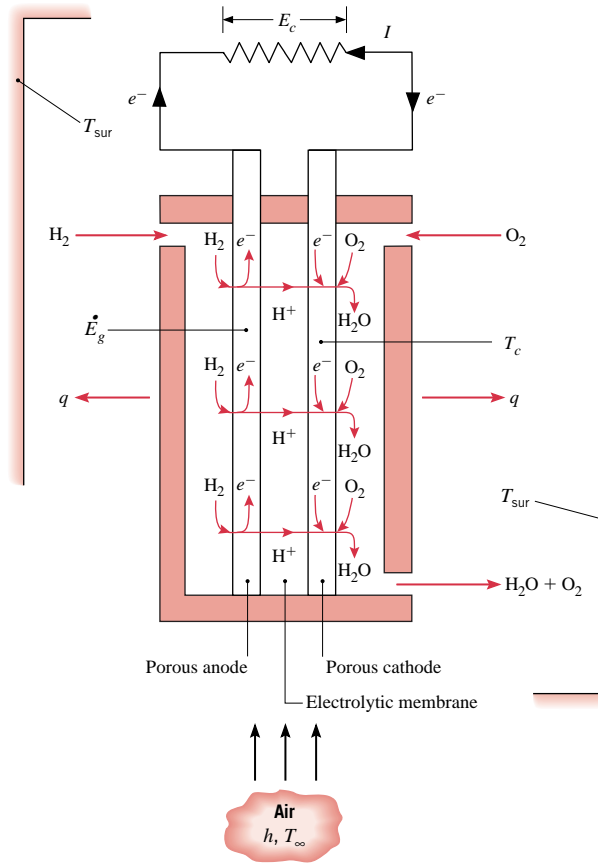

The membrane must operate in a moist state in order to conduct ions. However, the presence of liquid water in the cathode material may block the oxygen from reaching the cathode reaction sites, resulting in failure of the fuel cell. Therefore, it is critical to control the temperature of the fuel cell,  $T_c$ , so that the cathode side contains saturated water vapor.

For a given set of  $\text{H}_2$  and air inlet flow rates and use of a  $50 \text{ mm} \times 50 \text{ mm}$  MEA, the fuel cell generates  $P = I \cdot E_c = 9 \text{ W}$  of electrical power, associated with a cell voltage  $E_c = 0.6 \text{ volts}$  and electric current  $I = 15 \text{ A}$ . Saturated vapor conditions exist in the fuel cell, corresponding to  $T_c = T_{\text{sat}} = 56.4^\circ\text{C}$ . The overall electrochemical reaction is exothermic and the corresponding thermal generation rate of  $\dot{E}_g = 11.25 \text{ W}$  must be removed from the fuel cell by convection and radiation. The ambient and surrounding temperatures are  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ , and the relationship between the cooling air velocity and the convection heat transfer coefficient,  $h$ , is

$$h = 10.9 \text{ W} \cdot \text{s}^{0.8} / \text{m}^{2.8} \cdot \text{K} \times V^{0.8}$$


where  $V$  has units of m/s. The exterior surface of the fuel cell has an emissivity of  $\varepsilon = 0.88$ . Determine the value of the cooling air velocity needed to maintain steady-state operating conditions. Assume the edges of the fuel cell are well insulated.

### SOLUTION

**Known:** Ambient and surrounding temperatures, fuel cell output voltage and electrical current, heat generated by the overall electrochemical reaction, and the desired fuel cell operating temperature.

**Find:** The required cooling air velocity,  $V$ , needed to maintain steady-state operation at  $T_c \approx 56.4^\circ\text{C}$ .

**Schematic:**

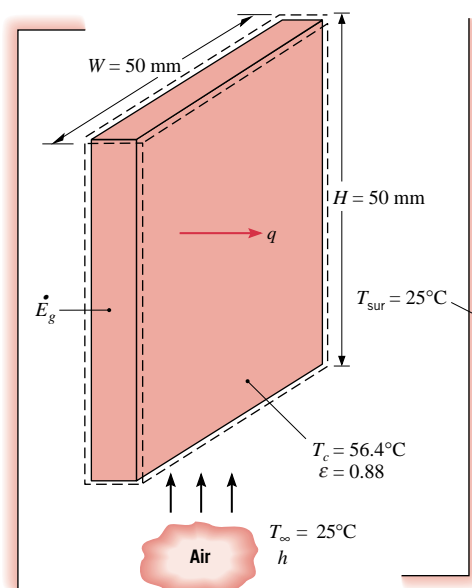

**Assumptions:**

1. Steady-state conditions.
2. Negligible temperature variations within the fuel cell.
3. Fuel cell is placed in large surroundings.
4. Edges of the fuel cell are well insulated.
5. Negligible energy entering or leaving the control volume due to gas or liquid flows.

**Analysis:** To determine the required cooling air velocity, we must first perform an energy balance on the fuel cell. With  $\dot{E}_{in} = 0$  and  $\dot{E}_{out} = \dot{E}_g$ ,

$$q_{conv} + q_{rad} = \dot{E}_g = 11.25 \text{ W}$$

where

$$\begin{aligned} q_{\text{rad}} &= \varepsilon A \sigma (T_c^4 - T_{\text{sur}}^4) \\ &= 0.88 \times (2 \times 0.05 \text{ m} \times 0.05 \text{ m}) \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 \times (329.4^4 - 298^4) \text{ K}^4 \\ &= 0.97 \text{ W} \end{aligned}$$

Therefore, we may find

$$\begin{aligned} q_{\text{conv}} &= 11.25 \text{ W} - 0.97 \text{ W} = 10.28 \text{ W} \\ &= hA(T_c - T_\infty) \\ &= 10.9 \text{ W} \cdot \text{s}^{0.8}/\text{m}^{2.8} \cdot \text{K} \times V^{0.8} A(T_c - T_\infty) \end{aligned}$$

which may be rearranged to yield

$$\begin{aligned} V &= \left[ \frac{10.28 \text{ W}}{10.9 \text{ W} \cdot \text{s}^{0.8}/\text{m}^{2.8} \cdot \text{K} \times (2 \times 0.05 \text{ m} \times 0.05 \text{ m}) \times (56.4 - 25)^\circ\text{C}} \right]^{1.25} \\ V &= 9.4 \text{ m/s} \end{aligned}$$

#### Comments:

1. Temperature and humidity of the MEA will vary from location to location within the fuel cell. Prediction of the *local* conditions within the fuel cell would require a more detailed analysis.
2. The required cooling air velocity is quite high. Decreased cooling velocities could be used if heat transfer enhancement devices were added to the exterior of the fuel cell.
3. The convective heat rate is significantly greater than the radiation heat rate.
4. The chemical energy (20.25 W) of the hydrogen and oxygen is converted to electrical (9 W) and thermal (11.25 W) energy. This fuel cell operates at a conversion efficiency of  $(9 \text{ W})/(20.25 \text{ W}) \times 100 = 44$  percent.

#### EXAMPLE 1.5

Large PEM fuel cells, such as those used in automotive applications, often require internal cooling using pure liquid water to maintain their temperature at a desired level (see Example 1.4). In cold climates, the cooling water must be drained from the fuel cell to an adjoining container when the automobile is turned off so that harmful freezing does not occur within the fuel cell. Consider a mass  $M$  of ice that was frozen while the automobile was not being operated. The ice is at the fusion temperature ( $T_f = 0^\circ\text{C}$ ) and is enclosed in a cubical container of width  $W$  on a side. The container wall is of thickness  $L$  and thermal conductivity  $k$ . If the outer surface of the wall is heated to a temperature  $T_1 > T_f$  to melt the ice, obtain an expression for the time needed to melt the entire mass of ice and, in turn, deliver cooling water to, and energize, the fuel cell.


#### SOLUTION

**Known:** Mass and temperature of ice. Dimensions, thermal conductivity, and outer surface temperature of containing wall.



**Find:** Expression for time needed to melt the ice.

**Schematic:**

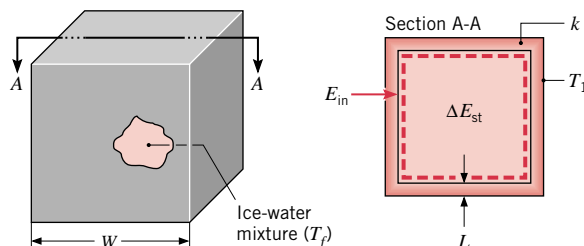

**Assumptions:**

1. Inner surface of wall is at  $T_f$  throughout the process.
2. Constant properties.
3. Steady-state, one-dimensional conduction through each wall.
4. Conduction area of one wall may be approximated as  $W^2$  ( $L \ll W$ ).

**Analysis:** Since we must determine the melting time  $t_m$ , the first law should be applied over the time interval  $\Delta t = t_m$ . Hence, applying Equation 1.11b to a control volume about the ice–water mixture, it follows that

$$E_{in} = \Delta E_{st} = \Delta U_{lat}$$

where the increase in energy stored within the control volume is due exclusively to the change in latent energy associated with conversion from the solid to liquid state. Heat is transferred to the ice by means of conduction through the container wall, and since the temperature difference across the wall is assumed to remain at  $(T_1 - T_f)$  throughout the melting process, the wall conduction rate is a constant

$$q_{cond} = k(6W^2) \frac{T_1 - T_f}{L}$$

and the amount of energy inflow is

$$E_{in} = \left[ k(6W^2) \frac{T_1 - T_f}{L} \right] t_m$$

The amount of energy required to effect such a phase change per unit mass of solid is termed the *latent heat of fusion*  $h_{sf}$ . Hence the increase in energy storage is

$$\Delta E_{st} = Mh_{sf}$$

By substituting into the first law expression, it follows that

$$t_m = \frac{Mh_{sf}L}{6W^2k(T_1 - T_f)}$$

**Comments:**

1. Several complications would arise if the ice were initially subcooled. The storage term would have to include the change in sensible (internal thermal) energy required

to take the ice from the subcooled to the fusion temperature. During this process, temperature gradients would develop in the ice.

- Consider a cavity of width  $W = 100$  mm on a side, wall thickness  $L = 5$  mm, and thermal conductivity  $k = 0.05$  W/m · K. The mass of the ice in the cavity is

$$M = \rho_s(W - 2L)^3 = 920 \text{ kg/m}^3 \times (0.100 - 0.01)^3 \text{ m}^3 = 0.67 \text{ kg}$$

If the outer surface temperature is  $T_1 = 30^\circ\text{C}$ , the time required to melt the ice is

$$t_m = \frac{0.67 \text{ kg} \times 334,000 \text{ J/kg} \times 0.005 \text{ m}}{6(0.100 \text{ m})^2 \times 0.05 \text{ W/m} \cdot \text{K} (30 - 0)^\circ\text{C}} = 1243 \text{ s} = 20.7 \text{ min}$$

The density and latent heat of fusion of the ice are  $\rho_s = 920$  kg/m<sup>3</sup> and  $h_{sf} = 334$  kJ/kg, respectively.

- Note that the units of K and  $^\circ\text{C}$  cancel each other in the foregoing expression for  $t_m$ . Such cancellation occurs frequently in heat transfer analysis and is due to both units appearing in the context of a *temperature difference*.


### 1.3.2 The Surface Energy Balance

We will frequently have occasion to apply the conservation of energy requirement at the surface of a medium. In this special case the control surfaces are located on either side of the physical boundary and enclose no mass or volume (see Figure 1.9). Accordingly, the generation and storage terms of the conservation expression, Equation 1.11c, are no longer relevant and it is only necessary to deal with surface phenomena. For this case the conservation requirement becomes

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = 0 \quad (1.12)$$

Even though thermal energy generation may be occurring in the medium, the process would not affect the energy balance at the control surface. Moreover, this conservation requirement holds for both *steady-state* and *transient* conditions.

In Figure 1.9 three heat transfer terms are shown for the control surface. On a unit area basis they are conduction from the medium *to* the control surface ( $q''_{\text{cond}}$ ),

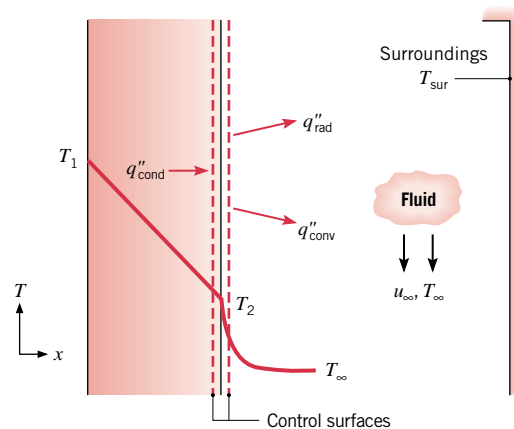

**FIGURE 1.9**

The energy balance for conservation of energy at the surface of a medium.

convection *from* the surface to a fluid ( $q''_{\text{conv}}$ ), and net radiation exchange from the surface to the surroundings ( $q''_{\text{rad}}$ ). The energy balance then takes the form

$$q''_{\text{cond}} - q''_{\text{conv}} - q''_{\text{rad}} = 0 \quad (1.13)$$

and we can express each of the terms using the appropriate rate equations, Equations 1.2, 1.3a, and 1.7.

### EXAMPLE 1.6

Humans are able to control their heat production rate and heat loss rate to maintain a nearly constant core temperature of  $T_c = 37^\circ\text{C}$  under a wide range of environmental conditions. This process is called *thermoregulation*. From the perspective of calculating heat transfer between a human body and its surroundings, we focus on a layer of skin and fat, with its outer surface exposed to the environment and its inner surface at a temperature slightly less than the core temperature,  $T_i = 35^\circ\text{C} = 308\text{ K}$ . Consider a person with a skin/fat layer of thickness  $L = 3\text{ mm}$  and effective thermal conductivity  $k = 0.3\text{ W/m}\cdot\text{K}$ . The person has a surface area  $A = 1.8\text{ m}^2$  and is dressed in a bathing suit. The emissivity of the skin is  $\varepsilon = 0.95$ .


1. When the person is in still air at  $T_\infty = 297\text{ K}$ , what is the skin surface temperature and rate of heat loss to the environment? Convection heat transfer to the air is characterized by a free convection coefficient of  $h = 2\text{ W/m}^2\cdot\text{K}$ .
2. When the person is in water at  $T_\infty = 297\text{ K}$ , what is the skin surface temperature and heat loss rate? Heat transfer to the water is characterized by a convection coefficient of  $h = 200\text{ W/m}^2\cdot\text{K}$ .

### SOLUTION

**Known:** Inner surface temperature of a skin/fat layer of known thickness, thermal conductivity, emissivity, and surface area. Ambient conditions.

**Find:** Skin surface temperature and heat loss rate for the person in air and the person in water.

**Schematic:**

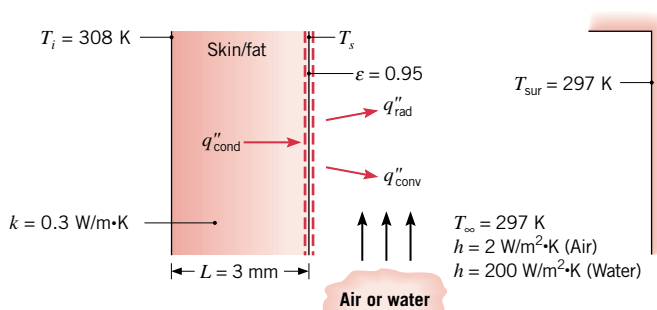

**Assumptions:**

1. Steady-state conditions.
2. One-dimensional heat transfer by conduction through the skin/fat layer.
3. Thermal conductivity is uniform.
4. Radiation exchange between the skin surface and the surroundings is between a small surface and a large enclosure at the air temperature.
5. Liquid water is opaque to thermal radiation.
6. Bathing suit has no effect on heat loss from body.
7. Solar radiation is negligible.
8. Body is completely immersed in water in part 2.

**Analysis:**

1. The skin surface temperature may be obtained by performing an energy balance at the skin surface. From Equation 1.12,

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = 0$$

It follows that, on a unit area basis,

$$q''_{\text{cond}} - q''_{\text{conv}} - q''_{\text{rad}} = 0$$

or, rearranging and substituting from Equations 1.2, 1.3a, and 1.7,

$$k \frac{T_i - T_s}{L} = h(T_s - T_\infty) + \varepsilon \sigma (T_s^4 - T_{\text{sur}}^4)$$

The only unknown is  $T_s$ , but we cannot solve for it explicitly because of the fourth power dependence of the radiation term. Therefore, we must solve the equation iteratively, which can be done by hand or by using *IHT* or some other equation solver. To expedite a hand solution, we write the radiation heat flux in terms of the radiation heat transfer coefficient, using Equations 1.8 and 1.9:

$$k \frac{T_i - T_s}{L} = h(T_s - T_\infty) + h_r(T_s - T_{\text{sur}})$$

Solving for  $T_s$ , with  $T_{\text{sur}} = T_\infty$ , we have

$$T_s = \frac{\frac{kT_i}{L} + (h + h_r)T_\infty}{\frac{k}{L} + (h + h_r)}$$

We estimate  $h_r$  using Equation 1.9 with a guessed value of  $T_s = 305$  K and  $T_\infty = 297$  K, to yield  $h_r = 5.9$  W/m<sup>2</sup> · K. Then, substituting numerical values into the above equation, we find

$$T_s = \frac{\frac{0.3 \text{ W/m} \cdot \text{K} \times 308 \text{ K}}{3 \times 10^{-3} \text{ m}} + (2 + 5.9) \text{ W/m}^2 \cdot \text{K} \times 297 \text{ K}}{\frac{0.3 \text{ W/m} \cdot \text{K}}{3 \times 10^{-3} \text{ m}} + (2 + 5.9) \text{ W/m}^2 \cdot \text{K}} = 307.2 \text{ K}$$

With this new value of  $T_s$  we can recalculate  $h_r$  and  $T_s$ , which are unchanged. Thus the skin temperature is 307.2 K  $\cong$  34°C. ◁

The rate of heat loss can be found by evaluating the conduction through the skin/fat layer:

$$q_s = kA \frac{T_i - T_s}{L} = 0.3 \text{ W/m} \cdot \text{K} \times 1.8 \text{ m}^2 \times \frac{(308 - 307.2) \text{ K}}{3 \times 10^{-3} \text{ m}} = 146 \text{ W} \quad \triangleleft$$

2. Since liquid water is opaque to thermal radiation, heat loss from the skin surface is by convection only. Using the previous expression with  $h_r = 0$ , we find

$$T_s = \frac{\frac{0.3 \text{ W/m} \cdot \text{K} \times 308 \text{ K}}{3 \times 10^{-3} \text{ m}} + 200 \text{ W/m}^2 \cdot \text{K} \times 297 \text{ K}}{\frac{0.3 \text{ W/m} \cdot \text{K}}{3 \times 10^{-3} \text{ m}} + 200 \text{ W/m}^2 \cdot \text{K}} = 300.7 \text{ K} \quad \triangleleft$$

and

$$q_s = kA \frac{T_i - T_s}{L} = 0.3 \text{ W/m} \cdot \text{K} \times 1.8 \text{ m}^2 \times \frac{(308 - 300.7) \text{ K}}{3 \times 10^{-3} \text{ m}} = 1320 \text{ W} \quad \triangleleft$$

### Comments:

1. When using energy balances involving radiation exchange, the temperatures appearing in the radiation terms must be expressed in kelvins, and it is good practice to use kelvins in all terms to avoid confusion.
2. In part 1, heat losses due to convection and radiation are 37 W and 109 W, respectively. Thus, it would not have been reasonable to neglect radiation. Care must be taken to include radiation when the heat transfer coefficient is small (as it often is for natural convection to a gas), even if the problem statement does not give any indication of its importance.
3. A typical rate of metabolic heat generation is 100 W. If the person stayed in the water too long the core body temperature would begin to fall. The large heat loss in water is due to the higher heat transfer coefficient, which in turn is due to the much larger thermal conductivity of water compared to air.
4. The skin temperature of 34°C in part 1 is comfortable, but the skin temperature of 28°C in part 2 is uncomfortably cold.
5. By entering the energy balance and appropriate input parameters in the *IHT Workspace*, a *model* of the system may be developed for calculating  $T_s$  and  $q_s$  or any other system parameter. With this model, *parameter sensitivity* studies may be performed to explore, for example, the effect of changing  $h$  on  $T_s$ . Wherever possible, it is good practice to *validate* your model against a known solution, which in this case is shown in the foregoing analysis.

### 1.3.3 Application of the Conservation Laws: Methodology

In addition to being familiar with the transport rate equations described in Section 1.2, the heat transfer analyst must be able to work with the energy conservation requirements of Equations 1.11 and 1.12. The application of these balances is simplified if a few basic rules are followed.

1. The appropriate control volume must be defined, with the control surfaces represented by a dashed line or lines.
2. The appropriate time basis must be identified.
3. The relevant energy processes must be identified, and each process should be shown on the control volume by an appropriately labeled arrow.
4. The conservation equation must then be written, and appropriate rate expressions must be substituted for the relevant terms in the equation.

It is important to note that the energy conservation requirement may be applied to a *finite* control volume or a *differential* (infinitesimal) control volume. In the first case the resulting expression governs overall system behavior. In the second case a differential equation is obtained that can be solved for conditions at each point in the system. Differential control volumes are introduced in Chapter 2, and both types of control volumes are used extensively throughout the text.

## 1.4

### Analysis of Heat Transfer Problems: Methodology

---

A major objective of this text is to prepare you to solve engineering problems that involve heat transfer processes. To this end numerous problems are provided at the end of each chapter. In working these problems you will gain a deeper appreciation for the fundamentals of the subject, and you will gain confidence in your ability to apply these fundamentals to the solution of engineering problems.

In solving problems, we advocate the use of a systematic procedure characterized by a prescribed format. We consistently employ this procedure in our examples, and we require our students to use it in their problem solutions. It consists of the following steps:

1. *Known:* After carefully reading the problem, state briefly and concisely what is known about the problem. Do not repeat the problem statement.
2. *Find:* State briefly and concisely what must be found.
3. *Schematic:* Draw a schematic of the physical system. If application of the conservation laws is anticipated, represent the required control surface or surfaces by dashed lines on the schematic. Identify relevant heat transfer processes by appropriately labeled arrows on the schematic.
4. *Assumptions:* List all pertinent simplifying assumptions.
5. *Properties:* Compile property values needed for subsequent calculations and identify the source from which they are obtained.
6. *Analysis:* Begin your analysis by applying appropriate conservation laws, and introduce rate equations as needed. Develop the analysis as completely as possible before substituting numerical values. Perform the calculations needed to obtain the desired results.
7. *Comments:* Discuss your results. Such a discussion may include a summary of key conclusions, a critique of the original assumptions, and an inference of

trends obtained by performing additional *what-if* and *parameter sensitivity* calculations.

The importance of following steps 1 through 4 should not be underestimated. They provide a useful guide to thinking about a problem before effecting its solution. In step 7 we hope you will take the initiative to gain additional insights by performing calculations that may be computer-based. The software accompanying this text provides a suitable tool for effecting such calculations.

### EXAMPLE 1.7

The coating on a plate is cured by exposure to an infrared lamp providing a uniform irradiation of  $2000 \text{ W/m}^2$ . It absorbs 80% of the irradiation and has an emissivity of 0.50. It is also exposed to an air flow and large surroundings for which temperatures are  $20^\circ\text{C}$  and  $30^\circ\text{C}$ , respectively.

1. If the convection coefficient between the plate and the ambient air is  $15 \text{ W/m}^2 \cdot \text{K}$ , what is the cure temperature of the plate?
2. Final characteristics of the coating, including wear and durability, are known to depend on the temperature at which curing occurs. An air flow system is able to control the air velocity, and hence the convection coefficient, on the cured surface, but the process engineer needs to know how the temperature depends on the convection coefficient. Provide the desired information by computing and plotting the surface temperature as a function of  $h$  for  $2 \leq h \leq 200 \text{ W/m}^2 \cdot \text{K}$ . What value of  $h$  would provide a cure temperature of  $50^\circ\text{C}$ ?


### SOLUTION

**Known:** Coating with prescribed radiation properties is cured by irradiation from an infrared lamp. Heat transfer from the coating is by convection to ambient air and radiation exchange with the surroundings.

### Find:

1. Cure temperature for  $h = 15 \text{ W/m}^2 \cdot \text{K}$ .
2. Effect of air flow on the cure temperature for  $2 \leq h \leq 200 \text{ W/m}^2 \cdot \text{K}$ . Value of  $h$  for which the cure temperature is  $50^\circ\text{C}$ .

### Schematic:

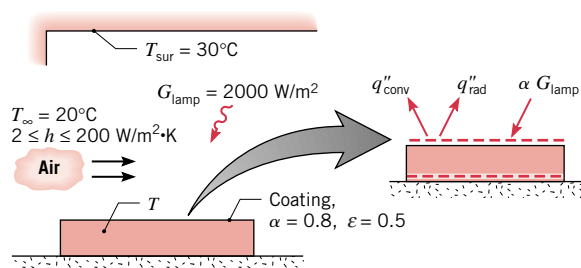

**Assumptions:**

1. Steady-state conditions.
2. Negligible heat loss from back surface of plate.
3. Plate is small object in large surroundings, and coating has an absorptivity of  $\alpha_{\text{sur}} = \varepsilon = 0.5$  with respect to irradiation from the surroundings.

**Analysis:**

1. Since the process corresponds to steady-state conditions and there is no heat transfer at the back surface, the plate must be isothermal ( $T_s = T$ ). Hence the desired temperature may be determined by placing a control surface about the exposed surface and applying Equation 1.12 or by placing the control surface about the entire plate and applying Equation 1.11c. Adopting the latter approach and recognizing that there is no internal energy generation ( $\dot{E}_g = 0$ ), Equation 1.11c reduces to

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = 0$$

where  $\dot{E}_{\text{st}} = 0$  for steady-state conditions. With energy inflow due to absorption of the lamp irradiation by the coating and outflow due to convection and net radiation transfer to the surroundings, it follows that

$$(\alpha G)_{\text{lamp}} - q''_{\text{conv}} - q''_{\text{rad}} = 0$$

Substituting from Equations 1.3a and 1.7, we obtain

$$(\alpha G)_{\text{lamp}} - h(T - T_{\infty}) - \varepsilon \sigma (T^4 - T_{\text{sur}}^4) = 0$$

Substituting numerical values


$$0.8 \times 2000 \text{ W/m}^2 - 15 \text{ W/m}^2 \cdot \text{K}(T - 293) \text{ K} - 0.5 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (T^4 - 303^4) \text{ K}^4 = 0$$

and solving by trial-and-error, we obtain

$$T = 377 \text{ K} = 104^\circ\text{C}$$



2. Solving the foregoing energy balance for selected values of  $h$  in the prescribed range and plotting the results, we obtain

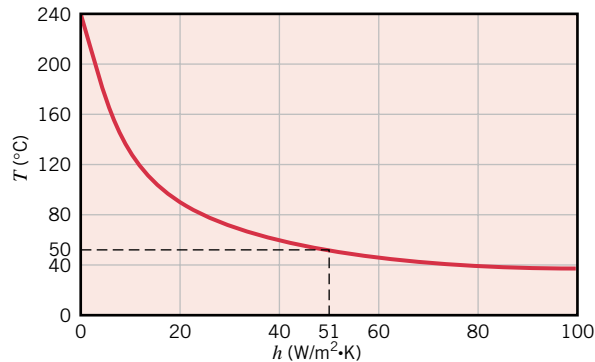



If a cure temperature of 50°C is desired, the air flow must provide a convection coefficient of

$$h(T = 50^\circ\text{C}) = 51.0 \text{ W/m}^2 \cdot \text{K}$$



### Comments:

1. The coating (plate) temperature may be reduced by decreasing  $T_\infty$  and  $T_{\text{sur}}$ , as well as by increasing the air velocity and hence the convection coefficient.
2. The relative contributions of convection and radiation to heat transfer from the plate vary greatly with  $h$ . For  $h = 2 \text{ W/m}^2 \cdot \text{K}$ ,  $T = 204^\circ\text{C}$  and radiation dominates ( $q''_{\text{rad}} \approx 1232 \text{ W/m}^2$ ,  $q''_{\text{conv}} \approx 368 \text{ W/m}^2$ ). Conversely, for  $h = 200 \text{ W/m}^2 \cdot \text{K}$ ,  $T = 28^\circ\text{C}$  and convection dominates ( $q''_{\text{conv}} \approx 1606 \text{ W/m}^2$ ,  $q''_{\text{rad}} \approx -6 \text{ W/m}^2$ ). In fact, for this condition the plate temperature is slightly less than that of the surroundings and net radiation exchange is *to* the plate.
3. This example is one of 15 ready-to-solve models in *IHT*, which may be accessed from *Examples* in the menu bar. As you begin each chapter, check the corresponding model examples. Each model includes *Exercises* that test your understanding of heat transfer concepts.


## 1.5

### Relevance of Heat Transfer

We will devote much time to acquiring an understanding of heat transfer effects and to developing the skills needed to predict heat transfer rates and temperatures that evolve in certain situations. What is the value of this knowledge, and to what problems may it be applied? A few examples will serve to illustrate the rich breadth of applications in which heat transfer plays a critical role.

Heat transfer is a dominant aspect of nearly every energy conversion and production device. For example, the efficiency of a *gas turbine engine* increases with its operating temperature. Today, the temperatures of the *combustion gases* inside these engines far exceed the melting point of the exotic alloys used to manufacture the turbine blades and vanes. Safe operation is typically achieved by three means. First, relatively cool gases are injected through small holes at the leading edge of a turbine blade (Figure 1.10). These gases hug the blade as they are carried downstream and help insulate the blade from the hot combustion gases. Second, thin layers of a very low thermal conductivity, ceramic *thermal barrier coating* are applied to the blades and vanes to provide an extra layer of insulation. These coatings are produced by spraying *molten* ceramic powders onto the engine components using extremely high-temperature sources such as plasma spray guns that can operate in excess of 10,000 kelvins. Third, the blades and vanes are designed with intricate, internal cooling passages, all carefully configured by the heat transfer engineer to allow the gas turbine engine to operate under such extreme conditions.

Emerging energy conversion devices such as *fuel cells* generate power from environmentally benign fuels such as hydrogen. Major roadblocks hindering widespread adoption of fuel cells are their size, weight, and limited durability. As with the gas turbine engine, the efficiency of a fuel cell increases with temperature, but

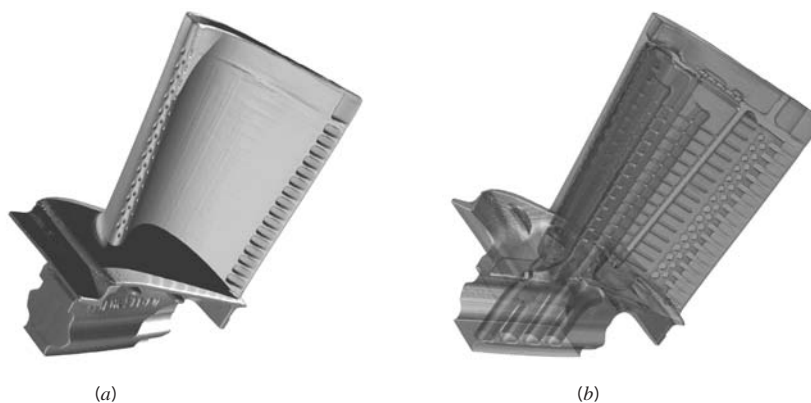


**FIGURE 1.10** Gas turbine blade. (a) External view showing holes for injection of cooling gases. (b) X ray view showing internal cooling passages. (Images courtesy of FarField Technology, Ltd., Christchurch, New Zealand.)

high operating temperatures and large internal temperature gradients can cause the delicate polymeric materials within the fuel cell to fail. The hydrogen fuel cell is the type that might eventually be used for automotive applications and is an *electrochemical reactor* that will cease operating if its internal components are contaminated with impurities. Water, in both the liquid and vapor phases, exists within every hydrogen fuel cell, but commonly used substances in internal combustion engines such as antifreeze cannot be utilized in a fuel cell. What are the heat transfer mechanisms that must be controlled to avoid freezing of pure water within the fuel cell engine when a vehicle of the future is parked overnight in a cold region? How might your knowledge of internal forced convection, evaporation, or condensation be applied to control the operating temperatures and enhance the durability of a fuel cell?

Due to the *information technology* revolution of the last two decades, strong industrial productivity growth has brought an improved quality of life worldwide. Many information technology breakthroughs have been enabled by advances in heat transfer engineering that have ensured the precise control of temperatures of systems ranging in size from nanoscale *integrated circuits*, to microscale *storage media* including compact discs, to large *data centers* filled with heat-generating equipment. As electronic devices become faster and incorporate greater functionality, they generate more thermal energy. Simultaneously, the devices have become smaller. Inevitably, heat fluxes ( $\text{W}/\text{m}^2$ ) and volumetric energy generation rates ( $\text{W}/\text{m}^3$ ) keep increasing; but the operating temperatures of the devices must be held to reasonably low values to ensure their reliability.

For *personal computers*, cooling fins (also known as *heat sinks*) are fabricated of a high thermal conductivity material (usually aluminum) and attached to the microprocessors to reduce their operating temperatures, as shown in Figure 1.11. Small fans are used to induce forced convection over the fins. The cumulative energy that is consumed worldwide, just to (1) power the small fans that provide the air flow over the fins and (2) manufacture the heat sinks for personal computers, is estimated to be over  $10^9 \text{ kW} \cdot \text{h}$  per year [1]. How might your knowledge of conduction, convection, and radiation be used to, for example, eliminate the fan and minimize the size of the heat sink?

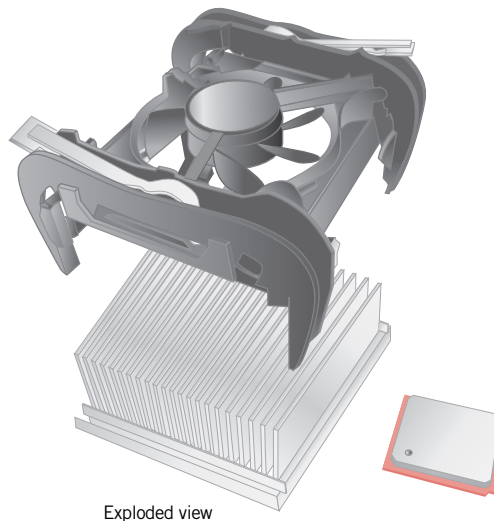**FIGURE 1.11**


A finned heat sink and fan assembly (left) and microprocessor (right).

Further improvements in microprocessor technology are currently limited by our ability to cool these tiny devices. Policy makers have voiced concern about our ability to continually reduce the cost of computing and, in turn as a society, continue the growth in productivity that has marked the last 25 years, specifically citing the need to *enhance heat transfer in electronics cooling* [2]. How might your knowledge of heat transfer help ensure continued industrial productivity into the future?

Heat transfer is important not only in engineered systems but also in nature. Temperature regulates and triggers biological responses in all living systems and ultimately marks the boundary between sickness and health. Two common examples include *hypothermia*, which results from excessive cooling of the human body, and *heat stroke*, which is triggered in warm, humid environments. Both are deadly and are associated with *core temperatures* of the body exceeding physiological limits. Both are directly linked to the convection, radiation, and evaporation processes occurring at the surface of the body, the transport of heat within the body, and the metabolic energy generated volumetrically within the body.

Recent advances in *biomedical engineering*, such as *laser surgery*, have been enabled by successfully applying fundamental heat transfer principles [3,4]. While increased temperatures resulting from contact with hot objects may cause thermal *burns*, beneficial *hyperthermal treatments* are used to purposely destroy, for example, cancerous lesions. In a similar manner, very low temperatures might induce *frostbite*, but purposeful localized freezing can selectively destroy diseased tissue during *cryosurgery*. Many medical therapies and devices therefore operate by destructively heating or cooling diseased tissue, while simultaneously leaving the surrounding healthy tissue unaffected.

The ability to design many medical devices and to develop the appropriate protocol for their use hinges on the engineer's ability to predict and control the distribution of temperatures during thermal treatment and the distribution of chemical species in *chemotherapies*. The treatment of mammalian tissue is made complicated by the morphology of this tissue, as shown in Figure 1.12. The flow of blood within the venular and capillary structure of a thermally-treated area affects heat transfer through advection processes. Larger veins and arteries, which commonly exist in pairs throughout the body, carry blood at different temperatures and advect thermal energy at different

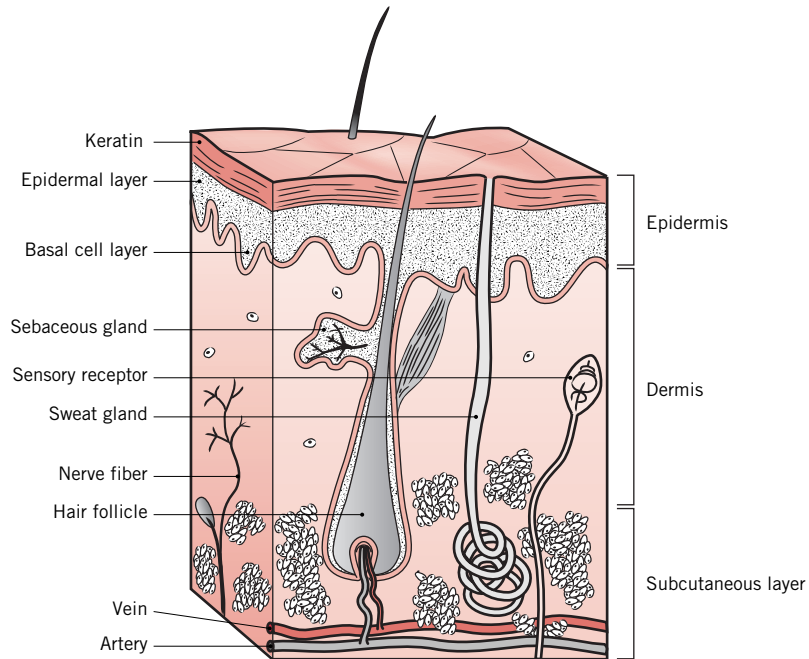

**FIGURE 1.12** Morphology of human skin.

rates. Therefore, the veins and arteries exist in a *counterflow heat exchange* arrangement with warm, arteriolar blood exchanging thermal energy with the cooler, venular blood through the intervening solid tissue. Networks of smaller capillaries can also affect local temperatures by *perfusing* blood through the treated area.

In subsequent chapters, many example and homework problems will deal with the analysis of these and other *thermal systems*.

## 1.6

### Units and Dimensions

The physical quantities of heat transfer are specified in terms of *dimensions*, which are measured in terms of units. Four *basic* dimensions are required for the development of heat transfer; they are length ( $L$ ), mass ( $M$ ), time ( $t$ ), and temperature ( $T$ ). All other physical quantities of interest may be related to these four basic dimensions.

In the United States it has been customary to measure dimensions in terms of an *English system of units*, for which the *base units* are

Dimension	Unit
Length ( $L$ )	→ foot (ft)
Mass ( $M$ )	→ pound mass ( $\text{lb}_m$ )
Time ( $t$ )	→ second (s)
Temperature ( $T$ )	→ degree Fahrenheit ( $^{\circ}\text{F}$ )

The units required to specify other physical quantities may then be inferred from this group. For example, the dimension of force is related to mass through Newton's second law of motion,

$$F = \frac{1}{g_c} Ma \quad (1.14)$$

where the acceleration  $a$  has units of feet per square second and  $g_c$  is a proportionality constant. If this constant is arbitrarily set equal to unity and made *dimensionless*, the dimensions of force are  $(F) = (M) \cdot (L)/(t)^2$  and the unit of force is

$$1 \text{ poundal} = 1 \text{ lb}_m \cdot \text{ft/s}^2$$

Alternatively, one could work with a system of basic dimensions that includes both mass and force. However, in this case the proportionality constant must have the dimensions  $(M) \cdot (L)/(F) \cdot (t)^2$ . Moreover, if one defines the pound force ( $\text{lb}_f$ ) as a unit of force that will accelerate one pound mass by  $32.17 \text{ ft/s}^2$ , the proportionality constant must be of the form

$$g_c = 32.17 \text{ lb}_m \cdot \text{ft/lb}_f \cdot \text{s}^2$$

The units of work may be inferred from its definition as the product of a force times a distance, in which case the units are  $\text{ft} \cdot \text{lb}_f$ . The units of work and energy are, of course, equivalent, although it is customary to use the British thermal unit (Btu) as the unit of thermal energy. One British thermal unit will raise the temperature of  $1 \text{ lb}_m$  of water at  $68^\circ\text{F}$  by  $1^\circ\text{F}$ . It is equivalent to  $778.16 \text{ ft} \cdot \text{lb}_f$ , which is termed the *mechanical equivalent of heat*.

In recent years there has been a strong trend toward worldwide usage of a standard set of units. In 1960 the SI (Système International d'Unités) system of units was defined by the Eleventh General Conference on Weights and Measures and recommended as a worldwide standard. In response to this trend, the American Society of Mechanical Engineers (ASME) has required the use of SI units in all of its publications since July 1, 1974. For this reason and because it is operationally more convenient than the English system, the SI system is used for calculations of this text. However, because for some time to come, engineers will also have to work with results expressed in the English system, you should be able to convert from one system to the other. For your convenience, conversion factors are provided on the inside back cover of the text.

The SI *base* units required for this text are summarized in Table 1.2. With regard to these units note that  $1 \text{ mol}$  is the amount of substance that has as many atoms or

**TABLE 1.2** SI base and supplementary units

Quantity and Symbol	Unit and Symbol
Length ( $L$ )	meter (m)
Mass ( $M$ )	kilogram (kg)
Concentration ( $C$ )	mole (mol)
Time ( $t$ )	second (s)
Electric current ( $I$ )	ampere (A)
Thermodynamic temperature ( $T$ )	kelvin (K)
Plane angle <sup>a</sup> ( $\theta$ )	radian (rad)
Solid angle <sup>a</sup> ( $\omega$ )	steradian (sr)

<sup>a</sup>Supplementary unit.

**TABLE 1.3** SI derived units for selected quantities

Quantity	Name and Symbol	Formula	Expression in SI Base Units
Force	newton (N)	$\text{m} \cdot \text{kg}/\text{s}^2$	$\text{m} \cdot \text{kg}/\text{s}^2$
Pressure and stress	pascal (Pa)	$\text{N}/\text{m}^2$	$\text{kg}/\text{m} \cdot \text{s}^2$
Energy	joule (J)	$\text{N} \cdot \text{m}$	$\text{m}^2 \cdot \text{kg}/\text{s}^2$
Power	watt (W)	$\text{J}/\text{s}$	$\text{m}^2 \cdot \text{kg}/\text{s}^3$

molecules as there are atoms in 12 g of carbon-12 ( $^{12}\text{C}$ ); this is the gram-mole (mol). Although the mole has been recommended as the unit quantity of matter for the SI system, it is more consistent to work with the kilogram-mol (kmol, kg-mol). One kmol is simply the amount of substance that has as many atoms or molecules as there are atoms in 12 kg of  $^{12}\text{C}$ . As long as the use is consistent within a given problem, no difficulties arise in using either mol or kmol. The molecular weight of a substance is the mass associated with a mole or kilogram-mole. For oxygen, as an example, the molecular weight  $\mathcal{M}$  is 16 g/mol or 16 kg/kmol.

Although the SI unit of temperature is the kelvin, use of the Celsius temperature scale remains widespread. Zero on the Celsius scale ( $0^\circ\text{C}$ ) is equivalent to 273.15 K on the thermodynamic scale,<sup>1</sup> in which case

$$T(\text{K}) = T(^{\circ}\text{C}) + 273.15$$

However, temperature *differences* are equivalent for the two scales and may be denoted as  $^{\circ}\text{C}$  or K. Also, although the SI unit of time is the second, other units of time (minute, hour, and day) are so common that their use with the SI system is generally accepted.

The SI units comprise a coherent form of the metric system. That is, all remaining units may be derived from the base units using formulas that do not involve any numerical factors. *Derived* units for selected quantities are listed in Table 1.3. Note that force is measured in newtons, where a 1-N force will accelerate a 1-kg mass at

**TABLE 1.4** Multiplying prefixes

Prefix	Abbreviation	Multiplier
pico	p	$10^{-12}$
nano	n	$10^{-9}$
micro	$\mu$	$10^{-6}$
milli	m	$10^{-3}$
centi	c	$10^{-2}$
hecto	h	$10^2$
kilo	k	$10^3$
mega	M	$10^6$
giga	G	$10^9$
tera	T	$10^{12}$

<sup>1</sup>The degree symbol is retained for designation of the Celsius temperature ( $^{\circ}\text{C}$ ) to avoid confusion with use of C for the unit of electrical charge (coulomb).

$1 \text{ m/s}^2$ . Hence  $1 \text{ N} = 1 \text{ kg} \cdot \text{m/s}^2$ . The unit of pressure ( $\text{N/m}^2$ ) is often referred to as the pascal. In the SI system there is one unit of energy (thermal, mechanical, or electrical), called the joule (J), and  $1 \text{ J} = 1 \text{ N} \cdot \text{m}$ . The unit for energy rate, or power, is then J/s, where one joule per second is equivalent to one watt ( $1 \text{ J/s} = 1 \text{ W}$ ). Since it is frequently necessary to work with extremely large or small numbers, a set of standard prefixes has been introduced to simplify matters (Table 1.4). For example, 1 megawatt (MW) =  $10^6 \text{ W}$ , and 1 micrometer ( $\mu\text{m}$ ) =  $10^{-6} \text{ m}$ .

## 1.7

### Summary

Although much of the material of this chapter will be discussed in greater detail, you should now have a reasonable overview of heat transfer. You should be aware of the several modes of transfer and their physical origins. Moreover, given a physical situation, you should be able to perceive the relevant transport phenomena. The importance of developing this facility must not be underestimated. You will be devoting much time to acquiring the tools needed to calculate heat transfer phenomena. However, before you can begin to use these tools to solve practical problems, you must have the intuition to determine what is happening physically. In short, you must be able to look at a problem and identify the pertinent transport phenomena. The example and problems at the end of this chapter should help you to begin developing this intuition.

You should also appreciate the significance of the rate equations and feel comfortable in using them to compute transport rates. These equations, summarized in Table 1.5, *should be committed to memory*. You must also recognize the importance of the conservation laws and the need to carefully identify control volumes. With the rate equations, the conservation laws may be used to solve numerous heat transfer problems.

Lastly, you should have begun to acquire an appreciation for the terminology and physical concepts that underpin the subject of heat transfer. Test your understanding

**TABLE 1.5** Summary of heat transfer processes

Mode	Mechanism(s)	Rate Equation	Equation Number	Transport Property or Coefficient
Conduction	Diffusion of energy due to random molecular motion	$q_x'' (\text{W/m}^2) = -k \frac{dT}{dx}$	(1.1)	$k (\text{W/m} \cdot \text{K})$
Convection	Diffusion of energy due to random molecular motion plus energy transfer due to bulk motion (advection)	$q'' (\text{W/m}^2) = h(T_s - T_\infty)$	(1.3a)	$h (\text{W/m}^2 \cdot \text{K})$
Radiation	Energy transfer by electromagnetic waves	$q'' (\text{W/m}^2) = \varepsilon \sigma (T_s^4 - T_{\text{sur}}^4)$	(1.7)	$\varepsilon$
		or $q (\text{W}) = h_r A (T_s - T_{\text{sur}})$	(1.8)	$h_r (\text{W/m}^2 \cdot \text{K})$



of the important terms and concepts introduced in this chapter by addressing the following questions.

- What are the *physical mechanisms* associated with heat transfer by *conduction*, *convection*, and *radiation*?
- What is the driving potential for heat transfer? What are analogs to this potential and to heat transfer itself for the transport of electric charge?
- What is the difference between a heat *flux* and a heat *rate*? What are their units?
- What is a *temperature gradient*? What are its units? What is the relationship of heat flow to a temperature gradient?
- What is the *thermal conductivity*? What are its units? What role does it play in heat transfer?
- What is *Fourier's law*? Can you write the equation from memory?
- If heat transfer by conduction through a medium occurs under *steady-state* conditions, will the temperature at a particular instant vary with location in the medium? Will the temperature at a particular location vary with time?
- What is the difference between *natural convection* and *forced convection*?
- What conditions are necessary for the development of a *hydrodynamic boundary layer*? A *thermal boundary layer*? What varies across a hydrodynamic boundary layer? A thermal boundary layer?
- If convection heat transfer for flow of a liquid or a vapor is not characterized by liquid/vapor phase change, what is the nature of the energy being transferred? What is it if there is such a phase change?
- What is *Newton's law of cooling*? Can you write the equation from memory?
- What role is played by the *convection heat transfer coefficient* in Newton's law of cooling? What are its units?
- What effect does convection heat transfer from or to a surface have on the solid bounded by the surface?
- What is predicted by the Stefan–Boltzmann law, and what unit of temperature must be used with the law? Can you write the equation from memory?
- What is the *emissivity*, and what role does it play in characterizing radiation transfer at a surface?
- What is *irradiation*, and what are its units?
- What two outcomes characterize the response of an *opaque* surface to incident radiation? Which outcome affects the thermal energy of the medium bounded by the surface and how? What property characterizes this outcome?
- What conditions are associated with use of the *radiation heat transfer coefficient*?
- Can you write the equation used to express net radiation exchange between a small isothermal surface and a large isothermal enclosure?
- Consider the surface of a solid that is at an elevated temperature and exposed to cooler surroundings. By what mode(s) is heat transferred from the surface if (1) it is in intimate (perfect) contact with another solid, (2) it is exposed to the flow of a liquid, (3) it is exposed to the flow of a gas, and (4) it is in an evacuated chamber?
- What is the inherent difference between application of conservation of energy over a *time interval* and at an *instant of time*?
- What is *thermal energy storage*? How does it differ from *thermal energy generation*? What role do the terms play in a surface energy balance?



**EXAMPLE 1.8**


A closed container filled with hot coffee is in a room whose air and walls are at a fixed temperature. Identify all heat transfer processes that contribute to cooling of the coffee. Comment on features that would contribute to a superior container design.

**SOLUTION**

**Known:** Hot coffee is separated from its cooler surroundings by a plastic flask, an air space, and a plastic cover.

**Find:** Relevant heat transfer processes.

**Schematic:**

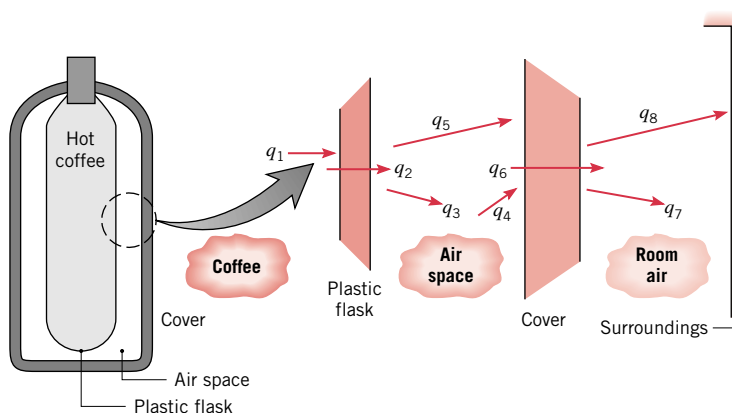

Pathways for energy transfer from the coffee are as follows:

- $q_1$ : free convection from the coffee to the flask
- $q_2$ : conduction through the flask
- $q_3$ : free convection from the flask to the air
- $q_4$ : free convection from the air to the cover
- $q_5$ : net radiation exchange between the outer surface of the flask and the inner surface of the cover
- $q_6$ : conduction through the cover
- $q_7$ : free convection from the cover to the room air
- $q_8$ : net radiation exchange between the outer surface of the cover and the surroundings

**Comments:** Design improvements are associated with (1) use of aluminized (low emissivity) surfaces for the flask and cover to reduce net radiation, and (2) evacuating the air space or using a filler material to retard free convection.

## References

1. Bar-Cohen, A., and I. Madhusudan, *IEEE Trans. Components and Packaging Tech.*, **25**, 584, 2002.
2. Miller, R., *Business Week*, November 11, 2004.
3. Diller, K.R., and T.P. Ryan, *J. Heat Transfer*, **120**, 810, 1998.
4. Datta, A.K., *Biological and Bioenvironmental Heat and Mass Transfer*, Marcel Dekker, New York, 2002.


## Problems

### Conduction

- 1.1 The thermal conductivity of a sheet of rigid, extruded insulation is reported to be  $k = 0.029 \text{ W/m} \cdot \text{K}$ . The measured temperature difference across a 20-mm-thick sheet of the material is  $T_1 - T_2 = 10^\circ\text{C}$ .
  - (a) What is the heat flux through a  $2 \text{ m} \times 2 \text{ m}$  sheet of the insulation?
  - (b) What is the rate of heat transfer through the sheet of insulation?
- 1.2 A concrete wall, which has a surface area of  $20 \text{ m}^2$  and is 0.30 m thick, separates conditioned room air from ambient air. The temperature of the inner surface of the wall is maintained at  $25^\circ\text{C}$ , and the thermal conductivity of the concrete is  $1 \text{ W/m} \cdot \text{K}$ .
  - (a) Determine the heat loss through the wall for outer surface temperatures ranging from  $-15^\circ\text{C}$  to  $38^\circ\text{C}$ , which correspond to winter and summer extremes, respectively. Display your results graphically.
  - (b) On your graph, also plot the heat loss as a function of the outer surface temperature for wall materials having thermal conductivities of 0.75 and  $1.25 \text{ W/m} \cdot \text{K}$ . Explain the family of curves you have obtained.
- 1.3 The concrete slab of a basement is 11 m long, 8 m wide, and 0.20 m thick. During the winter, temperatures are nominally  $17^\circ\text{C}$  and  $10^\circ\text{C}$  at the top and bottom surfaces, respectively. If the concrete has a thermal conductivity of  $1.4 \text{ W/m} \cdot \text{K}$ , what is the rate of heat loss through the slab? If the basement is heated by a gas furnace operating at an efficiency of  $\eta_f = 0.90$  and natural gas is priced at  $C_g = \$0.01/\text{MJ}$ , what is the daily cost of the heat loss?
- 1.4 The heat flux through a wood slab 50 mm thick, whose inner and outer surface temperatures are 40 and  $20^\circ\text{C}$ , respectively, has been determined to be  $40 \text{ W/m}^2$ . What is the thermal conductivity of the wood?
- 1.5 The inner and outer surface temperatures of a glass window 5 mm thick are 15 and  $5^\circ\text{C}$ . What is the heat loss through a window that is 1 m by 3 m on a side? The thermal conductivity of glass is  $1.4 \text{ W/m} \cdot \text{K}$ .
- 1.6 A glass window of width  $W = 1 \text{ m}$  and height  $H = 2 \text{ m}$  is 5 mm thick and has a thermal conductivity of  $k_g = 1.4 \text{ W/m} \cdot \text{K}$ . If the inner and outer surface temperatures of the glass are  $15^\circ\text{C}$  and  $-20^\circ\text{C}$ , respectively, on a cold winter day, what is the rate of heat loss through the glass? To reduce heat loss through windows, it is customary to use a double pane construction in which adjoining panes are separated by an air space. If the spacing is 10 mm and the glass surfaces in contact with the air have temperatures of  $10^\circ\text{C}$  and  $-15^\circ\text{C}$ , what is the rate of heat loss from a  $1 \text{ m} \times 2 \text{ m}$  window? The thermal conductivity of air is  $k_a = 0.024 \text{ W/m} \cdot \text{K}$ .
- 1.7 A freezer compartment consists of a cubical cavity that is 2 m on a side. Assume the bottom to be perfectly insulated. What is the minimum thickness of styrofoam insulation ( $k = 0.030 \text{ W/m} \cdot \text{K}$ ) that must be applied to the top and side walls to ensure a heat load of less than 500 W, when the inner and outer surfaces are  $-10$  and  $35^\circ\text{C}$ ?
- 1.8 An inexpensive food and beverage container is fabricated from 25-mm-thick polystyrene ( $k = 0.023 \text{ W/m} \cdot \text{K}$ ) and has interior dimensions of  $0.8 \text{ m} \times 0.6 \text{ m} \times 0.6 \text{ m}$ . Under conditions for which an inner surface temperature of approximately  $2^\circ\text{C}$  is maintained by an ice-water mixture and an outer surface temperature of  $20^\circ\text{C}$  is maintained by the ambient, what is the heat flux through the container wall? Assuming negligible heat gain through the  $0.8 \text{ m} \times 0.6 \text{ m}$  base of the cooler, what is the total heat load for the prescribed conditions?
- 1.9 What is the thickness required of a masonry wall having thermal conductivity  $0.75 \text{ W/m} \cdot \text{K}$  if the heat rate is to be 80% of the heat rate through a composite structural wall having a thermal conductivity of  $0.25 \text{ W/m} \cdot \text{K}$  and a thickness of 100 mm? Both walls are subjected to the same surface temperature difference.
- 1.10 The 5-mm-thick bottom of a 200-mm-diameter pan may be made from aluminum ( $k = 240 \text{ W/m} \cdot \text{K}$ ) or


copper ( $k = 390 \text{ W/m} \cdot \text{K}$ ). When used to boil water, the surface of the bottom exposed to the water is nominally at  $110^\circ\text{C}$ . If heat is transferred from the stove to the pan at a rate of  $600 \text{ W}$ , what is the temperature of the surface in contact with the stove for each of the two materials?

- 1.11** A square silicon chip ( $k = 150 \text{ W/m} \cdot \text{K}$ ) is of width  $w = 5 \text{ mm}$  on a side and of thickness  $t = 1 \text{ mm}$ . The chip is mounted in a substrate such that its side and back surfaces are insulated, while the front surface is exposed to a coolant.

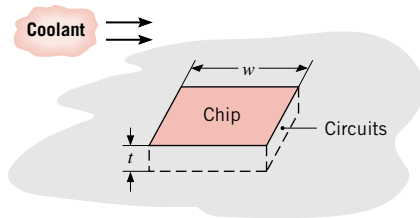

If  $4 \text{ W}$  are being dissipated in circuits mounted to the back surface of the chip, what is the steady-state temperature difference between back and front surfaces?

- 1.12** A gage for measuring heat flux to a surface or through a laminated material employs five thin-film, chromel/alumel (type K) thermocouples deposited on the upper and lower surfaces of a wafer with a thermal conductivity of  $1.4 \text{ W/m} \cdot \text{K}$  and a thickness of  $0.25 \text{ mm}$ .
- Determine the heat flux  $q''$  through the gage when the voltage output at the copper leads is  $350 \mu\text{V}$ . The Seebeck coefficient of the type-K thermocouple materials is approximately  $40 \mu\text{V}/^\circ\text{C}$ .
  - What precaution should you take in using a gage of this nature to measure heat flow through the laminated structure shown?

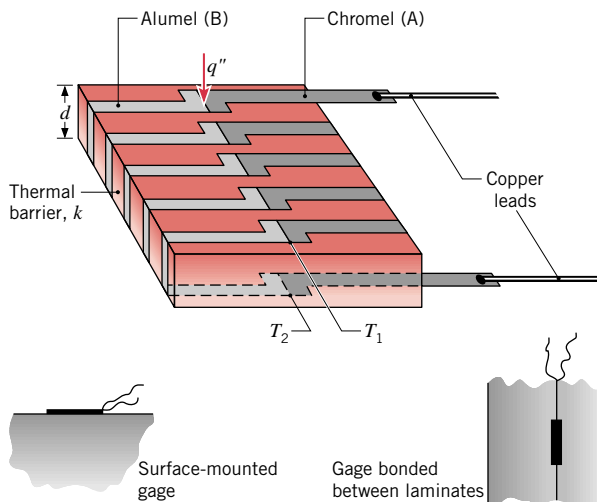

## Convection

- 1.13** You've experienced convection cooling if you've ever extended your hand out the window of a moving vehicle or into a flowing water stream. With the surface of your hand at a temperature of  $30^\circ\text{C}$ , determine the convection heat flux for (a) a vehicle speed of  $35 \text{ km/h}$  in air at  $-5^\circ\text{C}$  with a convection coefficient of  $40 \text{ W/m}^2 \cdot \text{K}$  and (b) a velocity of  $0.2 \text{ m/s}$  in a water stream at  $10^\circ\text{C}$  with a convection coefficient of  $900 \text{ W/m}^2 \cdot \text{K}$ . Which condition would *feel* colder? Contrast these results with a heat loss of approximately  $30 \text{ W/m}^2$  under normal room conditions.


- 1.14** Air at  $40^\circ\text{C}$  flows over a long,  $25\text{-mm}$ -diameter cylinder with an embedded electrical heater. In a series of tests, measurements were made of the power per unit length,  $P'$ , required to maintain the cylinder surface temperature at  $300^\circ\text{C}$  for different freestream velocities  $V$  of the air. The results are as follows:

Air velocity, $V$ (m/s)	1	2	4	8	12
Power, $P'$ (W/m)	450	658	983	1507	1963

- Determine the convection coefficient for each velocity, and display your results graphically.
  - Assuming the dependence of the convection coefficient on the velocity to be of the form  $h = CV^n$ , determine the parameters  $C$  and  $n$  from the results of part (a).
- 1.15** An electric resistance heater is embedded in a long cylinder of diameter  $30 \text{ mm}$ . When water with a temperature of  $25^\circ\text{C}$  and velocity of  $1 \text{ m/s}$  flows crosswise over the cylinder, the power per unit length required to maintain the surface at a uniform temperature of  $90^\circ\text{C}$  is  $28 \text{ kW/m}$ . When air, also at  $25^\circ\text{C}$ , but with a velocity of  $10 \text{ m/s}$  is flowing, the power per unit length required to maintain the same surface temperature is  $400 \text{ W/m}$ . Calculate and compare the convection coefficients for the flows of water and air.
- 1.16** A cartridge electrical heater is shaped as a cylinder of length  $L = 200 \text{ mm}$  and outer diameter  $D = 20 \text{ mm}$ . Under normal operating conditions the heater dissipates  $2 \text{ kW}$  while submerged in a water flow that is at  $20^\circ\text{C}$  and provides a convection heat transfer coefficient of  $h = 5000 \text{ W/m}^2 \cdot \text{K}$ . Neglecting heat transfer from the ends of the heater, determine its surface temperature  $T_s$ . If the water flow is inadvertently terminated while the heater continues to operate, the heater surface is exposed to air that is also at  $20^\circ\text{C}$  but for which  $h = 50 \text{ W/m}^2 \cdot \text{K}$ . What is the corresponding surface temperature? What are the consequences of such an event?


**1.17** A common procedure for measuring the velocity of an air stream involves insertion of an electrically heated wire (called a *hot-wire anemometer*) into the air flow, with the axis of the wire oriented perpendicular to the flow direction. The electrical energy dissipated in the wire is assumed to be transferred to the air by forced convection. Hence, for a prescribed electrical power, the temperature of the wire depends on the convection coefficient, which, in turn, depends on the velocity of the air. Consider a wire of length  $L = 20$  mm and diameter  $D = 0.5$  mm, for which a calibration of the form,  $V = 6.25 \times 10^{-5} h^2$ , has been determined. The velocity  $V$  and the convection coefficient  $h$  have units of m/s and  $\text{W/m}^2 \cdot \text{K}$ , respectively. In an application involving air at a temperature of  $T_\infty = 25^\circ\text{C}$ , the surface temperature of the anemometer is maintained at  $T_s = 75^\circ\text{C}$  with a voltage drop of 5 V and an electric current of 0.1 A. What is the velocity of the air?

**1.18** A square isothermal chip is of width  $w = 5$  mm on a side and is mounted in a substrate such that its side and back surfaces are well insulated, while the front surface is exposed to the flow of a coolant at  $T_\infty = 15^\circ\text{C}$ . From reliability considerations, the chip temperature must not exceed  $T = 85^\circ\text{C}$ .

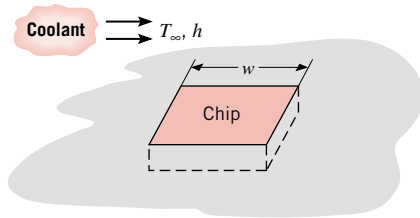

If the coolant is air and the corresponding convection coefficient is  $h = 200 \text{ W/m}^2 \cdot \text{K}$ , what is the maximum allowable chip power? If the coolant is a dielectric liquid for which  $h = 3000 \text{ W/m}^2 \cdot \text{K}$ , what is the maximum allowable power?


**1.19** The case of a power transistor, which is of length  $L = 10$  mm and diameter  $D = 12$  mm, is cooled by an air stream of temperature  $T_\infty = 25^\circ\text{C}$ .

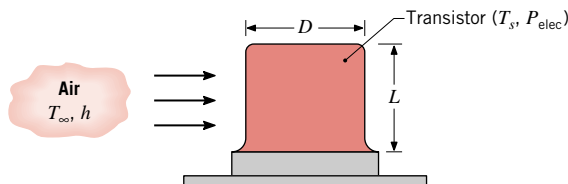

Under conditions for which the air maintains an average convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$  on the surface of the case, what is the maximum allowable power dissipation if the surface temperature is not to exceed  $85^\circ\text{C}$ ?

**1.20** The use of impinging air jets is proposed as a means of effectively cooling high-power logic chips in a computer. However, before the technique can be implemented, the convection coefficient associated with jet impingement on a chip surface must be known. Design an experiment that could be used to determine convection coefficients associated with air jet impingement on a chip measuring approximately 10 mm by 10 mm on a side.


**1.21** The temperature controller for a clothes dryer consists of a bimetallic switch mounted on an electrical heater attached to a wall-mounted insulation pad.

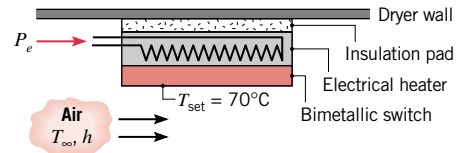

The switch is set to open at  $70^\circ\text{C}$ , the maximum dryer air temperature. In order to operate the dryer at a lower air temperature, sufficient power is supplied to the heater such that the switch reaches  $70^\circ\text{C}$  ( $T_{\text{set}}$ ) when the air temperature  $T$  is less than  $T_{\text{set}}$ . If the convection heat transfer coefficient between the air and the exposed switch surface of  $30 \text{ mm}^2$  is  $25 \text{ W/m}^2 \cdot \text{K}$ , how much heater power  $P_e$  is required when the desired dryer air temperature is  $T_\infty = 50^\circ\text{C}$ ?

**1.22** The free convection heat transfer coefficient on a thin hot vertical plate suspended in still air can be determined from observations of the change in plate temperature with time as it cools. Assuming the plate is isothermal and radiation exchange with its surroundings is negligible, evaluate the convection coefficient at the instant of time when the plate temperature is  $225^\circ\text{C}$  and the change in plate temperature with time ( $dT/dt$ ) is  $-0.022 \text{ K/s}$ . The ambient air temperature is  $25^\circ\text{C}$  and the plate measures  $0.3 \times 0.3$  m with a mass of 3.75 kg and a specific heat of  $2770 \text{ J/kg} \cdot \text{K}$ .

**1.23** A transmission case measures  $W = 0.30$  m on a side and receives a power input of  $P_i = 150$  hp from the engine.

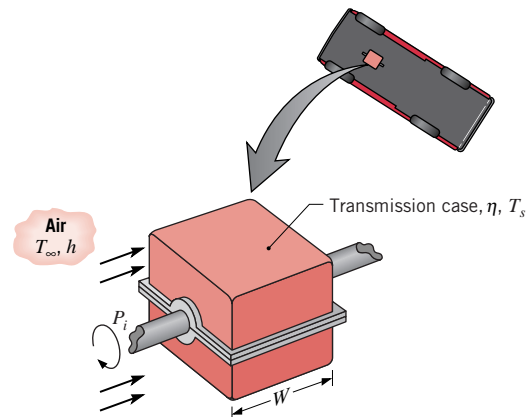

If the transmission efficiency is  $\eta = 0.93$  and air flow over the case corresponds to  $T_\infty = 30^\circ\text{C}$  and  $h = 200 \text{ W/m}^2 \cdot \text{K}$ , what is the surface temperature of the transmission?

## Radiation

**1.24** Under conditions for which the same room temperature is maintained by a heating or cooling system, it is not uncommon for a person to feel chilled in the winter but comfortable in the summer. Provide a plausible explanation for this situation (with supporting calculations) by considering a room whose air temperature is maintained at  $20^\circ\text{C}$  throughout the year, while the walls of the room are nominally at  $27^\circ\text{C}$  and  $14^\circ\text{C}$  in the summer and winter, respectively. The exposed surface of a person in the room may be assumed to be at a temperature of  $32^\circ\text{C}$  throughout the year and to have an emissivity of 0.90. The coefficient associated with heat transfer by natural convection between the person and the room air is approximately  $2 \text{ W/m}^2 \cdot \text{K}$ .

**1.25** A spherical interplanetary probe of 0.5-m diameter contains electronics that dissipate 150 W. If the probe surface has an emissivity of 0.8 and the probe does not receive radiation from other surfaces, as, for example, from the sun, what is its surface temperature?

**1.26** An instrumentation package has a spherical outer surface of diameter  $D = 100 \text{ mm}$  and emissivity  $\varepsilon = 0.25$ . The package is placed in a large space simulation chamber whose walls are maintained at 77 K. If operation of the electronic components is restricted to the temperature range  $40 \leq T \leq 85^\circ\text{C}$ , what is the range of acceptable power dissipation for the package? Display your results graphically, showing also the effect of variations in the emissivity by considering values of 0.20 and 0.30.

**1.27** Consider the conditions of Problem 1.22. However, now the plate is in a vacuum with a surrounding temperature of  $25^\circ\text{C}$ . What is the emissivity of the plate? What is the rate at which radiation is emitted by the surface?

**1.28** An overhead 25-m-long, uninsulated industrial steam pipe of 100 mm diameter is routed through a building whose walls and air are at  $25^\circ\text{C}$ . Pressurized steam maintains a pipe surface temperature of  $150^\circ\text{C}$ , and the coefficient associated with natural convection is  $h = 10 \text{ W/m}^2 \cdot \text{K}$ . The surface emissivity is  $\varepsilon = 0.8$ .

- What is the rate of heat loss from the steam line?
- If the steam is generated in a gas-fired boiler operating at an efficiency of  $\eta_f = 0.90$  and natural gas is priced at  $C_g = \$0.01$  per MJ, what is the annual cost of heat loss from the line?

**1.29** If  $T_s \approx T_{\text{sur}}$  in Equation 1.9, the radiation heat transfer coefficient may be approximated as


$$h_{r,a} = 4\varepsilon\sigma\bar{T}^3$$

where  $\bar{T} \equiv (T_s + T_{\text{sur}})/2$ . We wish to assess the validity of this approximation by comparing values of  $h_r$  and  $h_{r,a}$  for the following conditions. In each case represent your results graphically and comment on the validity of the approximation.

- Consider a surface of either polished aluminum ( $\varepsilon = 0.05$ ) or black paint ( $\varepsilon = 0.9$ ), whose temperature may exceed that of the surroundings ( $T_{\text{sur}} = 25^\circ\text{C}$ ) by 10 to  $100^\circ\text{C}$ . Also compare your results with values of the coefficient associated with free convection in air ( $T_\infty = T_{\text{sur}}$ ), where  $h \text{ (W/m}^2 \cdot \text{K)} = 0.98 \Delta T^{1/3}$ .
- Consider initial conditions associated with placing a workpiece at  $T_s = 25^\circ\text{C}$  in a large furnace whose wall temperature may be varied over the range  $100 \leq T_{\text{sur}} \leq 1000^\circ\text{C}$ . According to the surface finish or coating, its emissivity may assume values of 0.05, 0.2, and 0.9. For each emissivity, plot the relative error,  $(h_r - h_{r,a})/h_r$ , as a function of the furnace temperature.

**1.30** Consider the conditions of Problem 1.18. With heat transfer by convection to air, the maximum allowable chip power is found to be 0.35 W. If consideration is also given to net heat transfer by radiation from the chip surface to large surroundings at  $15^\circ\text{C}$ , what is the percentage increase in the maximum allowable chip power afforded by this consideration? The chip surface has an emissivity of 0.9.

**1.31** Chips of width  $L = 15 \text{ mm}$  on a side are mounted to a substrate that is installed in an enclosure whose walls and air are maintained at a temperature of  $T_{\text{sur}} = T_\infty = 25^\circ\text{C}$ . The chips have an emissivity of  $\varepsilon = 0.60$  and a maximum allowable temperature of  $T_s = 85^\circ\text{C}$ .

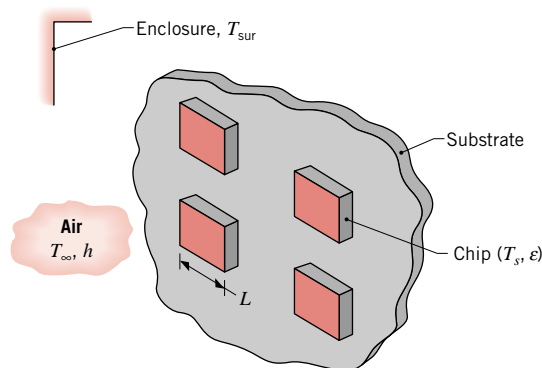


- If heat is rejected from the chips by radiation and natural convection, what is the maximum operating

power of each chip? The convection coefficient depends on the chip-to-air temperature difference and may be approximated as  $h = C(T_s - T_\infty)^{1/4}$ , where  $C = 4.2 \text{ W/m}^2 \cdot \text{K}^{5/4}$ .

- (b) If a fan is used to maintain air flow through the enclosure and heat transfer is by forced convection, with  $h = 250 \text{ W/m}^2 \cdot \text{K}$ , what is the maximum operating power?

- 1.32** A vacuum system, as used in sputtering electrically conducting thin films on microcircuits, is comprised of a baseplate maintained by an electrical heater at 300 K and a shroud within the enclosure maintained at 77 K by a liquid-nitrogen coolant loop. The circular baseplate, insulated on the lower side, is 0.3 m in diameter and has an emissivity of 0.25.

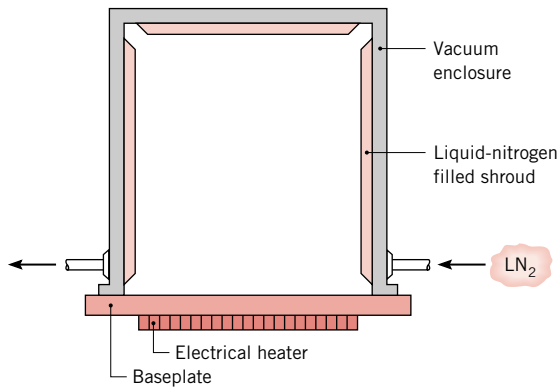


- (a) How much electrical power must be provided to the baseplate heater?
- (b) At what rate must liquid nitrogen be supplied to the shroud if its heat of vaporization is 125 kJ/kg?
- (c) To reduce the liquid-nitrogen consumption, it is proposed to bond a thin sheet of aluminum foil ( $\epsilon = 0.09$ ) to the baseplate. Will this have the desired effect?

- 1.33** Consider the transmission case of Problem 1.23, but now allow for radiation exchange with the ground/chassis, which may be approximated as large surroundings at  $T_{\text{sur}} = 30^\circ\text{C}$ . If the emissivity of the case is  $\epsilon = 0.80$ , what is the surface temperature?

### Energy Balance and Multimode Effects

- 1.34** An electrical resistor is connected to a battery, as shown schematically. After a brief transient, the resistor assumes a nearly uniform, steady-state temperature of  $95^\circ\text{C}$ , while the battery and lead wires remain at the ambient temperature of  $25^\circ\text{C}$ . Neglect the electrical resistance of the lead wires.

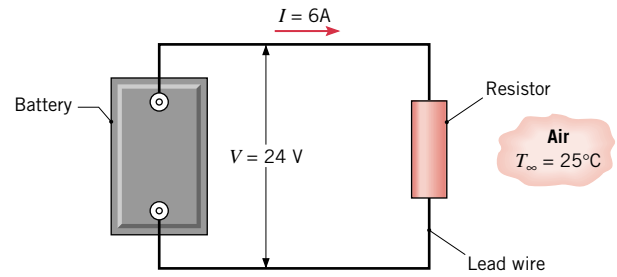

- (a) Consider the resistor as a system about which a control surface is placed and Equation 1.11c is applied. Determine the corresponding values of  $\dot{E}_{\text{in}}(\text{W})$ ,  $\dot{E}_g(\text{W})$ ,  $\dot{E}_{\text{out}}(\text{W})$ , and  $\dot{E}_{\text{st}}(\text{W})$ . If a control surface is placed about the entire system, what are the values of  $\dot{E}_{\text{in}}$ ,  $\dot{E}_g$ ,  $\dot{E}_{\text{out}}$ , and  $\dot{E}_{\text{st}}$ ?
- (b) If electrical energy is dissipated uniformly within the resistor, which is a cylinder of diameter  $D = 60 \text{ mm}$  and length  $L = 250 \text{ mm}$ , what is the volumetric heat generation rate,  $\dot{q}$  ( $\text{W/m}^3$ )?
- (c) Neglecting radiation from the resistor, what is the convection coefficient?
- 1.35** An aluminum plate 4 mm thick is mounted in a horizontal position, and its bottom surface is well insulated. A special, thin coating is applied to the top surface such that it absorbs 80% of any incident solar radiation, while having an emissivity of 0.25. The density  $\rho$  and specific heat  $c$  of aluminum are known to be  $2700 \text{ kg/m}^3$  and  $900 \text{ J/kg} \cdot \text{K}$ , respectively.
- (a) Consider conditions for which the plate is at a temperature of  $25^\circ\text{C}$  and its top surface is suddenly exposed to ambient air at  $T_\infty = 20^\circ\text{C}$  and to solar radiation that provides an incident flux of  $900 \text{ W/m}^2$ . The convection heat transfer coefficient between the surface and the air is  $h = 20 \text{ W/m}^2 \cdot \text{K}$ . What is the initial rate of change of the plate temperature?
- (b) What will be the equilibrium temperature of the plate when steady-state conditions are reached?
- (c) The surface radiative properties depend on the specific nature of the applied coating. Compute and plot the steady-state temperature as a function of the emissivity for  $0.05 \leq \epsilon \leq 1$ , with all other conditions remaining as prescribed. Repeat your calculations for values of  $\alpha_s = 0.5$  and  $1.0$ , and plot the results with those obtained for  $\alpha_s = 0.8$ . If the intent is to maximize the plate temperature, what is the most desirable combination of the plate emissivity and its absorptivity to solar radiation?

- 1.36** A blood warmer is to be used during the transfusion of blood to a patient. This device is to heat blood taken from the blood bank at  $10^\circ\text{C}$  to  $37^\circ\text{C}$  at a flow rate of  $200 \text{ ml/min}$ . The blood passes through tubing of length




2 m, with a rectangular cross section  $6.4 \text{ mm} \times 1.6 \text{ mm}$ . At what rate must heat be added to the blood to accomplish the required temperature increase? If the fluid originates from a large tank with nearly zero velocity and flows vertically downward for its 2-m length, estimate the magnitudes of kinetic and potential energy changes. Assume the blood's properties are similar to those of water.

- 1.37** The energy consumption associated with a home water heater has two components: (i) the energy that must be supplied to bring the temperature of groundwater to the heater storage temperature, as it is introduced to replace hot water that has been used, and (ii) the energy needed to compensate for heat losses incurred while the water is stored at the prescribed temperature. In this problem, we will evaluate the first of these components for a family of four, whose daily hot water consumption is approximately 100 gallons. If groundwater is available at  $15^\circ\text{C}$ , what is the annual energy consumption associated with heating the water to a storage temperature of  $55^\circ\text{C}$ ? For a unit electrical power cost of  $\$0.08/\text{kW} \cdot \text{h}$ , what is the annual cost associated with supplying hot water by means of (a) electric resistance heating or (b) a heat pump having a COP of 3.

- 1.38** Three electric resistance heaters of length  $L = 250 \text{ mm}$  and diameter  $D = 25 \text{ mm}$  are submerged in a 10 gallon tank of water, which is initially at  $295 \text{ K}$ . The water may be assumed to have a density and specific heat of  $\rho = 990 \text{ kg/m}^3$  and  $c = 4180 \text{ J/kg} \cdot \text{K}$ .


- If the heaters are activated, each dissipating  $q_1 = 500 \text{ W}$ , estimate the time required to bring the water to a temperature of  $335 \text{ K}$ .
- If the natural convection coefficient is given by an expression of the form  $h = 370(T_s - T)^{1/3}$ , where  $T_s$  and  $T$  are temperatures of the heater surface and water, respectively, what is the temperature of each heater shortly after activation and just before deactivation? Units of  $h$  and  $(T_s - T)$  are  $\text{W/m}^2 \cdot \text{K}$  and  $\text{K}$ , respectively.
- If the heaters are inadvertently activated when the tank is empty, the natural convection coefficient associated with heat transfer to the ambient air at  $T_\infty = 300 \text{ K}$  may be approximated as  $h = 0.70(T_s - T_\infty)^{1/3}$ . If the temperature of the tank walls is also  $300 \text{ K}$  and the emissivity of the heater surface is  $\varepsilon = 0.85$ , what is the surface temperature of each heater under steady-state conditions?

- 1.39** A hair dryer may be idealized as a circular duct through which a small fan draws ambient air and within which the air is heated as it flows over a coiled electric resistance wire.

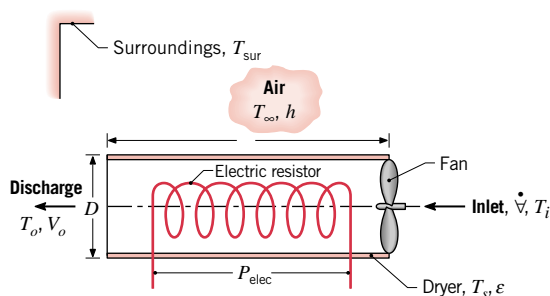


- If a dryer is designed to operate with an electric power consumption of  $P_{\text{elec}} = 500 \text{ W}$  and to heat air from an ambient temperature of  $T_i = 20^\circ\text{C}$  to a discharge temperature of  $T_o = 45^\circ\text{C}$ , at what volumetric flow rate  $\dot{V}$  should the fan operate? Heat loss from the casing to the ambient air and the surroundings may be neglected. If the duct has a diameter of  $D = 70 \text{ mm}$ , what is the discharge velocity  $V_o$  of the air? The density and specific heat of the air may be approximated as  $\rho = 1.10 \text{ kg/m}^3$  and  $c_p = 1007 \text{ J/kg} \cdot \text{K}$ , respectively.
- Consider a dryer duct length of  $L = 150 \text{ mm}$  and a surface emissivity of  $\varepsilon = 0.8$ . If the coefficient associated with heat transfer by natural convection from the casing to the ambient air is  $h = 4 \text{ W/m}^2 \cdot \text{K}$  and the temperature of the air and the surroundings is  $T_\infty = T_{\text{sur}} = 20^\circ\text{C}$ , confirm that the heat loss from the casing is, in fact, negligible. The casing may be assumed to have an average surface temperature of  $T_s = 40^\circ\text{C}$ .

- 1.40** In one stage of an annealing process, 304 stainless steel sheet is taken from  $300 \text{ K}$  to  $1250 \text{ K}$  as it passes through an electrically heated oven at a speed of  $V_s = 10 \text{ mm/s}$ . The sheet thickness and width are  $t_s = 8 \text{ mm}$  and  $W_s = 2 \text{ m}$ , respectively, while the height, width, and length of the oven are  $H_o = 2 \text{ m}$ ,  $W_o = 2.4 \text{ m}$ , and  $L_o = 25 \text{ m}$ , respectively. The top and four sides of the oven are exposed to ambient air and large surroundings, each at  $300 \text{ K}$ , and the corresponding surface temperature, convection coefficient, and emissivity are  $T_s = 350 \text{ K}$ ,  $h = 10 \text{ W/m}^2 \cdot \text{K}$ , and  $\varepsilon_s = 0.8$ . The bottom surface of the oven is also at  $350 \text{ K}$  and rests on a  $0.5\text{-m}$ -thick concrete pad whose base is at  $300 \text{ K}$ . Estimate the required electric power input,  $P_{\text{elec}}$ , to the oven.

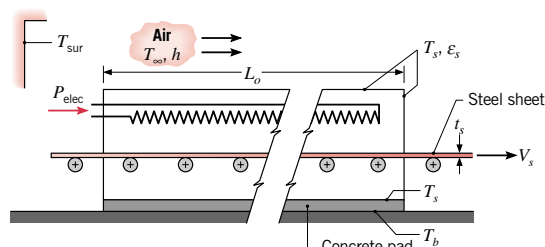


- 1.41** Annealing, an important step in semiconductor materials processing, can be accomplished by rapidly heating the silicon wafer to a high temperature for a short period of time. The schematic shows a method involving use of a hot plate operating at an elevated temperature  $T_h$ . The wafer, initially at a temperature of  $T_{w,i}$ , is suddenly positioned at a gap separation distance  $L$  from the hot plate. The purpose of the analysis is to compare the heat fluxes by conduction through the gas within the gap and by radiation exchange between the hot plate and the cool wafer. The initial time rate of change in the temperature of the wafer,  $(dT_w/dt)_i$ , is also of interest. Approximating the surfaces of the hot plate and the wafer as blackbodies and assuming their diameter  $D$  to be much larger than the spacing  $L$ , the radiative heat flux may be expressed as  $q''_{\text{rad}} = \sigma(T_h^4 - T_w^4)$ . The silicon wafer has a thickness of  $d = 0.78$  mm, a density of  $2700 \text{ kg/m}^3$ , and a specific heat of  $875 \text{ J/kg} \cdot \text{K}$ . The thermal conductivity of the gas in the gap is  $0.0436 \text{ W/m} \cdot \text{K}$ .

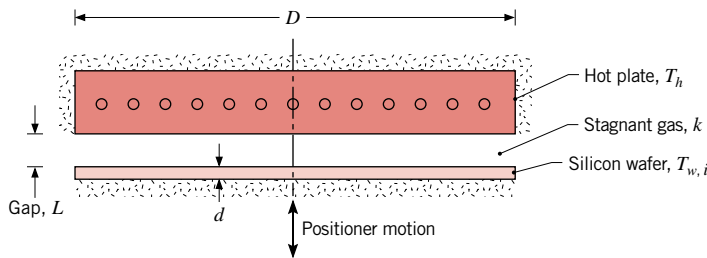

- (a) For  $T_h = 600^\circ\text{C}$  and  $T_{w,i} = 20^\circ\text{C}$ , calculate the radiative heat flux and the heat flux by conduction across a gap distance of  $L = 0.2$  mm. Also determine the value of  $(dT_w/dt)_i$ , resulting from each of the heating modes.
- (b) For gap distances of 0.2, 0.5, and 1.0 mm, determine the heat fluxes and temperature-time change as a function of the hot plate temperature for  $300 \leq T_h \leq 1300^\circ\text{C}$ . Display your results graphically. Comment on the relative importance of the two heat transfer modes and the effect of the gap distance on the heating process. Under what conditions could a wafer be heated to  $900^\circ\text{C}$  in less than 10 seconds?


- 1.42** In the thermal processing of semiconductor materials, annealing is accomplished by heating a silicon wafer according to a temperature-time recipe and then maintaining a fixed elevated temperature for a prescribed period of time. For the process tool arrangement shown as follows, the wafer is in an evacuated chamber whose walls are maintained at  $27^\circ\text{C}$  and within which heating lamps maintain a radiant flux  $q''_s$  at its upper surface. The wafer is 0.78 mm thick, has a thermal conductivity of  $30 \text{ W/m} \cdot \text{K}$ , and an emissivity that equals its absorptivity

to the radiant flux ( $\varepsilon = \alpha_i = 0.65$ ). For  $q''_s = 3.0 \times 10^5 \text{ W/m}^2$ , the temperature on its lower surface is measured by a radiation thermometer and found to have a value of  $T_{w,l} = 997^\circ\text{C}$ .

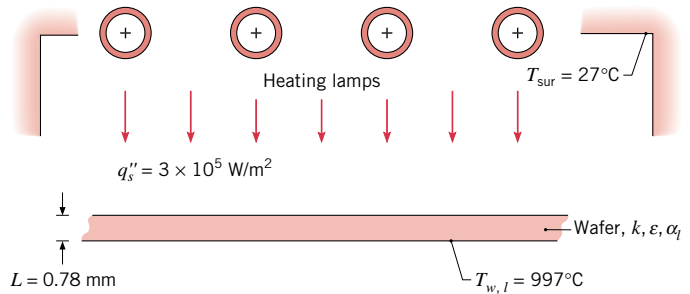

To avoid warping the wafer and inducing slip planes in the crystal structure, the temperature difference across the thickness of the wafer must be less than  $2^\circ\text{C}$ . Is this condition being met?


- 1.43** A furnace for processing semiconductor materials is formed by a silicon carbide chamber that is zone heated on the top section and cooled on the lower section. With the elevator in the lowest position, a robot arm inserts the silicon wafer on the mounting pins. In a production operation, the wafer is rapidly moved toward the hot zone to achieve the temperature-time history required for the process recipe. In this position the top and bottom surfaces of the wafer exchange radiation with the hot and cool zones, respectively, of the chamber. The zone temperatures are  $T_h = 1500 \text{ K}$  and  $T_c = 330 \text{ K}$ , and the emissivity and thickness of the wafer are  $\varepsilon = 0.65$  and  $d = 0.78$  mm, respectively. With the ambient gas at  $T_\infty = 700 \text{ K}$ , convection coefficients at the upper and lower surfaces of the wafer are  $8$  and  $4 \text{ W/m}^2 \cdot \text{K}$ , respectively. The silicon wafer has a density of  $2700 \text{ kg/m}^3$  and a specific heat of  $875 \text{ J/kg} \cdot \text{K}$ .

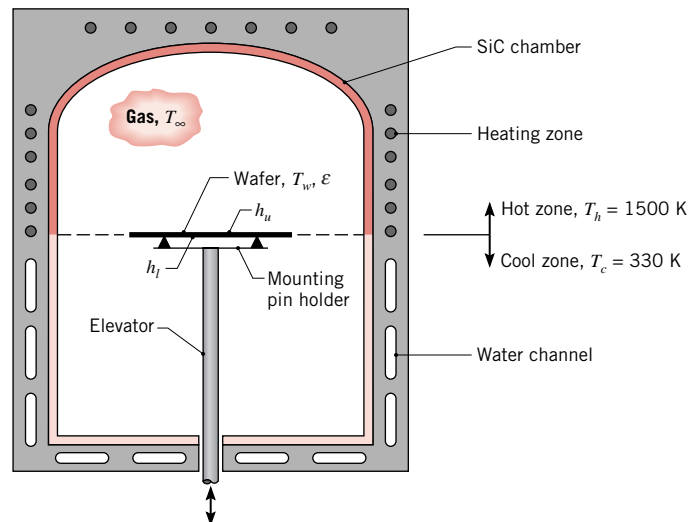



- (a) For an initial condition corresponding to a wafer temperature of  $T_{w,i} = 300$  K and the position of the wafer shown schematically, determine the corresponding time rate of change of the wafer temperature,  $(dT_w/dt)_i$ .
- (b) Determine the steady-state temperature reached by the wafer if it remains in this position. How significant is convection heat transfer for this situation? Sketch how you would expect the wafer temperature to vary as a function of vertical distance.

- 1.44** Radioactive wastes are packed in a long, thin-walled cylindrical container. The wastes generate thermal energy nonuniformly according to the relation  $\dot{q} = \dot{q}_o[1 - (r/r_o)^2]$ , where  $\dot{q}$  is the local rate of energy generation per unit volume,  $\dot{q}_o$  is a constant, and  $r_o$  is the radius of the container. Steady-state conditions are maintained by submerging the container in a liquid that is at  $T_\infty$  and provides a uniform convection coefficient  $h$ .

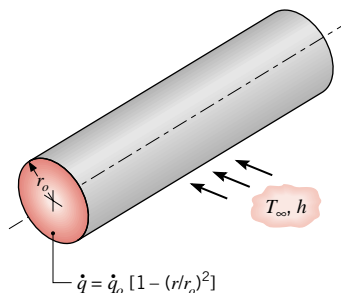

Obtain an expression for the total rate at which energy is generated in a unit length of the container. Use this result to obtain an expression for the temperature  $T_s$  of the container wall.

- 1.45** Consider the conducting rod of Example 1.3 under steady-state conditions. As suggested in Comment 3, the temperature of the rod may be controlled by varying the speed of air flow over the rod, which, in turn, alters the convection heat transfer coefficient. To consider the effect of the convection coefficient, generate plots of  $T$  versus  $I$  for values of  $h = 50, 100$ , and  $250$   $\text{W/m}^2 \cdot \text{K}$ . Would variations in the surface emissivity have a significant effect on the rod temperature?

- 1.46** A long bus bar (cylindrical rod used for making electrical connections) of diameter  $D$  is installed in a large conduit having a surface temperature of  $30^\circ\text{C}$  and in which the ambient air temperature is  $T_\infty = 30^\circ\text{C}$ . The electrical resistivity,  $\rho_e$  ( $\mu\Omega \cdot \text{m}$ ), of the bar material is a function of temperature,  $\rho_e = \rho_{e,o} [1 + \alpha(T - T_o)]$ , where  $\rho_{e,o} = 0.0171$   $\mu\Omega \cdot \text{m}$ ,  $T_o = 25^\circ\text{C}$ , and  $\alpha = 0.00396$   $\text{K}^{-1}$ . The bar experiences free convection in the ambient air, and the convection coefficient depends on the bar diameter, as well as on the difference between the surface and ambient


temperatures. The governing relation is of the form,  $h = CD^{-0.25}(T - T_\infty)^{0.25}$ , where  $C = 1.21$   $\text{W} \cdot \text{m}^{-1.75} \cdot \text{K}^{-1.25}$ . The emissivity of the bar surface is  $\varepsilon = 0.85$ .

- (a) Recognizing that the electrical resistance per unit length of the bar is  $R'_e = \rho_e/A_c$ , where  $A_c$  is its cross-sectional area, calculate the current-carrying capacity of a 20-mm-diameter bus bar if its temperature is not to exceed  $65^\circ\text{C}$ . Compare the relative importance of heat transfer by free convection and radiation exchange.

- (b) To assess the trade-off between current-carrying capacity, operating temperature, and bar diameter, for diameters of 10, 20, and 40 mm, plot the bar temperature  $T$  as a function of current for the range  $100 \leq I \leq 5000$  A. Also plot the ratio of the heat transfer by convection to the total heat transfer.

- 1.47** A small sphere of reference-grade iron with a specific heat of  $447$   $\text{J/kg} \cdot \text{K}$  and a mass of  $0.515$  kg is suddenly immersed in a water-ice mixture. Fine thermocouple wires suspend the sphere, and the temperature is observed to change from  $15$  to  $14^\circ\text{C}$  in  $6.35$  s. The experiment is repeated with a metallic sphere of the same diameter, but of unknown composition with a mass of  $1.263$  kg. If the same observed temperature change occurs in  $4.59$  s, what is the specific heat of the unknown material?

- 1.48** A spherical, stainless steel (AISI 302) canister is used to store reacting chemicals that provide for a uniform heat flux  $q''_i$  to its inner surface. The canister is suddenly submerged in a liquid bath of temperature  $T_\infty < T_i$ , where  $T_i$  is the initial temperature of the canister wall.

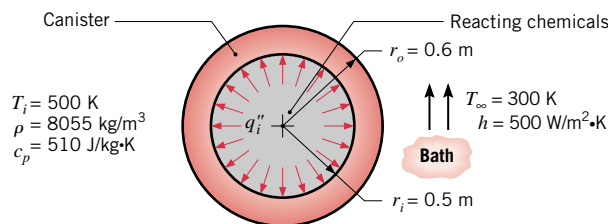

- (a) Assuming negligible temperature gradients in the canister wall and a constant heat flux  $q''_i$ , develop an equation that governs the variation of the wall temperature with time during the transient process. What is the initial rate of change of the wall temperature if  $q''_i = 10^5$   $\text{W/m}^2$ ?

- (b) What is the steady-state temperature of the wall?

- (c) The convection coefficient depends on the velocity associated with fluid flow over the canister and whether or not the wall temperature is large enough to induce boiling in the liquid. Compute and plot the steady-state temperature as a function of  $h$  for

the range  $100 \leq h \leq 10,000 \text{ W/m}^2 \cdot \text{K}$ . Is there a value of  $h$  below which operation would be unacceptable?

- 1.49** Liquid oxygen, which has a boiling point of 90 K and a latent heat of vaporization of 214 kJ/kg, is stored in a spherical container whose outer surface is of 500-mm diameter and at a temperature of  $-10^\circ\text{C}$ . The container is housed in a laboratory whose air and walls are at  $25^\circ\text{C}$ .

- (a) If the surface emissivity is 0.20 and the heat transfer coefficient associated with free convection at the outer surface of the container is  $10 \text{ W/m}^2 \cdot \text{K}$ , what is the rate, in kg/s, at which oxygen vapor must be vented from the system?
- (b) Moisture in the ambient air will result in frost formation on the container, causing the surface emissivity to increase. Assuming the surface temperature and convection coefficient to remain at  $-10^\circ\text{C}$  and  $10 \text{ W/m}^2 \cdot \text{K}$ , respectively, compute the oxygen evaporation rate (kg/s) as a function of surface emissivity over the range  $0.2 \leq \varepsilon \leq 0.94$ .


- 1.50** A freezer compartment is covered with a 2-mm-thick layer of frost at the time it malfunctions. If the compartment is in ambient air at  $20^\circ\text{C}$  and a coefficient of  $h = 2 \text{ W/m}^2 \cdot \text{K}$  characterizes heat transfer by natural convection from the exposed surface of the layer, estimate the time required to completely melt the frost. The frost may be assumed to have a mass density of  $700 \text{ kg/m}^3$  and a latent heat of fusion of 334 kJ/kg.

- 1.51** A vertical slab of Woods metal is joined to a substrate on one surface and is melted as it is uniformly irradiated by a laser source on the opposite surface. The metal is initially at its fusion temperature of  $T_f = 72^\circ\text{C}$ , and the melt runs off by gravity as soon as it is formed. The absorptivity of the metal to the laser radiation is  $\alpha_l = 0.4$ , and its latent heat of fusion is  $h_{sf} = 33 \text{ kJ/kg}$ .

- (a) Neglecting heat transfer from the irradiated surface by convection or radiation exchange with the surroundings, determine the instantaneous rate of melting in  $\text{kg/s} \cdot \text{m}^2$  if the laser irradiation is  $5 \text{ kW/m}^2$ . How much material is removed if irradiation is maintained for a period of 2 s?
- (b) Allowing for convection to ambient air, with  $T_\infty = 20^\circ\text{C}$  and  $h = 15 \text{ W/m}^2 \cdot \text{K}$ , and radiation exchange with large surroundings ( $\varepsilon = 0.4$ ,  $T_{\text{sur}} = 20^\circ\text{C}$ ), determine the instantaneous rate of melting during irradiation.


- 1.52** Following the hot vacuum forming of a paper-pulp mixture, the product, an egg carton, is transported on a conveyor for 18 s toward the entrance of a gas-fired

oven where it is dried to a desired final water content. It is observed that very little water evaporates during the travel time. So, to increase the productivity of the line, it is proposed that a bank of infrared radiation heaters, which provide a uniform radiant flux of  $5000 \text{ W/m}^2$ , be installed over the conveyor. The carton has an exposed area of  $0.0625 \text{ m}^2$  and a mass of 0.220 kg, 75% of which is water after the forming process.

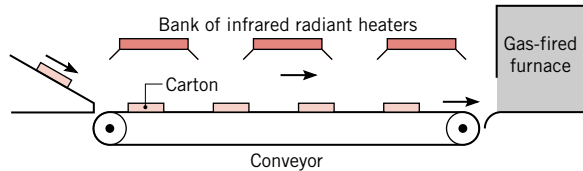


The chief engineer of your plant will approve the purchase of the heaters if they can reduce the water content by 10% of the total mass. Would you recommend the purchase? Assume the heat of vaporization of water is  $h_{fg} = 2400 \text{ kJ/kg}$ .

- 1.53** Electronic power devices are mounted to a heat sink having an exposed surface area of  $0.045 \text{ m}^2$  and an emissivity of 0.80. When the devices dissipate a total power of 20 W and the air and surroundings are at  $27^\circ\text{C}$ , the average sink temperature is  $42^\circ\text{C}$ . What average temperature will the heat sink reach when the devices dissipate 30 W for the same environmental condition?

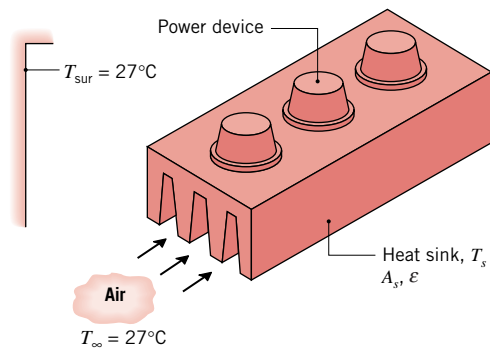

- 1.54** A computer consists of an array of five printed circuit boards (PCBs), each dissipating  $P_b = 20 \text{ W}$  of power. Cooling of the electronic components on a board is provided by the forced flow of air, equally distributed in passages formed by adjoining boards, and the convection coefficient associated with heat transfer from the components to the air is approximately  $h = 200 \text{ W/m}^2 \cdot \text{K}$ . Air enters the computer console at a temperature of  $T_i = 20^\circ\text{C}$ , and flow is driven by a fan whose power consumption is  $P_f = 25 \text{ W}$ .

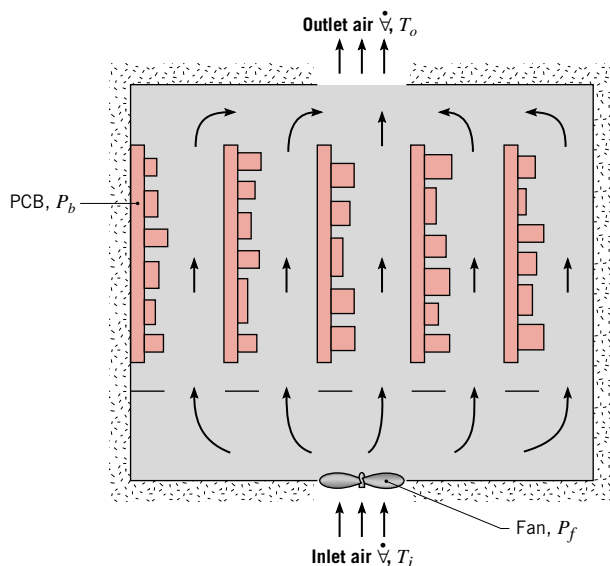

- (a) If the temperature rise of the air flow,  $(T_o - T_i)$ , is not to exceed  $15^\circ\text{C}$ , what is the minimum allowable volumetric flow rate  $\dot{V}$  of the air? The density and specific heat of the air may be approximated as  $\rho = 1.161 \text{ kg/m}^3$  and  $c_p = 1007 \text{ J/kg} \cdot \text{K}$ , respectively.
- (b) The component that is most susceptible to thermal failure dissipates  $1 \text{ W/cm}^2$  of surface area. To minimize the potential for thermal failure, where should the component be installed on a PCB? What is its surface temperature at this location?

**1.55** The roof of a car in a parking lot absorbs a solar radiant flux of  $800 \text{ W/m}^2$ , while the underside is perfectly insulated. The convection coefficient between the roof and the ambient air is  $12 \text{ W/m}^2 \cdot \text{K}$ .

- (a) Neglecting radiation exchange with the surroundings, calculate the temperature of the roof under steady-state conditions if the ambient air temperature is  $20^\circ\text{C}$ .
- (b) For the same ambient air temperature, calculate the temperature of the roof if its surface emissivity is 0.8.
- (c) The convection coefficient depends on airflow conditions over the roof, increasing with increasing air speed. Compute and plot the roof temperature as a function of  $h$  for  $2 \leq h \leq 200 \text{ W/m}^2 \cdot \text{K}$ .


**1.56** Consider the conditions of Problem 1.22, but the surroundings temperature is  $25^\circ\text{C}$  and radiation exchange with the surroundings is not negligible. If the convection coefficient is  $6.4 \text{ W/m}^2 \cdot \text{K}$  and the emissivity of the plate is  $\varepsilon = 0.42$ , determine the time rate of change of the plate temperature,  $dT/dt$ , when the plate temperature is  $225^\circ\text{C}$ . Evaluate the heat loss by convection and the heat loss by radiation.

**1.57** Most of the energy we consume as food is converted to thermal energy in the process of performing all our

bodily functions and is ultimately lost as heat from our bodies. Consider a person who consumes 2100 kcal per day (note that what are commonly referred to as food calories are actually kilocalories), of which 2000 kcal is converted to thermal energy. (The remaining 100 kcal is used to do work on the environment.) The person has a surface area of  $1.8 \text{ m}^2$  and is dressed in a bathing suit.

- (a) The person is in a room at  $20^\circ\text{C}$ , with a convection heat transfer coefficient of  $3 \text{ W/m}^2 \cdot \text{K}$ . At this air temperature, the person is not perspiring much. Estimate the person's average skin temperature.
- (b) If the temperature of the environment were  $33^\circ\text{C}$ , what rate of perspiration would be needed to maintain a comfortable skin temperature of  $33^\circ\text{C}$ ?

**1.58** Single fuel cells such as the one of Example 1.4 can be scaled up by arranging them into a *fuel cell stack*. A stack consists of multiple electrolytic membranes that are sandwiched between electrically conducting *bipolar plates*. Air and hydrogen are fed to each membrane through *flow channels* within each bipolar plate, as shown in the sketch. With this stack arrangement, the individual fuel cells are connected in series, electrically, producing a stack voltage of  $E_{\text{stack}} = N \times E_c$ , where  $E_c$  is the voltage produced across each membrane and  $N$  is the number of membranes in the stack. The electrical current is the same for each membrane. The cell voltage,  $E_c$ , as well as the cell efficiency, increases with temperature (the air and hydrogen fed to the stack are humidified to allow operation at temperatures greater than in Example 1.4), but the membranes will fail at temperatures exceeding  $T \approx 85^\circ\text{C}$ . Consider  $L \times w$  membranes, where  $L = w = 100 \text{ mm}$ , of thickness  $t_m = 0.43 \text{ mm}$  that each produce  $E_c = 0.6$  volts at  $I = 60 \text{ A}$ , and  $\dot{E}_{c,g} = 45 \text{ W}$  of thermal energy when operating at  $T = 80^\circ\text{C}$ . The external surfaces of the stack are exposed to air at  $T_\infty = 25^\circ\text{C}$  and surroundings at  $T_{\text{sur}} = 30^\circ\text{C}$ , with  $\varepsilon = 0.88$  and  $h = 150 \text{ W/m}^2 \cdot \text{K}$ .

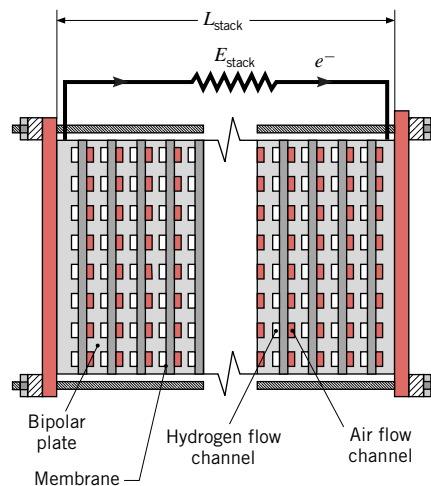

- (a) Find the electrical power produced by a stack that is  $L_{\text{stack}} = 200$  mm long, for bipolar plate thickness in the range  $1 \text{ mm} < t_{\text{bp}} < 10$  mm. Determine the total thermal energy generated by the stack.
- (b) Calculate the surface temperature and explain whether the stack needs to be internally heated or cooled to operate at the optimal internal temperature of  $80^\circ\text{C}$  for various bipolar plate thicknesses.
- (c) Identify how the internal stack operating temperature might be lowered or raised for a given bipolar plate thickness, and discuss design changes that would promote a more uniform temperature distribution within the stack. How would changes in the external air and surroundings temperature affect your answer? Which membrane in the stack is most likely to fail due to high operating temperature?

**1.59** Consider Problem 1.1.

- (a) If the exposed cold surface of the insulation is at  $T_2 = 20^\circ\text{C}$ , what is the value of the convection heat transfer coefficient on the cold side of the insulation if the surroundings temperature is  $T_{\text{sur}} = 320$  K, the ambient temperature is  $T_\infty = 5^\circ\text{C}$ , and the emissivity is  $\varepsilon = 0.95$ ? Express your results in units of  $\text{W/m}^2 \cdot \text{K}$  and  $\text{W/m}^2 \cdot ^\circ\text{C}$ .
- (b) Using the convective heat transfer coefficient you calculated in part (a), determine the surface temperature,  $T_2$ , as the emissivity of the surface is varied over the range  $0.05 \leq \varepsilon \leq 0.95$ . The hot wall temperature of the insulation remains fixed at  $T_1 = 30^\circ\text{C}$ . Display your results graphically.


**1.60** The wall of an oven used to cure plastic parts is of thickness  $L = 0.05$  m and is exposed to large surroundings and air at its outer surface. The air and the surroundings are at  $300$  K.

- (a) If the temperature of the outer surface is  $400$  K and its convection coefficient and emissivity are  $h = 20 \text{ W/m}^2 \cdot \text{K}$  and  $\varepsilon = 0.8$ , respectively, what is the temperature of the inner surface if the wall has a thermal conductivity of  $k = 0.7 \text{ W/m} \cdot \text{K}$ ?
- (b) Consider conditions for which the temperature of the inner surface is maintained at  $600$  K, while the air and large surroundings to which the outer surface is exposed are maintained at  $300$  K. Explore the effects of variations in  $k$ ,  $h$ , and  $\varepsilon$  on (i) the temperature of the outer surface, (ii) the heat flux through the wall, and (iii) the heat fluxes associated with convection and radiation heat transfer from the outer surface. Specifically, compute and plot the foregoing dependent variables for parametric variations about baseline conditions of  $k = 10 \text{ W/m} \cdot \text{K}$ ,  $h = 20 \text{ W/m}^2 \cdot \text{K}$ , and  $\varepsilon = 0.5$ . Suggested ranges of the independent variables are  $0.1 \leq k \leq$

$400 \text{ W/m} \cdot \text{K}$ ,  $2 \leq h \leq 200 \text{ W/m}^2 \cdot \text{K}$ , and  $0.05 \leq \varepsilon \leq 1$ . Discuss the physical implications of your results. Under what conditions will the temperature of the outer surface be less than  $45^\circ\text{C}$ , which is a reasonable upper limit to avoid burn injuries if contact is made?

- 1.61** An experiment to determine the convection coefficient associated with airflow over the surface of a thick stainless steel casting involves insertion of thermocouples in the casting at distances of  $10$  and  $20$  mm from the surface along a hypothetical line normal to the surface. The steel has a thermal conductivity of  $15 \text{ W/m} \cdot \text{K}$ . If the thermocouples measure temperatures of  $50$  and  $40^\circ\text{C}$  in the steel when the air temperature is  $100^\circ\text{C}$ , what is the convection coefficient?

- 1.62** A thin electrical heating element provides a uniform heat flux  $q_o''$  to the outer surface of a duct through which air flows. The duct wall has a thickness of  $10$  mm and a thermal conductivity of  $20 \text{ W/m} \cdot \text{K}$ .

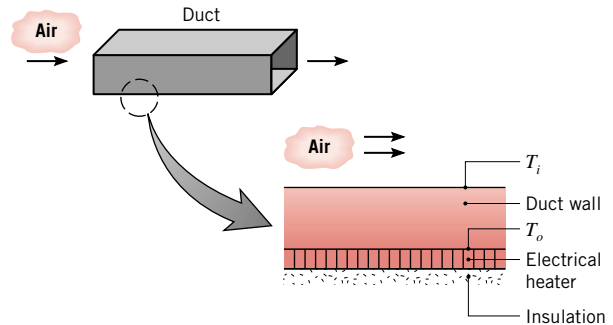

- (a) At a particular location, the air temperature is  $30^\circ\text{C}$  and the convection heat transfer coefficient between the air and inner surface of the duct is  $100 \text{ W/m}^2 \cdot \text{K}$ . What heat flux  $q_o''$  is required to maintain the inner surface of the duct at  $T_i = 85^\circ\text{C}$ ?
- (b) For the conditions of part (a), what is the temperature ( $T_o$ ) of the duct surface next to the heater?
- (c) With  $T_i = 85^\circ\text{C}$ , compute and plot  $q_o''$  and  $T_o$  as a function of the air-side convection coefficient  $h$  for the range  $10 \leq h \leq 200 \text{ W/m}^2 \cdot \text{K}$ . Briefly discuss your results.

- 1.63** A rectangular forced air heating duct is suspended from the ceiling of a basement whose air and walls are at a temperature of  $T_\infty = T_{\text{sur}} = 5^\circ\text{C}$ . The duct is  $15$  m long, and its cross-section is  $350 \text{ mm} \times 200 \text{ mm}$ .

- (a) For an uninsulated duct whose average surface temperature is  $50^\circ\text{C}$ , estimate the rate of heat loss from the duct. The surface emissivity and convection coefficient are approximately  $0.5$  and  $4 \text{ W/m}^2 \cdot \text{K}$ , respectively.
- (b) If heated air enters the duct at  $58^\circ\text{C}$  and a velocity of  $4$  m/s and the heat loss corresponds to the result of

part (a), what is the outlet temperature? The density and specific heat of the air may be assumed to be  $\rho = 1.10 \text{ kg/m}^3$  and  $c_p = 1008 \text{ J/kg} \cdot \text{K}$ , respectively.

- 1.64** Consider the steam pipe of Example 1.2. The facilities manager wants you to recommend methods for reducing the heat loss to the room, and two options are proposed. The first option would restrict air movement around the outer surface of the pipe and thereby reduce the convection coefficient by a factor of two. The second option would coat the outer surface of the pipe with a low emissivity ( $\varepsilon = 0.4$ ) paint.

(a) Which of the foregoing options would you recommend?

(b) To prepare for a presentation of your recommendation to management, generate a graph of the heat loss  $q'$  as a function of the convection coefficient for  $2 \leq h \leq 20 \text{ W/m}^2 \cdot \text{K}$  and emissivities of 0.2, 0.4, and 0.8. Comment on the relative efficacy of reducing heat losses associated with convection and radiation.

- 1.65** During its manufacture, plate glass at  $600^\circ\text{C}$  is cooled by passing air over its surface such that the convection heat transfer coefficient is  $h = 5 \text{ W/m}^2 \cdot \text{K}$ . To prevent cracking, it is known that the temperature gradient must not exceed  $15^\circ\text{C/mm}$  at any point in the glass during the cooling process. If the thermal conductivity of the glass is  $1.4 \text{ W/m} \cdot \text{K}$  and its surface emissivity is 0.8, what is the lowest temperature of the air that can initially be used for the cooling? Assume that the temperature of the air equals that of the surroundings.


- 1.66** The curing process of Example 1.7 involves exposure of the plate to irradiation from an infrared lamp and attendant cooling by convection and radiation exchange with the surroundings. Alternatively, in lieu of the lamp, heating may be achieved by inserting the plate in an oven whose walls (the surroundings) are maintained at an elevated temperature.

(a) Consider conditions for which the oven walls are at  $200^\circ\text{C}$ , air flow over the plate is characterized by  $T_\infty = 20^\circ\text{C}$  and  $h = 15 \text{ W/m}^2 \cdot \text{K}$ , and the coating has an emissivity of  $\varepsilon = 0.5$ . What is the temperature of the plate?

(b) For ambient air temperatures of 20, 40, and  $60^\circ\text{C}$ , determine the plate temperature as a function of the oven wall temperature over the range from 150 to  $250^\circ\text{C}$ . Plot your results, and identify conditions for which acceptable curing temperatures between 100 and  $110^\circ\text{C}$  may be maintained.

- 1.67** The electrical-substitution radiometer shown schematically determines the optical (radiant) power of a beam

by measuring the electrical power required to heat the receiver to the same temperature. With a beam, such as a laser of optical power  $P_{\text{opt}}$ , incident on the receiver, its temperature,  $T_s$ , increases above that of the chamber walls held at a uniform temperature,  $T_{\text{sur}} = 77 \text{ K}$ . With the optical beam blocked, the heater on the backside of the receiver is energized and the electrical power,  $P_{\text{elec}}$ , required to reach the same value of  $T_s$  is measured. The purpose of your analysis is to determine the relationship between the electrical and optical power, considering heat transfer processes experienced by the receiver.

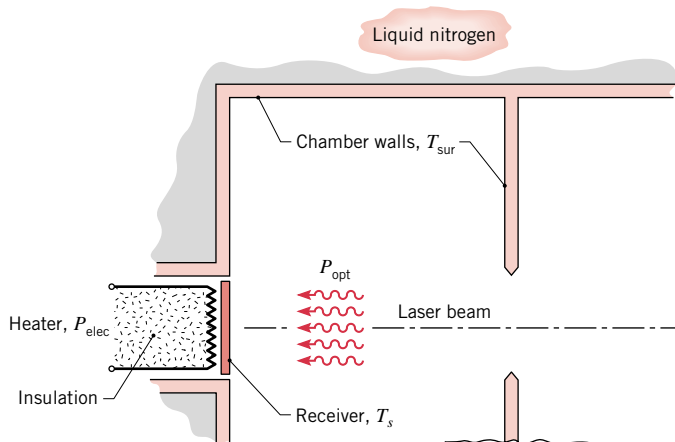

Consider a radiometer with a 15-mm-diameter receiver having a blackened surface with an emissivity of 0.95 and an absorptivity of 0.98 for the optical beam. When operating in the optical mode, conduction heat losses from the backside of the receiver are negligible. In the electrical mode, the loss amounts to 5% of the electrical power. What is the optical power of a beam when the indicated electrical power is 20.64 mW? What is the corresponding receiver temperature?

- 1.68** The diameter and surface emissivity of an electrically heated plate are  $D = 300 \text{ mm}$  and  $\varepsilon = 0.80$ , respectively.

(a) Estimate the power needed to maintain a surface temperature of  $200^\circ\text{C}$  in a room for which the air and the walls are at  $25^\circ\text{C}$ . The coefficient characterizing heat transfer by natural convection depends on the surface temperature and, in units of  $\text{W/m}^2 \cdot \text{K}$ , may be approximated by an expression of the form  $h = 0.80(T_s - T_\infty)^{1/3}$ .

(b) Assess the effect of surface temperature on the power requirement, as well as on the relative contributions of convection and radiation to heat transfer from the surface.

- 1.69** Bus bars proposed for use in a power transmission station have a rectangular cross section of height  $H = 600 \text{ mm}$  and width  $W = 200 \text{ mm}$ . The electrical resistivity,




$\rho_e(\mu\Omega \cdot \text{m})$ , of the bar material is a function of temperature,  $\rho_e = \rho_{e,o}[1 + \alpha(T - T_o)]$ , where  $\rho_{e,o} = 0.0828 \mu\Omega \cdot \text{m}$ ,  $T_o = 25^\circ\text{C}$ , and  $\alpha = 0.0040 \text{ K}^{-1}$ . The emissivity of the bar's painted surface is 0.8, and the temperature of the surroundings is  $30^\circ\text{C}$ . The convection coefficient between the bar and the ambient air at  $30^\circ\text{C}$  is  $10 \text{ W/m}^2 \cdot \text{K}$ .

(a) Assuming the bar has a uniform temperature  $T$ , calculate the steady-state temperature when a current of 60,000 A passes through the bar.

(b) Compute and plot the steady-state temperature of the bar as a function of the convection coefficient for  $10 \leq h \leq 100 \text{ W/m}^2 \cdot \text{K}$ . What minimum convection coefficient is required to maintain a safe-operating temperature below  $120^\circ\text{C}$ ? Will increasing the emissivity significantly affect this result?


- 1.70** A solar flux of  $700 \text{ W/m}^2$  is incident on a flat-plate solar collector used to heat water. The area of the collector is  $3 \text{ m}^2$ , and 90% of the solar radiation passes through the cover glass and is absorbed by the absorber plate. The remaining 10% is reflected away from the collector. Water flows through the tube passages on the back side of the absorber plate and is heated from an inlet temperature  $T_i$  to an outlet temperature  $T_o$ . The cover glass, operating at a temperature of  $30^\circ\text{C}$ , has an emissivity of 0.94 and experiences radiation exchange with the sky at  $-10^\circ\text{C}$ . The convection coefficient between the cover glass and the ambient air at  $25^\circ\text{C}$  is  $10 \text{ W/m}^2 \cdot \text{K}$ .

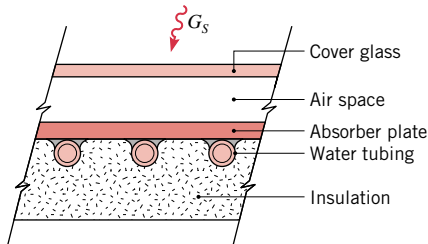

- (a) Perform an overall energy balance on the collector to obtain an expression for the rate at which useful heat is collected per unit area of the collector,  $q''_u$ . Determine the value of  $q''_u$ .
- (b) Calculate the temperature rise of the water,  $T_o - T_i$ , if the flow rate is  $0.01 \text{ kg/s}$ . Assume the specific heat of the water to be  $4179 \text{ J/kg} \cdot \text{K}$ .
- (c) The collector efficiency  $\eta$  is defined as the ratio of the useful heat collected to the rate at which solar energy is incident on the collector. What is the value of  $\eta$ ?

- 1.71** Consider a surface-mount type transistor on a circuit board whose temperature is maintained at  $35^\circ\text{C}$ . Air at  $20^\circ\text{C}$  flows over the upper surface of dimensions 4 mm by 8 mm with a convection coefficient of  $50 \text{ W/m}^2 \cdot \text{K}$ . Three wire leads, each of cross section 1 mm by 0.25 mm

and length 4 mm, conduct heat from the case to the circuit board. The gap between the case and the board is 0.2 mm.

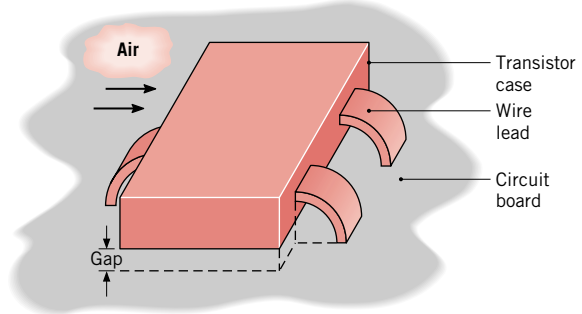

- (a) Assuming the case is isothermal and neglecting radiation, estimate the case temperature when 150 mW is dissipated by the transistor and (i) stagnant air or (ii) a conductive paste fills the gap. The thermal conductivities of the wire leads, air, and conductive paste are 25, 0.0263, and  $0.12 \text{ W/m} \cdot \text{K}$ , respectively.

(b) Using the conductive paste to fill the gap, we wish to determine the extent to which increased heat dissipation may be accommodated, subject to the constraint that the case temperature not exceed  $40^\circ\text{C}$ . Options include increasing the air speed to achieve a larger convection coefficient  $h$  and/or changing the lead wire material to one of larger thermal conductivity. Independently considering leads fabricated from materials with thermal conductivities of 200 and  $400 \text{ W/m} \cdot \text{K}$ , compute and plot the maximum allowable heat dissipation for variations in  $h$  over the range  $50 \leq h \leq 250 \text{ W/m}^2 \cdot \text{K}$ .


## Process Identification

- 1.72** In analyzing the performance of a thermal system, the engineer must be able to identify the relevant heat transfer processes. Only then can the system behavior be properly quantified. For the following systems identify the pertinent processes, designating them by appropriately labeled arrows on a sketch of the system. Answer additional questions that appear in the problem statement.

- (a) Identify the heat transfer processes that determine the temperature of an asphalt pavement on a summer day. Write an energy balance for the surface of the pavement.
- (b) Microwave radiation is known to be transmitted by plastics, glass, and ceramics, but to be absorbed by materials having polar molecules such as water. Water molecules exposed to microwave radiation align and reverse alignment with the microwave radiation at frequencies up to  $10^9 \text{ s}^{-1}$ , causing heat to be generated. Contrast cooking in a microwave


oven with cooking in a conventional radiant or convection oven. In each case what is the physical mechanism responsible for heating the food? Which oven has the greater energy utilization efficiency? Why? Microwave heating is being considered for drying clothes. How would operation of a microwave clothes dryer differ from a conventional dryer? Which is likely to have the greater energy utilization efficiency and why?

- (c) To prevent freezing of the liquid water inside the fuel cell of an automobile, the water is drained to an on-board storage tank when the automobile is not in use. (The water is transferred from the tank back to the fuel cell when the automobile is turned on.) Consider a fuel cell-powered automobile that is parked outside on a very cold evening with  $T_\infty = -20^\circ\text{C}$ . The storage tank is initially empty and at  $T_{i,t} = -20^\circ\text{C}$  when liquid water at atmospheric pressure and temperature  $T_{i,w} = 50^\circ\text{C}$  is introduced into the tank. The tank has a wall thickness  $t_t$  and is blanketed with insulation of thickness  $t_{ins}$ . Identify the heat transfer processes that will promote freezing of the water. Will the likelihood of freezing change as the insulation thickness is modified? Will the likelihood of freezing depend on the tank wall thickness and tank wall material? Would freezing of the water be more likely if plastic (low thermal conductivity) or stainless steel (moderate thermal conductivity) tubing is used to transfer the water to and from the tank? Is there an optimal tank shape that would minimize the probability of the water freezing? Would freezing be more likely or less likely to occur if a thin sheet of aluminum foil (high thermal conductivity, low emissivity) is applied to the outside of the insulation?

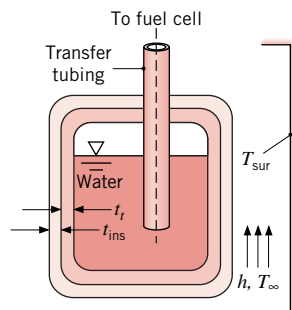


- (d) Consider an incandescent light source that consists of a tungsten filament enclosed in a gas-filled glass bulb. Assuming steady-state operation with the filament at a temperature of approximately 2900 K, list all the pertinent heat transfer processes for (i) the filament and (ii) the glass bulb.
- (e) There is considerable interest in developing building materials that have improved insulating qualities. The


development of such materials would do much to enhance energy conservation by reducing space heating requirements. It has been suggested that superior structural and insulating qualities could be obtained by using the composite shown. The material consists of a honeycomb, with cells of square cross section, sandwiched between solid slabs. The cells are filled with air, and the slabs, as well as the honeycomb matrix, are fabricated from plastics of low thermal conductivity. For heat transfer normal to the slabs, identify all heat transfer processes pertinent to the performance of the composite. Suggest ways in which this performance could be enhanced.

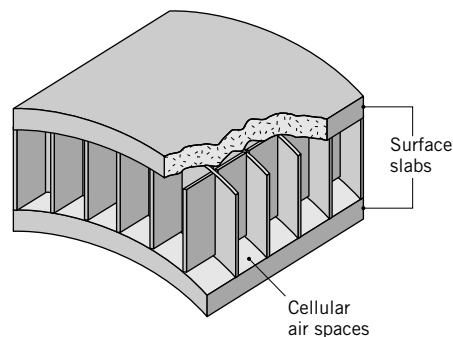

- (f) A thermocouple junction (bead) is used to measure the temperature of a hot gas stream flowing through a channel by inserting the junction into the mainstream of the gas. The surface of the channel is cooled such that its temperature is well below that of the gas. Identify the heat transfer processes associated with the junction surface. Will the junction sense a temperature that is less than, equal to, or greater than the gas temperature? A radiation shield is a small, open-ended tube that encloses the thermocouple junction, yet allows for passage of the gas through the tube. How does use of such a shield improve the accuracy of the temperature measurement?

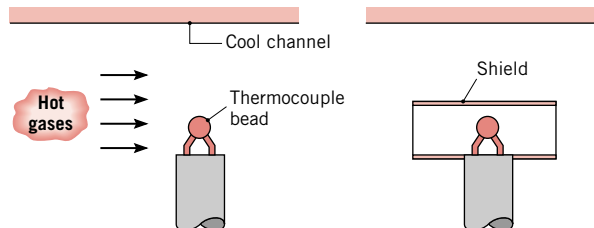


- (g) A double-glazed, glass fire screen is inserted between a wood-burning fireplace and the interior of a room. The screen consists of two vertical glass plates that are separated by a space through which room air may flow (the space is open at the top and bottom). Identify the heat transfer processes associated with the fire screen.

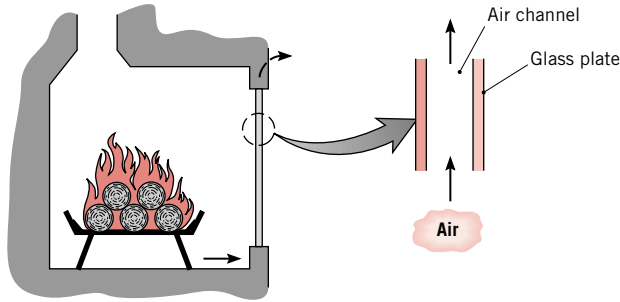


**1.73** In considering the following problems involving heat transfer in the natural environment (outdoors), recognize that solar radiation is comprised of long and short wavelength components. If this radiation is incident on a *semitransparent medium*, such as water or glass, two things will happen to the nonreflected portion of the radiation. The long wavelength component will be absorbed at the surface of the medium, whereas the short wavelength component will be transmitted by the surface.

- (a) The number of panes in a window can strongly influence the heat loss from a heated room to the outside ambient air. Compare the single- and double-paned units shown by identifying relevant heat transfer processes for each case.

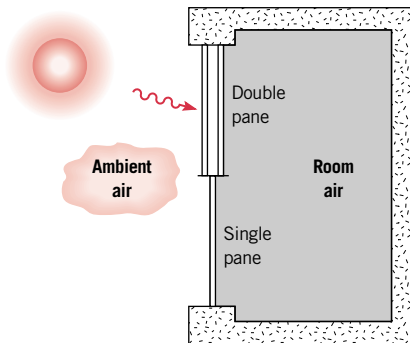


- (b) In a typical flat-plate solar collector, energy is collected by a working fluid that is circulated through tubes that are in good contact with the back face of an absorber plate. The back face is insulated from the surroundings, and the absorber plate receives solar radiation on its front face, which is typically covered by one or more transparent plates. Identify the relevant heat transfer processes, first for the absorber plate with no cover plate and then for the absorber plate with a single cover plate.
- (c) The solar energy collector design shown below has been used for agricultural applications. Air is

blown through a long duct whose cross section is in the form of an equilateral triangle. One side of the triangle is comprised of a double-paned, semi-transparent cover, while the other two sides are constructed from aluminum sheets painted flat black on the inside and covered on the outside with a layer of styrofoam insulation. During sunny periods, air entering the system is heated for delivery to either a greenhouse, grain drying unit, or a storage system.

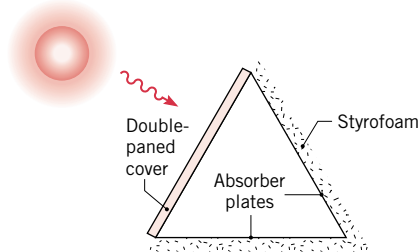

Identify all heat transfer processes associated with the cover plates, the absorber plate(s), and the air.

- (d) Evacuated-tube solar collectors are capable of improved performance relative to flat-plate collectors. The design consists of an inner tube enclosed in an outer tube that is transparent to solar radiation. The annular space between the tubes is evacuated. The outer, opaque surface of the inner tube absorbs solar radiation, and a working fluid is passed through the tube to collect the solar energy. The collector design generally consists of a row of such tubes arranged in front of a reflecting panel. Identify all heat transfer processes relevant to the performance of this device.

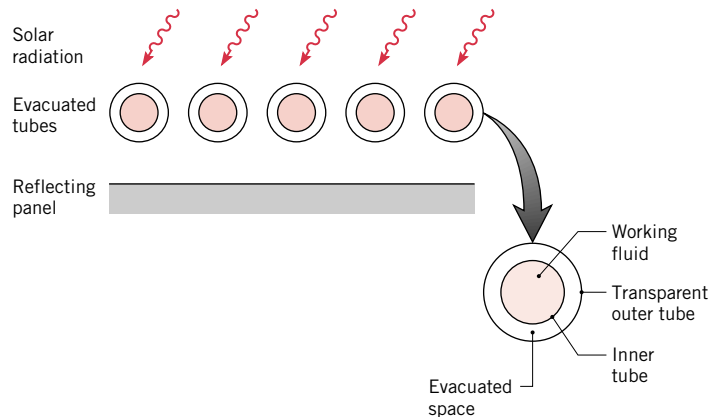






## *CHAPTER* **2**

# Introduction to Conduction

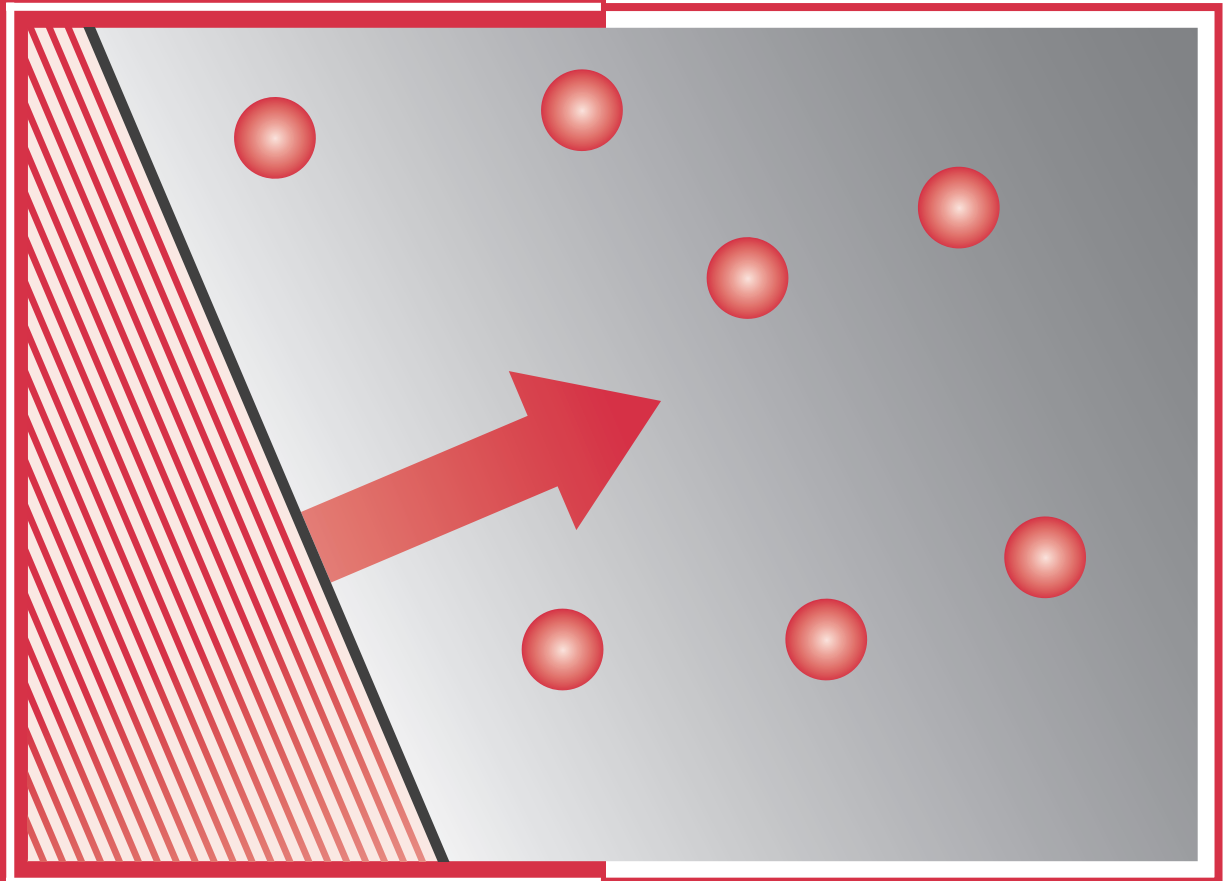

**R**ecall that conduction refers to the transport of energy in a medium due to a temperature gradient, and the physical mechanism is one of random atomic or molecular activity. In Chapter 1 we learned that conduction heat transfer is governed by *Fourier's law* and that use of the law to determine the heat flux depends on knowledge of the manner in which temperature varies within the medium (the *temperature distribution*). By way of introduction, we restricted our attention to simplified conditions (one-dimensional, steady-state conduction in a plane wall) for which the temperature distribution is readily deduced to be linear. However, Fourier's law is applicable to transient, multidimensional conduction in complex geometries for which the nature of the temperature distribution is not evident.

The objectives of this chapter are twofold. First, we wish to develop a deeper understanding of Fourier's law. What are its origins? What form does it take for different geometries? How does its proportionality constant (the *thermal conductivity*) depend on the physical nature of the medium? Our second objective is to develop, from basic principles, the general equation, termed the *heat equation*, which governs the temperature distribution in a medium. It is the solution to this equation that provides knowledge of the temperature distribution, which may then be used with Fourier's law to determine the heat flux.


## 2.1

### The Conduction Rate Equation

Although the conduction rate equation, Fourier's law, was introduced in Section 1.2, it is now appropriate to consider its origin. Fourier's law is *phenomenological*; that is, it is developed from observed phenomena rather than being derived from first principles. Hence, we view the rate equation as a generalization based on much experimental evidence. For example, consider the steady-state conduction experiment of Figure 2.1. A cylindrical rod of known material is insulated on its lateral surface, while its end faces are maintained at different temperatures, with  $T_1 > T_2$ . The temperature difference causes conduction heat transfer in the positive  $x$  direction. We are able to measure the heat transfer rate  $q_x$ , and we seek to determine how  $q_x$  depends on the following variables:  $\Delta T$ , the temperature difference;  $\Delta x$ , the rod length; and  $A$ , the cross-sectional area.

We might imagine first holding  $\Delta T$  and  $\Delta x$  constant and varying  $A$ . If we do so, we find that  $q_x$  is directly proportional to  $A$ . Similarly, holding  $\Delta T$  and  $A$  constant, we observe that  $q_x$  varies inversely with  $\Delta x$ . Finally, holding  $A$  and  $\Delta x$  constant, we find that  $q_x$  is directly proportional to  $\Delta T$ . The collective effect is then

$$q_x \propto A \frac{\Delta T}{\Delta x}$$

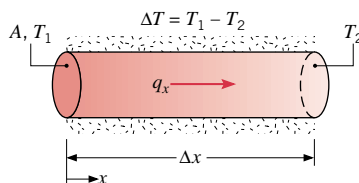

**FIGURE 2.1**  
Steady-state heat conduction experiment.

In changing the material (e.g., from a metal to a plastic), we would find that the above proportionality remains valid. However, we would also find that, for equal values of  $A$ ,  $\Delta x$ , and  $\Delta T$ , the value of  $q_x$  would be smaller for the plastic than for the metal. This suggests that the proportionality may be converted to an equality by introducing a coefficient that is a measure of the material behavior. Hence, we write


$$q_x = kA \frac{\Delta T}{\Delta x}$$

where  $k$ , the *thermal conductivity* ( $\text{W/m} \cdot \text{K}$ ), is an important *property* of the material. Evaluating this expression in the limit as  $\Delta x \rightarrow 0$ , we obtain for the heat *rate*

$$q_x = -kA \frac{dT}{dx} \quad (2.1)$$

or for the heat *flux*

$$q_x'' = \frac{q_x}{A} = -k \frac{dT}{dx} \quad (2.2)$$



**FIGURE 2.2**  
The relationship between coordinate system, heat flow direction, and temperature gradient in one dimension.

Recall that the minus sign is necessary because heat is always transferred in the direction of decreasing temperature.

Fourier's law, as written in Equation 2.2, implies that the heat flux is a directional quantity. In particular, the direction of  $q_x''$  is *normal* to the cross-sectional area  $A$ . Or, more generally, the direction of heat flow will always be normal to a surface of constant temperature, called an *isothermal* surface. Figure 2.2 illustrates the direction of heat flow  $q_x''$  in a plane wall for which the *temperature gradient*  $dT/dx$  is negative. From Equation 2.2, it follows that  $q_x''$  is positive. Note that the isothermal surfaces are planes normal to the  $x$  direction.

Recognizing that the heat flux is a vector quantity, we can write a more general statement of the conduction rate equation (*Fourier's law*) as follows:


$$\mathbf{q}'' = -k\nabla T = -k \left( \mathbf{i} \frac{\partial T}{\partial x} + \mathbf{j} \frac{\partial T}{\partial y} + \mathbf{k} \frac{\partial T}{\partial z} \right) \quad (2.3)$$

where  $\nabla$  is the three-dimensional del operator and  $T(x, y, z)$  is the scalar temperature field. It is implicit in Equation 2.3 that the heat flux vector is in a direction perpendicular to the isothermal surfaces. An alternative form of Fourier's law is therefore

$$q_n'' = -k \frac{\partial T}{\partial n} \quad (2.4)$$

where  $q_n''$  is the heat flux in a direction  $n$ , which is normal to an *isotherm*, as shown for the two-dimensional case in Figure 2.3. The heat transfer is sustained by a temperature gradient along  $n$ . Note also that the heat flux vector can be resolved into components such that, in Cartesian coordinates, the general expression for  $\mathbf{q}''$  is

$$\mathbf{q}'' = \mathbf{i}q_x'' + \mathbf{j}q_y'' + \mathbf{k}q_z'' \quad (2.5)$$



**FIGURE 2.3**  
The heat flux vector normal to an isotherm in a two-dimensional coordinate system.

where, from Equation 2.3, it follows that

$$q_x'' = -k \frac{\partial T}{\partial x} \quad q_y'' = -k \frac{\partial T}{\partial y} \quad q_z'' = -k \frac{\partial T}{\partial z} \quad (2.6)$$

Each of these expressions relates the heat flux *across a surface* to the temperature gradient in a direction perpendicular to the surface. It is also implicit in Equation 2.3 that the medium in which the conduction occurs is *isotropic*. For such a medium the value of the thermal conductivity is independent of the coordinate direction.

Fourier's law is the cornerstone of conduction heat transfer, and its key features are summarized as follows. It is *not* an expression that may be derived from first principles; it is instead a generalization based on experimental evidence. It is an expression that *defines* an important material property, the thermal conductivity. In addition, Fourier's law is a vector expression indicating that the heat flux is normal to an isotherm and in the direction of decreasing temperature. Finally, note that Fourier's law applies for all matter, regardless of its state (solid, liquid, or gas).

## 2.2

### The Thermal Properties of Matter

To use Fourier's law, the thermal conductivity of the material must be known. This property, which is referred to as a *transport property*, provides an indication of the rate at which energy is transferred by the diffusion process. It depends on the physical structure of matter, atomic and molecular, which is related to the state of the matter. In this section we consider various forms of matter, identifying important aspects of their behavior and presenting typical property values.

#### 2.2.1 Thermal Conductivity


From Fourier's law, Equation 2.6, the thermal conductivity associated with conduction in the  $x$ -direction is defined as

$$k_x \equiv -\frac{q_x''}{(\partial T / \partial x)}$$

Similar definitions are associated with thermal conductivities in the  $y$ - and  $z$ -directions ( $k_y, k_z$ ), but for an isotropic material the thermal conductivity is independent of the direction of transfer,  $k_x = k_y = k_z \equiv k$ .

From the foregoing equation, it follows that, for a prescribed temperature gradient, the conduction heat flux increases with increasing thermal conductivity. In general, the thermal conductivity of a solid is larger than that of a liquid, which is larger than that of a gas. As illustrated in Figure 2.4, the thermal conductivity of a solid may be more than four orders of magnitude larger than that of a gas. This trend is due largely to differences in intermolecular spacing for the two states.

**The Solid State** In the modern view of materials, a solid may be comprised of free electrons and atoms bound in a periodic arrangement called the lattice.

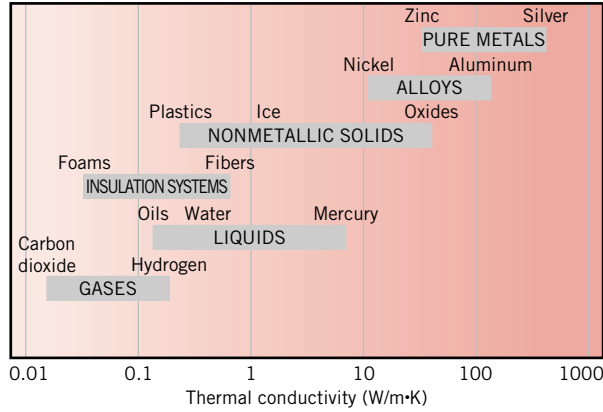

**FIGURE 2.4** Range of thermal conductivity for various states of matter at normal temperatures and pressure.

Accordingly, transport of thermal energy may be due to two effects: the migration of free electrons and lattice vibrational waves. When viewed as a particle-like phenomenon, the lattice vibration quanta are termed *phonons*. In pure metals, the electron contribution to conduction heat transfer dominates, while in nonconductors and semiconductors, the phonon contribution is dominant.

Kinetic theory yields the following expression for the thermal conductivity [1]:


$$k = \frac{1}{3} C \bar{c} \lambda_{\text{mfp}} \quad (2.7)$$

For conducting materials such as metals,  $C \equiv C_e$  is the electron specific heat per unit volume,  $\bar{c}$  is the mean electron velocity, and  $\lambda_{\text{mfp}} \equiv \lambda_e$  is the electron mean free path, which is defined as the average distance traveled by an electron before it collides with either an imperfection in the material or with a phonon. In nonconducting solids,  $C \equiv C_{\text{ph}}$  is the phonon specific heat,  $\bar{c}$  is the average speed of sound, and  $\lambda_{\text{mfp}} \equiv \lambda_{\text{ph}}$  is the phonon mean free path, which again is determined by collisions with imperfections or other phonons. In all cases, the thermal conductivity increases as the mean free path of the *energy carriers* (electrons or phonons) is increased.

When electrons and phonons carry thermal energy leading to conduction heat transfer in a solid, the thermal conductivity may be expressed as

$$k = k_e + k_{\text{ph}} \quad (2.8)$$

To a first approximation,  $k_e$  is inversely proportional to the electrical resistivity,  $\rho_e$ . For pure metals, which are of low  $\rho_e$ ,  $k_e$  is much larger than  $k_{\text{ph}}$ . In contrast, for alloys, which are of substantially larger  $\rho_e$ , the contribution of  $k_{\text{ph}}$  to  $k$  is no longer negligible. For nonmetallic solids,  $k$  is determined primarily by  $k_{\text{ph}}$ , which increases as the frequency of interactions between the atoms and the lattice decreases. The regularity of the lattice arrangement has an important effect on  $k_{\text{ph}}$ , with crystalline (well-ordered) materials like quartz having a higher thermal conductivity than amorphous materials like glass. In fact, for crystalline, nonmetallic solids such as diamond and beryllium oxide,  $k_{\text{ph}}$  can be quite large, exceeding values of  $k$  associated with good conductors, such as aluminum.

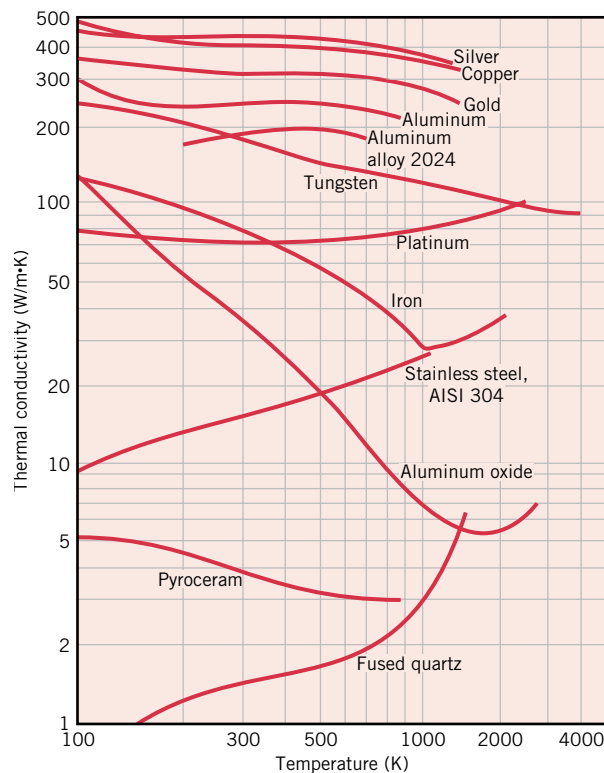


**FIGURE 2.5** The temperature dependence of the thermal conductivity of selected solids.

The temperature dependence of  $k$  is shown in Figure 2.5 for representative metallic and nonmetallic solids. Values for selected materials of technical importance are also provided in Table A.1 (metallic solids) and Tables A.2 and A.3 (non-metallic solids). More detailed treatments of thermal conductivity are available in the literature [2].

**The Solid State: Micro- and Nanoscale Effects** In the preceding discussion, the *bulk* thermal conductivity is described, and the thermal conductivity values listed in Tables A.1 through A.3 are appropriate for use when the physical dimensions of the material of interest are relatively large. This is the case in many commonplace engineering problems. However, in several areas of technology, such as microelectronics, the material's characteristic dimensions can be on the order of micrometers or nanometers, in which case care must be taken to account for the possible modifications of  $k$  that can occur as the physical dimensions become small.

Cross sections of *films* of the same material having thicknesses  $L_1$  and  $L_2$  are shown in Figure 2.6. Electrons or phonons that are associated with conduction of thermal energy are also shown qualitatively. Note that the physical boundaries of the film act to *scatter* the energy carriers and *redirect* their propagation. For large  $L/\lambda_{\text{mfp}}$  (Figure 2.6a), the effect of the boundaries on reducing the *average* energy carrier path length is minor, and conduction heat transfer occurs as described for bulk materials. However, as the film becomes thinner, the physical boundaries of the material can decrease the average *net* distance traveled by the energy carriers, as

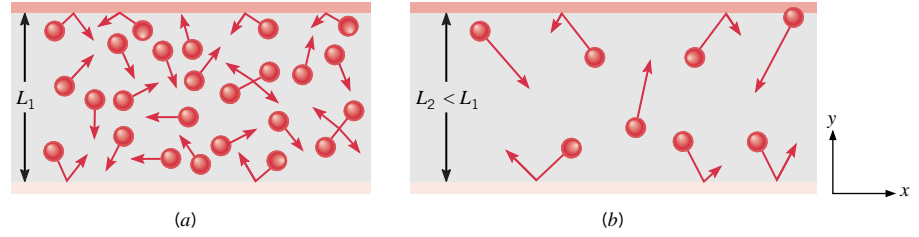

**FIGURE 2.6** Electron or phonon trajectories in (a) a relatively thick film and (b) a relatively thin film with boundary effects.

shown in Figure 2.6b. Moreover, electrons and phonons moving in the thin  $y$ -direction (representing conduction in the  $y$ -direction) are affected by the boundaries to a more significant degree than energy carriers moving in the  $x$ -direction. As such, for films characterized by small  $L/\lambda_{\text{mfp}}$ , we find that  $k_y < k_x < k$ , where  $k$  is the bulk thermal conductivity of the film material.

For  $L/\lambda_{\text{mfp}} \geq 1$ , predicted values of  $k_x$  and  $k_y$  may be estimated to within 20% from the following expression [1]:

$$k_x/k = 1 - 2\lambda_{\text{mfp}}/(3\pi L) \quad (2.9a)$$

$$k_y/k = 1 - \lambda_{\text{mfp}}/(3L) \quad (2.9b)$$


Equations 2.9a, b reveal that the values of  $k_x$  and  $k_y$  are within approximately 5% of the bulk thermal conductivity if  $L/\lambda_{\text{mfp}} > 7$  (for  $k_y$ ) and  $L/\lambda_{\text{mfp}} > 4.5$  (for  $k_x$ ). Values of the mean free path as well as critical film thicknesses below which microscale effects must be considered,  $L_{\text{crit}}$ , are included in Table 2.1 for several materials at  $T \approx 300$  K. For films with  $\lambda_{\text{mfp}} < L < L_{\text{crit}}$ ,  $k_x$  and  $k_y$  are reduced from the bulk value as indicated in Equations 2.9a, b. No general guidelines exist for predicting values of the thermal conductivities for  $L/\lambda_{\text{mfp}} < 1$ . Note that, in solids, the value of  $\lambda_{\text{mfp}}$  decreases as the temperature increases.

In addition to scattering from physical boundaries, as in the case of Figure 2.6b, energy carriers may be redirected by chemical *dopants* embedded within a material or by *grain boundaries* that separate individual clusters of material in otherwise homogeneous matter. *Nanostructured materials* are chemically identical to their conventional counterparts but are thermally processed to provide very small grain sizes in the final material and, from the heat transfer perspective, significantly increase the scattering and reflection of energy carriers at the grain boundaries.

**TABLE 2.1** Mean free path and critical film thickness for various materials at  $T \approx 300$  K [3,4]

Material	$\lambda_{\text{mfp}}$ (nm)	$L_{\text{crit},y}$ (nm)	$L_{\text{crit},x}$ (nm)
Aluminum oxide	5.08	36	22
Diamond (IIa)	315	2200	1400
Gallium arsenide	23	160	100
Gold	31	220	140
Silicon	43	290	180
Silicon dioxide	0.6	4	3
Yttria-stabilized zirconia	25	170	110



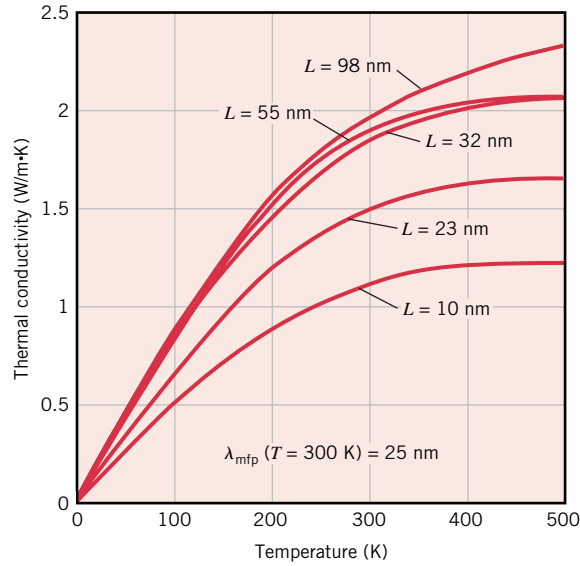

**FIGURE 2.7** Measured thermal conductivity of yttria-stabilized zirconia as a function of temperature and mean grain size [3].


Measured values of the thermal conductivity of a bulk, nanostructured yttria-stabilized zirconia material are shown in Figure 2.7. This particular ceramic is widely used for insulation purposes in high-temperature combustion devices such as gas turbine engines. Conduction is dominated by phonon transfer, and the mean free path of the phonon energy carriers is, from Table 2.1,  $\lambda_{\text{mfp}} = 25 \text{ nm}$  at 300 K. As the grain sizes are reduced to characteristic dimensions less than 25 nm (and more grain boundaries are introduced in the material per unit volume), significant reduction of the thermal conductivity occurs. Extrapolation of the results of Figure 2.7 to higher temperatures is not recommended, since the mean free path decreases with increasing temperature ( $\lambda_{\text{mfp}} \approx 4 \text{ nm}$  at  $T \approx 1525 \text{ K}$ ) and grains of the material may coalesce, merge, and enlarge at elevated temperatures. Therefore,  $L/\lambda_{\text{mfp}}$  becomes larger at high temperatures, and reduction of  $k$  due to nanoscale effects becomes less pronounced.

**The Fluid State** The fluid state includes both liquids and gases. Since the intermolecular spacing is much larger and the motion of the molecules is more random for the fluid state than for the solid state, thermal energy transport is less effective. The thermal conductivity of gases and liquids is therefore generally smaller than that of solids.

The effect of temperature, pressure, and chemical species on the thermal conductivity of a gas may be explained in terms of the kinetic theory of gases [5]. From this theory it is known that the thermal conductivity is directly proportional to the density of the gas, the mean molecular speed  $\bar{c}$ , and the mean free path  $\lambda_{\text{mfp}}$ , which is the average distance traveled by an energy carrier (a molecule) before experiencing a collision.

$$k = \frac{1}{3} c_v \rho \bar{c} \lambda_{\text{mfp}} \quad (2.10)$$

Because  $\bar{c}$  increases with increasing temperature and decreasing molecular weight, the thermal conductivity of a gas increases with increasing temperature and decreasing

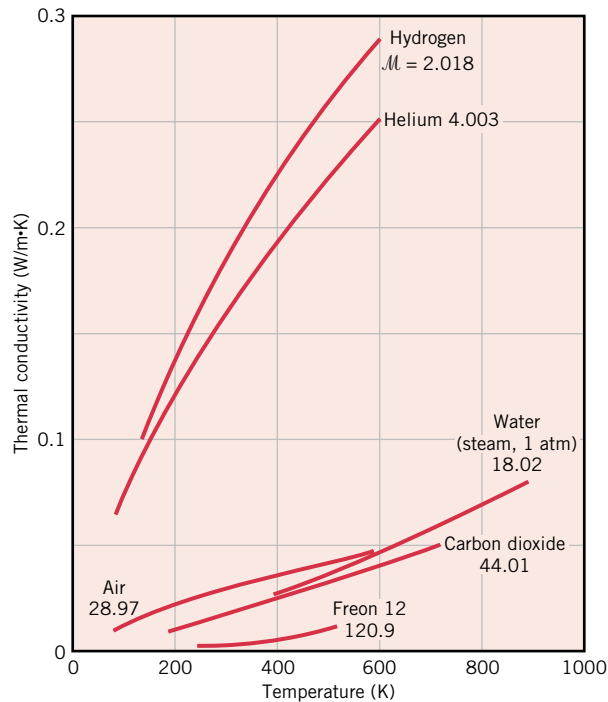


**FIGURE 2.8** The temperature dependence of the thermal conductivity of selected gases at normal pressures. Molecular weights ( $M$ ) of the gases are also shown.

molecular weight. These trends are shown in Figure 2.8. However, because  $\rho$  and  $\lambda_{\text{mfp}}$  are directly and inversely proportional to the gas pressure, respectively, the thermal conductivity is independent of pressure except in extreme cases as, for example, when conditions approach that of a perfect vacuum. Therefore, the assumption that  $k$  is independent of gas pressure for large volumes of gas is appropriate for the pressures of interest in this text. Accordingly, although the values of  $k$  presented in Table A.4 pertain to atmospheric pressure or the saturation pressure corresponding to the prescribed temperature, they may be used over a much wider pressure range.

Molecular conditions associated with the liquid state are more difficult to describe, and physical mechanisms for explaining the thermal conductivity are not well understood [6]. The thermal conductivity of nonmetallic liquids generally decreases with increasing temperature. As shown in Figure 2.9, water, glycerine, and engine oil are notable exceptions. The thermal conductivity of liquids is usually insensitive to pressure except near the critical point. Also, it is generally true that thermal conductivity decreases with increasing molecular weight. Values of the thermal conductivity are often tabulated as a function of temperature for the saturated state of the liquid. Tables A.5 and A.6 present such data for several common liquids.

Liquid metals are commonly used in high heat flux applications, such as occur in nuclear power plants. The thermal conductivity of such liquids is given in Table A.7. Note that the values are much larger than those of the nonmetallic liquids [7].

**The Fluid State: Micro- and Nanoscale Effects** As in the solid state, the bulk thermal conductivity may be modified as the characteristic dimensions of the

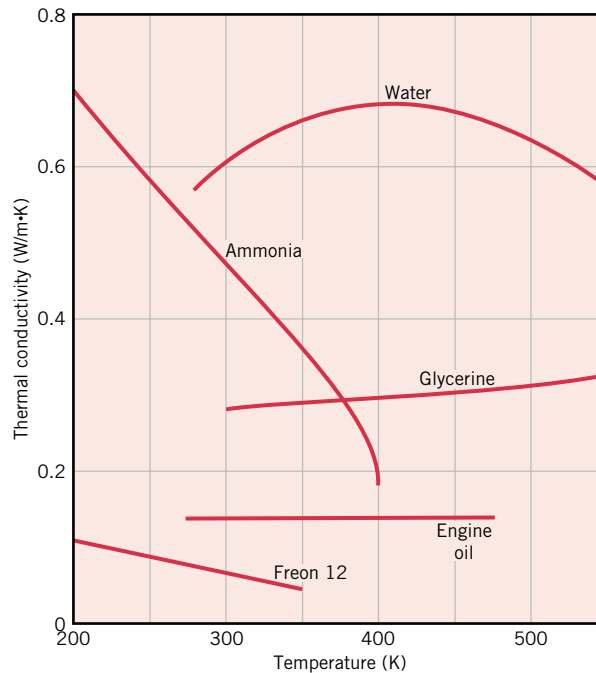


**FIGURE 2.9** The temperature dependence of the thermal conductivity of selected nonmetallic liquids under saturated conditions.

system become small, in particular for small values of  $L/\lambda_{\text{mfp}}$ . As for the situation shown in Figure 2.6b, the mean free path of the molecules becomes restricted when the fluid is, for example, contained in an enclosure of small physical dimension.

**Insulation Systems** Thermal insulations consist of low thermal conductivity materials combined to achieve an even lower system thermal conductivity. In conventional *fiber*-, *powder*-, and *flake*-type insulations, the solid material is finely dispersed throughout an air space. Such systems are characterized by an *effective thermal conductivity*, which depends on the thermal conductivity and surface radiative properties of the solid material, as well as the nature and volumetric fraction of the air or void space. A special parameter of the system is its bulk density (solid mass/total volume), which depends strongly on the manner in which the material is packed.

If small voids or hollow spaces are formed by bonding or fusing portions of the solid material, a rigid matrix is created. When these spaces are sealed from each other, the system is referred to as a *cellular* insulation. Examples of such rigid insulations are *foamed* systems, particularly those made from plastic and glass materials. *Reflective* insulations are composed of multilayered, parallel, thin sheets or foils of high reflectivity, which are spaced to reflect radiant energy back to its source. The spacing between the foils is designed to restrict the motion of air, and in high-performance insulations, the space is evacuated. In all types of insulation, evacuation of the air in the void space will reduce the effective thermal conductivity of the system.

It is important to recognize that heat transfer through any of these insulation systems may include several modes: conduction through the solid materials; conduction

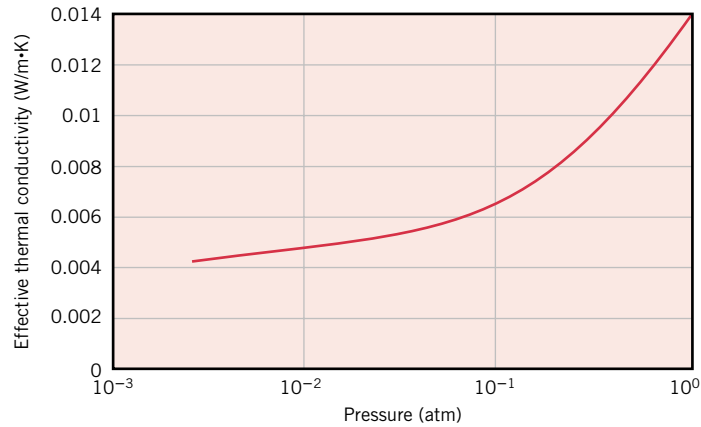

**FIGURE 2.10** Measured thermal conductivity of carbon-doped silica aerogel as a function of pressure at  $T \approx 300$  K [10].

or convection through the air in the void spaces; and radiation exchange between the surfaces of the solid matrix. The effective thermal conductivity accounts for all of these processes, and values for selected insulation systems are summarized in Table A.3. Additional background information and data are available in the literature [8, 9].

As with thin films, micro- and nanoscale effects can influence the effective thermal conductivity of insulating materials. The value of  $k$  for a nanostructured silica aerogel material that is composed of approximately 5% by volume solid material and 95% by volume air that is trapped within pores of  $L \approx 20$  nm is shown in Figure 2.10. Note that at  $T \approx 300$  K, the mean free path for air at atmospheric pressure is approximately 80 nm. As the gas pressure is reduced,  $\lambda_{\text{mfp}}$  would increase for an unconfined gas, but the molecular motion of the trapped air is restricted by the walls of the small pores and  $k$  is reduced to extremely small values relative to the thermal conductivities of conventional matter reported in Figure 2.4.

### 2.2.2 Other Relevant Properties

In our analysis of heat transfer problems, it will be necessary to use several properties of matter. These properties are generally referred to as *thermophysical* properties and include two distinct categories, *transport* and *thermodynamic* properties. The transport properties include the diffusion rate coefficients such as  $k$ , the thermal conductivity (for heat transfer), and  $\nu$ , the kinematic viscosity (for momentum transfer). Thermodynamic properties, on the other hand, pertain to the equilibrium state of a system. Density ( $\rho$ ) and specific heat ( $c_p$ ) are two such properties used extensively in thermodynamic analysis. The product  $\rho c_p$  ( $\text{J/m}^3 \cdot \text{K}$ ), commonly termed the *volumetric heat capacity*, measures the ability of a material to store thermal energy. Because substances of large density are typically characterized by small specific heats, many solids and liquids, which are very good energy storage media, have comparable heat capacities ( $\rho c_p > 1 \text{ MJ/m}^3 \cdot \text{K}$ ). Because of their very small densities, however, gases are poorly suited for thermal energy storage ( $\rho c_p \approx 1 \text{ kJ/m}^3 \cdot \text{K}$ ). Densities and specific heats are provided in the tables of Appendix A for a wide range of solids, liquids, and gases.

In heat transfer analysis, the ratio of the thermal conductivity to the heat capacity is an important property termed the *thermal diffusivity*  $\alpha$ , which has units of  $\text{m}^2/\text{s}$ :

$$\alpha = \frac{k}{\rho c_p}$$

It measures the ability of a material to conduct thermal energy relative to its ability to store thermal energy. Materials of large  $\alpha$  will respond quickly to changes in their thermal environment, while materials of small  $\alpha$  will respond more sluggishly, taking longer to reach a new equilibrium condition.

The accuracy of engineering calculations depends on the accuracy with which the thermophysical properties are known [11–13]. Numerous examples could be cited of flaws in equipment and process design or failure to meet performance specifications that were attributable to misinformation associated with the selection of key property values used in the initial system analysis. Selection of reliable property data is an integral part of any careful engineering analysis. The casual use of data that have not been well characterized or evaluated, as may be found in some literature or handbooks, is to be avoided. Recommended data values for many thermophysical properties can be obtained from Reference 14. This reference, available in most institutional libraries, was prepared by the Thermophysical Properties Research Center (TPRC) at Purdue University.

### EXAMPLE 2.1

The thermal diffusivity  $\alpha$  is the controlling transport property for transient conduction. Using appropriate values of  $k$ ,  $\rho$ , and  $c_p$  from Appendix A, calculate  $\alpha$  for the following materials at the prescribed temperatures: pure aluminum, 300 and 700 K; silicon carbide, 1000 K; paraffin, 300 K.

### SOLUTION

**Known:** Definition of the thermal diffusivity  $\alpha$ .

**Find:** Numerical values of  $\alpha$  for selected materials and temperatures.

**Properties:** Table A.1, pure aluminum (300 K):

$$\left. \begin{array}{l} \rho = 2702 \text{ kg/m}^3 \\ c_p = 903 \text{ J/kg} \cdot \text{K} \\ k = 237 \text{ W/m} \cdot \text{K} \end{array} \right\} \alpha = \frac{k}{\rho c_p} = \frac{237 \text{ W/m} \cdot \text{K}}{2702 \text{ kg/m}^3 \times 903 \text{ J/kg} \cdot \text{K}}$$

$$= 97.1 \times 10^{-6} \text{ m}^2/\text{s}$$

Table A.1, pure aluminum (700 K):

$\rho = 2702 \text{ kg/m}^3$	at 300 K
$c_p = 1090 \text{ J/kg} \cdot \text{K}$	at 700 K (by linear interpolation)
$k = 225 \text{ W/m} \cdot \text{K}$	at 700 K (by linear interpolation)

Hence

$$\alpha = \frac{k}{\rho c_p} = \frac{225 \text{ W/m} \cdot \text{K}}{2702 \text{ kg/m}^3 \times 1090 \text{ J/kg} \cdot \text{K}} = 76 \times 10^{-6} \text{ m}^2/\text{s} \quad \triangleleft$$

Table A.2, silicon carbide (1000 K):

$$\left. \begin{array}{ll} \rho = 3160 \text{ kg/m}^3 & \text{at 300 K} \\ c_p = 1195 \text{ J/kg} \cdot \text{K} & \text{at 1000 K} \\ k = 87 \text{ W/m} \cdot \text{K} & \text{at 1000 K} \end{array} \right\} \alpha = \frac{87 \text{ W/m} \cdot \text{K}}{3160 \text{ kg/m}^3 \times 1195 \text{ J/kg} \cdot \text{K}}$$

$$= 23 \times 10^{-6} \text{ m}^2/\text{s} \quad \triangleleft$$

Table A.3, paraffin (300 K):

$$\left. \begin{array}{ll} \rho = 900 \text{ kg/m}^3 & \\ c_p = 2890 \text{ J/kg} \cdot \text{K} & \\ k = 0.24 \text{ W/m} \cdot \text{K} & \end{array} \right\} \alpha = \frac{k}{\rho c_p} = \frac{0.24 \text{ W/m} \cdot \text{K}}{900 \text{ kg/m}^3 \times 2890 \text{ J/kg} \cdot \text{K}}$$

$$= 9.2 \times 10^{-8} \text{ m}^2/\text{s} \quad \triangleleft$$

### Comments:

1. Note temperature dependence of the thermophysical properties of aluminum and silicon carbide. For example, for silicon carbide,  $\alpha(1000 \text{ K}) \approx 0.1 \times \alpha(300 \text{ K})$ ; hence properties of this material have a strong temperature dependence.
2. The physical interpretation of  $\alpha$  is that it provides a measure of heat transport ( $k$ ) relative to energy storage ( $\rho c_p$ ). In general, metallic solids have higher  $\alpha$ , while nonmetallics (e.g., paraffin) have lower values of  $\alpha$ .
3. Linear interpolation of property values is generally acceptable for engineering calculations.
4. Use of the low-temperature (300 K) density at higher temperatures ignores thermal expansion effects but is also acceptable for engineering calculations.
5. The *IHT* software provides a library of thermophysical properties for selected solids, liquids, and gases that can be accessed from the toolbar button, *Properties*. The properties are expressed as intrinsic functions, as shown for the thermal conductivity of atmospheric air,

$$k = k\_T(\text{"Air"}, T) \quad // \text{Thermal conductivity, W/m} \cdot \text{K}$$

and are based on values tabulated in Appendix A, with temperatures in kelvin units. You can create your own functions to represent property values or other input data by using the *User-Defined Function* feature in *IHT*, as described in the *Help* section.


## 2.3

### The Heat Diffusion Equation

A major objective in a conduction analysis is to determine the *temperature field* in a medium resulting from conditions imposed on its boundaries. That is, we wish to know the *temperature distribution*, which represents how temperature varies with position in the medium. Once this distribution is known, the conduction heat flux at any point in the medium or on its surface may be computed from Fourier's law. Other important quantities of interest may also be determined. For a solid, knowledge of the temperature distribution could be used to ascertain structural integrity through determination of thermal stresses, expansions, and deflections. The temperature distribution could also be used to optimize the thickness of an insulating material or to determine the compatibility of special coatings or adhesives used with the material.

We now consider the manner in which the temperature distribution can be determined. The approach follows the methodology described in Section 1.3.3 of applying the energy conservation requirement. In this case, we define a *differential control volume*, identify the relevant energy transfer processes, and introduce the appropriate rate equations. The result is a differential equation whose solution, for prescribed boundary conditions, provides the temperature distribution in the medium.

Consider a homogeneous medium within which there is no bulk motion (advection) and the temperature distribution  $T(x, y, z)$  is expressed in Cartesian coordinates. Following the methodology of applying conservation of energy (Section 1.3.3), we first define an infinitesimally small (differential) control volume,  $dx \cdot dy \cdot dz$ , as shown in Figure 2.11. Choosing to formulate the first law at an instant of time, the second step is to consider the energy processes that are relevant to this control volume. If there are temperature gradients, conduction heat transfer will occur across

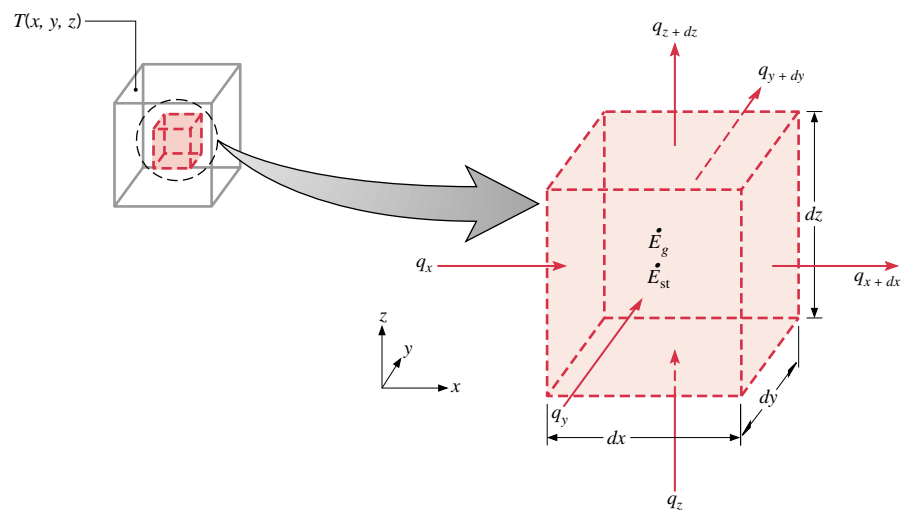

**FIGURE 2.11** Differential control volume,  $dx \, dy \, dz$ , for conduction analysis in Cartesian coordinates.

each of the control surfaces. The conduction heat rates perpendicular to each of the control surfaces at the  $x$ ,  $y$ , and  $z$  coordinate locations are indicated by the terms  $q_x$ ,  $q_y$ , and  $q_z$ , respectively. The conduction heat rates at the opposite surfaces can then be expressed as a Taylor series expansion where, neglecting higher order terms,

$$q_{x+dx} = q_x + \frac{\partial q_x}{\partial x} dx \quad (2.11a)$$

$$q_{y+dy} = q_y + \frac{\partial q_y}{\partial y} dy \quad (2.11b)$$

$$q_{z+dz} = q_z + \frac{\partial q_z}{\partial z} dz \quad (2.11c)$$

In words, Equation 2.11a simply states that the  $x$  component of the heat transfer rate at  $x + dx$  is equal to the value of this component at  $x$  plus the amount by which it changes with respect to  $x$  times  $dx$ .

Within the medium there may also be an *energy source* term associated with the rate of thermal energy generation. This term is represented as

$$\dot{E}_g = \dot{q} dx dy dz \quad (2.12)$$

where  $\dot{q}$  is the rate at which energy is generated per unit volume of the medium ( $\text{W/m}^3$ ). In addition, there may occur changes in the amount of the internal thermal energy stored by the material in the control volume. If the material is not experiencing a change in phase, latent energy effects are not pertinent, and the *energy storage* term may be expressed as

$$\dot{E}_{st} = \rho c_p \frac{\partial T}{\partial t} dx dy dz \quad (2.13)$$

where  $\rho c_p \partial T / \partial t$  is the time rate of change of the sensible (thermal) energy of the medium per unit volume.

Once again it is important to note that the terms  $\dot{E}_g$  and  $\dot{E}_{st}$  represent different physical processes. The energy generation term  $\dot{E}_g$  is a manifestation of some energy conversion process involving thermal energy on one hand and some other form of energy, such as chemical, electrical, or nuclear, on the other. The term is positive (a *source*) if thermal energy is being generated in the material at the expense of some other energy form; it is negative (a *sink*) if thermal energy is being consumed. In contrast, the energy storage term  $\dot{E}_{st}$  refers to the rate of change of thermal energy stored by the matter.

The last step in the methodology outlined in Section 1.3.3 is to express conservation of energy using the foregoing rate equations. On a *rate* basis, the general form of the conservation of energy requirement is

$$\dot{E}_{in} + \dot{E}_g - \dot{E}_{out} = \dot{E}_{st} \quad (1.11c)$$

Hence, recognizing that the conduction rates constitute the energy inflow,  $\dot{E}_{in}$ , and outflow,  $\dot{E}_{out}$ , and substituting Equations 2.12 and 2.13, we obtain

$$q_x + q_y + q_z + \dot{q} dx dy dz - q_{x+dx} - q_{y+dy} - q_{z+dz} = \rho c_p \frac{\partial T}{\partial t} dx dy dz \quad (2.14)$$



Substituting from Equations 2.11, it follows that

$$-\frac{\partial q_x}{\partial x} dx - \frac{\partial q_y}{\partial y} dy - \frac{\partial q_z}{\partial z} dz + \dot{q} dx dy dz = \rho c_p \frac{\partial T}{\partial t} dx dy dz \quad (2.15)$$

The conduction heat rates may be evaluated from Fourier's law,

$$q_x = -k dy dz \frac{\partial T}{\partial x} \quad (2.16a)$$

$$q_y = -k dx dz \frac{\partial T}{\partial y} \quad (2.16b)$$

$$q_z = -k dx dy \frac{\partial T}{\partial z} \quad (2.16c)$$

where each heat flux component of Equation 2.6 has been multiplied by the appropriate control surface (differential) area to obtain the heat transfer rate. Substituting Equations 2.16 into Equation 2.15 and dividing out the dimensions of the control volume ( $dx dy dz$ ), we obtain

$$\frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) + \frac{\partial}{\partial z} \left( k \frac{\partial T}{\partial z} \right) + \dot{q} = \rho c_p \frac{\partial T}{\partial t} \quad (2.17)$$

Equation 2.17 is the general form, in Cartesian coordinates, of the *heat diffusion equation*. This equation, often referred to as the *heat equation*, provides the basic tool for heat conduction analysis. From its solution, we can obtain the temperature distribution  $T(x, y, z)$  as a function of time. The apparent complexity of this expression should not obscure the fact that it describes an important physical condition, that is, conservation of energy. You should have a clear understanding of the physical significance of each term appearing in the equation. For example, the term  $\partial(k\partial T/\partial x)/\partial x$  is related to the *net* conduction heat flux *into* the control volume for the  $x$ -coordinate direction. That is, multiplying by  $dx$ ,

$$\frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) dx = q_x'' - q_{x+dx}'' \quad (2.18)$$

with similar expressions applying for the fluxes in the  $y$  and  $z$  directions. In words, the heat equation, Equation 2.17, therefore states that *at any point in the medium the net rate of energy transfer by conduction into a unit volume plus the volumetric rate of thermal energy generation must equal the rate of change of thermal energy stored within the volume*.

It is often possible to work with simplified versions of Equation 2.17. For example, if the thermal conductivity is constant, the heat equation is

$$\frac{\partial^2 T}{\partial x^2} + \frac{\partial^2 T}{\partial y^2} + \frac{\partial^2 T}{\partial z^2} + \frac{\dot{q}}{k} = \frac{1}{\alpha} \frac{\partial T}{\partial t} \quad (2.19)$$

where  $\alpha = k/\rho c_p$  is the *thermal diffusivity*. Additional simplifications of the general form of the heat equation are often possible. For example, under *steady-state*

conditions, there can be no change in the amount of energy storage; hence Equation 2.17 reduces to

$$\frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) + \frac{\partial}{\partial z} \left( k \frac{\partial T}{\partial z} \right) + \dot{q} = 0 \quad (2.20)$$

Moreover, if the heat transfer is *one-dimensional* (e.g., in the  $x$  direction) and there is *no energy generation*, Equation 2.20 reduces to

$$\frac{d}{dx} \left( k \frac{dT}{dx} \right) = 0 \quad (2.21)$$

The important implication of this result is that *under steady-state, one-dimensional conditions with no energy generation*, the heat flux is a constant in the direction of transfer ( $dq_x''/dx = 0$ ).


The heat equation may also be expressed in cylindrical and spherical coordinates. The differential control volumes for these two coordinate systems are shown in Figures 2.12 and 2.13.

**Cylindrical Coordinates** When the del operator  $\nabla$  of Equation 2.3 is expressed in cylindrical coordinates, the general form of the heat flux vector, and hence of Fourier's law, is


$$\mathbf{q}'' = -k \nabla T = -k \left( \mathbf{i} \frac{\partial T}{\partial r} + \mathbf{j} \frac{1}{r} \frac{\partial T}{\partial \phi} + \mathbf{k} \frac{\partial T}{\partial z} \right) \quad (2.22)$$

where

$$q_r'' = -k \frac{\partial T}{\partial r} \quad q_\phi'' = -\frac{k}{r} \frac{\partial T}{\partial \phi} \quad q_z'' = -k \frac{\partial T}{\partial z} \quad (2.23)$$

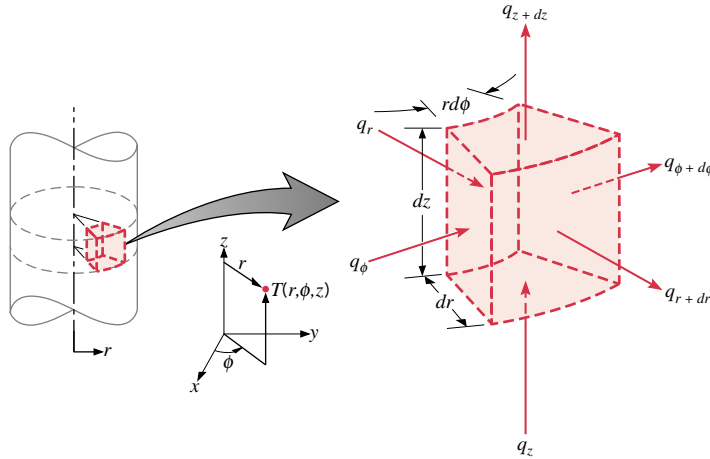

**FIGURE 2.12** Differential control volume,  $dr \cdot r d\phi \cdot dz$ , for conduction analysis in cylindrical coordinates  $(r, \phi, z)$ .

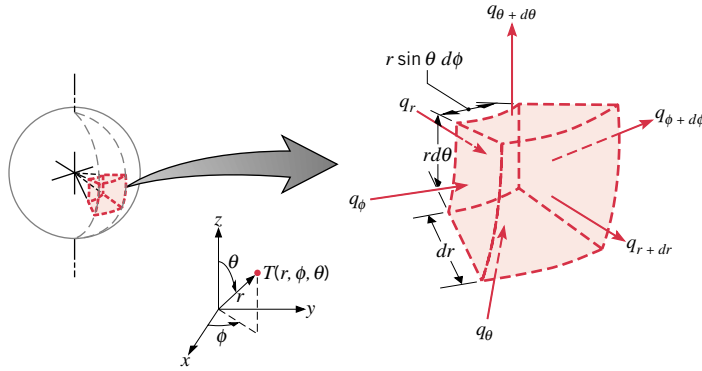

**FIGURE 2.13** Differential control volume,  $dr \cdot r \sin \theta d\phi \cdot r d\theta$ , for conduction analysis in spherical coordinates  $(r, \phi, \theta)$ .

are heat flux components in the radial, circumferential, and axial directions, respectively. Applying an energy balance to the differential control volume of Figure 2.12, the following general form of the heat equation is obtained:

$$\begin{aligned} \frac{1}{r} \frac{\partial}{\partial r} \left( kr \frac{\partial T}{\partial r} \right) + \frac{1}{r^2} \frac{\partial}{\partial \phi} \left( k \frac{\partial T}{\partial \phi} \right) \\ + \frac{\partial}{\partial z} \left( k \frac{\partial T}{\partial z} \right) + \dot{q} = \rho c_p \frac{\partial T}{\partial t} \end{aligned} \quad (2.24)$$

**Spherical Coordinates** In spherical coordinates the general form of the heat flux vector and Fourier's law is

$$\mathbf{q}'' = -k \nabla T = -k \left( \mathbf{i} \frac{\partial T}{\partial r} + \mathbf{j} \frac{1}{r} \frac{\partial T}{\partial \theta} + \mathbf{k} \frac{1}{r \sin \theta} \frac{\partial T}{\partial \phi} \right) \quad (2.25)$$

where

$$q_r'' = -k \frac{\partial T}{\partial r} \quad q_\theta'' = -\frac{k}{r} \frac{\partial T}{\partial \theta} \quad q_\phi'' = -\frac{k}{r \sin \theta} \frac{\partial T}{\partial \phi} \quad (2.26)$$

are heat flux components in the radial, polar, and azimuthal directions, respectively. Applying an energy balance to the differential control volume of Figure 2.13, the following general form of the heat equation is obtained:

$$\begin{aligned} \frac{1}{r^2} \frac{\partial}{\partial r} \left( kr^2 \frac{\partial T}{\partial r} \right) + \frac{1}{r^2 \sin^2 \theta} \frac{\partial}{\partial \phi} \left( k \frac{\partial T}{\partial \phi} \right) \\ + \frac{1}{r^2 \sin \theta} \frac{\partial}{\partial \theta} \left( k \sin \theta \frac{\partial T}{\partial \theta} \right) + \dot{q} = \rho c_p \frac{\partial T}{\partial t} \end{aligned} \quad (2.27)$$

Since it is important that you be able to apply conservation principles to differential control volumes, you should attempt to derive Equation 2.24 or 2.27 (see Problems 2.35 and 2.36). Note that the temperature gradient in Fourier's law must have units of K/m. Hence, when evaluating the gradient for an angular coordinate,

it must be expressed in terms of the differential change in arc *length*. For example, the heat flux component in the circumferential direction of a cylindrical coordinate system is  $q''_{\phi} = -(k/r)(\partial T/\partial \phi)$ , and *not*  $q''_{\phi} = -k(\partial T/\partial \phi)$ .

### EXAMPLE 2.2

The temperature distribution across a wall 1 m thick at a certain instant of time is given as

$$T(x) = a + bx + cx^2$$

where  $T$  is in degrees Celsius and  $x$  is in meters, while  $a = 900^{\circ}\text{C}$ ,  $b = -300^{\circ}\text{C/m}$ , and  $c = -50^{\circ}\text{C/m}^2$ . A uniform heat generation,  $\dot{q} = 1000 \text{ W/m}^3$ , is present in the wall of area  $10 \text{ m}^2$  having the properties  $\rho = 1600 \text{ kg/m}^3$ ,  $k = 40 \text{ W/m} \cdot \text{K}$ , and  $c_p = 4 \text{ kJ/kg} \cdot \text{K}$ .

1. Determine the rate of heat transfer entering the wall ( $x = 0$ ) and leaving the wall ( $x = 1 \text{ m}$ ).
2. Determine the rate of change of energy storage in the wall.
3. Determine the time rate of temperature change at  $x = 0, 0.25$ , and  $0.5 \text{ m}$ .


### SOLUTION

**Known:** Temperature distribution  $T(x)$  at an instant of time  $t$  in a one-dimensional wall with uniform heat generation.

### Find:

1. Heat rates entering,  $q_{\text{in}}$  ( $x = 0$ ), and leaving,  $q_{\text{out}}$  ( $x = 1 \text{ m}$ ), the wall.
2. Rate of change of energy storage in the wall,  $\dot{E}_{\text{st}}$ .
3. Time rate of temperature change at  $x = 0, 0.25$ , and  $0.5 \text{ m}$ .

### Schematic:

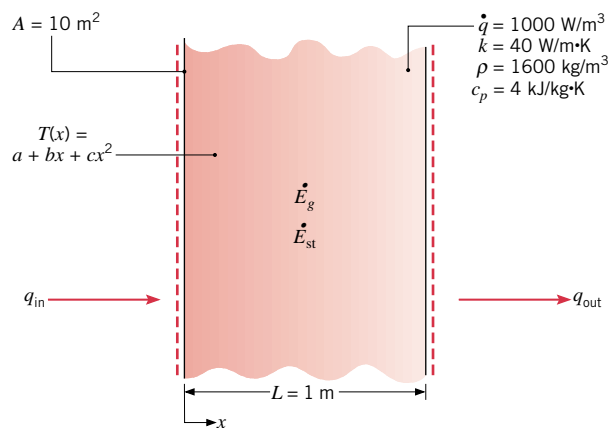

**Assumptions:**

1. One-dimensional conduction in the  $x$  direction.
2. Isotropic medium with constant properties.
3. Uniform internal heat generation,  $\dot{q}$  (W/m<sup>3</sup>).

**Analysis:**

1. Recall that once the temperature distribution is known for a medium, it is a simple matter to determine the conduction heat transfer rate at any point in the medium, or at its surfaces, by using Fourier's law. Hence the desired heat rates may be determined by using the prescribed temperature distribution with Equation 2.1. Accordingly,

$$q_{\text{in}} = q_x(0) = -kA \left. \frac{\partial T}{\partial x} \right|_{x=0} = -kA(b + 2cx)_{x=0}$$

$$q_{\text{in}} = -bkA = 300^\circ\text{C/m} \times 40 \text{ W/m} \cdot \text{K} \times 10 \text{ m}^2 = 120 \text{ kW} \quad \triangleleft$$

Similarly,

$$q_{\text{out}} = q_x(L) = -kA \left. \frac{\partial T}{\partial x} \right|_{x=L} = -kA(b + 2cx)_{x=L}$$

$$q_{\text{out}} = -(b + 2cL)kA = -[-300^\circ\text{C/m} + 2(-50^\circ\text{C/m}^2) \times 1 \text{ m}] \times 40 \text{ W/m} \cdot \text{K} \times 10 \text{ m}^2 = 160 \text{ kW} \quad \triangleleft$$

2. The rate of change of energy storage in the wall  $\dot{E}_{\text{st}}$  may be determined by applying an overall energy balance to the wall. Using Equation 1.11c for a control volume about the wall,

$$\dot{E}_{\text{in}} + \dot{E}_g - \dot{E}_{\text{out}} = \dot{E}_{\text{st}}$$

where  $\dot{E}_g = \dot{q}AL$ , it follows that

$$\dot{E}_{\text{st}} = \dot{E}_{\text{in}} + \dot{E}_g - \dot{E}_{\text{out}} = q_{\text{in}} + \dot{q}AL - q_{\text{out}}$$

$$\dot{E}_{\text{st}} = 120 \text{ kW} + 1000 \text{ W/m}^3 \times 10 \text{ m}^2 \times 1 \text{ m} - 160 \text{ kW}$$

$$\dot{E}_{\text{st}} = -30 \text{ kW} \quad \triangleleft$$

3. The time rate of change of the temperature at any point in the medium may be determined from the heat equation, Equation 2.19, rewritten as

$$\frac{\partial T}{\partial t} = \frac{k}{\rho c_p} \frac{\partial^2 T}{\partial x^2} + \frac{\dot{q}}{\rho c_p}$$

From the prescribed temperature distribution, it follows that

$$\begin{aligned} \frac{\partial^2 T}{\partial x^2} &= \frac{\partial}{\partial x} \left( \frac{\partial T}{\partial x} \right) \\ &= \frac{\partial}{\partial x} (b + 2cx) = 2c = 2(-50^\circ\text{C/m}^2) = -100^\circ\text{C/m}^2 \end{aligned}$$

Note that this derivative is independent of position in the medium. Hence the time rate of temperature change is also independent of position and is given by

$$\begin{aligned}\frac{\partial T}{\partial t} &= \frac{40 \text{ W/m} \cdot \text{K}}{1600 \text{ kg/m}^3 \times 4 \text{ kJ/kg} \cdot \text{K}} \times (-100^\circ\text{C/m}^2) \\ &\quad + \frac{1000 \text{ W/m}^3}{1600 \text{ kg/m}^3 \times 4 \text{ kJ/kg} \cdot \text{K}} \\ \frac{\partial T}{\partial t} &= -6.25 \times 10^{-4}^\circ\text{C/s} + 1.56 \times 10^{-4}^\circ\text{C/s} \\ &= -4.69 \times 10^{-4}^\circ\text{C/s}\end{aligned}$$

**Comments:**

1. From the above result it is evident that the temperature at every point within the wall is decreasing with time.
2. Fourier's law can always be used to compute the conduction heat rate from knowledge of the temperature distribution, even for unsteady conditions with internal heat generation.

**Microscale Effects** For most practical situations, the heat diffusion equations generated in this text may be used with confidence. However, these equations are based on use of Fourier's law to describe the conduction effects, which does not account for the finite speed at which thermal information is propagated within the medium by the various energy carriers. The consequences of the finite propagation speed may be neglected if the heat transfer events of interest occur over a sufficiently long time scale,  $\Delta t$ , such that

$$\frac{\lambda_{\text{mfp}}}{\bar{c}\Delta t} \ll 1 \quad (2.28)$$





The heat diffusion equations of this text are likewise invalid for problems where boundary scattering must be explicitly considered. For example, the temperature distribution *within* the thin film of Figure 2.6b cannot be determined by applying the foregoing heat diffusion equations. Additional discussion of micro- and nanoscale heat transfer applications and analysis methods is available in the literature [1, 15].

## 2.4

### Boundary and Initial Conditions

To determine the temperature distribution in a medium, it is necessary to solve the appropriate form of the heat equation. However, such a solution depends on the physical conditions existing at the *boundaries* of the medium and, if the situation is time dependent, on conditions existing in the medium at some *initial time*. With regard to the *boundary conditions*, there are several common possibilities that are

**TABLE 2.2** Boundary conditions for the heat diffusion equation at the surface ( $x = 0$ )

1. Constant surface temperature		
$T(0, t) = T_s$	(2.29)	
2. Constant surface heat flux		
(a) Finite heat flux		
$-k \frac{\partial T}{\partial x} \Big _{x=0} = q_s''$	(2.30)	
(b) Adiabatic or insulated surface		
$\frac{\partial T}{\partial x} \Big _{x=0} = 0$	(2.31)	
3. Convection surface condition		
$-k \frac{\partial T}{\partial x} \Big _{x=0} = h[T_\infty - T(0, t)]$	(2.32)	

simply expressed in mathematical form. Because the heat equation is second order in the spatial coordinates, two boundary conditions must be expressed for each coordinate needed to describe the system. Because the equation is first order in time, however, only one condition, termed the *initial condition*, must be specified.

Three kinds of boundary conditions commonly encountered in heat transfer are summarized in Table 2.2. The conditions are specified at the surface  $x = 0$  for a one-dimensional system. Heat transfer is in the positive  $x$  direction with the temperature distribution, which may be time dependent, designated as  $T(x, t)$ . The first condition corresponds to a situation for which the surface is maintained at a fixed temperature  $T_s$ . It is commonly termed a *Dirichlet condition*, or a boundary condition of the *first kind*. It is closely approximated, for example, when the surface is in contact with a melting solid or a boiling liquid. In both cases there is heat transfer at the surface, while the surface remains at the temperature of the phase change process. The second condition corresponds to the existence of a fixed or constant heat flux  $q_s''$  at the surface. This heat flux is related to the temperature gradient at the surface by Fourier's law, Equation 2.6, which may be expressed as

$$q_x''(0) = -k \frac{\partial T}{\partial x} \Big|_{x=0} = q_s''$$

It is termed a *Neumann condition*, or a boundary condition of the *second kind*, and may be realized by bonding a thin film electric heater to the surface. A special case of this condition corresponds to the *perfectly insulated*, or *adiabatic*, surface for

which  $\partial T / \partial x|_{x=0} = 0$ . The boundary condition of the *third kind* corresponds to the existence of convection heating (or cooling) at the surface and is obtained from the surface energy balance discussed in Section 1.3.2.

### EXAMPLE 2.3


A long copper bar of rectangular cross section, whose width  $w$  is much greater than its thickness  $L$ , is maintained in contact with a heat sink at its lower surface, and the temperature throughout the bar is approximately equal to that of the sink,  $T_o$ . Suddenly, an electric current is passed through the bar and an airstream of temperature  $T_\infty$  is passed over the top surface, while the bottom surface continues to be maintained at  $T_o$ . Obtain the differential equation and the boundary and initial conditions that could be solved to determine the temperature as a function of position and time in the bar.

### SOLUTION

**Known:** Copper bar initially in thermal equilibrium with a heat sink is suddenly heated by passage of an electric current.

**Find:** Differential equation and boundary and initial conditions needed to determine temperature as a function of position and time within the bar.

### Schematic:

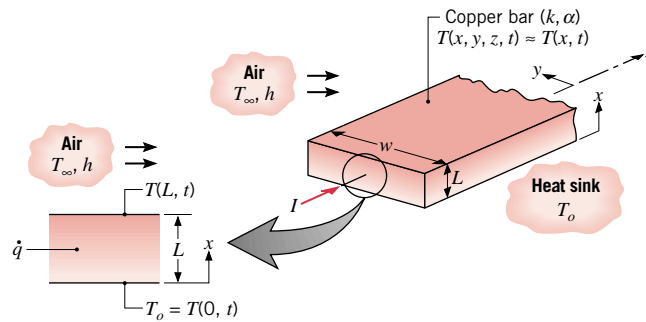

### Assumptions:

1. Since the bar is long and  $w \gg L$ , end and side effects are negligible and heat transfer within the bar is primarily one dimensional in the  $x$  direction.
2. Uniform volumetric heat generation,  $\dot{q}$ .
3. Constant properties.

**Analysis:** The temperature distribution is governed by the heat equation (2.17), which, for the one-dimensional and constant property conditions of the present problem, reduces to

$$\frac{\partial^2 T}{\partial x^2} + \frac{\dot{q}}{k} = \frac{1}{\alpha} \frac{\partial T}{\partial t} \quad (1) \quad \triangleleft$$



where the temperature is a function of position and time,  $T(x, t)$ . Since this differential equation is second order in the spatial coordinate  $x$  and first order in time  $t$ , there must be two boundary conditions for the  $x$  direction and one condition, termed the initial condition, for time. The boundary condition at the bottom surface corresponds to case 1 of Table 2.2. In particular, since the temperature of this surface is maintained at a value,  $T_o$ , which is fixed with time, it follows that

$$T(0, t) = T_o \quad (2) \quad \triangleleft$$

The convection surface condition, case 3 of Table 2.2, is appropriate for the top surface. Hence

$$-k \left. \frac{\partial T}{\partial x} \right|_{x=L} = h[T(L, t) - T_\infty] \quad (3) \quad \triangleleft$$


The initial condition is inferred from recognition that, before the change in conditions, the bar is at a uniform temperature  $T_o$ . Hence

$$T(x, 0) = T_o \quad (4) \quad \triangleleft$$

If  $T_o$ ,  $T_\infty$ ,  $\dot{q}$ , and  $h$  are known, Equations 1 through 4 may be solved to obtain the time-varying temperature distribution  $T(x, t)$  following imposition of the electric current.


### Comments:

1. The *heat sink* at  $x = 0$  could be maintained by exposing the surface to an ice bath or by attaching it to a *cold plate*. A cold plate contains coolant channels machined in a solid of large thermal conductivity (usually copper). By circulating a liquid (usually water) through the channels, the plate, and hence the surface to which it is attached, may be maintained at a nearly uniform temperature.
2. The temperature of the top surface  $T(L, t)$  will change with time. This temperature is an unknown and may be obtained after finding  $T(x, t)$ .
3. We may use our physical intuition to sketch temperature distributions in the bar at selected times from the beginning to the end of the transient process. If we assume that  $T_\infty > T_o$  and that the electric current is sufficiently large to heat the bar to temperatures in excess of  $T_\infty$ , the following distributions would correspond to the initial condition ( $t \leq 0$ ), the final (steady-state) condition ( $t \rightarrow \infty$ ), and two intermediate times.

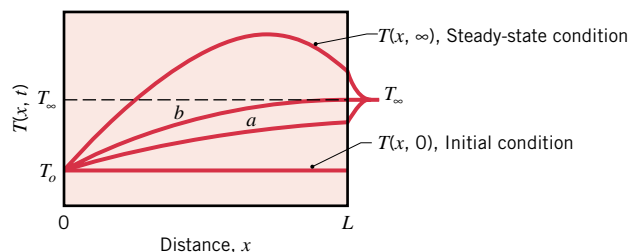

Note how the distributions comply with the initial and boundary conditions. What is a special feature of the distribution labeled (b)?

4. Our intuition may also be used to infer the manner in which the heat flux varies with time at the surfaces ( $x = 0, L$ ) of the bar. On  $q_x'' - t$  coordinates, the transient variations are as follows.

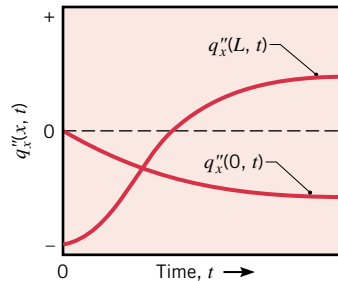

Convince yourself that the foregoing variations are consistent with the temperature distributions of Comment 3. For  $t \rightarrow \infty$ , how are  $q_x''(0)$  and  $q_x''(L)$  related to the volumetric rate of energy generation?

## 2.5 Summary

The primary objectives of this chapter were to improve your understanding of the conduction rate equation (Fourier's law) and to familiarize you with the heat equation. You may test your understanding of related concepts by addressing the following questions.

- In the general formulation of *Fourier's law* (applicable to any geometry), what are the vector and scalar quantities? Why is there a minus sign on the right-hand side of the equation?
- What is an *isothermal surface*? What can be said about the heat flux at any location on this surface?
- What form does *Fourier's law* take for each of the orthogonal directions of Cartesian, cylindrical, and spherical coordinate systems? In each case, what are the units of the temperature gradient? Can you write each equation from memory?
- An important property of matter is defined by *Fourier's law*. What is it? What is its physical significance? What are its units?
- What is an *isotropic* material?
- Why is the thermal conductivity of a solid generally larger than that of a liquid? Why is the thermal conductivity of a liquid larger than that of a gas?
- Why is the thermal conductivity of an electrically conducting solid generally larger than that of a nonconductor? Why are materials such as beryllium oxide, diamond, and silicon carbide (see Table A.2) exceptions to this rule?
- Is the *effective thermal conductivity* of an insulation system a true manifestation of the efficacy with which heat is transferred through the system by conduction alone?
- Why does the thermal conductivity of a gas increase with increasing temperature? Why is it approximately independent of pressure?
- What is the physical significance of the *thermal diffusivity*? How is it defined and what are its units?

- What is the physical significance of each term appearing in the *heat equation*?
- Cite some examples of *thermal energy generation*. If the rate at which thermal energy is generated per unit volume,  $\dot{q}$ , varies with location in a medium of volume  $V$ , how can the rate of energy generation for the entire medium,  $E_g$ , be determined from knowledge of  $\dot{q}(x, y, z)$ ?
- For a chemically reacting medium, what kind of reaction provides a *source* of thermal energy ( $\dot{q} > 0$ )? What kind of reaction provides a *sink* for thermal energy ( $\dot{q} < 0$ )?
- To solve the *heat equation* for the temperature distribution in a medium, *boundary conditions* must be prescribed at the surfaces of the medium. What physical conditions are commonly suitable for this purpose?


## References

1. Flik, M. I., B.-I. Choi, and K. E. Goodson, *J. Heat Transfer*, **114**, 666, 1992.
2. Klemens, P. G., "Theory of the Thermal Conductivity of Solids," in R. P. Tye, Ed., *Thermal Conductivity*, Vol. 1, Academic Press, London, 1969.
3. Yang, H.-S., G.-R. Bai, L. J. Thompson, and J. A. Eastman, *Acta Materialia*, **50**, 2309, 2002.
4. Chen, G., *J. Heat Transfer*, **118**, 539, 1996.
5. Vincenti, W. G., and C. H. Kruger, Jr., *Introduction to Physical Gas Dynamics*, Wiley, New York, 1986.
6. McLaughlin, E., "Theory of the Thermal Conductivity of Fluids," in R. P. Tye, Ed., *Thermal Conductivity*, Vol. 2, Academic Press, London, 1969.
7. Foust, O. J., Ed., "Sodium Chemistry and Physical Properties," in *Sodium-NaK Engineering Handbook*, Vol. 1, Gordon & Breach, New York, 1972.
8. Mallory, J. F., *Thermal Insulation*, Reinhold Book Corp., New York, 1969.
9. American Society of Heating, Refrigeration and Air Conditioning Engineers, *Handbook of Fundamentals*, Chapters 23–25 and 31, ASHRAE, New York, 2001.
10. Zeng, S. Q., A. Hunt, and R. Greif, *J. Heat Transfer*, **117**, 1055, 1995.
11. Sengers, J. V., and M. Klein, Eds., *The Technical Importance of Accurate Thermophysical Property Information*, National Bureau of Standards Technical Note No. 590, 1980.
12. Najjar, M. S., K. J. Bell, and R. N. Maddox, *Heat Transfer Eng.*, **2**, 27, 1981.
13. Hanley, H. J. M., and M. E. Baltatu, *Mech. Eng.*, **105**, 68, 1983.
14. Touloukian, Y. S., and C. Y. Ho, Eds., *Thermophysical Properties of Matter, The TPRC Data Series* (13 volumes on thermophysical properties: thermal conductivity, specific heat, thermal radiative, thermal diffusivity, and thermal linear expansion), Plenum Press, New York, 1970 through 1977.
15. Cahill, D. G., W. K. Ford, K. E. Goodson, G. D. Mahan, A. Majumdar, H. J. Maris, R. Merlin, and S. R. Phillpot, *App. Phys. Rev.*, **93**, 793, 2003.

## Problems

### Fourier's Law


- 2.1** Assume steady-state, one-dimensional heat conduction through the axisymmetric shape shown below.



Assuming constant properties and no internal heat generation, sketch the temperature distribution on  $T$ - $x$  coordinates. Briefly explain the shape of your curve.


- 2.2** A hot water pipe with outside radius  $r_1$  has a temperature  $T_1$ . A thick insulation applied to reduce the heat loss has an outer radius  $r_2$  and temperature  $T_2$ . On  $T$ - $r$  coordinates, sketch the temperature distribution in the insulation for one-dimensional, steady-state heat transfer with constant properties. Give a brief explanation, justifying the shape of your curve.

- 2.3 A spherical shell with inner radius  $r_1$  and outer radius  $r_2$  has surface temperatures  $T_1$  and  $T_2$ , respectively, where  $T_1 > T_2$ . Sketch the temperature distribution on  $T$ - $r$  coordinates assuming steady-state, one-dimensional conduction with constant properties. Briefly justify the shape of your curve.
- 2.4 Assume steady-state, one-dimensional heat conduction through the symmetric shape shown.



Assuming that there is no internal heat generation, derive an expression for the thermal conductivity  $k(x)$  for these conditions:  $A(x) = (1 - x)$ ,  $T(x) = 300(1 - 2x - x^3)$ , and  $q = 6000$  W, where  $A$  is in square meters,  $T$  in kelvins, and  $x$  in meters.

- 2.5 A solid, truncated cone serves as a support for a system that maintains the top (truncated) face of the cone at a temperature  $T_1$ , while the base of the cone is at a temperature  $T_2 < T_1$ .



The thermal conductivity of the solid depends on temperature according to the relation  $k = k_o - aT$ , where  $a$  is a positive constant, and the sides of the cone are well insulated. Do the following quantities increase, decrease, or remain the same with increasing  $x$ : the heat transfer rate  $q_x$ , the heat flux  $q_x''$ , the thermal conductivity  $k$ , and the temperature gradient  $dT/dx$ ?

- 2.6 To determine the effect of the temperature dependence of the thermal conductivity on the temperature distribution in a solid, consider a material for which this dependence may be represented as


$$k = k_o + aT$$

where  $k_o$  is a positive constant and  $a$  is a coefficient that may be positive or negative. Sketch the steady-state temperature distribution associated with heat transfer in

a plane wall for three cases corresponding to  $a > 0$ ,  $a = 0$ , and  $a < 0$ .

- 2.7 A young engineer is asked to design a thermal protection barrier for a sensitive electronic device that might be exposed to irradiation from a high-powered infrared laser. Having learned as a student that a low thermal conductivity material provides good insulating characteristics, the engineer specifies use of a nanostructured aerogel, characterized by a thermal conductivity of  $k_a = 0.005$  W/m · K, for the protective barrier. The engineer's boss questions the wisdom of selecting the aerogel *because* it has a low thermal conductivity. Consider the sudden laser irradiation of (a) pure aluminum, (b) glass, and (c) aerogel. The laser provides irradiation of  $G = 10 \times 10^6$  W/m<sup>2</sup>. The absorptivities of the materials are  $\alpha = 0.2, 0.9$ , and  $0.8$  for the aluminum, glass, and aerogel, respectively, and the initial temperature of the barrier is  $T_i = 300$  K. Explain why the boss is concerned. *Hint:* All materials experience thermal expansion (or contraction), and local stresses that develop within a material are, to a first approximation, proportional to the local temperature gradient.


- 2.8 Consider steady-state conditions for one-dimensional conduction in a plane wall having a thermal conductivity  $k = 50$  W/m · K and a thickness  $L = 0.25$  m, with no internal heat generation.



Determine the heat flux and the unknown quantity for each case and sketch the temperature distribution, indicating the direction of the heat flux.


Case	$T_1(^{\circ}\text{C})$	$T_2(^{\circ}\text{C})$	$dT/dx$ (K/m)
1	50	-20	
2	-30	-10	
3	70		160
4		40	-80
5		30	200

- 2.9 Consider a plane wall 100 mm thick and of thermal conductivity 100 W/m · K. Steady-state conditions are known to exist with  $T_1 = 400$  K and  $T_2 = 600$  K. Determine the heat flux  $q_x''$  and the temperature gradient  $dT/dx$  for the coordinate systems shown.

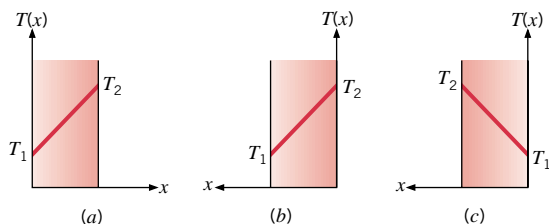

**2.10** A cylinder of radius  $r_o$ , length  $L$ , and thermal conductivity  $k$  is immersed in a fluid of convection coefficient  $h$  and unknown temperature  $T_\infty$ . At a certain instant the temperature distribution in the cylinder is  $T(r) = a + br^2$ , where  $a$  and  $b$  are constants. Obtain expressions for the heat transfer rate at  $r_o$  and the fluid temperature.

**2.11** In the two-dimensional body illustrated, the gradient at surface  $A$  is found to be  $\partial T/\partial y = 30$  K/m. What are  $\partial T/\partial y$  and  $\partial T/\partial x$  at surface  $B$ ?

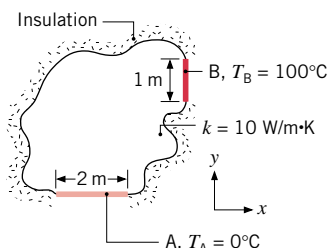


**2.12** Sections of the trans-Alaska pipeline run above the ground and are supported by vertical steel shafts ( $k = 25$  W/m·K) that are 1 m long and have a cross-sectional area of  $0.005$  m<sup>2</sup>. Under normal operating conditions, the temperature variation along the length of a shaft is known to be governed by an expression of the form

$$T = 100 - 150x + 10x^2$$

where  $T$  and  $x$  have units of °C and meters, respectively. Temperature variations are small over the shaft cross section. Evaluate the temperature and conduction heat rate at the shaft–pipeline joint ( $x = 0$ ) and at the shaft–ground interface ( $x = 1$  m). Explain the difference in the heat rates.

**2.13** Steady-state, one-dimensional conduction occurs in a rod of constant thermal conductivity  $k$  and variable cross-sectional area  $A_x(x) = A_o e^{ax}$ , where  $A_o$  and  $a$  are constants. The lateral surface of the rod is well insulated.



- Write an expression for the conduction heat rate,  $q_x(x)$ . Use this expression to determine the temperature distribution  $T(x)$  and qualitatively sketch the distribution for  $T(0) > T(L)$ .
- Now consider conditions for which thermal energy is generated in the rod at a volumetric rate  $\dot{q} = \dot{q}_o \exp(-ax)$ , where  $\dot{q}_o$  is a constant. Obtain an expression for  $q_x(x)$  when the left face ( $x = 0$ ) is well insulated.

## Thermophysical Properties

**2.14** Consider a 300 mm × 300 mm window in an aircraft. For a temperature difference of 80°C from the inner to the outer surface of the window, calculate the heat loss through  $L = 10$ -mm-thick polycarbonate, soda lime glass, and aerogel windows, respectively. The thermal conductivities of the aerogel and polycarbonate are  $k_{ag} = 0.014$  W/m·K and  $k_{pc} = 0.21$  W/m·K, respectively. Evaluate the thermal conductivity of the soda lime glass at 300 K. If the aircraft has 130 windows and the cost to heat the cabin air is \$1/kW·h, compare the costs associated with the heat loss through the windows for an 8-hour intercontinental flight.


**2.15** Gold is commonly used in semiconductor packaging to form interconnections (also known as interconnects) that carry electrical signals between different devices in the package. In addition to being a good electrical conductor, gold interconnects are also effective at protecting the heat-generating devices to which they are attached by conducting thermal energy away from the devices to surrounding, cooler regions. Consider a thin film of gold that has a cross section of 60 nm × 250 nm.

- For an applied temperature difference of 20°C, determine the energy conducted along a 1-μm-long, thin-film interconnect. Evaluate properties at 300 K.
- Plot the lengthwise (in the 1-μm direction) and spanwise (in the thinnest direction) thermal conductivities of the gold film as a function of the film thickness,  $L$ , for  $30 \leq L \leq 140$  nm.

**2.16** A TV advertisement by a well-known insulation manufacturer states: it isn't the thickness of the insulating material that counts, it's the R-value. The ad shows that to obtain an R-value of 19, you need 18 ft of rock, 15 in. of wood, or just 6 in. of the manufacturer's insulation. Is this advertisement technically reasonable? If you are like most TV viewers, you don't know the R-value is defined as  $L/k$ , where  $L$  (in.) is the thickness of the insulation and  $k$  (Btu·in./hr·ft<sup>2</sup>·°F) is the thermal conductivity of the material.

**2.17** An apparatus for measuring thermal conductivity employs an electrical heater sandwiched between two

identical samples of diameter 30 mm and length 60 mm, which are pressed between plates maintained at a uniform temperature  $T_o = 77^\circ\text{C}$  by a circulating fluid. A conducting grease is placed between all the surfaces to ensure good thermal contact. Differential thermocouples are imbedded in the samples with a spacing of 15 mm. The lateral sides of the samples are insulated to ensure one-dimensional heat transfer through the samples.

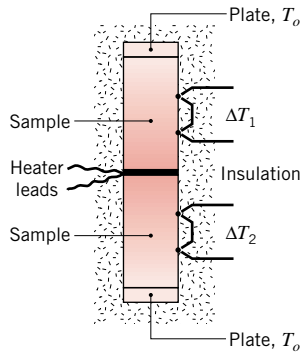


- With two samples of SS316 in the apparatus, the heater draws 0.353 A at 100 V and the differential thermocouples indicate  $\Delta T_1 = \Delta T_2 = 25.0^\circ\text{C}$ . What is the thermal conductivity of the stainless steel sample material? What is the average temperature of the samples? Compare your result with the thermal conductivity value reported for this material in Table A.1.
- By mistake, an Armco iron sample is placed in the lower position of the apparatus with one of the SS316 samples from part (a) in the upper portion. For this situation, the heater draws 0.601 A at 100 V and the differential thermocouples indicate  $\Delta T_1 = \Delta T_2 = 15.0^\circ\text{C}$ . What are the thermal conductivity and average temperature of the Armco iron sample?
- What is the advantage in constructing the apparatus with two identical samples sandwiching the heater rather than with a single heater-sample combination? When would heat leakage out of the lateral surfaces of the samples become significant? Under what conditions would you expect  $\Delta T_1 \neq \Delta T_2$ ?

**2.18** An engineer desires to measure the thermal conductivity of an aerogel material. It is expected that the aerogel will have an extremely small thermal conductivity.

- Explain why the apparatus of Problem 2.17 cannot be used to obtain an accurate measurement of the aerogel's thermal conductivity.
- The engineer designs a new apparatus for which an electric heater of diameter  $D = 150$  mm is sandwiched between two thin plates of aluminum. The steady-state temperatures of the 5-mm-thick aluminum plates,  $T_1$  and  $T_2$ , are measured with

thermocouples. Aerogel sheets of thickness  $t = 5$  mm are placed outside the aluminum plates, while a coolant with an inlet temperature of  $T_{c,i} = 25^\circ\text{C}$  maintains the exterior surfaces of the aerogel at a low temperature. The circular aerogel sheets are formed so that they encase the heater and aluminum sheets, providing insulation to minimize radial heat losses. At steady state,  $T_1 = T_2 = 55^\circ\text{C}$  and the heater draws 125 mA at 10 V. Determine the value of the aerogel thermal conductivity  $k_a$ .

- Calculate the temperature difference across the thickness of the 5-mm-thick aluminum plates. Comment on whether it is important to know the axial locations at which the temperatures of the aluminum plates are measured.
- If liquid water is used as the coolant with a total flow rate of  $\dot{m} = 1$  kg/min (0.5 kg/min for each of the two streams), calculate the outlet temperature of the water,  $T_{c,o}$ .

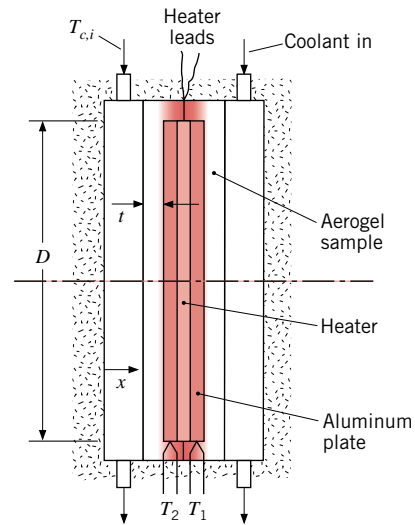


**2.19** A method for determining the thermal conductivity  $k$  and the specific heat  $c_p$  of a material is illustrated in the sketch. Initially the two identical samples of diameter  $D = 60$  mm and thickness  $L = 10$  mm and the thin heater are at a uniform temperature of  $T_i = 23.00^\circ\text{C}$ , while surrounded by an insulating powder. Suddenly the heater is energized to provide a uniform heat flux  $q_o''$  on each of the sample interfaces, and the heat flux is maintained constant for a period of time,  $\Delta t_o$ . A short time after sudden heating is initiated, the temperature at this interface  $T_o$  is related to the heat flux as

$$T_o(t) - T_i = 2q_o'' \left( \frac{t}{\pi \rho c_p k} \right)^{1/2}$$



For a particular test run, the electrical heater dissipates 15.0 W for a period of  $\Delta t_o = 120$  s and the temperature at the interface is  $T_o(30 \text{ s}) = 24.57^\circ\text{C}$  after 30 s of heating. A long time after the heater is deenergized,  $t \gg \Delta t_o$ , the samples reach the uniform temperature of  $T_o(\infty) = 33.50^\circ\text{C}$ . The density of the sample materials, determined by measurement of volume and mass, is  $\rho = 3965 \text{ kg/m}^3$ .

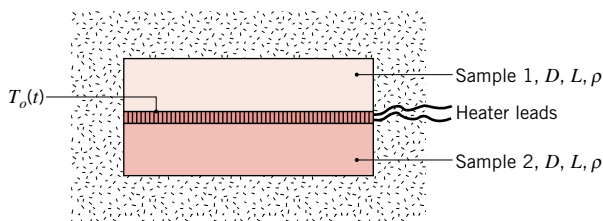

Determine the specific heat and thermal conductivity of the test material. By looking at values of the thermophysical properties in Table A.1 or A.2, identify the test sample material.

## The Heat Equation

- 2.20** At a given instant of time the temperature distribution within an infinite homogeneous body is given by the function

$$T(x, y, z) = x^2 - 2y^2 + z^2 - xy + 2yz$$

Assuming constant properties and no internal heat generation, determine the regions where the temperature changes with time.

- 2.21** A pan is used to boil water by placing it on a stove, from which heat is transferred at a fixed rate  $q_o$ . There are two stages to the process. In Stage 1, the water is taken from its initial (room) temperature  $T_i$  to the boiling point, as heat is transferred from the pan by natural convection. During this stage, a constant value of the convection coefficient  $h$  may be assumed, while the bulk temperature of the water increases with time,  $T_\infty = T_\infty(t)$ . In Stage 2, the water has come to a boil, and its temperature remains at a fixed value,  $T_\infty = T_b$ , as heating continues. Consider a pan bottom of thickness  $L$  and diameter  $D$ , with a coordinate system corresponding to  $x = 0$  and  $x = L$  for the surfaces in contact with the stove and water, respectively.

- (a) Write the form of the heat equation and the boundary/initial conditions that determine the variation of temperature with position and time,  $T(x, t)$ , in the pan bottom during Stage 1. Express your result in terms of the parameters  $q_o$ ,  $D$ ,  $L$ ,  $h$ , and  $T_\infty$ , as well as appropriate properties of the pan material.

- (b) During Stage 2, the surface of the pan in contact with the water is at a fixed temperature,  $T(L, t) = T_L > T_b$ . Write the form of the heat equation and boundary conditions that determine the temperature distribution,  $T(x)$ , in the pan bottom. Express your result in terms of the parameters  $q_o$ ,  $D$ ,  $L$ , and  $T_L$ , as well as appropriate properties of the pan material.

- 2.22** Uniform internal heat generation at  $\dot{q} = 5 \times 10^7 \text{ W/m}^3$  is occurring in a cylindrical nuclear reactor fuel rod of 50-mm diameter, and under steady-state conditions the temperature distribution is of the form  $T(r) = a + br^2$ , where  $T$  is in degrees Celsius and  $r$  is in meters, while  $a = 800^\circ\text{C}$  and  $b = -4.167 \times 10^5^\circ\text{C/m}^2$ . The fuel rod properties are  $k = 30 \text{ W/m} \cdot \text{K}$ ,  $\rho = 1100 \text{ kg/m}^3$ , and  $c_p = 800 \text{ J/kg} \cdot \text{K}$ .

- (a) What is the rate of heat transfer per unit length of the rod at  $r = 0$  (the centerline) and at  $r = 25 \text{ mm}$  (the surface)?
- (b) If the reactor power level is suddenly increased to  $\dot{q}_2 = 10^8 \text{ W/m}^3$ , what is the initial time rate of temperature change at  $r = 0$  and  $r = 25 \text{ mm}$ ?

- 2.23** The steady-state temperature distribution in a one-dimensional wall of thermal conductivity  $50 \text{ W/m} \cdot \text{K}$  and thickness  $50 \text{ mm}$  is observed to be  $T(^\circ\text{C}) = a + bx^2$ , where  $a = 200^\circ\text{C}$ ,  $b = -2000^\circ\text{C/m}^2$ , and  $x$  is in meters.

- (a) What is the heat generation rate  $\dot{q}$  in the wall?
- (b) Determine the heat fluxes at the two wall faces. In what manner are these heat fluxes related to the heat generation rate?

- 2.24** The temperature distribution across a wall  $0.3 \text{ m}$  thick at a certain instant of time is  $T(x) = a + bx + cx^2$ , where  $T$  is in degrees Celsius and  $x$  is in meters,  $a = 200^\circ\text{C}$ ,  $b = -200^\circ\text{C/m}$ , and  $c = 30^\circ\text{C/m}^2$ . The wall has a thermal conductivity of  $1 \text{ W/m} \cdot \text{K}$ .


- (a) On a unit surface area basis, determine the rate of heat transfer into and out of the wall and the rate of change of energy stored by the wall.
- (b) If the cold surface is exposed to a fluid at  $100^\circ\text{C}$ , what is the convection coefficient?

- 2.25** A plane wall of thickness  $2L = 40 \text{ mm}$  and thermal conductivity  $k = 5 \text{ W/m} \cdot \text{K}$  experiences uniform volumetric heat generation at a rate  $\dot{q}$ , while convection heat transfer occurs at both of its surfaces ( $x = -L, +L$ ), each of which is exposed to a fluid of temperature  $T_\infty = 20^\circ\text{C}$ . Under steady-state conditions, the temperature distribution in the wall is of the form  $T(x) = a + bx + cx^2$ , where  $a = 82.0^\circ\text{C}$ ,  $b = -210^\circ\text{C/m}$ ,  $c = -2 \times 10^4^\circ\text{C/m}^2$ , and  $x$  is in meters. The origin of the  $x$ -coordinate is at the midplane of the wall.

- (a) Sketch the temperature distribution and identify significant physical features.

- (b) What is the volumetric rate of heat generation  $\dot{q}$  in the wall?
- (c) Determine the surface heat fluxes,  $q_x''(-L)$  and  $q_x''(+L)$ . How are these fluxes related to the heat generation rate?
- (d) What are the convection coefficients for the surfaces at  $x = -L$  and  $x = +L$ ?
- (e) Obtain an expression for the heat flux distribution,  $q_x''(x)$ . Is the heat flux zero at any location? Explain any significant features of the distribution.
- (f) If the source of the heat generation is suddenly deactivated ( $\dot{q} = 0$ ), what is the rate of change of energy stored in the wall at this instant?
- (g) What temperature will the wall eventually reach with  $\dot{q} = 0$ ? How much energy must be removed by the fluid per unit area of the wall ( $\text{J/m}^2$ ) to reach this state? The density and specific heat of the wall material are  $2600 \text{ kg/m}^3$  and  $800 \text{ J/kg} \cdot \text{K}$ , respectively.

**2.26** One-dimensional, steady-state conduction with uniform internal energy generation occurs in a plane wall with a thickness of 50 mm and a constant thermal conductivity of  $5 \text{ W/m} \cdot \text{K}$ . For these conditions, the temperature distribution has the form,  $T(x) = a + bx + cx^2$ . The surface at  $x = 0$  has a temperature of  $T(0) \equiv T_o = 120^\circ\text{C}$  and experiences convection with a fluid for which  $T_\infty = 20^\circ\text{C}$  and  $h = 500 \text{ W/m}^2 \cdot \text{K}$ . The surface at  $x = L$  is well insulated.

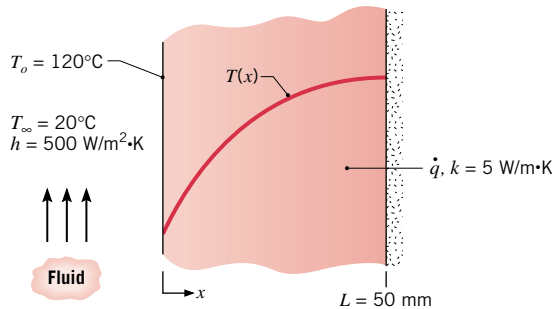


- (a) Applying an overall energy balance to the wall, calculate the internal energy generation rate,  $\dot{q}$ .
- (b) Determine the coefficients  $a$ ,  $b$ , and  $c$  by applying the boundary conditions to the prescribed temperature distribution. Use the results to calculate and plot the temperature distribution.
- (c) Consider conditions for which the convection coefficient is halved, but the internal energy generation rate remains unchanged. Determine the new values of  $a$ ,  $b$ , and  $c$ , and use the results to plot the temperature distribution. *Hint*: recognize that  $T(0)$  is no longer  $120^\circ\text{C}$ .

- (d) Under conditions for which the internal energy generation rate is doubled, and the convection coefficient remains unchanged ( $h = 500 \text{ W/m}^2 \cdot \text{K}$ ), determine the new values of  $a$ ,  $b$ , and  $c$  and plot the corresponding temperature distribution. Referring to the results of parts (b), (c), and (d) as Cases 1, 2, and 3, respectively, compare the temperature distributions for the three cases and discuss the effects of  $h$  and  $\dot{q}$  on the distributions.

**2.27** A salt-gradient solar pond is a shallow body of water that consists of three distinct fluid layers and is used to collect solar energy. The upper- and lower-most layers are well mixed and serve to maintain the upper and lower surfaces of the central layer at uniform temperatures  $T_1$  and  $T_2$ , where  $T_2 > T_1$ . Although there is bulk fluid motion in the mixed layers, there is no such motion in the central layer. Consider conditions for which solar radiation absorption in the central layer provides nonuniform heat generation of the form  $\dot{q} = Ae^{-ax}$ , and the temperature distribution in the central layer is

$$T(x) = -\frac{A}{ka^2}e^{-ax} + Bx + C$$

The quantities  $A$  ( $\text{W/m}^3$ ),  $a$  ( $1/\text{m}$ ),  $B$  ( $\text{K/m}$ ), and  $C$  ( $\text{K}$ ) are known constants having the prescribed units, and  $k$  is the thermal conductivity, which is also constant.

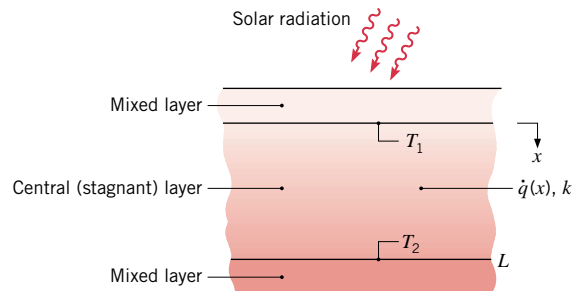


- (a) Obtain expressions for the rate at which heat is transferred per unit area from the lower mixed layer to the central layer and from the central layer to the upper mixed layer.
  - (b) Determine whether conditions are steady or transient.
  - (c) Obtain an expression for the rate at which thermal energy is generated in the entire central layer, per unit surface area.
- 2.28** The steady-state temperature distribution in a semitransparent material of thermal conductivity  $k$  and thickness  $L$  exposed to laser irradiation is of the form

$$T(x) = -\frac{A}{ka^2}e^{-ax} + Bx + C$$




where  $A$ ,  $a$ ,  $B$ , and  $C$  are known constants. For this situation, radiation absorption in the material is manifested by a distributed heat generation term,  $\dot{q}(x)$ .



- Obtain expressions for the conduction heat fluxes at the front and rear surfaces.
- Derive an expression for  $\dot{q}(x)$ .
- Derive an expression for the rate at which radiation is absorbed in the entire material, per unit surface area. Express your result in terms of the known constants for the temperature distribution, the thermal conductivity of the material, and its thickness.

**2.29** The steady-state temperature distribution in a one-dimensional wall of thermal conductivity  $k$  and thickness  $L$  is of the form  $T = ax^3 + bx^2 + cx + d$ . Derive expressions for the heat generation rate per unit volume in the wall and the heat fluxes at the two wall faces ( $x = 0, L$ ).


**2.30** One-dimensional, steady-state conduction with no internal energy generation is occurring in a plane wall of constant thermal conductivity.

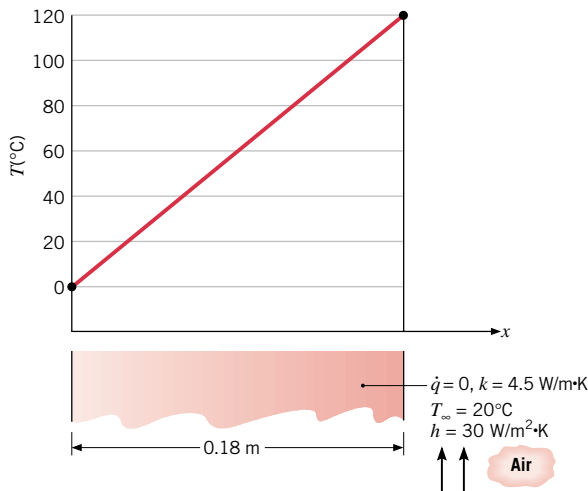

- Is the prescribed temperature distribution possible? Briefly explain your reasoning.
- With the temperature at  $x = 0$  and the fluid temperature fixed at  $T(0) = 0^\circ\text{C}$  and  $T_\infty = 20^\circ\text{C}$ ,

respectively, compute and plot the temperature at  $x = L$ ,  $T(L)$ , as a function of  $h$  for  $10 \leq h \leq 100 \text{ W/m}^2 \cdot \text{K}$ . Briefly explain your results.

**2.31** A plane layer of coal of thickness  $L = 1 \text{ m}$  experiences uniform volumetric generation at a rate of  $\dot{q} = 20 \text{ W/m}^3$  due to slow oxidation of the coal particles. Averaged over a daily period, the top surface of the layer transfers heat by convection to ambient air for which  $h = 5 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 25^\circ\text{C}$ , while receiving solar irradiation in the amount  $G_S = 400 \text{ W/m}^2$ . Irradiation from the atmosphere may be neglected. The solar absorptivity and emissivity of the surface are each  $\alpha_S = \varepsilon = 0.95$ .

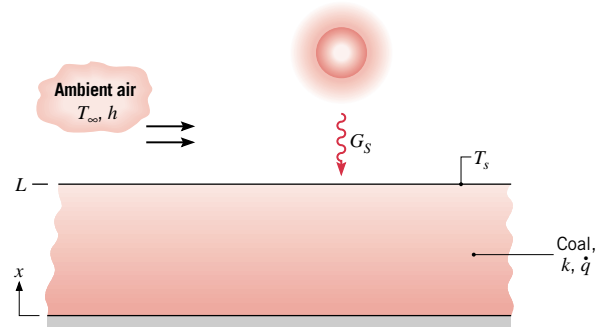

- Write the steady-state form of the heat diffusion equation for the layer of coal. Verify that this equation is satisfied by a temperature distribution of the form


$$T(x) = T_s + \frac{\dot{q}L^2}{2k} \left( 1 - \frac{x^2}{L^2} \right)$$

From this distribution, what can you say about conditions at the bottom surface ( $x = 0$ )? Sketch the temperature distribution and label key features.

- Obtain an expression for the rate of heat transfer by conduction per unit area at  $x = L$ . Applying an energy balance to a control surface about the top surface of the layer, obtain an expression for  $T_s$ . Evaluate  $T_s$  and  $T(0)$  for the prescribed conditions.

- Daily average values of  $G_S$  and  $h$  depend on a number of factors such as time of year, cloud cover, and wind conditions. For  $h = 5 \text{ W/m}^2 \cdot \text{K}$ , compute and plot  $T_s$  and  $T(0)$  as a function of  $G_S$  for  $50 \leq G_S \leq 500 \text{ W/m}^2$ . For  $G_S = 400 \text{ W/m}^2$ , compute and plot  $T_s$  and  $T(0)$  as a function of  $h$  for  $5 \leq h \leq 50 \text{ W/m}^2 \cdot \text{K}$ .

**2.32** The cylindrical system illustrated has negligible variation of temperature in the  $r$  and  $z$  directions. Assume that  $\Delta r = r_o - r_i$  is small compared to  $r_i$  and denote the length in the  $z$  direction, normal to the page, as  $L$ .

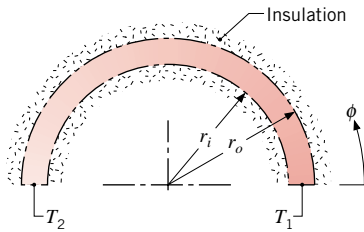

- (a) Beginning with a properly defined control volume and considering energy generation and storage effects, derive the differential equation that prescribes the variation in temperature with the angular coordinate  $\phi$ . Compare your result with Equation 2.24.
- (b) For steady-state conditions with no internal heat generation and constant properties, determine the temperature distribution  $T(\phi)$  in terms of the constants  $T_1$ ,  $T_2$ ,  $r_i$ , and  $r_o$ . Is this distribution linear in  $\phi$ ?
- (c) For the conditions of part (b) write the expression for the heat rate  $q_\phi$ .
- 2.33** Beginning with a differential control volume in the form of a cylindrical shell, derive the heat diffusion equation for a one-dimensional, cylindrical, radial coordinate system with internal heat generation. Compare your result with Equation 2.24.
- 2.34** Beginning with a differential control volume in the form of a spherical shell, derive the heat diffusion equation for a one-dimensional, spherical, radial coordinate system with internal heat generation. Compare your result with Equation 2.27.
- 2.35** Derive the heat diffusion equation, Equation 2.24, for cylindrical coordinates beginning with the differential control volume shown in Figure 2.12.
- 2.36** Derive the heat diffusion equation, Equation 2.27, for spherical coordinates beginning with the differential control volume shown in Figure 2.13.
- 2.37** A steam pipe is wrapped with insulation of inner and outer radii,  $r_i$  and  $r_o$ , respectively. At a particular instant the temperature distribution in the insulation is known to be of the form


$$T(r) = C_1 \ln\left(\frac{r}{r_o}\right) + C_2$$

Are conditions steady-state or transient? How do the heat flux and heat rate vary with radius?

- 2.38** For a long circular tube of inner and outer radii  $r_1$  and  $r_2$ , respectively, uniform temperatures  $T_1$  and  $T_2$  are maintained at the inner and outer surfaces, while thermal energy generation is occurring within the tube wall ( $r_1 < r < r_2$ ). Consider steady-state conditions for which  $T_1 > T_2$ . Is it possible to maintain a *linear* radial

temperature distribution in the wall? If so, what special conditions must exist?


- 2.39** Passage of an electric current through a long conducting rod of radius  $r_i$  and thermal conductivity  $k_r$  results in uniform volumetric heating at a rate of  $\dot{q}$ . The conducting rod is wrapped in an electrically nonconducting cladding material of outer radius  $r_o$  and thermal conductivity  $k_c$ , and convection cooling is provided by an adjoining fluid.

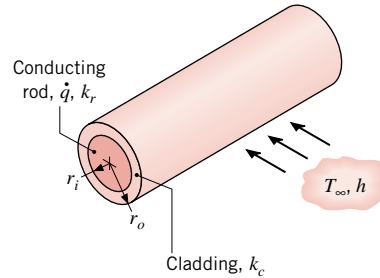

For steady-state conditions, write appropriate forms of the heat equations for the rod and cladding. Express appropriate boundary conditions for the solution of these equations.

- 2.40** Two-dimensional, steady-state conduction occurs in a hollow cylindrical solid of thermal conductivity  $k = 16 \text{ W/m} \cdot \text{K}$ , outer radius  $r_o = 1 \text{ m}$ , and overall length  $2z_o = 5 \text{ m}$ , where the origin of the coordinate system is located at the midpoint of the centerline. The inner surface of the cylinder is insulated, and the temperature distribution within the cylinder has the form  $T(r, z) = a + br^2 + c \ln r + dz^2$ , where  $a = 20^\circ\text{C}$ ,  $b = 150^\circ\text{C/m}^2$ ,  $c = -12^\circ\text{C}$ ,  $d = -300^\circ\text{C/m}^2$  and  $r$  and  $z$  are in meters.
- (a) Determine the inner radius  $r_i$  of the cylinder.
- (b) Obtain an expression for the volumetric rate of heat generation,  $\dot{q}(\text{W/m}^3)$ .
- (c) Determine the axial distribution of the heat flux at the outer surface,  $q_r''(r_o, z)$ . What is the heat rate at the outer surface? Is it into or out of the cylinder?
- (d) Determine the radial distribution of the heat flux at the end faces of the cylinder,  $q_z''(r, +z_o)$  and  $q_z''(r, -z_o)$ . What are the corresponding heat rates? Are they into or out of the cylinder?
- (e) Verify that your results are consistent with an overall energy balance on the cylinder.
- 2.41** An electric cable of radius  $r_1$  and thermal conductivity  $k_c$  is enclosed by an insulating sleeve whose outer surface is of radius  $r_2$  and experiences convection heat transfer and radiation exchange with the adjoining air and large surroundings, respectively. When electric current passes

through the cable, thermal energy is generated within the cable at a volumetric rate  $\dot{q}$ .

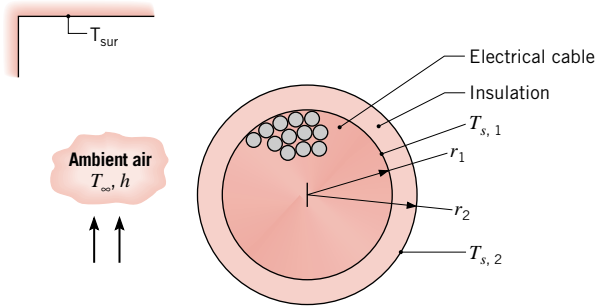

- (a) Write the steady-state forms of the heat diffusion equation for the insulation and the cable. Verify that these equations are satisfied by the following temperature distributions:

$$\text{Insulation: } T(r) = T_{s,2} + (T_{s,1} - T_{s,2}) \frac{\ln(r/r_2)}{\ln(r_1/r_2)}$$

$$\text{Cable: } T(r) = T_{s,1} + \frac{\dot{q}r_1^2}{4k_c} \left( 1 - \frac{r^2}{r_1^2} \right)$$

Sketch the temperature distribution,  $T(r)$ , in the cable and the sleeve, labeling key features.

- (b) Applying Fourier's law, show that the rate of conduction heat transfer per unit length through the sleeve may be expressed as

$$q'_r = \frac{2\pi k_s (T_{s,1} - T_{s,2})}{\ln(r_2/r_1)}$$

Applying an energy balance to a control surface placed around the cable, obtain an alternative expression for  $q'_r$ , expressing your result in terms of  $\dot{q}$  and  $r_1$ .

- (c) Applying an energy balance to a control surface placed around the outer surface of the sleeve, obtain an expression from which  $T_{s,2}$  may be determined as a function of  $\dot{q}$ ,  $r_1$ ,  $h$ ,  $T_\infty$ ,  $\varepsilon$ , and  $T_{\text{sur}}$ .
- (d) Consider conditions for which 250 A are passing through a cable having an electric resistance per unit length of  $R'_e = 0.005 \Omega/\text{m}$ , a radius of  $r_1 = 15$  mm, and a thermal conductivity of  $k_c = 200 \text{ W/m} \cdot \text{K}$ . For  $k_s = 0.15 \text{ W/m} \cdot \text{K}$ ,  $r_2 = 15.5$  mm,  $h = 25 \text{ W/m}^2 \cdot \text{K}$ ,  $\varepsilon = 0.9$ ,  $T_\infty = 25^\circ\text{C}$ , and  $T_{\text{sur}} = 35^\circ\text{C}$ , evaluate the surface temperatures,  $T_{s,1}$  and  $T_{s,2}$ , as well as the temperature  $T_o$  at the centerline of the cable.


- (e) With all other conditions remaining the same, compute and plot  $T_o$ ,  $T_{s,1}$ , and  $T_{s,2}$  as a function of  $r_2$  for  $15.5 \leq r_2 \leq 20$  mm.

- 2.42 A spherical shell of inner and outer radii  $r_i$  and  $r_o$ , respectively, contains heat-dissipating components, and at a particular instant the temperature distribution in the shell is known to be of the form

$$T(r) = \frac{C_1}{r} + C_2$$

Are conditions steady-state or transient? How do the heat flux and heat rate vary with radius?

- 2.43 A chemically reacting mixture is stored in a thin-walled spherical container of radius  $r_1 = 200$  mm, and the exothermic reaction generates heat at a uniform, but temperature-dependent volumetric rate of  $\dot{q} = \dot{q}_o \exp(-A/T_o)$ , where  $\dot{q}_o = 5000 \text{ W/m}^3$ ,  $A = 75 \text{ K}$ , and  $T_o$  is the mixture temperature in kelvins. The vessel is enclosed by an insulating material of outer radius  $r_2$ , thermal conductivity  $k$ , and emissivity  $\varepsilon$ . The outer surface of the insulation experiences convection heat transfer and net radiation exchange with the adjoining air and large surroundings, respectively.

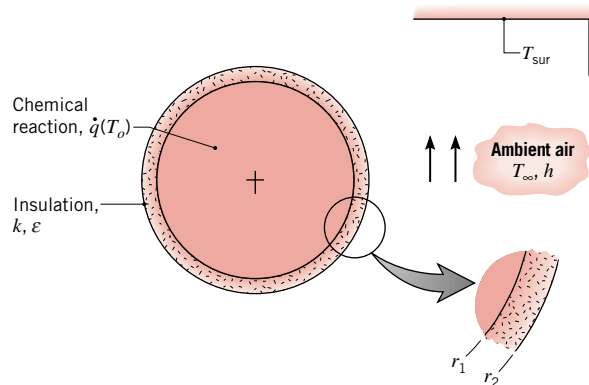

- (a) Write the steady-state form of the heat diffusion equation for the insulation. Verify that this equation is satisfied by the temperature distribution

$$T(r) = T_{s,1} - (T_{s,1} - T_{s,2}) \left[ \frac{1 - (r_1/r)}{1 - (r_1/r_2)} \right]$$

Sketch the temperature distribution,  $T(r)$ , labeling key features.

- (b) Applying Fourier's law, show that the rate of heat transfer by conduction through the insulation may be expressed as


$$q_r = \frac{4\pi k (T_{s,1} - T_{s,2})}{(1/r_1) - (1/r_2)}$$

Applying an energy balance to a control surface about the container, obtain an alternative expression for  $q_r$ , expressing your result in terms of  $\dot{q}$  and  $r_1$ .

- (c) Applying an energy balance to a control surface placed around the outer surface of the insulation, obtain an expression from which  $T_{s,2}$  may be determined as a function of  $\dot{q}$ ,  $r_1$ ,  $h$ ,  $T_\infty$ ,  $\varepsilon$ , and  $T_{\text{sur}}$ .
- (d) The process engineer wishes to maintain a reactor temperature of  $T_o = T(r_1) = 95^\circ\text{C}$  under conditions for which  $k = 0.05 \text{ W/m} \cdot \text{K}$ ,  $r_2 = 208 \text{ mm}$ ,  $h = 5 \text{ W/m}^2 \cdot \text{K}$ ,  $\varepsilon = 0.9$ ,  $T_\infty = 25^\circ\text{C}$ , and  $T_{\text{sur}} = 35^\circ\text{C}$ . What is the actual reactor temperature and the outer surface temperature of the insulation,  $T_{s,2}$ ?
- (e) Compute and plot the variation of  $T_{s,2}$  with  $r_2$  for  $201 \leq r_2 \leq 210 \text{ mm}$ . The engineer is concerned about potential burn injuries to personnel who may come into contact with the exposed surface of the insulation. Is increasing the insulation thickness a practical solution to maintaining  $T_{s,2} \leq 45^\circ\text{C}$ ? What other parameter could be varied to reduce  $T_{s,2}$ ?

### Graphical Representations

- 2.44** The one-dimensional system of mass  $M$  with constant properties and no internal heat generation shown in the figure is initially at a uniform temperature  $T_i$ . The electrical heater is suddenly energized providing a uniform heat flux  $q_o''$  at the surface  $x = 0$ . The boundaries at  $x = L$  and elsewhere are perfectly insulated.

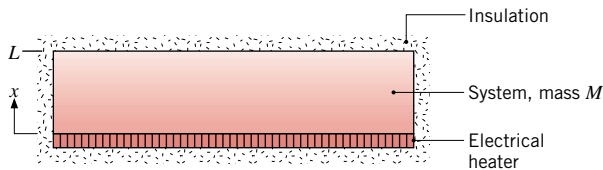


- (a) Write the differential equation and identify the boundary and initial conditions that could be used to determine the temperature as a function of position and time in the system.
- (b) On  $T-x$  coordinates, sketch the temperature distributions for the initial condition ( $t \leq 0$ ) and for several times after the heater is energized. Will a steady-state temperature distribution ever be reached?
- (c) On  $q_x''-t$  coordinates, sketch the heat flux  $q_x''(x,t)$  at the planes  $x = 0$ ,  $x = L/2$ , and  $x = L$  as a function of time.
- (d) After a period of time  $t_e$  has elapsed, the heater power is switched off. Assuming that the insulation is perfect, the system will eventually reach a final uniform temperature  $T_f$ . Derive an expression that can be used to determine  $T_f$  as a function of the parameters  $q_o''$ ,  $t_e$ ,  $T_i$ , and the system characteristics  $M$ ,  $c_p$ , and  $A_s$  (the heater surface area).

- 2.45** A large plate of thickness  $2L$  is at a uniform temperature of  $T_i = 200^\circ\text{C}$ , when it is suddenly quenched by dipping it in a liquid bath of temperature  $T_\infty = 20^\circ\text{C}$ . Heat transfer to the liquid is characterized by the convection coefficient  $h$ .

- (a) If  $x = 0$  corresponds to the midplane of the wall, on  $T-x$  coordinates, sketch the temperature distributions for the following conditions: initial condition ( $t \leq 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and two intermediate times.
- (b) On  $q_x''-t$  coordinates, sketch the variation with time of the heat flux at  $x = L$ .
- (c) If  $h = 100 \text{ W/m}^2 \cdot \text{K}$ , what is the heat flux at  $x = L$  and  $t = 0$ ? If the wall has a thermal conductivity of  $k = 50 \text{ W/m} \cdot \text{K}$ , what is the corresponding temperature gradient at  $x = L$ ?
- (d) Consider a plate of thickness  $2L = 20 \text{ mm}$  with a density of  $\rho = 2770 \text{ kg/m}^3$  and a specific heat  $c_p = 875 \text{ J/kg} \cdot \text{K}$ . By performing an energy balance on the plate, determine the amount of energy per unit surface area of the plate ( $\text{J/m}^2$ ) that is transferred to the bath over the time required to reach steady-state conditions.
- (e) From other considerations, it is known that, during the quenching process, the heat flux at  $x = +L$  and  $x = -L$  decays exponentially with time according to the relation,  $q'' = A \exp(-Bt)$ , where  $t$  is in seconds,  $A = 1.80 \times 10^4 \text{ W/m}^2$ , and  $B = 4.126 \times 10^{-3} \text{ s}^{-1}$ . Use this information to determine the energy per unit surface area of the plate that is transferred to the fluid during the quenching process.


- 2.46** The plane wall with constant properties and no internal heat generation shown in the figure is initially at a uniform temperature  $T_i$ . Suddenly the surface at  $x = L$  is heated by a fluid at  $T_\infty$  having a convection heat transfer coefficient  $h$ . The boundary at  $x = 0$  is perfectly insulated.

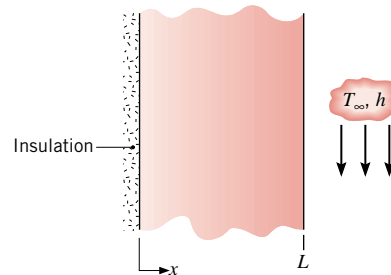

- (a) Write the differential equation and identify the boundary and initial conditions that could be used to determine the temperature as a function of position and time in the wall.


- (b) On  $T - x$  coordinates, sketch the temperature distributions for the following conditions: initial condition ( $t \leq 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and two intermediate times.
- (c) On  $q''_x - t$  coordinates, sketch the heat flux at the locations  $x = 0$  and  $x = L$ . That is, show qualitatively how  $q''_x(0, t)$  and  $q''_x(L, t)$  vary with time.
- (d) Write an expression for the total energy transferred to the wall per unit volume of the wall ( $\text{J/m}^3$ ).

**2.47** A plane wall has constant properties, no internal heat generation, and is initially at a uniform temperature  $T_i$ . Suddenly, the surface at  $x = L$  is heated by a fluid at  $T_\infty$  having a convection coefficient  $h$ . At the same instant, the electrical heater is energized, providing a constant heat flux  $q''_o$  at  $x = 0$ .

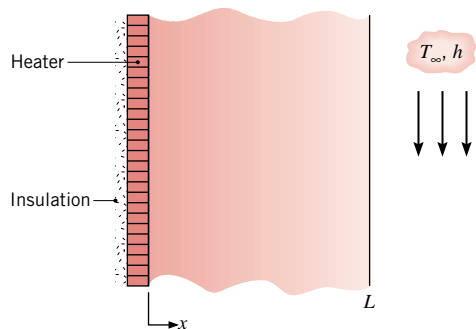

- (a) On  $T - x$  coordinates, sketch the temperature distributions for the following conditions: initial condition ( $t \leq 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and for two intermediate times.
- (b) On  $q''_x - x$  coordinates, sketch the heat flux corresponding to the four temperature distributions of part (a).
- (c) On  $q''_x - t$  coordinates, sketch the heat flux at the locations  $x = 0$  and  $x = L$ . That is, show qualitatively how  $q''_x(0, t)$  and  $q''_x(L, t)$  vary with time.
- (d) Derive an expression for the steady-state temperature at the heater surface,  $T(0, \infty)$ , in terms of  $q''_o$ ,  $T_\infty$ ,  $k$ ,  $h$ , and  $L$ .

**2.48** A plane wall with constant properties is initially at a uniform temperature  $T_o$ . Suddenly, the surface at  $x = L$  is exposed to a convection process with a fluid at  $T_\infty$  ( $> T_o$ ) having a convection coefficient  $h$ . Also, suddenly the wall experiences a uniform internal volumetric heating  $\dot{q}$  that is sufficiently large to induce a maximum steady-state temperature within the wall, which exceeds that of the fluid. The boundary at  $x = 0$  remains at  $T_o$ .

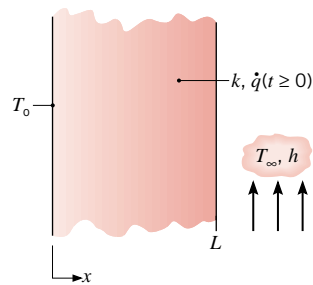


- (a) On  $T - x$  coordinates, sketch the temperature distributions for the following conditions: initial condition ( $t \leq 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and for two intermediate times. Show also the distribution for the special condition when there is no heat flow at the  $x = L$  boundary.
- (b) On  $q''_x - t$  coordinates, sketch the heat flux for the locations  $x = 0$  and  $x = L$ , that is,  $q''_x(0, t)$  and  $q''_x(L, t)$ , respectively.

**2.49** Consider the conditions associated with Problem 2.48, but now with a convection process for which  $T_\infty < T_o$ .


- (a) On  $T - x$  coordinates, sketch the temperature distributions for the following conditions: initial condition ( $t \leq 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and for two intermediate times. Identify key features of the distributions, especially the location of the maximum temperature and the temperature gradient at  $x = L$ .
- (b) On  $q''_x - t$  coordinates, sketch the heat flux for the locations  $x = 0$  and  $x = L$ , that is,  $q''_x(0, t)$  and  $q''_x(L, t)$ , respectively. Identify key features of the flux histories.

**2.50** A spherical particle of radius  $r_1$  experiences uniform thermal generation at a rate of  $\dot{q}$ . The particle is encapsulated by a spherical shell of outside radius  $r_2$  that is cooled by ambient air. The thermal conductivities of the particle and shell are  $k_1$  and  $k_2$ , respectively, where  $k_1 = 2k_2$ .

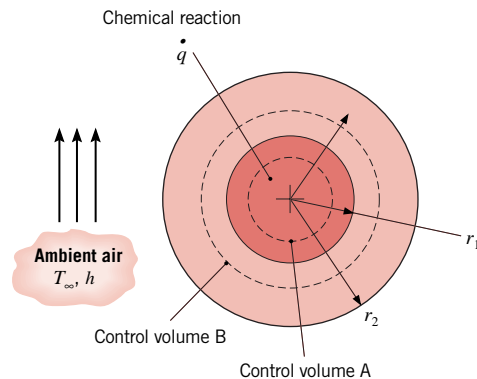

- (a) By applying the conservation of energy principle to spherical control volume A, which is placed at an arbitrary location within the sphere, determine a relationship between the temperature gradient,  $dT/dr$ , and the local radius,  $r$ , for  $0 \leq r \leq r_1$ .
- (b) By applying the conservation of energy principle to spherical control volume B, which is placed at an arbitrary location within the spherical shell, determine a relationship between the temperature gradient,  $dT/dr$ , and the local radius,  $r$ , for  $r_1 \leq r \leq r_2$ .
- (c) On  $T - r$  coordinates, sketch the temperature distribution over the range  $0 \leq r \leq r_2$ .

**2.51** A plane wall of thickness  $L = 0.1$  m experiences uniform volumetric heating at a rate  $\dot{q}$ . One surface of the wall ( $x = 0$ ) is insulated, while the other surface is exposed to a fluid at  $T_\infty = 20^\circ\text{C}$ , with convection heat transfer characterized by  $h = 1000$  W/m<sup>2</sup> · K. Initially, the temperature distribution in the wall is  $T(x, 0) = a + bx^2$ , where  $a = 300^\circ\text{C}$ ,  $b = -1.0 \times 10^4$  °C/m<sup>2</sup> and  $x$  is in meters. Suddenly, the volumetric heat generation is deactivated ( $\dot{q} = 0$  for  $t \geq 0$ ), while convection heat transfer continues to occur at  $x = L$ . The properties of the wall are  $\rho = 7000$  kg/m<sup>3</sup>,  $c_p = 450$  J/kg · K, and  $k = 90$  W/m · K.

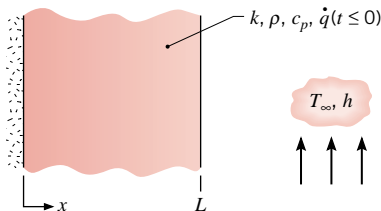

- (a) Determine the magnitude of the volumetric energy generation rate  $\dot{q}$  associated with the initial condition ( $t < 0$ ).
- (b) On  $T - x$  coordinates, sketch the temperature distribution for the following conditions: initial condition ( $t < 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and two intermediate conditions.
- (c) On  $q''_x - t$  coordinates, sketch the variation with time of the heat flux at the boundary exposed to the convection process,  $q''_x(L, t)$ . Calculate the corresponding value of the heat flux at  $t = 0$ ,  $q''_x(L, 0)$ .
- (d) Calculate the amount of energy removed from the wall per unit area (J/m<sup>2</sup>) by the fluid stream as the wall cools from its initial to steady-state condition.

**2.52** A plane wall that is insulated on one side ( $x = 0$ ) is initially at a uniform temperature  $T_i$ , when its exposed surface at  $x = L$  is suddenly raised to a temperature  $T_s$ .


- (a) Verify that the following equation satisfies the heat equation and boundary conditions:

$$\frac{T(x, t) - T_s}{T_i - T_s} = C_1 \exp\left(-\frac{\pi^2 \alpha t}{4 L^2}\right) \cos\left(\frac{\pi x}{2 L}\right)$$

where  $C_1$  is a constant and  $\alpha$  is the thermal diffusivity.

- (b) Obtain expressions for the heat flux at  $x = 0$  and  $x = L$ .
- (c) Sketch the temperature distribution  $T(x)$  at  $t = 0$ , at  $t \rightarrow \infty$ , and at an intermediate time. Sketch the variation with time of the heat flux at  $x = L$ ,  $q''_L(t)$ .
- (d) What effect does  $\alpha$  have on the thermal response of the material to a change in surface temperature?

**2.53** A thin electrical heater dissipating 4000 W/m<sup>2</sup> is sandwiched between two 25-mm-thick plates whose exposed surfaces experience convection with a fluid for which  $T_\infty = 20^\circ\text{C}$  and  $h = 400$  W/m<sup>2</sup> · K. The thermophysical properties of the plate material are  $\rho = 2500$  kg/m<sup>3</sup>,  $c = 700$  J/kg · K, and  $k = 5$  W/m · K.

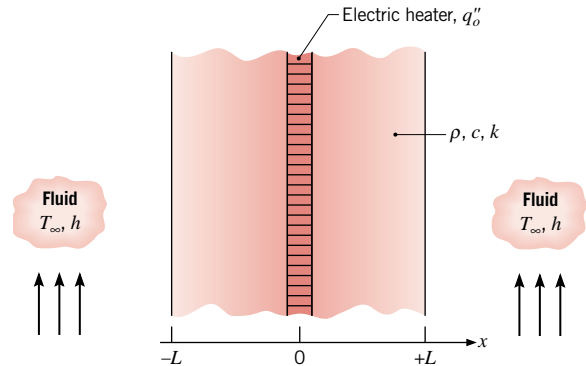


- (a) On  $T - x$  coordinates, sketch the steady-state temperature distribution for  $-L \leq x \leq +L$ . Calculate values of the temperatures at the surfaces,  $x = \pm L$ , and the midpoint,  $x = 0$ . Label this distribution as Case 1, and explain its salient features.
- (b) Consider conditions for which there is a loss of coolant and existence of a nearly adiabatic condition on the  $x = +L$  surface. On the  $T - x$  coordinates used for part (a), sketch the corresponding steady-state temperature distribution and indicate the temperatures at  $x = 0, \pm L$ . Label the distribution as Case 2, and explain its key features.
- (c) With the system operating as described in part (b), the surface  $x = -L$  also experiences a sudden loss of coolant. This dangerous situation goes undetected for 15 minutes, at which time the power to the heater is deactivated. Assuming no heat losses from the surfaces of the plates, what is the eventual ( $t \rightarrow \infty$ ), uni-



form, steady-state temperature distribution in the plates? Show this distribution as Case 3 on your sketch, and explain its key features. *Hint:* Apply the conservation of energy requirement on a time-interval basis, Eq. 1.11b, for the initial and final conditions corresponding to Case 2 and Case 3, respectively.

- (d) On  $T - t$  coordinates, sketch the temperature history at the plate locations  $x = 0, \pm L$  during the transient period between the distributions for Cases 2 and 3. Where and when will the temperature in the system achieve a maximum value?


**2.54** Typically, air is heated in a hair dryer by blowing it across a coiled wire through which an electric current is passed. Thermal energy is generated by electric resistance heating within the wire and is transferred by convection from the surface of the wire to the air. Consider conditions for which the wire is initially at room temperature,  $T_i$ , and resistance heating is concurrently initiated with air flow at  $t = 0$ .

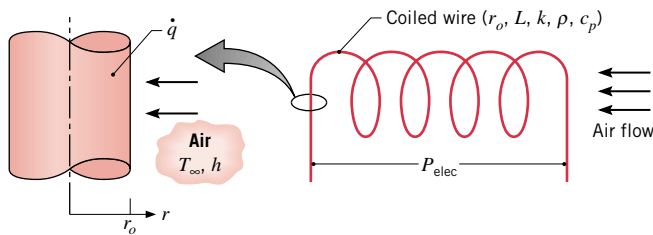

- (a) For a wire radius  $r_o$ , an air temperature  $T_\infty$ , and a convection coefficient  $h$ , write the form of the heat equation and the boundary/initial conditions that govern the transient thermal response,  $T(r, t)$ , of the wire.
- (b) If the length and radius of the wire are 500 mm and 1 mm, respectively, what is the volumetric rate of thermal energy generation for a power consumption of  $P_{elec} = 500$  W? What is the convection heat flux under steady-state conditions?
- (c) On  $T - r$  coordinates, sketch the temperature distributions for the following conditions: initial condition ( $t \leq 0$ ), steady-state condition ( $t \rightarrow \infty$ ), and for two intermediate times.
- (d) On  $q_r'' - t$  coordinates, sketch the variation of the heat flux with time for locations at  $r = 0$  and  $r = r_o$ .

# *C H A P T E R* **3**

## **One-Dimensional, Steady-State Conduction**

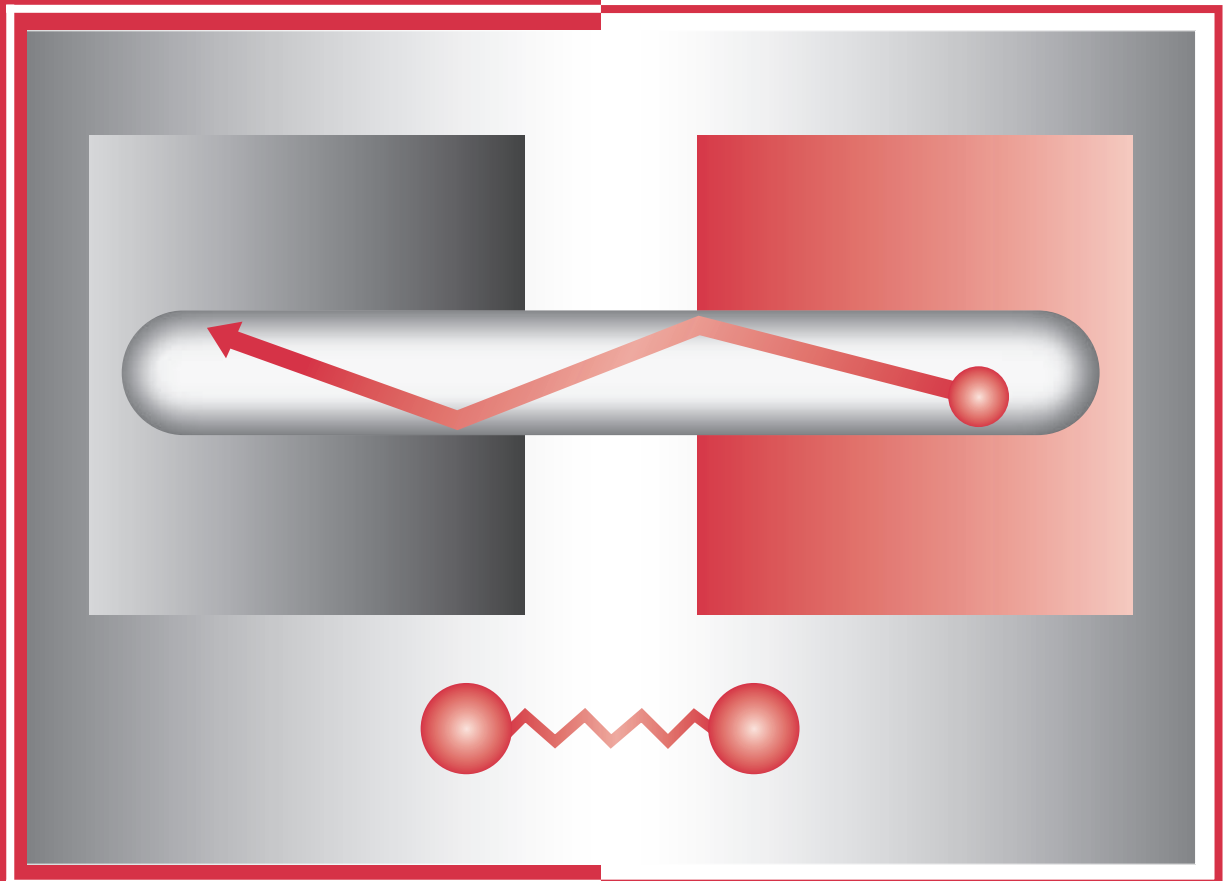



**I**n this chapter we treat situations for which heat is transferred by diffusion under *one-dimensional, steady-state* conditions. The term “one-dimensional” refers to the fact that only one coordinate is needed to describe the spatial variation of the dependent variables. Hence, in a *one-dimensional* system, temperature gradients exist along only a single coordinate direction, and heat transfer occurs exclusively in that direction. The system is characterized by *steady-state* conditions if the temperature at each point is independent of time. Despite their inherent simplicity, one-dimensional, steady-state models may be used to accurately represent numerous engineering systems.

We begin our consideration of one-dimensional, steady-state conduction by discussing heat transfer with no internal generation of thermal energy (Sections 3.1 through 3.4). The objective is to determine expressions for the temperature distribution and heat transfer rate in common (planar, cylindrical, and spherical) geometries. For such geometries, an additional objective is to introduce the concept of *thermal resistance* and to show how *thermal circuits* may be used to model heat flow, much as electrical circuits are used for current flow. The effect of internal heat generation is treated in Section 3.5, and again our objective is to obtain expressions for determining temperature distributions and heat transfer rates. In Section 3.6, we consider the special case of one-dimensional, steady-state conduction for *extended surfaces*. In their most common form, these surfaces are termed *fins* and are used to *enhance* heat transfer by convection to an adjoining fluid. In addition to determining related temperature distributions and heat rates, our objective is to introduce *performance parameters* that may be used to determine their efficacy. Finally, in Section 3.7 we present concepts and equations relating to heat transfer within the human body, including the effects of *metabolic heat generation* and *perfusion*.

## 3.1


### The Plane Wall

For one-dimensional conduction in a plane wall, temperature is a function of the  $x$  coordinate only and heat is transferred exclusively in this direction. In Figure 3.1a, a plane wall separates two fluids of different temperatures. Heat transfer occurs by convection from the hot fluid at  $T_{\infty,1}$  to one surface of the wall at  $T_{s,1}$ , by conduction through the wall, and by convection from the other surface of the wall at  $T_{s,2}$  to the cold fluid at  $T_{\infty,2}$ .

We begin by considering conditions *within* the wall. We first determine the temperature distribution, from which we can then obtain the conduction heat transfer rate.

#### 3.1.1 Temperature Distribution

The temperature distribution in the wall can be determined by solving the heat equation with the proper boundary conditions. For steady-state conditions with no

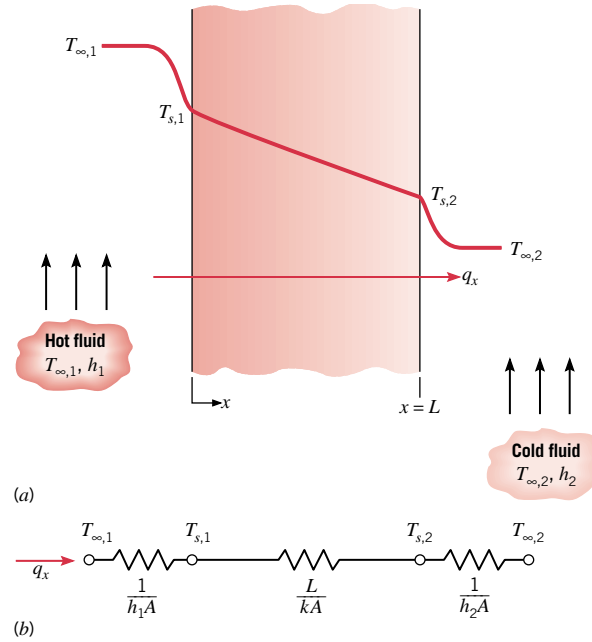

**FIGURE 3.1** Heat transfer through a plane wall. (a) Temperature distribution. (b) Equivalent thermal circuit.

distributed source or sink of energy within the wall, the appropriate form of the heat equation is Equation 2.21

$$\frac{d}{dx} \left( k \frac{dT}{dx} \right) = 0 \quad (3.1)$$

Hence, from Equation 2.2, it follows that, for *one-dimensional, steady-state conduction in a plane wall with no heat generation, the heat flux is a constant, independent of  $x$* . If the thermal conductivity of the wall material is assumed to be constant, the equation may be integrated twice to obtain the *general solution*

$$T(x) = C_1 x + C_2 \quad (3.2)$$

To obtain the constants of integration,  $C_1$  and  $C_2$ , boundary conditions must be introduced. We choose to apply conditions of the first kind at  $x = 0$  and  $x = L$ , in which case

$$T(0) = T_{s,1} \quad \text{and} \quad T(L) = T_{s,2}$$

Applying the condition at  $x = 0$  to the general solution, it follows that

$$T_{s,1} = C_2$$

Similarly, at  $x = L$ ,

$$T_{s,2} = C_1 L + C_2 = C_1 L + T_{s,1}$$

in which case

$$\frac{T_{s,2} - T_{s,1}}{L} = C_1$$

Substituting into the general solution, the temperature distribution is then

$$T(x) = (T_{s,2} - T_{s,1}) \frac{x}{L} + T_{s,1} \quad (3.3)$$

From this result it is evident that, *for one-dimensional, steady-state conduction in a plane wall with no heat generation and constant thermal conductivity, the temperature varies linearly with  $x$ .*

Now that we have the temperature distribution, we may use Fourier's law, Equation 2.1, to determine the conduction heat transfer rate. That is,

$$q_x = -kA \frac{dT}{dx} = \frac{kA}{L} (T_{s,1} - T_{s,2}) \quad (3.4)$$

Note that  $A$  is the area of the wall *normal* to the direction of heat transfer and, for the plane wall, it is a constant independent of  $x$ . The heat flux is then

$$q_x'' = \frac{q_x}{A} = \frac{k}{L} (T_{s,1} - T_{s,2}) \quad (3.5)$$

Equations 3.4 and 3.5 indicate that both the heat rate  $q_x$  and heat flux  $q_x''$  are constants, independent of  $x$ .

In the foregoing paragraphs we have used the *standard approach* to solving conduction problems. That is, the general solution for the temperature distribution is first obtained by solving the appropriate form of the heat equation. The boundary conditions are then applied to obtain the particular solution, which is used with Fourier's law to determine the heat transfer rate. Note that we have opted to prescribe surface temperatures at  $x = 0$  and  $x = L$  as boundary conditions, even though it is the fluid temperatures, and not the surface temperatures, that are typically known. However, since adjoining fluid and surface temperatures are easily related through a surface energy balance (see Section 1.3.2), it is a simple matter to express Equations 3.3 through 3.5 in terms of fluid, rather than surface, temperatures. Alternatively, equivalent results could be obtained directly by using the surface energy balances as boundary conditions of the third kind in evaluating the constants of Equation 3.2 (see Problem 3.1).

### 3.1.2 Thermal Resistance

At this point we note that, for the special case of one-dimensional heat transfer with no internal energy generation and with constant properties, a very important concept is suggested by Equation 3.4. In particular, there exists an analogy between the diffusion of heat and electrical charge. Just as an electrical resistance is associated with the conduction of electricity, a thermal resistance may be associated with the conduction of heat. Defining resistance as the ratio of a driving potential to the corresponding transfer rate, it follows from Equation 3.4 that the *thermal resistance for conduction* in a plane wall is

$$R_{t,\text{cond}} \equiv \frac{T_{s,1} - T_{s,2}}{q_x} = \frac{L}{kA} \quad (3.6)$$

Similarly, for electrical conduction in the same system, Ohm's law provides an electrical resistance of the form

$$R_e = \frac{E_{s,1} - E_{s,2}}{I} = \frac{L}{\sigma A} \quad (3.7)$$

The analogy between Equations 3.6 and 3.7 is obvious. A thermal resistance may also be associated with heat transfer by convection at a surface. From Newton's law of cooling,

$$q = hA(T_s - T_\infty) \quad (3.8)$$

The *thermal resistance for convection* is then

$$R_{t, \text{conv}} \equiv \frac{T_s - T_\infty}{q} = \frac{1}{hA} \quad (3.9)$$

Circuit representations provide a useful tool for both conceptualizing and quantifying heat transfer problems. The *equivalent thermal circuit* for the plane wall with convection surface conditions is shown in Figure 3.1b. The heat transfer rate may be determined from separate consideration of each element in the network. Since  $q_x$  is constant throughout the network, it follows that

$$q_x = \frac{T_{\infty,1} - T_{s,1}}{1/h_1A} = \frac{T_{s,1} - T_{s,2}}{L/kA} = \frac{T_{s,2} - T_{\infty,2}}{1/h_2A} \quad (3.10)$$

In terms of the *overall temperature difference*,  $T_{\infty,1} - T_{\infty,2}$ , and the *total thermal resistance*,  $R_{\text{tot}}$ , the heat transfer rate may also be expressed as

$$q_x = \frac{T_{\infty,1} - T_{\infty,2}}{R_{\text{tot}}} \quad (3.11)$$

Because the conduction and convection resistances are in series and may be summed, it follows that

$$R_{\text{tot}} = \frac{1}{h_1A} + \frac{L}{kA} + \frac{1}{h_2A} \quad (3.12)$$

Radiation exchange between the surface and surroundings may also be important if the convection heat transfer coefficient is small (as it often is for natural convection in a gas). A *thermal resistance for radiation* may be defined by reference to Equation 1.8:

$$R_{t, \text{rad}} = \frac{T_s - T_{\text{sur}}}{q_{\text{rad}}} = \frac{1}{h_rA} \quad (3.13)$$

For radiation between a surface and *large surroundings*,  $h_r$  is determined from Equation 1.9. Surface radiation and convection resistances act in parallel, and if  $T_\infty = T_{\text{sur}}$ , they may be combined to obtain a single, effective surface resistance.

### 3.1.3 The Composite Wall

Equivalent thermal circuits may also be used for more complex systems, such as *composite walls*. Such walls may involve any number of series and parallel thermal

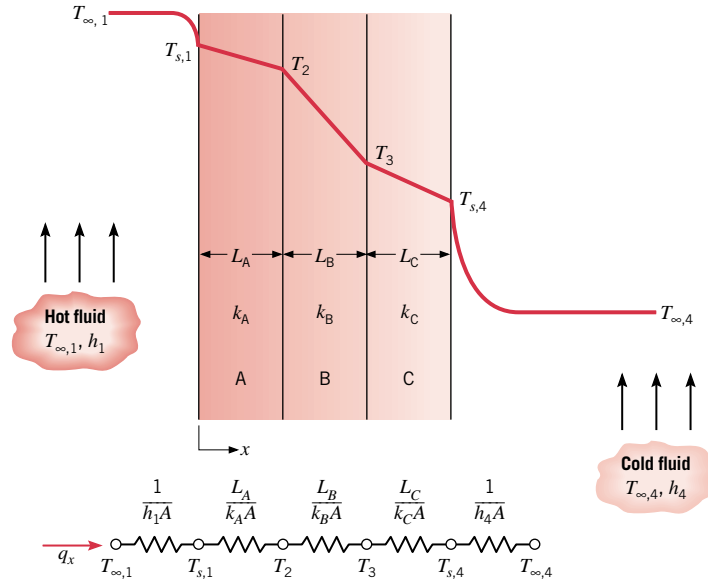


FIGURE 3.2 Equivalent thermal circuit for a series composite wall.

resistances due to layers of different materials. Consider the series composite wall of Figure 3.2. The one-dimensional heat transfer rate for this system may be expressed as

$$q_x = \frac{T_{\infty,1} - T_{\infty,4}}{\sum R_t} \quad (3.14)$$

where  $T_{\infty,1} - T_{\infty,4}$  is the *overall* temperature difference and the summation includes all thermal resistances. Hence

$$q_x = \frac{T_{\infty,1} - T_{\infty,4}}{[(1/h_1 A) + (L_A/k_A A) + (L_B/k_B A) + (L_C/k_C A) + (1/h_4 A)]} \quad (3.15)$$

Alternatively, the heat transfer rate can be related to the temperature difference and resistance associated with each element. For example,


$$q_x = \frac{T_{\infty,1} - T_{s,1}}{(1/h_1 A)} = \frac{T_{s,1} - T_2}{(L_A/k_A A)} = \frac{T_2 - T_3}{(L_B/k_B A)} = \dots \quad (3.16)$$

With composite systems it is often convenient to work with an *overall heat transfer coefficient*,  $U$ , which is defined by an expression analogous to Newton's law of cooling. Accordingly,

$$q_x \equiv UA \Delta T \quad (3.17)$$

where  $\Delta T$  is the overall temperature difference. The overall heat transfer coefficient is related to the total thermal resistance, and from Equations 3.14 and 3.17 we see that  $UA = 1/R_{\text{tot}}$ . Hence, for the composite wall of Figure 3.2,

$$U = \frac{1}{R_{\text{tot}} A} = \frac{1}{[(1/h_1) + (L_A/k_A) + (L_B/k_B) + (L_C/k_C) + (1/h_4)]} \quad (3.18)$$

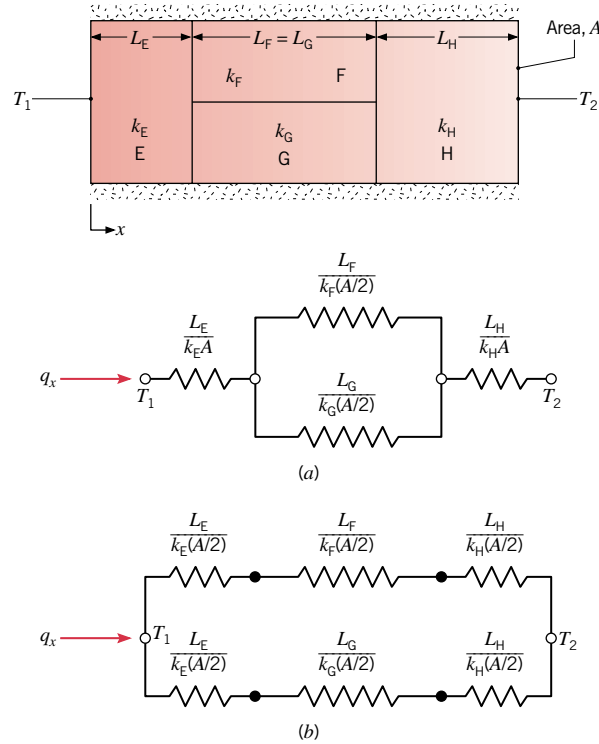

**FIGURE 3.3** Equivalent thermal circuits for a series–parallel composite wall.


In general, we may write

$$R_{\text{tot}} = \sum R_i = \frac{\Delta T}{q} = \frac{1}{UA} \quad (3.19)$$

Composite walls may also be characterized by series–parallel configurations, such as that shown in Figure 3.3. Although the heat flow is now multidimensional, it is often reasonable to assume one-dimensional conditions. Subject to this assumption, two different thermal circuits may be used. For case (a) it is presumed that surfaces normal to the  $x$  direction are isothermal, while for case (b) it is assumed that surfaces parallel to the  $x$  direction are adiabatic. Different results are obtained for  $R_{\text{tot}}$ , and the corresponding values of  $q$  bracket the actual heat transfer rate. These differences increase with increasing  $|k_F - k_G|$ , as multidimensional effects become more significant.

### 3.1.4 Contact Resistance

Although neglected until now, it is important to recognize that, in composite systems, the temperature drop across the interface between materials may be appreciable. This temperature change is attributed to what is known as the *thermal contact*

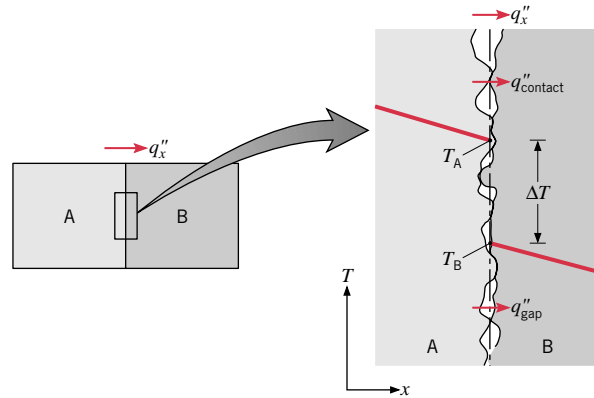

**FIGURE 3.4** Temperature drop due to thermal contact resistance.

resistance,  $R_{t,c}$ . The effect is shown in Figure 3.4, and for a unit area of the interface, the resistance is defined as

$$R''_{t,c} = \frac{T_A - T_B}{q''_x} \quad (3.20)$$

The existence of a finite contact resistance is due principally to surface roughness effects. Contact spots are interspersed with gaps that are, in most instances, air filled. Heat transfer is therefore due to conduction across the actual contact area and to conduction and/or radiation across the gaps. The contact resistance may be viewed as two parallel resistances: that due to the contact spots and that due to the gaps. The contact area is typically small, and especially for rough surfaces, the major contribution to the resistance is made by the gaps.

For solids whose thermal conductivities exceed that of the interfacial fluid, the contact resistance may be reduced by increasing the area of the contact spots. Such an increase may be effected by increasing the joint pressure and/or by reducing the roughness of the mating surfaces. The contact resistance may also be reduced by selecting an interfacial fluid of large thermal conductivity. In this respect, no fluid (an evacuated interface) eliminates conduction across the gap, thereby increasing the

**TABLE 3.1** Thermal contact resistance for (a) metallic interfaces under vacuum conditions and (b) aluminum interface (10- $\mu\text{m}$  surface roughness,  $10^5 \text{ N/m}^2$ ) with different interfacial fluids [1]

Thermal Resistance, $R''_{t,c} \times 10^4 (\text{m}^2 \cdot \text{K/W})$				
(a) Vacuum Interface			(b) Interfacial Fluid	
Contact pressure	100 kN/m <sup>2</sup>	10,000 kN/m <sup>2</sup>	Air	2.75
Stainless steel	6–25	0.7–4.0	Helium	1.05
Copper	1–10	0.1–0.5	Hydrogen	0.720
Magnesium	1.5–3.5	0.2–0.4	Silicone oil	0.525
Aluminum	1.5–5.0	0.2–0.4	Glycerine	0.265

**TABLE 3.2** Thermal resistance of representative solid/solid interfaces

Interface	$R''_{t,c} \times 10^4 \text{ (m}^2 \cdot \text{K/W)}$	Source
Silicon chip/lapped aluminum in air (27–500 kN/m <sup>2</sup> )	0.3–0.6	[2]
Aluminum/aluminum with indium foil filler (~100 kN/m <sup>2</sup> )	~0.07	[1, 3]
Stainless/stainless with indium foil filler (~3500 kN/m <sup>2</sup> )	~0.04	[1, 3]
Aluminum/aluminum with metallic (Pb) coating	0.01–0.1	[4]
Aluminum/aluminum with Dow Corning 340 grease (~100 kN/m <sup>2</sup> )	~0.07	[1, 3]
Stainless/stainless with Dow Corning 340 grease (~3500 kN/m <sup>2</sup> )	~0.04	[1, 3]
Silicon chip/aluminum with 0.02-mm epoxy	0.2–0.9	[5]
Brass/brass with 15- $\mu\text{m}$ tin solder	0.025–0.14	[6]

contact resistance. Likewise, if the characteristic gap width,  $L$ , becomes small (as, for example, in the case of very smooth surfaces in contact),  $L/\lambda_{\text{mfp}}$  can approach values for which the thermal conductivity of the interfacial gas is reduced by microscale effects, as discussed in Section 2.2.

Although theories have been developed for predicting  $R''_{t,c}$ , the most reliable results are those that have been obtained experimentally. The effect of loading on metallic interfaces can be seen in Table 3.1*a*, which presents an approximate range of thermal resistances under vacuum conditions. The effect of interfacial fluid on the thermal resistance of an aluminum interface is shown in Table 3.1*b*.

Contrary to the results of Table 3.1, many applications involve contact between dissimilar solids and/or a wide range of possible interstitial (filler) materials (Table 3.2). Any interstitial substance that fills the gap between contacting surfaces and whose thermal conductivity exceeds that of air will decrease the contact resistance. Two classes of materials that are well suited for this purpose are soft metals and thermal greases. The metals, which include indium, lead, tin, and silver, may be inserted as a thin foil or applied as a thin coating to one of the parent materials. Silicon-based thermal greases are attractive on the basis of their ability to completely fill the interstices with a material whose thermal conductivity is as much as 50 times that of air.

Unlike the foregoing interfaces, which are not permanent, many interfaces involve permanently bonded joints. The joint could be formed from an epoxy, a soft solder rich in lead, or a hard solder such as a gold/tin alloy. Due to interface resistances between the parent and bonding materials, the actual thermal resistance of the joint exceeds the theoretical value ( $L/k$ ) computed from the thickness  $L$  and thermal conductivity  $k$  of the joint material. The thermal resistance of epoxied and soldered joints is also adversely affected by voids and cracks, which may form during manufacture or as a result of thermal cycling during normal operation.

Comprehensive reviews of thermal contact resistance results and models are provided by Snaith et al. [3], Madhusudana and Fletcher [7], and Yovanovich [8].



### EXAMPLE 3.1


In Example 1.6, we calculated the heat loss rate from a human body in air and water environments. Now we consider the same conditions except that the surroundings (air or water) are at  $10^\circ\text{C}$ . To reduce the heat loss rate, the person wears special sporting gear (snow suit and wet suit) made from a nanostructured silica aerogel insulation with an extremely low thermal conductivity of  $0.014 \text{ W/m} \cdot \text{K}$ . The emissivity of the outer surface of the snow and wet suits is  $0.95$ . What thickness of aerogel insulation is needed to reduce the heat loss rate to  $100 \text{ W}$  (a typical metabolic heat generation rate) in air and water? What are the resulting skin temperatures?

### SOLUTION

**Known:** Inner surface temperature of a skin/fat layer of known thickness, thermal conductivity, and surface area. Thermal conductivity and emissivity of snow and wet suits. Ambient conditions.

**Find:** Insulation thickness needed to reduce heat loss rate to  $100 \text{ W}$  and corresponding skin temperature.


### Schematic:

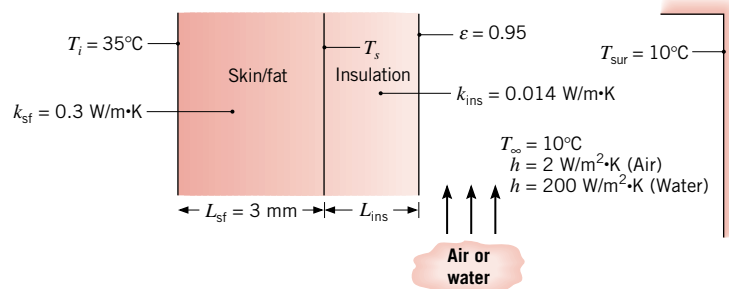

### Assumptions:

1. Steady-state conditions.
2. One-dimensional heat transfer by conduction through the skin/fat and insulation layers.
3. Contact resistance is negligible.
4. Thermal conductivities are uniform.
5. Radiation exchange between the skin surface and the surroundings is between a small surface and a large enclosure at the air temperature.
6. Liquid water is opaque to thermal radiation.
7. Solar radiation is negligible.
8. Body is completely immersed in water in part 2.

**Analysis:** The thermal circuit can be constructed by recognizing that resistance to heat flow is associated with conduction through the skin/fat and insulation layers and convection and radiation at the outer surface. Accordingly, the circuit and the resistances are of the following form (with  $h_r = 0$  for water):

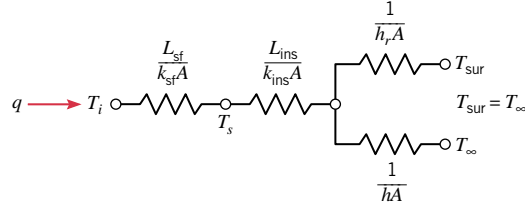

The total thermal resistance needed to achieve the desired heat loss rate is found from Equation 3.19,

$$R_{\text{tot}} = \frac{T_i - T_{\infty}}{q} = \frac{(35 - 10) \text{ K}}{100 \text{ W}} = 0.25 \text{ K/W}$$

The total thermal resistance between the inside of the skin/fat layer and the cold surroundings includes conduction resistances for the skin/fat and insulation layers and an effective resistance associated with convection and radiation, which act in parallel. Hence,

$$R_{\text{tot}} = \frac{L_{\text{sf}}}{k_{\text{sf}} A} + \frac{L_{\text{ins}}}{k_{\text{ins}} A} + \left( \frac{1}{1/hA} + \frac{1}{1/h_r A} \right)^{-1} = \frac{1}{A} \left( \frac{L_{\text{sf}}}{k_{\text{sf}}} + \frac{L_{\text{ins}}}{k_{\text{ins}}} + \frac{1}{h + h_r} \right)$$

This equation can be solved for the insulation thickness.

### Air

The radiation heat transfer coefficient is approximated as having the same value as in Example 1.6:  $h_r = 5.9 \text{ W/m}^2 \cdot \text{K}$ .

$$\begin{aligned} L_{\text{ins}} &= k_{\text{ins}} \left[ AR_{\text{tot}} - \frac{L_{\text{sf}}}{k_{\text{sf}}} - \frac{1}{h + h_r} \right] \\ &= 0.014 \text{ W/m} \cdot \text{K} \left[ 1.8 \text{ m}^2 \times 0.25 \text{ K/W} - \frac{3 \times 10^{-3} \text{ m}}{0.3 \text{ W/m} \cdot \text{K}} - \frac{1}{(2 + 5.9) \text{ W/m}^2 \cdot \text{K}} \right] \\ &= 0.0044 \text{ m} = 4.4 \text{ mm} \end{aligned} \quad \triangleleft$$

### Water

$$\begin{aligned} L_{\text{ins}} &= k_{\text{ins}} \left[ AR_{\text{tot}} - \frac{L_{\text{sf}}}{k_{\text{sf}}} - \frac{1}{h} \right] \\ &= 0.014 \text{ W/m} \cdot \text{K} \left[ 1.8 \text{ m}^2 \times 0.25 \text{ K/W} - \frac{3 \times 10^{-3} \text{ m}}{0.3 \text{ W/m} \cdot \text{K}} - \frac{1}{200 \text{ W/m}^2 \cdot \text{K}} \right] \\ &= 0.0061 \text{ m} = 6.1 \text{ mm} \end{aligned} \quad \triangleleft$$

These required thicknesses of insulation material can easily be incorporated into the snow and wet suits.

The skin temperature can be calculated by considering conduction through the skin/fat layer:

$$q = \frac{k_{sf} A (T_i - T_s)}{L_{sf}}$$

or solving for  $T_s$ ,

$$T_s = T_i - \frac{q L_{sf}}{k_{sf} A} = 35^\circ\text{C} - \frac{100 \text{ W} \times 3 \times 10^{-3} \text{ m}}{0.3 \text{ W/m} \cdot \text{K} \times 1.8 \text{ m}^2} = 34.4^\circ\text{C} \quad \triangleleft$$

The skin temperature is the same in both cases because the heat loss rate and skin/fat properties are the same.

**Comments:**

1. The nanostructured silica aerogel is an extremely porous material that is only around 5% solid. Its thermal conductivity is less than the thermal conductivity of the gas that fills its pores. As explained in Section 2.2, the reason for this seemingly impossible result is that the pore size is only around 20 nm, which reduces the mean free path of the gas and hence decreases its thermal conductivity.
2. By reducing the heat loss rate to 100 W, a person could remain in the cold environments indefinitely without becoming chilled. The skin temperature of  $34.4^\circ\text{C}$  would feel comfortable.
3. In the water case, the thermal resistance of the insulation dominates and all other resistances can be neglected.
4. The convection heat transfer coefficient associated with the air depends on the wind conditions, and can vary over a broad range. As it changes, so will the outer surface temperature of the insulation layer. Since the radiation heat transfer coefficient depends on this temperature, it will also vary. We can perform a more complete analysis which takes this into account. The radiation heat transfer coefficient is given by Equation 1.9:

$$h_r = \varepsilon \sigma (T_{s,o} + T_{\text{sur}})(T_{s,o}^2 + T_{\text{sur}}^2) \quad (1)$$


Here  $T_{s,o}$  is the outer surface temperature of the insulation layer, which can be calculated from

$$T_{s,o} = T_i - \frac{q}{\frac{L_{sf}}{k_{sf} A} + \frac{L_{ins}}{k_{ins} A}} \quad (2)$$

Since this depends on the insulation thickness, we also need the previous equation for  $L_{ins}$ :

$$L_{ins} = k_{ins} \left( AR_{\text{tot}} - \frac{L_{sf}}{k_{sf}} - \frac{1}{h + h_r} \right) \quad (3)$$

With all other values known, these three equations can be solved for the required insulation thickness. Using all the values from above, these equations have been solved for values of  $h$  in the range  $0 \leq h \leq 100 \text{ W/m}^2 \cdot \text{K}$ , and the results are represented graphically.

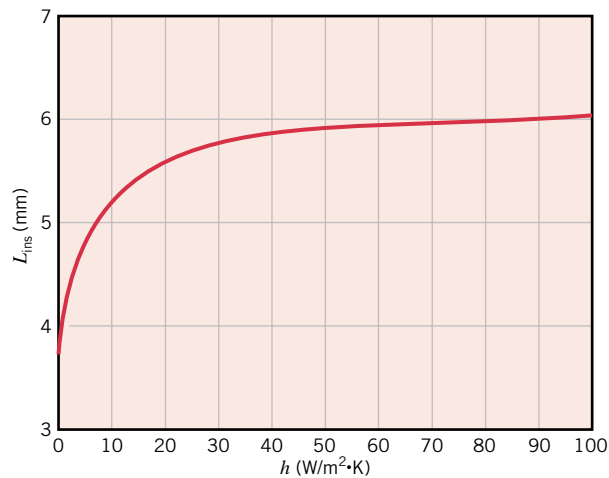

Increasing  $h$  reduces the corresponding convection resistance, which then requires additional insulation to maintain the heat transfer rate at 100 W. Once the heat transfer coefficient exceeds approximately  $60 \text{ W/m}^2 \cdot \text{K}$ , the convection resistance is negligible and further increases in  $h$  have little effect on the required insulation thickness.

The outer surface temperature and radiation heat transfer coefficient can also be calculated. As  $h$  increases from 0 to  $100 \text{ W/m}^2 \cdot \text{K}$ ,  $T_{s,o}$  decreases from 294 to 284 K, while  $h_r$  decreases from 5.2 to  $4.9 \text{ W/m}^2 \cdot \text{K}$ . The initial estimate of  $h_r = 5.9 \text{ W/m}^2 \cdot \text{K}$  was not highly accurate. Using this more complete model of the radiation heat transfer, with  $h = 2 \text{ W/m}^2 \cdot \text{K}$ , the radiation heat transfer coefficient is  $5.1 \text{ W/m}^2 \cdot \text{K}$  and the required insulation thickness is 4.2 mm, close to the value calculated in the first part of the problem.

5. This example is provided as a ready-to-solve model in *IHT* under *Examples* in the menu bar. It could also be solved using the thermal resistance network builder, *Models/Resistance Networks*. As an exercise, enter Equations 1 through 3 from Comment 4 into the *IHT* workspace and solve for the required insulation thickness when the air convection heat transfer coefficient is  $20 \text{ W/m}^2 \cdot \text{K}$ . All other conditions remain the same as in the problem statement. [Answer, 5.6 mm]

### EXAMPLE 3.2


A thin silicon chip and an 8-mm-thick aluminum substrate are separated by a 0.02-mm-thick epoxy joint. The chip and substrate are each 10 mm on a side, and their exposed surfaces are cooled by air, which is at a temperature of  $25^\circ\text{C}$  and provides a convection coefficient of  $100 \text{ W/m}^2 \cdot \text{K}$ . If the chip dissipates  $10^4 \text{ W/m}^2$  under normal conditions, will it operate below a maximum allowable temperature of  $85^\circ\text{C}$ ?

### SOLUTION

**Known:** Dimensions, heat dissipation, and maximum allowable temperature of a silicon chip. Thickness of aluminum substrate and epoxy joint. Convection conditions at exposed chip and substrate surfaces.

**Find:** Whether maximum allowable temperature is exceeded.

**Schematic:**

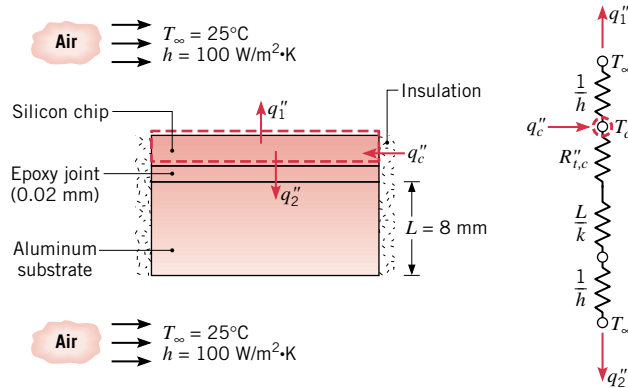

**Assumptions:**

1. Steady-state conditions.
2. One-dimensional conduction (negligible heat transfer from sides of composite).
3. Negligible chip thermal resistance (an isothermal chip).
4. Constant properties.
5. Negligible radiation exchange with surroundings.

**Properties:** Table A.1, pure aluminum ( $T \sim 350$  K):  $k = 239$  W/m · K.

**Analysis:** Heat dissipated in the chip is transferred to the air directly from the exposed surface and indirectly through the joint and substrate. Performing an energy balance on a control surface about the chip, it follows that, on the basis of a unit surface area,

$$q_c'' = q_1'' + q_2''$$

or

$$q_c'' = \frac{T_c - T_\infty}{(1/h)} + \frac{T_c - T_\infty}{R_{t,c} + (L/k) + (1/h)}$$

To conservatively estimate  $T_c$ , the maximum possible value of  $R_{t,c} = 0.9 \times 10^{-4}$  m<sup>2</sup> · K/W is obtained from Table 3.2. Hence

$$T_c = T_\infty + q_c'' \left[ h + \frac{1}{R_{t,c} + (L/k) + (1/h)} \right]^{-1}$$

or


$$\begin{aligned} T_c &= 25^\circ\text{C} + 10^4 \text{ W/m}^2 \\ &\quad \times \left[ 100 + \frac{1}{(0.9 + 0.33 + 100) \times 10^{-4}} \right]^{-1} \text{ m}^2 \cdot \text{K/W} \\ T_c &= 25^\circ\text{C} + 50.3^\circ\text{C} = 75.3^\circ\text{C} \end{aligned}$$



Hence the chip will operate below its maximum allowable temperature.

### Comments:

1. The joint and substrate thermal resistances are much less than the convection resistance. The joint resistance would have to increase to the unrealistically large value of  $50 \times 10^{-4} \text{ m}^2 \cdot \text{K/W}$ , before the maximum allowable chip temperature would be exceeded.
2. The allowable power dissipation may be increased by increasing the convection coefficients, either by increasing the air velocity and/or by replacing the air with a more effective heat transfer fluid. Exploring this option for  $100 \leq h \leq 2000 \text{ W/m}^2 \cdot \text{K}$  with  $T_c = 85^\circ\text{C}$ , the following results are obtained.

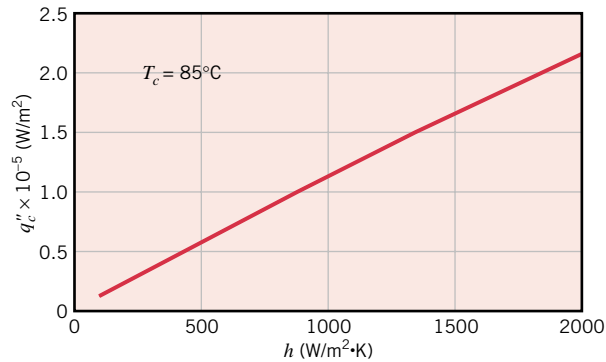

As  $h \rightarrow \infty$ ,  $q_c'' \rightarrow 0$  and virtually all of the chip power is transferred directly to the fluid stream.

3. As calculated, the *difference* between the air temperature ( $T_\infty = 25^\circ\text{C}$ ) and the chip temperature ( $T_c = 75.3^\circ\text{C}$ ) is 50.3 K. Keep in mind that this is a temperature *difference* and therefore is the same as  $50.3^\circ\text{C}$ .
4. Consider conditions for which air flow over the chip (upper) or substrate (lower) surface ceases due to a blockage in the air supply channel. If heat transfer from either surface is negligible, what are the resulting chip temperatures for  $q_c'' = 10^4 \text{ W/m}^2$ ? [Answer,  $126^\circ\text{C}$  or  $125^\circ\text{C}$ ]
5. Consider using *IHT* to calculate the allowable power dissipation for the prescribed air-flow conditions and  $T_c = 85^\circ\text{C}$ . Plot the results and compare them with those shown graphically in Comment 2.

### EXAMPLE 3.3

The thermal conductivity of a  $D = 14\text{-nm}$ -diameter carbon nanotube is measured with an instrument that is fabricated of a wafer of silicon nitride at a temperature of  $T_\infty = 300 \text{ K}$ . The  $20\text{-}\mu\text{m}$ -long nanotube rests on two  $0.5\text{-}\mu\text{m}$ -thick,  $10 \mu\text{m} \times 10 \mu\text{m}$  square islands that are separated by a distance  $s = 5 \mu\text{m}$ . A thin layer of platinum is used as an electrical resistor on the *heated island* (at temperature  $T_h$ ) to dissipate  $q = 11.3 \mu\text{W}$  of electrical power. On the *sensing island*, a similar layer of platinum is used to determine its temperature,  $T_s$ . The platinum's electrical resistance,  $R(T_s) = E/I$ , is found by measuring the voltage drop and electrical current across the platinum layer. The temperature of the sensing island,  $T_s$ , is then determined from the relationship of the platinum electrical resistance to its temperature. Each island is


suspended by two  $L_{\text{sn}} = 250\text{-}\mu\text{m}$ -long silicon nitride beams that are  $w_{\text{sn}} = 3\text{ }\mu\text{m}$  wide and  $t_{\text{sn}} = 0.5\text{ }\mu\text{m}$  thick. A platinum line of width  $w_{\text{pt}} = 1\text{ }\mu\text{m}$  and thickness  $t_{\text{pt}} = 0.2\text{ }\mu\text{m}$  is deposited within each silicon nitride beam to power the heated island or detect the voltage drop associated with the determination of  $T_s$ . The entire experiment is performed in a vacuum with  $T_{\text{sur}} = 300\text{ K}$  and at steady state,  $T_s = 308.4\text{ K}$ . Estimate the thermal conductivity of the carbon nanotube.

### SOLUTION

**Known:** Dimensions, heat dissipated at the heated island, and temperatures of the sensing island and surrounding silicon nitride wafer.

**Find:** The thermal conductivity of the carbon nanotube.

**Schematic:**

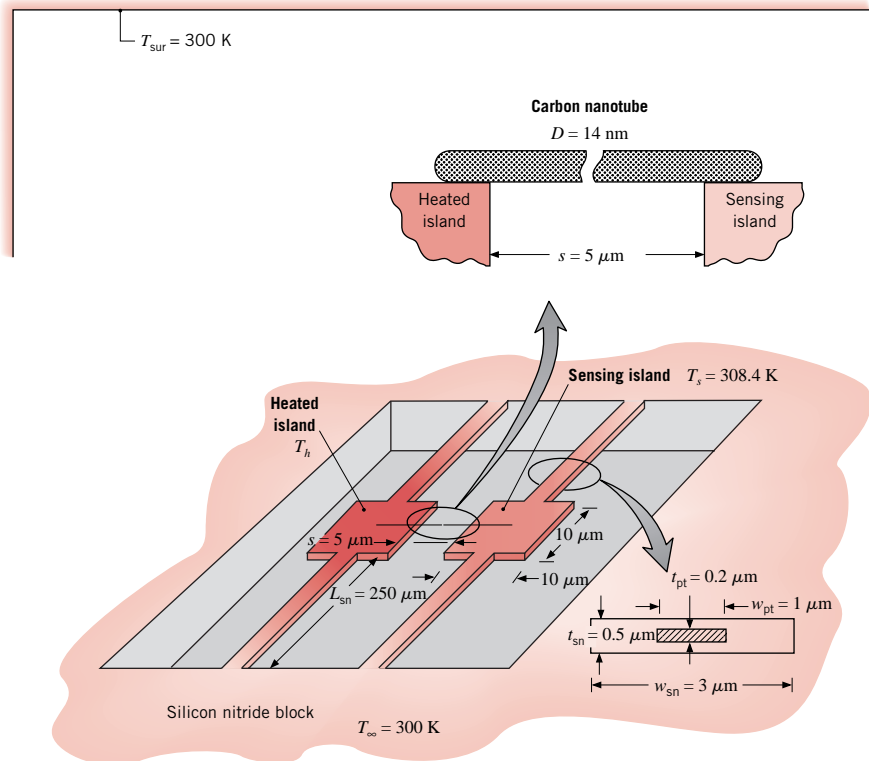


**Assumptions:**

1. Steady-state conditions.
2. One-dimensional heat transfer.
3. The heated and sensing islands are isothermal.
4. Radiation exchange between the surfaces and the surroundings is negligible.
5. Convection losses are negligible.

6. Ohmic heating in the platinum signal lines is negligible.
7. Constant properties.
8. Contact resistance between the nanotube and the islands is negligible.

**Properties:** Table A.1, platinum (325 K, assumed):  $k_{pt} = 71.6 \text{ W/m} \cdot \text{K}$ . Table A.2, silicon nitride (325 K, assumed):  $k_{sn} = 15.5 \text{ W/m} \cdot \text{K}$ .

**Analysis:** Energy that is dissipated at the heated island is transferred to the silicon nitride block through the support beams of the heated island, the carbon nanotube, and subsequently through the support beams of the sensing island. Therefore, the thermal circuit may be constructed as follows

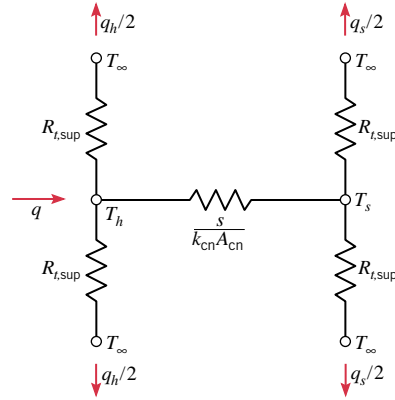

where each supporting beam provides a thermal resistance,  $R_{t,sup}$ , that is composed of a resistance due to the silicon nitride (sn) in parallel with a resistance due to the platinum (pt) line.

The cross-sectional areas of the materials in the support beams are

$$A_{pt} = w_{pt} t_{pt} = (1 \times 10^{-6} \text{ m}) \times (0.2 \times 10^{-6} \text{ m}) = 2 \times 10^{-13} \text{ m}^2$$

$$A_{sn} = w_{sn} t_{sn} - A_{pt} = (3 \times 10^{-6} \text{ m}) \times (0.5 \times 10^{-6} \text{ m}) - 2 \times 10^{-13} \text{ m}^2 = 1.3 \times 10^{-12} \text{ m}^2$$

while the cross-sectional area of the carbon nanotube is

$$A_{cn} = \pi D^2/4 = \pi(14 \times 10^{-9} \text{ m})^2/4 = 1.54 \times 10^{-16} \text{ m}^2$$

The thermal resistance of each support is

$$\begin{aligned} R_{t,sup} &= \left[ \frac{k_{pt} A_{pt}}{L_{pt}} + \frac{k_{sn} A_{sn}}{L_{sn}} \right]^{-1} \\ &= \left[ \frac{71.6 \text{ W/m} \cdot \text{K} \times 2 \times 10^{-13} \text{ m}^2}{250 \times 10^{-6} \text{ m}} + \frac{15.5 \text{ W/m} \cdot \text{K} \times 1.3 \times 10^{-12} \text{ m}^2}{250 \times 10^{-6} \text{ m}} \right]^{-1} \\ &= 7.25 \times 10^6 \text{ K/W} \end{aligned}$$

The combined heat loss through both sensing island supports is

$$\begin{aligned} q_s &= 2(T_s - T_\infty)/R_{t,sup} = 2 \times (308.4 \text{ K} - 300 \text{ K})/(7.25 \times 10^6 \text{ K/W}) \\ &= 2.32 \times 10^{-6} \text{ W} = 2.32 \mu\text{W} \end{aligned}$$



It follows that

$$q_h = q - q_s = 11.3 \mu\text{W} - 2.32 \mu\text{W} = 8.98 \mu\text{W}$$

and  $T_h$  attains a value of

$$T_h = T_\infty + \frac{1}{2}q_h R_{t,\text{sup}} = 300 \text{ K} + \frac{8.98 \times 10^{-6} \text{ W} \times 7.25 \times 10^6 \text{ K/W}}{2} = 332.6 \text{ K}$$

For the portion of the thermal circuit connecting  $T_h$  and  $T_s$ ,

$$q_s = \frac{T_h - T_s}{s/(k_{\text{cn}} A_{\text{cn}})}$$

from which

$$k_{\text{cn}} = \frac{q_s s}{A_{\text{cn}}(T_h - T_s)} = \frac{2.32 \times 10^{-6} \text{ W} \times 5 \times 10^{-6} \text{ m}}{1.54 \times 10^{-16} \text{ m}^2 \times (332.6 \text{ K} - 308.4 \text{ K})}$$

$$k_{\text{cn}} = 3113 \text{ W/m} \cdot \text{K}$$


### Comments:

1. The measured thermal conductivity is extremely large, as evident by comparing its value to the thermal conductivities of pure metals shown in Figure 2.4. Carbon nanotubes may be used to *dope* otherwise low thermal conductivity materials to improve heat transfer.
2. Contact resistances between the carbon nanotube and the heated and sensing islands were neglected because little is known about such resistances at the nanoscale. However, *if* a contact resistance were included in the analysis, the measured thermal conductivity of the carbon nanotube would be even higher than the predicted value.
3. The significance of radiation heat transfer may be estimated by approximating the heated island as a blackbody radiating to  $T_{\text{sur}}$  from both its top and bottom surfaces. Hence,  $q_{\text{rad},b} \approx 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 \times 2 \times (10 \times 10^{-6} \text{ m})^2 \times (332.6^4 - 300^4) \text{ K}^4 = 4.7 \times 10^{-8} \text{ W} = 0.047 \mu\text{W}$ , and radiation is negligible.

## 3.2

### An Alternative Conduction Analysis

The conduction analysis of Section 3.1 was performed using the *standard approach*. That is, the heat equation was solved to obtain the temperature distribution, Equation 3.3, and Fourier's law was then applied to obtain the heat transfer rate, Equation 3.4. However, an alternative approach may be used for the conditions presently of interest. Considering conduction in the system of Figure 3.5, we recognize that, for *steady-state conditions* with *no heat generation* and *no heat loss from the sides*, the heat transfer rate  $q_x$  must be a constant independent of  $x$ . That is, for any differential element  $dx$ ,  $q_x = q_{x+dx}$ . This condition is, of course, a consequence of the energy conservation requirement, and it must apply even if the area varies

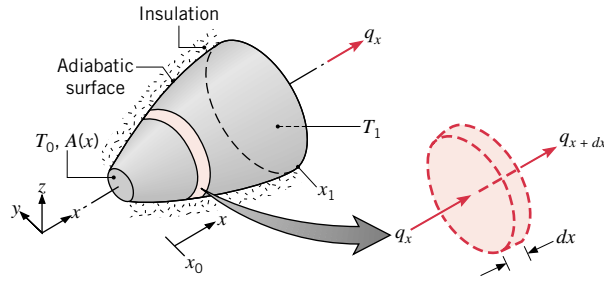

**FIGURE 3.5** System with a constant conduction heat transfer rate.

with position,  $A(x)$ , and the thermal conductivity varies with temperature,  $k(T)$ . Moreover, even though the temperature distribution may be two dimensional, varying with  $x$  and  $y$ , it is often reasonable to neglect the  $y$  variation and to assume a *one-dimensional* distribution in  $x$ .

For the above conditions it is possible to work exclusively with Fourier's law when performing a conduction analysis. In particular, since the conduction rate is a *constant*, the rate equation may be *integrated*, even though neither the rate nor the temperature distribution is known. Consider Fourier's law, Equation 2.1, which may be applied to the system of Figure 3.5. Although we may have no knowledge of the value of  $q_x$  or the form of  $T(x)$ , we do know that  $q_x$  is a constant. Hence we may express Fourier's law in the integral form

$$q_x \int_{x_0}^x \frac{dx}{A(x)} = - \int_{T_0}^T k(T) dT \quad (3.21)$$

The cross-sectional area may be a known function of  $x$ , and the material thermal conductivity may vary with temperature in a known manner. If the integration is performed from a point  $x_0$  at which the temperature  $T_0$  is known, the resulting equation provides the functional form of  $T(x)$ . Moreover, if the temperature  $T = T_1$  at some  $x = x_1$  is also known, integration between  $x_0$  and  $x_1$  provides an expression from which  $q_x$  may be computed. Note that, if the area  $A$  is uniform and  $k$  is independent of temperature, Equation 3.21 reduces to


$$\frac{q_x \Delta x}{A} = -k \Delta T \quad (3.22)$$

where  $\Delta x = x_1 - x_0$  and  $\Delta T = T_1 - T_0$ .

We frequently elect to solve diffusion problems by working with integrated forms of the diffusion rate equations. However, the limiting conditions for which this may be done should be firmly fixed in our minds: *steady-state* and *one-dimensional* transfer with *no heat generation*.

### EXAMPLE 3.4

The diagram shows a conical section fabricated from pyroceram. It is of circular cross section with the diameter  $D = ax$ , where  $a = 0.25$ . The small end is at  $x_1 = 50$  mm and the large end at  $x_2 = 250$  mm. The end temperatures are  $T_1 = 400$  K and  $T_2 = 600$  K, while the lateral surface is well insulated.



1. Derive an expression for the temperature distribution  $T(x)$  in symbolic form, assuming one-dimensional conditions. Sketch the temperature distribution.
2. Calculate the heat rate  $q_x$  through the cone.


### SOLUTION

**Known:** Conduction in a circular conical section having a diameter  $D = ax$ , where  $a = 0.25$ .

### Find:

1. Temperature distribution  $T(x)$ .
2. Heat transfer rate  $q_x$ .

### Schematic:

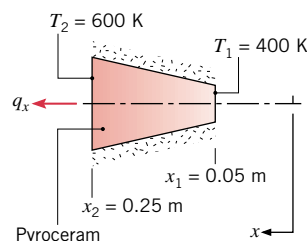

### Assumptions:

1. Steady-state conditions.
2. One-dimensional conduction in the  $x$  direction.
3. No internal heat generation.
4. Constant properties.

**Properties:** Table A.2, pyroceram (500 K):  $k = 3.46 \text{ W/m} \cdot \text{K}$ .

### Analysis:

1. Since heat conduction occurs under steady-state, one-dimensional conditions with no internal heat generation, the heat transfer rate  $q_x$  is a constant independent of  $x$ . Accordingly, Fourier's law, Equation 2.1, may be used to determine the temperature distribution

$$q_x = -kA \frac{dT}{dx}$$

where  $A = \pi D^2/4 = \pi a^2 x^2/4$ . Separating variables,

$$\frac{4q_x dx}{\pi a^2 x^2} = -k dT$$

Integrating from  $x_1$  to any  $x$  within the cone, and recalling that  $q_x$  and  $k$  are constants, it follows that

$$\frac{4q_x}{\pi a^2} \int_{x_1}^x \frac{dx}{x^2} = -k \int_{T_1}^T dT$$

Hence

$$\frac{4q_x}{\pi a^2} \left( -\frac{1}{x} + \frac{1}{x_1} \right) = -k(T - T_1)$$

or solving for  $T$

$$T(x) = T_1 - \frac{4q_x}{\pi a^2 k} \left( \frac{1}{x_1} - \frac{1}{x} \right)$$

Although  $q_x$  is a constant, it is as yet an unknown. However, it may be determined by evaluating the above expression at  $x = x_2$ , where  $T(x_2) = T_2$ . Hence

$$T_2 = T_1 - \frac{4q_x}{\pi a^2 k} \left( \frac{1}{x_1} - \frac{1}{x_2} \right)$$

and solving for  $q_x$


$$q_x = \frac{\pi a^2 k (T_1 - T_2)}{4[(1/x_1) - (1/x_2)]}$$

Substituting for  $q_x$  into the expression for  $T(x)$ , the temperature distribution becomes

$$T(x) = T_1 + (T_1 - T_2) \left[ \frac{(1/x) - (1/x_1)}{(1/x_1) - (1/x_2)} \right]$$

◁

From this result, temperature may be calculated as a function of  $x$  and the distribution is as shown.



Note that, since  $dT/dx = -4q_x/k\pi a^2 x^2$  from Fourier's law, it follows that the temperature gradient and heat flux decrease with increasing  $x$ .

2. Substituting numerical values into the foregoing result for the heat transfer rate, it follows that

$$q_x = \frac{\pi(0.25)^2 \times 3.46 \text{ W/m} \cdot \text{K} (400 - 600) \text{ K}}{4 (1/0.05 \text{ m} - 1/0.25 \text{ m})} = -2.12 \text{ W}$$

◁

**Comments:** When the parameter  $a$  increases, the cross-sectional area changes more rapidly with distance, causing the one-dimensional assumption to become less appropriate.

### 3.3

#### Radial Systems


Cylindrical and spherical systems often experience temperature gradients in the radial direction only and may therefore be treated as one dimensional. Moreover, under steady-state conditions with no heat generation, such systems may be analyzed by using the *standard* method, which begins with the appropriate form of the heat equation, or the *alternative* method, which begins with the appropriate form of Fourier's law. In this section, the cylindrical system is analyzed by means of the standard method and the spherical system by means of the alternative method.

##### 3.3.1 The Cylinder

A common example is the hollow cylinder, whose inner and outer surfaces are exposed to fluids at different temperatures (Figure 3.6). For steady-state conditions with no heat generation, the appropriate form of the heat equation, Equation 2.24, is

$$\frac{1}{r} \frac{d}{dr} \left( kr \frac{dT}{dr} \right) = 0 \quad (3.23)$$

where, for the moment,  $k$  is treated as a variable. The physical significance of this result becomes evident if we also consider the appropriate form of Fourier's law. The

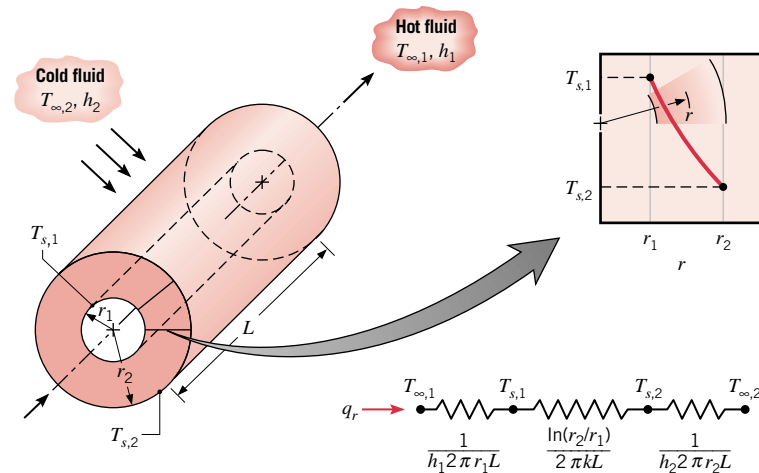

**FIGURE 3.6** Hollow cylinder with convective surface conditions.

rate at which energy is conducted across any cylindrical surface in the solid may be expressed as

$$q_r = -kA \frac{dT}{dr} = -k(2\pi rL) \frac{dT}{dr} \quad (3.24)$$

where  $A = 2\pi rL$  is the area normal to the direction of heat transfer. Since Equation 3.23 dictates that the quantity  $kr(dT/dr)$  is independent of  $r$ , it follows from Equation 3.24 that the conduction *heat transfer rate*  $q_r$  (not the heat flux  $q_r''$ ) is a *constant in the radial direction*.

We may determine the temperature distribution in the cylinder by solving Equation 3.23 and applying appropriate boundary conditions. Assuming the value of  $k$  to be constant, Equation 3.23 may be integrated twice to obtain the general solution

$$T(r) = C_1 \ln r + C_2 \quad (3.25)$$

To obtain the constants of integration  $C_1$  and  $C_2$ , we introduce the following boundary conditions:

$$T(r_1) = T_{s,1} \quad \text{and} \quad T(r_2) = T_{s,2}$$

Applying these conditions to the general solution, we then obtain

$$T_{s,1} = C_1 \ln r_1 + C_2 \quad \text{and} \quad T_{s,2} = C_1 \ln r_2 + C_2$$

Solving for  $C_1$  and  $C_2$  and substituting into the general solution, we then obtain

$$T(r) = \frac{T_{s,1} - T_{s,2}}{\ln(r_1/r_2)} \ln\left(\frac{r}{r_2}\right) + T_{s,2} \quad (3.26)$$

Note that the temperature distribution associated with radial conduction through a cylindrical wall is logarithmic, not linear, as it is for the plane wall under the same conditions. The logarithmic distribution is sketched in the inset of Figure 3.6.

If the temperature distribution, Equation 3.26, is now used with Fourier's law, Equation 3.24, we obtain the following expression for the heat transfer rate:

$$q_r = \frac{2\pi Lk(T_{s,1} - T_{s,2})}{\ln(r_2/r_1)} \quad (3.27)$$

From this result it is evident that, for radial conduction in a cylindrical wall, the thermal resistance is of the form

$$R_{t,\text{cond}} = \frac{\ln(r_2/r_1)}{2\pi Lk} \quad (3.28)$$

This resistance is shown in the series circuit of Figure 3.6. Note that since the value of  $q_r$  is independent of  $r$ , the foregoing result could have been obtained by using the alternative method, that is, by integrating Equation 3.24.

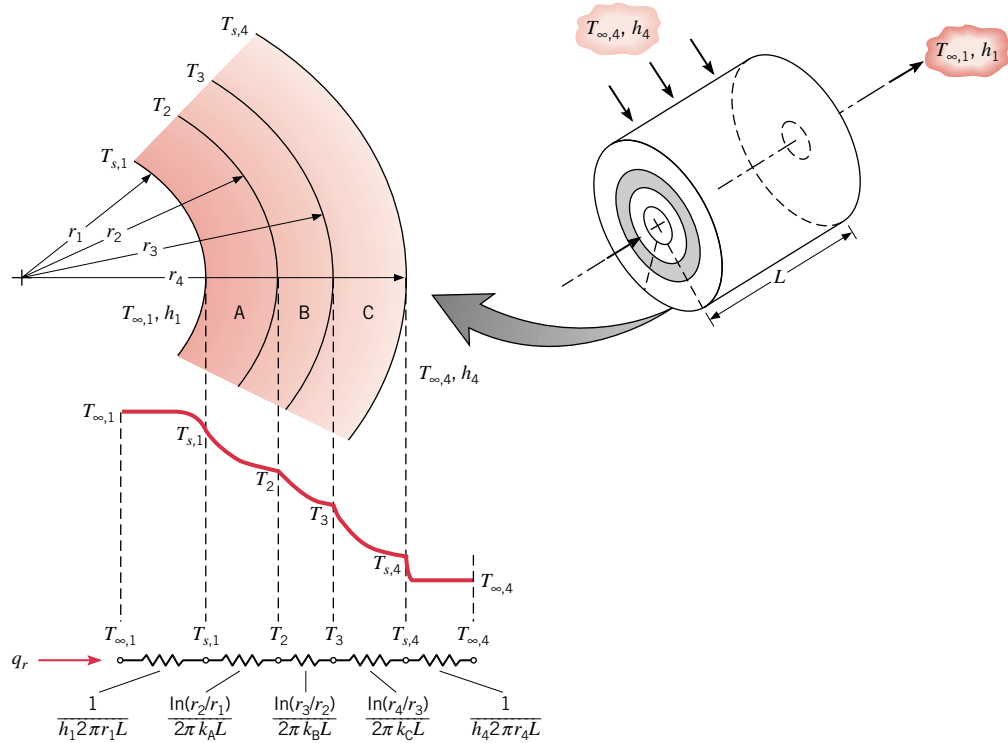


FIGURE 3.7 Temperature distribution for a composite cylindrical wall.

Consider now the composite system of Figure 3.7. Recalling how we treated the composite plane wall and neglecting the interfacial contact resistances, the heat transfer rate may be expressed as

$$q_r = \frac{T_{\infty,1} - T_{\infty,4}}{\frac{1}{2\pi r_1 L h_1} + \frac{\ln(r_2/r_1)}{2\pi k_A L} + \frac{\ln(r_3/r_2)}{2\pi k_B L} + \frac{\ln(r_4/r_3)}{2\pi k_C L} + \frac{1}{2\pi r_4 L h_4}} \quad (3.29)$$

The foregoing result may also be expressed in terms of an overall heat transfer coefficient. That is,

$$q_r = \frac{T_{\infty,1} - T_{\infty,4}}{R_{\text{tot}}} = UA(T_{\infty,1} - T_{\infty,4}) \quad (3.30)$$

If  $U$  is defined in terms of the inside area,  $A_1 = 2\pi r_1 L$ , Equations 3.29 and 3.30 may be equated to yield

$$U_1 = \frac{1}{\frac{1}{h_1} + \frac{r_1}{k_A} \ln \frac{r_2}{r_1} + \frac{r_1}{k_B} \ln \frac{r_3}{r_2} + \frac{r_1}{k_C} \ln \frac{r_4}{r_3} + \frac{r_1}{r_4} \frac{1}{h_4}} \quad (3.31)$$

This definition is *arbitrary*, and the overall coefficient may also be defined in terms of  $A_4$  or any of the intermediate areas. Note that

$$U_1 A_1 = U_2 A_2 = U_3 A_3 = U_4 A_4 = (\sum R_i)^{-1} \quad (3.32)$$

and the specific forms of  $U_2$ ,  $U_3$ , and  $U_4$  may be inferred from Equations 3.29 and 3.30.

### EXAMPLE 3.5

The possible existence of an optimum insulation thickness for radial systems is suggested by the presence of competing effects associated with an increase in this thickness. In particular, although the conduction resistance increases with the addition of insulation, the convection resistance decreases due to increasing outer surface area. Hence there may exist an insulation thickness that minimizes heat loss by maximizing the total resistance to heat transfer. Resolve this issue by considering the following system.

1. A thin-walled copper tube of radius  $r_i$  is used to transport a low-temperature refrigerant and is at a temperature  $T_i$  that is less than that of the ambient air at  $T_\infty$  around the tube. Is there an optimum thickness associated with application of insulation to the tube?
2. Confirm the above result by computing the total thermal resistance per unit length of tube for a 10-mm-diameter tube having the following insulation thicknesses: 0, 2, 5, 10, 20, and 40 mm. The insulation is composed of cellular glass, and the outer surface convection coefficient is  $5 \text{ W/m}^2 \cdot \text{K}$ .


### SOLUTION

**Known:** Radius  $r_i$  and temperature  $T_i$  of a thin-walled copper tube to be insulated from the ambient air.

### Find:

1. Whether there exists an optimum insulation thickness that minimizes the heat transfer rate.
2. Thermal resistance associated with using cellular glass insulation of varying thickness.

### Schematic:

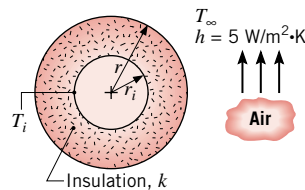

### Assumptions:


1. Steady-state conditions.
2. One-dimensional heat transfer in the radial (cylindrical) direction.
3. Negligible tube wall thermal resistance.
4. Constant properties for insulation.
5. Negligible radiation exchange between insulation outer surface and surroundings.



**Properties:** Table A.3, cellular glass (285 K, assumed):  $k = 0.055 \text{ W/m} \cdot \text{K}$ .

**Analysis:**

1. The resistance to heat transfer between the refrigerant and the air is dominated by conduction in the insulation and convection in the air. The thermal circuit is therefore



where the conduction and convection resistances per unit length follow from Equations 3.28 and 3.9, respectively. The total thermal resistance per unit length of tube is then

$$R'_{\text{tot}} = \frac{\ln(r/r_i)}{2\pi k} + \frac{1}{2\pi r h}$$

where the rate of heat transfer per unit length of tube is

$$q' = \frac{T_\infty - T_i}{R'_{\text{tot}}}$$

An optimum insulation thickness would be associated with the value of  $r$  that minimized  $q'$  or maximized  $R'_{\text{tot}}$ . Such a value could be obtained from the requirement that

$$\frac{dR'_{\text{tot}}}{dr} = 0$$

Hence

$$\frac{1}{2\pi k r} - \frac{1}{2\pi r^2 h} = 0$$

or

$$r = \frac{k}{h}$$

To determine whether the foregoing result maximizes or minimizes the total resistance, the second derivative must be evaluated. Hence

$$\frac{d^2 R'_{\text{tot}}}{dr^2} = -\frac{1}{2\pi k r^2} + \frac{1}{\pi r^3 h}$$

or, at  $r = k/h$ ,

$$\frac{d^2 R'_{\text{tot}}}{dr^2} = \frac{1}{\pi(k/h)^2} \left( \frac{1}{k} - \frac{1}{2k} \right) = \frac{1}{2\pi k^3/h^2} > 0$$

Since this result is always positive, it follows that  $r = k/h$  is the insulation radius for which the total resistance is a minimum, not a maximum. Hence an *optimum* insulation thickness *does not exist*.

From the above result it makes more sense to think in terms of a *critical insulation radius*

$$r_{\text{cr}} \equiv \frac{k}{h}$$

which maximizes heat transfer, that is, below which  $q'$  increases with increasing  $r$  and above which  $q'$  decreases with increasing  $r$ .


2. With  $h = 5 \text{ W/m}^2 \cdot \text{K}$  and  $k = 0.055 \text{ W/m} \cdot \text{K}$ , the critical radius is

$$r_{\text{cr}} = \frac{0.055 \text{ W/m} \cdot \text{K}}{5 \text{ W/m}^2 \cdot \text{K}} = 0.011 \text{ m}$$

Hence  $r_{\text{cr}} > r_i$  and heat transfer will increase with the addition of insulation up to a thickness of


$$r_{\text{cr}} - r_i = (0.011 - 0.005) \text{ m} = 0.006 \text{ m}$$

The thermal resistances corresponding to the prescribed insulation thicknesses may be calculated and are plotted as follows:

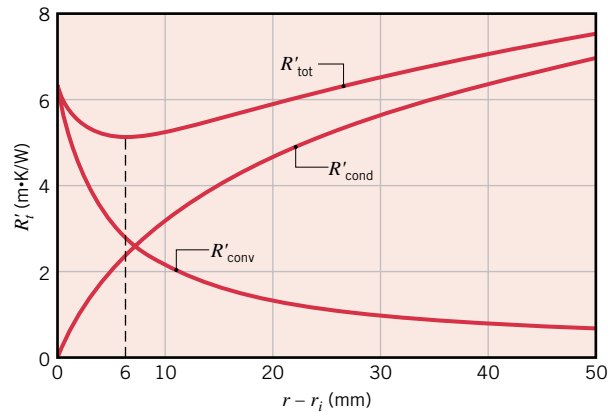

### Comments:

1. The effect of the critical radius is revealed by the fact that, even for 20 mm of insulation, the total resistance is not as large as the value for no insulation.
2. If  $r_i < r_{\text{cr}}$ , as it is in this case, the total resistance decreases and the heat rate therefore increases with the addition of insulation. This trend continues until the outer radius of the insulation corresponds to the critical radius. The trend is desirable for electrical current flow through a wire, since the addition of electrical insulation would aid in transferring heat dissipated in the wire to the surroundings. Conversely, if  $r_i > r_{\text{cr}}$ , any addition of insulation would increase the total resistance and therefore decrease the heat loss. This behavior would be desirable for steam flow through a pipe, where insulation is added to reduce heat loss to the surroundings.
3. For radial systems, the problem of reducing the total resistance through the application of insulation exists only for small diameter wires or tubes and for small convection coefficients, such that  $r_{\text{cr}} > r_i$ . For a typical insulation ( $k \approx 0.03 \text{ W/m} \cdot \text{K}$ ) and free convection in air ( $h \approx 10 \text{ W/m}^2 \cdot \text{K}$ ),  $r_{\text{cr}} = (k/h) \approx 0.003 \text{ m}$ . Such a small value tells us that, normally,  $r_i > r_{\text{cr}}$  and we need not be concerned with the effects of a critical radius.
4. The existence of a critical radius requires that the heat transfer area change in the direction of transfer, as for radial conduction in a cylinder (or a sphere). In a plane wall the area perpendicular to the direction of heat flow is constant and there is no critical insulation thickness (the total resistance always increases with increasing insulation thickness).

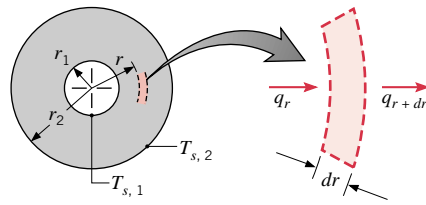

**FIGURE 3.8**  
Conduction in a spherical shell.

### 3.3.2 The Sphere

Now consider applying the alternative method to analyzing conduction in the hollow sphere of Figure 3.8. For the differential control volume of the figure, energy conservation requires that  $q_r = q_{r+dr}$  for steady-state, one-dimensional conditions with no heat generation. The appropriate form of Fourier's law is

$$q_r = -kA \frac{dT}{dr} = -k(4\pi r^2) \frac{dT}{dr} \quad (3.33)$$

where  $A = 4\pi r^2$  is the area normal to the direction of heat transfer.

Acknowledging that  $q_r$  is a constant, independent of  $r$ , Equation 3.33 may be expressed in the integral form

$$\frac{q_r}{4\pi} \int_{r_1}^{r_2} \frac{dr}{r^2} = - \int_{T_{s,1}}^{T_{s,2}} k(T) dT \quad (3.34)$$

Assuming constant  $k$ , we then obtain

$$q_r = \frac{4\pi k(T_{s,1} - T_{s,2})}{(1/r_1) - (1/r_2)} \quad (3.35)$$

Remembering that the thermal resistance is defined as the temperature difference divided by the heat transfer rate, we obtain

$$R_{t, \text{cond}} = \frac{1}{4\pi k} \left( \frac{1}{r_1} - \frac{1}{r_2} \right) \quad (3.36)$$

Note that the temperature distribution and Equations 3.35 and 3.36 could have been obtained by using the standard approach, which begins with the appropriate form of the heat equation.

Spherical composites may be treated in much the same way as composite walls and cylinders, where appropriate forms of the total resistance and overall heat transfer coefficient may be determined.

### EXAMPLE 3.6

A spherical, thin-walled metallic container is used to store liquid nitrogen at 77 K. The container has a diameter of 0.5 m and is covered with an evacuated, reflective insulation composed of silica powder. The insulation is 25 mm thick, and its outer surface is exposed to ambient air at 300 K. The convection coefficient is

known to be  $20 \text{ W/m}^2 \cdot \text{K}$ . The latent heat of vaporization and the density of liquid nitrogen are  $2 \times 10^5 \text{ J/kg}$  and  $804 \text{ kg/m}^3$ , respectively.

1. What is the rate of heat transfer to the liquid nitrogen?
2. What is the rate of liquid boil-off?


### SOLUTION

**Known:** Liquid nitrogen is stored in a spherical container that is insulated and exposed to ambient air.

### Find:

1. The rate of heat transfer to the nitrogen.
2. The mass rate of nitrogen boil-off.

### Schematic:

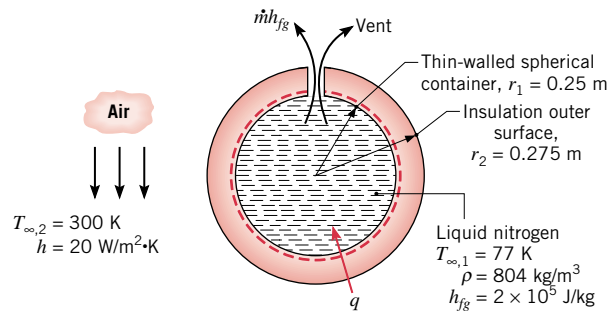


### Assumptions:

1. Steady-state conditions.
2. One-dimensional transfer in the radial direction.
3. Negligible resistance to heat transfer through the container wall and from the container to the nitrogen.
4. Constant properties.
5. Negligible radiation exchange between outer surface of insulation and surroundings.

**Properties:** Table A.3, evacuated silica powder (300 K):  $k = 0.0017 \text{ W/m} \cdot \text{K}$ .

### Analysis:

1. The thermal circuit involves a conduction and convection resistance in series and is of the form



where, from Equation 3.36,

$$R_{t, \text{cond}} = \frac{1}{4\pi k} \left( \frac{1}{r_1} - \frac{1}{r_2} \right)$$

and from Equation 3.9

$$R_{t, \text{conv}} = \frac{1}{h4\pi r_2^2}$$

The rate of heat transfer to the liquid nitrogen is then

$$q = \frac{T_{\infty, 2} - T_{\infty, 1}}{(1/4\pi k)[(1/r_1) - (1/r_2)] + (1/h4\pi r_2^2)}$$

Hence,

$$\begin{aligned} q &= [(300 - 77) \text{ K}] \\ &\div \left[ \frac{1}{4\pi(0.0017 \text{ W/m} \cdot \text{K})} \left( \frac{1}{0.25 \text{ m}} - \frac{1}{0.275 \text{ m}} \right) \right. \\ &\quad \left. + \frac{1}{(20 \text{ W/m}^2 \cdot \text{K})4\pi(0.275 \text{ m})^2} \right] \\ q &= \frac{223}{17.02 + 0.05} \text{ W} = 13.06 \text{ W} \end{aligned}$$

2. Performing an energy balance for a control surface about the nitrogen, it follows from Equation 1.12 that

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = 0$$

where  $\dot{E}_{\text{in}} = q$  and  $\dot{E}_{\text{out}} = \dot{m}h_{fg}$  is associated with the loss of latent energy due to boiling. Hence

$$q - \dot{m}h_{fg} = 0$$

and the boil-off  $\dot{m}$  is

$$\begin{aligned} \dot{m} &= \frac{q}{h_{fg}} \\ \dot{m} &= \frac{13.06 \text{ J/s}}{2 \times 10^5 \text{ J/kg}} = 6.53 \times 10^{-5} \text{ kg/s} \end{aligned}$$

The loss per day is

$$\begin{aligned} \dot{m} &= 6.53 \times 10^{-5} \text{ kg/s} \times 3600 \text{ s/h} \times 24 \text{ h/day} \\ \dot{m} &= 5.64 \text{ kg/day} \end{aligned}$$

or on a volumetric basis


$$\dot{V} = \frac{\dot{m}}{\rho} = \frac{5.64 \text{ kg/day}}{804 \text{ kg/m}^3} = 0.007 \text{ m}^3/\text{day} = 7 \text{ liters/day}$$

### Comments:

1. Since  $R_{t, \text{conv}} \ll R_{t, \text{cond}}$ , the dominant contribution to the total thermal resistance is that due to conduction in the insulation. Even if the convection coefficient

were reduced by a factor of 10, thereby increasing the convection resistance by the same amount, the effect on the boil-off would be small.

2. With a container volume of  $(4/3)(\pi r_1^3) = 0.065 \text{ m}^3 = 65 \text{ liters}$ , the daily loss amounts to  $(7 \text{ liters}/65 \text{ liters}) 100\% = 10.8\%$  of capacity.
3. Using the foregoing model, the boil-off rate has been calculated as a function of the insulation thickness,  $\Delta r = (r_2 - r_1)$ , where  $r_1 = 0.25 \text{ m}$ .

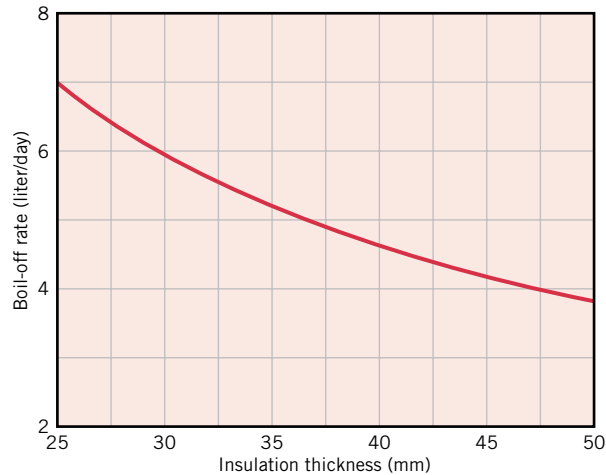

As shown graphically, doubling the insulation thickness from 25 mm to 50 mm reduces the boil-off rate by 45%.

4. The designer of the storage container has been asked to reduce the daily boil-off rate from 7 to 4 liters/day. What is the required thickness of the silica powder insulation? Another option is to use an evacuated foil-mat blanket for cryogenic applications with a thermal conductivity of  $0.00016 \text{ W/m} \cdot \text{K}$  and a thickness of 5 mm. What is the corresponding daily boil-off rate? [Answers: 47.5 mm, 3.1 liter/day]

### 3.4

#### Summary of One-Dimensional Conduction Results

Many important problems are characterized by one-dimensional, steady-state conduction in plane, cylindrical, or spherical walls without thermal energy generation. Key results for these three geometries are summarized in Table 3.3, where  $\Delta T$  refers to the temperature difference,  $T_{s,1} - T_{s,2}$ , between the inner and outer surfaces identified in Figures 3.1, 3.6, and 3.8. In each case, beginning with the heat equation, you should be able to derive the corresponding expressions for the temperature distribution, heat flux, heat rate, and thermal resistance.

**TABLE 3.3** One-dimensional, steady-state solutions to the heat equation with no generation

	Plane Wall	Cylindrical Wall <sup>a</sup>	Spherical Wall <sup>a</sup>
Heat equation	$\frac{d^2T}{dx^2} = 0$	$\frac{1}{r} \frac{d}{dr} \left( r \frac{dT}{dr} \right) = 0$	$\frac{1}{r^2} \frac{d}{dr} \left( r^2 \frac{dT}{dr} \right) = 0$
Temperature distribution	$T_{s,1} - \Delta T \frac{x}{L}$	$T_{s,2} + \Delta T \frac{\ln(r/r_2)}{\ln(r_1/r_2)}$	$T_{s,1} - \Delta T \left[ \frac{1 - (r_1/r)}{1 - (r_1/r_2)} \right]$
Heat flux ( $q''$ )	$k \frac{\Delta T}{L}$	$\frac{k \Delta T}{r \ln(r_2/r_1)}$	$\frac{k \Delta T}{r^2 [(1/r_1) - (1/r_2)]}$
Heat rate ( $q$ )	$kA \frac{\Delta T}{L}$	$\frac{2\pi Lk \Delta T}{\ln(r_2/r_1)}$	$\frac{4\pi k \Delta T}{(1/r_1) - (1/r_2)}$
Thermal resistance ( $R_{t,\text{cond}}$ )	$\frac{L}{kA}$	$\frac{\ln(r_2/r_1)}{2\pi Lk}$	$\frac{(1/r_1) - (1/r_2)}{4\pi k}$

<sup>a</sup>The critical radius of insulation is  $r_{\text{cr}} = k/h$  for the cylinder and  $r_{\text{cr}} = 2k/h$  for the sphere.

### 3.5

#### Conduction with Thermal Energy Generation

In the preceding section we considered conduction problems for which the temperature distribution in a medium was determined solely by conditions at the boundaries of the medium. We now want to consider the additional effect on the temperature distribution of processes that may be occurring *within* the medium. In particular, we wish to consider situations for which thermal energy is being *generated* due to *conversion* from some other energy form.

A common thermal energy generation process involves the conversion from *electrical to thermal energy* in a current-carrying medium (*Ohmic*, or *resistance*, or *Joule heating*). The rate at which energy is generated by passing a current  $I$  through a medium of electrical resistance  $R_e$  is

$$\dot{E}_g = I^2 R_e \quad (3.37)$$

If this power generation (W) occurs uniformly throughout the medium of volume  $V$ , the volumetric generation rate (W/m<sup>3</sup>) is then

$$\dot{q} \equiv \frac{\dot{E}_g}{V} = \frac{I^2 R_e}{V} \quad (3.38)$$

Energy generation may also occur as a result of the deceleration and absorption of neutrons in the fuel element of a nuclear reactor or exothermic chemical reactions occurring within a medium. Endothermic reactions would, of course, have the inverse effect (a thermal energy sink) of converting thermal energy to chemical bonding energy. Finally, a conversion from electromagnetic to thermal energy may occur due to the absorption of radiation within the medium. The process occurs, for example, when gamma rays are absorbed in external nuclear reactor components (cladding,

thermal shields, pressure vessels, etc.) or when visible radiation is absorbed in a semitransparent medium. Remember not to confuse energy generation with energy storage (Section 1.3.1).

### 3.5.1 The Plane Wall

Consider the plane wall of Figure 3.9a, in which there is *uniform* energy generation per unit volume ( $\dot{q}$  is constant) and the surfaces are maintained at  $T_{s,1}$  and  $T_{s,2}$ . For constant thermal conductivity  $k$ , the appropriate form of the heat equation, Equation 2.20, is

$$\frac{d^2T}{dx^2} + \frac{\dot{q}}{k} = 0 \quad (3.39)$$

The general solution is


$$T = -\frac{\dot{q}}{2k}x^2 + C_1x + C_2 \quad (3.40)$$

where  $C_1$  and  $C_2$  are the constants of integration. For the prescribed boundary conditions,

$$T(-L) = T_{s,1} \quad \text{and} \quad T(L) = T_{s,2}$$

The constants may be evaluated and are of the form

$$C_1 = \frac{T_{s,2} - T_{s,1}}{2L} \quad \text{and} \quad C_2 = \frac{\dot{q}}{2k}L^2 + \frac{T_{s,1} + T_{s,2}}{2}$$

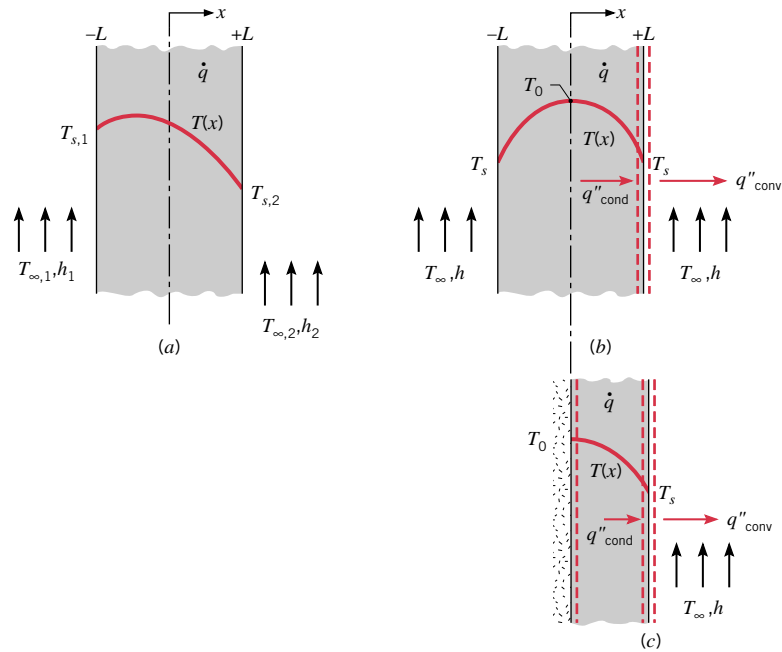

**FIGURE 3.9** Conduction in a plane wall with uniform heat generation. (a) Asymmetrical boundary conditions. (b) Symmetrical boundary conditions. (c) Adiabatic surface at midplane.



in which case the temperature distribution is

$$T(x) = \frac{\dot{q}L^2}{2k} \left( 1 - \frac{x^2}{L^2} \right) + \frac{T_{s,2} - T_{s,1}}{2} \frac{x}{L} + \frac{T_{s,1} + T_{s,2}}{2} \quad (3.41)$$

The heat flux at any point in the wall may, of course, be determined by using Equation 3.41 with Fourier's law. Note, however, that *with generation the heat flux is no longer independent of  $x$ .*

The preceding result simplifies when both surfaces are maintained at a common temperature,  $T_{s,1} = T_{s,2} \equiv T_s$ . The temperature distribution is then *symmetrical* about the midplane, Figure 3.9b, and is given by

$$T(x) = \frac{\dot{q}L^2}{2k} \left( 1 - \frac{x^2}{L^2} \right) + T_s \quad (3.42)$$

The maximum temperature exists at the midplane

$$T(0) \equiv T_0 = \frac{\dot{q}L^2}{2k} + T_s \quad (3.43)$$

in which case the temperature distribution, Equation 3.42, may be expressed as

$$\frac{T(x) - T_0}{T_s - T_0} = \left( \frac{x}{L} \right)^2 \quad (3.44)$$

It is important to note that at the plane of symmetry in Figure 3.9b, the temperature gradient is zero,  $(dT/dx)_{x=0} = 0$ . Accordingly, there is no heat transfer across this plane, and it may be represented by the *adiabatic* surface shown in Figure 3.9c. One implication of this result is that Equation 3.42 also applies to plane walls that are perfectly insulated on one side ( $x = 0$ ) and maintained at a fixed temperature  $T_s$  on the other side ( $x = L$ ).

To use the foregoing results, the surface temperature(s)  $T_s$  must be known. However, a common situation is one for which it is the temperature of an adjoining fluid,  $T_\infty$ , and not  $T_s$ , which is known. It then becomes necessary to relate  $T_s$  to  $T_\infty$ . This relation may be developed by applying a surface energy balance. Consider the surface at  $x = L$  for the symmetrical plane wall (Figure 3.9b) or the insulated plane wall (Figure 3.9c). Neglecting radiation and substituting the appropriate rate equations, the energy balance given by Equation 1.12 reduces to

$$-k \frac{dT}{dx} \Big|_{x=L} = h(T_s - T_\infty) \quad (3.45)$$

Substituting from Equation 3.42 to obtain the temperature gradient at  $x = L$ , it follows that

$$T_s = T_\infty + \frac{\dot{q}L}{h} \quad (3.46)$$

Hence  $T_s$  may be computed from knowledge of  $T_\infty$ ,  $\dot{q}$ ,  $L$ , and  $h$ .

Equation 3.46 may also be obtained by applying an *overall* energy balance to the plane wall of Figure 3.9b or 3.9c. For example, relative to a control surface about the wall of Figure 3.9c, the rate at which energy is generated within the wall must be balanced by the rate at which energy leaves via convection at the boundary. Equation 1.11c reduces to

$$\dot{E}_g = \dot{E}_{\text{out}} \quad (3.47)$$

or, for a unit surface area,

$$\dot{q}L = h(T_s - T_\infty) \quad (3.48)$$

Solving for  $T_s$ , Equation 3.46 is obtained.

Equation 3.46 may be combined with Equation 3.42 to eliminate  $T_s$  from the temperature distribution, which is then expressed in terms of the known quantities  $\dot{q}$ ,  $L$ ,  $k$ ,  $h$ , and  $T_\infty$ . The same result may be obtained directly by using Equation 3.45 as a boundary condition to evaluate the constants of integration appearing in Equation 3.40.

### EXAMPLE 3.7

A plane wall is a composite of two materials, A and B. The wall of material A has uniform heat generation  $\dot{q} = 1.5 \times 10^6 \text{ W/m}^3$ ,  $k_A = 75 \text{ W/m} \cdot \text{K}$ , and thickness  $L_A = 50 \text{ mm}$ . The wall material B has no generation with  $k_B = 150 \text{ W/m} \cdot \text{K}$  and thickness  $L_B = 20 \text{ mm}$ . The inner surface of material A is well insulated, while the outer surface of material B is cooled by a water stream with  $T_\infty = 30^\circ\text{C}$  and  $h = 1000 \text{ W/m}^2 \cdot \text{K}$ .

1. Sketch the temperature distribution that exists in the composite under steady-state conditions.
2. Determine the temperature  $T_0$  of the insulated surface and the temperature  $T_2$  of the cooled surface.


### SOLUTION

**Known:** Plane wall of material A with internal heat generation is insulated on one side and bounded by a second wall of material B, which is without heat generation and is subjected to convection cooling.

### Find:

1. Sketch of steady-state temperature distribution in the composite.
2. Inner and outer surface temperatures of the composite.

### Schematic:

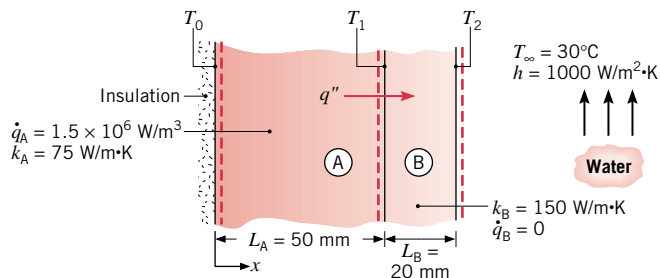


### Assumptions:

1. Steady-state conditions.
2. One-dimensional conduction in  $x$ -direction.
3. Negligible contact resistance between walls.

4. Inner surface of A adiabatic.
5. Constant properties for materials A and B.

**Analysis:**

1. From the prescribed physical conditions, the temperature distribution in the composite is known to have the following features, as shown:
  - (a) Parabolic in material A.
  - (b) Zero slope at insulated boundary.
  - (c) Linear in material B.
  - (d) Slope change  $= k_B/k_A = 2$  at interface.
 The temperature distribution in the water is characterized by
  - (e) Large gradients near the surface.



2. The outer surface temperature  $T_2$  may be obtained by performing an energy balance on a control volume about material B. Since there is no generation in this material, it follows that, for steady-state conditions and a unit surface area, the heat flux into the material at  $x = L_A$  must equal the heat flux from the material due to convection at  $x = L_A + L_B$ . Hence

$$q'' = h(T_2 - T_\infty) \quad (1)$$

The heat flux  $q''$  may be determined by performing a second energy balance on a control volume about material A. In particular, since the surface at  $x = 0$  is adiabatic, there is no inflow and the rate at which energy is generated must equal the outflow. Accordingly, for a unit surface area,

$$\dot{q}L_A = q'' \quad (2)$$

Combining Equations 1 and 2, the outer surface temperature is


$$T_2 = T_\infty + \frac{\dot{q}L_A}{h}$$

$$T_2 = 30^\circ\text{C} + \frac{1.5 \times 10^6 \text{ W/m}^3 \times 0.05 \text{ m}}{1000 \text{ W/m}^2 \cdot \text{K}} = 105^\circ\text{C} \quad \triangleleft$$

From Equation 3.43 the temperature at the insulated surface is

$$T_0 = \frac{\dot{q}L_A^2}{2k_A} + T_1 \quad (3)$$

where  $T_1$  may be obtained from the following thermal circuit:



That is,

$$T_1 = T_\infty + (R''_{\text{cond,B}} + R''_{\text{conv}}) q''$$

where the resistances for a unit surface area are

$$R''_{\text{cond,B}} = \frac{L_B}{k_B} \quad R''_{\text{conv}} = \frac{1}{h}$$

Hence,

$$\begin{aligned} T_1 &= 30^\circ\text{C} + \left( \frac{0.02 \text{ m}}{150 \text{ W/m} \cdot \text{K}} + \frac{1}{1000 \text{ W/m}^2 \cdot \text{K}} \right) \\ &\quad \times 1.5 \times 10^6 \text{ W/m}^3 \times 0.05 \text{ m} \\ T_1 &= 30^\circ\text{C} + 85^\circ\text{C} = 115^\circ\text{C} \end{aligned}$$


Substituting into Equation 3,


$$\begin{aligned} T_0 &= \frac{1.5 \times 10^6 \text{ W/m}^3 (0.05 \text{ m})^2}{2 \times 75 \text{ W/m} \cdot \text{K}} + 115^\circ\text{C} \\ T_0 &= 25^\circ\text{C} + 115^\circ\text{C} = 140^\circ\text{C} \end{aligned}$$



**Comments:**

1. Material A, having heat generation, cannot be represented by a thermal circuit element.
2. Since the resistance to heat transfer by convection is significantly larger than that due to conduction in material B,  $R''_{\text{conv}}/R''_{\text{cond}} = 7.5$ , the surface-to-fluid temperature difference is much larger than the temperature drop across material B,  $(T_2 - T_\infty)/(T_1 - T_2) = 7.5$ . This result is consistent with the temperature distribution plotted in part 1.
3. The surface and interface temperatures ( $T_0$ ,  $T_1$ , and  $T_2$ ) depend on the generation rate  $\dot{q}$ , the thermal conductivities  $k_A$  and  $k_B$ , and the convection coefficient  $h$ . Each material will have a maximum allowable operating temperature, which must not be exceeded if thermal failure of the system is to be avoided. We explore the effect of one of these parameters by computing and plotting temperature distributions for values of  $h = 200$  and  $1000 \text{ W/m}^2 \cdot \text{K}$ , which would be representative of air and liquid cooling, respectively.

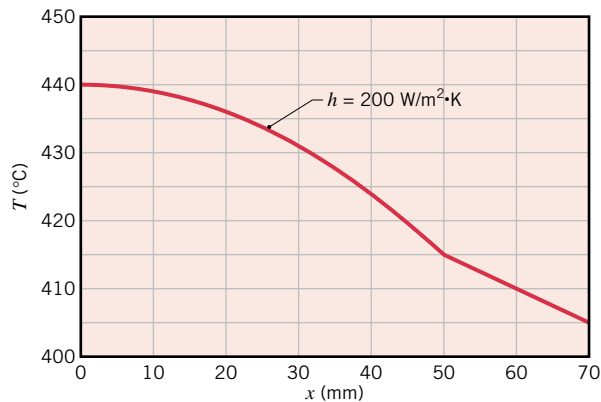

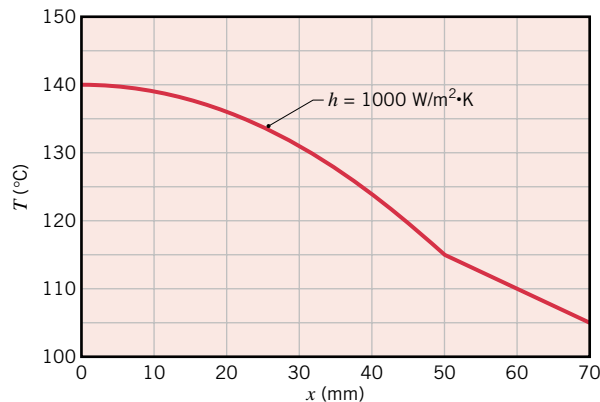


For  $h = 200 \text{ W/m}^2 \cdot \text{K}$ , there is a significant increase in temperature throughout the system and, depending on the selection of materials, thermal failure could be a problem. Note the slight discontinuity in the temperature gradient,  $dT/dx$ , at  $x = 50 \text{ mm}$ . What is the physical basis for this discontinuity? We have assumed negligible contact resistance at this location. What would be the effect of such a resistance on the temperature distribution throughout the system? Sketch a representative distribution. What would be the effect on the temperature distribution of an increase in  $\dot{q}$ ,  $k_A$ , or  $k_B$ ? Qualitatively sketch the effect of such changes on the temperature distribution.

4. This example is provided as two ready-to-solve models in *IHT*, which may be accessed in *Examples* on the *menu bar*. The first approach uses the model builder, *Models/1-D, Steady-State Conduction*, which solves for temperature distributions and heat rates in plane walls, cylinders, and spheres. The second approach demonstrates how to represent temperature distributions as *User-Defined Functions*, which for this situation represents two piece-wise distributions in materials A (quadratic) and B (linear).

### 3.5.2 Radial Systems

Heat generation may occur in a variety of radial geometries. Consider the long, solid cylinder of Figure 3.10, which could represent a current-carrying wire or a fuel

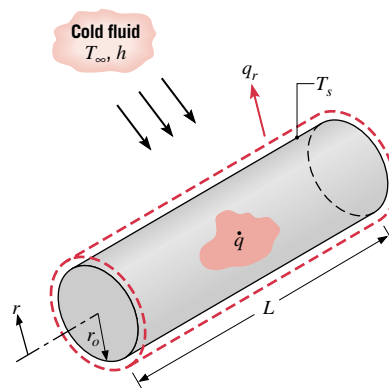

**FIGURE 3.10**

Conduction in a solid cylinder with uniform heat generation.

element in a nuclear reactor. For steady-state conditions the rate at which heat is generated within the cylinder must equal the rate at which heat is convected from the surface of the cylinder to a moving fluid. This condition allows the surface temperature to be maintained at a fixed value of  $T_s$ .

To determine the temperature distribution in the cylinder, we begin with the appropriate form of the heat equation. For constant thermal conductivity  $k$ , Equation 2.24 reduces to

$$\frac{1}{r} \frac{d}{dr} \left( r \frac{dT}{dr} \right) + \frac{\dot{q}}{k} = 0 \quad (3.49)$$

Separating variables and assuming uniform generation, this expression may be integrated to obtain

$$r \frac{dT}{dr} = -\frac{\dot{q}}{2k} r^2 + C_1 \quad (3.50)$$

Repeating the procedure, the general solution for the temperature distribution becomes

$$T(r) = -\frac{\dot{q}}{4k} r^2 + C_1 \ln r + C_2 \quad (3.51)$$

To obtain the constants of integration  $C_1$  and  $C_2$ , we apply the boundary conditions

$$\left. \frac{dT}{dr} \right|_{r=0} = 0 \quad \text{and} \quad T(r_o) = T_s$$

The first condition results from the symmetry of the situation. That is, for the solid cylinder the centerline is a line of symmetry for the temperature distribution and the temperature gradient must be zero. Recall that similar conditions existed at the midplane of a wall having symmetrical boundary conditions (Figure 3.9b). From the symmetry condition at  $r = 0$  and Equation 3.50, it is evident that  $C_1 = 0$ . Using the surface boundary condition at  $r = r_o$  with Equation 3.51, we then obtain

$$C_2 = T_s + \frac{\dot{q}}{4k} r_o^2 \quad (3.52)$$

The temperature distribution is therefore

$$T(r) = \frac{\dot{q} r_o^2}{4k} \left( 1 - \frac{r^2}{r_o^2} \right) + T_s \quad (3.53)$$

Evaluating Equation 3.53 at the centerline and dividing the result into Equation 3.53, we obtain the temperature distribution in nondimensional form,

$$\frac{T(r) - T_s}{T_o - T_s} = 1 - \left( \frac{r}{r_o} \right)^2 \quad (3.54)$$

where  $T_o$  is the centerline temperature. The heat rate at any radius in the cylinder may, of course, be evaluated by using Equation 3.53 with Fourier's law.

To relate the surface temperature,  $T_s$ , to the temperature of the cold fluid,  $T_\infty$ , either a surface energy balance or an overall energy balance may be used. Choosing the second approach, we obtain

$$\dot{q}(\pi r_o^2 L) = h(2\pi r_o L)(T_s - T_\infty)$$

or

$$T_s = T_\infty + \frac{\dot{q}r_o}{2h} \quad (3.55)$$

A convenient and systematic procedure for treating the different combinations of surface conditions, which may be applied to one-dimensional planar and radial (cylindrical and spherical) geometries with uniform thermal energy generation, is provided in Appendix C. From the tabulated results of this appendix, it is a simple matter to obtain distributions of the temperature, heat flux, and heat rate for boundary conditions of the *second kind* (a uniform surface heat flux) and the *third kind* (a surface heat flux that is proportional to a convection coefficient  $h$  or the overall heat transfer coefficient  $U$ ). You are encouraged to become familiar with the contents of the appendix.

### EXAMPLE 3.8

Consider a long solid tube, insulated at the outer radius  $r_2$  and cooled at the inner radius  $r_1$ , with uniform heat generation  $\dot{q}$  (W/m<sup>3</sup>) within the solid.

1. Obtain the general solution for the temperature distribution in the tube.
2. In a practical application a limit would be placed on the maximum temperature that is permissible at the insulated surface ( $r = r_2$ ). Specifying this limit as  $T_{s,2}$ , identify appropriate boundary conditions that could be used to determine the arbitrary constants appearing in the general solution. Determine these constants and the corresponding form of the temperature distribution.
3. Determine the heat removal rate per unit length of tube.
4. If the coolant is available at a temperature  $T_\infty$ , obtain an expression for the convection coefficient that would have to be maintained at the inner surface to allow for operation at prescribed values of  $T_{s,2}$  and  $\dot{q}$ .


### SOLUTION

**Known:** Solid tube with uniform heat generation is insulated at the outer surface and cooled at the inner surface.

### Find:

1. General solution for the temperature distribution  $T(r)$ .
2. Appropriate boundary conditions and the corresponding form of the temperature distribution.
3. Heat removal rate for specified maximum temperature.
4. Corresponding required convection coefficient at the inner surface.

**Schematic:**

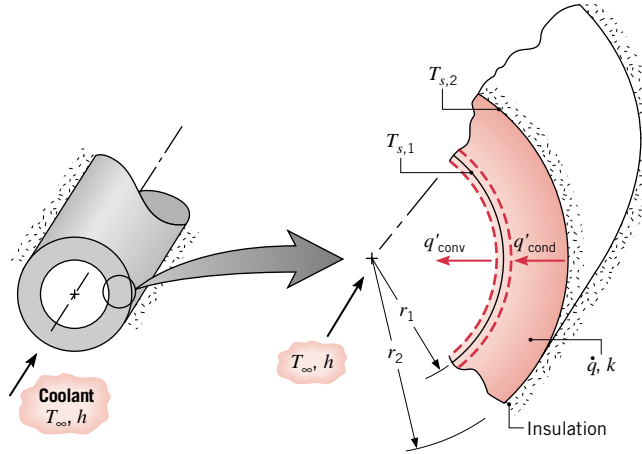

**Assumptions:**

1. Steady-state conditions.
2. One-dimensional radial conduction.
3. Constant properties.
4. Uniform volumetric heat generation.
5. Outer surface adiabatic.

**Analysis:**

1. To determine  $T(r)$ , the appropriate form of the heat equation, Equation 2.24, must be solved. For the prescribed conditions, this expression reduces to Equation 3.49, and the general solution is given by Equation 3.51. Hence, this solution applies in a cylindrical shell, as well as in a solid cylinder (Figure 3.10).
2. Two boundary conditions are needed to evaluate  $C_1$  and  $C_2$ , and in this problem it is appropriate to specify both conditions at  $r_2$ . Invoking the prescribed temperature limit,

$$T(r_2) = T_{s,2} \quad (1)$$

and applying Fourier's law, Equation 3.24, at the adiabatic outer surface

$$\left. \frac{dT}{dr} \right|_{r_2} = 0 \quad (2)$$

Using Equations 3.51 and 1, it follows that

$$T_{s,2} = -\frac{\dot{q}}{4k} r_2^2 + C_1 \ln r_2 + C_2 \quad (3)$$

Similarly, from Equations 3.50 and 2

$$0 = -\frac{\dot{q}}{2k} r_2^2 + C_1 \quad (4)$$



Hence, from Equation 4,

$$C_1 = \frac{\dot{q}}{2k} r_2^2 \quad (5)$$

and from Equation 3

$$C_2 = T_{s,2} + \frac{\dot{q}}{4k} r_2^2 - \frac{\dot{q}}{2k} r_2^2 \ln r_2 \quad (6)$$

Substituting Equations 5 and 6 into the general solution, Equation 3.51, it follows that

$$T(r) = T_{s,2} + \frac{\dot{q}}{4k} (r_2^2 - r^2) - \frac{\dot{q}}{2k} r_2^2 \ln \frac{r_2}{r} \quad (7)$$

3. The heat removal rate may be determined by obtaining the conduction rate at  $r_1$  or by evaluating the total generation rate for the tube. From Fourier's law

$$q'_r = -k2\pi r \frac{dT}{dr}$$

Hence, substituting from Equation 7 and evaluating the result at  $r_1$ ,

$$q'_r(r_1) = -k2\pi r_1 \left( -\frac{\dot{q}}{2k} r_1 + \frac{\dot{q}}{2k} \frac{r_2^2}{r_1} \right) = -\pi \dot{q} (r_2^2 - r_1^2) \quad (8)$$

Alternatively, because the tube is insulated at  $r_2$ , the rate at which heat is generated in the tube must equal the rate of removal at  $r_1$ . That is, for a control volume about the tube, the energy conservation requirement, Equation 1.11c, reduces to  $\dot{E}_g - \dot{E}_{\text{out}} = 0$ , where  $\dot{E}_g = \dot{q}\pi(r_2^2 - r_1^2)L$  and  $\dot{E}_{\text{out}} = q'_{\text{cond}}L = -q'_r(r_1)L$ . Hence

$$q'_r(r_1) = -\pi \dot{q} (r_2^2 - r_1^2) \quad (9)$$

4. Applying the energy conservation requirement, Equation 1.12, to the inner surface, it follows that

$$q'_{\text{cond}} = q'_{\text{conv}}$$

or

$$\pi \dot{q} (r_2^2 - r_1^2) = h2\pi r_1 (T_{s,1} - T_\infty)$$

Hence


$$h = \frac{\dot{q}(r_2^2 - r_1^2)}{2r_1(T_{s,1} - T_\infty)} \quad (10)$$

where  $T_{s,1}$  may be obtained by evaluating Equation 7 at  $r = r_1$ .

### Comments:

- Note that, through application of Fourier's law in part 3, the sign on  $q'_r(r_1)$  was found to be negative, Equation 8, implying that heat flow is in the negative  $r$  direction. However, in applying the energy balance, we acknowledged that heat flow was *out* of the wall. Hence we expressed  $q'_{\text{cond}}$  as  $-q'_r(r_1)$  and we expressed  $q'_{\text{conv}}$  in terms of  $(T_{s,1} - T_\infty)$ , rather than  $(T_\infty - T_{s,1})$ .
- Results of the foregoing analysis may be used to determine the convection coefficient required to maintain the maximum tube temperature,  $T_{s,2}$ , below a prescribed value. Consider a tube of thermal conductivity  $k = 5 \text{ W/m} \cdot \text{K}$

and inner and outer radii of  $r_1 = 20$  mm and  $r_2 = 25$  mm, respectively, with a maximum allowable temperature of  $T_{s,2} = 350^\circ\text{C}$ . The tube experiences heat generation at a rate of  $\dot{q} = 5 \times 10^6$  W/m<sup>3</sup>, and the coolant is at a temperature of  $T_\infty = 80^\circ\text{C}$ . Obtaining  $T(r_1) = T_{s,1} = 336.5^\circ\text{C}$  from Equation 7 and substituting into Equation 10, the required convection coefficient is found to be  $h = 110$  W/m<sup>2</sup> · K. Using the *IHT Workspace*, parametric calculations may be performed to determine the effects of the convection coefficient and the generation rate on the maximum tube temperature, and results are plotted as a function of  $h$  for three values of  $\dot{q}$ .

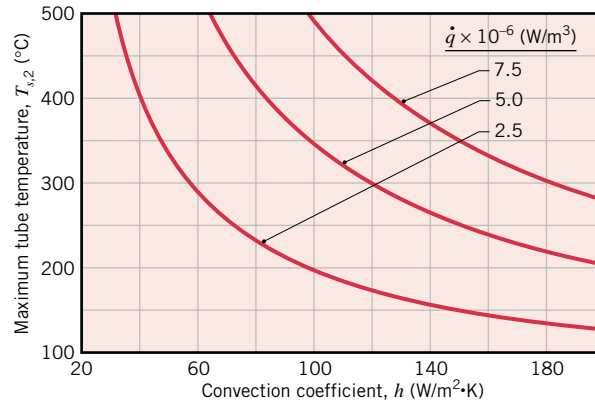

For each generation rate, the minimum value of  $h$  needed to maintain  $T_{s,2} \leq 350^\circ\text{C}$  may be determined from the figure.

3. The temperature distribution, Equation 7, may also be obtained by using the results of Appendix C. Applying a surface energy balance at  $r = r_1$ , with  $q(r_1) = -\dot{q}\pi(r_2^2 - r_1^2)L$ ,  $(T_{s,2} - T_{s,1})$  may be determined from Equation C.8 and the result substituted into Equation C.2 to eliminate  $T_{s,1}$  and obtain the desired expression.


### 3.5.3 Application of Resistance Concepts

We conclude our discussion of heat generation effects with a word of caution. In particular, when such effects are present, the heat transfer rate is not a constant, independent of the spatial coordinate. Accordingly, it would be *incorrect* to use the conduction resistance concepts and the related heat rate equations developed in Sections 3.1 and 3.3.

## 3.6

### Heat Transfer from Extended Surfaces

The term *extended surface* is commonly used to depict an important special case involving heat transfer by conduction within a solid and heat transfer by convection (and/or radiation) from the boundaries of the solid. Until now, we have considered heat transfer from the boundaries of a solid to be in the same direction as heat

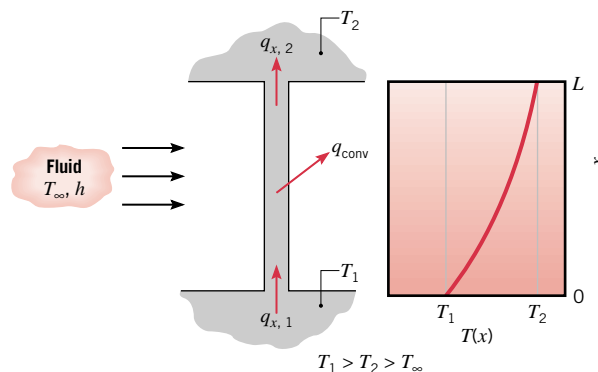


**FIGURE 3.11** Combined conduction and convection in a structural element.

transfer by conduction in the solid. In contrast, for an extended surface, the direction of heat transfer from the boundaries is perpendicular to the principal direction of heat transfer in the solid.


Consider a strut that connects two walls at different temperatures and across which there is fluid flow (Figure 3.11). With  $T_1 > T_2$ , temperature gradients in the  $x$ -direction sustain heat transfer by conduction in the strut. However, with  $T_1 > T_2 > T_\infty$ , there is concurrent heat transfer by convection to the fluid, causing  $q_{x,1}$  and hence the magnitude of the temperature gradient,  $|dT/dx|$ , to decrease with increasing  $x$ .

Although there are many different situations that involve such combined conduction–convection effects, the most frequent application is one in which an extended surface is used specifically to *enhance* heat transfer between a solid and an adjoining fluid. Such an extended surface is termed a *fin*.

Consider the plane wall of Figure 3.12a. If  $T_s$  is fixed, there are two ways in which the heat transfer rate may be increased. The convection coefficient  $h$  could be increased by increasing the fluid velocity, and/or the fluid temperature  $T_\infty$  could be reduced. However, there are many situations for which increasing  $h$  to the maximum possible value is either insufficient to obtain the desired heat transfer rate or the associated costs are prohibitive. Such costs are related to the blower or pump

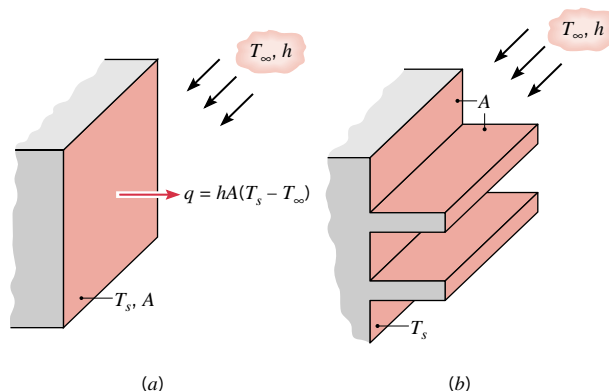

**FIGURE 3.12** Use of fins to enhance heat transfer from a plane wall. (a) Bare surface. (b) Finned surface.

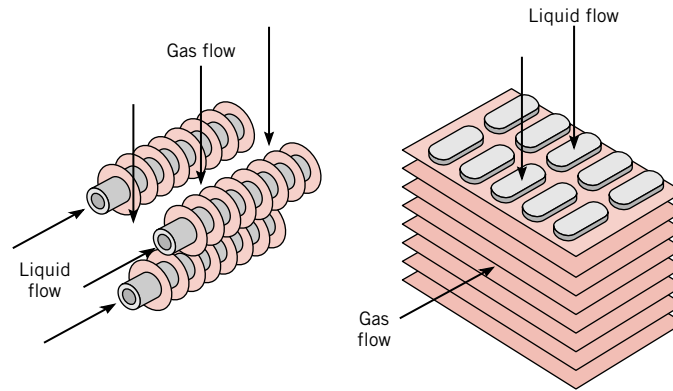

**FIGURE 3.13** Schematic of typical finned-tube heat exchangers.


power requirements needed to increase  $h$  through increased fluid motion. Moreover, the second option of reducing  $T_\infty$  is often impractical. Examining Figure 3.12b, however, we see that there exists a third option. That is, the heat transfer rate may be increased by increasing the surface area across which the convection occurs. This may be done by employing *fins* that *extend* from the wall into the surrounding fluid. The thermal conductivity of the fin material can have a strong effect on the temperature distribution along the fin and therefore influences the degree to which the heat transfer rate is enhanced. Ideally, the fin material should have a large thermal conductivity to minimize temperature variations from its base to its tip. In the limit of infinite thermal conductivity, the entire fin would be at the temperature of the base surface, thereby providing the maximum possible heat transfer enhancement.

Examples of fin applications are easy to find. Consider the arrangement for cooling engine heads on motorcycles and lawn mowers or for cooling electric power transformers. Consider also the tubes with attached fins used to promote heat exchange between air and the working fluid of an air conditioner. Two common finned-tube arrangements are shown in Figure 3.13.

Different fin configurations are illustrated in Figure 3.14. A *straight fin* is any extended surface that is attached to a *plane wall*. It may be of uniform cross-sectional area, or its cross-sectional area may vary with the distance  $x$  from the wall. An *annular fin* is one that is circumferentially attached to a cylinder, and its cross section varies with radius from the wall of the cylinder. The foregoing fin types have rectangular cross sections, whose area may be expressed as a product of the fin thickness  $t$  and the width  $w$  for straight fins or the circumference  $2\pi r$  for annular fins. In contrast a *pin fin*, or *spine*, is an extended surface of circular cross section. Pin fins may also be of uniform or nonuniform cross section. In any application, selection of a particular fin configuration may depend on space, weight, manufacturing, and cost considerations, as well as on the extent to which the fins reduce the surface convection coefficient and increase the pressure drop associated with flow over the fins.


### 3.6.1 A General Conduction Analysis

As engineers we are primarily interested in knowing the extent to which particular extended surfaces or fin arrangements could improve heat transfer from a surface

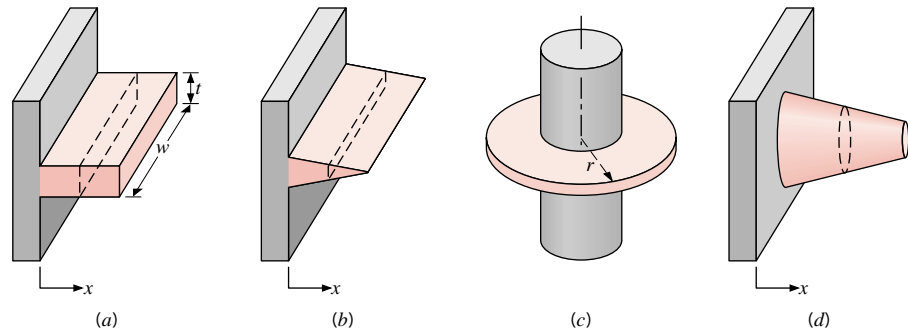

**FIGURE 3.14** Fin configurations. (a) Straight fin of uniform cross section. (b) Straight fin of nonuniform cross section. (c) Annular fin. (d) Pin fin.

to the surrounding fluid. To determine the heat transfer rate associated with a fin, we must first obtain the temperature distribution along the fin. As we have done for previous systems, we begin by performing an energy balance on an appropriate differential element. Consider the extended surface of Figure 3.15. The analysis is simplified if certain assumptions are made. We choose to assume one-dimensional conditions in the longitudinal ( $x$ ) direction, even though conduction within the fin is actually two dimensional. The rate at which energy is convected to the fluid from any point on the fin surface must be balanced by the net rate at which energy reaches that point due to conduction in the transverse ( $y, z$ ) direction. However, in practice the fin is thin, and temperature changes in the transverse direction within the fin are small compared with the temperature difference between the fin and the environment. Hence, we may assume that the temperature is uniform across the fin thickness, that is, it is only a function of  $x$ . We will consider steady-state conditions and also assume that the thermal conductivity is constant, that radiation from the surface is negligible, that heat generation effects are absent, and that the convection heat transfer coefficient  $h$  is uniform over the surface.

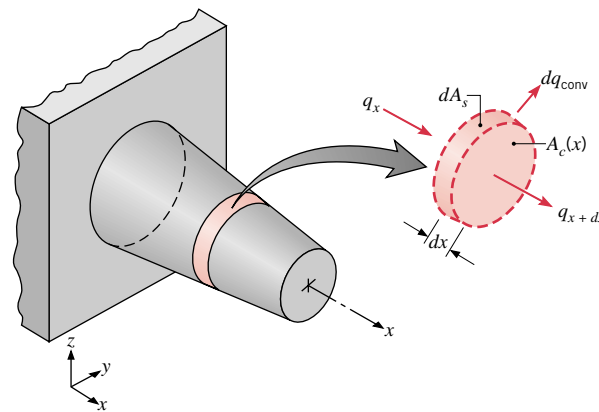

**FIGURE 3.15** Energy balance for an extended surface.

Applying the conservation of energy requirement, Equation 1.11c, to the differential element of Figure 3.15, we obtain

$$q_x = q_{x+dx} + dq_{\text{conv}} \quad (3.56)$$

From Fourier's law we know that

$$q_x = -kA_c \frac{dT}{dx} \quad (3.57)$$

where  $A_c$  is the *cross-sectional* area, which may vary with  $x$ . Since the conduction heat rate at  $x + dx$  may be expressed as

$$q_{x+dx} = q_x + \frac{dq_x}{dx} dx \quad (3.58)$$

it follows that

$$q_{x+dx} = -kA_c \frac{dT}{dx} - k \frac{d}{dx} \left( A_c \frac{dT}{dx} \right) dx \quad (3.59)$$

The convection heat transfer rate may be expressed as

$$dq_{\text{conv}} = h dA_s (T - T_\infty) \quad (3.60)$$

where  $dA_s$  is the *surface* area of the differential element. Substituting the foregoing rate equations into the energy balance, Equation 3.56, we obtain

$$\frac{d}{dx} \left( A_c \frac{dT}{dx} \right) - \frac{h}{k} \frac{dA_s}{dx} (T - T_\infty) = 0$$

or

$$\frac{d^2 T}{dx^2} + \left( \frac{1}{A_c} \frac{dA_c}{dx} \right) \frac{dT}{dx} - \left( \frac{1}{A_c} \frac{h}{k} \frac{dA_s}{dx} \right) (T - T_\infty) = 0 \quad (3.61)$$

This result provides a general form of the energy equation for an extended surface. Its solution for appropriate boundary conditions provides the temperature distribution, which may be used with Equation 3.57 to calculate the conduction rate at any  $x$ .

### 3.6.2 Fins of Uniform Cross-Sectional Area


To solve Equation 3.61 it is necessary to be more specific about the geometry. We begin with the simplest case of straight rectangular and pin fins of uniform cross section (Figure 3.16). Each fin is attached to a base surface of temperature  $T(0) = T_b$  and extends into a fluid of temperature  $T_\infty$ .

For the prescribed fins,  $A_c$  is a constant and  $A_s = Px$ , where  $A_s$  is the surface area measured from the base to  $x$  and  $P$  is the fin perimeter. Accordingly, with  $dA_c/dx = 0$  and  $dA_s/dx = P$ , Equation 3.61 reduces to

$$\frac{d^2 T}{dx^2} - \frac{hP}{kA_c} (T - T_\infty) = 0 \quad (3.62)$$

To simplify the form of this equation, we transform the dependent variable by defining an *excess temperature*  $\theta$  as

$$\theta(x) \equiv T(x) - T_\infty \quad (3.63)$$

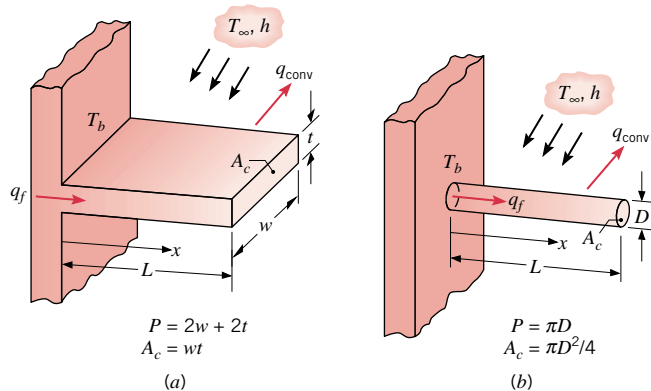

**FIGURE 3.16** Straight fins of uniform cross section. (a) Rectangular fin. (b) Pin fin.

where, since  $T_\infty$  is a constant,  $d\theta/dx = dT/dx$ . Substituting Equation 3.63 into Equation 3.62, we then obtain

$$\frac{d^2\theta}{dx^2} - m^2\theta = 0 \quad (3.64)$$

where

$$m^2 \equiv \frac{hP}{kA_c} \quad (3.65)$$

Equation 3.64 is a linear, homogeneous, second-order differential equation with constant coefficients. Its general solution is of the form

$$\theta(x) = C_1 e^{mx} + C_2 e^{-mx} \quad (3.66)$$

By substitution it may readily be verified that Equation 3.66 is indeed a solution to Equation 3.64.

To evaluate the constants  $C_1$  and  $C_2$  of Equation 3.66, it is necessary to specify appropriate boundary conditions. One such condition may be specified in terms of the temperature at the *base* of the fin ( $x = 0$ )

$$\theta(0) = T_b - T_\infty \equiv \theta_b \quad (3.67)$$

The second condition, specified at the fin tip ( $x = L$ ), may correspond to one of four different physical situations.


The first condition, Case A, considers convection heat transfer from the fin tip. Applying an energy balance to a control surface about this tip (Figure 3.17), we obtain

$$hA_c[T(L) - T_\infty] = -kA_c \left. \frac{dT}{dx} \right|_{x=L}$$

or

$$h\theta(L) = -k \left. \frac{d\theta}{dx} \right|_{x=L} \quad (3.68)$$

That is, the rate at which energy is transferred to the fluid by convection from the tip must equal the rate at which energy reaches the tip by conduction through

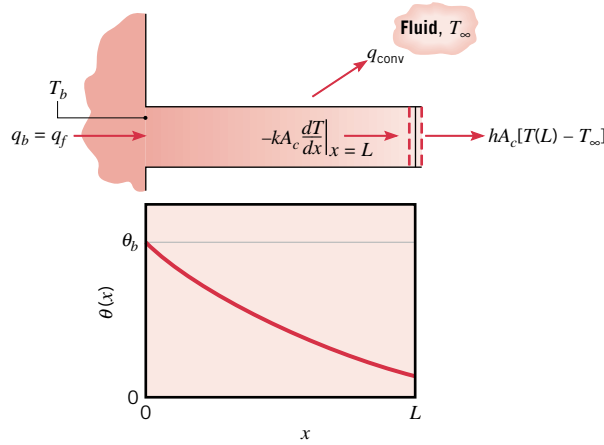

**FIGURE 3.17** Conduction and convection in a fin of uniform cross section.

the fin. Substituting Equation 3.66 into Equations 3.67 and 3.68, we obtain, respectively,

$$\theta_b = C_1 + C_2 \quad (3.69)$$

and

$$h(C_1 e^{mL} + C_2 e^{-mL}) = km(C_2 e^{-mL} - C_1 e^{mL})$$

Solving for  $C_1$  and  $C_2$ , it may be shown, after some manipulation, that

$$\frac{\theta}{\theta_b} = \frac{\cosh m(L-x) + (h/mk) \sinh m(L-x)}{\cosh mL + (h/mk) \sinh mL} \quad (3.70)$$

The form of this temperature distribution is shown schematically in Figure 3.17. Note that the magnitude of the temperature gradient decreases with increasing  $x$ . This trend is a consequence of the reduction in the conduction heat transfer  $q_x(x)$  with increasing  $x$  due to continuous convection losses from the fin surface.

We are particularly interested in the amount of heat transferred from the entire fin. From Figure 3.17 it is evident that the fin heat transfer rate  $q_f$  may be evaluated in two alternative ways, both of which involve use of the temperature distribution. The simpler procedure, and the one that we will use, involves applying Fourier's law at the fin base. That is,

$$q_f = q_b = -kA_c \left. \frac{dT}{dx} \right|_{x=0} = -kA_c \left. \frac{d\theta}{dx} \right|_{x=0} \quad (3.71)$$

Hence, knowing the temperature distribution,  $\theta(x)$ ,  $q_f$  may be evaluated, giving

$$q_f = \sqrt{hPkA_c} \theta_b \frac{\sinh mL + (h/mk) \cosh mL}{\cosh mL + (h/mk) \sinh mL} \quad (3.72)$$

However, conservation of energy dictates that the rate at which heat is transferred by convection from the fin must equal the rate at which it is conducted through the base of the fin. Accordingly, the alternative formulation for  $q_f$  is

$$q_f = \int_{A_f} h[T(x) - T_\infty] dA_s$$



$$q_f = \int_{A_f} h\theta(x) dA_s \quad (3.73)$$

where  $A_f$  is the *total*, including the tip, *fin surface area*. Substitution of Equation 3.70 into Equation 3.73 would yield Equation 3.72.

The second tip condition, Case B, corresponds to the assumption that the convective heat loss from the fin tip is negligible, in which case the tip may be treated as adiabatic and

$$\left. \frac{d\theta}{dx} \right|_{x=L} = 0 \quad (3.74)$$

Substituting from Equation 3.66 and dividing by  $m$ , we then obtain

$$C_1 e^{mL} - C_2 e^{-mL} = 0$$

Using this expression with Equation 3.69 to solve for  $C_1$  and  $C_2$  and substituting the results into Equation 3.66, we obtain

$$\frac{\theta}{\theta_b} = \frac{\cosh m(L-x)}{\cosh mL} \quad (3.75)$$

Using this temperature distribution with Equation 3.71, the fin heat transfer rate is then

$$q_f = \sqrt{hPkA_c} \theta_b \tanh mL \quad (3.76)$$

In the same manner, we can obtain the fin temperature distribution and heat transfer rate for Case C, where the temperature is prescribed at the fin tip. That is, the second boundary condition is  $\theta(L) = \theta_L$ , and the resulting expressions are of the form

$$\frac{\theta}{\theta_b} = \frac{(\theta_L/\theta_b) \sinh mx + \sinh m(L-x)}{\sinh mL} \quad (3.77)$$

$$q_f = \sqrt{hPkA_c} \theta_b \frac{\cosh mL - \theta_L/\theta_b}{\sinh mL} \quad (3.78)$$

**TABLE 3.4** Temperature distribution and heat loss for fins of uniform cross section

Case	Tip Condition ( $x = L$ )	Temperature Distribution $\theta/\theta_b$	Fin Heat Transfer Rate $q_f$
A	Convection heat transfer: $h\theta(L) = -kd\theta/dx _{x=L}$	$\frac{\cosh m(L-x) + (h/mk) \sinh m(L-x)}{\cosh mL + (h/mk) \sinh mL} \quad (3.70)$	$M \frac{\sinh mL + (h/mk) \cosh mL}{\cosh mL + (h/mk) \sinh mL} \quad (3.72)$
B	Adiabatic $d\theta/dx _{x=L} = 0$	$\frac{\cosh m(L-x)}{\cosh mL} \quad (3.75)$	$M \tanh mL \quad (3.76)$
C	Prescribed temperature: $\theta(L) = \theta_L$	$\frac{(\theta_L/\theta_b) \sinh mx + \sinh m(L-x)}{\sinh mL} \quad (3.77)$	$M \frac{(\cosh mL - \theta_L/\theta_b)}{\sinh mL} \quad (3.78)$
D	Infinite fin ( $L \rightarrow \infty$ ): $\theta(L) = 0$	$e^{-mx} \quad (3.79)$	$M \quad (3.80)$
$\theta \equiv T - T_\infty$ $\theta_b = \theta(0) = T_b - T_\infty$ $m^2 \equiv hP/kA_c$ $M \equiv \sqrt{hPkA_c} \theta_b$			

The *very long fin*, Case D, is an interesting extension of these results. In particular, as  $L \rightarrow \infty$ ,  $\theta_L \rightarrow 0$  and it is easily verified that

$$\frac{\theta}{\theta_b} = e^{-mx} \quad (3.79)$$

$$q_f = \sqrt{hPkA_c}\theta_b \quad (3.80)$$

The foregoing results are summarized in Table 3.4. A table of hyperbolic functions is provided in Appendix B.1.

### EXAMPLE 3.9

A very long rod 5 mm in diameter has one end maintained at 100°C. The surface of the rod is exposed to ambient air at 25°C with a convection heat transfer coefficient of 100 W/m<sup>2</sup> · K.

1. Determine the temperature distributions along rods constructed from pure copper, 2024 aluminum alloy, and type AISI 316 stainless steel. What are the corresponding heat losses from the rods?
2. Estimate how long the rods must be for the assumption of *infinite length* to yield an accurate estimate of the heat loss.


### SOLUTION

**Known:** A long circular rod exposed to ambient air.

**Find:**

1. Temperature distribution and heat loss when rod is fabricated from copper, an aluminum alloy, or stainless steel.
2. How long rods must be to assume infinite length.

**Schematic:**

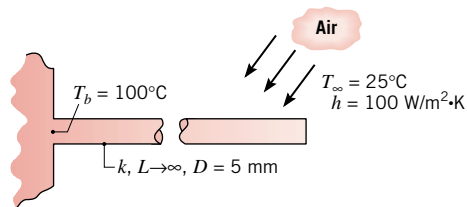

**Assumptions:**

1. Steady-state conditions.
2. One-dimensional conduction along the rod.
3. Constant properties.
4. Negligible radiation exchange with surroundings.
5. Uniform heat transfer coefficient.
6. Infinitely long rod.


**Properties:** Table A.1, copper [ $T = (T_b + T_\infty)/2 = 62.5^\circ\text{C} \approx 335\text{ K}$ ]:  $k = 398\text{ W/m} \cdot \text{K}$ . Table A.1, 2024 aluminum (335 K):  $k = 180\text{ W/m} \cdot \text{K}$ . Table A.1, stainless steel, AISI 316 (335 K):  $k = 14\text{ W/m} \cdot \text{K}$ .

**Analysis:**

1. Subject to the assumption of an infinitely long fin, the temperature distributions are determined from Equation 3.79, which may be expressed as

$$T = T_\infty + (T_b - T_\infty)e^{-mx}$$

where  $m = (hP/kA_c)^{1/2} = (4h/kD)^{1/2}$ . Substituting for  $h$  and  $D$ , as well as for the thermal conductivities of copper, the aluminum alloy, and the stainless steel, respectively, the values of  $m$  are 14.2, 21.2, and  $75.6\text{ m}^{-1}$ . The temperature distributions may then be computed and plotted as follows.

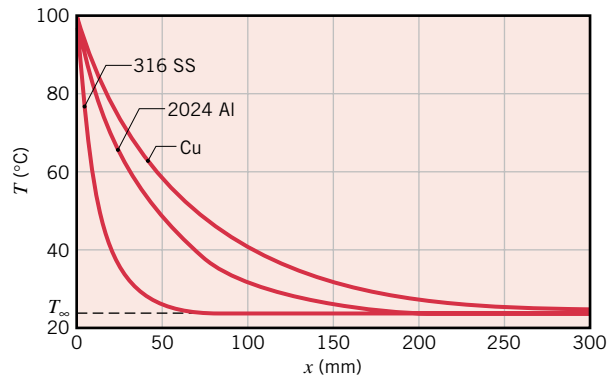

From these distributions, it is evident that there is little additional heat transfer associated with extending the length of the rod much beyond 50, 200, and 300 mm, respectively, for the stainless steel, the aluminum alloy, and the copper.

From Equation 3.80 the heat loss is

$$q_f = \sqrt{hPkA_c}\theta_b$$

Hence for copper,

$$\begin{aligned} q_f &= \left[ 100\text{ W/m}^2 \cdot \text{K} \times \pi \times 0.005\text{ m} \right. \\ &\quad \left. \times 398\text{ W/m} \cdot \text{K} \times \frac{\pi}{4} (0.005\text{ m})^2 \right]^{1/2} (100 - 25)^\circ\text{C} \\ &= 8.3\text{ W} \end{aligned}$$

Similarly, for the aluminum alloy and stainless steel, respectively, the heat rates are  $q_f = 5.6\text{ W}$  and  $1.6\text{ W}$ .

2. Since there is no heat loss from the tip of an infinitely long rod, an estimate of the validity of this approximation may be made by comparing Equations 3.76 and 3.80. To a satisfactory approximation, the expressions provide equivalent results if  $\tanh mL \geq 0.99$  or  $mL \geq 2.65$ . Hence a rod may be assumed to be infinitely long if

$$L \geq L_\infty \equiv \frac{2.65}{m} = 2.65 \left( \frac{kA_c}{hP} \right)^{1/2}$$

For copper,

$$L_{\infty} = 2.65 \left[ \frac{398 \text{ W/m} \cdot \text{K} \times (\pi/4)(0.005 \text{ m})^2}{100 \text{ W/m}^2 \cdot \text{K} \times \pi(0.005 \text{ m})} \right]^{1/2} = 0.19 \text{ m} \quad \triangleleft$$

Results for the aluminum alloy and stainless steel are  $L_{\infty} = 0.13 \text{ m}$  and  $L_{\infty} = 0.04 \text{ m}$ , respectively.

**Comments:**

1. The foregoing results suggest that the fin heat transfer rate may accurately be predicted from the infinite fin approximation if  $mL \gtrsim 2.65$ . However, if the infinite fin approximation is to accurately predict the temperature distribution  $T(x)$ , a larger value of  $mL$  would be required. This value may be inferred from Equation 3.79 and the requirement that the tip temperature be very close to the fluid temperature. Hence, if we require that  $\theta(L)/\theta_b = \exp(-mL) < 0.01$ , it follows that  $mL > 4.6$ , in which case  $L_{\infty} \approx 0.33, 0.23$ , and  $0.07 \text{ m}$  for the copper, aluminum alloy, and stainless steel, respectively. These results are consistent with the distributions plotted in part 1.
2. For the four tip conditions of Table 3.4, the *Models/Extended Surfaces* option of *IHT* provides ready-to-solve models for the heat rate and temperature distribution of straight fins and pin fins of uniform cross section. These models can save considerable time in solving more complicated problems, assuming of course, that you understand the relations and use them properly. See if you can use the *Pin Fins* model to generate the graph of this example. The example is also provided as a solved-model in the *Examples* section of *IHT*.

### 3.6.3 Fin Performance

Recall that fins are used to increase the heat transfer from a surface by increasing the effective surface area. However, the fin itself represents a conduction resistance to heat transfer from the original surface. For this reason, there is no assurance that the heat transfer rate will be increased through the use of fins. An assessment of this matter may be made by evaluating the *fin effectiveness*  $\varepsilon_f$ . It is defined as the *ratio of the fin heat transfer rate to the heat transfer rate that would exist without the fin*. Therefore

$$\varepsilon_f = \frac{q_f}{hA_{c,b}\theta_b} \quad (3.81)$$

where  $A_{c,b}$  is the fin cross-sectional area at the base. In any rational design the value of  $\varepsilon_f$  should be as large as possible, and in general, the use of fins may rarely be justified unless  $\varepsilon_f \gtrsim 2$ .

Subject to any one of the four tip conditions that have been considered, the effectiveness for a fin of uniform cross section may be obtained by dividing the appropriate expression for  $q_f$  in Table 3.4 by  $hA_{c,b}\theta_b$ . Although the installation of fins will alter the surface convection coefficient, this effect is commonly neglected.

Hence, assuming the convection coefficient of the finned surface to be equivalent to that of the unfinned base, it follows that, for the infinite fin approximation (Case D), the result is

$$\varepsilon_f = \left( \frac{kP}{hA_c} \right)^{1/2} \quad (3.82)$$

Several important trends may be inferred from this result. Obviously, fin effectiveness is enhanced by the choice of a material of high thermal conductivity. Aluminum alloys and copper come to mind. However, although copper is superior from the standpoint of thermal conductivity, aluminum alloys are the more common choice because of additional benefits related to lower cost and weight. Fin effectiveness is also enhanced by increasing the ratio of the perimeter to the cross-sectional area. For this reason, the use of *thin*, but closely spaced fins, is preferred, with the proviso that the fin gap not be reduced to a value for which flow between the fins is severely impeded, thereby reducing the convection coefficient.

Equation 3.82 also suggests that the use of fins can be better justified under conditions for which the convection coefficient  $h$  is small. Hence from Table 1.1 it is evident that the need for fins is stronger when the fluid is a gas rather than a liquid and when the surface heat transfer is by *free* convection. If fins are to be used on a surface separating a gas and a liquid, they are generally placed on the gas side, which is the side of lower convection coefficient. A common example is the tubing in an automobile radiator. Fins are applied to the outer tube surface, over which there is flow of ambient air (small  $h$ ), and not to the inner surface, through which there is flow of water (large  $h$ ). Note that, if  $\varepsilon_f > 2$  is used as a criterion to justify the implementation of fins, Equation 3.82 yields the requirement that  $(kP/hA_c) > 4$ .

Equation 3.82 provides an upper limit to  $\varepsilon_f$ , which is reached as  $L$  approaches infinity. However, it is certainly not necessary to use very long fins to achieve near maximum heat transfer enhancement. As seen in Example 3.8, 99% of the maximum possible fin heat transfer rate is achieved for  $mL = 2.65$ . Hence, it would make no sense to extend the fins beyond  $L = 2.65/m$ .

Fin performance may also be quantified in terms of a thermal resistance. Treating the difference between the base and fluid temperatures as the driving potential, a *fin resistance* may be defined as

$$R_{t,f} = \frac{\theta_b}{q_f} \quad (3.83)$$

This result is extremely useful, particularly when representing a finned surface by a thermal circuit. Note that, according to the fin tip condition, an appropriate expression for  $q_f$  may be obtained from Table 3.4.

Dividing Equation 3.83 into the expression for the thermal resistance due to convection at the exposed base,

$$R_{t,b} = \frac{1}{hA_{c,b}} \quad (3.84)$$

and substituting from Equation 3.81, it follows that

$$\varepsilon_f = \frac{R_{t,b}}{R_{t,f}} \quad (3.85)$$

Hence the fin effectiveness may be interpreted as a ratio of thermal resistances, and to increase  $\varepsilon_f$  it is necessary to reduce the conduction/convection resistance of the fin. If the fin is to enhance heat transfer, its resistance must not exceed that of the exposed base.

Another measure of fin thermal performance is provided by the *fin efficiency*  $\eta_f$ . The maximum driving potential for convection is the temperature difference between the base ( $x = 0$ ) and the fluid,  $\theta_b = T_b - T_\infty$ . Hence the maximum rate at which a fin could dissipate energy is the rate that would exist if the entire fin surface were at the base temperature. However, since any fin is characterized by a finite conduction resistance, a temperature gradient must exist along the fin and the above condition is an idealization. A logical definition of fin efficiency is therefore

$$\eta_f \equiv \frac{q_f}{q_{\max}} = \frac{q_f}{hA_f\theta_b} \quad (3.86)$$

where  $A_f$  is the surface area of the fin. For a straight fin of uniform cross section and an adiabatic tip, Equations 3.76 and 3.86 yield

$$\eta_f = \frac{M \tanh mL}{hPL\theta_b} = \frac{\tanh mL}{mL} \quad (3.87)$$

Referring to Table B.1, this result tells us that  $\eta_f$  approaches its maximum and minimum values of 1 and 0, respectively, as  $L$  approaches 0 and  $\infty$ .

In lieu of the somewhat cumbersome expression for heat transfer from a straight rectangular fin with an active tip, Equation 3.72, it has been shown that approximate, yet accurate, predictions may be obtained by using the adiabatic tip result, Equation 3.76, with a corrected fin length of the form  $L_c = L + (t/2)$  for a rectangular fin and  $L_c = L + (D/4)$  for a pin fin [9]. The correction is based on assuming equivalence between heat transfer from the actual fin with tip convection and heat transfer from a longer, hypothetical fin with an adiabatic tip. Hence, with tip convection, the fin heat rate may be approximated as

$$q_f = M \tanh mL_c \quad (3.88)$$

and the corresponding efficiency as

$$\eta_f = \frac{\tanh mL_c}{mL_c} \quad (3.89)$$


Errors associated with the approximation are negligible if  $(ht/k)$  or  $(hD/2k) \leq 0.0625$  [10].

If the width of a rectangular fin is much larger than its thickness,  $w \gg t$ , the perimeter may be approximated as  $P = 2w$ , and

$$mL_c = \left( \frac{hP}{kA_c} \right)^{1/2} L_c = \left( \frac{2h}{kt} \right)^{1/2} L_c$$

Multiplying numerator and denominator by  $L_c^{1/2}$  and introducing a corrected fin profile area,  $A_p = L_c t$ , it follows that

$$mL_c = \left( \frac{2h}{kA_p} \right)^{1/2} L_c^{3/2} \quad (3.90)$$

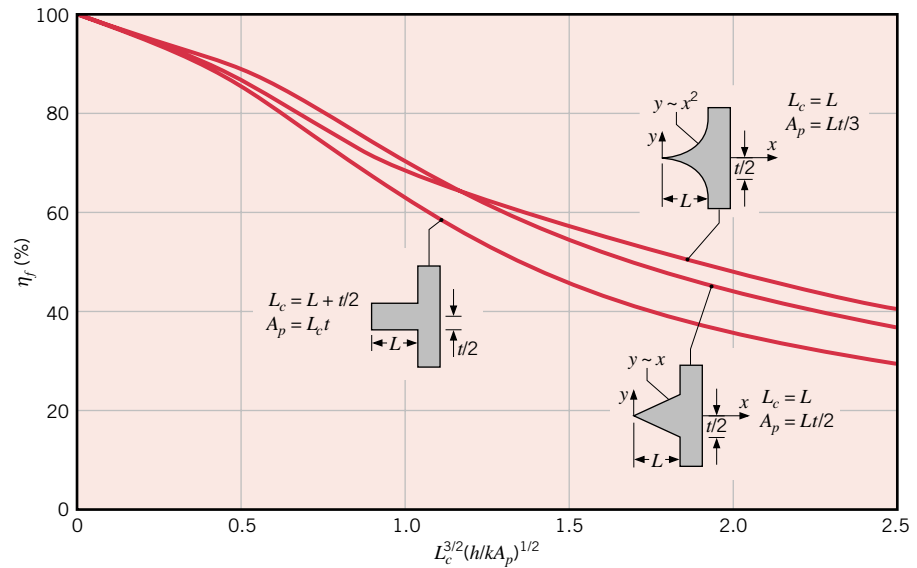


**FIGURE 3.18** Efficiency of straight fins (rectangular, triangular, and parabolic profiles).

Hence, as shown in Figures 3.18 and 3.19, the efficiency of a rectangular fin with tip convection may be represented as a function of  $L_c^{3/2}(h/ka_p)^{1/2}$ .

### 3.6.4 Fins of Nonuniform Cross-Sectional Area

Analysis of fin thermal behavior becomes more complex if the fin is of nonuniform cross section. For such cases the second term of Equation 3.61 must be retained, and the solutions are no longer in the form of simple exponential or hyperbolic

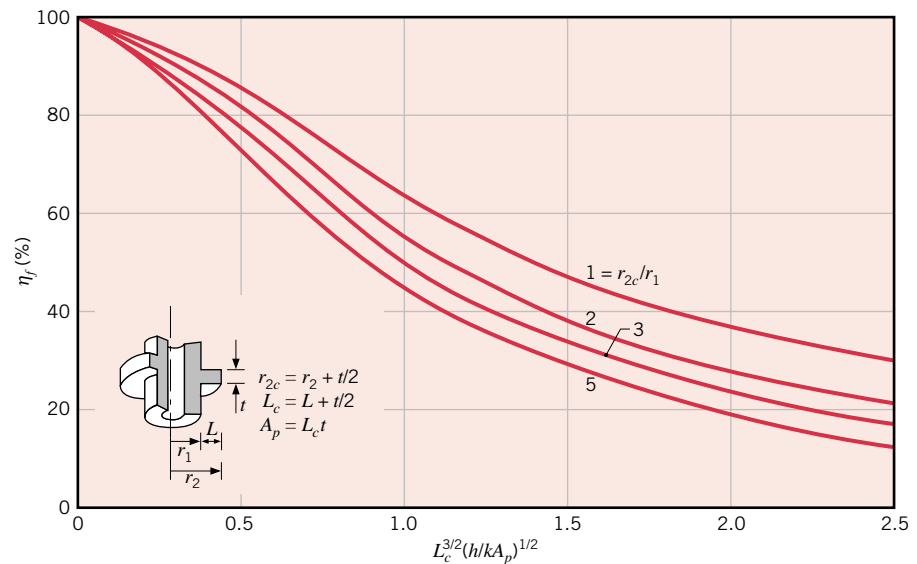

**FIGURE 3.19** Efficiency of annular fins of rectangular profile.

functions. As a special case, consider the annular fin shown in the inset of Figure 3.19. Although the fin thickness is uniform ( $t$  is independent of  $r$ ), the cross-sectional area,  $A_c = 2\pi r t$ , varies with  $r$ . Replacing  $x$  by  $r$  in Equation 3.61 and expressing the surface area as  $A_s = 2\pi(r^2 - r_1^2)$ , the general form of the fin equation reduces to

$$\frac{d^2 T}{dr^2} + \frac{1}{r} \frac{dT}{dr} - \frac{2h}{kt} (T - T_\infty) = 0$$

or, with  $m^2 \equiv 2h/kt$  and  $\theta \equiv T - T_\infty$ ,

$$\frac{d^2 \theta}{dr^2} + \frac{1}{r} \frac{d\theta}{dr} - m^2 \theta = 0$$

The foregoing expression is a *modified Bessel equation* of order zero, and its general solution is of the form

$$\theta(r) = C_1 I_0(mr) + C_2 K_0(mr)$$

where  $I_0$  and  $K_0$  are modified, zero-order Bessel functions of the first and second kinds, respectively. If the temperature at the base of the fin is prescribed,  $\theta(r_1) = \theta_b$ , and an adiabatic tip is presumed,  $d\theta/dr|_{r_2} = 0$ ,  $C_1$  and  $C_2$  may be evaluated to yield a temperature distribution of the form

$$\frac{\theta}{\theta_b} = \frac{I_0(mr)K_1(mr_2) + K_0(mr)I_1(mr_2)}{I_0(mr_1)K_1(mr_2) + K_0(mr_1)I_1(mr_2)}$$

where  $I_1(mr) = d[I_0(mr)]/d(mr)$  and  $K_1(mr) = -d[K_0(mr)]/d(mr)$  are modified, first-order Bessel functions of the first and second kinds, respectively. The Bessel functions are tabulated in Appendix B.

With the fin heat transfer rate expressed as

$$q_f = -kA_{c,b} \left. \frac{dT}{dr} \right|_{r=r_1} = -k(2\pi r_1 t) \left. \frac{d\theta}{dr} \right|_{r=r_1}$$

it follows that

$$q_f = 2\pi k r_1 t \theta_b m \frac{K_1(mr_1)I_1(mr_2) - I_1(mr_1)K_1(mr_2)}{K_0(mr_1)I_1(mr_2) + I_0(mr_1)K_1(mr_2)}$$

from which the fin efficiency becomes

$$\eta_f = \frac{q_f}{h2\pi(r_2^2 - r_1^2)\theta_b} = \frac{2r_1}{m(r_2^2 - r_1^2)} \frac{K_1(mr_1)I_1(mr_2) - I_1(mr_1)K_1(mr_2)}{K_0(mr_1)I_1(mr_2) + I_0(mr_1)K_1(mr_2)} \quad (3.91)$$

This result may be applied for an active (convecting) tip, if the tip radius  $r_2$  is replaced by a corrected radius of the form  $r_{2c} = r_2 + (t/2)$ . Results are represented graphically in Figure 3.19.

Knowledge of the thermal efficiency of a fin may be used to evaluate the fin resistance, where, from Equations 3.83 and 3.86, it follows that

$$R_{t,f} = \frac{1}{hA_f \eta_f} \quad (3.92)$$

Expressions for the efficiency and surface area of several common fin geometries are summarized in Table 3.5. Although results for the fins of uniform thickness or diameter were obtained by assuming an adiabatic tip, the effects of convection



**TABLE 3.5** Efficiency of common fin shapes


**Straight Fins**

*Rectangular<sup>a</sup>*

$$A_f = 2wL_c$$

$$L_c = L + (t/2)$$

$$A_p = tL$$




$$\eta_f = \frac{\tanh mL_c}{mL_c} \quad (3.89)$$

*Triangular<sup>a</sup>*

$$A_f = 2w[L^2 + (t/2)^2]^{1/2}$$

$$A_p = (t/2)L$$




$$\eta_f = \frac{1}{mL} \frac{I_1(2mL)}{I_0(2mL)} \quad (3.93)$$

*Parabolic<sup>a</sup>*

$$A_f = w[C_1L + (L^2/t)\ln(t/L + C_1)]$$

$$C_1 = [1 + (t/L)^2]^{1/2}$$

$$A_p = (t/3)L$$



$$\eta_f = \frac{2}{[4(mL)^2 + 1]^{1/2} + 1} \quad (3.94)$$


**Circular Fin**

*Rectangular<sup>a</sup>*

$$A_f = 2\pi(r_{2c}^2 - r_1^2)$$

$$r_{2c} = r_2 + (t/2)$$

$$V = \pi(r_{2c}^2 - r_1^2)t$$



$$\eta_f = C_2 \frac{K_1(mr_1)I_1(mr_{2c}) - I_1(mr_1)K_1(mr_{2c})}{I_0(mr_1)K_1(mr_{2c}) + K_0(mr_1)I_1(mr_{2c})} \quad (3.91)$$

$$C_2 = \frac{(2r_1/m)}{(r_{2c}^2 - r_1^2)}$$


**Pin Fins**

*Rectangular<sup>b</sup>*

$$A_f = \pi DL_c$$

$$L_c = L + (D/4)$$

$$V = (\pi D^2/4)L$$




$$\eta_f = \frac{\tanh mL_c}{mL_c} \quad (3.95)$$

*Triangular<sup>b</sup>*

$$A_f = \frac{\pi D}{2} [L^2 + (D/2)^2]^{1/2}$$

$$V = (\pi/12)D^2L$$



$$\eta_f = \frac{2}{mL} \frac{I_2(2mL)}{I_1(2mL)} \quad (3.96)$$

**TABLE 3.5** Continued

Parabolic<sup>b</sup>

$$A_f = \frac{\pi L^3}{8D} \left\{ C_3 C_4 - \frac{L}{2D} \ln [(2DC_4/L) + C_3] \right\}$$


$$C_3 = 1 + 2(D/L)^2$$

$$C_4 = [1 + (D/L)^2]^{1/2}$$

$$V = (\pi/20)D^2 L$$

$$^a m = (2h/kt)^{1/2}$$

$$^b m = (4h/kD)^{1/2}$$



$$\eta_f = \frac{2}{[4/9(mL)^2 + 1]^{1/2} + 1} \quad (3.97)$$

may be treated by using a corrected length (Equations 3.89 and 3.95) or radius (Equation 3.91). The triangular and parabolic fins are of nonuniform thickness, which reduces to zero at the fin tip.

Expressions for the profile area,  $A_p$ , or the volume,  $V$ , of a fin are also provided in Table 3.5. The volume of a straight fin is simply the product of its width and profile area,  $V = wA_p$ .

Fin design is often motivated by a desire to minimize the fin material and/or related manufacturing costs required to achieve a prescribed cooling effectiveness. Hence, a straight *triangular* fin is attractive because, for equivalent heat transfer, it requires much less volume (fin material) than a rectangular profile. In this regard, heat dissipation per unit volume,  $(q/V)_f$ , is largest for a *parabolic* profile. However, since  $(q/V)_f$  for the parabolic profile is only slightly larger than that for a triangular profile, its use can rarely be justified in view of its larger manufacturing costs. The *annular* fin of rectangular profile is commonly used to enhance heat transfer to or from circular tubes.

### 3.6.5 Overall Surface Efficiency


In contrast to the fin efficiency  $\eta_f$ , which characterizes the performance of a single fin, the *overall surface efficiency*  $\eta_o$  characterizes an *array* of fins and the base surface to which they are attached. Representative arrays are shown in Figure 3.20, where  $S$  designates the fin pitch. In each case the overall efficiency is defined as

$$\eta_o = \frac{q_t}{q_{\max}} = \frac{q_t}{hA_t\theta_b} \quad (3.98)$$

where  $q_t$  is the total heat rate from the surface area  $A_t$  associated with both the fins and the exposed portion of the base (often termed the *prime* surface). If there are  $N$  fins in the array, each of surface area  $A_f$ , and the area of the prime surface is designated as  $A_b$ , the total surface area is

$$A_t = NA_f + A_b \quad (3.99)$$

The maximum possible heat rate would result if the entire fin surface, as well as the exposed base, were maintained at  $T_h$ .

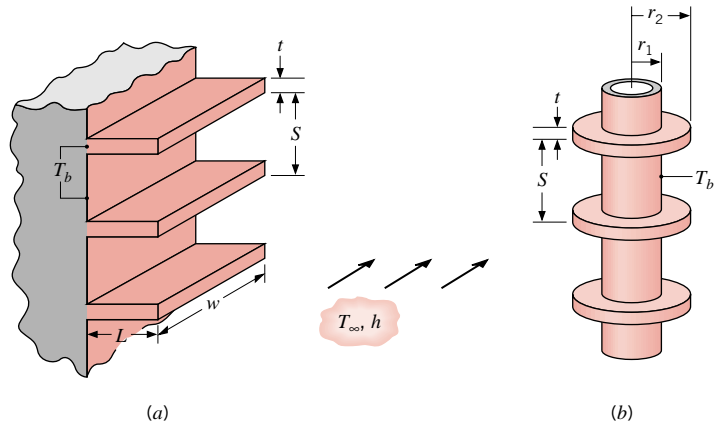

**FIGURE 3.20** Representative fin arrays. (a) Rectangular fins. (b) Annular fins.

The total rate of heat transfer by convection from the fins and the prime (unfinned) surface may be expressed as

$$q_t = N\eta_f h A_f \theta_b + h A_b \theta_b \quad (3.100)$$

where the convection coefficient  $h$  is assumed to be equivalent for the finned and prime surfaces and  $\eta_f$  is the efficiency of a single fin. Hence

$$q_t = h[N\eta_f A_f + (A_t - N A_f)]\theta_b = h A_t \left[ 1 - \frac{N A_f}{A_t} (1 - \eta_f) \right] \theta_b \quad (3.101)$$

Substituting Equation (3.101) into (3.98), it follows that

$$\eta_o = 1 - \frac{N A_f}{A_t} (1 - \eta_f) \quad (3.102)$$


From knowledge of  $\eta_o$ , Equation 3.98 may be used to calculate the total heat rate for a fin array.

Recalling the definition of the fin thermal resistance, Equation 3.83, Equation 3.98 may be used to infer an expression for the thermal resistance of a fin array. That is,

$$R_{t,o} = \frac{\theta_b}{q_t} = \frac{1}{\eta_o h A_t} \quad (3.103)$$

where  $R_{t,o}$  is an effective resistance that accounts for parallel heat flow paths by conduction/convection in the fins and by convection from the prime surface. Figure 3.21 illustrates the thermal circuits corresponding to the parallel paths and their representation in terms of an effective resistance.

If fins are machined as an integral part of the wall from which they extend (Figure 3.21a), there is no contact resistance at their base. However, more commonly, fins are manufactured separately and are attached to the wall by a metallurgical or adhesive joint. Alternatively, the attachment may involve a *press fit*, for which the

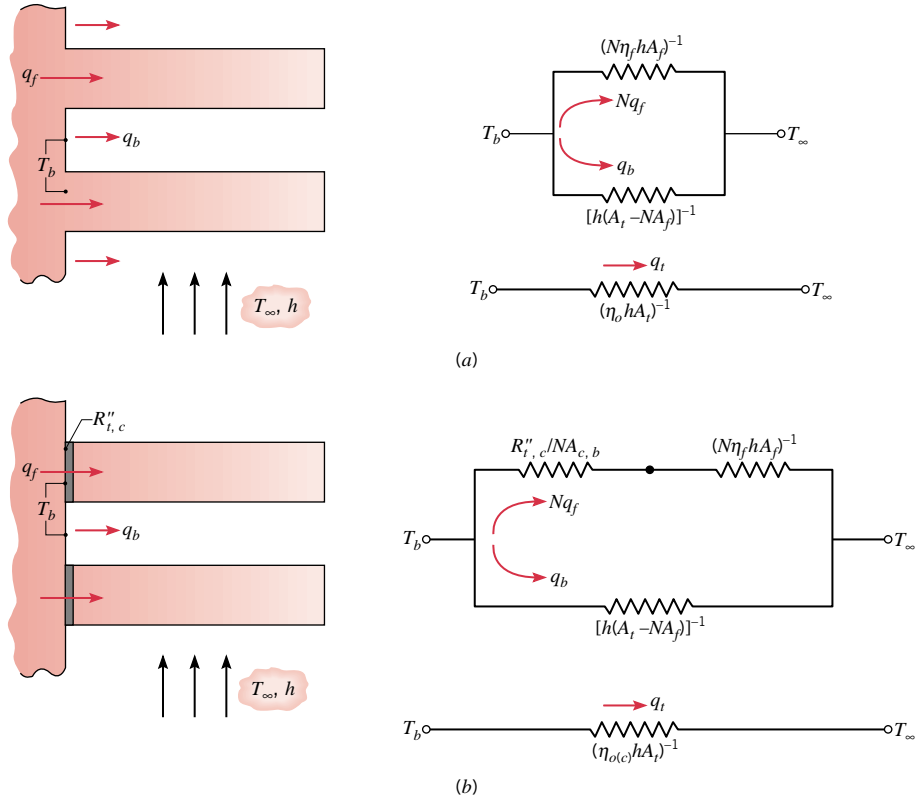

**FIGURE 3.21** Fin array and thermal circuit. (a) Fins that are integral with the base. (b) Fins that are attached to the base.

fins are forced into slots machined on the wall material. In such cases (Figure 3.21b), there is a thermal contact resistance,  $R_{t,c}$ , which may adversely influence overall thermal performance. An effective circuit resistance may again be obtained, where, with the contact resistance,

$$R_{t,o(c)} = \frac{\theta_b}{q_t} = \frac{1}{\eta_{o(c)} h A_t} \quad (3.104)$$

It is readily shown that the corresponding overall surface efficiency is

$$\eta_{o(c)} = 1 - \frac{NA_f}{A_t} \left( 1 - \frac{\eta_f}{C_1} \right) \quad (3.105a)$$

where

$$C_1 = 1 + \eta_f h A_f (R_{t,c}''/A_{c,b}) \quad (3.105b)$$

In manufacturing, care must be taken to render  $R_{t,c} \ll R_{t,f}$ .

**EXAMPLE 3.10**


The engine cylinder of a motorcycle is constructed of 2024-T6 aluminum alloy and is of height  $H = 0.15$  m and outside diameter  $D = 50$  mm. Under typical operating conditions the outer surface of the cylinder is at a temperature of 500 K and is exposed to ambient air at 300 K, with a convection coefficient of  $50 \text{ W/m}^2 \cdot \text{K}$ . Annular fins are integrally cast with the cylinder to increase heat transfer to the surroundings. Consider five such fins, which are of thickness  $t = 6$  mm, length  $L = 20$  mm, and equally spaced. What is the increase in heat transfer due to use of the fins?

**SOLUTION**

**Known:** Operating conditions of a finned motorcycle cylinder.

**Find:** Increase in heat transfer associated with using fins.

**Schematic:**

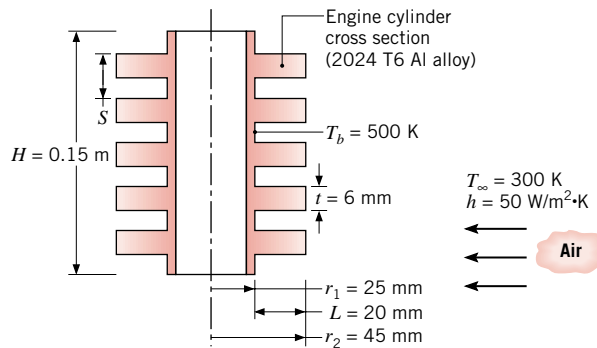

**Assumptions:**

1. Steady-state conditions.
2. One-dimensional radial conduction in fins.
3. Constant properties.
4. Negligible radiation exchange with surroundings.
5. Uniform convection coefficient over outer surface (with or without fins).

**Properties:** Table A.1, 2024-T6 aluminum ( $T = 400 \text{ K}$ ):  $k = 186 \text{ W/m} \cdot \text{K}$ .

**Analysis:** With the fins in place, the heat transfer rate is given by Equation 3.101

$$q_t = hA_t \left[ 1 - \frac{NA_f}{A_t} (1 - \eta_f) \right] \theta_b$$

where  $A_f = 2\pi(r_2^2 - r_1^2) = 2\pi[(0.048 \text{ m})^2 - (0.025 \text{ m})^2] = 0.0105 \text{ m}^2$  and, from Equation 3.99,  $A_t = NA_f + 2\pi r_1(H - Nt) = 0.0527 \text{ m}^2 + 2\pi(0.025 \text{ m}) [0.15 \text{ m} - 0.03 \text{ m}] = 0.0716 \text{ m}^2$ . With  $r_2/r_1 = 1.92$ ,  $L_c = 0.023 \text{ m}$ ,  $A_p = 1.380 \times 10^{-4} \text{ m}^2$ , we obtain  $L_c^{3/2}(h/kA_p)^{1/2} = 0.15$ . Hence, from Figure 3.19, the fin efficiency is  $\eta_f \approx 0.95$ .

With the fins, the total heat transfer rate is then

$$q_t = 50 \text{ W/m}^2 \cdot \text{K} \times 0.0716 \text{ m}^2 \left[ 1 - \frac{0.0527 \text{ m}^2}{0.0716 \text{ m}^2} (0.05) \right] 200 \text{ K} = 690 \text{ W}$$

Without the fins, the convection heat transfer rate would be

$$q_{wo} = h(2\pi r_1 H)\theta_b = 50 \text{ W/m}^2 \cdot \text{K} (2\pi \times 0.025 \text{ m} \times 0.15 \text{ m}) 200 \text{ K} = 236 \text{ W}$$


Hence

$$\Delta q = q_t - q_{wo} = 454 \text{ W}$$




**Comments:**

1. Although the fins significantly increase heat transfer from the cylinder, considerable improvement could still be obtained by increasing the number of fins. We assess this possibility by computing  $q_t$  as a function of  $N$ , first by fixing the fin thickness at  $t = 6 \text{ mm}$  and increasing the number of fins by reducing the spacing between fins. Prescribing a fin clearance of  $2 \text{ mm}$  at each end of the array and a minimum fin gap of  $4 \text{ mm}$ , the maximum allowable number of fins is  $N = H/S = 0.15 \text{ m}/(0.004 + 0.006) \text{ m} = 15$ . The parametric calculations yield the following variation of  $q_t$  with  $N$ :

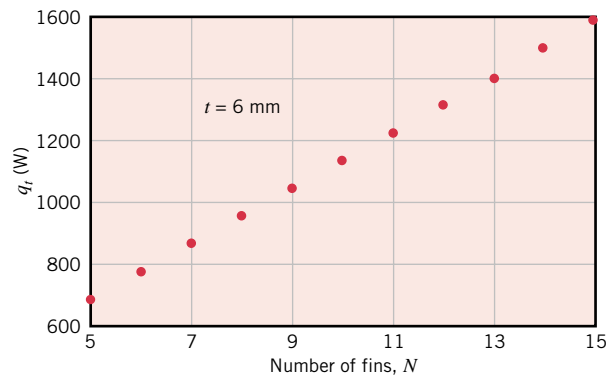

The number of fins could also be increased by reducing the fin thickness. If the fin gap is fixed at  $(S - t) = 4 \text{ mm}$  and manufacturing constraints dictate a minimum allowable fin thickness of  $2 \text{ mm}$ , up to  $N = 25$  fins may be accommodated. In this case the parametric calculations yield

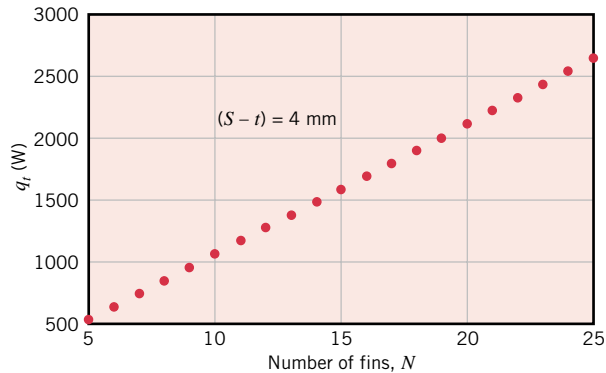


The foregoing calculations are based on the assumption that  $h$  is not affected by a reduction in the fin gap. The assumption is reasonable as long as there is no interaction between boundary layers that develop on the opposing surfaces of adjoining fins. Note that, since  $NA_f \gg 2\pi r_1(H - Nt)$  for the prescribed conditions,  $q_t$  increases nearly linearly with increasing  $N$ .

2. The *Models/Extended Surfaces* option of *IHT* provides ready-to-solve models for straight, pin, and circular fins, as well as for fin arrays. The models include the efficiency relations of Figures 3.18 and 3.19 and Table 3.5.

### EXAMPLE 3.11

In Example 1.4, we saw that to generate an electrical power of  $P = 9$  W, the temperature of the PEM fuel cell had to be maintained at  $T_c \approx 56.4^\circ\text{C}$ , which required removal of 11.25 W from the fuel cell and a cooling air velocity of  $V = 9.4$  m/s for  $T_\infty = 25^\circ\text{C}$ . To provide these convective conditions, the fuel cell is centered in a  $50\text{ mm} \times 26\text{ mm}$  rectangular duct, with 10-mm gaps between the exterior of the  $50\text{ mm} \times 50\text{ mm} \times 6\text{ mm}$  fuel cell and the top and bottom of the well-insulated duct wall. A small fan, powered by the fuel cell, is used to circulate the cooling air. Inspection of a particular fan vendor's data sheets suggests that the ratio of the fan power consumption to the fan's volumetric flow rate is  $P_f/\dot{V}_f = C = 1000\text{ W}/(\text{m}^3/\text{s})$  for the range  $10^{-4} \leq \dot{V}_f \leq 10^{-2}\text{ m}^3/\text{s}$ .

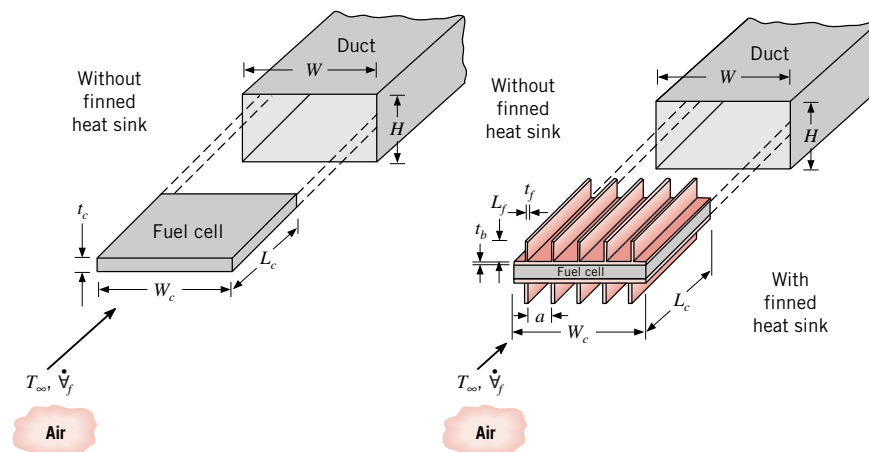

1. Determine the *net* electric power produced by the fuel cell–fan system,  $P_{\text{net}} = P - P_f$ .
2. Consider the effect of attaching an aluminum ( $k = 200\text{ W/m} \cdot \text{K}$ ) *finned heat sink*, of identical top and bottom sections, onto the fuel cell body. The contact joint has a thermal resistance of  $R''_{t,c} = 10^{-3}\text{ m}^2 \cdot \text{K/W}$ , and the base of the heat sink is of thickness  $t_b = 2\text{ mm}$ . Each of the  $N$  rectangular fins is of length  $L_f = 8\text{ mm}$  and thickness  $t_f = 1\text{ mm}$ , and spans the entire length of the fuel cell,  $L_c = 50\text{ mm}$ . With the heat sink in place, radiation losses are negligible and the convective heat transfer coefficient may be related to the size and geometry of a

typical air channel by an expression of the form  $h = 1.78 k_{\text{air}} (L_f + a)/(L_f \cdot a)$ , where  $a$  is the distance between fins. Draw an equivalent thermal circuit for part 2 and determine the total number of fins needed to reduce the fan power consumption to half of the value found in part 1.


### SOLUTION

**Known:** Dimensions of a fuel cell and finned heat sink, fuel cell operating temperature, rate of thermal energy generation, power production. Relationship between power consumed by a cooling fan and the fan air flow rate. Relationship between the convection coefficient and the air channel dimensions.

### Find:

1. The net power produced by the fuel cell–fan system when there is no heat sink.
2. The number of fins needed to reduce the fan power consumption found in part 1 by 50%.

### Schematic:

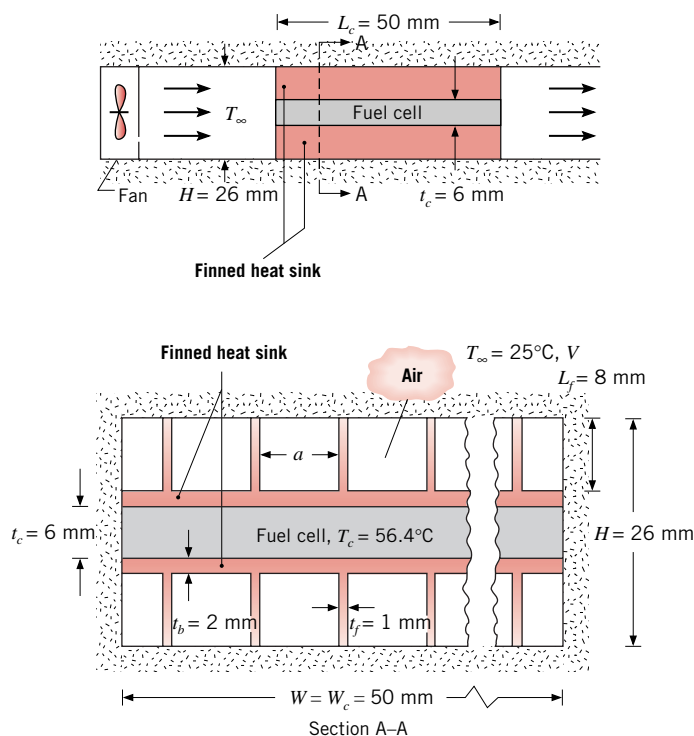

### Assumptions:

1. Steady-state conditions.
2. Negligible heat transfer from the edges of the fuel cell, as well as from the front and back faces of the finned heat sink.
3. One-dimensional heat transfer through the heat sink.



4. Adiabatic fin tips.
5. Constant properties.
6. Negligible radiation when the heat sink is in place.

**Properties:** Table A.4, air ( $\bar{T} = 300$  K):  $k_{\text{air}} = 0.0263$  W/m · K,  $c_p = 1007$  J/kg · K,  $\rho = 1.1614$  kg/m<sup>3</sup>.

**Analysis:**

1. The volumetric flow rate of cooling air is  $\dot{V}_f = VA_c$ , where  $A_c = W(H - t_c)$  is the cross-sectional area of the flow region between the duct walls and the unfinned fuel cell. Therefore,


$$\begin{aligned}\dot{V}_f &= V[W(H - t_c)] = 9.4 \text{ m/s} \times [0.05 \text{ m} \times (0.026 \text{ m} - 0.006 \text{ m})] \\ &= 9.4 \times 10^{-3} \text{ m}^3/\text{s}\end{aligned}$$

and

$$P_{\text{net}} = P - C\dot{V}_f = 9.0 \text{ W} - 1000 \text{ W}/(\text{m}^3/\text{s}) \times 9.4 \times 10^{-3} \text{ m}^3/\text{s} = -0.4 \text{ W} \quad \triangleleft$$

With this arrangement, the fan consumes more power than is generated by the fuel cell, and the system cannot produce net power.

2. To reduce the fan power consumption by 50%, the volumetric flow rate of air must be reduced to  $\dot{V}_f = 4.7 \times 10^{-3} \text{ m}^3/\text{s}$ . The thermal circuit includes resistances for the contact joint, conduction through the base of the finned heat sink, and resistances for the exposed base of the finned side of the heat sink, as well as the fins.

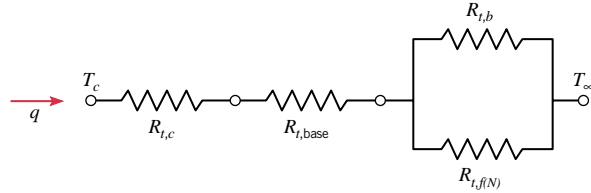

The thermal resistances for the contact joint and the base are

$$R_{t,c} = R''_{t,c}/2L_cW_c = (10^{-3} \text{ m}^2 \cdot \text{K}/\text{W})/(2 \times 0.05 \text{ m} \times 0.05 \text{ m}) = 0.2 \text{ K}/\text{W}$$

and

$$\begin{aligned}R_{t,base} &= t_b/(2kL_cW_c) = (0.002 \text{ m})/(2 \times 200 \text{ W}/\text{m} \cdot \text{K} \times 0.05 \text{ m} \times 0.05 \text{ m}) \\ &= 0.002 \text{ K}/\text{W}\end{aligned}$$

where the factors of two account for the two sides of the heat sink assembly. For the portion of the base exposed to the cooling air, the thermal resistance is

$$R_{t,b} = 1/[h(2W_c - Nt_f)L_c] = 1/[h \times (2 \times 0.05 \text{ m} - N \times 0.001 \text{ m}) \times 0.05 \text{ m}]$$

which cannot be evaluated until the total number of fins on both sides,  $N$ , and  $h$  are determined.

For a single fin,  $R_{t,f} = \theta_b/q_f$ , where, from Table 3.4 for a fin with an insulated fin tip,  $R_{t,f} = (hPkA_c)^{-1/2}/\tanh(mL_f)$ . In our case,  $P = 2(L_c + t_f) = 2 \times (0.05 \text{ m} + 0.001 \text{ m}) = 0.102 \text{ m}$ ,  $A_c = L_c t_f = 0.05 \text{ m} \times 0.001 \text{ m} = 0.00005 \text{ m}^2$ , and

$$m = \sqrt{hP/kA_c} = [h \times 0.102 \text{ m}/(200 \text{ W}/\text{m} \cdot \text{K} \times 0.00005 \text{ m}^2)]^{1/2}$$

Hence,

$$R_{t,f} = \frac{(h \times 0.102 \text{ m} \times 200 \text{ W/m} \cdot \text{K} \times 0.00005 \text{ m}^2)^{-1/2}}{\tanh(m \times 0.008 \text{ m})}$$

and for  $N$  fins,  $R_{t,ff(N)} = R_{t,f}/N$ . As for  $R_{t,b}$ ,  $R_{t,f}$  cannot be evaluated until  $h$  and  $N$  are determined. Also,  $h$  depends on  $a$ , the distance between fins, which in turn depends on  $N$ , according to  $a = (2W_c - Nt_f)/N = (2 \times 0.05 \text{ m} - N \times 0.001 \text{ m})/N$ . Thus, specification of  $N$  will make it possible to calculate all resistances. From the thermal resistance network, the total thermal resistance is  $R_{\text{tot}} = R_{t,c} + R_{t,\text{base}} + R_{\text{equiv}}$ , where  $R_{\text{equiv}} = [R_{t,b}^{-1} + R_{t,ff(N)}^{-1}]^{-1}$ .

The equivalent fin resistance,  $R_{\text{equiv}}$ , corresponding to the desired fuel cell temperature is found from the expression

$$q = \frac{T_c - T_\infty}{R_{\text{tot}}} = \frac{T_c - T_\infty}{R_{t,c} + R_{t,\text{base}} + R_{\text{equiv}}}$$

in which case,

$$\begin{aligned} R_{\text{equiv}} &= \frac{T_c - T_\infty}{q} - (R_{t,c} + R_{t,\text{base}}) \\ &= (56.4^\circ\text{C} - 25^\circ\text{C})/11.25 \text{ W} - (0.2 + 0.002) \text{ K/W} = 2.59 \text{ K/W} \end{aligned}$$

For  $N = 22$ , the following values of the various parameters are obtained:  $a = 0.0035 \text{ m}$ ,  $h = 19.1 \text{ W/m}^2 \cdot \text{K}$ ,  $m = 13.9 \text{ m}^{-1}$ ,  $R_{t,ff(N)} = 2.94 \text{ K/W}$ ,  $R_{t,b} = 13.5 \text{ K/W}$ ,  $R_{\text{equiv}} = 2.41 \text{ K/W}$ , and  $R_{\text{tot}} = 2.61 \text{ K/W}$ , resulting in a fuel cell temperature of  $54.4^\circ\text{C}$ . Fuel cell temperatures associated with  $N = 20$  and  $N = 24$  fins are  $T_c = 58.9^\circ\text{C}$  and  $50.7^\circ\text{C}$ , respectively.

The actual fuel cell temperature is closest to the desired value when  $N = 22$ . Therefore, a total of 22 fins, 11 on top and 11 on the bottom, should be specified, resulting in

$$P_{\text{net}} = P - P_f = 9.0 \text{ W} - 4.7 \text{ W} = 4.3 \text{ W} \quad \triangleleft$$

### Comments:

1. The performance of the fuel cell–fan system is enhanced significantly by combining the finned heat sink with the fuel cell. Good thermal management can transform an impractical proposal into a viable concept.
2. The temperature of the cooling air increases as heat is transferred from the fuel cell. The temperature of the air leaving the finned heat sink may be calculated from an overall energy balance on the air flow, which yields  $T_o = T_i + q/(\rho c_p \dot{V}_p)$ . For part 1,  $T_o = 25^\circ\text{C} + 10.28 \text{ W}/(1.1614 \text{ kg/m}^3 \times 1007 \text{ J/kg} \cdot \text{K} \times 9.4 \times 10^{-3} \text{ m}^3/\text{s}) = 25.9^\circ\text{C}$ . For part 2, the outlet air temperature is  $T_o = 27.0^\circ\text{C}$ . Hence, the operating temperature of the fuel cell will be slightly higher than predicted under the assumption that the cooling air temperature is constant at  $25^\circ\text{C}$  and will be closer to the desired value.
3. For the conditions in part 2, the convection heat transfer coefficient does not vary with the air velocity. The insensitivity of the value of  $h$  to the fluid velocity occurs frequently in cases where the flow is confined within passages of small cross-sectional area, as will be discussed in detail in Chapter 8. The fin's influence on increasing or reducing the value of  $h$  relative to that of an unfinned surface should be taken into account in critical applications.

4. A more detailed analysis of the system would involve prediction of the pressure drop associated with the fan-induced flow of air through the gaps between the fins.
5. The adiabatic fin tip assumption is valid since the duct wall is well insulated.

### 3.7

#### The Bioheat Equation

The topic of heat transfer within the human body is becoming increasingly important as new medical treatments are developed that involve extreme temperatures [11] and as we explore more adverse environments, such as the Arctic, underwater, or space. There are two main phenomena that make heat transfer in living tissues more complex than in conventional engineering materials: metabolic heat generation and the exchange of thermal energy between flowing blood and the surrounding tissue. Pennes [12] introduced a modification to the heat equation, now known as the Pennes or bioheat equation, to account for these effects. The bioheat equation is known to have limitations, but it continues to be a useful tool for understanding heat transfer in living tissues. In this section, we present a simplified version of the bioheat equation for the case of steady-state, one-dimensional heat transfer.

Both the metabolic heat generation and exchange of thermal energy with the blood can be viewed as effects of thermal energy generation. Therefore, we can rewrite Equation 3.39 to account for these two heat sources as

$$\frac{d^2T}{dx^2} + \frac{\dot{q}_m + \dot{q}_p}{k} = 0 \quad (3.106)$$

where  $\dot{q}_m$  and  $\dot{q}_p$  are the *metabolic* and *perfusion* heat source terms, respectively. The perfusion term accounts for energy exchange between the blood and the tissue and is an energy source or sink according to whether heat transfer is from or to the blood, respectively. The thermal conductivity has been assumed constant in writing Equation 3.106.

Pennes proposed an expression for the perfusion term by assuming that within any small volume of tissue, the blood flowing in the small capillaries enters at an arterial temperature,  $T_a$ , and exits at the local tissue temperature,  $T$ . The rate at which heat is gained by the tissue is the rate at which heat is lost from the blood. If the perfusion rate is  $\omega$  ( $\text{m}^3/\text{s}$  of volumetric blood flow per  $\text{m}^3$  of tissue), the heat lost from the blood can be calculated from Equation 1.11e, or, on a unit volume basis,

$$\dot{q}_p = \omega \rho_b c_b (T_a - T) \quad (3.107)$$

where  $\rho_b$  and  $c_b$  are the blood density and specific heat, respectively. Note that  $\omega \rho_b$  is the blood mass flow rate per unit volume of tissue.

Substituting Equation 3.107 into Equation 3.106, we find

$$\frac{d^2T}{dx^2} + \frac{\dot{q}_m + \omega \rho_b c_b (T_a - T)}{k} = 0 \quad (3.108)$$

Drawing on our experience with extended surfaces, it is convenient to define an excess temperature of the form  $\theta \equiv T - T_a - \dot{q}_m / \omega \rho_b c_b$ . Then, if we assume that  $T_a$ ,  $\dot{q}_m$ ,  $\omega$ , and the blood properties are all constant, Equation 3.108 can be rewritten as

$$\frac{d^2\theta}{dx^2} - \tilde{m}^2\theta = 0 \quad (3.109)$$

where  $\tilde{m}^2 = \omega \rho_b c_b / k$ . This equation is identical in form to Equation 3.64. Depending on the form of the boundary conditions, it may therefore be possible to use the results of Table 3.4 to estimate the temperature distribution within the living tissue.

### EXAMPLE 3.12


In Example 1.6, the temperature at the inner surface of the skin/fat layer was given as 35°C. In reality, this temperature depends on the existing heat transfer conditions, including phenomena occurring farther inside the body. Consider a region of muscle with a skin/fat layer over it. At a depth of  $L_m = 30$  mm into the muscle, the temperature can be assumed to be at the core body temperature of  $T_c = 37^\circ\text{C}$ . The muscle thermal conductivity is  $k_m = 0.5$  W/m · K. The metabolic heat generation rate within the muscle is  $\dot{q}_m = 700$  W/m<sup>3</sup>. The perfusion rate is  $\omega = 0.0005$  s<sup>-1</sup>; the blood density and specific heat are  $\rho_b = 1000$  kg/m<sup>3</sup> and  $c_b = 3600$  J/kg · K, respectively, and the arterial blood temperature,  $T_a$ , is the same as the core body temperature. The thickness, emissivity, and thermal conductivity of the skin/fat layer are as given in Example 1.6; perfusion and metabolic heat generation within this layer can be neglected. We wish to predict the heat loss rate from the body and the temperature at the inner surface of the skin/fat layer for air and water environments of Example 1.6.

### SOLUTION

**Known:** Dimensions and thermal conductivities of a muscle layer and a skin/fat layer. Skin emissivity and surface area. Metabolic heat generation rate and perfusion rate within the muscle layer. Core body and arterial temperatures. Blood density and specific heat. Ambient conditions.

**Find:** Heat loss rate from body and temperature at inner surface of the skin/fat layer.

### Schematic:

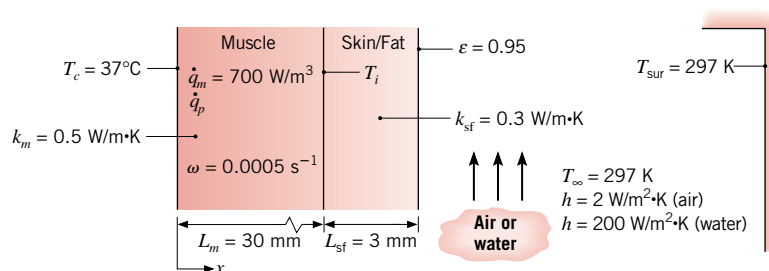

**Assumptions:**

1. Steady-state conditions.
2. One dimensional heat transfer through the muscle and skin/fat layers.
3. Metabolic heat generation rate, perfusion rate, arterial temperature, blood properties, and thermal conductivities are all uniform.
4. Radiation heat transfer coefficient is known from Example 1.6.
5. Solar irradiation is negligible.

**Analysis:** We will combine an analysis of the muscle layer with a treatment of heat transfer through the skin/fat layer and into the environment. The rate of heat transfer through the skin/fat layer and into the environment can be expressed in terms of a total resistance,  $R_{\text{tot}}$ , as

$$q = \frac{T_i - T_\infty}{R_{\text{tot}}} \quad (1)$$

As in Example 3.1 and for exposure of the skin to the air,  $R_{\text{tot}}$  accounts for conduction through the skin/fat layer in series with heat transfer by convection and radiation, which act in parallel with each other. Thus,

$$R_{\text{tot}} = \frac{L_{\text{sf}}}{k_{\text{sf}}A} + \left( \frac{1}{1/hA} + \frac{1}{1/h_rA} \right)^{-1} = \frac{1}{A} \left( \frac{L_{\text{sf}}}{k_{\text{sf}}} + \frac{1}{h + h_r} \right)$$

Using the values from Example 1.6 for air,

$$R_{\text{tot}} = \frac{1}{1.8 \text{ m}^2} \left( \frac{0.003 \text{ m}}{0.3 \text{ W/m} \cdot \text{K}} + \frac{1}{(2 + 5.9) \text{ W/m}^2 \cdot \text{K}} \right) = 0.076 \text{ K/W}$$

For water, with  $h_r = 0$  and  $h = 200 \text{ W/m}^2 \cdot \text{K}$ ,  $R_{\text{tot}} = 0.0083 \text{ W/m}^2 \cdot \text{K}$ .

Heat transfer in the muscle layer is governed by Equation 3.109. The boundary conditions are specified in terms of the temperatures,  $T_c$  and  $T_i$ , where  $T_i$  is, as yet, unknown. In terms of the excess temperature  $\theta$ , the boundary conditions are then

$$\theta(0) = T_c - T_a - \frac{\dot{q}_m}{\omega \rho_b c_b} = \theta_c \quad \text{and} \quad \theta(L_m) = T_i - T_a - \frac{\dot{q}_m}{\omega \rho_b c_b} = \theta_i$$

Since we have two boundary conditions involving prescribed temperatures, the solution for  $\theta$  is given by case C of Table 3.4,

$$\frac{\theta}{\theta_c} = \frac{(\theta_i/\theta_c) \sinh \tilde{m}x + \sinh \tilde{m}(L_m - x)}{\sinh \tilde{m}L_m}$$

The value of  $q_f$  given in Table 3.4 would correspond to the heat transfer rate at  $x = 0$ , but this is not of particular interest here. Rather, we seek the rate at which heat leaves the muscle and enters the skin/fat layer so that we can equate this quantity with the rate at which heat is transferred through the skin/fat layer and into the environment. Therefore, we calculate the heat transfer rate at  $x = L_m$  as

$$q \Big|_{x=L_m} = -k_m A \frac{dT}{dx} \Big|_{x=L_m} = -k_m A \frac{d\theta}{dx} \Big|_{x=L_m} = -k_m A \tilde{m} \theta_c \frac{(\theta_i/\theta_c) \cosh \tilde{m}L_m - 1}{\sinh \tilde{m}L_m} \quad (2)$$

Combining Equations 1 and 2 yields

$$-k_m A \tilde{m} \theta_c \frac{(\theta_i/\theta_c) \cosh \tilde{m} L_m - 1}{\sinh \tilde{m} L_m} = \frac{T_i - T_\infty}{R_{\text{tot}}}$$

This expression can be solved for  $T_i$ , recalling that  $T_i$  also appears in  $\theta_i$ .

$$T_i = \frac{T_\infty \sinh \tilde{m} L_m + k_m A \tilde{m} R_{\text{tot}} \left[ \theta_c + \left( T_a + \frac{\dot{q}_m}{\omega \rho_b c_b} \right) \cosh \tilde{m} L_m \right]}{\sinh \tilde{m} L_m + k_m A \tilde{m} R_{\text{tot}} \cosh \tilde{m} L_m}$$

where

$$\begin{aligned} \tilde{m} &= \sqrt{\omega \rho_b c_b / k_m} = [0.0005 \text{ s}^{-1} \times 1000 \text{ kg/m}^3 \times 3600 \text{ J/kg} \cdot \text{K} / 0.5 \text{ W/m} \cdot \text{K}]^{1/2} \\ &= 60 \text{ m}^{-1} \end{aligned}$$

$$\sinh(\tilde{m} L_m) = \sinh(60 \text{ m}^{-1} \times 0.03 \text{ m}) = 2.94 \quad \text{and}$$

$$\cosh(\tilde{m} L_m) = \cosh(60 \text{ m}^{-1} \times 0.03 \text{ m}) = 3.11$$

$$\begin{aligned} \theta_c &= T_c - T_a - \frac{\dot{q}_m}{\omega \rho_b c_b} = -\frac{\dot{q}_m}{\omega \rho_b c_b} = -\frac{700 \text{ W/m}^3}{0.0005 \text{ s}^{-1} \times 1000 \text{ kg/m}^3 \times 3600 \text{ J/kg} \cdot \text{K}} \\ &= -0.389 \text{ K} \end{aligned}$$

The excess temperature can be expressed in kelvins or degrees Celsius, since it is a temperature difference.

Thus, for air:

$$T_i = \frac{\{24^\circ\text{C} \times 2.94 + 0.5 \text{ W/m} \cdot \text{K} \times 1.8 \text{ m}^2 \times 60 \text{ m}^{-1} \times 0.076 \text{ K/W} [-0.389^\circ\text{C} + (37^\circ\text{C} + 0.389^\circ\text{C}) \times 3.11]\}}{2.94 + 0.5 \text{ W/m} \cdot \text{K} \times 1.8 \text{ m}^2 \times 60 \text{ m}^{-1} \times 0.076 \text{ K/W} \times 3.11} = 34.8^\circ\text{C} \quad \triangleleft$$

This result agrees well with the value of  $35^\circ\text{C}$  that was assumed for Example 1.6. Next we can find the heat loss rate:

$$q = \frac{T_i - T_\infty}{R_{\text{tot}}} = \frac{34.8^\circ\text{C} - 24^\circ\text{C}}{0.076 \text{ K/W}} = 142 \text{ W} \quad \triangleleft$$

Again this agrees well with the previous result. Repeating the calculation for water, we find

$$T_i = 28.2^\circ\text{C} \quad \triangleleft$$


$$q = 514 \text{ W} \quad \triangleleft$$

Here the calculation of Example 1.6 was not accurate because it incorrectly assumed that the inside of the skin/fat layer would be at  $35^\circ\text{C}$ . Furthermore, the skin temperature in this case would be only  $25.4^\circ\text{C}$  based on this more complete calculation.

### Comments:

1. In reality, our bodies adjust in many ways to the thermal environment. For example, if we are too cold, we will shiver, which increases our metabolic heat generation rate. If we are too warm, the perfusion rate near the skin surface will increase, locally raising the skin temperature to increase heat loss to the environment.

2. Measuring the true thermal conductivity of living tissue is very challenging, first because of the necessity of making *invasive* measurements in a living being, and second because it is difficult to experimentally separate the effects of heat conduction and perfusion. It is easier to measure an effective thermal conductivity that would account for the combined contributions of conduction and perfusion. However, this effective conductivity value necessarily depends on the perfusion rate, which in turn varies with the thermal environment and physical condition of the specimen.
3. The calculations can be repeated for a range of values of the perfusion rate, and the dependence of the heat loss rate on the perfusion rate is illustrated below. The effect is stronger for the case of the water environment, because the muscle temperature is lower and therefore the effect of perfusion by the warm arterial blood is more pronounced.

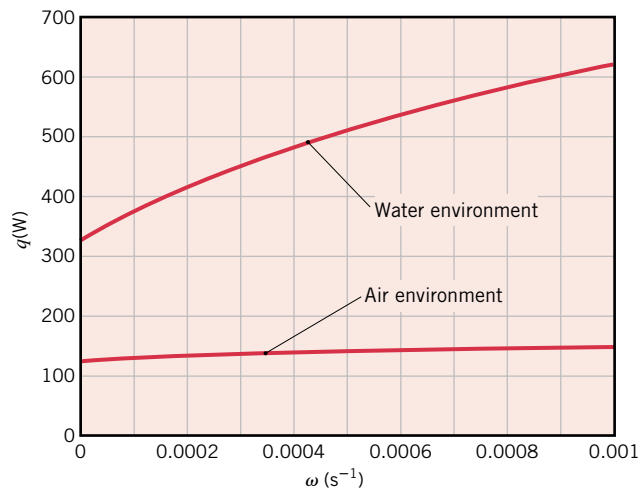

### 3.8

#### Summary

Despite its inherent mathematical simplicity, one-dimensional, steady-state heat transfer occurs in numerous engineering applications. Although one-dimensional, steady-state conditions may not apply exactly, the assumptions may often be made to obtain results of reasonable accuracy. You should therefore be thoroughly familiar with the means by which such problems are treated. In particular, you should be comfortable with the use of equivalent thermal circuits and with the expressions for the conduction resistances that pertain to each of the three common geometries. You should also be familiar with how the heat equation and Fourier's law may be used to obtain temperature distributions and the corresponding fluxes. The implications of an internally distributed source of energy should also be clearly understood. Finally, you should appreciate the important role

that extended surfaces can play in the design of thermal systems and should have the facility to effect design and performance calculations for such surfaces.

You may test your understanding of this chapter's key concepts by addressing the following questions.

- Under what conditions may it be said that the *heat flux* is a constant, independent of the direction of heat flow? For each of these conditions, use physical considerations to convince yourself that the heat flux would not be independent of direction if the condition were not satisfied.
- For one-dimensional, steady-state conduction in a cylindrical or spherical shell without heat generation, is the radial heat flux independent of radius? Is the radial heat rate independent of radius?
- For one-dimensional, steady-state conduction without heat generation, what is the shape of the temperature distribution in a *plane wall*? In a *cylindrical shell*? In a *spherical shell*?
- What is the *thermal resistance*? How is it defined? What are its units?
- For conduction across a *plane wall*, can you write the expression for the thermal resistance from memory? Similarly, can you write expressions for the thermal resistance associated with conduction across *cylindrical* and *spherical* shells? From memory, can you express the thermal resistances associated with convection from a surface and net radiation exchange between the surface and large surroundings?
- What is the physical basis for existence of a *critical insulation radius*? How do the thermal conductivity and the convection coefficient affect its value?
- How is the conduction resistance of a solid affected by its thermal conductivity? How is the convection resistance at a surface affected by the convection coefficient? How is the radiation resistance affected by the surface emissivity?
- If heat is transferred from a surface by convection and radiation, how are the corresponding thermal resistances represented in a circuit?
- Consider steady-state conduction through a plane wall separating fluids of different temperatures,  $T_{\infty,i}$  and  $T_{\infty,o}$ , adjoining the inner and outer surfaces, respectively. If the convection coefficient at the outer surface is five times larger than that at the inner surface,  $h_o = 5h_i$ , what can you say about relative proximity of the corresponding surface temperatures,  $T_{s,o}$  and  $T_{s,i}$ , to their adjoining fluid temperatures?
- Can a thermal conduction resistance be applied to a *solid* cylinder or sphere?
- What is a *contact resistance*? How is it defined? What are its units for an interface of prescribed area? What are they for a unit area?
- How is the contact resistance affected by the roughness of adjoining surfaces?
- If the air in the contact region between two surfaces is replaced by helium, how is the thermal contact resistance affected? How is it affected if the region is evacuated?
- What is the *overall heat transfer coefficient*? How is it defined and how is it related to the *total thermal resistance*? What are its units?
- In a solid circular cylinder experiencing uniform volumetric heating and convection heat transfer from its surface, how does the heat flux vary with radius? How does the heat rate vary with radius?
- In a solid circular sphere experiencing uniform volumetric heating and convection heat transfer from its surface, how does the heat flux vary with radius? How does the heat rate vary with radius?



- Is it possible to achieve steady-state conditions in a solid cylinder or sphere that is experiencing heat generation and whose surface is perfectly insulated? Explain.
- Can a material experiencing heat generation be represented by a thermal resistance and included in a circuit analysis? If so, why? If not, why not?
- What is the physical mechanism associated with cooking in a microwave oven? How do conditions differ from a conventional (convection or radiant) oven?
- If radiation is incident on the surface of a semitransparent medium and is absorbed as it propagates through the medium, will the corresponding volumetric rate of heat generation  $\dot{q}$  be distributed uniformly in the medium? If not, how will  $\dot{q}$  vary with distance from the surface?
- In what way is a plane wall that is of thickness  $2L$  and experiences uniform volumetric heating and equivalent convection conditions at both surfaces similar to a plane wall that is of thickness  $L$  and experiences the same volumetric heating and convection conditions at one surface but whose opposite surface is well insulated?
- What purpose is served by attaching *fins* to a surface?
- In the derivation of the general form of the energy equation for an extended surface, why is the assumption of one-dimensional conduction an approximation? Under what conditions is it a good approximation?
- Consider a straight fin of uniform cross section (Figure 3.14a). For an  $x$  location in the fin, sketch the temperature distribution in the transverse ( $y$ ) direction, placing the origin of the coordinate at the midplane of the fin ( $-t/2 \leq y \leq t/2$ ). What is the form of a *surface* energy balance applied at the location  $(x, t/2)$ ?
- What is the *fin effectiveness*? What is its range of possible values? Under what conditions are fins most effective?
- What is the *fin efficiency*? What is its range of possible values? Under what conditions will the efficiency be large?
- What is the *fin resistance*? What are its units?
- How are the effectiveness, efficiency, and thermal resistance of a fin affected if its thermal conductivity is increased? If the convection coefficient is increased? If the length of the fin is increased? If the thickness (or diameter) of the fin is increased?
- Heat is transferred from hot water flowing through a tube to air flowing over the tube. To enhance the rate of heat transfer, should fins be installed on the tube interior or exterior surface?
- A fin may be manufactured as an integral part of a surface by using a casting or extrusion process, or it may be separately brazed or adhered to the surface. From thermal considerations, which option is preferred?
- Describe the physical origins of the two heat source terms in the bioheat equation. Under what conditions is the perfusion term a heat sink?

## References

1. Fried, E., "Thermal Conduction Contribution to Heat Transfer at Contacts," in R. P. Tye, Ed., *Thermal Conductivity*, Vol. 2, Academic Press, London, 1969.
2. Eid, J. C., and V. W. Antonetti, "Small Scale Thermal Contact Resistance of Aluminum against Silicon," in C. L. Tien, V. P. Carey, and J. K. Ferrel, Eds., *Heat Transfer—1986*, Vol. 2, Hemisphere, New York, 1986, pp. 659–664.
3. Snaith, B., P. W. O'Callaghan, and S. D. Probert, *Appl. Energy*, **16**, 175, 1984.
4. Yovanovich, M. M., "Theory and Application of Constriction and Spreading Resistance Concepts for Microelectronic Thermal Management," Presented at the International Symposium on Cooling Technology for Electronic Equipment, Honolulu, 1987.

5. Peterson, G. P., and L. S. Fletcher, "Thermal Contact Resistance of Silicon Chip Bonding Materials," Proceedings of the International Symposium on Cooling Technology for Electronic Equipment, Honolulu, 1987, pp. 438–448.
6. Yovanovich, M. M., and M. Tuarze, *AIAA J. Spacecraft Rockets*, **6**, 1013, 1969.
7. Madhusudana, C. V., and L. S. Fletcher, *AIAA J.*, **24**, 510, 1986.
8. Yovanovich, M. M., "Recent Developments in Thermal Contact, Gap and Joint Conductance Theories and Experiment," in C. L. Tien, V. P. Carey, and J. K. Ferrel, Eds., *Heat Transfer—1986*, Vol. 1, Hemisphere, New York, 1986, pp. 35–45.
9. Harper, D. R., and W. B. Brown, "Mathematical Equations for Heat Conduction in the Fins of Air Cooled Engines," NACA Report No. 158, 1922.
10. Schneider, P. J., *Conduction Heat Transfer*, Addison-Wesley, Reading, MA, 1957.
11. Diller, K. R., and T.P. Ryan, *J. Heat Transfer*, **120**, 810, 1998.
12. Pennes, H. H., *J. Applied Physiology*, **85**, 5, 1998.


## Problems

### Plane Wall

- 3.1 Consider the plane wall of Figure 3.1, separating hot and cold fluids at temperatures  $T_{\infty,1}$  and  $T_{\infty,2}$ , respectively. Using surface energy balances as boundary conditions at  $x = 0$  and  $x = L$  (see Equation 2.32), obtain the temperature distribution within the wall and the heat flux in terms of  $T_{\infty,1}$ ,  $T_{\infty,2}$ ,  $h_1$ ,  $h_2$ ,  $k$ , and  $L$ .
- 3.2 The rear window of an automobile is defogged by passing warm air over its inner surface.
  - (a) If the warm air is at  $T_{\infty,i} = 40^\circ\text{C}$  and the corresponding convection coefficient is  $h_i = 30 \text{ W/m}^2 \cdot \text{K}$ , what are the inner and outer surface temperatures of 4-mm-thick window glass, if the outside ambient air temperature is  $T_{\infty,o} = -10^\circ\text{C}$  and the associated convection coefficient is  $h_o = 65 \text{ W/m}^2 \cdot \text{K}$ ?
  - (b) In practice  $T_{\infty,o}$  and  $h_o$  vary according to weather conditions and car speed. For values of  $h_o = 2, 65$ , and  $100 \text{ W/m}^2 \cdot \text{K}$ , compute and plot the inner and outer surface temperatures as a function of  $T_{\infty,o}$  for  $-30 \leq T_{\infty,o} \leq 0^\circ\text{C}$ .
- 3.3 The rear window of an automobile is defogged by attaching a thin, transparent, film-type heating element to its inner surface. By electrically heating this element, a uniform heat flux may be established at the inner surface.
  - (a) For 4-mm-thick window glass, determine the electrical power required per unit window area to maintain an inner surface temperature of  $15^\circ\text{C}$  when the interior air temperature and convection coefficient are  $T_{\infty,i} = 25^\circ\text{C}$  and  $h_i = 10 \text{ W/m}^2 \cdot \text{K}$ , while the exterior (ambient) air temperature and convection coefficient are  $T_{\infty,o} = -10^\circ\text{C}$  and  $h_o = 65 \text{ W/m}^2 \cdot \text{K}$ .
  - (b) In practice  $T_{\infty,o}$  and  $h_o$  vary according to weather conditions and car speed. For values of  $h_o = 2, 20, 65$ , and  $100 \text{ W/m}^2 \cdot \text{K}$ , determine and plot the electrical power

requirement as a function of  $T_{\infty,o}$  for  $-30 \leq T_{\infty,o} \leq 0^\circ\text{C}$ . From your results, what can you conclude about the need for heater operation at low values of  $h_o$ ? How is this conclusion affected by the value of  $T_{\infty,o}$ ? If  $h \propto V^n$ , where  $V$  is the vehicle speed and  $n$  is a positive exponent, how does the vehicle speed affect the need for heater operation?

- 3.4 In a manufacturing process, a transparent film is being bonded to a substrate as shown in the sketch. To cure the bond at a temperature  $T_0$ , a radiant source is used to provide a heat flux  $q_0''$  ( $\text{W/m}^2$ ), all of which is absorbed at the bonded surface. The back of the substrate is maintained at  $T_1$  while the free surface of the film is exposed to air at  $T_\infty$  and a convection heat transfer coefficient  $h$ .

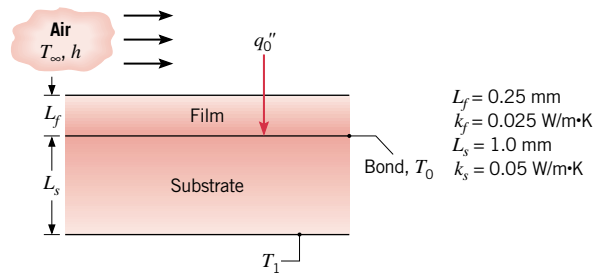


- (a) Show the thermal circuit representing the steady-state heat transfer situation. Be sure to label *all* elements, nodes, and heat rates. Leave in symbolic form.
- (b) Assume the following conditions:  $T_\infty = 20^\circ\text{C}$ ,  $h = 50 \text{ W/m}^2 \cdot \text{K}$ , and  $T_1 = 30^\circ\text{C}$ . Calculate the heat flux  $q_0''$  that is required to maintain the bonded surface at  $T_0 = 60^\circ\text{C}$ .
- (c) Compute and plot the required heat flux as a function of the film thickness for  $0 \leq L_f \leq 1 \text{ mm}$ .
- (d) If the film is not transparent and all of the radiant heat flux is absorbed at its upper surface, determine

the heat flux required to achieve bonding. Plot your results as a function of  $L_f$  for  $0 \leq L_f \leq 1$  mm.

- 3.5** The walls of a refrigerator are typically constructed by sandwiching a layer of insulation between sheet metal panels. Consider a wall made from fiberglass insulation of thermal conductivity  $k_i = 0.046$  W/m · K and thickness  $L_i = 50$  mm and steel panels, each of thermal conductivity  $k_p = 60$  W/m · K and thickness  $L_p = 3$  mm. If the wall separates refrigerated air at  $T_{\infty,i} = 4^\circ\text{C}$  from ambient air at  $T_{\infty,o} = 25^\circ\text{C}$ , what is the heat gain per unit surface area? Coefficients associated with natural convection at the inner and outer surfaces may be approximated as  $h_i = h_o = 5$  W/m<sup>2</sup> · K.

- 3.6** A technique for measuring convection heat transfer coefficients involves bonding one surface of a thin metallic foil to an insulating material and exposing the other surface to the fluid flow conditions of interest.

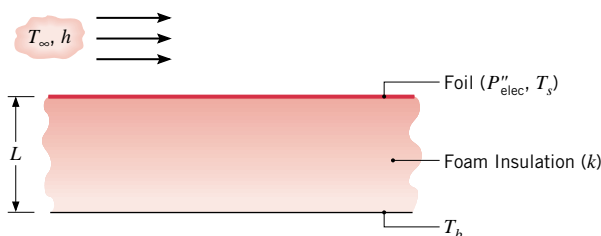

By passing an electric current through the foil, heat is dissipated uniformly within the foil and the corresponding flux,  $P''_{\text{elec}}$ , may be inferred from related voltage and current measurements. If the insulation thickness  $L$  and thermal conductivity  $k$  are known and the fluid, foil, and insulation temperatures ( $T_{\infty}$ ,  $T_s$ ,  $T_b$ ) are measured, the convection coefficient may be determined. Consider conditions for which  $T_{\infty} = T_b = 25^\circ\text{C}$ ,  $P''_{\text{elec}} = 2000$  W/m<sup>2</sup>,  $L = 10$  mm, and  $k = 0.040$  W/m · K.

- (a) With water flow over the surface, the foil temperature measurement yields  $T_s = 27^\circ\text{C}$ . Determine the convection coefficient. What error would be incurred by assuming all of the dissipated power to be transferred to the water by convection?
- (b) If, instead, air flows over the surface and the temperature measurement yields  $T_s = 125^\circ\text{C}$ , what is the convection coefficient? The foil has an emissivity of 0.15 and is exposed to large surroundings at  $25^\circ\text{C}$ . What error would be incurred by assuming all of the dissipated power to be transferred to the air by convection?
- (c) Typically, heat flux gages are operated at a fixed temperature ( $T_s$ ), in which case the power dissipation provides a direct measure of the convection coefficient. For  $T_s = 27^\circ\text{C}$ , plot  $P''_{\text{elec}}$  as a function of  $h_o$  for  $10 \leq h_o \leq 1000$  W/m<sup>2</sup> · K. What effect does  $h_o$  have on the error associated with neglecting conduction through the insulation?


- 3.7** The *wind chill*, which is experienced on a cold, windy day, is related to increased heat transfer from exposed human skin to the surrounding atmosphere. Consider a layer of fatty tissue that is 3 mm thick and whose interior surface is maintained at a temperature of  $36^\circ\text{C}$ . On a calm day the convection heat transfer coefficient at the outer surface is  $25$  W/m<sup>2</sup> · K, but with 30 km/h winds it reaches  $65$  W/m<sup>2</sup> · K. In both cases the ambient air temperature is  $-15^\circ\text{C}$ .

- (a) What is the ratio of the heat loss per unit area from the skin for the calm day to that for the windy day?
- (b) What will be the skin outer surface temperature for the calm day? For the windy day?
- (c) What temperature would the air have to assume on the calm day to produce the same heat loss occurring with the air temperature at  $-15^\circ\text{C}$  on the windy day?

- 3.8** A thermopane window consists of two pieces of glass 7 mm thick that enclose an air space 7 mm thick. The window separates room air at  $20^\circ\text{C}$  from outside ambient air at  $-10^\circ\text{C}$ . The convection coefficient associated with the inner (room-side) surface is  $10$  W/m<sup>2</sup> · K.

- (a) If the convection coefficient associated with the outer (ambient) air is  $h_o = 80$  W/m<sup>2</sup> · K, what is the heat loss through a window that is 0.8 m long by 0.5 m wide? Neglect radiation, and assume the air enclosed between the panes to be stagnant.
- (b) Compute and plot the effect of  $h_o$  on the heat loss for  $10 \leq h_o \leq 100$  W/m<sup>2</sup> · K. Repeat this calculation for a triple-pane construction in which a third pane and a second air space of equivalent thickness are added.


- 3.9** The composite wall of an oven consists of three materials, two of which are of known thermal conductivity,  $k_A = 20$  W/m · K and  $k_C = 50$  W/m · K, and known thickness,  $L_A = 0.30$  m and  $L_C = 0.15$  m. The third material, B, which is sandwiched between materials A and C, is of known thickness,  $L_B = 0.15$  m, but unknown thermal conductivity  $k_B$ .

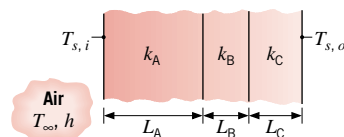

Under steady-state operating conditions, measurements reveal an outer surface temperature of  $T_{s,o} = 20^\circ\text{C}$ , an inner surface temperature of  $T_{s,i} = 600^\circ\text{C}$ , and an oven air temperature of  $T_{\infty} = 800^\circ\text{C}$ . The inside convection coefficient  $h$  is known to be  $25$  W/m<sup>2</sup> · K. What is the value of  $k_B$ ?

- 3.10** A testing lab is contracted to measure the thermal conductivity of various liquids as a function of the liquid temperature. Typically, the lab would measure the thermal conductivity and its temperature dependence


by performing many time-consuming experiments at various operating temperatures. A new experimental design is proposed whereby the temperature dependence may be determined in one experiment. The proposed apparatus consists of multiple layers, with each layer consisting of a  $t_{\text{icm}}$ -thick square sheet of low thermal conductivity material sandwiched between two  $t_{\text{ss}} = 1\text{-mm}$ -thick stainless steel plates with  $k_{\text{ss}} = 15\text{ W/m} \cdot \text{K}$ . The resulting *stainless steel–low thermal conductivity–stainless steel* sandwiches then separate  $N = 5$ ,  $t_l = 2\text{-mm}$ -thick layers of the liquid. The entire structure is heated from above to eliminate natural convection within the liquid, and cooled from below with a flowing liquid. The temperature of each stainless steel sheet is measured with a thermocouple, and the device is encased in insulation. The temperature range over which the thermal conductivity of a particular liquid is to be measured is  $300\text{ K} \leq T \leq 400\text{ K}$ . To resolve the temperature dependence of the liquid's thermal conductivity, the temperature difference across each liquid layer is to be held to within  $\Delta T = 2^\circ\text{C}$ . The nominal thermal conductivity of the liquid is  $k_l = 0.8\text{ W/m} \cdot \text{K}$ .

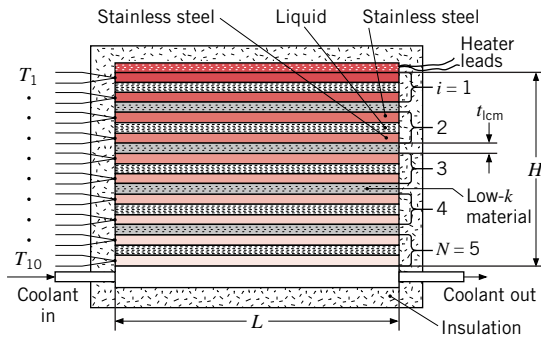

- Consider the low thermal conductivity material to be Bakelite. Determine the overall height,  $H$ , of the experimental apparatus.
- Consider replacing the Bakelite with an aerogel characterized by  $k_a = 0.0065\text{ W/m} \cdot \text{K}$ . What is the overall height of the apparatus?
- To minimize heat losses through the sides of the device, the area of the heater ( $A_h$ ) is made 10 times larger than the area of the sides ( $A_s$ ) of the device. Compare the required heater area and required electrical power for devices constructed using Bakelite and aerogel low thermal conductivity materials.


- 3.11** The wall of a drying oven is constructed by sandwiching an insulation material of thermal conductivity  $k = 0.05\text{ W/m} \cdot \text{K}$  between thin metal sheets. The oven air is at  $T_{\infty,i} = 300^\circ\text{C}$ , and the corresponding convection coefficient is  $h_i = 30\text{ W/m}^2 \cdot \text{K}$ . The inner wall surface absorbs a radiant flux of  $q''_{\text{rad}} = 100\text{ W/m}^2$  from hotter objects

within the oven. The room air is at  $T_{\infty,o} = 25^\circ\text{C}$ , and the overall coefficient for convection and radiation from the outer surface is  $h_o = 10\text{ W/m}^2 \cdot \text{K}$ .

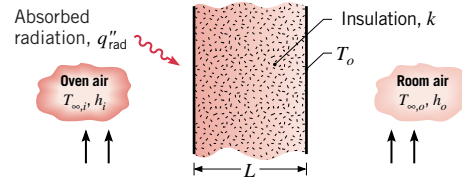


- Draw the thermal circuit for the wall and label all temperatures, heat rates, and thermal resistances.
- What insulation thickness  $L$  is required to maintain the outer wall surface at a *safe-to-touch* temperature of  $T_o = 40^\circ\text{C}$ ?

- 3.12** The electrolytic membrane of the fuel cell in Example 1.4 is a thin composite structure consisting of sandwiched layers of delicate materials, as shown in the sketch. The thickness of the polymer core is  $t_{\text{pc}} = 0.20\text{ mm}$ , while the thickness of each of the catalyst layers is  $t_{\text{cl}} = 0.01\text{ mm}$ . The gas diffusion layers are each  $t_{\text{gdl}} = 0.1\text{ mm}$  thick. Since the membrane can soften and lose durability at temperatures exceeding  $85^\circ\text{C}$ , the materials engineer decides to strengthen the membrane by implanting long carbon nanotubes (diameter  $D_{\text{cn}} = 14\text{ nm}$ ,  $k_{\text{cn}} = 3000\text{ W/m} \cdot \text{K}$ ) lengthwise within both catalyst layers. Determine the value of the *effective thermal conductivity*,  $k_{\text{eff},x}$ , of the membrane assembly that is defined by the relation  $q_x = k_{\text{eff},x} w \Delta T / L$ , where  $L$ ,  $w$ , and  $t$  are the length, width, and total thickness of the membrane assembly respectively;  $q_x$  is the heat transfer rate along the assembly; and  $\Delta T$  is the temperature drop along a section of the assembly of length  $L$ . Determine the value of  $k_{\text{eff},x}$  for carbon nanotube loadings of  $f = 0, 10\%, 20\%$ , and  $30\%$ , where  $f$  is the volume fraction of carbon nanotubes in the catalyst layers. The thermal conductivity of the polymer core is  $k_{\text{pc}} = 0.25\text{ W/m} \cdot \text{K}$ , and the thermal conductivities of the gas diffusion layers and catalyst layers are  $k_{\text{gdl}} = 1.3\text{ W/m} \cdot \text{K}$  and  $k_{\text{cl}} = 1\text{ W/m} \cdot \text{K}$ , respectively.

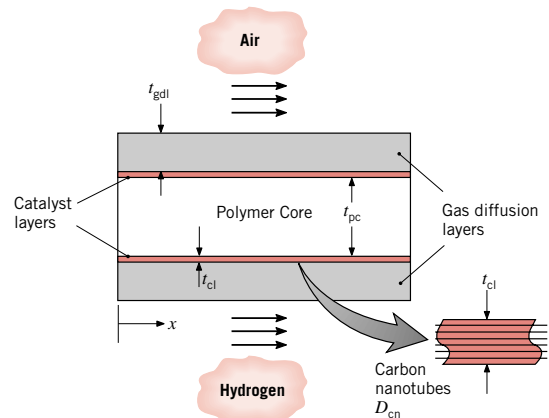

**3.13** A house has a composite wall of wood, fiberglass insulation, and plaster board, as indicated in the sketch. On a cold winter day the convection heat transfer coefficients are  $h_o = 60 \text{ W/m}^2 \cdot \text{K}$  and  $h_i = 30 \text{ W/m}^2 \cdot \text{K}$ . The total wall surface area is  $350 \text{ m}^2$ .

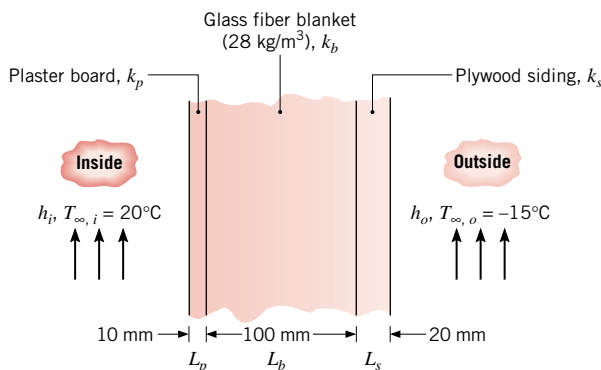

- Determine a symbolic expression for the total thermal resistance of the wall, including inside and outside convection effects for the prescribed conditions.
- Determine the total heat loss through the wall.
- If the wind were blowing violently, raising  $h_o$  to  $300 \text{ W/m}^2 \cdot \text{K}$ , determine the percentage increase in the heat loss.
- What is the controlling resistance that determines the amount of heat flow through the wall?


**3.14** Consider the composite wall of Problem 3.13 under conditions for which the inside air is still characterized by  $T_{\infty,i} = 20^\circ\text{C}$  and  $h_i = 30 \text{ W/m}^2 \cdot \text{K}$ . However, use the more realistic conditions for which the outside air is characterized by a diurnal (time) varying temperature of the form

$$T_{\infty,o}(\text{K}) = 273 + 5 \sin\left(\frac{2\pi}{24}t\right) \quad 0 \leq t \leq 12 \text{ h}$$

$$T_{\infty,o}(\text{K}) = 273 + 11 \sin\left(\frac{2\pi}{24}t\right) \quad 12 \leq t \leq 24 \text{ h}$$

with  $h_o = 60 \text{ W/m}^2 \cdot \text{K}$ . Assuming quasisteady conditions for which changes in energy storage within the wall may be neglected, estimate the daily heat loss through the wall if its total surface area is  $200 \text{ m}^2$ .

**3.15** Consider a composite wall that includes an 8-mm-thick hardwood siding, 40-mm by 130-mm hardwood studs on 0.65-m centers with glass fiber insulation (paper faced,  $28 \text{ kg/m}^3$ ), and a 12-mm layer of gypsum (vermiculite) wall board.

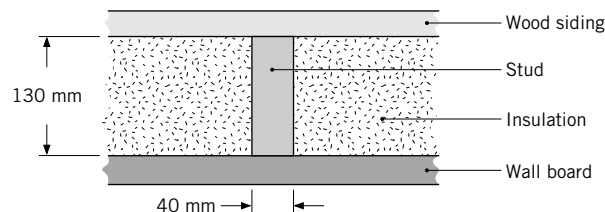

What is the thermal resistance associated with a wall that is 2.5 m high by 6.5 m wide (having 10 studs, each 2.5 m high)?

**3.16** The thermal characteristics of a small, dormitory refrigerator are determined by performing two separate experiments, each with the door closed and the refrigerator placed in ambient air at  $T_\infty = 25^\circ\text{C}$ . In one case, an electric heater is suspended in the refrigerator cavity, while the refrigerator is unplugged. With the heater dissipating 20 W, a steady-state temperature of  $90^\circ\text{C}$  is recorded within the cavity. With the heater removed and the refrigerator now in operation, the second experiment involves maintaining a steady-state cavity temperature of  $5^\circ\text{C}$  for a fixed time interval and recording the electrical energy required to operate the refrigerator. In such an experiment for which steady operation is maintained over a 12-hour period, the input electrical energy is 125,000 J. Determine the refrigerator's coefficient of performance (COP).

**3.17** In the design of buildings, energy conservation requirements dictate that the exterior surface area,  $A_s$ , be minimized. This requirement implies that, for a desired floor space, there may be optimum values associated with the number of floors and horizontal dimensions of the building. Consider a design for which the total floor space,  $A_f$ , and the vertical distance between floors,  $H_f$ , are prescribed.

- If the building has a square cross section of width  $W$  on a side, obtain an expression for the value of  $W$  that would minimize heat loss to the surroundings. Heat loss may be assumed to occur from the four vertical side walls and from a flat roof. Express your result in terms of  $A_f$  and  $H_f$ .
- If  $A_f = 32,768 \text{ m}^2$  and  $H_f = 4 \text{ m}$ , for what values of  $W$  and  $N_f$  (the number of floors) is the heat loss minimized? If the average overall heat transfer coefficient is  $U = 1 \text{ W/m}^2 \cdot \text{K}$  and the difference between the inside and ambient air temperatures is  $25^\circ\text{C}$ , what is the corresponding heat loss? What is the percent reduction in heat loss compared with a building for  $N_f = 2$ ?


**3.18** When raised to very high temperatures, many conventional liquid fuels dissociate into hydrogen and other components. Thus the advantage of a *solid oxide fuel*



cell is that such a device can internally *reform* readily available liquid fuels into hydrogen that can then be used to produce electrical power in a manner similar to Example 1.4. Consider a portable solid oxide fuel cell, operating at a temperature of  $T_{fc} = 800^\circ\text{C}$ . The fuel cell is housed within a cylindrical canister of diameter  $D = 75$  mm and length  $L = 120$  mm. The outer surface of the canister is insulated with a low-thermal-conductivity material. For a particular application, it is desired that the *thermal signature* of the canister be small, to avoid its detection by infrared sensors. The degree to which the canister can be detected with an infrared sensor may be estimated by equating the radiation heat flux emitted from the exterior surface of the canister (Equation 1.5;  $E_s = \epsilon_s \sigma T_s^4$ ) to the heat flux emitted from an *equivalent* black surface, ( $E_b = \sigma T_b^4$ ). If the equivalent black surface temperature,  $T_b$ , is near the surroundings temperature, the thermal signature of the canister is too small to be detected—the canister is indistinguishable from the surroundings.

- Determine the required thickness of insulation to be applied to the cylindrical wall of the canister to ensure that the canister does not become highly visible to an infrared sensor (i.e.,  $T_b - T_{\text{sur}} < 5$  K). Consider cases where (i) the outer surface is covered with a very thin layer of dirt ( $\epsilon_s = 0.90$ ) and (ii) the outer surface is comprised of a very thin polished aluminum sheet ( $\epsilon_s = 0.08$ ). Calculate the required thicknesses for two types of insulating material, calcium silicate ( $k = 0.09$  W/m · K) and aerogel ( $k = 0.006$  W/m · K). The temperatures of the surroundings and the ambient are  $T_{\text{sur}} = 300$  K and  $T_\infty = 298$  K, respectively. The outer surface is characterized by a convective heat transfer coefficient of  $h = 12$  W/m<sup>2</sup> · K.
- Calculate the outer surface temperature of the canister for the four cases (high and low thermal conductivity; high and low surface emissivity).
- Calculate the heat loss from the cylindrical walls of the canister for the four cases.

- 3.19** A firefighter's protective clothing, referred to as a *turnout coat*, is typically constructed as an ensemble of three layers separated by air gaps, as shown schematically.

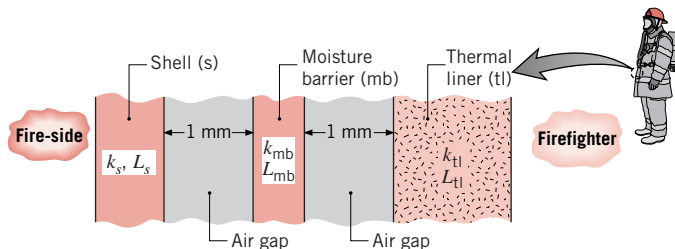

Representative dimensions and thermal conductivities for the layers are as follows.

Layer	Thickness (mm)	$k$ (W/m · K)
Shell (s)	0.8	0.047
Moisture barrier (mb)	0.55	0.012
Thermal liner (tl)	3.5	0.038

The air gaps between the layers are 1 mm thick, and heat is transferred by conduction and radiation exchange through the stagnant air. The linearized radiation coefficient for a gap may be approximated as,  $h_{\text{rad}} = \sigma(T_1 + T_2)(T_1^2 + T_2^2) \approx 4\sigma T_{\text{avg}}^3$ , where  $T_{\text{avg}}$  represents the average temperature of the surfaces comprising the gap, and the radiation flux across the gap may be expressed as  $q''_{\text{rad}} = h_{\text{rad}}(T_1 - T_2)$ .

- Represent the turnout coat by a thermal circuit, labeling all the thermal resistances. Calculate and tabulate the thermal resistances per unit area (m<sup>2</sup> · K/W) for each of the layers, as well as for the conduction and radiation processes in the gaps. Assume that a value of  $T_{\text{avg}} = 470$  K may be used to approximate the radiation resistance of both gaps. Comment on the relative magnitudes of the resistances.
- For a *pre-flash-over* fire environment in which firefighters often work, the typical radiant heat flux on the fire-side of the turnout coat is 0.25 W/cm<sup>2</sup>. What is the outer surface temperature of the turnout coat if the inner surface temperature is 66°C, a condition that would result in burn injury?

## Contact Resistance

- 3.20** A composite wall separates combustion gases at 2600°C from a liquid coolant at 100°C, with gas- and liquid-side convection coefficients of 50 and 1000 W/m<sup>2</sup> · K. The wall is composed of a 10-mm-thick layer of beryllium oxide on the gas side and a 20-mm-thick slab of stainless steel (AISI 304) on the liquid side. The contact resistance between the oxide and the steel is 0.05 m<sup>2</sup> · K/W. What is the heat loss per unit surface area of the composite? Sketch the temperature distribution from the gas to the liquid.


- 3.21** Two stainless steel plates 10 mm thick are subjected to a contact pressure of 1 bar under vacuum conditions for which there is an overall temperature drop of 100°C across the plates. What is the heat flux through the plates? What is the temperature drop across the contact plane?

- 3.22** Consider a plane composite wall that is composed of two materials of thermal conductivities  $k_A = 0.1$  W/m · K and

$k_B = 0.04 \text{ W/m} \cdot \text{K}$  and thicknesses  $L_A = 10 \text{ mm}$  and  $L_B = 20 \text{ mm}$ . The contact resistance at the interface between the two materials is known to be  $0.30 \text{ m}^2 \cdot \text{K/W}$ . Material A adjoins a fluid at  $200^\circ\text{C}$  for which  $h = 10 \text{ W/m}^2 \cdot \text{K}$ , and material B adjoins a fluid at  $40^\circ\text{C}$  for which  $h = 20 \text{ W/m}^2 \cdot \text{K}$ .

- What is the rate of heat transfer through a wall that is 2 m high by 2.5 m wide?
- Sketch the temperature distribution.

**3.23** The performance of gas turbine engines may be improved by increasing the tolerance of the turbine blades to hot gases emerging from the combustor. One approach to achieving high operating temperatures involves application of a *thermal barrier coating* (TBC) to the exterior surface of a blade, while passing cooling air through the blade. Typically, the blade is made from a high-temperature superalloy, such as Inconel ( $k \approx 25 \text{ W/m} \cdot \text{K}$ ), while a ceramic, such as zirconia ( $k \approx 1.3 \text{ W/m} \cdot \text{K}$ ), is used as a TBC.

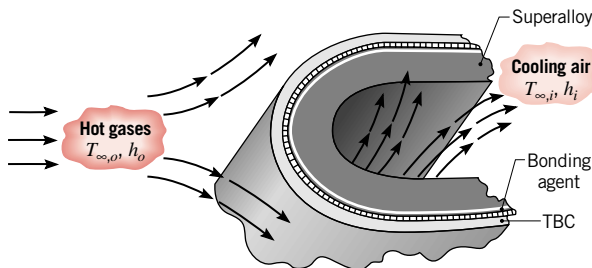

Consider conditions for which hot gases at  $T_{\infty,o} = 1700 \text{ K}$  and cooling air at  $T_{\infty,i} = 400 \text{ K}$  provide outer and inner surface convection coefficients of  $h_o = 1000 \text{ W/m}^2 \cdot \text{K}$  and  $h_i = 500 \text{ W/m}^2 \cdot \text{K}$ , respectively. If a 0.5-mm-thick zirconia TBC is attached to a 5-mm-thick Inconel blade wall by means of a metallic bonding agent, which provides an interfacial thermal resistance of  $R''_{t,c} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ , can the Inconel be maintained at a temperature that is below its maximum allowable value of  $1250 \text{ K}$ ? Radiation effects may be neglected, and the turbine blade may be approximated as a plane wall. Plot the temperature distribution with and without the TBC. Are there any limits to the thickness of the TBC?

**3.24** A commercial grade cubical freezer, 3 m on a side, has a composite wall consisting of an exterior sheet of 6.35-mm-thick plain carbon steel, an intermediate layer of 100-mm-thick cork insulation, and an inner sheet of 6.35-mm-thick aluminum alloy (2024). Adhesive interfaces between the insulation and the metallic strips are each characterized by a thermal contact resistance of  $R''_{t,c} = 2.5 \times 10^{-4} \text{ m}^2 \cdot \text{K/W}$ . What is the steady-state


cooling load that must be maintained by the refrigerator under conditions for which the outer and inner surface temperatures are  $22^\circ\text{C}$  and  $-6^\circ\text{C}$  respectively?

**3.25** Physicists have determined the theoretical value of the thermal conductivity of a carbon nanotube to be  $k_{\text{cn},T} = 5000 \text{ W/m} \cdot \text{K}$ .


(a) Assuming the actual thermal conductivity of the carbon nanotube is the same as its theoretical value, find the thermal contact resistance,  $R_{t,c}$ , that exists between the carbon nanotube and the top surfaces of the heated and sensing islands in Example 3.3.

(b) Using the value of the thermal contact resistance calculated in part (a), plot the fraction of the total resistance between the heated and sensing islands that is due to the thermal contact resistances for island separation distances of  $5 \mu\text{m} \leq s \leq 20 \mu\text{m}$ .

**3.26** In a particular application, it is desirable to minimize the effects of the thermal contact resistance between two plane mating surfaces as shown in part (a) of the schematic. An engineer suggests that the overall resistance to heat transfer can be reduced by cutting relatively deep linear grooves in each surface, resulting in the interlocking fin-like structure shown in part (b) of the schematic. If the grooves in material A are of the same width as the grooves in material B, evaluate the merit of the proposed scheme using an appropriate analysis.

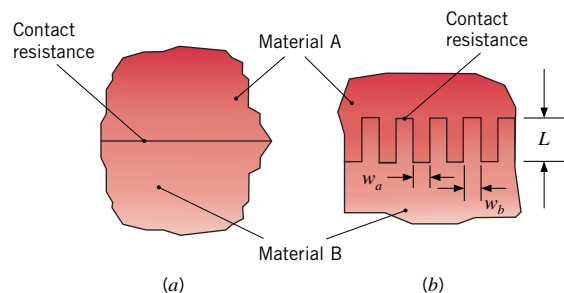


**3.27** Approximately  $10^6$  discrete electrical components can be placed on a single integrated circuit (chip), with electrical heat dissipation as high as  $30,000 \text{ W/m}^2$ . The chip, which is very thin, is exposed to a dielectric liquid at its outer surface, with  $h_o = 1000 \text{ W/m}^2 \cdot \text{K}$  and  $T_{\infty,o} = 20^\circ\text{C}$ , and is joined to a circuit board at its inner surface. The thermal contact resistance between the chip and the board is  $10^{-4} \text{ m}^2 \cdot \text{K/W}$ , and the board thickness and thermal conductivity are  $L_b = 5 \text{ mm}$  and  $k_b = 1 \text{ W/m} \cdot \text{K}$ , respectively. The other surface of the board is exposed to ambient air for which  $h_i = 40 \text{ W/m}^2 \cdot \text{K}$  and  $T_{\infty,i} = 20^\circ\text{C}$ .

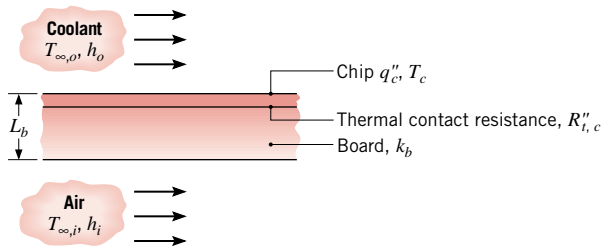

- Sketch the equivalent thermal circuit corresponding to steady-state conditions. In variable form, label appropriate resistances, temperatures, and heat fluxes.
- Under steady-state conditions for which the chip heat dissipation is  $q_c'' = 30,000 \text{ W/m}^2$ , what is the chip temperature?
- The maximum allowable heat flux,  $q_{c,m}''$ , is determined by the constraint that the chip temperature must not exceed  $85^\circ\text{C}$ . Determine  $q_{c,m}''$  for the foregoing conditions. If air is used in lieu of the dielectric liquid, the convection coefficient is reduced by approximately an order of magnitude. What is the value of  $q_{c,m}''$  for  $h_o = 100 \text{ W/m}^2 \cdot \text{K}$ ? With air cooling, can significant improvements be realized by using an aluminum oxide circuit board and/or by using a conductive paste at the chip/board interface for which  $R_{t,c}'' = 10^{-5} \text{ m}^2 \cdot \text{K/W}$ ?


**3.28** Consider a power transistor encapsulated in an aluminum case that is attached at its base to a square aluminum plate of thermal conductivity  $k = 240 \text{ W/m} \cdot \text{K}$ , thickness  $L = 6 \text{ mm}$ , and width  $W = 20 \text{ mm}$ . The case is joined to the plate by screws that maintain a contact pressure of 1 bar, and the back surface of the plate transfers heat by natural convection and radiation to ambient air and large surroundings at  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ . The surface has an emissivity of  $\varepsilon = 0.9$ , and the convection coefficient is  $h = 4 \text{ W/m}^2 \cdot \text{K}$ . The case is completely enclosed such that heat transfer may be assumed to occur exclusively through the base plate.

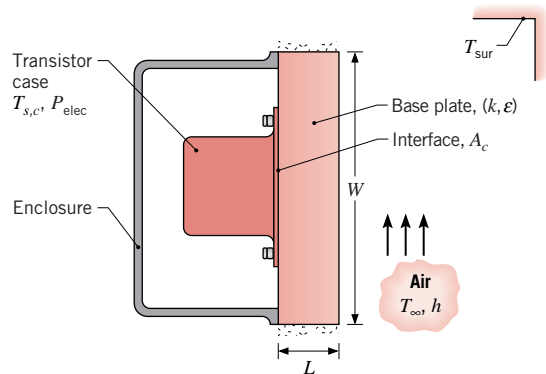

- If the air-filled aluminum-to-aluminum interface is characterized by an area of  $A_c = 2 \times 10^{-4} \text{ m}^2$  and a roughness of  $10 \mu\text{m}$ , what is the maximum allowable power dissipation if the surface temperature of the case,  $T_{s,c}$ , is not to exceed  $85^\circ\text{C}$ ?
- The convection coefficient may be increased by subjecting the plate surface to a forced flow of air. Explore the effect of increasing the coefficient over the range  $4 \leq h \leq 200 \text{ W/m}^2 \cdot \text{K}$ .


### Alternative Conduction Analysis

**3.29** The diagram shows a conical section fabricated from pure aluminum. It is of circular cross section having diameter  $D = ax^{1/2}$ , where  $a = 0.5 \text{ m}^{1/2}$ . The small end is located at  $x_1 = 25 \text{ mm}$  and the large end at  $x_2 = 125 \text{ mm}$ . The end temperatures are  $T_1 = 600 \text{ K}$  and  $T_2 = 400 \text{ K}$ , while the lateral surface is well insulated.



- Derive an expression for the temperature distribution  $T(x)$  in symbolic form, assuming one-dimensional conditions. Sketch the temperature distribution.
- Calculate the heat rate  $q_x$ .

**3.30** A truncated solid cone is of circular cross section, and its diameter is related to the axial coordinate by an expression of the form  $D = ax^{3/2}$ , where  $a = 1.0 \text{ m}^{-1/2}$ .



The sides are well insulated, while the top surface of the cone at  $x_1$  is maintained at  $T_1$  and the bottom surface at  $x_2$  is maintained at  $T_2$ .




- (a) Obtain an expression for the temperature distribution  $T(x)$ .
- (b) What is the rate of heat transfer across the cone if it is constructed of pure aluminum with  $x_1 = 0.075$  m,  $T_1 = 100^\circ\text{C}$ ,  $x_2 = 0.225$  m, and  $T_2 = 20^\circ\text{C}$ ?

**3.31** From Figure 2.5 it is evident that, over a wide temperature range, the temperature dependence of the thermal conductivity of many solids may be approximated by a linear expression of the form  $k = k_o + aT$ , where  $k_o$  is a positive constant and  $a$  is a coefficient that may be positive or negative. Obtain an expression for the heat flux across a plane wall whose inner and outer surfaces are maintained at  $T_0$  and  $T_1$ , respectively. Sketch the forms of the temperature distribution corresponding to  $a > 0$ ,  $a = 0$ , and  $a < 0$ .

**3.32** Consider a tube wall of inner and outer radii  $r_i$  and  $r_o$ , whose temperatures are maintained at  $T_i$  and  $T_o$ , respectively. The thermal conductivity of the cylinder is temperature dependent and may be represented by an expression of the form  $k = k_o(1 + aT)$ , where  $k_o$  and  $a$  are constants. Obtain an expression for the heat transfer per unit length of the tube. What is the thermal resistance of the tube wall?

**3.33** Measurements show that steady-state conduction through a plane wall without heat generation produced a convex temperature distribution such that the midpoint temperature was  $\Delta T_o$  higher than expected for a linear temperature distribution.




Assuming that the thermal conductivity has a linear dependence on temperature,  $k = k_o(1 + \alpha T)$ , where  $\alpha$  is a constant, develop a relationship to evaluate  $\alpha$  in terms of  $\Delta T_o$ ,  $T_1$ , and  $T_2$ .

**3.34** A device used to measure the surface temperature of an object to within a spatial resolution of approximately 50 nm is shown in the schematic. It consists of an extremely sharp-tipped stylus and an extremely small cantilever that is scanned across the surface. The probe tip is of circular cross section and is fabricated of polycrystalline silicon dioxide. The ambient temperature is measured at the pivoted end of the cantilever as  $T_\infty = 25^\circ\text{C}$ , and the device is equipped with a sensor to measure the

temperature at the upper end of the sharp tip,  $T_{\text{sen}}$ . The thermal resistance between the sensing probe and the pivoted end is  $R_t = 5 \times 10^6$  K/W.

- (a) Determine the thermal resistance between the surface temperature and the sensing temperature.
- (b) If the sensing temperature is  $T_{\text{sen}} = 28.5^\circ\text{C}$ , determine the surface temperature.

*Hint:* Although nanoscale heat transfer effects may be important, assume that the conduction occurring in the air adjacent to the probe tip can be described by Fourier's law and the thermal conductivity found in Table A.4.

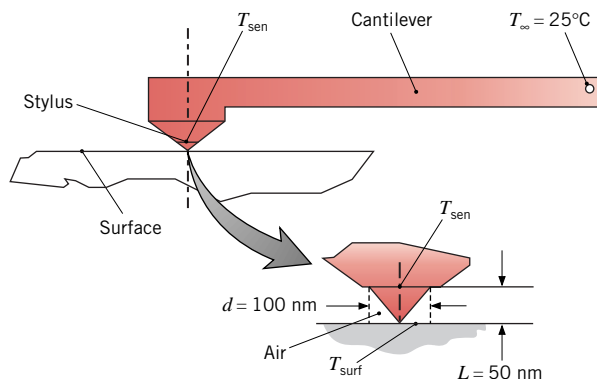

### Cylindrical Wall

**3.35** A steam pipe of 0.12-m outside diameter is insulated with a layer of calcium silicate.

- (a) If the insulation is 20 mm thick and its inner and outer surfaces are maintained at  $T_{s,1} = 800$  K and  $T_{s,2} = 490$  K, respectively, what is the heat loss per unit length ( $q'$ ) of the pipe?

- (b) We wish to explore the effect of insulation thickness on the heat loss  $q'$  and outer surface temperature  $T_{s,2}$ , with the inner surface temperature fixed at  $T_{s,1} = 800$  K. The outer surface is exposed to an airflow ( $T_\infty = 25^\circ\text{C}$ ) that maintains a convection coefficient of  $h = 25$  W/m<sup>2</sup> · K and to large surroundings for which  $T_{\text{sur}} = T_\infty = 25^\circ\text{C}$ . The surface emissivity of calcium silicate is approximately 0.8. Compute and plot the temperature distribution in the insulation as a function of the dimensionless radial coordinate,  $(r - r_1)/(r_2 - r_1)$ , where  $r_1 = 0.06$  m and  $r_2$  is a variable ( $0.06 < r_2 \leq 0.20$  m). Compute and plot the heat loss as a function of the insulation thickness for  $0 \leq (r_2 - r_1) \leq 0.14$  m.

**3.36** Consider the water heater described in Problem 1.37. We now wish to determine the energy needed to compensate for heat losses incurred while the water is

stored at the prescribed temperature of  $55^{\circ}\text{C}$ . The cylindrical storage tank (with flat ends) has a capacity of 100 gallons, and foamed urethane is used to insulate the side and end walls from ambient air at an annual average temperature of  $20^{\circ}\text{C}$ . The resistance to heat transfer is dominated by conduction in the insulation and by free convection in the air, for which  $h \approx 2 \text{ W/m}^2 \cdot \text{K}$ . If electric resistance heating is used to compensate for the losses and the cost of electric power is  $\$0.08/\text{kW} \cdot \text{h}$ , specify tank and insulation dimensions for which the annual cost associated with the heat losses is less than  $\$50$ .

- 3.37** A thin electrical heater is wrapped around the outer surface of a long cylindrical tube whose inner surface is maintained at a temperature of  $5^{\circ}\text{C}$ . The tube wall has inner and outer radii of 25 and 75 mm, respectively, and a thermal conductivity of  $10 \text{ W/m} \cdot \text{K}$ . The thermal contact resistance between the heater and the outer surface of the tube (per unit length of the tube) is  $R'_{t,c} = 0.01 \text{ m} \cdot \text{K/W}$ . The outer surface of the heater is exposed to a fluid with  $T_{\infty} = -10^{\circ}\text{C}$  and a convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$ . Determine the heater power per unit length of tube required to maintain the heater at  $T_o = 25^{\circ}\text{C}$ .

- 3.38** In the previous problem, the electrical power required to maintain the heater at  $T_o = 25^{\circ}\text{C}$  depends on the thermal conductivity of the wall material  $k$ , the thermal contact resistance  $R'_{t,c}$ , and the convection coefficient  $h$ . Compute and plot the separate effect of changes in  $k$  ( $1 \leq k \leq 200 \text{ W/m} \cdot \text{K}$ ),  $R'_{t,c}$  ( $0 \leq R'_{t,c} \leq 0.1 \text{ m} \cdot \text{K/W}$ ), and  $h$  ( $10 \leq h \leq 1000 \text{ W/m}^2 \cdot \text{K}$ ) on the total heater power requirement, as well as the rate of heat transfer to the inner surface of the tube and to the fluid.

- 3.39** A stainless steel (AISI 304) tube used to transport a chilled pharmaceutical has an inner diameter of 36 mm and a wall thickness of 2 mm. The pharmaceutical and ambient air are at temperatures of  $6^{\circ}\text{C}$  and  $23^{\circ}\text{C}$ , respectively, while the corresponding inner and outer convection coefficients are  $400 \text{ W/m}^2 \cdot \text{K}$  and  $6 \text{ W/m}^2 \cdot \text{K}$ , respectively.

- What is the heat gain per unit tube length?
- What is the heat gain per unit length if a 10-mm-thick layer of calcium silicate insulation ( $k_{\text{ins}} = 0.050 \text{ W/m} \cdot \text{K}$ ) is applied to the tube?

- 3.40** Superheated steam at  $575^{\circ}\text{C}$  is routed from a boiler to the turbine of an electric power plant through steel tubes ( $k = 35 \text{ W/m} \cdot \text{K}$ ) of 300 mm inner diameter and 30 mm wall thickness. To reduce heat loss to the surroundings and to maintain a *safe-to-touch* outer surface temperature, a layer of calcium silicate insulation ( $k = 0.10 \text{ W/m} \cdot \text{K}$ ) is applied to the tubes, while degradation of the insulation is reduced by

wrapping it in a thin sheet of aluminum having an emissivity of  $\epsilon = 0.20$ . The air and wall temperatures of the power plant are  $27^{\circ}\text{C}$ .

- Assuming that the inner surface temperature of a steel tube corresponds to that of the steam and the convection coefficient outside the aluminum sheet is  $6 \text{ W/m}^2 \cdot \text{K}$ , what is the minimum insulation thickness needed to insure that the temperature of the aluminum does not exceed  $50^{\circ}\text{C}$ ? What is the corresponding heat loss per meter of tube length?

- (b)** Explore the effect of the insulation thickness on the temperature of the aluminum and the heat loss per unit tube length.

- 3.41** A thin electrical heater is inserted between a long circular rod and a concentric tube with inner and outer radii of 20 and 40 mm. The rod (A) has a thermal conductivity of  $k_A = 0.15 \text{ W/m} \cdot \text{K}$ , while the tube (B) has a thermal conductivity of  $k_B = 1.5 \text{ W/m} \cdot \text{K}$  and its outer surface is subjected to convection with a fluid of temperature  $T_{\infty} = -15^{\circ}\text{C}$  and heat transfer coefficient  $50 \text{ W/m}^2 \cdot \text{K}$ . The thermal contact resistance between the cylinder surfaces and the heater is negligible.

- Determine the electrical power per unit length of the cylinders (W/m) that is required to maintain the outer surface of cylinder B at  $5^{\circ}\text{C}$ .

- What is the temperature at the center of cylinder A?

- 3.42** A wire of diameter  $D = 2 \text{ mm}$  and uniform temperature  $T$  has an electrical resistance of  $0.01 \Omega/\text{m}$  and a current flow of 20 A.

- What is the rate at which heat is dissipated per unit length of wire? What is the heat dissipation per unit volume within the wire?


- If the wire is not insulated and is in ambient air and large surrounding for which  $T_{\infty} = T_{\text{sur}} = 20^{\circ}\text{C}$ , what is the temperature  $T$  of the wire? The wire has an emissivity of 0.3, and the coefficient associated with heat transfer by natural convection may be approximated by an expression of the form,  $h = C[(T - T_{\infty})/D]^{1/4}$ , where  $C = 1.25 \text{ W/m}^{7/4} \cdot \text{K}^{5/4}$ .

- (c)** If the wire is coated with plastic insulation of 2-mm thickness and a thermal conductivity of  $0.25 \text{ W/m} \cdot \text{K}$ , what are the inner and outer surface temperatures of the insulation? The insulation has an emissivity of 0.9, and the convection coefficient is given by the expression of part (b). Explore the effect of the insulation thickness on the surface temperatures.

- 3.43** A 2-mm-diameter electrical wire is insulated by a 2-mm-thick rubberized sheath ( $k = 0.13 \text{ W/m} \cdot \text{K}$ ), and the wire/sheath interface is characterized by a thermal

contact resistance of  $R''_{t,c} = 3 \times 10^{-4} \text{ m}^2 \cdot \text{K/W}$ . The convection heat transfer coefficient at the outer surface of the sheath is  $10 \text{ W/m}^2 \cdot \text{K}$ , and the temperature of the ambient air is  $20^\circ\text{C}$ . If the temperature of the insulation may not exceed  $50^\circ\text{C}$ , what is the maximum allowable electrical power that may be dissipated per unit length of the conductor? What is the critical radius of the insulation?

- 3.44** Electric current flows through a long rod generating thermal energy at a uniform volumetric rate of  $\dot{q} = 2 \times 10^6 \text{ W/m}^3$ . The rod is concentric with a hollow ceramic cylinder, creating an enclosure that is filled with air.

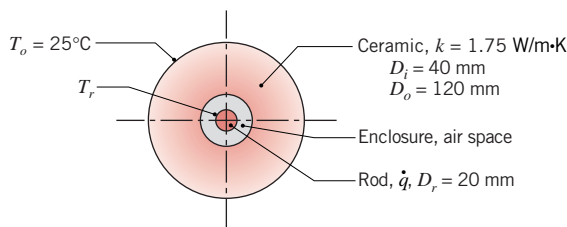


The thermal resistance per unit length due to radiation between the enclosure surfaces is  $R'_{\text{rad}} = 0.30 \text{ m} \cdot \text{K/W}$ , and the coefficient associated with free convection in the enclosure is  $h = 20 \text{ W/m}^2 \cdot \text{K}$ .

- Construct a thermal circuit that can be used to calculate the surface temperature of the rod,  $T_r$ . Label all temperatures, heat rates, and thermal resistances, and evaluate each thermal resistance.
  - Calculate the surface temperature of the rod for the prescribed conditions.
- 3.45** The evaporator section of a refrigeration unit consists of thin-walled, 10-mm-diameter tubes through which refrigerant passes at a temperature of  $-18^\circ\text{C}$ . Air is cooled as it flows over the tubes, maintaining a surface convection coefficient of  $100 \text{ W/m}^2 \cdot \text{K}$ , and is subsequently routed to the refrigerator compartment.
- For the foregoing conditions and an air temperature of  $-3^\circ\text{C}$ , what is the rate at which heat is extracted from the air per unit tube length?
  - If the refrigerator's defrost unit malfunctions, frost will slowly accumulate on the outer tube surface. Assess the effect of frost formation on the cooling capacity of a tube for frost layer thicknesses in the range  $0 \leq \delta \leq 4 \text{ mm}$ . Frost may be assumed to have a thermal conductivity of  $0.4 \text{ W/m} \cdot \text{K}$ .
  - The refrigerator is disconnected after the defrost unit malfunctions and a 2-mm-thick layer of frost has formed. If the tubes are in ambient air for which  $T_\infty = 20^\circ\text{C}$  and natural convection maintains a convection coefficient of  $2 \text{ W/m}^2 \cdot \text{K}$ , how long will it

take for the frost to melt? The frost may be assumed to have a mass density of  $700 \text{ kg/m}^3$  and a latent heat of fusion of  $334 \text{ kJ/kg}$ .

- 3.46** A composite cylindrical wall is composed of two materials of thermal conductivity  $k_A$  and  $k_B$ , which are separated by a very thin, electric resistance heater for which interfacial contact resistances are negligible.

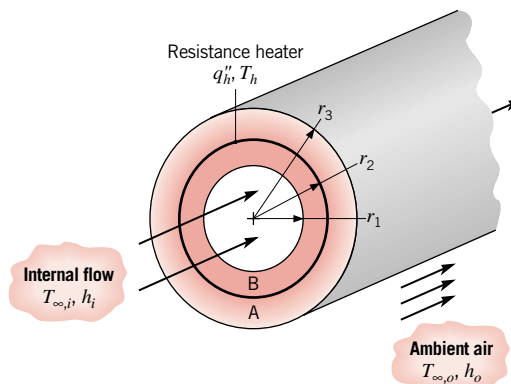


Liquid pumped through the tube is at a temperature  $T_{\infty,i}$  and provides a convection coefficient  $h_i$  at the inner surface of the composite. The outer surface is exposed to ambient air, which is at  $T_{\infty,o}$  and provides a convection coefficient of  $h_o$ . Under steady-state conditions, a uniform heat flux of  $q''_h$  is dissipated by the heater.

- Sketch the equivalent thermal circuit of the system and express all resistances in terms of relevant variables.
  - Obtain an expression that may be used to determine the heater temperature,  $T_h$ .
  - Obtain an expression for the ratio of heat flows to the outer and inner fluids,  $q'_o/q'_i$ . How might the variables of the problem be adjusted to minimize this ratio?
- 3.47** An electrical current of  $700 \text{ A}$  flows through a stainless steel cable having a diameter of  $5 \text{ mm}$  and an electrical resistance of  $6 \times 10^{-4} \Omega/\text{m}$  (i.e., per meter of cable length). The cable is in an environment having a temperature of  $30^\circ\text{C}$ , and the total coefficient associated with convection and radiation between the cable and the environment is approximately  $25 \text{ W/m}^2 \cdot \text{K}$ .
- If the cable is bare, what is its surface temperature?
  - If a very thin coating of electrical insulation is applied to the cable, with a contact resistance of  $0.02 \text{ m}^2 \cdot \text{K/W}$ , what are the insulation and cable surface temperatures?

- (c) There is some concern about the ability of the insulation to withstand elevated temperatures. What thickness of this insulation ( $k = 0.5 \text{ W/m} \cdot \text{K}$ ) will yield the lowest value of the maximum insulation temperature? What is the value of the maximum temperature when the thickness is used?
- 3.48** A 0.20-m-diameter, thin-walled steel pipe is used to transport saturated steam at a pressure of 20 bars in a room for which the air temperature is  $25^\circ\text{C}$  and the convection heat transfer coefficient at the outer surface of the pipe is  $20 \text{ W/m}^2 \cdot \text{K}$ .
- (a) What is the heat loss per unit length from the bare pipe (no insulation)? Estimate the heat loss per unit length if a 50-mm-thick layer of insulation (magnesia, 85%) is added. The steel and magnesia may each be assumed to have an emissivity of 0.8, and the steam-side convection resistance may be neglected.
- (b) The costs associated with generating the steam and installing the insulation are known to be  $\$4/10^9 \text{ J}$  and  $\$100/\text{m}$  of pipe length, respectively. If the steam line is to operate 7500 h/yr, how many years are needed to pay back the initial investment in insulation?
- 3.49** Steam at a temperature of  $250^\circ\text{C}$  flows through a steel pipe (AISI 1010) of 60-mm inside diameter and 75-mm outside diameter. The convection coefficient between the steam and the inner surface of the pipe is  $500 \text{ W/m}^2 \cdot \text{K}$ , while that between the outer surface of the pipe and the surroundings is  $25 \text{ W/m}^2 \cdot \text{K}$ . The pipe emissivity is 0.8, and the temperature of the air and the surroundings is  $20^\circ\text{C}$ . What is the heat loss per unit length of pipe?
- 3.50** We wish to determine the effect of adding a layer of magnesia insulation to the steam pipe of the foregoing problem. The convection coefficient at the outer surface of the insulation may be assumed to remain at  $25 \text{ W/m}^2 \cdot \text{K}$ , and the emissivity is  $\varepsilon = 0.8$ . Determine and plot the heat loss per unit length of pipe and the outer surface temperature as a function of insulation thickness. If the cost of generating the steam is  $\$4/10^9 \text{ J}$  and the steam line operates 7000 h/yr, recommend an insulation thickness and determine the corresponding annual savings in energy costs. Plot the temperature distribution in the insulation for the recommended thickness.
- 3.51** An uninsulated, thin-walled pipe of 100-mm diameter is used to transport water to equipment that operates outdoors and uses the water as a coolant. During particularly harsh winter conditions, the pipe wall achieves a temperature of  $-15^\circ\text{C}$  and a cylindrical layer of ice forms on the inner surface of the wall. If the mean water temperature is  $3^\circ\text{C}$  and a convection coefficient of

$2000 \text{ W/m}^2 \cdot \text{K}$  is maintained at the inner surface of the ice, which is at  $0^\circ\text{C}$ , what is the thickness of the ice layer?

- 3.52** Steam flowing through a long, thin-walled pipe maintains the pipe wall at a uniform temperature of  $500 \text{ K}$ . The pipe is covered with an insulation blanket comprised of two different materials, A and B.

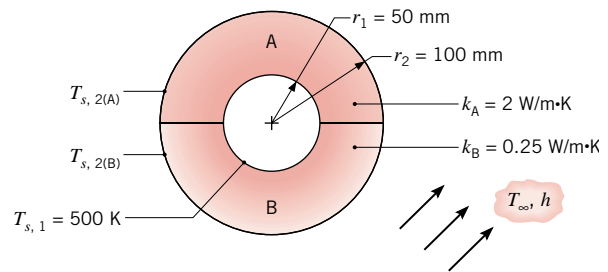

The interface between the two materials may be assumed to have an infinite contact resistance, and the entire outer surface is exposed to air for which  $T_\infty = 300 \text{ K}$  and  $h = 25 \text{ W/m}^2 \cdot \text{K}$ .

- (a) Sketch the thermal circuit of the system. Label (using the above symbols) all pertinent nodes and resistances.
- (b) For the prescribed conditions, what is the total heat loss from the pipe? What are the outer surface temperatures  $T_{s,2(A)}$  and  $T_{s,2(B)}$ ?
- 3.53** A bakelite coating is to be used with a 10-mm-diameter conducting rod, whose surface is maintained at  $200^\circ\text{C}$  by passage of an electrical current. The rod is in a fluid at  $25^\circ\text{C}$ , and the convection coefficient is  $140 \text{ W/m}^2 \cdot \text{K}$ . What is the critical radius associated with the coating? What is the heat transfer rate per unit length for the bare rod and for the rod with a coating of bakelite that corresponds to the critical radius? How much bakelite should be added to reduce the heat transfer associated with the bare rod by 25%?

## Spherical Wall

- 3.54** A storage tank consists of a cylindrical section that has a length and inner diameter of  $L = 2 \text{ m}$  and  $D_i = 1 \text{ m}$ , respectively, and two hemispherical end sections. The tank is constructed from 20-mm-thick glass (Pyrex) and is exposed to ambient air for which the temperature is  $300 \text{ K}$  and the convection coefficient is  $10 \text{ W/m}^2 \cdot \text{K}$ . The tank is used to store heated oil, which maintains the inner surface at a temperature of  $400 \text{ K}$ . Determine the electrical power that must be supplied to a heater submerged in the oil if the prescribed conditions are to be maintained. Radiation

effects may be neglected, and the Pyrex may be assumed to have a thermal conductivity of  $1.4 \text{ W/m} \cdot \text{K}$ .

- 3.55** Consider the liquid oxygen storage system and the laboratory environmental conditions of Problem 1.49. To reduce oxygen loss due to vaporization, an insulating layer should be applied to the outer surface of the container. Consider using a laminated aluminum foil/glass mat insulation, for which the thermal conductivity and surface emissivity are  $k = 0.00016 \text{ W/m} \cdot \text{K}$  and  $\varepsilon = 0.20$ , respectively.

(a) If the container is covered with a 10-mm-thick layer of insulation, what is the percentage reduction in oxygen loss relative to the uncovered container?

(b) Compute and plot the oxygen evaporation rate ( $\text{kg/s}$ ) as a function of the insulation thickness  $t$  for  $0 \leq t \leq 50 \text{ mm}$ .

- 3.56** In Example 3.5, an expression was derived for the critical insulation radius of an insulated, cylindrical tube. Derive the expression that would be appropriate for an insulated sphere.

- 3.57** A hollow aluminum sphere, with an electrical heater in the center, is used in tests to determine the thermal conductivity of insulating materials. The inner and outer radii of the sphere are 0.15 and 0.18 m, respectively, and testing is done under steady-state conditions with the inner surface of the aluminum maintained at  $250^\circ\text{C}$ . In a particular test, a spherical shell of insulation is cast on the outer surface of the sphere to a thickness of 0.12 m. The system is in a room for which the air temperature is  $20^\circ\text{C}$  and the convection coefficient at the outer surface of the insulation is  $30 \text{ W/m}^2 \cdot \text{K}$ . If 80 W are dissipated by the heater under steady-state conditions, what is the thermal conductivity of the insulation?

- 3.58** A spherical tank for storing liquid oxygen on the space shuttle is to be made from stainless steel of 0.80-m outer diameter and 5-mm wall thickness. The boiling point and latent heat of vaporization of liquid oxygen are 90 K and 213 kJ/kg, respectively. The tank is to be installed in a large compartment whose temperature is to be maintained at 240 K. Design a thermal insulation system that will maintain oxygen losses due to boiling below 1 kg/day.

- 3.59** A spherical, cryosurgical probe may be imbedded in diseased tissue for the purpose of freezing, and thereby destroying, the tissue. Consider a probe of 3-mm diameter whose surface is maintained at  $-30^\circ\text{C}$  when imbedded in tissue that is at  $37^\circ\text{C}$ . A spherical layer of frozen tissue forms around the probe, with a temperature of  $0^\circ\text{C}$  existing at the phase front (interface) between the frozen and normal tissue. If the thermal conductivity of frozen tissue is approximately  $1.5 \text{ W/m} \cdot \text{K}$  and heat transfer at the phase front may be characterized by

an effective convection coefficient of  $50 \text{ W/m}^2 \cdot \text{K}$ , what is the thickness of the layer of frozen tissue (assuming negligible perfusion)?

- 3.60** A spherical vessel used as a reactor for producing pharmaceuticals has a 10-mm-thick stainless steel wall ( $k = 17 \text{ W/m} \cdot \text{K}$ ) and an inner diameter of 1 m. The exterior surface of the vessel is exposed to ambient air ( $T_\infty = 25^\circ\text{C}$ ) for which a convection coefficient of  $6 \text{ W/m}^2 \cdot \text{K}$  may be assumed.

(a) During steady-state operation, an inner surface temperature of  $50^\circ\text{C}$  is maintained by energy generated within the reactor. What is the heat loss from the vessel?

(b) If a 20-mm-thick layer of fiberglass insulation ( $k = 0.040 \text{ W/m} \cdot \text{K}$ ) is applied to the exterior of the vessel and the rate of thermal energy generation is unchanged, what is the inner surface temperature of the vessel?

- 3.61** The wall of a spherical tank of 1-m diameter contains an exothermic chemical reaction and is at  $200^\circ\text{C}$  when the ambient air temperature is  $25^\circ\text{C}$ . What thickness of urethane foam is required to reduce the exterior temperature to  $40^\circ\text{C}$ , assuming the convection coefficient is  $20 \text{ W/m}^2 \cdot \text{K}$  for both situations? What is the percentage reduction in heat rate achieved by using the insulation?


- 3.62** A composite spherical shell of inner radius  $r_1 = 0.25 \text{ m}$  is constructed from lead of outer radius  $r_2 = 0.30 \text{ m}$  and AISI 302 stainless steel of outer radius  $r_3 = 0.31 \text{ m}$ . The cavity is filled with radioactive wastes that generate heat at a rate of  $\dot{q} = 5 \times 10^5 \text{ W/m}^3$ . It is proposed to submerge the container in oceanic waters that are at a temperature of  $T_\infty = 10^\circ\text{C}$  and provide a uniform convection coefficient of  $h = 500 \text{ W/m}^2 \cdot \text{K}$  at the outer surface of the container. Are there any problems associated with this proposal?

- 3.63** As an alternative to storing radioactive materials in oceanic waters, it is proposed that the system of Problem 3.62 be placed in a large tank for which the flow of water, and hence the convection coefficient  $h$ , can be controlled. Compute and plot the maximum temperature of the lead,  $T(r_1)$ , as a function of  $h$  for  $100 \leq h \leq 1000 \text{ W/m}^2 \cdot \text{K}$ . If the temperature of the lead is not to exceed  $500 \text{ K}$ , what is the minimum allowable value of  $h$ ? To improve system reliability, it is desirable to increase the thickness of the stainless steel shell. For  $h = 300, 500$ , and  $1000 \text{ W/m}^2 \cdot \text{K}$ , compute and plot the maximum lead temperature as a function of shell thickness for  $r_3 \geq 0.30 \text{ m}$ . What are the corresponding values of the maximum allowable thickness?

- 3.64** The energy transferred from the anterior chamber of the eye through the cornea varies considerably depending on whether a contact lens is worn. Treat the eye as a



spherical system and assume the system to be at steady state. The convection coefficient  $h_o$  is unchanged with and without the contact lens in place. The cornea and the lens cover one-third of the spherical surface area.

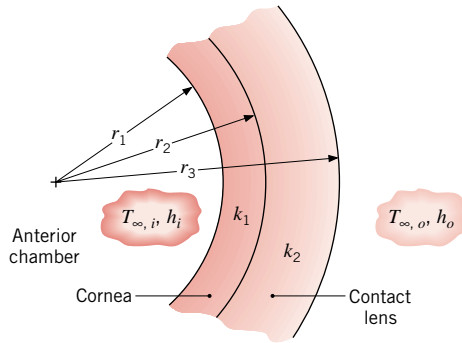


Values of the parameters representing this situation are as follows:

$$\begin{aligned} r_1 &= 10.2 \text{ mm} & r_2 &= 12.7 \text{ mm} \\ r_3 &= 16.5 \text{ mm} & T_{\infty,o} &= 21^\circ\text{C} \\ T_{\infty,i} &= 37^\circ\text{C} & k_2 &= 0.80 \text{ W/m} \cdot \text{K} \\ k_1 &= 0.35 \text{ W/m} \cdot \text{K} & h_o &= 6 \text{ W/m}^2 \cdot \text{K} \\ h_i &= 12 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

- Construct the thermal circuits, labeling all potentials and flows for the systems excluding the contact lens and including the contact lens. Write resistance elements in terms of appropriate parameters.
  - Determine the heat loss from the anterior chamber with and without the contact lens in place.
  - Discuss the implication of your results.
- 3.65** The outer surface of a hollow sphere of radius  $r_2$  is subjected to a uniform heat flux  $q_2''$ . The inner surface at  $r_1$  is held at a constant temperature  $T_{s,1}$ .
- Develop an expression for the temperature distribution  $T(r)$  in the sphere wall in terms of  $q_2''$ ,  $T_{s,1}$ ,  $r_1$ ,  $r_2$ , and the thermal conductivity of the wall material  $k$ .
  - If the inner and outer tube radii are  $r_1 = 50 \text{ mm}$  and  $r_2 = 100 \text{ mm}$ , what heat flux  $q_2''$  is required to maintain the outer surface at  $T_{s,2} = 50^\circ\text{C}$ , while the inner surface is at  $T_{s,1} = 20^\circ\text{C}$ ? The thermal conductivity of the wall material is  $k = 10 \text{ W/m} \cdot \text{K}$ .
- 3.66** A spherical shell of inner and outer radii  $r_i$  and  $r_o$ , respectively, is filled with a heat-generating material that provides for a uniform volumetric generation rate ( $\text{W/m}^3$ ) of  $\dot{q}$ . The outer surface of the shell is exposed to a fluid having a temperature  $T_\infty$  and a convection coefficient  $h$ . Obtain an expression for the steady-state temperature distribution  $T(r)$  in the shell, expressing your

result in terms of  $r_i$ ,  $r_o$ ,  $\dot{q}$ ,  $h$ ,  $T_\infty$ , and the thermal conductivity  $k$  of the shell material.

- 3.67** A spherical tank of 3-m diameter contains a liquified-petroleum gas at  $-60^\circ\text{C}$ . Insulation with a thermal conductivity of  $0.06 \text{ W/m} \cdot \text{K}$  and thickness 250 mm is applied to the tank to reduce the heat gain.
- Determine the radial position in the insulation layer at which the temperature is  $0^\circ\text{C}$  when the ambient air temperature is  $20^\circ\text{C}$  and the convection coefficient on the outer surface is  $6 \text{ W/m}^2 \cdot \text{K}$ .
  - If the insulation is pervious to moisture from the atmospheric air, what conclusions can you reach about the formation of ice in the insulation? What effect will ice formation have on heat gain to the LP gas? How could this situation be avoided?
- 3.68** A transistor, which may be approximated as a hemispherical heat source of radius  $r_o = 0.1 \text{ mm}$ , is embedded in a large silicon substrate ( $k = 125 \text{ W/m} \cdot \text{K}$ ) and dissipates heat at a rate  $q$ . All boundaries of the silicon are maintained at an ambient temperature of  $T_\infty = 27^\circ\text{C}$ , except for the top surface, which is well insulated.

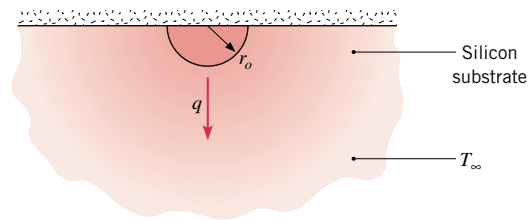

Obtain a general expression for the substrate temperature distribution and evaluate the surface temperature of the heat source for  $q = 4 \text{ W}$ .


- 3.69** One modality for destroying malignant tissue involves imbedding a small spherical heat source of radius  $r_o$  within the tissue and maintaining local temperatures above a critical value  $T_c$  for an extended period. Tissue that is well removed from the source may be assumed to remain at normal body temperature ( $T_b = 37^\circ\text{C}$ ). Obtain a general expression for the radial temperature distribution in the tissue under steady-state conditions for which heat is dissipated at a rate  $q$ . If  $r_o = 0.5 \text{ mm}$ , what heat rate must be supplied to maintain a tissue temperature of  $T \geq T_c = 42^\circ\text{C}$  in the domain  $0.5 \leq r \leq 5 \text{ mm}$ ? The tissue thermal conductivity is approximately  $0.5 \text{ W/m} \cdot \text{K}$ . Assume negligible perfusion.

## Conduction with Thermal Energy Generation


- 3.70** Consider cylindrical and spherical shells with inner and outer surfaces at  $r_1$  and  $r_2$  maintained at uniform

temperatures  $T_{s,1}$  and  $T_{s,2}$ , respectively. If there is uniform heat generation within the shells, obtain expressions for the steady-state, one-dimensional radial distributions of the temperature, heat flux, and heat rate. Contrast your results with those summarized in Appendix C.

- 3.71** The steady-state temperature distribution in a composite plane wall of three different materials, each of constant thermal conductivity, is shown as follows.

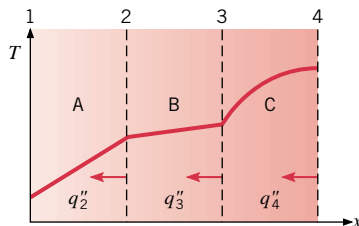

- Comment on the relative magnitudes of  $q''_2$  and  $q''_3$  and of  $q''_3$  and  $q''_4$ .
  - Comment on the relative magnitudes of  $k_A$  and  $k_B$  and of  $k_B$  and  $k_C$ .
  - Sketch the heat flux as a function of  $x$ .
- 3.72** A plane wall of thickness 0.1 m and thermal conductivity  $25 \text{ W/m} \cdot \text{K}$  having uniform volumetric heat generation of  $0.3 \text{ MW/m}^3$  is insulated on one side, while the other side is exposed to a fluid at  $92^\circ\text{C}$ . The convection heat transfer coefficient between the wall and the fluid is  $500 \text{ W/m}^2 \cdot \text{K}$ . Determine the maximum temperature in the wall.
- 3.73** Consider one-dimensional conduction in a plane composite wall. The outer surfaces are exposed to a fluid at  $25^\circ\text{C}$  and a convection heat transfer coefficient of  $1000 \text{ W/m}^2 \cdot \text{K}$ . The middle wall B experiences uniform heat generation  $\dot{q}_B$ , while there is no generation in walls A and C. The temperatures at the interfaces are  $T_1 = 261^\circ\text{C}$  and  $T_2 = 211^\circ\text{C}$ .

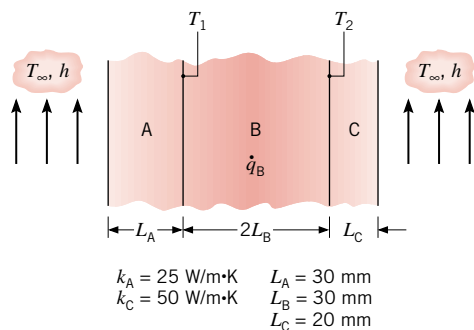


- Assuming negligible contact resistance at the interfaces, determine the volumetric heat generation  $\dot{q}_B$  and the thermal conductivity  $k_B$ .
- Plot the temperature distribution, showing its important features.
- Consider conditions corresponding to a loss of coolant at the exposed surface of material A ( $h = 0$ ). Determine  $T_1$  and  $T_2$  and plot the temperature distribution throughout the system.

- 3.74** Consider a plane composite wall that is composed of three materials (materials A, B, and C are arranged left to right) of thermal conductivities  $k_A = 0.24 \text{ W/m} \cdot \text{K}$ ,  $k_B = 0.13 \text{ W/m} \cdot \text{K}$ , and  $k_C = 0.50 \text{ W/m} \cdot \text{K}$ . The thicknesses of the three sections of the wall are  $L_A = 20 \text{ mm}$ ,  $L_B = 13 \text{ mm}$ , and  $L_C = 20 \text{ mm}$ . A contact resistance of  $R''_{t,c} = 10^{-2} \text{ m}^2 \cdot \text{K/W}$  exists at the interface between materials A and B, as well as at the interface between materials B and C. The left face of the composite wall is insulated, while the right face is exposed to convective conditions characterized by  $h = 10 \text{ W/m}^2 \cdot \text{K}$ ,  $T_\infty = 20^\circ\text{C}$ . For Case 1, thermal energy is generated within material A at the rate  $\dot{q}_A = 5000 \text{ W/m}^3$ . For Case 2, thermal energy is generated within material C at the rate  $\dot{q}_C = 5000 \text{ W/m}^3$ .

- Determine the maximum temperature within the composite wall under steady-state conditions for Case 1.
- Sketch the steady-state temperature distribution on  $T - x$  coordinates for Case 1.
- Sketch the steady-state temperature distribution for Case 2 on the same  $T - x$  coordinates used for Case 1.


- 3.75** Consider the composite wall of Example 3.7. In the Comments section, temperature distributions in the wall were determined assuming negligible contact resistance between materials A and B. Compute and plot the temperature distributions if the thermal contact resistance is  $R''_{t,c} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ .

- 3.76** A plane wall of thickness  $2L$  and thermal conductivity  $k$  experiences a uniform volumetric generation rate  $\dot{q}$ . As shown in the sketch for Case 1, the surface at  $x = -L$  is perfectly insulated, while the other surface is maintained at a uniform, constant temperature  $T_o$ . For Case 2, a very thin dielectric strip is inserted at the midpoint of the wall ( $x = 0$ ) in order to electrically isolate the two sections, A and B. The thermal resistance of the strip is  $R''_t = 0.0005 \text{ m}^2 \cdot \text{K/W}$ . The parameters associated with the wall are  $k = 50 \text{ W/m} \cdot \text{K}$ ,  $L = 20 \text{ mm}$ ,  $\dot{q} = 5 \times 10^6 \text{ W/m}^3$ , and  $T_o = 50^\circ\text{C}$ .

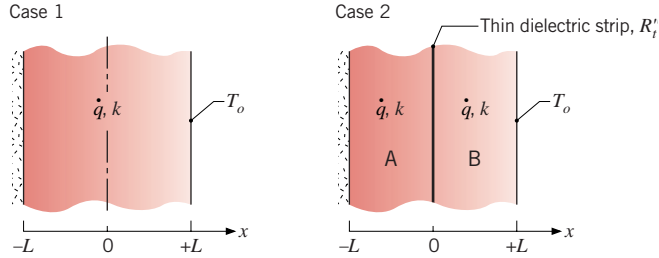

- Sketch the temperature distribution for case 1 on  $T-x$  coordinates. Describe the key features of this distribution. Identify the location of the maximum temperature in the wall and calculate this temperature.
- Sketch the temperature distribution for Case 2 on the same  $T-x$  coordinates. Describe the key features of this distribution.
- What is the temperature difference between the two walls at  $x=0$  for Case 2?
- What is the location of the maximum temperature in the composite wall of Case 2? Calculate this temperature.

**3.77** A nuclear fuel element of thickness  $2L$  is covered with a steel cladding of thickness  $b$ . Heat generated within the nuclear fuel at a rate  $\dot{q}$  is removed by a fluid at  $T_\infty$ , which adjoins one surface and is characterized by a convection coefficient  $h$ . The other surface is well insulated, and the fuel and steel have thermal conductivities of  $k_f$  and  $k_s$ , respectively.

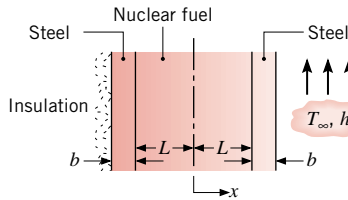

- Obtain an equation for the temperature distribution  $T(x)$  in the nuclear fuel. Express your results in terms of  $\dot{q}$ ,  $k_f$ ,  $L$ ,  $b$ ,  $k_s$ ,  $h$ , and  $T_\infty$ .
- Sketch the temperature distribution  $T(x)$  for the entire system.


**3.78** Consider the clad fuel element of Problem 3.77.

- Using appropriate relations from Tables C.1 and C.2, obtain an expression for the temperature distribution  $T(x)$  in the fuel element. For  $k_f = 60 \text{ W/m} \cdot \text{K}$ ,  $L = 15 \text{ mm}$ ,  $b = 3 \text{ mm}$ ,  $k_s = 15 \text{ W/m} \cdot \text{K}$ ,  $h = 10,000 \text{ W/m}^2 \cdot \text{K}$ , and  $T_\infty = 200^\circ\text{C}$ , what are the largest and smallest temperatures in the fuel element if heat is

generated uniformly at a volumetric rate of  $\dot{q} = 2 \times 10^7 \text{ W/m}^3$ ? What are the corresponding locations?

- If the insulation is removed and equivalent convection conditions are maintained at each surface, what is the corresponding form of the temperature distribution in the fuel element? For the conditions of part (a), what are the largest and smallest temperatures in the fuel? What are the corresponding locations?
- For the conditions of parts (a) and (b), plot the temperature distributions in the fuel element.

**3.79** The air *inside* a chamber at  $T_{\infty,i} = 50^\circ\text{C}$  is heated convectively with  $h_i = 20 \text{ W/m}^2 \cdot \text{K}$  by a 200-mm-thick wall having a thermal conductivity of  $4 \text{ W/m} \cdot \text{K}$  and a uniform heat generation of  $1000 \text{ W/m}^3$ . To prevent any heat generated within the wall from being lost to the *outside* of the chamber at  $T_{\infty,o} = 25^\circ\text{C}$  with  $h_o = 5 \text{ W/m}^2 \cdot \text{K}$ , a very thin electrical strip heater is placed on the outer wall to provide a uniform heat flux,  $q_o''$ .

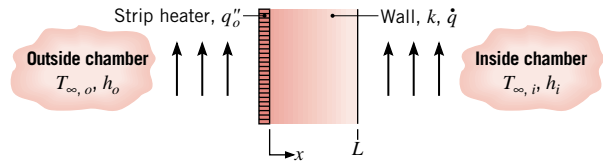

- Sketch the temperature distribution in the wall on  $T-x$  coordinates for the condition where no heat generated within the wall is lost to the *outside* of the chamber.
- What are the temperatures at the wall boundaries,  $T(0)$  and  $T(L)$ , for the conditions of part (a)?
- Determine the value of  $q_o''$  that must be supplied by the strip heater so that all heat generated within the wall is transferred to the *inside* of the chamber.
- If the heat generation in the wall were switched off while the heat flux to the strip heater remained constant, what would be the steady-state temperature,  $T(0)$ , of the outer wall surface?

**3.80** In the previous problem, the strip heater acts to *guard* against heat losses from the wall to the outside, and the required heat flux  $q_o''$  depends on chamber operating conditions such as  $\dot{q}$  and  $T_{\infty,i}$ . As a first step in designing a controller for the guard heater, compute and plot  $q_o''$  and  $T(0)$  as a function of  $\dot{q}$  for  $200 \leq \dot{q} \leq 2000 \text{ W/m}^3$  and  $T_{\infty,i} = 30, 50, \text{ and } 70^\circ\text{C}$ .

**3.81** The exposed surface ( $x=0$ ) of a plane wall of thermal conductivity  $k$  is subjected to microwave radiation that causes volumetric heating to vary as

$$\dot{q}(x) = \dot{q}_o \left(1 - \frac{x}{L}\right)$$



where  $\dot{q}_o$  ( $\text{W/m}^3$ ) is a constant. The boundary at  $x = L$  is perfectly insulated, while the exposed surface is maintained at a constant temperature  $T_o$ . Determine the temperature distribution  $T(x)$  in terms of  $x$ ,  $L$ ,  $k$ ,  $\dot{q}_o$ , and  $T_o$ .

- 3.82** A quartz window of thickness  $L$  serves as a viewing port in a furnace used for annealing steel. The inner surface ( $x = 0$ ) of the window is irradiated with a uniform heat flux  $q_o''$  due to emission from hot gases in the furnace. A fraction,  $\beta$ , of this radiation may be assumed to be absorbed at the inner surface, while the remaining radiation is partially absorbed as it passes through the quartz. The volumetric heat generation due to this absorption may be described by an expression of the form

$$\dot{q}(x) = (1 - \beta)q_o''\alpha e^{-\alpha x}$$


where  $\alpha$  is the absorption coefficient of the quartz. Convection heat transfer occurs from the outer surface ( $x = L$ ) of the window to ambient air at  $T_\infty$  and is characterized by the convection coefficient  $h$ . Convection and radiation emission from the inner surface may be neglected, along with radiation emission from the outer surface. Determine the temperature distribution in the quartz, expressing your result in terms of the foregoing parameters.

- 3.83** For the conditions described in Problem 1.44, determine the temperature distribution,  $T(r)$ , in the container, expressing your result in terms of  $\dot{q}_o$ ,  $r_o$ ,  $T_\infty$ ,  $h$ , and the thermal conductivity  $k$  of the radioactive wastes.
- 3.84** A cylindrical shell of inner and outer radii,  $r_i$  and  $r_o$ , respectively, is filled with a heat-generating material that provides a uniform volumetric generation rate ( $\text{W/m}^3$ ) of  $\dot{q}$ . The inner surface is insulated, while the outer surface of the shell is exposed to a fluid at  $T_\infty$  and a convection coefficient  $h$ .
- Obtain an expression for the steady-state temperature distribution,  $T(r)$ , in the shell, expressing your result in terms of  $r_i$ ,  $r_o$ ,  $\dot{q}$ ,  $h$ ,  $T_\infty$ , and the thermal conductivity  $k$  of the shell material.
  - Determine an expression for the heat rate,  $q'(r_o)$ , at the outer radius of the shell in terms of  $\dot{q}$  and shell dimensions.

- 3.85** Consider the solid tube of Example 3.8. Using Equation (7) with Equation (10) in the *IHT* workspace, calculate and plot the temperature distributions for a tube of inner and outer radii, 50 mm and 100 mm, and a thermal conductivity of  $5 \text{ W/m} \cdot \text{K}$  for volumetric generation rates of  $1 \times 10^5$ ,  $5 \times 10^5$ , and  $1 \times 10^6 \text{ W/m}^3$ . The inner surface is cooled by a fluid at  $30^\circ\text{C}$  with a convection coefficient of  $1000 \text{ W/m}^2 \cdot \text{K}$ .


- 3.86** An air heater may be fabricated by coiling Nichrome wire and passing air in cross flow over the wire.

Consider a heater fabricated from wire of diameter  $D = 1 \text{ mm}$ , electrical resistivity  $\rho_e = 10^{-6} \Omega \cdot \text{m}$ , thermal conductivity  $k = 25 \text{ W/m} \cdot \text{K}$ , and emissivity  $\varepsilon = 0.20$ . The heater is designed to deliver air at a temperature of  $T_\infty = 50^\circ\text{C}$  under flow conditions that provide a convection coefficient of  $h = 250 \text{ W/m}^2 \cdot \text{K}$  for the wire. The temperature of the housing that encloses the wire and through which the air flows is  $T_{\text{sur}} = 50^\circ\text{C}$ .

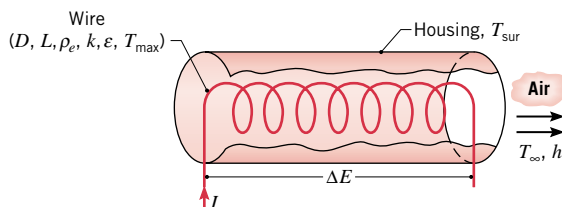

If the maximum allowable temperature of the wire is  $T_{\text{max}} = 1200^\circ\text{C}$ , what is the maximum allowable electric current  $I$ ? If the maximum available voltage is  $\Delta E = 110 \text{ V}$ , what is the corresponding length  $L$  of wire that may be used in the heater and the power rating of the heater? *Hint:* In your solution, assume negligible temperature variations within the wire, but after obtaining the desired results, assess the validity of this assumption.

- 3.87** The cross section of a long cylindrical fuel element in a nuclear reactor is shown. Energy generation occurs uniformly in the thorium fuel rod, which is of diameter  $D = 25 \text{ mm}$  and is wrapped in a thin aluminum cladding.

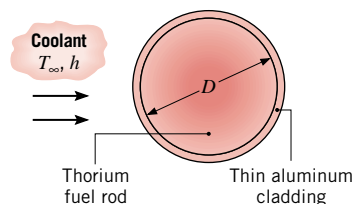

- It is proposed that, under steady-state conditions, the system operates with a generation rate of  $\dot{q} = 7 \times 10^8 \text{ W/m}^3$  and cooling system characteristics of  $T_\infty = 95^\circ\text{C}$  and  $h = 7000 \text{ W/m}^2 \cdot \text{K}$ . Is this proposal satisfactory?
- Explore the effect of variations in  $\dot{q}$  and  $h$  by plotting temperature distributions,  $T(r)$ , for a range of parameter values. Suggest an envelope of acceptable operating conditions.

- 3.88** A nuclear reactor fuel element consists of a solid cylindrical pin of radius  $r_1$  and thermal conductivity  $k_f$ . The fuel pin is in good contact with a cladding material of outer radius  $r_2$  and thermal conductivity  $k_c$ . Consider steady-state conditions for which uniform

heat generation occurs within the fuel at a volumetric rate  $\dot{q}$  and the outer surface of the cladding is exposed to a coolant that is characterized by a temperature  $T_\infty$  and a convection coefficient  $h$ .

- (a) Obtain equations for the temperature distributions  $T_f(r)$  and  $T_c(r)$  in the fuel and cladding, respectively. Express your results exclusively in terms of the foregoing variables.
- (b) Consider a uranium oxide fuel pin for which  $k_f = 2 \text{ W/m} \cdot \text{K}$  and  $r_1 = 6 \text{ mm}$  and cladding for which  $k_c = 25 \text{ W/m} \cdot \text{K}$  and  $r_2 = 9 \text{ mm}$ . If  $\dot{q} = 2 \times 10^8 \text{ W/m}^3$ ,  $h = 2000 \text{ W/m}^2 \cdot \text{K}$ , and  $T_\infty = 300 \text{ K}$ , what is the maximum temperature in the fuel element?
- (c) Compute and plot the temperature distribution,  $T(r)$ , for values of  $h = 2000, 5000$ , and  $10,000 \text{ W/m}^2 \cdot \text{K}$ . If the operator wishes to maintain the centerline temperature of the fuel element below  $1000 \text{ K}$ , can she do so by adjusting the coolant flow and hence the value of  $h$ ?


**3.89** Consider the configuration of Example 3.8, where uniform volumetric heating within a stainless steel tube is induced by an electric current and heat is transferred by convection to air flowing through the tube. The tube wall has inner and outer radii of  $r_1 = 25 \text{ mm}$  and  $r_2 = 35 \text{ mm}$ , a thermal conductivity of  $k = 15 \text{ W/m} \cdot \text{K}$ , an electrical resistivity of  $\rho_e = 0.7 \times 10^{-6} \Omega \cdot \text{m}$ , and a maximum allowable operating temperature of  $1400 \text{ K}$ .

- (a) Assuming the outer tube surface to be perfectly insulated and the air flow to be characterized by a temperature and convection coefficient of  $T_{\infty,1} = 400 \text{ K}$  and  $h_1 = 100 \text{ W/m}^2 \cdot \text{K}$ , determine the maximum allowable electric current  $I$ .
- (b) Compute and plot the radial temperature distribution in the tube wall for the electric current of part (a) and three values of  $h_1$  (100, 500, and  $1000 \text{ W/m}^2 \cdot \text{K}$ ). For each value of  $h_1$ , determine the rate of heat transfer to the air per unit length of tube.
- (c) In practice, even the best of insulating materials would be unable to maintain adiabatic conditions at the outer tube surface. Consider use of a refractory insulating material of thermal conductivity  $k = 1.0 \text{ W/m} \cdot \text{K}$  and neglect radiation exchange at its outer surface. For  $h_1 = 100 \text{ W/m}^2 \cdot \text{K}$  and the maximum allowable current determined in part (a), compute and plot the temperature distribution in the composite wall for two values of the insulation thickness ( $\delta = 25$  and  $50 \text{ mm}$ ). The outer surface of the insulation is exposed to room air for which  $T_{\infty,2} = 300 \text{ K}$  and  $h_2 = 25 \text{ W/m}^2 \cdot \text{K}$ . For each insulation thickness, determine the rate of heat transfer per unit tube length to the inner air flow and the ambient air.

**3.90** A homeowner, whose water pipes have frozen during a period of cold weather, decides to melt the ice by passing an electric current  $I$  through the pipe wall. The inner and outer radii of the wall are designated as  $r_1$  and  $r_2$ , and its electrical resistance per unit length is designated as  $R'_e (\Omega/\text{m})$ . The pipe is well insulated on the outside, and during melting the ice (and water) in the pipe remain at a constant temperature  $T_m$  associated with the melting process.

- (a) Assuming that steady-state conditions are reached shortly after application of the current, determine the form of the steady-state temperature distribution  $T(r)$  in the pipe wall during the melting process.
- (b) Develop an expression for the time  $t_m$  required to completely melt the ice. Calculate this time for  $I = 100 \text{ A}$ ,  $R'_e = 0.30 \Omega/\text{m}$ , and  $r_1 = 50 \text{ mm}$ .


**3.91** A high-temperature, gas-cooled nuclear reactor consists of a composite cylindrical wall for which a thorium fuel element ( $k \approx 57 \text{ W/m} \cdot \text{K}$ ) is encased in graphite ( $k \approx 3 \text{ W/m} \cdot \text{K}$ ) and gaseous helium flows through an annular coolant channel. Consider conditions for which the helium temperature is  $T_\infty = 600 \text{ K}$  and the convection coefficient at the outer surface of the graphite is  $h = 2000 \text{ W/m}^2 \cdot \text{K}$ .

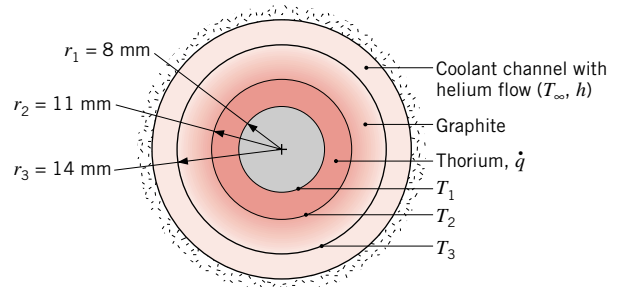

- (a) If thermal energy is uniformly generated in the fuel element at a rate  $\dot{q} = 10^8 \text{ W/m}^3$ , what are the temperatures  $T_1$  and  $T_2$  at the inner and outer surfaces, respectively, of the fuel element?
  - (b) Compute and plot the temperature distribution in the composite wall for selected values of  $\dot{q}$ . What is the maximum allowable value of  $\dot{q}$ ?
- 3.92** A long cylindrical rod of diameter  $200 \text{ mm}$  with thermal conductivity of  $0.5 \text{ W/m} \cdot \text{K}$  experiences uniform volumetric heat generation of  $24,000 \text{ W/m}^3$ . The rod is encapsulated by a circular sleeve having an outer diameter of  $400 \text{ mm}$  and a thermal conductivity of  $4 \text{ W/m} \cdot \text{K}$ . The outer surface of the sleeve is exposed to cross flow of air at  $27^\circ\text{C}$  with a convection coefficient of  $25 \text{ W/m}^2 \cdot \text{K}$ .
- (a) Find the temperature at the interface between the rod and sleeve and on the outer surface.
  - (b) What is the temperature at the center of the rod?


**3.93** A radioactive material of thermal conductivity  $k$  is cast as a solid sphere of radius  $r_o$  and placed in a liquid bath for which the temperature  $T_\infty$  and convection coefficient  $h$  are known. Heat is uniformly generated within the solid at a volumetric rate of  $\dot{q}$ . Obtain the steady-state radial temperature distribution in the solid, expressing your result in terms of  $r_o$ ,  $\dot{q}$ ,  $k$ ,  $h$ , and  $T_\infty$ .

**3.94** Radioactive wastes are packed in a thin-walled spherical container. The wastes generate thermal energy nonuniformly according to the relation  $\dot{q} = \dot{q}_o[1 - (r/r_o)^2]$ , where  $\dot{q}$  is the local rate of energy generation per unit volume,  $\dot{q}_o$  is a constant, and  $r_o$  is the radius of the container. Steady-state conditions are maintained by submerging the container in a liquid that is at  $T_\infty$  and provides a uniform convection coefficient  $h$ .

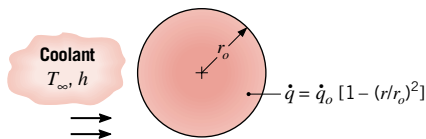

Determine the temperature distribution,  $T(r)$ , in the container. Express your result in terms of  $\dot{q}_o$ ,  $r_o$ ,  $T_\infty$ ,  $h$ , and the thermal conductivity  $k$  of the radioactive wastes.


**3.95** Radioactive wastes ( $k_{rw} = 20 \text{ W/m} \cdot \text{K}$ ) are stored in a spherical, stainless steel ( $k_{ss} = 15 \text{ W/m} \cdot \text{K}$ ) container of inner and outer radii equal to  $r_i = 0.5 \text{ m}$  and  $r_o = 0.6 \text{ m}$ . Heat is generated volumetrically within the wastes at a uniform rate of  $\dot{q} = 10^5 \text{ W/m}^3$ , and the outer surface of the container is exposed to a water flow for which  $h = 1000 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 25^\circ\text{C}$ .

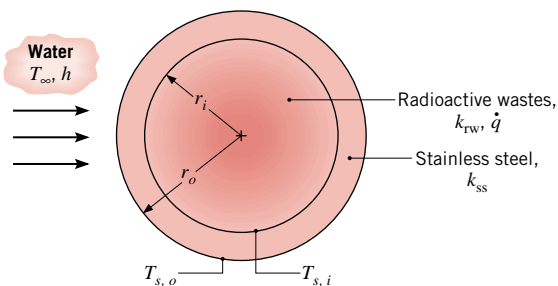

- Evaluate the steady-state outer surface temperature,  $T_{s,o}$ .
- Evaluate the steady-state inner surface temperature,  $T_{s,i}$ .
- Obtain an expression for the temperature distribution,  $T(r)$ , in the radioactive wastes. Express your result in terms of  $r_i$ ,  $T_{s,i}$ ,  $k_{rw}$ , and  $\dot{q}$ . Evaluate the temperature at  $r = 0$ .

(d) A proposed extension of the foregoing design involves storing waste materials having the same thermal conductivity but twice the heat generation ( $\dot{q} = 2 \times 10^5 \text{ W/m}^3$ ) in a stainless steel container of equivalent inner radius ( $r_i = 0.5 \text{ m}$ ). Safety considerations dictate that the maximum system temperature not exceed  $475^\circ\text{C}$  and that the container wall thickness be no less than  $t = 0.04 \text{ m}$  and preferably at or close to the original design ( $t = 0.1 \text{ m}$ ). Assess the effect of varying the outside convection coefficient to a maximum achievable value of  $h = 5000 \text{ W/m}^2 \cdot \text{K}$  (by increasing the water velocity) and the container wall thickness. Is the proposed extension feasible? If so, recommend suitable operating and design conditions for  $h$  and  $t$ , respectively.


**3.96** Unique characteristics of biologically active materials such as fruits, vegetables, and other products require special care in handling. Following harvest and separation from producing plants, glucose is catabolized to produce carbon dioxide, water vapor, and heat, with attendant internal energy generation. Consider a carton of apples, each of 80-mm diameter, which is ventilated with air at  $5^\circ\text{C}$  and a velocity of  $0.5 \text{ m/s}$ . The corresponding value of the heat transfer coefficient is  $7.5 \text{ W/m}^2 \cdot \text{K}$ . Within each apple thermal energy is uniformly generated at a total rate of  $4000 \text{ J/kg} \cdot \text{day}$ . The density and thermal conductivity of the apple are  $840 \text{ kg/m}^3$  and  $0.5 \text{ W/m} \cdot \text{K}$ , respectively.

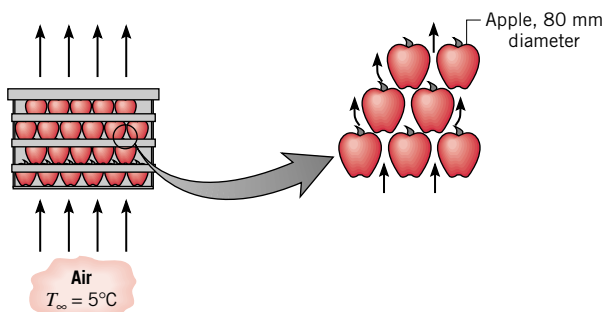

(a) Determine the apple center and surface temperatures.

(b) For the stacked arrangement of apples within the crate, the convection coefficient depends on the velocity as  $h = C_1 V^{0.425}$ , where  $C_1 = 10.1 \text{ W/m}^2 \cdot \text{K} \cdot (\text{m/s})^{0.425}$ . Compute and plot the center and surface temperatures as a function of the air velocity for  $0.1 \leq V \leq 1 \text{ m/s}$ .


**3.97** Consider the plane wall, long cylinder, and sphere shown schematically, each with the same characteristic length  $a$ , thermal conductivity  $k$ , and uniform volumetric energy generation rate  $\dot{q}$ .

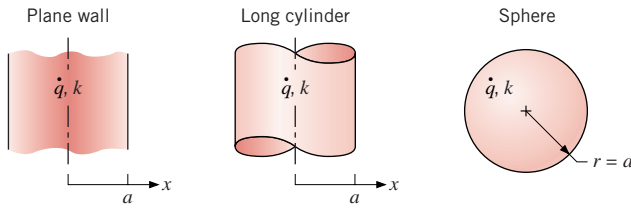

- On the same graph, plot the steady-state dimensionless temperature,  $[T(x \text{ or } r) - T(a)]/[(\dot{q}a^2)/2k]$ , versus the dimensionless characteristic length,  $x/a$  or  $r/a$ , for each shape.
- Which shape has the smallest temperature difference between the center and the surface? Explain this behavior by comparing the ratio of the volume-to-surface area.
- Which shape would be preferred for use as a nuclear fuel element? Explain why.


### Extended Surfaces

- 3.98** The radiation heat gage shown in the diagram is made from constantan metal foil, which is coated black and is in the form of a circular disk of radius  $R$  and thickness  $t$ . The gage is located in an evacuated enclosure. The incident radiation flux absorbed by the foil,  $q_i''$ , diffuses toward the outer circumference and into the larger copper ring, which acts as a heat sink at the constant temperature  $T(R)$ . Two copper lead wires are attached to the center of the foil and to the ring to complete a thermocouple circuit that allows for measurement of the temperature difference between the foil center and the foil edge,  $\Delta T = T(0) - T(R)$ .

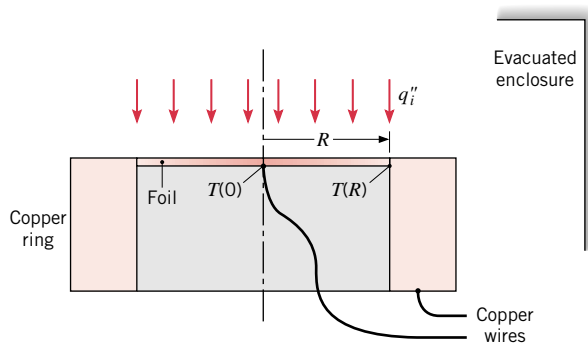


Obtain the differential equation that determines  $T(r)$ , the temperature distribution in the foil, under steady-state conditions. Solve this equation to obtain an expression relating  $\Delta T$  to  $q_i''$ . You may neglect radiation exchange between the foil and its surroundings.

- 3.99** Copper tubing is joined to the absorber of a flat-plate solar collector as shown.

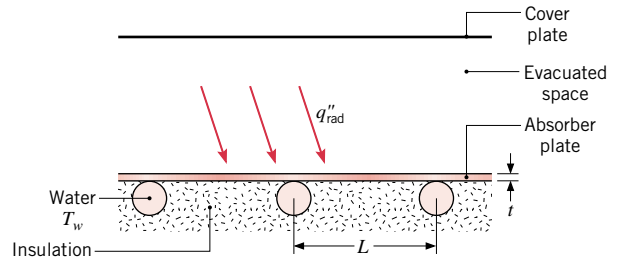

The aluminum alloy (2024-T6) absorber plate is 6 mm thick and well insulated on its bottom. The top surface of the plate is separated from a transparent cover plate by an evacuated space. The tubes are spaced a distance  $L$  of 0.20 m from each other, and water is circulated through the tubes to remove the collected energy. The water may be assumed to be at a uniform temperature of  $T_w = 60^\circ\text{C}$ . Under steady-state operating conditions for which the *net* radiation heat flux to the surface is  $q_{\text{rad}}'' = 800 \text{ W/m}^2$ , what is the maximum temperature on the plate and the heat transfer rate per unit length of tube? Note that  $q_{\text{rad}}''$  represents the net effect of solar radiation absorption by the absorber plate and radiation exchange between the absorber and cover plates. You may assume the temperature of the absorber plate directly above a tube to be equal to that of the water.


- 3.100** Copper tubing is joined to a solar collector plate of thickness  $t$ , and the working fluid maintains the temperature of the plate above the tubes at  $T_o$ . There is a uniform net radiation heat flux  $q_{\text{rad}}''$  to the top surface of the plate, while the bottom surface is well insulated. The top surface is also exposed to a fluid at  $T_\infty$  that provides for a uniform convection coefficient  $h$ .

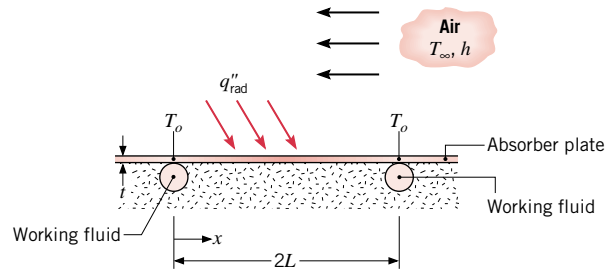

- Derive the differential equation that governs the temperature distribution  $T(x)$  in the plate.
- Obtain a solution to the differential equation for appropriate boundary conditions.

- 3.101** A thin flat plate of length  $L$ , thickness  $t$ , and width  $W \gg L$  is thermally joined to two large heat sinks that are maintained at a temperature  $T_o$ . The bottom of the

plate is well insulated, while the net heat flux to the top surface of the plate is known to have a uniform value of  $q_o''$ .

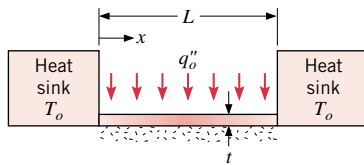

- Derive the differential equation that determines the steady-state temperature distribution  $T(x)$  in the plate.
- Solve the foregoing equation for the temperature distribution, and obtain an expression for the rate of heat transfer from the plate to the heat sinks.


**3.102** Consider the flat plate of Problem 3.101, but with the heat sinks at different temperatures,  $T(0) = T_o$  and  $T(L) = T_L$ , and with the bottom surface no longer insulated. Convection heat transfer is now allowed to occur between this surface and a fluid at  $T_\infty$ , with a convection coefficient  $h$ .

- Derive the differential equation that determines the steady-state temperature distribution  $T(x)$  in the plate.
- Solve the foregoing equation for the temperature distribution, and obtain an expression for the rate of heat transfer from the plate to the heat sinks.

(c) For  $q_o'' = 20,000 \text{ W/m}^2$ ,  $T_o = 100^\circ\text{C}$ ,  $T_L = 35^\circ\text{C}$ ,  $T_\infty = 25^\circ\text{C}$ ,  $k = 25 \text{ W/m} \cdot \text{K}$ ,  $h = 50 \text{ W/m}^2 \cdot \text{K}$ ,  $L = 100 \text{ mm}$ ,  $t = 5 \text{ mm}$ , and a plate width of  $W = 30 \text{ mm}$ , plot the temperature distribution and determine the sink heat rates,  $q_x(0)$  and  $q_x(L)$ . On the same graph, plot three additional temperature distributions corresponding to changes in the following parameters, with the remaining parameters unchanged: (i)  $q_o'' = 30,000 \text{ W/m}^2$ , (ii)  $h = 200 \text{ W/m}^2 \cdot \text{K}$ , and (iii) the value of  $q_o''$  for which  $q_x(0) = 0$  when  $h = 200 \text{ W/m}^2 \cdot \text{K}$ .

**3.103** A bonding operation utilizes a laser to provide a constant heat flux,  $q_o''$ , across the top surface of a thin adhesive-backed, plastic film to be affixed to a metal strip as shown in the sketch. The metal strip has a thickness  $d = 1.25 \text{ mm}$  and its width is large relative to that of the film. The thermophysical properties of the strip are  $\rho = 7850 \text{ kg/m}^3$ ,  $c_p = 435 \text{ J/kg} \cdot \text{K}$ , and  $k = 60 \text{ W/m} \cdot \text{K}$ . The thermal resistance of the plastic film of width  $w_1 = 40 \text{ mm}$  is negligible. The upper and lower surfaces of the strip (including the plastic film) experience convection with air at  $25^\circ\text{C}$  and a convection coefficient of  $10 \text{ W/m}^2 \cdot \text{K}$ . The strip and film are very


long in the direction normal to the page. Assume the edges of the metal strip are at the air temperature ( $T_\infty$ ).

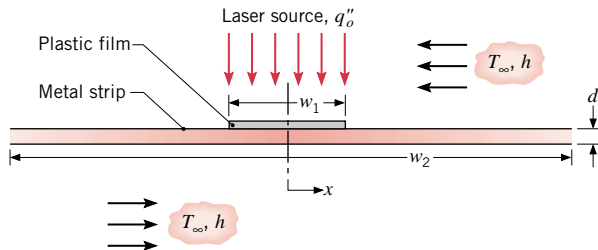

- Derive an expression for the temperature distribution in the portion of the steel strip with the plastic film ( $-w_1/2 \leq x \leq w_1/2$ ).
- If the heat flux provided by the laser is  $10,000 \text{ W/m}^2$ , determine the temperature of the plastic film at the center ( $x = 0$ ) and its edges ( $x = \pm w_1/2$ ).
- Plot the temperature distribution for the entire strip and point out its special features.

**3.104** A thin metallic wire of thermal conductivity  $k$ , diameter  $D$ , and length  $2L$  is annealed by passing an electrical current through the wire to induce a uniform volumetric heat generation  $\dot{q}$ . The ambient air around the wire is at a temperature  $T_\infty$ , while the ends of the wire at  $x = \pm L$  are also maintained at  $T_\infty$ . Heat transfer from the wire to the air is characterized by the convection coefficient  $h$ . Obtain an expression for the steady-state temperature distribution  $T(x)$  along the wire.

**3.105** A motor draws electric power  $P_{\text{elec}}$  from a supply line and delivers mechanical power  $P_{\text{mech}}$  to a pump through a rotating copper shaft of thermal conductivity  $k_s$ , length  $L$ , and diameter  $D$ . The motor is mounted on a square pad of width  $W$ , thickness  $t$ , and thermal conductivity  $k_p$ . The surface of the housing exposed to ambient air at  $T_\infty$  is of area  $A_h$ , and the corresponding convection coefficient is  $h_h$ . Opposite ends of the shaft are at temperatures of  $T_h$  and  $T_\infty$ , and heat transfer from the shaft to the ambient air is characterized by the convection coefficient  $h_s$ . The base of the pad is at  $T_\infty$ .

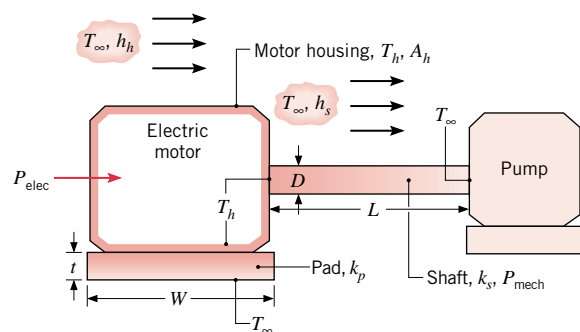




- (a) Expressing your result in terms of  $P_{\text{elec}}$ ,  $P_{\text{mech}}$ ,  $k_s$ ,  $L$ ,  $D$ ,  $W$ ,  $t$ ,  $k_p$ ,  $A_h$ ,  $h_h$ , and  $h_s$ , obtain an expression for  $(T_h - T_\infty)$ .
- (b) What is the value of  $T_h$  if  $P_{\text{elec}} = 25 \text{ kW}$ ,  $P_{\text{mech}} = 15 \text{ kW}$ ,  $k_s = 400 \text{ W/m} \cdot \text{K}$ ,  $L = 0.5 \text{ m}$ ,  $D = 0.05 \text{ m}$ ,  $W = 0.7 \text{ m}$ ,  $t = 0.05 \text{ m}$ ,  $k_p = 0.5 \text{ W/m} \cdot \text{K}$ ,  $A_h = 2 \text{ m}^2$ ,  $h_h = 10 \text{ W/m}^2 \cdot \text{K}$ ,  $h_s = 300 \text{ W/m}^2 \cdot \text{K}$ , and  $T_\infty = 25^\circ\text{C}$ ?


**3.106** Consider the fuel cell stack of Problem 1.58. The  $t = 0.42 \text{ mm}$  thick membranes have a nominal thermal conductivity of  $k = 0.79 \text{ W/m} \cdot \text{K}$  that can be increased to  $k_{\text{eff},x} = 15.1 \text{ W/m} \cdot \text{K}$  by loading 10%, by volume, carbon nanotubes into the catalyst layers (see Problem 3.12). The membrane experiences uniform volumetric energy generation at a rate of  $\dot{q} = 10 \times 10^6 \text{ W/m}^3$ . Air at  $T_a = 80^\circ\text{C}$  provides a convection coefficient of  $h_a = 35 \text{ W/m}^2 \cdot \text{K}$  on one side of the membrane, while hydrogen at  $T_h = 80^\circ\text{C}$ ,  $h_h = 235 \text{ W/m}^2 \cdot \text{K}$  flows on the opposite side of the membrane. The flow channels are  $2L = 3 \text{ mm}$  wide. The membrane is clamped between bipolar plates, each of which is at a temperature  $T_{\text{bp}} = 80^\circ\text{C}$ .

- (a) Derive the differential equation that governs the temperature distribution  $T(x)$  in the membrane.
- (b) Obtain a solution to the differential equation, assuming the membrane is at the bipolar plate temperature at  $x = 0$  and  $x = 2L$ .
- (c) Plot the temperature distribution  $T(x)$  from  $x = 0$  to  $x = L$  for carbon nanotube loadings of 0% and 10% by volume. Comment on the ability of the carbon nanotubes to keep the membrane below its softening temperature of  $85^\circ\text{C}$ .

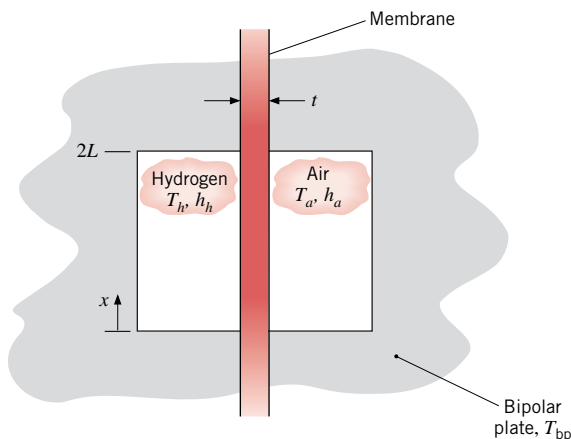

**3.107** The thermocouple (TC) installation on a snowmobile engine cylinder head is shown in the schematic. The TC wire leads are attached to the upper and lower surfaces of the cylindrically shaped solder bead. The


base of the bead is attached to the cylinder head operating at  $385^\circ\text{C}$ , and there is a thermal resistance between the bead and the cylinder head due to the *constriction* of heat flow from the head to the bead. This *constriction resistance* may be expressed as  $R_{\text{con}} = 1/(2k_{\text{head}} D_{\text{sol}})$ . The TC wire leads are very long and experience heat loss to the winter air at  $-10^\circ\text{C}$  with a convection coefficient of  $100 \text{ W/m}^2 \cdot \text{K}$ . Values of other geometrical and thermal parameters are shown on the schematic.

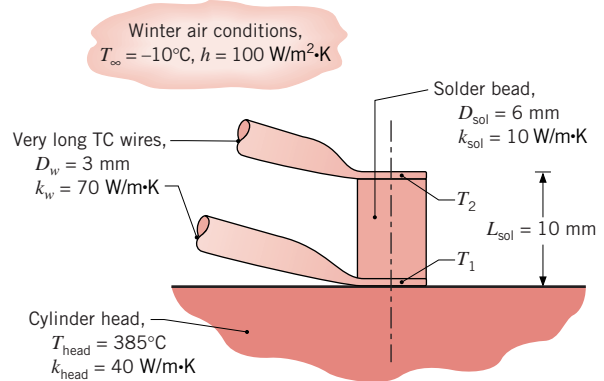

The objective of this problem is to develop a thermal model that can be used to determine the temperature difference  $(T_1 - T_2)$  between the two intermediate-metal TC junctions. Assume that the solder bead does not experience any heat loss from its lateral surface.

- (a) Sketch a thermal circuit of the installation, labeling temperatures, thermal resistances, and heat rates. Write expressions for each of the thermal resistances and calculate their values.
- (b) Use your thermal circuit to evaluate  $(T_1 - T_2)$  for the prescribed conditions. Comment on the assumptions made in building your model.


**3.108** Consider a rod of diameter  $D$ , thermal conductivity  $k$ , and length  $2L$  that is perfectly insulated over one portion of its length,  $-L \leq x \leq 0$ , and experiences convection with a fluid  $(T_\infty, h)$  over the other portion,  $0 \leq x \leq +L$ . One end is maintained at  $T_1$ , while the other is separated from a heat sink at  $T_3$  by an interfacial thermal contact resistance  $R''_{t,c}$ .

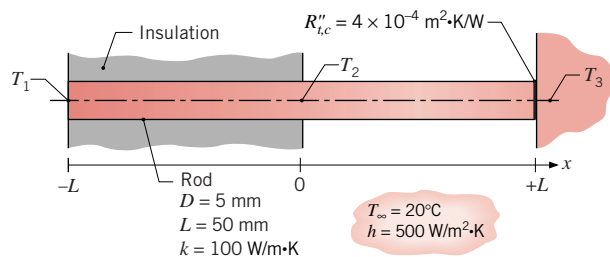

- Sketch the temperature distribution on  $T-x$  coordinates and identify its key features. Assume that  $T_1 > T_3 > T_\infty$ .
- Derive an expression for the midpoint temperature  $T_2$  in terms of the thermal and geometric parameters of the system.
- For  $T_1 = 200^\circ\text{C}$ ,  $T_3 = 100^\circ\text{C}$ , and the conditions provided in the schematic, calculate  $T_2$  and plot the temperature distribution. Describe key features of the distribution and compare it to your sketch of part (a).


**3.109** One method that is used to grow nanowires (nanotubes with solid cores) is to initially deposit a small droplet of a liquid catalyst onto a flat surface. The surface and catalyst are heated and simultaneously exposed to a higher-temperature, low-pressure gas that contains a mixture of chemical species from which the nanowire is to be formed. The catalytic liquid *slowly* absorbs the species from the gas through its top surface and converts these to a solid material that is deposited onto the underlying liquid-solid interface, resulting in construction of the nanowire. The liquid catalyst remains suspended at the tip of the nanowire.

Consider the growth of a 15-nm-diameter silicon carbide nanowire onto a silicon carbide surface. The surface is maintained at a temperature of  $T_s = 2400\text{ K}$ , and the particular liquid catalyst that is used must be maintained in the range  $2400\text{ K} \leq T_c \leq 3000\text{ K}$  in order to perform its function. Determine the maximum length of a nanowire that may be grown for conditions characterized by  $h = 10^5\text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 8000\text{ K}$ . Assume properties of the nanowire are the same as for bulk silicon carbide.

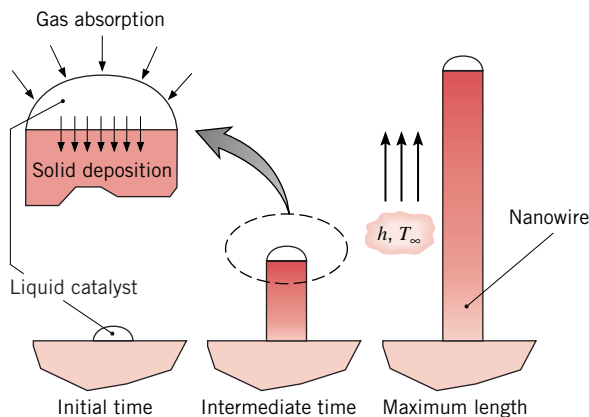


**3.110** A probe of overall length  $L = 200\text{ mm}$  and diameter  $D = 12.5\text{ mm}$  is inserted through a duct wall such that a portion of its length, referred to as the immersion length  $L_i$ , is in contact with the water stream whose

temperature,  $T_{\infty,i}$ , is to be determined. The convection coefficients over the immersion and ambient-exposed lengths are  $h_i = 1100\text{ W/m}^2 \cdot \text{K}$  and  $h_o = 10\text{ W/m}^2 \cdot \text{K}$ , respectively. The probe has a thermal conductivity of  $177\text{ W/m} \cdot \text{K}$  and is in poor thermal contact with the duct wall.

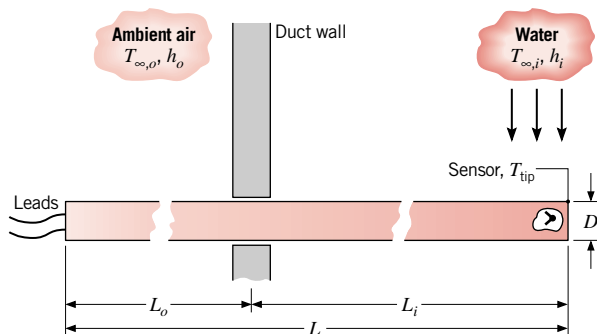


- Derive an expression for evaluating the measurement error,  $\Delta T_{\text{err}} = T_{\text{tip}} - T_{\infty,i}$ , which is the difference between the tip temperature,  $T_{\text{tip}}$ , and the water temperature,  $T_{\infty,i}$ . *Hint:* Define a coordinate system with the origin at the duct wall and treat the probe as two fins extending inward and outward from the duct, but having the same base temperature. Use Case A results from Table 3.4.
- With the water and ambient air temperatures at 80 and  $20^\circ\text{C}$ , respectively, calculate the measurement error,  $\Delta T_{\text{err}}$ , as a function of immersion length for the conditions  $L_i/L = 0.225, 0.425$ , and  $0.625$ .
- Compute and plot the effects of probe thermal conductivity and water velocity ( $h_i$ ) on the measurement error.

**3.111** A rod of diameter  $D = 25\text{ mm}$  and thermal conductivity  $k = 60\text{ W/m} \cdot \text{K}$  protrudes normally from a furnace wall that is at  $T_w = 200^\circ\text{C}$  and is covered by insulation of thickness  $L_{\text{ins}} = 200\text{ mm}$ . The rod is welded to the furnace wall and is used as a hanger for supporting instrumentation cables. To avoid damaging the cables, the temperature of the rod at its exposed surface,  $T_o$ , must be maintained below a specified operating limit of  $T_{\text{max}} = 100^\circ\text{C}$ . The ambient air temperature is  $T_\infty = 25^\circ\text{C}$ , and the convection coefficient is  $h = 15\text{ W/m}^2 \cdot \text{K}$ .

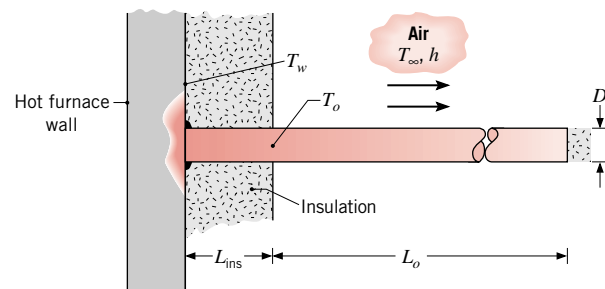


- (a) Derive an expression for the exposed surface temperature  $T_o$  as a function of the prescribed thermal and geometrical parameters. The rod has an exposed length  $L_o$ , and its tip is well insulated.
- (b) Will a rod with  $L_o = 200$  mm meet the specified operating limit? If not, what design parameters would you change? Consider another material, increasing the thickness of the insulation, and increasing the rod length. Also, consider how you might attach the base of the rod to the furnace wall as a means to reduce  $T_o$ .

**3.112** A metal rod of length  $2L$ , diameter  $D$ , and thermal conductivity  $k$  is inserted into a perfectly insulating wall, exposing one-half of its length to an air stream that is at temperature  $T_\infty$  and provides a convection coefficient  $h$  at the surface of the rod. An electromagnetic field induces volumetric energy generation at a uniform rate  $\dot{q}$  within the embedded portion of the rod.

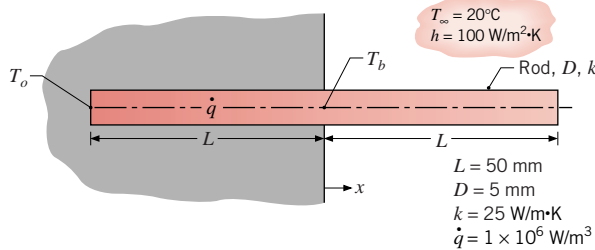

- (a) Derive an expression for the steady-state temperature  $T_b$  at the base of the exposed half of the rod. The exposed region may be approximated as a very long fin.
- (b) Derive an expression for the steady-state temperature  $T_o$  at the end of the embedded half of the rod.
- (c) Using numerical values provided in the schematic, plot the temperature distribution in the rod and describe key features of the distribution. Does the rod behave as a very long fin?


**3.113** A very long rod of 5-mm diameter and uniform thermal conductivity  $k = 25$  W/m·K is subjected to a heat treatment process. The center, 30-mm-long portion of the rod within the induction heating coil experiences uniform volumetric heat generation of  $7.5 \times 10^6$  W/m³.

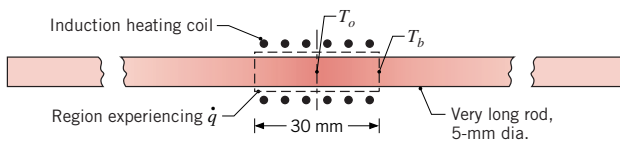

The unheated portions of the rod, which protrude from the heating coil on either side, experience convection with the ambient air at  $T_\infty = 20^\circ\text{C}$  and  $h = 10$  W/m²·K. Assume that there is no convection from the surface of the rod within the coil.


- (a) Calculate the steady-state temperature  $T_o$  of the rod at the midpoint of the heated portion in the coil.
- (b) Calculate the temperature of the rod  $T_b$  at the edge of the heated portion.

**3.114** From Problem 1.71, consider the wire leads connecting the transistor to the circuit board. The leads are of thermal conductivity  $k$ , thickness  $t$ , width  $w$ , and length  $L$ . One end of a lead is maintained at a temperature  $T_c$  corresponding to the transistor case, while the other end assumes the temperature  $T_b$  of the circuit board. During steady-state operation, current flow through the leads provides for uniform volumetric heating in the amount  $\dot{q}$ , while there is convection cooling to air that is at  $T_\infty$  and maintains a convection coefficient  $h$ .

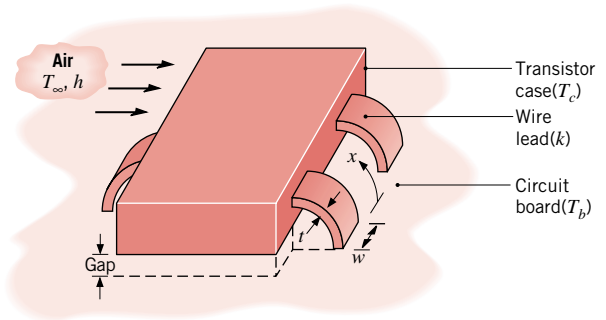

- (a) Derive an equation from which the temperature distribution in a wire lead may be determined. List all pertinent assumptions.
- (b) Determine the temperature distribution in a wire lead, expressing your results in terms of the prescribed variables.


**3.115** A disk-shaped electronic device of thickness  $L_d$ , diameter  $D$ , and thermal conductivity  $k_d$  dissipates electrical power at a steady rate  $P_e$  along one of its surfaces. The device is bonded to a cooled base at  $T_o$  using a thermal pad of thickness  $L_p$  and thermal conductivity  $k_p$ . A long fin of diameter  $D$  and thermal conductivity  $k_f$  is bonded to the heat-generating surface of the device using an identical thermal pad. The fin is cooled by an air stream, which is at a temperature  $T_\infty$  and provides a convection coefficient  $h$ .

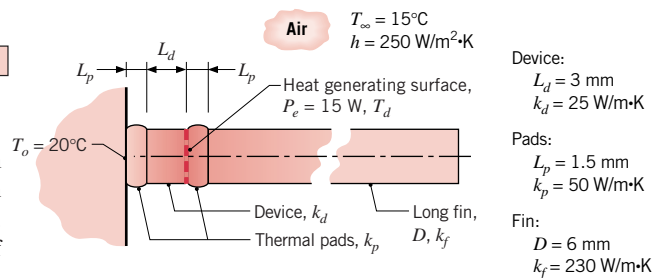



- Construct a thermal circuit of the system.
- Derive an expression for the temperature  $T_d$  of the heat-generating surface of the device in terms of the circuit thermal resistances,  $T_o$  and  $T_\infty$ . Express the thermal resistances in terms of appropriate parameters.
- Calculate  $T_d$  for the prescribed conditions.


**3.116** Turbine blades mounted to a rotating disc in a gas turbine engine are exposed to a gas stream that is at  $T_\infty = 1200^\circ\text{C}$  and maintains a convection coefficient of  $h = 250 \text{ W/m}^2 \cdot \text{K}$  over the blade.

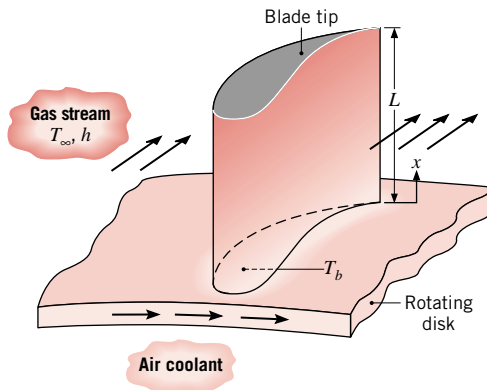

The blades, which are fabricated from Inconel,  $k \approx 20 \text{ W/m} \cdot \text{K}$ , have a length of  $L = 50 \text{ mm}$ . The blade profile has a uniform cross-sectional area of  $A_c = 6 \times 10^{-4} \text{ m}^2$  and a perimeter of  $P = 110 \text{ mm}$ . A proposed blade-cooling scheme, which involves routing air through the supporting disc, is able to maintain the base of each blade at a temperature of  $T_b = 300^\circ\text{C}$ .


- If the maximum allowable blade temperature is  $1050^\circ\text{C}$  and the blade tip may be assumed to be adiabatic, is the proposed cooling scheme satisfactory?
- For the proposed cooling scheme, what is the rate at which heat is transferred from each blade to the coolant?

**3.117** In a test to determine the friction coefficient,  $\mu$ , associated with a disk brake, one disk and its shaft are rotated at a constant angular velocity  $\omega$ , while an equivalent disk/shaft assembly is stationary. Each disk has an outer radius of  $r_2 = 180 \text{ mm}$ , a shaft radius of  $r_1 = 20 \text{ mm}$ , a thickness of  $t = 12 \text{ mm}$ , and a thermal conductivity of  $k = 15 \text{ W/m} \cdot \text{K}$ . A known force  $F$  is applied to the system, and the corresponding torque  $\tau$  required to maintain rotation is measured. The disk contact pressure may be assumed to be uniform (i.e., independent of location on the interface), and the disks may be assumed to be well insulated from the surroundings.

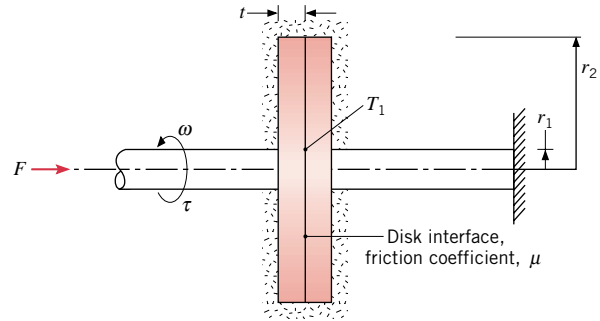

- Obtain an expression that may be used to evaluate  $\mu$  from known quantities.
- For the region  $r_1 \leq r \leq r_2$ , determine the radial temperature distribution,  $T(r)$ , in the disk, where  $T(r_1) = T_1$  is presumed to be known.
- Consider test conditions for which  $F = 200 \text{ N}$ ,  $\omega = 40 \text{ rad/s}$ ,  $\tau = 8 \text{ N} \cdot \text{m}$ , and  $T_1 = 80^\circ\text{C}$ . Evaluate the friction coefficient and the maximum disk temperature.

**3.118** Consider an extended surface of rectangular cross section with heat flow in the longitudinal direction.

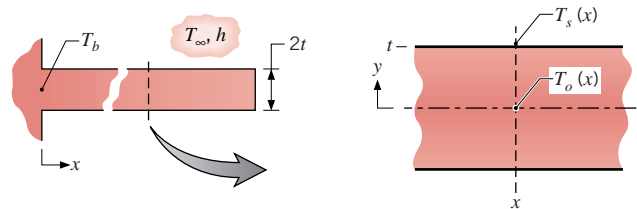

In this problem we seek to determine conditions for which the transverse (y-direction) temperature difference within the extended surface is negligible compared to the temperature difference between the surface and the environment, such that the one-dimensional analysis of Section 3.6.1 is valid.

- Assume that the transverse temperature distribution is parabolic and of the form

$$\frac{T(y) - T_o(x)}{T_s(x) - T_o(x)} = \left(\frac{y}{t}\right)^2$$

where  $T_s(x)$  is the surface temperature and  $T_o(x)$  is the centerline temperature at any  $x$ -location. Using Fourier's law, write an expression for the conduction heat flux at the surface,  $q''_s(t)$ , in terms of  $T_s$  and  $T_o$ .

- Write an expression for the convection heat flux at the surface for the  $x$ -location. Equating the two expressions for the heat flux by conduction and

convection, identify the parameter that determines the ratio  $(T_o - T_s)/(T_s - T_\infty)$ .

- (c) From the foregoing analysis, develop a criterion for establishing the validity of the one-dimensional assumption used to model an extended surface.

### Simple Fins

**3.119** A long, circular aluminum rod is attached at one end to a heated wall and transfers heat by convection to a cold fluid.

- (a) If the diameter of the rod is tripled, by how much would the rate of heat removal change?  
 (b) If a copper rod of the same diameter is used in place of the aluminum, by how much would the rate of heat removal change?

**3.120** A brass rod 100 mm long and 5 mm in diameter extends horizontally from a casting at 200°C. The rod is in an air environment with  $T_\infty = 20^\circ\text{C}$  and  $h = 30 \text{ W/m}^2 \cdot \text{K}$ . What is the temperature of the rod 25, 50, and 100 mm from the casting?

**3.121** The extent to which the tip condition affects the thermal performance of a fin depends on the fin geometry and thermal conductivity, as well as the convection coefficient. Consider an alloyed aluminum ( $k = 180 \text{ W/m} \cdot \text{K}$ ) rectangular fin of length  $L = 10 \text{ mm}$ , thickness  $t = 1 \text{ mm}$ , and width  $w \gg t$ . The base temperature of the fin is  $T_b = 100^\circ\text{C}$ , and the fin is exposed to a fluid of temperature  $T_\infty = 25^\circ\text{C}$ .

- (a) Assuming a uniform convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$  over the entire fin surface, determine the fin heat transfer rate per unit width  $q'_f$ , efficiency  $\eta_f$ , effectiveness  $\varepsilon_f$ , thermal resistance per unit width  $R'_{t,f}$ , and the tip temperature  $T(L)$  for Cases A and B of Table 3.4. Contrast your results with those based on an *infinite fin* approximation.

- (b) Explore the effect of variations in the convection coefficient on the heat rate for  $10 < h < 1000 \text{ W/m}^2 \cdot \text{K}$ . Also consider the effect of such variations for a stainless steel fin ( $k = 15 \text{ W/m} \cdot \text{K}$ ).

**3.122** The extent to which the tip condition affects the thermal performance of a fin depends on the fin geometry and thermal conductivity, as well as the convection coefficient. Consider an alloyed aluminum ( $k = 180 \text{ W/m} \cdot \text{K}$ ) rectangular fin whose base temperature is  $T_b = 100^\circ\text{C}$ . The fin is exposed to a fluid of temperature  $T_\infty = 25^\circ\text{C}$ , and a uniform convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$  may be assumed for the fin surface.

- (a) For a fin of length  $L = 10 \text{ mm}$ , thickness  $t = 1 \text{ mm}$ , and width  $w \gg t$ , determine the fin heat

transfer rate per unit width  $q'_f$ , efficiency  $\eta_f$ , effectiveness  $\varepsilon_f$ , thermal resistance per unit width  $R'_{t,f}$ , and tip temperature  $T(L)$  for Cases A and B of Table 3.4. Contrast your results with those based on an *infinite fin* approximation.

- (b) Explore the effect of variations in  $L$  on the heat rate for  $3 < L < 50 \text{ mm}$ . Also consider the effect of such variations for a stainless steel fin ( $k = 15 \text{ W/m} \cdot \text{K}$ ).

**3.123** A straight fin fabricated from 2024 aluminum alloy ( $k = 185 \text{ W/m} \cdot \text{K}$ ) has a base thickness of  $t = 3 \text{ mm}$  and a length of  $L = 15 \text{ mm}$ . Its base temperature is  $T_b = 100^\circ\text{C}$ , and it is exposed to a fluid for which  $T_\infty = 20^\circ\text{C}$  and  $h = 50 \text{ W/m}^2 \cdot \text{K}$ . For the foregoing conditions and a fin of unit width, compare the fin heat rate, efficiency, and volume for rectangular, triangular, and parabolic profiles.

**3.124** Two long copper rods of diameter  $D = 10 \text{ mm}$  are soldered together end to end, with solder having a melting point of  $650^\circ\text{C}$ . The rods are in air at  $25^\circ\text{C}$  with a convection coefficient of  $10 \text{ W/m}^2 \cdot \text{K}$ . What is the minimum power input needed to effect the soldering?


**3.125** Circular copper rods of diameter  $D = 1 \text{ mm}$  and length  $L = 25 \text{ mm}$  are used to enhance heat transfer from a surface that is maintained at  $T_{s,1} = 100^\circ\text{C}$ . One end of the rod is attached to this surface (at  $x = 0$ ), while the other end ( $x = 25 \text{ mm}$ ) is joined to a second surface, which is maintained at  $T_{s,2} = 0^\circ\text{C}$ . Air flowing between the surfaces (and over the rods) is also at a temperature of  $T_\infty = 0^\circ\text{C}$ , and a convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$  is maintained.

- (a) What is the rate of heat transfer by convection from a single copper rod to the air?  
 (b) What is the total rate of heat transfer from a 1-m by 1-m section of the surface at  $100^\circ\text{C}$ , if a bundle of the rods is installed on 4-mm centers?

**3.126** During the initial stages of the growth of the nanowire of Problem 3.109, a slight perturbation of the liquid catalyst droplet can cause it to be suspended on the top of the nanowire in an off-center position. The resulting nonuniform deposition of solid at the solid-liquid interface can be manipulated to form engineered shapes such as a *nanospring*, that is characterized by a spring radius,  $r$ , spring pitch,  $s$ , overall chord length,  $L_c$  (length running along the spring), and end-to-end length,  $L$ , as shown in the sketch. Consider a silicon carbide nanospring of diameter  $D = 15 \text{ nm}$ ,  $r = 30 \text{ nm}$ ,  $s = 25 \text{ nm}$ , and  $L_c = 425 \text{ nm}$ . From experiments, it is known that the average spring pitch  $\bar{s}$  varies with average temperature  $\bar{T}$  by the relation  $d\bar{s}/d\bar{T} = 0.1 \text{ nm/K}$ . Using this information, a student suggests that a *nanoactuator*

can be constructed by connecting one end of the nanospring to a small heater and raising the temperature of that end of the nanospring above its initial value. Calculate the actuation distance,  $\Delta L$ , for conditions where  $h = 10^6 \text{ W/m}^2 \cdot \text{K}$ ,  $T_\infty = T_i = 25^\circ\text{C}$ , with a base temperature of  $T_b = 50^\circ\text{C}$ . If the base temperature can be controlled to within  $1^\circ\text{C}$ , calculate the accuracy to which the actuation distance can be controlled. *Hint:* Assume the spring radius does not change when the spring is heated. The overall spring length may be approximated by the formula,

$$L = \frac{\bar{s}}{2\pi} \frac{L_c}{\sqrt{r^2 + (\bar{s}/2\pi)^2}}$$

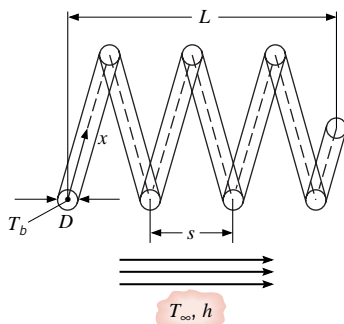

**3.127** Consider two long, slender rods of the same diameter but different materials. One end of each rod is attached to a base surface maintained at  $100^\circ\text{C}$ , while the surfaces of the rods are exposed to ambient air at  $20^\circ\text{C}$ . By traversing the length of each rod with a thermocouple, it was observed that the temperatures of the rods were equal at the positions  $x_A = 0.15 \text{ m}$  and  $x_B = 0.075 \text{ m}$ , where  $x$  is measured from the base surface. If the thermal conductivity of rod A is known to be  $k_A = 70 \text{ W/m} \cdot \text{K}$ , determine the value of  $k_B$  for rod B.

**3.128** A 40-mm-long, 2-mm-diameter pin fin is fabricated of an aluminum alloy ( $k = 140 \text{ W/m}^2 \cdot \text{K}$ ).


- Determine the fin heat transfer rate for  $T_b = 50^\circ\text{C}$ ,  $T_\infty = 25^\circ\text{C}$ ,  $h = 1000 \text{ W/m}^2 \cdot \text{K}$ , and an adiabatic tip condition.
- An engineer suggests that by holding the fin tip at a low temperature, the fin heat transfer rate can be increased. For  $T(x = L) = 0^\circ\text{C}$ , determine the new fin heat transfer rate. Other conditions are as in part (a).
- Plot the temperature distribution,  $T(x)$ , over the range  $0 \leq x \leq L$  for the adiabatic tip case and the prescribed tip temperature case. Also show the ambient temperature in your graph. Discuss relevant features of the temperature distribution.

- Plot the fin heat transfer rate over the range  $0 \leq h \leq 1000 \text{ W/m}^2 \cdot \text{K}$  for the adiabatic tip case and the prescribed tip temperature case. For the prescribed tip temperature case, what would the calculated fin heat transfer rate be if Equation 3.73 were used to determine  $q_f$  rather than Equation 3.71?

**3.129** An experimental arrangement for measuring the thermal conductivity of solid materials involves the use of two long rods that are equivalent in every respect, except that one is fabricated from a standard material of known thermal conductivity  $k_A$  while the other is fabricated from the material whose thermal conductivity  $k_B$  is desired. Both rods are attached at one end to a heat source of fixed temperature  $T_b$ , are exposed to a fluid of temperature  $T_\infty$ , and are instrumented with thermocouples to measure the temperature at a fixed distance  $x_1$  from the heat source. If the standard material is aluminum, with  $k_A = 200 \text{ W/m} \cdot \text{K}$ , and measurements reveal values of  $T_A = 75^\circ\text{C}$  and  $T_B = 60^\circ\text{C}$  at  $x_1$  for  $T_b = 100^\circ\text{C}$  and  $T_\infty = 25^\circ\text{C}$ , what is the thermal conductivity  $k_B$  of the test material?

### Fin Systems and Arrays

**3.130** Finned passages are frequently formed between parallel plates to enhance convection heat transfer in compact heat exchanger cores. An important application is in electronic equipment cooling, where one or more air-cooled stacks are placed between heat-dissipating electrical components. Consider a single stack of rectangular fins of length  $L$  and thickness  $t$ , with convection conditions corresponding to  $h$  and  $T_\infty$ .

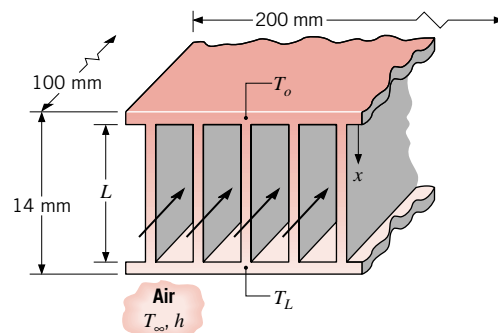


- Obtain expressions for the fin heat transfer rates,  $q_{f,o}$  and  $q_{f,L}$ , in terms of the base temperatures,  $T_o$  and  $T_L$ .
- In a specific application, a stack that is 200 mm wide and 100 mm deep contains 50 fins, each of length  $L = 12 \text{ mm}$ . The entire stack is made from aluminum, which is everywhere 1.0 mm thick. If temperature limitations associated with electrical

components joined to opposite plates dictate maximum allowable plate temperatures of  $T_o = 400$  K and  $T_L = 350$  K, what are the corresponding maximum power dissipations if  $h = 150$  W/m<sup>2</sup> · K and  $T_\infty = 300$  K?

- 3.131** The fin array of Problem 3.130 is commonly found in *compact heat exchangers*, whose function is to provide a large surface area per unit volume in transferring heat from one fluid to another. Consider conditions for which the second fluid maintains equivalent temperatures at the parallel plates,  $T_o = T_L$ , thereby establishing symmetry about the midplane of the fin array. The heat exchanger is 1 m long in the direction of the flow of air (first fluid) and 1 m wide in a direction normal to both the air flow and the fin surfaces. The length of the fin passages between adjoining parallel plates is  $L = 8$  mm, while the fin thermal conductivity and convection coefficient are  $k = 200$  W/m · K (aluminum) and  $h = 150$  W/m<sup>2</sup> · K, respectively.

- (a) If the fin thickness and pitch are  $t = 1$  mm and  $S = 4$  mm, respectively, what is the value of the thermal resistance  $R_{t,o}$  for a one-half section of the fin array?
- (b) Subject to the constraints that the fin thickness and pitch may not be less than 0.5 and 3 mm, respectively, assess the effect of changes in  $t$  and  $S$ .


- 3.132** An isothermal silicon chip of width  $W = 20$  mm on a side is soldered to an aluminum heat sink ( $k = 180$  W/m · K) of equivalent width. The heat sink has a base thickness of  $L_b = 3$  mm and an array of rectangular fins, each of length  $L_f = 15$  mm. Air flow at  $T_\infty = 20^\circ\text{C}$  is maintained through channels formed by the fins and a cover plate, and for a convection coefficient of  $h = 100$  W/m<sup>2</sup> · K, a minimum fin spacing of 1.8 mm is dictated by limitations on the flow pressure drop. The solder joint has a thermal resistance of  $R''_{t,c} = 2 \times 10^{-6}$  m<sup>2</sup> · K/W.

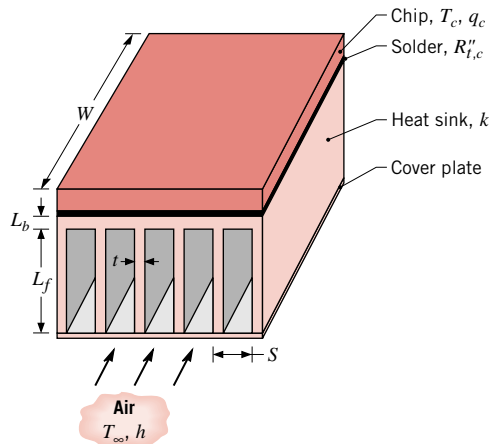


- (a) Consider limitations for which the array has  $N = 11$  fins, in which case values of the fin thickness  $t = 0.182$  mm and pitch  $S = 1.982$  mm are obtained from the requirements that  $W = (N - 1)S + t$  and  $S - t = 1.8$  mm. If the maximum allowable chip temperature is  $T_c = 85^\circ\text{C}$ , what is the corresponding value of the chip power  $q_c$ ? An adiabatic fin tip condition may be assumed, and air flow along the outer surfaces of the heat sink may be assumed to provide a convection coefficient equivalent to that associated with air flow through the channels.

- (b) With  $(S - t)$  and  $h$  fixed at 1.8 mm and 100 W/m<sup>2</sup> · K, respectively, explore the effect of increasing the fin thickness by reducing the number of fins. With  $N = 11$  and  $S - t$  fixed at 1.8 mm, but relaxation of the constraint on the pressure drop, explore the effect of increasing the air flow, and hence the convection coefficient.

- 3.133** As seen in Problem 3.109, silicon carbide nanowires of diameter  $D = 15$  nm can be grown onto a solid silicon carbide surface by carefully depositing droplets of catalyst liquid onto a flat silicon carbide substrate. Silicon carbide nanowires grow upward from the deposited drops, and if the drops are deposited in a pattern, an array of nanowire fins can be grown, forming a silicon carbide *nano-heat sink*. Consider finned and unfinned electronics packages in which an extremely small,  $10 \mu\text{m} \times 10 \mu\text{m}$  electronics device is sandwiched between two  $d = 100$  nm thick silicon carbide sheets. In both cases, the coolant is a dielectric liquid at  $20^\circ\text{C}$ . A heat transfer coefficient of  $h = 1 \times 10^5$  W/m<sup>2</sup> · K exists on the top and bottom of the unfinned package and on all surfaces of the exposed silicon carbide fins, which are each  $L = 300$  nm long. Each nano-heat sink includes a  $200 \times 200$  array of nanofins. Determine the maximum allowable heat rate that can be generated by the electronic device so that its temperature is maintained at  $T_t < 85^\circ\text{C}$  for the unfinned and finned packages.

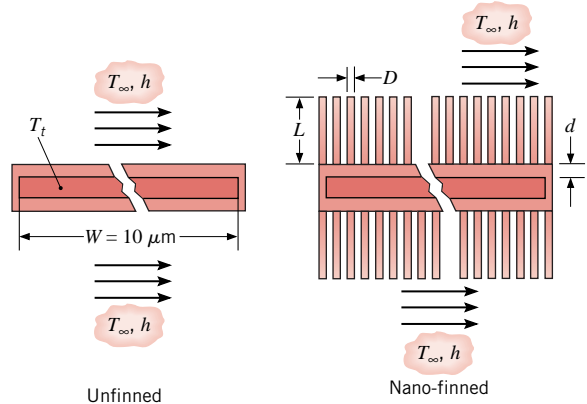

**3.134** As more and more components are placed on a single integrated circuit (chip), the amount of heat that is dissipated continues to increase. However, this increase is limited by the maximum allowable chip operating temperature, which is approximately  $75^\circ\text{C}$ . To maximize heat dissipation, it is proposed that a  $4 \times 4$  array of copper pin fins be metallurgically joined to the outer surface of a square chip that is 12.7 mm on a side.

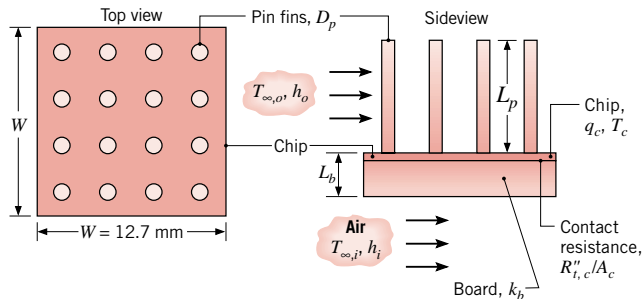


- Sketch the equivalent thermal circuit for the pin-chip-board assembly, assuming one-dimensional, steady-state conditions and negligible contact resistance between the pins and the chip. In variable form, label appropriate resistances, temperatures, and heat rates.
- For the conditions prescribed in Problem 3.27, what is the maximum rate at which heat can be dissipated in the chip when the pins are in place? That is, what is the value of  $q_c$  for  $T_c = 75^\circ\text{C}$ ? The pin diameter and length are  $D_p = 1.5$  mm and  $L_p = 15$  mm.

**3.135** In Problem 3.134, the prescribed value of  $h_o = 1000$   $\text{W/m}^2 \cdot \text{K}$  is large and characteristic of liquid cooling. In practice it would be far more preferable to use air cooling, for which a reasonable upper limit to the convection coefficient would be  $h_o = 250$   $\text{W/m}^2 \cdot \text{K}$ . Assess the effect of changes in the pin fin geometry on the chip heat rate if the remaining conditions of Problem 3.134, including a maximum allowable chip temperature of  $75^\circ\text{C}$ , remain in effect. Parametric variations that may be considered include the total number of pins,  $N$ , in the square array, the pin diameter  $D_p$ , and the pin length  $L_p$ . However, the product  $N^{1/2}D_p$  should not exceed 9 mm to ensure adequate air flow passage through the array. Recommend a design that enhances chip cooling.

**3.136** As a means of enhancing heat transfer from high-performance logic chips, it is common to attach a *heat sink* to the chip surface in order to increase the surface area available for convection heat transfer. Because of the ease with which it may be manufactured (by taking orthogonal sawcuts in a block of material), an attractive

option is to use a heat sink consisting of an array of square fins of width  $w$  on a side. The spacing between adjoining fins would be determined by the width of the sawblade, with the sum of this spacing and the fin width designated as the fin pitch  $S$ . The method by which the heat sink is joined to the chip would determine the interfacial contact resistance,  $R''_{t,c}$ .

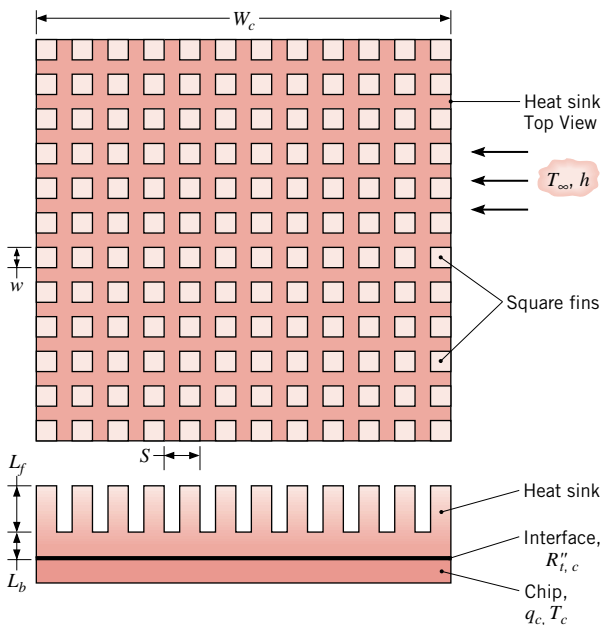

Consider a square chip of width  $W_c = 16$  mm and conditions for which cooling is provided by a dielectric liquid with  $T_\infty = 25^\circ\text{C}$  and  $h = 1500$   $\text{W/m}^2 \cdot \text{K}$ . The heat sink is fabricated from copper ( $k = 400$   $\text{W/m} \cdot \text{K}$ ), and its characteristic dimensions are  $w = 0.25$  mm,  $S = 0.50$  mm,  $L_f = 6$  mm, and  $L_b = 3$  mm. The prescribed values of  $w$  and  $S$  represent minima imposed by manufacturing constraints and the need to maintain adequate flow in the passages between fins.


- If a metallurgical joint provides a contact resistance of  $R''_{t,c} = 5 \times 10^{-6}$   $\text{m}^2 \cdot \text{K/W}$  and the maximum allowable chip temperature is  $85^\circ\text{C}$ , what is the maximum allowable chip power dissipation  $q_c$ ? Assume all of the heat to be transferred through the heat sink.
- It may be possible to increase the heat dissipation by increasing  $w$ , subject to the constraint that  $(S - w) \geq 0.25$  mm, and/or increasing  $L_f$  (subject to manufacturing constraints that  $L_f \leq 10$  mm). Assess the effect of such changes.

**3.137** Because of the large number of devices in today's PC chips, finned heat sinks are often used to maintain the chip at an acceptable operating temperature. Two fin




designs are to be evaluated, both of which have base (unfinned) area dimensions of  $53 \text{ mm} \times 57 \text{ mm}$ . The fins are of square cross section and fabricated from an extruded aluminum alloy with a thermal conductivity of  $175 \text{ W/m} \cdot \text{K}$ . Cooling air may be supplied at  $25^\circ\text{C}$ , and the maximum allowable chip temperature is  $75^\circ\text{C}$ . Other features of the design and operating conditions are tabulated.

Design	Fin Dimensions			Convection Coefficient ( $\text{W/m}^2 \cdot \text{K}$ )
	Cross Section $w \times w \text{ (mm)}$	Length $L \text{ (mm)}$	Number of Fins in Array	
A	$3 \times 3$	30	$6 \times 9$	125
B	$1 \times 1$	7	$14 \times 17$	375

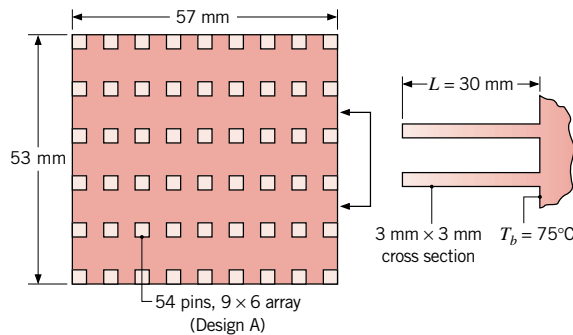


Determine which fin arrangement is superior. In your analysis, calculate the heat rate, efficiency, and effectiveness of a single fin, as well as the total heat rate and overall efficiency of the array. Since real estate inside the computer enclosure is important, compare the total heat rate per unit volume for the two designs.

- 3.138** Consider design B of Problem 3.137. Over time, dust can collect in the fine grooves that separate the fins. Consider the buildup of a dust layer of thickness  $L_d$ , as shown in the sketch. Calculate and plot the total heat rate for design B for dust layers in the range  $0 \leq L_d \leq 5 \text{ mm}$ . The thermal conductivity of the dust can be taken as  $k_d = 0.032 \text{ W/m} \cdot \text{K}$ . Include the effects of convection off the fin tip.

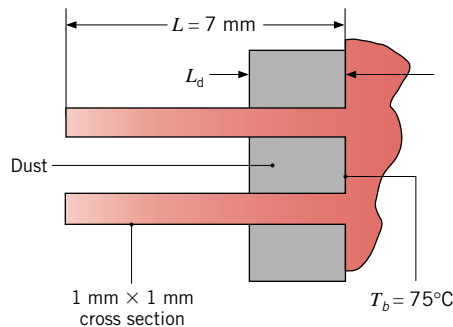


- 3.139** A long rod of 20-mm diameter and a thermal conductivity of  $1.5 \text{ W/m} \cdot \text{K}$  has a uniform internal volumetric thermal energy generation of  $10^6 \text{ W/m}^3$ . The rod is covered with an electrically insulating sleeve of 2-mm thickness and thermal conductivity of  $0.5 \text{ W/m} \cdot \text{K}$ . A spider with 12 ribs and dimensions as shown in the sketch has a thermal conductivity of  $175 \text{ W/m} \cdot \text{K}$ , and is used to support the rod and to maintain concentricity with an 80-mm-diameter tube. Air at  $T_\infty = 25^\circ\text{C}$  passes over the spider surface, and the convection coefficient is  $20 \text{ W/m}^2 \cdot \text{K}$ . The outer surface of the tube is well insulated.

We wish to increase volumetric heating within the rod, while not allowing its centerline temperature to exceed  $100^\circ\text{C}$ . Determine the impact of the following changes, which may be effected independently or concurrently: (i) increasing the air speed and hence the convection coefficient; (ii) changing the number and/or thickness of the ribs; and (iii) using an electrically non-conducting sleeve material of larger thermal conductivity (e.g., amorphous carbon or quartz). Recommend a realistic configuration that yields a significant increase in  $\dot{q}$ .

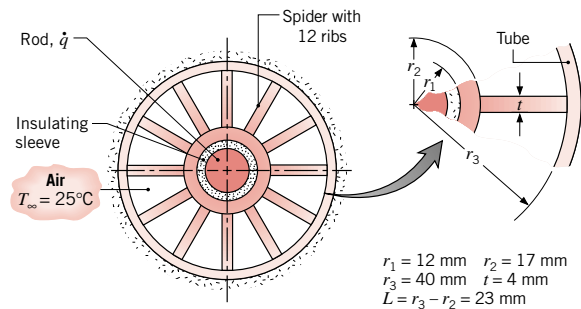


- 3.140** An air heater consists of a steel tube ( $k = 20 \text{ W/m} \cdot \text{K}$ ), with inner and outer radii of  $r_1 = 13 \text{ mm}$  and  $r_2 = 16 \text{ mm}$ , respectively, and eight integrally machined longitudinal fins, each of thickness  $t = 3 \text{ mm}$ . The fins extend to a concentric tube, which is of radius  $r_3 = 40 \text{ mm}$  and insulated on its outer surface. Water at a temperature  $T_{\infty,i} = 90^\circ\text{C}$  flows through the inner tube, while air at  $T_{\infty,o} = 25^\circ\text{C}$  flows through the annular region formed by the larger concentric tube.

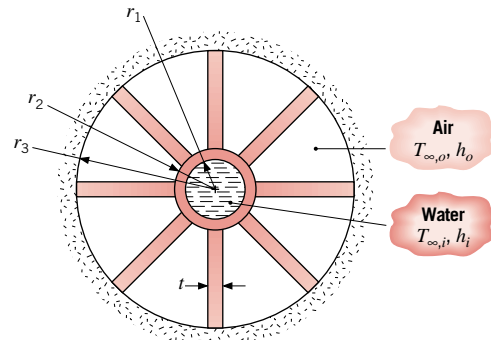

- (a) Sketch the equivalent thermal circuit of the heater and relate each thermal resistance to appropriate system parameters.
- (b) If  $h_i = 5000 \text{ W/m}^2 \cdot \text{K}$  and  $h_o = 200 \text{ W/m}^2 \cdot \text{K}$ , what is the heat rate per unit length?
- (c) Assess the effect of increasing the number of fins  $N$  and/or the fin thickness  $t$  on the heat rate, subject to the constraint that  $Nt < 50 \text{ mm}$ .

**3.141** Determine the percentage increase in heat transfer associated with attaching aluminum fins of rectangular profile to a plane wall. The fins are 50 mm long, 0.5 mm thick, and are equally spaced at a distance of 4 mm (250 fins/m). The convection coefficient associated with the bare wall is  $40 \text{ W/m}^2 \cdot \text{K}$ , while that resulting from attachment of the fins is  $30 \text{ W/m}^2 \cdot \text{K}$ .

**3.142** Heat is uniformly generated at the rate of  $2 \times 10^5 \text{ W/m}^3$  in a wall of thermal conductivity  $25 \text{ W/m} \cdot \text{K}$  and thickness 60 mm. The wall is exposed to convection on both sides, with different heat transfer coefficients and temperatures as shown. There are straight rectangular fins on the right-hand side of the wall, with dimensions as shown and thermal conductivity of  $250 \text{ W/m} \cdot \text{K}$ . What is the maximum temperature that will occur in the wall?

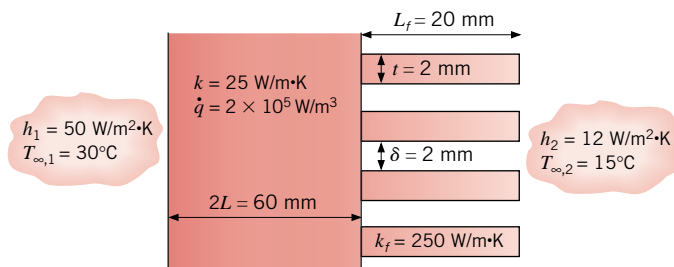

**3.143** Aluminum fins of triangular profile are attached to a plane wall whose surface temperature is  $250^\circ\text{C}$ . The fin base thickness is 2 mm, and its length is 6 mm. The system is in ambient air at a temperature of  $20^\circ\text{C}$ , and the surface convection coefficient is  $40 \text{ W/m}^2 \cdot \text{K}$ .

- (a) What are the fin efficiency and effectiveness?
- (b) What is the heat dissipated per unit width by a single fin?


**3.144** An annular aluminum fin of rectangular profile is attached to a circular tube having an outside diameter of 25 mm and a surface temperature of  $250^\circ\text{C}$ . The fin is 1 mm thick and 10 mm long, and the temperature and the convection coefficient associated with the adjoining fluid are  $25^\circ\text{C}$  and  $25 \text{ W/m}^2 \cdot \text{K}$ , respectively.

- (a) What is the heat loss per fin?
- (b) If 200 such fins are spaced at 5-mm increments along the tube length, what is the heat loss per meter of tube length?

**3.145** Annular aluminum fins of rectangular profile are attached to a circular tube having an outside diameter of 50 mm and an outer surface temperature of  $200^\circ\text{C}$ . The fins are 4 mm thick and 15 mm long. The system is in ambient air at a temperature of  $20^\circ\text{C}$ , and the surface convection coefficient is  $40 \text{ W/m}^2 \cdot \text{K}$ .

- (a) What are the fin efficiency and effectiveness?
- (b) If there are 125 such fins per meter of tube length, what is the rate of heat transfer per unit length of tube?

**3.146** It is proposed to air-cool the cylinders of a combustion chamber by joining an aluminum casing with annular fins ( $k = 240 \text{ W/m} \cdot \text{K}$ ) to the cylinder wall ( $k = 50 \text{ W/m} \cdot \text{K}$ ).

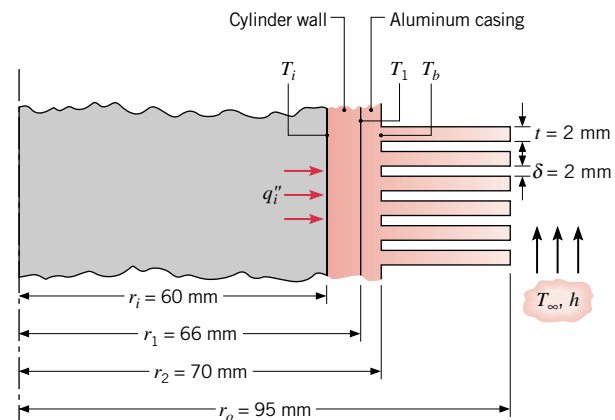


The air is at  $320 \text{ K}$  and the corresponding convection coefficient is  $100 \text{ W/m}^2 \cdot \text{K}$ . Although heating at the inner surface is periodic, it is reasonable to assume steady-state conditions with a time-averaged heat flux of  $q''_i = 10^5 \text{ W/m}^2$ . Assuming negligible contact resistance between the wall and the casing, determine the wall inner temperature  $T_i$ , the interface temperature  $T_1$ , and the fin base temperature  $T_b$ . Determine these temperatures if the interface contact resistance is  $R_{t,c} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ .

**3.147** Consider the air-cooled combustion cylinder of Problem 3.146, but instead of imposing a uniform heat flux at the inner surface, consider conditions for which the time-averaged temperature of the combustion gases is  $T_g = 1100 \text{ K}$  and the corresponding convection coefficient is  $h_g = 150 \text{ W/m}^2 \cdot \text{K}$ . All other conditions, including the cylinder/casing contact resistance, remain the same. Determine the heat rate per unit length of cylinder ( $\text{W/m}$ ), as well as the cylinder inner temperature  $T_i$ , the interface temperatures  $T_{1,i}$  and  $T_{1,o}$ , and the fin base temperature  $T_b$ . Subject to the constraint that the fin gap is fixed at  $\delta = 2 \text{ mm}$ , assess the effect of increasing the fin thickness at the expense of reducing the number of fins.

**3.148** Heat transfer from a transistor may be enhanced by inserting it in an aluminum sleeve ( $k = 200 \text{ W/m} \cdot \text{K}$ )


having 12 integrally machined longitudinal fins on its outer surface. The transistor radius and height are  $r_1 = 2.5$  mm and  $H = 4$  mm, respectively, while the fins are of length  $L = r_3 - r_2 = 8$  mm and uniform thickness  $t = 0.8$  mm. The thickness of the sleeve base is  $r_2 - r_1 = 1$  mm, and the contact resistance of the sleeve-transistor interface is  $R''_{t,c} = 0.6 \times 10^{-3} \text{ m}^2 \cdot \text{K/W}$ . Air at  $T_\infty = 20^\circ\text{C}$  flows over the fin surface, providing an approximately uniform convection coefficient of  $h = 30 \text{ W/m}^2 \cdot \text{K}$ .

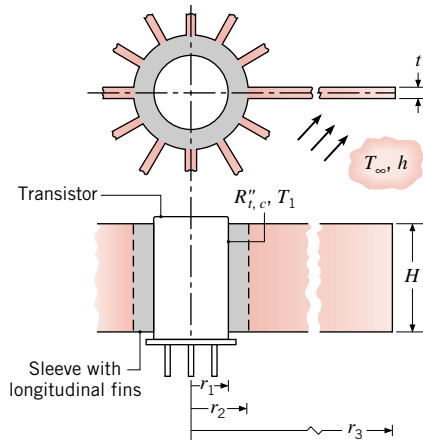

(a) When the transistor case temperature is  $80^\circ\text{C}$ , what is the rate of heat transfer from the sleeve?

(b) Identify all of the measures that could be taken to improve design and/or operating conditions, such that heat dissipation may be increased while still maintaining a case temperature of  $80^\circ\text{C}$ . In words, assess the relative merits of each measure. Choose what you believe to be the three most promising measures, and numerically assess the effect of corresponding changes in design and/or operating conditions on thermal performance.

**3.149** Water is heated by submerging 50-mm diameter, thin-walled copper tubes in a tank and passing hot combustion gases ( $T_g = 750 \text{ K}$ ) through the tubes. To enhance heat transfer to the water, four straight fins of uniform cross section, which form a cross, are inserted in each tube. The fins are 5 mm thick and are also made of copper ( $k = 400 \text{ W/m} \cdot \text{K}$ ).

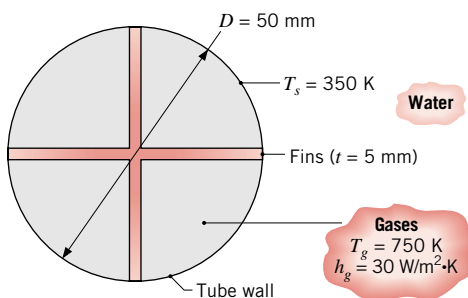

If the tube surface temperature is  $T_s = 350 \text{ K}$  and the gas-side convection coefficient is  $h_g = 30 \text{ W/m}^2 \cdot \text{K}$ , what is the rate of heat transfer to the water per meter of pipe length?

**3.150** Consider the conditions of Problem 3.149, but now allow for a tube wall thickness of 5 mm (inner and outer diameters of 50 and 60 mm), a fin-to-tube thermal contact resistance of  $10^{-4} \text{ m}^2 \cdot \text{K/W}$ , and the fact that it is the water temperature,  $T_w = 350 \text{ K}$ , rather than the tube surface temperature, that is known. The water-side convection coefficient is  $h_w = 2000 \text{ W/m}^2 \cdot \text{K}$ . Determine the rate of heat transfer per unit tube length (W/m) to the water. What would be the separate effect of each of the following design changes on the heat rate: (i) elimination of the contact resistance; (ii) increasing the number of fins from four to eight; and (iii) changing the tube wall and fin material from copper to AISI 304 stainless steel ( $k = 20 \text{ W/m} \cdot \text{K}$ )?


**3.151** A scheme for concurrently heating separate water and air streams involves passing them through and over an array of tubes, respectively, while the tube wall is heated electrically. To enhance gas-side heat transfer, annular fins of rectangular profile are attached to the outer tube surface. Attachment is facilitated with a dielectric adhesive that electrically isolates the fins from the current-carrying tube wall.

(a) Assuming uniform volumetric heat generation within the tube wall, obtain expressions for the heat rate per unit tube length (W/m) at the inner ( $r_i$ ) and outer ( $r_o$ ) surfaces of the wall. Express your results in terms of the tube inner and outer surface temperatures,  $T_{s,i}$  and  $T_{s,o}$ , and other pertinent parameters.

(b) Obtain expressions that could be used to determine  $T_{s,i}$  and  $T_{s,o}$  in terms of parameters associated with the water- and air-side conditions.

(c) Consider conditions for which the water and air are at  $T_{\infty,i} = T_{\infty,o} = 300 \text{ K}$ , with corresponding convection coefficients of  $h_i = 2000 \text{ W/m}^2 \cdot \text{K}$  and  $h_o = 100 \text{ W/m}^2 \cdot \text{K}$ . Heat is uniformly dissipated in a stainless steel tube ( $k_w = 15 \text{ W/m} \cdot \text{K}$ ), having inner and outer radii of  $r_i = 25 \text{ mm}$  and  $r_o = 30 \text{ mm}$ , and aluminum fins ( $t = \delta = 2 \text{ mm}$ ,  $r_f = 55 \text{ mm}$ ) are attached to the outer surface, with  $R''_{t,c} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ . Determine the heat rates and temperatures at the inner and outer surfaces as a function of the rate of volumetric heating  $\dot{q}$ . The upper limit to  $\dot{q}$  will be determined by the constraints that  $T_{s,i}$  not exceed the boiling point of water ( $100^\circ\text{C}$ ) and  $T_{s,o}$  not exceed the decomposition temperature of the adhesive ( $250^\circ\text{C}$ ).



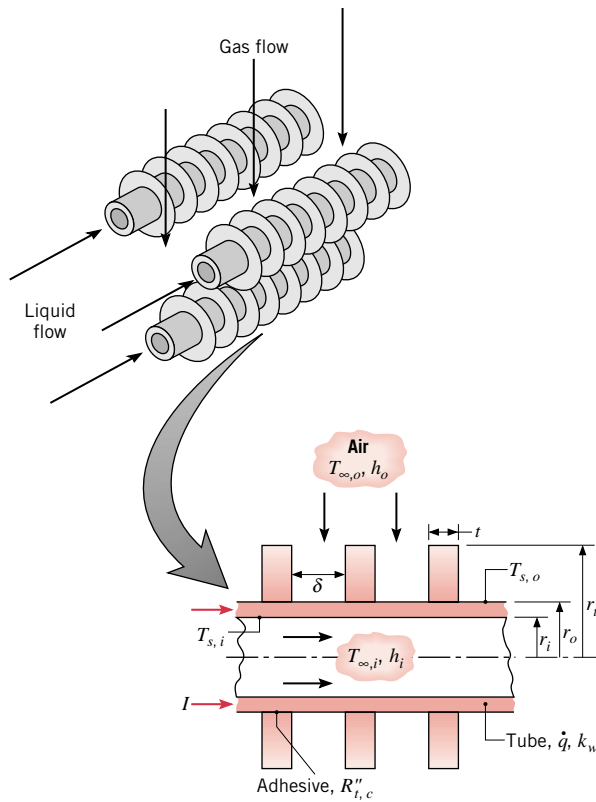


### The Bioheat Equation

- 3.152** Consider the conditions of Example 3.12, except that the person is now exercising (in the air environment), which increases the metabolic heat generation rate by a factor of eight, to  $5600 \text{ W/m}^3$ . At what rate would the person have to perspire (in liters/s) to maintain the same skin temperature as in that example?
- 3.153** Consider the conditions of Example 3.12 for an air environment, except now the air and surroundings

temperatures are both  $15^\circ\text{C}$ . Humans respond to cold by shivering, which increases the metabolic heat generation rate. What would the metabolic heat generation rate (per unit volume) have to be to maintain a comfortable skin temperature of  $33^\circ\text{C}$  under these conditions?

- 3.154** Consider heat transfer in a forearm, which can be approximated as a cylinder of muscle of radius  $50 \text{ mm}$  (neglecting the presence of bones), with an outer layer of skin and fat of thickness  $3 \text{ mm}$ . There is metabolic heat generation and perfusion within the muscle. The metabolic heat generation rate, perfusion rate, arterial temperature, and properties of blood, muscle, and skin/fat layer are identical to those in Example 3.12. The environment and surroundings are the same as for the air environment in Example 3.12.

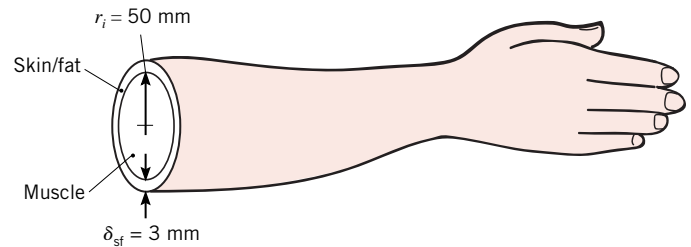

- Write the bioheat transfer equation in radial coordinates. Write the boundary conditions that express symmetry at the centerline of the forearm and specified temperature at the outer surface of the muscle. Solve the differential equation and apply the boundary conditions to find an expression for the temperature distribution. Note that the derivatives of the modified Bessel functions are given in Section 3.6.4.
- Equate the heat flux at the outer surface of the muscle to the heat flux through the skin/fat layer and into the environment to determine the temperature at the outer surface of the muscle.
- Find the maximum forearm temperature.

*CHAPTER* **4**

---

**Two-Dimensional,  
Steady-State  
Conduction**



To this point we have restricted our attention to conduction problems in which the temperature gradient is significant for only one coordinate direction. However, in many cases such problems are grossly oversimplified if a one-dimensional treatment is used, and it is necessary to account for multidimensional effects. In this chapter, we consider several techniques for treating two-dimensional systems under steady-state conditions.

We begin our consideration of two-dimensional, steady-state conduction by briefly reviewing alternative approaches to determining temperatures and heat rates (Section 4.1). The approaches range from *exact solutions*, which may be obtained for idealized conditions, to *approximate methods* of varying complexity and accuracy. In Section 4.2 we consider some of the mathematical issues associated with obtaining an exact solution. In Section 4.3, we present compilations of existing exact solutions for a variety of simple geometries. Our objective in Sections 4.4 and 4.5 is to show how, with the aid of a computer, *numerical (finite-difference or finite-element) methods* may be used to accurately predict temperatures and heat rates within the medium and at its boundaries.

## 4.1

### Alternative Approaches

Consider a long, prismatic solid in which there is two-dimensional heat conduction (Figure 4.1). With two surfaces insulated and the other surfaces maintained at different temperatures,  $T_1 > T_2$ , heat transfer by conduction occurs from surface 1 to 2. According to Fourier's law, Equation 2.3 or 2.4, the local heat flux in the solid is a vector that is everywhere perpendicular to lines of constant temperature (*isotherms*). The directions of the heat flux vector are represented by the *heat flow lines* of Figure 4.1, and the vector itself is the resultant of heat flux components in the  $x$  and  $y$  directions. These components are determined by Equation 2.6. Since the heat flow lines are, by definition, in the direction of heat flow, *no heat can be conducted across a heat flow line* and they are therefore sometimes referred to as *adiabats*. Conversely, adiabatic surfaces (or symmetry lines) are heat flow lines.

Recall that, in any conduction analysis, there exist two major objectives. The first objective is to determine the temperature distribution in the medium, which, for

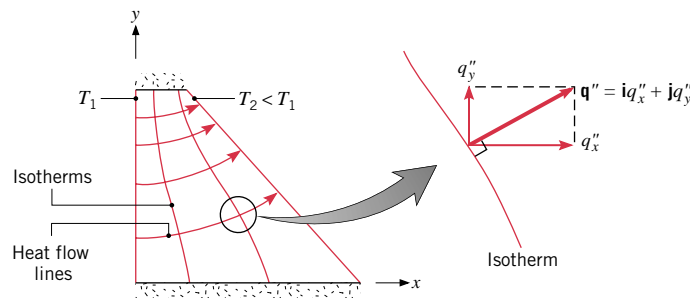


FIGURE 4.1 Two-dimensional conduction.


the present problem, necessitates determining  $T(x, y)$ . This objective is achieved by solving the appropriate form of the heat equation. For two-dimensional, steady-state conditions with no generation and constant thermal conductivity, this form is, from Equation 2.20,

$$\frac{\partial^2 T}{\partial x^2} + \frac{\partial^2 T}{\partial y^2} = 0 \quad (4.1)$$

If Equation 4.1 can be solved for  $T(x, y)$ , it is then a simple matter to satisfy the second major objective, which is to determine the heat flux components  $q_x''$  and  $q_y''$  by applying the rate equations (2.6). Methods for solving Equation 4.1 include the use of *analytical*, *graphical*, and *numerical* (*finite-difference*, *finite-element*, or *boundary-element*) approaches.

The analytical method involves effecting an exact mathematical solution to Equation 4.1. The problem is more difficult than those considered in Chapter 3, since it now involves a partial, rather than an ordinary, differential equation. Although several techniques are available for solving such equations, the solutions typically involve complicated mathematical series and functions and may be obtained for only a restricted set of simple geometries and boundary conditions [1–5]. Nevertheless, the solutions are of value, since the dependent variable  $T$  is determined as a continuous function of the independent variables  $(x, y)$ . Hence the solution could be used to compute the temperature at *any* point of interest in the medium. To illustrate the nature and importance of analytical techniques, an exact solution to Equation 4.1 is obtained in Section 4.2 by the method of *separation of variables*. Conduction shape factors and dimensionless conduction heat rates (Section 4.3) are compilations of existing solutions for geometries that are commonly encountered in engineering practice.


In contrast to the analytical methods, which provide *exact* results at *any* point, graphical and numerical methods can provide only *approximate* results at *discrete* points. Although superseded by computer solutions based on numerical procedures, the graphical, or flux-plotting, method may be used to obtain a quick estimate of the temperature distribution. Its use is restricted to two-dimensional problems involving adiabatic and isothermal boundaries. The method is based on the fact that isotherms must be perpendicular to heat flow lines, as noted in Figure 4.1. Unlike the analytical or graphical approaches, numerical methods (Sections 4.4 and 4.5) may be used to obtain accurate results for complex, two- or three-dimensional geometries involving a wide variety of boundary conditions.

 The graphical method is described, and its use is demonstrated, in Section 4S.1.

## 4.2

### The Method of Separation of Variables

To appreciate how the method of separation of variables may be used to solve two-dimensional conduction problems, we consider the system of Figure 4.2. Three sides of a thin rectangular plate or a long rectangular rod are maintained at a constant temperature  $T_1$ , while the fourth side is maintained at a constant temperature  $T_2 \neq T_1$ . Assuming negligible heat transfer from the surfaces of the plate or the ends of the rod, temperature gradients normal to the  $x$ - $y$  plane may be neglected ( $\partial^2 T / \partial z^2 \approx 0$ ) and conduction heat transfer is primarily in the  $x$  and  $y$  directions.

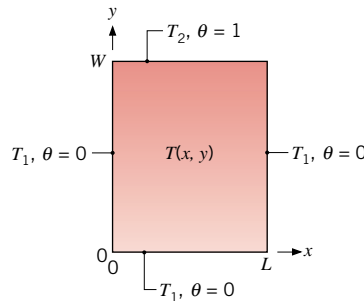

**FIGURE 4.2**

Two-dimensional conduction in a thin rectangular plate or a long rectangular rod.

We are interested in the temperature distribution  $T(x, y)$ , but to simplify the solution we introduce the transformation

$$\theta \equiv \frac{T - T_1}{T_2 - T_1} \quad (4.2)$$

Substituting Equation 4.2 into Equation 4.1, the transformed differential equation is then

$$\frac{\partial^2 \theta}{\partial x^2} + \frac{\partial^2 \theta}{\partial y^2} = 0 \quad (4.3)$$

Since the equation is second order in both  $x$  and  $y$ , two boundary conditions are needed for each of the coordinates. They are

$$\begin{aligned} \theta(0, y) = 0 \quad \text{and} \quad \theta(x, 0) = 0 \\ \theta(L, y) = 0 \quad \text{and} \quad \theta(x, W) = 1 \end{aligned}$$

Note that, through the transformation of Equation 4.2, three of the four boundary conditions are now homogeneous and the value of  $\theta$  is restricted to the range from 0 to 1.

We now apply the separation of variables technique by assuming that the desired solution can be expressed as the product of two functions, one of which depends only on  $x$  while the other depends only on  $y$ . That is, we assume the existence of a solution of the form

$$\theta(x, y) = X(x) \cdot Y(y) \quad (4.4)$$

Substituting into Equation 4.3 and dividing by  $XY$ , we obtain

$$-\frac{1}{X} \frac{d^2 X}{dx^2} = \frac{1}{Y} \frac{d^2 Y}{dy^2} \quad (4.5)$$

and it is evident that the differential equation is, in fact, separable. That is, the left-hand side of the equation depends only on  $x$  and the right-hand side depends only on  $y$ . Hence the equality can apply in general (for any  $x$  or  $y$ ) only if both sides are equal to the same constant. Identifying this, as yet unknown, *separation constant* as  $\lambda^2$ , we then have

$$\frac{d^2 X}{dx^2} + \lambda^2 X = 0 \quad (4.6)$$

$$\frac{d^2 Y}{dy^2} - \lambda^2 Y = 0 \quad (4.7)$$

and the partial differential equation has been reduced to two ordinary differential equations. Note that the designation of  $\lambda^2$  as a positive constant was not arbitrary. If a negative value were selected or a value of  $\lambda^2 = 0$  was chosen, it is readily shown (Problem 4.1) that it would be impossible to obtain a solution that satisfies the prescribed boundary conditions.

The general solutions to Equations 4.6 and 4.7 are, respectively,

$$\begin{aligned} X &= C_1 \cos \lambda x + C_2 \sin \lambda x \\ Y &= C_3 e^{-\lambda y} + C_4 e^{+\lambda y} \end{aligned}$$

in which case the general form of the two-dimensional solution is

$$\theta = (C_1 \cos \lambda x + C_2 \sin \lambda x)(C_3 e^{-\lambda y} + C_4 e^{+\lambda y}) \quad (4.8)$$

Applying the condition that  $\theta(0, y) = 0$ , it is evident that  $C_1 = 0$ . In addition from the requirement that  $\theta(x, 0) = 0$ , we obtain

$$C_2 \sin \lambda x (C_3 + C_4) = 0$$

which may only be satisfied if  $C_3 = -C_4$ . Although the requirement could also be satisfied by having  $C_2 = 0$ , this would result in  $\theta(x, y) = 0$ , which does not satisfy the boundary condition  $\theta(x, W) = 1$ . If we now invoke the requirement that  $\theta(L, y) = 0$ , we obtain

$$C_2 C_4 \sin \lambda L (e^{\lambda y} - e^{-\lambda y}) = 0$$

The only way in which this condition may be satisfied (and still have a nonzero solution) is by requiring that  $\lambda$  assume discrete values for which  $\sin \lambda L = 0$ . These values must then be of the form

$$\lambda = \frac{n\pi}{L} \quad n = 1, 2, 3, \dots \quad (4.9)$$

where the integer  $n = 0$  is precluded, since it implies  $\theta(x, y) = 0$ . The desired solution may now be expressed as

$$\theta = C_2 C_4 \sin \frac{n\pi x}{L} (e^{n\pi y/L} - e^{-n\pi y/L}) \quad (4.10)$$

Combining constants and acknowledging that the new constant may depend on  $n$ , we obtain

$$\theta(x, y) = C_n \sin \frac{n\pi x}{L} \sinh \frac{n\pi y}{L}$$

where we have also used the fact that  $(e^{n\pi y/L} - e^{-n\pi y/L}) = 2 \sinh(n\pi y/L)$ . In the above form we have really obtained an infinite number of solutions that satisfy the differential equation and boundary conditions. However, since the problem is linear, a more general solution may be obtained from a superposition of the form

$$\theta(x, y) = \sum_{n=1}^{\infty} C_n \sin \frac{n\pi x}{L} \sinh \frac{n\pi y}{L} \quad (4.11)$$

To determine  $C_n$  we now apply the remaining boundary condition, which is of the form

$$\theta(x, W) = 1 = \sum_{n=1}^{\infty} C_n \sin \frac{n\pi x}{L} \sinh \frac{n\pi W}{L} \quad (4.12)$$

Although Equation 4.12 would seem to be an extremely complicated relation for evaluating  $C_n$ , a standard method is available. It involves writing an infinite series expansion in terms of *orthogonal functions*. An infinite set of functions  $g_1(x), g_2(x), \dots, g_n(x), \dots$  is said to be orthogonal in the domain  $a \leq x \leq b$  if

$$\int_a^b g_m(x)g_n(x) dx = 0 \quad m \neq n \quad (4.13)$$

Many functions exhibit orthogonality, including the trigonometric functions  $\sin(n\pi x/L)$  and  $\cos(n\pi x/L)$  for  $0 \leq x \leq L$ . Their utility in the present problem rests with the fact that any function  $f(x)$  may be expressed in terms of an infinite series of orthogonal functions

$$f(x) = \sum_{n=1}^{\infty} A_n g_n(x) \quad (4.14)$$

The form of the coefficients  $A_n$  in this series may be determined by multiplying each side of the equation by  $g_m(x)$  and integrating between the limits  $a$  and  $b$ .

$$\int_a^b f(x)g_m(x) dx = \int_a^b g_m(x) \sum_{n=1}^{\infty} A_n g_n(x) dx \quad (4.15)$$

However, from Equation 4.13 it is evident that all but one of the terms on the right-hand side of Equation 4.15 must be zero, leaving us with

$$\int_a^b f(x)g_m(x) dx = A_m \int_a^b g_m^2(x) dx$$

Hence, solving for  $A_m$ , and recognizing that this holds for any  $A_n$  by switching  $m$  to  $n$ :

$$A_n = \frac{\int_a^b f(x)g_n(x) dx}{\int_a^b g_n^2(x) dx} \quad (4.16)$$

The properties of orthogonal functions may be used to solve Equation 4.12 for  $C_n$  by formulating an infinite series for the appropriate form of  $f(x)$ . From Equation 4.14 it is evident that we should choose  $f(x) = 1$  and the orthogonal function  $g_n(x) = \sin(n\pi x/L)$ . Substituting into Equation 4.16 we obtain


$$A_n = \frac{\int_0^L \sin \frac{n\pi x}{L} dx}{\int_0^L \sin^2 \frac{n\pi x}{L} dx} = \frac{2}{\pi} \frac{(-1)^{n+1} + 1}{n}$$

Hence from Equation 4.14, we have

$$1 = \sum_{n=1}^{\infty} \frac{2}{\pi} \frac{(-1)^{n+1} + 1}{n} \sin \frac{n\pi x}{L} \quad (4.17)$$

which is simply the expansion of unity in a Fourier series. Comparing Equations 4.12 and 4.17 we obtain

$$C_n = \frac{2[(-1)^{n+1} + 1]}{n\pi \sinh(n\pi W/L)} \quad n = 1, 2, 3, \dots \quad (4.18)$$

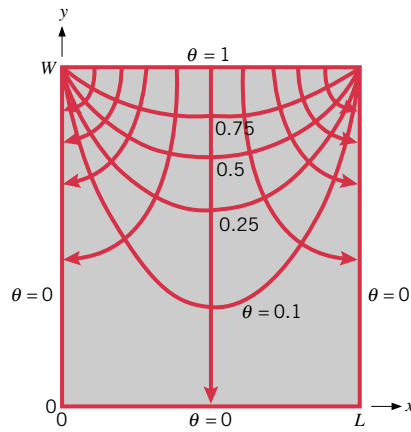

**FIGURE 4.3**

Isotherms and heat flow lines for two-dimensional conduction in a rectangular plate.

Substituting Equation 4.18 into Equation 4.11, we then obtain for the final solution

$$\theta(x, y) = \frac{2}{\pi} \sum_{n=1}^{\infty} \frac{(-1)^{n+1} + 1}{n} \sin \frac{n\pi x}{L} \frac{\sinh(n\pi y/L)}{\sinh(n\pi W/L)} \quad (4.19)$$

Equation 4.19 is a convergent series, from which the value of  $\theta$  may be computed for any  $x$  and  $y$ . Representative results are shown in the form of isotherms for a schematic of the rectangular plate (Figure 4.3). The temperature  $T$  corresponding to a value of  $\theta$  may be obtained from Equation 4.2, and components of the heat flux may be determined by using Equation 4.19 with Equation 2.6. The heat flux components determine the heat flow lines, which are shown in the figure. We note that the temperature distribution is symmetric about  $x = L/2$ , with  $\partial T/\partial x = 0$  at that location. Hence, from Equation 2.6, we know the symmetry plane at  $x = L/2$  is adiabatic and, therefore, is a heat flow line. However, note that the discontinuities prescribed at the upper corners of the plate are physically untenable. In reality, large temperature gradients could be maintained in proximity to the corners, but discontinuities could not exist.

Exact solutions have been obtained for many other geometries and boundary conditions, including cylindrical and spherical systems. Such solutions are presented in specialized books on conduction heat transfer [1–5].

## 4.3

### The Conduction Shape Factor and the Dimensionless Conduction Heat Rate


In many instances, two-dimensional or three-dimensional conduction problems may be rapidly solved by utilizing existing solutions to the heat diffusion equation. These solutions are reported in terms of a *shape factor*,  $S$ , or a steady-state *dimensionless conduction heat rate*,  $q_{ss}^*$ . That is, the heat transfer rate may be expressed as

$$q = Sk\Delta T_{1-2} \quad (4.20)$$



where  $\Delta T_{1-2}$  is the temperature difference between boundaries, as shown in, for example, Figure 4.2. It also follows that a two-dimensional conduction resistance may be expressed as

$$R_{t,\text{cond}(2D)} = \frac{1}{Sk} \quad (4.21)$$

 Shape factors for two-dimensional geometries may also be estimated with the graphical method that is described in Section 4S.1.

Shape factors have been obtained analytically for numerous two- and three-dimensional systems, and results are summarized in Table 4.1 for some common configurations. Results are also available for many other configurations [6–9]. In cases 1 through 8 and case 11, two-dimensional conduction is presumed to occur between the boundaries that are maintained at uniform temperatures, with  $\Delta T_{1-2} = T_1 - T_2$ . In case 9, three-dimensional conduction exists in the corner region, while in case 10, conduction occurs between an isothermal disk ( $T_1$ ) and a semi-infinite medium of uniform temperature ( $T_2$ ) at locations well removed from the disk. Shape factors may also be defined for one-dimensional geometries, and from the results of Table 3.3, it follows that for plane, cylindrical, and spherical walls, respectively, the shape factors are  $A/L$ ,  $2\pi L/\ln(r_2/r_1)$ , and  $4\pi r_1 r_2/(r_2 - r_1)$ .

Cases 12 through 15 are associated with conduction from objects held at an isothermal temperature ( $T_1$ ) that are embedded within an infinite medium of uniform temperature ( $T_2$ ) at locations removed from the object. For the infinite medium cases, useful results may be obtained by defining a *characteristic length*

$$L_c \equiv (A_s/4\pi)^{1/2} \quad (4.22)$$

where  $A_s$  is the surface area of the object. Conduction heat transfer rates from the object to the infinite medium may then be reported in terms of a *dimensionless conduction heat rate* [10]

$$q_{ss}^* \equiv qL_c/kA_s(T_1 - T_2) \quad (4.23)$$

From Table 4.1*b*, it is evident that the values of  $q_{ss}^*$ , which have been obtained analytically and numerically, are similar for a wide range of geometrical configurations. As a consequence of this similarity, values of  $q_{ss}^*$  may be *estimated* for configurations that are *similar* to those for which  $q_{ss}^*$  is known. For example, dimensionless conduction heat rates from cuboid shapes (case 15) over the range  $0.1 \leq d/D \leq 10$  may be closely approximated by interpolating the values of  $q_{ss}^*$  reported in Table 4.1. Additional procedures that may be exploited to estimate values of  $q_{ss}^*$  for other geometries are explained in [10]. Note that results for  $q_{ss}^*$  in Table 4.1*b* may be converted to expressions for  $S$  listed in Table 4.1*a*. For example, the shape factor of case 10 may be derived from the dimensionless conduction heat rate of case 13 (recognizing that the infinite medium can be viewed as two adjacent semi-infinite media).

The shape factors and dimensionless conduction heat rates reported in Table 4.1*b* are associated with objects that are held at uniform temperatures. For uniform heat flux conditions, the object's temperature is no longer uniform but varies spatially with the coolest temperatures located near the periphery of the heated object. Hence, the temperature difference that is used to define  $S$  or  $q_{ss}^*$  is replaced by a temperature difference involving the *spatially averaged* surface temperature of the object ( $\bar{T}_1 - T_2$ ), or the difference between the *maximum* surface temperature of the

**TABLE 4.1** Conduction shape factors and dimensionless conduction heat rates for selected systems.

(a) Shape factors [ $q = Sk(T_1 - T_2)$ ]

System	Schematic	Restrictions	Shape Factor
<b>Case 1</b> Isothermal sphere buried in a semi-infinite medium		$z > D/2$	$\frac{2\pi D}{1 - D/4z}$
<b>Case 2</b> Horizontal isothermal cylinder of length $L$ buried in a semi-infinite medium		$L \gg D$ $L \gg D$ $z > 3D/2$	$\frac{2\pi L}{\cosh^{-1}(2z/D)}$ $\frac{2\pi L}{\ln(4z/D)}$
<b>Case 3</b> Vertical cylinder in a semi-infinite medium		$L \gg D$	$\frac{2\pi L}{\ln(4L/D)}$
<b>Case 4</b> Conduction between two cylinders of length $L$ in infinite medium		$L \gg D_1, D_2$ $L \gg w$	$\frac{2\pi L}{\cosh^{-1}\left(\frac{4w^2 - D_1^2 - D_2^2}{2D_1D_2}\right)}$
<b>Case 5</b> Horizontal circular cylinder of length $L$ midway between parallel planes of equal length and infinite width		$z \gg D/2$ $L \gg z$	$\frac{2\pi L}{\ln(8z/\pi D)}$
<b>Case 6</b> Circular cylinder of length $L$ centered in a square solid of equal length		$w > D$ $L \gg w$	$\frac{2\pi L}{\ln(1.08 w/D)}$
<b>Case 7</b> Eccentric circular cylinder of length $L$ in a cylinder of equal length		$D > d$ $L \gg D$	$\frac{2\pi L}{\cosh^{-1}\left(\frac{D^2 + d^2 - 4z^2}{2Dd}\right)}$

TABLE 4.1 Continued

System	Schematic	Restrictions	Shape Factor
<b>Case 8</b> Conduction through the edge of adjoining walls		$D > 5L$	$0.54D$
<b>Case 9</b> Conduction through corner of three walls with a temperature difference $\Delta T_{1-2}$ across the walls		$L \ll \text{length and width of wall}$	$0.15L$
<b>Case 10</b> Disk of diameter $D$ and temperature $T_1$ on a semi-infinite medium of thermal conductivity $k$ and temperature $T_2$		None	$2D$
<b>Case 11</b> Square channel of length $L$		$\frac{W}{L} < 1.4$ $\frac{W}{L} > 1.4$ $L \gg W$	$\frac{2\pi L}{0.785 \ln(W/w)}$ $\frac{2\pi L}{0.930 \ln(W/w) - 0.050}$

(b) Dimensionless conduction heat rates [ $q = q_{ss}^* k A_s (T_1 - T_2) / L_c$ ;  $L_c \equiv (A_s / 4\pi)^{1/2}$ ]

System	Schematic	Active Area, $A_s$	$q_{ss}^*$
<b>Case 12</b> Isothermal sphere of diameter $D$ and temperature $T_1$ in an infinite medium of temperature $T_2$		$\pi D^2$	1
<b>Case 13</b> Infinitely thin, isothermal disk of diameter $D$ and temperature $T_1$ in an infinite medium of temperature $T_2$		$\frac{\pi D^2}{2}$	$\frac{2\sqrt{2}}{\pi} = 0.900$
<b>Case 14</b> Infinitely thin rectangle of length $L$ , width $w$ , and temperature $T_1$ in an infinite medium of temperature $T_2$		$2wL$	0.932
<b>Case 15</b> Cuboid shape of height $d$ with a square footprint of width $D$ and temperature $T_1$ in an infinite medium of temperature $T_2$		$2D^2 + 4Dd$	$d/D$ $q_{ss}^*$ 0.1 0.943 1.0 0.956 2.0 0.961 10 1.111

heated object and the far field temperature of the surrounding medium,  $(T_{1,\max} - T_2)$ . For the *uniformly heated* geometry of case 10 (a disk of diameter  $D$  in contact with a semi-infinite medium of thermal conductivity  $k$  and temperature  $T_2$ ), the values of  $S$  are  $3\pi^2 D/16$  and  $\pi D/2$  for temperature differences based on the average and maximum disk temperatures, respectively.

### EXAMPLE 4.1


A metallic electrical wire of diameter  $d = 5 \text{ mm}$  is to be coated with insulation of thermal conductivity  $k = 0.35 \text{ W/m} \cdot \text{K}$ . It is expected that, for the typical installation, the coated wire will be exposed to conditions for which the total coefficient associated with convection and radiation is  $h = 15 \text{ W/m}^2 \cdot \text{K}$ . To minimize the temperature rise of the wire due to ohmic heating, the insulation thickness is specified so that the *critical insulation radius* is achieved (see Example 3.4). During the wire coating process, however, the insulation thickness sometimes varies around the periphery of the wire, resulting in eccentricity of the wire relative to the coating. Determine the change in the thermal resistance of the insulation due to an eccentricity that is 50% of the critical insulation thickness.

### SOLUTION

**Known:** Wire diameter, convective conditions, and insulation thermal conductivity.

**Find:** Thermal resistance of the wire coating associated with peripheral variations in the coating thickness.

**Schematic:**

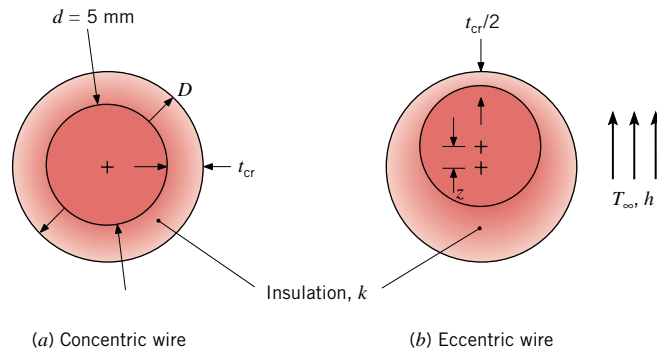

**Assumptions:**

1. Steady-state conditions.
2. Two-dimensional conduction.
3. Constant properties.
4. Both the exterior and interior surfaces of the coating are at uniform temperatures.

**Analysis:** From Example 3.4, the critical insulation radius is

$$r_{\text{cr}} = \frac{k}{h} = \frac{0.35 \text{ W/m} \cdot \text{K}}{15 \text{ W/m}^2 \cdot \text{K}} = 0.023 \text{ m} = 23 \text{ mm}$$

Therefore, the critical insulation thickness is


$$t_{cr} = r_{cr} - d/2 = 0.023 \text{ m} - \frac{0.005 \text{ m}}{2} = 0.021 \text{ m} = 21 \text{ mm}$$

The thermal resistance of the coating associated with the concentric wire may be evaluated using Equation 3.28 and is

$$R'_{t,cond} = \frac{\ln[r_{cr}/(d/2)]}{2\pi k} = \frac{\ln[0.023 \text{ m}/(0.005 \text{ m}/2)]}{2\pi(0.35 \text{ W/m} \cdot \text{K})} = 1.0 \text{ m} \cdot \text{K/W}$$

For the eccentric wire, the thermal resistance of the insulation may be evaluated using case 7 of Table 4.1, where the eccentricity is  $z = 0.5 \times t_{cr} = 0.5 \times 0.021 \text{ m} = 0.010 \text{ m}$

$$\begin{aligned} R'_{t,cond(2D)} &= \frac{1}{Sk} = \frac{\cosh^{-1}\left(\frac{D^2 + d^2 - 4z^2}{2Dd}\right)}{2\pi k} \\ &= \frac{\cosh^{-1}\left(\frac{(2 \times 0.023 \text{ m})^2 + (0.005 \text{ m})^2 - 4(0.010 \text{ m})^2}{2 \times (2 \times 0.023 \text{ m}) \times 0.005 \text{ m}}\right)}{2\pi \times 0.35 \text{ W/m} \cdot \text{K}} \\ &= 0.91 \text{ m} \cdot \text{K/W} \end{aligned}$$

Therefore, the reduction in the thermal resistance of the insulation is  $0.10 \text{ m} \cdot \text{K/W}$ , or 10%. 

#### Comments:

1. Reduction in the local insulation thickness leads to a smaller local thermal resistance of the insulation. Conversely, locations associated with thicker coatings have increased local thermal resistances. These effects offset each other, but not exactly; the maximum resistance is associated with the concentric wire case. For this application, eccentricity of the wire relative to the coating provides *enhanced* thermal performance relative to the concentric wire case.
2. The interior surface of the coating will be at nearly uniform temperature if the thermal conductivity of the wire is high relative to that of the insulation. Such is the case for metallic wire. However, the exterior surface temperature of the coating will not be perfectly uniform due to the variation in the local insulation thickness.

## 4.4


### Finite-Difference Equations

As discussed in Sections 4.1 and 4.2, analytical methods may be used, in certain cases, to effect exact mathematical solutions to steady, two-dimensional conduction problems. These solutions have been generated for an assortment of simple geometries and boundary conditions and are well documented in the literature [1–5]. However,

more often than not, two-dimensional problems involve geometries and/or boundary conditions that preclude such solutions. In these cases, the best alternative is often one that uses a *numerical* technique such as the *finite-difference*, *finite-element*, or *boundary-element* method. Another strength of numerical methods is that they can be readily extended to three-dimensional problems. Because of its ease of application, the finite-difference method is well suited for an introductory treatment of numerical techniques.

### 4.4.1 The Nodal Network

In contrast to an analytical solution, which allows for temperature determination at *any* point of interest in a medium, a numerical solution enables determination of the temperature at only *discrete* points. The first step in any numerical analysis must therefore be to select these points. Referring to Figure 4.4, this may be done by subdividing the medium of interest into a number of small regions and assigning to each a reference point that is at its center. The reference point is frequently termed a *nodal point* (or simply a *node*), and the aggregate of points is termed a *nodal network*, *grid*, or *mesh*. The nodal points are designated by a numbering scheme that, for a two-dimensional system, may take the form shown in Figure 4.4a. The  $x$  and  $y$  locations are designated by the  $m$  and  $n$  indices, respectively.

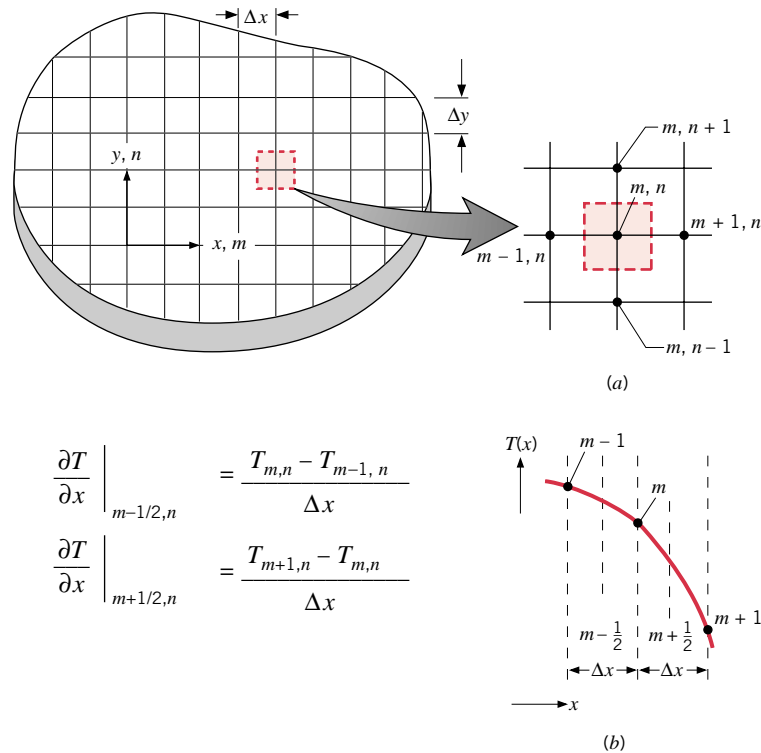

**FIGURE 4.4** Two-dimensional conduction. (a) Nodal network. (b) Finite-difference approximation.

Each node represents a certain region, and its temperature is a measure of the *average* temperature of the region. For example, the temperature of the node  $m, n$  of Figure 4.4a may be viewed as the average temperature of the surrounding shaded area. The selection of nodal points is rarely arbitrary, depending often on matters such as geometric convenience and the desired accuracy. The numerical accuracy of the calculations depends strongly on the number of designated nodal points. If this number is large (a *fine mesh*), accurate solutions can be obtained.

#### 4.4.2 Finite-Difference Form of the Heat Equation

Determination of the temperature distribution numerically dictates that an appropriate conservation equation be written for *each* of the nodal points of unknown temperature. The resulting set of equations may then be solved simultaneously for the temperature at each node. For *any interior* node of a two-dimensional system with no generation and uniform thermal conductivity, the *exact* form of the energy conservation requirement is given by the heat equation, Equation 4.1. However, if the system is characterized in terms of a nodal network, it is necessary to work with an *approximate*, or *finite-difference*, form of this equation.

A finite-difference equation that is suitable for the interior nodes of a two-dimensional system may be inferred directly from Equation 4.1. Consider the second derivative,  $\partial^2 T / \partial x^2$ . From Figure 4.4b, the value of this derivative at the  $m, n$  nodal point may be approximated as

$$\left. \frac{\partial^2 T}{\partial x^2} \right|_{m,n} \approx \frac{\partial T / \partial x|_{m+1/2,n} - \partial T / \partial x|_{m-1/2,n}}{\Delta x} \quad (4.24)$$

The temperature gradients may in turn be expressed as a function of the nodal temperatures. That is,

$$\left. \frac{\partial T}{\partial x} \right|_{m+1/2,n} \approx \frac{T_{m+1,n} - T_{m,n}}{\Delta x} \quad (4.25)$$

$$\left. \frac{\partial T}{\partial x} \right|_{m-1/2,n} \approx \frac{T_{m,n} - T_{m-1,n}}{\Delta x} \quad (4.26)$$

Substituting Equations 4.25 and 4.26 into 4.24, we obtain

$$\left. \frac{\partial^2 T}{\partial x^2} \right|_{m,n} \approx \frac{T_{m+1,n} + T_{m-1,n} - 2T_{m,n}}{(\Delta x)^2} \quad (4.27)$$

Proceeding in a similar fashion, it is readily shown that

$$\begin{aligned} \left. \frac{\partial^2 T}{\partial y^2} \right|_{m,n} &\approx \frac{\partial T / \partial y|_{m,n+1/2} - \partial T / \partial y|_{m,n-1/2}}{\Delta y} \\ &\approx \frac{T_{m,n+1} + T_{m,n-1} - 2T_{m,n}}{(\Delta y)^2} \end{aligned} \quad (4.28)$$

Using a network for which  $\Delta x = \Delta y$  and substituting Equations 4.27 and 4.28 into Equation 4.1, we obtain

$$T_{m,n+1} + T_{m,n-1} + T_{m+1,n} + T_{m-1,n} - 4T_{m,n} = 0 \quad (4.29)$$


Hence for the  $m, n$  node the heat equation, which is an *exact differential equation*, is reduced to an *approximate algebraic equation*. This approximate, *finite-difference form of the heat equation* may be applied to any interior node that is equidistant from its four neighboring nodes. It simply requires that the temperature of an interior node be equal to the average of the temperatures of the four neighboring nodes.

### 4.4.3 The Energy Balance Method

In many cases, it is desirable to develop the finite-difference equations by an alternative method called the *energy balance method*. As will become evident, this approach enables one to analyze many different phenomena such as problems involving multiple materials, embedded heat sources, or exposed surfaces that do not align with an axis of the coordinate system. In the energy balance method, the finite-difference equation for a node is obtained by applying conservation of energy to a control volume about the nodal region. Since the actual direction of heat flow (into or out of the node) is often unknown, it is convenient to formulate the energy balance by *assuming* that *all* the heat flow is *into the node*. Such a condition is, of course, impossible, but if the rate equations are expressed in a manner consistent with this assumption, the correct form of the finite-difference equation is obtained. For steady-state conditions with generation, the appropriate form of Equation 1.11c is then

$$\dot{E}_{\text{in}} + \dot{E}_g = 0 \quad (4.30)$$

Consider applying Equation 4.30 to a control volume about the interior node  $m, n$  of Figure 4.5. For two-dimensional conditions, energy exchange is influenced by

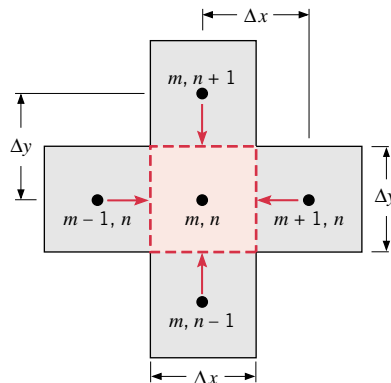

**FIGURE 4.5**

Conduction to an interior node from its adjoining nodes.



conduction between  $m, n$  and its four adjoining nodes, as well as by generation. Hence Equation 4.30 reduces to

$$\sum_{i=1}^4 q_{(i) \rightarrow (m,n)} + \dot{q}(\Delta x \cdot \Delta y \cdot 1) = 0$$

where  $i$  refers to the neighboring nodes,  $q_{(i) \rightarrow (m,n)}$  is the conduction rate between nodes, and unit depth is assumed. To evaluate the conduction rate terms, we *assume* that conduction transfer occurs exclusively through *lanes* that are oriented in either the  $x$  or  $y$  direction. Simplified forms of Fourier's law may therefore be used. For example, the rate at which energy is transferred by conduction from node  $m - 1, n$  to  $m, n$  may be expressed as

$$q_{(m-1,n) \rightarrow (m,n)} = k(\Delta y \cdot 1) \frac{T_{m-1,n} - T_{m,n}}{\Delta x} \quad (4.31)$$

The quantity  $(\Delta y \cdot 1)$  is the heat transfer area, and the term  $(T_{m-1,n} - T_{m,n})/\Delta x$  is the finite-difference approximation to the temperature gradient at the boundary between the two nodes. The remaining conduction rates may be expressed as

$$q_{(m+1,n) \rightarrow (m,n)} = k(\Delta y \cdot 1) \frac{T_{m+1,n} - T_{m,n}}{\Delta x} \quad (4.32)$$

$$q_{(m,n+1) \rightarrow (m,n)} = k(\Delta x \cdot 1) \frac{T_{m,n+1} - T_{m,n}}{\Delta y} \quad (4.33)$$

$$q_{(m,n-1) \rightarrow (m,n)} = k(\Delta x \cdot 1) \frac{T_{m,n-1} - T_{m,n}}{\Delta y} \quad (4.34)$$


Note that in evaluating each conduction rate, we have subtracted the temperature of the  $m, n$  node from the temperature of its adjoining node. This convention is necessitated by the assumption of heat flow into  $m, n$  and is consistent with the direction of the arrows shown in Figure 4.5. Substituting Equations 4.31 through 4.34 into the energy balance and remembering that  $\Delta x = \Delta y$ , it follows that the finite-difference equation for an interior node with generation is

$$T_{m,n+1} + T_{m,n-1} + T_{m+1,n} + T_{m-1,n} + \frac{\dot{q}(\Delta x)^2}{k} - 4T_{m,n} = 0 \quad (4.35)$$

If there is no internally distributed source of energy ( $\dot{q} = 0$ ), this expression reduces to Equation 4.29.

It is important to note that a finite-difference equation is needed for each nodal point at which the temperature is unknown. However, it is not always possible to classify all such points as interior and hence to use Equation 4.29 or 4.35. For example, the temperature may be unknown at an insulated surface or at a surface that is exposed to convective conditions. For points on such surfaces, the finite-difference equation must be obtained by applying the energy balance method.

To further illustrate this method, consider the node corresponding to the internal corner of Figure 4.6. This node represents the three-quarter shaded section and exchanges energy by convection with an adjoining fluid at  $T_\infty$ . Conduction to the

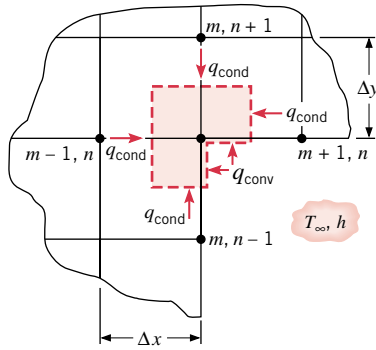

**FIGURE 4.6**

Formulation of the finite-difference equation for an internal corner of a solid with surface convection.

nodal region  $(m, n)$  occurs along four different lanes from neighboring nodes in the solid. The conduction heat rates  $q_{\text{cond}}$  may be expressed as

$$q_{(m-1,n) \rightarrow (m,n)} = k(\Delta y \cdot 1) \frac{T_{m-1,n} - T_{m,n}}{\Delta x} \quad (4.36)$$

$$q_{(m,n+1) \rightarrow (m,n)} = k(\Delta x \cdot 1) \frac{T_{m,n+1} - T_{m,n}}{\Delta y} \quad (4.37)$$

$$q_{(m+1,n) \rightarrow (m,n)} = k\left(\frac{\Delta y}{2} \cdot 1\right) \frac{T_{m+1,n} - T_{m,n}}{\Delta x} \quad (4.38)$$

$$q_{(m,n-1) \rightarrow (m,n)} = k\left(\frac{\Delta x}{2} \cdot 1\right) \frac{T_{m,n-1} - T_{m,n}}{\Delta y} \quad (4.39)$$

Note that the areas for conduction from nodal regions  $(m-1, n)$  and  $(m, n+1)$  are proportional to  $\Delta y$  and  $\Delta x$ , respectively, whereas conduction from  $(m+1, n)$  and  $(m, n-1)$  occurs along lanes of width  $\Delta y/2$  and  $\Delta x/2$ , respectively.

Conditions in the nodal region  $m, n$  are also influenced by convective exchange with the fluid, and this exchange may be viewed as occurring along half-lanes in the  $x$  and  $y$  directions. The total convection rate  $q_{\text{conv}}$  may be expressed as

$$q_{(\infty) \rightarrow (m,n)} = h\left(\frac{\Delta x}{2} \cdot 1\right)(T_{\infty} - T_{m,n}) + h\left(\frac{\Delta y}{2} \cdot 1\right)(T_{\infty} - T_{m,n}) \quad (4.40)$$






Implicit in this expression is the assumption that the exposed surfaces of the corner are at a uniform temperature corresponding to the nodal temperature  $T_{m,n}$ . This assumption is consistent with the concept that the entire nodal region is characterized by a single temperature, which represents an average of the actual temperature distribution in the region. In the absence of transient, three-dimensional, and generation effects, conservation of energy, Equation 4.30, requires that the sum of Equations 4.36 through 4.40 be zero. Summing these equations and rearranging, we therefore obtain

$$T_{m-1,n} + T_{m,n+1} + \frac{1}{2}(T_{m+1,n} + T_{m,n-1}) + \frac{h\Delta x}{k}T_{\infty} - \left(3 + \frac{h\Delta x}{k}\right)T_{m,n} = 0 \quad (4.41)$$

where again the mesh is such that  $\Delta x = \Delta y$ .

Nodal energy balance equations pertinent to several common geometries for situations where there is no internal energy generation are presented in Table 4.2.

**TABLE 4.2** Summary of nodal finite-difference equations

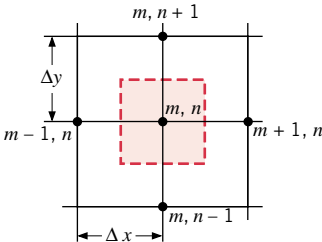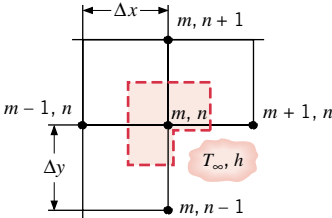Configuration	Finite-Difference Equation for $\Delta x = \Delta y$
	$T_{m,n+1} + T_{m,n-1} + T_{m+1,n} + T_{m-1,n} - 4T_{m,n} = 0 \quad (4.29)$ <p><b>Case 1.</b> Interior node</p>
	$2(T_{m-1,n} + T_{m,n+1}) + (T_{m+1,n} + T_{m,n-1}) + 2\frac{h\Delta x}{k}T_{\infty} - 2\left(3 + \frac{h\Delta x}{k}\right)T_{m,n} = 0 \quad (4.41)$ <p><b>Case 2.</b> Node at an internal corner with convection</p>
	$(2T_{m-1,n} + T_{m,n+1} + T_{m,n-1}) + \frac{2h\Delta x}{k}T_{\infty} - 2\left(\frac{h\Delta x}{k} + 2\right)T_{m,n} = 0 \quad (4.42)^a$ <p><b>Case 3.</b> Node at a plane surface with convection</p>
	$(T_{m,n-1} + T_{m-1,n}) + 2\frac{h\Delta x}{k}T_{\infty} - 2\left(\frac{h\Delta x}{k} + 1\right)T_{m,n} = 0 \quad (4.43)$ <p><b>Case 4.</b> Node at an external corner with convection</p>
	$(2T_{m-1,n} + T_{m,n+1} + T_{m,n-1}) + \frac{2q''\Delta x}{k} - 4T_{m,n} = 0 \quad (4.44)^b$ <p><b>Case 5.</b> Node at a plane surface with uniform heat flux</p>

<sup>a,b</sup>To obtain the finite-difference equation for an adiabatic surface (or surface of symmetry), simply set  $h$  or  $q''$  equal to zero.


### EXAMPLE 4.2

Using the energy balance method, derive the finite-difference equation for the  $m, n$  nodal point located on a plane, insulated surface of a medium with uniform heat generation.



point. If  $\dot{q} = 0$ , the desired result could also be obtained by setting  $h = 0$  in Equation 4.42 (Table 4.2).

- As an application of the foregoing finite-difference equation, consider the following two-dimensional system within which thermal energy is uniformly generated at an unknown rate  $\dot{q}$ . The thermal conductivity of the solid is known, as are convection conditions at one of the surfaces. In addition, temperatures have been measured at locations corresponding to the nodal points of a finite-difference mesh.

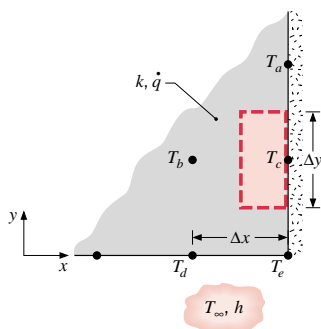


$$\begin{aligned} T_a &= 235.9^\circ\text{C} & T_b &= 227.6^\circ\text{C} \\ T_c &= 230.9^\circ\text{C} & T_d &= 220.1^\circ\text{C} \\ T_e &= 222.4^\circ\text{C} & T_\infty &= 200.0^\circ\text{C} \\ h &= 50 \text{ W/m}^2\cdot\text{K} & k &= 1 \text{ W/m}\cdot\text{K} \\ \Delta x &= 10 \text{ mm} & \Delta y &= 10 \text{ mm} \end{aligned}$$

The generation rate can be determined by applying the finite-difference equation to node c.

$$\begin{aligned} 2T_b + T_e + T_a - 4T_c + \frac{\dot{q}(\Delta x \cdot \Delta y)}{k} &= 0 \\ (2 \times 227.6 + 222.4 + 235.9 - 4 \times 230.9)^\circ\text{C} + \frac{\dot{q}(0.01\text{m})^2}{1 \text{ W/m}\cdot\text{K}} &= 0 \\ \dot{q} &= 1.01 \times 10^5 \text{ W/m}^3 \end{aligned}$$

From the prescribed thermal conditions and knowledge of  $\dot{q}$ , we can also determine whether the conservation of energy requirement is satisfied for node e. Applying an energy balance to a control volume about this node, it follows that

$$\begin{aligned} q_1 + q_2 + q_3 + q_4 + \dot{q}(\Delta x/2 \cdot \Delta y/2 \cdot 1) &= 0 \\ k(\Delta x/2 \cdot 1) \frac{T_c - T_e}{\Delta y} + 0 + h(\Delta x/2 \cdot 1)(T_\infty - T_e) + k(\Delta y/2 \cdot 1) \frac{T_d - T_e}{\Delta x} \\ + \dot{q}(\Delta x/2 \cdot \Delta y/2 \cdot 1) &= 0 \end{aligned}$$

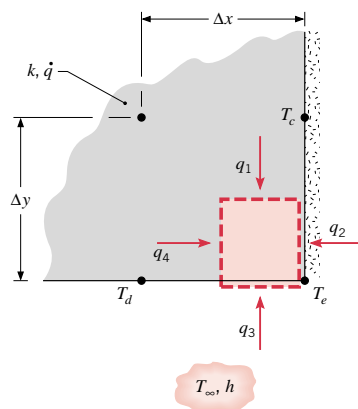

If the energy balance is satisfied, the left-hand side of this equation will be identically equal to zero. Substituting values, we obtain

$$\begin{aligned} & 1 \text{ W/m} \cdot \text{K}(0.005 \text{ m}^2) \frac{(230.9 - 222.4)^\circ\text{C}}{0.010 \text{ m}} \\ & + 0 + 50 \text{ W/m}^2 \cdot \text{K}(0.005 \text{ m}^2) (200 - 222.4)^\circ\text{C} \\ & 1 \text{ W/m} \cdot \text{K}(0.005 \text{ m}^2) \frac{(220.1 - 222.4)^\circ\text{C}}{0.010 \text{ m}} + 1.01 \times 10^5 \text{ W/m}^3(0.005)^2 \text{ m}^3 = 0(?) \\ & 4.250 \text{ W} + 0 - 5.600 \text{ W} - 1.150 \text{ W} + 2.525 \text{ W} = 0(?) \\ & 0.025 \text{ W} \approx 0 \end{aligned}$$

The inability to precisely satisfy the energy balance is attributable to temperature measurement errors, the approximations employed in developing the finite-difference equations, and the use of a relatively coarse mesh.

It is useful to note that heat rates between adjoining nodes may also be formulated in terms of the corresponding thermal resistances. Referring, for example, to Figure 4.6, the rate of heat transfer by conduction from node  $(m - 1, n)$  to  $(m, n)$  may be expressed as

$$q_{(m-1,n) \rightarrow (m,n)} = \frac{T_{m-1,n} - T_{m,n}}{R_{t,\text{cond}}} = \frac{T_{m-1,n} - T_{m,n}}{\Delta x/k(\Delta y \cdot 1)}$$


yielding a result that is equivalent to that of Equation 4.36. Similarly, the rate of heat transfer by convection to  $(m, n)$  may be expressed as

$$q_{(\infty) \rightarrow (m,n)} = \frac{T_\infty - T_{m,n}}{R_{t,\text{conv}}} = \frac{T_\infty - T_{m,n}}{\{h[(\Delta x/2) \cdot 1 + (\Delta y/2) \cdot 1]\}^{-1}}$$

which is equivalent to Equation 4.40.

As an example of the utility of resistance concepts, consider an interface that separates two dissimilar materials and is characterized by a thermal contact resistance  $R''_{t,c}$  (Figure 4.7). The rate of heat transfer from node  $(m, n)$  to  $(m, n - 1)$  may be expressed as

$$q_{(m,n) \rightarrow (m,n-1)} = \frac{T_{m,n} - T_{m,n-1}}{R_{\text{tot}}} \quad (4.45)$$

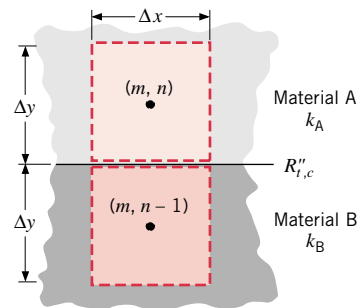

**FIGURE 4.7**

Conduction between adjoining, dissimilar materials with an interface contact resistance.

where, for a unit depth,

$$R_{\text{tot}} = \frac{\Delta y/2}{k_A(\Delta x \cdot 1)} + \frac{R''_{t,c}}{\Delta x \cdot 1} + \frac{\Delta y/2}{k_B(\Delta x \cdot 1)} \quad (4.46)$$

## 4.5

### Solving the Finite-Difference Equations

Once the nodal network has been established and an appropriate finite-difference equation has been written for each node, the temperature distribution may be determined. The problem reduces to one of solving a system of linear, algebraic equations. Numerous methods are available for this purpose and may be classified according to whether they are *direct* or *iterative*. Direct methods involve a fixed and predetermined number of arithmetic operations and are suitable for use when the number of equations (unknown nodal temperatures) is small. However, such methods are associated with larger computer memory and time requirements, and it is sometimes more efficient to use an iterative technique.

In this section we consider matrix inversion and Gauss–Seidel iteration as examples of the direct and iterative methods, respectively. More detailed descriptions of such procedures, as well as related algorithms, may be found in the literature [11, 12].

#### 4.5.1 The Matrix Inversion Method

Consider a system of  $N$  finite-difference equations corresponding to  $N$  unknown temperatures. Identifying the nodes by a single integer subscript, rather than by the double subscript  $(m, n)$ , the procedure for performing a matrix inversion begins by expressing the equations as

$$\begin{aligned} a_{11}T_1 + a_{12}T_2 + a_{13}T_3 + \cdots + a_{1N}T_N &= C_1 \\ a_{21}T_1 + a_{22}T_2 + a_{23}T_3 + \cdots + a_{2N}T_N &= C_2 \\ \vdots & \\ a_{N1}T_1 + a_{N2}T_2 + a_{N3}T_3 + \cdots + a_{NN}T_N &= C_N \end{aligned} \quad (4.47)$$

where the quantities  $a_{11}, a_{12}, \dots, C_1, \dots$  are known coefficients and constants involving quantities such as  $\Delta x, k, h$ , and  $T_\infty$ . Using matrix notation, these equations may be expressed as

$$[A][T] = [C] \quad (4.48)$$

where

$$A \equiv \begin{bmatrix} a_{11} & a_{12} & \cdots & a_{1N} \\ a_{21} & a_{22} & \cdots & a_{2N} \\ \vdots & \vdots & & \vdots \\ a_{N1} & a_{N2} & \cdots & a_{NN} \end{bmatrix}, \quad T \equiv \begin{bmatrix} T_1 \\ T_2 \\ \vdots \\ T_N \end{bmatrix}, \quad C \equiv \begin{bmatrix} C_1 \\ C_2 \\ \vdots \\ C_N \end{bmatrix}$$

The *coefficient matrix*  $[A]$  is square ( $N \times N$ ), and its *elements* are designated by a double subscript notation, for which the first and second subscripts refer to rows and columns, respectively. The matrices  $[T]$  and  $[C]$  have a single column and are

known as *column vectors*. Typically, they are termed the *solution* and *right-hand side vectors*, respectively. If the matrix multiplication implied by the left-hand side of Equation 4.48 is performed, Equations 4.47 are obtained.

The solution vector may now be expressed as

$$[T] = [A]^{-1}[C] \quad (4.49)$$

where  $[A]^{-1}$  is the inverse of  $[A]$  and is defined as

$$[A]^{-1} \equiv \begin{bmatrix} b_{11} & b_{12} & \cdots & b_{1N} \\ b_{21} & b_{22} & \cdots & b_{2N} \\ \vdots & \vdots & \ddots & \vdots \\ b_{N1} & b_{N2} & \cdots & b_{NN} \end{bmatrix}$$

Evaluating the right-hand side of Equation 4.49, it follows that

$$\begin{aligned} T_1 &= b_{11}C_1 + b_{12}C_2 + \cdots + b_{1N}C_N \\ T_2 &= b_{21}C_1 + b_{22}C_2 + \cdots + b_{2N}C_N \\ \vdots &\quad \quad \quad \vdots \quad \quad \quad \vdots \quad \quad \quad \vdots \\ T_N &= b_{N1}C_1 + b_{N2}C_2 + \cdots + b_{NN}C_N \end{aligned} \quad (4.50)$$

and the problem reduces to one of determining  $[A]^{-1}$ . That is, if  $[A]$  is inverted, its elements  $b_{11}, b_{12}, \dots$  may be determined and the unknown temperatures may be computed from the above expressions.

Matrix inversion may readily be performed on a programmable calculator or a personal computer, depending on the size of the matrix. Hence the method provides a convenient means of solving two-dimensional conduction problems.

### 4.5.2 Gauss–Seidel Iteration

Application of the Gauss–Seidel method to the system of equations represented by Equation 4.47 is facilitated by the following procedure.

1. To whatever extent possible, the equations should be reordered to provide diagonal elements whose magnitudes are larger than those of other elements in the same row. That is, it is desirable to sequence the equations such that  $|a_{11}| > |a_{12}|, |a_{13}|, \dots, |a_{1N}|; |a_{22}| > |a_{21}|, |a_{23}|, \dots, |a_{2N}|$ ; and so on.
2. After reordering, each of the  $N$  equations should be written in explicit form for the temperature associated with its diagonal element. Each temperature in the solution vector would then be of the form

$$T_i^{(k)} = \frac{C_i}{a_{ii}} - \sum_{j=1}^{i-1} \frac{a_{ij}}{a_{ii}} T_j^{(k)} - \sum_{j=i+1}^N \frac{a_{ij}}{a_{ii}} T_j^{(k-1)} \quad (4.51)$$

where  $i = 1, 2, \dots, N$ . The superscript  $k$  refers to the level of the iteration.

3. An initial ( $k = 0$ ) value is assumed for each temperature  $T_i$ . Subsequent computations may be reduced by selecting values based on rational estimates of the actual solution.
4. Setting  $k = 1$  in Equation 4.51, values of  $T_i^{(1)}$  are then calculated by substituting assumed (second summation,  $k - 1 = 0$ ) or new (first summation,  $k = 1$ ) values of  $T_j$  into the right-hand side. This step is the first ( $k = 1$ ) iteration.



5. Using Equation 4.51, the iteration procedure is continued by calculating new values of  $T_i^{(k)}$  from the  $T_j^{(k)}$  values of the current iteration, where  $1 \leq j \leq i - 1$ , and the  $T_j^{(k-1)}$  values of the previous iteration, where  $i + 1 \leq j \leq N$ .
6. The iteration is terminated when a prescribed *convergence criterion* is satisfied. The criterion may be expressed as

$$|T_i^{(k)} - T_i^{(k-1)}| \leq \varepsilon \quad (4.52)$$

where  $\varepsilon$  represents an error in the temperature, which is considered to be acceptable.

If step 1 can be accomplished for each equation, the resulting system is said to be *diagonally dominant*, and the rate of convergence is maximized (the number of required iterations is minimized). However, convergence may also be achieved in many situations for which diagonal dominance cannot be obtained, although the rate of convergence is slowed. The manner in which new values of  $T_i$  are computed (steps 4 and 5) should also be noted. Because the  $T_i$  for a particular iteration are calculated sequentially, each value can be computed by using the *most recent estimates* of the other  $T_i$ . This feature is implicit in Equation 4.51, where the value of each unknown is updated as soon as possible, that is, for  $1 \leq j \leq i - 1$ .

### EXAMPLE 4.3


A large industrial furnace is supported on a long column of fireclay brick, which is 1 m by 1 m on a side. During steady-state operation, installation is such that three surfaces of the column are maintained at 500 K while the remaining surface is exposed to an airstream for which  $T_\infty = 300$  K and  $h = 10$  W/m<sup>2</sup> · K. Using a grid of  $\Delta x = \Delta y = 0.25$  m, determine the two-dimensional temperature distribution in the column and the heat rate to the airstream per unit length of column.

### SOLUTION

**Known:** Dimensions and surface conditions of a support column.

**Find:** Temperature distribution and heat rate per unit length.

**Schematic:**

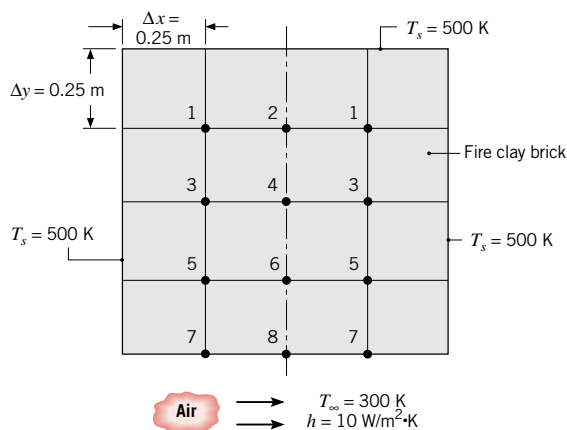

**Assumptions:**

1. Steady-state conditions.
2. Two-dimensional conduction.
3. Constant properties.
4. No internal heat generation.

**Properties:** Table A.3, fireclay brick ( $T \approx 478$  K):  $k = 1$  W/m · K.

**Analysis:** The prescribed grid consists of 12 nodal points at which the temperature is unknown. However, the number of unknowns is reduced to 8 through symmetry, in which case the temperature of nodal points to the left of the symmetry line must equal the temperature of those to the right.

Nodes 1, 3, and 5 are interior points for which the finite-difference equations may be inferred from Equation 4.29. Hence

$$\text{Node 1: } T_2 + T_3 + 1000 - 4T_1 = 0$$

$$\text{Node 3: } T_1 + T_4 + T_5 + 500 - 4T_3 = 0$$

$$\text{Node 5: } T_3 + T_6 + T_7 + 500 - 4T_5 = 0$$

Equations for points 2, 4, and 6 may be obtained in a like manner or, since they lie on a symmetry adiabat, by using Equation 4.42 with  $h = 0$ . Hence

$$\text{Node 2: } 2T_1 + T_4 + 500 - 4T_2 = 0$$

$$\text{Node 4: } T_2 + 2T_3 + T_6 - 4T_4 = 0$$

$$\text{Node 6: } T_4 + 2T_5 + T_8 - 4T_6 = 0$$

From Equation 4.42 and the fact that  $h \Delta x/k = 2.5$ , it also follows that

$$\text{Node 7: } 2T_5 + T_8 + 2000 - 9T_7 = 0$$

$$\text{Node 8: } 2T_6 + 2T_7 + 1500 - 9T_8 = 0$$

Having the required finite-difference equations, a matrix inversion solution may be obtained by ordering them from node 1 to node 8 as follows:

$$\begin{array}{cccccccccccc} -4T_1 & + & T_2 & + & T_3 & + & 0 & + & 0 & + & 0 & + & 0 & + & 0 & = & -1000 \\ 2T_1 & + & -4T_2 & + & 0 & + & T_4 & + & 0 & + & 0 & + & 0 & + & 0 & = & -500 \\ T_1 & + & 0 & + & -4T_3 & + & T_4 & + & T_5 & + & 0 & + & 0 & + & 0 & = & -500 \\ 0 & + & T_2 & + & 2T_3 & + & -4T_4 & + & 0 & + & T_6 & + & 0 & + & 0 & = & 0 \\ 0 & + & 0 & + & T_3 & + & 0 & + & -4T_5 & + & T_6 & + & T_7 & + & 0 & = & -500 \\ 0 & + & 0 & + & 0 & + & T_4 & + & 2T_5 & + & -4T_6 & + & 0 & + & T_8 & = & 0 \\ 0 & + & 0 & + & 0 & + & 0 & + & 2T_5 & + & 0 & + & -9T_7 & + & T_8 & = & -2000 \\ 0 & + & 0 & + & 0 & + & 0 & + & 0 & + & 2T_6 & + & 2T_7 & - & 9T_8 & = & -1500 \end{array}$$

In matrix notation, following Equation 4.48, these equations are of the form  $[A][T] = [C]$ , where

$$[A] = \begin{bmatrix} -4 & 1 & 1 & 0 & 0 & 0 & 0 & 0 \\ 2 & -4 & 0 & 1 & 0 & 0 & 0 & 0 \\ 1 & 0 & -4 & 1 & 1 & 0 & 0 & 0 \\ 0 & 1 & 2 & -4 & 0 & 1 & 0 & 0 \\ 0 & 0 & 1 & 0 & -4 & 1 & 1 & 0 \\ 0 & 0 & 0 & 1 & 2 & -4 & 0 & 1 \\ 0 & 0 & 0 & 0 & 2 & 0 & -9 & 1 \\ 0 & 0 & 0 & 0 & 0 & 2 & 2 & -9 \end{bmatrix} \quad [C] = \begin{bmatrix} -1000 \\ -500 \\ -500 \\ 0 \\ -500 \\ 0 \\ -2000 \\ -1500 \end{bmatrix}$$

Using a standard matrix inversion routine, it is a simple matter to find the inverse of  $[A]$ ,  $[A]^{-1}$ , giving

$$[T] = [A]^{-1}[C]$$

where

$$[T] = \begin{bmatrix} T_1 \\ T_2 \\ T_3 \\ T_4 \\ T_5 \\ T_6 \\ T_7 \\ T_8 \end{bmatrix} = \begin{bmatrix} 489.30 \\ 485.15 \\ 472.07 \\ 462.01 \\ 436.95 \\ 418.74 \\ 356.99 \\ 339.05 \end{bmatrix} \text{ K}$$

The heat rate from the column to the airstream may be computed from the expression


$$\left(\frac{q}{L}\right) = 2h \left[ \left(\frac{\Delta x}{2}\right)(T_s - T_\infty) + \Delta x(T_7 - T_\infty) + \left(\frac{\Delta x}{2}\right)(T_8 - T_\infty) \right]$$

where the factor of 2 outside the brackets originates from the symmetry condition. Hence

$$\begin{aligned} \left(\frac{q}{L}\right) &= 2 \times 10 \text{ W/m}^2 \cdot \text{K} [(0.125 \text{ m} (200 \text{ K}) \\ &\quad + 0.25 \text{ m} (56.99 \text{ K}) + 0.125 \text{ m} (39.05 \text{ K})] = 883 \text{ W/m} \end{aligned}$$

### Comments:

1. To ensure that no errors have been made in formulating the finite-difference equations or in effecting their solution, a check should be made to verify that the results satisfy conservation of energy for the nodal network. For steady-state conditions, the requirement dictates that the rate of energy inflow be balanced by the rate of outflow *for a control surface about those nodal regions whose temperatures have been evaluated.*

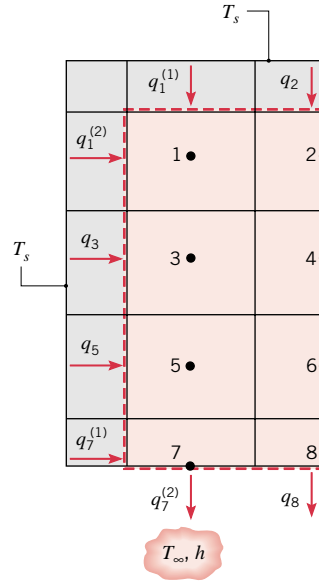

For the one-half symmetrical section shown schematically above, it follows that conduction into the nodal regions must be balanced by convection from the regions. Hence

$$q_1^{(1)} + q_1^{(2)} + q_2 + q_3 + q_5 + q_7^{(1)} = q_7^{(2)} + q_8$$

The cumulative conduction rate is then

$$\begin{aligned} \frac{q_{\text{cond}}}{L} &= k \left[ \Delta x \frac{(T_s - T_1)}{\Delta y} + \Delta y \frac{(T_s - T_1)}{\Delta x} + \frac{\Delta x}{2} \frac{(T_s - T_2)}{\Delta y} \right. \\ &\quad \left. + \Delta y \frac{(T_s - T_3)}{\Delta x} + \Delta y \frac{(T_s - T_5)}{\Delta x} + \frac{\Delta y}{2} \frac{(T_s - T_7)}{\Delta x} \right] \\ &= 191.31 \text{ W/m} \end{aligned}$$

and the convection rate is

$$\frac{q_{\text{conv}}}{L} = h \left[ \Delta x (T_7 - T_\infty) + \frac{\Delta x}{2} (T_8 - T_\infty) \right] = 191.29 \text{ W/m}$$

Agreement between the conduction and convection rates is excellent (within round-off error), confirming that mistakes have not been made in formulating and solving the finite-difference equations. Note that convection transfer from the entire bottom surface (883 W/m) is obtained by adding transfer from the edge node at 500 K (250 W/m) to that from the interior nodes (191.3 W/m) and multiplying by 2 from symmetry.

2. Although the computed temperatures satisfy the finite-difference equations, they do not provide us with the exact temperature field. Remember that the equations are approximations whose accuracy may be improved by reducing the grid size (increasing the number of nodal points).
3. The temperature distribution may also be determined by using the Gauss–Seidel iteration method. Referring to the arrangement of finite-difference equations, it

is evident that the order is already characterized by diagonal dominance. This behavior is typical of finite-difference solutions to conduction problems. We therefore begin with step 2 and express the equations in explicit form

$$T_1^{(k)} = 0.25T_2^{(k-1)} + 0.25T_3^{(k-1)} + 250$$

$$T_2^{(k)} = 0.50T_1^{(k)} + 0.25T_4^{(k-1)} + 125$$

$$T_3^{(k)} = 0.25T_1^{(k)} + 0.25T_4^{(k-1)} + 0.25T_5^{(k-1)} + 125$$

$$T_4^{(k)} = 0.25T_2^{(k)} + 0.50T_3^{(k)} + 0.25T_6^{(k-1)}$$

$$T_5^{(k)} = 0.25T_3^{(k)} + 0.25T_6^{(k-1)} + 0.25T_7^{(k-1)} + 125$$

$$T_6^{(k)} = 0.25T_4^{(k)} + 0.50T_5^{(k)} + 0.25T_8^{(k-1)}$$

$$T_7^{(k)} = 0.2222T_5^{(k)} + 0.1111T_8^{(k-1)} + 222.22$$

$$T_8^{(k)} = 0.2222T_6^{(k)} + 0.2222T_7^{(k)} + 166.67$$

Having the finite-difference equations in the required form, the iteration procedure may be implemented by using a table that has one column for the iteration (step) number and a column for each of the nodes labeled as  $T_i$ . The calculations proceed as follows:

1. For each node, the initial temperature estimate is entered on the row for  $k = 0$ . Values are selected rationally to reduce the number of required iterations.
2. Using the  $N$  finite-difference equations and values of  $T_i$  from the first and second rows, the new values of  $T_i$  are calculated for the first iteration ( $k = 1$ ). These new values are entered on the second row.
3. This procedure is repeated to calculate  $T_i^{(k)}$  from the previous values of  $T_i^{(k-1)}$  and the current values of  $T_i^{(k)}$ , until the temperature difference between iterations meets the prescribed criterion,  $\varepsilon \leq 0.2$  K, at every nodal point.

$k$	$T_1$	$T_2$	$T_3$	$T_4$	$T_5$	$T_6$	$T_7$	$T_8$
0	480	470	440	430	400	390	370	350
1	477.5	471.3	451.9	441.3	428.0	411.8	356.2	337.3
2	480.8	475.7	462.5	453.1	432.6	413.9	355.8	337.7
3	484.6	480.6	467.6	457.4	434.3	415.9	356.2	338.3
4	487.0	482.9	469.7	459.6	435.5	417.2	356.6	338.6
5	488.1	484.0	470.8	460.7	436.1	417.9	356.7	338.8
6	488.7	484.5	471.4	461.3	436.5	418.3	356.9	338.9
7	489.0	484.8	471.7	461.6	436.7	418.5	356.9	339.0
8	489.1	485.0	471.9	461.8	436.8	418.6	356.9	339.0

The results given in row 8 are in excellent agreement with those obtained by matrix inversion, although better agreement could be obtained by reducing the value of  $\varepsilon$ . However, given the approximate nature of the finite-difference equations, the results still represent approximations to the actual temperatures. The accuracy of the approximation may be improved by using a finer grid (increasing the number of nodes).

4. Note that the *IHT* solver can be used to solve the foregoing system of eight finite-difference equations for the nodal temperatures. As a skill-building exercise, key the equations into the *IHT Workspace* and press *Solve*. Compare your results with those in the foregoing table. For more complicated applications, consider using the equation-builder in the *Tools* menu, *Finite-Difference Equations* for *1-D* or *2-D*, *Steady-State* or *Transient* conditions. The nodal arrangements include those shown in Table 4.2, as well as those for extended surfaces, and allow for inclusion of volumetric generation and/or uniform heating at a boundary.
5. A second software package accompanying this text, *Finite-Element Heat Transfer (FEHT)*, may also be used to solve one- and two-dimensional forms of the heat equation. As in application of the finite-difference method, the solid is discretized, but in terms of triangular nodal elements on which energy balances are formulated. This example is provided in *FEHT* as a solved model, which may be accessed through the *Toolbar* menu *Examples*. The input screen summarizes key pre-processing and post-processing steps, as well as the results for different mesh sizes. As an exercise, press *Run* to solve for the nodal temperatures, and in the *View* menu, select *Temperature Contours* to represent the temperature distribution by a group of isotherms. For a tutorial on how to develop a model in *FEHT*, refer to the booklet *Software Tools and User's Guides*, which accompanies the *IHT* and *FEHT* software.

### 4.5.3 Some Precautions

As previously noted, it is good practice to verify that a numerical solution has been correctly formulated by performing an energy balance on a control surface about the nodal regions whose temperatures have been evaluated. The temperatures should be substituted into the energy balance equation, and if the balance is not satisfied to a high degree of precision, the finite-difference equations should be checked for errors.


Even when the finite-difference equations have been properly formulated and solved, the results may still represent a coarse approximation to the actual temperature field. This behavior is a consequence of the finite spacings ( $\Delta x$ ,  $\Delta y$ ) between nodes and of finite-difference approximations, such as  $k(\Delta y \cdot 1)(T_{m-1,n} - T_{m,n})/\Delta x$ , to Fourier's law of conduction,  $-k(dy \cdot 1)dT/dx$ . We have previously indicated that the finite-difference approximations become more accurate as the nodal network is refined ( $\Delta x$  and  $\Delta y$  are reduced). Hence, if accurate results are desired, grid studies should be performed, whereby results obtained for a fine grid are compared with those obtained for a coarse grid. One could, for example, reduce  $\Delta x$  and  $\Delta y$  by a factor of 2, thereby increasing the number of nodes and finite-difference equations by a factor of 4. If the agreement is unsatisfactory, further grid refinements could be made until the computed temperatures no longer depend significantly on the choice of  $\Delta x$  and  $\Delta y$ . Such *grid-independent* results would provide an accurate solution to the physical problem.

Another option for validating a numerical solution involves comparing results with those obtained from an exact solution. For example, a finite-difference solution

of the physical problem described in Figure 4.2 could be compared with the exact solution given by Equation 4.19. However, this option is limited by the fact that we seldom seek numerical solutions to problems for which there exist exact solutions. Nevertheless, if we seek a numerical solution to a complex problem for which there is no exact solution, it is often useful to test our finite-difference procedures by applying them to a simpler version of the problem.

#### EXAMPLE 4.4

A major objective in advancing gas turbine engine technologies is to increase the temperature limit associated with operation of the gas turbine blades. This limit determines the permissible turbine gas inlet temperature, which, in turn, strongly influences overall system performance. In addition to fabricating turbine blades from special, high-temperature, high-strength superalloys, it is common to use internal cooling by machining flow channels within the blades and routing air through the channels. We wish to assess the effect of such a scheme by approximating the blade as a rectangular solid in which rectangular channels are machined. The blade, which has a thermal conductivity of  $k = 25 \text{ W/m} \cdot \text{K}$ , is 6 mm thick, and each channel has a  $2 \text{ mm} \times 6 \text{ mm}$  rectangular cross section, with a 4-mm spacing between adjoining channels.

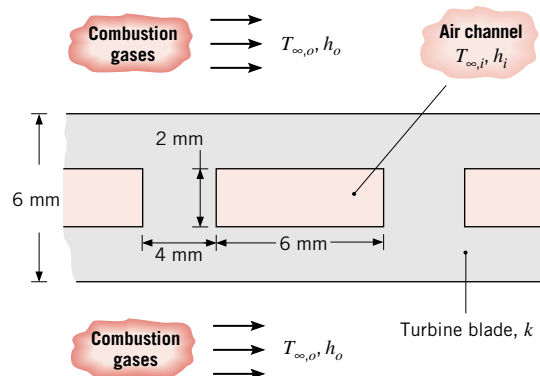


Under operating conditions for which  $h_o = 1000 \text{ W/m}^2 \cdot \text{K}$ ,  $T_{\infty,o} = 1700 \text{ K}$ ,  $h_i = 200 \text{ W/m}^2 \cdot \text{K}$ , and  $T_{\infty,i} = 400 \text{ K}$ , determine the temperature field in the turbine blade and the rate of heat transfer per unit length to the channel. At what location is the temperature a maximum?

#### SOLUTION

**Known:** Dimensions and operating conditions for a gas turbine blade with embedded channels.

**Find:** Temperature field in the blade, including a location of maximum temperature. Rate of heat transfer per unit length to the channel.

**Schematic:**

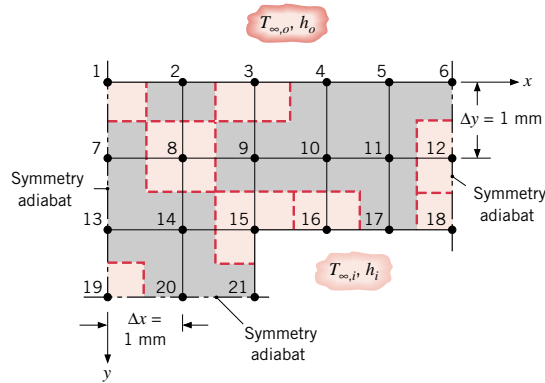

**Assumptions:**

1. Steady-state, two-dimensional conduction.
2. Constant properties.

**Analysis:** Adopting a grid space of  $\Delta x = \Delta y = 1$  mm and identifying the three lines of symmetry, the foregoing nodal network is constructed. The corresponding finite-difference equations may be obtained by applying the energy balance method to nodes 1, 6, 18, 19, and 21 and by using the results of Table 4.2 for the remaining nodes.

Heat transfer to node 1 occurs by conduction from nodes 2 and 7, as well as by convection from the outer fluid. Since there is no heat transfer from the region beyond the symmetry adiabat, application of an energy balance to the one-quarter section associated with node 1 yields a finite-difference equation of the form

$$\text{Node 1: } T_2 + T_7 - \left(2 + \frac{h_o \Delta x}{k}\right) T_1 = -\frac{h_o \Delta x}{k} T_{\infty,o}$$

A similar result may be obtained for nodal region 6, which is characterized by equivalent surface conditions (2 conduction, 1 convection, 1 adiabatic). Nodes 2 to 5 correspond to case 3 of Table 4.2, and choosing node 3 as an example, it follows that

$$\text{Node 3: } T_2 + T_4 + 2T_9 - 2\left(\frac{h_o \Delta x}{k} + 2\right) T_3 = -\frac{2h_o \Delta x}{k} T_{\infty,o}$$

Nodes 7, 12, 13, and 20 correspond to case 5 of Table 4.2, with  $q'' = 0$ , and choosing node 12 as an example, it follows that

$$\text{Node 12: } T_6 + 2T_{11} + T_{18} - 4T_{12} = 0$$

Nodes 8 to 11 and 14 are interior nodes (case 1), in which case the finite-difference equation for node 8 is

$$\text{Node 8: } T_2 + T_7 + T_9 + T_{14} - 4T_8 = 0$$

Node 15 is an internal corner (case 2) for which

$$\text{Node 15: } 2T_9 + 2T_{14} + T_{16} + T_{21} - 2\left(3 + \frac{h_i \Delta x}{k}\right) T_{15} = -2\frac{h_i \Delta x}{k} T_{\infty,i}$$



while nodes 16 and 17 are situated on a plane surface with convection (case 3):

$$\text{Node 16: } 2T_{10} + T_{15} + T_{17} - 2\left(\frac{h_i \Delta x}{k} + 2\right)T_{16} = -\frac{2h_i \Delta x}{k}T_{\infty,i}$$

In each case heat transfer to nodal regions 18 and 21 is characterized by conduction from two adjoining nodes and convection from the internal flow, with no heat transfer occurring from an adjoining adiabat. Performing an energy balance for nodal region 18, it follows that

$$\text{Node 18: } T_{12} + T_{17} - \left(2 + \frac{h_i \Delta x}{k}\right)T_{18} = -\frac{h_i \Delta x}{k}T_{\infty,i}$$


The last special case corresponds to nodal region 19, which has two adiabatic surfaces and experiences heat transfer by conduction across the other two surfaces.

$$\text{Node 19: } T_{13} + T_{20} - 2T_{19} = 0$$


The 21 finite-difference equations may be solved for the unknown temperatures, and for the prescribed conditions, the following results are obtained:

$T_1$	$T_2$	$T_3$	$T_4$	$T_5$	$T_6$
1526.0K	1525.3 K	1523.6 K	1521.9 K	1520.8 K	1520.5 K
$T_7$	$T_8$	$T_9$	$T_{10}$	$T_{11}$	$T_{12}$
1519.7 K	1518.8K	1516.5 K	1514.5 K	1513.3 K	1512.9 K
$T_{13}$	$T_{14}$	$T_{15}$	$T_{16}$	$T_{17}$	$T_{18}$
1515.1 K	1513.7 K	1509.2 K	1506.4 K	1505.0 K	1504.5 K
$T_{19}$	$T_{20}$	$T_{21}$			
1513.4 K	1511.7 K	1506.0 K			

The temperature field may also be represented in the form of isotherms, and four such lines of constant temperature are shown schematically. Also shown are heat flux lines that have been carefully drawn so that they are everywhere perpendicular to the isotherms and coincident with the symmetry adiabat. The surfaces that are exposed to the combustion gases and air are not isothermal, and therefore the heat flow lines are not perpendicular to these boundaries.

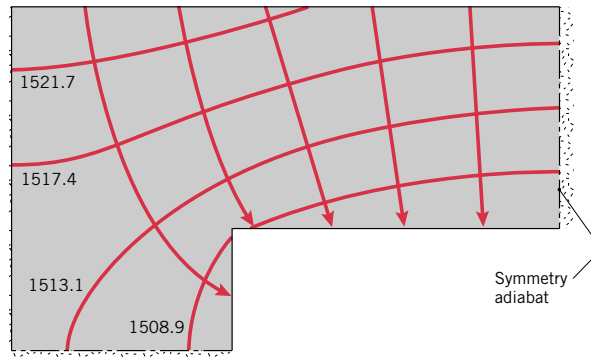

As expected, the maximum temperature exists at the location furthest removed from the coolant, which corresponds to node 1. Temperatures along the surface of the turbine blade exposed to the combustion gases are of particular interest, and using an interpolation scheme with the finite-difference predictions, the following distribution is obtained:

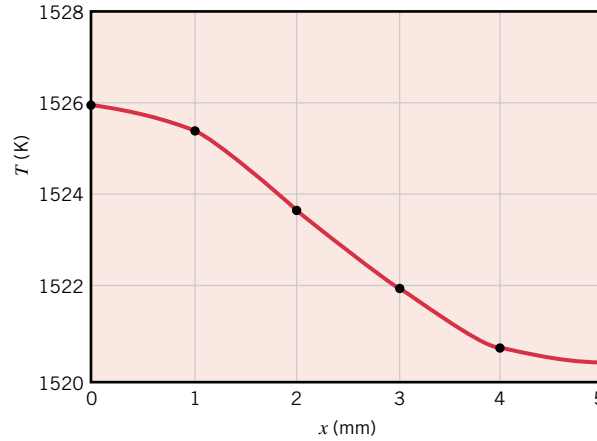

The rate of heat transfer per unit length of channel may be expressed as

$$q' = 4h_i[(\Delta y/2)(T_{21} - T_{\infty,i}) + (\Delta y/2 + \Delta x/2)(T_{15} - T_{\infty,i}) + (\Delta x)(T_{16} - T_{\infty,i}) + \Delta x(T_{17} - T_{\infty,i}) + (\Delta x/2)(T_{18} - T_{\infty,i})]$$

or, alternatively, as

$$q' = 4h_o[(\Delta x/2)(T_{\infty,o} - T_1) + (\Delta x)(T_{\infty,o} - T_2) + (\Delta x)(T_{\infty,o} - T_3) + (\Delta x)(T_{\infty,o} - T_4) + (\Delta x)(T_{\infty,o} - T_5) + (\Delta x/2)(T_{\infty,o} - T_6)]$$

where the factor of 4 originates from the symmetry conditions. In both cases, we obtain

$$q' = 3540.6 \text{ W/m}$$



### Comments:

1. The accuracy of the finite-difference solution may be improved by refining the grid. If, for example, we halve the grid spacing ( $\Delta x = \Delta y = 0.5 \text{ mm}$ ), thereby increasing the number of unknown nodal temperatures to 65, we obtain the following results for selected temperatures and the heat rate:

$$\begin{aligned} T_1 &= 1525.9 \text{ K}, & T_6 &= 1520.5 \text{ K}, & T_{15} &= 1509.2 \text{ K}, \\ T_{18} &= 1504.5 \text{ K}, & T_{19} &= 1513.5 \text{ K}, & T_{21} &= 1505.7 \text{ K}, \\ q' &= 3539.9 \text{ W/m} \end{aligned}$$

Agreement between the two sets of results is excellent. Of course, use of the finer mesh increases set up and computation time, and in many cases results obtained from a coarse grid are satisfactory. Selection of the appropriate grid is a judgment that must be made by the engineer.

2. In the gas turbine industry, there is great interest in adopting measures that reduce blade temperatures. Such measures could include use of a different alloy

of larger thermal conductivity and/or increasing coolant flow through the channel, thereby increasing  $h_i$ . Using the finite-difference solution with  $\Delta x = \Delta y = 1$  mm, the following results are obtained for parametric variations of  $k$  and  $h_i$ :

$k$ (W/m · K)	$h_i$ (W/m <sup>2</sup> · K)	$T_1$ (K)	$q'$ (W/m)
25	200	1526.0	3540.6
50	200	1523.4	3563.3
25	1000	1154.5	11,095.5
50	1000	1138.9	11,320.7

Why do increases in  $k$  and  $h_i$  reduce temperature in the blade? Why is the effect of the change in  $h_i$  more significant than that of  $k$ ?

- Note that, because the exterior surface of the blade is at an extremely high temperature, radiation losses to its surroundings may be significant. In the finite-difference analysis, such effects could be considered by linearizing the radiation rate equation (see Equations 1.8 and 1.9) and treating radiation in the same manner as convection. However, because the radiation coefficient  $h_r$  depends on the surface temperature, an iterative finite-difference solution would be necessary to ensure that the resulting surface temperatures correspond to the temperatures at which  $h_r$  is evaluated at each nodal point.
- The *IHT* solver can be used to solve the system of 19 finite-difference equations for the nodal temperatures. The equations may be formulated by accessing the equation-builder in the *Finite-Difference Equations, 2-D, Steady-State* section of the *Tools* menu. The menu provides schematics of the control volumes (interior nodes, corner nodes, etc.), and boxes are provided to enter identifiers or subscripts for the temperatures and other parameters.
- This example is provided as a solved model in *FEHT* and may be accessed through *Examples* on the *Toolbar*. The input screen summarizes pre- and post-processing steps, as well as the results for different nodal spacings of 1 and 0.125 mm. As an exercise, press *Run* to compute the nodal temperatures, and in the *View* menu, select *Temperature Contours* to represent the temperature field in the form of isotherms. For a tutorial on how to develop a model in *FEHT*, refer to the booklet, *Software Tools and User's Guides*, which accompanies the *IHT* and *FEHT* software.

## 4.6

### Summary

The primary objective of this chapter was to develop an appreciation for the nature of a two-dimensional conduction problem and the methods that are available for its solution. When confronted with a two-dimensional problem, one should first determine whether an exact solution is known. This may be done by examining some of the excellent references in which exact solutions to the heat equation are obtained [1–5]. One may also want to determine whether the shape factor or dimensionless conduction heat rate is known for the system of interest [6–10]. However, often,

conditions are such that the use of a shape factor, dimensionless conduction heat rate, or an exact solution is not possible, and it is necessary to use a finite-difference or finite-element solution. You should appreciate the inherent nature of the *discretization process* and know how to formulate and solve the finite-difference equations for the discrete points of a nodal network. You may test your understanding of related concepts by addressing the following questions.

- What is an *isotherm*? What is a *heat flow line*? How are the two lines related geometrically?
- What is an *adiabat*? How is it related to a line of symmetry? How is it intersected by an isotherm?
- What parameters characterize the effect of geometry on the relationship between the heat rate and the overall temperature difference for steady conduction in a two-dimensional system? How are these parameters related to the conduction resistance?
- What is represented by the temperature of a *nodal point*, and how does the accuracy of a nodal temperature depend on prescription of the *nodal network*?

## References


1. Schneider, P. J., *Conduction Heat Transfer*, Addison-Wesley, Reading, MA, 1955.
2. Carslaw, H. S., and J. C. Jaeger, *Conduction of Heat in Solids*, Oxford University Press, London, 1959.
3. Özisik, M. N., *Heat Conduction*, Wiley Interscience, New York, 1980.
4. Kakac, S., and Y. Yener, *Heat Conduction*, Hemisphere Publishing, New York, 1985.
5. Poulidakos, D., *Conduction Heat Transfer*, Prentice-Hall, Englewood Cliffs, NJ, 1994.
6. Sunderland, J. E., and K. R. Johnson, *Trans. ASHRAE*, **10**, 237–241, 1964.
7. Kutateladze, S. S., *Fundamentals of Heat Transfer*, Academic Press, New York, 1963.
8. General Electric Co. (Corporate Research and Development), *Heat Transfer Data Book*, Section 502, General Electric Company, Schenectady, NY, 1973.
9. Hahne, E., and U. Grigull, *Int. J. Heat Mass Transfer*, **18**, 751–767, 1975.
10. Yovanovich, M. M., in W. M. Rohsenow, J. P. Hartnett, and Y. I. Cho, Eds., *Handbook of Heat Transfer*, McGraw-Hill, New York, 1998, pp. 3.1–3.73.
11. Gerald, C. F., and P. O. Wheatley, *Applied Numerical Analysis*, Pearson Education, Upper Saddle River, NJ, 1998.
12. Hoffman, J. D., *Numerical Methods for Engineers and Scientists*, McGraw-Hill, New York, 1992.

## Problems


### Exact Solutions

- 4.1 In the method of separation of variables (Section 4.2) for two-dimensional, steady-state conduction, the separation constant  $\lambda^2$  in Equations 4.6 and 4.7 must be a positive constant. Show that a negative or zero value of  $\lambda^2$  will result in solutions that cannot satisfy the prescribed boundary conditions.
- 4.2 A two-dimensional rectangular plate is subjected to prescribed boundary conditions. Using the results of the exact solution for the heat equation presented in Section 4.2, calculate the temperature at the midpoint


(1, 0.5) by considering the first five nonzero terms of the infinite series that must be evaluated. Assess the error resulting from using only the first three terms of the infinite series. Plot the temperature distributions  $T(x, 0.5)$  and  $T(1.0, y)$ .

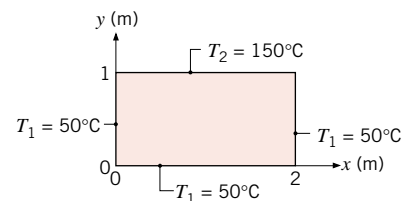

- 4.3** Consider the two-dimensional rectangular plate of Problem 4.2 having a thermal conductivity of  $50 \text{ W/m} \cdot \text{K}$ . Beginning with the exact solution for the temperature distribution, derive an expression for the heat transfer rate per unit thickness from the plate along the lower surface ( $0 \leq x \leq 2$ ,  $y = 0$ ). Evaluate the heat rate considering the first five nonzero terms of the infinite series.
- 4.4** A two-dimensional rectangular plate is subjected to the boundary conditions shown. Derive an expression for the steady-state temperature distribution  $T(x, y)$ .



- 4.5** A two-dimensional rectangular plate is subjected to prescribed temperature boundary conditions on three sides and a uniform heat flux *into* the plate at the top surface. Using the general approach of Section 4.2, derive an expression for the temperature distribution in the plate.

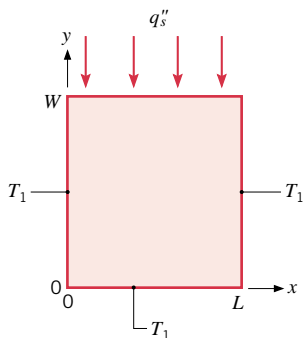


### Shape Factors and Dimensionless Conduction Heat Rates

- 4.6** Using the thermal resistance relations developed in Chapter 3, determine shape factor expressions for the following geometries:
- Plane wall, cylindrical shell, and spherical shell.
  - Isothermal sphere of diameter  $D$  buried in an infinite medium.
- 4.7** Consider Problem 4.5 for the case where the plate is of square cross section,  $W = L$ .
- Derive an expression for the shape factor,  $S_{\max}$ , associated with the *maximum* top surface temperature, such that  $q = S_{\max} k (T_{2, \max} - T_1)$  where  $T_{2, \max}$  is the maximum temperature along  $y = W$ .

- Derive an expression for the shape factor,  $S_{\text{avg}}$ , associated with the *average* top surface temperature,  $q = S_{\text{avg}} k (\bar{T}_2 - T_1)$  where  $\bar{T}_2$  is the average temperature along  $y = W$ .
- Evaluate the shape factors that can be used to determine the maximum and average temperatures along  $y = W$ . Evaluate the maximum and average temperatures for  $T_1 = 0^\circ\text{C}$ ,  $L = W = 10 \text{ mm}$ ,  $k = 20 \text{ W/m} \cdot \text{K}$ , and  $q''_s = 1000 \text{ W/m}^2$ .

- 4.8** Based on the dimensionless conduction heat rates for cases 12–15 in Table 4.1b, find shape factors for the following objects having temperature  $T_1$ , located at the surface of a semi-infinite medium having temperature  $T_2$ . The surface of the semi-infinite medium is adiabatic.
- A buried hemisphere, flush with the surface.
  - A disk on the surface. Compare your result to Table 4.1a, case 10.
  - A square on the surface.
  - A buried cube, flush with the surface.

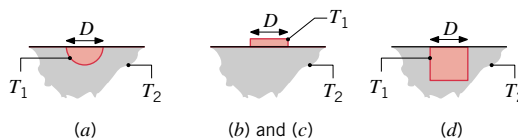

- 4.9** Radioactive wastes are temporarily stored in a spherical container, the center of which is buried a distance of 10 m below the earth's surface. The outside diameter of the container is 2 m, and 500 W of heat are released as a result of the radioactive decay process. If the soil surface temperature is  $20^\circ\text{C}$ , what is the outside surface temperature of the container under steady-state conditions? On a sketch of the soil–container system drawn to scale, show representative isotherms and heat flow lines in the soil.
- 4.10** A pipeline, used for the transport of crude oil, is buried in the earth such that its centerline is a distance of 1.5 m below the surface. The pipe has an outer diameter of 0.5 m and is insulated with a layer of cellular glass 100 mm thick. What is the heat loss per unit length of pipe under conditions for which heated oil at  $120^\circ\text{C}$  flows through the pipe and the surface of the earth is at a temperature of  $0^\circ\text{C}$ ?
- 4.11** A long power transmission cable is buried at a depth (ground to cable centerline distance) of 2 m. The cable is encased in a thin-walled pipe of 0.1-m diameter, and to render the cable *superconducting* (essentially zero power dissipation), the space between the cable and pipe is filled with liquid nitrogen at 77 K. If the pipe is covered with a superinsulator ( $k_i = 0.005 \text{ W/m} \cdot \text{K}$ ) of 0.05-m thickness and the surface of the earth ( $k_g = 1.2 \text{ W/m} \cdot \text{K}$ ) is at 300 K, what is the cooling load in W/m that must be maintained by a cryogenic refrigerator per unit pipe length?

- 4.12** An electrical heater 100 mm long and 5 mm in diameter is inserted into a hole drilled normal to the surface of a large block of material having a thermal conductivity of  $5 \text{ W/m} \cdot \text{K}$ . Estimate the temperature reached by the heater when dissipating 50 W with the surface of the block at a temperature of  $25^\circ\text{C}$ .
- 4.13** Two parallel pipelines spaced 0.5 m apart are buried in soil having a thermal conductivity of  $0.5 \text{ W/m} \cdot \text{K}$ . The pipes have outer diameters of 100 and 75 mm with surface temperatures of  $175^\circ\text{C}$  and  $5^\circ\text{C}$ , respectively. Estimate the heat transfer rate per unit length between the two pipelines.
- 4.14** A tube of diameter 50 mm having a surface temperature of  $85^\circ\text{C}$  is embedded in the center plane of a concrete slab 0.1 m thick with upper and lower surfaces at  $20^\circ\text{C}$ . Using the appropriate tabulated relation for this configuration, find the shape factor. Determine the heat transfer rate per unit length of the tube.
- 4.15** Pressurized steam at 450 K flows through a long, thin-walled pipe of 0.5-m diameter. The pipe is enclosed in a concrete casing that is of square cross section and 1.5 m on a side. The axis of the pipe is centered in the casing, and the outer surfaces of the casing are maintained at 300 K. What is the heat loss per unit length of pipe?
- 4.16** Hot water at  $85^\circ\text{C}$  flows through a thin-walled copper tube of 30 mm diameter. The tube is enclosed by an eccentric cylindrical shell that is maintained at  $35^\circ\text{C}$  and has a diameter of 120 mm. The eccentricity, defined as the separation between the centers of the tube and shell, is 20 mm. The space between the tube and shell is filled with an insulating material having a thermal conductivity of  $0.05 \text{ W/m} \cdot \text{K}$ . Calculate the heat loss per unit length of the tube and compare the result with the heat loss for a concentric arrangement.
- 4.17** A furnace of cubical shape, with external dimensions of 0.35 m, is constructed from a refractory brick (fireclay). If the wall thickness is 50 mm, the inner surface temperature is  $600^\circ\text{C}$ , and the outer surface temperature is  $75^\circ\text{C}$ , calculate the heat loss from the furnace.
- 4.18** The temperature distribution in laser-irradiated materials is determined by the power, size, and shape of the laser beam, along with the properties of the material being irradiated. The beam shape is typically Gaussian, and the local beam irradiation flux (often referred to as the laser *fluence*) is

$$q''(x, y) = q''(x = y = 0) \exp(-x/r_b)^2 \exp(-y/r_b)^2$$

The  $x$  and  $y$  coordinates determine the location of interest on the surface of the irradiated material. Consider

the case where the center of the beam is located at  $x = y = r = 0$ . The beam is characterized by a radius,  $r_b$ , defined as the radial location where the local fluence is  $q''(r_b) = q''(r = 0)/e \approx 0.368q''(r = 0)$ .

A shape factor for Gaussian heating is  $S = 2\pi^{1/2}r_b$ , where  $S$  is defined in terms of  $T_{1,\max} - T_2$  [Nissin, Y. I., A. Lietoila, R. G. Gold, and J. F. Gibbons, *J. Appl. Phys.*, **51**, 274, 1980]. Calculate the maximum steady-state surface temperature associated with irradiation of a material of thermal conductivity  $k = 27 \text{ W/m} \cdot \text{K}$  and absorptivity  $\alpha = 0.45$  by a Gaussian beam with  $r_b = 0.1 \text{ mm}$  and power  $P = 1 \text{ W}$ . Compare your result with the maximum temperature that would occur if the irradiation was from a circular beam of the same diameter and power, but characterized by a uniform fluence (a *flat beam*). Also calculate the average temperature of the irradiated surface for the uniform fluence case. The temperature far from the irradiated spot is  $T_2 = 25^\circ\text{C}$ .

- 4.19** Laser beams are used to thermally process materials in a wide range of applications. Often, the beam is scanned along the surface of the material in a desired pattern. Consider the laser heating process of Problem 4.18, except now the laser beam scans the material at a scanning velocity of  $U$ . A dimensionless maximum surface temperature can be well correlated by an expression of the form [Nissin, Y. I., A. Lietoila, R. G. Gold, and J. F. Gibbons, *J. Appl. Phys.*, **51**, 274, 1980]

$$\frac{T_{1,\max,U=0} - T_2}{T_{1,\max,U \neq 0} - T_2} = 1 + 0.301Pe - 0.0108Pe^2$$

for the range  $0 < Pe < 10$  where  $Pe$  is a dimensionless velocity known as the Peclet number. For this problem,  $Pe = Ur_b/\sqrt{2}\alpha$  where  $\alpha$  is the thermal diffusivity of the material. The maximum material temperature does not occur directly below the laser beam, but a lag distance,  $\delta$ , behind the center of the moving beam. The dimensionless lag distance can be correlated to  $Pe$  by [Sheng, I. C., and Y. Chen, *J. Thermal Stresses*, **14**, 129, 1991]


$$\frac{\delta U}{\alpha} = 0.944Pe^{1.55}$$

- (a) For the laser beam size and shape, and material of Problem 4.18, determine the laser power required to achieve  $T_{1,\max} = 200^\circ\text{C}$  for  $U = 2 \text{ m/s}$ . The density and specific heat of the material are  $\rho = 2000 \text{ kg/m}^3$  and  $c = 800 \text{ J/kg} \cdot \text{K}$ , respectively.
- (b) Determine the lag distance,  $\delta$ , associated with  $U = 2 \text{ m/s}$ .
- (c) Plot the required laser power to achieve  $T_{\max,1} = 200^\circ\text{C}$  for  $0 \leq U \leq 2 \text{ m/s}$ .

### Shape Factors with Thermal Circuits

**4.20** A cubical glass melting furnace has exterior dimensions of width  $W = 5$  m on a side and is constructed from refractory brick of thickness  $L = 0.35$  m and thermal conductivity  $k = 1.4$  W/m · K. The sides and top of the furnace are exposed to ambient air at  $25^\circ\text{C}$ , with free convection characterized by an average coefficient of  $h = 5$  W/m<sup>2</sup> · K. The bottom of the furnace rests on a framed platform for which much of the surface is exposed to the ambient air, and a convection coefficient of  $h = 5$  W/m<sup>2</sup> · K may be assumed as a first approximation. Under operating conditions for which combustion gases maintain the inner surfaces of the furnace at  $1100^\circ\text{C}$ , what is the heat loss from the furnace?


**4.21** A hot fluid passes through circular channels of a cast iron platen (A) of thickness  $L_A = 30$  mm which is in poor contact with the cover plates (B) of thickness  $L_B = 7.5$  mm. The channels are of diameter  $D = 15$  mm with a centerline spacing of  $L_o = 60$  mm. The thermal conductivities of the materials are  $k_A = 20$  W/m · K and  $k_B = 75$  W/m · K, while the contact resistance between the two materials is  $R''_{t,c} = 2.0 \times 10^{-4}$  m<sup>2</sup> · K/W. The hot fluid is at  $T_i = 150^\circ\text{C}$ , and the convection coefficient is  $1000$  W/m<sup>2</sup> · K. The cover plate is exposed to ambient air at  $T_\infty = 25^\circ\text{C}$  with a convection coefficient of  $200$  W/m<sup>2</sup> · K. The shape factor between one channel and the platen top and bottom surfaces is  $4.25$ .

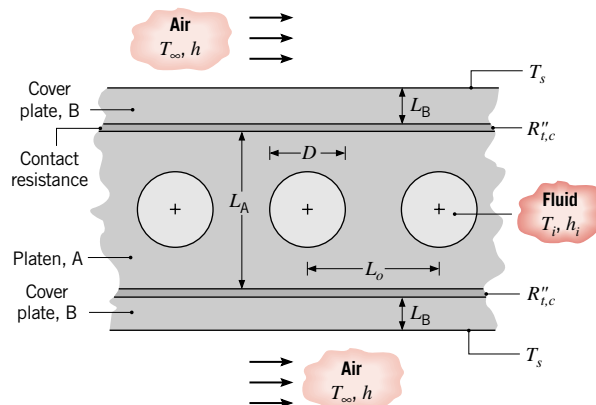

- Determine the heat rate from a single channel per unit length of the platen normal to the page,  $q'_i$ .
- Determine the outer surface temperature of the cover plate,  $T_s$ .
- Comment on the effects that changing the centerline spacing will have on  $q'_i$  and  $T_s$ . How would insulating the lower surface affect  $q'_i$  and  $T_s$ ?


**4.22** A long constantan wire of 1-mm diameter is butt welded to the surface of a large copper block, forming a thermo-

couple junction. The wire behaves as a fin, permitting heat to flow from the surface, thereby depressing the sensing junction temperature  $T_j$  below that of the block  $T_o$ .

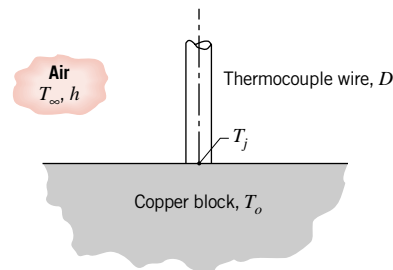


- If the wire is in air at  $25^\circ\text{C}$  with a convection coefficient of  $10$  W/m<sup>2</sup> · K, estimate the measurement error ( $T_j - T_o$ ) for the thermocouple when the block is at  $125^\circ\text{C}$ .
- For convection coefficients of  $5$ ,  $10$ , and  $25$  W/m<sup>2</sup> · K, plot the measurement error as a function of the thermal conductivity of the block material over the range  $15$  to  $400$  W/m · K. Under what circumstances is it advantageous to use smaller diameter wire?

**4.23** A hole of diameter  $D = 0.25$  m is drilled through the center of a solid block of square cross section with  $w = 1$  m on a side. The hole is drilled along the length,  $l = 2$  m, of the block, which has a thermal conductivity of  $k = 150$  W/m · K. The outer surfaces are exposed to ambient air, with  $T_{\infty,2} = 25^\circ\text{C}$  and  $h_2 = 4$  W/m<sup>2</sup> · K, while hot oil flowing through the hole is characterized by  $T_{\infty,1} = 300^\circ\text{C}$  and  $h_1 = 50$  W/m<sup>2</sup> · K. Determine the corresponding heat rate and surface temperatures.

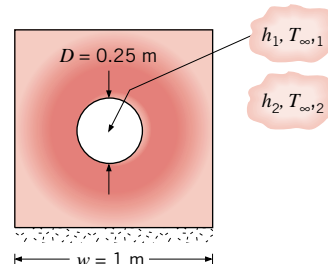

**4.24** In Chapter 3 we assumed that, whenever fins are attached to a base material, the base temperature is unchanged. What in fact happens is that, if the temperature of the base material exceeds the fluid temperature, attachment of a fin depresses the junction temperature  $T_j$  below the original temperature of the base, and heat flow from the base material to the fin is two-dimensional.




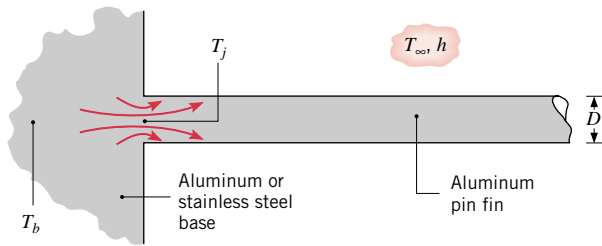

Consider conditions for which a long aluminum pin fin of diameter  $D = 5$  mm is attached to a base material whose temperature far from the junction is maintained at  $T_b = 100^\circ\text{C}$ . Fin convection conditions correspond to  $h = 50 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 25^\circ\text{C}$ .

- What are the fin heat rate and junction temperature when the base material is (i) aluminum ( $k = 240 \text{ W/m} \cdot \text{K}$ ) and (ii) stainless steel ( $k = 15 \text{ W/m} \cdot \text{K}$ )?
- Repeat the foregoing calculations if a thermal contact resistance of  $R''_{t,j} = 3 \times 10^{-5} \text{ m}^2 \cdot \text{K/W}$  is associated with the method of joining the pin fin to the base material.
- Considering the thermal contact resistance, plot the heat rate as a function of the convection coefficient over the range  $10 \leq h \leq 100 \text{ W/m}^2 \cdot \text{K}$  for each of the two materials.

- 4.25** An igloo is built in the shape of a hemisphere, with an inner radius of 1.8 m and walls of compacted snow that are 0.5 m thick. On the inside of the igloo the surface heat transfer coefficient is  $6 \text{ W/m}^2 \cdot \text{K}$ ; on the outside, under normal wind conditions, it is  $15 \text{ W/m}^2 \cdot \text{K}$ . The thermal conductivity of compacted snow is  $0.15 \text{ W/m} \cdot \text{K}$ . The temperature of the ice cap on which the igloo sits is  $-20^\circ\text{C}$  and has the same thermal conductivity as the compacted snow.

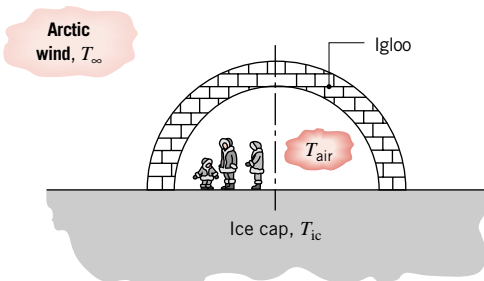


- Assuming that the occupants' body heat provides a continuous source of 320 W within the igloo, calculate the inside air temperature when the outside air temperature is  $T_\infty = -40^\circ\text{C}$ . Be sure to consider heat losses through the floor of the igloo.

- Using the thermal circuit of part (a), perform a parameter sensitivity analysis to determine which variables have a significant effect on the inside air temperature. For instance, for very high wind conditions, the outside convection coefficient could double or even triple. Does it make sense to construct the igloo with walls half or twice as thick?

- 4.26** Consider the thin integrated circuit (chip) of Problem 3.136. Instead of attaching the heat sink to the chip surface, an engineer suggests that sufficient cooling might be achieved by mounting the top of the chip onto a large copper ( $k = 400 \text{ W/m} \cdot \text{K}$ ) surface that is located nearby. The metallurgical joint between the chip and the substrate provides a contact resistance of  $R''_{t,c} = 5 \times 10^{-6} \text{ m}^2 \cdot \text{K/W}$ , and the maximum allowable chip temperature is  $85^\circ\text{C}$ . If the large substrate temperature is  $T_2 = 25^\circ\text{C}$  at locations far from the chip, what is the maximum allowable chip power dissipation  $q_c$ ?


- 4.27** An electronic device, in the form of a disk 20 mm in diameter, dissipates 100 W when mounted flush on a large aluminum alloy (2024) block whose temperature is maintained at  $27^\circ\text{C}$ . The mounting arrangement is such that a contact resistance of  $R''_{t,c} = 5 \times 10^{-5} \text{ m}^2 \cdot \text{K/W}$  exists at the interface between the device and the block.

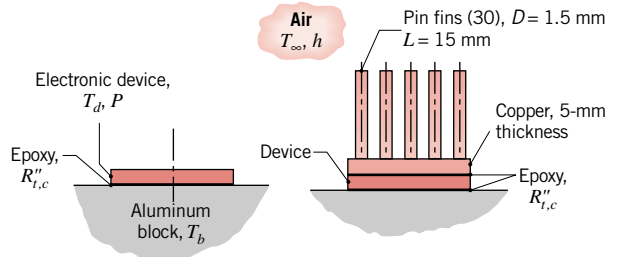

- Calculate the temperature the device will reach, assuming that all the power generated by the device must be transferred by conduction to the block.
  - In order to operate the device at a higher power level, a circuit designer proposes to attach a finned heat sink to the top of the device. The pin fins and base material are fabricated from copper ( $k = 400 \text{ W/m} \cdot \text{K}$ ) and are exposed to an airstream at  $27^\circ\text{C}$  for which the convection coefficient is  $1000 \text{ W/m}^2 \cdot \text{K}$ . For the device temperature computed in part (a), what is the permissible operating power?
- 4.28** An aluminum heat sink ( $k = 240 \text{ W/m} \cdot \text{K}$ ) used to cool an array of electronic chips consists of a square channel of inner width  $w = 25$  mm, through which liquid flow may be assumed to maintain a uniform surface temperature of




$T_1 = 20^\circ\text{C}$ . The outer width and length of the channel are  $W = 40\text{ mm}$  and  $L = 160\text{ mm}$ , respectively.

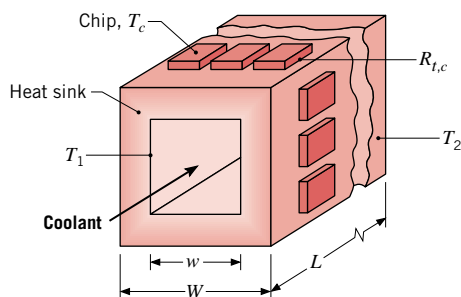

If  $N = 120$  chips attached to the outer surfaces of the heat sink maintain an approximately uniform surface temperature of  $T_2 = 50^\circ\text{C}$  and all of the heat dissipated by the chips is assumed to be transferred to the coolant, what is the heat dissipation per chip? If the contact resistance between each chip and the heat sink is  $R_{t,c} = 0.2\text{ K/W}$ , what is the chip temperature?


- 4.29** Hot water is transported from a cogeneration power station to commercial and industrial users through steel pipes of diameter  $D = 150\text{ mm}$ , with each pipe centered in concrete ( $k = 1.4\text{ W/m}\cdot\text{K}$ ) of square cross section ( $w = 300\text{ mm}$ ). The outer surfaces of the concrete are exposed to ambient air for which  $T_\infty = 0^\circ\text{C}$  and  $h = 25\text{ W/m}^2\cdot\text{K}$ .

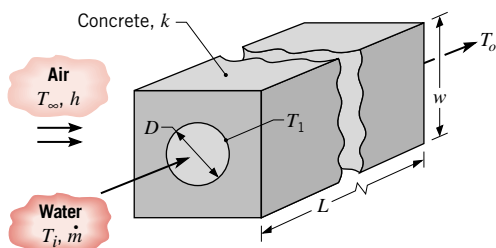

- If the inlet temperature of water flowing through the pipe is  $T_i = 90^\circ\text{C}$ , what is the heat loss per unit length of pipe in proximity to the inlet? The temperature of the pipe  $T_1$  may be assumed to be that of the inlet water.
- If the difference between the inlet and outlet temperatures of water flowing through a 100-m-long pipe is not to exceed  $5^\circ\text{C}$ , estimate the minimum allowable flow rate  $\dot{m}$ . A value of  $c = 4207\text{ J/kg}\cdot\text{K}$  may be used for the specific heat of the water.

- 4.30** The elemental unit of an air heater consists of a long circular rod of diameter  $D$ , which is encapsulated by a

finned sleeve and in which thermal energy is generated by Ohmic heating. The  $N$  fins of thickness  $t$  and length  $L$  are integrally fabricated with the square sleeve of width  $w$ . Under steady-state operating conditions, the rate of thermal energy generation corresponds to the rate of heat transfer to air flow over the sleeve.

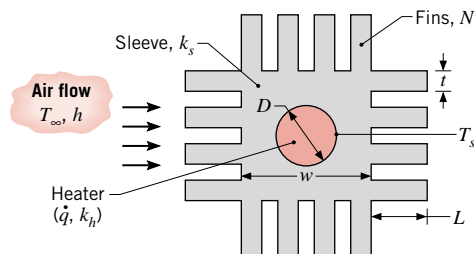


- Under conditions for which a uniform surface temperature  $T_s$  is maintained around the circumference of the heater and the temperature  $T_\infty$  and convection coefficient  $h$  of the air flow are known, obtain an expression for the rate of heat transfer per unit length to the air. Evaluate the heat rate for  $T_s = 300^\circ\text{C}$ ,  $D = 20\text{ mm}$ , an aluminum sleeve ( $k_s = 240\text{ W/m}\cdot\text{K}$ ),  $w = 40\text{ mm}$ ,  $N = 16$ ,  $t = 4\text{ mm}$ ,  $L = 20\text{ mm}$ ,  $T_\infty = 50^\circ\text{C}$ , and  $h = 500\text{ W/m}^2\cdot\text{K}$ .
- For the foregoing heat rate and a copper heater of thermal conductivity  $k_h = 400\text{ W/m}\cdot\text{K}$ , what is the required volumetric heat generation within the heater and its corresponding centerline temperature?
- With all other quantities unchanged, explore the effect of variations in the fin parameters ( $N$ ,  $L$ ,  $t$ ) on the heat rate, subject to the constraint that the fin thickness and the spacing between fins cannot be less than  $2\text{ mm}$ .

- 4.31** For a small heat source attached to a large substrate, the spreading resistance associated with multidimensional conduction in the substrate may be approximated by the expression (Yovanovich, M. M. and V. W. Antonetti, *Adv. Thermal Modeling Elec. Comp. and Systems*, Vol. 1, A. Bar-Cohen and A. D. Kraus, Eds., Hemisphere, NY, 79–128, 1988)

$$R_{t(sp)} = \frac{1 - 1.410 A_r + 0.344 A_r^3 + 0.043 A_r^5 + 0.034 A_r^7}{4k_{\text{sub}} A_{s,h}^{1/2}}$$

where  $A_r = A_{s,h}/A_{s,\text{sub}}$  is the ratio of the heat source area to the substrate area. Consider application of the expression to an in-line array of square chips of width  $L_h = 5\text{ mm}$  on a side and pitch  $S_h = 10\text{ mm}$ . The interface between the chips and a large substrate of thermal conductivity  $k_{\text{sub}} = 80\text{ W/m}\cdot\text{K}$  is characterized by a thermal contact resistance of  $R'_{t,c} = 0.5 \times 10^{-4}\text{ m}^2\cdot\text{K/W}$ .

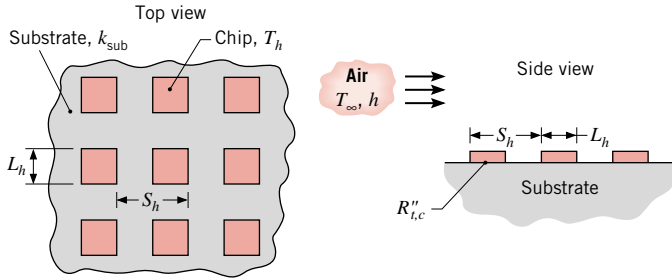

If a convection heat transfer coefficient of  $h = 100 \text{ W/m}^2\cdot\text{K}$  is associated with air flow ( $T_{\infty} = 15^\circ\text{C}$ ) over the chips and substrate, what is the maximum allowable chip power dissipation if the chip temperature is not to exceed  $T_h = 85^\circ\text{C}$ ?

### Finite-Difference Equations: Derivations

**4.32** Consider nodal configuration 2 of Table 4.2. Derive the finite-difference equations under steady-state conditions for the following situations.

- The horizontal boundary of the internal corner is perfectly insulated and the vertical boundary is subjected to the convection process ( $T_{\infty}$ ,  $h$ ).
- Both boundaries of the internal corner are perfectly insulated. How does this result compare with Equation 4.41?


**4.33** Consider nodal configuration 3 of Table 4.2. Derive the finite-difference equations under steady-state conditions for the following situations.

- The boundary is insulated. Explain how Equation 4.42 can be modified to agree with your result.
- The boundary is subjected to a constant heat flux.

**4.34** Consider nodal configuration 4 of Table 4.2. Derive the finite-difference equations under steady-state conditions for the following situations.

- The upper boundary of the external corner is perfectly insulated and the side boundary is subjected to the convection process ( $T_{\infty}$ ,  $h$ ).
- Both boundaries of the external corner are perfectly insulated. How does this result compare with Equation 4.43?


**4.35** One of the strengths of numerical methods is their ability to handle complex boundary conditions. In the sketch, the boundary condition changes from specified heat flux,  $q''_s$  (into the domain), to convection, at the location of the node  $m, n$ . Write the steady-state, two-dimensional finite difference equation at this node.




**4.36** Consider heat transfer in a one-dimensional (radial) cylindrical coordinate system under steady-state conditions with volumetric heat generation.

- Derive the finite-difference equation for any interior node  $m$ .
- Derive the finite-difference equation for the node  $n$  located at the external boundary subjected to the convection process ( $T_{\infty}$ ,  $h$ ).

**4.37** In a two-dimensional cylindrical configuration, the radial ( $\Delta r$ ) and angular ( $\Delta\phi$ ) spacings of the nodes are uniform. The boundary at  $r = r_i$  is of uniform temperature  $T_i$ . The boundaries in the radial direction are adiabatic (insulated) and exposed to surface convection ( $T_{\infty}$ ,  $h$ ), as illustrated. Derive the finite-difference equations for (a) node 2, (b) node 3, and (c) node 1.

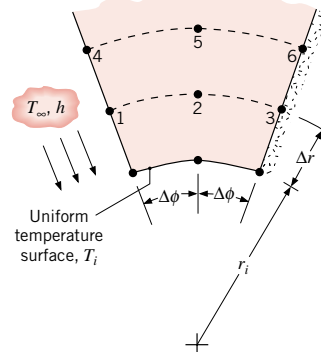


**4.38** Upper and lower surfaces of a bus bar are convectively cooled by air at  $T_{\infty}$ , with  $h_u \neq h_l$ . The sides are cooled by maintaining contact with heat sinks at  $T_o$ , through a thermal contact resistance of  $R''_{t,c}$ . The bar is of thermal conductivity  $k$ , and its width is twice its thickness  $L$ .

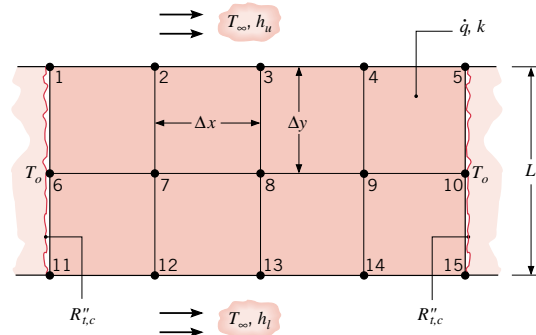


Consider steady-state conditions for which heat is uniformly generated at a volumetric rate  $\dot{q}$  due to passage of an electric current. Using the energy balance method, derive finite-difference equations for nodes 1 and 13.

**4.39** Derive the nodal finite-difference equations for the following configurations.


- (a) Node  $m, n$  on a diagonal boundary subjected to convection with a fluid at  $T_\infty$  and a heat transfer coefficient  $h$ . Assume  $\Delta x = \Delta y$ .

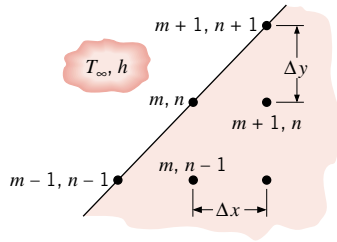

- (b) Node  $m, n$  at the tip of a cutting tool with the upper surface exposed to a constant heat flux  $q_o''$ , and the diagonal surface exposed to a convection cooling process with the fluid at  $T_\infty$  and a heat transfer coefficient  $h$ . Assume  $\Delta x = \Delta y$ .

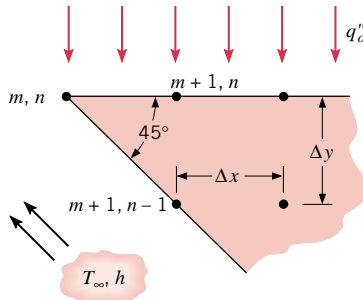


**4.40** Consider the nodal point 0 located on the boundary between materials of thermal conductivity  $k_A$  and  $k_B$ .

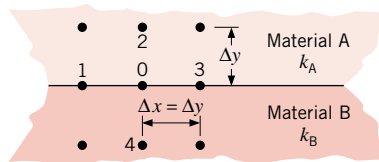

Derive the finite-difference equation, assuming no internal generation.

**4.41** Consider the two-dimensional grid ( $\Delta x = \Delta y$ ) representing steady-state conditions with no internal volumetric generation for a system with thermal conductivity  $k$ .

One of the boundaries is maintained at a constant temperature  $T_s$  while the others are adiabatic.

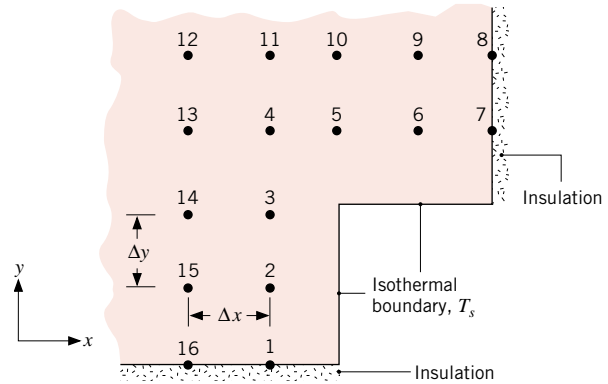


Derive an expression for the heat rate per unit length normal to the page crossing the isothermal boundary ( $T_s$ ).

**4.42** Consider a one-dimensional fin of uniform cross-sectional area, insulated at its tip,  $x = L$ . (See Table 3.4, case B). The temperature at the base of the fin  $T_b$  and of the adjoining fluid  $T_\infty$ , as well as the heat transfer coefficient  $h$  and the thermal conductivity  $k$ , are known.

- (a) Derive the finite-difference equation for any interior node  $m$ .  
(b) Derive the finite-difference equation for a node  $n$  located at the insulated tip.


### Finite-Difference Equations: Analysis

**4.43** Consider the network for a two-dimensional system without internal volumetric generation having nodal temperatures shown below. If the grid space is 125 mm and the thermal conductivity of the material is 50 W/m · K, calculate the heat rate per unit length normal to the page from the isothermal surface ( $T_s$ ).

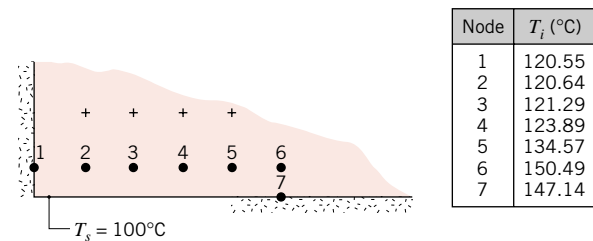


**4.44** Consider the square channel shown in the sketch operating under steady-state conditions. The inner surface of the channel is at a uniform temperature of 600 K, while the outer surface is exposed to convection with a fluid at 300 K and a convection coefficient of 50 W/m<sup>2</sup> · K. From a symmetrical element of the channel, a two-dimensional

grid has been constructed and the nodes labeled. The temperatures for nodes 1, 3, 6, 8, and 9 are identified.

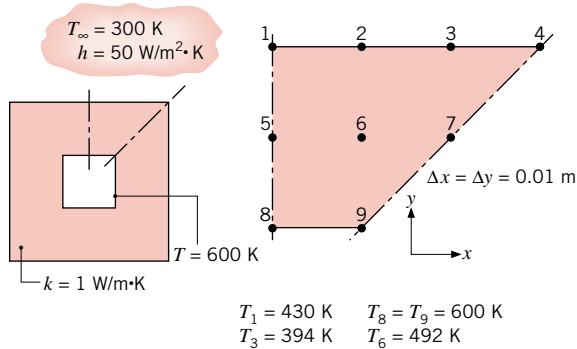

- Beginning with properly defined control volumes, derive the finite-difference equations for nodes 2, 4, and 7 and determine the temperatures  $T_2$ ,  $T_4$ , and  $T_7$  (K).
- Calculate the heat loss per unit length from the channel.


**4.45** Steady-state temperatures (K) at three nodal points of a long rectangular rod are as shown. The rod experiences a uniform volumetric generation rate of  $5 \times 10^7 \text{ W/m}^3$  and has a thermal conductivity of  $20 \text{ W/m} \cdot \text{K}$ . Two of its sides are maintained at a constant temperature of  $300 \text{ K}$ , while the others are insulated.

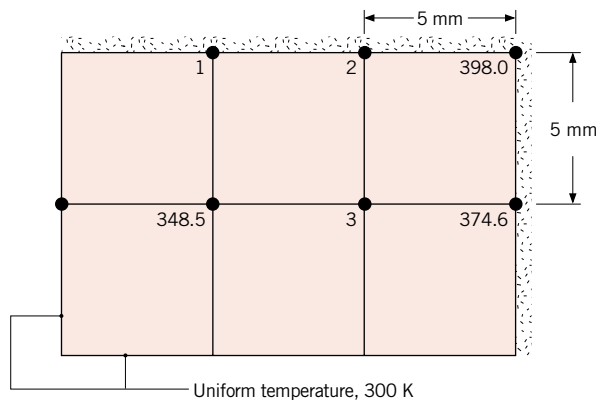

- Determine the temperatures at nodes 1, 2, and 3.
- Calculate the heat transfer rate per unit length (W/m) from the rod using the nodal temperatures. Compare this result with the heat rate calculated from knowledge of the volumetric generation rate and the rod dimensions.

**4.46** Steady-state temperatures at selected nodal points of the symmetrical section of a flow channel are known to be  $T_2 = 95.47^\circ\text{C}$ ,  $T_3 = 117.3^\circ\text{C}$ ,  $T_5 = 79.79^\circ\text{C}$ ,


$T_6 = 77.29^\circ\text{C}$ ,  $T_8 = 87.28^\circ\text{C}$ , and  $T_{10} = 77.65^\circ\text{C}$ . The wall experiences uniform volumetric heat generation of  $\dot{q} = 10^6 \text{ W/m}^3$  and has a thermal conductivity of  $k = 10 \text{ W/m} \cdot \text{K}$ . The inner and outer surfaces of the channel experience convection with fluid temperatures of  $T_{\infty,i} = 50^\circ\text{C}$  and  $T_{\infty,o} = 25^\circ\text{C}$  and convection coefficients of  $h_i = 500 \text{ W/m}^2 \cdot \text{K}$  and  $h_o = 250 \text{ W/m}^2 \cdot \text{K}$ .

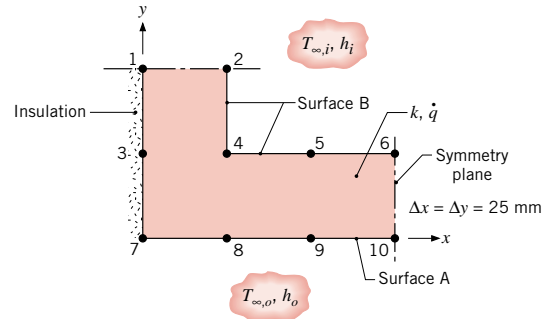


- Determine the temperatures at nodes 1, 4, 7, and 9.
- Calculate the heat rate per unit length (W/m) from the outer surface A to the adjacent fluid.
- Calculate the heat rate per unit length from the inner fluid to surface B.
- Verify that your results are consistent with an overall energy balance on the channel section.

**4.47** Consider an aluminum heat sink ( $k = 240 \text{ W/m} \cdot \text{K}$ ), such as that shown schematically in Problem 4.28. The inner and outer widths of the square channel are  $w = 20 \text{ mm}$  and  $W = 40 \text{ mm}$ , respectively, and an outer surface temperature of  $T_s = 50^\circ\text{C}$  is maintained by the array of electronic chips. In this case, it is not the inner surface temperature that is known, but conditions  $(T_{\infty}, h)$  associated with coolant flow through the channel, and we wish to determine the rate of heat transfer to the coolant per unit length of channel. For this purpose, consider a symmetrical section of the channel and a two-dimensional grid with  $\Delta x = \Delta y = 5 \text{ mm}$ .

- For  $T_{\infty} = 20^\circ\text{C}$  and  $h = 5000 \text{ W/m}^2 \cdot \text{K}$ , determine the unknown temperatures,  $T_1, \dots, T_7$ , and the rate of heat transfer per unit length of channel,  $q'$ .
- Assess the effect of variations in  $h$  on the unknown temperatures and the heat rate.

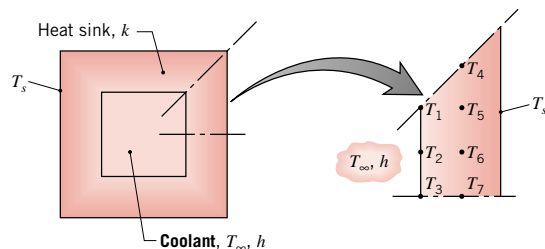


- 4.48** The steady-state temperatures ( $^{\circ}\text{C}$ ) associated with selected nodal points of a two-dimensional system having a thermal conductivity of  $1.5 \text{ W/m} \cdot \text{K}$  are shown on the accompanying grid.

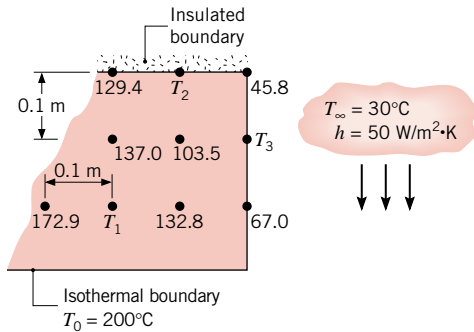

- Determine the temperatures at nodes 1, 2, and 3.
- Calculate the heat transfer rate per unit thickness normal to the page from the system to the fluid.


- 4.49** A steady-state, finite-difference analysis has been performed on a cylindrical fin with a diameter of 12 mm and a thermal conductivity of  $15 \text{ W/m} \cdot \text{K}$ . The convection process is characterized by a fluid temperature of  $25^{\circ}\text{C}$  and a heat transfer coefficient of  $25 \text{ W/m}^2 \cdot \text{K}$ .

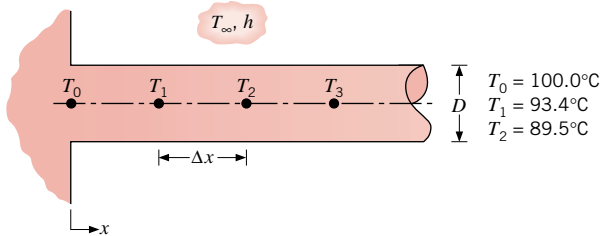

- The temperatures for the first three nodes, separated by a spatial increment of  $x = 10 \text{ mm}$ , are given in the sketch. Determine the fin heat rate.
- Determine the temperature at node 3,  $T_3$ .


### Solving the Finite-Difference Equations

- 4.50** A long bar of rectangular cross section is 60 mm by 90 mm on a side and has a thermal conductivity of  $1 \text{ W/m} \cdot \text{K}$ . One surface is exposed to a convection process with air at  $100^{\circ}\text{C}$  and a convection coefficient of  $100 \text{ W/m}^2 \cdot \text{K}$ , while the remaining surfaces are maintained at  $50^{\circ}\text{C}$ .

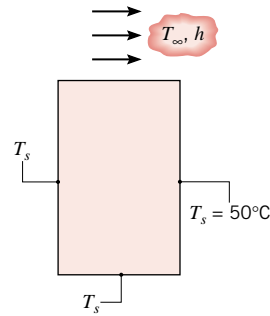

- Using a grid spacing of 30 mm and the Gauss-Seidel iteration method, determine the nodal temperatures and the heat rate per unit length normal to the page into the bar from the air.
- Determine the effect of grid spacing on the temperature field and heat rate. Specifically, consider a grid spacing of 15 mm. For this grid, explore the effect of changes in  $h$  on the temperature field and the isotherms.

- 4.51** Consider two-dimensional, steady-state conduction in a square cross section with prescribed surface temperatures.

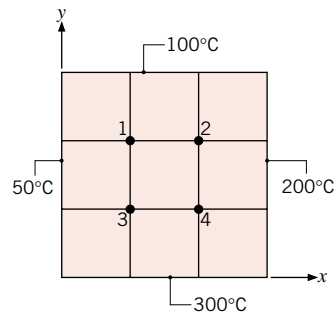

- Determine the temperatures at nodes 1, 2, 3, and 4. Estimate the midpoint temperature.
- Reducing the mesh size by a factor of 2, determine the corresponding nodal temperatures. Compare your results with those from the coarser grid.
- From the results for the finer grid, plot the 75, 150, and  $250^{\circ}\text{C}$  isotherms.

- 4.52** Consider a long bar of square cross section (0.8 m to the side) and of thermal conductivity  $2 \text{ W/m} \cdot \text{K}$ . Three of these sides are maintained at a uniform temperature of  $300^{\circ}\text{C}$ . The fourth side is exposed to a fluid at  $100^{\circ}\text{C}$  for which the convection heat transfer coefficient is  $10 \text{ W/m}^2 \cdot \text{K}$ .

- (a) Using an appropriate numerical technique with a grid spacing of 0.2 m, determine the midpoint temperature and heat transfer rate between the bar and the fluid per unit length of the bar.

- (b) Reducing the grid spacing by a factor of 2, determine the midpoint temperature and heat transfer rate. Plot the corresponding temperature distribution across the surface exposed to the fluid. Also, plot the 200 and 250°C isotherms.

**4.53** A long conducting rod of rectangular cross section (20 mm × 30 mm) and thermal conductivity  $k = 20 \text{ W/m} \cdot \text{K}$  experiences uniform heat generation at a rate  $\dot{q} = 5 \times 10^7 \text{ W/m}^3$ , while its surfaces are maintained at 300 K.

- (a) Using a finite-difference method with a grid spacing of 5 mm, determine the temperature distribution in the rod.
- (b) With the boundary conditions unchanged, what heat generation rate will cause the midpoint temperature to reach 600 K?


**4.54** A flue passing hot exhaust gases has a square cross section, 300 mm to a side. The walls are constructed of refractory brick 150 mm thick with a thermal conductivity of  $0.85 \text{ W/m} \cdot \text{K}$ . Calculate the heat loss from the flue per unit length when the interior and exterior surfaces are maintained at 350 and 25°C, respectively. Use a grid spacing of 75 mm.

**4.55** Consider the system of Problem 4.54. The interior surface is exposed to hot gases at 350°C with a convection coefficient of  $100 \text{ W/m}^2 \cdot \text{K}$ , while the exterior surface experiences convection with air at 25°C and a convection coefficient of  $5 \text{ W/m}^2 \cdot \text{K}$ .

- (a) Using a grid spacing of 75 mm, calculate the temperature field within the system and determine the heat loss per unit length by convection from the outer surface of the flue to the air. Compare this result with the heat gained by convection from the hot gases to the air.
- (b) Determine the effect of grid spacing on the temperature field and heat loss per unit length to the air. Specifically, consider a grid spacing of 25 mm and plot appropriately spaced isotherms on a schematic of the system. Explore the effect of changes in the convection coefficients on the temperature field, and heat loss.

**4.56** A common arrangement for heating a large surface area is to move warm air through rectangular ducts


below the surface. The ducts are square and located midway between the top and bottom surfaces that are exposed to room air and insulated, respectively.

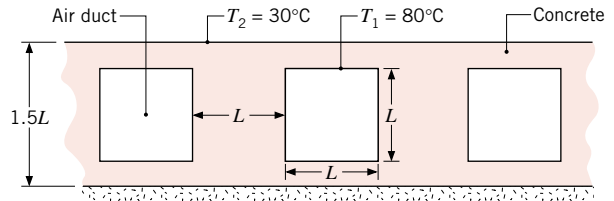

For the condition when the floor and duct temperatures are 30 and 80°C, respectively, and the thermal conductivity of concrete is  $1.4 \text{ W/m} \cdot \text{K}$ , calculate the heat rate from each duct, per unit length of duct. Use a grid spacing with  $\Delta x = 2 \Delta y$ , where  $\Delta y = 0.125L$  and  $L = 150 \text{ mm}$ .


**4.57** Consider the gas turbine cooling scheme of Example 4.4. In Problem 3.23, advantages associated with applying a *thermal barrier coating* (TBC) to the exterior surface of a turbine blade are described. If a 0.5-mm-thick zirconia coating ( $k = 1.3 \text{ W/m} \cdot \text{K}$ ,  $R''_{t,c} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ ) is applied to the outer surface of the air-cooled blade, determine the temperature field in the blade for the operating conditions of Example 4.4.

**4.58** A long bar of rectangular cross section,  $0.4 \text{ m} \times 0.6 \text{ m}$  on a side and having a thermal conductivity of  $1.5 \text{ W/m} \cdot \text{K}$ , is subjected to the boundary conditions shown below. Two of the sides are maintained at a uniform temperature of 200°C. One of the sides is adiabatic, and the remaining side is subjected to a convection process with  $T_\infty = 30^\circ\text{C}$  and  $h = 50 \text{ W/m}^2 \cdot \text{K}$ . Using an appropriate numerical technique with a grid spacing of 0.1 m, determine the temperature distribution in the bar and the heat transfer rate between the bar and the fluid per unit length of the bar.

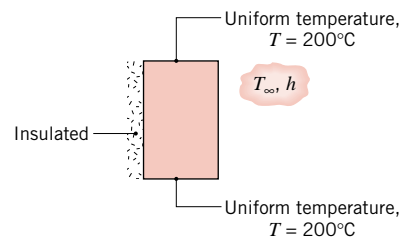

**4.59** The top surface of a plate, including its grooves, is maintained at a uniform temperature of  $T_1 = 200^\circ\text{C}$ . The lower surface is at  $T_2 = 20^\circ\text{C}$ , the thermal conductivity is  $15 \text{ W/m} \cdot \text{K}$ , and the groove spacing is 0.16 m.




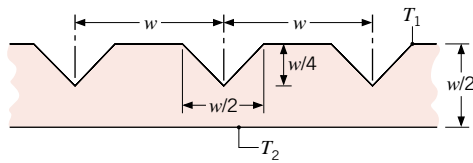


- (a) Using a finite-difference method with a mesh size of  $\Delta x = \Delta y = 40$  mm, calculate the unknown nodal temperatures and the heat transfer rate per width of groove spacing ( $w$ ) and per unit length normal to the page.
- (b) With a mesh size of  $\Delta x = \Delta y = 10$  mm, repeat the foregoing calculations, determining the temperature field and the heat rate. Also, consider conditions for which the bottom surface is not at a uniform temperature  $T_2$  but is exposed to a fluid at  $T_\infty = 20^\circ\text{C}$ . With  $\Delta x = \Delta y = 10$  mm, determine the temperature field and heat rate for values of  $h = 5, 200$ , and  $1000$   $\text{W/m}^2\cdot\text{K}$ , as well as for  $h \rightarrow \infty$ .

**4.60** Refer to the two-dimensional rectangular plate of Problem 4.2. Using an appropriate numerical method with  $\Delta x = \Delta y = 0.25$  m, determine the temperature at the midpoint (1, 0.5).

**4.61** A long trapezoidal bar is subjected to uniform temperatures on two surfaces, while the remaining surfaces are well insulated. If the thermal conductivity of the material is  $20 \text{ W/m}\cdot\text{K}$ , estimate the heat transfer rate per unit length of the bar using a finite-difference method. Use the Gauss-Seidel method of solution with a space increment of 10 mm.

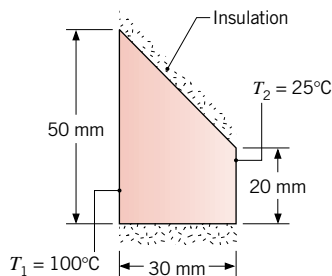


**4.62** The shape factor for conduction through the edge of adjoining walls for which  $D > L/5$ , where  $D$  and  $L$  are the wall depth and thickness, respectively, is shown in Table 4.1. The two-dimensional symmetrical element of the edge, which is represented by inset (a), is bounded by the diagonal symmetry adiabat and a section of the wall thickness over which the temperature distribution is assumed to be linear between  $T_1$  and  $T_2$ .

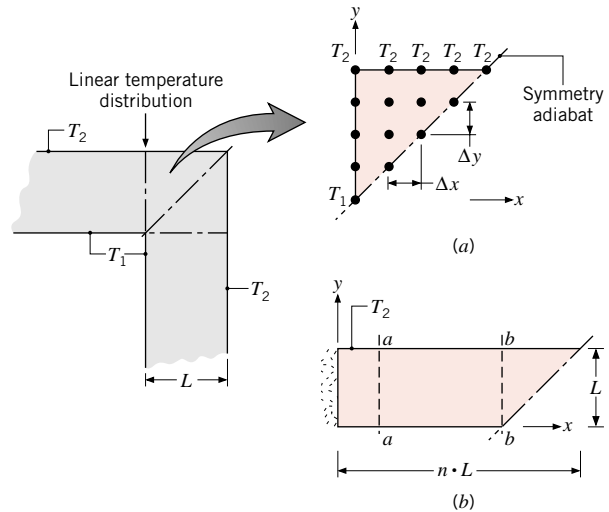

- (a) Using the nodal network of inset (a) with  $L = 40$  mm, determine the temperature distribution in the element for  $T_1 = 100^\circ\text{C}$  and  $T_2 = 0^\circ\text{C}$ . Evaluate the heat rate per unit depth ( $D = 1$  m) if  $k = 1 \text{ W/m}\cdot\text{K}$ . Determine the corresponding shape factor for the edge and compare your result with that from Table 4.1.
- (b) Choosing a value of  $n = 1$  or  $n = 1.5$ , establish a nodal network for the trapezoid of inset (b) and determine the corresponding temperature field. Assess the validity of assuming linear temperature distributions across sections  $a-a$  and  $b-b$ .

**4.63** The diagonal of a long triangular bar is well insulated, while sides of equivalent length are maintained at uniform temperatures  $T_a$  and  $T_b$ .

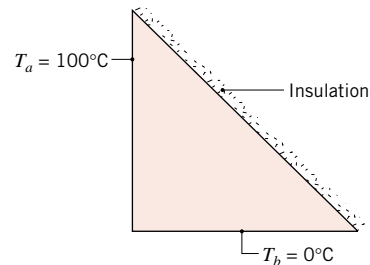


- (a) Establish a nodal network consisting of five nodes along each of the sides. For one of the nodes on the diagonal surface, define a suitable control volume and derive the corresponding finite-difference equation. Using this form for the diagonal nodes and appropriate equations for the interior nodes, find the temperature distribution for the bar. On a scale drawing of the shape, show the 25, 50, and 75°C isotherms.

- (b) An alternate and simpler procedure to obtain the finite-difference equations for the diagonal nodes follows from recognizing that the insulated diagonal surface is a symmetry plane. Consider a square  $5 \times 5$  nodal network and represent its diagonal as a symmetry line. Recognize which nodes on either side of the diagonal have identical temperatures. Show that you can treat the diagonal nodes as “interior” nodes and write the finite-difference equations by inspection.

### Finite-Element Solutions

- 4.64** A straight fin of uniform cross section is fabricated from a material of thermal conductivity  $k = 5 \text{ W/m} \cdot \text{K}$ , thickness  $w = 20 \text{ mm}$ , and length  $L = 200 \text{ mm}$ . The fin is very long in the direction normal to the page. The base of the fin is maintained at  $T_b = 200^\circ\text{C}$ , and the tip condition allows for convection (case A of Table 3.4), with  $h = 500 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 25^\circ\text{C}$ .

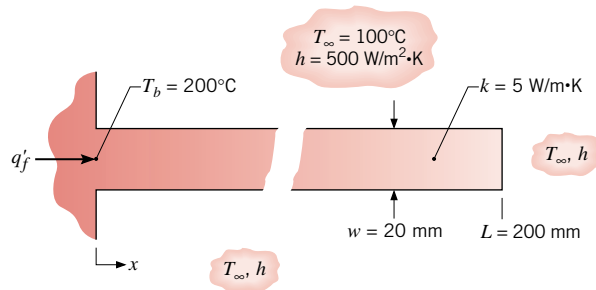

- (a) Assuming one-dimensional heat transfer in the fin, calculate the fin heat rate,  $q'_f$  (W/m), and the tip temperature  $T_L$ . Calculate the Biot number for the fin to determine whether the one-dimensional assumption is valid.
- (b) Using the finite-element method of *FEHT*, perform a two-dimensional analysis on the fin to determine the fin heat rate and tip temperature. Compare your results with those from the one-dimensional, analytical solution of part (a). Use the *View/Temperature Contours* option to display isotherms, and discuss key features of the corresponding temperature field and heat flow pattern. *Hint:* In drawing the outline of the fin, take advantage of symmetry. Use a fine mesh near the base and a coarser mesh near the tip. Why?
- (c) Validate your *FEHT* model by comparing predictions with the analytical solution for a fin with thermal conductivities of  $k = 50 \text{ W/m} \cdot \text{K}$  and  $500 \text{ W/m} \cdot \text{K}$ . Is the one-dimensional heat transfer assumption valid for these conditions?

- 4.65** Consider the long rectangular bar of Problem 4.50 with the prescribed boundary conditions.

- (a) Using the finite-element method of *FEHT*, determine the temperature distribution. Use the *View/Temperature Contours* command to represent the isotherms. Identify significant features of the distribution.
- (b) Using the *View/Heat Flows* command, calculate the heat rate per unit length (W/m) from the bar to the air stream.
- (c) Explore the effect on the heat rate of increasing the convection coefficient by factors of two and three. Explain why the change in the heat rate is not proportional to the change in the convection coefficient.

- 4.66** Consider the long rectangular rod of Problem 4.53, which experiences uniform heat generation while its surfaces are maintained at a fixed temperature.

- (a) Using the finite-element method of *FEHT*, determine the temperature distribution. Use the *View/Temperature Contours* command to represent the isotherms. Identify significant features of the distribution.
- (b) With the boundary conditions unchanged, what heat generation rate will cause the midpoint temperature to reach  $600 \text{ K}$ ?


- 4.67** Consider the symmetrical section of the flow channel of Problem 4.46, with the prescribed values of  $\dot{q}$ ,  $k$ ,  $T_{\infty,i}$ ,  $T_{\infty,o}$ ,  $h_i$  and  $h_o$ . Use the finite-element method of *FEHT* to obtain the following results.

- (a) Determine the temperature distribution in the symmetrical section, and use the *View/Temperature Contours* command to represent the isotherms. Identify significant features of the temperature distribution, including the hottest and coolest regions and the region with the steepest gradients. Describe the heat flow field.
- (b) Using the *View/Heat Flows* command, calculate the heat rate per unit length (W/m) from the outer surface A to the adjacent fluid.
- (c) Calculate the heat rate per unit length from the inner fluid to surface B.
- (d) Verify that your results are consistent with an overall energy balance on the channel section.

- 4.68** The hot-film heat flux gage shown schematically may be used to determine the convection coefficient of an adjoining fluid stream by measuring the electric power dissipation per unit area,  $P''_e$  (W/m<sup>2</sup>), and the average surface temperature,  $T_{s,f}$  of the film. The power dissipated in the film is transferred



directly to the fluid by convection, as well as by conduction into the substrate. If substrate conduction is negligible, the gage measurements can be used to determine the convection coefficient without application of a correction factor. Your assignment is to perform a two-dimensional, steady-state conduction analysis to estimate the fraction of the power dissipation that is conducted into a 2-mm-thick quartz substrate of width  $W = 40$  mm and thermal conductivity  $k = 1.4$  W/m·K. The thin, hot-film gage has a width of  $w = 4$  mm and operates at a uniform power dissipation of  $5000$  W/m<sup>2</sup>. Consider cases for which the fluid temperature is  $25^\circ\text{C}$  and the convection coefficient is  $500$ ,  $1000$ , and  $2000$  W/m<sup>2</sup>·K.

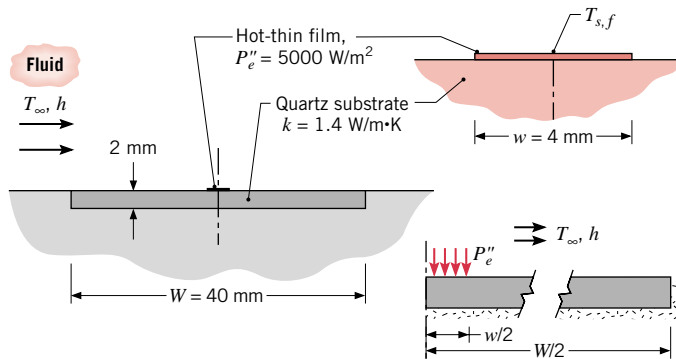


Use the finite-element method of *FEHT* to analyze a symmetrical half-section of the gage and the quartz substrate. Assume that the lower and end surfaces of the substrate are perfectly insulated, while the upper surface experiences convection with the fluid.

- Determine the temperature distribution and the conduction heat rate into the region below the hot film for the three values of  $h$ . Calculate the fractions of electric power dissipation represented by these rates. *Hint:* Use the *View/Heat Flow* command to find the heat rate across the boundary elements.
- Use the *View/Temperature Contours* command to view the isotherms and heat flow patterns. Describe the heat flow paths, and comment on features of the gage design that influence the paths. What limitations on applicability of the gage have been revealed by your analysis?

**4.69** A semiconductor industry roadmap for microlithography processing requires that a 300-mm-diameter silicon wafer be maintained at a steady-state temperature of  $140^\circ\text{C}$  to within a uniformity of  $0.1^\circ\text{C}$ . The design of a hot-plate tool to hopefully meet this requirement is shown schematically. An *equalizing block* (EB), on which the wafer would be placed, is fabricated from an aluminum alloy of thermal

conductivity  $k = 75$  W/m·K and is heated by two ring-shaped electrical heaters. The two-zone heating arrangement allows for independent control of a main heater (MH) and a trim heater (TH), which is used to improve the uniformity of the surface temperature for the EB. Your assignment is to size the heaters, MH and TH, by specifying their applied heat fluxes,  $q''_{mh}$  and  $q''_{th}$  (W/m<sup>2</sup>), and their radial extents,  $\Delta r_{mh}$  and  $\Delta r_{th}$ . The constraints on radial positioning of the heaters are imposed by manufacturing considerations and are shown in the schematic.

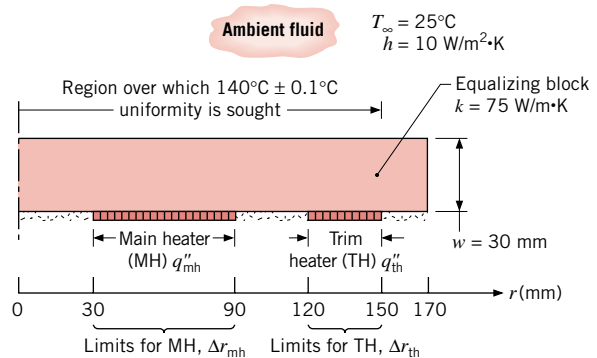


Use the finite-element method of *FEHT* to perform a conduction analysis on an axisymmetric EB of 340-mm diameter. The upper and lateral surfaces are exposed to the ambient fluid at  $T_\infty = 25^\circ\text{C}$  with a convection coefficient of  $10$  W/m<sup>2</sup>·K. The lower surface of the EB is adiabatic, except for the ring sectors with the uniform applied heat fluxes,  $q''_{mh}$  and  $q''_{th}$ .

- For an upper surface of  $140^\circ\text{C}$ , perform an overall energy balance on the EB to obtain an initial estimate for the applied heater fluxes. Assume that  $q''_{mh} = q''_{th}$  and that each heater extends fully over the radial limits indicated schematically. Use this estimate as a boundary condition in your *FEHT* model; determine the temperature distribution; and using the *View/Temperature Contours* command, examine the isotherms and the temperature distribution across the upper surface of the EB. Did you achieve the desired uniformity?
- Rerun your *FEHT* model with different values of the heater fluxes, until you obtain the best uniformity possible within the imposed constraints. *Hint:* If you want to know the specific nodal temperatures, see the *View/Tabular Output* page. You may obtain a plot of the surface temperature distribution by highlighting the appropriate nodal data, using the *Copy* command, and pasting the data into *Excel* for graphing.

- (c) In what manner would a nonuniform distribution of the convection coefficient across the upper surface of the EB affect the temperature uniformity? For the downward flowing gas stream used in the microlithography process, a representative distribution of the convection coefficient on the upper surface of the EB is  $h(r) = h_o[1 + a(r/r_o)^n]$ , where  $h_o = 5.4 \text{ W/m}^2 \cdot \text{K}$  and  $a = n = 1.5$ . For this distribution and retention of a value of  $h = 10 \text{ W/m}^2 \cdot \text{K}$  at the lateral surface of the EB, can you adjust the trim heater flux to obtain improved uniformity of the surface temperature?
- (d) What changes to the design would you propose for improving the surface temperature uniformity?

### Special Applications


- 4.70** A straight fin of uniform cross section is fabricated from a material of thermal conductivity  $50 \text{ W/m} \cdot \text{K}$ , thickness  $w = 6 \text{ mm}$ , and length  $L = 48 \text{ mm}$ , and is very long in the direction normal to the page. The convection heat transfer coefficient is  $500 \text{ W/m}^2 \cdot \text{K}$  with an ambient air temperature of  $T_\infty = 30^\circ\text{C}$ . The base of the fin is maintained at  $T_b = 100^\circ\text{C}$ , while the fin tip is well insulated.

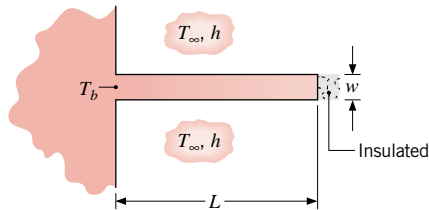

- (a) Using a finite-difference method with a space increment of  $4 \text{ mm}$ , estimate the temperature distribution within the fin. Is the assumption of one-dimensional heat transfer reasonable for this fin?
- (b) Estimate the fin heat transfer rate per unit length normal to the page. Compare your result with the one-dimensional, analytical solution, Equation 3.76.
- (c) Using the finite-difference mesh of part (a), compute and plot the fin temperature distribution for values of  $h = 10, 100, 500$ , and  $1000 \text{ W/m}^2 \cdot \text{K}$ . Determine and plot the fin heat transfer rate as a function of  $h$ .


- 4.71** A rod of  $10\text{-mm}$  diameter and  $250\text{-mm}$  length has one end maintained at  $100^\circ\text{C}$ . The surface of the rod experiences free convection with the ambient air at  $25^\circ\text{C}$  and a convection coefficient that depends on the difference between the temperature of the surface and the ambient air. Specifically, the coefficient is prescribed by a correlation of the form,  $h_{fc} = 2.89[0.6 + 0.624(T - T_\infty)^{1/4}]^2$ , where the units are  $h_{fc} (\text{W/m}^2 \cdot \text{K})$

and  $T (\text{K})$ . The surface of the rod has an emissivity  $\varepsilon = 0.2$  and experiences radiation exchange with the surroundings at  $T_{\text{sur}} = 25^\circ\text{C}$ . The fin tip also experiences free convection and radiation exchange.

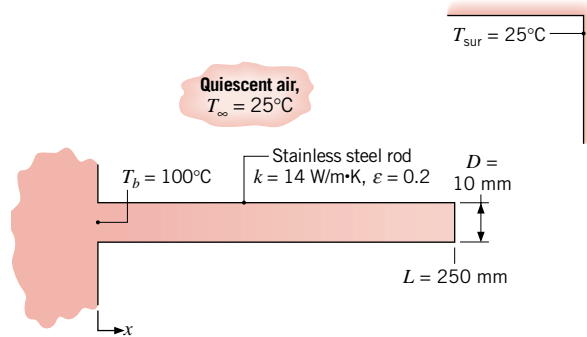


Assuming one-dimensional conduction and using a finite-difference method representing the fin by five nodes, estimate the temperature distribution for the fin. Determine also the fin heat rate and the relative contributions of free convection and radiation exchange. *Hint:* For each node requiring an energy balance, use the linearized form of the radiation rate equation, Equation 1.8, with the radiation coefficient  $h_r$ , Equation 1.9, evaluated for each node. Similarly, for the convection rate equation associated with each node, the free convection coefficient  $h_{fc}$  must be evaluated for each node.

- 4.72** A thin metallic foil of thickness  $0.25 \text{ mm}$  with a pattern of extremely small holes serves as an acceleration grid to control the electrical potential of an ion beam. Such a grid is used in a chemical vapor deposition (CVD) process for the fabrication of semiconductors. The top surface of the grid is exposed to a uniform heat flux caused by absorption of the ion beam,  $q_s'' = 600 \text{ W/m}^2$ . The edges of the foil are thermally coupled to water-cooled sinks maintained at  $300 \text{ K}$ . The upper and lower surfaces of the foil experience radiation exchange with the vacuum enclosure walls maintained at  $300 \text{ K}$ . The effective thermal conductivity of the foil material is  $40 \text{ W/m} \cdot \text{K}$  and its emissivity is  $0.45$ .

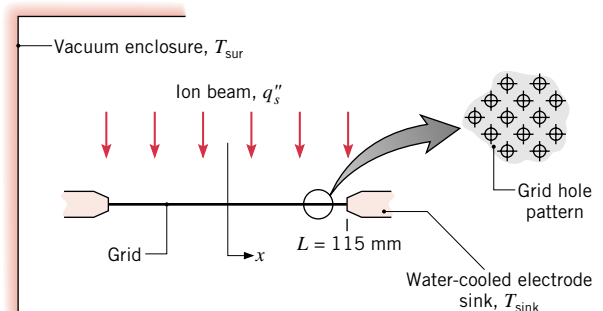

Assuming one-dimensional conduction and using a finite-difference method representing the grid by ten nodes in the  $x$  direction, estimate the temperature distribution for the grid. *Hint:* For each node requiring an energy balance, use the linearized form of the radiation rate equation, Equation 1.8, with the radiation coefficient  $h_r$ , Equation 1.9, evaluated for each node.


- 4.73** Small diameter electrical heating elements dissipating 50 W/m (length normal to the sketch) are used to heat a ceramic plate of thermal conductivity 2 W/m·K. The upper surface of the plate is exposed to ambient air at 30°C with a convection coefficient of 100 W/m<sup>2</sup>·K, while the lower surface is well insulated.

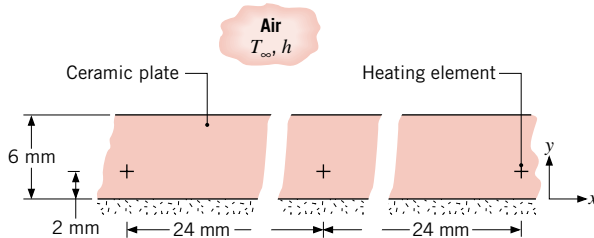

- Using the Gauss–Seidel method with a grid spacing of  $\Delta x = 6$  mm and  $\Delta y = 2$  mm, obtain the temperature distribution within the plate.
- Using the calculated nodal temperatures, sketch four isotherms to illustrate the temperature distribution in the plate.
- Calculate the heat loss by convection from the plate to the fluid. Compare this value with the element dissipation rate.
- What advantage, if any, is there in not making  $\Delta x = \Delta y$  for this situation?
- With  $\Delta x = \Delta y = 2$  mm, calculate the temperature field within the plate and the rate of heat transfer from the plate. Under no circumstances may the temperature at any location in the plate exceed 400°C. Would this limit be exceeded if the air flow were terminated and heat transfer to the air was by natural convection with  $h = 10$  W/m<sup>2</sup>·K?


- 4.74** A simplified representation for cooling in very large-scale integration (VLSI) of microelectronics is shown in the sketch. A silicon chip is mounted in a dielectric substrate, and one surface of the system is convectively cooled, while the remaining surfaces are well insulated from the surroundings. The problem is rendered two-dimensional by assuming the system to be very long in the direction perpendicular to the paper. Under steady-state operation, electric power dissipation in the chip provides for uniform volumetric heating at a rate of  $\dot{q}$ .

However, the heating rate is limited by restrictions on the maximum temperature that the chip is allowed to assume.

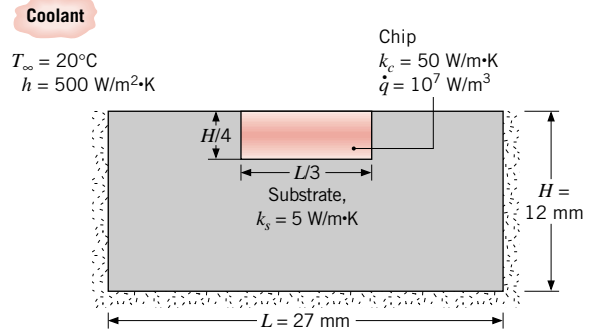


For the conditions shown on the sketch, will the maximum temperature in the chip exceed 85°C, the maximum allowable operating temperature set by industry standards? A grid spacing of 3 mm is suggested.

- 4.75** Electronic devices dissipating electrical power can be cooled by conduction to a heat sink. The lower surface of the sink is cooled, and the spacing of the devices  $w_s$ , the width of the device  $w_d$ , and the thickness  $L$  and thermal conductivity  $k$  of the heat sink material each affect the thermal resistance between the device and the cooled surface. The function of the heat sink is to *spread* the heat dissipated in the device throughout the sink material.

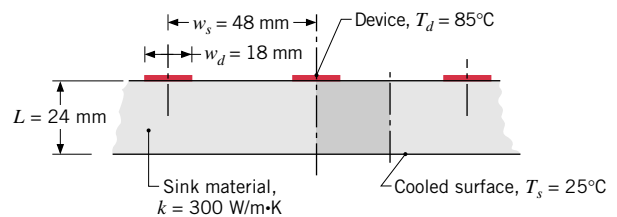


- Beginning with the shaded symmetrical element, use a coarse ( $5 \times 5$ ) nodal network to estimate the thermal resistance per unit depth between the device and lower surface of the sink,  $R'_{td-s}$  (m·K/W). How does this value compare with thermal resistances based on the assumption of one-dimensional conduction in rectangular domains of (i) width  $w_d$  and length  $L$  and (ii) width  $w_s$  and length  $L$ ?
- Using nodal networks with grid spacings three and five times smaller than that in part (a), determine the effect of grid size on the precision of the thermal resistance calculation.
- Using the finer nodal network developed for part (b), determine the effect of device width on the

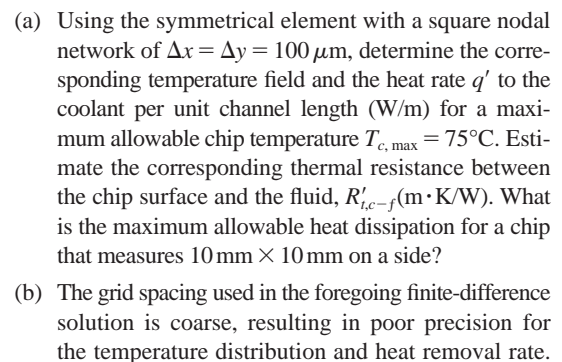

Investigate the effect of grid spacing by considering spatial increments of 50 and 25  $\mu\text{m}$ .

- (c) Consistent with the requirement that  $a + b = 400 \mu\text{m}$ , can the heat sink dimensions be altered in a manner that reduces the overall thermal resistance?


**4.78** A plate ( $k = 10 \text{ W/m} \cdot \text{K}$ ) is stiffened by a series of longitudinal ribs having a rectangular cross section with length  $L = 8 \text{ mm}$  and width  $w = 4 \text{ mm}$ . The base of the plate is maintained at a uniform temperature  $T_b = 45^\circ\text{C}$ , while the rib surfaces are exposed to air at a temperature of  $T_\infty = 25^\circ\text{C}$  and a convection coefficient of  $h = 600 \text{ W/m}^2 \cdot \text{K}$ .

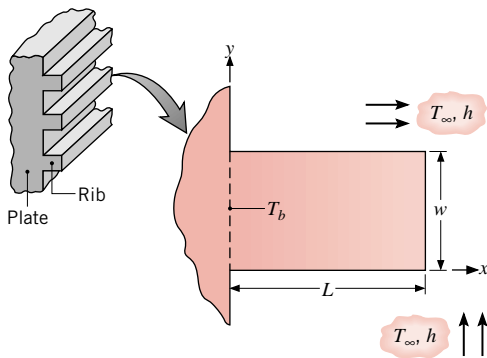

- (a) Using a finite-difference method with  $\Delta x = \Delta y = 2 \text{ mm}$  and a total of  $5 \times 3$  nodal points and regions, estimate the temperature distribution and the heat rate from the base. Compare these results with those obtained by assuming that heat transfer in the rib is one-dimensional, thereby approximating the behavior of a fin.
- (b) The grid spacing used in the foregoing finite-difference solution is coarse, resulting in poor precision for estimates of temperatures and the heat rate. Investigate the effect of grid refinement by reducing the nodal spacing to  $\Delta x = \Delta y = 1 \text{ mm}$  (a  $9 \times 3$  grid) considering symmetry of the center line.
- (c) Investigate the nature of two-dimensional conduction in the rib and determine a criterion for which the one-dimensional approximation is reasonable. Do so by extending your finite-difference analysis to determine the heat rate from the base as a function of the length of the rib for the range  $1.5 \leq L/w \leq 10$ , keeping the length  $L$  constant. Compare your results with those determined by approximating the rib as a fin.


**4.79** The bottom half of an I-beam providing support for a furnace roof extends into the heating zone. The web is well insulated, while the flange surfaces experience convection with hot gases at  $T_\infty = 400^\circ\text{C}$  and a convection

coefficient of  $h = 150 \text{ W/m}^2 \cdot \text{K}$ . Consider the symmetrical element of the flange region (inset *a*), assuming that the temperature distribution across the web is uniform at  $T_w = 100^\circ\text{C}$ . The beam thermal conductivity is  $10 \text{ W/m} \cdot \text{K}$ , and its dimensions are  $w_f = 80 \text{ mm}$ ,  $w_w = 30 \text{ mm}$ , and  $L = 30 \text{ mm}$ .

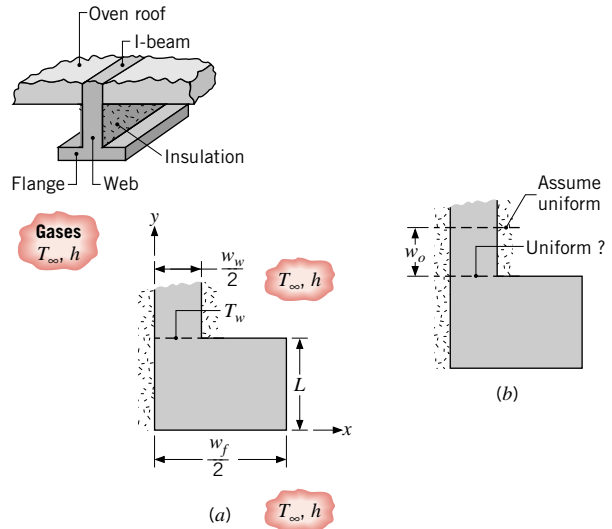


- (a) Calculate the heat transfer rate per unit length to the beam using a  $5 \times 4$  nodal network.
- (b) Is it reasonable to assume that the temperature distribution across the web-flange interface is uniform? Consider the L-shaped domain of inset (*b*) and use a fine grid to obtain the temperature distribution across the web-flange interface. Make the distance  $w_o \geq w_w/2$ .

**4.80** Consider one-dimensional conduction in a plane composite wall. The exposed surfaces of materials A and B are maintained at  $T_1 = 600 \text{ K}$  and  $T_2 = 300 \text{ K}$  respectively. Material A, of thickness  $L_a = 20 \text{ mm}$ , has a temperature-dependent thermal conductivity of  $k_a = k_o [1 + \alpha(T - T_o)]$ , where  $k_o = 4.4 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 0.008 \text{ K}^{-1}$ ,  $T_o = 300 \text{ K}$  and  $T$  is in kelvins. Material B is of thickness  $L_b = 5 \text{ mm}$  and has a thermal conductivity of  $k_b = 1 \text{ W/m} \cdot \text{K}$ .

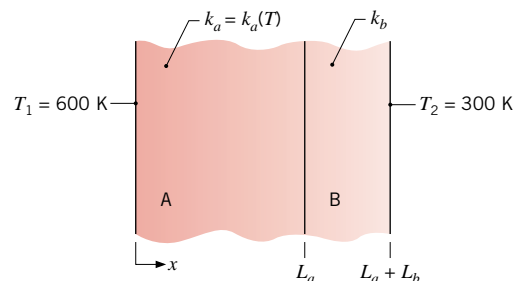

- Calculate the heat flux through the composite wall by assuming material A to have a uniform thermal conductivity evaluated at the average temperature of the section.
- Using a space increment of 1 mm, obtain the finite-difference equations for the internal nodes and calculate the heat flux considering the temperature-dependent thermal conductivity for Material A. If the *IHT* software is employed, call-up functions from *Tools/Finite-Difference Equations* may be used to obtain the nodal equations. Compare your result with that obtained in part (a).
- As an alternative to the finite-difference method of part (b), use the finite-element method of *FEHT* to calculate the heat flux, and compare the result with that from part (a). *Hint:* In the *Specify/Material Properties* box, properties may be entered as a function of temperature ( $T$ ), the space coordinates ( $x, y$ ), or time ( $t$ ). See the *Help* section for more details.

**4.81** A platen of thermal conductivity  $k = 15 \text{ W/m} \cdot \text{K}$  is heated by flow of a hot fluid through channels of width  $L = 20 \text{ mm}$ , with  $T_{\infty,i} = 200^\circ\text{C}$  and  $h_i = 500 \text{ W/m}^2 \cdot \text{K}$ . The upper surface of the platen is used to heat a process fluid at  $T_{\infty,o} = 25^\circ\text{C}$  with a convection coefficient of  $h_o = 250 \text{ W/m}^2 \cdot \text{K}$ . The lower surface of the platen is insulated. To heat the process fluid uniformly, the temperature of the platen's upper surface must be uniform to within  $5^\circ\text{C}$ . Use a finite-difference method, such as that of *IHT*, or the finite-element method of *FEHT* to obtain the following results.

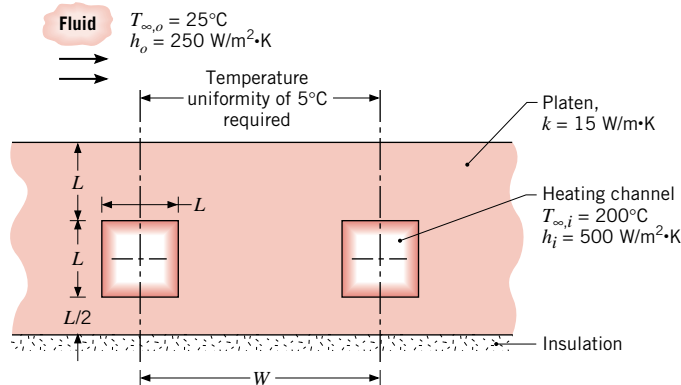

- Determine the maximum allowable spacing,  $W$ , between the channel centerlines that will satisfy the specified temperature uniformity requirement.
- What is the corresponding heat rate per unit length from a flow channel?

**4.82** Consider the cooling arrangement for the very large-scale integration (VLSI) chip of Problem 4.75. Use the finite-element method of *FEHT* to obtain the following results.

- Determine the temperature distribution in the chip-substrate system. Will the maximum temperature exceed  $85^\circ\text{C}$ ?
- Using the *FEHT* model developed for part (a), determine the volumetric heating rate that yields a maximum temperature of  $85^\circ\text{C}$ .
- What effect would reducing the substrate thickness have on the maximum operating temperature? For a volumetric generation rate of  $\dot{q} = 10^7 \text{ W/m}^3$ , reduce the thickness of the substrate from 12 mm to 6 mm, keeping all other dimensions unchanged. What is the maximum system temperature for these conditions? What fraction of the chip power generation is removed by convection directly from the chip surface?



## 4S.1

### The Graphical Method

---


The graphical method may be employed for two-dimensional problems involving adiabatic and isothermal boundaries. Although the approach has been superseded by computer solutions based on numerical procedures, it may be used to obtain a first estimate of the temperature distribution and to develop a physical appreciation for the nature of the temperature field and heat flow.

#### 4S.1.1 Methodology of Constructing a Flux Plot

The rationale for the graphical method comes from the fact that lines of constant temperature must be perpendicular to lines that indicate the direction of heat flow (see Figure 4.1). The objective of the graphical method is to systematically construct such a network of isotherms and heat flow lines. This network, commonly termed a *flux plot*, is used to infer the temperature distribution and the rate of heat flow through the system.

Consider a square, two-dimensional channel whose inner and outer surfaces are maintained at  $T_1$  and  $T_2$ , respectively. A cross section of the channel is shown in Figure 4S.1a. A procedure for constructing the flux plot, a portion of which is shown in Figure 4S.1b, is as follows.

1. The first step is to *identify all relevant lines of symmetry*. Such lines are determined by thermal, as well as geometrical, conditions. For the square channel of Figure 4S.1a, such lines include the designated vertical, horizontal, and diagonal lines. For this system it is therefore possible to consider only one-eighth of the configuration, as shown in Figure 4S.1b.
2. *Lines of symmetry are adiabatic* in the sense that there can be no heat transfer in a direction perpendicular to the lines. They are therefore heat flow lines and should be treated as such. Since there is no heat flow in a direction perpendicular to a heat flow line, it can be termed an *adiabat*.
3. After all known lines of constant temperature are identified, an attempt should be made to sketch lines of constant temperature within the system. Note that *isotherms should always be perpendicular to adiabats*.
4. Heat flow lines should then be drawn with an eye toward creating a network of *curvilinear squares*. This is done by having the *heat flow lines and isotherms intersect at right angles* and by requiring that *all sides of each square be of approximately the same length*. It is often impossible to satisfy this second requirement exactly, and it is more realistic to strive for equivalence between the sums of the opposite sides of each square, as shown in Figure 4S.1c. Assigning

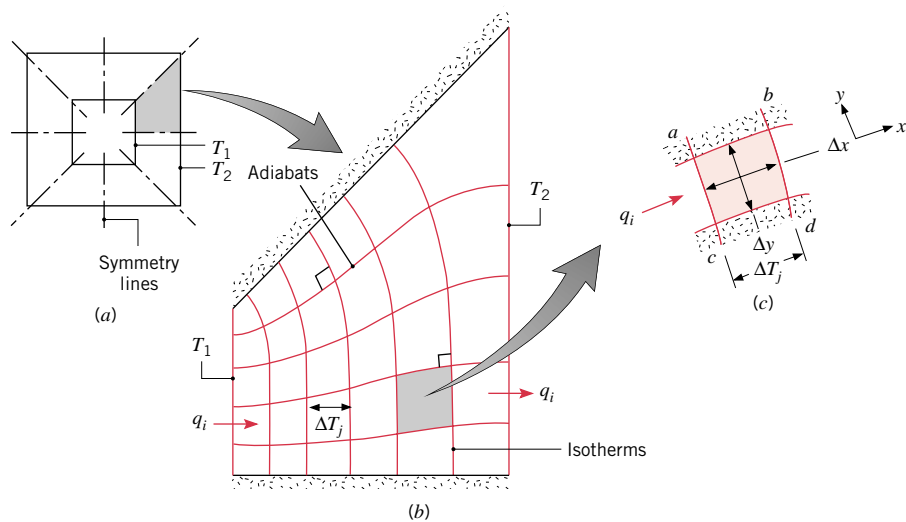

**FIGURE 4S.1** Two-dimensional conduction in a square channel of length  $l$ . (a) Symmetry planes. (b) Flux plot. (c) Typical curvilinear square.

the  $x$  coordinate to the direction of heat flow and the  $y$  coordinate to the direction normal to this flow, the requirement may be expressed as

$$\Delta x \equiv \frac{ab + cd}{2} \approx \Delta y \equiv \frac{ac + bd}{2} \quad (4S.1)$$

It is difficult to create a satisfactory network of curvilinear squares in the first attempt, and several iterations must often be made. This trial-and-error process involves adjusting the isotherms and adiabats until satisfactory curvilinear squares are obtained for most of the network.<sup>1</sup> Once the flux plot has been obtained, it may be used to infer the temperature distribution in the medium. From a simple analysis, the heat transfer rate may then be obtained.

### 4S.1.2 Determination of the Heat Transfer Rate

The rate at which energy is conducted through a *lane*, which is the region between adjoining adiabats, is designated as  $q_i$ . If the flux plot is properly constructed, the value of  $q_i$  will be approximately the same for all lanes and the total heat transfer rate may be expressed as

$$q \approx \sum_{i=1}^M q_i = M q_i \quad (4S.2)$$

<sup>1</sup>In certain regions, such as corners, it may be impossible to approach the curvilinear square requirements. However, such difficulties generally have a small effect on the overall accuracy of the results obtained from the flux plot.



where  $M$  is the *number of lanes* associated with the plot. From the curvilinear square of Figure 4S.1c and the application of Fourier's law,  $q_i$  may be expressed as

$$q_i \approx k A_i \frac{\Delta T_j}{\Delta x} \approx k(\Delta y \cdot l) \frac{\Delta T_j}{\Delta x} \quad (4S.3)$$

where  $\Delta T_j$  is the temperature difference between successive isotherms,  $A_i$  is the conduction heat transfer area for the lane, and  $l$  is the length of the channel normal to the page. However, since the temperature increment is approximately the same for all adjoining isotherms, the overall temperature difference between boundaries,  $\Delta T_{1-2}$ , may be expressed as

$$\Delta T_{1-2} = \sum_{j=1}^N \Delta T_j \approx N \Delta T_j \quad (4S.4)$$

where  $N$  is the total number of temperature increments. Combining Equations 4S.2 through 4S.4 and recognizing that  $\Delta x \approx \Delta y$  for curvilinear squares, we obtain

$$q \approx \frac{Ml}{N} k \Delta T_{1-2} \quad (4S.5)$$

The manner in which a flux plot may be used to obtain the heat transfer rate for a two-dimensional system is evident from Equation 4S.5. The ratio of the number of heat flow lanes to the number of temperature increments (the value of  $M/N$ ) may be obtained from the plot. Recall that specification of  $N$  is based on step 3 of the foregoing procedure, and the value, which is an integer, may be made large or small depending on the desired accuracy. The value of  $M$  is then a consequence of following step 4. Note that  $M$  is not necessarily an integer, since a fractional lane may be needed to arrive at a satisfactory network of curvilinear squares. For the network of Figure 4S.1b,  $N = 6$  and  $M = 5$ . Of course, as the network, or *mesh*, of curvilinear squares is made finer,  $N$  and  $M$  increase and the estimate of  $M/N$  becomes more accurate.

### 4S.1.3 The Conduction Shape Factor

Equation 4S.5 may be used to define the *shape factor*,  $S$ , of a two-dimensional system. That is, the heat transfer rate may be expressed as

$$q = Sk \Delta T_{1-2} \quad (4S.6)$$

where, for a flux plot,

$$S \equiv \frac{Ml}{N} \quad (4S.7)$$

From Equation 4S.6, it also follows that a *two-dimensional conduction resistance* may be expressed as

$$R_{t,\text{cond}(2D)} = \frac{1}{Sk} \quad (4S.8)$$

Shape factors have been obtained for numerous two-dimensional systems, and results are summarized in Table 4.1 for some common configurations. In cases 1 through 9 and case 11, two-dimensional conduction is presumed to occur between boundaries that are maintained at uniform temperatures, with  $\Delta T_{1-2} \equiv T_1 - T_2$ . In case 10 conduction is between an isothermal surface ( $T_1$ ) and a semi-infinite medium of uniform temperature ( $T_2$ ) at locations well removed from the surface. Shape factors may also be defined for one-dimensional geometries, and from the results of Table 3.3, it follows that for plane, cylindrical, and spherical walls, respectively, the shape factors are  $A/L$ ,  $2\pi L/\ln(r_2/r_1)$ , and  $4\pi r_1 r_2/(r_2 - r_1)$ . Results are available for many other configurations [1–4].

### EXAMPLE 4S.1

A hole of diameter  $D = 0.25$  m is drilled through the center of a solid block of square cross section with  $w = 1$  m on a side. The hole is drilled along the length,  $l = 2$  m, of the block, which has a thermal conductivity of  $k = 150$  W/m · K. A warm fluid passing through the hole maintains an inner surface temperature of  $T_1 = 75^\circ\text{C}$ , while the outer surface of the block is kept at  $T_2 = 25^\circ\text{C}$ .

1. Using the flux plot method, determine the shape factor for the system.
2. What is the rate of heat transfer through the block?


### SOLUTION

**Known:** Dimensions and thermal conductivity of a block with a circular hole drilled along its length.

### Find:

1. Shape factor.
2. Heat transfer rate for prescribed surface temperatures.

### Schematic:

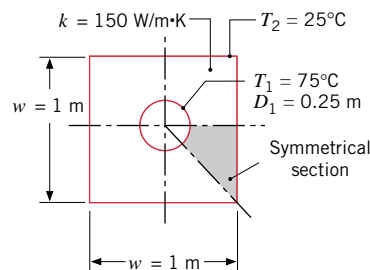


### Assumptions:

1. Steady-state conditions.
2. Two-dimensional conduction.

3. Constant properties.
4. Ends of block are well insulated.

**Analysis:**

1. The flux plot may be simplified by identifying lines of symmetry and reducing the system to the one-eighth section shown in the schematic. Using a fairly coarse grid involving  $N = 6$  temperature increments, the flux plot was generated. The resulting network of curvilinear squares is as follows.

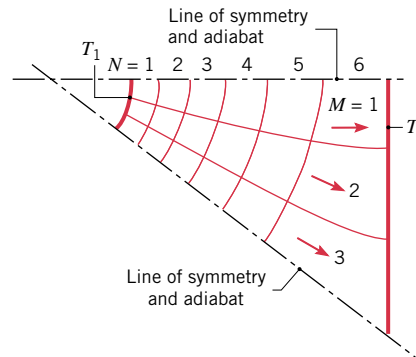

With the number of heat flow lanes for the section corresponding to  $M = 3$ , it follows from Equation 4S.7 that the shape factor for the entire block is

$$S = 8 \frac{Ml}{N} = 8 \frac{3 \times 2 \text{ m}}{6} = 8 \text{ m}$$

where the factor of 8 results from the number of symmetrical sections. The accuracy of this result may be determined by referring to Table 4.1, where, for the prescribed system, case 6, it follows that

$$S = \frac{2\pi L}{\ln(1.08 w/D)} = \frac{2\pi \times 2 \text{ m}}{\ln(1.08 \times 1 \text{ m}/0.25 \text{ m})} = 8.59 \text{ m}$$

Hence the result of the flux plot underpredicts the shape factor by approximately 7%. Note that, although the requirement  $l \gg w$  is not satisfied for this problem, the shape factor result from Table 4.1 remains valid if there is negligible axial conduction in the block. This condition is satisfied if the ends are insulated.

2. Using  $S = 8.59 \text{ m}$  with Equation 4S.6, the heat rate is

$$q = Sk(T_1 - T_2)$$

$$q = 8.59 \text{ m} \times 150 \text{ W/m} \cdot \text{K} (75 - 25)^\circ\text{C} = 64.4 \text{ kW}$$

**Comments:** The accuracy of the flux plot may be improved by using a finer grid (increasing the value of  $N$ ). How would the symmetry and heat flow lines change if the vertical sides were insulated? If one vertical and one horizontal side were insulated? If both vertical and one horizontal side were insulated?


## References

1. Sunderland, J. E., and K. R. Johnson, *Trans. ASHRAE*, **10**, 237–241, 1964.
2. Kutateladze, S. S., *Fundamentals of Heat Transfer*, Academic Press, New York, 1963.
3. General Electric Co. (Corporate Research and Development), *Heat Transfer Data Book*, Section 502, General Electric Company, Schenectady, NY, 1973.
4. Hahne, E., and U. Grigull, *Int. J. Heat Mass Transfer*, **18**, 751–767, 1975.


## Problems

### Flux Plotting


**4S.1** A long furnace, constructed from refractory brick with a thermal conductivity of  $1.2 \text{ W/m} \cdot \text{K}$ , has the cross section shown with inner and outer surface temperatures of  $600$  and  $60^\circ\text{C}$ , respectively. Determine the shape factor and the heat transfer rate per unit length using the flux plot method.



**4S.2** A hot pipe is embedded eccentrically as shown in a material of thermal conductivity  $0.5 \text{ W/m} \cdot \text{K}$ . Using the flux plot method, determine the shape factor and the heat transfer per unit length when the pipe and outer surface temperatures are  $150$  and  $35^\circ\text{C}$ , respectively.




**4S.3** A supporting strut fabricated from a material with a thermal conductivity of  $75 \text{ W/m} \cdot \text{K}$  has the cross section shown. The end faces are at different temperatures  $T_1 = 100^\circ\text{C}$  and  $T_2 = 0^\circ\text{C}$ , while the remaining sides are insulated.

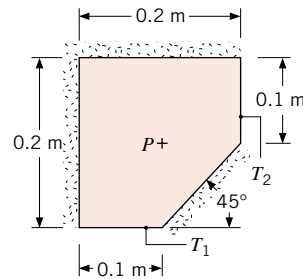


- Estimate the temperature at the location  $P$ .
- Using the flux plot method, estimate the shape factor and the heat transfer rate through the strut per unit length.
- Sketch the  $25$ ,  $50$ , and  $75^\circ\text{C}$  isotherms.
- Consider the same geometry, but now with the  $0.1\text{-m}$  wide surfaces insulated, the  $45^\circ$  surface maintained at  $T_1 = 100^\circ\text{C}$ , and the  $0.2\text{-m}$  wide surfaces maintained at  $T_2 = 0^\circ\text{C}$ . Using the flux plot method, estimate the corresponding shape factor and the heat rate per unit length. Sketch the  $25$ ,  $50$ , and  $75^\circ\text{C}$  isotherms.

**4S.4** A hot liquid flows along a V-groove in a solid whose top and side surfaces are well insulated and whose bottom surface is in contact with a coolant.

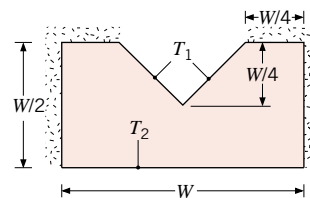


Accordingly, the V-groove surface is at a temperature  $T_1$ , which exceeds that of the bottom surface,  $T_2$ . Construct an appropriate flux plot and determine the shape factor of the system.

- 4S.5** A very long conduit of inner circular cross section and a thermal conductivity of  $1 \text{ W/m} \cdot \text{K}$  passes a hot fluid, which maintains the inner surface at  $T_1 = 50^\circ\text{C}$ . The outer surfaces of square cross section are insulated or maintained at a uniform temperature of  $T_2 = 20^\circ\text{C}$ , depending on the application. Find the shape factor and the heat rate for each case.

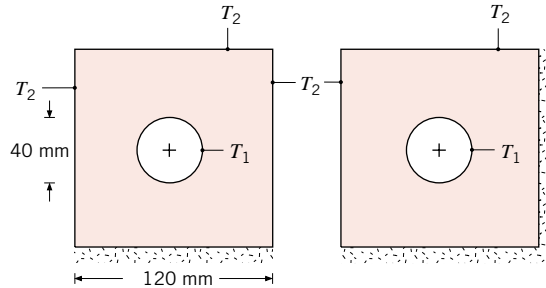


- 4S.6** A long support column of trapezoidal cross section is well insulated on its sides, and temperatures of  $100$  and  $0^\circ\text{C}$  are maintained at its top and bottom surfaces, respectively. The column is fabricated from AISI 1010 steel, and its widths at the top and bottom surfaces are  $0.3$  and  $0.6 \text{ m}$ , respectively.

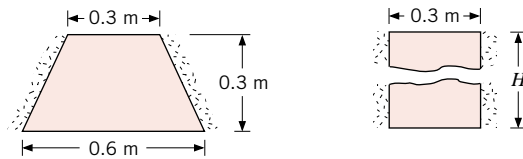


- Using the flux plot method, determine the heat transfer rate per unit length of the column.
- If the trapezoidal column is replaced by a bar of rectangular cross section  $0.3 \text{ m}$  wide and the same

material, what height  $H$  must the bar be to provide an equivalent thermal resistance?

- 4S.7** Hollow prismatic bars fabricated from plain carbon steel are  $1 \text{ m}$  long with top and bottom surfaces, as well as both ends, well insulated. For each bar, find the shape factor and the heat rate per unit length of the bar when  $T_1 = 500 \text{ K}$  and  $T_2 = 300 \text{ K}$ .

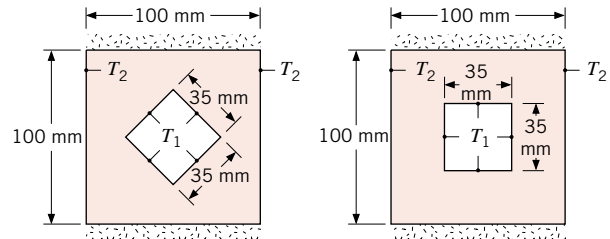


- 4S.8** The two-dimensional, square shapes,  $1 \text{ m}$  to a side, are maintained at uniform temperatures,  $T_1 = 100^\circ\text{C}$  and  $T_2 = 0^\circ\text{C}$ , on portions of their boundaries and are well insulated elsewhere.

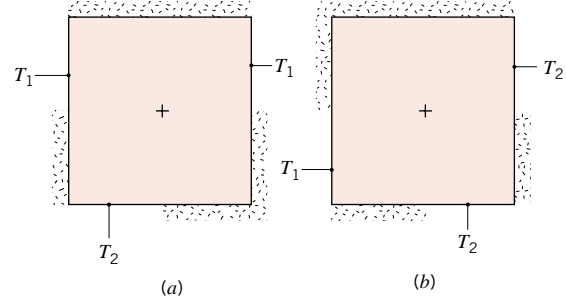

Use the flux plot method to estimate the heat rate per unit length normal to the page if the thermal conductivity is  $50 \text{ W/m} \cdot \text{K}$ .

# *C H A P T E R* **5**

## **Transient Conduction**

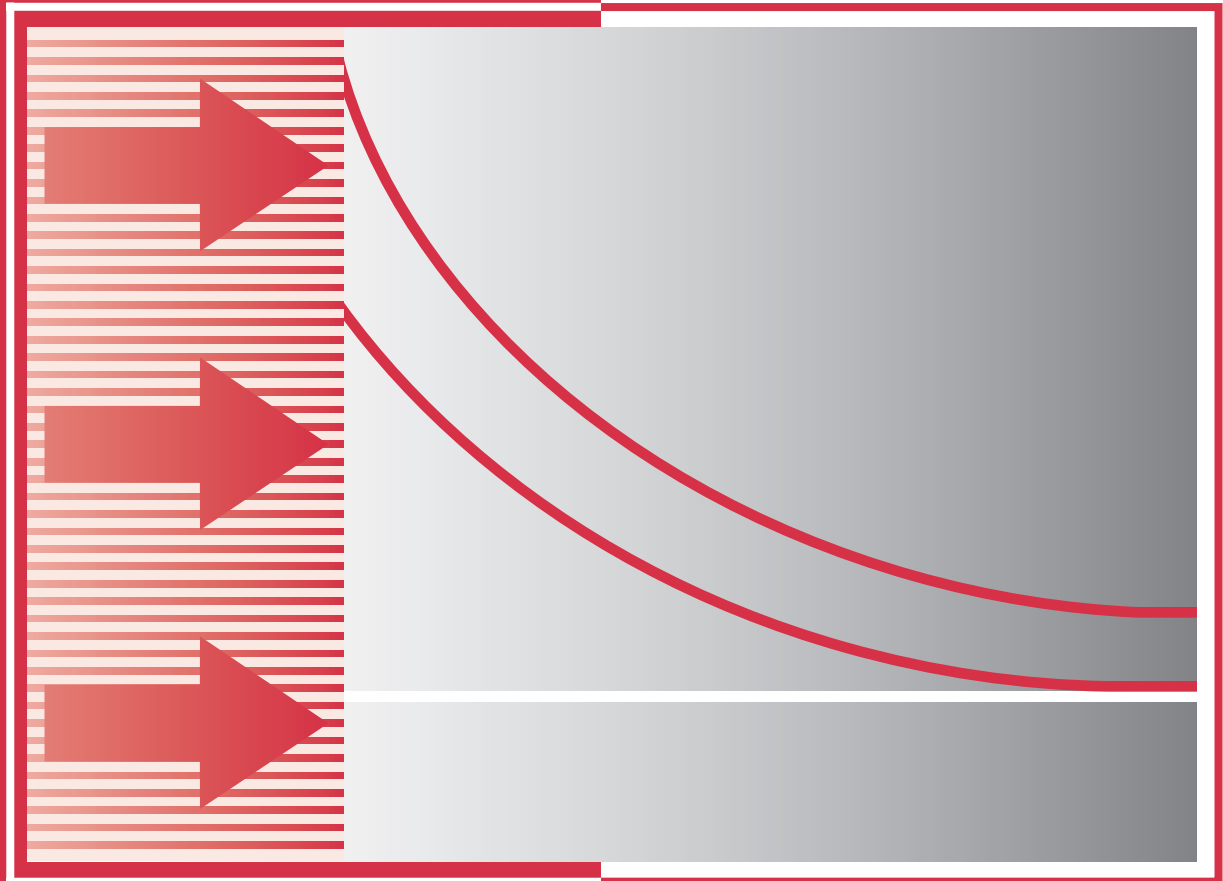

**I**n our treatment of conduction we have gradually considered more complicated conditions. We began with the simple case of one-dimensional, steady-state conduction with no internal generation, and we subsequently considered more realistic situations involving multidimensional and generation effects. However, we have not yet considered situations for which conditions change with time.

We now recognize that many heat transfer problems are time dependent. Such *unsteady*, or *transient*, problems typically arise when the boundary conditions of a system are changed. For example, if the surface temperature of a system is altered, the temperature at each point in the system will also begin to change. The changes will continue to occur until a *steady-state* temperature distribution is reached. Consider a hot metal billet that is removed from a furnace and exposed to a cool airstream. Energy is transferred by convection and radiation from its surface to the surroundings. Energy transfer by conduction also occurs from the interior of the metal to the surface, and the temperature at each point in the billet decreases until a steady-state condition is reached. The final properties of the metal will depend significantly on the time-temperature history that results from heat transfer. Controlling the heat transfer is one key to fabricating new materials with enhanced properties.

Our objective in this chapter is to develop procedures for determining the time dependence of the temperature distribution within a solid during a transient process, as well as for determining heat transfer between the solid and its surroundings. The nature of the procedure depends on assumptions that may be made for the process. If, for example, temperature gradients within the solid may be neglected, a comparatively simple approach, termed the *lumped capacitance method*, may be used to determine the variation of temperature with time. The method is developed in Sections 5.1 to 5.3.


Under conditions for which temperature gradients are not negligible, but heat transfer within the solid is one-dimensional, exact solutions to the heat equation may be used to compute the dependence of temperature on both location and time. Such solutions are considered for *finite solids* (plane walls, long cylinders and spheres) in Sections 5.4 to 5.6 and for *semi-infinite solids* in Section 5.7. Section 5.8 presents the transient thermal response of a variety of objects subject to a step change in either surface temperature or surface heat flux. In Section 5.9, the response of a semi-infinite solid to periodic heating conditions at its surface is explored. For more complex conditions, finite-difference or finite-element methods must be used to predict the time dependence of temperatures within the solid, as well as heat rates at its boundaries (Section 5.10).

## 5.1

### The Lumped Capacitance Method

---

A simple, yet common, transient conduction problem is one for which a solid experiences a sudden change in its thermal environment. Consider a hot metal forging that is initially at a uniform temperature  $T_i$  and is quenched by immersing it in a liquid of lower temperature  $T_\infty < T_i$  (Figure 5.1). If the quenching is said to begin at time  $t = 0$ , the temperature of the solid will decrease for time  $t > 0$ , until it eventually

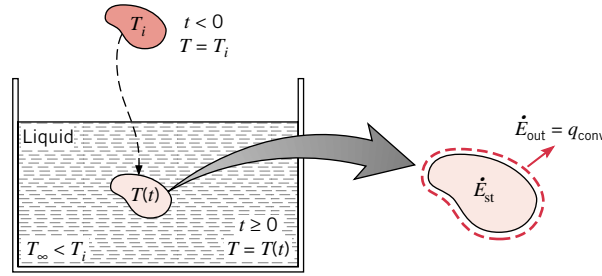

**FIGURE 5.1** Cooling of a hot metal forging.

reaches  $T_\infty$ . This reduction is due to convection heat transfer at the solid–liquid interface. The essence of the lumped capacitance method is the assumption that the temperature of the solid is *spatially uniform* at any instant during the transient process. This assumption implies that temperature gradients within the solid are negligible.

From Fourier's law, heat conduction in the absence of a temperature gradient implies the existence of infinite thermal conductivity. Such a condition is clearly impossible. However, the condition is closely approximated if the resistance to conduction within the solid is small compared with the resistance to heat transfer between the solid and its surroundings. For now we assume that this is, in fact, the case.

In neglecting temperature gradients within the solid, we can no longer consider the problem from within the framework of the heat equation. Instead, the transient temperature response is determined by formulating an overall energy balance on the solid. This balance must relate the rate of heat loss at the surface to the rate of change of the internal energy. Applying Equation 1.11c to the control volume of Figure 5.1, this requirement takes the form

$$-\dot{E}_{\text{out}} = \dot{E}_{\text{st}} \quad (5.1)$$

or

$$-hA_s(T - T_\infty) = \rho Vc \frac{dT}{dt} \quad (5.2)$$

Introducing the temperature difference

$$\theta \equiv T - T_\infty \quad (5.3)$$

and recognizing that  $(d\theta/dt) = (dT/dt)$  if  $T_\infty$  is constant, it follows that

$$\frac{\rho Vc}{hA_s} \frac{d\theta}{dt} = -\theta$$

Separating variables and integrating from the initial condition, for which  $t = 0$  and  $T(0) = T_i$ , we then obtain

$$\frac{\rho Vc}{hA_s} \int_{\theta_i}^{\theta} \frac{d\theta}{\theta} = - \int_0^t dt$$

where

$$\theta_i \equiv T_i - T_\infty \quad (5.4)$$



Evaluating the integrals, it follows that

$$\frac{\rho V c}{h A_s} \ln \frac{\theta_i}{\theta} = t \quad (5.5)$$

or

$$\frac{\theta}{\theta_i} = \frac{T - T_\infty}{T_i - T_\infty} = \exp \left[ - \left( \frac{h A_s}{\rho V c} \right) t \right] \quad (5.6)$$

Equation 5.5 may be used to determine the time required for the solid to reach some temperature  $T$ , or, conversely, Equation 5.6 may be used to compute the temperature reached by the solid at some time  $t$ .


The foregoing results indicate that the difference between the solid and fluid temperatures must decay exponentially to zero as  $t$  approaches infinity. This behavior is shown in Figure 5.2. From Equation 5.6 it is also evident that the quantity  $(\rho V c / h A_s)$  may be interpreted as a *thermal time constant* expressed as

$$\tau_t = \left( \frac{1}{h A_s} \right) (\rho V c) = R_t C_t \quad (5.7)$$

where  $R_t$  is the resistance to convection heat transfer and  $C_t$  is the *lumped thermal capacitance* of the solid. Any increase in  $R_t$  or  $C_t$  will cause a solid to respond more slowly to changes in its thermal environment. This behavior is analogous to the voltage decay that occurs when a capacitor is discharged through a resistor in an electrical  $RC$  circuit.

To determine the total energy transfer  $Q$  occurring up to some time  $t$ , we simply write

$$Q = \int_0^t q \, dt = h A_s \int_0^t \theta \, dt$$

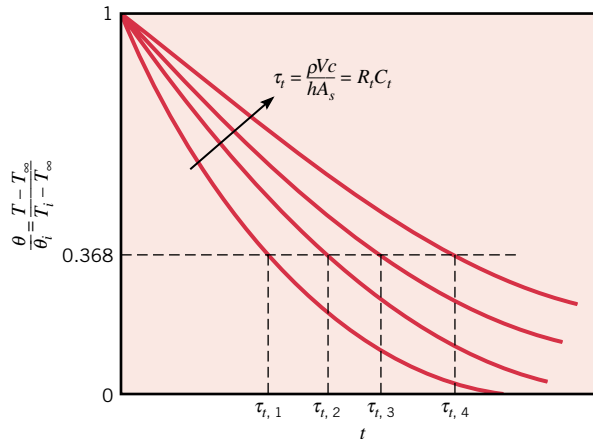

**FIGURE 5.2** Transient temperature response of lumped capacitance solids for different thermal time constants  $\tau_t$ .

Substituting for  $\theta$  from Equation 5.6 and integrating, we obtain

$$Q = (\rho V c) \theta_i \left[ 1 - \exp\left(-\frac{t}{\tau_i}\right) \right] \quad (5.8a)$$

The quantity  $Q$  is, of course, related to the change in the internal energy of the solid, and from Equation 1.11b

$$-Q = \Delta E_{st} \quad (5.8b)$$

For quenching  $Q$  is positive and the solid experiences a decrease in energy. Equations 5.5, 5.6, and 5.8a also apply to situations where the solid is heated ( $\theta < 0$ ), in which case  $Q$  is negative and the internal energy of the solid increases.


## 5.2

### Validity of the Lumped Capacitance Method

From the foregoing results it is easy to see why there is a strong preference for using the lumped capacitance method. It is certainly the simplest and most convenient method that can be used to solve transient heating and cooling problems. Hence it is important to determine under what conditions it may be used with reasonable accuracy.

To develop a suitable criterion consider steady-state conduction through the plane wall of area  $A$  (Figure 5.3). Although we are assuming steady-state conditions, this criterion is readily extended to transient processes. One surface is maintained at a temperature  $T_{s,1}$  and the other surface is exposed to a fluid of temperature  $T_\infty < T_{s,1}$ . The temperature of this surface will be some intermediate value,  $T_{s,2}$ , for which  $T_\infty < T_{s,2} < T_{s,1}$ . Hence under steady-state conditions the surface energy balance, Equation 1.12, reduces to

$$\frac{kA}{L} (T_{s,1} - T_{s,2}) = hA(T_{s,2} - T_\infty)$$

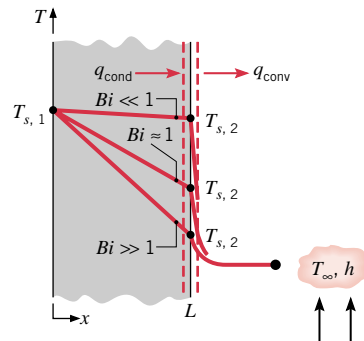

**FIGURE 5.3**

Effect of Biot number on steady-state temperature distribution in a plane wall with surface convection.


where  $k$  is the thermal conductivity of the solid. Rearranging, we then obtain

$$\frac{T_{s,1} - T_{s,2}}{T_{s,2} - T_{\infty}} = \frac{(L/kA)}{(1/hA)} = \frac{R_{\text{cond}}}{R_{\text{conv}}} = \frac{hL}{k} \equiv Bi \quad (5.9)$$

The quantity  $(hL/k)$  appearing in Equation 5.9 is a *dimensionless parameter*. It is termed the *Biot number*, and it plays a fundamental role in conduction problems that involve surface convection effects. According to Equation 5.9 and as illustrated in Figure 5.3, the Biot number provides a measure of the temperature drop in the solid relative to the temperature difference between the surface and the fluid. Note especially the conditions corresponding to  $Bi \ll 1$ . The results suggest that, for these conditions, it is reasonable to *assume* a uniform temperature distribution within a solid at any time during a transient process. This result may also be associated with interpretation of the Biot number as a ratio of thermal resistances, Equation 5.9. *If  $Bi \ll 1$ , the resistance to conduction within the solid is much less than the resistance to convection across the fluid boundary layer.* Hence the assumption of a uniform temperature distribution is reasonable.

We have introduced the Biot number because of its significance to transient conduction problems. Consider the plane wall of Figure 5.4, which is initially at a uniform temperature  $T_i$  and experiences convection cooling when it is immersed in a fluid of  $T_{\infty} < T_i$ . The problem may be treated as one-dimensional in  $x$ , and we are interested in the temperature variation with position and time,  $T(x, t)$ . This variation is a strong function of the Biot number, and three conditions are shown in Figure 5.4. For  $Bi \ll 1$  the temperature gradient in the solid is small and  $T(x, t) \approx T(t)$ . Virtually all the temperature difference is between the solid and the fluid, and the solid temperature remains nearly uniform as it decreases to  $T_{\infty}$ . For moderate to large values of the Biot number, however, the temperature gradients within the solid are significant. Hence  $T = T(x, t)$ . Note that for  $Bi \gg 1$ , the temperature difference across the solid is much larger than that between the surface and the fluid.

We conclude this section by emphasizing the importance of the lumped capacitance method. Its inherent simplicity renders it the preferred method for solving

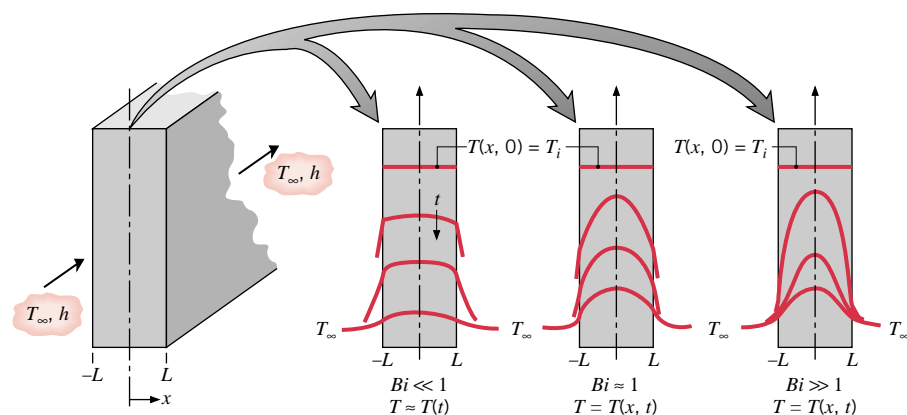

**FIGURE 5.4** Transient temperature distributions for different Biot numbers in a plane wall symmetrically cooled by convection.

transient heating and cooling problems. Hence, when confronted with such a problem, *the very first thing that one should do is calculate the Biot number*. If the following condition is satisfied

$$Bi = \frac{hL_c}{k} < 0.1 \quad (5.10)$$

the error associated with using the lumped capacitance method is small. For convenience, it is customary to define the *characteristic length* of Equation 5.10 as the ratio of the solid's volume to surface area,  $L_c \equiv V/A_s$ . Such a definition facilitates calculation of  $L_c$  for solids of complicated shape and reduces to the half-thickness  $L$  for a plane wall of thickness  $2L$  (Figure 5.4), to  $r_o/2$  for a long cylinder, and to  $r_o/3$  for a sphere. However, if one wishes to implement the criterion in a conservative fashion,  $L_c$  should be associated with the length scale corresponding to the maximum spatial temperature difference. Accordingly, for a symmetrically heated (or cooled) plane wall of thickness  $2L$ ,  $L_c$  would remain equal to the half-thickness  $L$ . However, for a long cylinder or sphere,  $L_c$  would equal the actual radius  $r_o$ , rather than  $r_o/2$  or  $r_o/3$ .

Finally, we note that, with  $L_c \equiv V/A_s$ , the exponent of Equation 5.6 may be expressed as

$$\frac{hA_s t}{\rho V c} = \frac{ht}{\rho c L_c} = \frac{hL_c}{k} \frac{k}{\rho c} \frac{t}{L_c^2} = \frac{hL_c}{k} \frac{\alpha t}{L_c^2}$$

or

$$\frac{hA_s t}{\rho V c} = Bi \cdot Fo \quad (5.11)$$

where

$$Fo \equiv \frac{\alpha t}{L_c^2} \quad (5.12)$$

is termed the Fourier number. It is a *dimensionless time*, which, with the Biot number, characterizes transient conduction problems. Substituting Equation 5.11 into 5.6, we obtain

$$\frac{\theta}{\theta_i} = \frac{T - T_\infty}{T_i - T_\infty} = \exp(-Bi \cdot Fo) \quad (5.13)$$

### EXAMPLE 5.1


A thermocouple junction, which may be approximated as a sphere, is to be used for temperature measurement in a gas stream. The convection coefficient between the junction surface and the gas is  $h = 400 \text{ W/m}^2 \cdot \text{K}$ , and the junction thermophysical properties are  $k = 20 \text{ W/m} \cdot \text{K}$ ,  $c = 400 \text{ J/kg} \cdot \text{K}$ , and  $\rho = 8500 \text{ kg/m}^3$ . Determine the junction diameter needed for the thermocouple to have a time constant of 1 s. If the junction is at  $25^\circ\text{C}$  and is placed in a gas stream that is at  $200^\circ\text{C}$ , how long will it take for the junction to reach  $199^\circ\text{C}$ ?

**SOLUTION**

**Known:** Thermophysical properties of thermocouple junction used to measure temperature of a gas stream.

**Find:**

1. Junction diameter needed for a time constant of 1 s.
2. Time required to reach 199°C in gas stream at 200°C.

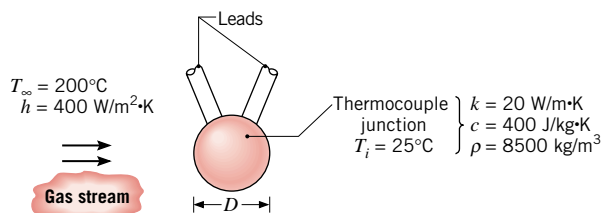**Schematic:****Assumptions:**

1. Temperature of junction is uniform at any instant.
2. Radiation exchange with the surroundings is negligible.
3. Losses by conduction through the leads are negligible.
4. Constant properties.

**Analysis:**

1. Because the junction diameter is unknown, it is not possible to begin the solution by determining whether the criterion for using the lumped capacitance method, Equation 5.10, is satisfied. However, a reasonable approach is to use the method to find the diameter and to then determine whether the criterion is satisfied. From Equation 5.7 and the fact that  $A_s = \pi D^2$  and  $V = \pi D^3/6$  for a sphere, it follows that

$$\tau_t = \frac{1}{h\pi D^2} \times \frac{\rho\pi D^3}{6} c$$

Rearranging and substituting numerical values,

$$D = \frac{6h\tau_t}{\rho c} = \frac{6 \times 400 \text{ W/m}^2 \cdot \text{K} \times 1 \text{ s}}{8500 \text{ kg/m}^3 \times 400 \text{ J/kg} \cdot \text{K}} = 7.06 \times 10^{-4} \text{ m}$$

With  $L_c = r_o/3$  it then follows from Equation 5.10 that

$$Bi = \frac{h(r_o/3)}{k} = \frac{400 \text{ W/m}^2 \cdot \text{K} \times 3.53 \times 10^{-4} \text{ m}}{3 \times 20 \text{ W/m} \cdot \text{K}} = 2.35 \times 10^{-3}$$

Accordingly, Equation 5.10 is satisfied (for  $L_c = r_o$ , as well as for  $L_c = r_o/3$ ) and the lumped capacitance method may be used to an excellent approximation.

2. From Equation 5.5 the time required for the junction to reach  $T = 199^\circ\text{C}$  is

$$t = \frac{\rho(\pi D^3/6)c}{h(\pi D^2)} \ln \frac{T_i - T_\infty}{T - T_\infty} = \frac{\rho D c}{6h} \ln \frac{T_i - T_\infty}{T - T_\infty}$$

$$t = \frac{8500 \text{ kg/m}^3 \times 7.06 \times 10^{-4} \text{ m} \times 400 \text{ J/kg} \cdot \text{K}}{6 \times 400 \text{ W/m}^2 \cdot \text{K}} \ln \frac{25 - 200}{199 - 200}$$

$$t = 5.2 \text{ s} \approx 5\tau_t$$


**Comments:** Heat transfer due to radiation exchange between the junction and the surroundings and conduction through the leads would affect the time response of the junction and would, in fact, yield an equilibrium temperature that differs from  $T_\infty$ .

## 5.3

### General Lumped Capacitance Analysis

Although transient conduction in a solid is commonly initiated by convection heat transfer to or from an adjoining fluid, other processes may induce transient thermal conditions within the solid. For example, a solid may be separated from large surroundings by a gas or vacuum. If the temperatures of the solid and surroundings differ, radiation exchange could cause the internal thermal energy, and hence the temperature, of the solid to change. Temperature changes could also be induced by applying a heat flux at a portion, or all, of the surface and/or by initiating thermal energy generation within the solid. Surface heating could, for example, be applied by attaching a film or sheet electrical heater to the surface, while thermal energy could be generated by passing an electrical current through the solid.

Figure 5.5 depicts a situation for which thermal conditions within a solid may be influenced simultaneously by convection, radiation, an applied surface heat flux, and internal energy generation. It is presumed that, initially ( $t = 0$ ), the temperature of the solid ( $T_i$ ) differs from that of the fluid,  $T_\infty$ , and the surroundings,  $T_{\text{sur}}$ , and that both surface and volumetric heating ( $q_s''$  and  $\dot{q}$ ) are initiated. The imposed heat flux

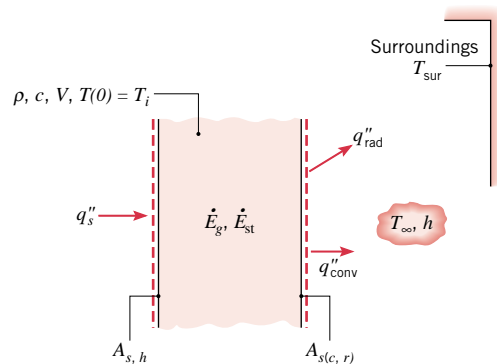

**FIGURE 5.5**

Control surface for general lumped capacitance analysis.

$q_s''$  and the convection–radiation heat transfer occur at mutually exclusive portions of the surface,  $A_{s(h)}$  and  $A_{s(c,r)}$ , respectively, and convection–radiation transfer is presumed to be *from* the surface. Moreover, although convection and radiation have been prescribed for the same surface, the surfaces may, in fact, differ ( $A_{s,c} \neq A_{s,r}$ ). Applying conservation of energy at any instant  $t$ , it follows from Equation 1.11c that

$$q_s'' A_{s,h} + \dot{E}_g - (q_{\text{conv}}'' + q_{\text{rad}}'') A_{s(c,r)} = \rho V c \frac{dT}{dt} \quad (5.14)$$

or, from Equations 1.3a and 1.7,

$$q_s'' A_{s,h} + \dot{E}_g - [h(T - T_\infty) + \varepsilon \sigma (T^4 - T_{\text{sur}}^4)] A_{s(c,r)} = \rho V c \frac{dT}{dt} \quad (5.15)$$

Equation 5.15 is a nonlinear, first-order, nonhomogeneous, ordinary differential equation that cannot be integrated to obtain an exact solution.<sup>1</sup> However, exact solutions may be obtained for simplified versions of the equation. For example, if there is no imposed heat flux or generation and convection is either nonexistent (a vacuum) or negligible relative to radiation, Equation 5.15 reduces to

$$\rho V c \frac{dT}{dt} = -\varepsilon A_{s,r} \sigma (T^4 - T_{\text{sur}}^4) \quad (5.16)$$

Separating variables and integrating from the initial condition to any time  $t$ , it follows that

$$\frac{\varepsilon A_{s,r} \sigma}{\rho V c} \int_0^t dt = \int_{T_i}^T \frac{dT}{T_{\text{sur}}^4 - T^4} \quad (5.17)$$

Evaluating both integrals and rearranging, the time required to reach the temperature  $T$  becomes

$$t = \frac{\rho V c}{4 \varepsilon A_{s,r} \sigma T_{\text{sur}}^3} \left\{ \ln \left| \frac{T_{\text{sur}} + T}{T_{\text{sur}} - T} \right| - \ln \left| \frac{T_{\text{sur}} + T_i}{T_{\text{sur}} - T_i} \right| + 2 \left[ \tan^{-1} \left( \frac{T}{T_{\text{sur}}} \right) - \tan^{-1} \left( \frac{T_i}{T_{\text{sur}}} \right) \right] \right\} \quad (5.18)$$

This expression cannot be used to evaluate  $T$  explicitly in terms of  $t$ ,  $T_i$ , and  $T_{\text{sur}}$ , nor does it readily reduce to the limiting result for  $T_{\text{sur}} = 0$  (radiation to deep space). However, returning to Equation 5.17, its solution for  $T_{\text{sur}} = 0$  yields

$$t = \frac{\rho V c}{3 \varepsilon A_{s,r} \sigma} \left( \frac{1}{T^3} - \frac{1}{T_i^3} \right) \quad (5.19)$$

An exact solution to Equation 5.15 may also be obtained if radiation may be neglected and  $h$  is independent of time. Introducing a temperature difference  $\theta \equiv T - T_\infty$ , where  $d\theta/dt = dT/dt$ , Equation 5.15 reduces to a linear, first-order, nonhomogeneous differential equation of the form

$$\frac{d\theta}{dt} + a\theta - b = 0 \quad (5.20)$$

<sup>1</sup>An approximate, finite-difference solution may be obtained by *discretizing* the time derivative (Section 5.10) and *marching* the solution out in time.

where  $a \equiv (hA_{s,c}/\rho Vc)$  and  $b \equiv [(q''_s A_{s,h} + \dot{E}_g)/\rho Vc]$ . Although Equation 5.20 may be solved by summing its homogeneous and particular solutions, an alternative approach is to eliminate the nonhomogeneity by introducing the transformation

$$\theta' \equiv \theta - \frac{b}{a} \quad (5.21)$$

Recognizing that  $d\theta'/dt = d\theta/dt$ , Equation 5.21 may be substituted into (5.20) to yield

$$\frac{d\theta'}{dt} + a\theta' = 0 \quad (5.22)$$

Separating variables and integrating from 0 to  $t$  ( $\theta'_i$  to  $\theta'$ ), it follows that

$$\frac{\theta'}{\theta'_i} = \exp(-at) \quad (5.23)$$

or substituting for  $\theta'$  and  $\theta$ ,

$$\frac{T - T_\infty - (b/a)}{T_i - T_\infty - (b/a)} = \exp(-at) \quad (5.24)$$

Hence

$$\frac{T - T_\infty}{T_i - T_\infty} = \exp(-at) + \frac{b/a}{T_i - T_\infty} [1 - \exp(-at)] \quad (5.25)$$

As it must, Equation 5.25 reduces to Equation 5.6 when  $b = 0$  and yields  $T = T_i$  at  $t = 0$ . As  $t \rightarrow \infty$ , Equation 5.25 reduces to  $(T - T_\infty) = (b/a)$ , which could also be obtained by performing an energy balance on the control surface of Figure 5.5 for steady-state conditions.

### EXAMPLE 5.2

Consider the thermocouple and convection conditions of Example 5.1, but now allow for radiation exchange with the walls of a duct that encloses the gas stream. If the duct walls are at 400°C and the emissivity of the thermocouple bead is 0.9, calculate the steady-state temperature of the junction. Also, determine the time for the junction temperature to increase from an initial condition of 25°C to a temperature that is within 1°C of its steady-state value.

### SOLUTION


**Known:** Thermophysical properties and diameter of the thermocouple junction used to measure temperature of a gas stream passing through a duct with hot walls.

**Find:**

1. Steady-state temperature of the junction.
2. Time required for the thermocouple to reach a temperature that is within 1°C of its steady-state value.



**Schematic:**

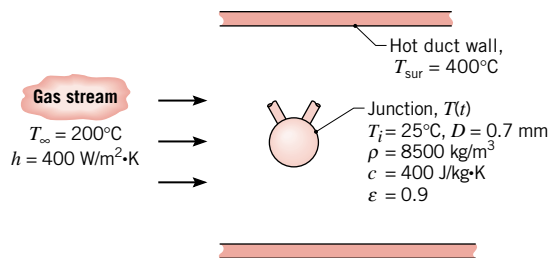

**Assumptions:** Same as Example 5.1, but radiation transfer is no longer treated as negligible and is approximated as exchange between a small surface and large surroundings.

**Analysis:**

- For steady-state conditions, the energy balance on the thermocouple junction has the form

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = 0$$

Recognizing that net radiation to the junction must be balanced by convection from the junction to the gas, the energy balance may be expressed as

$$[\epsilon\sigma(T_{\text{sur}}^4 - T^4) - h(T - T_{\infty})]A_s = 0$$

Substituting numerical values, we obtain

$$T = 218.7^{\circ}\text{C}$$

- The temperature-time history,  $T(t)$ , for the junction, initially at  $T(0) = T_i = 25^{\circ}\text{C}$ , follows from the energy balance for transient conditions,

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = \dot{E}_{\text{st}}$$

From Equation 5.15, the energy balance may be expressed as

$$- [h(T - T_{\infty}) + \epsilon\sigma(T^4 - T_{\text{sur}}^4)]A_s = \rho Vc \frac{dT}{dt}$$


The solution to this first-order differential equation can be obtained by numerical integration, giving the result,  $T(4.9 \text{ s}) = 217.7^{\circ}\text{C}$ . Hence, the time required to reach a temperature that is within  $1^{\circ}\text{C}$  of the steady-state value is

$$t = 4.9 \text{ s.}$$

**Comments:**

- The effect of radiation exchange with the hot duct walls is to increase the junction temperature, such that the thermocouple indicates an erroneous gas stream temperature that exceeds the actual temperature by  $18.7^{\circ}\text{C}$ . The time required to reach a temperature that is within  $1^{\circ}\text{C}$  of the steady-state value is slightly less than the result of Example 5.1, which only considers convection heat transfer. Why is this so?

- The response of the thermocouple and the indicated gas stream temperature depend on the velocity of the gas stream, which in turn affects the magnitude of the convection coefficient. Temperature-time histories for the thermocouple junction are shown in the following graph for values of  $h = 200, 400,$  and  $800 \text{ W/m}^2 \cdot \text{K}$ .

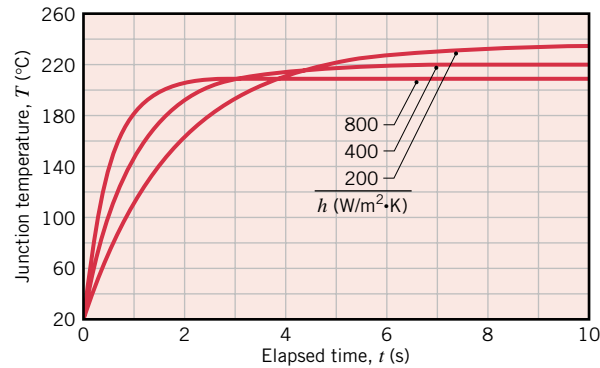

The effect of increasing the convection coefficient is to cause the junction to indicate a temperature closer to that of the gas stream. Further, the effect is to reduce the time required for the junction to reach the near-steady-state condition. What physical explanation can you give for these results?

- The *IHT* software accompanying this text includes an integral function,  $\text{Der}(T, t)$ , that can be used to represent the temperature-time derivative and to integrate first-order differential equations. For this problem, an energy balance relation of the following form may be entered into the *Workspace*,

$$(-h(T - T_{\infty}) - \epsilon \sigma (T^4 - T_{\text{sur}}^4)) A_s = \rho V c \text{Der}(T, t)$$

After hitting the *Solve* button, the *Diff/Integral Equations* pad will appear, identifying the independent variable  $t$  and providing boxes (*Start*, *Stop*, and *Step*) for entering the integration limits and the time increment  $\Delta t$ , respectively, as well as the initial condition (*IC*). Alternatively, the *IHT Lumped Capacitance Model* can be used to build a model that includes the phenomena of this problem and to perform the numerical integration.

### EXAMPLE 5.3

A 3-mm-thick panel of aluminum alloy ( $k = 177 \text{ W/m} \cdot \text{K}$ ,  $c = 875 \text{ J/kg} \cdot \text{K}$ , and  $\rho = 2770 \text{ kg/m}^3$ ) is finished on both sides with an epoxy coating that must be cured at or above  $T_c = 150^\circ\text{C}$  for at least 5 min. The production line for the curing operation involves two steps: (1) heating in a large oven with air at  $T_{\infty,o} = 175^\circ\text{C}$  and a convection coefficient of  $h_o = 40 \text{ W/m}^2 \cdot \text{K}$ , and (2) cooling in a large chamber with air at  $T_{\infty,c} = 25^\circ\text{C}$  and a convection coefficient of  $h_c = 10 \text{ W/m}^2 \cdot \text{K}$ . The heating portion of the process is conducted over a time interval  $t_e$ , which exceeds the time  $t_c$  required to reach  $150^\circ\text{C}$  by 5 min ( $t_e = t_c + 300 \text{ s}$ ). The coating has an emissivity of  $\epsilon = 0.8$ , and the temperatures of the oven and chamber walls are  $175^\circ\text{C}$  and  $25^\circ\text{C}$ , respectively. If the panel is placed in the oven at an initial temperature of  $25^\circ\text{C}$  and


removed from the chamber at a *safe-to-touch* temperature of 37°C, what is the total elapsed time for the two-step curing operation?

### SOLUTION

**Known:** Operating conditions for a two-step heating/cooling process in which a coated aluminum panel is maintained at or above a temperature of 150°C for at least 5 min.

**Find:** Total time  $t_i$  required for the two-step process.

**Schematic:**

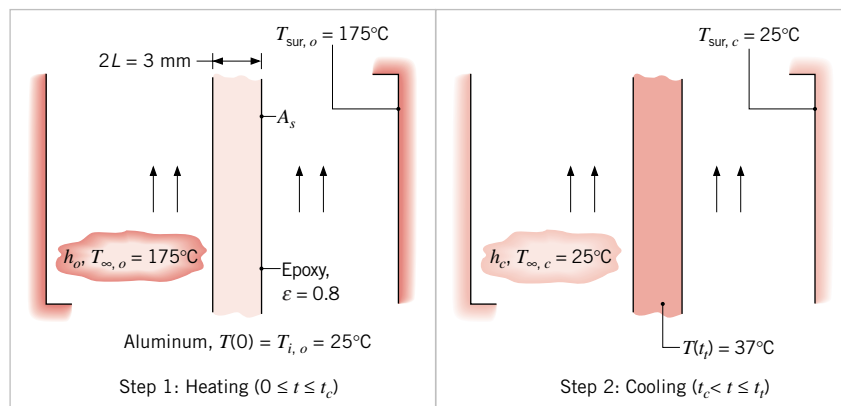

**Assumptions:**

1. Panel temperature is uniform at any instant.
2. Thermal resistance of epoxy is negligible.
3. Constant properties.

**Analysis:** To assess the validity of the lumped capacitance approximation, we begin by calculating Biot numbers for the heating and cooling processes.

$$Bi_h = \frac{h_o L}{k} = \frac{(40 \text{ W/m}^2 \cdot \text{K})(0.0015 \text{ m})}{177 \text{ W/m} \cdot \text{K}} = 3.4 \times 10^{-4}$$

$$Bi_c = \frac{h_c L}{k} = \frac{(10 \text{ W/m}^2 \cdot \text{K})(0.0015 \text{ m})}{177 \text{ W/m} \cdot \text{K}} = 8.5 \times 10^{-5}$$

Hence the lumped capacitance approximation is excellent.

To determine whether radiation exchange between the panel and its surroundings should be considered, the radiation heat transfer coefficient is determined from Equation 1.9. A representative value of  $h_r$  for the heating process is associated with the cure condition, in which case


$$\begin{aligned} h_{r,o} &= \varepsilon \sigma (T_c + T_{\text{sur},o})(T_c^2 + T_{\text{sur},o}^2) \\ &= 0.8 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (423 + 448) \text{ K} (423^2 + 448^2) \text{ K}^2 \\ &= 15 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

Using  $T_c = 150^\circ\text{C}$  with  $T_{\text{sur},c} = 25^\circ\text{C}$  for the cooling process, we also obtain  $h_{r,c} = 8.8 \text{ W/m}^2 \cdot \text{K}$ . Since the values of  $h_{r,o}$  and  $h_{r,c}$  are comparable to those of  $h_o$  and  $h_c$ , respectively, radiation effects must be considered.

With  $V = 2LA_s$  and  $A_{s,c} = A_{s,r} = 2A_s$ , Equation 5.15 may be expressed as

$$\int_{T_i}^T dT = T(t) - T_i = -\frac{1}{\rho c L} \int_0^t [h(T - T_\infty) + \varepsilon \sigma (T^4 - T_{\text{sur}}^4)] dt$$

Selecting a suitable time increment  $\Delta t$ , the right-hand side of this equation may be evaluated numerically to obtain the panel temperature at  $t = \Delta t, 2\Delta t, 3\Delta t$ , and so on. At each new step of the calculation, the value of  $T$  computed from the previous time step is used in the integrand. Selecting  $\Delta t = 10 \text{ s}$ , calculations for the heating process are extended to  $t_e = t_c + 300 \text{ s}$ , which is 5 min beyond the time required for the panel to reach  $T_c = 150^\circ\text{C}$ . At  $t_e$  the cooling process is initiated and continued until the panel temperature reaches  $37^\circ\text{C}$  at  $t = t_t$ . The integration was performed using a fourth-order Runge-Kutta scheme, and results of the calculations are plotted as follows:

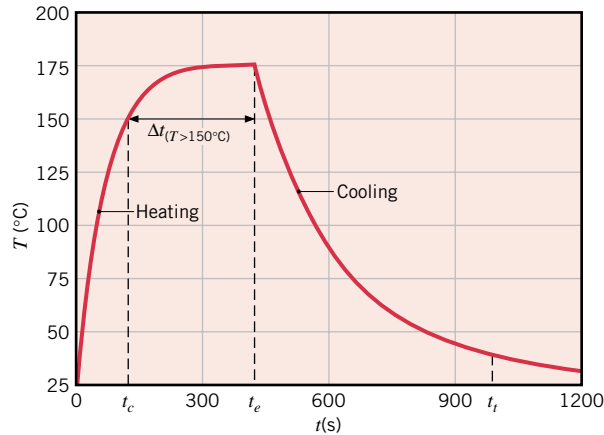

The total time for the two-step process is

$$t_t = 989 \text{ s}$$

with intermediate times of  $t_c = 124 \text{ s}$  and  $t_e = 424 \text{ s}$ .

### Comments:

1. Generally, the accuracy of a numerical integration improves with decreasing  $\Delta t$ , but at the expense of increased computation time. In this case, however, results obtained for  $\Delta t = 1 \text{ s}$  are virtually identical to those obtained for  $\Delta t = 10 \text{ s}$ , indicating that the larger time interval is sufficient to accurately depict the temperature history.
2. The duration of the two-step process may be reduced by increasing the convection coefficients and/or by reducing the period of extended heating. The second option is made possible by the fact that, during a portion of the cooling period, the panel temperature remains above  $150^\circ\text{C}$ . Hence, to satisfy the cure requirement, it is not necessary to extend heating for as much as 5 min from  $t = t_c$ . If the convection coefficients are increased to  $h_o = h_c = 100 \text{ W/m}^2 \cdot \text{K}$  and an

extended heating period of 300 s is maintained, the numerical integration yields  $t_c = 58$  s and  $t_f = 445$  s. The corresponding time interval over which the panel temperature exceeds  $150^\circ\text{C}$  is  $\Delta t_{(T>150^\circ\text{C})} = 306$  s ( $58 \text{ s} \leq t \leq 364 \text{ s}$ ). If the extended heating period is reduced to 294 s, the numerical integration yields  $t_c = 58$  s,  $t_f = 439$  s, and  $\Delta t_{(T>150^\circ\text{C})} = 300$  s. Hence the total process time is reduced, while the curing requirement is still satisfied.

3. The solution for this example is provided as a ready-to-solve model in *IHT*, with annotations on how the code is written and solved. Look under *Examples* on the *Toolbar*. Note how the *User-Defined Function* feature of *IHT* (\*.udf) is used to represent the time dependence of the ambient temperature in the two-step heating and cooling process, thereby allowing use of a single form of the energy balance relation for the entire process. The model can be used to check the results of Comment 2 or to independently explore modifications of the cure process.

## 5.4

### Spatial Effects

Situations frequently arise for which the lumped capacitance method is inappropriate, and alternative approaches must be used. Regardless of the particular method, we must now cope with the fact that temperature gradients within the medium are no longer negligible.

In their most general form, transient conduction problems are described by the heat equation, Equation 2.17, for rectangular coordinates or Equations 2.24 and 2.27, respectively, for cylindrical and spherical coordinates. The solutions to these partial differential equations provide the variation of temperature with both time and the spatial coordinates. However, in many problems, such as the plane wall of Figure 5.4, only one spatial coordinate is needed to describe the internal temperature distribution. With no internal generation and the assumption of constant thermal conductivity, Equation 2.17 then reduces to

$$\frac{\partial^2 T}{\partial x^2} = \frac{1}{\alpha} \frac{\partial T}{\partial t} \quad (5.26)$$

To solve Equation 5.26 for the temperature distribution  $T(x, t)$ , it is necessary to specify an *initial* condition and two *boundary conditions*. For the typical transient conduction problem of Figure 5.4, the initial condition is

$$T(x, 0) = T_i \quad (5.27)$$

and the boundary conditions are

$$\left. \frac{\partial T}{\partial x} \right|_{x=0} = 0 \quad (5.28)$$

and

$$-k \frac{\partial T}{\partial x} \Big|_{x=L} = h[T(L, t) - T_{\infty}] \quad (5.29)$$

Equation 5.27 presumes a uniform temperature distribution at time  $t = 0$ ; Equation 5.28 reflects the *symmetry requirement* for the midplane of the wall; and Equation 5.29 describes the surface condition experienced for time  $t > 0$ . From Equations 5.26 through 5.29, it is evident that, in addition to depending on  $x$  and  $t$ , temperatures in the wall also depend on a number of physical parameters. In particular

$$T = T(x, t, T_i, T_{\infty}, L, k, \alpha, h) \quad (5.30)$$

The foregoing problem may be solved analytically or numerically. These methods will be considered in subsequent sections, but first it is important to note the advantages that may be obtained by *nondimensionalizing* the governing equations. This may be done by arranging the relevant variables into suitable *groups*. Consider the dependent variable  $T$ . If the temperature difference  $\theta \equiv T - T_{\infty}$  is divided by the *maximum possible temperature difference*  $\theta_i \equiv T_i - T_{\infty}$ , a dimensionless form of the dependent variable may be defined as

$$\theta^* \equiv \frac{\theta}{\theta_i} = \frac{T - T_{\infty}}{T_i - T_{\infty}} \quad (5.31)$$

Accordingly,  $\theta^*$  must lie in the range  $0 \leq \theta^* \leq 1$ . A dimensionless spatial coordinate may be defined as

$$x^* \equiv \frac{x}{L} \quad (5.32)$$

where  $L$  is the half-thickness of the plane wall, and a dimensionless time may be defined as

$$t^* \equiv \frac{\alpha t}{L^2} \equiv Fo \quad (5.33)$$

where  $t^*$  is equivalent to the dimensionless *Fourier number*, Equation 5.12.

Substituting the definitions of Equations 5.31 through 5.33 into Equations 5.26 through 5.29, the heat equation becomes

$$\frac{\partial^2 \theta^*}{\partial x^{*2}} = \frac{\partial \theta^*}{\partial Fo} \quad (5.34)$$

and the initial and boundary conditions become

$$\theta^*(x^*, 0) = 1 \quad (5.35)$$

$$\frac{\partial \theta^*}{\partial x^*} \Big|_{x^*=0} = 0 \quad (5.36)$$

and

$$\frac{\partial \theta^*}{\partial x^*} \Big|_{x^*=1} = -Bi \theta^*(1, t^*) \quad (5.37)$$

where the *Biot number* is  $Bi \equiv hL/k$ . In dimensionless form the functional dependence may now be expressed as

$$\theta^* = f(x^*, Fo, Bi) \quad (5.38)$$

Recall that a similar functional dependence, without the  $x^*$  variation, was obtained for the lumped capacitance method, as shown in Equation 5.13.

Although the Fourier number may be viewed as a dimensionless time, it has an important physical interpretation when used in problems for which heat transfer by conduction through a solid is concurrent with thermal energy storage by the solid. With a characteristic length of  $L$ , the temperature gradient across a solid and the cross-sectional area perpendicular to conduction heat transfer may be approximated as  $\Delta T/L$  and  $L^2$ , respectively. Hence, as a first-order approximation, the heat rate may be expressed as  $q \sim kL^2\Delta T/L$ . Similarly, with the volume of the solid represented as  $V \sim L^3$ , the rate of change of thermal energy storage by the solid may be approximated as  $\dot{E}_{st} \sim \rho L^3 c \Delta T/t$ . It follows that  $(q/\dot{E}_{st}) \sim kt/\rho c L^2 = \alpha t/L^2 = Fo$ . Hence, the Fourier number provides a measure of the relative effectiveness with which a solid conducts and stores thermal energy.

Comparing Equations 5.30 and 5.38, the considerable advantage associated with casting the problem in dimensionless form becomes apparent. Equation 5.38 implies that *for a prescribed geometry, the transient temperature distribution is a universal function of  $x^*$ ,  $Fo$ , and  $Bi$* . That is, the *dimensionless solution* has a prescribed form that does not depend on the particular value of  $T_i$ ,  $T_\infty$ ,  $L$ ,  $k$ ,  $\alpha$ , or  $h$ . Since this generalization greatly simplifies the presentation and utilization of transient solutions, the dimensionless variables are used extensively in subsequent sections.


## 5.5

### The Plane Wall with Convection

Exact, analytical solutions to transient conduction problems have been obtained for many simplified geometries and boundary conditions and are well documented [1–4]. Several mathematical techniques, including the method of separation of variables (Section 4.2), may be used for this purpose, and typically the solution for the dimensionless temperature distribution, Equation 5.38, is in the form of an infinite series. However, except for very small values of the Fourier number, this series may be approximated by a single term.

#### 5.5.1 Exact Solution

Consider the *plane wall* of thickness  $2L$  (Figure 5.6a). If the thickness is small relative to the width and height of the wall, it is reasonable to assume that conduction occurs exclusively in the  $x$  direction. If the wall is initially at a uniform temperature,  $T(x, 0) = T_i$ , and is suddenly immersed in a fluid of  $T_\infty \neq T_i$ , the resulting temperatures may be obtained by solving Equation 5.34 subject to the conditions of Equations 5.35 through 5.37. Since the convection conditions for the surfaces at

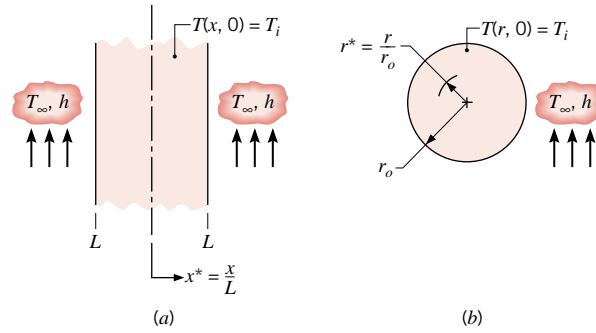

**FIGURE 5.6** One-dimensional systems with an initial uniform temperature subjected to sudden convection conditions. (a) Plane wall. (b) Infinite cylinder or sphere.

$x^* = \pm 1$  are the same, the temperature distribution at any instant must be symmetrical about the midplane ( $x^* = 0$ ). An exact solution to this problem is of the form [2]

$$\theta^* = \sum_{n=1}^{\infty} C_n \exp(-\zeta_n^2 Fo) \cos(\zeta_n x^*) \quad (5.39a)$$

where  $Fo = \alpha t/L^2$ , the coefficient  $C_n$  is

$$C_n = \frac{4 \sin \zeta_n}{2\zeta_n + \sin(2\zeta_n)} \quad (5.39b)$$

and the discrete values of  $\zeta_n$  (*eigenvalues*) are positive roots of the transcendental equation

$$\zeta_n \tan \zeta_n = Bi \quad (5.39c)$$

The first four roots of this equation are given in Appendix B.3.

### 5.5.2 Approximate Solution

It can be shown (Problem 5.34) that for values of  $Fo > 0.2$ , the infinite series solution, Equation 5.39a, can be approximated by the first term of the series. Invoking this approximation, the dimensionless form of the temperature distribution becomes

$$\theta^* = C_1 \exp(-\zeta_1^2 Fo) \cos(\zeta_1 x^*) \quad (5.40a)$$


or

$$\theta^* = \theta_o^* \cos(\zeta_1 x^*) \quad (5.40b)$$

where  $\theta_o^* \equiv (T_o - T_{\infty})/(T_i - T_{\infty})$  represents the midplane ( $x^* = 0$ ) temperature

$$\theta_o^* = C_1 \exp(-\zeta_1^2 Fo) \quad (5.41)$$

An important implication of Equation 5.40b is that *the time dependence of the temperature at any location within the wall is the same as that of the midplane temperature*. The coefficients  $C_1$  and  $\zeta_1$  are evaluated from Equations 5.39b and 5.39c, respectively, and are given in Table 5.1 for a range of Biot numbers.

 Graphical representations of the one-term approximations are presented in Section 5S.1.



**TABLE 5.1** Coefficients used in the one-term approximation to the series solutions for transient one-dimensional conduction

$Bi^a$	Plane Wall		Infinite Cylinder		Sphere	
	$\zeta_1$ (rad)	$C_1$	$\zeta_1$ (rad)	$C_1$	$\zeta_1$ (rad)	$C_1$
0.01	0.0998	1.0017	0.1412	1.0025	0.1730	1.0030
0.02	0.1410	1.0033	0.1995	1.0050	0.2445	1.0060
0.03	0.1723	1.0049	0.2440	1.0075	0.2991	1.0090
0.04	0.1987	1.0066	0.2814	1.0099	0.3450	1.0120
0.05	0.2218	1.0082	0.3143	1.0124	0.3854	1.0149
0.06	0.2425	1.0098	0.3438	1.0148	0.4217	1.0179
0.07	0.2615	1.0114	0.3709	1.0173	0.4551	1.0209
0.08	0.2791	1.0130	0.3960	1.0197	0.4860	1.0239
0.09	0.2956	1.0145	0.4195	1.0222	0.5150	1.0268
0.10	0.3111	1.0161	0.4417	1.0246	0.5423	1.0298
0.15	0.3779	1.0237	0.5376	1.0365	0.6609	1.0445
0.20	0.4328	1.0311	0.6170	1.0483	0.7593	1.0592
0.25	0.4801	1.0382	0.6856	1.0598	0.8447	1.0737
0.30	0.5218	1.0450	0.7465	1.0712	0.9208	1.0880
0.4	0.5932	1.0580	0.8516	1.0932	1.0528	1.1164
0.5	0.6533	1.0701	0.9408	1.1143	1.1656	1.1441
0.6	0.7051	1.0814	1.0184	1.1345	1.2644	1.1713
0.7	0.7506	1.0919	1.0873	1.1539	1.3525	1.1978
0.8	0.7910	1.1016	1.1490	1.1724	1.4320	1.2236
0.9	0.8274	1.1107	1.2048	1.1902	1.5044	1.2488
1.0	0.8603	1.1191	1.2558	1.2071	1.5708	1.2732
2.0	1.0769	1.1785	1.5994	1.3384	2.0288	1.4793
3.0	1.1925	1.2102	1.7887	1.4191	2.2889	1.6227
4.0	1.2646	1.2287	1.9081	1.4698	2.4556	1.7202
5.0	1.3138	1.2402	1.9898	1.5029	2.5704	1.7870
6.0	1.3496	1.2479	2.0490	1.5253	2.6537	1.8338
7.0	1.3766	1.2532	2.0937	1.5411	2.7165	1.8673
8.0	1.3978	1.2570	2.1286	1.5526	1.7654	1.8920
9.0	1.4149	1.2598	2.1566	1.5611	2.8044	1.9106
10.0	1.4289	1.2620	2.1795	1.5677	2.8363	1.9249
20.0	1.4961	1.2699	2.2881	1.5919	2.9857	1.9781
30.0	1.5202	1.2717	2.3261	1.5973	3.0372	1.9898
40.0	1.5325	1.2723	2.3455	1.5993	3.0632	1.9942
50.0	1.5400	1.2727	2.3572	1.6002	3.0788	1.9962
100.0	1.5552	1.2731	2.3809	1.6015	3.1102	1.9990
$\infty$	1.5708	1.2733	2.4050	1.6018	3.1415	2.0000

<sup>a</sup> $Bi = hL/k$  for the plane wall and  $hr_o/k$  for the infinite cylinder and sphere. See Figure 5.6.

### 5.5.3 Total Energy Transfer

In many situations it is useful to know the total energy that has left (or entered) the wall up to any time  $t$  in the transient process. The conservation of energy requirement,

Equation 1.11b, may be applied for the time interval bounded by the initial condition ( $t = 0$ ) and any time  $t > 0$

$$E_{\text{in}} - E_{\text{out}} = \Delta E_{\text{st}} \quad (5.42)$$

Equating the energy transferred from the wall  $Q$  to  $E_{\text{out}}$  and setting  $E_{\text{in}} = 0$  and  $\Delta E_{\text{st}} = E(t) - E(0)$ , it follows that

$$Q = -[E(t) - E(0)] \quad (5.43a)$$

or

$$Q = - \int \rho c [T(x, t) - T_i] dV \quad (5.43b)$$

where the integration is performed over the volume of the wall. It is convenient to nondimensionalize this result by introducing the quantity

$$Q_o = \rho c V (T_i - T_\infty) \quad (5.44)$$

which may be interpreted as the initial internal energy of the wall relative to the fluid temperature. It is also the *maximum* amount of energy transfer that could occur if the process were continued to time  $t = \infty$ . Hence, assuming constant properties, the ratio of the total energy transferred from the wall over the time interval  $t$  to the maximum possible transfer is

$$\frac{Q}{Q_o} = \int \frac{-[T(x, t) - T_i]}{T_i - T_\infty} \frac{dV}{V} = \frac{1}{V} \int (1 - \theta^*) dV \quad (5.45)$$

Employing the approximate form of the temperature distribution for the plane wall, Equation 5.40b, the integration prescribed by Equation 5.45 can be performed to obtain

$$\frac{Q}{Q_o} = 1 - \frac{\sin \zeta_1}{\zeta_1} \theta_o^* \quad (5.46)$$

where  $\theta_o^*$  can be determined from Equation 5.41, using Table 5.1 for values of the coefficients  $C_1$  and  $\zeta_1$ .

### 5.5.4 Additional Considerations

Because the mathematical problem is precisely the same, the foregoing results may also be applied to a plane wall of thickness  $L$ , which is insulated on one side ( $x^* = 0$ ) and experiences convective transport on the other side ( $x^* = +1$ ). This equivalence is a consequence of the fact that, regardless of whether a symmetrical or an adiabatic requirement is prescribed at  $x^* = 0$ , the boundary condition is of the form  $\partial \theta^* / \partial x^* = 0$ .

It should also be noted that the foregoing results may be used to determine the transient response of a plane wall to a sudden change in *surface* temperature. The process is equivalent to having an infinite convection coefficient, in which case the Biot number is infinite ( $Bi = \infty$ ) and the fluid temperature  $T_\infty$  is replaced by the prescribed surface temperature  $T_s$ .

## 5.6

### Radial Systems with Convection

For an infinite cylinder or sphere of radius  $r_o$  (Figure 5.6b), which is at an initial uniform temperature and experiences a change in convective conditions, results similar to those of Section 5.5 may be developed. That is, an exact series solution may be obtained for the time dependence of the radial temperature distribution, and a one-term approximation may be used for most conditions. The infinite cylinder is an idealization that permits the assumption of one-dimensional conduction in the radial direction. It is a reasonable approximation for cylinders having  $L/r_o \geq 10$ .

#### 5.6.1 Exact Solutions

For a uniform initial temperature and convective boundary conditions, the exact solutions [2] are as follows.

**Infinite Cylinder** In dimensionless form, the temperature is

$$\theta^* = \sum_{n=1}^{\infty} C_n \exp(-\zeta_n^2 Fo) J_0(\zeta_n r^*) \quad (5.47a)$$

where  $Fo = \alpha t/r_o^2$ ,

$$C_n = \frac{2}{\zeta_n} \frac{J_1(\zeta_n)}{J_0^2(\zeta_n) + J_1^2(\zeta_n)} \quad (5.47b)$$

and the discrete values of  $\zeta_n$  are positive roots of the transcendental equation

$$\zeta_n \frac{J_1(\zeta_n)}{J_0(\zeta_n)} = Bi \quad (5.47c)$$

where  $Bi = hr_o/k$ . The quantities  $J_1$  and  $J_0$  are Bessel functions of the first kind and their values are tabulated in Appendix B.4. Roots of the transcendental equation (5.47c) are tabulated by Schneider [2].

**Sphere** Similarly, for the sphere

$$\theta^* = \sum_{n=1}^{\infty} C_n \exp(-\zeta_n^2 Fo) \frac{1}{\zeta_n r^*} \sin(\zeta_n r^*) \quad (5.48a)$$

where  $Fo = \alpha t/r_o^2$ ,

$$C_n = \frac{4[\sin(\zeta_n) - \zeta_n \cos(\zeta_n)]}{2\zeta_n - \sin(2\zeta_n)} \quad (5.48b)$$

and the discrete values of  $\zeta_n$  are positive roots of the transcendental equation

$$1 - \zeta_n \cot \zeta_n = Bi \quad (5.48c)$$

where  $Bi = hr_o/k$ . Roots of the transcendental equation are tabulated by Schneider [2].

### 5.6.2 Approximate Solutions

For the infinite cylinder and sphere, the foregoing series solutions can again be approximated by a single term for  $Fo > 0.2$ . Hence, as for the case of the plane wall, the time dependence of the temperature at any location within the radial system is the same as that of the centerline or centerpoint.

**Infinite Cylinder** The one-term approximation to Equation 5.47a is

$$\theta^* = C_1 \exp(-\zeta_1^2 Fo) J_0(\zeta_1 r^*) \quad (5.49a)$$

or

$$\theta^* = \theta_o^* J_0(\zeta_1 r^*) \quad (5.49b)$$

where  $\theta_o^*$  represents the centerline temperature and is of the form

$$\theta_o^* = C_1 \exp(-\zeta_1^2 Fo) \quad (5.49c)$$

Values of the coefficients  $C_1$  and  $\zeta_1$  have been determined and are listed in Table 5.1 for a range of Biot numbers.

**Sphere** From Equation 5.48a, the one-term approximation is

$$\theta^* = C_1 \exp(-\zeta_1^2 Fo) \frac{1}{\zeta_1 r^*} \sin(\zeta_1 r^*) \quad (5.50a)$$

or

$$\theta^* = \theta_o^* \frac{1}{\zeta_1 r^*} \sin(\zeta_1 r^*) \quad (5.50b)$$

where  $\theta_o^*$  represents the center temperature and is of the form

$$\theta_o^* = C_1 \exp(-\zeta_1^2 Fo) \quad (5.50c)$$

Values of the coefficients  $C_1$  and  $\zeta_1$  have been determined and are listed in Table 5.1 for a range of Biot numbers.

### 5.6.3 Total Energy Transfer


As in Section 5.5.3, an energy balance may be performed to determine the total energy transfer from the infinite cylinder or sphere over the time interval  $\Delta t = t$ . Substituting from the approximate solutions, Equations 5.49b and 5.50b, and introducing  $Q_o$  from Equation 5.44, the results are as follows.


**Infinite Cylinder**

$$\frac{Q}{Q_o} = 1 - \frac{2\theta_o^*}{\zeta_1} J_1(\zeta_1) \quad (5.51)$$

**Sphere**

$$\frac{Q}{Q_o} = 1 - \frac{3\theta_o^*}{\zeta_1^3} [\sin(\zeta_1) - \zeta_1 \cos(\zeta_1)] \quad (5.52)$$

 Graphical representations of the one-term approximations are presented in Section 5S.1.

 Graphical representations of the one-term approximations are presented in Section 5S.1.

Values of the center temperature  $\theta_o^*$  are determined from Equation 5.49c or 5.50c, using the coefficients of Table 5.1 for the appropriate system.

### 5.6.4 Additional Considerations

As for the plane wall, the foregoing results may be used to predict the transient response of long cylinders and spheres subjected to a sudden change in *surface* temperature. Namely, an infinite Biot number is prescribed, and the fluid temperature  $T_\infty$  is replaced by the constant surface temperature  $T_s$ .

#### EXAMPLE 5.4

Consider a steel pipeline (AISI 1010) that is 1 m in diameter and has a wall thickness of 40 mm. The pipe is heavily insulated on the outside, and before the initiation of flow, the walls of the pipe are at a uniform temperature of  $-20^\circ\text{C}$ . With the initiation of flow, hot oil at  $60^\circ\text{C}$  is pumped through the pipe, creating a convective condition corresponding to  $h = 500 \text{ W/m}^2 \cdot \text{K}$  at the inner surface of the pipe.

1. What are the appropriate Biot and Fourier numbers 8 min after the initiation of flow?
2. At  $t = 8 \text{ min}$ , what is the temperature of the exterior pipe surface covered by the insulation?
3. What is the heat flux  $q''$  ( $\text{W/m}^2$ ) to the pipe from the oil at  $t = 8 \text{ min}$ ?
4. How much energy per meter of pipe length has been transferred from the oil to the pipe at  $t = 8 \text{ min}$ ?


#### SOLUTION

**Known:** Wall subjected to sudden change in convective surface condition.

**Find:**

1. Biot and Fourier numbers after 8 min.
2. Temperature of exterior pipe surface after 8 min.
3. Heat flux to the wall at 8 min.
4. Energy transferred to pipe per unit length after 8 min.

**Schematic:**

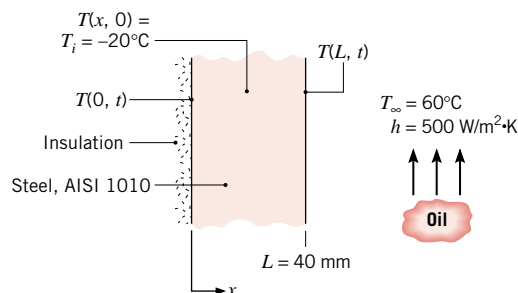

**Assumptions:**

1. Pipe wall can be approximated as plane wall, since thickness is much less than diameter.
2. Constant properties.
3. Outer surface of pipe is adiabatic.

**Properties:** Table A.1, steel type AISI 1010 [ $T = (-20 + 60)^\circ\text{C}/2 \approx 300\text{ K}$ ]:  
 $\rho = 7832\text{ kg/m}^3$ ,  $c = 434\text{ J/kg} \cdot \text{K}$ ,  $k = 63.9\text{ W/m} \cdot \text{K}$ ,  $\alpha = 18.8 \times 10^{-6}\text{ m}^2/\text{s}$ .

**Analysis:**

1. At  $t = 8\text{ min}$ , the Biot and Fourier numbers are computed from Equations 5.10 and 5.12, respectively, with  $L_c = L$ . Hence

$$Bi = \frac{hL}{k} = \frac{500\text{ W/m}^2 \cdot \text{K} \times 0.04\text{ m}}{63.9\text{ W/m} \cdot \text{K}} = 0.313 \quad \triangleleft$$

$$Fo = \frac{\alpha t}{L^2} = \frac{18.8 \times 10^{-6}\text{ m}^2/\text{s} \times 8\text{ min} \times 60\text{ s/min}}{(0.04\text{ m})^2} = 5.64 \quad \triangleleft$$

2. With  $Bi = 0.313$ , use of the lumped capacitance method is inappropriate. However, since  $Fo > 0.2$  and transient conditions in the insulated pipe wall of thickness  $L$  correspond to those in a plane wall of thickness  $2L$  experiencing the same surface condition, the desired results may be obtained from the one-term approximation for a plane wall. The midplane temperature can be determined from Equation 5.41

$$\theta_o^* = \frac{T_o - T_\infty}{T_i - T_\infty} = C_1 \exp(-\zeta_1^2 Fo)$$

where, with  $Bi = 0.313$ ,  $C_1 = 1.047$  and  $\zeta_1 = 0.531\text{ rad}$  from Table 5.1. With  $Fo = 5.64$ ,

$$\theta_o^* = 1.047 \exp[-(0.531\text{ rad})^2 \times 5.64] = 0.214$$

Hence after 8 min, the temperature of the exterior pipe surface, which corresponds to the midplane temperature of a plane wall, is

$$T(0, 8\text{ min}) = T_\infty + \theta_o^*(T_i - T_\infty) = 60^\circ\text{C} + 0.214(-20 - 60)^\circ\text{C} = 42.9^\circ\text{C} \quad \triangleleft$$

3. Heat transfer to the inner surface at  $x = L$  is by convection, and at any time  $t$  the heat flux may be obtained from Newton's law of cooling. Hence at  $t = 480\text{ s}$ ,

$$q_x''(L, 480\text{ s}) \equiv q_L'' = h[T(L, 480\text{ s}) - T_\infty]$$

Using the one-term approximation for the surface temperature, Equation 5.40b with  $x^* = 1$  has the form

$$\theta^* = \theta_o^* \cos(\zeta_1)$$

$$T(L, t) = T_\infty + (T_i - T_\infty)\theta_o^* \cos(\zeta_1)$$

$$T(L, 8\text{ min}) = 60^\circ\text{C} + (-20 - 60)^\circ\text{C} \times 0.214 \times \cos(0.531\text{ rad})$$

$$T(L, 8\text{ min}) = 45.2^\circ\text{C}$$

The heat flux at  $t = 8$  min is then

$$q_L'' = 500 \text{ W/m}^2 \cdot \text{K} (45.2 - 60)^\circ\text{C} = -7400 \text{ W/m}^2 \quad \triangleleft$$

4. The energy transfer to the pipe wall over the 8-min interval may be obtained from Equations 5.44 and 5.46. With

$$\frac{Q}{Q_o} = 1 - \frac{\sin(\xi_1)}{\xi_1} \theta_o^*$$

$$\frac{Q}{Q_o} = 1 - \frac{\sin(0.531 \text{ rad})}{0.531 \text{ rad}} \times 0.214 = 0.80$$

it follows that

$$Q = 0.80 \rho c V (T_i - T_\infty)$$

or with a volume per unit pipe length of  $V' = \pi DL$ ,

$$Q' = 0.80 \rho c \pi DL (T_i - T_\infty)$$

$$Q' = 0.80 \times 7832 \text{ kg/m}^3 \times 434 \text{ J/kg} \cdot \text{K} \\ \times \pi \times 1 \text{ m} \times 0.04 \text{ m} (-20 - 60)^\circ\text{C} \\ Q' = -2.73 \times 10^7 \text{ J/m} \quad \triangleleft$$

### Comments:

1. The minus sign associated with  $q''$  and  $Q'$  simply implies that the direction of heat transfer is from the oil to the pipe (into the pipe wall).
2. The foregoing results may be obtained using the *IHT Models, Transient Conduction, Plane Wall* option. The model provides for calculation of the temperature distribution,  $T(x, t)$ , the heat flux distribution,  $q_x''(x, t)$ , and the amount of energy transferred from the wall,  $Q(t)$ . Substituting the appropriate input parameters for the wall geometry, thermophysical properties and thermal conditions, the model yields the following results:

$$\begin{aligned} T(0, 8 \text{ min}) &= 43.1^\circ\text{C} & q_L''(L, 8 \text{ min}) &= q_L'' = -7305 \text{ W/m}^2 \\ T(L, 8 \text{ min}) &= 45.4^\circ\text{C} & Q'(8 \text{ min}) &= -2.724 \times 10^7 \text{ J/m} \end{aligned}$$

Since the *IHT* model uses a multiple-term approximation to the series solution, the results are more accurate than those obtained from the foregoing one-term approximation. The complete solution for this example is provided as a ready-to-solve model in *IHT*, with annotations on how the code is written and solved (see *Examples*). *IHT Models for Transient Conduction* are also provided for the radial systems treated in Section 5.6.

### EXAMPLE 5.5

A new process for treatment of a special material is to be evaluated. The material, a sphere of radius  $r_o = 5$  mm, is initially in equilibrium at  $400^\circ\text{C}$  in a furnace. It is suddenly removed from the furnace and subjected to a two-step cooling process.

**Step 1** Cooling in air at  $20^\circ\text{C}$  for a period of time  $t_a$  until the center temperature reaches a critical value,  $T_a(0, t_a) = 335^\circ\text{C}$ . For this situation, the convective heat transfer coefficient is  $h_a = 10 \text{ W/m}^2 \cdot \text{K}$ .

After the sphere has reached this critical temperature, the second step is initiated.

**Step 2** Cooling in a well-stirred water bath at  $20^\circ\text{C}$ , with a convective heat transfer coefficient of  $h_w = 6000 \text{ W/m}^2 \cdot \text{K}$ .

The thermophysical properties of the material are  $\rho = 3000 \text{ kg/m}^3$ ,  $k = 20 \text{ W/m} \cdot \text{K}$ ,  $c = 1000 \text{ J/kg} \cdot \text{K}$ , and  $\alpha = 6.66 \times 10^{-6} \text{ m}^2/\text{s}$ .

1. Calculate the time  $t_a$  required for step 1 of the cooling process to be completed.
2. Calculate the time  $t_w$  required during step 2 of the process for the center of the sphere to cool from  $335^\circ\text{C}$  (the condition at the completion of step 1) to  $50^\circ\text{C}$ .


### SOLUTION

**Known:** Temperature requirements for cooling a sphere.

**Find:**

1. Time  $t_a$  required to accomplish desired cooling in air.
2. Time  $t_w$  required to complete cooling in water bath.

**Schematic:**

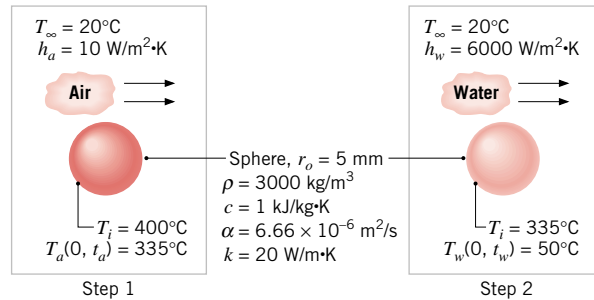

**Assumptions:**

1. One-dimensional conduction in  $r$ .
2. Constant properties.

**Analysis:**

1. To determine whether the lumped capacitance method can be used, the Biot number is calculated. From Equation 5.10, with  $L_c = r_o/3$ ,

$$Bi = \frac{h_a r_o}{3k} = \frac{10 \text{ W/m}^2 \cdot \text{K} \times 0.005 \text{ m}}{3 \times 20 \text{ W/m} \cdot \text{K}} = 8.33 \times 10^{-4}$$



Accordingly, the lumped capacitance method may be used, and the temperature is nearly uniform throughout the sphere. From Equation 5.5 it follows that

$$t_a = \frac{\rho V c}{h_a A_s} \ln \frac{\theta_i}{\theta_a} = \frac{\rho r_o c}{3 h_a} \ln \frac{T_i - T_\infty}{T_a - T_\infty}$$

where  $V = (4/3)\pi r_o^3$  and  $A_s = 4\pi r_o^2$ . Hence

$$t_a = \frac{3000 \text{ kg/m}^3 \times 0.005 \text{ m} \times 1000 \text{ J/kg} \cdot \text{K}}{3 \times 10 \text{ W/m}^2 \cdot \text{K}} \ln \frac{400 - 20}{335 - 20} = 94 \text{ s} \quad \triangleleft$$

2. To determine whether the lumped capacitance method may also be used for the second step of the cooling process, the Biot number is again calculated. In this case

$$Bi = \frac{h_w r_o}{3k} = \frac{6000 \text{ W/m}^2 \cdot \text{K} \times 0.005 \text{ m}}{3 \times 20 \text{ W/m} \cdot \text{K}} = 0.50$$

and the lumped capacitance method is not appropriate. However, to an excellent approximation, the temperature of the sphere is uniform at  $t = t_a$  and the one-term approximation may be used for the calculations. The time  $t_w$  at which the center temperature reaches  $50^\circ\text{C}$ , that is,  $T(0, t_w) = 50^\circ\text{C}$ , can be obtained by rearranging Equation 5.50c

$$Fo = -\frac{1}{\zeta_1^2} \ln \left[ \frac{\theta_o^*}{C_1} \right] = -\frac{1}{\zeta_1^2} \ln \left[ \frac{1}{C_1} \times \frac{T(0, t_w) - T_\infty}{T_i - T_\infty} \right]$$

where  $t_w = Fo r_o^2 / \alpha$ . With the Biot number now defined as

$$Bi = \frac{h_w r_o}{k} = \frac{6000 \text{ W/m}^2 \cdot \text{K} \times 0.005 \text{ m}}{20 \text{ W/m} \cdot \text{K}} = 1.50$$

Table 5.1 yields  $C_1 = 1.376$  and  $\zeta_1 = 1.800$  rad. It follows that

$$Fo = -\frac{1}{(1.800 \text{ rad})^2} \ln \left[ \frac{1}{1.376} \times \frac{(50 - 20)^\circ\text{C}}{(335 - 20)^\circ\text{C}} \right] = 0.82$$

and

$$t_w = Fo \frac{r_o^2}{\alpha} = 0.82 \frac{(0.005 \text{ m})^2}{6.66 \times 10^{-6} \text{ m}^2/\text{s}} = 3.1 \text{ s} \quad \triangleleft$$

Note that, with  $Fo = 0.82$ , use of the one-term approximation is justified.

### Comments:


1. If the temperature distribution in the sphere at the conclusion of step 1 were not uniform, the one-term approximation could not be used for the calculations of step 2.
2. The surface temperature of the sphere at the conclusion of step 2 may be obtained from Equation 5.50b. With  $\theta_o^* = 0.095$  and  $r^* = 1$ ,

$$\theta^*(r_o) = \frac{T(r_o) - T_\infty}{T_i - T_\infty} = \frac{0.095}{1.800 \text{ rad}} \sin(1.800 \text{ rad}) = 0.0514$$

and

$$T(r_o) = 20^\circ\text{C} + 0.0514(335 - 20)^\circ\text{C} = 36^\circ\text{C}$$

The infinite series, Equation 5.48a, and its one-term approximation, Equation 5.50b, may be used to compute the temperature at any location in the sphere and at any time  $t > t_a$ . For  $(t - t_a) < 0.2(0.005 \text{ m})^2/6.66 \times 10^{-6} \text{ m}^2/\text{s} = 0.75 \text{ s}$ , a sufficient number of terms must be retained to ensure convergence of the series. For  $(t - t_a) > 0.75 \text{ s}$ , satisfactory convergence is provided by the one-term approximation. Computing and plotting the temperature histories for  $r = 0$  and  $r = r_o$ , we obtain the following results for  $0 \leq (t - t_a) \leq 5 \text{ s}$ :

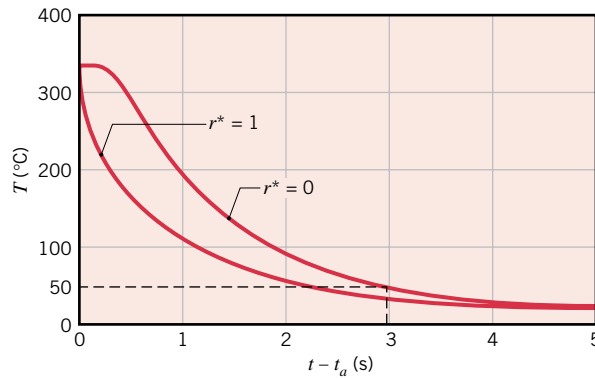


3. The *IHT Models, Transient Conduction, Sphere* option could be used to analyze the cooling processes experienced by the sphere in air and water, steps 1 and 2. The *IHT Models, Lumped Capacitance* option may only be used to analyze the air-cooling process, step 1.

## 5.7

### The Semi-Infinite Solid

Another simple geometry for which analytical solutions may be obtained is the *semi-infinite solid*. Since, in principle, such a solid extends to infinity in all but one direction, it is characterized by a single identifiable surface (Figure 5.7). If a sudden change of conditions is imposed at this surface, transient, one-dimensional conduction will occur within the solid. The semi-infinite solid provides a *useful idealization* for many practical problems. It may be used to determine transient heat transfer near the surface of the earth or to approximate the transient response of a finite solid, such as a thick slab. For this second situation the approximation would be reasonable for the early portion of the transient, during which temperatures in the slab interior (well removed from the surface) are essentially uninfluenced by the change in surface conditions.

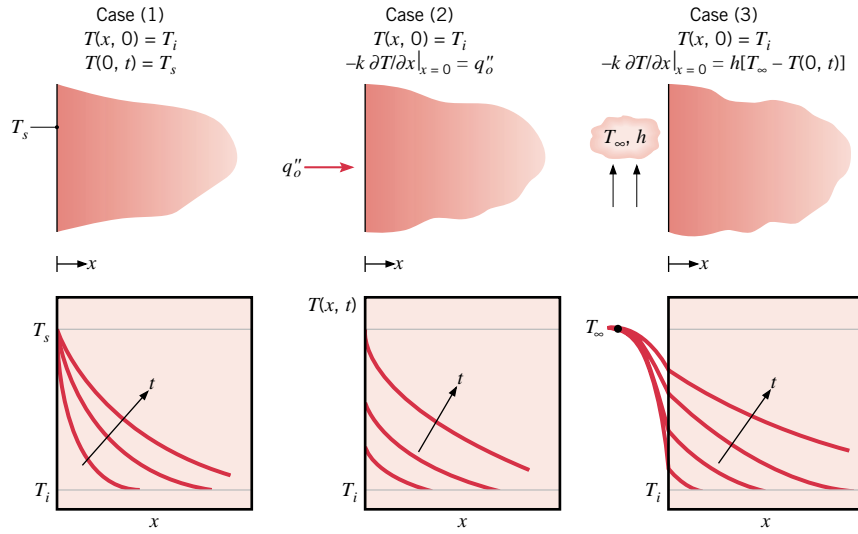

**FIGURE 5.7** Transient temperature distributions in a semi-infinite solid for three surface conditions: constant surface temperature, constant surface heat flux, and surface convection.

The heat equation for transient conduction in a semi-infinite solid is given by Equation 5.26. The initial condition is prescribed by Equation 5.27, and the interior boundary condition is of the form

$$T(x \rightarrow \infty, t) = T_i \quad (5.53)$$

Closed-form solutions have been obtained for three important surface conditions, instantaneously applied at  $t = 0$  [1, 2]. These conditions are shown in Figure 5.7. They include application of a constant surface temperature  $T_s \neq T_i$ , application of a constant surface heat flux  $q_o''$ , and exposure of the surface to a fluid characterized by  $T_\infty \neq T_i$  and the convection coefficient  $h$ .

The solution for case 1 may be obtained by recognizing the existence of a *similarity variable*  $\eta$ , through which the heat equation may be transformed from a partial differential equation, involving two independent variables ( $x$  and  $t$ ), to an ordinary differential equation expressed in terms of the single similarity variable. To confirm that such a requirement is satisfied by  $\eta \equiv x/(4\alpha t)^{1/2}$ , we first transform the pertinent differential operators, such that

$$\begin{aligned} \frac{\partial T}{\partial x} &= \frac{dT}{d\eta} \frac{\partial \eta}{\partial x} = \frac{1}{(4\alpha t)^{1/2}} \frac{dT}{d\eta} \\ \frac{\partial^2 T}{\partial x^2} &= \frac{d}{d\eta} \left[ \frac{\partial T}{\partial x} \right] \frac{\partial \eta}{\partial x} = \frac{1}{4\alpha t} \frac{d^2 T}{d\eta^2} \\ \frac{\partial T}{\partial t} &= \frac{dT}{d\eta} \frac{\partial \eta}{\partial t} = -\frac{x}{2t(4\alpha t)^{1/2}} \frac{dT}{d\eta} \end{aligned}$$

Substituting into Equation 5.26, the heat equation becomes

$$\frac{d^2 T}{d\eta^2} = -2\eta \frac{dT}{d\eta} \quad (5.54)$$

With  $x = 0$  corresponding to  $\eta = 0$ , the surface condition may be expressed as

$$T(\eta = 0) = T_s \quad (5.55)$$

and with  $x \rightarrow \infty$ , as well as  $t = 0$ , corresponding to  $\eta \rightarrow \infty$ , both the initial condition and the interior boundary condition correspond to the single requirement that

$$T(\eta \rightarrow \infty) = T_i \quad (5.56)$$

Since the transformed heat equation and the initial/boundary conditions are independent of  $x$  and  $t$ ,  $\eta \equiv x/(4\alpha t)^{1/2}$  is, indeed, a similarity variable. Its existence implies that, irrespective of the values of  $x$  and  $t$ , the temperature may be represented as a unique function of  $\eta$ .

The specific form of the temperature dependence,  $T(\eta)$ , may be obtained by separating variables in Equation 5.54, such that

$$\frac{d(dT/d\eta)}{(dT/d\eta)} = -2\eta \, d\eta$$

Integrating, it follows that

$$\ln(dT/d\eta) = -\eta^2 + C_1'$$

or

$$\frac{dT}{d\eta} = C_1 \exp(-\eta^2)$$

Integrating a second time, we obtain

$$T = C_1 \int_0^\eta \exp(-u^2) \, du + C_2$$

where  $u$  is a dummy variable. Applying the boundary condition at  $\eta = 0$ , Equation 5.55, it follows that  $C_2 = T_s$  and

$$T = C_1 \int_0^\eta \exp(-u^2) \, du + T_s$$

From the second boundary condition, Equation 5.56, we obtain

$$T_i = C_1 \int_0^\infty \exp(-u^2) \, du + T_s$$

or, evaluating the definite integral,

$$C_1 = \frac{2(T_i - T_s)}{\pi^{1/2}}$$

Hence the temperature distribution may be expressed as

$$\frac{T - T_s}{T_i - T_s} = (2/\pi^{1/2}) \int_0^\eta \exp(-u^2) \, du \equiv \text{erf } \eta \quad (5.57)$$

where the *Gaussian error function*,  $\text{erf } \eta$ , is a standard mathematical function that is tabulated in Appendix B. Note that  $\text{erf}(\eta)$  asymptotically approaches unity as  $\eta$  becomes infinite. Thus, at any nonzero time, temperatures everywhere are predicted to have changed from  $T_i$  (become closer to  $T_s$ ). The infinite speed at which

boundary-condition information propagates into the semi-infinite solid is physically unrealistic, but this limitation of Fourier's law is not important except at extremely small time scales, as discussed in Section 2.3. The surface heat flux may be obtained by applying Fourier's law at  $x = 0$ , in which case

$$\begin{aligned} q_s'' &= -k \frac{\partial T}{\partial x} \Big|_{x=0} = -k(T_i - T_s) \frac{d(\operatorname{erf} \eta)}{d\eta} \frac{\partial \eta}{\partial x} \Big|_{\eta=0} \\ q_s'' &= k(T_s - T_i)(2/\pi^{1/2})\exp(-\eta^2)(4\alpha t)^{-1/2} \Big|_{\eta=0} \\ q_s'' &= \frac{k(T_s - T_i)}{(\pi\alpha t)^{1/2}} \end{aligned} \quad (5.58)$$

Analytical solutions may also be obtained for the case 2 and case 3 surface conditions, and results for all three cases are summarized as follows.

**Case 1 Constant Surface Temperature:**  $T(0, t) = T_s$

$$\frac{T(x, t) - T_s}{T_i - T_s} = \operatorname{erf}\left(\frac{x}{2\sqrt{\alpha t}}\right) \quad (5.57)$$

$$q_s''(t) = \frac{k(T_s - T_i)}{\sqrt{\pi\alpha t}} \quad (5.58)$$

**Case 2 Constant Surface Heat Flux:**  $q_s'' = q_o''$


$$T(x, t) - T_i = \frac{2q_o''(\alpha t/\pi)^{1/2}}{k} \exp\left(\frac{-x^2}{4\alpha t}\right) - \frac{q_o'' x}{k} \operatorname{erfc}\left(\frac{x}{2\sqrt{\alpha t}}\right) \quad (5.59)$$

**Case 3 Surface Convection:**  $-k \frac{\partial T}{\partial x} \Big|_{x=0} = h[T_\infty - T(0, t)]$

$$\begin{aligned} \frac{T(x, t) - T_i}{T_\infty - T_i} &= \operatorname{erfc}\left(\frac{x}{2\sqrt{\alpha t}}\right) \\ &\quad - \left[ \exp\left(\frac{hx}{k} + \frac{h^2\alpha t}{k^2}\right) \right] \left[ \operatorname{erfc}\left(\frac{x}{2\sqrt{\alpha t}} + \frac{h\sqrt{\alpha t}}{k}\right) \right] \end{aligned} \quad (5.60)$$

The *complementary error function*,  $\operatorname{erfc} w$ , is defined as  $\operatorname{erfc} w \equiv 1 - \operatorname{erf} w$ .

Temperature histories for the three cases are shown in Figure 5.7, and distinguishing features should be noted. With a step change in the surface temperature, case 1, temperatures within the medium monotonically approach  $T_s$  with increasing  $t$ , while the magnitude of the surface temperature gradient, and hence the surface heat flux, decreases as  $t^{-1/2}$ . In contrast, for a fixed surface heat flux (case 2), Equation 5.59 reveals that  $T(0, t) = T_s(t)$  increases monotonically as  $t^{1/2}$ . For surface convection (case 3), the surface temperature and temperatures within the medium approach the fluid temperature  $T_\infty$  with increasing time. As  $T_s$  approaches  $T_\infty$ , there is, of course, a reduction in the surface heat flux,  $q_s''(t) = h[T_\infty - T_s(t)]$ . Specific temperature histories computed from Equation 5.60 are plotted in Figure 5.8. The result corresponding to  $h = \infty$  is equivalent to that associated with a sudden change

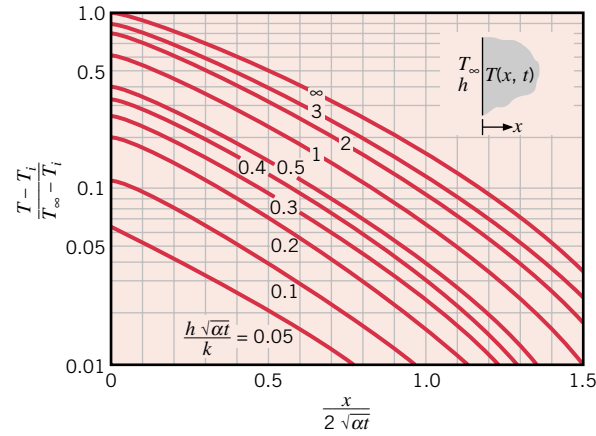

**FIGURE 5.8**

Temperature histories in a semi-infinite solid with surface convection [2]. Adapted with permission.

in surface temperature, case 1. That is, for  $h = \infty$ , the surface instantaneously achieves the imposed fluid temperature ( $T_s = T_\infty$ ), and with the second term on the right-hand side of Equation 5.60 reducing to zero, the result is equivalent to Equation 5.57.


An interesting permutation of case 1 results when two semi-infinite solids, initially at uniform temperatures  $T_{A,i}$  and  $T_{B,i}$ , are placed in contact at their free surfaces (Figure 5.9). If the contact resistance is negligible, the requirement of thermal equilibrium dictates that, at the instant of contact ( $t = 0$ ), both surfaces must assume the same temperature  $T_s$ , for which  $T_{B,i} < T_s < T_{A,i}$ . Since  $T_s$  does not change with increasing time, it follows that the transient thermal response and the surface heat flux of each of the solids are determined by Equations 5.57 and 5.58, respectively.

The equilibrium surface temperature of Figure 5.9 may be determined from a surface energy balance, which requires that

$$q''_{s,A} = q''_{s,B} \quad (5.61)$$

Substituting from Equation 5.58 for  $q''_{s,A}$  and  $q''_{s,B}$  and recognizing that the  $x$  coordinate of Figure 5.9 requires a sign change for  $q''_{s,A}$ , it follows that

$$\frac{-k_A(T_s - T_{A,i})}{(\pi\alpha_A t)^{1/2}} = \frac{k_B(T_s - T_{B,i})}{(\pi\alpha_B t)^{1/2}} \quad (5.62)$$

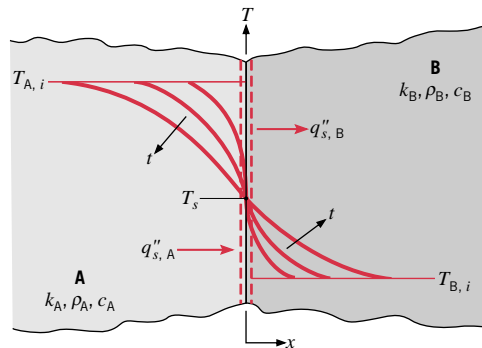

**FIGURE 5.9**

Interfacial contact between two semi-infinite solids at different initial temperatures.

or, solving for  $T_s$ ,

$$T_s = \frac{(k\rho c)_A^{1/2} T_{A,i} + (k\rho c)_B^{1/2} T_{B,i}}{(k\rho c)_A^{1/2} + (k\rho c)_B^{1/2}} \quad (5.63)$$

Hence the quantity  $m \equiv (k\rho c)^{1/2}$  is a weighting factor that determines whether  $T_s$  will more closely approach  $T_{A,i}$  ( $m_A > m_B$ ) or  $T_{B,i}$  ( $m_B > m_A$ ).

### EXAMPLE 5.6


In laying water mains, utilities must be concerned with the possibility of freezing during cold periods. Although the problem of determining the temperature in soil as a function of time is complicated by changing surface conditions, reasonable estimates can be based on the assumption of a constant surface temperature over a prolonged period of cold weather. What minimum burial depth  $x_m$  would you recommend to avoid freezing under conditions for which soil, initially at a uniform temperature of  $20^\circ\text{C}$ , is subjected to a constant surface temperature of  $-15^\circ\text{C}$  for 60 days?

### SOLUTION

**Known:** Temperature imposed at the surface of soil initially at  $20^\circ\text{C}$ .

**Find:** The depth  $x_m$  to which the soil has frozen after 60 days.

**Schematic:**

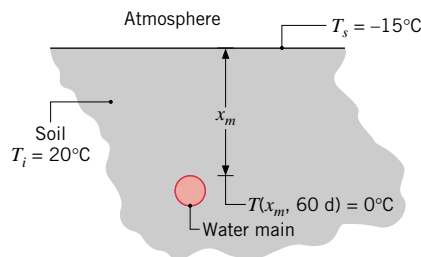

**Assumptions:**

1. One-dimensional conduction in  $x$ .
2. Soil is a semi-infinite medium.
3. Constant properties.

**Properties:** Table A.3, soil (300 K):  $\rho = 2050 \text{ kg/m}^3$ ,  $k = 0.52 \text{ W/m} \cdot \text{K}$ ,  $c = 1840 \text{ J/kg} \cdot \text{K}$ ,  $\alpha = (k/\rho c) = 0.138 \times 10^{-6} \text{ m}^2/\text{s}$ .

**Analysis:** The prescribed conditions correspond to those of case 1 of Figure 5.7, and the transient temperature response of the soil is governed by Equation 5.57. Hence at the time  $t = 60$  days after the surface temperature change,

$$\frac{T(x_m, t) - T_s}{T_i - T_s} = \text{erf}\left(\frac{x_m}{2\sqrt{\alpha t}}\right)$$

or

$$\frac{0 - (-15)}{20 - (-15)} = 0.429 = \operatorname{erf}\left(\frac{x_m}{2\sqrt{\alpha t}}\right)$$

Hence, from Appendix B.2

$$\frac{x_m}{2\sqrt{\alpha t}} = 0.40$$


and

$$x_m = 0.80(\alpha t)^{1/2} = 0.80(0.138 \times 10^{-6} \text{ m}^2/\text{s} \times 60 \text{ days} \times 24 \text{ h/day} \times 3600 \text{ s/h})^{1/2} = 0.68 \text{ m}$$




**Comments:**

1. The properties of soil are highly variable, depending on the nature of the soil and its moisture content, and a representative range of thermal diffusivities is  $1 \times 10^{-7} < \alpha < 3 \times 10^{-7} \text{ m}^2/\text{s}$ . To assess the effect of soil properties on freezing conditions, we use Equation 5.57 to compute temperature histories at  $x_m = 0.68 \text{ m}$  for  $\alpha \times 10^7 = 1.0, 1.38, \text{ and } 3.0 \text{ m}^2/\text{s}$ .

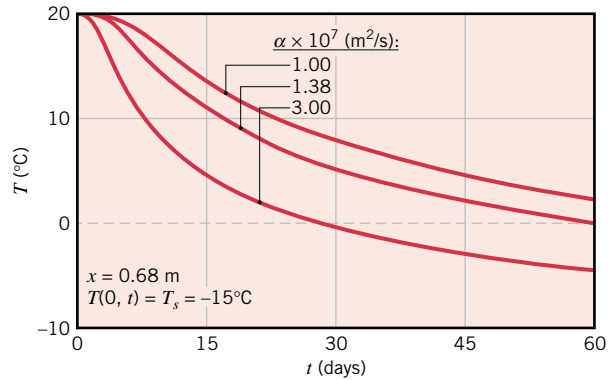

If  $\alpha > 1.38 \times 10^{-7} \text{ m}^2/\text{s}$ , the design criterion is not achieved at  $x_m = 0.68 \text{ m}$  and freezing would occur. It is also instructional to examine temperature distributions in the soil at representative times during the cooling period. Using Equation 5.57 with  $\alpha = 1.38 \times 10^{-7} \text{ m}^2/\text{s}$ , the following results are obtained:

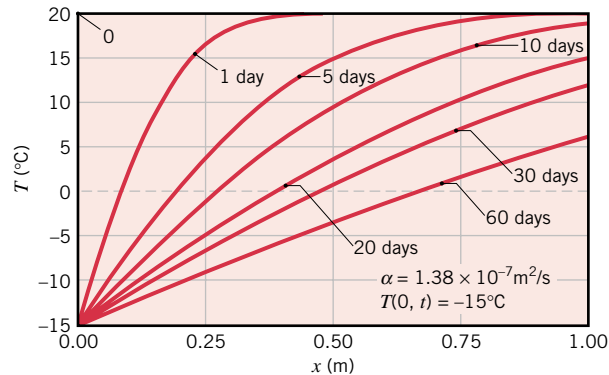



As thermal penetration increases with increasing time, the temperature gradient at the surface,  $\partial T/\partial x|_{x=0}$ , and hence the rate of heat extraction from the soil, decreases.

2. The *IHT Models, Transient Conduction, Semi-infinite Solid* option may be used to generate the foregoing numerical results. The option provides model builders for the three boundary conditions of *constant surface temperature*, *constant surface heat flux*, and *surface convection*.

## 5.8

### Objects with Constant Surface Temperatures or Surface Heat Fluxes

In Sections 5.5 and 5.6, the transient thermal response of plane walls, cylinders, and spheres to an applied convection boundary condition was considered in detail. It was pointed out that the solutions in those sections may be used for cases involving a step change in surface temperature by allowing the Biot number to be infinite. In Section 5.7, the response of a semi-infinite solid to a step change in surface temperature, or to an applied constant heat flux, was determined. This section further explores the transient thermal response of a variety of objects to a constant surface temperature or a constant surface heat flux boundary condition.

#### 5.8.1 Constant Temperature Boundary Conditions

In the following discussion, the transient thermal response of objects to a step change in surface temperature is considered.


**Semi-Infinite Solid** Insight into the thermal response of objects to an applied constant temperature boundary condition may be obtained by casting the heat flux in Equation 5.58 into the nondimensional form

$$q^* \equiv \frac{q_s'' L_c}{k(T_s - T_i)} \quad (5.64)$$

where  $L_c$  is a *characteristic length* and  $q^*$  is the *dimensionless conduction heat rate* that was introduced in Section 4.3.3. Substituting Equation 5.64 into Equation 5.58 yields

$$q^* = \frac{1}{\sqrt{\pi Fo}} \quad (5.65)$$

where the Fourier number is defined as  $Fo \equiv \alpha t/L_c^2$ . Note that the value of  $q_s''$  is independent of the choice of the characteristic length, as it must be for a semi-infinite solid. Equation 5.65 is plotted in Figure 5.10a, and since  $q^* \propto Fo^{-1/2}$ , the slope of the line is  $-1/2$  on the log-log plot.

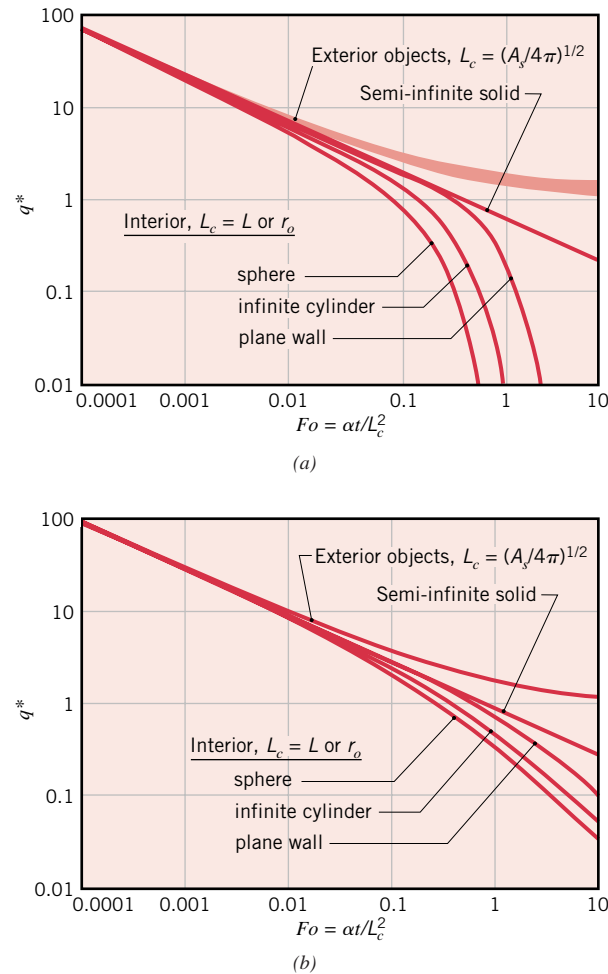

**FIGURE 5.10** Transient dimensionless conduction heat rates for a variety of geometries. (a) Constant surface temperature. Results for the geometries of Table 4.1 lie within the shaded region and are from [5]. (b) Constant surface heat flux.

**Interior Heat Transfer: Plane Wall, Cylinder, and Sphere** Results for heat transfer to the *interior* of a plane wall, cylinder, and sphere are also shown in Figure 5.10a. These results are generated by using Fourier's law in conjunction with Equations 5.39, 5.47, and 5.48 for  $Bi \rightarrow \infty$ . As in Sections 5.5 and 5.6, the characteristic length is  $L_c = L$  or  $r_o$  for a plane wall of thickness  $2L$  or a cylinder (or sphere) of radius  $r_o$ , respectively. For each geometry,  $q^*$  initially follows the semi-infinite solid solution but at some point decreases rapidly as the objects approach their equilibrium temperature and  $q_s''(t \rightarrow \infty) \rightarrow 0$ . The value of  $q^*$  is expected to decrease more rapidly for geometries that possess large surface area to volume ratios, and this trend is evident in Figure 5.10a.

**Exterior Heat Transfer: Various Geometries** Additional results are shown in Figure 5.10a for an object that is embedded in an exterior (surrounding) medium

of infinite extent. The infinite medium is initially at temperature  $T_i$ , and the surface temperature of the object is suddenly changed to  $T_s$ . For the exterior cases,  $L_c$  is the characteristic length used in Section 4.3.3, namely  $L_c = (A_s/4\pi)^{1/2}$ . For the sphere in a surrounding infinite medium, the exact solution for  $q^*(Fo)$  is [5]

$$q^* = \frac{1}{\sqrt{\pi Fo}} + 1 \quad (5.66)$$

As seen in the figure, for all of the *exterior cases*  $q^*$  closely mimics that of the sphere when the appropriate length scale is used in its definition, regardless of the object's shape. In a manner consistent with the interior cases,  $q^*$  initially follows the semi-infinite solid solution. In contrast to the interior cases,  $q^*$  eventually reaches the nonzero, steady-state value of  $q_{ss}^*$  that is listed in Table 4.1. Note that  $q_s''$  in Equation 5.64 is the *average* surface heat flux for geometries that have nonuniform surface heat flux.

As seen in Figure 5.10a, all of the thermal responses collapse to that of the semi-infinite solid for early times, that is, for  $Fo$  less than approximately  $10^{-3}$ . This remarkable consistency reflects the fact that temperature variations are confined to thin layers adjacent to the surface of any object at early times, regardless of whether internal or external heat transfer is of interest. At early times, therefore, Equations 5.57 and 5.58 may be used to predict the temperatures and heat transfer rates within the thin regions adjacent to the boundaries of any object. For example, predicted local heat fluxes and local dimensionless temperatures using the semi-infinite solid solutions are within approximately 5% of the predictions obtained from the exact solutions for the interior and exterior heat transfer cases involving spheres when  $Fo \leq 10^{-3}$ .

### 5.8.2 Constant Heat Flux Boundary Conditions

When a constant surface heat flux is applied to an object, the resulting surface temperature history is often of interest. In this case, the heat flux in the numerator of Equation 5.64 is now constant, and the temperature difference in the denominator,  $T_s - T_i$ , increases with time.

**Semi-Infinite Solid** In the case of a semi-infinite solid, the surface temperature history can be found by evaluating Equation 5.59 at  $x = 0$ , which may be re-arranged and combined with Equation 5.64 to yield

$$q^* = \frac{1}{2} \sqrt{\frac{\pi}{Fo}} \quad (5.67)$$

As for the constant temperature case,  $q^* \propto Fo^{-1/2}$ , but with a different coefficient. Equation 5.67 is presented in Figure 5.10b.

**Interior Heat Transfer: Plane Wall, Cylinder, and Sphere** A second set of results is shown in Figure 5.10b for the *interior* cases of the plane wall, cylinder, and sphere. As for the constant surface temperature results of Figure 5.10a,  $q^*$  initially follows the semi-infinite solid solution and subsequently decreases more rapidly, with the decrease occurring first for the sphere, then the cylinder, and finally the plane wall. Compared to the constant surface temperature case, the rate at which  $q^*$  decreases is not as dramatic, since steady-state conditions are never reached; the surface temperature must continue to increase with time. At *late* times (large  $Fo$ ), the surface temperature increases linearly with time, yielding  $q^* \propto Fo^{-1}$ , with a slope of  $-1$  on the log-log plot.

**Exterior Heat Transfer: Various Geometries** Results for heat transfer between a sphere and an exterior infinite medium are also presented in Figure 5.10b. The exact solution for the embedded sphere is

$$q^* = [1 - \exp(Fo) \operatorname{erfc}(Fo^{1/2})]^{-1} \quad (5.68)$$

As in the constant surface temperature case of Figure 5.10a, this solution approaches steady-state conditions, with  $q_{ss}^* = 1$ . For objects of other shapes that are embedded within an infinite medium,  $q^*$  would follow the semi-infinite solid solution at small  $Fo$ . At larger  $Fo$ ,  $q^*$  must asymptotically approach the value of  $q_{ss}^*$  given in Table 4.1 where  $T_s$  in Equation 5.64 is the *average* surface temperature for geometries that have nonuniform surface temperatures.


### 5.8.3 Approximate Solutions

Simple expressions have been developed for  $q^*(Fo)$ . These expressions may be used to approximate all the results included in Figure 5.10 over the *entire range of*  $Fo$ . These expressions are listed in Table 5.2, along with the corresponding exact solutions. Table 5.2a is for the constant surface temperature case, while Table 5.2b is for the constant surface heat flux situation. For each of the geometries listed in the left-hand column, the tables provide the length scale to be used in the definition of both  $Fo$  and  $q^*$ , the exact solution for  $q^*(Fo)$ , the approximation solutions for early times ( $Fo < 0.2$ ) and late times ( $Fo \geq 0.2$ ), and the maximum percentage error associated with use of the approximations (which occurs at  $Fo \approx 0.2$  for all results except the external sphere with constant heat flux).

#### EXAMPLE 5.7

A proposed cancer treatment utilizes small, composite *nanoshells* whose size and composition are carefully engineered so that the particles efficiently absorb laser irradiation at particular wavelengths [6]. Prior to treatment, antibodies are attached to the nanoscale particles. The doped particles are then injected into the patient's bloodstream and are distributed throughout the body. The antibodies are attracted to malignant sites, and therefore carry and adhere the nanoshells only to cancerous tissue. After the particles have come to rest within the tumor, a laser beam penetrates through the tissue between the skin and the cancer, is absorbed by the nanoshells, and, in turn, heats and destroys the cancerous tissues.

Consider an approximately spherical tumor of diameter  $D_t = 3$  mm that is uniformly infiltrated with nanoshells that are highly absorptive of incident radiation from a laser located outside the patient's body.

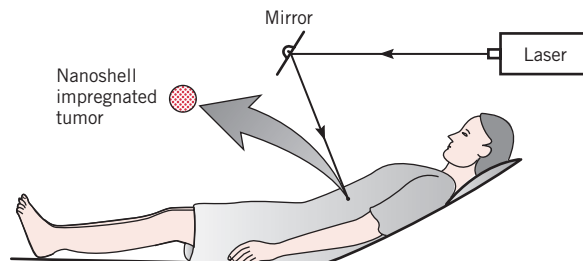

**TABLE 5.2a** Summary of transient heat transfer results for constant surface temperature cases<sup>a</sup>

Geometry	Length Scale, $L_c$	Exact Solutions	$q^*(Fo)$		Maximum Error (%)
			$Fo < 0.2$	$Fo \geq 0.2$	
Semi-infinite	$L$ (arbitrary)	$\frac{1}{\sqrt{\pi Fo}}$	Use exact solution.		none
Interior Cases					
Plane wall of thickness $2L$	$L$	$2 \sum_{n=1}^{\infty} \exp(-\xi_n^2 Fo) \quad \xi_n = (n - \frac{1}{2})\pi$	$\frac{1}{\sqrt{\pi Fo}}$	$2 \exp(-\xi_1^2 Fo) \quad \xi_1 = \pi/2$	1.7
Infinite cylinder	$r_o$	$2 \sum_{n=1}^{\infty} \exp(-\xi_n^2 Fo) \quad J_0(\xi_n) = 0$	$\frac{1}{\sqrt{\pi Fo}}$	$2 \exp(-\xi_1^2 Fo) \quad \xi_1 = 2.4050$	0.8
Sphere	$r_o$	$2 \sum_{n=1}^{\infty} \exp(-\xi_n^2 Fo) \quad \xi_n = n\pi$	$\frac{1}{\sqrt{\pi Fo}}$	$2 \exp(-\xi_1^2 Fo) \quad \xi_1 = \pi$	6.3
Exterior Cases					
Sphere	$r_o$	$\frac{1}{\sqrt{\pi Fo}} + 1$	Use exact solution.		none
Various shapes (Table 4.1, cases 12–15)	$(A_s/4\pi)^{1/2}$	none	$\frac{1}{\sqrt{\pi Fo}} + q_s^*, \quad q_s^*$ from Table 4.1		7.1

<sup>a</sup> $q^* \equiv q'' L_c / k(T_s - T_i)$  and  $Fo \equiv \alpha t / L_c^2$  where  $L_c$  is the length scale given in the table,  $T_s$  is the object surface temperature, and  $T_i$  is (a) the initial object temperature for the interior cases and (b) the temperature of the infinite medium for the exterior cases.

**TABLE 5.2b** Summary of transient heat transfer results for constant surface heat flux cases<sup>a</sup>

Geometry	Length Scale, $L_c$	Exact Solutions	$q^*(Fo)$		Maximum Error (%)
			Approximate Solutions		
			$Fo < 0.2$	$Fo \geq 0.2$	
Semi-infinite	$L$ (arbitrary)	$\frac{1}{2}\sqrt{\frac{\pi}{Fo}}$	Use exact solution.		none
Interior Cases					
	Plane wall of thickness $2L$	$L$	$\xi_n = n\pi$	$\left[Fo + \frac{1}{3}\right]^{-1}$	5.3
	Infinite cylinder	$r_o$	$J_1(\xi_n) = 0$	$\left[2Fo + \frac{1}{4}\right]^{-1}$	2.1
Sphere	$r_o$	$\tan(\xi_n) = \xi_n$		$\left[3Fo + \frac{1}{5}\right]^{-1}$	4.5
Exterior Cases					
Sphere	$r_o$	$[1 - \exp(Fo)\text{erfc}(Fo^{1/2})]^{-1}$	$\frac{1}{2}\sqrt{\frac{\pi}{Fo}} + \frac{\pi}{4}$	$\frac{0.77}{\sqrt{Fo}} + 1$	3.2
Various shapes (Table 4.1, cases 12–15)	$(A_s/4\pi)^{1/2}$	none	$\frac{1}{2}\sqrt{\frac{\pi}{Fo}} + \frac{\pi}{4}$	$\frac{0.77}{\sqrt{Fo}} + q_{ss}^*$	unknown

<sup>a</sup> $q^* \equiv q_s'' L_c / k(T_s - T_i)$  and  $Fo \equiv \alpha t / L_c^2$  where  $L_c$  is the length scale given in the table,  $T_s$  is the object surface temperature, and  $T_i$  is (a) the initial object temperature for the interior cases and (b) the temperature of the infinite medium for the exterior cases.


1. Estimate the heat transfer rate from the tumor to the surrounding healthy tissue for a steady-state treatment temperature of  $T_{t,ss} = 55^\circ\text{C}$  at the surface of the tumor. The thermal conductivity of healthy tissue is approximately  $k = 0.5 \text{ W/m} \cdot \text{K}$ , and the body temperature is  $T_b = 37^\circ\text{C}$ .
2. Find the laser power necessary to sustain the tumor surface temperature at  $T_{t,ss} = 55^\circ\text{C}$  if the tumor is located  $d = 20 \text{ mm}$  beneath the surface of the skin, and the laser heat flux decays exponentially,  $q''_l(x) = q''_{l,o}(1 - \rho)e^{-\kappa x}$ , between the surface of the body and the tumor. In the preceding expression,  $q''_{l,o}$  is the laser heat flux outside the body,  $\rho = 0.05$  is the reflectivity of the skin surface, and  $\kappa = 0.02 \text{ mm}^{-1}$  is the *extinction coefficient* of the tissue between the tumor and the surface of the skin. The laser beam has a diameter of  $D_l = 5 \text{ mm}$ .
3. Neglecting heat transfer to the surrounding tissue, estimate the time at which the tumor temperature is within  $3^\circ\text{C}$  of  $T_{t,ss} = 55^\circ\text{C}$  for the laser power found in part 2. Assume the tissue's density and specific heat are that of water.
4. Neglecting the thermal mass of the tumor but accounting for heat transfer to the surrounding tissue, estimate the time needed for the surface temperature of the tumor to reach  $T_t = 52^\circ\text{C}$ .

**SOLUTION**

**Known:** Size of a small sphere; thermal conductivity, reflectivity, and extinction coefficient of tissue; depth of sphere below the surface of the skin.

**Find:**

1. Heat transferred from the tumor to maintain its surface temperature at  $T_{t,ss} = 55^\circ\text{C}$ .
2. Laser power needed to sustain the tumor surface temperature at  $T_{t,ss} = 55^\circ\text{C}$ .
3. Time for the tumor to reach  $T_t = 52^\circ\text{C}$  when heat transfer to the surrounding tissue is neglected.
4. Time for the tumor to reach  $T_t = 52^\circ\text{C}$  when heat transfer to the surrounding tissue is considered and the thermal mass of the tumor is neglected.

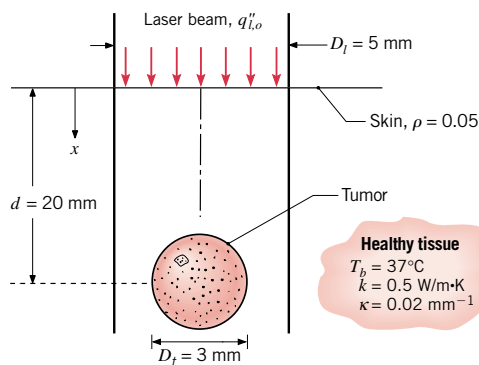**Schematic:**

**Assumptions:**

1. One-dimensional conduction in the radial direction.
2. Constant properties.
3. Healthy tissue can be treated as an infinite medium.
4. The treated tumor absorbs all irradiation incident from the laser.
5. Lumped capacitance behavior for the tumor.
6. Neglect potential nanoscale heat transfer effects.
7. Neglect the effect of perfusion.

**Properties:** Table A.6, water (320 K, assumed):  $\rho = v_f^{-1} = 989.1 \text{ kg/m}^3$ ,  $c_p = 4180 \text{ J/kg} \cdot \text{K}$ .

**Analysis:**

1. The steady-state heat loss from the spherical tumor may be determined by evaluating the dimensionless heat rate from the expression for case 12 of Table 4.1:

$$q = 2\pi k D_i (T_{t,ss} - T_b) = 2 \times \pi \times 0.5 \text{ W/m} \cdot \text{K} \times 3 \times 10^{-3} \text{ m} \times (55 - 37)^\circ\text{C} \\ = 0.170 \text{ W} \quad \triangleleft$$

2. The laser irradiation will be absorbed over the projected area of the tumor,  $\pi D_i^2/4$ . To determine the laser power corresponding to  $q = 0.170 \text{ W}$ , we first write an energy balance for the sphere. For a control surface about the sphere, the energy absorbed from the laser irradiation is offset by heat conduction to the healthy tissue,  $q = 0.170 \text{ W} \approx q_i''(x = d)\pi D_i^2/4$ , where,  $q_i''(x = d) = q_{i,o}''(1 - \rho)e^{-\kappa d}$  and the laser power is  $P_l = q_{i,o}''\pi D_i^2/4$ . Hence,

$$P_l = q D_i^2 e^{\kappa d} / [(1 - \rho) D_i^2] \\ = 0.170 \text{ W} \times (5 \times 10^{-3} \text{ m})^2 \times e^{(0.02 \text{ mm}^{-1} \times 20 \text{ mm})} / [(1 - 0.05) \times (3 \times 10^{-3} \text{ m})^2] \\ = 0.74 \text{ W} \quad \triangleleft$$

3. The general lumped capacitance energy balance, Equation 5.14, may be written

$$q_i''(x = d)\pi D_i^2/4 = q = \rho V c \frac{dT}{dt}$$

Separating variables and integrating between appropriate limits,

$$\frac{q}{\rho V c} \int_{t=0}^t dt = \int_{T_b}^{T_i} dT$$

yields

$$t = \frac{\rho V c}{q} (T_i - T_b) = \frac{989.1 \text{ kg/m}^3 \times (\pi/6) \times (3 \times 10^{-3} \text{ m})^3 \times 4180 \text{ J/kg} \cdot \text{K}}{0.170 \text{ W}} \\ \times (52^\circ\text{C} - 37^\circ\text{C})$$

or

$$t = 5.16 \text{ s} \quad \triangleleft$$



4. Using Equation 5.68,


$$q/2\pi k D_i (T_i - T_b) = q^* = [1 - \exp(Fo) \operatorname{erfc}(Fo^{1/2})]^{-1}$$

which may be solved by trial-and-error to yield  $Fo = 10.3 = 4\alpha t/D_i^2$ . Then, with  $\alpha = k/\rho c = 0.50 \text{ W/m} \cdot \text{K}/(989.1 \text{ kg/m}^3 \times 4180 \text{ J/kg} \cdot \text{K}) = 1.21 \times 10^{-7} \text{ m}^2/\text{s}$ , we find

$$t = Fo D_i^2 / 4\alpha = 10.3 \times (3 \times 10^{-3} \text{ m})^2 / (4 \times 1.21 \times 10^{-7} \text{ m}^2/\text{s}) = 192 \text{ s} \quad \triangleleft$$

**Comments:**

1. The analysis does not account for blood perfusion. The flow of blood would lead to advection of warmed fluid away from the tumor (and relatively cool blood to the vicinity of the tumor), increasing the power needed to reach the desired treatment temperature.
2. The laser power needed to treat various-sized tumors, calculated as in parts 1 and 2 of the problem solution, is shown below. Note that as the tumor becomes smaller, a higher-powered laser is needed, which may seem counterintuitive. The power required to heat the tumor, which is the same as the heat loss calculated in part 1, increases in direct proportion to the diameter, as might be expected. However, since the laser power flux remains constant, a smaller tumor cannot absorb as much energy (the energy absorbed has a  $D_i^2$  dependence). Less of the overall laser power is utilized to heat the tumor, and the required laser power increases for smaller tumors.

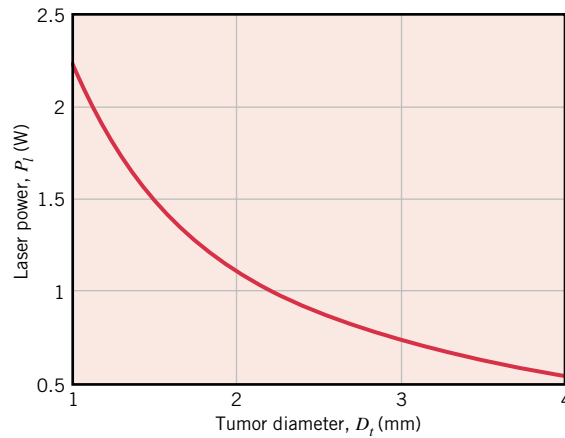

3. To determine the *actual* time needed for the tumor temperature to approach steady-state conditions, a numerical solution of the heat diffusion equation applied to the surrounding tissue, *coupled* with a solution for the temperature history within the tumor, would be required. However, we see that significantly more time is needed for the surrounding tissue to reach steady-state conditions than to increase the temperature of the isolated spherical tumor. This is due to the fact that higher temperatures propagate into a large volume when heating of the surrounding tissue is considered, while in contrast the thermal mass of the tumor is limited by the tumor's size. Hence, the *actual* time to heat *both* the tumor and the surrounding tissue will be slightly greater than 192 s.

4. Since temperatures are likely to increase at a considerable distance from the tumor, the assumption that the surroundings are of infinite size would need to be checked by inspecting results of the proposed numerical solution described in Comment 3.

## 5.9

### Periodic Heating

*Periodic heating* is used in various applications, such as thermal processing of materials using pulsed lasers, and occurs naturally in situations such as those involving the collection of solar energy.


Consider, for example, the semi-infinite solid of Figure 5.11a. For a surface temperature history described by  $T(0,t) = T_i + \Delta T \sin \omega t$ , the solution of Equation 5.26 subject to the interior boundary condition given by Equation 5.53 is

$$\frac{T(x,t) - T_i}{\Delta T} = \exp[-x\sqrt{\omega/2\alpha}] \sin[\omega t - x\sqrt{\omega/2\alpha}] \quad (5.69)$$

This solution applies after sufficient time has passed to yield a *quasi* steady state for which all temperatures fluctuate periodically about a time-invariant mean value. At locations in the solid, the fluctuations have a time lag relative to the surface temperature. In addition, the amplitude of the fluctuations within the material decays exponentially with distance from the surface. For  $x > \delta_p \equiv 4\sqrt{\alpha/\omega}$ , the amplitude of the temperature fluctuation is reduced by approximately 90% relative to that of the surface. The term  $\delta_p$  is a *thermal penetration depth*, which is an indication of the extent to which significant temperature effects propagate within a medium. The heat flux at the surface may be determined by applying Fourier's law at  $x = 0$ , yielding

$$q_s''(t) = k\Delta T\sqrt{\omega/\alpha} \sin(\omega t + \pi/4) \quad (5.70)$$

Equation 5.70 reveals that the surface heat flux is periodic, with a time-averaged value of zero.

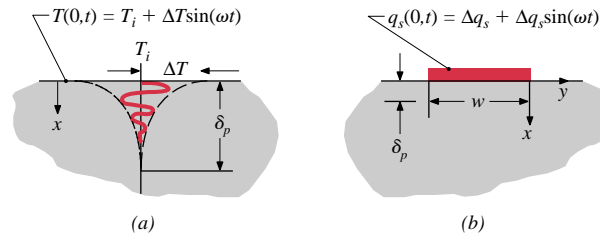

**FIGURE 5.11** Schematic of (a) a periodically heated, one-dimensional semi-infinite solid and (b) a periodically heated strip attached to a semi-infinite solid.

Periodic heating can also occur in two- or three-dimensional arrangements, as shown in Figure 5.11*b*. Recall that for this geometry, a steady state can be attained with constant heating of the strip placed upon a semi-infinite solid (Table 4.1, case 13). In a similar manner, a quasi steady state may be achieved when sinusoidal heating ( $q_s = \Delta q_s + \Delta q_s \sin \omega t$ ) is applied to the strip. Again, a quasi steady state is achieved for which all temperatures fluctuate about a time-invariant mean value.

The solution of the two-dimensional, transient heat diffusion equation for the two-dimensional configuration shown in Figure 5.11*b* has been obtained, and the relationship between the amplitude of the applied sinusoidal heating and the amplitude of the temperature response of the heated strip can be approximated as [7]

$$\Delta T \approx \frac{\Delta q_s}{L\pi k} \left[ -\frac{1}{2} \ln(\omega/2) - \ln(w^2/4\alpha) + C_1 \right] = \frac{\Delta q_s}{L\pi k} \left[ -\frac{1}{2} \ln(\omega/2) + C_2 \right] \quad (5.71)$$

where the constant  $C_1$  depends on the thermal contact resistance at the interface between the heated strip and the underlying material. Note that the amplitude of the temperature fluctuation,  $\Delta T$ , corresponds to the spatially averaged temperature of the rectangular strip of length  $L$  and width  $w$ . The heat flux from the strip to the semi-infinite medium is assumed to be spatially uniform. The approximation is valid for  $L \gg w$ . For the system of Figure 5.11*b*, the thermal penetration depth is smaller than that of Figure 5.11*a* because of the lateral spreading of thermal energy and is  $\delta_p \approx \sqrt{\alpha/\omega}$ .

### EXAMPLE 5.8


A novel nanostructured dielectric material has been fabricated, and the following method is used to measure its thermal conductivity. A long metal strip 3000 angstroms thick,  $w = 100 \mu\text{m}$  wide, and  $L = 3.5 \text{ mm}$  long is deposited by a photolithography technique on the top surface of a  $d = 300\text{-}\mu\text{m}$  thick sample of the new material. The strip is heated periodically by an electric current supplied through two connector pads. The heating rate is  $q_s(t) = \Delta q_s + \Delta q_s \sin(\omega t)$ , where  $\Delta q_s$  is 3.5 mW. The instantaneous, spatially averaged temperature of the metal strip is found experimentally by measuring the time variation of its electrical resistance,  $R(t) = E(t)/I(t)$ , and by knowing how the electrical resistance of the metal varies with temperature. The measured temperature of the metal strip is periodic; it has an amplitude of  $\Delta T = 1.37 \text{ K}$  at a relatively low heating frequency of  $\omega = 2\pi \text{ rad/s}$  and 0.71 K at a frequency of  $200\pi \text{ rad/s}$ . Determine the thermal conductivity of the nanostructured dielectric material. The density and specific heats of the conventional version of the material are  $3100 \text{ kg/m}^3$  and  $820 \text{ J/kg} \cdot \text{K}$ , respectively.

### SOLUTION

**Known:** Dimensions of a thin metal strip, the frequency and amplitude of the electric power dissipated within the strip, the amplitude of the induced oscillating strip temperature, and the thickness of the underlying nanostructured material.

**Find:** The thermal conductivity of the nanostructured material.

**Schematic:**

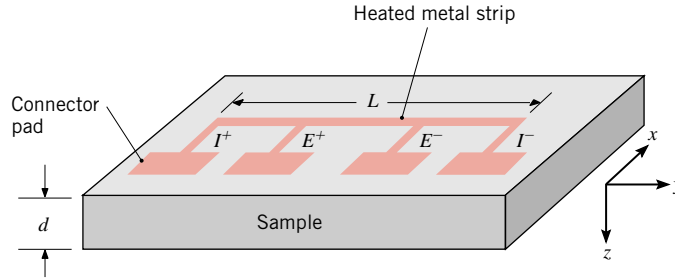

**Assumptions:**

1. Two-dimensional transient conduction in the  $x$ - and  $z$ -directions.
2. Constant properties.
3. Negligible radiation and convection losses from the metal strip and top surface of the sample.
4. The nanostructured material sample is a semi-infinite solid.
5. Uniform heat flux at the interface between the heated strip and the nanostructured material.

**Analysis:** Substitution of  $\Delta T = 1.37$  K at  $\omega = 2\pi$  rad/s and  $\Delta T = 0.71$  K at  $\omega = 200\pi$  rad/s into Equation 5.71 results in two equations that may be solved simultaneously to yield

$$C_2 = 5.35 \quad k = 1.11 \text{ W/m} \cdot \text{K}$$


The thermal diffusivity is  $\alpha = 4.37 \times 10^{-7} \text{ m}^2/\text{s}$ , while the thermal penetration depths are estimated by  $\delta_p \approx \sqrt{\alpha/\omega}$ , resulting in  $\delta_p = 260 \text{ } \mu\text{m}$  and  $\delta_p = 26 \text{ } \mu\text{m}$  at  $\omega = 2\pi$  rad/s and  $\omega = 200\pi$  rad/s, respectively.

**Comments:**

1. The foregoing experimental technique, which is widely used to measure the thermal conductivity of microscale devices and nanostructured materials, is referred to as the *3  $\omega$  method* [7].
2. Because this technique is based on measurement of a temperature that fluctuates about a mean value that is approximately the same as the temperature of the surroundings, the measured value of  $k$  is relatively insensitive to radiation heat transfer losses from the top of the metal strip. Likewise, the technique is insensitive to thermal contact resistances that may exist at the interface between the sensing strip and the underlying material since these effects cancel when measurements are made at two different excitation frequencies [7].
3. The specific heat and density are not strongly dependent on the nanostructure of most solids, and properties of conventional material may be used.
4. The thermal penetration depth is less than the sample thickness. Therefore, treating the sample as a semi-infinite solid is a valid approach. Thinner samples could be used if higher heating frequencies were employed.

## 5.10

### Finite-Difference Methods

 Analytical solutions for some simple two- and three-dimensional geometries are found in Section 5S.2.

Analytical solutions to transient problems are restricted to simple geometries and boundary conditions, such as the one-dimensional cases considered in the preceding sections. For some simple two- and three-dimensional geometries, analytical solutions are still possible. However, in many cases the geometry and/or boundary conditions preclude the use of analytical techniques, and recourse must be made to *finite-difference* (or *finite-element*) methods. Such methods, introduced in Section 4.4 for steady-state conditions, are readily extended to transient problems. In this section we consider *explicit* and *implicit* forms of finite-difference solutions to transient conduction problems.

#### 5.10.1 Discretization of the Heat Equation: The Explicit Method

Once again consider the two-dimensional system of Figure 4.4. Under transient conditions with constant properties and no internal generation, the appropriate form of the heat equation, Equation 2.19, is

$$\frac{1}{\alpha} \frac{\partial T}{\partial t} = \frac{\partial^2 T}{\partial x^2} + \frac{\partial^2 T}{\partial y^2} \quad (5.72)$$

To obtain the finite-difference form of this equation, we may use the *central-difference* approximations to the spatial derivatives prescribed by Equations 4.27 and 4.28. Once again the  $m$  and  $n$  subscripts may be used to designate the  $x$  and  $y$  locations of *discrete nodal points*. However, in addition to being discretized in space, the problem must be discretized in time. The integer  $p$  is introduced for this purpose, where

$$t = p \Delta t \quad (5.73)$$

and the finite-difference approximation to the time derivative in Equation 5.72 is expressed as

$$\left. \frac{\partial T}{\partial t} \right|_{m,n} \approx \frac{T_{m,n}^{p+1} - T_{m,n}^p}{\Delta t} \quad (5.74)$$

The superscript  $p$  is used to denote the time dependence of  $T$ , and the time derivative is expressed in terms of the difference in temperatures associated with the *new* ( $p + 1$ ) and *previous* ( $p$ ) times. Hence calculations must be performed at successive times separated by the interval  $\Delta t$ , and just as a finite-difference solution restricts temperature determination to discrete points in space, it also restricts it to discrete points in time.

If Equation 5.74 is substituted into Equation 5.72, the nature of the finite-difference solution will depend on the specific time at which temperatures are evaluated in the finite-difference approximations to the spatial derivatives. In the *explicit method* of solution, these temperatures are evaluated at the *previous* ( $p$ ) time. Hence Equation 5.74 is considered to be a *forward-difference* approximation to the time derivative.

Evaluating terms on the right-hand side of Equations 4.27 and 4.28 at  $p$  and substituting into Equation 5.72, the explicit form of the finite-difference equation for the interior node  $m, n$  is

$$\frac{1}{\alpha} \frac{T_{m,n}^{p+1} - T_{m,n}^p}{\Delta t} = \frac{T_{m+1,n}^p + T_{m-1,n}^p - 2T_{m,n}^p}{(\Delta x)^2} + \frac{T_{m,n+1}^p + T_{m,n-1}^p - 2T_{m,n}^p}{(\Delta y)^2} \quad (5.75)$$

Solving for the nodal temperature at the new  $(p + 1)$  time and assuming that  $\Delta x = \Delta y$ , it follows that

$$T_{m,n}^{p+1} = Fo(T_{m+1,n}^p + T_{m-1,n}^p + T_{m,n+1}^p + T_{m,n-1}^p) + (1 - 4Fo)T_{m,n}^p \quad (5.76)$$

where  $Fo$  is a finite-difference form of the Fourier number

$$Fo = \frac{\alpha \Delta t}{(\Delta x)^2} \quad (5.77)$$

This approach can easily be extended to one- or three-dimensional systems. If the system is one-dimensional in  $x$ , the explicit form of the finite-difference equation for an interior node  $m$  reduces to

$$T_m^{p+1} = Fo(T_{m+1}^p + T_{m-1}^p) + (1 - 2Fo)T_m^p \quad (5.78)$$

Equations 5.76 and 5.78 are *explicit* because *unknown* nodal temperatures for the new time are determined exclusively by *known* nodal temperatures at the previous time. Hence calculation of the unknown temperatures is straightforward. Since the temperature of each interior node is known at  $t = 0$  ( $p = 0$ ) from prescribed initial conditions, the calculations begin at  $t = \Delta t$  ( $p = 1$ ), where Equation 5.76 or 5.78 is applied to each interior node to determine its temperature. With temperatures known for  $t = \Delta t$ , the appropriate finite-difference equation is then applied at each node to determine its temperature at  $t = 2 \Delta t$  ( $p = 2$ ). In this way, the transient temperature distribution is obtained by *marching out in time*, using intervals of  $\Delta t$ .

The accuracy of the finite-difference solution may be improved by decreasing the values of  $\Delta x$  and  $\Delta t$ . Of course, the number of interior nodal points that must be considered increases with decreasing  $\Delta x$ , and the number of time intervals required to carry the solution to a prescribed final time increases with decreasing  $\Delta t$ . Hence the computation time increases with decreasing  $\Delta x$  and  $\Delta t$ . The choice of  $\Delta x$  is typically based on a compromise between accuracy and computational requirements. Once this selection has been made, however, the value of  $\Delta t$  may not be chosen independently. It is, instead, determined by *stability* requirements.

An undesirable feature of the explicit method is that it is not unconditionally *stable*. In a transient problem, the solution for the nodal temperatures should continuously approach final (steady-state) values with increasing time. However, with the explicit method, this solution may be characterized by numerically induced oscillations, which are physically impossible. The oscillations may become *unstable*, causing the solution to diverge from the actual steady-state conditions. To prevent such erroneous results, the prescribed value of  $\Delta t$  must be maintained below a certain limit, which depends on  $\Delta x$  and other parameters of the system. This dependence is termed a *stability criterion*, which may be obtained mathematically or demonstrated from a thermodynamic argument (see Problem 5.92). For the problems of interest in this text, *the criterion is determined by requiring that the coefficient associated with the node of interest at the previous*

time is greater than or equal to zero. In general, this is done by collecting all terms involving  $T_{m,n}^p$  to obtain the form of the coefficient. This result is then used to obtain a limiting relation involving  $Fo$ , from which the maximum allowable value of  $\Delta t$  may be determined. For example, with Equations 5.76 and 5.78 already expressed in the desired form, it follows that the stability criterion for a one-dimensional interior node is  $(1 - 2Fo) \geq 0$ , or

$$Fo \leq \frac{1}{2} \quad (5.79)$$

and for a two-dimensional node, it is  $(1 - 4Fo) \geq 0$ , or

$$Fo \leq \frac{1}{4} \quad (5.80)$$

For prescribed values of  $\Delta x$  and  $\alpha$ , these criteria may be used to determine upper limits to the value of  $\Delta t$ .

Equations 5.76 and 5.78 may also be derived by applying the energy balance method of Section 4.4.3 to a control volume about the interior node. Accounting for changes in thermal energy storage, a general form of the energy balance equation may be expressed as

$$\dot{E}_{\text{in}} + \dot{E}_g = \dot{E}_{\text{st}} \quad (5.81)$$

In the interest of adopting a consistent methodology, it is again assumed that all heat flow is *into* the node.

To illustrate application of Equation 5.81, consider the surface node of the one-dimensional system shown in Figure 5.12. To more accurately determine thermal conditions near the surface, this node has been assigned a thickness that is one-half that of the interior nodes. Assuming convection transfer from an adjoining fluid and no generation, it follows from Equation 5.81 that

$$hA(T_{\infty} - T_0^p) + \frac{kA}{\Delta x}(T_1^p - T_0^p) = \rho cA \frac{\Delta x}{2} \frac{T_0^{p+1} - T_0^p}{\Delta t}$$

or, solving for the surface temperature at  $t + \Delta t$ ,

$$T_0^{p+1} = \frac{2h \Delta t}{\rho c \Delta x}(T_{\infty} - T_0^p) + \frac{2\alpha \Delta t}{\Delta x^2}(T_1^p - T_0^p) + T_0^p$$

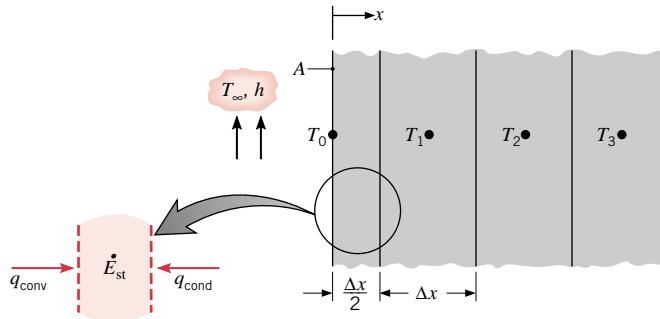


FIGURE 5.12 Surface node with convection and one-dimensional transient conduction.

Recognizing that  $(2h \Delta t / \rho c \Delta x) = 2(h \Delta x / k)(\alpha \Delta t / \Delta x^2) = 2 Bi Fo$  and grouping terms involving  $T_0^p$ , it follows that

$$T_0^{p+1} = 2Fo(T_1^p + Bi T_\infty) + (1 - 2Fo - 2Bi Fo)T_0^p \quad (5.82)$$

The finite-difference form of the Biot number is

$$Bi = \frac{h \Delta x}{k} \quad (5.83)$$

Recalling the procedure for determining the stability criterion, we require that the coefficient for  $T_0^p$  be greater than or equal to zero. Hence

$$1 - 2Fo - 2Bi Fo \geq 0$$

or

$$Fo(1 + Bi) \leq \frac{1}{2} \quad (5.84)$$

Since the complete finite-difference solution requires the use of Equation 5.78 for the interior nodes, as well as Equation 5.82 for the surface node, Equation 5.84 must be contrasted with Equation 5.79 to determine which requirement is more stringent. Since  $Bi \geq 0$ , it is apparent that the limiting value of  $Fo$  for Equation 5.84 is less than that for Equation 5.79. To ensure stability for all nodes, Equation 5.84 should therefore be used to select the maximum allowable value of  $Fo$ , and hence  $\Delta t$ , to be used in the calculations.

Forms of the explicit finite-difference equation for several common geometries are presented in Table 5.3(a). Each equation may be derived by applying the energy balance method to a control volume about the corresponding node. To develop confidence in your ability to apply this method, you should attempt to verify at least one of these equations.

### EXAMPLE 5.9

A fuel element of a nuclear reactor is in the shape of a plane wall of thickness  $2L = 20$  mm and is convectively cooled at both surfaces, with  $h = 1100$  W/m<sup>2</sup> · K and  $T_\infty = 250^\circ\text{C}$ . At normal operating power, heat is generated uniformly within the element at a volumetric rate of  $\dot{q}_1 = 10^7$  W/m<sup>3</sup>. A departure from the steady-state conditions associated with normal operation will occur if there is a change in the generation rate. Consider a sudden change to  $\dot{q}_2 = 2 \times 10^7$  W/m<sup>3</sup>, and use the explicit finite-difference method to determine the fuel element temperature distribution after 1.5 s. The fuel element thermal properties are  $k = 30$  W/m · K and  $\alpha = 5 \times 10^{-6}$  m<sup>2</sup>/s.





### SOLUTION

**Known:** Conditions associated with heat generation in a rectangular fuel element with surface cooling.

**Find:** Temperature distribution 1.5 s after a change in operating power.




**TABLE 5.3** Transient, two-dimensional finite-difference equations ( $\Delta x = \Delta y$ )

(a) Explicit Method		(b) Implicit Method	
Configuration	Finite-Difference Equation	Stability Criterion	Implicit Method
 <p>1. Interior node</p>	$T_{m,n}^{p+1} = Fo(T_{m+1,n}^p + T_{m-1,n}^p + T_{m,n+1}^p + T_{m,n-1}^p) + (1 - 4Fo)T_{m,n}^p \quad (5.76)$	$Fo \leq \frac{1}{4} \quad (5.80)$	$(1 + 4Fo)T_{m,n}^{p+1} - Fo(T_{m+1,n}^{p+1} + T_{m-1,n}^{p+1} + T_{m,n+1}^{p+1} + T_{m,n-1}^{p+1}) = T_{m,n}^p \quad (5.92)$
 <p>2. Node at interior corner with convection</p>	$T_{m,n}^{p+1} = \frac{2}{3}Fo(T_{m+1,n}^p + 2T_{m-1,n}^p + 2T_{m,n+1}^p + T_{m,n-1}^p) + 2Bi T_{\infty}^p + (1 - 4Fo - \frac{4}{3}Bi Fo)T_{m,n}^p \quad (5.85)$	$Fo(3 + Bi) \leq \frac{3}{4} \quad (5.86)$	$(1 + 4Fo(1 + \frac{1}{3}Bi))T_{m,n}^{p+1} - \frac{2}{3}Fo \cdot (T_{m+1,n}^{p+1} + 2T_{m-1,n}^{p+1} + 2T_{m,n+1}^{p+1} + T_{m,n-1}^{p+1}) = T_{m,n}^p + \frac{4}{3}Bi Fo T_{\infty} \quad (5.95)$
 <p>3. Node at plane surface with convection<sup>a</sup></p>	$T_{m,n}^{p+1} = Fo(2T_{m-1,n}^p + T_{m,n+1}^p + T_{m,n-1}^p + 2Bi T_{\infty}^p) + (1 - 4Fo - 2Bi Fo)T_{m,n}^p \quad (5.87)$	$Fo(2 + Bi) \leq \frac{1}{2} \quad (5.88)$	$(1 + 2Fo(2 + Bi))T_{m,n}^{p+1} - Fo(2T_{m-1,n}^{p+1} + T_{m,n+1}^{p+1} + T_{m,n-1}^{p+1}) = T_{m,n}^p + 2Bi Fo T_{\infty} \quad (5.96)$
 <p>4. Node at exterior corner with convection</p>	$T_{m,n}^{p+1} = 2Fo(T_{m-1,n}^p + T_{m,n+1}^p + 2Bi T_{\infty}^p) + (1 - 4Fo - 4Bi Fo)T_{m,n}^p \quad (5.89)$	$Fo(1 + Bi) \leq \frac{1}{4} \quad (5.90)$	$(1 + 4Fo(1 + Bi))T_{m,n}^{p+1} - 2Fo(T_{m-1,n}^{p+1} + T_{m,n+1}^{p+1}) = T_{m,n}^p + 4Bi Fo T_{\infty} \quad (5.97)$

<sup>a</sup>To obtain the finite-difference equation and/or stability criterion for an adiabatic surface (or surface of symmetry), simply set  $Bi$  equal to zero.

**Schematic:**

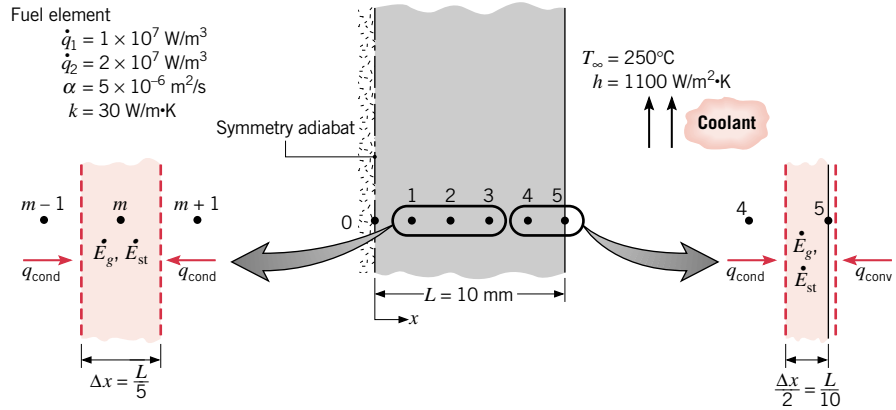

**Assumptions:**

1. One-dimensional conduction in  $x$ .
2. Uniform generation.
3. Constant properties.

**Analysis:** A numerical solution will be obtained using a space increment of  $\Delta x = 2$  mm. Since there is symmetry about the midplane, the nodal network yields six unknown nodal temperatures. Using the energy balance method, Equation 5.81, an explicit finite-difference equation may be derived for any interior node  $m$ .

$$kA \frac{T_{m-1}^p - T_m^p}{\Delta x} + kA \frac{T_{m+1}^p - T_m^p}{\Delta x} + \dot{q}A \Delta x = \rho A \Delta x c \frac{T_m^{p+1} - T_m^p}{\Delta t}$$

Solving for  $T_m^{p+1}$  and rearranging,

$$T_m^{p+1} = Fo \left[ T_{m-1}^p + T_{m+1}^p + \frac{\dot{q}(\Delta x)^2}{k} \right] + (1 - 2Fo)T_m^p \quad (1)$$

This equation may be used for node 0, with  $T_{m-1}^p = T_{m+1}^p$ , as well as for nodes 1, 2, 3, and 4. Applying energy conservation to a control volume about node 5,

$$hA(T_\infty - T_5^p) + kA \frac{T_4^p - T_5^p}{\Delta x} + \dot{q}A \frac{\Delta x}{2} = \rho A \frac{\Delta x}{2} c \frac{T_5^{p+1} - T_5^p}{\Delta t}$$

or

$$T_5^{p+1} = 2Fo \left[ T_4^p + Bi T_\infty + \frac{\dot{q}(\Delta x)^2}{2k} \right] + (1 - 2Fo - 2Bi Fo)T_5^p \quad (2)$$

Since the most restrictive stability criterion is associated with Equation 2, we select  $Fo$  from the requirement that

$$Fo(1 + Bi) \leq \frac{1}{2}$$

Hence, with

$$Bi = \frac{h \Delta x}{k} = \frac{1100 \text{ W/m}^2 \cdot \text{K} (0.002 \text{ m})}{30 \text{ W/m} \cdot \text{K}} = 0.0733$$

it follows that

$$Fo \leq 0.466$$

or

$$\Delta t = \frac{Fo(\Delta x)^2}{\alpha} \leq \frac{0.466(2 \times 10^{-3} \text{ m})^2}{5 \times 10^{-6} \text{ m}^2/\text{s}} \leq 0.373 \text{ s}$$

To be well within the stability limit, we select  $\Delta t = 0.3 \text{ s}$ , which corresponds to

$$Fo = \frac{5 \times 10^{-6} \text{ m}^2/\text{s}(0.3 \text{ s})}{(2 \times 10^{-3} \text{ m})^2} = 0.375$$

Substituting numerical values, including  $\dot{q} = \dot{q}_2 = 2 \times 10^7 \text{ W/m}^3$ , the nodal equations become

$$T_0^{p+1} = 0.375(2T_1^p + 2.67) + 0.250T_0^p$$

$$T_1^{p+1} = 0.375(T_0^p + T_2^p + 2.67) + 0.250T_1^p$$

$$T_2^{p+1} = 0.375(T_1^p + T_3^p + 2.67) + 0.250T_2^p$$

$$T_3^{p+1} = 0.375(T_2^p + T_4^p + 2.67) + 0.250T_3^p$$

$$T_4^{p+1} = 0.375(T_3^p + T_5^p + 2.67) + 0.250T_4^p$$

$$T_5^{p+1} = 0.750(T_4^p + 19.67) + 0.195T_5^p$$

To begin the marching solution, the initial temperature distribution must be known. This distribution is given by Equation 3.42, with  $\dot{q} = \dot{q}_1$ . Obtaining  $T_s = T_5$  from Equation 3.46,

$$T_s = T_\infty + \frac{\dot{q}L}{h} = 250^\circ\text{C} + \frac{10^7 \text{ W/m}^3 \times 0.01 \text{ m}}{1100 \text{ W/m}^2 \cdot \text{K}} = 340.91^\circ\text{C}$$

it follows that

$$T(x) = 16.67 \left( 1 - \frac{x^2}{L^2} \right) + 340.91^\circ\text{C}$$

Computed temperatures for the nodal points of interest are shown in the first row of the accompanying table.

Using the finite-difference equations, the nodal temperatures may be sequentially calculated with a time increment of 0.3 s until the desired final time is reached. The results are illustrated in rows 2 through 6 of the table and may be contrasted

with the new steady-state condition (row 7), which was obtained by using Equations 3.42 and 3.46 with  $\dot{q} = \dot{q}_2$ :


**Tabulated Nodal Temperatures**

$p$	$t(s)$	$T_0$	$T_1$	$T_2$	$T_3$	$T_4$	$T_5$
0	0	357.58	356.91	354.91	351.58	346.91	340.91
1	0.3	358.08	357.41	355.41	352.08	347.41	341.41
2	0.6	358.58	357.91	355.91	352.58	347.91	341.88
3	0.9	359.08	358.41	356.41	353.08	348.41	342.35
4	1.2	359.58	358.91	356.91	353.58	348.89	342.82
5	1.5	360.08	359.41	357.41	354.07	349.37	343.27
$\infty$	$\infty$	465.15	463.82	459.82	453.15	443.82	431.82

**Comments:**

1. It is evident that at 1.5 s, the wall is in the early stages of the transient process and that many additional calculations would have to be made to reach steady-state conditions with the finite-difference solution. The computation time could be reduced slightly by using the maximum allowable time increment ( $\Delta t = 0.373$  s), but with some loss of accuracy. In the interest of maximizing accuracy, the time interval should be reduced until the computed results become independent of further reductions in  $\Delta t$ .

Extending the finite-difference solution, the time required to achieve the new steady-state condition may be determined, with temperature histories computed for the midplane (0) and surface (5) nodes having the following forms:

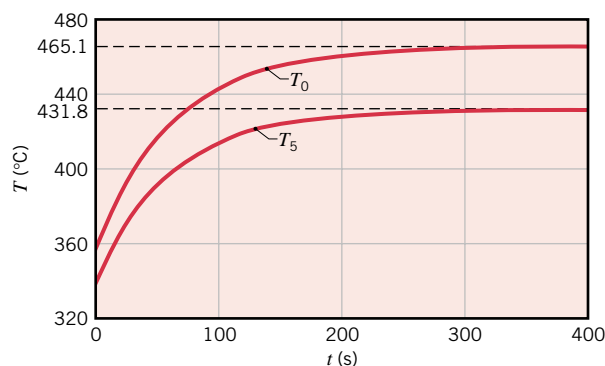

With steady-state temperatures of  $T_0 = 465.15^\circ\text{C}$  and  $T_5 = 431.82^\circ\text{C}$ , it is evident that the new equilibrium condition is reached within 250 s of the step change in operating power.

2. The *IHT* option entitled *Tools, Finite-Difference Equations, One-Dimensional, Transient* can be used to express the nodal equations according to the implicit method of solution. In solving the equations, the user is prompted to enter the initial temperature of each node on the *Initial Condition (IC)* pad. The problem may also be solved using *FEHT*, with the initial temperature distribution determined by applying the *Steady-State* command of the *Set-up* menu for

$\dot{q}_1 = 10^7 \text{ W/m}^3$ . The generation rate may then be changed to  $\dot{q}_2 = 2 \times 10^7 \text{ W/m}^3$ , and after enabling the *Transient* command of the *Set-up* menu, the *Continue* command of the *Solve* menu may be activated to obtain the transient solution. For details on application of *IHT* or *FEHT* to transient conduction problems, refer to the booklet *Software Tools and User's Guides*, which accompanies the software.

### 5.10.2 Discretization of the Heat Equation: The Implicit Method

In the *explicit* finite-difference scheme, the temperature of any node at  $t + \Delta t$  may be calculated from knowledge of temperatures at the same and neighboring nodes for the *preceding time*  $t$ . Hence determination of a nodal temperature at some time is *independent* of temperatures at other nodes for the *same time*. Although the method offers computational convenience, it suffers from limitations on the selection of  $\Delta t$ . For a given space increment, the time interval must be compatible with stability requirements. Frequently, this dictates the use of extremely small values of  $\Delta t$ , and a very large number of time intervals may be necessary to obtain a solution.

A reduction in the amount of computation time may often be realized by employing an *implicit*, rather than explicit, finite-difference scheme. The implicit form of a finite-difference equation may be derived by using Equation 5.74 to approximate the time derivative, while evaluating all other temperatures at the *new* ( $p + 1$ ) time, instead of the previous ( $p$ ) time. Equation 5.74 is then considered to provide a *backward-difference* approximation to the time derivative. In contrast to Equation 5.75, the implicit form of the finite-difference equation for the interior node of a two-dimensional system is then

$$\frac{1}{\alpha} \frac{T_{m,n}^{p+1} - T_{m,n}^p}{\Delta t} = \frac{T_{m+1,n}^{p+1} + T_{m-1,n}^{p+1} - 2T_{m,n}^{p+1}}{(\Delta x)^2} + \frac{T_{m,n+1}^{p+1} + T_{m,n-1}^{p+1} - 2T_{m,n}^{p+1}}{(\Delta y)^2} \quad (5.91)$$

Rearranging and assuming  $\Delta x = \Delta y$ , it follows that

$$(1 + 4Fo)T_{m,n}^{p+1} - Fo(T_{m+1,n}^{p+1} + T_{m-1,n}^{p+1} + T_{m,n+1}^{p+1} + T_{m,n-1}^{p+1}) = T_{m,n}^p \quad (5.92)$$

From Equation 5.92 it is evident that the *new* temperature of the  $m, n$  node depends on the *new* temperatures of its adjoining nodes, which are, in general, unknown. Hence, to determine the unknown nodal temperatures at  $t + \Delta t$ , the corresponding nodal equations must be *solved simultaneously*. Such a solution may be effected by using Gauss–Seidel iteration or matrix inversion, as discussed in Section 4.5. The *marching solution* would then involve simultaneously solving the nodal equations at each time  $t = \Delta t, 2\Delta t, \dots$ , until the desired final time was reached.

Relative to the explicit method, the implicit formulation has the important advantage of being *unconditionally stable*. That is, the solution remains stable for all space and time intervals, in which case there are no restrictions on  $\Delta x$  and  $\Delta t$ .

Since larger values of  $\Delta t$  may therefore be used with an implicit method, computation times may often be reduced, with little loss of accuracy. Nevertheless, to maximize accuracy,  $\Delta t$  should be sufficiently small to ensure that the results are independent of further reductions in its value.

The implicit form of a finite-difference equation may also be derived from the energy balance method. For the surface node of Figure 5.12, it is readily shown that

$$(1 + 2Fo + 2Fo Bi)T_0^{p+1} - 2Fo T_1^{p+1} = 2Fo Bi T_\infty + T_0^p \quad (5.93)$$

For any interior node of Figure 5.12, it may also be shown that

$$(1 + 2Fo)T_m^{p+1} - Fo (T_{m-1}^{p+1} + T_{m+1}^{p+1}) = T_m^p \quad (5.94)$$

Forms of the implicit finite-difference equation for other common geometries are presented in Table 5.3(b). Each equation may be derived by applying the energy balance method.

### EXAMPLE 5.10

A thick slab of copper initially at a uniform temperature of  $20^\circ\text{C}$  is suddenly exposed to radiation at one surface such that the net heat flux is maintained at a constant value of  $3 \times 10^5 \text{ W/m}^2$ . Using the explicit and implicit finite-difference techniques with a space increment of  $\Delta x = 75 \text{ mm}$ , determine the temperature at the irradiated surface and at an interior point that is  $150 \text{ mm}$  from the surface after  $2 \text{ min}$  have elapsed. Compare the results with those obtained from an appropriate analytical solution.


### SOLUTION

**Known:** Thick slab of copper, initially at a uniform temperature, is subjected to a constant net heat flux at one surface.

### Find:

1. Using the explicit finite-difference method, determine temperatures at the surface and  $150 \text{ mm}$  from the surface after an elapsed time of  $2 \text{ min}$ .
2. Repeat the calculations using the implicit finite-difference method.
3. Determine the same temperatures analytically.

### Schematic:

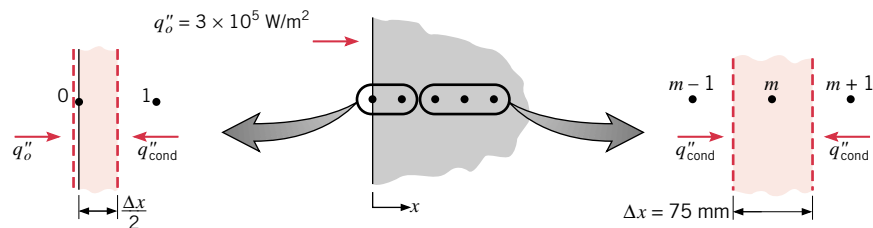

**Assumptions:**

1. One-dimensional conduction in  $x$ .
2. Thick slab may be approximated as a semi-infinite medium with constant surface heat flux.
3. Constant properties.

**Properties:** Table A.1, copper (300 K):  $k = 401 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 117 \times 10^{-6} \text{ m}^2/\text{s}$ .

**Analysis:**

1. An explicit form of the finite-difference equation for the surface node may be obtained by applying an energy balance to a control volume about the node.

$$q_o'' A + kA \frac{T_1^p - T_0^p}{\Delta x} = \rho A \frac{\Delta x}{2} c \frac{T_0^{p+1} - T_0^p}{\Delta t}$$

or

$$T_0^{p+1} = 2Fo \left( \frac{q_o'' \Delta x}{k} + T_1^p \right) + (1 - 2Fo) T_0^p$$

The finite-difference equation for any interior node is given by Equation 5.78. Both the surface and interior nodes are governed by the stability criterion

$$Fo \leq \frac{1}{2}$$

Noting that the finite-difference equations are simplified by choosing the maximum allowable value of  $Fo$ , we select  $Fo = \frac{1}{2}$ . Hence

$$\Delta t = Fo \frac{(\Delta x)^2}{\alpha} = \frac{1}{2} \frac{(0.075 \text{ m})^2}{117 \times 10^{-6} \text{ m}^2/\text{s}} = 24 \text{ s}$$

With

$$\frac{q_o'' \Delta x}{k} = \frac{3 \times 10^5 \text{ W/m}^2 (0.075 \text{ m})}{401 \text{ W/m} \cdot \text{K}} = 56.1^\circ\text{C}$$

the finite-difference equations become

$$T_0^{p+1} = 56.1^\circ\text{C} + T_1^p \quad \text{and} \quad T_m^{p+1} = \frac{T_{m+1}^p + T_{m-1}^p}{2}$$

for the surface and interior nodes, respectively. Performing the calculations, the results are tabulated as follows:

**Explicit Finite-Difference Solution for  $Fo = \frac{1}{2}$**

$p$	$t(\text{s})$	$T_0$	$T_1$	$T_2$	$T_3$	$T_4$
0	0	20	20	20	20	20
1	24	76.1	20	20	20	20
2	48	76.1	48.1	20	20	20
3	72	104.2	48.1	34.1	20	20
4	96	104.2	69.1	34.1	27.1	20
5	120	125.3	69.1	48.1	27.1	20

After 2 min, the surface temperature and the desired interior temperature are  $T_0 = 125.3^\circ\text{C}$  and  $T_2 = 48.1^\circ\text{C}$ .

Note that calculation of identical temperatures at successive times for the same node is an idiosyncrasy of using the maximum allowable value of  $Fo$  with the explicit finite-difference technique. The actual physical condition is, of course, one in which the temperature changes continuously with time. The idiosyncrasy is eliminated and the accuracy of the calculations is improved by reducing the value of  $Fo$ .

To determine the extent to which the accuracy may be improved by reducing  $Fo$ , let us redo the calculations for  $Fo = \frac{1}{4}(\Delta t = 12 \text{ s})$ . The finite-difference equations are then of the form

$$T_0^{p+1} = \frac{1}{2}(56.1^\circ\text{C} + T_1^p) + \frac{1}{2}T_0^p$$

$$T_m^{p+1} = \frac{1}{4}(T_{m+1}^p + T_{m-1}^p) + \frac{1}{2}T_m^p$$

and the results of the calculations are tabulated as follows:

**Explicit Finite-Difference Solution for  $Fo = \frac{1}{4}$**

$p$	$t(\text{s})$	$T_0$	$T_1$	$T_2$	$T_3$	$T_4$	$T_5$	$T_6$	$T_7$	$T_8$
0	0	20	20	20	20	20	20	20	20	20
1	12	48.1	20	20	20	20	20	20	20	20
2	24	62.1	27.0	20	20	20	20	20	20	20
3	36	72.6	34.0	21.8	20	20	20	20	20	20
4	48	81.4	40.6	24.4	20.4	20	20	20	20	20
5	60	89.0	46.7	27.5	21.3	20.1	20	20	20	20
6	72	95.9	52.5	30.7	22.6	20.4	20.0	20	20	20
7	84	102.3	57.9	34.1	24.1	20.8	20.1	20.0	20	20
8	96	108.1	63.1	37.6	25.8	21.5	20.3	20.0	20.0	20
9	108	113.7	68.0	41.0	27.6	22.2	20.5	20.1	20.0	20.0
10	120	118.9	72.6	44.4	29.6	23.2	20.8	20.2	20.0	20.0

After 2 min, the desired temperatures are  $T_0 = 118.9^\circ\text{C}$  and  $T_2 = 44.4^\circ\text{C}$ . Comparing the above results with those obtained for  $Fo = \frac{1}{2}$ , it is clear that by reducing  $Fo$  we have eliminated the problem of recurring temperatures. We have also predicted greater thermal penetration (to node 6 instead of node 3). An assessment of the improvement in accuracy must await a comparison with results based on an exact solution.

2. Performing an energy balance on a control volume about the surface node, the implicit form of the finite-difference equation is

$$q_o'' + k \frac{T_1^{p+1} - T_0^{p+1}}{\Delta x} = \rho \frac{\Delta x}{2} c \frac{T_0^{p+1} - T_0^p}{\Delta t}$$

or

$$(1 + 2Fo)T_0^{p+1} - 2FoT_1^{p+1} = \frac{2\alpha q_o'' \Delta t}{k \Delta x} + T_0^p$$

Arbitrarily choosing  $Fo = \frac{1}{2}(\Delta t = 24 \text{ s})$ , it follows that

$$2T_0^{p+1} - T_1^{p+1} = 56.1 + T_0^p$$



From Equation 5.94, the finite-difference equation for any interior node is then of the form

$$-T_{m-1}^{p+1} + 4T_m^{p+1} - T_{m+1}^{p+1} = 2T_m^p$$

Since we are dealing with a semi-infinite solid, the number of nodes is, in principle, infinite. In practice, however, the number may be limited to the nodes that are affected by the change in the boundary condition for the time of interest. From the results of the explicit method, it is evident that we are safe in choosing nine nodes corresponding to  $T_0, T_1, \dots, T_8$ . We are thereby assuming that, at  $t = 120$  s, there has been no change in  $T_8$ .

We now have a set of nine equations that must be solved simultaneously for each time increment. Using the matrix inversion method, we express the equations in the form  $[A][T] = [C]$ , where

$$[A] = \begin{bmatrix} 2 & -1 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ -1 & 4 & -1 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & -1 & 4 & -1 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & -1 & 4 & -1 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & -1 & 4 & -1 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & -1 & 4 & -1 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & -1 & 4 & -1 & 0 \\ 0 & 0 & 0 & 0 & 0 & 0 & -1 & 4 & -1 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & -1 & 4 \end{bmatrix}$$

$$[C] = \begin{bmatrix} 56.1 + T_0^p \\ 2T_1^p \\ 2T_2^p \\ 2T_3^p \\ 2T_4^p \\ 2T_5^p \\ 2T_6^p \\ 2T_7^p \\ 2T_8^p + T_9^{p+1} \end{bmatrix}$$

Note that numerical values for the components of  $[C]$  are determined from previous values of the nodal temperatures. Note also how the finite-difference equation for node 8 appears in matrices  $[A]$  and  $[C]$ .

A table of nodal temperatures may be compiled, beginning with the first row ( $p = 0$ ) corresponding to the prescribed initial condition. To obtain nodal temperatures for subsequent times, the inverse of the coefficient matrix  $[A]^{-1}$  must first be found. At each time  $p + 1$ , it is then multiplied by the column vector  $[C]$ , which is evaluated at  $p$ , to obtain the temperatures  $T_0^{p+1}, T_1^{p+1}, \dots, T_8^{p+1}$ . For example, multiplying  $[A]^{-1}$  by the column vector corresponding to  $p = 0$ ,

$$[C]_{p=0} = \begin{bmatrix} 76.1 \\ 40 \\ 40 \\ 40 \\ 40 \\ 40 \\ 40 \\ 40 \\ 60 \end{bmatrix}$$

the second row of the table is obtained. Updating  $[C]$ , the process is repeated four more times to determine the nodal temperatures at 120 s. The desired temperatures are  $T_0 = 114.7^\circ\text{C}$  and  $T_2 = 44.2^\circ\text{C}$ .

**Implicit Finite-Difference Solution for  $Fo = \frac{1}{2}$**

$p$	$t(\text{s})$	$T_0$	$T_1$	$T_2$	$T_3$	$T_4$	$T_5$	$T_6$	$T_7$	$T_8$
0	0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
1	24	52.4	28.7	22.3	20.6	20.2	20.0	20.0	20.0	20.0
2	48	74.0	39.5	26.6	22.1	20.7	20.2	20.1	20.0	20.0
3	72	90.2	50.3	32.0	24.4	21.6	20.6	20.2	20.1	20.0
4	96	103.4	60.5	38.0	27.4	22.9	21.1	20.4	20.2	20.1
5	120	114.7	70.0	44.2	30.9	24.7	21.9	20.8	20.3	20.1

3. Approximating the slab as a semi-infinite medium, the appropriate analytical expression is given by Equation 5.59, which may be applied to any point in the slab.

$$T(x, t) - T_i = \frac{2q_o''(\alpha t/\pi)^{1/2}}{k} \exp\left(-\frac{x^2}{4\alpha t}\right) - \frac{q_o''x}{k} \operatorname{erfc}\left(\frac{x}{2\sqrt{\alpha t}}\right)$$

At the surface, this expression yields

$$T(0, 120 \text{ s}) - 20^\circ\text{C} = \frac{2 \times 3 \times 10^5 \text{ W/m}^2}{401 \text{ W/m} \cdot \text{K}} (117 \times 10^{-6} \text{ m}^2/\text{s} \times 120 \text{ s}/\pi)^{1/2}$$

or

$$T(0, 120 \text{ s}) = 120.0^\circ\text{C}$$

At the interior point ( $x = 0.15 \text{ m}$ )

$$\begin{aligned} T(0.15 \text{ m}, 120 \text{ s}) - 20^\circ\text{C} &= \frac{2 \times 3 \times 10^5 \text{ W/m}^2}{401 \text{ W/m} \cdot \text{K}} \\ &\times (117 \times 10^{-6} \text{ m}^2/\text{s} \times 120 \text{ s}/\pi)^{1/2} \\ &\times \exp\left[-\frac{(0.15 \text{ m})^2}{4 \times 117 \times 10^{-6} \text{ m}^2/\text{s} \times 120 \text{ s}}\right] \\ &- \frac{3 \times 10^5 \text{ W/m}^2 \times 0.15 \text{ m}}{401 \text{ W/m} \cdot \text{K}} \\ &\times \left[1 - \operatorname{erf}\left(\frac{0.15 \text{ m}}{2\sqrt{117 \times 10^{-6} \text{ m}^2/\text{s} \times 120 \text{ s}}}\right)\right] \\ T(0.15 \text{ m}, 120 \text{ s}) &= 45.4^\circ\text{C} \end{aligned}$$


**Comments:**

1. Comparing the exact results with those obtained from the three approximate solutions, it is clear that the explicit method with  $Fo = \frac{1}{4}$  provides the most accurate predictions.

Method	$T_0 = T(0, 120 \text{ s})$	$T_2 = T(0.15 \text{ m}, 120 \text{ s})$
Explicit ( $Fo = \frac{1}{2}$ )	125.3	48.1
Explicit ( $Fo = \frac{1}{4}$ )	118.9	44.4
Implicit ( $Fo = \frac{1}{2}$ )	114.7	44.2
Exact	120.0	45.4

This is not unexpected, since the corresponding value of  $\Delta t$  is 50% smaller than that used in the other two methods. Although computations are simplified by using the maximum allowable value of  $Fo$  in the explicit method, the accuracy of the results is seldom satisfactory.

- The accuracy of the foregoing calculations is adversely affected by the coarse grid ( $\Delta x = 75 \text{ mm}$ ), as well as by the large time steps ( $\Delta t = 24 \text{ s}, 12 \text{ s}$ ). Applying the implicit method with  $\Delta x = 18.75 \text{ mm}$  and  $\Delta t = 6 \text{ s}$  ( $Fo = 2.0$ ), the solution yields  $T_0 = T(0, 120 \text{ s}) = 119.2^\circ\text{C}$  and  $T_2 = T(0.15 \text{ m}, 120 \text{ s}) = 45.3^\circ\text{C}$ , both of which are in good agreement with the exact solution. Complete temperature distributions may be plotted at any of the discrete times, and results obtained at  $t = 60$  and  $120 \text{ s}$  are as follows:

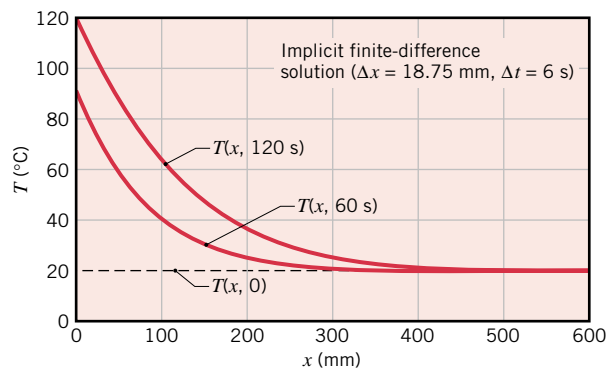

Note that, at  $t = 120 \text{ s}$ , the assumption of a semi-infinite medium would remain valid if the thickness of the slab exceeded approximately  $500 \text{ mm}$ .

- Note that the coefficient matrix  $[A]$  is *tridiagonal*. That is, all elements are zero except those that are on, or to either side of, the main diagonal. Tridiagonal matrices are associated with one-dimensional conduction problems.
- A more general radiative heating condition would be one in which the surface is suddenly exposed to large surroundings at an elevated temperature  $T_{\text{sur}}$  (Problem 5.107). The net rate at which radiation is transferred to the surface may then be calculated from Equation 1.7. Allowing for convection heat transfer to the surface, application of conservation of energy to the surface node yields an explicit finite-difference equation of the form

$$\varepsilon\sigma[T_{\text{sur}}^4 - (T_0^p)^4] + h(T_{\infty} - T_0^p) + k \frac{T_1^p - T_0^p}{\Delta x} = \rho \frac{\Delta x}{2} c \frac{T_0^{p+1} - T_0^p}{\Delta t}$$

Use of this finite-difference equation in a numerical solution is complicated by the fact that it is *nonlinear*. However, the equation may be *linearized* by introducing

the radiation heat transfer coefficient  $h_r$ , defined by Equation 1.9, and the finite-difference equation is

$$h_r^p(T_{\text{sur}} - T_0^p) + h(T_\infty - T_0^p) + k \frac{T_1^p - T_0^p}{\Delta x} = \rho \frac{\Delta x}{2} c \frac{T_0^{p+1} - T_0^p}{\Delta t}$$

The solution may proceed in the usual manner, although the effect of a radiative Biot number ( $Bi_r \equiv h_r \Delta x/k$ ) must be included in the stability criterion and the value of  $h_r$  must be updated at each step in the calculations. If the implicit method is used,  $h_r$  is calculated at  $p + 1$ , in which case an iterative calculation must be made at each time step.

5. The *IHT Tools, Finite-Difference Equations, One-Dimensional, Transient* option can be used to formulate the nodal equations for the implicit method. A schematic of the pertinent node and its control volume appears in the tool pad, with provision for entering indices associated with the node of interest and relevant adjoining nodes. The system of equations, with comments, has this form:

```
//Node 0

rho * cp * der(T0,t) = fd_1d_sur_w(T0,T1,k,qdot,deltax,Tinf,h,q''a0)
q''a0 = 3e5           // Applied heat flux, W/m^2
Tinf = 20            // Arbitrary value for convection process
h = 1e-20            // Makes convection process negligible

// Interior nodes, 1 - 8
rho*cp*der(T1,t) = fd_1d_int(T1,T2,T0,k,qdot,deltax)
rho*cp*der(T2,t) = fd_1d_int(T2,T3,T1,k,qdot,deltax)
rho*cp*der(T3,t) = fd_1d_int(T3,T4,T2,k,qdot,deltax)
rho*cp*der(T4,t) = fd_1d_int(T4,T5,T3,k,qdot,deltax)
rho*cp*der(T5,t) = fd_1d_int(T5,T6,T4,k,qdot,deltax)
rho*cp*der(T6,t) = fd_1d_int(T6,T7,T5,k,qdot,deltax)
rho*cp*der(T7,t) = fd_1d_int(T7,T8,T6,k,qdot,deltax)
rho*cp*der(T8,t) = fd_1d_int(T8,T9,T7,k,qdot,deltax)
```

Note that the prescribed convection coefficient renders convection negligible, as required by the problem statement. Using  $\Delta x = 75$  mm and  $\Delta t = 12$  s, the solution yields  $T_0 = T(0,120 \text{ s}) = 116.0^\circ\text{C}$  and  $T_2 = T(150 \text{ mm}, 120 \text{ s}) = 44.2^\circ\text{C}$ . Contrast these results with those summarized in Comment 1.

6. This example is provided in *FEHT* as a solved model accessed through the *Tool-bar* menu, *Examples*. The input screen summarizes key pre- and post-processing steps, as well as results for nodal spacings of 1 and 0.125 mm. As an exercise, press *Run* to solve for the nodal temperatures, and in the *View* menu, select *Temperature Contours* to represent the temperature field in the form of isotherms.

## 5.11

### Summary

Transient conduction occurs in numerous engineering applications and may be treated using different methods. There is certainly much to be said for simplicity, in which case, when confronted with a transient problem, the first thing you should do

is calculate the Biot number. If this number is much less than unity, you may use the lumped capacitance method to obtain accurate results with minimal computational requirements. However, if the Biot number is not much less than unity, spatial effects must be considered, and some other method must be used. Analytical results are available in convenient graphical and equation form for the plane wall, the infinite cylinder, the sphere, and the semi-infinite solid. You should know when and how to use these results. If geometrical complexities and/or the form of the boundary conditions preclude their use, recourse must be made to an approximate numerical technique, such as the finite-difference method.

You may test your understanding of key concepts by addressing the following questions.

- Under what conditions may the *lumped capacitance method* be used to predict the transient response of a solid to a change in its thermal environment?
- What is the physical interpretation of the *Biot number*?
- Is the lumped capacitance method of analysis likely to be more applicable for a hot solid being cooled by forced convection in air or in water? By forced convection in air or natural convection in air?
- Is the lumped capacitance method of analysis likely to be more applicable for cooling of a hot solid made of copper or aluminum? For silicon nitride or glass?
- What parameters determine the *time constant* associated with the transient thermal response of a lumped capacitance solid? Is this response accelerated or decelerated by an increase in the convection coefficient? By an increase in the density or specific heat of the solid?
- For one-dimensional, transient conduction in a plane wall, a long cylinder or a sphere with surface convection, what dimensionless parameters may be used to simplify the representation of thermal conditions? How are these parameters defined?
- Why is the semi-infinite solution applicable to any geometry at early times?
- What is the physical interpretation of the *Fourier number*?
- What requirement must be satisfied for use of a *one-term approximation* to determine the transient thermal response of a plane wall, a long cylinder or a sphere experiencing one-dimensional conduction due to a change in surface conditions? At what stage of a transient process is the requirement not satisfied?
- What does transient heating or cooling of a plane wall with equivalent convection conditions at opposite surfaces have in common with a plane wall heated or cooled by convection at one surface and well insulated at the other surface?
- How may a one-term approximation be used to determine the transient thermal response of a plane wall, long cylinder, or sphere subjected to a sudden change in surface temperature?
- For one-dimensional, transient conduction, what is implied by the idealization of a *semi-infinite* solid? Under what conditions may the idealization be applied to a plane wall?
- What differentiates an *explicit*, finite-difference solution to a transient conduction problem from an *implicit* solution?
- What is meant by characterization of the implicit finite-difference method as *unconditionally stable*? What constraint is placed on the explicit method to ensure a stable solution?


## References

1. Carslaw, H. S., and J. C. Jaeger, *Conduction of Heat in Solids*, 2nd ed., Oxford University Press, London, 1986.
2. Schneider, P. J., *Conduction Heat Transfer*, Addison-Wesley, Reading, MA, 1957.
3. Kakac, S., and Y. Yener, *Heat Conduction*, Taylor & Francis, Washington, DC, 1993.
4. Poulidakos, D., *Conduction Heat Transfer*, Prentice-Hall, Englewood Cliffs, NJ, 1994.
5. Yovanovich, M. M., "Conduction and Thermal Contact Resistances (Conductances)," in W. M. Rohsenow, J. P. Hartnett, and Y. I. Cho, Eds. *Handbook of Heat Transfer*, McGraw-Hill, New York, 1998, pp. 3.1–3.73.
6. Hirsch, L. R., R. J. Stafford, J. A. Bankson, S. R. Serksen, B. Rivera, R. E. Price, J. D. Hazle, N. J. Halas, and J. L. West, *Proc. Nat. Acad. Sciences of the U.S.*, **100**, 13549–13554, 2003.
7. Cahill, D.G., *Rev. Sci. Instrum.*, **61**, 802–808, 1990.


## Problems

### Qualitative Considerations

- 5.1 Consider a thin electrical heater attached to a plate and backed by insulation. Initially, the heater and plate are at the temperature of the ambient air,  $T_\infty$ . Suddenly, the power to the heater is activated, yielding a constant heat flux  $q_o''$  (W/m<sup>2</sup>) at the inner surface of the plate.

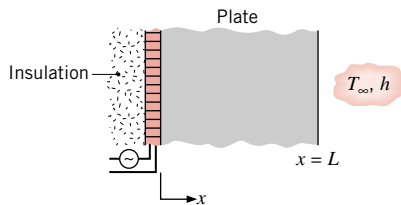

- (a) Sketch and label, on  $T$ - $x$  coordinates, the temperature distributions: initial, steady-state, and at two intermediate times.
  - (b) Sketch the heat flux at the outer surface  $q_x''(L, t)$  as a function of time.
- 5.2 The inner surface of a plane wall is insulated while the outer surface is exposed to an airstream at  $T_\infty$ . The wall is at a uniform temperature corresponding to that of the airstream. Suddenly, a radiation heat source is switched on applying a uniform flux  $q_o''$  to the outer surface.

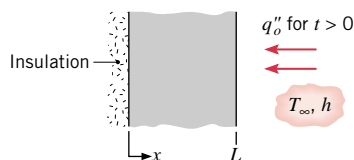

- (a) Sketch and label, on  $T$ - $x$  coordinates, the temperature distributions: initial, steady-state, and at two intermediate times.

- (b) Sketch the heat flux at the outer surface  $q_x''(L, t)$  as a function of time.

- 5.3 A microwave oven operates on the principle that application of a high-frequency field causes electrically polarized molecules in food to oscillate. The net effect is a nearly *uniform generation* of thermal energy within the food. Consider the process of cooking a slab of beef of thickness  $2L$  in a microwave oven and compare it with cooking in a conventional oven, where *each side* of the slab is *heated by radiation*. In each case the meat is to be heated from  $0^\circ\text{C}$  to a *minimum* temperature of  $90^\circ\text{C}$ . Base your comparison on a sketch of the temperature distribution at selected times for each of the cooking processes. In particular, consider the time  $t_0$  at which heating is initiated, a time  $t_1$  during the heating process, the time  $t_2$  corresponding to the conclusion of heating, and a time  $t_3$  well into the subsequent cooling process.

- 5.4 A plate of thickness  $2L$ , surface area  $A_s$ , mass  $M$ , and specific heat  $c_p$ , initially at a uniform temperature  $T_i$ , is suddenly heated on both surfaces by a convection process ( $T_\infty, h$ ) for a period of time  $t_o$ , following which the plate is insulated. Assume that the midplane temperature does not reach  $T_\infty$  within this period of time.

- (a) Assuming  $Bi \gg 1$  for the heating process, sketch and label, on  $T$ - $x$  coordinates, the following temperature distributions: initial, steady-state ( $t \rightarrow \infty$ ),  $T(x, t_o)$ , and at two intermediate times between  $t = t_o$  and  $t \rightarrow \infty$ .
- (b) Sketch and label, on  $T$ - $t$  coordinates, the midplane and exposed surface temperature distributions.
- (c) Repeat parts (a) and (b) assuming  $Bi \ll 1$  for the plate.

- (d) Derive an expression for the steady-state temperature  $T(x, \infty) = T_f$ , leaving your result in terms of plate parameters ( $M, c_p$ ), thermal conditions ( $T_i, T_\infty, h$ ), the surface temperature  $T(L, t)$ , and the heating time  $t_o$ .

### Lumped Capacitance Method

**5.5** Steel balls 12 mm in diameter are annealed by heating to 1150 K and then slowly cooling to 400 K in an air environment for which  $T_\infty = 325$  K and  $h = 20$  W/m<sup>2</sup> · K. Assuming the properties of the steel to be  $k = 40$  W/m · K,  $\rho = 7800$  kg/m<sup>3</sup>, and  $c = 600$  J/kg · K, estimate the time required for the cooling process.


**5.6** Consider the steel balls of Problem 5.5, except now the air temperature increases with time as  $T_\infty(t) = 325$  K +  $at$  where  $a = 0.1875$  K/s.

- (a) Sketch the ball temperature versus time for  $0 \leq t \leq 1$  h. Also show the ambient temperature,  $T_\infty$ , in your graph. Explain special features of the ball temperature behavior.
- (b) Find an expression for the ball temperature as a function of time,  $T(t)$ , and plot the ball temperature for  $0 \leq t \leq 1$  h. Was your sketch correct?

**5.7** The heat transfer coefficient for air flowing over a sphere is to be determined by observing the temperature–time history of a sphere fabricated from pure copper. The sphere, which is 12.7 mm in diameter, is at 66°C before it is inserted into an airstream having a temperature of 27°C. A thermocouple on the outer surface of the sphere indicates 55°C 69 s after the sphere is inserted in the airstream. Assume, and then justify, that the sphere behaves as a spacewise isothermal object and calculate the heat transfer coefficient.

**5.8** A solid steel sphere (AISI 1010), 300 mm in diameter, is coated with a dielectric material layer of thickness 2 mm and thermal conductivity 0.04 W/m · K. The coated sphere is initially at a uniform temperature of 500°C and is suddenly quenched in a large oil bath for which  $T_\infty = 100^\circ\text{C}$  and  $h = 3300$  W/m<sup>2</sup> · K. Estimate the time required for the coated sphere temperature to reach 140°C. *Hint:* Neglect the effect of energy storage in the dielectric material, since its thermal capacitance ( $\rho cV$ ) is small compared to that of the steel sphere.


**5.9** The base plate of an iron has a thickness of  $L = 7$  mm and is made from an aluminum alloy ( $\rho = 2800$  kg/m<sup>3</sup>,  $c = 900$  J/kg · K,  $k = 180$  W/m · K,  $\varepsilon = 0.80$ ). An electric resistance heater is attached to the inner surface of the plate, while the outer surface is exposed to ambient air and large surroundings at  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ . The areas of both the inner and outer surfaces are  $A_s = 0.040$  m<sup>2</sup>.

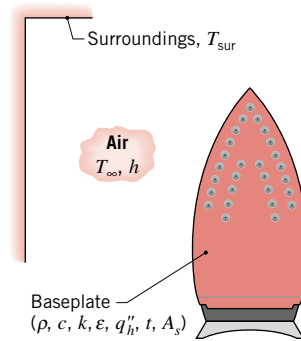

If an approximately uniform heat flux of  $q''_h = 1.25 \times 10^4$  W/m<sup>2</sup> is applied to the inner surface of the base plate and the convection coefficient at the outer surface is  $h = 10$  W/m<sup>2</sup> · K, estimate the time required for the plate to reach a temperature of 135°C. *Hint:* Numerical integration is suggested in order to solve the problem.

**5.10** Carbon steel (AISI 1010) shafts of 0.1-m diameter are heat treated in a gas-fired furnace whose gases are at 1200 K and provide a convection coefficient of 100 W/m<sup>2</sup> · K. If the shafts enter the furnace at 300 K, how long must they remain in the furnace to achieve a centerline temperature of 800 K?

**5.11** A thermal energy storage unit consists of a large rectangular channel, which is well insulated on its outer surface and encloses alternating layers of the storage material and the flow passage.

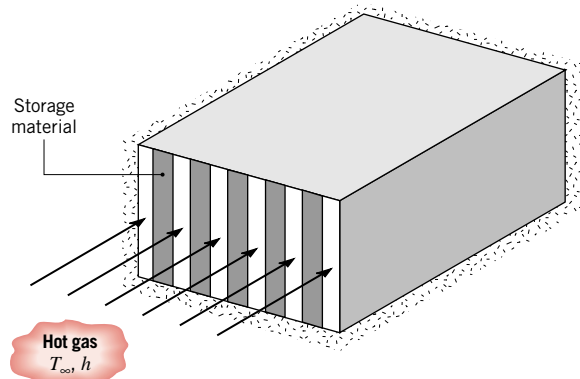


Each layer of the storage material is an aluminum slab of width  $W = 0.05$  m, which is at an initial temperature of 25°C. Consider conditions for which the storage unit is charged by passing a hot gas through the passages, with the gas temperature and the convection coefficient assumed to have constant values of  $T_\infty = 600^\circ\text{C}$  and  $h = 100$  W/m<sup>2</sup> · K throughout the channel. How long will it take to achieve 75% of the maximum possible




energy storage? What is the temperature of the aluminum at this time?

- 5.12** Thermal energy storage systems commonly involve a *packed bed* of solid spheres, through which a hot gas flows if the system is being charged, or a cold gas if it is being discharged. In a charging process, heat transfer from the hot gas increases thermal energy stored within the colder spheres; during discharge, the stored energy decreases as heat is transferred from the warmer spheres to the cooler gas.

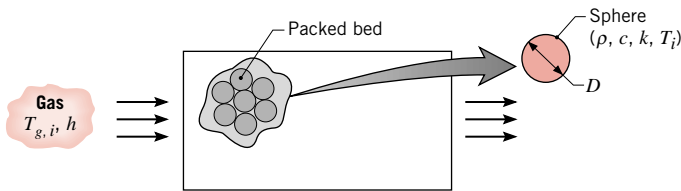

Consider a packed bed of 75-mm-diameter aluminum spheres ( $\rho = 2700 \text{ kg/m}^3$ ,  $c = 950 \text{ J/kg} \cdot \text{K}$ ,  $k = 240 \text{ W/m} \cdot \text{K}$ ) and a charging process for which gas enters the storage unit at a temperature of  $T_{g,i} = 300^\circ\text{C}$ . If the initial temperature of the spheres is  $T_i = 25^\circ\text{C}$  and the convection coefficient is  $h = 75 \text{ W/m}^2 \cdot \text{K}$ , how long does it take a sphere near the inlet of the system to accumulate 90% of the maximum possible thermal energy? What is the corresponding temperature at the center of the sphere? Is there any advantage to using copper instead of aluminum?

- 5.13** A tool used for fabricating semiconductor devices consists of a chuck (thick metallic, cylindrical disk) onto which a very thin silicon wafer ( $\rho = 2700 \text{ kg/m}^3$ ,  $c = 875 \text{ J/kg} \cdot \text{K}$ ,  $k = 177 \text{ W/m} \cdot \text{K}$ ) is placed by a robotic arm. Once in position, an electric field in the chuck is energized, creating an electrostatic force that holds the wafer firmly to the chuck. To ensure a reproducible thermal contact resistance between the chuck and the wafer from cycle-to-cycle, pressurized helium gas is introduced at the center of the chuck and flows (very slowly) radially outward between the asperities of the interface region.

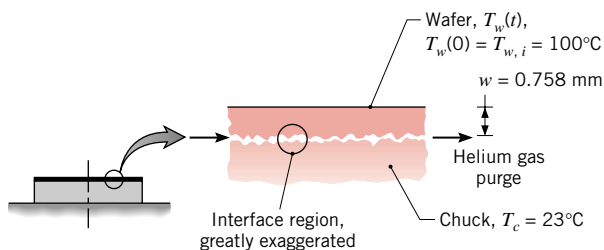


An experiment has been performed under conditions for which the wafer, initially at a uniform temperature  $T_{w,i} = 100^\circ\text{C}$ , is suddenly placed on the chuck, which is at a uniform and constant temperature  $T_c = 23^\circ\text{C}$ . With the wafer in place, the electrostatic force and the helium gas flow are applied. After 15 seconds, the temperature of the wafer is determined to be  $33^\circ\text{C}$ . What is the thermal contact resistance  $R''_{t,c}$  ( $\text{m}^2 \cdot \text{K/W}$ ) between the wafer and chuck? Will the value of  $R''_{t,c}$  increase, decrease, or remain the same if air, instead of helium, is used as the purge gas?

- 5.14** A spherical vessel used as a reactor for producing pharmaceuticals has a 5-mm-thick stainless steel wall ( $k = 17 \text{ W/m} \cdot \text{K}$ ) and an inner diameter of  $D_i = 1.0 \text{ m}$ . During production, the vessel is filled with reactants for which  $\rho = 1100 \text{ kg/m}^3$  and  $c = 2400 \text{ J/kg} \cdot \text{K}$ , while exothermic reactions release energy at a volumetric rate of  $\dot{q} = 10^4 \text{ W/m}^3$ . As first approximations, the reactants may be assumed to be well stirred and the thermal capacitance of the vessel may be neglected.

- (a) The exterior surface of the vessel is exposed to ambient air ( $T_\infty = 25^\circ\text{C}$ ) for which a convection coefficient of  $h = 6 \text{ W/m}^2 \cdot \text{K}$  may be assumed. If the initial temperature of the reactants is  $25^\circ\text{C}$ , what is the temperature of the reactants after five hours of process time? What is the corresponding temperature at the outer surface of the vessel?
- (b) Explore the effect of varying the convection coefficient on transient thermal conditions within the reactor.

- 5.15** Batch processes are often used in chemical and pharmaceutical operations to achieve a desired chemical composition for the final product and typically involve a transient heating operation to take the product from room temperature to the desired process temperature.

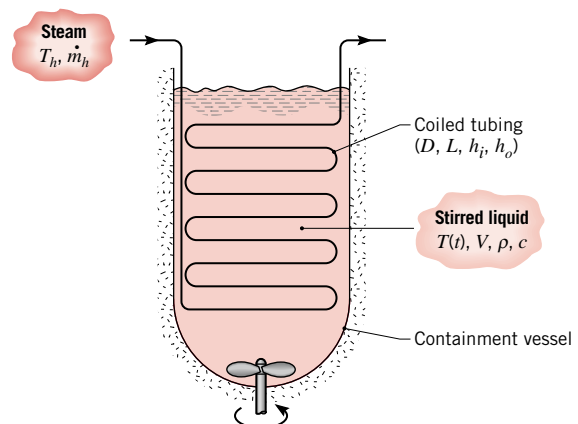




Consider a situation for which a chemical of density  $\rho = 1200 \text{ kg/m}^3$  and specific heat  $c = 2200 \text{ J/kg} \cdot \text{K}$  occupies a volume of  $V = 2.25 \text{ m}^3$  in an insulated vessel. The chemical is to be heated from room temperature,  $T_i = 300 \text{ K}$ , to a process temperature of  $T = 450 \text{ K}$  by passing saturated steam at  $T_h = 500 \text{ K}$  through a coiled, thin-walled, 20-mm-diameter tube in the vessel. Steam condensation within the tube maintains an interior convection coefficient of  $h_i = 10,000 \text{ W/m}^2 \cdot \text{K}$ , while the highly agitated liquid in the stirred vessel maintains an outside convection coefficient of  $h_o = 2000 \text{ W/m}^2 \cdot \text{K}$ .


If the chemical is to be heated from 300 to 450 K in 60 minutes, what is the required length  $L$  of the submerged tubing?

- 5.16** A plane wall of a furnace is fabricated from plain carbon steel ( $k = 60 \text{ W/m} \cdot \text{K}$ ,  $\rho = 7850 \text{ kg/m}^3$ ,  $c = 430 \text{ J/kg} \cdot \text{K}$ ) and is of thickness  $L = 10 \text{ mm}$ . To protect it from the corrosive effects of the furnace combustion gases, one surface of the wall is coated with a thin ceramic film that, for a unit surface area, has a thermal resistance of  $R''_{t,f} = 0.01 \text{ m}^2 \cdot \text{K/W}$ . The opposite surface is well insulated from the surroundings.

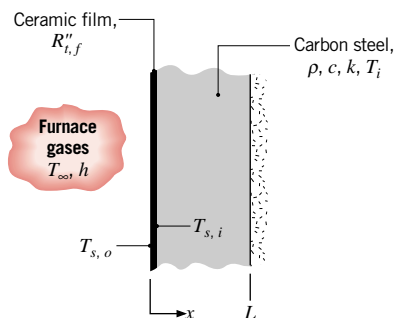

At furnace start-up the wall is at an initial temperature of  $T_i = 300 \text{ K}$ , and combustion gases at  $T_\infty = 1300 \text{ K}$  enter the furnace, providing a convection coefficient of  $h = 25 \text{ W/m}^2 \cdot \text{K}$  at the ceramic film. Assuming the film to have negligible thermal capacitance, how long will it take for the inner surface of the steel to achieve a temperature of  $T_{s,i} = 1200 \text{ K}$ ? What is the temperature  $T_{s,o}$  of the exposed surface of the ceramic film at this time?

- 5.17** A steel strip of thickness  $\delta = 12 \text{ mm}$  is annealed by passing it through a large furnace whose walls are maintained at a temperature  $T_w$  corresponding to that of combustion gases flowing through the furnace ( $T_w = T_\infty$ ). The strip, whose density, specific heat, thermal conductivity, and emissivity are  $\rho = 7900 \text{ kg/m}^3$ ,  $c_p = 640 \text{ J/kg} \cdot \text{K}$ ,  $k = 30 \text{ W/m} \cdot \text{K}$ , and  $\varepsilon = 0.7$ , respectively, is to be heated from  $300^\circ\text{C}$  to  $600^\circ\text{C}$ .

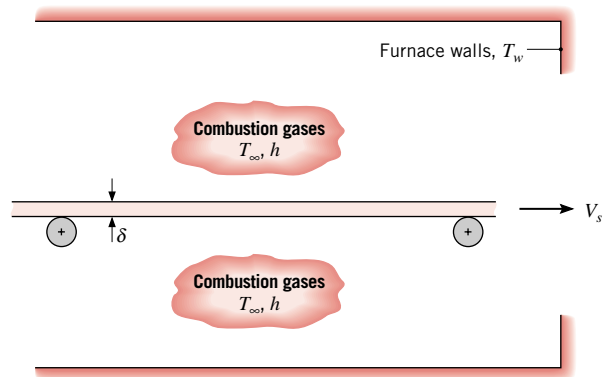

- (a) For a uniform convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$  and  $T_w = T_\infty = 700^\circ\text{C}$ , determine the time required to heat the strip. If the strip is moving at  $0.5 \text{ m/s}$ , how long must the furnace be?
- (b) The annealing process may be accelerated (the strip speed increased) by increasing the environmental temperatures. For the furnace length obtained in part (a), determine the strip speed for  $T_w = T_\infty = 850^\circ\text{C}$  and  $T_w = T_\infty = 1000^\circ\text{C}$ . For each set of environmental temperatures ( $700$ ,  $850$ , and  $1000^\circ\text{C}$ ), plot the strip temperature as a function of time over the range  $25^\circ\text{C} \leq T \leq 600^\circ\text{C}$ . Over this range, also plot the radiation heat transfer coefficient,  $h_r$ , as a function of time.
- 5.18** A long wire of diameter  $D = 1 \text{ mm}$  is submerged in an oil bath of temperature  $T_\infty = 25^\circ\text{C}$ . The wire has an electrical resistance per unit length of  $R'_e = 0.01 \Omega/\text{m}$ . If a current of  $I = 100 \text{ A}$  flows through the wire and the convection coefficient is  $h = 500 \text{ W/m}^2 \cdot \text{K}$ , what is the steady-state temperature of the wire? From the time the current is applied, how long does it take for the wire to reach a temperature that is within  $1^\circ\text{C}$  of the steady-state value? The properties of the wire are  $\rho = 8000 \text{ kg/m}^3$ ,  $c = 500 \text{ J/kg} \cdot \text{K}$ , and  $k = 20 \text{ W/m} \cdot \text{K}$ .
- 5.19** Consider the system of Problem 5.1 where the temperature of the plate is spacewise isothermal during the transient process.
- (a) Obtain an expression for the temperature of the plate as a function of time  $T(t)$  in terms of  $q''_o$ ,  $T_\infty$ ,  $h$ ,  $L$ , and the plate properties  $\rho$  and  $c$ .
- (b) Determine the thermal time constant and the steady-state temperature for a 12-mm-thick plate of pure copper when  $T_\infty = 27^\circ\text{C}$ ,  $h = 50 \text{ W/m}^2 \cdot \text{K}$ , and  $q''_o = 5000 \text{ W/m}^2$ . Estimate the time required to reach steady-state conditions.
- (c) For the conditions of part (b), as well as for  $h = 100$  and  $200 \text{ W/m}^2 \cdot \text{K}$ , compute and plot the

corresponding temperature histories of the plate for  $0 \leq t \leq 2500$  s.

- 5.20** An electronic device, such as a power transistor mounted on a finned heat sink, can be modeled as a spatially isothermal object with internal heat generation and an external convection resistance.

- (a) Consider such a system of mass  $M$ , specific heat  $c$ , and surface area  $A_s$ , which is initially in equilibrium with the environment at  $T_\infty$ . Suddenly, the electronic device is energized such that a constant heat generation  $\dot{E}_g$  (W) occurs. Show that the temperature response of the device is


$$\frac{\theta}{\theta_i} = \exp\left(-\frac{t}{RC}\right)$$

where  $\theta \equiv T - T(\infty)$  and  $T(\infty)$  is the steady-state temperature corresponding to  $t \rightarrow \infty$ ;  $\theta_i = T_i - T(\infty)$ ;  $T_i$  = initial temperature of device;  $R$  = thermal resistance  $1/hA_s$ ; and  $C$  = thermal capacitance  $Mc$ .

- (b) An electronic device, which generates 60 W of heat, is mounted on an aluminum heat sink weighing 0.31 kg and reaches a temperature of 100°C in ambient air at 20°C under steady-state conditions. If the device is initially at 20°C, what temperature will it reach 5 min after the power is switched on?
- 5.21** Before being injected into a furnace, pulverized coal is preheated by passing it through a cylindrical tube whose surface is maintained at  $T_{\text{sur}} = 1000^\circ\text{C}$ . The coal pellets are suspended in an airflow and are known to move with a speed of 3 m/s. If the pellets may be approximated as spheres of 1-mm diameter and it may be assumed that they are heated by radiation transfer from the tube surface, how long must the tube be to heat coal entering at 25°C to a temperature of 600°C? Is the use of the lumped capacitance method justified?
- 5.22** A metal sphere of diameter  $D$ , which is at a uniform temperature  $T_i$ , is suddenly removed from a furnace and suspended from a fine wire in a large room with air at a uniform temperature  $T_\infty$  and the surrounding walls at a temperature  $T_{\text{sur}}$ .
- (a) Neglecting heat transfer by radiation, obtain an expression for the time required to cool the sphere to some temperature  $T$ .
- (b) Neglecting heat transfer by convection, obtain an expression for the time required to cool the sphere to the temperature  $T$ .
- (c) How would you go about determining the time required for the sphere to cool to the temperature  $T$  if both convection and radiation are of the same order of magnitude?

- (d) Consider an anodized aluminum sphere ( $\varepsilon = 0.75$ ) 50 mm in diameter, which is at an initial temperature of  $T_i = 800$  K. Both the air and surroundings are at 300 K, and the convection coefficient is  $10 \text{ W/m}^2 \cdot \text{K}$ . For the conditions of parts (a), (b), and (c), determine the time required for the sphere to cool to 400 K. Plot the corresponding temperature histories. Repeat the calculations for a polished aluminum sphere ( $\varepsilon = 0.1$ ).

- 5.23** As permanent space stations increase in size, there is an attendant increase in the amount of electrical power they dissipate. To keep station compartment temperatures from exceeding prescribed limits, it is necessary to transfer the dissipated heat to space. A novel heat rejection scheme that has been proposed for this purpose is termed a Liquid Droplet Radiator (LDR). The heat is first transferred to a high vacuum oil, which is then injected into outer space as a stream of small droplets. The stream is allowed to traverse a distance  $L$ , over which it cools by radiating energy to outer space at absolute zero temperature. The droplets are then collected and routed back to the space station.

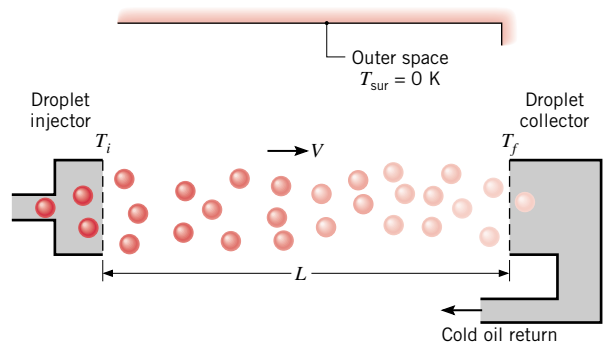


Consider conditions for which droplets of emissivity  $\varepsilon = 0.95$  and diameter  $D = 0.5$  mm are injected at a temperature of  $T_i = 500$  K and a velocity of  $V = 0.1$  m/s. Properties of the oil are  $\rho = 885 \text{ kg/m}^3$ ,  $c = 1900 \text{ J/kg} \cdot \text{K}$ , and  $k = 0.145 \text{ W/m} \cdot \text{K}$ . Assuming each drop to radiate to deep space at  $T_{\text{sur}} = 0$  K, determine the distance  $L$  required for the droplets to impact the collector at a final temperature of  $T_f = 300$  K. What is the amount of thermal energy rejected by each droplet?

- 5.24** In a material processing experiment conducted aboard the space shuttle, a coated niobium sphere of 10-mm diameter is removed from a furnace at 900°C and cooled to a temperature of 300°C. Although properties of the niobium vary over this temperature range, constant values may be assumed to a reasonable approximation, with  $\rho = 8600 \text{ kg/m}^3$ ,  $c = 290 \text{ J/kg} \cdot \text{K}$ , and  $k = 63 \text{ W/m} \cdot \text{K}$ .

- (a) If cooling is implemented in a large evacuated chamber whose walls are at  $25^\circ\text{C}$ , determine the time required to reach the final temperature if the coating is polished and has an emissivity of  $\varepsilon = 0.1$ . How long would it take if the coating is oxidized and  $\varepsilon = 0.6$ ?
- (b) To reduce the time required for cooling, consideration is given to immersion of the sphere in an inert gas stream for which  $T_\infty = 25^\circ\text{C}$  and  $h = 200 \text{ W/m}^2 \cdot \text{K}$ . Neglecting radiation, what is the time required for cooling?
- (c) Considering the effect of both radiation and convection, what is the time required for cooling if  $h = 200 \text{ W/m}^2 \cdot \text{K}$  and  $\varepsilon = 0.6$ ? Explore the effect on the cooling time of independently varying  $h$  and  $\varepsilon$ .

**5.25** Plasma spray-coating processes are often used to provide surface protection for materials exposed to hostile environments, which induce degradation through factors such as wear, corrosion, or outright thermal failure. Ceramic coatings are commonly used for this purpose. By injecting ceramic powder through the nozzle (anode) of a plasma torch, the particles are entrained by the plasma jet, within which they are then accelerated and heated.

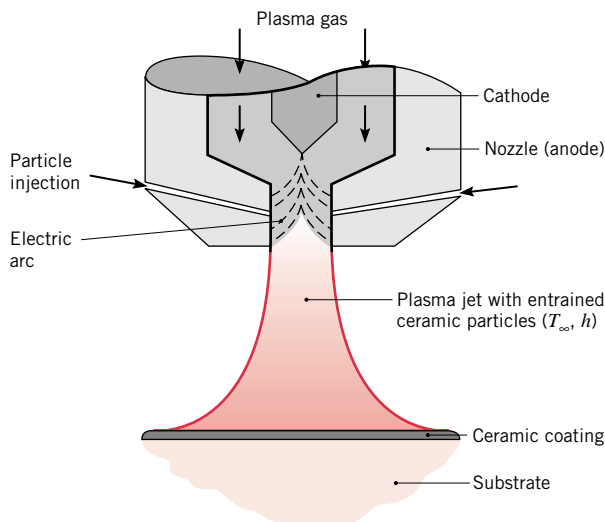

During their *time-in-flight*, the ceramic particles must be heated to their melting point and experience complete conversion to the liquid state. The coating is formed as the molten droplets impinge (*splat*) on the substrate material and experience rapid solidification. Consider conditions for which spherical alumina ( $\text{Al}_2\text{O}_3$ ) particles of diameter  $D_p = 50 \mu\text{m}$ , density  $\rho_p = 3970 \text{ kg/m}^3$ , thermal conductivity  $k_p = 10.5 \text{ W/m} \cdot \text{K}$ , and specific heat  $c_p = 1560 \text{ J/kg} \cdot \text{K}$  are injected into an


arc plasma, which is at  $T_\infty = 10,000 \text{ K}$  and provides a coefficient of  $h = 30,000 \text{ W/m}^2 \cdot \text{K}$  for convective heating of the particles. The melting point and latent heat of fusion of alumina are  $T_{\text{mp}} = 2318 \text{ K}$  and  $h_{sf} = 3577 \text{ kJ/kg}$ , respectively.

- (a) Neglecting radiation, obtain an expression for the time-in-flight,  $t_{i-f}$ , required to heat a particle from its initial temperature  $T_i$  to its melting point  $T_{\text{mp}}$ , and, once at the melting point, for the particle to experience complete melting. Evaluate  $t_{i-f}$  for  $T_i = 300 \text{ K}$  and the prescribed heating conditions.
- (b) Assuming alumina to have an emissivity of  $\varepsilon_p = 0.4$  and the particles to exchange radiation with large surroundings at  $T_{\text{sur}} = 300 \text{ K}$ , assess the validity of neglecting radiation.

**5.26** Thin film coatings characterized by high resistance to abrasion and fracture may be formed by using micro-scale composite particles in a plasma spraying process. A spherical particle typically consists of a *ceramic core*, such as tungsten carbide (WC), and a *metallic shell*, such as cobalt (Co). The ceramic provides the thin film coating with its desired hardness at elevated temperatures, while the metal serves to coalesce the particles on the coated surface and to inhibit crack formation. In the plasma spraying process, the particles are injected into a plasma gas jet that heats them to a temperature above the melting point of the metallic casing and melts the casing before the particles impact the surface.

Consider spherical particles comprised of a WC core of diameter  $D_i = 16 \mu\text{m}$ , which is encased in a Co shell of outer diameter  $D_o = 20 \mu\text{m}$ . If the particles flow in a plasma gas at  $T_\infty = 10,000 \text{ K}$  and the coefficient associated with convection from the gas to the particles is  $h = 20,000 \text{ W/m}^2 \cdot \text{K}$ , how long does it take to heat the particles from an initial temperature of  $T_i = 300 \text{ K}$  to the melting point of cobalt,  $T_{\text{mp}} = 1770 \text{ K}$ ? The density and specific heat of WC (the core of the particle) are  $\rho_c = 16,000 \text{ kg/m}^3$  and  $c_c = 300 \text{ J/kg} \cdot \text{K}$ , while the corresponding values for Co (the outer shell) are  $\rho_s = 8900 \text{ kg/m}^3$  and  $c_s = 750 \text{ J/kg} \cdot \text{K}$ . Once having reached the melting point, how much additional time is required to completely melt the cobalt if its latent heat of fusion is  $h_{sf} = 2.59 \times 10^5 \text{ J/kg}$ ? You may use the lumped capacitance method of analysis and neglect radiation exchange between the particle and its surroundings.


**5.27** A chip that is of length  $L = 5 \text{ mm}$  on a side and thickness  $t = 1 \text{ mm}$  is encased in a ceramic substrate, and its exposed surface is convectively cooled by a dielectric liquid for which  $h = 150 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 20^\circ\text{C}$ .

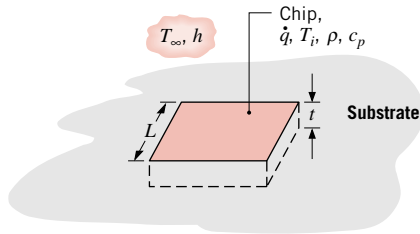

In the off-mode the chip is in thermal equilibrium with the coolant ( $T_i = T_\infty$ ). When the chip is energized, however, its temperature increases until a new steady-state is established. For purposes of analysis, the energized chip is characterized by uniform volumetric heating with  $\dot{q} = 9 \times 10^6 \text{ W/m}^3$ . Assuming an infinite contact resistance between the chip and substrate and negligible conduction resistance within the chip, determine the steady-state chip temperature  $T_f$ . Following activation of the chip, how long does it take to come within  $1^\circ\text{C}$  of this temperature? The chip density and specific heat are  $\rho = 2000 \text{ kg/m}^3$  and  $c = 700 \text{ J/kg} \cdot \text{K}$ , respectively.


- 5.28** Consider the conditions of Problem 5.27. In addition to treating heat transfer by convection directly from the chip to the coolant, a more realistic analysis would account for indirect transfer from the chip to the substrate and then from the substrate to the coolant. The total thermal resistance associated with this indirect route includes contributions due to the chip–substrate interface (a contact resistance), multidimensional conduction in the substrate, and convection from the surface of the substrate to the coolant. If this total thermal resistance is  $R_t = 200 \text{ K/W}$ , what is the steady-state chip temperature  $T_f$ ? Following activation of the chip, how long does it take to come within  $1^\circ\text{C}$  of this temperature?

- 5.29** Thermal stress testing is a common procedure used to assess the reliability of an electronic package. Typically, thermal stresses are induced in soldered or wired connections to reveal mechanisms that could cause failure and must therefore be corrected before the product is released. As an example of the procedure, consider an array of silicon chips ( $\rho_{\text{ch}} = 2300 \text{ kg/m}^3$ ,  $c_{\text{ch}} = 710 \text{ J/kg} \cdot \text{K}$ ) joined to an alumina substrate ( $\rho_{\text{sb}} = 4000 \text{ kg/m}^3$ ,  $c_{\text{sb}} = 770 \text{ J/kg} \cdot \text{K}$ ) by solder balls ( $\rho_{\text{sd}} = 11,000 \text{ kg/m}^3$ ,  $c_{\text{sd}} = 130 \text{ J/kg} \cdot \text{K}$ ). Each chip of width  $L_{\text{ch}}$  and thickness  $t_{\text{ch}}$  is joined to a unit substrate section of width  $L_{\text{sb}}$  and thickness  $t_{\text{sb}}$  by solder balls of diameter  $D$ .

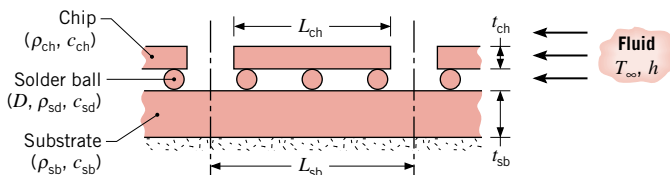

A thermal stress test begins by subjecting the multichip module, which is initially at room temperature, to a hot fluid stream and subsequently cooling the module by exposing it to a cold fluid stream. The process is repeated for a prescribed number of cycles to assess the integrity of the soldered connections.

- (a) As a first approximation, assume that there is negligible heat transfer between the components (chip/solder/substrate) of the module and that the thermal response of each component may be determined from a lumped capacitance analysis involving the same convection coefficient  $h$ . Assuming no reduction in surface area due to contact between a solder ball and the chip or substrate, obtain expressions for the thermal time constant of each component. Heat transfer is to all surfaces of a chip, but to only the top surface of the substrate. Evaluate the three time constants for  $L_{\text{ch}} = 15 \text{ mm}$ ,  $t_{\text{ch}} = 2 \text{ mm}$ ,  $L_{\text{sb}} = 25 \text{ mm}$ ,  $t_{\text{sb}} = 10 \text{ mm}$ ,  $D = 2 \text{ mm}$ , and a value of  $h = 50 \text{ W/m}^2 \cdot \text{K}$ , which is characteristic of an air stream. Compute and plot the temperature histories of the three components for the heating portion of a cycle, with  $T_i = 20^\circ\text{C}$  and  $T_\infty = 80^\circ\text{C}$ . At what time does each component experience 99% of its maximum possible temperature rise, that is,  $(T - T_i)/(T_\infty - T_i) = 0.99$ ? If the maximum stress on a solder ball corresponds to the maximum difference between its temperature and that of the chip or substrate, when will this maximum occur?
- (b) To reduce the time required to complete a stress test, a dielectric liquid could be used in lieu of air to provide a larger convection coefficient of  $h = 200 \text{ W/m}^2 \cdot \text{K}$ . What is the corresponding savings in time for each component to achieve 99% of its maximum possible temperature rise?
- 5.30** The objective of this problem is to develop thermal models for estimating the steady-state temperature and the transient temperature history of the electrical transformer shown below.

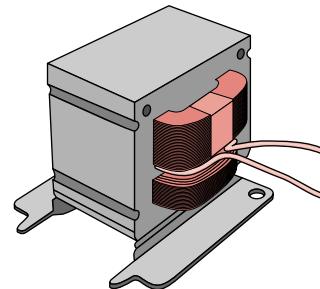


The external transformer geometry is approximately cubical, with a length of 32 mm to a side. The combined

mass of the iron and copper in the transformer is 0.28 kg, and its weighted-average specific heat is  $400 \text{ J/kg} \cdot \text{K}$ . The transformer dissipates 4.0 W and is operating in ambient air at  $T_\infty = 20^\circ\text{C}$ , with a convection coefficient of  $10 \text{ W/m}^2 \cdot \text{K}$ . List and justify the assumptions made in your analysis, and discuss limitations of the models.

- Beginning with a properly defined control volume, develop a model for estimating the steady-state temperature of the transformer,  $T(\infty)$ . Evaluate  $T(\infty)$  for the prescribed operating conditions.
- Develop a model for estimating the thermal response (temperature history) of the transformer if it is initially at a temperature of  $T_i = T_\infty$  and power is suddenly applied. Determine the time required for the transformer to come within  $5^\circ\text{C}$  of its steady-state operating temperature.

**5.31** In thermomechanical data storage, a processing head, consisting of  $M$  heated cantilevers, is used to write data onto an underlying polymer storage medium. Electrical resistance heaters are microfabricated onto each cantilever, which continually travel over the surface of the medium. The resistance heaters are turned on and off by controlling electrical current to each cantilever. As a cantilever goes through a complete heating and cooling cycle, the underlying polymer is softened, and one bit of data is written in the form of a *surface pit* in the polymer. A track of individual data bits (pits), each separated by approximately 50 nm, can be fabricated. Multiple tracks of bits, also separated by approximately 50 nm, are subsequently fabricated into the surface of the storage medium. Consider a single cantilever that is fabricated primarily of silicon with a mass of  $50 \times 10^{-18} \text{ kg}$  and a surface area of  $600 \times 10^{-15} \text{ m}^2$ . The cantilever is initially at  $T_i = T_\infty = 300 \text{ K}$ , and the heat transfer coefficient between the cantilever and the ambient is  $200 \times 10^3 \text{ W/m}^2 \cdot \text{K}$ .

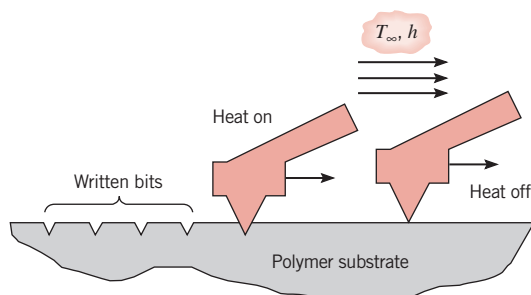

- Determine the ohmic heating required to raise the cantilever temperature to  $T = 1000 \text{ K}$  within a heating time of  $t_h = 1 \mu\text{s}$ . *Hint:* See Problem 5.20.
- Find the time required to cool the cantilever from 1000 K to 400 K ( $t_c$ ) and the thermal processing

time required for one complete heating and cooling cycle,  $t_p = t_h + t_c$ .

- Determine how many bits ( $N$ ) can be written onto a  $1 \text{ mm} \times 1 \text{ mm}$  polymer storage medium. If  $M = 100$  cantilevers are ganged onto a single processing head, determine the total thermal processing time needed to write the data.

**5.32** The melting of water initially at the fusion temperature,  $T_f = 0^\circ\text{C}$ , was considered in Example 1.5. Freezing of water often occurs at  $0^\circ\text{C}$ . However, pure liquids that undergo a cooling process can remain in a *supercooled* liquid state well below their equilibrium freezing temperature,  $T_f$ , particularly when the liquid is not in contact with any solid material. Droplets of liquid water in the atmosphere have a supercooled freezing temperature,  $T_{f,sc}$ , that can be well correlated to the droplet diameter by the expression  $T_{f,sc} = -28 + 0.87 \ln(D_p)$  in the diameter range  $10^{-7} < D_p < 10^{-2} \text{ m}$ , where  $T_{f,sc}$  has units of degrees Celsius and  $D_p$  is expressed in units of meters. For a droplet of diameter  $D = 50 \mu\text{m}$  and initial temperature  $T_i = 10^\circ\text{C}$  subject to ambient conditions of  $T_\infty = -40^\circ\text{C}$  and  $h = 900 \text{ W/m}^2 \cdot \text{K}$ , compare the time needed to completely solidify the droplet for case A, when the droplet solidifies at  $T_f = 0^\circ\text{C}$ , and case B, when the droplet starts to freeze at  $T_{f,sc}$ . Sketch the temperature histories from the initial time to the time when the droplets are completely solid. *Hint:* When the droplet reaches  $T_{f,sc}$  in case B, rapid solidification occurs during which the latent energy released by the freezing water is absorbed by the remaining liquid in the drop. As soon as any ice is formed within the droplet, the remaining liquid is in contact with a solid (the ice) and the freezing temperature immediately shifts from  $T_{f,sc}$  to  $T_f = 0^\circ\text{C}$ .

**5.33** As noted in Problem 5.3, microwave ovens operate by rapidly aligning and reversing water molecules within the food, resulting in volumetric energy generation and, in turn, cooking of the food. When the food is initially frozen, however, the water molecules do not readily oscillate in response to the microwaves, and the volumetric generation rates are between one and two orders of magnitude lower than if the water were in liquid form. (Microwave power that is not absorbed in the food is reflected back to the microwave generator, where it must be dissipated in the form of heat to prevent damage to the generator.)

- Consider a frozen, 1-kg spherical piece of ground beef at an initial temperature of  $T_i = -20^\circ\text{C}$  placed in a microwave oven with  $T_\infty = 30^\circ\text{C}$  and  $h = 15 \text{ W/m}^2 \cdot \text{K}$ . Determine how long it will take the beef to reach a uniform temperature of  $T = 0^\circ\text{C}$ , with all the water in the form of ice. Assume the properties




of the beef are the same as ice, and assume 3% of the oven power ( $P = 1$  kW total) is absorbed in the food.

- (b) After all the ice is converted to liquid, determine how long it will take to heat the beef to  $T_f = 80^\circ\text{C}$  if 95% of the oven power is absorbed in the food. Assume the properties of the beef are the same as liquid water.
- (c) When thawing food in microwave ovens, one may observe that some of the food may still be frozen while other parts of the food are overcooked. Explain why this occurs. Explain why most microwave ovens have thaw cycles that are associated with very low oven powers.

### One-Dimensional Conduction: The Plane Wall

- 5.34** Consider the series solution, Equation 5.39, for the plane wall with convection. Calculate midplane ( $x^* = 0$ ) and surface ( $x^* = 1$ ) temperatures  $\theta^*$  for  $Fo = 0.1$  and 1, using  $Bi = 0.1$ , 1, and 10. Consider only the first four eigenvalues. Based on these results discuss the validity of the approximate solutions, Equations 5.40 and 5.41.
- 5.35** Consider the one-dimensional wall shown in the sketch, which is initially at a uniform temperature  $T_i$  and is suddenly subjected to the convection boundary condition with a fluid at  $T_\infty$ .

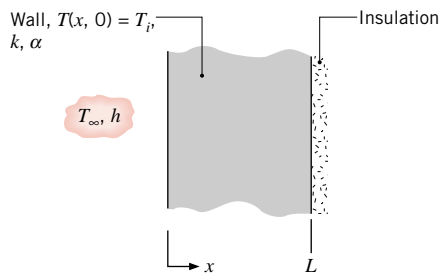


For a particular wall, case 1, the temperature at  $x = L_1$  after  $t_1 = 100$  s is  $T_1(L_1, t_1) = 315^\circ\text{C}$ . Another wall, case 2, has different thickness and thermal conditions as shown below.

Case	$L$ (m)	$\alpha$ ( $\text{m}^2/\text{s}$ )	$k$ ( $\text{W}/\text{m} \cdot \text{K}$ )	$T_i$ ( $^\circ\text{C}$ )	$T_\infty$ ( $^\circ\text{C}$ )	$h$ ( $\text{W}/\text{m}^2 \cdot \text{K}$ )
1	0.10	$15 \times 10^{-6}$	50	300	400	200
2	0.40	$25 \times 10^{-6}$	100	30	20	100

How long will it take for the second wall to reach  $28.5^\circ\text{C}$  at the position  $x = L_2$ ? Use as the basis for

analysis, the dimensionless functional dependence for the transient temperature distribution expressed in Equation 5.38.

- 5.36** Referring to the semiconductor processing tool of Problem 5.13, it is desired at some point in the manufacturing cycle to cool the chuck, which is made of aluminum alloy 2024. The proposed cooling scheme passes air at  $20^\circ\text{C}$  between the air-supply head and the chuck surface.

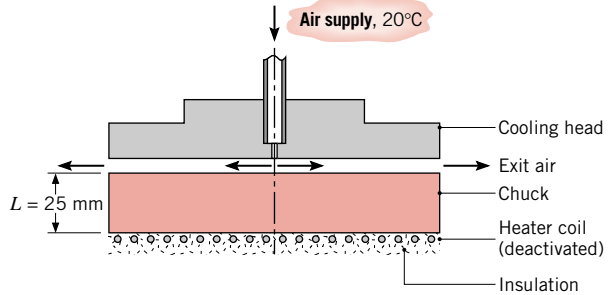

- (a) If the chuck is initially at a uniform temperature of  $100^\circ\text{C}$ , calculate the time required for its lower surface to reach  $25^\circ\text{C}$ , assuming a uniform convection coefficient of  $50 \text{ W}/\text{m}^2 \cdot \text{K}$  at the head–chuck interface.
- (b) Generate a plot of the time-to-cool as a function of the convection coefficient for the range  $10 \leq h \leq 2000 \text{ W}/\text{m}^2 \cdot \text{K}$ . If the lower limit represents a free convection condition without any head present, comment on the effectiveness of the head design as a method for cooling the chuck.

- 5.37** Annealing is a process by which steel is reheated and then cooled to make it less brittle. Consider the reheat stage for a 100-mm-thick steel plate ( $\rho = 7830 \text{ kg}/\text{m}^3$ ,  $c = 550 \text{ J}/\text{kg} \cdot \text{K}$ ,  $k = 48 \text{ W}/\text{m} \cdot \text{K}$ ), which is initially at a uniform temperature of  $T_i = 200^\circ\text{C}$  and is to be heated to a minimum temperature of  $550^\circ\text{C}$ . Heating is effected in a gas-fired furnace, where products of combustion at  $T_\infty = 800^\circ\text{C}$  maintain a convection coefficient of  $h = 250 \text{ W}/\text{m}^2 \cdot \text{K}$  on both surfaces of the plate. How long should the plate be left in the furnace?

- 5.38** Consider the heavily insulated pipe of Example 5.4, which is suddenly subjected to the flow of hot oil. Use the *Transient Conduction, Plane Wall* model of *IHT* to obtain the following solutions.

- (a) Calculate the temperature of the inner and outer surfaces of the pipe, the heat flux at the inner surface, and the energy transferred to the wall after 8 min. Compare your results with those obtained in the example.
- (b) At what time will the outer surface temperature of the pipe,  $T(0, t)$ , reach  $25^\circ\text{C}$ ?

- (c) Using the *Explore* and *Graph* options of *IHT*, calculate and plot on a single graph the temperature distributions,  $T(x, t)$ , for the initial condition, the final condition, and intermediate times of 4 and 8 min. Explain key features of the distributions.
- (d) Calculate and plot the temperature histories,  $T(x, t)$ , at the inner ( $x = 0$ ) and outer ( $x = L$ ) pipe surfaces for  $0 \leq t \leq 16$  min.


**5.39** The 150-mm-thick wall of a gas-fired furnace is constructed of fire-clay brick ( $k = 1.5 \text{ W/m} \cdot \text{K}$ ,  $\rho = 2600 \text{ kg/m}^3$ ,  $c_p = 1000 \text{ J/kg} \cdot \text{K}$ ) and is well insulated at its outer surface. The wall is at a uniform initial temperature of  $20^\circ\text{C}$ , when the burners are fired and the inner surface is exposed to products of combustion for which  $T_\infty = 950^\circ\text{C}$  and  $h = 100 \text{ W/m}^2 \cdot \text{K}$ .

- (a) How long does it take for the outer surface of the wall to reach a temperature of  $750^\circ\text{C}$ ?
- (b) Plot the temperature distribution in the wall at the foregoing time, as well as at several intermediate times.


**5.40** Steel is sequentially heated and cooled (*annealed*) to relieve stresses and to make it less brittle. Consider a 100-mm-thick plate ( $k = 45 \text{ W/m} \cdot \text{K}$ ,  $\rho = 7800 \text{ kg/m}^3$ ,  $c_p = 500 \text{ J/kg} \cdot \text{K}$ ) that is initially at a uniform temperature of  $300^\circ\text{C}$  and is heated (on both sides) in a gas-fired furnace for which  $T_\infty = 700^\circ\text{C}$  and  $h = 500 \text{ W/m}^2 \cdot \text{K}$ . How long will it take for a minimum temperature of  $550^\circ\text{C}$  to be reached in the plate?

**5.41** A plate of thickness  $2L = 25 \text{ mm}$  at a temperature of  $600^\circ\text{C}$  is removed from a hot pressing operation and must be cooled rapidly in order to achieve the required physical properties. The process engineer plans to use air jets to control the rate of cooling, but she is uncertain whether it is necessary to cool both sides (case 1) or only one side (case 2) of the plate. The concern is not just for the *time-to-cool*, but also for the maximum temperature difference within the plate. If this temperature difference is too large, the plate can experience significant warping.

Case 1: cooling, both sides

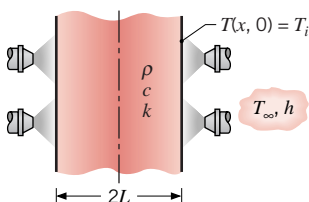

Case 2: cooling, one side only



The air supply is at  $25^\circ\text{C}$ , and the convection coefficient on the surface is  $400 \text{ W/m}^2 \cdot \text{K}$ . The thermophysical

properties of the plate are  $\rho = 3000 \text{ kg/m}^3$ ,  $c = 750 \text{ J/kg} \cdot \text{K}$ , and  $k = 15 \text{ W/m} \cdot \text{K}$ .

- (a) Using the *IHT* software, calculate and plot on one graph the temperature histories for cases 1 and 2 for a 500-s cooling period. Compare the times required for the maximum temperature in the plate to reach  $100^\circ\text{C}$ . Assume no heat loss from the unexposed surface of case 2.
- (b) For both cases, calculate and plot on one graph the variation with time of the maximum temperature difference in the plate. Comment on the relative magnitudes of the temperature gradients within the plate as a function of time.

**5.42** During transient operation, the steel nozzle of a rocket engine must not exceed a maximum allowable operating temperature of  $1500 \text{ K}$  when exposed to combustion gases characterized by a temperature of  $2300 \text{ K}$  and a convection coefficient of  $5000 \text{ W/m}^2 \cdot \text{K}$ . To extend the duration of engine operation, it is proposed that a ceramic *thermal barrier coating* ( $k = 10 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 6 \times 10^{-6} \text{ m}^2/\text{s}$ ) be applied to the interior surface of the nozzle.

- (a) If the ceramic coating is 10 mm thick and at an initial temperature of  $300 \text{ K}$ , obtain a conservative estimate of the maximum allowable duration of engine operation. The nozzle radius is much larger than the combined wall and coating thickness.

- (b) Compute and plot the inner and outer surface temperatures of the coating as a function of time for  $0 \leq t \leq 150 \text{ s}$ . Repeat the calculations for a coating thickness of 40 mm.

**5.43** In a tempering process, glass plate, which is initially at a uniform temperature  $T_i$ , is cooled by suddenly reducing the temperature of both surfaces to  $T_s$ . The plate is 20 mm thick, and the glass has a thermal diffusivity of  $6 \times 10^{-7} \text{ m}^2/\text{s}$ .


- (a) How long will it take for the midplane temperature to achieve 50% of its maximum possible temperature reduction?
- (b) If  $(T_i - T_s) = 300^\circ\text{C}$ , what is the maximum temperature gradient in the glass at the above time?

**5.44** The strength and stability of tires may be enhanced by heating both sides of the rubber ( $k = 0.14 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 6.35 \times 10^{-8} \text{ m}^2/\text{s}$ ) in a steam chamber for which  $T_\infty = 200^\circ\text{C}$ . In the heating process, a 20-mm-thick rubber wall (assumed to be untreaded) is taken from an initial temperature of  $25^\circ\text{C}$  to a midplane temperature of  $150^\circ\text{C}$ .

- (a) If steam flow over the tire surfaces maintains a convection coefficient of  $h = 200 \text{ W/m}^2 \cdot \text{K}$ , how long will it take to achieve the desired midplane temperature?

- (b) To accelerate the heating process, it is recommended that the steam flow be made sufficiently vigorous to maintain the tire surfaces at  $200^{\circ}\text{C}$  throughout the process. Compute and plot the midplane and surface temperatures for this case, as well as for the conditions of part (a).


- 5.45** Copper-coated, epoxy-filled fiberglass circuit boards are treated by heating a stack of them under high pressure as shown in the sketch. The purpose of the pressing–heating operation is to cure the epoxy that bonds the fiberglass sheets, imparting stiffness to the boards. The stack, referred to as a *book*, is comprised of 10 *boards* and 11 *pressing plates*, which prevent epoxy from flowing between the boards and impart a smooth finish to the cured boards. In order to perform simplified thermal analyses, it is reasonable to approximate the book as having an effective thermal conductivity ( $k$ ) and an effective thermal capacitance ( $\rho c_p$ ). Calculate the effective properties if each of the boards and plates has a thickness of 2.36 mm and the following thermophysical properties: board ( $b$ )  $\rho_b = 1000 \text{ kg/m}^3$ ,  $c_{p,b} = 1500 \text{ J/kg} \cdot \text{K}$ ,  $k_b = 0.30 \text{ W/m} \cdot \text{K}$ ; plate ( $p$ )  $\rho_p = 8000 \text{ kg/m}^3$ ,  $c_{p,p} = 480 \text{ J/kg} \cdot \text{K}$ ,  $k_p = 12 \text{ W/m} \cdot \text{K}$ .

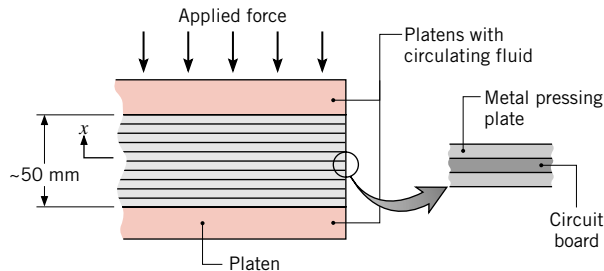

- 5.46** Circuit boards are treated by heating a stack of them under high pressure as illustrated in Problem 5.45. The platens at the top and bottom of the stack are maintained at a uniform temperature by a circulating fluid. The purpose of the pressing–heating operation is to cure the epoxy, which bonds the fiberglass sheets, and impart stiffness to the boards. The cure condition is achieved when the epoxy has been maintained at or above  $170^{\circ}\text{C}$  for at least 5 min. The effective thermophysical properties of the stack or *book* (boards and metal pressing plates) are  $k = 0.613 \text{ W/m} \cdot \text{K}$  and  $\rho c_p = 2.73 \times 10^6 \text{ J/m}^3 \cdot \text{K}$ .
- (a) If the book is initially at  $15^{\circ}\text{C}$  and, following application of pressure, the platens are suddenly brought to a uniform temperature of  $190^{\circ}\text{C}$ , calculate the elapsed time  $t_e$  required for the midplane of the book to reach the cure temperature of  $170^{\circ}\text{C}$ .
- (b) If, at this instant of time,  $t = t_e$ , the platen temperature were reduced suddenly to  $15^{\circ}\text{C}$ , how much

energy would have to be removed from the book by the coolant circulating in the platen, in order to return the stack to its initial uniform temperature?

- 5.47** A plastic coating is applied to wood panels by first depositing molten polymer on a panel and then cooling the surface of the polymer by subjecting it to air flow at  $25^{\circ}\text{C}$ . As first approximations, the heat of reaction associated with solidification of the polymer may be neglected and the polymer/wood interface may be assumed to be adiabatic.

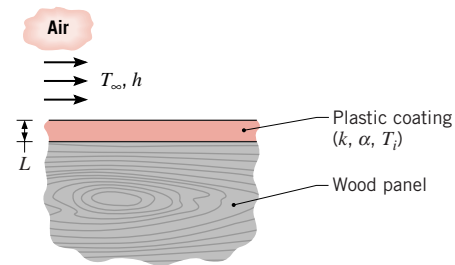

If the thickness of the coating is  $L = 2 \text{ mm}$  and it has an initial uniform temperature of  $T_i = 200^{\circ}\text{C}$ , how long will it take for the surface to achieve a *safe-to-touch* temperature of  $42^{\circ}\text{C}$  if the convection coefficient is  $h = 200 \text{ W/m}^2 \cdot \text{K}$ ? What is the corresponding value of the interface temperature? The thermal conductivity and diffusivity of the plastic are  $k = 0.25 \text{ W/m} \cdot \text{K}$  and  $\alpha = 1.20 \times 10^{-7} \text{ m}^2/\text{s}$ , respectively.


### One-Dimensional Conduction: The Long Cylinder

- 5.48** A long rod of 60-mm diameter and thermophysical properties  $\rho = 8000 \text{ kg/m}^3$ ,  $c = 500 \text{ J/kg} \cdot \text{K}$ , and  $k = 50 \text{ W/m} \cdot \text{K}$  is initially at a uniform temperature and is heated in a forced convection furnace maintained at  $750 \text{ K}$ . The convection coefficient is estimated to be  $1000 \text{ W/m}^2 \cdot \text{K}$ .
- (a) What is the centerline temperature of the rod when the surface temperature is  $550 \text{ K}$ ?
- (b) In a heat-treating process, the centerline temperature of the rod must be increased from  $T_i = 300 \text{ K}$  to  $T = 500 \text{ K}$ . Compute and plot the centerline temperature histories for  $h = 100, 500$ , and  $1000 \text{ W/m}^2 \cdot \text{K}$ . In each case the calculation may be terminated when  $T = 500 \text{ K}$ .
- 5.49** A long cylinder of 30-mm diameter, initially at a uniform temperature of  $1000 \text{ K}$ , is suddenly quenched in a large, constant-temperature oil bath at  $350 \text{ K}$ . The cylinder properties are  $k = 1.7 \text{ W/m} \cdot \text{K}$ ,  $c = 1600 \text{ J/kg} \cdot \text{K}$ , and  $\rho = 400 \text{ kg/m}^3$ , while the convection coefficient is  $50 \text{ W/m}^2 \cdot \text{K}$ .



- (a) Calculate the time required for the surface of the cylinder to reach 500 K.
- (b) Compute and plot the surface temperature history for  $0 \leq t \leq 300$  s. If the oil were agitated, providing a convection coefficient of  $250 \text{ W/m}^2 \cdot \text{K}$ , how would the temperature history change?

**5.50** A long pyroceram rod of diameter 20 mm is clad with a very thin metallic tube for mechanical protection. The bonding between the rod and the tube has a thermal contact resistance of  $R'_{tc} = 0.12 \text{ m} \cdot \text{K/W}$ .

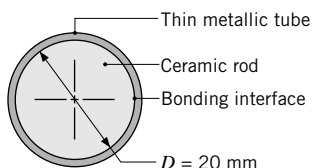

- (a) If the rod is initially at a uniform temperature of 900 K and is suddenly cooled by exposure to an air-stream for which  $T_\infty = 300 \text{ K}$  and  $h = 100 \text{ W/m}^2 \cdot \text{K}$ , at which time will the centerline reach 600 K?
- (b) Cooling may be accelerated by increasing the air-speed and hence the convection coefficient. For values of  $h = 100, 500$ , and  $1000 \text{ W/m}^2 \cdot \text{K}$ , compute and plot the centerline and surface temperatures of the pyroceram as a function of time for  $0 \leq t \leq 300$  s. Comment on the implications of achieving enhanced cooling solely by increasing  $h$ .

**5.51** A long rod 40 mm in diameter, fabricated from sapphire (aluminum oxide) and initially at a uniform temperature of 800 K, is suddenly cooled by a fluid at 300 K having a heat transfer coefficient of  $1600 \text{ W/m}^2 \cdot \text{K}$ . After 35 s, the rod is wrapped in insulation and experiences no heat losses. What will be the temperature of the rod after a long period of time?


**5.52** A long plastic rod of 30-mm diameter ( $k = 0.3 \text{ W/m} \cdot \text{K}$  and  $\rho c_p = 1040 \text{ kJ/m}^3 \cdot \text{K}$ ) is uniformly heated in an oven as preparation for a pressing operation. For best results, the temperature in the rod should not be less than  $200^\circ\text{C}$ . To what uniform temperature should the rod be heated in the oven if, for the worst case, the rod sits on a conveyor for 3 min while exposed to convection cooling with ambient air at  $25^\circ\text{C}$  and with a convection coefficient of  $8 \text{ W/m}^2 \cdot \text{K}$ ? A further condition for good results is a maximum–minimum temperature difference of less than  $10^\circ\text{C}$ . Is this condition satisfied and, if not, what could you do to satisfy it?

**5.53** As part of a heat treatment process, cylindrical, 304 stainless steel rods of 100-mm diameter are cooled from an initial temperature of  $500^\circ\text{C}$  by suspending them in an oil bath at  $30^\circ\text{C}$ . If a convection coefficient of 500

$\text{W/m}^2 \cdot \text{K}$  is maintained by circulation of the oil, how long does it take for the centerline of a rod to reach a temperature of  $50^\circ\text{C}$ , at which point it is withdrawn from the bath? If 10 rods of length  $L = 1 \text{ m}$  are processed per hour, what is the nominal rate at which energy must be extracted from the bath (the cooling load)?

**5.54** In a manufacturing process, long rods of different diameters are at a uniform temperature of  $400^\circ\text{C}$  in a curing oven, from which they are removed and cooled by forced convection in air at  $25^\circ\text{C}$ . One of the line operators has observed that it takes 280 seconds for a 40-mm-diameter rod to cool to a *safe-to-handle* temperature of  $60^\circ\text{C}$ . For an equivalent convection coefficient, how long will it take for an 80-mm-diameter rod to cool to the same temperature? The thermophysical properties of the rod are  $\rho = 2500 \text{ kg/m}^3$ ,  $c = 900 \text{ J/kg} \cdot \text{K}$ , and  $k = 15 \text{ W/m} \cdot \text{K}$ . Comment on your result. Did you anticipate this outcome?

**5.55** The density and specific heat of a particular material are known ( $\rho = 1200 \text{ kg/m}^3$ ,  $c_p = 1250 \text{ J/kg} \cdot \text{K}$ ), but its thermal conductivity is unknown. To determine the thermal conductivity, a long cylindrical specimen of diameter  $D = 40 \text{ mm}$  is machined, and a thermocouple is inserted through a small hole drilled along the centerline.

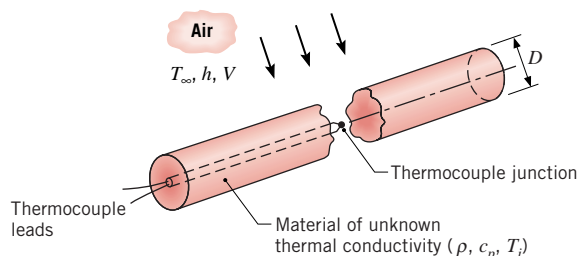

The thermal conductivity is determined by performing an experiment in which the specimen is heated to a uniform temperature of  $T_i = 100^\circ\text{C}$  and then cooled by passing air at  $T_\infty = 25^\circ\text{C}$  in cross flow over the cylinder. For the prescribed air velocity, the convection coefficient is  $h = 55 \text{ W/m}^2 \cdot \text{K}$ .

(a) If a centerline temperature of  $T(0, t) = 40^\circ\text{C}$  is recorded after  $t = 1136 \text{ s}$  of cooling, verify that the material has a thermal conductivity of  $k = 0.30 \text{ W/m} \cdot \text{K}$ .


(b) For air in cross-flow over the cylinder, the prescribed value of  $h = 55 \text{ W/m}^2 \cdot \text{K}$  corresponds to a velocity of  $V = 6.8 \text{ m/s}$ . If  $h = CV^{0.618}$ , where the constant  $C$  has units of  $\text{W} \cdot \text{s}^{0.618}/\text{m}^{2.618} \cdot \text{K}$ , how does the centerline temperature at  $t = 1136 \text{ s}$  vary with velocity for  $3 \leq V \leq 20 \text{ m/s}$ ? Determine the centerline temperature histories for  $0 \leq t \leq 1500 \text{ s}$  and velocities of 3, 10, and 20 m/s.

**5.56** In Section 5.2 we noted that the value of the Biot number significantly influences the nature of the temperature distribution in a solid during a transient conduction process. Reinforce your understanding of this important concept by using the *IHT* model for one-dimensional transient conduction to determine radial temperature distributions in a 30-mm-diameter, stainless steel rod ( $k = 15 \text{ W/m} \cdot \text{K}$ ,  $\rho = 8000 \text{ kg/m}^3$ ,  $c_p = 475 \text{ J/kg} \cdot \text{K}$ ), as it is cooled from an initial uniform temperature of  $325^\circ\text{C}$  by a fluid at  $25^\circ\text{C}$ . For the following values of the convection coefficient and the designated times, determine the radial temperature distribution:  $h = 100 \text{ W/m}^2 \cdot \text{K}$  ( $t = 0, 100, 500 \text{ s}$ );  $h = 1000 \text{ W/m}^2 \cdot \text{K}$  ( $t = 0, 10, 50 \text{ s}$ );  $h = 5000 \text{ W/m}^2 \cdot \text{K}$  ( $t = 0, 1, 5, 25 \text{ s}$ ). Prepare a separate graph for each convection coefficient, on which temperature is plotted as a function of dimensionless radius at the designated times.

### One-Dimensional Conduction: The Sphere

**5.57** In heat treating to harden steel ball bearings ( $c = 500 \text{ J/kg} \cdot \text{K}$ ,  $\rho = 7800 \text{ kg/m}^3$ ,  $k = 50 \text{ W/m} \cdot \text{K}$ ), it is desirable to increase the surface temperature for a short time without significantly warming the interior of the ball. This type of heating can be accomplished by sudden immersion of the ball in a molten salt bath with  $T_\infty = 1300 \text{ K}$  and  $h = 5000 \text{ W/m}^2 \cdot \text{K}$ . Assume that any location within the ball whose temperature exceeds  $1000 \text{ K}$  will be hardened. Estimate the time required to harden the outer millimeter of a ball of diameter  $20 \text{ mm}$ , if its initial temperature is  $300 \text{ K}$ .

**5.58** A cold air chamber is proposed for quenching steel ball bearings of diameter  $D = 0.2 \text{ m}$  and initial temperature  $T_i = 400^\circ\text{C}$ . Air in the chamber is maintained at  $-15^\circ\text{C}$  by a refrigeration system, and the steel balls pass through the chamber on a conveyor belt. Optimum bearing production requires that 70% of the initial thermal energy content of the ball above  $-15^\circ\text{C}$  be removed. Radiation effects may be neglected, and the convection heat transfer coefficient within the chamber is  $1000 \text{ W/m}^2 \cdot \text{K}$ . Estimate the residence time of the balls within the chamber, and recommend a drive velocity of the conveyor. The following properties may be used for the steel:  $k = 50 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 2 \times 10^{-5} \text{ m}^2/\text{s}$ , and  $c = 450 \text{ J/kg} \cdot \text{K}$ .

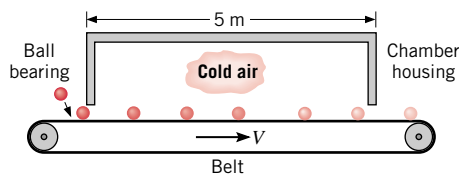

**5.59** Stainless steel (AISI 304) ball bearings, which have uniformly been heated to  $850^\circ\text{C}$ , are hardened by quenching them in an oil bath that is maintained at  $40^\circ\text{C}$ . The ball diameter is  $20 \text{ mm}$ , and the convection coefficient associated with the oil bath is  $1000 \text{ W/m}^2 \cdot \text{K}$ .

- If quenching is to occur until the surface temperature of the balls reaches  $100^\circ\text{C}$ , how long must the balls be kept in the oil? What is the center temperature at the conclusion of the cooling period?
- If 10,000 balls are to be quenched per hour, what is the rate at which energy must be removed by the oil bath cooling system in order to maintain its temperature at  $40^\circ\text{C}$ ?

**5.60** A sphere  $30 \text{ mm}$  in diameter initially at  $800 \text{ K}$  is quenched in a large bath having a constant temperature of  $320 \text{ K}$  with a convection heat transfer coefficient of  $75 \text{ W/m}^2 \cdot \text{K}$ . The thermophysical properties of the sphere material are:  $\rho = 400 \text{ kg/m}^3$ ,  $c = 1600 \text{ J/kg} \cdot \text{K}$ , and  $k = 1.7 \text{ W/m} \cdot \text{K}$ .

- Show, in a qualitative manner on  $T-t$  coordinates, the temperatures at the center and at the surface of the sphere as a function of time.
- Calculate the time required for the surface of the sphere to reach  $415 \text{ K}$ .
- Determine the heat flux ( $\text{W/m}^2$ ) at the outer surface of the sphere at the time determined in part (b).
- Determine the energy ( $\text{J}$ ) that has been lost by the sphere during the process of cooling to the surface temperature of  $415 \text{ K}$ .
- At the time determined by part (b), the sphere is quickly removed from the bath and covered with perfect insulation, such that there is no heat loss from the surface of the sphere. What will be the temperature of the sphere after a long period of time has elapsed?

**(f)** Compute and plot the center and surface temperature histories over the period  $0 \leq t \leq 150 \text{ s}$ . What effect does an increase in the convection coefficient to  $h = 200 \text{ W/m}^2 \cdot \text{K}$  have on the foregoing temperature histories? For  $h = 75$  and  $200 \text{ W/m}^2 \cdot \text{K}$ , compute and plot the surface heat flux as a function of time for  $0 \leq t \leq 150 \text{ s}$ .

**5.61** Spheres A and B are initially at  $800 \text{ K}$ , and they are simultaneously quenched in large constant temperature baths, each having a temperature of  $320 \text{ K}$ . The following parameters are associated with each of the spheres and their cooling processes.

	Sphere A	Sphere B
Diameter (mm)	300	30
Density (kg/m <sup>3</sup> )	1600	400
Specific heat (kJ/kg · K)	0.400	1.60
Thermal conductivity (W/m · K)	170	1.70
Convection coefficient (W/m <sup>2</sup> · K)	5	50

- Show in a qualitative manner, on  $T$  versus  $t$  coordinates, the temperatures at the center and at the surface for each sphere as a function of time. Briefly explain the reasoning by which you determine the relative positions of the curves.
- Calculate the time required for the surface of each sphere to reach 415 K.
- Determine the energy that has been gained by each of the baths during the process of the spheres cooling to 415 K.

**5.62** Spheres of 40-mm diameter heated to a uniform temperature of 400°C are suddenly removed from the oven and placed in a forced-air bath operating at 25°C with a convection coefficient of 300 W/m<sup>2</sup> · K on the sphere surfaces. The thermophysical properties of the sphere material are  $\rho = 3000$  kg/m<sup>3</sup>,  $c = 850$  J/kg · K, and  $k = 15$  W/m · K.

- How long must the spheres remain in the air bath for 80% of the thermal energy to be removed?
- The spheres are then placed in a packing carton that prevents further heat transfer to the environment. What uniform temperature will the spheres eventually reach?

**5.63** Consider the packed bed operating conditions of Problem 5.12, but with Pyrex ( $\rho = 2225$  kg/m<sup>3</sup>,  $c = 835$  J/kg · K,  $k = 1.4$  W/m · K) used instead of aluminum. How long does it take a sphere near the inlet of the system to accumulate 90% of the maximum possible thermal energy? What is the corresponding temperature at the center of the sphere?

**5.64** The convection coefficient for flow over a solid sphere may be determined by submerging the sphere, which is initially at 25°C, into the flow, which is at 75°C, and measuring its surface temperature at some time during the transient heating process.

- If the sphere has a diameter of 0.1 m, a thermal conductivity of 15 W/m · K, and a thermal diffusivity of  $10^{-5}$  m<sup>2</sup>/s, at what time will a surface temperature of 60°C be recorded if the convection coefficient is 300 W/m<sup>2</sup> · K?

- Assess the effect of thermal diffusivity on the thermal response of the material by computing center

and surface temperature histories for  $\alpha = 10^{-6}$ ,  $10^{-5}$ , and  $10^{-4}$  m<sup>2</sup>/s. Plot your results for the period  $0 \leq t \leq 300$  s. In a similar manner, assess the effect of thermal conductivity by considering values of  $k = 1.5$ , 15, and 150 W/m · K.

**5.65** Consider the sphere of Example 5.5, which is initially at a uniform temperature when it is suddenly removed from the furnace and subjected to a two-step cooling process. Use the *Transient Conduction, Sphere* model of *IHT* to obtain the following solutions.

- For step 1, calculate the time required for the center temperature to reach  $T(0, t) = 335^\circ\text{C}$ , while cooling in air at 20°C with a convection coefficient of 10 W/m<sup>2</sup> · K. What is the Biot number for this cooling process? Do you expect radial temperature gradients to be appreciable? Compare your results to those of the example.
- For step 2, calculate the time required for the center temperature to reach  $T(0, t) = 50^\circ\text{C}$ , while cooling in a water bath at 20°C with a convection coefficient of 6000 W/m<sup>2</sup> · K.
- For the step 2 cooling process, calculate and plot the temperature histories,  $T(r, t)$ , for the center and surface of the sphere. Identify and explain key features of the histories. When do you expect the temperature gradients in the sphere to be the largest?

### Semi-Infinite Media

**5.66** Two large blocks of different materials, such as copper and concrete, have been sitting in a room (23°C) for a very long time. Which of the two blocks, if either, will feel colder to the touch? Assume the blocks to be semi-infinite solids and your hand to be at a temperature of 37°C.

**5.67** A plane wall of thickness 0.6 m ( $L = 0.3$  m) is made of steel ( $k = 30$  W/m · K,  $\rho = 7900$  kg/m<sup>3</sup>,  $c = 640$  J/kg · K). It is initially at a uniform temperature and is then exposed to air on both surfaces. Consider two different convection conditions: natural convection, characterized by  $h = 10$  W/m<sup>2</sup> · K, and forced convection, with  $h = 100$  W/m<sup>2</sup> · K. You are to calculate the surface temperature at three different times— $t = 2.5$  min, 25 min, and 250 min—for a total of six different cases.

- For each of these six cases, calculate the nondimensional surface temperature,  $\theta_s^* = (T_s - T_\infty)/(T_i - T_\infty)$ , using four different methods: exact solution, first-term-of-the-series solution, lumped capacitance, and semi-infinite solid. Present your results in a table.
- Briefly explain the conditions for which (i) the first-term solution is a good approximation to the

exact solution, (ii) the lumped capacitance solution is a good approximation, (iii) the semi-infinite solid solution is a good approximation.


**5.68** Asphalt pavement may achieve temperatures as high as 50°C on a hot summer day. Assume that such a temperature exists throughout the pavement, when suddenly a rainstorm reduces the surface temperature to 20°C. Calculate the total amount of energy (J/m<sup>2</sup>) that will be transferred from the asphalt over a 30-min period in which the surface is maintained at 20°C.

**5.69** A thick steel slab ( $\rho = 7800 \text{ kg/m}^3$ ,  $c = 480 \text{ J/kg} \cdot \text{K}$ ,  $k = 50 \text{ W/m} \cdot \text{K}$ ) is initially at 300°C and is cooled by water jets impinging on one of its surfaces. The temperature of the water is 25°C, and the jets maintain an extremely large, approximately uniform convection coefficient at the surface. Assuming that the surface is maintained at the temperature of the water throughout the cooling, how long will it take for the temperature to reach 50°C at a distance of 25 mm from the surface?

**5.70** Consider the water main of Example 5.6, which is buried in soil initially at 20°C and is suddenly subjected to a constant surface temperature of -15°C for 60 days. Use the *Transient Conduction/Semi-Infinite Solid* model of IHT to obtain the following solutions. Compare your results with those in the Comments section of the example.

- Calculate and plot the temperature history at the burial depth of 0.68 m for thermal diffusivities of  $\alpha \times 10^7 = 1.0, 1.38$ , and  $3.0 \text{ m}^2/\text{s}$ .
- For  $\alpha = 1.38 \times 10^{-7} \text{ m}^2/\text{s}$ , plot the temperature distribution over the depth  $0 \leq x \leq 1.0 \text{ m}$  for times of 1, 5, 10, 30, and 60 days.
- For  $\alpha = 1.38 \times 10^{-7} \text{ m}^2/\text{s}$ , show that the heat flux from the soil decreases with increasing time by plotting  $q_x''(0, t)$  as a function of time for the 60-day period. On this graph, also plot the heat flux at the depth of the buried main,  $q_x''(0.68 \text{ m}, t)$ .


**5.71** A tile-iron consists of a massive plate maintained at 150°C by an imbedded electrical heater. The iron is placed in contact with a tile to soften the adhesive, allowing the tile to be easily lifted from the subflooring. The adhesive will soften sufficiently if heated above 50°C for at least 2 min, but its temperature should not exceed 120°C to avoid deterioration of the adhesive. Assume the tile and subfloor to have an initial temperature of 25°C and to have equivalent thermophysical properties of  $k = 0.15 \text{ W/m} \cdot \text{K}$  and  $\rho c_p = 1.5 \times 10^6 \text{ J/m}^3 \cdot \text{K}$ .



(a) How long will it take a worker using the tile-iron to lift a tile? Will the adhesive temperature exceed 120°C?


(b) If the tile-iron has a square surface area 254 mm to the side, how much energy has been removed from it during the time it has taken to lift the tile?

**5.72** The manufacturer of a heat flux gage like that illustrated in Problem 1.12 claims the time constant for a 63.2% response to be  $\tau = (4d^2\rho c_p)/\pi^2 k$ , where  $\rho$ ,  $c_p$ , and  $k$  are the thermophysical properties of the gage material and  $d$  is its thickness. Not knowing the origin of this relation, your task is to model the gage considering the two extreme cases illustrated below. In both cases, the gage, initially at a uniform temperature  $T_i$ , is exposed to a sudden change in surface temperature,  $T(0, t) = T_s$ . For case (a) the backside of the gage is insulated, and for case (b) the gage is imbedded in a semi-infinite solid having the same thermophysical properties as those of the gage.

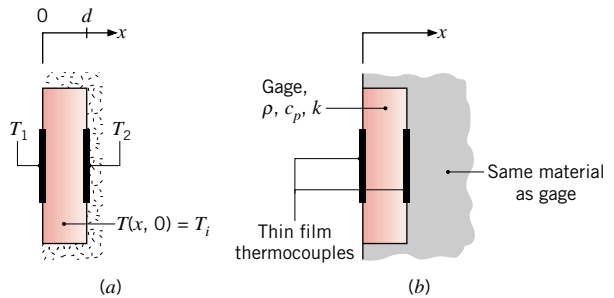

Develop relationships for predicting the time constant of the gage for the two cases and compare them to the manufacturer's relation. What conclusion can you draw from this analysis regarding the transient response of gages for different applications?

**5.73** A simple procedure for measuring surface convection heat transfer coefficients involves coating the surface with a thin layer of material having a precise melting point temperature. The surface is then heated and, by determining the time required for melting to occur, the

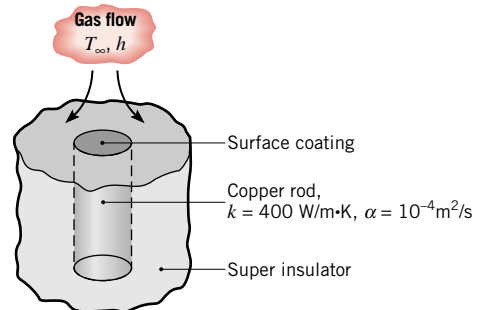

convection coefficient is determined. The following experimental arrangement uses the procedure to determine the convection coefficient for gas flow normal to a surface. Specifically, a long copper rod is encased in a super insulator of very low thermal conductivity, and a very thin coating is applied to its exposed surface.

If the rod is initially at  $25^\circ\text{C}$  and gas flow for which  $h = 200 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = 300^\circ\text{C}$  is initiated, what is the melting point temperature of the coating if melting is observed to occur at  $t = 400 \text{ s}$ ?


- 5.74** An insurance company has hired you as a consultant to improve their understanding of burn injuries. They are especially interested in injuries induced when a portion of a worker's body comes into contact with machinery that is at elevated temperatures in the range of  $50$  to  $100^\circ\text{C}$ . Their medical consultant informs them that irreversible thermal injury (cell death) will occur in any living tissue that is maintained at  $T \geq 48^\circ\text{C}$  for a duration  $\Delta t \geq 10 \text{ s}$ . They want information concerning the extent of irreversible tissue damage (as measured by distance from the skin surface) as a function of the machinery temperature and the time during which contact is made between the skin and the machinery. Assume that living tissue has a normal temperature of  $37^\circ\text{C}$ , is isotropic, and has constant properties equivalent to those of liquid water.

- To assess the seriousness of the problem, compute locations in the tissue at which the temperature will reach  $48^\circ\text{C}$  after  $10 \text{ s}$  of exposure to machinery at  $50^\circ\text{C}$  and  $100^\circ\text{C}$ .
- For a machinery temperature of  $100^\circ\text{C}$  and  $0 \leq t \leq 30 \text{ s}$ , compute and plot temperature histories at tissue locations of  $0.5$ ,  $1$ , and  $2 \text{ mm}$  from the skin.

- 5.75** A procedure for determining the thermal conductivity of a solid material involves embedding a thermocouple in a thick slab of the solid and measuring the response to a prescribed change in temperature at one surface. Consider an arrangement for which the thermocouple is embedded  $10 \text{ mm}$  from a surface that is suddenly brought to a temperature of  $100^\circ\text{C}$  by exposure to boiling water. If the initial temperature of the slab was  $30^\circ\text{C}$  and the thermocouple measures a temperature of  $65^\circ\text{C}$ ,  $2 \text{ min}$  after the surface is brought to  $100^\circ\text{C}$ , what is its thermal conductivity? The density and specific heat of the solid are known to be  $2200 \text{ kg/m}^3$  and  $700 \text{ J/kg} \cdot \text{K}$ .

- 5.76** The density and specific heat of a plastic material are known ( $\rho = 950 \text{ kg/m}^3$ ,  $c_p = 1100 \text{ J/kg} \cdot \text{K}$ ), but its thermal conductivity is unknown. To determine the thermal conductivity, an experiment is performed in which a thick sample of the material is heated to a uniform

temperature of  $100^\circ\text{C}$  and then cooled by passing air at  $25^\circ\text{C}$  over one surface. A thermocouple embedded a distance of  $x_m = 10 \text{ mm}$  below the surface records the thermal response of the plastic during cooling.

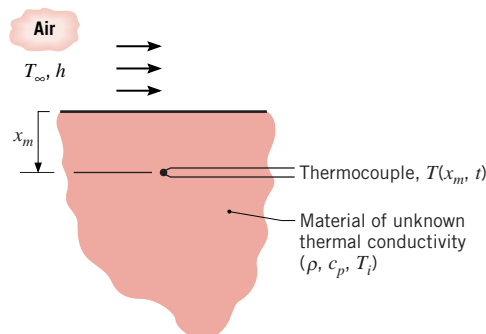


If the convection coefficient associated with the air flow is  $h = 200 \text{ W/m}^2 \cdot \text{K}$  and a temperature of  $60^\circ\text{C}$  is recorded  $5 \text{ min}$  after the onset of cooling, what is the thermal conductivity of the material?

- 5.77** A very thick slab with thermal diffusivity  $5.6 \times 10^{-6} \text{ m}^2/\text{s}$  and thermal conductivity  $20 \text{ W/m} \cdot \text{K}$  is initially at a uniform temperature of  $325^\circ\text{C}$ . Suddenly, the surface is exposed to a coolant at  $15^\circ\text{C}$  for which the convection heat transfer coefficient is  $100 \text{ W/m}^2 \cdot \text{K}$ .
- Determine temperatures at the surface and at a depth of  $45 \text{ mm}$  after  $3 \text{ min}$  have elapsed.
  - Compute and plot temperature histories ( $0 \leq t \leq 300 \text{ s}$ ) at  $x = 0$  and  $x = 45 \text{ mm}$  for the following parametric variations: (i)  $\alpha = 5.6 \times 10^{-7}$ ,  $5.6 \times 10^{-6}$ , and  $5.6 \times 10^{-5} \text{ m}^2/\text{s}$ ; and (ii)  $k = 2$ ,  $20$ , and  $200 \text{ W/m} \cdot \text{K}$ .
- 5.78** A thick oak wall, initially at  $25^\circ\text{C}$ , is suddenly exposed to combustion products for which  $T_\infty = 800^\circ\text{C}$  and  $h = 20 \text{ W/m}^2 \cdot \text{K}$ .
- Determine the time of exposure required for the surface to reach the ignition temperature of  $400^\circ\text{C}$ .
  - Plot the temperature distribution  $T(x)$  in the medium at  $t = 325 \text{ s}$ . The distribution should extend to a location for which  $T \approx 25^\circ\text{C}$ .
- 5.79** Standards for firewalls may be based on their thermal response to a prescribed radiant heat flux. Consider a  $0.25\text{-m}$ -thick concrete wall ( $\rho = 2300 \text{ kg/m}^3$ ,  $c = 880 \text{ J/kg} \cdot \text{K}$ ,  $k = 1.4 \text{ W/m} \cdot \text{K}$ ), which is at an initial temperature of  $T_i = 25^\circ\text{C}$  and irradiated at one surface by lamps that provide a uniform heat flux of  $q''_s = 10^4 \text{ W/m}^2$ . The absorptivity of the surface to the irradiation is  $\alpha_s = 1.0$ . If building code requirements dictate that the temperatures of the irradiated and back



surfaces must not exceed 325°C and 25°C, respectively, after 30 min of heating, will the requirements be met?


- 5.80** It is well known that, although two materials are at the same temperature, one may feel cooler to the touch than the other. Consider thick plates of copper and glass, each at an initial temperature of 300 K. Assuming your finger to be at an initial temperature of 310 K and to have thermo-physical properties of  $\rho = 1000 \text{ kg/m}^3$ ,  $c = 4180 \text{ J/kg} \cdot \text{K}$ , and  $k = 0.625 \text{ W/m} \cdot \text{K}$ , determine whether the copper or the glass will feel cooler to the touch.
- 5.81** Two stainless steel plates ( $\rho = 8000 \text{ kg/m}^3$ ,  $c = 500 \text{ J/kg} \cdot \text{K}$ ,  $k = 15 \text{ W/m} \cdot \text{K}$ ), each 20 mm thick and insulated on one surface, are initially at 400 and 300 K when they are pressed together at their uninsulated surfaces. What is the temperature of the insulated surface of the hot plate after 1 min has elapsed?
- 5.82** Special coatings are often formed by depositing thin layers of a molten material on a solid substrate. Solidification begins at the substrate surface and proceeds until the thickness  $S$  of the solid layer becomes equal to the thickness  $\delta$  of the deposit.

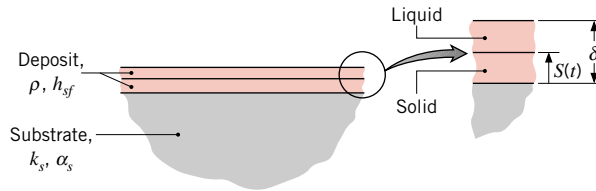

- (a) Consider conditions for which molten material at its fusion temperature  $T_f$  is deposited on a large substrate that is at an initial uniform temperature  $T_i$ . With  $S = 0$  at  $t = 0$ , develop an expression for estimating the time  $t_d$  required to completely solidify the deposit if it remains at  $T_f$  throughout the solidification process. Express your result in terms of the substrate thermal conductivity and thermal diffusivity ( $k_s$ ,  $\alpha_s$ ), the density and latent heat of fusion of the deposit ( $\rho$ ,  $h_{sf}$ ), the deposit thickness  $\delta$ , and the relevant temperatures ( $T_f$ ,  $T_i$ ).
- (b) The plasma spray deposition process of Problem 5.25 is used to apply a thin ( $\delta = 2 \text{ mm}$ ) alumina coating on a thick tungsten substrate. The substrate has a uniform initial temperature of  $T_i = 300 \text{ K}$ , and its thermal conductivity and thermal diffusivity may be approximated as  $k_s = 120 \text{ W/m} \cdot \text{K}$  and  $\alpha_s = 4.0 \times 10^{-5} \text{ m}^2/\text{s}$ , respectively. The density and latent heat of fusion of the alumina are  $\rho = 3970 \text{ kg/m}^3$  and  $h_{sf} = 3577 \text{ kJ/kg}$ , respectively, and the alumina solidifies at its fusion temperature ( $T_f = 2318 \text{ K}$ ). Assuming that the molten layer is


instantaneously deposited on the substrate, estimate the time required for the deposit to solidify.

- 5.83** When a molten metal is cast in a mold that is a poor conductor, the dominant resistance to heat flow is within the mold wall. Consider conditions for which a liquid metal is solidifying in a thick-walled mold of thermal conductivity  $k_w$  and thermal diffusivity  $\alpha_w$ . The density and latent heat of fusion of the metal are designated as  $\rho$  and  $h_{sf}$ , respectively, and in both its molten and solid states, the thermal conductivity of the metal is very much larger than that of the mold.

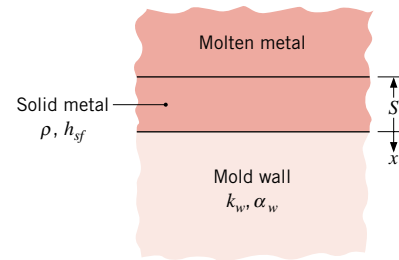

Just before the start of solidification ( $S = 0$ ), the mold wall is everywhere at an initial uniform temperature  $T_i$  and the molten metal is everywhere at its fusion (melting point) temperature of  $T_f$ . Following the start of solidification, there is conduction heat transfer into the mold wall and the thickness of the solidified metal,  $S$ , increases with time  $t$ .

- (a) Sketch the one-dimensional temperature distribution,  $T(x)$ , in the mold wall and the metal at  $t = 0$  and at two subsequent times during the solidification. Clearly indicate any underlying assumptions.
- (b) Obtain a relation for the variation of the solid layer thickness  $S$  with time  $t$ , expressing your result in terms of appropriate parameters of the system.
- 5.84** Joints of high quality can be formed by friction welding. Consider the friction welding of two 40-mm-diameter Inconel rods. The bottom rod is stationary, while the top rod is forced into a back-and-forth linear motion characterized by an instantaneous horizontal displacement,  $d(t) = a \cos(\omega t)$  where  $a = 2 \text{ mm}$  and  $\omega = 1000 \text{ rad/s}$ . The coefficient of sliding friction between the two pieces is  $\mu = 0.3$ . Determine the compressive force that must be applied in order to heat the joint to the Inconel melting point within  $t = 3 \text{ s}$ , starting from an initial temperature of 20°C. *Hint:* The frequency of the motion and resulting heat rate are very high. The temperature response can be approximated as if the heating rate were constant in time, equal to its average value.

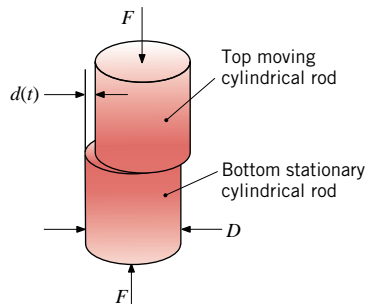


### Objects with Constant Surface Temperatures or Surface Heat Fluxes and Periodic Heating

**5.85** An above-ground circular swimming pool is heated so that it can be used in cool weather. The ground has a temperature of  $10^\circ\text{C}$  far from the pool. The heater is turned on and quickly brings the pool water to a comfortable  $20^\circ\text{C}$ ; assume this is the temperature of the circular region of the ground beneath the swimming pool. The pool has a diameter of 5 m.

- Calculate the rate of heat transfer from the pool to the ground, ten hours after the heater is turned on. *Hint:* Based on symmetry considerations, the pool footprint can be viewed as a heated disk in *infinite* surroundings.
- Calculate the time it would take for the heat transfer rate to reach within 10% of its steady-state value.


**5.86** A rewritable optical disc (DVD) is formed by sandwiching a 15-nm-thick binary compound storage material between two 1-mm-thick polycarbonate sheets. Data are *written* to the opaque storage medium by irradiating it from below with a relatively high-powered laser beam of diameter  $0.4\ \mu\text{m}$  and power 1 mW, resulting in rapid heating of the compound material (the polycarbonate is transparent to the laser irradiation). If the temperature of the storage medium exceeds 900 K, a noncrystalline, amorphous material forms at the heated spot when the laser irradiation is curtailed and the spot is allowed to cool rapidly. The resulting spots of amorphous material have a different reflectivity from the surrounding crystalline material, so they can subsequently be *read* by irradiating them with a second, low-power laser and detecting the changes in laser radiation transmitted through the entire DVD thickness. Determine the irradiation (write) time needed to raise the storage medium temperature from an initial value of 300 K to 1000 K. The absorptivity of the storage medium is 0.8. The polycarbonate properties are  $\rho = 1200\ \text{kg/m}^3$ ,  $k = 0.21\ \text{W/m}\cdot\text{K}$ , and  $c_p = 1260\ \text{J/kg}\cdot\text{K}$ .

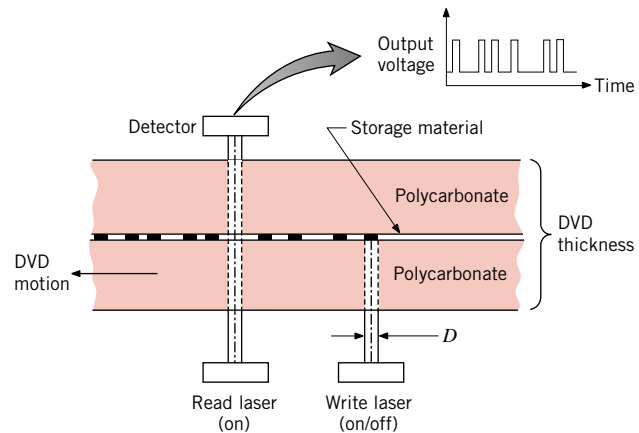

**5.87** To enable cooking a wider range of foods in microwave ovens, thin, metallic packaging materials have been developed that will readily absorb microwave energy. As the packaging material is heated by the microwaves, conduction simultaneously occurs from the hot packaging material to the cold food. Consider the spherical piece of frozen ground beef of Problem 5.33 that is now wrapped in the thin microwave-absorbing packaging material. Determine the time needed for the beef that is immediately adjacent to the packaging material to reach  $T = 0^\circ\text{C}$  if 50% of the oven power ( $P = 1\ \text{kW}$  total) is absorbed in the packaging material.

**5.88** The structural components of modern aircraft are commonly fabricated of high-performance composite materials. These materials are fabricated by impregnating mats of extremely strong fibers that are held within a form with an epoxy or thermoplastic liquid. After the liquid cures or cools, the resulting component is of extremely high strength and low weight. Periodically, these components must be inspected to ensure that the fiber mats and bonding material do not become delaminated and, in turn, the component loses its airworthiness. One inspection method involves application of a uniform, constant radiation heat flux to the surface being inspected. The thermal response of the surface is measured with an infrared imaging system, which captures the emission from the surface and converts it to a color-coded map of the surface temperature distribution. Consider the case where a uniform flux of  $5\ \text{kW/m}^2$  is applied to the top skin of an airplane wing initially at  $20^\circ\text{C}$ . The opposite side of the 15-mm-thick skin is adjacent to stagnant air and can be treated as well insulated. The density and specific heat of the skin material are  $1200\ \text{kg/m}^3$  and  $1200\ \text{J/kg}\cdot\text{K}$ , respectively. The effective thermal conductivity of the intact skin material is  $k_1 = 1.6\ \text{W/m}\cdot\text{K}$ . Contact resistances develop internal to the structure as a result of delamination

between the fiber mats and the bonding material, leading to a reduced effective thermal conductivity of  $k_2 = 1.1 \text{ W/m} \cdot \text{K}$ . Determine the surface temperature of the component after 10 and 100 seconds of irradiation for (a) an area where the material is structurally intact and (b) an adjacent area where delamination has occurred within the wing.

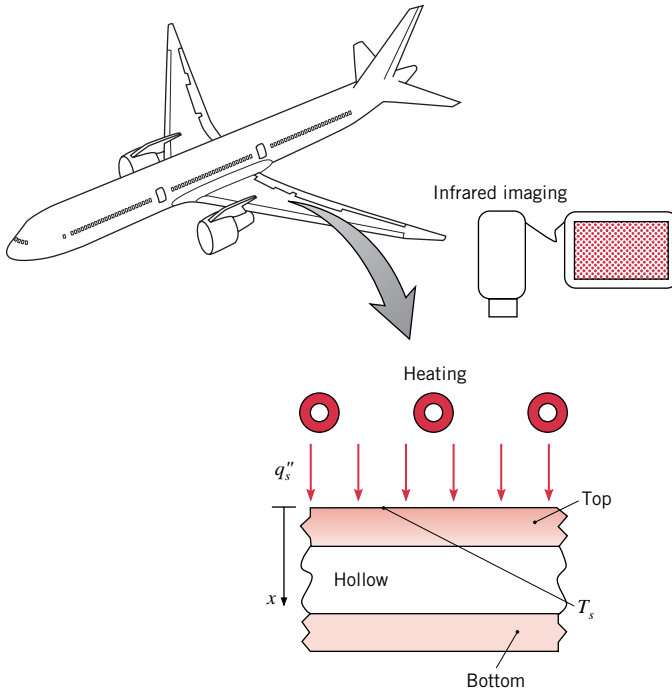


- 5.89** Problem 4.9 addressed radioactive wastes stored underground in a spherical container. Because of uncertainty in the thermal properties of the soil, it is desired to measure the steady-state temperature using a test container (identical to the real container) that is equipped with internal electrical heaters. Estimate how long it will take the test container to come within  $10^\circ\text{C}$  of its steady-state value, assuming it is buried very far underground. Use the soil properties from Table A.3 in your analysis.

**5.90** A thermal storage medium consists of a large mass of limestone. Ambient air is pumped through a 30-mm-high, 5-m-long, 5-m-wide fissure within the limestone at a velocity of 2 m/s, providing a heat transfer coefficient between the air and the limestone of  $h = 10 \text{ W/m}^2 \cdot \text{K}$ . Over a 24-hour time period, the temperature of the surface of the limestone adjacent to the air stream near the inlet exhibits periodic behavior with maximum and minimum values of 302 and 298 K, respectively.

- (a) Determine the minimum and maximum values of the temperature of the air near the inlet.

- (b) Determine the maximum heat flux to the air during a 24-hour time period near the inlet. Determine the air inlet and outlet temperatures at the time corresponding to the maximum air heat flux.
- (c) Determine the air outlet temperatures at the times corresponding to the maximum and minimum air inlet temperatures.
- (d) Plot the inlet air temperature, the limestone surface temperature, and the heat transfer rate to the limestone over 48 hours.
- (e) What is the required thickness of limestone necessary to ensure that the limestone may be viewed as a semi-infinite medium?

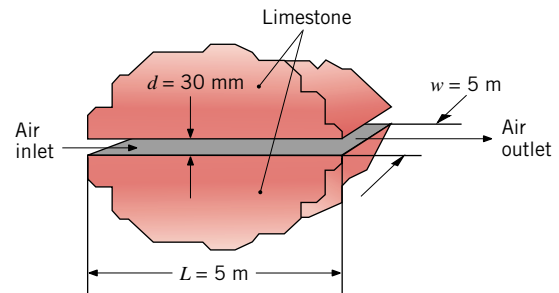

- 5.91** Consider the experimental measurement of Example 5.8. It is desired to measure the thermal conductivity of an extremely thin sample of the same nanostructured material having the same length and width. To minimize experimental uncertainty, the experimenter wishes to keep the amplitude of the temperature response,  $\Delta T$ , above a value of  $0.1^\circ\text{C}$ . What is the minimum sample thickness that can be measured? Assume the properties of the thin sample and the magnitude of the applied heating rate are the same as those measured and used in Example 5.8.


### Finite-Difference Equations: Derivations

- 5.92** The stability criterion for the explicit method requires that the coefficient of the  $T_m^p$  term of the one-dimensional, finite-difference equation be zero or positive. Consider the situation for which the temperatures at the two neighboring nodes ( $T_{m-1}^p, T_{m+1}^p$ ) are  $100^\circ\text{C}$  while the center node ( $T_m^p$ ) is at  $50^\circ\text{C}$ . Show that for values of  $Fo > \frac{1}{2}$  the finite-difference equation will predict a value of  $T_m^{p+1}$  that violates the second law of thermodynamics.


- 5.93** A thin rod of diameter  $D$  is initially in equilibrium with its surroundings, a large vacuum enclosure at temperature  $T_{\text{sur}}$ . Suddenly an electrical current  $I$  (A) is passed through the rod having an electrical resistivity  $\rho_e$  and emissivity  $\varepsilon$ . Other pertinent thermophysical properties



are identified in the sketch. Derive the transient, finite-difference equation for node  $m$ .

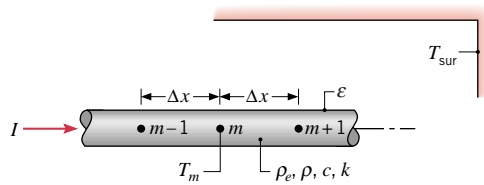


- 5.94** A one-dimensional slab of thickness  $2L$  is initially at a uniform temperature  $T_i$ . Suddenly, electric current is passed through the slab causing a uniform volumetric heating  $\dot{q}$  ( $\text{W/m}^3$ ). At the same time, both outer surfaces ( $x = \pm L$ ) are subjected to a convection process at  $T_\infty$  with a heat transfer coefficient  $h$ .

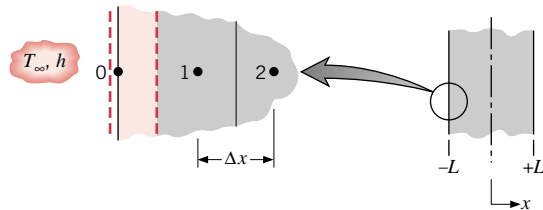

Write the finite-difference equation expressing conservation of energy for node 0 located on the outer surface at  $x = -L$ . Rearrange your equation and identify any important dimensionless coefficients.

- 5.95** A plane wall ( $\rho = 4000 \text{ kg/m}^3$ ,  $c_p = 500 \text{ J/kg} \cdot \text{K}$ ,  $k = 10 \text{ W/m} \cdot \text{K}$ ) of thickness  $L = 20 \text{ mm}$  initially has a linear, steady-state temperature distribution with boundaries maintained at  $T_1 = 0^\circ\text{C}$  and  $T_2 = 100^\circ\text{C}$ . Suddenly, an electric current is passed through the wall, causing uniform energy generation at a rate  $\dot{q} = 2 \times 10^7 \text{ W/m}^3$ . The boundary conditions  $T_1$  and  $T_2$  remain fixed.

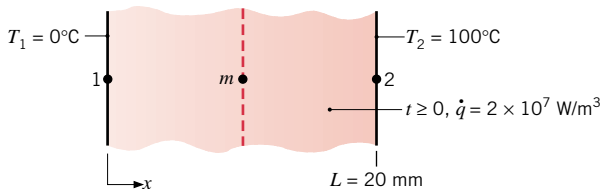


- (a) On  $T$ - $x$  coordinates, sketch temperature distributions for the following cases: (i) initial condition ( $t \leq 0$ ); (ii) steady-state conditions ( $t \rightarrow \infty$ ), assuming that the maximum temperature in the wall exceeds  $T_2$ ; and (iii) for two intermediate times. Label all important features of the distributions.
- (b) For the system of three nodal points shown schematically (1,  $m$ , 2), define an appropriate control volume for node  $m$  and, identifying all relevant

processes, derive the corresponding finite-difference equation using either the *explicit* or *implicit* method.

- (c) With a time increment of  $\Delta t = 5 \text{ s}$ , use the finite-difference method to obtain values of  $T_m$  for the first 45 s of elapsed time. Determine the corresponding heat fluxes at the boundaries, that is,  $q_x''$  (0, 45 s) and  $q_x''$  (20 mm, 45 s).
- (d) To determine the effect of mesh size, repeat your analysis using grids of 5 and 11 nodal points ( $\Delta x = 5.0$  and  $2.0 \text{ mm}$ , respectively).


- 5.96** A round solid cylinder made of a plastic material ( $\alpha = 6 \times 10^{-7} \text{ m}^2/\text{s}$ ) is initially at a uniform temperature of  $20^\circ\text{C}$  and is well insulated along its lateral surface and at one end. At time  $t = 0$ , heat is applied to the left boundary causing  $T_0$  to increase linearly with time at a rate of  $1^\circ\text{C/s}$ .

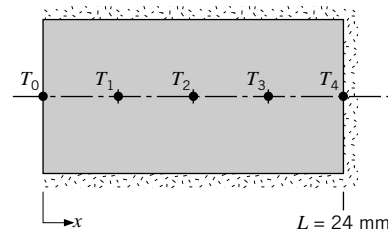

- (a) Using the explicit method with  $Fo = \frac{1}{2}$ , derive the finite-difference equations for nodes 1, 2, 3, and 4.
- (b) Format a table with headings of  $p$ ,  $t$  (s), and the nodal temperatures  $T_0$  to  $T_4$ . Determine the surface temperature  $T_0$  when  $T_4 = 35^\circ\text{C}$ .

- 5.97** Derive the explicit finite-difference equation for an interior node for three-dimensional transient conduction. Also determine the stability criterion. Assume constant properties and equal grid spacing in all three directions.

- 5.98** Derive the transient, two-dimensional finite-difference equation for the temperature at nodal point 0 located on the boundary between two different materials.

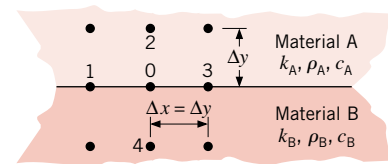


## Finite-Difference Solutions: One-Dimensional Systems

- 5.99** A wall 0.12 m thick having a thermal diffusivity of  $1.5 \times 10^{-6} \text{ m}^2/\text{s}$  is initially at a uniform temperature of  $85^\circ\text{C}$ . Suddenly one face is lowered to a temperature of  $20^\circ\text{C}$ , while the other face is perfectly insulated.

- (a) Using the explicit finite-difference technique with space and time increments of 30 mm and 300 s, respectively, determine the temperature distribution at  $t = 45$  min.
- (b) With  $\Delta x = 30$  mm and  $\Delta t = 300$  s, compute  $T(x, t)$  for  $0 \leq t \leq t_{ss}$ , where  $t_{ss}$  is the time required for the temperature at each nodal point to reach a value that is within  $1^\circ\text{C}$  of the steady-state temperature. Repeat the foregoing calculations for  $\Delta t = 75$  s. For each value of  $\Delta t$ , plot temperature histories for each face and the midplane.

- 5.100** A molded plastic product ( $\rho = 1200 \text{ kg/m}^3$ ,  $c = 1500 \text{ J/kg} \cdot \text{K}$ ,  $k = 0.30 \text{ W/m} \cdot \text{K}$ ) is cooled by exposing one surface to an array of air jets, while the opposite surface is well insulated. The product may be approximated as a slab of thickness  $L = 60$  mm, which is initially at a uniform temperature of  $T_i = 80^\circ\text{C}$ . The air jets are at a temperature of  $T_\infty = 20^\circ\text{C}$  and provide a uniform convection coefficient of  $h = 100 \text{ W/m}^2 \cdot \text{K}$  at the cooled surface.

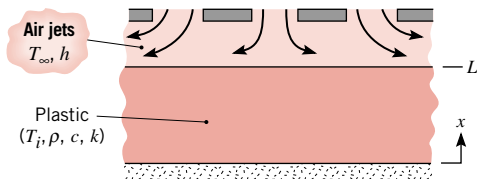

Using a finite-difference solution with a space increment of  $\Delta x = 6$  mm, determine temperatures at the cooled and insulated surfaces after 1 hour of exposure to the gas jets.

- 5.101** The plane wall of Problem 2.48 ( $k = 50 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 1.5 \times 10^{-6} \text{ m}^2/\text{s}$ ) has a thickness of  $L = 40$  mm and an initial uniform temperature of  $T_o = 25^\circ\text{C}$ . Suddenly, the boundary at  $x = L$  experiences heating by a fluid for which  $T_\infty = 50^\circ\text{C}$  and  $h = 1000 \text{ W/m}^2 \cdot \text{K}$ , while heat is uniformly generated within the wall at  $\dot{q} = 1 \times 10^7 \text{ W/m}^3$ . The boundary at  $x = 0$  remains at  $T_o$ .
- (a) With  $\Delta x = 4$  mm and  $\Delta t = 1$  s, plot temperature distributions in the wall for (i) the initial condition, (ii) the steady-state condition, and (iii) two intermediate times.
- (b) On  $q_x''-t$  coordinates, plot the heat flux at  $x = 0$  and  $x = L$ . At what elapsed time is there zero heat flux at  $x = L$ ?

- 5.102** Consider the fuel element of Example 5.9. Initially, the element is at a uniform temperature of  $250^\circ\text{C}$  with no heat generation. Suddenly, the element is inserted into the reactor core causing a uniform volumetric heat generation rate of  $\dot{q} = 10^8 \text{ W/m}^3$ . The surfaces are

convectively cooled with  $T_\infty = 250^\circ\text{C}$  and  $h = 1100 \text{ W/m}^2 \cdot \text{K}$ . Using the explicit method with a space increment of 2 mm, determine the temperature distribution 1.5 s after the element is inserted into the core.

- 5.103** Consider the fuel element of Example 5.9, which operates at a uniform volumetric generation rate of  $\dot{q}_1 = 10^7 \text{ W/m}^3$ , until the generation rate suddenly changes to  $\dot{q}_2 = 2 \times 10^7 \text{ W/m}^3$ . Use the *Finite-Difference Equations, One-Dimensional, Transient* conduction model builder of *IHT* to obtain the implicit form of the finite-difference equations for the 6 nodes, with  $\Delta x = 2$  mm, as shown in the example.


- (a) Calculate the temperature distribution 1.5 s after the change in operating power and compare your results with those tabulated in the example.
- (b) Use the *Explore* and *Graph* options of *IHT* to calculate and plot temperature histories at the midplane (00) and surface (05) nodes for  $0 \leq t \leq 400$  s. What are the steady-state temperatures, and approximately how long does it take to reach the new equilibrium condition after the step change in operating power?

- 5.104** Consider the fuel element of Example 5.9, which operates at a uniform volumetric generation rate of  $\dot{q}_1 = 10^7 \text{ W/m}^3$ , until the generation rate suddenly changes to  $\dot{q}_2 = 2 \times 10^7 \text{ W/m}^3$ . Use the finite-element software *FEHT* to obtain the following solutions.

- (a) Calculate the temperature distribution 1.5 s after the change in operating power and compare your results with those tabulated in the example. *Hint:* First determine the steady-state temperature distribution for  $\dot{q}_1$ , which represents the initial condition for the transient temperature distribution after the step change in power to  $\dot{q}_2$ . Next, in the *Setup* menu, click on *Transient*: in the *Specify/Internal Generation* box, change the value to  $\dot{q}_2$ ; and in the *Run* command, click on *Continue* (not *Calculate*). See the *Run* menu in the *FEHT* Help section for background information on the *Continue* option.
- (b) Use your *FEHT* model to plot temperature histories at the midplane and surface for  $0 \leq t \leq 400$  s. What are the steady-state temperatures, and approximately how long does it take to reach the new equilibrium condition after the step change in operating power?

- 5.105** In a thin-slab, continuous casting process, molten steel leaves a mold with a thin solid shell, and the molten material solidifies as the slab is quenched by water jets en route to a section of rollers. Once fully solidified,

the slab continues to cool as it is brought to an acceptable handling temperature. It is this portion of the process that is of interest.

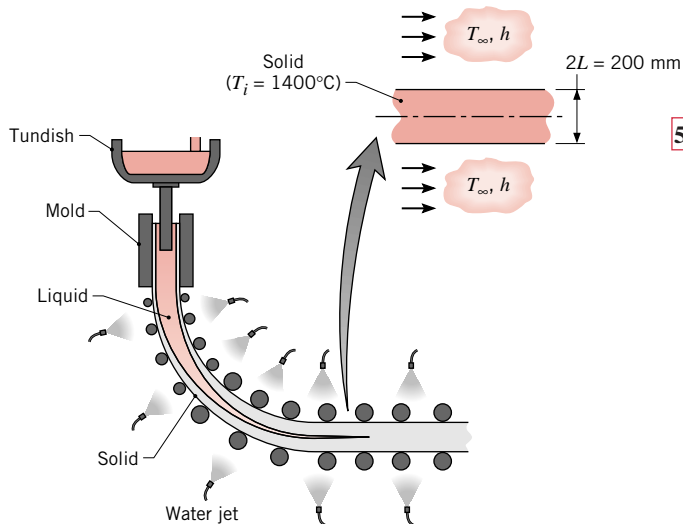

Consider a 200-mm-thick solid slab of steel ( $\rho = 7800 \text{ kg/m}^3$ ,  $c = 700 \text{ J/kg} \cdot \text{K}$ ,  $k = 30 \text{ W/m} \cdot \text{K}$ ), initially at a uniform temperature of  $T_i = 1400^\circ\text{C}$ . The slab is cooled at its top and bottom surfaces by water jets ( $T_\infty = 50^\circ\text{C}$ ), which maintain an approximately uniform convection coefficient of  $h = 5000 \text{ W/m}^2 \cdot \text{K}$  at both surfaces. Using a finite-difference solution with a space increment of  $\Delta x = 1 \text{ mm}$ , determine the time required to cool the surface of the slab to  $200^\circ\text{C}$ . What is the corresponding temperature at the midplane of the slab? If the slab moves at a speed of  $V = 15 \text{ mm/s}$ , what is the required length of the cooling section?

**5.106** A very thick plate with thermal diffusivity  $5.6 \times 10^{-6} \text{ m}^2/\text{s}$  and thermal conductivity  $20 \text{ W/m} \cdot \text{K}$  is initially at a uniform temperature of  $325^\circ\text{C}$ . Suddenly, the surface is exposed to a coolant at  $15^\circ\text{C}$  for which the convection heat transfer coefficient is  $100 \text{ W/m}^2 \cdot \text{K}$ . Using the finite-difference method with a space increment of  $\Delta x = 15 \text{ mm}$  and a time increment of  $18 \text{ s}$ , determine temperatures at the surface and at a depth of  $45 \text{ mm}$  after  $3 \text{ min}$  have elapsed.

**5.107** Referring to Example 5.10, Comment 4, consider a sudden exposure of the surface to large surroundings at an elevated temperature ( $T_{\text{sur}}$ ) and to convection ( $T_\infty$ ,  $h$ ).

- Derive the explicit, finite-difference equation for the surface node in terms of  $Fo$ ,  $Bi$ , and  $Bi_r$ .
- Obtain the stability criterion for the surface node. Does this criterion change with time? Is the criterion more restrictive than that for an interior node?

(c) A thick slab of material ( $k = 1.5 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 7 \times 10^{-7} \text{ m}^2/\text{s}$ ,  $\epsilon = 0.9$ ), initially at a uniform temperature of  $27^\circ\text{C}$ , is suddenly exposed to large surroundings at  $1000 \text{ K}$ . Neglecting convection and using a space increment of  $10 \text{ mm}$ , determine temperatures at the surface and  $30 \text{ mm}$  from the surface after an elapsed time of  $1 \text{ min}$ .

**5.108** Consider the thick slab of copper in Example 5.10, which is initially at a uniform temperature of  $20^\circ\text{C}$  and is suddenly exposed to a net radiant flux of  $3 \times 10^5 \text{ W/m}^2$ . Use the *Finite-Difference Equations/One-Dimensional/Transient* conduction model builder of *IHT* to obtain the implicit form of the finite-difference equations for the interior nodes. In your analysis, use a space increment of  $\Delta x = 37.5 \text{ mm}$  with a total of 17 nodes (00–16), and a time increment of  $\Delta t = 1.2 \text{ s}$ . For the surface node 00, use the finite-difference equation derived in Section 2 of the Example.

- Calculate the 00 and 04 nodal temperatures at  $t = 120 \text{ s}$ , that is,  $T(0, 120 \text{ s})$  and  $T(0.15 \text{ m}, 120 \text{ s})$ , and compare the results with those given in Comment 1 for the exact solution. Will a time increment of  $0.12 \text{ s}$  provide more accurate results?
- Plot temperature histories for  $x = 0, 150$ , and  $600 \text{ mm}$ , and explain key features of your results.


**5.109** Consider the thick slab of copper in Example 5.10, which is initially at a uniform temperature of  $20^\circ\text{C}$  and is suddenly exposed to large surroundings at  $1000^\circ\text{C}$  (instead of a prescribed heat flux).

- For a surface emissivity of  $0.94$ , calculate the temperatures  $T(0, 120 \text{ s})$  and  $T(0.15 \text{ m}, 120 \text{ s})$  using the finite-element software *FEHT*. *Hint:* In the *Convection Coefficient* box of the *Specify/Boundary Conditions* menu of *FEHT*, enter the linearized radiation coefficient (see Equation 1.9) for the surface ( $x = 0$ ). Enter the temperature of the surroundings in the *Fluid Temperature* box. See also the *Help* section on *Entering Equations*. Click on *Setup/Temperatures in K* to enter all temperatures in kelvins.
- Plot the temperature histories for  $x = 0, 150$ , and  $600 \text{ mm}$ , and explain key features of your results.

**5.110** Consider the composite wall of Problem 2.53. In part (d), you are asked to sketch the temperature histories at  $x = 0, L$  during the transient period between cases 2 and 3. Calculate and plot these histories using the finite-element method of *FEHT*, the finite-difference method of *IHT* (with  $\Delta x = 5 \text{ mm}$  and  $\Delta t = 1.2 \text{ s}$ ), and/or an alternative procedure of your choice. If you

use more than one method, compare the respective results. Note that, in using *FEHT* or *IHT*, a look-up table must be created for prescribing the variation of the heater flux with time (see the appropriate *Help* section for guidance).


- 5.111** In Section 5.5, the one-term approximation to the series solution for the temperature distribution was developed for a plane wall of thickness  $2L$  that is initially at a uniform temperature and suddenly subjected to convection heat transfer. If  $Bi < 0.1$ , the wall can be approximated as isothermal and represented as a lumped capacitance (Equation 5.7). For the conditions shown schematically, we wish to compare predictions based on the one-term approximation, the lumped capacitance method, and a finite-difference solution.

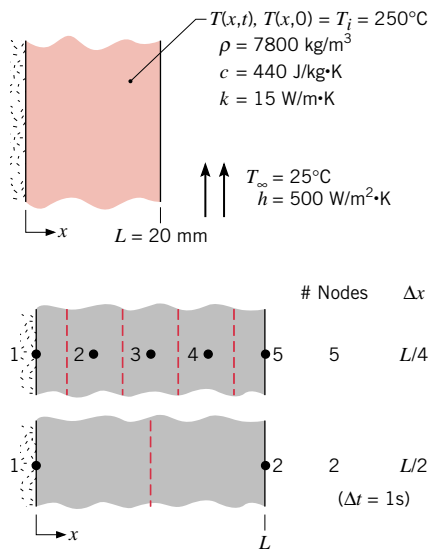

- Determine the midplane,  $T(0, t)$ , and surface,  $T(L, t)$ , temperatures at  $t = 100, 200$ , and  $500 \text{ s}$  using the one-term approximation to the series solution, Equation 5.40. What is the Biot number for the system?
- Treating the wall as a lumped capacitance, calculate the temperatures at  $t = 50, 100, 200$ , and  $500 \text{ s}$ . Did you expect these results to compare favorably with those from part (a)? Why are the temperatures considerably higher?
- Consider the 2- and 5-node networks shown schematically. Write the implicit form of the finite-difference equations for each network, and determine the temperature distributions for  $t = 50, 100, 200$ , and  $500 \text{ s}$  using a time increment of  $\Delta t = 1 \text{ s}$ . You may use *IHT* to solve the finite-difference equations by representing the rate of change of the

nodal temperatures by the intrinsic function,  $\text{Der}(T, t)$ . Prepare a table summarizing the results of parts (a), (b), and (c). Comment on the relative differences of the predicted temperatures. *Hint*: See the *Solver/Intrinsic Functions* section of *IHT/Help* or the *IHT Examples* menu (Example 5.2) for guidance on using the  $\text{Der}(T, t)$  function.

- 5.112** Consider the bonding operation described in Problem 3.103, which was analyzed under steady-state conditions. In this case, however, the laser will be used to heat the film for a prescribed period of time, creating the transient heating situation shown in the sketch.

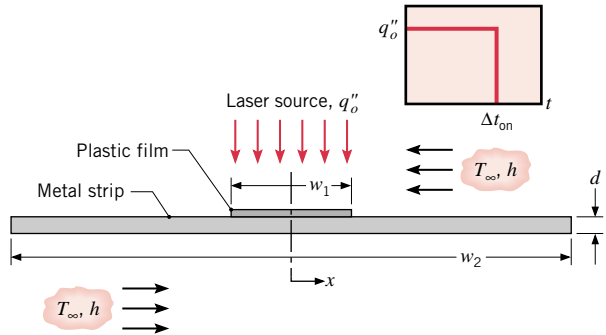


The strip is initially at  $25^\circ\text{C}$  and the laser provides a uniform flux of  $85,000 \text{ W/m}^2$  over a time interval of  $\Delta t_{\text{on}} = 10 \text{ s}$ . The system dimensions and thermophysical properties remain the same, but the convection coefficient to the ambient air at  $25^\circ\text{C}$  is now  $100 \text{ W/m}^2\cdot\text{K}$  and  $w_1 = 44 \text{ mm}$ .


Using an implicit finite-difference method with  $\Delta x = 4 \text{ mm}$  and  $\Delta t = 1 \text{ s}$ , obtain temperature histories for  $0 \leq t \leq 30 \text{ s}$  at the center and film edge,  $T(0, t)$  and  $T(w_1/2, t)$ , respectively, to determine if the adhesive is satisfactorily cured above  $90^\circ\text{C}$  for  $10 \text{ s}$  and if its degradation temperature of  $200^\circ\text{C}$  is exceeded.

- 5.113** One end of a stainless steel (AISI 316) rod of diameter  $10 \text{ mm}$  and length  $0.16 \text{ m}$  is inserted into a fixture maintained at  $200^\circ\text{C}$ . The rod, covered with an insulating sleeve, reaches a uniform temperature throughout its length. When the sleeve is removed, the rod is subjected to ambient air at  $25^\circ\text{C}$  such that the convection heat transfer coefficient is  $30 \text{ W/m}^2\cdot\text{K}$ .
- Using the explicit finite-difference technique with a space increment of  $\Delta x = 0.016 \text{ m}$ , estimate the time required for the midlength of the rod to reach  $100^\circ\text{C}$ .
  - With  $\Delta x = 0.016 \text{ m}$  and  $\Delta t = 10 \text{ s}$ , compute  $T(x, t)$  for  $0 \leq t \leq t_1$ , where  $t_1$  is the time required for the midlength of the rod to reach  $50^\circ\text{C}$ . Plot the temperature distribution for  $t = 0, 200 \text{ s}, 400 \text{ s}$ , and  $t_1$ .

- 5.114** A tantalum rod of diameter 3 mm and length 120 mm is supported by two electrodes within a large vacuum enclosure. Initially the rod is in equilibrium with the electrodes and its surroundings, which are maintained at 300 K. Suddenly, an electrical current,  $I = 80$  A, is passed through the rod. Assume the emissivity of the rod is 0.1 and the electrical resistivity is  $95 \times 10^{-8} \Omega \cdot \text{m}$ . Use Table A.1 to obtain the other thermophysical properties required in your solution. Use a finite-difference method with a space increment of 10 mm.

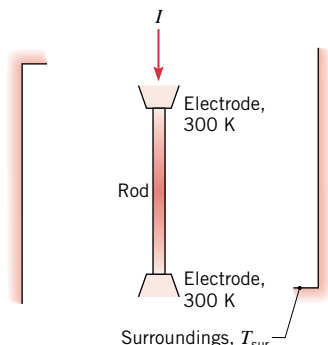

- (a) Estimate the time required for the midlength of the rod to reach 1000 K.
- (b) Determine the steady-state temperature distribution and estimate approximately how long it will take to reach this condition.
- 5.115** A support rod ( $k = 15 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 4.0 \times 10^{-6} \text{ m}^2/\text{s}$ ) of diameter  $D = 15 \text{ mm}$  and length  $L = 100 \text{ mm}$  spans a channel whose walls are maintained at a temperature of  $T_b = 300 \text{ K}$ . Suddenly, the rod is exposed to a cross flow of hot gases for which  $T_\infty = 600 \text{ K}$  and  $h = 75 \text{ W/m}^2 \cdot \text{K}$ . The channel walls are cooled and remain at 300 K.

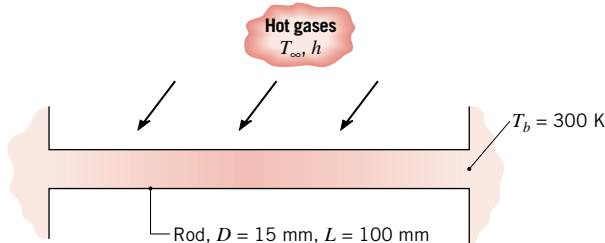


- (a) Using an appropriate numerical technique, determine the thermal response of the rod to the convective heating. Plot the midspan temperature as a function of elapsed time. Using an appropriate analytical model of the rod, determine the steady-state temperature distribution and compare the result with that obtained numerically for very long elapsed times.

- (b) After the rod has reached steady-state conditions, the flow of hot gases is suddenly terminated, and the rod cools by free convection to ambient air at  $T_\infty = 300 \text{ K}$  and by radiation exchange with large surroundings at  $T_{\text{sur}} = 300 \text{ K}$ . The free convection coefficient can be expressed as  $h \text{ (W/m}^2 \cdot \text{K)} = C \Delta T^n$ , where  $C = 4.4 \text{ W/m}^2 \cdot \text{K}^{1.188}$  and  $n = 0.188$ . The emissivity of the rod is 0.5. Determine the subsequent thermal response of the rod. Plot the midspan temperature as a function of cooling time, and determine the time required for the rod to reach a *safe-to-touch* temperature of 315 K.

- 5.116** Consider the acceleration-grid foil ( $k = 40 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 3 \times 10^{-5} \text{ m}^2/\text{s}$ ,  $\varepsilon = 0.45$ ) of Problem 4.72. Develop an implicit, finite-difference model of the foil, which can be used for the following purposes.

- (a) Assuming the foil to be at a uniform temperature of 300 K when the ion beam source is activated, obtain a plot of the midspan temperature–time history. At what elapsed time does this point on the foil reach a temperature within 1 K of the steady-state value?
- (b) The foil is operating under steady-state conditions when, suddenly, the ion beam is deactivated. Obtain a plot of the subsequent midspan temperature–time history. How long does it take for the hottest point on the foil to cool to 315 K, a *safe-to-touch* condition?


- 5.117** Circuit boards are treated by heating a stack of them under high pressure as illustrated in Problem 5.45 and described further in Problem 5.46. A finite-difference method of solution is sought with two additional considerations. First, the book is to be treated as having distributed, rather than lumped, characteristics, by using a grid spacing of  $\Delta x = 2.36 \text{ mm}$  with nodes at the center of the individual circuit board or plate. Second, rather than bringing the platens to  $190^\circ\text{C}$  in one sudden change, the heating schedule  $T_p(t)$  shown below is to be used in order to minimize excessive thermal stresses induced by rapidly changing thermal gradients in the vicinity of the platens.

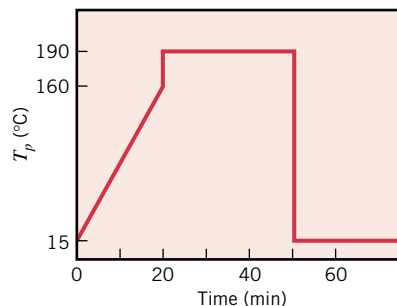



- Using a time increment of  $\Delta t = 60$  s and the implicit method, find the temperature history of the midplane of the book and determine whether curing will occur ( $170^\circ\text{C}$  for 5 min).
- Following the reduction of the platen temperatures to  $15^\circ\text{C}$  ( $t = 50$  min), how long will it take for the midplane of the book to reach  $37^\circ\text{C}$ , a safe temperature at which the operator can begin unloading the press?
- Validate your program code by using the heating schedule of a sudden change of platen temperature from  $15$  to  $190^\circ\text{C}$  and compare results with those from an appropriate analytical solution (see Problem 5.46).

**5.118** Common transmission failures result from the glazing of clutch surfaces by deposition of oil oxidation and decomposition products. Both the oxidation and decomposition processes depend on temperature histories of the surfaces. Because it is difficult to measure these surface temperatures during operation, it is useful to develop models to predict clutch-interface thermal behavior. The relative velocity between mating clutch plates, from the initial engagement to the zero-sliding (lock-up) condition, generates heat that is transferred to the plates. The relative velocity decreases at a constant rate during this period, producing a heat flux that is initially very large and decreases linearly with time, until lock-up occurs. Accordingly,  $q_f'' = q_o''[1 - (t/t_{lu})]$ , where  $q_o'' = 1.6 \times 10^7 \text{ W/m}^2$  and  $t_{lu} = 100$  ms is the lock-up time. The plates have an initial uniform temperature of  $T_i = 40^\circ\text{C}$ , when the prescribed frictional heat flux is suddenly applied to the surfaces. The reaction plate is fabricated from steel, while the composite plate has a thinner steel center section bonded to low-conductivity friction material layers. The thermophysical properties are  $\rho_s = 7800 \text{ kg/m}^3$ ,  $c_s = 500 \text{ J/kg} \cdot \text{K}$ , and  $k_s = 40 \text{ W/m} \cdot \text{K}$  for the steel and  $\rho_{fm} = 1150 \text{ kg/m}^3$ ,  $c_{fm} = 1650 \text{ J/kg} \cdot \text{K}$ , and  $k_{fm} = 4 \text{ W/m} \cdot \text{K}$  for the friction material.

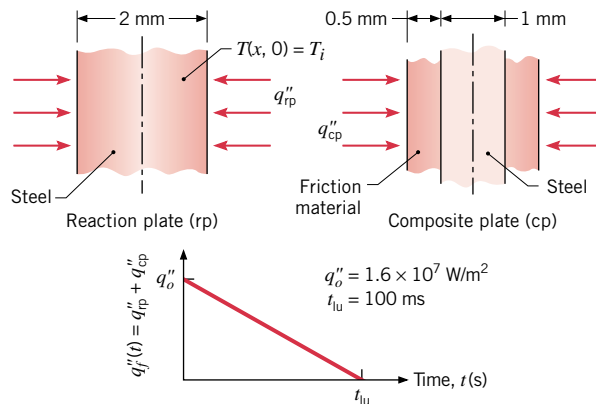


- On  $T - t$  coordinates, sketch the temperature history at the midplane of the reaction plate, at the interface between the clutch pair, and at the midplane of the composite plate. Identify key features.
- Perform an energy balance on the clutch pair over the time interval  $\Delta t = t_{lu}$  to determine the steady-state temperature resulting from clutch engagement. Assume negligible heat transfer from the plates to the surroundings.
- Compute and plot the three temperature histories of interest using the finite-element method of *FEHT* or the finite-difference method of *IHT* (with  $\Delta x = 0.1$  mm and  $\Delta t = 1$  ms). Calculate and plot the frictional heat fluxes to the reaction and composite plates,  $q''_{rp}$  and  $q''_{cp}$ , respectively, as a function of time. Comment on features of the temperature and heat flux histories. Validate your model by comparing predictions with the results from part (b). *Note:* Use of both *FEHT* and *IHT* requires creation of a look-up data table for prescribing the heat flux as a function of time.

**5.119** Heat transfer is not an intuitive process muses the Curious Cook. Does doubling the thickness of a hamburger approximately double the cooking time? What effect does the initial temperature have on cooking time? To answer these questions, develop a model to do virtual cooking of meat of thickness  $2L$  in a double-sided grill. The meat is initially at  $20^\circ\text{C}$  when it is placed in the grill and both sides experience convection heat transfer characterized by an ambient temperature of  $100^\circ\text{C}$  and a convection coefficient of  $5000 \text{ W/m}^2 \cdot \text{K}$ . Assume the meat to have the properties of liquid water at  $300 \text{ K}$  and to be properly cooked when the center temperature is  $60^\circ\text{C}$ .

- For hamburgers of thickness  $2L = 10, 20$ , and  $30$  mm, calculate the time for the center to reach the required cooking temperature of  $60^\circ\text{C}$ . Determine a relationship between the cooking time and the thickness. For your solution, use the finite-element method of *FEHT*, the ready-to-solve model in the *Models/Transient Conduction/Plane Wall* section of *IHT*, or a numerical procedure of your choice. For one of the thicknesses, use an appropriate analytical solution to validate your numerical results.
- Without performing a detailed numerical solution, but drawing on the results of part (a), what can you say about the effect on the cooking time of changing the initial temperature of the meat from  $20^\circ\text{C}$  to  $5^\circ\text{C}$ ? You may use your numerical model from part (a) to confirm your assessment.


- 5.120** A process mixture at 200°C flows at a rate of 207 kg/min onto a conveyor belt of 3-mm thickness, 1-m width, and 30-m length traveling with a velocity of 36 m/min. The underside of the belt is cooled by a water spray at a temperature of 30°C, and the convection coefficient is 3000 W/m<sup>2</sup>·K. The thermophysical properties of the process mixture are  $\rho_m = 960$  kg/m<sup>3</sup>,  $c_m = 1700$  J/kg·K, and  $k_m = 1.5$  W/m·K, while the properties for the conveyor (metallic) belt are  $\rho_b = 8000$  kg/m<sup>3</sup>,  $c_b = 460$  J/kg·K, and  $k_b = 15$  W/m·K.

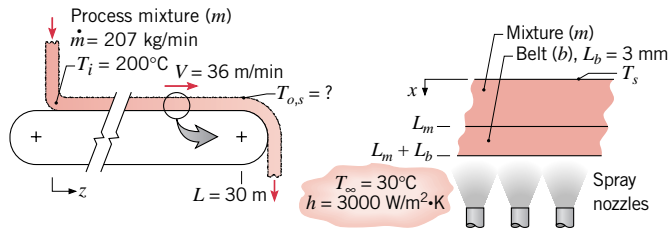

Using the finite-difference method of *IHT* ( $\Delta x = 0.5$  mm,  $\Delta t = 0.05$  s), the finite-element method of *FEHT*, or a numerical procedure of your choice, calculate the surface temperature of the mixture at the end of the conveyor belt,  $T_{o,s}$ . Assume negligible heat transfer to the ambient air by convection or by radiation to the surroundings.


### Finite-Difference Equations: Cylindrical Coordinates

- 5.121** A thin circular disk is subjected to induction heating from a coil, the effect of which is to provide a uniform heat generation within a ring section as shown. Convection occurs at the upper surface, while the lower surface is well insulated.

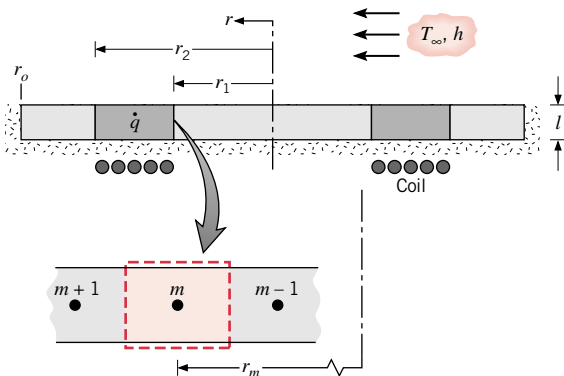

- (a) Derive the transient, finite-difference equation for node  $m$ , which is within the region subjected to induction heating.
- (b) On  $T$ - $r$  coordinates sketch, in a qualitative manner, the steady-state temperature distribution, identifying important features.

- 5.122** An electrical cable, experiencing a uniform volumetric generation  $\dot{q}$ , is half buried in an insulating material while the upper surface is exposed to a convection process ( $T_\infty, h$ ).

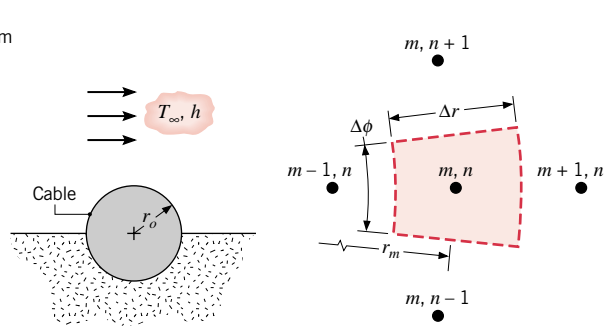


- (a) Derive the explicit, finite-difference equations for an interior node ( $m, n$ ), the center node ( $m = 0$ ), and the outer surface nodes ( $M, n$ ) for the convection and insulated boundaries.
- (b) Obtain the stability criterion for each of the finite-difference equations. Identify the most restrictive criterion.

### Finite-Difference Solutions: Two-Dimensional Systems

- 5.123** Two very long (in the direction normal to the page) bars having the prescribed initial temperature distributions are to be soldered together. At time  $t = 0$ , the  $m = 3$  face of the copper (pure) bar contacts the  $m = 4$  face of the steel (AISI 1010) bar. The solder and flux act as an interfacial layer of negligible thickness and effective contact resistance  $R''_{t,c} = 2 \times 10^{-5}$  m<sup>2</sup>·K/W.


#### Initial Temperatures (K)

$m/n$	1	2	3	4	5	6
1	700	700	700	1000	900	800
2	700	700	700	1000	900	800
3	700	700	700	1000	900	800

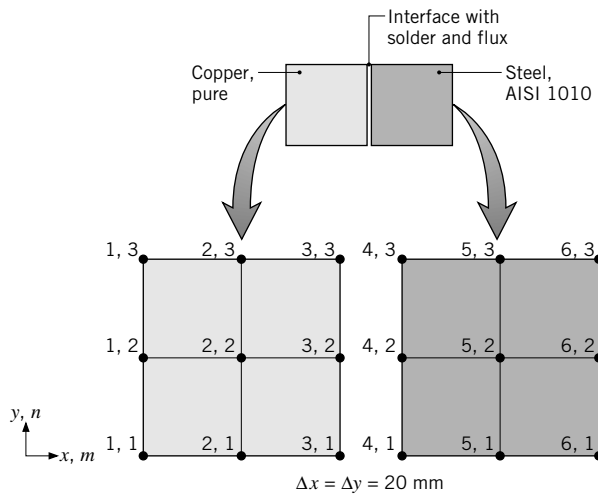

- Derive the explicit, finite-difference equation in terms of  $Fo$  and  $Bi_c = \Delta x / kR''_{t,c}$  for  $T_{4,2}$  and determine the corresponding stability criterion.
- Using  $Fo = 0.01$ , determine  $T_{4,2}$  one time step after contact is made. What is  $\Delta t$ ? Is the stability criterion satisfied?

**5.124** In a manufacturing process, stainless steel cylinders (AISI 304) initially at 600 K are quenched by submersion in an oil bath maintained at 300 K with  $h = 500 \text{ W/m}^2 \cdot \text{K}$ . Each cylinder is of length  $2L = 60 \text{ mm}$  and diameter  $D = 80 \text{ mm}$ . Use the *ready-to-solve* model in the *Examples* menu of *FEHT* to obtain the following solutions.

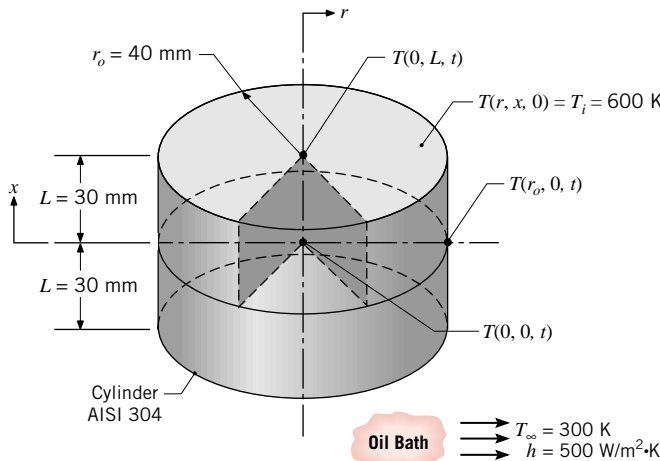

- Calculate the temperatures,  $T(r, x, t)$ , after 3 min at the cylinder center,  $T(0, 0, 3 \text{ min})$ , at the center of a circular face,  $T(0, L, 3 \text{ min})$ , and the midheight of the side,  $T(r_o, 0, 3 \text{ min})$ .

- Plot the temperature history at the center,  $T(0, 0, t)$ , and at the midheight of the side,  $T(r_o, 0, t)$ , for  $0 \leq t \leq 10 \text{ min}$  using the *View/Temperatures vs. Time* command. Comment on the gradients occurring at these locations and what effect they might have on phase transformations and thermal stresses.
- Having solved the model for a total integration time of 10 min in part (b), now use the *View/Temperature Contours* command with the shaded band option for the isotherm contours. Select the *From Start to Stop* time option, and view the temperature contours as the cylinder cools during the quench process. Describe the major features of the cooling process revealed by this display. Use other options of this command to create a 10-isotherm temperature distribution for  $t = 3 \text{ min}$ .
- For the location of part (a), calculate the temperatures after 3 min if the convection coefficient is doubled ( $h = 1000 \text{ W/m}^2 \cdot \text{K}$ ). Also, for convection coefficients of 500 and  $1000 \text{ W/m}^2 \cdot \text{K}$ , determine how long the cylinder needs to remain in the oil bath to achieve a *safe-to-touch* surface temperature of 316 K. Tabulate and comment on the results of parts (a) and (d).

**5.125** Consider the system of Problem 4.55. Initially with no flue gases flowing, the walls ( $\alpha = 5.5 \times 10^{-7} \text{ m}^2/\text{s}$ ) are at a uniform temperature of  $25^\circ\text{C}$ . Using the implicit, finite-difference method with a time increment of 1 h, find the temperature distribution in the wall 5, 10, 50, and 100 h after introduction of the flue gases.

**5.126** Consider the system of Problem 4.73. Initially, the ceramic plate ( $\alpha = 1.5 \times 10^{-6} \text{ m}^2/\text{s}$ ) is at a uniform temperature of  $30^\circ\text{C}$ , and suddenly the electrical heating elements are energized. Using the implicit, finite-difference method, estimate the time required for the difference between the surface and initial temperatures to reach 95% of the difference for steady-state conditions. Use a time increment of 2 s.

**5.127** Consider the thermal conduction module and operating conditions of Problem 4.76. To evaluate the transient response of the cold plate, which has a thermal diffusivity of  $\alpha = 75 \times 10^{-6} \text{ m}^2/\text{s}$ , assume that, when the module is activated at  $t = 0$ , the initial temperature of the cold plate is  $T_i = 15^\circ\text{C}$  and a uniform heat flux of  $q''_o = 10^5 \text{ W/m}^2$  is applied at its base. Using the implicit finite-difference method and a time increment of  $\Delta t = 0.1 \text{ s}$ , compute the designated nodal temperatures as a function of time. From the temperatures




computed at a particular time, evaluate the ratio of the rate of heat transfer by convection to the water to the heat input at the base. Terminate the calculations when this ratio reaches 0.99. Print the temperature field at 5-s intervals and at the time for which the calculations are terminated.

**5.128** The operations manager for a metals processing plant anticipates the need to repair a large furnace and has come to you for an estimate of the time required for the furnace interior to cool to a safe working temperature. The furnace is cubical with a 16-m interior dimension and 1-m thick walls for which  $\rho = 2600 \text{ kg/m}^3$ ,  $c = 960 \text{ J/kg} \cdot \text{K}$ , and  $k = 1 \text{ W/m} \cdot \text{K}$ . The operating temperature of the furnace is  $900^\circ\text{C}$ , and the outer surface experiences convection with ambient air at  $25^\circ\text{C}$  and a convection coefficient of  $20 \text{ W/m}^2 \cdot \text{K}$ .

(a) Use a numerical procedure to estimate the time required for the inner surface of the furnace to cool to a safe working temperature of  $35^\circ\text{C}$ . *Hint:* Consider a two-dimensional cross-section of the furnace, and perform your analysis on the smallest symmetrical section.

(b) Anxious to reduce the furnace downtime, the operations manager also wants to know what effect circulating ambient air through the furnace would have on the cool-down period. Assume equivalent convection conditions for the inner and outer surfaces.

**5.129** The door panel of an automobile is fabricated by a plastic hot-extrusion process resulting in the ribbed cross section shown schematically. Following a process involving air-cooling, painting, and baking, the panel is ready for assembly on the vehicle. However, upon visual inspection, the rib pattern is evident on the outer surface. In regions over the ribs, the paint has an “orange peel” appearance, making the door panel unacceptable for use. The apparent reason for this defect is the variable microfinish caused by differential cooling rates at the surface of the panel, which affect adherence of the paint. Your assignment is to estimate the panel surface temperature distribution as a function of cooling time.

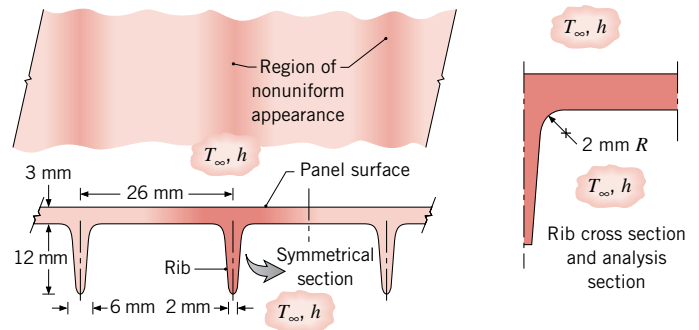

Use the finite-element software *FEHT* to obtain the temperature distribution in the symmetrical section shown schematically. The panel is ejected from the extrusion press at a uniform temperature of  $275^\circ\text{C}$  and is allowed to cool on a transport table, where the air temperature is  $25^\circ\text{C}$  and the convection coefficient is  $10 \text{ W/m}^2 \cdot \text{K}$ . The thermophysical properties of the extruded plastic are  $\rho = 1050 \text{ kg/m}^3$ ,  $c = 800 \text{ J/kg} \cdot \text{K}$ , and  $k = 0.5 \text{ W/m} \cdot \text{K}$ .

(a) Using the *View/Temperature vs. Time* command, plot temperature histories for selected locations on the panel surface. Is there noticeable differential cooling in the region above the rib? If so, what is the cause? *Hint:* When you draw the shape outline in *FEHT*, represent the fillet region by six or seven segments that approximate the fillet radius. Then draw element lines to form triangular elements.

(b) Use the *View/Temperature Contours* command with the shaded band option to plot the isotherm contours. Select the *From Start to Stop* time option, and view the temperature contours as the panel cools. Describe major features of the cooling process observed from the display. Use other options of this command to create a 10-isotherm temperature distribution for a time that illustrates some of the foregoing important features. How would you redesign the ribbed panel to reduce this thermally induced defect, while still retaining the stiffening function required of the ribs?




**5S.1**


### Graphical Representation of One-Dimensional, Transient Conduction in the Plane Wall, Long Cylinder, and Sphere

In Sections 5.5 and 5.6, one-term approximations have been developed for transient, one-dimensional conduction in a plane wall (with symmetrical convection conditions) and radial systems (long cylinder and sphere). The results apply for  $Fo > 0.2$  and can conveniently be represented in graphical forms that illustrate the functional dependence of the transient temperature distribution on the Biot and Fourier numbers.

Results for the plane wall (Figure 5.6a) are presented in Figures 5S.1 through 5S.3. Figure 5S.1 may be used to obtain the *midplane* temperature of the wall,  $T(0, t) \equiv T_o(t)$ , at any time during the transient process. If  $T_o$  is known for particular values of  $Fo$  and  $Bi$ , Figure 5S.2 may be used to determine the corresponding temperature at any location *off the midplane*. Hence Figure 5S.2 must be used in conjunction with Figure 5S.1. For example, if one wishes to determine the surface temperature ( $x^* = \pm 1$ ) at some time  $t$ , Figure 5S.1 would first be used to determine  $T_o$  at  $t$ . Figure 5S.2 would then be used to determine the surface temperature from knowledge of  $T_o$ . The

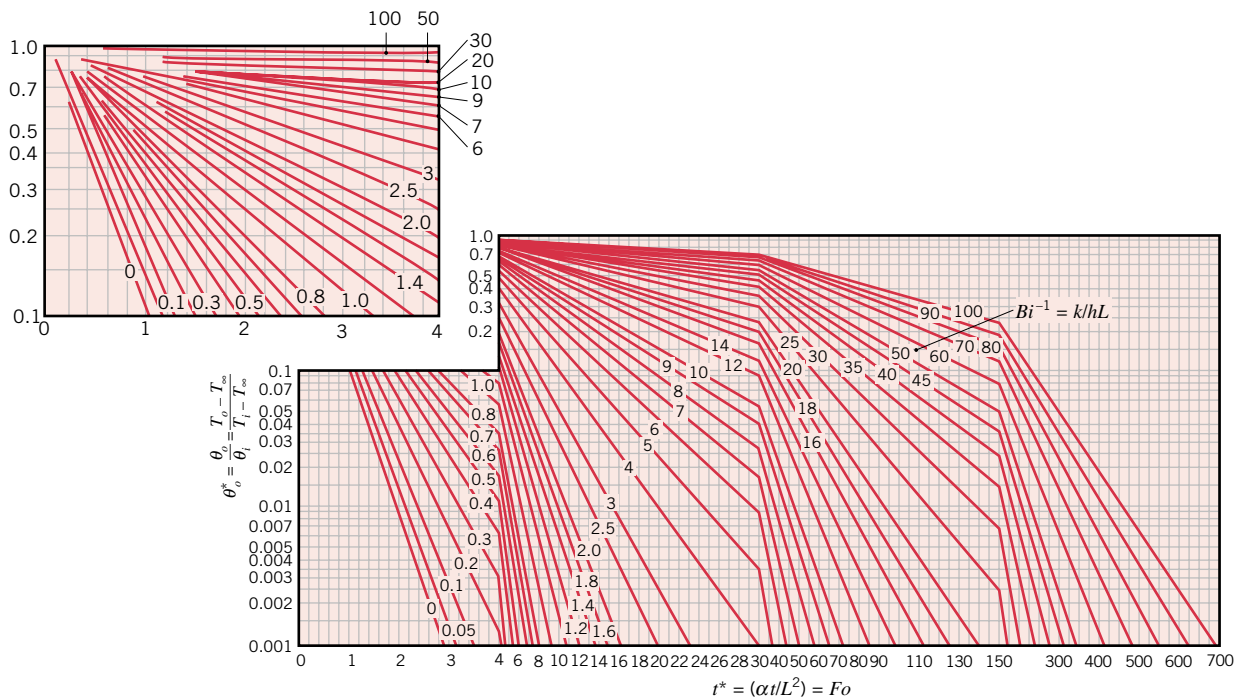

**FIGURE 5S.1** Midplane temperature as a function of time for a plane wall of thickness  $2L$  [1]. Used with permission.

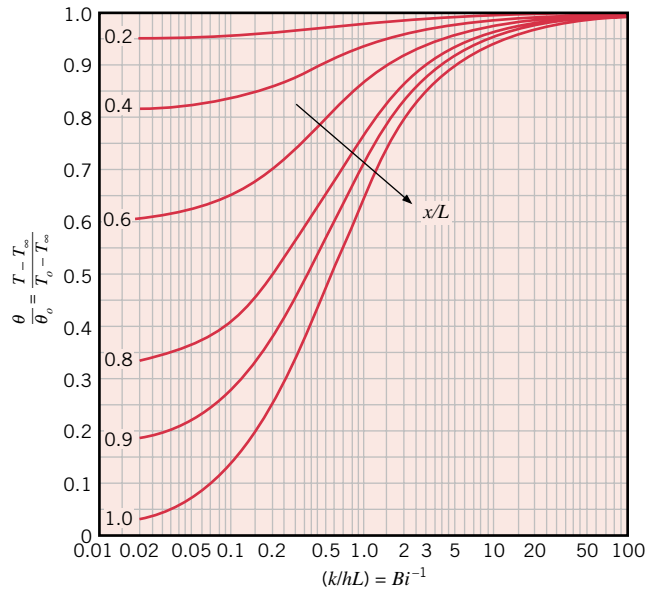


**FIGURE 5S.2** Temperature distribution in a plane wall of thickness  $2L$  [1]. Used with permission.


procedure would be inverted if the problem were one of determining the time required for the surface to reach a prescribed temperature.

Graphical results for the energy transferred from a plane wall over the time interval  $t$  are presented in Figure 5S.3. These results were generated from Equation 5.46. The dimensionless energy transfer  $Q/Q_0$  is expressed exclusively in terms of  $Fo$  and  $Bi$ .


Results for the infinite cylinder are presented in Figures 5S.4 through 5S.6, and those for the sphere are presented in Figures 5S.7 through 5S.9, where the Biot number is defined in terms of the radius  $r_0$ .

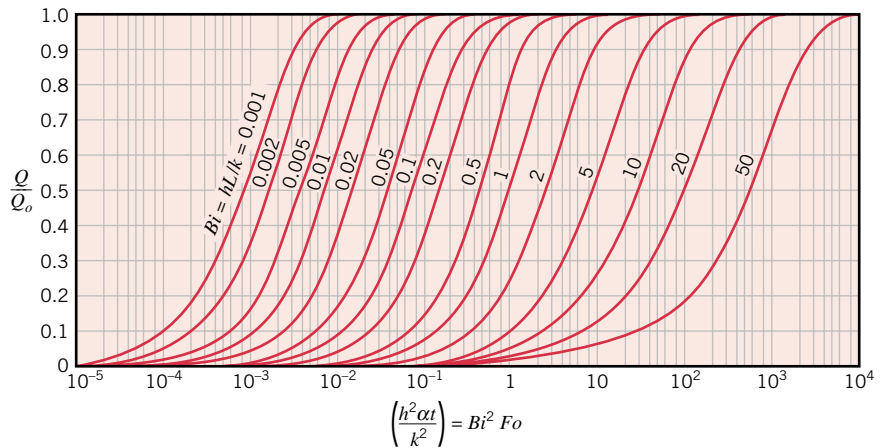


**FIGURE 5S.3** Internal energy change as a function of time for a plane wall of thickness  $2L$  [2]. Adapted with permission.

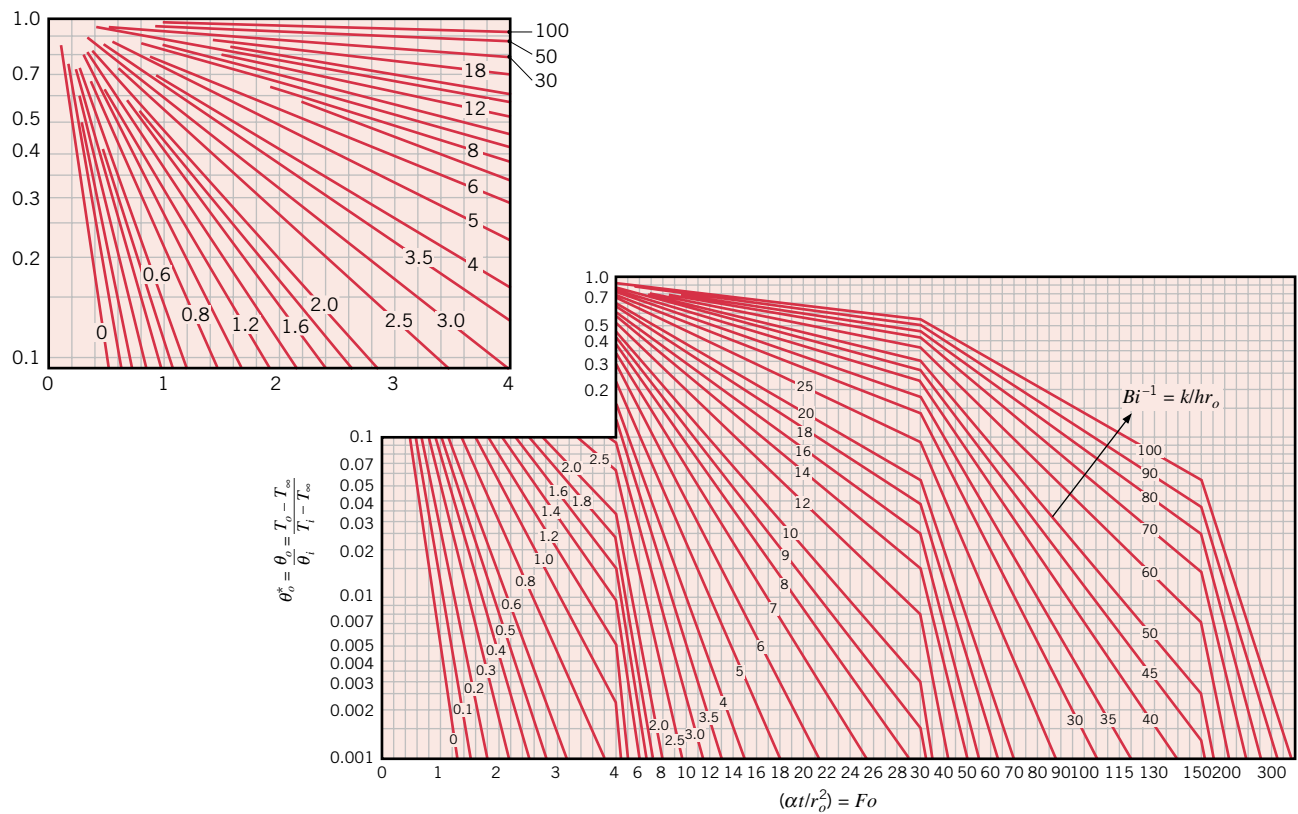

**FIGURE 5S.4** Centerline temperature as a function of time for an infinite cylinder of radius  $r_o$  [1]. Used with permission.

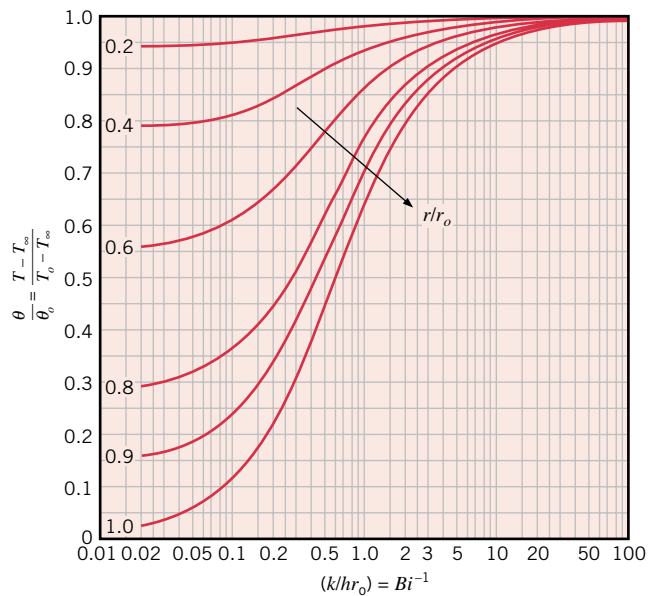


**FIGURE 5S.5** Temperature distribution in an infinite cylinder of radius  $r_o$  [1]. Used with permission.

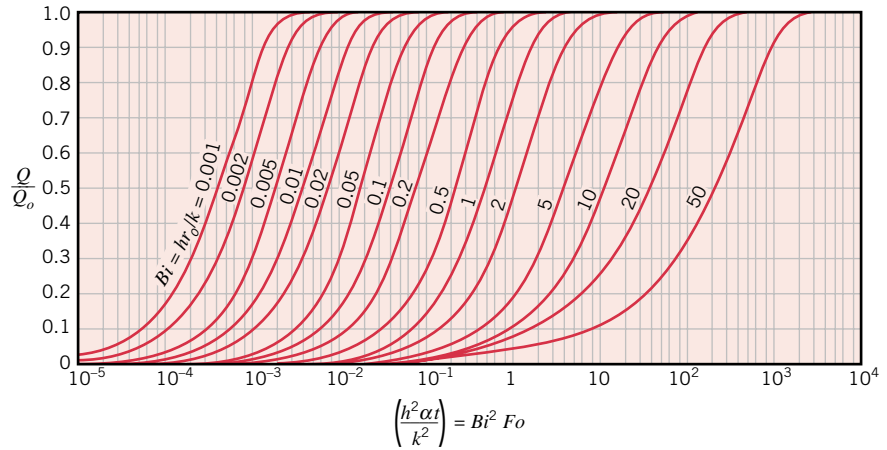


**FIGURE 5S.6** Internal energy change as a function of time for an infinite cylinder of radius  $r_o$  [2]. Adapted with permission.


The foregoing charts may also be used to determine the transient response of a plane wall, an infinite cylinder, or sphere subjected to a *sudden change in surface temperature*. For such a condition it is only necessary to replace  $T_\infty$  by the prescribed surface temperature  $T_s$  and to set  $Bi^{-1}$  equal to zero. In so doing, the convection coefficient is tacitly assumed to be infinite, in which case  $T_\infty = T_s$ .

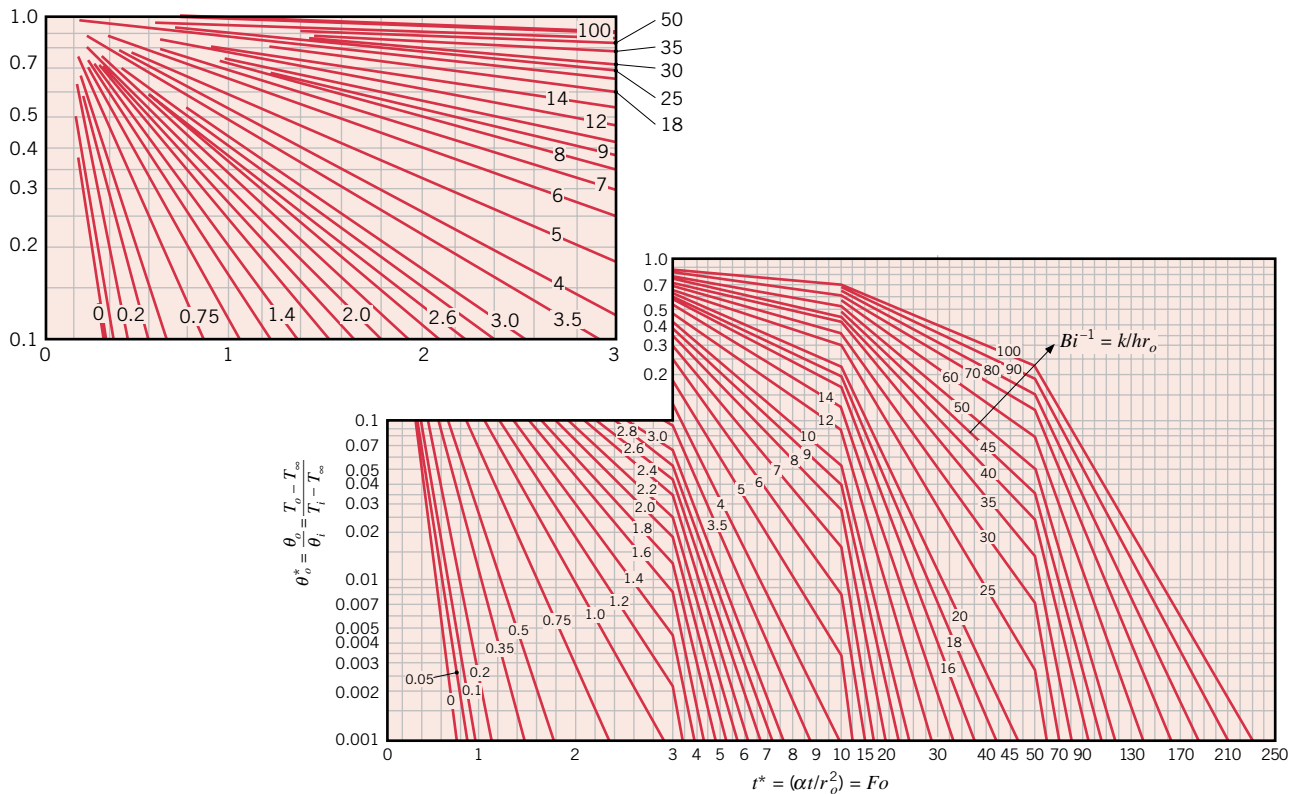

**FIGURE 5S.7** Center temperature as a function of time in a sphere of radius  $r_o$  [1]. Used with permission.

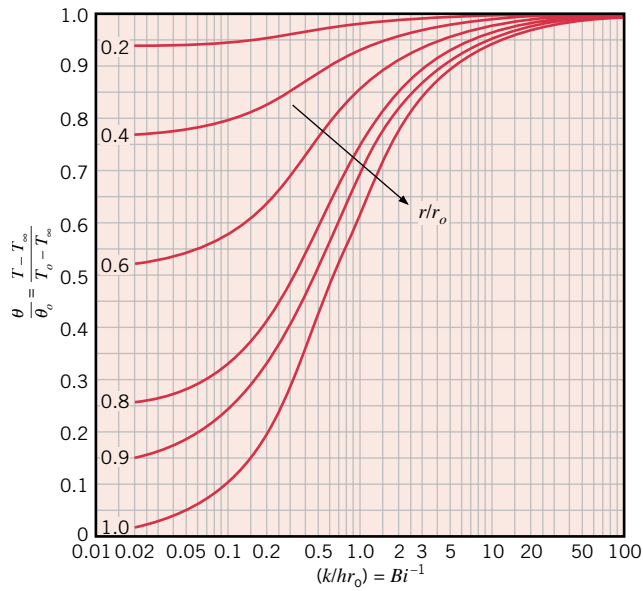

**FIGURE 5S.8** Temperature distribution in a sphere of radius  $r_o$  [1]. Used with permission.

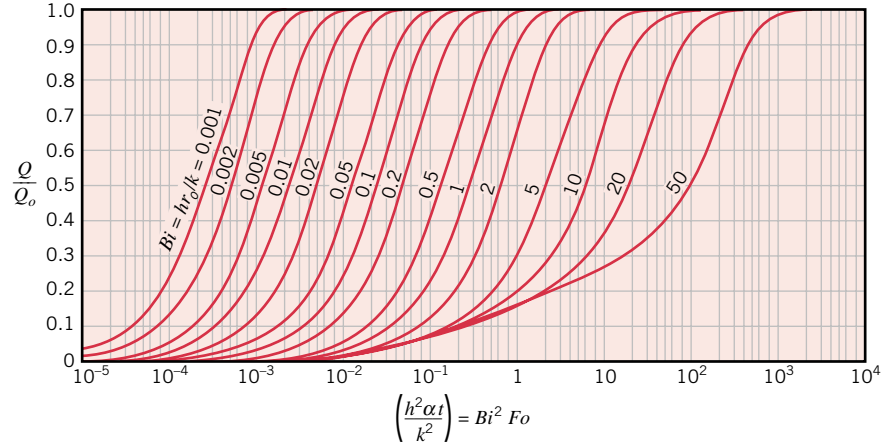

**FIGURE 5S.9** Internal energy change as a function of time for a sphere of radius  $r_o$  [2]. Adapted with permission.

## References

1. Heisler, M. P., *Trans. ASME*, **69**, 227–236, 1947.
2. Gröber, H., S. Erk, and U. Grigull, *Fundamentals of Heat Transfer*, McGraw-Hill, New York, 1961.

## 5S.2

### Analytical Solution of Multidimensional Effects

Transient problems are frequently encountered for which two- and even three-dimensional effects are significant. Solution to a class of such problems can be obtained from the one-dimensional analytical results of Sections 5.5 through 5.7.

Consider immersing the *short* cylinder of Figure 5S.10, which is initially at a uniform temperature  $T_i$ , in a fluid of temperature  $T_\infty \neq T_i$ . Because the length and diameter are comparable, the subsequent transfer of energy by conduction will be significant for both the  $r$  and  $x$  coordinate directions. The temperature within the cylinder will therefore depend on  $r$ ,  $x$ , and  $t$ .


Assuming constant properties and no generation, the appropriate form of the heat equation is, from Equation 2.24,

$$\frac{1}{r} \frac{\partial}{\partial r} \left( r \frac{\partial T}{\partial r} \right) + \frac{\partial^2 T}{\partial x^2} = \frac{1}{\alpha} \frac{\partial T}{\partial t}$$

where  $x$  has been used in place of  $z$  to designate the axial coordinate. A closed-form solution to this equation may be obtained by the separation of variables method. Although we will not consider the details of this solution, it is important to note that the end result may be expressed in the following form:

$$\frac{T(r, x, t) - T_\infty}{T_i - T_\infty} = \frac{T(x, t) - T_\infty}{T_i - T_\infty} \Big|_{\text{Plane wall}} \cdot \frac{T(r, t) - T_\infty}{T_i - T_\infty} \Big|_{\text{Infinite cylinder}}$$

That is, the two-dimensional solution may be expressed as a *product* of one-dimensional solutions that correspond to those for a plane wall of thickness  $2L$  and an infinite cylinder of radius  $r_o$ . For  $Fo > 0.2$ , these solutions are provided by the one-term approximations of Equations 5.40 and 5.49, as well as by Figures 5S.1 and 5S.2 for the plane wall and Figures 5S.4 and 5S.5 for the infinite cylinder.

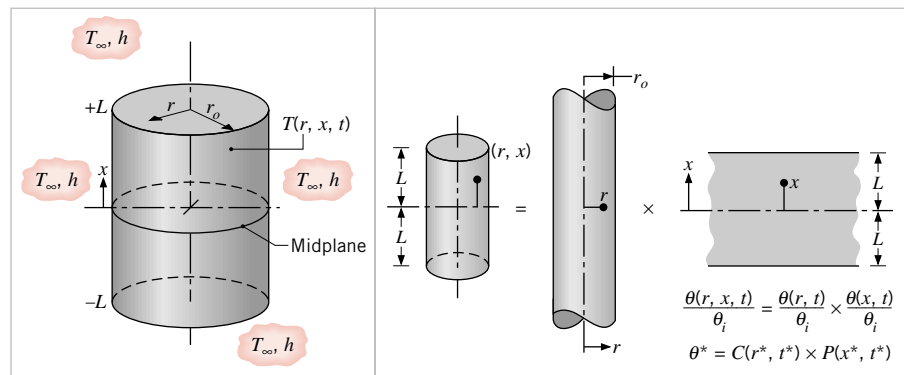

**FIGURE 5S.10** Two-dimensional, transient conduction in a short cylinder. (a) Geometry. (b) Form of the product solution.




Results for other multidimensional geometries are summarized in Figure 5S.11. In each case the multidimensional solution is prescribed in terms of a product involving one or more of the following one-dimensional solutions:

$$S(x, t) \equiv \frac{T(x, t) - T_{\infty}}{T_i - T_{\infty}} \quad \left| \begin{array}{l} \text{Semi-infinite} \\ \text{solid} \end{array} \right. \quad (5S.1)$$

$$P(x, t) \equiv \frac{T(x, t) - T_{\infty}}{T_i - T_{\infty}} \quad \left| \begin{array}{l} \text{Plane} \\ \text{wall} \end{array} \right. \quad (5S.2)$$

$$C(r, t) \equiv \frac{T(r, t) - T_{\infty}}{T_i - T_{\infty}} \quad \left| \begin{array}{l} \text{Infinite} \\ \text{cylinder} \end{array} \right. \quad (5S.3)$$

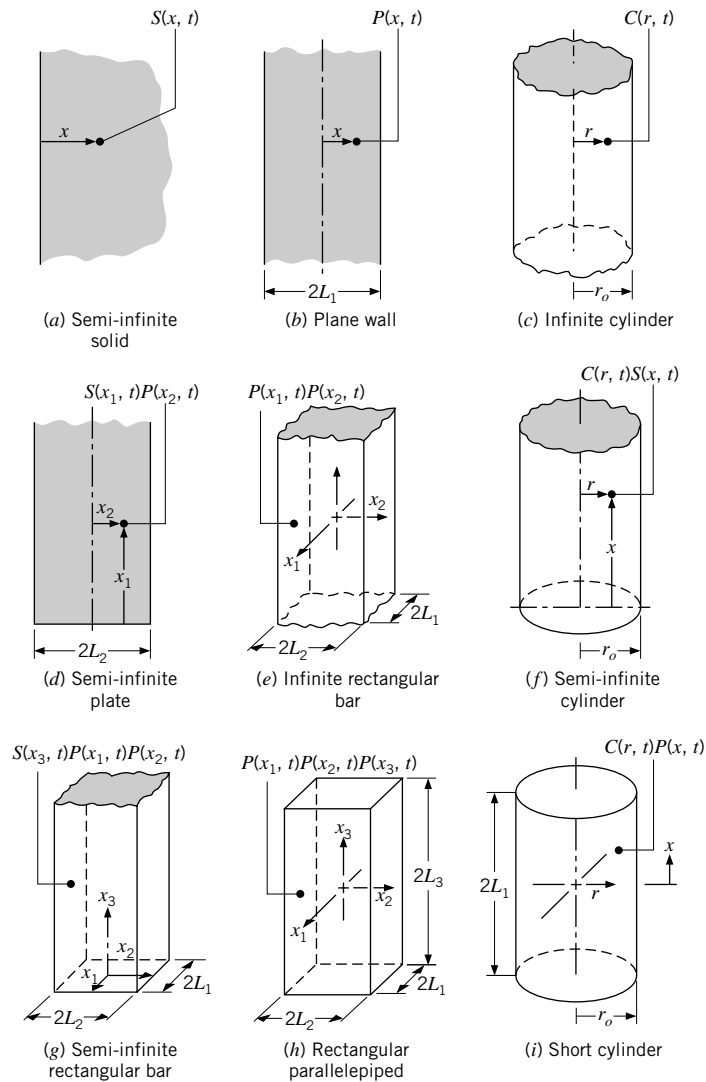

**FIGURE 5S.11** Solutions for multidimensional systems expressed as products of one-dimensional results.

The  $x$  coordinate for the semi-infinite solid is measured from the surface, whereas for the plane wall it is measured from the midplane. In using Figure 5S.11 the coordinate origins should carefully be noted. The transient, three-dimensional temperature distribution in a rectangular parallelepiped, Figure 5S.11*h*, is then, for example, the product of three one-dimensional solutions for plane walls of thicknesses  $2L_1$ ,  $2L_2$ , and  $2L_3$ . That is,

$$\frac{T(x_1, x_2, x_3, t) - T_\infty}{T_i - T_\infty} = P(x_1, t) \cdot P(x_2, t) \cdot P(x_3, t)$$

The distances  $x_1$ ,  $x_2$ , and  $x_3$  are all measured with respect to a rectangular coordinate system whose origin is at the center of the parallelepiped.

The amount of energy  $Q$  transferred to or from a solid during a multidimensional transient conduction process may also be determined by combining one-dimensional results, as shown by Langston [1].

### EXAMPLE 5S.1


In a manufacturing process stainless steel cylinders (AISI 304) initially at 600 K are quenched by submersion in an oil bath maintained at 300 K with  $h = 500 \text{ W/m}^2 \cdot \text{K}$ . Each cylinder is of length  $2L = 60 \text{ mm}$  and diameter  $D = 80 \text{ mm}$ . Consider a time 3 min into the cooling process and determine temperatures at the center of the cylinder, at the center of a circular face, and at the midheight of the side. Note that Problem 5.124 requires a numerical solution of the same problem using *FEHT*.

### SOLUTION

**Known:** Initial temperature and dimensions of cylinder and temperature and convection conditions of an oil bath.

**Find:** Temperatures  $T(r, x, t)$  after 3 min at the cylinder center,  $T(0, 0, 3 \text{ min})$ , at the center of a circular face,  $T(0, L, 3 \text{ min})$ , and at the midheight of the side,  $T(r_o, 0, 3 \text{ min})$ .

**Schematic:**

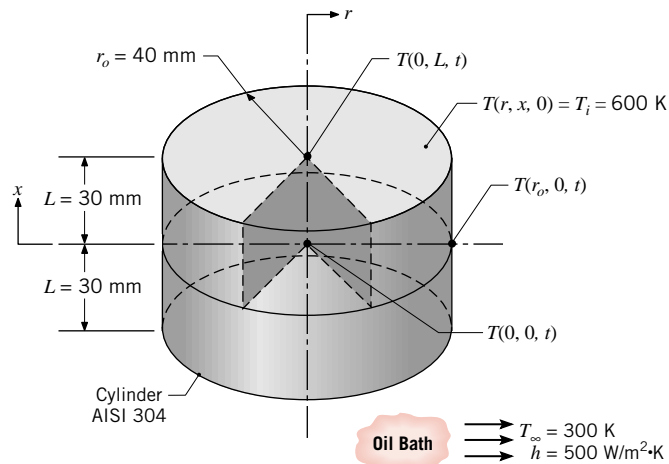

**Assumptions:**

1. Two-dimensional conduction in  $r$  and  $x$ .
2. Constant properties.

**Properties:** Table A.1, stainless steel, AISI 304 [ $T = (600 + 300)/2 = 450$  K]:  
 $\rho = 7900 \text{ kg/m}^3$ ,  $c = 526 \text{ J/kg} \cdot \text{K}$ ,  $k = 17.4 \text{ W/m} \cdot \text{K}$ ,  $\alpha = k/\rho c = 4.19 \times 10^{-6} \text{ m}^2/\text{s}$ .

**Analysis:** The solid steel cylinder corresponds to case (i) of Figure 5S.11, and the temperature at any point in the cylinder may be expressed as the following product of one-dimensional solutions.

$$\frac{T(r, x, t) - T_\infty}{T_i - T_\infty} = P(x, t)C(r, t)$$

where  $P(x, t)$  and  $C(r, t)$  are defined by Equations 5S.2 and 5S.3, respectively. Accordingly, for the center of the cylinder,

$$\frac{T(0, 0, 3 \text{ min}) - T_\infty}{T_i - T_\infty} = \frac{T(0, 3 \text{ min}) - T_\infty}{T_i - T_\infty} \bigg|_{\text{Plane wall}} \cdot \frac{T(0, 3 \text{ min}) - T_\infty}{T_i - T_\infty} \bigg|_{\text{Infinite cylinder}}$$

Hence, for the plane wall, with

$$Bi^{-1} = \frac{k}{hL} = \frac{17.4 \text{ W/m} \cdot \text{K}}{500 \text{ W/m}^2 \cdot \text{K} \times 0.03 \text{ m}} = 1.16$$

$$Fo = \frac{\alpha t}{L^2} = \frac{4.19 \times 10^{-6} \text{ m}^2/\text{s} \times 180 \text{ s}}{(0.03 \text{ m})^2} = 0.84$$

it follows from Equation 5.41 that

$$\theta_o^* = \frac{\theta_o}{\theta_i} = C_1 \exp(-\zeta_1^2 Fo)$$

where, with  $Bi = 0.862$ ,  $C_1 = 1.109$  and  $\zeta_1 = 0.814 \text{ rad}$  from Table 5.1. With  $Fo = 0.84$ ,

$$\frac{\theta_o}{\theta_i} = \frac{T(0, 3 \text{ min}) - T_\infty}{T_i - T_\infty} \bigg|_{\text{Plane wall}} = 1.109 \exp[-(0.814 \text{ rad})^2 \times 0.84] = 0.636$$

Similarly, for the infinite cylinder, with

$$Bi^{-1} = \frac{k}{hr_o} = \frac{17.4 \text{ W/m} \cdot \text{K}}{500 \text{ W/m}^2 \cdot \text{K} \times 0.04 \text{ m}} = 0.87$$

$$Fo = \frac{\alpha t}{r_o^2} = \frac{4.19 \times 10^{-6} \text{ m}^2/\text{s} \times 180 \text{ s}}{(0.04 \text{ m})^2} = 0.47$$

it follows from Equation 5.49c that

$$\theta_o^* = \frac{\theta_o}{\theta_i} = C_1 \exp(-\zeta_1^2 Fo)$$

where, with  $Bi = 1.15$ ,  $C_1 = 1.227$  and  $\zeta_1 = 1.307 \text{ rad}$  from Table 5.1. With  $Fo = 0.47$ ,

$$\frac{\theta_o}{\theta_i} \bigg|_{\text{Infinite cylinder}} = 1.109 \exp[-(1.307 \text{ rad})^2 \times 0.47] = 0.550$$

Hence, for the center of the cylinder,

$$\frac{T(0, 0, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} = 0.636 \times 0.550 = 0.350$$

$$T(0, 0, 3 \text{ min}) = 300 \text{ K} + 0.350(600 - 300) \text{ K} = 405 \text{ K}$$

◀

The temperature at the center of a circular face may be obtained from the requirement that

$$\frac{T(0, L, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} = \frac{T(L, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Plane wall}} \cdot \frac{T(0, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Infinite cylinder}}$$

where, from Equation 5.40b,

$$\frac{\theta^*}{\theta_o} = \frac{\theta}{\theta_o} = \cos(\zeta_1 x^*)$$

Hence, with  $x^* = 1$ , we have

$$\frac{\theta(L)}{\theta_o} = \frac{T(L, 3 \text{ min}) - T_{\infty}}{T(0, 3 \text{ min}) - T_{\infty}} \bigg|_{\text{Plane wall}} = \cos(0.814 \text{ rad} \times 1) = 0.687$$

Hence

$$\frac{T(L, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Plane wall}} = \frac{T(L, 3 \text{ min}) - T_{\infty}}{T(0, 3 \text{ min}) - T_{\infty}} \bigg|_{\text{Plane wall}} \cdot \frac{T(0, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Plane wall}}$$

$$\frac{T(L, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Plane wall}} = 0.687 \times 0.636 = 0.437$$

Hence

$$\frac{T(0, L, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} = 0.437 \times 0.550 = 0.240$$

$$T(0, L, 3 \text{ min}) = 300 \text{ K} + 0.24(600 - 300) \text{ K} = 372 \text{ K}$$

◀

The temperature at the midheight of the side may be obtained from the requirement that

$$\frac{T(r_o, 0, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} = \frac{T(0, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Plane wall}} \cdot \frac{T(r_o, 3 \text{ min}) - T_{\infty}}{T_i - T_{\infty}} \bigg|_{\text{Infinite cylinder}}$$

where, from Equation 5.49b,

$$\frac{\theta^*}{\theta_o} = \frac{\theta}{\theta_o} = J_0(\zeta_1 r^*)$$

With  $r^* = 1$  and the value of the Bessel function determined from Table B.4,

$$\frac{\theta(r_o)}{\theta_o} = \frac{T(r_o, 3 \text{ min}) - T_{\infty}}{T(0, 3 \text{ min}) - T_{\infty}} \bigg|_{\text{Infinite cylinder}} = J_0(1.307 \text{ rad} \times 1) = 0.616$$

Hence

$$\begin{aligned} \frac{T(r_o, 3 \text{ min}) - T_\infty}{T_i - T_\infty} \Big|_{\text{Infinite cylinder}} &= \frac{T(r_o, 3 \text{ min}) - T_\infty}{T(0, 3 \text{ min}) - T_\infty} \Big|_{\text{Infinite cylinder}} \\ &\quad \cdot \frac{T(0, 3 \text{ min}) - T_\infty}{T_i - T_\infty} \Big|_{\text{Infinite cylinder}} \\ \frac{T(r_o, 3 \text{ min}) - T_\infty}{T_i - T_\infty} \Big|_{\text{Infinite cylinder}} &= 0.616 \times 0.550 = 0.339 \end{aligned}$$

Hence

$$\begin{aligned} \frac{T(r_o, 0, 3 \text{ min}) - T_\infty}{T_i - T_\infty} &= 0.636 \times 0.339 = 0.216 \\ T(r_o, 0, 3 \text{ min}) &= 300 \text{ K} + 0.216(600 - 300) \text{ K} = 365 \text{ K} \end{aligned}$$

### Comments:

1. Verify that the temperature at the edge of the cylinder is  $T(r_o, L, 3 \text{ min}) = 344 \text{ K}$ .
2. The Heisler charts of Section 5S.1 could also be used to obtain the desired results. Accessing these charts, one would obtain  $\theta_o/\theta_i|_{\text{Plane wall}} \approx 0.64$ ,  $\theta_o/\theta_i|_{\text{Infinite cylinder}} \approx 0.55$ ,  $\theta(L)/\theta_o|_{\text{Plane wall}} \approx 0.68$ , and  $\theta(r_o)/\theta_o|_{\text{Infinite cylinder}} \approx 0.61$ , which are in good agreement with results obtained from the one-term approximations.
3. The *IHT Models, Transient Conduction* option for the *Plane Wall* and *Infinite Cylinder* may be used to calculate temperature ratios required for the foregoing product solution.

## Reference

1. Langston, L.S., *Int. J. Heat Mass Transfer*, **25**, 149–150, 1982.

## Problems

### One-Dimensional Conduction: The Plane Wall

- 5S.1** Consider the thermal energy storage unit of Problem 5.11, but with a masonry material of  $\rho = 1900 \text{ kg/m}^3$ ,  $c = 800 \text{ J/kg} \cdot \text{K}$ , and  $k = 0.70 \text{ W/m} \cdot \text{K}$  used in place of the aluminum. How long will it take to achieve 75% of the maximum possible energy storage? What are the maximum and minimum temperatures of the masonry at this time?
- 5S.2** An ice layer forms on a 5-mm-thick windshield of a car while parked during a cold night for which the ambient temperature is  $-20^\circ\text{C}$ . Upon start-up, using a new

defrost system, the interior surface is suddenly exposed to an airstream at  $30^\circ\text{C}$ . Assuming that the ice behaves as an insulating layer on the exterior surface, what interior convection coefficient would allow the exterior surface to reach  $0^\circ\text{C}$  in 60 s? The windshield thermophysical properties are  $\rho = 2200 \text{ kg/m}^3$ ,  $c_p = 830 \text{ J/kg} \cdot \text{K}$ , and  $k = 1.2 \text{ W/m} \cdot \text{K}$ .

### One-Dimensional Conduction: The Long Cylinder

- 5S.3** Cylindrical steel rods (AISI 1010), 50 mm in diameter, are heat treated by drawing them through an oven 5 m long in which air is maintained at  $750^\circ\text{C}$ . The

rods enter at  $50^\circ\text{C}$  and achieve a centerline temperature of  $600^\circ\text{C}$  before leaving. For a convection coefficient of  $125\text{ W/m}^2 \cdot \text{K}$ , estimate the speed at which the rods must be drawn through the oven.

- 5S.4** Estimate the time required to cook a hot dog in boiling water. Assume that the hot dog is initially at  $6^\circ\text{C}$ , that the convection heat transfer coefficient is  $100\text{ W/m}^2 \cdot \text{K}$ , and that the final temperature is  $80^\circ\text{C}$  at the centerline. Treat the hot dog as a long cylinder of 20-mm diameter having the properties:  $\rho = 880\text{ kg/m}^3$ ,  $c = 3350\text{ J/kg} \cdot \text{K}$ , and  $k = 0.52\text{ W/m} \cdot \text{K}$ .
- 5S.5** A long bar of 70-mm diameter and initially at  $90^\circ\text{C}$  is cooled by immersing it in a water bath that is at  $40^\circ\text{C}$  and provides a convection coefficient of  $20\text{ W/m}^2 \cdot \text{K}$ . The thermophysical properties of the bar are  $\rho = 2600\text{ kg/m}^3$ ,  $c = 1030\text{ J/kg} \cdot \text{K}$ , and  $k = 3.50\text{ W/m} \cdot \text{K}$ .
- How long should the bar remain in the bath in order that, when it is removed and allowed to equilibrate while isolated from any surroundings, it achieves a uniform temperature of  $55^\circ\text{C}$ ?
  - What is the surface temperature of the bar when it is removed from the bath?


### One-Dimensional Conduction: The Sphere

- 5S.6** A sphere of 80-mm diameter ( $k = 50\text{ W/m} \cdot \text{K}$  and  $\alpha = 1.5 \times 10^{-6}\text{ m}^2/\text{s}$ ) is initially at a uniform, elevated temperature and is quenched in an oil bath maintained at  $50^\circ\text{C}$ . The convection coefficient for the cooling process is  $1000\text{ W/m}^2 \cdot \text{K}$ . At a certain time, the surface temperature of the sphere is measured to be  $150^\circ\text{C}$ . What is the corresponding center temperature of the sphere?
- 5S.7** A spherical hailstone that is 5 mm in diameter is formed in a high-altitude cloud at  $-30^\circ\text{C}$ . If the stone begins to fall through warmer air at  $5^\circ\text{C}$ , how long will it take before the outer surface begins to melt? What is the temperature of the stone's center at this point in time, and how much energy (J) has been transferred to the stone? A convection heat transfer coefficient of  $250\text{ W/m}^2 \cdot \text{K}$  may be assumed, and the properties of the hailstone may be taken to be those of ice.
- 5S.8** In a process to manufacture glass beads ( $k = 1.4\text{ W/m} \cdot \text{K}$ ,  $\rho = 2200\text{ kg/m}^3$ ,  $c_p = 800\text{ J/kg} \cdot \text{K}$ ) of 3-mm diameter, the beads are suspended in an upwardly directed airstream that is at  $T_\infty = 15^\circ\text{C}$  and maintains a convection coefficient of  $h = 400\text{ W/m}^2 \cdot \text{K}$ .
- If the beads are at an initial temperature of  $T_i = 477^\circ\text{C}$ , how long must they be suspended to achieve a center temperature of  $80^\circ\text{C}$ ? What is the corresponding surface temperature?

- Compute and plot the center and surface temperatures as a function of time for  $0 \leq t \leq 20\text{ s}$  and  $h = 100, 400$ , and  $1000\text{ W/m}^2 \cdot \text{K}$ .

### Multidimensional Conduction

- 5S.9** A long steel (plain carbon) billet of square cross section 0.3 m by 0.3 m, initially at a uniform temperature of  $30^\circ\text{C}$ , is placed in a soaking oven having a temperature of  $750^\circ\text{C}$ . If the convection heat transfer coefficient for the heating process is  $100\text{ W/m}^2 \cdot \text{K}$ , how long must the billet remain in the oven before its center temperature reaches  $600^\circ\text{C}$ ?
- 5S.10** Fireclay brick of dimensions  $0.06\text{ m} \times 0.09\text{ m} \times 0.20\text{ m}$  is removed from a kiln at  $1600\text{ K}$  and cooled in air at  $40^\circ\text{C}$  with  $h = 50\text{ W/m}^2 \cdot \text{K}$ . What is the temperature at the center and at the corners of the brick after 50 min of cooling?
- 5S.11** A cylindrical copper pin 100 mm long and 50 mm in diameter is initially at a uniform temperature of  $20^\circ\text{C}$ . The end faces are suddenly subjected to an intense heating rate that raises them to a temperature of  $500^\circ\text{C}$ . At the same time, the cylindrical surface is subjected to heating by gas flow with a temperature of  $500^\circ\text{C}$  and a heat transfer coefficient of  $100\text{ W/m}^2 \cdot \text{K}$ .

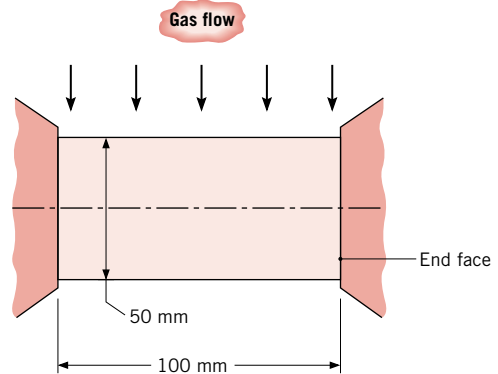

- Determine the temperature at the center point of the cylinder 8 s after sudden application of the heat.
  - Considering the parameters governing the temperature distribution in transient heat diffusion problems, can any simplifying assumptions be justified in analyzing this particular problem? Explain briefly.
- 5S.12** Recalling that your mother once said that meat should be cooked until every portion has attained a temperature of  $80^\circ\text{C}$ , how long will it take to cook a 2.25-kg roast? Assume that the meat is initially at  $6^\circ\text{C}$  and that the oven temperature is  $175^\circ\text{C}$  with a convection heat transfer coefficient of  $15\text{ W/m}^2 \cdot \text{K}$ . Treat the roast as a cylinder with properties of liquid water, having a diameter equal to its length.

**5S.13** A long rod 20 mm in diameter is fabricated from alumina (polycrystalline aluminum oxide) and is initially at a uniform temperature of 850 K. The rod is suddenly exposed to fluid at 350 K with  $h = 500 \text{ W/m}^2 \cdot \text{K}$ . Estimate the centerline temperature of the rod after 30 s at an exposed end and at an axial distance of 6 mm from the end.

**5S.14** Consider the stainless steel cylinder of Example 5S.1, which is initially at 600 K and suddenly quenched in an oil bath at 300 K with  $h = 500 \text{ W/m}^2 \cdot \text{K}$ . Use the *Transient Conduction, Plane Wall and Cylinder* models of *IHT* to obtain the following solutions.

- (a) Calculate the temperatures,  $T(r, x, t)$ , after 3 min at the cylinder center,  $T(0, 0, 3 \text{ min})$ , at the center

of a circular face,  $T(0, L, 3 \text{ min})$ , and at the midheight of the side,  $T(r_o, 0, 3 \text{ min})$ . Compare your results with those in the example.

- (b) Use the *Explore* and *Graph* options of *IHT* to calculate and plot temperature histories at the cylinder center,  $T(0, 0, t)$ , and the midheight of the side,  $T(r_o, 0, t)$ , for  $0 \leq t \leq 10 \text{ min}$ . Comment on the gradients occurring at these locations and what effect they might have on phase transformations and thermal stresses. *Hint*: In your sweep over the time variable, start at 1 s rather than zero.
- (c) For  $0 \leq t \leq 10 \text{ min}$ , calculate and plot temperature histories at the cylinder center,  $T(0, 0, t)$ , for convection coefficients of  $500 \text{ W/m}^2 \cdot \text{K}$  and  $1000 \text{ W/m}^2 \cdot \text{K}$ .

# *CHAPTER* **6**

## **Introduction to Convection**





**T**hus far we have focused on heat transfer by conduction and have considered convection only to the extent that it provides a possible boundary condition for conduction problems. In Section 1.2.2 we used the term *convection* to describe energy transfer between a surface and a fluid moving over the surface. Convection includes energy transfer by both the bulk fluid motion (advection) and the random motion of fluid molecules (conduction or diffusion).

In our treatment of convection, we have two major objectives. In addition to obtaining an understanding of the physical mechanisms that underlie convection transfer, we wish to develop the means to perform convection transfer calculations. This chapter and the supplementary material of Appendix D are devoted primarily to achieving the former objective. Physical origins are discussed, and relevant dimensionless parameters, as well as important analogies, are developed.

A unique feature of this chapter is the manner in which convection mass transfer effects are introduced by analogy to those of convection heat transfer. In mass transfer by convection, gross fluid motion combines with diffusion to promote the transfer of a species for which there exists a concentration gradient. In this text, we focus on convection mass transfer that occurs at the surface of a volatile solid or liquid due to motion of a gas over the surface.

With conceptual foundations established, subsequent chapters are used to develop useful tools for quantifying convection effects. Chapters 7 and 8 present methods for computing the coefficients associated with forced convection in external and internal flow configurations, respectively. Chapter 9 describes methods for determining these coefficients in free convection, and Chapter 10 considers the problem of convection with phase change (boiling and condensation). Chapter 11 develops methods for designing and evaluating the performance of heat exchangers, devices that are widely used in engineering practice to effect heat transfer between fluids.

Accordingly, we begin by developing our understanding of the nature of convection.

## 6.1


### *The Convection Boundary Layers*

---

The concept of boundary layers is central to the understanding of convection heat and mass transfer between a surface and a fluid flowing past it. In this section, velocity, thermal, and concentration boundary layers are described, and their relationships to the friction coefficient, convection heat transfer coefficient, and convection mass transfer coefficient are introduced.

#### 6.1.1 The Velocity Boundary Layer

To introduce the concept of a boundary layer, consider flow over the flat plate of Figure 6.1. When fluid particles make contact with the surface, they assume zero velocity. These particles then act to retard the motion of particles in the adjoining fluid layer, which act to retard the motion of particles in the next layer, and so on until, at a distance  $y = \delta$  from the surface, the effect becomes negligible. This retardation of fluid motion is

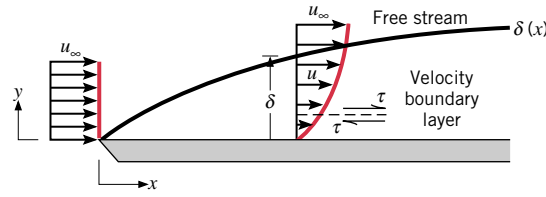

**FIGURE 6.1**  
Velocity boundary layer development on a flat plate.

associated with *shear stresses*  $\tau$  acting in planes that are parallel to the fluid velocity (Figure 6.1). With increasing distance  $y$  from the surface, the  $x$  velocity component of the fluid,  $u$ , must then increase until it approaches the free stream value  $u_\infty$ . The subscript  $\infty$  is used to designate conditions in the *free stream* outside the boundary layer.

The quantity  $\delta$  is termed the *boundary layer thickness*, and it is typically defined as the value of  $y$  for which  $u = 0.99u_\infty$ . The *boundary layer velocity profile* refers to the manner in which  $u$  varies with  $y$  through the boundary layer. Accordingly, the fluid flow is characterized by two distinct regions, a thin fluid layer (the boundary layer) in which velocity gradients and shear stresses are large and a region outside the boundary layer in which velocity gradients and shear stresses are negligible. With increasing distance from the leading edge, the effects of viscosity penetrate further into the free stream and the boundary layer grows ( $\delta$  increases with  $x$ ).

Because it pertains to the fluid velocity, the foregoing boundary layer may be referred to more specifically as the *velocity boundary layer*. It develops whenever there is fluid flow over a surface, and it is of fundamental importance to problems involving convection transport. In fluid mechanics its significance to the engineer stems from its relation to the surface shear stress  $\tau_s$ , and hence to surface frictional effects. For external flows it provides the basis for determining the local *friction coefficient*

$$C_f \equiv \frac{\tau_s}{\rho u_\infty^2 / 2} \quad (6.1)$$


a key dimensionless parameter from which the surface frictional drag may be determined. Assuming a *Newtonian fluid*, the surface shear stress may be evaluated from knowledge of the velocity gradient at the surface

$$\tau_s = \mu \left. \frac{\partial u}{\partial y} \right|_{y=0} \quad (6.2)$$

where  $\mu$  is a fluid property known as the *dynamic viscosity*. In a velocity boundary layer, the velocity gradient at the surface depends on the distance  $x$  from the leading edge of the plate. Therefore, the surface shear stress and friction coefficient also depend on  $x$ .

### 6.1.2 The Thermal Boundary Layer

Just as a velocity boundary layer develops when there is fluid flow over a surface, a *thermal boundary layer* must develop if the fluid free stream and surface temperatures differ. Consider flow over an isothermal flat plate (Figure 6.2). At the leading edge the *temperature profile* is uniform, with  $T(y) = T_\infty$ . However, fluid particles that come into contact with the plate achieve thermal equilibrium at the plate's surface

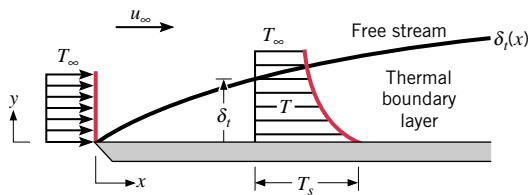

**FIGURE 6.2**

Thermal boundary layer development on an isothermal flat plate.

temperature. In turn, these particles exchange energy with those in the adjoining fluid layer, and temperature gradients develop in the fluid. The region of the fluid in which these temperature gradients exist is the thermal boundary layer, and its thickness  $\delta_t$  is typically defined as the value of  $y$  for which the ratio  $[(T_s - T)/(T_s - T_\infty)] = 0.99$ . With increasing distance from the leading edge, the effects of heat transfer penetrate further into the free stream and the thermal boundary layer grows.

The relation between conditions in this boundary layer and the convection heat transfer coefficient may readily be demonstrated. At any distance  $x$  from the leading edge, the *local* surface heat flux may be obtained by applying Fourier's law to the *fluid* at  $y = 0$ . That is,

$$q_s'' = -k_f \left. \frac{\partial T}{\partial y} \right|_{y=0} \quad (6.3)$$

The subscript  $s$  has been used to emphasize that this is the surface heat flux, but it will be dropped in later sections. This expression is appropriate because, *at the surface, there is no fluid motion and energy transfer occurs only by conduction*. Recalling Newton's law of cooling, we see that

$$q_s'' = h(T_s - T_\infty) \quad (6.4)$$


and combining this with Equation 6.3, we obtain

$$h = \frac{-k_f \partial T / \partial y|_{y=0}}{T_s - T_\infty} \quad (6.5)$$

Hence, conditions in the thermal boundary layer, which strongly influence the wall temperature gradient  $\partial T / \partial y|_{y=0}$ , determine the rate of heat transfer across the boundary layer. Since  $(T_s - T_\infty)$  is a constant, independent of  $x$ , while  $\delta_t$  increases with increasing  $x$ , temperature gradients in the boundary layer must decrease with increasing  $x$ . Accordingly, the magnitude of  $\partial T / \partial y|_{y=0}$  decreases with increasing  $x$ , and it follows that  $q_s''$  and  $h$  decrease with increasing  $x$ .

### 6.1.3 The Concentration Boundary Layer

When air moves past the surface of a pool of water, the liquid water will evaporate, and water vapor will be transferred into the air stream. This is an example of convection mass transfer. More generally, consider a *binary mixture* of chemical species A and B that flows over a surface (Figure 6.3). The molar concentration ( $\text{kmol}/\text{m}^3$ ) of species A at the surface is  $C_{A,s}$ , and in the free stream it is  $C_{A,\infty}$ . If  $C_{A,s}$  differs from  $C_{A,\infty}$ , transfer of species A by convection will occur. For example, species A could

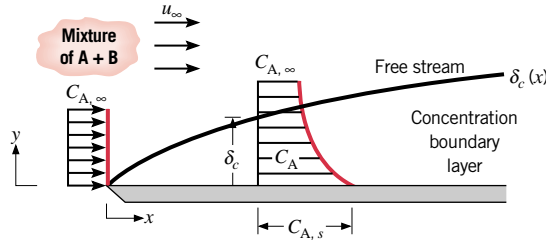

**FIGURE 6.3**  
Species concentration boundary layer development on a flat plate.

be a vapor that is transferred into a gas stream (species B) due to *evaporation* at a liquid surface (as in the water example) or due to *sublimation* at a solid surface. In this situation, a *concentration boundary layer* will develop that is similar to the velocity and thermal boundary layers. The concentration boundary layer is the region of the fluid in which concentration gradients exist, and its thickness  $\delta_c$  is typically defined as the value of  $y$  for which  $[(C_{A,s} - C_A)/(C_{A,s} - C_{A,\infty})] = 0.99$ . With increasing distance from the leading edge, the effects of species transfer penetrate further into the free stream and the concentration boundary layer grows.

Species transfer by convection between the surface and the free stream fluid is determined by conditions in the boundary layer, and we are interested in determining the rate at which this transfer occurs. In particular, we are interested in the molar flux of species A,  $N''_A$  (kmol/s · m<sup>2</sup>). It is helpful to recognize that the molar flux associated with species transfer *by diffusion* is determined by an expression that is analogous to Fourier's law. For the conditions of interest in this chapter, the expression, which is termed *Fick's law*, has the form

$$N''_A = -D_{AB} \frac{\partial C_A}{\partial y} \quad (6.6)^1$$

where  $D_{AB}$  is a property of the binary mixture known as the *binary diffusion coefficient*. At any point corresponding to  $y > 0$  in the concentration boundary layer of Figure 6.3, species transfer is due to both bulk fluid motion (*advection*) and diffusion. However, at  $y = 0$  there is no fluid motion (neglecting the often small velocity normal to the surface caused by the species transfer process itself, as is discussed in Chapter 14), and thus species transfer is by diffusion only. Applying Fick's law at  $y = 0$ , we see that the molar flux at the surface at any distance from the leading edge is then

$$N''_{A,s} = -D_{AB} \frac{\partial C_A}{\partial y} \bigg|_{y=0} \quad (6.7)$$

The subscript  $s$  has been used to emphasize that this is the molar flux at the surface, but it will be dropped in later sections. Analogous to Newton's law of cooling, an equation can be written that relates the molar flux to the concentration difference across the boundary layer, as

$$N''_{A,s} = h_m(C_{A,s} - C_{A,\infty}) \quad (6.8)$$

<sup>1</sup>This expression is an approximation of a more general form of Fick's law of diffusion (Section 14.1.3) when the total molar concentration of the mixture,  $C = C_A + C_B$ , is a constant.

where  $h_m$  (m/s) is the *convection mass transfer coefficient*, analogous to the convection heat transfer coefficient. Combining Equations 6.7 and 6.8, it follows that

$$h_m = \frac{-D_{AB} \partial C_A / \partial y|_{y=0}}{C_{A,s} - C_{A,\infty}} \quad (6.9)$$

Therefore, conditions in the concentration boundary layer, which strongly influence the surface concentration gradient  $\partial C_A / \partial y|_{y=0}$ , also influence the convection mass transfer coefficient and hence the rate of species transfer in the boundary layer.

### 6.1.4 Significance of the Boundary Layers

For flow over any surface, there will always exist a velocity boundary layer and hence surface friction. Likewise, a thermal boundary layer, and hence convection heat transfer, will always exist if the surface and free stream temperatures differ. Similarly, a concentration boundary layer and convection mass transfer will exist if the surface concentration of a species differs from its free stream concentration. The velocity boundary layer is of extent  $\delta(x)$  and is characterized by the presence of velocity gradients and shear stresses. The thermal boundary layer is of extent  $\delta_t(x)$  and is characterized by temperature gradients and heat transfer. Finally, the concentration boundary layer is of extent  $\delta_c(x)$  and is characterized by concentration gradients and species transfer. Situations can arise in which all three boundary layers are present. In such cases, the boundary layers rarely grow at the same rate, and the values of  $\delta$ ,  $\delta_t$ , and  $\delta_c$  at a given location are not the same.

For the engineer, the principal manifestations of the three boundary layers are, respectively, *surface friction*, *convection heat transfer*, and *convection mass transfer*. The key boundary layer parameters are then the *friction coefficient*  $C_f$  and the *heat and mass transfer convection coefficients*  $h$  and  $h_m$ , respectively. We now turn our attention to examining these key parameters, which are central to the analysis of convection heat and mass transfer problems.


## 6.2

### Local and Average Convection Coefficients

#### 6.2.1 Heat Transfer

Consider the conditions of Figure 6.4a. A fluid of velocity  $V$  and temperature  $T_\infty$  flows over a surface of arbitrary shape and of area  $A_s$ . The surface is presumed to be at a uniform temperature,  $T_s$ , and if  $T_s \neq T_\infty$ , we know that convection heat transfer will occur. From Section 6.1.2, we also know that the surface heat flux and convection heat transfer coefficient both vary along the surface. The *total heat transfer rate*  $q$  may be obtained by integrating the local flux over the entire surface. That is,

$$q = \int_{A_s} q'' dA_s \quad (6.10)$$

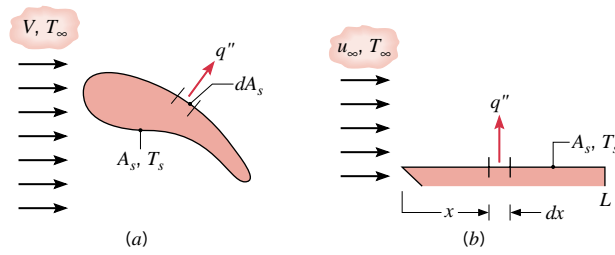

**FIGURE 6.4** Local and total convection heat transfer. (a) Surface of arbitrary shape. (b) Flat plate.

or, from Equation 6.4,

$$q = (T_s - T_\infty) \int_{A_s} h dA_s \quad (6.11)$$

Defining an *average convection coefficient*  $\bar{h}$  for the entire surface, the total heat transfer rate may also be expressed as

$$q = \bar{h} A_s (T_s - T_\infty) \quad (6.12)$$

Equating Equations 6.11 and 6.12, it follows that the average and local convection coefficients are related by an expression of the form

$$\bar{h} = \frac{1}{A_s} \int_{A_s} h dA_s \quad (6.13)$$

Note that for the special case of flow over a flat plate (Figure 6.4b),  $h$  varies only with the distance  $x$  from the leading edge and Equation 6.13 reduces to

$$\bar{h} = \frac{1}{L} \int_0^L h dx \quad (6.14)$$


### 6.2.2 Mass Transfer

Similar results may be obtained for convection mass transfer. If a fluid of species molar concentration  $C_{A,\infty}$  flows over a surface at which the species concentration is maintained at some uniform value  $C_{A,s} \neq C_{A,\infty}$  (Figure 6.5a), transfer of the species by convection will occur. From Section 6.1.3, we know that the surface molar flux and convection mass transfer coefficient both vary along the surface. The total molar transfer rate for an entire surface,  $N_A$  (kmol/s), may then be expressed as

$$N_A = \bar{h}_m A_s (C_{A,s} - C_{A,\infty}) \quad (6.15)$$

where the average and local mass transfer convection coefficients are related by an equation of the form

$$\bar{h}_m = \frac{1}{A_s} \int_{A_s} h_m dA_s \quad (6.16)$$

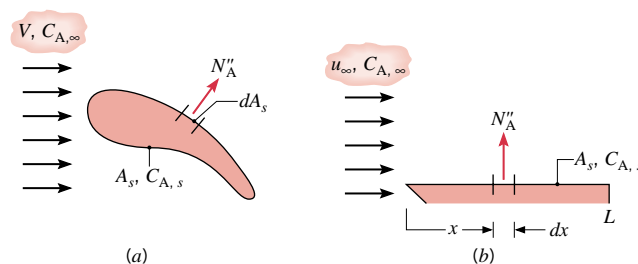

**FIGURE 6.5** Local and total convection species transfer. (a) Surface of arbitrary shape. (b) Flat plate.

For the flat plate of Figure 6.5b, it follows that

$$\bar{h}_m = \frac{1}{L} \int_0^L h_m dx \quad (6.17)$$

Species transfer may also be expressed as a mass flux,  $n''_A$  (kg/s · m<sup>2</sup>), or as a mass transfer rate,  $n_A$  (kg/s), by multiplying both sides of Equations 6.8 and 6.15, respectively, by the molecular weight  $\mathcal{M}_A$  (kg/kmol) of species A. Accordingly,

$$n''_A = h_m(\rho_{A,s} - \rho_{A,\infty}) \quad (6.18)$$

and

$$n_A = \bar{h}_m A_s(\rho_{A,s} - \rho_{A,\infty}) \quad (6.19)$$

where  $\rho_A$  (kg/m<sup>3</sup>) is the mass density of species A.<sup>2</sup> We can also write Fick's law on a mass basis by multiplying Equation 6.7 by  $\mathcal{M}_A$  to yield

$$n''_{A,s} = -D_{AB} \left. \frac{\partial \rho_A}{\partial y} \right|_{y=0} \quad (6.20)$$

Furthermore, multiplying the numerator and denominator of Equation 6.9 by  $\mathcal{M}_A$  yields an alternative expression for  $h_m$ :

$$h_m = \frac{-D_{AB} \partial \rho_A / \partial y|_{y=0}}{\rho_{A,s} - \rho_{A,\infty}} \quad (6.21)$$

To perform a convection mass transfer calculation, it is necessary to determine the value of  $C_{A,s}$  or  $\rho_{A,s}$ . Such a determination may be made by assuming thermodynamic equilibrium at the interface between the gas and the liquid or solid phase. One implication of equilibrium is that the temperature of the vapor at the interface is equal to the surface temperature  $T_s$ . A second implication is that the vapor is in a *saturated state*, in which case thermodynamic tables, such as Table A.6 for water, may be used to obtain its density from knowledge of  $T_s$ . To a good approximation, the molar concentration of the vapor at the surface may also be determined from the vapor pressure through application of the equation of state for an ideal gas. That is,

<sup>2</sup>Although the foregoing nomenclature is well suited for characterizing mass transfer processes of interest in this text, there is by no means a standard nomenclature, and it is often difficult to reconcile the results from different publications. A review of the different ways in which driving potentials, fluxes, and convection coefficients may be formulated is provided by Webb [1].

$$C_{A,s} = \frac{p_{\text{sat}}(T_s)}{\mathcal{R}T_s} \quad (6.22)$$

where  $\mathcal{R}$  is the universal gas constant and  $p_{\text{sat}}(T_s)$  is the vapor pressure corresponding to saturation at  $T_s$ . Note that the vapor mass density and molar concentration are related by  $\rho_A = \mathcal{M}_A C_A$ .

### 6.2.3 The Problem of Convection

The local flux and/or the total transfer rate are of paramount importance in any convection problem. These quantities may be determined from the rate equations, Equations 6.4, 6.8, 6.12, and 6.15, which depend on knowledge of the local ( $h$  or  $h_m$ ) and average ( $\bar{h}$  or  $\bar{h}_m$ ) convection coefficients. It is for this reason that determination of these coefficients is viewed as *the problem of convection*. However, the problem is not a simple one, for in addition to depending on numerous *fluid properties* such as density, viscosity, thermal conductivity, and specific heat, the coefficients depend on the *surface geometry* and the *flow conditions*. This multiplicity of independent variables is attributable to the dependence of convection transfer on the boundary layers that develop on the surface.

#### EXAMPLE 6.1

Experimental results for the local heat transfer coefficient  $h_x$  for flow over a flat plate with an extremely rough surface were found to fit the relation

$$h_x(x) = ax^{-0.1}$$

where  $a$  is a coefficient ( $\text{W/m}^{1.9} \cdot \text{K}$ ) and  $x$  (m) is the distance from the leading edge of the plate.

1. Develop an expression for the ratio of the average heat transfer coefficient  $\bar{h}_x$  for a plate of length  $x$  to the local heat transfer coefficient  $h_x$  at  $x$ .
2. Show, in a qualitative manner, the variation of  $h_x$  and  $\bar{h}_x$  as a function of  $x$ .


#### SOLUTION

**Known:** Variation of the local heat transfer coefficient,  $h_x(x)$ .

**Find:**

1. The ratio of the average heat transfer coefficient  $\bar{h}(x)$  to the local value  $h_x(x)$ .
2. Sketch of the variation of  $h_x$  and  $\bar{h}_x$  with  $x$ .

**Schematic:**

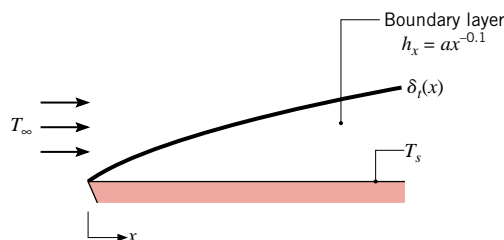



**Analysis:**

- From Equation 6.14 the average value of the convection heat transfer coefficient over the region from 0 to  $x$  is

$$\bar{h}_x = \bar{h}_x(x) = \frac{1}{x} \int_0^x h_x(x) dx$$

Substituting the expression for the local heat transfer coefficient

$$h_x(x) = ax^{-0.1}$$

and integrating, we obtain


$$\bar{h}_x = \frac{1}{x} \int_0^x ax^{-0.1} dx = \frac{a}{x} \int_0^x x^{-0.1} dx = \frac{a}{x} \left( \frac{x^{+0.9}}{0.9} \right) = 1.11ax^{-0.1}$$

or

$$\bar{h}_x = 1.11h_x$$



- The variation of  $h_x$  and  $\bar{h}_x$  with  $x$  is as follows:

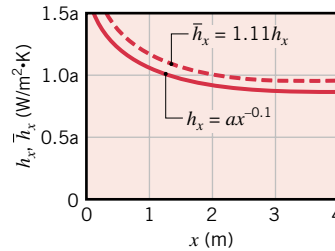

**Comments:** Boundary layer development causes both the local and average coefficients to decrease with increasing distance from the leading edge. The average coefficient up to  $x$  must therefore exceed the local value at  $x$ .

**EXAMPLE 6.2**


A long circular cylinder 20 mm in diameter is fabricated from solid naphthalene, a common moth repellent, and is exposed to an airstream that provides for an average convection mass transfer coefficient of  $\bar{h}_m = 0.05$  m/s. The molar concentration of naphthalene vapor at the cylinder surface is  $5 \times 10^{-6}$  kmol/m<sup>3</sup>, and its molecular weight is 128 kg/kmol. What is the mass sublimation rate per unit length of cylinder?

**SOLUTION**

**Known:** Saturated vapor concentration of naphthalene.

**Find:** Sublimation rate per unit length,  $n'_A$  (kg/s · m).

**Schematic:**

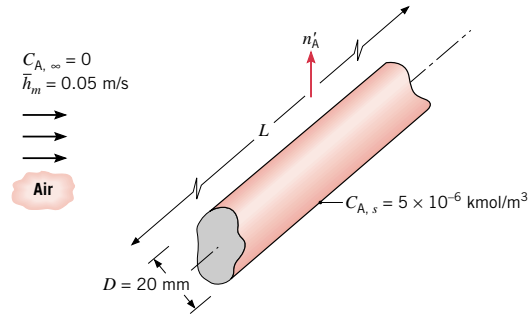

**Assumptions:**

1. Steady-state conditions.
2. Negligible concentration of naphthalene in free stream of air.

**Analysis:** Naphthalene is transported to the air by convection, and from Equation 6.15, the molar transfer rate for the cylinder is

$$N_A = \bar{h}_m \pi D L (C_{A,s} - C_{A,\infty})$$

With  $C_{A,\infty} = 0$  and  $N'_A = N_A/L$ , it follows that

$$N'_A = (\pi D) \bar{h}_m C_{A,s} = \pi \times 0.02 \text{ m} \times 0.05 \text{ m/s} \times 5 \times 10^{-6} \text{ kmol/m}^3$$

$$N'_A = 1.57 \times 10^{-8} \text{ kmol/s} \cdot \text{m}$$


The mass sublimation rate is then

$$n'_A = \mathcal{M}_A N'_A = 128 \text{ kg/kmol} \times 1.57 \times 10^{-8} \text{ kmol/s} \cdot \text{m}$$

$$n'_A = 2.01 \times 10^{-6} \text{ kg/s} \cdot \text{m}$$

**EXAMPLE 6.3**

At some location on the surface of a pan of water, measurements of the partial pressure of water vapor  $p_A$  (atm) are made as a function of the distance  $y$  from the surface, and the results are as follows:

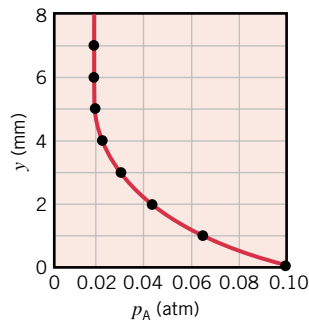


Determine the convection mass transfer coefficient  $h_{m,x}$  at this location.

### SOLUTION

**Known:** Partial pressure  $p_A$  of water vapor as a function of distance  $y$  at a particular location on the surface of a water layer.

**Find:** Convection mass transfer coefficient at the prescribed location.

**Schematic:**

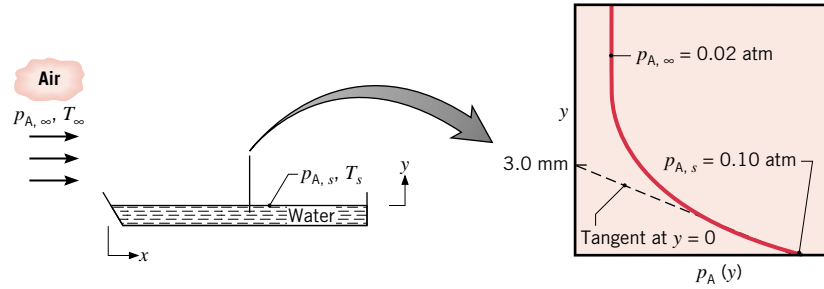

**Assumptions:**

1. Water vapor may be approximated as an ideal gas.
2. Conditions are isothermal.

**Properties:** Table A.6, saturated vapor (0.1 atm = 0.101 bar):  $T_s = 319$  K. Table A.8, water vapor–air (319 K):  $D_{AB}(319 \text{ K}) = D_{AB}(298 \text{ K}) \times (319 \text{ K}/298 \text{ K})^{3/2} = 0.288 \times 10^{-4} \text{ m}^2/\text{s}$ .

**Analysis:** From Equation 6.21 the local convection mass transfer coefficient is

$$h_{m,x} = \frac{-D_{AB} \partial \rho_A / \partial y|_{y=0}}{\rho_{A,s} - \rho_{A,\infty}}$$

or, approximating the vapor as an ideal gas

$$p_A = \rho_A RT$$

with constant  $T$  (isothermal conditions),

$$h_{m,x} = \frac{-D_{AB} \partial p_A / \partial y|_{y=0}}{p_{A,s} - p_{A,\infty}}$$

From the measured vapor pressure distribution

$$\left. \frac{\partial p_A}{\partial y} \right|_{y=0} = \frac{(0 - 0.1) \text{ atm}}{(0.003 - 0) \text{ m}} = -33.3 \text{ atm/m}$$

Hence

$$h_{m,x} = \frac{-0.288 \times 10^{-4} \text{ m}^2/\text{s} (-33.3 \text{ atm/m})}{(0.1 - 0.02) \text{ atm}} = 0.0120 \text{ m/s}$$

**Comments:** From thermodynamic equilibrium at the liquid–vapor interface, the interfacial temperature was determined from Table A.6.

## 6.3

### Laminar and Turbulent Flow

In the discussion of convection so far, we have not addressed the significance of the *flow conditions*. An essential first step in the treatment of any convection problem is to determine whether the boundary layer is *laminar* or *turbulent*. Surface friction and the convection transfer rates depend strongly on which of these conditions exists.

#### 6.3.1 Laminar and Turbulent Velocity Boundary Layers

Boundary layer *development* on a flat plate is illustrated in Figure 6.6. In many cases, laminar and turbulent flow conditions both occur, with the laminar section preceding the turbulent section. For either condition, the fluid motion is characterized by velocity components in the  $x$ - and  $y$ -directions. Fluid motion away from the surface is necessitated by the slowing of the fluid near the wall as the boundary layer grows in the  $x$ -direction. Figure 6.6 shows that there are sharp differences between laminar and turbulent flow conditions, as described in the following paragraphs.

In the laminar boundary layer, the fluid flow is highly ordered and it is possible to identify streamlines along which fluid particles move. From Section 6.1.1 we know that the boundary layer thickness grows and that velocity gradients at  $y = 0$  decrease in the streamwise (increasing  $x$ ) direction. From Equation 6.2, we see that the local surface shear stress  $\tau_s$  also decreases with increasing  $x$ . The highly ordered behavior continues until a *transition* zone is reached, across which a conversion from laminar to turbulent conditions occurs. Conditions within the transition zone change with time, with the flow sometimes exhibiting laminar behavior and sometimes exhibiting the characteristics of turbulent flow.

Flow in the fully turbulent boundary layer is, in general, highly irregular and is characterized by random, three-dimensional motion of relatively large parcels of fluid. Mixing within the boundary layer carries high-speed fluid toward the solid surface and transfers slower-moving fluid farther into the free stream. Much of the

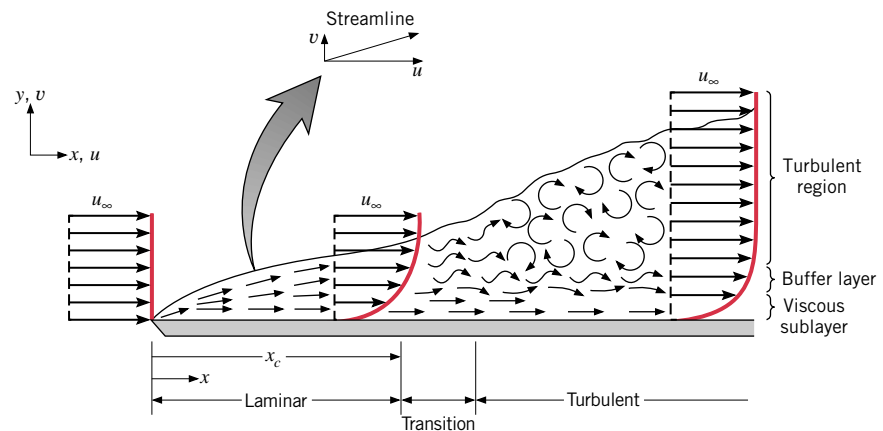


FIGURE 6.6 Velocity boundary layer development on a flat plate.


mixing is promoted by streamwise vortices called *streaks* that are generated intermittently near the flat plate, where they rapidly grow and decay. Recent analytical and experimental studies have suggested that these and other *coherent structures* within the turbulent flow can travel in *waves* at velocities that can exceed  $u_\infty$ , interact nonlinearly, and spawn the chaotic conditions that characterize turbulent flow [2].

As a result of the interactions that lead to chaotic flow conditions, velocity and pressure fluctuations occur at any point within the turbulent boundary layer. Three different regions may be delineated within the turbulent boundary layer as a function of distance from the surface. We may speak of a *viscous sublayer* in which transport is dominated by diffusion and the velocity profile is nearly linear. There is an adjoining *buffer layer* in which diffusion and turbulent mixing are comparable, and there is a *turbulent zone* in which transport is dominated by turbulent mixing. A comparison of the laminar and turbulent boundary layer profiles for the  $x$ -component of the velocity, provided in Figure 6.7, shows that the turbulent velocity profile is relatively flat due to the mixing that occurs within the buffer layer and turbulent region, giving rise to large velocity gradients within the viscous sublayer. Hence,  $\tau_s$  is generally larger in the turbulent portion of the boundary layer of Figure 6.6 than in the laminar portion.

The transition from laminar to turbulent flow is ultimately due to *triggering mechanisms*, such as the interaction of unsteady flow structures that develop naturally within the fluid or small disturbances that exist within many typical boundary layers. These disturbances may originate from fluctuations in the free stream, or they may be induced by surface roughness or minute surface vibrations. The onset of turbulence depends on whether the triggering mechanisms are amplified or attenuated in the direction of fluid flow, which in turn depends on a dimensionless grouping of parameters called the *Reynolds number*,

$$Re_x = \frac{\rho u_\infty x}{\mu} \quad (6.23)$$

where, for a flat plate, the characteristic length is  $x$ , the distance from the leading edge. It will be shown later that the Reynolds number represents the ratio of the inertia to viscous forces. If the Reynolds number is small, inertia forces are insignificant relative to viscous forces. The disturbances are then dissipated, and the flow remains laminar. For a large Reynolds number, however, the inertia forces can be sufficient to amplify the triggering mechanisms, and a transition to turbulence occurs.

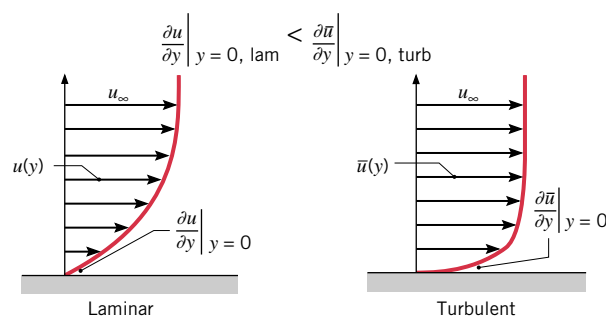

**FIGURE 6.7** Comparison of laminar and turbulent velocity boundary layer profiles for the same free stream velocity.<sup>3</sup>

<sup>3</sup>Since velocity fluctuates with time in turbulent flow, the time-averaged velocity,  $\bar{u}$ , is plotted in Figure 6.7.

In calculating boundary layer behavior, it is frequently reasonable to assume that transition begins at some location  $x_c$ , as shown in Figure 6.6. This location is determined by the *critical* Reynolds number,  $Re_{x,c}$ . For flow over a flat plate,  $Re_{x,c}$  is known to vary from approximately  $10^5$  to  $3 \times 10^6$ , depending on surface roughness and the turbulence level of the free stream. A representative value of


$$Re_{x,c} \equiv \frac{\rho u_\infty x_c}{\mu} = 5 \times 10^5 \quad (6.24)$$

is often assumed for boundary layer calculations and, unless otherwise noted, is used for the calculations of this text that involve a flat plate.

### 6.3.2 Laminar and Turbulent Thermal and Species Concentration Boundary Layers

Since the velocity distribution determines the advective component of thermal energy or chemical species transfer within the boundary layer, the nature of the flow also has a profound effect on convective heat and mass transfer rates. Similar to the laminar velocity boundary layer, the thermal and species boundary layers grow in the streamwise (increasing  $x$ ) direction, temperature and species concentration gradients in the fluid at  $y = 0$  decrease in the streamwise direction, and, from Equations 6.5 and 6.9, the heat and mass transfer coefficients also decrease with increasing  $x$ .

Just as it induces large velocity gradients at  $y = 0$ , turbulent mixing promotes large temperature and species concentration gradients adjacent to the solid surface as well as a corresponding increase in the heat and mass transfer coefficients across the transition region. These effects are illustrated in Figure 6.8 for the velocity boundary layer thickness  $\delta$  and the local convection heat transfer coefficient  $h$ . Because turbulence induces mixing, which in turn reduces the importance of conduction and diffusion in determining the thermal and species boundary layer thicknesses, *differences* in the thicknesses of the velocity, thermal, and species boundary layers tend to be much smaller in turbulent flow than in laminar flow. As is evident in Equation 6.24, the presence of heat and/or mass transfer can affect the location of the transition from laminar to turbulent flow  $x_c$  if the density or dynamic viscosity of the fluid is dependent on temperature or species concentration.

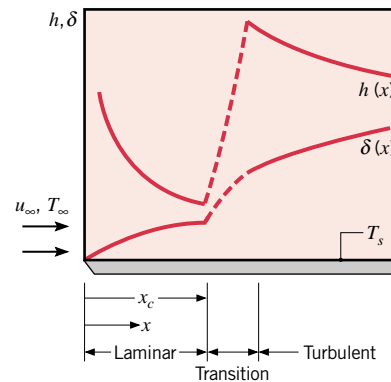

**FIGURE 6.8**

Variation of velocity boundary layer thickness  $\delta$  and the local heat transfer coefficient  $h$  for flow over an isothermal flat plate.

### EXAMPLE 6.4

Water flows at a velocity  $u_\infty = 1$  m/s over a flat plate of length  $L = 0.6$  m. Consider two cases, one for which the water temperature is approximately 300 K and the other for an approximate water temperature of 350 K. In the laminar and turbulent regions, experimental measurements show that the local convection coefficients are well described by

$$h_{\text{lam}}(x) = C_{\text{lam}} x^{-0.5} \quad h_{\text{turb}}(x) = C_{\text{turb}} x^{-0.2}$$

where  $x$  has units of m. At 300 K,

$$C_{\text{lam},300} = 395 \text{ W/m}^{1.5} \cdot \text{K} \quad C_{\text{turb},300} = 2330 \text{ W/m}^{1.8} \cdot \text{K}$$

while at 350 K,

$$C_{\text{lam},350} = 477 \text{ W/m}^{1.5} \cdot \text{K} \quad C_{\text{turb},350} = 3600 \text{ W/m}^{1.8} \cdot \text{K}$$

As is evident, the constant,  $C$ , depends on the nature of the flow as well as the water temperature because of the thermal dependence of various properties of the fluid.


Determine the average convection coefficient,  $\bar{h}$ , over the entire plate for the two water temperatures.

### SOLUTION

**Known:** Water flow over a flat plate; expressions for the dependence of the local convection coefficient with distance from the plate's leading edge,  $x$ ; and approximate temperature of the water.

**Find:** Average convection coefficient,  $\bar{h}$ .

**Schematic:**

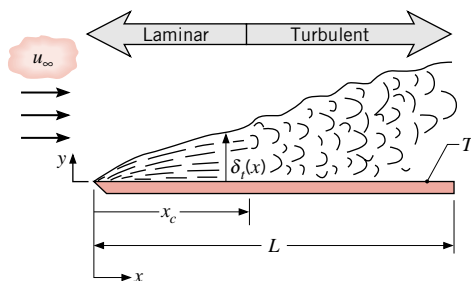

**Assumptions:**

1. Steady-state conditions.
2. Transition occurs at a critical Reynolds number of  $Re_{x,c} = 5 \times 10^5$ .

**Properties:** Table A.6, water ( $\bar{T} \approx 300$  K):  $\rho = v_f^{-1} = 997 \text{ kg/m}^3$ ,  $\mu = 855 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ . Table A.6 ( $\bar{T} \approx 350$  K):  $\rho = v_f^{-1} = 974 \text{ kg/m}^3$ ,  $\mu = 365 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ .

**Analysis:** The local convection coefficient is highly dependent on whether laminar or turbulent conditions exist. Therefore, we first determine the extent to which these conditions exist by finding the location where transition occurs,  $x_c$ . From Equation 6.24, we know that at 300 K,

$$x_c = \frac{Re_{x,c}\mu}{\rho u_\infty} = \frac{5 \times 10^5 \times 855 \times 10^{-6} \text{ N} \cdot \text{s/m}^2}{997 \text{ kg/m}^3 \times 1 \text{ m/s}} = 0.43 \text{ m}$$

while at 350 K,

$$x_c = \frac{Re_{x,c}\mu}{\rho u_\infty} = \frac{5 \times 10^5 \times 365 \times 10^{-6} \text{ N} \cdot \text{s/m}^2}{974 \text{ kg/m}^3 \times 1 \text{ m/s}} = 0.19 \text{ m}$$

From Equation 6.14 we know that

$$\bar{h} = \frac{1}{L} \int_0^L h dx = \frac{1}{L} \left[ \int_0^{x_c} h_{\text{lam}} dx + \int_{x_c}^L h_{\text{turb}} dx \right]$$

or

$$\bar{h} = \frac{1}{L} \left[ \frac{C_{\text{lam}}}{0.5} x^{0.5} \Big|_0^{x_c} + \frac{C_{\text{turb}}}{0.8} x^{0.8} \Big|_{x_c}^L \right]$$


At 300 K,

$$\begin{aligned} \bar{h} = \frac{1}{0.6 \text{ m}} & \left[ \frac{395 \text{ W/m}^{1.5} \cdot \text{K}}{0.5} \times (0.43^{0.5}) \text{ m}^{0.5} + \frac{2330 \text{ W/m}^{1.8} \cdot \text{K}}{0.8} \right. \\ & \left. \times (0.6^{0.8} - 0.43^{0.8}) \text{ m}^{0.8} \right] = 1620 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

while at 350 K,

$$\begin{aligned} \bar{h} = \frac{1}{0.6 \text{ m}} & \left[ \frac{477 \text{ W/m}^{1.5} \cdot \text{K}}{0.5} \times (0.19^{0.5}) \text{ m}^{0.5} + \frac{3600 \text{ W/m}^{1.8} \cdot \text{K}}{0.8} \right. \\ & \left. \times (0.6^{0.8} - 0.19^{0.8}) \text{ m}^{0.8} \right] = 3710 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

The local and average convection coefficient distributions for the plate are shown in the figure below.

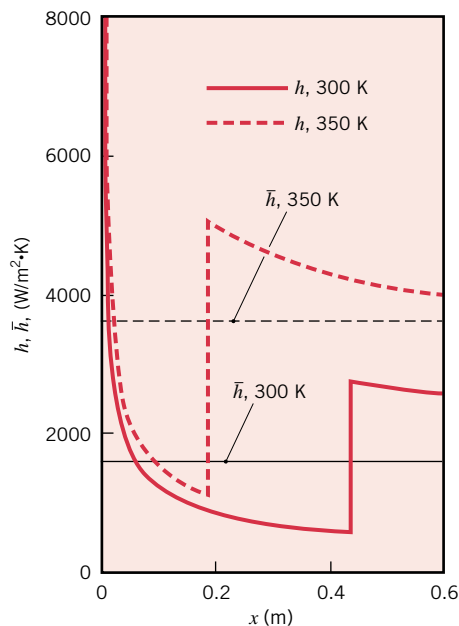



**Comments:**

1. The average convection coefficient at  $T \approx 350$  K is over twice as large as the value at  $T \approx 300$  K. This strong temperature dependence is due primarily to the significant shift of  $x_c$  that is associated with the smaller viscosity of the water at the higher temperature. Careful consideration of the temperature dependence of fluid properties is *crucial* when performing a convection heat transfer analysis.
2. Spatial variations in the local convection coefficient are significant. The largest local convection coefficients occur at the leading edge of the flat plate, where the laminar thermal boundary layer is extremely thin, and just downstream of  $x_c$ , where the turbulent boundary layer is thinnest.


## 6.4

### The Boundary Layer Equations

We can improve our understanding of the physical effects that determine boundary layer behavior and further illustrate its relevance to convection transport by considering the equations that govern boundary layer conditions, such as those illustrated in Figure 6.9.

The velocity boundary layer results from the difference between the free stream velocity and the zero velocity at the wall, while the thermal boundary layer results from a difference between the free stream and surface temperatures. The fluid is considered to be a binary mixture of species A and B, and the concentration boundary layer originates from a difference between the free stream and surface concentrations ( $C_{A,\infty} \neq C_{A,s}$ ). Illustration of the relative thicknesses ( $\delta_t > \delta_c > \delta$ ) in Figure 6.9 is arbitrary, for the moment, and the factors that influence relative boundary layer development are discussed later in this chapter.


Our objective in the next section is to obtain the differential equations that govern the velocity, temperature, and species concentration fields that are applicable to

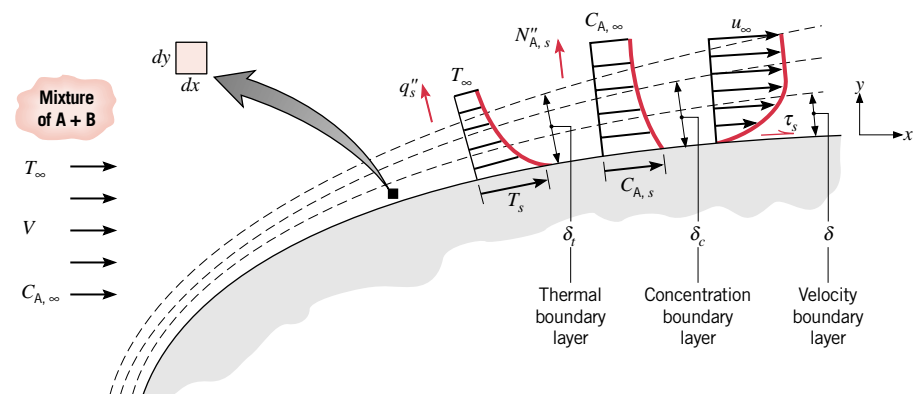

**FIGURE 6.9** Development of the velocity, thermal, and concentration boundary layers for an arbitrary surface.

boundary layer flow with heat and species transfer. Section 6.4.1 presents the laminar boundary layer equations, and Appendix E gives the corresponding equations for turbulent conditions.

### 6.4.1 Boundary Layer Equations for Laminar Flow

 These equations are derived in Section 6S.1.

Motion of a fluid in which there are coexisting velocity, temperature, and concentration gradients must comply with several *fundamental laws of nature*. In particular, at each point in the fluid, *conservation of mass, energy, and chemical species*, as well as *Newton's second law of motion*, must be satisfied. Equations representing these requirements are derived by applying the laws to a differential control volume situated in the flow. The resulting equations, in Cartesian coordinates, for the *steady, two-dimensional flow* of an *incompressible fluid* with *constant properties* are given in Appendix D. These equations serve as starting points for our analysis of laminar boundary layers. Note that turbulent flows are inherently unsteady, and the equations governing them are presented in Appendix E.

We begin by restricting attention to applications for which *body forces are negligible* ( $X = Y = 0$ ), there is *no thermal energy generation* ( $\dot{q} = 0$ ), and the *flow is nonreacting* ( $\dot{N}_A = 0$ ). Additional simplifications may be made by invoking approximations pertinent to conditions in the velocity, thermal, and concentration boundary layers. The boundary layer thicknesses are typically very small relative to the size of the object upon which they form, and the  $x$ -direction velocity, temperature, and concentration must change from their surface to their free stream values over these very small distances. Therefore, gradients normal to the object's surface are much larger than those along the surface. As a result, we can neglect terms that represent  $x$ -direction diffusion of momentum, thermal energy, and chemical species, relative to their  $y$ -direction counterparts. That is [3, 4]:

$$\frac{\partial^2 u}{\partial x^2} \ll \frac{\partial^2 u}{\partial y^2} \quad \frac{\partial^2 T}{\partial x^2} \ll \frac{\partial^2 T}{\partial y^2} \quad \frac{\partial^2 C_A}{\partial x^2} \ll \frac{\partial^2 C_A}{\partial y^2} \quad (6.25)$$

By neglecting the  $x$ -direction terms, we are assuming that the corresponding shear stress, conduction flux, and species diffusion flux are negligible.

Furthermore, because the boundary layer is so thin, the  $x$ -direction pressure gradient within the boundary layer can be approximated as the free stream pressure gradient:

$$\frac{\partial p}{\partial x} \approx \frac{dp_\infty}{dx} \quad (6.26)$$

The form of  $p_\infty(x)$  depends on the surface geometry and may be obtained from a separate consideration of flow conditions in the free stream. Hence, the pressure gradient may be treated as a known quantity.

With the foregoing simplifications and approximations, the overall continuity equation is unchanged from Equation D.1:

$$\frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} = 0 \quad (6.27)$$

This equation is an outgrowth of applying conservation of mass to the differential,  $dx \cdot dy \cdot 1$  control volume shown in Figure 6.9. The two terms represent the *net* outflow (outflow minus inflow) of mass in the  $x$ - and  $y$ -directions, the sum of which must be zero for steady flow.

The  $x$ -momentum equation (Equation D.2) reduces to:

$$u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} = -\frac{1}{\rho} \frac{dp_{\infty}}{dx} + \nu \frac{\partial^2 u}{\partial y^2} \quad (6.28)$$

This equation results from application of Newton's second law of motion in the  $x$ -direction to the  $dx \cdot dy \cdot 1$  differential control volume in the fluid. The left-hand side represents the net rate at which  $x$ -momentum leaves the control volume due to fluid motion across its boundaries. The first term on the right-hand side represents the net pressure force, and the second term represents the net force due to viscous shear stresses.

The energy equation (Equation D.4) reduces to

$$u \frac{\partial T}{\partial x} + v \frac{\partial T}{\partial y} = \alpha \frac{\partial^2 T}{\partial y^2} + \frac{\nu}{c_p} \left( \frac{\partial u}{\partial y} \right)^2 \quad (6.29)$$

This equation results from application of conservation of energy to a differential control volume in the flowing fluid. Terms on the left-hand side account for the net rate at which thermal energy leaves the control volume due to bulk fluid motion (advection). The first term on the right-hand side accounts for the net inflow of thermal energy due to  $y$ -direction conduction. The last term on the right-hand side is what remains of the viscous dissipation, Equation D.5, when it is acknowledged that, in a boundary layer, the velocity component in the direction along the surface,  $u$ , is much larger than that normal to the surface,  $v$ , and gradients normal to the surface are much larger than those along the surface. In many situations this term may be neglected relative to those that account for advection and conduction. However, aerodynamic heating that accompanies high-speed (especially supersonic) flight is a noteworthy situation in which this term is important.

The species conservation equation (Equation D.6) reduces to

$$u \frac{\partial C_A}{\partial x} + v \frac{\partial C_A}{\partial y} = D_{AB} \frac{\partial^2 C_A}{\partial y^2} \quad (6.30)$$

This equation is obtained by applying conservation of chemical species to a differential control volume in the flow. Terms on the left-hand side account for net transport of species A due to bulk fluid motion (advection), while the right-hand side represents the net inflow due to  $y$ -direction diffusion.

Equations 6.27 through 6.30 may be solved to determine the spatial variations of  $u$ ,  $v$ ,  $T$ , and  $C_A$  in the different laminar boundary layers. For incompressible, constant property flow, Equations 6.27 and 6.28 are *uncoupled* from Equations 6.29 and 6.30. That is, Equations 6.27 and 6.28 may be solved for the *velocity field*,  $u(x,y)$  and  $v(x,y)$ , without consideration of Equations 6.29 and 6.30. From knowledge of  $u(x,y)$ , the velocity gradient  $(\partial u / \partial y)|_{y=0}$  could then be evaluated, and the wall shear stress could be obtained from Equation 6.2. In contrast, through the appearance of  $u$  and  $v$  in Equations 6.29 and 6.30, the temperature and species concentration are *coupled* to the velocity field. Hence  $u(x,y)$  and  $v(x,y)$  must be known before Equations 6.29 and 6.30 may be solved for  $T(x,y)$  and  $C_A(x,y)$ . Once  $T(x,y)$  and  $C_A(x,y)$  have been obtained from such solutions, the convection heat and mass transfer coefficients may

be determined from Equations 6.5 and 6.9, respectively. It follows that these coefficients depend strongly on the velocity field.<sup>4</sup>

Because boundary layer solutions generally involve mathematics beyond the scope of this text, our treatment of such solutions will be restricted to the analysis of laminar parallel flow over a flat plate (Section 7.2 and Appendix F). However, other analytical solutions are discussed in advanced texts on convection [6–8], and detailed boundary layer solutions may be obtained by using numerical (finite-difference or finite-element) techniques [9]. It is also essential to recognize that a wide array of situations of engineering relevance involve turbulent convective heat transfer, which is both mathematically and physically more complex than laminar convection. The boundary layer equations for turbulent flow are included in Appendix E.

It is important to stress that we have not developed the laminar boundary layer equations solely for the purpose of obtaining solutions. In fact, we have been motivated primarily by two other considerations. One motivation has been to obtain an appreciation for the physical processes that occur in boundary layers. These processes affect wall friction as well as energy and species transfer in the boundary layers. A second important motivation arises from the fact that the equations may be used to identify key *boundary layer similarity parameters*, as well as important *analogies* between *momentum*, *heat*, and *mass* transfer. The laminar governing equations will be used for this purpose in Sections 6.5 through 6.7, but the same key parameters and analogies hold true for turbulent conditions as well.

## 6.5

### Boundary Layer Similarity: The Normalized Boundary Layer Equations

---

If we examine Equations 6.28, 6.29, and 6.30 we note a strong similarity. In fact, if the pressure gradient appearing in Equation 6.28 and the viscous dissipation term of Equation 6.29 are negligible, the three equations are of the same form. *Each equation is characterized by advection terms on the left-hand side and a diffusion term on the right-hand side.* This situation describes *low-speed, forced convection flows*, which are

---

<sup>4</sup>Special attention must be given to the effect of species transfer on the velocity boundary layer. Recall that velocity boundary layer development is generally characterized by the existence of zero fluid velocity *at the surface*. This condition pertains to the velocity component  $v$  normal to the surface, as well as to the velocity component  $u$  along the surface. However, if there is simultaneous mass transfer to or from the surface, it is evident that  $v$  can no longer be zero at the surface. Nevertheless, for the mass transfer problems of interest in this text, it is reasonable to assume that  $v = 0$  at the surface, which is equivalent to assuming that mass transfer has a negligible effect on the velocity boundary layer. The assumption is appropriate for many problems involving evaporation or sublimation from gas–liquid or gas–solid interfaces, respectively. It is not appropriate, however, for *mass transfer cooling* problems that involve large surface mass transfer rates [5]. In addition, we note that, with mass transfer, the boundary layer fluid is a binary mixture of species A and B, and its properties should be those of the mixture. However, in all problems in this text,  $C_A \ll C_B$  and it is reasonable to assume that the boundary layer properties (such as  $k$ ,  $\mu$ ,  $c_p$ , etc.) are those of species B.

found in many engineering applications. Implications of this similarity may be developed in a rational manner by first *nondimensionalizing* the governing equations.

### 6.5.1 Boundary Layer Similarity Parameters

The boundary layer equations are normalized by first defining dimensionless independent variables of the forms

$$x^* \equiv \frac{x}{L} \quad \text{and} \quad y^* \equiv \frac{y}{L} \quad (6.31)$$

where  $L$  is a *characteristic length* for the surface of interest (e.g., the length of a flat plate). Moreover, dependent dimensionless variables may also be defined as

$$u^* \equiv \frac{u}{V} \quad \text{and} \quad v^* \equiv \frac{v}{V} \quad (6.32)$$

where  $V$  is the velocity upstream of the surface (Figure 6.9), and as

$$T^* \equiv \frac{T - T_s}{T_\infty - T_s} \quad (6.33)$$

$$C_A^* \equiv \frac{C_A - C_{A,s}}{C_{A,\infty} - C_{A,s}} \quad (6.34)$$

Equations 6.31 through 6.34 may be substituted into Equations 6.28, 6.29, and 6.30 to obtain the dimensionless forms of the conservation equations shown in Table 6.1. Note that viscous dissipation has been neglected and that  $p^* \equiv (p_\infty/\rho V^2)$  is a dimensionless pressure. The  $y$ -direction boundary conditions required to solve the equations are also shown in the table.

Three very important dimensionless *similarity parameters* are introduced in Table 6.1. They are the Reynolds number,  $Re_L$ ; Prandtl number,  $Pr$ ; and Schmidt number,  $Sc$ . Similarity parameters are important because they allow us to apply results obtained for a surface experiencing one set of convective conditions to *geometrically similar* surfaces experiencing entirely different conditions. These conditions may vary, for example, with the nature of the fluid, the fluid velocity, and/or the size of the surface, as described by the characteristic length,  $L$ . As long as the similarity parameters and dimensionless boundary conditions are the same for the two sets of conditions, the solutions of the differential equations for the nondimensional velocity, temperature, and species concentration will also be the same. This concept will be expanded upon in the remainder of this section.

### 6.5.2 Functional Form of the Solutions

Equations 6.35 through 6.43 in Table 6.1 are extremely useful from the standpoint of suggesting how important boundary layer results may be simplified and generalized. The momentum equation (6.35) suggests that, although conditions in the velocity boundary layer depend on the fluid properties  $\rho$  and  $\mu$ , the velocity  $V$ , and the length scale  $L$ , this dependence may be simplified by grouping these variables

TABLE 6.1 The boundary layer equations and their y-direction boundary conditions in nondimensional form

Boundary Layer	Conservation Equation	Boundary Conditions		Similarity Parameter(s)
		Wall	Free Stream	
Velocity	$u^* \frac{\partial u^*}{\partial x^*} + v^* \frac{\partial u^*}{\partial y^*} = - \frac{dp^*}{dx^*} + \frac{1}{Re_L} \frac{\partial^2 u^*}{\partial y^{*2}} \quad (6.35)$	$\begin{aligned} u^*(x^*, 0) &= 0 \\ v^*(x^*, 0) &= 0 \end{aligned}$	$u^*(x^*, \infty) = \frac{u_\infty(x^*)}{V} \quad (6.38)$	$Re_L = \frac{VL}{\nu} \quad (6.41)$
Thermal	$u^* \frac{\partial T^*}{\partial x^*} + v^* \frac{\partial T^*}{\partial y^*} = \frac{1}{Re_L Pr} \frac{\partial^2 T^*}{\partial y^{*2}} \quad (6.36)$	$T^*(x^*, 0) = 0$	$T^*(x^*, \infty) = 1 \quad (6.39)$	$Re_L, Pr = \frac{\nu}{\alpha} \quad (6.42)$
Concentration	$u^* \frac{\partial C_A^*}{\partial x^*} + v^* \frac{\partial C_A^*}{\partial y^*} = \frac{1}{Re_L Sc} \frac{\partial^2 C_A^*}{\partial y^{*2}} \quad (6.37)$	$C_A^*(x^*, 0) = 0$	$C_A^*(x^*, \infty) = 1 \quad (6.40)$	$Re_L, Sc = \frac{\nu}{D_{AB}} \quad (6.43)$

in the form of the Reynolds number. We therefore anticipate that the solution to Equation 6.35 will be of the functional form

$$u^* = f\left(x^*, y^*, Re_L, \frac{dp^*}{dx^*}\right) \quad (6.44)$$

Since the pressure distribution  $p^*(x^*)$  depends on the surface geometry and may be obtained independently by considering flow conditions in the free stream, the appearance of  $dp^*/dx^*$  in Equation 6.44 represents the influence of geometry on the velocity distribution.

From Equation 6.2, the shear stress at the surface,  $y^* = 0$ , may be expressed as

$$\tau_s = \mu \left. \frac{\partial u}{\partial y} \right|_{y=0} = \left( \frac{\mu V}{L} \right) \left. \frac{\partial u^*}{\partial y^*} \right|_{y^*=0}$$

and from Equations 6.1 and 6.41, it follows that the friction coefficient is

$$C_f = \frac{\tau_s}{\rho V^2/2} = \frac{2}{Re_L} \left. \frac{\partial u^*}{\partial y^*} \right|_{y^*=0} \quad (6.45)$$

From Equation 6.44 we also know that

$$\left. \frac{\partial u^*}{\partial y^*} \right|_{y^*=0} = f\left(x^*, Re_L, \frac{dp^*}{dx^*}\right)$$

Hence, for a prescribed geometry Equation 6.45 may be expressed as

$$C_f = \frac{2}{Re_L} f(x^*, Re_L) \quad (6.46)$$

The significance of this result should not be overlooked. Equation 6.46 states that the friction coefficient, a dimensionless parameter of considerable importance to the engineer, may be expressed exclusively in terms of a dimensionless space coordinate and the Reynolds number. Hence, for a prescribed geometry we expect the function that relates  $C_f$  to  $x^*$  and  $Re_L$  to be *universally* applicable. That is, we expect it to apply to different fluids and over a wide range of values for  $V$  and  $L$ .

Similar results may be obtained for the convection coefficients of heat and mass transfer. Intuitively, we might anticipate that  $h$  depends on the fluid properties ( $k$ ,  $c_p$ ,  $\mu$ , and  $\rho$ ), the fluid velocity  $V$ , the length scale  $L$ , and the surface geometry. However, Equation 6.36 suggests the manner in which this dependence may be simplified. In particular, the solution to this equation may be expressed in the form

$$T^* = f\left(x^*, y^*, Re_L, Pr, \frac{dp^*}{dx^*}\right) \quad (6.47)$$

where the dependence on  $dp^*/dx^*$  originates from the influence of the geometry on the fluid motion ( $u^*$  and  $v^*$ ), which, in turn, affects the thermal conditions. Once again the term  $dp^*/dx^*$  represents the effect of surface geometry. From the definition of the convection coefficient, Equation 6.5, and the dimensionless variables, Equations 6.31 and 6.33, we also obtain

$$h = -\frac{k_f (T_\infty - T_s)}{L} \left. \frac{\partial T^*}{\partial y^*} \right|_{y^*=0} = +\frac{k_f}{L} \left. \frac{\partial T^*}{\partial y^*} \right|_{y^*=0}$$

This expression suggests defining a dependent dimensionless parameter termed the Nusselt number.

**Nusselt Number:**

$$Nu \equiv \frac{hL}{k_f} = + \left. \frac{\partial T^*}{\partial y^*} \right|_{y^*=0} \quad (6.48)$$

This parameter is equal to the dimensionless temperature gradient at the surface, and it provides a measure of the convection heat transfer occurring at the surface. From Equation 6.47 it follows that, *for a prescribed geometry*,

$$Nu = f(x^*, Re_L, Pr) \quad (6.49)$$

The Nusselt number is to the thermal boundary layer what the friction coefficient is to the velocity boundary layer. Equation 6.49 implies that for a given geometry, the Nusselt number must be some *universal function* of  $x^*$ ,  $Re_L$ , and  $Pr$ . If this function were known, it could be used to compute the value of  $Nu$  for different fluids and for different values of  $V$  and  $L$ . From knowledge of  $Nu$ , the local convection coefficient  $h$  may be found and the *local* heat flux may then be computed from Equation 6.4. Moreover, since the *average* heat transfer coefficient is obtained by integrating over the surface of the body, it must be independent of the spatial variable  $x^*$ . Hence the functional dependence of the *average* Nusselt number is

$$\overline{Nu} = \frac{\bar{h}L}{k_f} = f(Re_L, Pr) \quad (6.50)$$

Similarly, it may be argued that, for mass transfer in a gas flow over an evaporating liquid or a sublimating solid, the convection mass transfer coefficient  $h_m$  depends on the properties  $D_{AB}$ ,  $\rho$ , and  $\mu$ , the velocity  $V$ , and the characteristic length  $L$ . However, Equation 6.37 suggests that this dependence may be simplified. The solution to this equation must be of the form

$$C_A^* = f\left(x^*, y^*, Re_L, Sc, \frac{dp^*}{dx^*}\right) \quad (6.51)$$

where the dependence on  $dp^*/dx^*$  again originates from the influence of the fluid motion. From the definition of the convection coefficient, Equation 6.9, and the dimensionless variables, Equation 6.31 and 6.34, we know that

$$h_m = -\frac{D_{AB}}{L} \frac{(C_{A,\infty} - C_{A,s})}{(C_{A,s} - C_{A,\infty})} \left. \frac{\partial C_A^*}{\partial y^*} \right|_{y^*=0} = + \frac{D_{AB}}{L} \left. \frac{\partial C_A^*}{\partial y^*} \right|_{y^*=0}$$

Hence we may define a dependent dimensionless parameter termed the Sherwood number ( $Sh$ ).

**Sherwood Number:**

$$Sh \equiv \frac{h_m L}{D_{AB}} = + \left. \frac{\partial C_A^*}{\partial y^*} \right|_{y^*=0} \quad (6.52)$$



This parameter is equal to the dimensionless concentration gradient at the surface, and it provides a measure of the convection mass transfer occurring at the surface. From Equation 6.51 it follows that, *for a prescribed geometry*,

$$Sh = f(x^*, Re_L, Sc) \quad (6.53)$$

The Sherwood number is to the concentration boundary layer what the Nusselt number is to the thermal boundary layer, and Equation 6.53 implies that it must be a universal function of  $x^*$ ,  $Re_L$ , and  $Sc$ . As for the Nusselt number, it is also possible to work with an *average* Sherwood number that depends on only  $Re_L$  and  $Sc$ .


$$\overline{Sh} = \frac{\bar{h}_m L}{D_{AB}} = f(Re_L, Sc) \quad (6.54)$$

From the foregoing development we have obtained the relevant dimensionless parameters for low-speed, forced-convection boundary layers. We have done so by nondimensionalizing the differential equations that describe the physical processes occurring within the boundary layers. An alternative approach could have involved the use of dimensional analysis in the form of the Buckingham pi theorem [10]. However, the success of that method depends on one's ability to select, largely from intuition, the various parameters that influence a problem. For example, knowing beforehand that  $\bar{h} = f(k, c_p, \rho, \mu, V, L)$ , one could use the Buckingham pi theorem to obtain Equation 6.50. However, having begun with the differential form of the conservation equations, we have eliminated the guesswork and have established the similarity parameters in a rigorous fashion.

The value of an expression such as Equation 6.50 should be fully appreciated. It states that many convection heat transfer results, whether obtained theoretically or experimentally, can be represented in terms of three dimensionless groups, instead of the original seven parameters. The convenience afforded by such simplifications is evident. Moreover, once the form of the functional dependence of Equation 6.50 has been obtained for a particular surface geometry, let us say from laboratory measurements, it is known to be *universally* applicable. By this we mean that it may be applied for different fluids, velocities, and length scales, as long as the assumptions implicit in the originating boundary layer equations remain valid (e.g., negligible viscous dissipation and body forces).

### EXAMPLE 6.5

Experimental tests on a portion of the turbine blade shown indicate a heat flux to the blade of  $q'' = 95,000 \text{ W/m}^2$ . To maintain a steady-state surface temperature of  $800^\circ\text{C}$ , heat transferred to the blade is removed by circulating a coolant inside the blade.

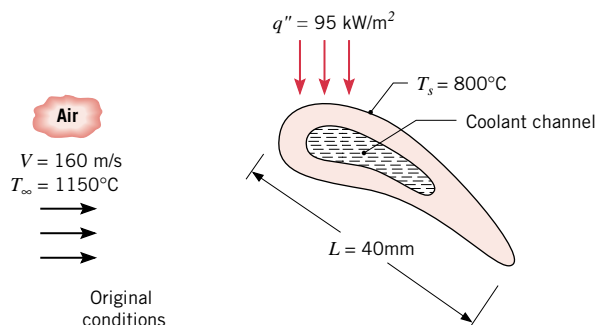

1. Determine the heat flux to the blade if its temperature is reduced to  $T_{s,1} = 700^\circ\text{C}$  by increasing the coolant flow.
2. Determine the heat flux at the same dimensionless location for a similar turbine blade having a chord length of  $L = 80\text{ mm}$ , when the blade operates in an air-flow at  $T_\infty = 1150^\circ\text{C}$  and  $V = 80\text{ m/s}$ , with  $T_s = 800^\circ\text{C}$ .


### SOLUTION

**Known:** Operating conditions of an internally cooled turbine blade.

**Find:**

1. Heat flux to the blade when the surface temperature is reduced.
2. Heat flux to a larger turbine blade of the same shape with reduced air velocity.

**Schematic:**

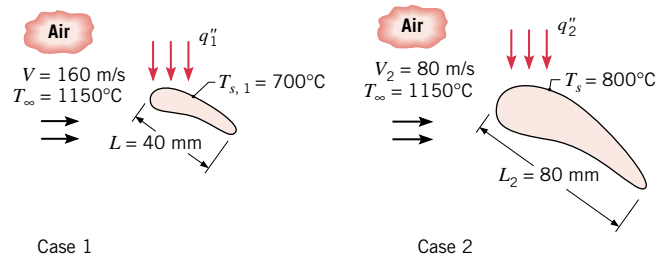

**Assumptions:**

1. Steady-state conditions.
2. Constant air properties.

**Analysis:**

1. When the surface temperature is  $800^\circ\text{C}$ , the convection heat transfer coefficient between the surface and the air can be obtained from Newton's law of cooling:

$$q'' = h(T_\infty - T_s)$$

Thus,

$$h = \frac{q''}{(T_\infty - T_s)}$$

We proceed without calculating the value for now. From Equation 6.49, it follows that, for the prescribed geometry,

$$Nu = \frac{hL}{k} = f(x^*, Re_L, Pr)$$

Hence, since there is no change in  $x^*$ ,  $Re_L$ , or  $Pr$  associated with a change in  $T$ , for constant properties, the local Nusselt number is unchanged. Moreover, since  $L$  and  $k$  are also unchanged, the local convection coefficient remains the same. Thus, when the surface temperature is reduced to  $700^\circ\text{C}$ , the heat flux may be obtained from Newton's law of cooling, using the same convection coefficient:

$$\begin{aligned} q''_1 &= h(T_\infty - T_{s,1}) = \frac{q''}{(T_\infty - T_s)}(T_\infty - T_{s,1}) = \frac{95,000\text{ W/m}^2}{(1150 - 800)^\circ\text{C}}(1150 - 700)^\circ\text{C} \\ &= 122,000\text{ W/m}^2 \end{aligned}$$



2. To determine the heat flux associated with the larger blade and the reduced air-flow (case 2), we first note that, although  $L$  has increased by a factor of 2, the velocity has decreased by the same factor and the Reynolds number has not changed. That is,

$$Re_{L,2} = \frac{V_2 L_2}{\nu} = \frac{VL}{\nu} = Re_L$$

Accordingly, since  $x^*$  and  $Pr$  are also unchanged, the local Nusselt number remains the same.

$$Nu_2 = Nu$$

Because the characteristic length is different, however, the convection coefficient changes, where

$$\frac{h_2 L_2}{k} = \frac{hL}{k} \quad \text{or} \quad h_2 = h \frac{L}{L_2} = \frac{q''}{(T_\infty - T_s)} \frac{L}{L_2}$$

The heat flux is then

$$q_2'' = h_2 (T_\infty - T_s) = q'' \frac{(T_\infty - T_s)}{(T_\infty - T_s)} \frac{L}{L_2}$$

$$q_2'' = 95,000 \text{ W/m}^2 \times \frac{0.04 \text{ m}}{0.08 \text{ m}} = 47,500 \text{ W/m}^2 \quad \triangleleft$$

**Comments:** If the Reynolds number for the two situations of part 2 differed, that is,  $Re_{L,2} \neq Re_L$ , the heat flux  $q_2''$  could only be obtained if the particular functional dependence of Equation 6.49 were known. Such forms are provided for many different shapes in subsequent chapters.

## 6.6

### Physical Significance of the Dimensionless Parameters

All of the foregoing dimensionless parameters have physical interpretations that relate to conditions in the flow, not only for boundary layers but also for other flow types as well, such as the internal flows we will see in Chapter 8. Consider the *Reynolds number*,  $Re_L$  (Equation 6.41), which may be interpreted as the *ratio of inertia to viscous forces* in a region of characteristic dimension  $L$ . Inertia forces are associated with an increase in the momentum of a moving fluid. From Equation 6.28, it is evident that these forces (per unit mass) are of the form  $u \partial u / \partial x$ , in which case an order-of-magnitude approximation gives  $F_I \approx V^2 / L$ . Similarly, the net shear force (per unit mass) is found on the right-hand side of Equation 6.28 as  $\nu (\partial^2 u / \partial y^2)$  and may be approximated as  $F_s \approx \nu V / L^2$ . Therefore, the ratio of forces is

$$\frac{F_I}{F_s} \approx \frac{\rho V^2 / L}{\mu V / L^2} = \frac{\rho V L}{\mu} = Re_L$$

We therefore expect inertia forces to dominate for large values of  $Re_L$  and viscous forces to dominate for small values of  $Re_L$ .

There are several important implications of this result. Recall that the Reynolds number determines the existence of laminar or turbulent flow. In any flow there exist small disturbances that can be amplified to produce turbulent conditions. For small  $Re_L$ , however, viscous forces are sufficiently large relative to inertia forces to prevent this amplification. Hence, laminar flow is maintained. But, with increasing  $Re_L$ , viscous effects become progressively less important relative to inertia effects, and small disturbances may be amplified to a point where transition occurs. We should also expect the magnitude of the Reynolds number to influence the velocity boundary layer thickness  $\delta$ . With increasing  $Re_L$  at a fixed location on a surface, we expect viscous forces to become less influential relative to inertia forces. Hence the effects of viscosity do not penetrate as far into the free stream, and the value of  $\delta$  diminishes.

The physical interpretation of the *Prandtl number* follows from its definition as a ratio of the momentum diffusivity  $\nu$  to the thermal diffusivity  $\alpha$ . The Prandtl number provides a *measure of the relative effectiveness of momentum and energy transport by diffusion in the velocity and thermal boundary layers*, respectively. From Table A.4 we see that the Prandtl number of gases is near unity, in which case energy and momentum transfer by diffusion are comparable. In a liquid metal (Table A.7),  $Pr \ll 1$  and the energy diffusion rate greatly exceeds the momentum diffusion rate. The opposite is true for oils (Table A.5), for which  $Pr \gg 1$ . From this interpretation it follows that the value of  $Pr$  strongly influences the relative growth of the velocity and thermal boundary layers. In fact for laminar boundary layers (in which transport by diffusion is *not* overshadowed by turbulent mixing) it is reasonable to expect that

$$\frac{\delta}{\delta_t} \approx Pr^n \quad (6.55)$$

where  $n$  is a positive exponent. Hence for a gas  $\delta_t \approx \delta$ ; for a liquid metal  $\delta_t \gg \delta$ ; for an oil  $\delta_t \ll \delta$ .

Similarly, the *Schmidt number*, which is defined by Equation 6.43, provides a *measure of the relative effectiveness of momentum and mass transport by diffusion in the velocity and concentration boundary layers*, respectively. For convection mass transfer in laminar flows, it therefore determines the relative velocity and concentration boundary layer thicknesses, where

$$\frac{\delta}{\delta_c} \approx Sc^n \quad (6.56)$$

Another parameter, which is related to  $Pr$  and  $Sc$ , is the *Lewis number* ( $Le$ ). It is defined as

$$Le = \frac{\alpha}{D_{AB}} = \frac{Sc}{Pr} \quad (6.57)$$

and is relevant to any situation involving simultaneous heat and mass transfer by convection. From Equations 6.55 through 6.57 it then follows that

$$\frac{\delta_t}{\delta_c} \approx Le^n \quad (6.58)$$

The Lewis number is therefore a measure of the relative thermal and concentration boundary layer thicknesses. For most applications it is reasonable to assume a value of  $n = 1/3$  in Equations 6.55, 6.56, and 6.58.

Table 6.2 lists the dimensionless groups that appear frequently in heat and mass transfer. The list includes groups already considered, as well as those yet to be introduced for special conditions. As a new group is confronted, its definition and interpretation should be committed to memory. Note that the *Grashof number* provides a measure of the ratio of buoyancy forces to viscous forces in the velocity

**TABLE 6.2** Selected dimensionless groups of heat and mass transfer

Group	Definition	Interpretation
Biot number ( $Bi$ )	$\frac{hL}{k_s}$	Ratio of the internal thermal resistance of a solid to the boundary layer thermal resistance.
Mass transfer Biot number ( $Bi_m$ )	$\frac{h_m L}{D_{AB}}$	Ratio of the internal species transfer resistance to the boundary layer species transfer resistance.
Bond number ( $Bo$ )	$\frac{g(\rho_l - \rho_v)L^2}{\sigma}$	Ratio of gravitational and surface tension forces.
Coefficient of friction ( $C_f$ )	$\frac{\tau_s}{\rho V^2/2}$	Dimensionless surface shear stress.
Eckert number ( $Ec$ )	$\frac{V^2}{c_p(T_s - T_\infty)}$	Kinetic energy of the flow relative to the boundary layer enthalpy difference.
Fourier number ( $Fo$ )	$\frac{\alpha t}{L^2}$	Ratio of the heat conduction rate to the rate of thermal energy storage in a solid. Dimensionless time.
Mass transfer Fourier number ( $Fo_m$ )	$\frac{D_{AB} t}{L^2}$	Ratio of the species diffusion rate to the rate of species storage. Dimensionless time.
Friction factor ( $f$ )	$\frac{\Delta p}{(L/D)(\rho u_m^2/2)}$	Dimensionless pressure drop for internal flow.
Grashof number ( $Gr_L$ )	$\frac{g\beta(T_s - T_\infty)L^3}{\nu^2}$	Measure of the ratio of buoyancy forces to viscous forces.
Colburn $j$ factor ( $j_H$ )	$St Pr^{2/3}$	Dimensionless heat transfer coefficient.
Colburn $j$ factor ( $j_m$ )	$St_m Sc^{2/3}$	Dimensionless mass transfer coefficient.
Jakob number ( $Ja$ )	$\frac{c_p(T_s - T_{sat})}{h_{fg}}$	Ratio of sensible to latent energy absorbed during liquid–vapor phase change.
Lewis number ( $Le$ )	$\frac{\alpha}{D_{AB}}$	Ratio of the thermal and mass diffusivities.
Nusselt number ( $Nu_L$ )	$\frac{hL}{k_f}$	Ratio of convection to pure conduction heat transfer.
Peclet number ( $Pe_L$ )	$\frac{VL}{\alpha} = Re_L Pr$	Ratio of advection to conduction heat transfer rates.
Prandtl number ( $Pr$ )	$\frac{c_p \mu}{k} = \frac{\nu}{\alpha}$	Ratio of the momentum and thermal diffusivities.

**TABLE 6.2** *Continued*

Group	Definition	Interpretation
Reynolds number ( $Re_L$ )	$\frac{VL}{\nu}$	Ratio of the inertia and viscous forces.
Schmidt number ( $Sc$ )	$\frac{\nu}{D_{AB}}$	Ratio of the momentum and mass diffusivities.
Sherwood number ( $Sh_L$ )	$\frac{h_m L}{D_{AB}}$	Dimensionless concentration gradient at the surface.
Stanton number ( $St$ )	$\frac{h}{\rho V c_p} = \frac{Nu_L}{Re_L Pr}$	Modified Nusselt number.
Mass transfer Stanton number ( $St_m$ )	$\frac{h_m}{V} = \frac{Sh_L}{Re_L Sc}$	Modified Sherwood number.
Weber number ( $We$ )	$\frac{\rho V^2 L}{\sigma}$	Ratio of inertia to surface tension forces.

boundary layer. Its role in free convection (Chapter 9) is much the same as that of the Reynolds number in forced convection. The *Eckert number* provides a measure of the kinetic energy of the flow relative to the enthalpy difference across the thermal boundary layer. It plays an important role in high-speed flows for which viscous dissipation is significant. Note also that, although similar in form, the Nusselt and Biot numbers differ in both definition and interpretation. Whereas the Nusselt number is defined in terms of the thermal conductivity of the fluid, the Biot number is based on the solid thermal conductivity, Equation 5.9.

## 6.7

### Boundary Layer Analogies

As engineers, our interest in boundary layer behavior is directed principally toward the dimensionless parameters  $C_f$ ,  $Nu$ , and  $Sh$ . From knowledge of these parameters, we may compute the wall shear stress and the convection heat and mass transfer rates. It is therefore understandable that expressions that relate  $C_f$ ,  $Nu$ , and  $Sh$  to each other can be useful tools in convection analysis. Such expressions are available in the form of *boundary layer analogies*.

#### 6.7.1 The Heat and Mass Transfer Analogy

If two or more processes are governed by dimensionless equations of the same form, the processes are said to be *analogous*. Clearly, then, from Equations 6.36 and 6.37 and the boundary conditions, Equations 6.39 and 6.40, of Table 6.1, convection heat and mass transfer are analogous. Each of the differential equations is composed of advection and diffusion terms of the same form. Moreover, as shown in

**TABLE 6.3** Functional relations pertinent to the boundary layer analogies

Fluid Flow	Heat Transfer	Mass Transfer
$u^* = f\left(x^*, y^*, Re_L, \frac{dp^*}{dx^*}\right)$ (6.44)	$T^* = f\left(x^*, y^*, Re_L, Pr, \frac{dp^*}{dx^*}\right)$ (6.47)	$C_A^* = f\left(x^*, y^*, Re_L, Sc, \frac{dp^*}{dx^*}\right)$ (6.51)
$C_f = \frac{2}{Re_L} \frac{\partial u^*}{\partial y^*} \bigg _{y^*=0}$ (6.45)	$Nu = \frac{hL}{k} = + \frac{\partial T^*}{\partial y^*} \bigg _{y^*=0}$ (6.48)	$Sh = \frac{h_m L}{D_{AB}} = + \frac{\partial C_A^*}{\partial y^*} \bigg _{y^*=0}$ (6.52)
$C_f = \frac{2}{Re_L} f(x^*, Re_L)$ (6.46)	$Nu = f(x^*, Re_L, Pr)$ (6.49)	$Sh = f(x^*, Re_L, Sc)$ (6.53)
	$\overline{Nu} = f(Re_L, Pr)$ (6.50)	$\overline{Sh} = f(Re_L, Sc)$ (6.54)

Equations 6.36 and 6.37, each equation is related to the velocity field through  $Re_L$ , and the parameters  $Pr$  and  $Sc$  assume analogous roles. One implication of this analogy is that dimensionless relations that govern thermal boundary layer behavior must be of the same form as those that govern the concentration boundary layer. Hence the boundary layer temperature and concentration profiles must also be of the same functional form if the applied boundary conditions are analogous.

Recalling the discussion of Section 6.5.2, features of which are summarized in Table 6.3, an important result of the heat and mass transfer analogy may be obtained. From the foregoing paragraph, it follows that Equation 6.47 must be of the same functional form as Equation 6.51. From Equations 6.48 and 6.52, it then follows that the dimensionless temperature and concentration gradients evaluated at the surface, and therefore the values of  $Nu$  and  $Sh$ , are analogous. Similarly, expressions for the average Nusselt and Sherwood numbers, Equations 6.50 and 6.54, respectively, are also of the same form. *Accordingly, heat and mass transfer relations for a particular geometry are interchangeable.* If, for example, one has performed a set of heat transfer experiments to determine the functional form of Equation 6.49 for a particular surface geometry, the results may be used for convection mass transfer involving the same geometry, simply by replacing  $Nu$  with  $Sh$  and  $Pr$  with  $Sc$ .

The analogy may also be used to directly relate the two convection coefficients. In subsequent chapters we will find that  $Nu$  and  $Sh$  are generally proportional to  $Pr^n$  and  $Sc^n$ , respectively, where  $n$  is a positive exponent less than 1. Anticipating this dependence, we use Equations 6.49 and 6.53 to obtain

$$Nu = f(x^*, Re_L) Pr^n \quad \text{and} \quad Sh = f(x^*, Re_L) Sc^n$$

in which case, with equivalent functions,  $f(x^*, Re_L)$ ,

$$\frac{Nu}{Pr^n} = \frac{Sh}{Sc^n} \quad (6.59)$$

Substituting from Equations 6.48 and 6.52 we then obtain

$$\frac{hL/k}{Pr^n} = \frac{h_m L/D_{AB}}{Sc^n}$$

or, from Equation 6.57,

$$\frac{h}{h_m} = \frac{k}{D_{AB}Le^n} = \rho c_p Le^{1-n} \quad (6.60)$$

This result may often be used to determine one convection coefficient, for example,  $h_m$ , from knowledge of the other coefficient. The same relation may be applied to the average coefficients  $\bar{h}$  and  $\bar{h}_m$ , and it may be used in turbulent, as well as laminar, flow. For most applications it is reasonable to assume a value of  $n = \frac{1}{3}$ .

### EXAMPLE 6.6


A solid of arbitrary shape is suspended in atmospheric air having a free stream temperature and velocity of 20°C and 100 m/s, respectively. The solid has a characteristic length of 1 m, and its surface is maintained at 80°C. Under these conditions measurements of the heat flux at a particular point ( $x^*$ ) on the surface and of the temperature in the boundary layer above this point ( $x^*, y^*$ ) reveal values of  $10^4$  W/m<sup>2</sup> and 60°C, respectively. A mass transfer operation is to be effected for a second solid having the same shape but a characteristic length of 2 m. In particular, a thin film of water on the solid is to be evaporated in dry atmospheric air having a free stream velocity of 50 m/s, with the air and the solid both at a temperature of 50°C. What are the molar concentration and the species molar flux of the water vapor at a location ( $x^*, y^*$ ) corresponding to the point at which the temperature and heat flux measurements were made in the first case?

### SOLUTION

**Known:** A boundary layer temperature and heat flux at a location on a solid in an airstream of prescribed temperature and velocity.

**Find:** Water vapor concentration and flux associated with the same location on a larger surface of the same shape.

**Schematic:**

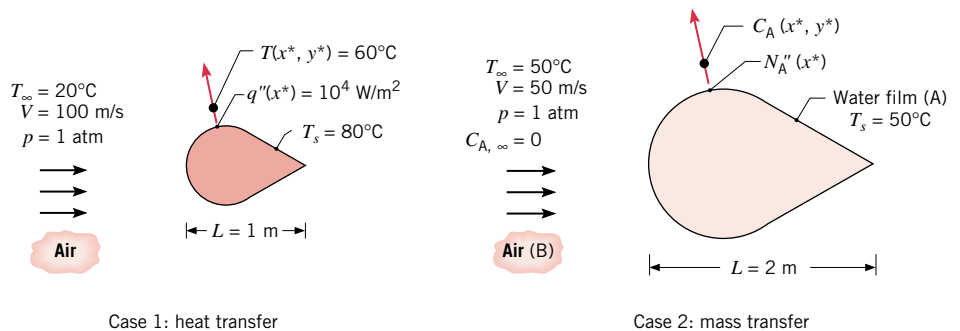

**Assumptions:**

1. Steady-state, two-dimensional, incompressible boundary layer behavior; constant properties.



2. Boundary layer approximations are valid.
3. Negligible viscous dissipation.
4. Mole fraction of water vapor in concentration boundary layer is much less than unity.

**Properties:** Table A.4, air (50°C):  $\nu = 18.2 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k = 28 \times 10^{-3} \text{ W/m} \cdot \text{K}$ ,  $Pr = 0.70$ . Table A.6, saturated water vapor (50°C):  $\rho_{A,\text{sat}} = v_g^{-1} = 0.082 \text{ kg/m}^3$ . Table A.8, water vapor–air (50°C):  $D_{AB} \approx 0.26 \times 10^{-4} \text{ m}^2/\text{s}$ .

**Analysis:** The desired molar concentration and flux may be determined by invoking the analogy between heat and mass transfer. From Equations 6.47 and 6.51, we know that

$$T^* \equiv \frac{T - T_s}{T_\infty - T_s} = f\left(x^*, y^*, Re_L, Pr, \frac{dp^*}{dx^*}\right)$$

and

$$C_A^* \equiv \frac{C_A - C_{A,s}}{C_{A,\infty} - C_{A,s}} = f\left(x^*, y^*, Re_L, Sc, \frac{dp^*}{dx^*}\right)$$

However, for case 1

$$Re_{L,1} = \frac{V_1 L_1}{\nu} = \frac{100 \text{ m/s} \times 1 \text{ m}}{18.2 \times 10^{-6} \text{ m}^2/\text{s}} = 5.5 \times 10^6, \quad Pr = 0.70$$

while for case 2

$$Re_{L,2} = \frac{V_2 L_2}{\nu} = \frac{50 \text{ m/s} \times 2 \text{ m}}{18.2 \times 10^{-6} \text{ m}^2/\text{s}} = 5.5 \times 10^6$$

$$Sc = \frac{\nu}{D_{AB}} = \frac{18.2 \times 10^{-6} \text{ m}^2/\text{s}}{26 \times 10^{-6} \text{ m}^2/\text{s}} = 0.70$$

Since  $Re_{L,1} = Re_{L,2}$ ,  $Pr = Sc$ ,  $x_1^* = x_2^*$ ,  $y_1^* = y_2^*$ , and the surface geometries are the same, it follows that the temperature and concentration distributions have the same functional form. Hence

$$\frac{C_A(x^*, y^*) - C_{A,s}}{C_{A,\infty} - C_{A,s}} = \frac{T(x^*, y^*) - T_s}{T_\infty - T_s} = \frac{60 - 80}{20 - 80} = 0.33$$

or, with  $C_{A,\infty} = 0$ ,

$$C_A(x^*, y^*) = C_{A,s}(1 - 0.33) = 0.67 C_{A,s}$$

With

$$C_{A,s} = C_{A,\text{sat}}(50^\circ\text{C}) = \frac{\rho_{A,\text{sat}}}{\mathcal{M}_A} = \frac{0.082 \text{ kg/m}^3}{18 \text{ kg/kmol}} = 0.0046 \text{ kmol/m}^3$$

it follows that

$$C_A(x^*, y^*) = 0.67 (0.0046 \text{ kmol/m}^3) = 0.0031 \text{ kmol/m}^3$$



The molar flux may be obtained from Equation 6.8

$$N_A''(x^*) = h_m(C_{A,s} - C_{A,\infty})$$

with  $h_m$  evaluated from the analogy. From Equations 6.49 and 6.53 we know that, since  $x_1^* = x_2^*$ ,  $Re_{L,1} = Re_{L,2}$ , and  $Pr = Sc$ , the corresponding functional forms are equivalent. Hence

$$Sh = \frac{h_m L_2}{D_{AB}} = Nu = \frac{h L_1}{k}$$

With  $h = q''/(T_s - T_\infty)$  from Newton's law of cooling,

$$h_m = \frac{L_1}{L_2} \times \frac{D_{AB}}{k} \times \frac{q''}{(T_s - T_\infty)} = \frac{1}{2} \times \frac{0.26 \times 10^{-4} \text{ m}^2/\text{s}}{0.028 \text{ W/m} \cdot \text{K}} \times \frac{10^4 \text{ W/m}^2}{(80 - 20)^\circ\text{C}}$$

$$h_m = 0.077 \text{ m/s}$$

Hence

$$N_A''(x^*) = 0.077 \text{ m/s} (0.0046 - 0.0) \text{ kmol/m}^3$$

or

$$N_A''(x^*) = 3.54 \times 10^{-4} \text{ kmol/s} \cdot \text{m}^2$$



### Comments:


1. Recognize that, since the mole fraction of water vapor in the concentration boundary layer is small, the kinematic viscosity of air ( $\nu_B$ ) may be used to evaluate  $Re_{L,2}$ .
2. The properties of air (and a variety of other substances) can be very quickly and easily found using *IHT* by selecting *Properties* from the *Tools* menu, and then "Air." The *Viewpad* window will list property function calls for the properties available for air. Copy the equations to the *Workspace* as needed, and add an equation that specifies the temperature at which properties are to be evaluated, namely the *film temperature*,  $T_f = (T_s + T_\infty)/2$ . The resulting lines of *IHT* are shown below. Click the *Solve* button, accept the initial guess, and the properties will be displayed in the *Data Browser*.

```
//Evaluate air properties at the film temperature
T = 50 + 273

//Air property functions : From Table A.4
//Units: T(K); 1 atm pressure
nu = nu_T("Air",T) //Kinematic viscosity, m^2/s
k = k_T("Air",T) //Thermal conductivity, W/m · K
Pr = Pr_T("Air",T) //Prandtl number
```

### 6.7.2 Evaporative Cooling

An important application of the heat and mass transfer analogy is to the process of *evaporative cooling*, which occurs when a gas flows over a liquid (Figure 6.10). Evaporation occurs from the liquid surface, and the energy associated with the phase change is the latent heat of vaporization of the liquid. Evaporation occurs

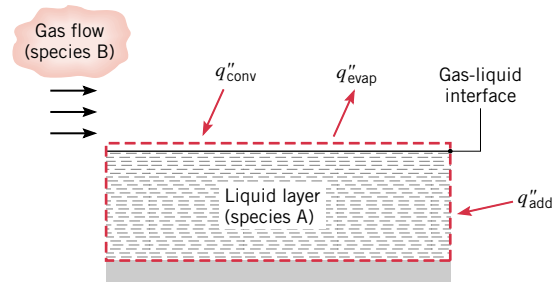

**FIGURE 6.10**  
Latent and sensible heat exchange at a gas–liquid interface.

when liquid molecules near the surface experience collisions that increase their energy above that needed to overcome the surface binding energy. The energy required to sustain the evaporation must come from the internal energy of the liquid, which would then experience a reduction in temperature (the cooling effect). However, if steady-state conditions are to be maintained, the latent energy lost by the liquid because of evaporation must be replenished by energy transfer to the liquid from its surroundings. Neglecting radiation effects, this transfer may be due to the convection of sensible energy from the gas or to heat addition by other means, as, for example, by an electrical heater submerged in the liquid. Applying conservation of energy to a control surface about the liquid (Equation 1.11c), it follows that, for a unit surface area,

$$q''_{\text{conv}} + q''_{\text{add}} = q''_{\text{evap}} \quad (6.61)$$

where  $q''_{\text{evap}}$  may be approximated as the product of the evaporative mass flux and the latent heat of vaporization

$$q''_{\text{evap}} = n''_A h_{fg} \quad (6.62)$$

If there is no heat addition by other means, Equation 6.61 reduces to a balance between convection heat transfer from the gas and the evaporative heat loss from the liquid. Substituting from Equations 6.4, 6.18, and 6.62, Equation 6.61 may then be expressed as

$$h(T_\infty - T_s) = h_{fg} h_m [\rho_{A,\text{sat}}(T_s) - \rho_{A,\infty}] \quad (6.63)$$

where the vapor density at the surface is that associated with saturated conditions at  $T_s$ . Hence the magnitude of the cooling effect may be expressed as

$$T_\infty - T_s = h_{fg} \left( \frac{h_m}{h} \right) [\rho_{A,\text{sat}}(T_s) - \rho_{A,\infty}] \quad (6.64)$$

Substituting for  $(h_m/h)$  from Equation 6.60 and for the vapor densities from the ideal gas law, the cooling effect may also be expressed as

$$(T_\infty - T_s) = \frac{\mathcal{M}_A h_{fg}}{\mathcal{R} \rho c_p Le^{2/3}} \left[ \frac{p_{A,\text{sat}}(T_s)}{T_s} - \frac{p_{A,\infty}}{T_\infty} \right] \quad (6.65)$$

In the interest of accuracy, the gas (species B) properties  $\rho$ ,  $c_p$ , and  $Le$  should be evaluated at the arithmetic mean temperature of the thermal boundary layer,

$T_{\text{am}} = (T_s + T_{\infty})/2$ . A representative value of  $n = \frac{1}{3}$  has been assumed for the  $Pr$  and  $Sc$  exponent of Equation 6.60.

Numerous environmental and industrial applications of the foregoing results arise for situations in which the gas is *air* and the liquid is *water*.

### EXAMPLE 6.7


A container, which is wrapped in a fabric that is continually moistened with a highly volatile liquid, may be used to keep beverages cool in hot arid regions. Suppose that the container is placed in dry ambient air at 40°C, with heat and mass transfer between the wetting agent and the air occurring by forced convection. The wetting agent is known to have a molecular weight of 200 kg/kmol and a latent heat of vaporization of 100 kJ/kg. Its saturated vapor pressure for the prescribed conditions is approximately 5000 N/m<sup>2</sup>, and the diffusion coefficient of the vapor in air is  $0.2 \times 10^{-4}$  m<sup>2</sup>/s. What is the steady-state temperature of the beverage?

### SOLUTION

**Known:** Properties of wetting agent used to evaporatively cool a beverage container.

**Find:** Steady-state temperature of beverage.

**Schematic:**

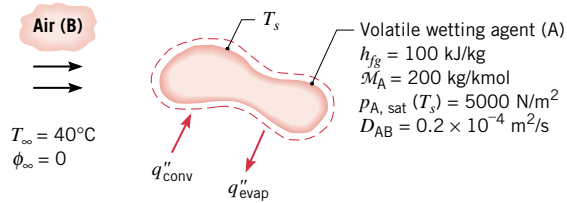

**Assumptions:**

1. Heat and mass transfer analogy is applicable.
2. Vapor displays ideal gas behavior.
3. Radiation effects are negligible.
4. Air properties may be evaluated at a mean boundary layer temperature assumed to be 300 K.

**Properties:** Table A.4, air (300 K):  $\rho = 1.16 \text{ kg/m}^3$ ,  $c_p = 1.007 \text{ kJ/kg} \cdot \text{K}$ ,  $\alpha = 22.5 \times 10^{-6} \text{ m}^2/\text{s}$ .

**Analysis:** Subject to the foregoing assumptions, the evaporative cooling effect is given by Equation 6.65.

$$(T_{\infty} - T_s) = \frac{M_A h_{fg}}{\mathcal{R} \rho c_p Le^{2/3}} \left[ \frac{p_{A, \text{sat}}(T_s)}{T_s} - \frac{p_{A, \infty}}{T_{\infty}} \right]$$

Setting  $p_{A,\infty} = 0$  and rearranging, it follows that

$$T_s^2 - T_\infty T_s + B = 0$$

where the coefficient  $B$  is

$$B = \frac{\mathcal{M}_A h_{fg} p_{A,\text{sat}}}{\mathcal{R} \rho_c p Le^{2/3}}$$

or

$$\begin{aligned} B &= [200 \text{ kg/kmol} \times 100 \text{ kJ/kg} \times 5000 \text{ N/m}^2 \times 10^{-3} \text{ kJ/N} \cdot \text{m}] \\ &\div \left[ 8.315 \text{ kJ/kmol} \cdot \text{K} \times 1.16 \text{ kg/m}^3 \times 1.007 \text{ kJ/kg} \cdot \text{K} \right. \\ &\quad \left. \times \left( \frac{22.5 \times 10^{-6} \text{ m}^2/\text{s}}{20 \times 10^{-6} \text{ m}^2/\text{s}} \right)^{2/3} \right] = 9518 \text{ K}^2 \end{aligned}$$

Hence

$$T_s = \frac{T_\infty \pm \sqrt{T_\infty^2 - 4B}}{2} = \frac{313 \text{ K} \pm \sqrt{(313)^2 - 4(9514)}}{2}$$

Rejecting the minus sign on physical grounds ( $T_s$  must equal  $T_\infty$  if there is no evaporation, in which case  $p_{A,\text{sat}} = 0$  and  $B = 0$ ), it follows that

$$T_s = 278.9 \text{ K} = 5.9^\circ\text{C}$$



**Comments:** The result is independent of the shape of the container as long as the heat and mass transfer analogy may be used.

### 6.7.3 The Reynolds Analogy

A second boundary layer analogy may be obtained by noting from Table 6.1 that, for  $dp^*/dx^* = 0$  and  $Pr = Sc = 1$ , the boundary layer equations, Equations 6.35 through 6.37, are of precisely the same form. For a flat plate parallel to the incoming flow, we have  $dp^*/dx^* = 0$  and there is no variation in the free stream velocity outside the boundary layer. With  $u_\infty = V$ , Equations 6.38 through 6.40 also have the same form. Hence the functional forms of the solutions for  $u^*$ ,  $T^*$ , and  $C_A^*$ , Equations 6.44, 6.47, and 6.51, must be equivalent. From Equations 6.45, 6.48, and 6.52, it follows that

$$C_f \frac{Re_L}{2} = Nu = Sh \quad (6.66)$$

Replacing  $Nu$  and  $Sh$  by the *Stanton number* ( $St$ ) and the *mass transfer Stanton number* ( $St_m$ ), respectively,

$$St \equiv \frac{h}{\rho V C_p} = \frac{Nu}{Re Pr} \quad (6.67)$$

$$St_m \equiv \frac{h_m}{V} = \frac{Sh}{Re Sc} \quad (6.68)$$

Equation 6.66 may also be expressed in the form

$$\frac{C_f}{2} = St = St_m \quad (6.69)$$

Equation 6.69 is known as the *Reynolds analogy*, and it relates the key engineering parameters of the velocity, thermal, and concentration boundary layers. If the velocity parameter is known, the analogy may be used to obtain the other parameters, and vice versa. However, there are restrictions associated with using this result. In addition to relying on the validity of the boundary layer approximations, the accuracy of Equation 6.69 depends on having  $Pr$  and  $Sc \approx 1$  and  $dp^*/dx^* \approx 0$ . However, it has been shown that the analogy may be applied over a wide range of  $Pr$  and  $Sc$ , if certain corrections are added. In particular the *modified Reynolds*, or *Chilton–Colburn, analogies* [11, 12], have the form

$$\frac{C_f}{2} = St Pr^{2/3} \equiv j_H \quad 0.6 < Pr < 60 \quad (6.70)$$

$$\frac{C_f}{2} = St_m Sc^{2/3} \equiv j_m \quad 0.6 < Sc < 3000 \quad (6.71)$$

where  $j_H$  and  $j_m$  are the *Colburn  $j$  factors* for heat and mass transfer, respectively. For laminar flow Equations 6.70 and 6.71 are only appropriate when  $dp^*/dx^* \approx 0$ , but in turbulent flow, conditions are less sensitive to the effect of pressure gradients and these equations remain approximately valid. If the analogy is applicable at every point on a surface, it may be applied to the surface average coefficients.

## 6.8

### The Convection Coefficients

In this chapter we have considered several fundamental issues related to convection transport phenomena. In the process, however, you should not lose sight of what remains *the problem of convection*. Our primary objective is still one of developing means to determine the convection coefficients  $h$  and  $h_m$ . Although these coefficients may be obtained by solving the boundary layer equations, it is only for simple flow situations that such solutions are readily effected. The more practical approach frequently involves calculating  $h$  and  $h_m$  from empirical relations of the form given by Equations 6.49 and 6.53. The particular form of these equations is obtained by *correlating* measured convection heat and mass transfer results in terms of appropriate dimensionless groups. It is this approach that is emphasized in the chapters that follow.

## 6.9

### Summary

In this chapter, attempts have been made to develop, in a logical fashion, the mathematical and physical bases of convection transport. To test your comprehension of the material, you should challenge yourself with appropriate questions.

- What is the difference between a *local* convection heat transfer coefficient and an *average* coefficient? What are their units? What is the difference between local and average convection coefficients for species transfer? What are their units?

- What are the forms of *Newton's law of cooling* for a *heat flux* and a *heat rate*? What are the analogous forms for convection mass transfer, expressed in molar and mass units?
- Provide some examples for which species transfer by convection is pertinent.
- What is *Fick's law*?
- What are the *velocity*, *thermal*, and *concentration boundary layers*? Under what conditions do they develop?
- What quantities change with location in a *velocity boundary layer*? A *thermal boundary layer*? A *concentration boundary layer*?
- Recognizing that convection heat (mass) transfer is strongly influenced by conditions associated with fluid flow over a surface, how is it that we may determine the convection heat (species) flux by applying Fourier's (Fick's) law to the fluid at the surface?
- Do we expect heat and mass transfer to change with transition from a laminar to a turbulent boundary layer? If so, how?
- What laws of nature are embodied by the *convection transfer equations*?
- What physical processes are represented by the terms of the *x-momentum equation* (6.28)? By the *energy equation* (6.29)? By the *species conservation equation* (6.30)?
- What special approximations may be made for conditions within *thin* velocity, thermal, and concentration boundary layers?
- How is the *Reynolds number* defined? What is its physical interpretation? What role is played by the *critical Reynolds number*?
- What is the definition of the *Prandtl number*? How does its value affect relative growth of the velocity and thermal boundary layers for laminar flow over a surface? What are representative room-temperature values of the Prandtl number for a liquid metal, a gas, water, and an oil?
- What is the definition of the *Schmidt number*? The *Lewis number*? What are their physical interpretations, and how do they influence relative velocity, thermal, and concentration boundary layer development for laminar flow over a surface?
- What is the *coefficient of friction*? The *Nusselt number*? The *Sherwood number*? For flow over a prescribed geometry, what are the independent parameters that determine local and average values of these quantities?
- Under what conditions may velocity, thermal, and concentration boundary layers be termed *analogous*? What is the physical basis of analogous behavior?
- What important boundary layer parameters are linked by the *heat and mass transfer analogy*?
- What is the physical basis of the *evaporative cooling effect*? Have you ever experienced the effect?
- What important boundary layer parameters are linked by the *Reynolds analogy*?
- What physical features distinguish a turbulent flow from a laminar flow?

## References

1. Webb, R. L., *Int. Comm. Heat Mass Trans.*, **17**, 529, 1990.
2. Hof, B., C. W. H. van Doorne, J. Westerweel, F. T. M. Nieuwstadt, H. Faisst, B. Eckhardt, H. Wedin, R. R. Kerswell, and F. Waleffe, *Science*, **305**, 1594, 2004.
3. Schlichting, H., and K. Gersten, *Boundary Layer Theory*, 8th ed., Springer-Verlag, New York, 1999.
4. Bird, R. B., W. E. Stewart, and E. N. Lightfoot, *Transport Phenomena*, 2nd ed., Wiley, New York, 2002.

5. Hartnett, J. P., "Mass Transfer Cooling," in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, McGraw-Hill, New York, 1973.
6. Kays, W. M., M. E. Crawford, and B. Weigand, *Convective Heat and Mass Transfer*, 4th ed., McGraw-Hill Higher Education, Boston, 2005.
7. Burmeister, L. C., *Convective Heat Transfer*, 2nd ed., Wiley, New York, 1993.
8. Kaviani, M., *Principles of Convective Heat Transfer*, Springer-Verlag, New York, 1994.
9. Patankar, S. V., *Numerical Heat Transfer and Fluid Flow*, Hemisphere Publishing, New York, 1980.
10. Fox, R. W., A. T. McDonald, and P. J. Pritchard, *Introduction to Fluid Mechanics*, 6th ed., Wiley, Hoboken, NJ, 2003.
11. Colburn, A. P., *Trans. Am. Inst. Chem. Eng.*, **29**, 174, 1933.
12. Chilton, T. H., and A. P. Colburn, *Ind. Eng. Chem.*, **26**, 1183, 1934.

## Problems

### Boundary Layer Profiles

- 6.1** In flow over a surface, velocity and temperature profiles are of the forms

$$u(y) = Ay + By^2 - Cy^3 \quad \text{and} \\ T(y) = D + Ey + Fy^2 - Gy^3$$

where the coefficients  $A$  through  $G$  are constants. Obtain expressions for the friction coefficient  $C_f$  and the convection coefficient  $h$  in terms of  $u_\infty$ ,  $T_\infty$ , and appropriate profile coefficients and fluid properties.

- 6.2** Water at a temperature of  $T_\infty = 25^\circ\text{C}$  flows over one of the surfaces of a steel wall (AISI 1010) whose temperature is  $T_{s,1} = 40^\circ\text{C}$ . The wall is 0.35 m thick, and its other surface temperature is  $T_{s,2} = 100^\circ\text{C}$ . For steady-state conditions what is the convection coefficient associated with the water flow? What is the temperature gradient in the wall and in the water that is in contact with the wall? Sketch the temperature distribution in the wall and in the adjoining water.
- 6.3** In a particular application involving airflow over a heated surface, the boundary layer temperature distribution may be approximated as

$$\frac{T - T_s}{T_\infty - T_s} = 1 - \exp\left(-Pr \frac{u_\infty y}{\nu}\right)$$

where  $y$  is the distance normal to the surface and the Prandtl number,  $Pr = c_p \mu / k = 0.7$ , is a dimensionless fluid property. If  $T_\infty = 400\text{ K}$ ,  $T_s = 300\text{ K}$ , and  $u_\infty / \nu = 5000\text{ m}^{-1}$ , what is the surface heat flux?


### Heat Transfer Coefficients

- 6.4** For laminar flow over a flat plate, the local heat transfer coefficient  $h_x$  is known to vary as  $x^{-1/2}$ , where  $x$  is the distance from the leading edge ( $x = 0$ ) of the plate. What is the ratio of the average coefficient between the leading edge and some location  $x$  on the plate to the local coefficient at  $x$ ?

- 6.5** For laminar free convection from a heated vertical surface, the local convection coefficient may be expressed as  $h_x = Cx^{-1/4}$ , where  $h_x$  is the coefficient at a distance  $x$  from the leading edge of the surface and the quantity  $C$ , which depends on the fluid properties, is independent of  $x$ . Obtain an expression for the ratio  $\bar{h}_x/h_x$ , where  $\bar{h}_x$  is the average coefficient between the leading edge ( $x = 0$ ) and the  $x$  location. Sketch the variation of  $h_x$  and  $\bar{h}_x$  with  $x$ .

- 6.6** A circular, hot gas jet at  $T_\infty$  is directed normal to a circular plate that has radius  $r_o$  and is maintained at a uniform temperature  $T_s$ . Gas flow over the plate is axisymmetric, causing the local convection coefficient to have a radial dependence of the form  $h(r) = a + br^n$ , where  $a$ ,  $b$ , and  $n$  are constants. Determine the rate of heat transfer to the plate, expressing your result in terms of  $T_\infty$ ,  $T_s$ ,  $r_o$ ,  $a$ ,  $b$ , and  $n$ .

- 6.7** Parallel flow of atmospheric air over a flat plate of length  $L = 3\text{ m}$  is disrupted by an array of stationary rods placed in the flow path over the plate.

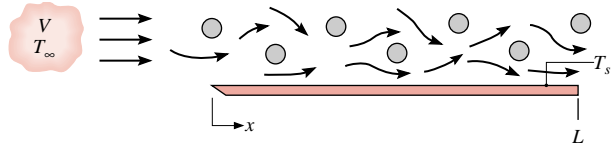


Laboratory measurements of the local convection coefficient at the surface of the plate are made for a prescribed value of  $V$  and  $T_s > T_\infty$ . The results are correlated by an expression of the form  $h_x = 0.7 + 13.6x - 3.4x^2$ , where  $h_x$  has units of  $\text{W/m}^2 \cdot \text{K}$  and  $x$  is in meters. Evaluate the average convection coefficient  $\bar{h}_L$  for the entire plate and the ratio  $\bar{h}_L/h_L$  at the trailing edge.

- 6.8** Air at a free stream temperature of  $T_\infty = 20^\circ\text{C}$  is in parallel flow over a flat plate of length  $L = 5\text{ m}$  and temperature  $T_s = 90^\circ\text{C}$ . However, obstacles placed in the flow intensify mixing with increasing distance  $x$  from the leading edge, and the spatial variation of temperatures



measured in the boundary layer is correlated by an expression of the form  $T(^{\circ}\text{C}) = 20 + 70 \exp(-600xy)$ , where  $x$  and  $y$  are in meters. Determine and plot the manner in which the local convection coefficient  $h$  varies with  $x$ . Evaluate the average convection coefficient  $\bar{h}$  for the plate.

- 6.9** The heat transfer rate per unit width (normal to the page) from a longitudinal section,  $x_2 - x_1$ , can be expressed as  $q'_{12} = \bar{h}_{12}(x_2 - x_1)(T_s - T_{\infty})$ , where  $\bar{h}_{12}$  is the average coefficient for the section of length  $(x_2 - x_1)$ . Consider laminar flow over a flat plate with a uniform temperature  $T_s$ . The spatial variation of the local convection coefficient is of the form  $h_x = Cx^{-1/2}$ , where  $C$  is a constant.

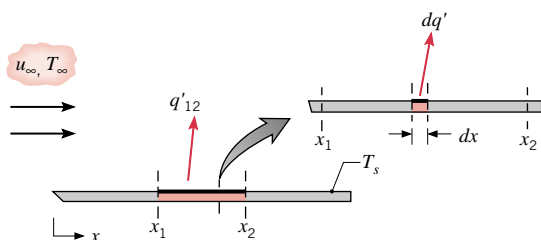

- Beginning with the convection rate equation in the form  $dq' = h_x dx(T_s - T_{\infty})$ , derive an expression for  $\bar{h}_{12}$  in terms of  $C$ ,  $x_1$ , and  $x_2$ .
- Derive an expression for  $\bar{h}_{12}$  in terms of  $x_1$ ,  $x_2$ , and the average coefficients  $\bar{h}_1$  and  $\bar{h}_2$ , corresponding to lengths  $x_1$  and  $x_2$ , respectively.

- 6.10** Experiments have been conducted to determine local heat transfer coefficients for flow perpendicular to a long, isothermal bar of rectangular cross section. The bar is of width  $c$ , parallel to the flow, and height  $d$ , normal to the flow. For Reynolds numbers in the range  $10^4 \leq Re_d \leq 5 \times 10^4$ , the *face-averaged* Nusselt numbers are well correlated by an expression of the form

$$Nu_d = hd / k = CRe_d^m Pr^{1/3}$$

The values of  $C$  and  $m$  for the front face, side faces, and back face of the rectangular rod are found to be the following:

Face	$c/d$	$C$	$m$
Front	$0.33 \leq c/d \leq 1.33$	0.674	1/2
Side	0.33	0.153	2/3
Side	1.33	0.107	2/3
Back	0.33	0.174	2/3
Back	1.33	0.153	2/3


Determine the value of the average heat transfer coefficient for the entire exposed surface (that is, averaged over all four faces) of a  $c = 40$ -mm wide,  $d = 30$ -mm tall rectangular rod. The rod is exposed to air in cross flow at  $V = 10$  m/s,  $T_{\infty} = 300$  K. Provide a plausible explanation of the relative values of the face-averaged heat transfer coefficients on the front, side, and back faces.

- 6.11** Experiments to determine the local convection heat transfer coefficient for uniform flow normal to a heated circular disk have yielded a radial Nusselt number distribution of the form

$$Nu_D = \frac{h(r)D}{k} = Nu_o \left[ 1 + a \left( \frac{r}{r_o} \right)^n \right]$$

where both  $n$  and  $a$  are positive. The Nusselt number at the stagnation point is correlated in terms of the Reynolds ( $Re_D = VD/\nu$ ) and Prandtl numbers

$$Nu_o = \frac{h(r=0)D}{k} = 0.814 Re_D^{1/2} Pr^{0.36}$$

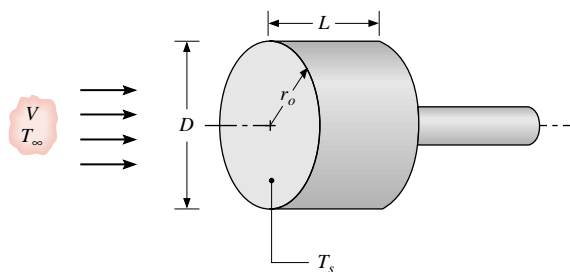


Obtain an expression for the average Nusselt number,  $\bar{Nu}_D = \bar{h}D/k$ , corresponding to heat transfer from an isothermal disk. Typically, boundary layer development from a stagnation point yields a decaying convection coefficient with increasing distance from the stagnation point. Provide a plausible explanation for why the opposite trend is observed for the disk.

- 6.12** An experimental procedure for validating results of the foregoing problem involves preheating a copper disk to an initial elevated temperature  $T_i$  and recording its temperature history  $T(t)$  as it is subsequently cooled by the impinging flow to a final temperature  $T_f$ . The measured temperature decay may then be compared with predictions based on the correlation for  $\bar{Nu}_D$ . Assume that values of  $a = 0.30$  and  $n = 2$  are associated with the correlation.

Consider experimental conditions for which a disk of diameter  $D = 50$  mm and length  $L = 25$  mm is preheated to  $T_i = 1000$  K and cooled to  $T_f = 400$  K by an impinging airflow at  $T_{\infty} = 300$  K. The cooled surface of

the disk has an emissivity of  $\varepsilon = 0.8$  and is exposed to large, isothermal surroundings for which  $T_{\text{sur}} = T_{\infty}$ . The remaining surfaces of the disk are well insulated, and heat transfer through the supporting rod may be neglected. Using results from the preceding problem, compute and plot temperature histories corresponding to air velocities of  $V = 4, 20$ , and  $50$  m/s. Constant properties may be assumed for the copper ( $\rho = 8933$  kg/m<sup>3</sup>,  $c_p = 425$  J/kg · K,  $k = 386$  W/m · K) and air ( $\nu = 38.8 \times 10^{-6}$  m<sup>2</sup>/s,  $k = 0.0407$  W/m · K,  $Pr = 0.684$ ).

- 6.13** If laminar flow is induced at the surface of a disk due to rotation about its axis, the local convection coefficient is known to be a constant,  $h = C$ , independent of radius. Consider conditions for which a disk of radius  $r_o = 100$  mm is rotating in stagnant air at  $T_{\infty} = 20^{\circ}\text{C}$  and a value of  $C = 20$  W/m<sup>2</sup> · K is maintained.

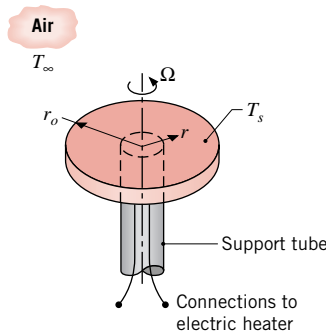

If an embedded electric heater maintains a surface temperature of  $T_s = 50^{\circ}\text{C}$ , what is the local heat flux at the surface of the disk? What is the total electric power requirement? What can you say about the nature of boundary layer development on the disk?

## Boundary Layer Transition

- 6.14** Consider airflow over a flat plate of length  $L = 1$  m under conditions for which transition occurs at  $x_c = 0.5$  m based on the critical Reynolds number,  $Re_{x,c} = 5 \times 10^5$ .

- Evaluating the thermophysical properties of air at  $350$  K, determine the air velocity.
- In the laminar and turbulent regions, the local convection coefficients are, respectively,

$$h_{\text{lam}}(x) = C_{\text{lam}} x^{-0.5} \quad \text{and} \quad h_{\text{turb}} = C_{\text{turb}} x^{-0.2}$$

where, at  $T = 350$  K,  $C_{\text{lam}} = 8.845$  W/m<sup>3/2</sup> · K,  $C_{\text{turb}} = 49.75$  W/m<sup>1.8</sup> · K, and  $x$  has units of m. Develop an expression for the average convection coefficient,  $\bar{h}_{\text{lam}}(x)$ , as a function of distance from the leading edge,  $x$ , for the laminar region,  $0 \leq x \leq x_c$ .

- Develop an expression for the average convection coefficient,  $\bar{h}_{\text{turb}}(x)$ , as a function of distance from the leading edge,  $x$ , for the turbulent region,  $x_c \leq x \leq L$ .
- On the same coordinates, plot the local and average convection coefficients,  $h_x$  and  $\bar{h}_x$ , respectively, as a function of  $x$  for  $0 \leq x \leq L$ .

- 6.15** A fan that can provide air speeds up to  $50$  m/s is to be used in a low-speed wind tunnel with atmospheric air at  $25^{\circ}\text{C}$ . If one wishes to use the wind tunnel to study flat-plate boundary layer behavior up to Reynolds numbers of  $Re_x = 10^8$ , what is the minimum plate length that should be used? At what distance from the leading edge would transition occur if the critical Reynolds number were  $Re_{x,c} = 5 \times 10^5$ ?

- 6.16** Assuming a transition Reynolds number of  $5 \times 10^5$ , determine the distance from the leading edge of a flat plate at which transition will occur for each of the following fluids when  $u_{\infty} = 1$  m/s: atmospheric air, engine oil, and mercury. In each case, calculate the transition location for fluid temperatures of  $27^{\circ}\text{C}$  and  $77^{\circ}\text{C}$ .

- 6.17** To a good approximation, the dynamic viscosity  $\mu$ , the thermal conductivity  $k$ , and the specific heat  $c_p$  are independent of pressure. In what manner do the kinematic viscosity  $\nu$  and thermal diffusivity  $\alpha$  vary with pressure for an incompressible liquid and an ideal gas? Determine  $\alpha$  of air at  $350$  K for pressures of  $1, 5$ , and  $10$  atm. Assuming a transition Reynolds number of  $5 \times 10^5$ , determine the distance from the leading edge of a flat plate at which transition will occur for air at  $350$  K at pressures of  $1, 5$ , and  $10$  atm with  $u_{\infty} = 2$  m/s.

## Similarity and Dimensionless Parameters


- 6.18** An object of irregular shape has a characteristic length of  $L = 1$  m and is maintained at a uniform surface temperature of  $T_s = 400$  K. When placed in atmospheric air at a temperature of  $T_{\infty} = 300$  K and moving with a velocity of  $V = 100$  m/s, the average heat flux from the surface to the air is  $20,000$  W/m<sup>2</sup>. If a second object of the same shape, but with a characteristic length of  $L = 5$  m, is maintained at a surface temperature of  $T_s = 400$  K and is placed in atmospheric air at  $T_{\infty} = 300$  K, what will the value of the average convection coefficient be if the air velocity is  $V = 20$  m/s?

- 6.19** Experiments have shown that, for airflow at  $T_{\infty} = 35^{\circ}\text{C}$  and  $V_1 = 100$  m/s, the rate of heat transfer from a turbine blade of characteristic length  $L_1 = 0.15$  m and surface temperature  $T_{s,1} = 300^{\circ}\text{C}$  is  $q_1 = 1500$  W. What would be the heat transfer rate from a second turbine blade of characteristic length  $L_2 = 0.3$  m operating at  $T_{s,2} = 400^{\circ}\text{C}$  in airflow of  $T_{\infty} = 35^{\circ}\text{C}$  and  $V_2 = 50$  m/s?

The surface area of the blade may be assumed to be directly proportional to its characteristic length.

- 6.20** Experimental measurements of the convection heat transfer coefficient for a square bar in cross flow yielded the following values:

$$\begin{aligned} \bar{h}_1 &= 50 \text{ W/m}^2 \cdot \text{K} & \text{when } V_1 &= 20 \text{ m/s} \\ \bar{h}_2 &= 40 \text{ W/m}^2 \cdot \text{K} & \text{when } V_2 &= 15 \text{ m/s} \end{aligned}$$

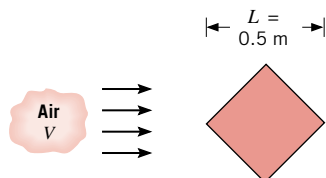

Assume that the functional form of the Nusselt number is  $\bar{Nu} = C Re^m Pr^n$ , where  $C$ ,  $m$ , and  $n$  are constants.

- What will be the convection heat transfer coefficient for a similar bar with  $L = 1 \text{ m}$  when  $V = 15 \text{ m/s}$ ?
- What will be the convection heat transfer coefficient for a similar bar with  $L = 1 \text{ m}$  when  $V = 30 \text{ m/s}$ ?
- Would your results be the same if the side of the bar, rather than its diagonal, were used as the characteristic length?

- 6.21** Experimental results for heat transfer over a flat plate with an extremely rough surface were found to be correlated by an expression of the form

$$Nu_x = 0.04 Re_x^{0.9} Pr^{1/3}$$


where  $Nu_x$  is the local value of the Nusselt number at a position  $x$  measured from the leading edge of the plate. Obtain an expression for the ratio of the average heat transfer coefficient  $\bar{h}_x$  to the local coefficient  $h_x$ .

- 6.22** Consider conditions for which a fluid with a free stream velocity of  $V = 1 \text{ m/s}$  flows over a surface with a characteristic length of  $L = 1 \text{ m}$ , providing an average convection heat transfer coefficient of  $\bar{h} = 100 \text{ W/m}^2 \cdot \text{K}$ . Calculate the dimensionless parameters  $\bar{Nu}_L$ ,  $Re_L$ ,  $Pr$ , and  $\bar{J}_H$  for the following fluids: air, engine oil, mercury, and water. Assume the fluids to be at  $300 \text{ K}$ .
- 6.23** For flow over a flat plate of length  $L$ , the local heat transfer coefficient  $h_x$  is known to vary as  $x^{-1/2}$ , where  $x$  is the distance from the leading edge of the plate. What is the ratio of the average Nusselt number for the entire plate ( $\bar{Nu}_L$ ) to the local Nusselt number at  $x = L$  ( $Nu_L$ )?
- 6.24** For laminar boundary layer flow over a flat plate with air at  $20^\circ\text{C}$  and  $1 \text{ atm}$ , the thermal boundary layer thickness  $\delta_t$  is approximately 13% larger than the velocity boundary layer thickness  $\delta$ . Determine the ratio  $\delta/\delta_t$  if the fluid is ethylene glycol under the same flow conditions.

- 6.25** Sketch the variation of the velocity and thermal boundary layer thicknesses with distance from the leading edge of a flat plate for the laminar flow of air, water, engine oil, and mercury. For each case assume a mean fluid temperature of  $300 \text{ K}$ .

- 6.26** Forced air at  $T_\infty = 25^\circ\text{C}$  and  $V = 10 \text{ m/s}$  is used to cool electronic elements on a circuit board. One such element is a chip,  $4 \text{ mm}$  by  $4 \text{ mm}$ , located  $120 \text{ mm}$  from the leading edge of the board. Experiments have revealed that flow over the board is disturbed by the elements and that convection heat transfer is correlated by an expression of the form

$$Nu_x = 0.04 Re_x^{0.85} Pr^{1/3}$$

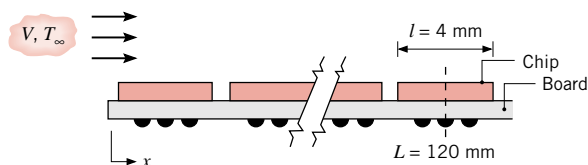

Estimate the surface temperature of the chip if it is dissipating  $30 \text{ mW}$ .

- 6.27** Consider the electronic elements that are cooled by forced convection in Problem 6.26. The cooling system is designed and tested at sea level ( $P \approx 1 \text{ atm}$ ), but the circuit board is sold to a customer in Mexico City, with an elevation of  $2250 \text{ m}$  and atmospheric pressure of  $76.5 \text{ kPa}$ .
- Estimate the surface temperature of the chip located  $120 \text{ mm}$  from the leading edge of the board when the board is operated in Mexico City. The dependence of various thermophysical properties upon pressure is noted in Problem 6.17.
  - It is highly desirable for the chip operating temperature to be independent of the location of the customer. What air velocity is required for operation in Mexico City if the chip temperature is to be the same as at sea level?

- 6.28** Consider the chip on the circuit board of Problem 6.26. To ensure reliable operation over extended periods, the chip temperature should not exceed  $85^\circ\text{C}$ . Assuming the availability of forced air at  $T_\infty = 25^\circ\text{C}$  and applicability of the prescribed heat transfer correlation, compute and plot the maximum allowable chip power dissipation  $P_c$  as a function of air velocity for  $1 \leq V \leq 25 \text{ m/s}$ . If the chip surface has an emissivity of  $0.80$  and the board is mounted in a large enclosure whose walls are at  $25^\circ\text{C}$ , what is the effect of radiation on the  $P_c$ - $V$  plot?

- 6.29** A major contributor to product defects in electronic modules relates to stresses induced during thermal


cycling (intermittent heating and cooling). For example, in circuit cards having active and passive components with materials of different thermal expansion coefficients, thermal stresses are the principal source of failure in component joints, such as soldered and wired connections. Although concern is generally for fatigue failure resulting from numerous excursions during the life of a product, it is possible to identify defective joints by performing accelerated thermal stress tests before the product is released to the customer. In such cases, it is important to achieve rapid thermal cycling to minimize disruptions to production schedules.

A manufacturer of circuit cards wishes to develop an apparatus for imposing rapid thermal transients on the cards by subjecting them to forced convection characterized by a relation of the form  $\overline{Nu}_L = C Re_L^m Pr^n$ , where  $m = 0.8$  and  $n = 0.33$ . However, she does not know whether to use air ( $k = 0.026 \text{ W/m} \cdot \text{K}$ ,  $\nu = 1.6 \times 10^{-5} \text{ m}^2/\text{s}$ ,  $Pr = 0.71$ ) or a dielectric liquid ( $k = 0.064 \text{ W/m} \cdot \text{K}$ ,  $\nu = 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 25$ ) as the working fluid. Assuming equivalent air and liquid velocities and validity of the lumped capacitance model for the components, obtain a quantitative estimate of the ratio of the thermal time constants for the two fluids. What fluid provides the faster thermal response?

- 6.30** To assess the efficacy of different liquids for cooling an object of given size and shape by forced convection, it is convenient to introduce a *figure of merit*,  $F_F$ , which combines the influence of all pertinent fluid properties on the convection coefficient. If the Nusselt number is governed by an expression of the form,  $Nu_L \sim Re_L^m Pr^n$ , obtain the corresponding relationship between  $F_F$  and the fluid properties. For representative values of  $m = 0.80$  and  $n = 0.33$ , calculate values of  $F_F$  for air ( $k = 0.026 \text{ W/m} \cdot \text{K}$ ,  $\nu = 1.6 \times 10^{-5} \text{ m}^2/\text{s}$ ,  $Pr = 0.71$ ), water ( $k = 0.604 \text{ W/m} \cdot \text{K}$ ,  $\nu = 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 5.0$ ), and a dielectric liquid ( $k = 0.064 \text{ W/m} \cdot \text{K}$ ,  $\nu = 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 25$ ). What fluid is the most effective cooling agent?


- 6.31** Gases are often used instead of liquids to cool electronics in avionics applications because of weight considerations. The cooling systems are often *closed* so that coolants other than air may be used. Gases with high figures of merit (see Problem 6.30) are desired. For representative values of  $m = 0.85$  and  $n = 0.33$  in the expression of Problem 6.30, determine the figures of merit for air, pure helium, pure xenon ( $k = 0.006 \text{ W/m} \cdot \text{K}$ ,  $\mu = 24.14 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ), and an ideal He-Xe mixture containing 0.75 mole fraction of helium ( $k = 0.0713 \text{ W/m} \cdot \text{K}$ ,  $\mu = 25.95 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ). Evaluate properties at 300 K and atmospheric pressure. For monatomic gases such as helium and xenon and their mixtures, the specific heat at constant pressure is well described by the relation  $c_p = (5/2)\mathcal{R}/M$ .

- 6.32** The defroster of an automobile functions by discharging warm air on the inner surface of the windshield. To prevent condensation of water vapor on the surface, the temperature of the air and the surface convection coefficient ( $T_{\infty,i}$ ,  $\bar{h}_i$ ) must be large enough to maintain a surface temperature  $T_{s,i}$  that is at least as high as the dewpoint ( $T_{s,i} \geq T_{dp}$ ).

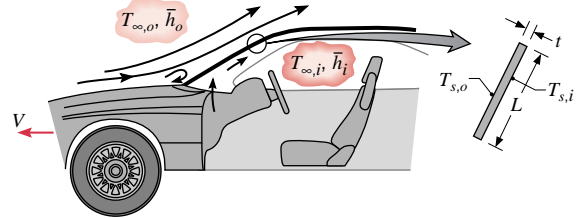

Consider a windshield of length  $L = 800 \text{ mm}$  and thickness  $t = 6 \text{ mm}$  and driving conditions for which the vehicle moves at a velocity of  $V = 70 \text{ mph}$  in ambient air at  $T_{\infty,o} = -15^\circ\text{C}$ . From laboratory experiments performed on a model of the vehicle, the average convection coefficient on the outer surface of the windshield is known to be correlated by an expression of the form  $\overline{Nu}_L = 0.030 Re_L^{0.8} Pr^{1/3}$ , where  $Re_L \equiv VL/\nu$ . Properties of the ambient air may be approximated as  $k = 0.023 \text{ W/m} \cdot \text{K}$ ,  $\nu = 12.5 \times 10^{-6} \text{ m}^2/\text{s}$ , and  $Pr = 0.71$ . If  $T_{dp} = 10^\circ\text{C}$  and  $T_{\infty,i} = 50^\circ\text{C}$ , what is the smallest value of  $\bar{h}_i$  required to prevent condensation on the inner surface?

- 6.33** A microscale detector monitors a steady flow ( $T_\infty = 27^\circ\text{C}$ ,  $V = 10 \text{ m/s}$ ) of air for the possible presence of small, hazardous particulate matter that may be suspended in the room. The sensor is heated to a slightly higher temperature in order to induce a chemical reaction associated with certain substances of interest that might impinge on the sensor's active surface. The active surface produces an electric current if such surface reactions occur; the electric current is then sent to an alarm. To maximize the sensor head's surface area and, in turn, the probability of capturing and detecting a particle, the sensor head is designed with a very complex shape. The value of the average heat transfer coefficient associated with the heated sensor must be known so that the required electrical power to the sensor can be determined.

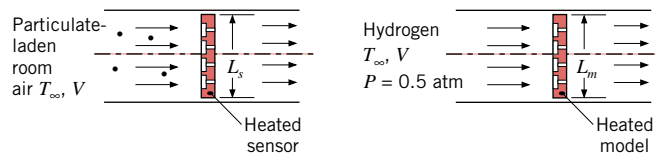

Consider a sensor with a characteristic dimension of  $L_s = 80 \mu\text{m}$ . A scale model of the sensor is placed in a

recirculating (closed) wind tunnel using hydrogen as the working fluid. If the wind tunnel operates at a hydrogen absolute pressure of 0.5 atm and velocity of  $V = 0.5$  m/s, find the required hydrogen temperature and characteristic dimension of the scale model,  $L_m$ .


### Reynolds Analogy

**6.34** A thin, flat plate that is 0.2 m by 0.2 m on a side is oriented parallel to an atmospheric airstream having a velocity of 40 m/s. The air is at a temperature of  $T_\infty = 20^\circ\text{C}$ , while the plate is maintained at  $T_s = 120^\circ\text{C}$ . The air flows over the top and bottom surfaces of the plate, and measurement of the drag force reveals a value of 0.075 N. What is the rate of heat transfer from both sides of the plate to the air?

**6.35** Atmospheric air is in parallel flow ( $u_\infty = 15$  m/s,  $T_\infty = 15^\circ\text{C}$ ) over a flat heater surface that is to be maintained at a temperature of  $140^\circ\text{C}$ . The heater surface area is  $0.25$  m<sup>2</sup>, and the airflow is known to induce a drag force of 0.25 N on the heater. What is the electrical power needed to maintain the prescribed surface temperature?

**6.36** For flow over a flat plate with an extremely rough surface, convection heat transfer effects are known to be correlated by the expression of Problem 6.21. For airflow at 50 m/s, what is the surface shear stress at  $x = 1$  m from the leading edge of the plate? Assume the air to be at a temperature of 300 K.


**6.37** A thin, flat plate that is 0.2 m by 0.2 m on a side with extremely rough top and bottom surfaces is placed in a wind tunnel so that its surfaces are parallel to an atmospheric air stream having a velocity of 30 m/s. The air is at a temperature of  $T_\infty = 20^\circ\text{C}$  while the plate is maintained at  $T_s = 80^\circ\text{C}$ . The plate is rotated  $45^\circ$  about its center point, as shown in the schematic. Air flows over the top and bottom surfaces of the plate, and measurement of the heat transfer rate is 2000 W. What is the drag force on the plate?

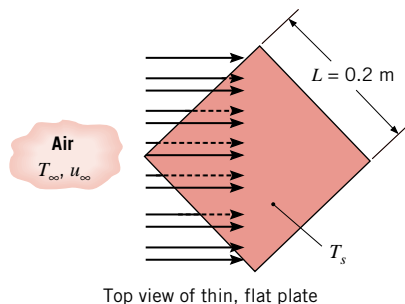

**6.38** As a means of preventing ice formation on the wings of a small, private aircraft, it is proposed that electric resis-

tance heating elements be installed within the wings. To determine representative power requirements, consider nominal flight conditions for which the plane moves at 100 m/s in air that is at a temperature of  $-23^\circ\text{C}$  and has properties of  $k = 0.022$  W/m  $\cdot$  K,  $Pr = 0.72$ , and  $\nu = 16.3 \times 10^{-6}$  m<sup>2</sup>/s. If the characteristic length of the airfoil is  $L = 2$  m and wind tunnel measurements indicate an average friction coefficient of  $\bar{C}_f = 0.0025$  for the nominal conditions, what is the average heat flux needed to maintain a surface temperature of  $T_s = 5^\circ\text{C}$ ?

**6.39** A circuit board with a dense distribution of integrated circuits (ICs) and dimensions of 120 mm by 120 mm on a side is cooled by the parallel flow of atmospheric air with a velocity of 2 m/s.

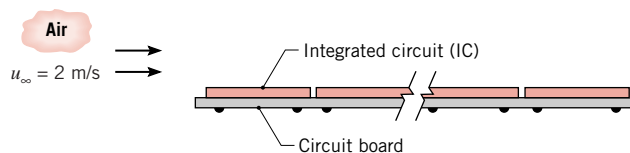

From wind tunnel tests under the same flow conditions, the average frictional shear stress on the upper surface is determined to be  $0.0625$  N/m<sup>2</sup>. What is the allowable power dissipation from the upper surface of the board if the average surface temperature of the ICs must not exceed the ambient air temperature by more than  $25^\circ\text{C}$ ? Evaluate the thermophysical properties of air at 300 K.

### Mass Transfer Coefficients

**6.40** On a summer day the air temperature is  $27^\circ\text{C}$  and the relative humidity is 30%. Water evaporates from the surface of a lake at a rate of 0.10 kg/h per square meter of water surface area. The temperature of the water is also  $27^\circ\text{C}$ . Determine the value of the convection mass transfer coefficient.

**6.41** It is observed that a 230-mm-diameter pan of water at  $23^\circ\text{C}$  has a mass loss rate of  $1.5 \times 10^{-5}$  kg/s when the ambient air is dry and at  $23^\circ\text{C}$ .

- Determine the convection mass transfer coefficient for this situation.
- Estimate the evaporation mass loss rate when the ambient air has a relative humidity of 50%.
- Estimate the evaporation mass loss rate when the water and ambient air temperatures are  $47^\circ\text{C}$ , assuming that the convection mass transfer coefficient remains unchanged and the ambient air is dry.

**6.42** The rate at which water is lost because of evaporation from the surface of a body of water may be determined



by measuring the surface recession rate. Consider a summer day for which the temperature of both the water and the ambient air is 305 K and the relative humidity of the air is 40%. If the surface recession rate is known to be 0.1 mm/h, what is the rate at which mass is lost because of evaporation per unit surface area? What is the convection mass transfer coefficient?

- 6.43** Photosynthesis, as it occurs in the leaves of a green plant, involves transport of carbon dioxide ( $\text{CO}_2$ ) from the atmosphere to the chloroplasts of the leaves, and the rate of photosynthesis may be quantified in terms of the rate of  $\text{CO}_2$  assimilation by the chloroplasts. This assimilation is strongly influenced by  $\text{CO}_2$  transfer through the boundary layer that develops on the leaf surface. Under conditions for which the density of  $\text{CO}_2$  is  $6 \times 10^{-4} \text{ kg/m}^3$  in the air and  $5 \times 10^{-4} \text{ kg/m}^3$  at the leaf surface and the convection mass transfer coefficient is  $10^{-2} \text{ m/s}$ , what is the rate of photosynthesis in terms of kilograms of  $\text{CO}_2$  assimilated per unit time and area of leaf surface?
- 6.44** Species A is evaporating from a flat surface into species B. Assume that the concentration profile for species A in the concentration boundary layer is of the form  $C_A(y) = Dy^2 + Ey + F$ , where  $D$ ,  $E$ , and  $F$  are constants at any  $x$  location and  $y$  is measured along a normal from the surface. Develop an expression for the mass transfer convection coefficient  $h_m$  in terms of these constants, the concentration of A in the free stream  $C_{A,\infty}$  and the mass diffusivity  $D_{AB}$ . Write an expression for the molar flux of mass transfer by convection for species A.

### Similarity and Heat–Mass Transfer Analogy

- 6.45** Consider cross flow of gas X over an object having a characteristic length of  $L = 0.1 \text{ m}$ . For a Reynolds number of  $1 \times 10^4$ , the average heat transfer coefficient is  $25 \text{ W/m}^2 \cdot \text{K}$ . The same object is then impregnated with liquid Y and subjected to the same flow conditions. Given the following thermophysical properties, what is the average convection mass transfer coefficient?

	$\nu \text{ (m}^2/\text{s)}$	$k \text{ (W/m} \cdot \text{K)}$	$\alpha \text{ (m}^2/\text{s)}$
Gas X	$21 \times 10^{-6}$	0.030	$29 \times 10^{-6}$
Liquid Y	$3.75 \times 10^{-7}$	0.665	$1.65 \times 10^{-7}$
Vapor Y	$4.25 \times 10^{-5}$	0.023	$4.55 \times 10^{-5}$
Mixture of gas X–vapor Y:	$Sc = 0.72$		

- 6.46** Consider conditions for which a fluid with a free stream velocity of  $V = 1 \text{ m/s}$  flows over an evaporating or subliming surface with a characteristic length of  $L = 1 \text{ m}$ , providing an average mass transfer convection coefficient

of  $\bar{h}_m = 10^{-2} \text{ m/s}$ . Calculate the dimensionless parameters  $\overline{Sh}_L$ ,  $Re_L$ ,  $Sc$ , and  $\bar{J}_m$  for the following combinations: airflow over water, airflow over naphthalene, and warm glycerol over ice. Assume a fluid temperature of 300 K and a pressure of 1 atm.

- 6.47** An object of irregular shape has a characteristic length of  $L = 1 \text{ m}$  and is maintained at a uniform surface temperature of  $T_s = 325 \text{ K}$ . It is suspended in an airstream that is at atmospheric pressure ( $p = 1 \text{ atm}$ ) and has a velocity of  $V = 100 \text{ m/s}$  and a temperature of  $T_\infty = 275 \text{ K}$ . The average heat flux from the surface to the air is  $12,000 \text{ W/m}^2$ . Referring to the foregoing situation as case 1, consider the following cases and determine whether conditions are analogous to those of case 1. Each case involves an object of the same shape, which is suspended in an airstream in the same manner. Where analogous behavior does exist, determine the corresponding value of the average convection coefficient.

- The values of  $T_s$ ,  $T_\infty$ , and  $p$  remain the same, but  $L = 2 \text{ m}$  and  $V = 50 \text{ m/s}$ .
- The values of  $T_s$  and  $T_\infty$  remain the same, but  $L = 2 \text{ m}$ ,  $V = 50 \text{ m/s}$ , and  $p = 0.2 \text{ atm}$ .
- The surface is coated with a liquid film that evaporates into the air. The entire system is at 300 K, and the diffusion coefficient for the air–vapor mixture is  $D_{AB} = 1.12 \times 10^{-4} \text{ m}^2/\text{s}$ . Also,  $L = 2 \text{ m}$ ,  $V = 50 \text{ m/s}$ , and  $p = 1 \text{ atm}$ .
- The surface is coated with another liquid film for which  $D_{AB} = 1.12 \times 10^{-4} \text{ m}^2/\text{s}$ , and the system is at 300 K. In this case  $L = 2 \text{ m}$ ,  $V = 250 \text{ m/s}$ , and  $p = 0.2 \text{ atm}$ .

- 6.48** On a cool day in April a scantily clothed runner is known to lose heat at a rate of 500 W because of convection to the surrounding air at  $T_\infty = 10^\circ\text{C}$ . The runner's skin remains dry and at a temperature of  $T_s = 30^\circ\text{C}$ . Three months later, the runner is moving at the same speed, but the day is warm and humid with a temperature of  $T_\infty = 30^\circ\text{C}$  and a relative humidity of  $\phi_\infty = 60\%$ . The runner is now drenched in sweat and has a uniform surface temperature of  $35^\circ\text{C}$ . Under both conditions constant air properties may be assumed with  $\nu = 1.6 \times 10^{-5} \text{ m}^2/\text{s}$ ,  $k = 0.026 \text{ W/m} \cdot \text{K}$ ,  $Pr = 0.70$ , and  $D_{AB}$  (water vapor–air) =  $2.3 \times 10^{-5} \text{ m}^2/\text{s}$ .

- What is the rate of water loss due to evaporation on the summer day?
- What is the total convective heat loss on the summer day?

- 6.49** An object of irregular shape 1 m long maintained at a constant temperature of  $100^\circ\text{C}$  is suspended in an airstream having a free stream temperature of  $0^\circ\text{C}$ , a

pressure of 1 atm, and a velocity of 120 m/s. The air temperature measured at a point near the object in the airstream is 80°C. A second object having the same shape is 2 m long and is suspended in an airstream in the same manner. The air free stream velocity is 60 m/s. Both the air and the object are at 50°C, and the total pressure is 1 atm. A plastic coating on the surface of the object is being dried by this process. The molecular weight of the vapor is 82 and the saturation pressure at 50°C for the plastic material is 0.0323 atm. The mass diffusivity for the vapor in air at 50°C is  $2.60 \times 10^{-5} \text{ m}^2/\text{s}$ .

- For the second object, at a location corresponding to the point of measurement on the first object, determine the vapor concentration and partial pressure.
- If the average heat flux  $q''$  is 2000 W/m<sup>2</sup> for the first object, determine the average mass flux  $n_A''$  (kg/s · m<sup>2</sup>) for the second object.

**6.50** An industrial process involves the evaporation of water from a liquid film that forms on a contoured surface. Dry air is passed over the surface, and from laboratory measurements the convection heat transfer correlation is of the form

$$\overline{Nu}_L = 0.43 Re_L^{0.58} Pr^{0.4}$$


- For an air temperature and velocity of 27°C and 10 m/s, respectively, what is the rate of evaporation from a surface of 1-m<sup>2</sup> area and characteristic length  $L = 1 \text{ m}$ ? Approximate the density of saturated vapor as  $\rho_{A,\text{sat}} = 0.0077 \text{ kg/m}^3$ .
- What is the steady-state temperature of the liquid film?

**6.51** The *naphthalene sublimation technique* involves use of a mass transfer experiment coupled with an analysis based on the heat and mass transfer analogy to obtain local or average convection heat transfer coefficients for complex surface geometries. A coating of naphthalene, which is a volatile solid at room temperature, is applied to the surface and is then subjected to airflow in a wind tunnel. Alternatively, solid objects may be cast from liquid naphthalene. Over a designated time interval,  $\Delta t$ , there is a discernible loss of naphthalene due to sublimation, and by measuring the surface recession at locations of interest or the mass loss of the sample, local or average mass transfer coefficients may be determined.

Consider a rectangular rod of naphthalene exposed to air in cross flow at  $V = 10 \text{ m/s}$ ,  $T_\infty = 300 \text{ K}$ , as in Problem 6.10, except now  $c = 10 \text{ mm}$  and  $d = 30 \text{ mm}$ . Determine the change in mass of the  $L = 500 \text{ mm}$  long rod over a time period of  $\Delta t = 30 \text{ min}$ . Naphthalene has a molecular weight of  $\mathcal{M}_A = 128.16 \text{ kg/kmol}$ , and its

solid–vapor saturation pressure at 27°C and 1 atm is  $p_{A,\text{sat}} = 1.33 \times 10^{-4} \text{ bar}$ .

- 6.52** Consider application of the naphthalene sublimation technique (Problem 6.51) to a gas turbine blade that is coated with naphthalene and has a surface area of  $A_s = 0.05 \text{ m}^2$ .

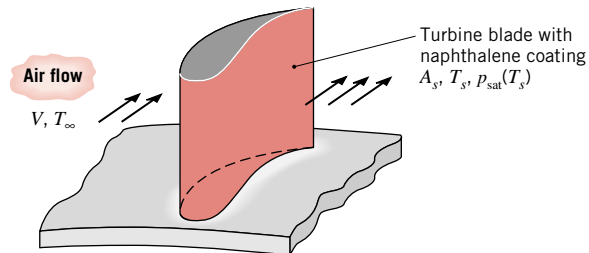

To determine the average convection heat transfer coefficient for a representative operating condition, an experiment is performed in which the coated blade is exposed for 30 min to atmospheric air at the desired velocity and a temperature of  $T_\infty = 27^\circ\text{C}$ . During the experiment the surface temperature is  $T_s = 27^\circ\text{C}$ , and at its conclusion the mass of the blade is reduced by  $\Delta m = 8 \text{ g}$ . What is the average convection heat transfer coefficient associated with the operating condition?


- 6.53** A manufacturer of ski equipment wishes to develop headgear that will offer enhanced thermal protection for skiers on cold days at the slopes. Headgear can be made with good thermal insulating characteristics, but it tends to be bulky and cumbersome. Skiers prefer comfortable, lighter gear that offers good visibility, but such gear tends to have poor thermal insulating characteristics. The manufacturer decides to take a new approach to headgear design by concentrating the insulation in areas about the head that are prone to the highest heat losses from the skier and minimizing use of insulation in other locations. Hence, the manufacturer must determine the local heat transfer coefficients associated with the human head with a velocity of  $V = 10 \text{ m/s}$  directed normal to the face and an air temperature of  $-13^\circ\text{C}$ . A young engineer is assigned the task of building the heat transfer experiment but soon finds the experimental challenges to be daunting. She decides to make use of the heat and mass transfer analogy and the naphthalene sublimation technique (see Problem 6.51) and casts head shapes of solid naphthalene with characteristic dimensions that are half-scale (i.e., the models are half as large as the full-scale head).

- What wind tunnel velocity ( $T_\infty = 300 \text{ K}$ ) is needed in order to apply the experimental results to the human head associated with  $V = 10 \text{ m/s}$ ?
- A wind tunnel experiment is performed for  $\Delta t = 120 \text{ min}$ ,  $T_\infty = 27^\circ\text{C}$ . The engineer finds that the

naphthalene has receded by  $\delta_1 = 0.1$  mm at the back of the head,  $\delta_2 = 0.32$  mm in the middle of the forehead, and  $\delta_3 = 0.64$  mm on the ear. Determine the heat transfer coefficients at these locations for the full-scale head at  $-13^\circ\text{C}$ . The density of solid naphthalene is  $\rho_{A,\text{sol}} = 1025$  kg/m<sup>3</sup>.

- (c) After the new headgear is designed, the models are fitted with the new gear (half-scale) and the experiments are repeated. Some areas of the model that were found to have extremely small local heat transfer coefficients are left uncovered since insulating these areas would have little overall benefit in reducing heat losses during skiing. Would you expect the local heat transfer coefficients for these exposed areas to remain the same as before fitting the model with the headgear? Explain why.

- 6.54** A streamlined strut supporting a bearing housing is exposed to a hot airflow from an engine exhaust. It is necessary to run experiments to determine the average convection heat transfer coefficient  $\bar{h}$  from the air to the strut in order to be able to cool the strut to the desired surface temperature  $T_s$ . It is decided to run mass transfer experiments on an object of the same shape and to obtain the desired heat transfer results by using the heat and mass transfer analogy.



The mass transfer experiments were conducted using a half-size model strut constructed from naphthalene exposed to an airstream at  $27^\circ\text{C}$ . Mass transfer measurements yielded these results:

$Re_L$	$\bar{Sh}_L$
60,000	282
120,000	491
144,000	568
288,000	989

- (a) Using the mass transfer experimental results, determine the coefficients  $C$  and  $m$  for a correlation of the form  $\bar{Sh}_L = C Re_L^m Sc^{1/3}$ .
- (b) Determine the average convection heat transfer coefficient  $\bar{h}$  for the full-sized strut,  $L_H = 60$  mm, when exposed to a free stream airflow with  $V = 60$  m/s,  $T_\infty = 184^\circ\text{C}$ , and  $p_\infty = 1$  atm when  $T_s = 70^\circ\text{C}$ .

- (c) The surface area of the strut can be expressed as  $A_s = 2.2L_H \cdot l$ , where  $l$  is the length normal to the page. For the conditions of part (b), what is the change in the rate of heat transfer to the strut if the characteristic length  $L_H$  is doubled?

- 6.55** Consider the conditions of Problem 6.3, but with a thin film of water on the surface. If the air is dry and the Schmidt number  $Sc$  is 0.6, what is the evaporative mass flux? Is there net energy transfer to or from the water?


- 6.56** Consider the conditions of Problem 6.7, for which a heat transfer experiment yielded the prescribed distribution of the local convection coefficient,  $h_i(x)$ . The experiment was performed for surface and free stream temperatures of 310 and 290 K, respectively. Now consider repeating the experiment under conditions for which the surface is coated with a thin layer of naphthalene and both the surface and air are at 300 K. What is the corresponding value of the average convection mass transfer coefficient,  $\bar{h}_{mL}$ ?

- 6.57** Using the naphthalene sublimation technique, the radial distribution of the local convection mass transfer coefficient for uniform flow normal to a circular disk has been correlated by an expression of the form

$$Sh_D = \frac{h_m(r)D}{D_{AB}} = Sh_o \left[ 1 + a \left( \frac{r}{r_o} \right)^n \right]$$

The stagnation point Sherwood number ( $Sh_o$ ) depends on the Reynolds ( $Re_D = VD/\nu$ ) and Schmidt ( $Sc = \nu/D_{AB}$ ) numbers, and data have been correlated by the following expression:

$$Sh_o = \frac{h_m(r=0)D}{D_{AB}} = 0.814 Re_D^{1/2} Sc^{0.36}$$

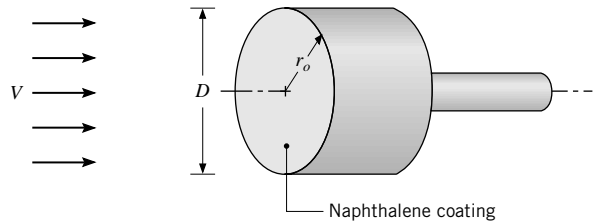


Obtain an expression for the average Nusselt number ( $\bar{Nu}_D = \bar{h}D/k$ ) corresponding to heat transfer from an isothermal disk exposed to the foregoing flow conditions. If  $a = 1.2$  and  $n = 5.5$ , what is the rate of heat transfer from a disk of diameter  $D = 20$  mm and surface temperature  $T_s = 125^\circ\text{C}$  to an airstream for which  $Re_D = 5 \times 10^4$  and  $T_\infty = 25^\circ\text{C}$ ? Typically, boundary layer development from a stagnation point yields a decaying convection coefficient with increasing



distance from the stagnation point. Provide a plausible explanation for why the opposite trend is observed for the disk.

- 6.58** To reduce the threat of predators, the sand grouse, a bird of Kenya, will lay its eggs in locations well removed from sources of groundwater. To bring water to its chicks, the grouse will then fly to the nearest source and, by submerging the lower part of its body, will entrain water within its plumage. The grouse will then return to its nest, and the chicks will imbibe water from the plumage. Of course, if the time of flight is too long, evaporative losses could cause a significant reduction in the water content of the plumage and the chicks could succumb to dehydration.



To gain a better understanding of convective transfer during flight, wind tunnel studies were performed using molded models of the grouse. By heating that portion of the model which corresponds to the water-encapsulating plumage, an average convection heat transfer coefficient was determined. Results for different air speeds and model sizes were then used to develop an empirical correlation of the form


$$\overline{Nu}_L = 0.034 Re_L^{4/5} Pr^{1/3}$$

The effective surface area of the water-encapsulating portion of the plumage is designated as  $A_s$ , and the characteristic length is defined as  $L = (A_s)^{1/2}$ .

Consider conditions for which a grouse has entrained 0.05 kg of water within plumage of  $A_s = 0.04 \text{ m}^2$  and is returning to its nest at a constant speed of  $V = 30 \text{ m/s}$ . The ambient air is stagnant and at a temperature and relative humidity of  $T_\infty = 37^\circ\text{C}$  and  $\phi_\infty = 25\%$ , respectively. If, throughout the flight, the surface  $A_s$  is covered with a liquid water film at  $T_s = 32^\circ\text{C}$ , what is the maximum allowable distance of the nest from the water source, if the bird must return with at least 50% of its initial water supply? Properties of the air and the air–vapor mixture may be taken to be  $\nu = 16.7 \times 10^{-6} \text{ m}^2/\text{s}$  and  $D_{AB} = 26.0 \times 10^{-6} \text{ m}^2/\text{s}$ .


- 6.59** A laboratory experiment involves simultaneous heat and mass transfer from a water-soaked towel experiencing irradiation from a bank of radiant lamps and parallel flow of air over its surface. Using a convection correlation to be introduced in Chapter 7, the average heat transfer convection coefficient is estimated to be  $\bar{h} = 28.7 \text{ W/m}^2 \cdot \text{K}$ .

Assume that the radiative properties of the towel are those of water, for which  $\alpha = \varepsilon = 0.96$ , and that the surroundings are at 300 K.

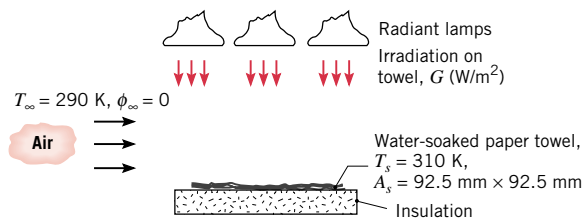

- Determine the rate at which water evaporates from the towel,  $n_A$  (kg/s).
- Perform an energy balance on the towel to determine the net rate of radiation transfer,  $q_{\text{rad}}$  (W), to the towel. Determine the irradiation  $G$  (W/m<sup>2</sup>).


- 6.60** In the spring, concrete surfaces such as sidewalks and driveways are sometimes very wet in the morning, even when it has not rained during the night. Typical nighttime conditions are shown in the sketch.

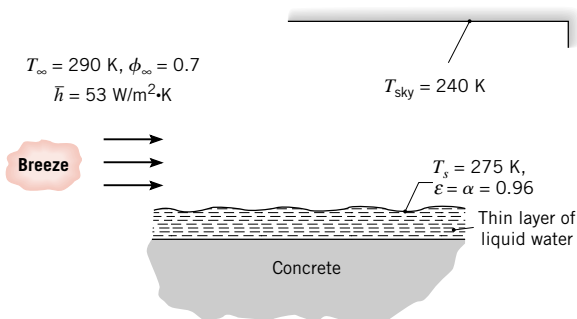

- Determine the heat fluxes associated with convection,  $q''_{\text{conv}}$ , evaporation,  $q''_{\text{evap}}$ , and radiation exchange with the sky,  $q''_{\text{rad}}$ .
- Do your calculations suggest why the concrete is wet instead of dry? Explain briefly.
- Is heat flowing from the liquid layer to the concrete? Or from the concrete to the liquid layer? Determine the heat flux by conduction into or out of the concrete.

- 6.61** Dry air at  $32^\circ\text{C}$  flows over a wetted (water) plate of  $0.2 \text{ m}^2$  area. The average convection coefficient is  $\bar{h} = 20 \text{ W/m}^2 \cdot \text{K}$ , and the heater power required to maintain the plate at a temperature of  $27^\circ\text{C}$  is 432 W. Estimate the power required to maintain the wetted plate at a temperature of  $37^\circ\text{C}$  in dry air at  $32^\circ\text{C}$  if the convection coefficients remain unchanged.


- 6.62** Dry air at 32°C flows over a wetted plate of length 200 mm and width 1 m (case A). An imbedded electrical heater supplies 432 W and the surface temperature is 27°C.

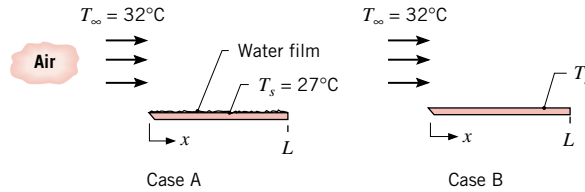

- What is the evaporation rate of water from the plate (kg/h)?
- After a long period of operation, all the water is evaporated from the plate and its surface is dry (case B). For the same free stream conditions and the same heater power as case A, estimate the temperature of the plate,  $T_s$ .

### Evaporative Cooling

- 6.63** A 20-mm diameter sphere is suspended in a dry air stream with a temperature of 22°C. The power supplied to an embedded electrical heater within the sphere is 2.51 W when the surface temperature is 32°C. How much power is required to maintain the sphere at 32°C if its outer surface has a thin porous covering saturated with water? Evaluate the properties of air and the diffusion coefficient of the air–water vapor mixture at 300 K.
- 6.64** A successful California engineer has installed a circular hot tub in his back yard and finds that for the typical operating conditions prescribed below, water must be added at a rate of 0.001 kg/s in order to maintain a fixed water level in the tub.

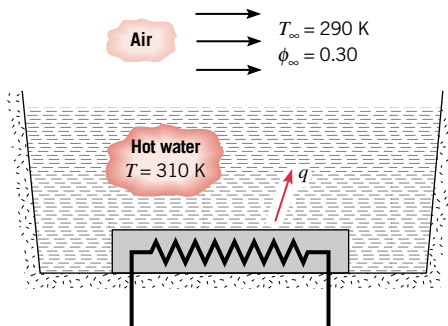

If the tub is well insulated on its sides and bottom and the temperature of the makeup water is equal to that of

the tub water, at what rate must electrical heaters supply energy to maintain the tub water at 310 K?

- 6.65** It is known that on clear nights the air temperature need not drop below 0°C before a thin layer of water on the ground will freeze. Consider such a layer of water on a clear night for which the effective sky temperature is  $-30^\circ\text{C}$  and the convection heat transfer coefficient due to wind motion is  $h = 25\text{ W/m}^2 \cdot \text{K}$ . The water may be assumed to have an emissivity of 1.0 and to be insulated from the ground as far as conduction is concerned.
- Neglecting evaporation, determine the lowest temperature the air can have without the water freezing.
  - For the conditions given, estimate the mass transfer coefficient for water evaporation  $h_m$  (m/s).
  - Accounting now for the effect of evaporation, what is the lowest temperature the air can have without the water freezing? Assume the air to be dry.
- 6.66** An expression for the actual water vapor partial pressure in terms of wet-bulb and dry-bulb temperatures, referred to as the Carrier equation, is given as

$$p_v = p_{gw} - \frac{(p - p_{gw})(T_{db} - T_{wb})}{1810 - T_{wb}}$$

where  $p_v$ ,  $p_{gw}$ , and  $p$  are the actual partial pressure, the saturation pressure at the wet-bulb temperature, and the total pressure (all in bars), while  $T_{db}$  and  $T_{wb}$  are the dry- and wet-bulb temperatures in kelvins. Consider air at 1 atm and 37.8°C flowing over a wet-bulb thermometer that indicates 21.1°C.

- Using Carrier's equation, calculate the partial pressure of the water vapor in the free stream. What is the relative humidity?
  - Refer to a psychrometric chart and obtain the relative humidity directly for the conditions indicated. Compare the result with part (a).
  - Use Equation 6.65 to determine the relative humidity. Compare the result to parts (a) and (b).
- 6.67** A wet-bulb thermometer consists of a mercury-in-glass thermometer covered with a wetted (water) fabric. When suspended in a stream of air, the steady-state thermometer reading indicates the wet-bulb temperature  $T_{wb}$ . Obtain an expression for determining the relative humidity of the air from knowledge of the air temperature ( $T_\infty$ ), the wet-bulb temperature, and appropriate air and water vapor properties. If  $T_\infty = 45^\circ\text{C}$  and  $T_{wb} = 25^\circ\text{C}$ , what is the relative humidity of the airstream?
- 6.68** An industrial process involves evaporation of a thin water film from a contoured surface by heating it from


below and forcing air across it. Laboratory measurements for this surface have provided the following heat transfer correlation:

$$\overline{Nu}_L = 0.43 Re_L^{0.58} Pr^{0.4}$$

The air flowing over the surface has a temperature of 290 K, a velocity of 10 m/s, and is completely dry ( $\phi_\infty = 0$ ). The surface has a length of 1 m and a surface area of 1 m<sup>2</sup>. Just enough energy is supplied to maintain its steady-state temperature at 310 K.

- Determine the heat transfer coefficient and the rate at which the surface loses heat by convection.
- Determine the mass transfer coefficient and the evaporation rate (kg/h) of the water on the surface.
- Determine the rate at which heat must be supplied to the surface for these conditions.


**6.69** A 2-mm-thick layer of water on an electrically heated plate is maintained at a temperature of  $T_w = 340$  K, as dry air at  $T_\infty = 300$  K flows over the surface of the water (case A). The arrangement is in large surroundings that are also at 300 K.

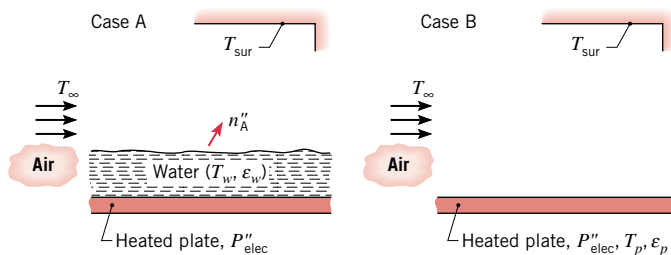

- If the evaporative flux from the surface of the water to the air is  $n''_A = 0.030$  kg/s · m<sup>2</sup>, what is the corresponding value of the convection mass transfer coefficient? How long will it take for the water to completely evaporate?
- What is the corresponding value of the convection heat transfer coefficient and the rate at which electrical power must be supplied per unit area of the plate to maintain the prescribed temperature of the water? Property values of the air are  $\rho = 1.08$  kg/m<sup>3</sup>,  $c_p = 1008$  J/kg · K, and  $k = 0.028$  W/m · K. The binary diffusion coefficient for air and water vapor is  $D_{AB} = 0.29 \times 10^{-4}$  m<sup>2</sup>/s, and the emissivity of water is  $\epsilon_w = 0.95$ .
- If the electrical power determined in part (b) is maintained after complete evaporation of the water (case B), what is the resulting temperature of the plate, whose emissivity is  $\epsilon_p = 0.60$ ?


**6.70** A disk of 20-mm diameter is covered with a water film. Under steady-state conditions, a heater power of

200 mW is required to maintain the disk–water film at 305 K in dry air at 295 K and the observed evaporation rate is  $2.55 \times 10^{-4}$  kg/h.

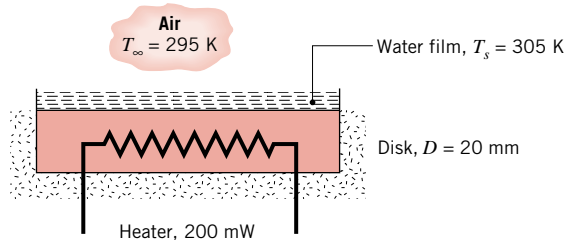

- Calculate the average mass transfer convection coefficient,  $\bar{h}_m$ , for the evaporation process.
- Calculate the average heat transfer convection coefficient,  $\bar{h}$ .
- Do the values of  $\bar{h}_m$  and  $\bar{h}$  satisfy the heat–mass analogy?
- If the relative humidity of the ambient air at 295 K were increased from 0 (dry) to 0.50, but the power supplied to the heater was maintained at 200 mW, would the evaporation rate increase or decrease? Would the disk temperature increase or decrease?

**6.71** An experiment is conducted to determine the average mass transfer convection coefficient of a small droplet using a heater controlled to operate at a constant temperature. The power history required to completely evaporate the droplet at a temperature of 37°C is shown in the sketch. It was observed that, as the droplet dried, its wetted diameter on the heater surface remained nearly constant at a value of 4 mm.

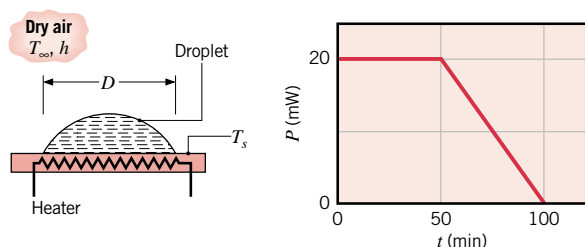

- Calculate the average mass transfer convection coefficient based on the wetted area during the evaporation process when the droplet, heater, and the dry ambient air are at 37°C.
- How much energy will be required to evaporate the droplet if the dry ambient air temperature is 27°C, while the droplet–heater temperature remains at 37°C?

**6.72** It is desired to develop a simple model for predicting the temperature–time history of a plate during the drying

cycle in a dishwasher. Following the wash cycle the plate is at  $T_p(t) = T_p(0) = 65^\circ\text{C}$  and the air in the dishwasher is completely saturated ( $\phi_\infty = 1.0$ ) at  $T_\infty = 55^\circ\text{C}$ . The values of the plate surface area  $A_s$ , mass  $M$ , and specific heat  $c$  are such that  $Mc/A_s = 1600 \text{ J/m}^2 \cdot \text{K}$ .

- (a) Assuming the plate is completely covered by a thin film of water and neglecting the thermal resis-

tances of the film and plate, derive a differential equation for predicting the plate temperature as a function of time.

- (b) For the initial conditions ( $t = 0$ ) estimate the change in plate temperature with time,  $dT/dt$  ( $^\circ\text{C/s}$ ), assuming that the average heat transfer coefficient on the plate is  $3.5 \text{ W/m}^2 \cdot \text{K}$ .



## 6S.1

### *Derivation of the Convection Transfer Equations*

---


In Chapter 2 we considered a stationary substance in which heat is transferred by conduction and developed means for determining the temperature distribution within the substance. We did so by applying *conservation of energy* to a differential control volume (Figure 2.11) and deriving a differential equation that was termed the *heat equation*. For a prescribed geometry and boundary conditions, the equation may be solved to determine the corresponding temperature distribution.

If the substance is not stationary, conditions become more complex. For example, if conservation of energy is applied to a differential control volume in a moving fluid, the effects of fluid motion (*advection*) on energy transfer across the surfaces of the control volume must be considered, along with those of conduction. The resulting differential equation, which provides the basis for predicting the temperature distribution, now requires knowledge of the velocity field. This field must, in turn, be determined by solving additional differential equations derived by applying *conservation of mass* and *Newton's second law of motion* to a differential control volume.

In this supplemental material we consider conditions involving flow of a *viscous fluid* in which there is concurrent *heat* and *mass transfer*. Our objective is to develop differential equations that may be used to predict velocity, temperature, and species concentration fields within the fluid, and we do so by applying Newton's second law of motion and conservation of mass, energy, and species to a differential control volume. To simplify this development, we restrict our attention to *steady, two-dimensional flow* in the  $x$  and  $y$  directions of a Cartesian coordinate system. A unit depth may therefore be assigned to the  $z$  direction, thereby providing a differential control volume of extent  $(dx \cdot dy \cdot 1)$ .

#### 6S.1.1 Conservation of Mass

One conservation law that is pertinent to the flow of a viscous fluid is that matter may neither be created nor destroyed. Stated in the context of the differential control volume of Figure 6S.1, this law requires that, for steady flow, *the net rate at which mass enters the control volume* (inflow – outflow) *must equal zero*. Mass enters and leaves the control volume exclusively through gross fluid motion. Transport due to such motion is often referred to as *advection*. If one corner of the control volume is located at  $(x, y)$ , the rate at which mass enters the control volume through the surface perpendicular to  $x$  may be expressed as  $(\rho u) dy$ , where  $\rho$  is the total mass density ( $\rho = \rho_A + \rho_B$ ) and  $u$  is the  $x$  component of the *mass average velocity*. The control volume is of unit depth in the  $z$  direction. Since  $\rho$  and  $u$  may vary with  $x$ , the

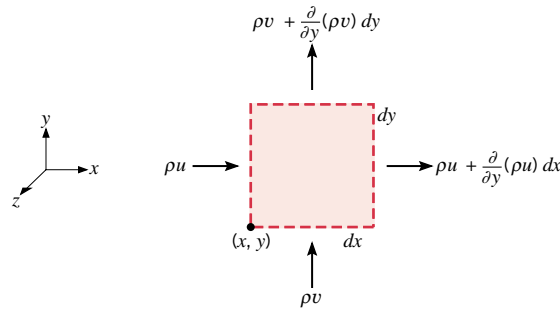

**FIGURE 6S.1**  
Differential control volume  
( $\mathbf{dx} \cdot \mathbf{dy} \cdot \mathbf{1}$ ) for mass  
conservation in two-dimensional  
flow of a viscous fluid.

rate at which mass leaves the surface at  $x + dx$  may be expressed by a Taylor series expansion of the form

$$\left[ (\rho u) + \frac{\partial(\rho u)}{\partial x} dx \right] dy$$

Using a similar result for the  $y$  direction, the conservation of mass requirement becomes

$$(\rho u) dy + (\rho v) dx - \left[ \rho u + \frac{\partial(\rho u)}{\partial x} dx \right] dy - \left[ \rho v + \frac{\partial(\rho v)}{\partial y} dy \right] dx = 0$$

Canceling terms and dividing by  $dx dy$ , we obtain

$$\frac{\partial(\rho u)}{\partial x} + \frac{\partial(\rho v)}{\partial y} = 0 \quad (6S.1)$$


Equation 6S.1, the *continuity equation*, is a general expression of the *overall mass* conservation requirement, and it must be satisfied at every point in the fluid. The equation applies for a single species fluid, as well as for mixtures in which species diffusion and chemical reactions may be occurring. If the fluid is *incompressible*, the density  $\rho$  is a constant, and the continuity equation reduces to

$$\frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} = 0 \quad (6S.2)$$

### 6S.1.2 Newton's Second Law of Motion

The second fundamental law that is pertinent to the flow of a viscous fluid is *Newton's second law of motion*. For a differential control volume in the fluid, this requirement states that the sum of all forces acting on the control volume must equal the net rate at which momentum leaves the control volume (outflow – inflow).

Two kinds of forces may act on the fluid: *body forces*, which are proportional to the volume, and *surface forces*, which are proportional to area. Gravitational, centrifugal, magnetic, and/or electric fields may contribute to the total body force, and we designate the  $x$  and  $y$  components of this force per unit volume of fluid as  $X$  and  $Y$ , respectively. The surface forces  $F_s$  are due to the fluid static pressure as well as to *viscous stresses*. At any point in the fluid, the viscous stress (a force per unit area)

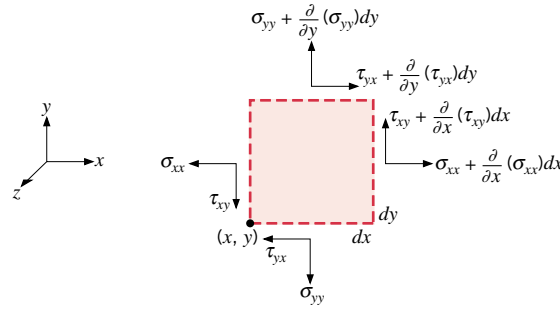

**FIGURE 6S.2**

Normal and shear viscous stresses for a differential control volume ( $dx \cdot dy \cdot 1$ ) in two-dimensional flow of a viscous fluid.

may be resolved into two perpendicular components, which include a *normal stress*  $\sigma_{ii}$  and a *shear stress*  $\tau_{ij}$  (Figure 6S.2).

A double subscript notation is used to specify the stress components. The first subscript indicates the surface orientation by providing the direction of its outward normal, and the second subscript indicates the direction of the force component. Accordingly, for the  $x$  surface of Figure 6S.2, the normal stress  $\sigma_{xx}$  corresponds to a force component normal to the surface, and the shear stress  $\tau_{xy}$  corresponds to a force in the  $y$  direction along the surface. All the stress components shown are positive in the sense that *both* the surface normal and the force component are in the same direction. That is, they are both in either the positive coordinate direction or the negative coordinate direction. By this convention the normal viscous stresses are *tensile stresses*. In contrast the static pressure originates from an external force acting on the fluid in the control volume and is therefore a *compressive stress*.

Several features of the viscous stress should be noted. The associated force is between adjoining fluid elements and is a natural consequence of the fluid motion and viscosity. The surface forces of Figure 6S.2 are therefore presumed to act on the fluid within the control volume and are attributed to its interaction with the surrounding fluid. These stresses would vanish if the fluid velocity, or the velocity gradient, went to zero. In this respect the normal viscous stresses ( $\sigma_{xx}$  and  $\sigma_{yy}$ ) must not be confused with the static pressure, which does not vanish for zero velocity.

Each of the stresses may change continuously in each of the coordinate directions. Using a Taylor series expansion for the stresses, the *net* surface force for each of the two directions may be expressed as

$$F_{s,x} = \left( \frac{\partial \sigma_{xx}}{\partial x} - \frac{\partial p}{\partial x} + \frac{\partial \tau_{yx}}{\partial y} \right) dx dy \quad (6S.3)$$

$$F_{s,y} = \left( \frac{\partial \tau_{xy}}{\partial x} + \frac{\partial \sigma_{yy}}{\partial y} - \frac{\partial p}{\partial y} \right) dx dy \quad (6S.4)$$

To use Newton's second law, the fluid momentum fluxes for the control volume must also be evaluated. If we focus on the  $x$ -direction, the relevant fluxes are as shown in Figure 6S.3. A contribution to the total  $x$ -momentum flux is made by the mass flow in each of the two directions. For example, the mass flux through the  $x$  surface (in the  $y$ - $z$  plane) is  $(\rho u)$ , the corresponding  $x$ -momentum flux is  $(\rho u)u$ . Similarly, the  $x$ -momentum flux due to mass flow through the  $y$  surface (in the  $x$ - $z$



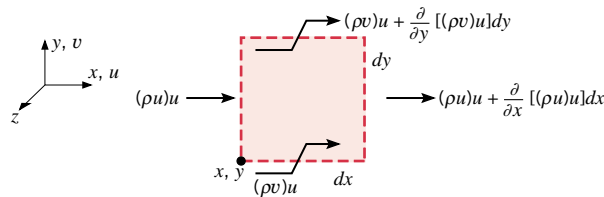


FIGURE 6S.3

Momentum fluxes for a differential control volume ( $\mathbf{dx} \cdot \mathbf{dy} \cdot \mathbf{1}$ ) in two-dimensional flow of a viscous fluid.

plane) is  $(\rho v)u$ . These fluxes may change in each of the coordinate directions, and the *net* rate at which  $x$  momentum leaves the control volume is

$$\frac{\partial[(\rho u)u]}{\partial x} dx (dy) + \frac{\partial[(\rho v)u]}{\partial y} dy (dx)$$

Equating the rate of change in the  $x$  momentum of the fluid to the sum of the forces in the  $x$  direction, we then obtain

$$\frac{\partial[(\rho u)u]}{\partial x} + \frac{\partial[(\rho v)u]}{\partial y} = \frac{\partial \sigma_{xx}}{\partial x} - \frac{\partial p}{\partial x} + \frac{\partial \tau_{yx}}{\partial y} + X \quad (6S.5)$$

This expression may be put in a more convenient form by expanding the derivatives on the left-hand side and substituting from the continuity equation, Equation 6S.1, giving

$$\rho \left( u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} \right) = \frac{\partial}{\partial x} (\sigma_{xx} - p) + \frac{\partial \tau_{yx}}{\partial y} + X \quad (6S.6)$$


A similar expression may be obtained for the  $y$  direction and is of the form

$$\rho \left( u \frac{\partial v}{\partial x} + v \frac{\partial v}{\partial y} \right) = \frac{\partial \tau_{xy}}{\partial x} + \frac{\partial}{\partial y} (\sigma_{yy} - p) + Y \quad (6S.7)$$

We should not lose sight of the physics represented by Equations 6S.6 and 6S.7. The two terms on the left-hand side of each equation represent the *net* rate of momentum flow from the control volume. The terms on the right-hand side account for the net viscous and pressure forces, as well as the body force. These equations must be satisfied at each point in the fluid, and with Equation 6S.1 they may be solved for the velocity field.

Before a solution to the foregoing equations can be obtained, it is necessary to relate the viscous stresses to other flow variables. These stresses are associated with the deformation of the fluid and are a function of the fluid viscosity and velocity gradients. From Figure 6S.4 it is evident that a *normal stress* must produce a *linear deformation* of the fluid, whereas a *shear stress* produces an *angular deformation*. Moreover, the magnitude of a stress is proportional to the *rate* at which the deformation occurs. The deformation rate is, in turn, related to the fluid viscosity and to the velocity gradients in the flow. For a *Newtonian fluid*<sup>1</sup> the stresses are proportional to

<sup>1</sup>A Newtonian fluid is one for which the shear stress is linearly proportional to the rate of angular deformation. All fluids of interest in the text are Newtonian.

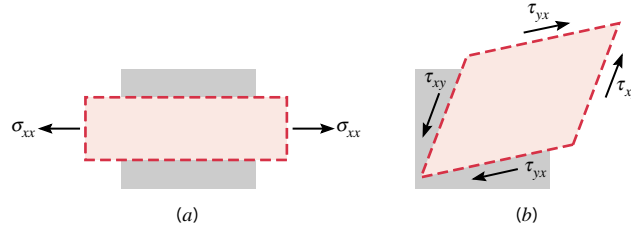

**FIGURE 6S.4**

Deformations of a fluid element due to viscous stresses.

(a) Linear deformation due to a normal stress. (b) Angular deformation due to shear stresses.

the velocity gradients, where the proportionality constant is the fluid viscosity. Because of its complexity, however, development of the specific relations is left to the literature [1], and we limit ourselves to a presentation of the results. In particular, it has been shown that

$$\sigma_{xx} = 2\mu \frac{\partial u}{\partial x} - \frac{2}{3}\mu \left( \frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} \right) \quad (6S.8)$$

$$\sigma_{yy} = 2\mu \frac{\partial v}{\partial y} - \frac{2}{3}\mu \left( \frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} \right) \quad (6S.9)$$

$$\tau_{xy} = \tau_{yx} = \mu \left( \frac{\partial u}{\partial y} + \frac{\partial v}{\partial x} \right) \quad (6S.10)$$

Substituting Equations 6S.8 through 6S.10 into Equations 6S.6 and 6S.7, the  $x$ - and  $y$ -momentum equations become

$$\begin{aligned} \rho \left( u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} \right) = & -\frac{\partial p}{\partial x} + \frac{\partial}{\partial x} \left\{ \mu \left[ 2 \frac{\partial u}{\partial x} - \frac{2}{3} \left( \frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} \right) \right] \right\} \\ & + \frac{\partial}{\partial y} \left[ \mu \left( \frac{\partial u}{\partial y} + \frac{\partial v}{\partial x} \right) \right] + X \end{aligned} \quad (6S.11)$$

$$\begin{aligned} \rho \left( u \frac{\partial v}{\partial x} + v \frac{\partial v}{\partial y} \right) = & -\frac{\partial p}{\partial y} + \frac{\partial}{\partial y} \left\{ \mu \left[ 2 \frac{\partial v}{\partial y} - \frac{2}{3} \left( \frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} \right) \right] \right\} \\ & + \frac{\partial}{\partial x} \left[ \mu \left( \frac{\partial u}{\partial y} + \frac{\partial v}{\partial x} \right) \right] + Y \end{aligned} \quad (6S.12)$$

Equations 6S.1, 6S.11, and 6S.12 provide a complete representation of conditions in a two-dimensional viscous flow, and the corresponding velocity field may be determined by solving the equations. Once the velocity field is known, it is a simple matter to obtain the wall shear stress  $\tau_s$  from Equation 6.2.

Equations 6S.11 and 6S.12 may be simplified for an *incompressible fluid of constant viscosity*. Rearranging the right-hand side of each expression and substituting from Equation 6S.2, the  $x$ - and  $y$ -momentum equations become

$$\rho \left( u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} \right) = -\frac{\partial p}{\partial x} + \mu \left( \frac{\partial^2 u}{\partial x^2} + \frac{\partial^2 u}{\partial y^2} \right) + X \quad (6S.13)$$

$$\rho \left( u \frac{\partial v}{\partial x} + v \frac{\partial v}{\partial y} \right) = - \frac{\partial p}{\partial y} + \mu \left( \frac{\partial^2 v}{\partial x^2} + \frac{\partial^2 v}{\partial y^2} \right) + Y \quad (6S.14)$$

### 6S.1.3 Conservation of Energy


To apply the energy conservation requirement (Equation 1.11c) to a differential control volume in a viscous fluid with heat transfer (Figure 6S.5), it is necessary to first delineate the relevant physical processes. If potential energy effects are treated as work done by the body forces, the energy per unit mass of the fluid includes the thermal internal energy  $e$  and the kinetic energy  $V^2/2$ , where  $V^2 \equiv u^2 + v^2$ . Accordingly, thermal and kinetic energy are *advected* with the *bulk fluid* motion across the control surfaces, and for the  $x$ -direction, the *net* rate at which this energy *enters* the control volume is

$$\begin{aligned} \dot{E}_{\text{adv},x} - \dot{E}_{\text{adv},x+dx} &\equiv \rho u \left( e + \frac{V^2}{2} \right) dy - \left\{ \rho u \left( e + \frac{V^2}{2} \right) \right. \\ &\quad \left. + \frac{\partial}{\partial x} \left[ \rho u \left( e + \frac{V^2}{2} \right) \right] dx \right\} dy \\ &= - \frac{\partial}{\partial x} \left[ \rho u \left( e + \frac{V^2}{2} \right) \right] dx dy \end{aligned} \quad (6S.15)$$

Energy is also transferred across the control surface by *molecular processes*. There may be two contributions: that due to *conduction* and energy transfer due to the *diffusion of species A and B*. However, it is only in chemically reacting flows that species diffusion strongly influences thermal conditions. Hence the effect is neglected in this development. For the conduction process, the *net* transfer of energy into the control volume is

$$\begin{aligned} \dot{E}_{\text{cond},x} - \dot{E}_{\text{cond},x+dx} &= - \left( k \frac{\partial T}{\partial x} \right) dy - \left[ -k \frac{\partial T}{\partial x} - \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) dx \right] dy \\ &= \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) dx dy \end{aligned} \quad (6S.16)$$

Energy may also be transferred to and from the fluid in the control volume by *work* interactions involving the *body* and *surface forces*. The *net* rate at which work is done on the fluid by forces in the  $x$ -direction may be expressed as

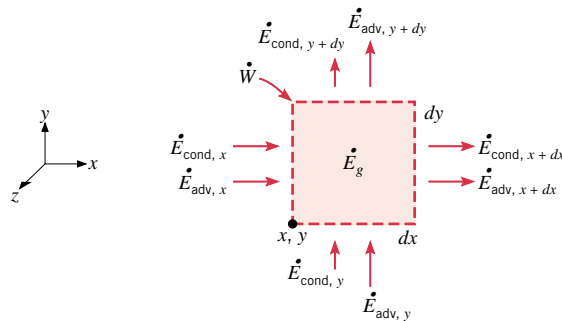

**FIGURE 6S.5**

Differential control volume ( $dx \cdot dy \cdot 1$ ) for energy conservation in two-dimensional flow of a viscous fluid with heat transfer.

$$\dot{W}_{\text{net},x} = (Xu) dx dy + \frac{\partial}{\partial x} [(\sigma_{xx} - p)u] dx dy + \frac{\partial}{\partial y} (\tau_{yx}u) dx dy \quad (6S.17)$$

The first term on the right-hand side of Equation 6S.17 represents the work done by the body force, and the remaining terms account for the *net* work done by the pressure and viscous forces.

Using Equations 6S.15 through 6S.17, as well as analogous equations for the y-direction, the energy conservation requirement (Equation 1.11c) may be expressed as

$$\begin{aligned} & -\frac{\partial}{\partial x} \left[ \rho u \left( e + \frac{V^2}{2} \right) \right] - \frac{\partial}{\partial y} \left[ \rho v \left( e + \frac{V^2}{2} \right) \right] \\ & + \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) + (Xu + Yv) - \frac{\partial}{\partial x} (pu) - \frac{\partial}{\partial y} (pv) \\ & + \frac{\partial}{\partial x} (\sigma_{xx}u + \tau_{xy}v) + \frac{\partial}{\partial y} (\tau_{yx}u + \sigma_{yy}v) + \dot{q} = 0 \end{aligned} \quad (6S.18)$$

where  $\dot{q}$  is the rate at which thermal energy is generated per unit volume. This expression provides a general form of the energy conservation requirement for flow of a viscous fluid with heat transfer.

Because Equation 6S.18 represents conservation of *kinetic* and *thermal internal* energy, it is rarely used in solving heat transfer problems. Instead, a more convenient form, which is termed the *thermal energy equation*, is obtained by multiplying Equations 6S.6 and 6S.7 by  $u$  and  $v$ , respectively, and subtracting the results from Equation 6S.18. After considerable manipulation, it follows that [2]

$$\rho u \frac{\partial e}{\partial x} + \rho v \frac{\partial e}{\partial y} = \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) - p \left( \frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} \right) + \mu \Phi + \dot{q} \quad (6S.19)$$

where the term  $p(\partial u/\partial x + \partial v/\partial y)$  represents a reversible conversion between mechanical work and thermal energy, and  $\mu \Phi$ , the *viscous dissipation*, is defined as

$$\mu \Phi \equiv \mu \left\{ \left( \frac{\partial u}{\partial y} + \frac{\partial v}{\partial x} \right)^2 + 2 \left[ \left( \frac{\partial u}{\partial x} \right)^2 + \left( \frac{\partial v}{\partial y} \right)^2 \right] - \frac{2}{3} \left( \frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} \right)^2 \right\} \quad (6S.20)$$

The first term on the right-hand side of Equation 6S.20 originates from the viscous shear stresses, and the remaining terms arise from the viscous normal stresses. Collectively, the terms account for the rate at which *mechanical work is irreversibly converted to thermal energy due to viscous effects in the fluid*.

If the fluid is incompressible, Equations 6S.19 and 6S.20 may be simplified by substituting Equation 6S.2. Moreover, with  $de = c_v dT$  and  $c_v = c_p$  for an incompressible fluid, the thermal energy equation may then be expressed as

$$\rho c_p \left( u \frac{\partial T}{\partial x} + v \frac{\partial T}{\partial y} \right) = \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) + \mu \Phi + \dot{q} \quad (6S.21)$$

where

$$\mu \Phi = \mu \left\{ \left( \frac{\partial u}{\partial y} + \frac{\partial v}{\partial x} \right)^2 + 2 \left[ \left( \frac{\partial u}{\partial x} \right)^2 + \left( \frac{\partial v}{\partial y} \right)^2 \right] \right\} \quad (6S.22)$$

The thermal energy equation may also be cast in terms of the fluid enthalpy  $i$ , instead of its internal energy  $e$ . Introducing the definition of the enthalpy,

$$i = e + \frac{p}{\rho} \quad (6S.23)$$

and using Equation 6S.1 to replace the third term on the right-hand side of Equation 6S.19 by spatial derivatives of  $p$  and  $(p/\rho)$ , the energy equation may be expressed as [2]

$$\rho u \frac{\partial i}{\partial x} + \rho v \frac{\partial i}{\partial y} = \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) + \left( u \frac{\partial p}{\partial x} + v \frac{\partial p}{\partial y} \right) + \mu \Phi + \dot{q} \quad (6S.24)$$

If the fluid may be approximated as a *perfect gas*,  $di = c_p dT$ , Equation 6S.24 becomes

$$\rho c_p \left( u \frac{\partial T}{\partial x} + v \frac{\partial T}{\partial y} \right) = \frac{\partial}{\partial x} \left( k \frac{\partial T}{\partial x} \right) + \frac{\partial}{\partial y} \left( k \frac{\partial T}{\partial y} \right) + \left( u \frac{\partial p}{\partial x} + v \frac{\partial p}{\partial y} \right) + \mu \Phi + \dot{q} \quad (6S.25)$$


## 6S.1.4

### Conservation of Species

If the viscous fluid consists of a binary mixture in which there are species concentration gradients (Figure 6.9), there will be *relative* transport of the species, and *species conservation* must be satisfied at each point in the fluid. The pertinent form of the conservation equation may be obtained by identifying the processes that affect the *transport* and *generation* of species A for a differential control volume in the fluid.

Consider the control volume of Figure 6S.6. Species A may be transported by *advection* (with the mean velocity of the mixture) and by *diffusion* (relative to the mean motion) in each of the coordinate directions. The concentration may also be affected by chemical reactions, and we designate the rate at which the mass of species A is generated per unit volume due to such reactions as  $\dot{n}_A$ .

The *net* rate at which species A *enters* the control volume due to *advection* in the  $x$ -direction is

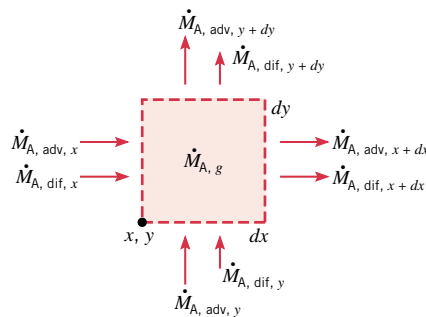

**FIGURE 6S.6**

Differential control volume ( $dx \cdot dy \cdot 1$ ) for species conservation in two-dimensional flow of a viscous fluid with mass transfer.

$$\begin{aligned}\dot{M}_{A,\text{adv},x} - \dot{M}_{A,\text{adv},x+dx} &= (\rho_A u) dy - \left[ (\rho_A u) + \frac{\partial(\rho_A u)}{\partial x} dx \right] dy \\ &= -\frac{\partial(\rho_A u)}{\partial x} dx dy\end{aligned}\quad (6S.26)$$

Similarly, multiplying both sides of Fick's law (Equation 6.6) by the molecular weight  $\mathcal{M}_A$  (kg/kmol) of species A to evaluate the diffusion flux, the *net* rate at which species A *enters* the control volume due to *diffusion* in the  $x$ -direction is

$$\begin{aligned}\dot{M}_{A,\text{dif},x} - \dot{M}_{A,\text{dif},x+dx} &= \left( -D_{AB} \frac{\partial \rho_A}{\partial x} \right) dy - \left[ \left( -D_{AB} \frac{\partial \rho_A}{\partial x} \right) \right. \\ &\quad \left. + \frac{\partial}{\partial x} \left( -D_{AB} \frac{\partial \rho_A}{\partial x} \right) dx \right] dy = \frac{\partial}{\partial x} \left( D_{AB} \frac{\partial \rho_A}{\partial x} \right) dx dy\end{aligned}\quad (6S.27)$$

Expressions similar to Equations 6S.26 and 6S.27 may be formulated for the  $y$ -direction.

Referring to Figure 6S.6, the species conservation requirement is

$$\begin{aligned}\dot{M}_{A,\text{adv},x} - \dot{M}_{A,\text{adv},x+dx} + \dot{M}_{A,\text{adv},y} - \dot{M}_{A,\text{adv},y+dy} \\ + \dot{M}_{A,\text{dif},x} - \dot{M}_{A,\text{dif},x+dx} + \dot{M}_{A,\text{dif},y} - \dot{M}_{A,\text{dif},y+dy} + \dot{M}_{A,g} = 0\end{aligned}\quad (6S.28)$$

Substituting from Equations 6S.26 and 6S.27, as well as from similar forms for the  $y$ -direction, it follows that

$$\frac{\partial(\rho_A u)}{\partial x} + \frac{\partial(\rho_A v)}{\partial y} = \frac{\partial}{\partial x} \left( D_{AB} \frac{\partial \rho_A}{\partial x} \right) + \frac{\partial}{\partial y} \left( D_{AB} \frac{\partial \rho_A}{\partial y} \right) + \dot{n}_A \quad (6S.29)$$

A more useful form of this equation may be obtained by expanding the terms on the left-hand side and substituting from the overall continuity equation for an incompressible fluid. Equation 6S.29 then reduces to

$$u \frac{\partial \rho_A}{\partial x} + v \frac{\partial \rho_A}{\partial y} = \frac{\partial}{\partial x} \left( D_{AB} \frac{\partial \rho_A}{\partial x} \right) + \frac{\partial}{\partial y} \left( D_{AB} \frac{\partial \rho_A}{\partial y} \right) + \dot{n}_A \quad (6S.30)$$

or in molar form

$$u \frac{\partial C_A}{\partial x} + v \frac{\partial C_A}{\partial y} = \frac{\partial}{\partial x} \left( D_{AB} \frac{\partial C_A}{\partial x} \right) + \frac{\partial}{\partial y} \left( D_{AB} \frac{\partial C_A}{\partial y} \right) + \dot{N}_A \quad (6S.31)$$

### EXAMPLE 6S.1

One of the few situations for which *exact* solutions to the convection transfer equations may be obtained involves what is termed *parallel flow*. In this case fluid motion is only in one direction. Consider a special case of parallel flow involving stationary and moving plates of infinite extent separated by a distance  $L$ , with the intervening space filled by an incompressible fluid. This situation is referred to as Couette flow and occurs, for example, in a journal bearing.

1. What is the appropriate form of the continuity equation (Equation D.1)?
2. Beginning with the momentum equation (Equation D.2), determine the velocity distribution between the plates.


- Beginning with the energy equation (Equation D.4), determine the temperature distribution between the plates.
- Consider conditions for which the fluid is engine oil with  $L = 3$  mm. The speed of the moving plate is  $U = 10$  m/s, and the temperatures of the stationary and moving plates are  $T_0 = 10^\circ\text{C}$  and  $T_L = 30^\circ\text{C}$ , respectively. Calculate the heat flux to each of the plates and determine the maximum temperature in the oil.

**SOLUTION**

**Known:** Couette flow with heat transfer.

**Find:**

- Form of the continuity equation.
- Velocity distribution.
- Temperature distribution.
- Surface heat fluxes and maximum temperature for prescribed conditions.

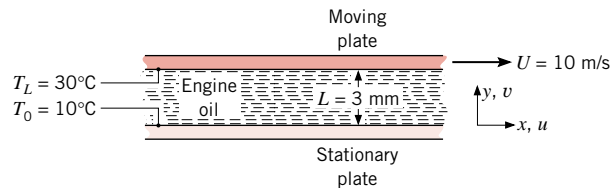**Schematic:****Assumptions:**

- Steady-state conditions.
- Two-dimensional flow (no variations in  $z$ ).
- Incompressible fluid with constant properties.
- No body forces.
- No internal energy generation.

**Properties:** Table A.8, engine oil ( $20^\circ\text{C}$ ):  $\rho = 888.2$  kg/m<sup>3</sup>,  $k = 0.145$  W/m · K,  $\nu = 900 \times 10^{-6}$  m<sup>2</sup>/s,  $\mu = \nu\rho = 0.799$  N · s/m<sup>2</sup>.

**Analysis:**

- For an incompressible fluid (constant  $\rho$ ) and parallel flow ( $v = 0$ ), Equation D.1 reduces to

$$\frac{\partial u}{\partial x} = 0$$

The important implication of this result is that, although depending on  $y$ , the  $x$  velocity component  $u$  is independent of  $x$ . It may then be said that the velocity field is *fully developed*.

- For two-dimensional, steady-state conditions with  $v = 0$ ,  $(\partial u / \partial x) = 0$ , and  $X = 0$ , Equation D.2 reduces to

$$0 = -\frac{\partial p}{\partial x} + \mu \left( \frac{\partial^2 u}{\partial y^2} \right)$$

However, in Couette flow, motion of the fluid is not sustained by the pressure gradient,  $\partial p/\partial x$ , but by an external force that provides for motion of the top plate relative to the bottom plate. Hence  $(\partial p/\partial x) = 0$ . Accordingly, the  $x$ -momentum equation reduces to

$$\frac{\partial^2 u}{\partial y^2} = 0$$

The desired velocity distribution may be obtained by solving this equation. Integrating twice, we obtain

$$u(y) = C_1 y + C_2$$

where  $C_1$  and  $C_2$  are the constants of integration. Applying the boundary conditions

$$u(0) = 0 \quad u(L) = U$$

it follows that  $C_2 = 0$  and  $C_1 = U/L$ . The velocity distribution is then

$$u(y) = \frac{y}{L} U$$

3. The energy equation (D.4) may be simplified for the prescribed conditions. In particular, with  $v = 0$ ,  $(\partial u/\partial x) = 0$ , and  $\dot{q} = 0$ , it follows that

$$\rho c_p u \frac{\partial T}{\partial x} = k \frac{\partial^2 T}{\partial x^2} + k \frac{\partial^2 T}{\partial y^2} + \mu \left( \frac{\partial u}{\partial y} \right)^2$$

However, because the top and bottom plates are at uniform temperatures, the temperature field must also be fully developed, in which case  $(\partial T/\partial x) = 0$ . The appropriate form of the energy equation is then

$$0 = k \frac{\partial^2 T}{\partial y^2} + \mu \left( \frac{\partial u}{\partial y} \right)^2$$

The desired temperature distribution may be obtained by solving this equation. Rearranging and substituting for the velocity distribution,

$$k \frac{d^2 T}{dy^2} = -\mu \left( \frac{du}{dy} \right)^2 = -\mu \left( \frac{U}{L} \right)^2$$

Integrating twice, we obtain

$$T(y) = -\frac{\mu}{2k} \left( \frac{U}{L} \right)^2 y^2 + C_3 y + C_4$$

The constants of integration may be obtained from the boundary conditions

$$T(0) = T_0 \quad T(L) = T_L$$

in which case

$$C_4 = T_0 \quad \text{and} \quad C_3 = \frac{T_L - T_0}{L} + \frac{\mu}{2k} \frac{U^2}{L}$$

and

$$T(y) = T_0 + \frac{\mu}{2k} U^2 \left[ \frac{y}{L} - \left( \frac{y}{L} \right)^2 \right] + (T_L - T_0) \frac{y}{L}$$



4. Knowing the temperature distribution, the surface heat fluxes may be obtained by applying Fourier's law. Hence

$$q_y'' = -k \frac{dT}{dy} = -k \left[ \frac{\mu}{2k} U^2 \left( \frac{1}{L} - \frac{2y}{L^2} \right) + \frac{T_L - T_0}{L} \right]$$

At the bottom and top surfaces, respectively, it follows that

$$q_0'' = -\frac{\mu U^2}{2L} - \frac{k}{L} (T_L - T_0) \quad \text{and} \quad q_L'' = +\frac{\mu U^2}{2L} - \frac{k}{L} (T_L - T_0)$$

Hence, for the prescribed numerical values,

$$q_0'' = -\frac{0.799 \text{ N} \cdot \text{s/m}^2 \times 100 \text{ m}^2/\text{s}^2}{2 \times 3 \times 10^{-3} \text{ m}} - \frac{0.145 \text{ W/m} \cdot \text{K}}{3 \times 10^{-3} \text{ m}} (30 - 10)^\circ\text{C}$$

$$q_0'' = -13,315 \text{ W/m}^2 - 967 \text{ W/m}^2 = -14.3 \text{ kW/m}^2 \quad \triangleleft$$

$$q_L'' = +13,315 \text{ W/m}^2 - 967 \text{ W/m}^2 = 12.3 \text{ kW/m}^2 \quad \triangleleft$$

The location of the maximum temperature in the oil may be found from the requirement that

$$\frac{dT}{dy} = \frac{\mu}{2k} U^2 \left( \frac{1}{L} - \frac{2y}{L^2} \right) + \frac{T_L - T_0}{L} = 0$$

Solving for  $y$ , it follows that

$$y_{\max} = \left[ \frac{k}{\mu U^2} (T_L - T_0) + \frac{1}{2} \right] L$$

or for the prescribed conditions


$$y_{\max} = \left[ \frac{0.145 \text{ W/m} \cdot \text{K}}{0.799 \text{ N} \cdot \text{s/m}^2 \times 100 \text{ m}^2/\text{s}^2} (30 - 10)^\circ\text{C} + \frac{1}{2} \right] L = 0.536L$$

Substituting the value of  $y_{\max}$  into the expression for  $T(y)$ ,

$$T_{\max} = 89.2^\circ\text{C} \quad \triangleleft$$

### Comments:

1. Given the strong effect of viscous dissipation for the prescribed conditions, the maximum temperature occurs in the oil and there is heat transfer to the hot, as well as to the cold, plate. The temperature distribution is a function of the velocity of the moving plate, and the effect is shown schematically below.



For velocities less than  $U_1$  the maximum temperature corresponds to that of the hot plate. For  $U = 0$  there is no viscous dissipation, and the temperature distribution is linear.

2. Recognize that the properties were evaluated at  $\bar{T} = (T_L + T_0)/2 = 20^\circ\text{C}$ , which is *not* a good measure of the average oil temperature. For more precise calculations, the properties should be evaluated at a more appropriate value of the average temperature (e.g.,  $\bar{T} \approx 55^\circ\text{C}$ ), and the calculations should be repeated.


## References

1. Schlichting, H., *Boundary Layer Theory*, 7th ed., McGraw-Hill, New York, 1979.
2. Bird, R. B., W. E. Stewart, and E. N. Lightfoot, *Transport Phenomena*, Wiley, New York, 1966.

## Problems

### Conservation Equations and Solutions


- 6S.1** Consider the control volume shown for the special case of steady-state conditions with  $v = 0$ ,  $T = T(y)$ , and  $\rho = \text{const}$ .



- (a) Prove that  $u = u(y)$  if  $v = 0$  everywhere.
  - (b) Derive the  $x$ -momentum equation and simplify it as much as possible.
  - (c) Derive the energy equation and simplify it as much as possible.
- 6S.2** Consider a lightly loaded journal bearing using oil having the constant properties  $\mu = 10^{-2} \text{ kg/s} \cdot \text{m}$  and  $k = 0.15 \text{ W/m} \cdot \text{K}$ . If the journal and the bearing are each maintained at a temperature of  $40^\circ\text{C}$ , what is the maximum temperature in the oil when the journal is rotating at  $10 \text{ m/s}$ ?
- 6S.3** Consider a lightly loaded journal bearing using oil having the constant properties  $\rho = 800 \text{ kg/m}^3$ ,  $\nu = 10^{-5} \text{ m}^2/\text{s}$ , and  $k = 0.13 \text{ W/m} \cdot \text{K}$ . The journal diameter is  $75 \text{ mm}$ ; the clearance is  $0.25 \text{ mm}$ ; and the bearing operates at  $3600 \text{ rpm}$ .
- (a) Determine the temperature distribution in the oil film assuming that there is no heat transfer into the journal and that the bearing surface is maintained at  $75^\circ\text{C}$ .
  - (b) What is the rate of heat transfer from the bearing, and how much power is needed to rotate the journal?
- 6S.4** Consider two large (infinite) parallel plates,  $5 \text{ mm}$  apart. One plate is stationary, while the other plate is moving at a speed of  $200 \text{ m/s}$ . Both plates are maintained at  $27^\circ\text{C}$ . Consider two cases, one for which the plates are separated by water and the other for which the plates are separated by air.
- (a) For each of the two fluids, what is the force per unit surface area required to maintain the above condition? What is the corresponding power requirement?
  - (b) What is the viscous dissipation associated with each of the two fluids?
  - (c) What is the maximum temperature in each of the two fluids?
- 6S.5** A judgment concerning the influence of viscous dissipation in forced convection heat transfer may be made by calculating the quantity  $Pr \cdot Ec$ , where the Prandtl number  $Pr = c_p \mu / k$  and the Eckert number  $Ec = U^2 / c_p \Delta T$  are *dimensionless groups*. The characteristic velocity and temperature difference of the problem are designated as  $U$  and  $\Delta T$ , respectively. If  $Pr \cdot Ec \ll 1$ , dissipation effects may be neglected. Consider Couette flow for which one plate moves at  $10 \text{ m/s}$  and a temperature difference of  $25^\circ\text{C}$  is maintained between the plates. Evaluating properties at  $27^\circ\text{C}$ , determine the value of  $Pr \cdot Ec$  for air, water, and engine oil. What is the value of  $Pr \cdot Ec$  for air if the plate is moving at the sonic velocity?


**6S.6** Consider Couette flow for which the moving plate is maintained at a uniform temperature and the stationary plate is insulated. Determine the temperature of the insulated plate, expressing your result in terms of fluid properties and the temperature and speed of the moving plate. Obtain an expression for the heat flux at the moving plate.

**6S.7** Consider Couette flow with heat transfer for which the lower plate (mp) moves with a speed of  $U = 5$  m/s and is perfectly insulated. The upper plate (sp) is stationary and is made of a material with thermal conductivity  $k_{sp} = 1.5$  W/m · K and thickness  $L_{sp} = 3$  mm. Its outer surface is maintained at  $T_{sp} = 40^\circ\text{C}$ . The plates are separated by a distance  $L_o = 5$  mm, which is filled with an engine oil of viscosity  $\mu = 0.799$  N · s/m<sup>2</sup> and thermal conductivity  $k_o = 0.145$  W/m · K.

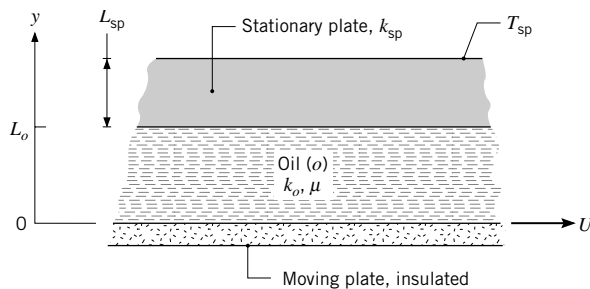

- On  $T(y)$ - $y$  coordinates, sketch the temperature distribution in the oil film and the moving plate.
- Obtain an expression for the temperature at the lower surface of the oil film,  $T(0) = T_o$ , in terms of the plate speed  $U$ , the stationary plate parameters ( $T_{sp}$ ,  $k_{sp}$ ,  $L_{sp}$ ) and the oil parameters ( $\mu$ ,  $k_o$ ,  $L_o$ ). Calculate this temperature for the prescribed conditions.

**6S.8** A shaft with a diameter of 100 mm rotates at 9000 rpm in a journal bearing that is 70 mm long. A uniform lubricant gap of 1 mm separates the shaft and the bearing. The lubricant properties are  $\mu = 0.03$  N · s/m<sup>2</sup> and  $k = 0.15$  W/m · K, while the bearing material has a thermal conductivity of  $k_b = 45$  W/m · K.

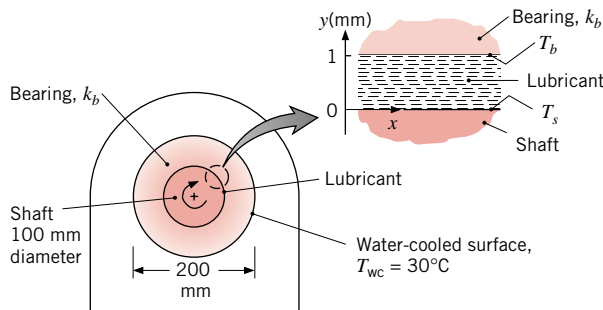

- Determine the viscous dissipation,  $\mu\Phi$  (W/m<sup>3</sup>), in the lubricant.
- Determine the rate of heat transfer (W) from the lubricant, assuming that no heat is lost through the shaft.
- If the bearing housing is water-cooled, such that the outer surface of the bearing is maintained at  $30^\circ\text{C}$ , determine the temperatures of the bearing and shaft,  $T_b$  and  $T_s$ .

**6S.9** Consider Couette flow with heat transfer as described in Example 6S.1.


- Rearrange the temperature distribution to obtain the dimensionless form

$$\theta(\eta) = \eta[1 + \frac{1}{2}Pr Ec(1 - \eta)]$$

where  $\theta \equiv [T(y) - T_0]/[T_L - T_0]$  and  $\eta = y/L$ . The dimensionless groups are the Prandtl number  $Pr = \mu c_p/k$  and the Eckert number  $Ec = U^2/c_p(T_L - T_0)$ .

- Derive an expression that prescribes the conditions under which there will be no heat transfer to the upper plate.
- Derive an expression for the heat transfer rate to the lower plate for the conditions identified in part (b).
- Generate a plot of  $\theta$  versus  $\eta$  for  $0 \leq \eta \leq 1$  and values of  $Pr Ec = 0, 1, 2, 4, 10$ . Explain key features of the temperature distributions.

**6S.10** Consider the problem of steady, incompressible laminar flow between two stationary, infinite parallel plates maintained at different temperatures.

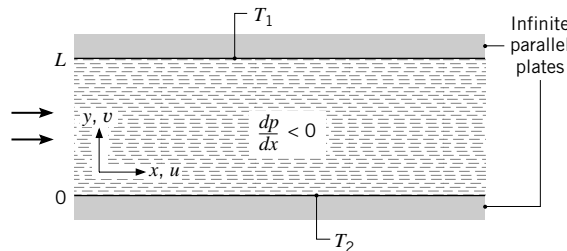

Referred to as *Poiseuille flow* with heat transfer, this special case of parallel flow is one for which the  $x$  velocity component is finite, but the  $y$  and  $z$  components ( $v$  and  $w$ ) are zero.

- What is the form of the continuity equation for this case? In what way is the flow *fully developed*?
- What forms do the  $x$ - and  $y$ -momentum equations take? What is the form of the velocity profile? Note that, unlike Couette flow, fluid motion between the plates is now sustained by a finite pressure gradient. How is this pressure gradient related to the maximum fluid velocity?

- (c) Assuming viscous dissipation to be significant and recognizing that conditions must be thermally fully developed, what is the appropriate form of the energy equation? Solve this equation for the temperature distribution. What is the heat flux at the upper ( $y = L$ ) surface?

### Species Conservation Equation and Solution

**6S.11** Consider Problem 6S.10, when the fluid is a binary mixture with different molar concentrations  $C_{A,1}$  and  $C_{A,2}$  at the top and bottom surfaces, respectively. For the region between the plates, what is the appropriate form of the species A continuity equation? Obtain expressions for the species concentration distribution and the species flux at the upper surface.

**6S.12** A simple scheme for desalination involves maintaining a thin film of saltwater on the lower surface of two large (infinite) parallel plates that are slightly inclined and separated by a distance  $L$ .




A slow, incompressible, laminar airflow exists between the plates, such that the  $x$  velocity component is finite while the  $y$  and  $z$  components are zero. Evaporation occurs from the liquid film on the lower surface, which is maintained at an elevated temperature  $T_0$ , while condensation occurs at the upper surface, which is maintained at a reduced temperature  $T_L$ . The corresponding molar concentrations of water vapor at the lower and upper surfaces are designated as  $C_{A,0}$  and  $C_{A,L}$ , respectively. The species concentration and temperature may be assumed to be independent of  $x$  and  $z$ .

- Obtain an expression for the distribution of the water vapor molar concentration  $C_A(y)$  in the air. What is the mass rate of pure water production per unit surface area? Express your results in terms of  $C_{A,0}$ ,  $C_{A,L}$ ,  $L$ , and the vapor–air diffusion coefficient  $D_{AB}$ .
- Obtain an expression for the rate at which heat must be supplied per unit area to maintain the lower surface at  $T_0$ . Express your result in terms of  $C_{A,0}$ ,  $C_{A,L}$ ,  $T_0$ ,  $T_L$ ,  $L$ ,  $D_{AB}$ ,  $h_{fg}$  (the latent heat of vaporization of water), and the thermal conductivity  $k$ .

**6S.13** Consider the conservation equations (6S.24) and (6S.31).

- Describe the physical significance of each term.
- Identify the approximations and special conditions needed to reduce these expressions to the boundary layer equations (6.29 and 6.30). Comparing these equations, identify the conditions under which they have the same form. Comment on the existence of a heat and mass transfer analogy.

**6S.14** The *falling film* is widely used in chemical processing for the removal of gaseous species. It involves the flow of a liquid along a surface that may be inclined at some angle  $\phi \geq 0$ .

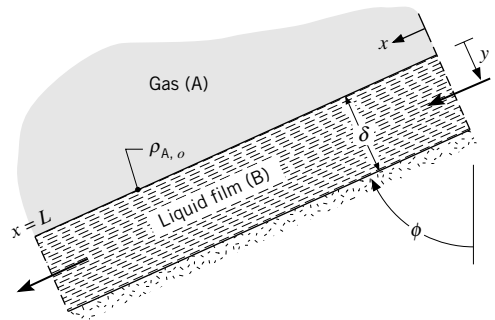

The flow is sustained by gravity, and the gas species A outside the film is absorbed at the liquid–gas interface. The film is in fully developed laminar flow over the entire plate, such that its velocity components in the  $y$  and  $z$  directions are zero. The mass density of A at  $y = 0$  in the liquid is a constant  $\rho_{A,o}$  independent of  $x$ .

- Write the appropriate form of the  $x$ -momentum equation for the film. Solve this equation for the distribution of the  $x$  velocity component,  $u(y)$ , in the film. Express your result in terms of  $\delta$ ,  $g$ ,  $\phi$ , and the liquid properties  $\mu$  and  $\rho$ . Write an expression for the maximum velocity  $u_{\max}$ .
- Obtain an appropriate form of the A species conservation equation for conditions within the film. If it is further assumed that the transport of species A across the gas–liquid interface does not penetrate very far into the film, the position  $y = \delta$  may, for all practical purposes, be viewed as  $y = \infty$ . This condition implies that to a good approximation,  $u = u_{\max}$  in the region of penetration. Subject to these assumptions, determine an expression for  $\rho_A(x, y)$  that applies in the film. *Hint:* This problem is analogous to conduction in a semi-infinite medium with a sudden change in surface temperature.

- (c) If a local mass transfer convection coefficient is defined as

$$h_{m,x} \equiv \frac{n''_{A,x}}{\rho_{A,o}}$$


where  $n''_{A,x}$  is the local mass flux at the gas–liquid interface, develop a suitable correlation for  $Sh_x$  as a function of  $Re_x$  and  $Sc$ .

- (d) Develop an expression for the total gas absorption rate per unit width for a film of length  $L$  (kg/s · m).

- (e) A water film that is 1 mm thick runs down the inside surface of a vertical tube that is 2 m long and has an inside diameter of 50 mm. An airstream containing ammonia ( $\text{NH}_3$ ) moves through the tube, such that the mass density of  $\text{NH}_3$  at the gas–liquid interface (but in the liquid) is  $25 \text{ kg/m}^3$ . A dilute solution of ammonia in water is formed, and the diffusion coefficient is  $2 \times 10^{-9} \text{ m}^2/\text{s}$ . What is the mass rate of  $\text{NH}_3$  removal by absorption?

# *CHAPTER* **7**

## **External Flow**

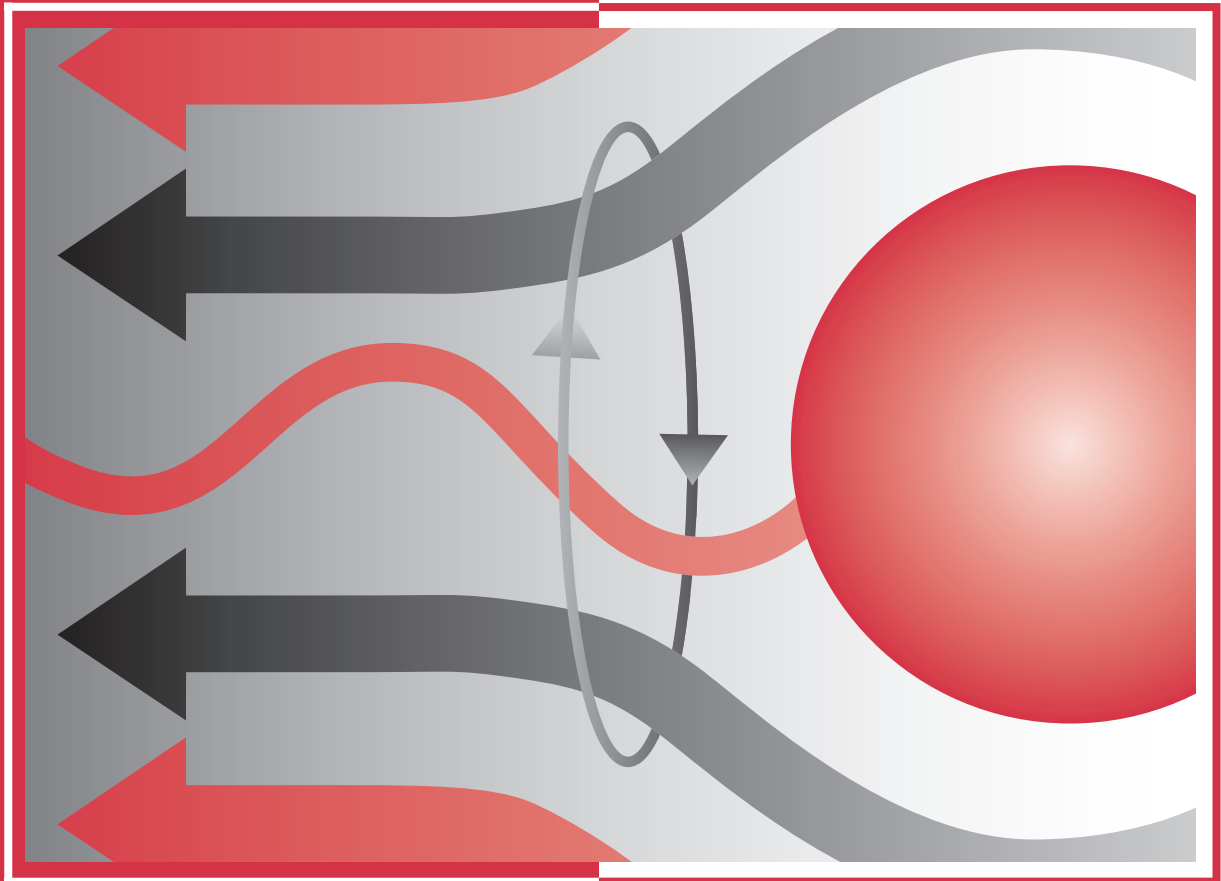

**I**n this chapter we focus on the problem of computing heat and mass transfer rates to or from a surface in *external flow*. In such a flow boundary layers develop freely, without constraints imposed by adjacent surfaces. Accordingly, there will always exist a region of the flow outside the boundary layer in which velocity, temperature, and/or concentration gradients are negligible. Examples include fluid motion over a flat plate (inclined or parallel to the free stream velocity) and flow over curved surfaces such as a sphere, cylinder, airfoil, or turbine blade.

For the moment we confine our attention to problems of *low-speed, forced convection* with *no phase change* occurring within the fluid. In addition, we will not consider potential micro- or nanoscale effects within the fluid, as described in Section 2.2, in this chapter. In *forced convection*, the relative motion between the fluid and the surface is maintained by external means, such as a fan or a pump, and not by buoyancy forces due to temperature gradients in the fluid (*natural convection*). *Internal flows, natural convection, and convection with phase change* are treated in Chapters 8, 9, and 10, respectively.

Our primary objective is to determine convection coefficients for different flow geometries. In particular, we wish to obtain specific forms of the functions that represent these coefficients. By nondimensionalizing the boundary layer equations in Chapter 6, we found that the local and average convection coefficients may be correlated by equations of the form

#### Heat Transfer:

$$Nu_x = f(x^*, Re_x, Pr) \quad (6.49)$$

$$\overline{Nu}_x = f(Re_x, Pr) \quad (6.50)$$

#### Mass Transfer:

$$Sh_x = f(x^*, Re_x, Sc) \quad (6.53)$$

$$\overline{Sh}_x = f(Re_x, Sc) \quad (6.54)$$

The subscript  $x$  has been added to emphasize our interest in conditions at a particular location on the surface. The overbar indicates an average from  $x^* = 0$ , where the boundary layer begins to develop, to the location of interest. Recall that *the problem of convection* is one of obtaining these functions. There are two approaches that we could take, one theoretical and the other experimental.

The *experimental* or *empirical approach* involves performing heat or mass transfer measurements under controlled laboratory conditions and correlating the data in terms of appropriate dimensionless parameters. A general discussion of the approach is provided in Section 7.1. It has been applied to many different geometries and flow conditions, and important results are presented in Sections 7.2 through 7.8.

The *theoretical approach* involves solving the boundary layer equations for a particular geometry. For example, obtaining the temperature profile  $T^*$  from such a

solution, Equation 6.48 may be used to evaluate the local Nusselt number  $Nu_x$ , and therefore the local convection coefficient  $h_x$ . With knowledge of how  $h_x$  varies over the surface, Equation 6.13 may then be used to determine the average convection coefficient  $\bar{h}_x$ , and therefore the Nusselt number  $\bar{Nu}_x$ . In Section 7.2.1 this approach is illustrated by using the *similarity method* to obtain an *exact solution* of the boundary layer equations for a flat plate in parallel, laminar flow [1–3]. An *approximate solution* to the same problem is obtained in Appendix F by using the *integral method* [4].


## 7.1

### The Empirical Method

The manner in which a convection heat transfer correlation may be obtained experimentally is illustrated in Figure 7.1. If a prescribed geometry, such as the flat plate in parallel flow, is heated electrically to maintain  $T_s > T_\infty$ , convection heat transfer occurs from the surface to the fluid. It would be a simple matter to measure  $T_s$  and  $T_\infty$ , as well as the electrical power,  $E \cdot I$ , which is equal to the total heat transfer rate  $q$ . The convection coefficient  $\bar{h}_L$ , which is an average associated with the entire plate, could then be computed from Newton's law of cooling, Equation 6.12. Moreover, from knowledge of the characteristic length  $L$  and the fluid properties, the Nusselt, Reynolds, and Prandtl numbers could be computed from their definitions, Equations 6.50, 6.41, and 6.42, respectively.

The foregoing procedure could be repeated for a variety of test conditions. We could vary the velocity  $u_\infty$  and the plate length  $L$ , as well as the nature of the fluid, using, for example, air, water, and engine oil, which have substantially different Prandtl numbers. We would then be left with many different values of the Nusselt number corresponding to a wide range of Reynolds and Prandtl numbers, and the results could be plotted on a *log–log* scale, as shown in Figure 7.2a. Each symbol represents a unique set of test conditions. As is often the case, the results associated with a given fluid, and hence a fixed Prandtl number, fall close to a straight line, indicating a power law dependence of the Nusselt number on the Reynolds number. Considering all the fluids, the data may then be represented by an algebraic expression of the form


$$\bar{Nu}_L = C Re_L^m Pr^n \quad (7.1)$$

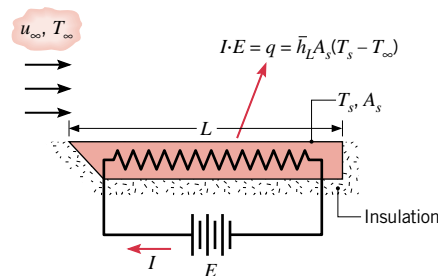

**FIGURE 7.1**

Experiment for measuring the average convection heat transfer coefficient  $\bar{h}_L$ .



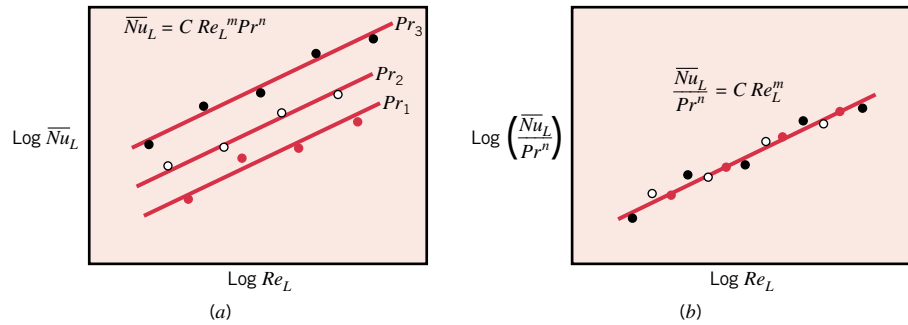

**FIGURE 7.2** Dimensionless representation of convection heat transfer measurements.

Since the values of  $C$ ,  $m$ , and  $n$  are often independent of the nature of the fluid, the family of straight lines corresponding to different Prandtl numbers can be collapsed to a single line by plotting the results in terms of the ratio,  $\overline{Nu}_L/Pr^n$ , as shown in Figure 7.2b.

Because Equation 7.1 is inferred from experimental measurements, it is termed an *empirical correlation*. The specific values of the coefficient  $C$  and the exponents  $m$  and  $n$  vary with the nature of the surface geometry and the type of flow.

We will use expressions of the form given by Equation 7.1 for many special cases, and it is important to note that the assumption of *constant fluid properties* is often implicit in the results. However, we know that the fluid properties vary with temperature across the boundary layer and that this variation can certainly influence the heat transfer rate. This influence may be handled in one of two ways. In one method, Equation 7.1 is used with all properties evaluated at a mean boundary layer temperature  $T_f$ , termed the *film temperature*.

$$T_f \equiv \frac{T_s + T_\infty}{2} \quad (7.2)$$

The alternate method is to evaluate all properties at  $T_\infty$  and to multiply the right-hand side of Equation 7.1 by an additional parameter to account for the property variations. The parameter is commonly of the form  $(Pr_\infty/Pr_s)^r$  or  $(\mu_\infty/\mu_s)^r$ , where the subscripts  $\infty$  and  $s$  designate evaluation of the properties at the free stream and surface temperatures, respectively. Both methods are used in the results that follow.

Finally, we note that experiments may also be performed to obtain convection mass transfer correlations. However, under conditions for which the heat and mass transfer analogy (Section 6.7.1) may be applied, the mass transfer correlation assumes the same form as the corresponding heat transfer correlation. Accordingly, we anticipate correlations of the form

$$\overline{Sh}_L = C Re_L^m Sc^n \quad (7.3)$$

where, for a given geometry and flow condition, the values of  $C$ ,  $m$ , and  $n$  are the same as those appearing in Equation 7.1.

## 7.2

### The Flat Plate in Parallel Flow

Despite its simplicity, parallel flow over a flat plate (Figure 7.3) occurs in numerous engineering applications. As discussed in Section 6.3, laminar boundary layer development begins at the leading edge ( $x = 0$ ) and transition to turbulence may occur at a downstream location ( $x_c$ ) for which a critical Reynolds number  $Re_{x,c}$  is achieved. We begin by considering conditions in the laminar boundary layer.

#### 7.2.1 Laminar Flow over an Isothermal Plate: A Similarity Solution

The major convection parameters may be obtained by solving the appropriate form of the boundary layer equations. Assuming *steady, incompressible, laminar* flow with *constant fluid properties* and *negligible viscous dissipation* and recognizing that  $dp/dx = 0$ , the boundary layer equations (6.27, 6.28, 6.29, and 6.30) reduce to

**Continuity:**

$$u \frac{\partial u}{\partial x} + v \frac{\partial v}{\partial y} = 0 \quad (7.4)$$

**Momentum:**


$$u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} = \nu \frac{\partial^2 u}{\partial y^2} \quad (7.5)$$

**Energy:**

$$u \frac{\partial T}{\partial x} + v \frac{\partial T}{\partial y} = \alpha \frac{\partial^2 T}{\partial y^2} \quad (7.6)$$

**Species:**

$$u \frac{\partial \rho_A}{\partial x} + v \frac{\partial \rho_A}{\partial y} = D_{AB} \frac{\partial^2 \rho_A}{\partial y^2} \quad (7.7)$$

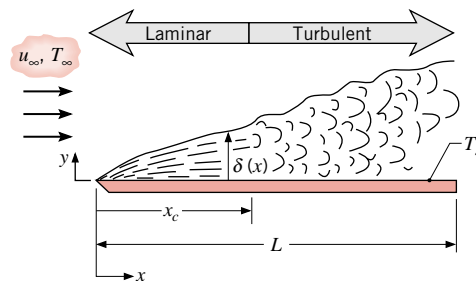

**FIGURE 7.3**  
The flat plate in parallel flow.

Solution of these equations is simplified by the fact that for constant properties, conditions in the velocity (hydrodynamic) boundary layer are independent of temperature and species concentration. Hence we may begin by solving the hydrodynamic problem, Equations 7.4 and 7.5, to the exclusion of Equations 7.6 and 7.7. Once the hydrodynamic problem has been solved, solutions to Equations 7.6 and 7.7, which depend on  $u$  and  $v$ , may be obtained.

The hydrodynamic solution follows the method of Blasius [1, 2]. The velocity components are defined in terms of a stream function  $\psi(x, y)$ ,

$$u \equiv \frac{\partial \psi}{\partial y} \quad \text{and} \quad v \equiv -\frac{\partial \psi}{\partial x} \quad (7.8)$$

such that Equation 7.4 is automatically satisfied and hence is no longer needed. New dependent and independent variables,  $f$  and  $\eta$ , respectively, are then defined such that

$$f(\eta) \equiv \frac{\psi}{u_\infty \sqrt{\nu x / u_\infty}} \quad (7.9)$$

$$\eta \equiv y \sqrt{u_\infty / \nu x} \quad (7.10)$$

As we will find, use of these variables simplifies matters by reducing the partial differential equation, Equation 7.5, to an ordinary differential equation.

The Blasius solution is termed a *similarity solution*, and  $\eta$  is a *similarity variable*. This terminology is used because, despite growth of the boundary layer with distance  $x$  from the leading edge, the velocity profile  $u/u_\infty$  remains *geometrically similar*. This similarity is of the functional form

$$\frac{u}{u_\infty} = \phi\left(\frac{y}{\delta}\right)$$

where  $\delta$  is the boundary layer thickness. We will find from the Blasius solution that  $\delta$  varies as  $(\nu x / u_\infty)^{1/2}$ ; thus, it follows that

$$\frac{u}{u_\infty} = \phi(\eta) \quad (7.11)$$

Hence the velocity profile is uniquely determined by the similarity variable  $\eta$ , which depends on both  $x$  and  $y$ .

From Equations 7.8 through 7.10 we obtain

$$u = \frac{\partial \psi}{\partial y} = \frac{\partial \psi}{\partial \eta} \frac{\partial \eta}{\partial y} = u_\infty \sqrt{\frac{\nu x}{u_\infty}} \frac{df}{d\eta} \sqrt{\frac{u_\infty}{\nu x}} = u_\infty \frac{df}{d\eta} \quad (7.12)$$

and

$$\begin{aligned} v &= -\frac{\partial \psi}{\partial x} = -\left(u_\infty \sqrt{\frac{\nu x}{u_\infty}} \frac{\partial f}{\partial x} + \frac{u_\infty}{2} \sqrt{\frac{\nu}{u_\infty x}} f\right) \\ v &= \frac{1}{2} \sqrt{\frac{\nu u_\infty}{x}} \left(\eta \frac{df}{d\eta} - f\right) \end{aligned} \quad (7.13)$$

By differentiating the velocity components, it may also be shown that

$$\frac{\partial u}{\partial x} = -\frac{u_\infty}{2x} \eta \frac{d^2 f}{d\eta^2} \quad (7.14)$$

$$\frac{\partial u}{\partial y} = u_{\infty} \sqrt{\frac{u_{\infty}}{\nu x}} \frac{d^2 f}{d\eta^2} \quad (7.15)$$

$$\frac{\partial^2 u}{\partial y^2} = \frac{u_{\infty}^2}{\nu x} \frac{d^3 f}{d\eta^3} \quad (7.16)$$

Substituting these expressions into Equation 7.5, we then obtain

$$2 \frac{d^3 f}{d\eta^3} + f \frac{d^2 f}{d\eta^2} = 0 \quad (7.17)$$

Hence the hydrodynamic boundary layer problem is reduced to one of solving a nonlinear, third-order ordinary differential equation. The appropriate boundary conditions are

$$u(x, 0) = v(x, 0) = 0 \quad \text{and} \quad u(x, \infty) = u_{\infty}$$

or, in terms of the similarity variables,

$$\left. \frac{df}{d\eta} \right|_{\eta=0} = f(0) = 0 \quad \text{and} \quad \left. \frac{df}{d\eta} \right|_{\eta \rightarrow \infty} = 1 \quad (7.18)$$

The solution to Equation 7.17, subject to the conditions of Equations 7.18, may be obtained by a series expansion [2] or by numerical integration [3]. Selected results are presented in Table 7.1, from which useful information may be extracted. We first note that, to a good approximation,  $(u/u_{\infty}) = 0.99$  for  $\eta = 5.0$ . Defining the

**TABLE 7.1** Flat plate laminar boundary layer functions [3]

$\eta = y \sqrt{\frac{u_{\infty}}{\nu x}}$	$f$	$\frac{df}{d\eta} = \frac{u}{u_{\infty}}$	$\frac{d^2 f}{d\eta^2}$
0	0	0	0.332
0.4	0.027	0.133	0.331
0.8	0.106	0.265	0.327
1.2	0.238	0.394	0.317
1.6	0.420	0.517	0.297
2.0	0.650	0.630	0.267
2.4	0.922	0.729	0.228
2.8	1.231	0.812	0.184
3.2	1.569	0.876	0.139
3.6	1.930	0.923	0.098
4.0	2.306	0.956	0.064
4.4	2.692	0.976	0.039
4.8	3.085	0.988	0.022
5.2	3.482	0.994	0.011
5.6	3.880	0.997	0.005
6.0	4.280	0.999	0.002
6.4	4.679	1.000	0.001
6.8	5.079	1.000	0.000

boundary layer thickness  $\delta$  as that value of  $y$  for which  $(u/u_\infty) = 0.99$ , it follows from Equation 7.10 that

$$\delta = \frac{5.0}{\sqrt{u_\infty/\nu x}} = \frac{5x}{\sqrt{Re_x}} \quad (7.19)$$

From Equation 7.19 it is clear that  $\delta$  increases with increasing  $x$  and  $\nu$  but decreases with increasing  $u_\infty$  (the larger the free stream velocity, the *thinner* the boundary layer). In addition, from Equation 7.15 the wall shear stress may be expressed as

$$\tau_s = \mu \left. \frac{\partial u}{\partial y} \right|_{y=0} = \mu u_\infty \sqrt{u_\infty/\nu x} \left. \frac{d^2 f}{d\eta^2} \right|_{\eta=0}$$

Hence from Table 7.1

$$\tau_s = 0.332 u_\infty \sqrt{\rho \mu u_\infty / x}$$

The *local* friction coefficient is then

$$C_{f,x} \equiv \frac{\tau_{s,x}}{\rho u_\infty^2 / 2} = 0.664 Re_x^{-1/2} \quad (7.20)$$

From knowledge of conditions in the velocity boundary layer, the energy and species continuity equations may now be solved. To solve Equation 7.6 we introduce the dimensionless temperature  $T^* \equiv [(T - T_s)/(T_\infty - T_s)]$  and assume a similarity solution of the form  $T^* = T^*(\eta)$ . Making the necessary substitutions, Equation 7.6 reduces to

$$\frac{d^2 T^*}{d\eta^2} + \frac{Pr}{2} f \frac{dT^*}{d\eta} = 0 \quad (7.21)$$

Note the dependence of the thermal solution on hydrodynamic conditions through appearance of the variable  $f$  in Equation 7.21. The appropriate boundary conditions are

$$T^*(0) = 0 \quad \text{and} \quad T^*(\infty) = 1 \quad (7.22)$$

Subject to the conditions of Equation 7.22, Equation 7.21 may be solved by numerical integration for different values of the Prandtl number. One important consequence of this solution is that, for  $Pr \gtrsim 0.6$ , results for the surface temperature gradient  $dT^*/d\eta|_{\eta=0}$  may be correlated by the following relation:

$$\left. \frac{dT^*}{d\eta} \right|_{\eta=0} = 0.332 Pr^{1/3}$$

Expressing the local convection coefficient as

$$h_x = \frac{q_s''}{T_s - T_\infty} = - \frac{T_\infty - T_s}{T_s - T_\infty} k \left. \frac{\partial T^*}{\partial y} \right|_{y=0}$$

$$h_x = k \left( \frac{u_\infty}{\nu x} \right)^{1/2} \left. \frac{dT^*}{d\eta} \right|_{\eta=0}$$

it follows that the *local* Nusselt number is of the form

$$Nu_x \equiv \frac{h_x x}{k} = 0.332 Re_x^{1/2} Pr^{1/3} \quad Pr \gtrsim 0.6 \quad (7.23)$$

From the solution to Equation 7.21, it also follows that the ratio of the velocity to thermal boundary layer thickness is

$$\frac{\delta}{\delta_t} \approx Pr^{1/3} \quad (7.24)$$

where  $\delta$  is given by Equation 7.19.

The species boundary layer equation, Equation 7.7, is of the same form as the energy boundary layer equation, Equation 7.6, with  $D_{AB}$  replacing  $\alpha$ . Introducing a normalized species density  $\rho_A^* = [(\rho_A - \rho_{A,s})/(\rho_{A,\infty} - \rho_{A,s})]$  and noting that, for a fixed surface species concentration

$$\rho_A^*(0) = 0 \quad \text{and} \quad \rho_A^*(\infty) = 1 \quad (7.25)$$

we also see that the species boundary conditions are of the same form as the temperature boundary conditions given in Equation 7.22. Therefore, as discussed in Section 6.7.1, the heat and mass transfer analogy may be applied since the differential equation and boundary conditions for the species concentration are of the same form as for temperature. Hence, with reference to Equation 7.23,

$$Sh_x \equiv \frac{h_{m,x} x}{D_{AB}} = 0.332 Re_x^{1/2} Sc^{1/3} \quad Sc \geq 0.6 \quad (7.26)$$

By analogy to Equation 7.24, it also follows that the ratio of boundary layer thicknesses is

$$\frac{\delta}{\delta_c} \approx Sc^{1/3} \quad (7.27)$$

The foregoing results may be used to compute important *laminar* boundary layer parameters for  $0 < x < x_c$ , where  $x_c$  is the distance from the leading edge at which transition begins. Equations 7.20, 7.23, and 7.26 imply that  $\tau_{s,x}$ ,  $h_x$ , and  $h_{m,x}$  are, in principle, infinite at the leading edge and decrease as  $x^{-1/2}$  in the flow direction. Equations 7.24 and 7.27 also imply that, for values of  $Pr$  and  $Sc$  close to unity, which is the case for most gases, the three boundary layers experience nearly identical growth.

From the foregoing local results, average boundary layer parameters may be determined. With the average friction coefficient defined as

$$\bar{C}_{f,x} \equiv \frac{\bar{\tau}_{s,x}}{\rho u_\infty^2/2} \quad (7.28)$$

where

$$\bar{\tau}_{s,x} \equiv \frac{1}{x} \int_0^x \tau_{s,x} dx$$

the form of  $\tau_{s,x}$  may be substituted from Equation 7.20 and the integration performed to obtain

$$\bar{C}_{f,x} = 1.328 Re_x^{-1/2} \quad (7.29)$$

Moreover, from Equations 6.14 and 7.23, the *average* heat transfer coefficient for laminar flow is

$$\bar{h}_x = \frac{1}{x} \int_0^x h_x dx = 0.332 \left( \frac{k}{x} \right) Pr^{1/3} \left( \frac{u_\infty}{\nu} \right)^{1/2} \int_0^x \frac{dx}{x^{1/2}}$$

Integrating and substituting from Equation 7.23, it follows that  $\bar{h}_x = 2h_x$ . Hence

$$\bar{Nu}_x \equiv \frac{\bar{h}_x x}{k} = 0.664 Re_x^{1/2} Pr^{1/3} \quad Pr \geq 0.6 \quad (7.30)$$

Employing the heat and mass transfer analogy, it follows that

$$\bar{Sh}_x \equiv \frac{\bar{h}_{m,x} x}{D_{AB}} = 0.664 Re_x^{1/2} Sc^{1/3} \quad Sc \geq 0.6 \quad (7.31)$$

If the flow is laminar over the entire surface, the subscript  $x$  may be replaced by  $L$ , and Equations 7.29 through 7.31 may be used to predict average conditions for the entire surface.

From the foregoing expressions we see that, for laminar flow over a flat plate, the *average* friction and convection coefficients from the leading edge to a point  $x$  on the surface are *twice* the *local* coefficients at that point. We also note that, in using these expressions, the effect of variable properties can be treated by evaluating all properties at the *film temperature*, Equation 7.2.

For fluids of small Prandtl number, namely, *liquid metals*, Equation 7.23 does not apply. However, for this case the thermal boundary layer development is much more rapid than that of the velocity boundary layer ( $\delta_t \gg \delta$ ), and it is reasonable to assume uniform velocity ( $u = u_\infty$ ) throughout the thermal boundary layer. From a solution to the thermal boundary layer equation based on this assumption [5], it may then be shown that

$$Nu_x = 0.565 Pe_x^{1/2} \quad Pr \leq 0.05, \quad Pe_x \geq 100 \quad (7.32)$$

where  $Pe_x \equiv Re_x Pr$  is the *Peclet number* (Table 6.2). Despite the corrosive and reactive nature of liquid metals, their unique properties (low melting point and vapor pressure, as well as high thermal capacity and conductivity) render them attractive as coolants in applications requiring high heat transfer rates.

A single correlating equation, which applies for all Prandtl numbers, has been recommended by Churchill and Ozoe [6]. For laminar flow over an isothermal plate, the local convection coefficient may be obtained from

$$Nu_x = \frac{0.3387 Re_x^{1/2} Pr^{1/3}}{[1 + (0.0468/Pr)^{2/3}]^{1/4}} \quad Pe_x \geq 100 \quad (7.33)$$

with  $\bar{Nu}_x = 2Nu_x$ .

## 7.2.2 Turbulent Flow over an Isothermal Plate

From experiment [2] it is known that, for turbulent flows with Reynolds numbers up to approximately  $10^8$ , the *local* friction coefficient is correlated to within 15% accuracy by an expression of the form

$$C_{f,x} = 0.0592 Re_x^{-1/5} \quad Re_{x,c} \leq Re_x \leq 10^8 \quad (7.34)$$

Moreover, it is known that, to a reasonable approximation, the velocity boundary layer thickness may be expressed as

$$\delta = 0.37x Re_x^{-1/5} \quad (7.35)$$

Comparing these results with those for the laminar boundary layer, Equations 7.19 and 7.20, we see that turbulent boundary layer growth is much more rapid ( $\delta$  varies as  $x^{4/5}$  in contrast to  $x^{1/2}$  for laminar flow) and that the decay in the friction coefficient is more gradual ( $x^{-1/5}$  versus  $x^{-1/2}$ ). For turbulent flow, boundary layer development is influenced strongly by random fluctuations in the fluid and not by molecular diffusion. Hence relative boundary layer growth does not depend on the value of  $Pr$  or  $Sc$ , and Equation 7.35 may be used to obtain the thermal and concentration, as well as the velocity, boundary layer thicknesses. That is, for turbulent flow,  $\delta \approx \delta_t \approx \delta_c$ .

Using Equation 7.34 with the modified Reynolds, or Chilton–Colburn, analogy, Equations 6.70 and 6.71, the *local* Nusselt number for turbulent flow is

$$Nu_x = St Re_x Pr = 0.0296 Re_x^{4/5} Pr^{1/3} \quad 0.6 \leq Pr \leq 60 \quad (7.36)$$

and the *local* Sherwood number is

$$Sh_x = St_m Re_x Sc = 0.0296 Re_x^{4/5} Sc^{1/3} \quad 0.6 \leq Sc \leq 3000 \quad (7.37)$$

Enhanced mixing causes the turbulent boundary layer to grow more rapidly than the laminar boundary layer and to have larger friction and convection coefficients.

Expressions for the average coefficients may now be determined. However, since the turbulent boundary layer is generally preceded by a laminar boundary layer, we first consider *mixed* boundary layer conditions.

### 7.2.3 Mixed Boundary Layer Conditions

For laminar flow over the entire plate, Equations 7.29 through 7.31 may be used to compute the average coefficients. Moreover, if transition occurs toward the rear of the plate, for example, in the range  $0.95 \leq (x_c/L) \leq 1$ , these equations may be used to compute the average coefficients to a reasonable approximation. However, when transition occurs sufficiently upstream of the trailing edge,  $(x_c/L) \leq 0.95$ , the surface average coefficients will be influenced by conditions in both the laminar and turbulent boundary layers.

In the mixed boundary layer situation (Figure 7.3), Equation 6.14 may be used to obtain the average convection heat transfer coefficient for the entire plate. Integrating over the laminar region ( $0 \leq x \leq x_c$ ) and then over the turbulent region ( $x_c < x \leq L$ ), this equation may be expressed as

$$\bar{h}_L = \frac{1}{L} \left( \int_0^{x_c} h_{\text{lam}} dx + \int_{x_c}^L h_{\text{turb}} dx \right)$$

where it is assumed that transition occurs abruptly at  $x = x_c$ . Substituting from Equations 7.23 and 7.36 for  $h_{\text{lam}}$  and  $h_{\text{turb}}$ , respectively, we obtain



$$\bar{h}_L = \left(\frac{k}{L}\right) \left[ 0.332 \left(\frac{u_\infty}{\nu}\right)^{1/2} \int_0^{x_c} \frac{dx}{x^{1/2}} + 0.0296 \left(\frac{u_\infty}{\nu}\right)^{4/5} \int_{x_c}^L \frac{dx}{x^{1/5}} \right] Pr^{1/3}$$

Integrating, we then obtain

$$\overline{Nu}_L = (0.037 Re_L^{4/5} - A) Pr^{1/3} \quad (7.38)$$

$$\left[ \begin{array}{l} 0.6 \leq Pr \leq 60 \\ Re_{x,c} \leq Re_L \leq 10^8 \end{array} \right]$$

where the bracketed relations indicate the range of applicability and the constant  $A$  is determined by the value of the critical Reynolds number,  $Re_{x,c}$ . That is,

$$A = 0.037 Re_{x,c}^{4/5} - 0.664 Re_{x,c}^{1/2} \quad (7.39)$$

Similarly, the average friction coefficient may be found using the expression

$$\bar{C}_{f,L} = \frac{1}{L} \left( \int_0^{x_c} C_{f,x,\text{lam}} dx + \int_{x_c}^L C_{f,x,\text{turb}} dx \right)$$

Substituting expressions for  $C_{f,x,\text{lam}}$  and  $C_{f,x,\text{turb}}$  from Equations 7.20 and 7.34, respectively, and carrying out the integration provides an expression of the form

$$\bar{C}_{f,L} = 0.074 Re_L^{-1/5} - \frac{2A}{Re_L} \quad (7.40)$$

$$[Re_{x,c} \leq Re_L \leq 10^8]$$

Applying the heat and mass transfer analogy to Equation 7.38 yields

$$\overline{Sh}_L = (0.037 Re_L^{4/5} - A) Sc^{1/3} \quad (7.41)$$

$$\left[ \begin{array}{l} 0.6 \leq Sc \leq 60 \\ Re_{x,c} \leq Re_L \leq 10^8 \end{array} \right]$$

For a completely turbulent boundary layer ( $Re_{x,c} = 0$ ),  $A = 0$ . Such a condition may be realized by *tripping* the boundary layer at the leading edge, using a fine wire or some other turbulence promoter. For a transition Reynolds number of  $Re_{x,c} = 5 \times 10^5$ ,  $A = 871$ .

All of the foregoing correlations require evaluation of the fluid properties at the film temperature, Equation 7.2.

### 7.2.4 Unheated Starting Length

All the foregoing Nusselt number expressions are restricted to situations for which the surface temperature  $T_s$  is uniform. A common exception involves existence of an *unheated starting length* ( $T_s = T_\infty$ ) upstream of a heated section ( $T_s \neq T_\infty$ ). As shown in Figure 7.4, velocity boundary layer growth begins at  $x = 0$ , while thermal boundary layer development begins at  $x = \xi$ . Hence there is no heat transfer for  $0 \leq x \leq \xi$ . Through use of an integral boundary layer solution [5], it is known that, for laminar flow,

$$Nu_x = \frac{Nu_x|_{\xi=0}}{[1 - (\xi/x)^{3/4}]^{1/3}} \quad (7.42)$$

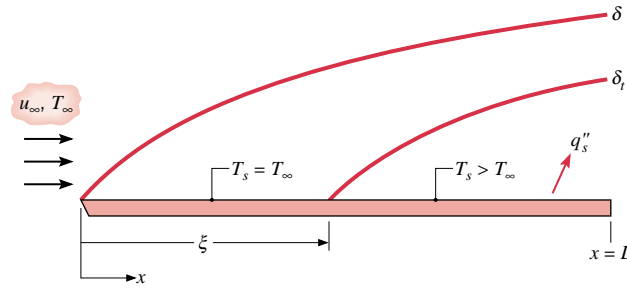


FIGURE 7.4 Flat plate in parallel flow with unheated starting length.

where  $Nu_x|_{\xi=0}$ , is given by Equation 7.23. In both  $Nu_x$  and  $Nu_x|_{\xi=0}$ , the characteristic length  $x$  is measured from the leading edge of the unheated starting length. It has also been found that, for turbulent flow,

$$Nu_x = \frac{Nu_x|_{\xi=0}}{[1 - (\xi/x)^{9/10}]^{1/9}} \quad (7.43)$$

where  $Nu_x|_{\xi=0}$  is given by Equation 7.36. Analogous mass transfer results are obtained by replacing  $(Nu_x, Pr)$  with  $(Sh_x, Sc)$ .

By using Equation 6.14 with local convection coefficients given by the foregoing relations, expressions may be obtained for the *average Nusselt number* of an isothermal plate with an unheated starting length [7]. For a plate of total length  $L$ , with laminar *or* turbulent flow over the entire surface, the expressions are of the form

$$\overline{Nu}_L = \overline{Nu}_L|_{\xi=0} \frac{L}{L - \xi} [1 - (\xi/L)^{(p+1)/(p+2)}]^{p/(p+1)} \quad (7.44)$$

where  $p = 2$  for laminar flow and  $p = 8$  for turbulent flow. The quantity  $\overline{Nu}_L|_{\xi=0}$  is the average Nusselt number for a plate of length  $L$  when heating starts at the leading edge of the plate. For laminar flow, it can be obtained from Equation 7.30 (with  $x$  replaced by  $L$ ); for turbulent flow it is given by Equation 7.38 with  $A = 0$  (assuming turbulent flow over the entire surface). Note that  $\overline{Nu}_L$  is equal to  $\bar{h}L/k$ , where  $\bar{h}$  is averaged over the heated portion of the plate only, which is of length  $(L - \xi)$ . The corresponding value of  $\bar{h}_L$  must therefore be multiplied by the area of the heated section to determine the total heat rate from the plate.

### 7.2.5 Flat Plates with Constant Heat Flux Conditions

It is also possible to have a uniform surface heat flux, rather than a uniform temperature, imposed at the plate. For laminar flow, it may be shown that [5]

$$Nu_x = 0.453 Re_x^{1/2} Pr^{1/3} \quad Pr \gtrsim 0.6 \quad (7.45)$$

while for turbulent flow

$$Nu_x = 0.0308 Re_x^{4/5} Pr^{1/3} \quad 0.6 \leq Pr \leq 60 \quad (7.46)$$

Hence the Nusselt number is 36% and 4% larger than the constant surface temperature result for laminar and turbulent flow, respectively. Correction for the effect of an unheated starting length may be made by using Equations 7.45 and 7.46 with Equations 7.42 and 7.43, respectively. If the heat flux is known, the convection coefficient may be used to determine the local surface temperature

$$T_s(x) = T_\infty + \frac{q_s''}{h_x} \quad (7.47)$$

Since the total heat rate is readily determined from the product of the uniform flux and the surface area,  $q = q_s'' A_s$ , it is not necessary to introduce an average convection coefficient for the purpose of determining  $q$ . However, one may still wish to determine an *average surface temperature* from an expression of the form

$$\overline{(T_s - T_\infty)} = \frac{1}{L} \int_0^L (T_s - T_\infty) dx = \frac{q_s''}{L} \int_0^L \frac{x}{k Nu_x} dx$$

where  $Nu_x$  is obtained from the appropriate convection correlation. Substituting from Equation 7.45, it follows that

$$\overline{(T_s - T_\infty)} = \frac{q_s'' L}{k Nu_L} \quad (7.48)$$

where

$$\overline{Nu}_L = 0.680 Re_L^{1/2} Pr^{1/3} \quad (7.49)$$

This result is only 2% larger than that obtained by evaluating Equation 7.30 at  $x = L$ . Differences are even smaller for turbulent flow, suggesting that any of the  $\overline{Nu}_L$  results obtained for a uniform surface temperature may be used with Equation 7.48 to evaluate  $\overline{(T_s - T_\infty)}$ . Expressions for the average temperature of a plate that is subjected to a uniform heat flux downstream of an unheated starting section have been obtained by Ameel [7].

### 7.2.6 Limitations on Use of Convection Coefficients

Although the equations of this section are suitable for most engineering calculations, in practice they rarely provide exact values for the convection coefficients. Conditions vary according to free stream turbulence and surface roughness, and errors as large as 25% may be incurred by using the expressions. A detailed description of free stream turbulence effects is provided by Blair [8].

## 7.3

### Methodology for a Convection Calculation

Although we have only discussed correlations for parallel flow over a flat plate, selection and application of a convection correlation for *any flow situation* are facilitated by following a few simple rules.

1. *Become immediately cognizant of the flow geometry.* Does the problem involve flow over a flat plate, a sphere, or a cylinder? The specific form of the convection correlation depends, of course, on the geometry.
2. *Specify the appropriate reference temperature and evaluate the pertinent fluid properties at that temperature.* For moderate boundary layer temperature differences, the film temperature, Equation 7.2, may be used for this purpose. However, we will consider correlations that require property evaluation at the free stream temperature and include a property ratio to account for the nonconstant property effect.
3. *In mass transfer problems the pertinent fluid properties are those of species B.* In our treatment of convection mass transfer, we are only concerned with *dilute, binary mixtures*. That is, the problems involve transport of some species A for which  $x_A \ll 1$ . To a good approximation the properties of the mixture may then be assumed to be the properties of species B. The Schmidt number, for example, would be  $Sc = \nu_B/D_{AB}$  and the Reynolds number would be  $Re_L = (VL/\nu_B)$ .
4. *Calculate the Reynolds number.* Boundary layer conditions are strongly influenced by this parameter. If the geometry is a flat plate in parallel flow, determine whether the flow is laminar or turbulent.
5. *Decide whether a local or surface average coefficient is required.* Recall that for constant surface temperature or vapor density, the local coefficient is used to determine the flux at a particular point on the surface, whereas the average coefficient determines the transfer rate for the entire surface.
6. *Select the appropriate correlation.*

### EXAMPLE 7.1


Air at a pressure of 6 kN/m<sup>2</sup> and a temperature of 300°C flows with a velocity of 10 m/s over a flat plate 0.5 m long. Estimate the cooling rate per unit width of the plate needed to maintain it at a surface temperature of 27°C.

### SOLUTION

**Known:** Airflow over an isothermal flat plate.

**Find:** Cooling rate per unit width of the plate,  $q'$  (W/m).

**Schematic:**

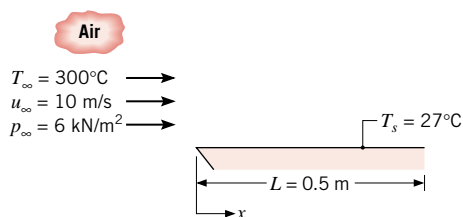

**Assumptions:**

1. Steady-state conditions.
2. Negligible radiation effects.

**Properties:** Table A.4, air ( $T_f = 437$  K,  $p = 1$  atm):  $\nu = 30.84 \times 10^{-6}$  m<sup>2</sup>/s,  $k = 36.4 \times 10^{-3}$  W/m · K,  $Pr = 0.687$ . Properties such as  $k$ ,  $Pr$ , and  $\mu$  may be assumed to be independent of pressure to an excellent approximation. However, for a gas, the kinematic viscosity  $\nu = \mu/\rho$  will vary with pressure through its dependence on density. From the ideal gas law,  $\rho = p/RT$ , it follows that the ratio of kinematic viscosities for a gas at the same temperature but at different pressures,  $p_1$  and  $p_2$ , is  $(\nu_1/\nu_2) = (p_2/p_1)$ . Hence the kinematic viscosity of air at 437 K and  $p_\infty = 6 \times 10^3$  N/m<sup>2</sup> is

$$\nu = 30.84 \times 10^{-6} \text{ m}^2/\text{s} \times \frac{1.0133 \times 10^5 \text{ N/m}^2}{6 \times 10^3 \text{ N/m}^2} = 5.21 \times 10^{-4} \text{ m}^2/\text{s}$$

**Analysis:** For a plate of unit width, it follows from Newton's law of cooling that the rate of convection heat transfer to the plate is

$$q' = \bar{h}L(T_\infty - T_s)$$

To determine the appropriate convection correlation for computing  $\bar{h}$ , the Reynolds number must first be determined

$$Re_L = \frac{u_\infty L}{\nu} = \frac{10 \text{ m/s} \times 0.5 \text{ m}}{5.21 \times 10^{-4} \text{ m}^2/\text{s}} = 9597$$

Hence the flow is laminar over the entire plate, and the appropriate correlation is given by Equation 7.30.

$$\overline{Nu}_L = 0.664 Re_L^{1/2} Pr^{1/3} = 0.664(9597)^{1/2}(0.687)^{1/3} = 57.4$$

The average convection coefficient is then

$$\bar{h} = \frac{\overline{Nu}_L k}{L} = \frac{57.4 \times 0.0364 \text{ W/m} \cdot \text{K}}{0.5 \text{ m}} = 4.18 \text{ W/m}^2 \cdot \text{K}$$

and the required cooling rate per unit width of plate is

$$q' = 4.18 \text{ W/m}^2 \cdot \text{K} \times 0.5 \text{ m} (300 - 27)^\circ\text{C} = 570 \text{ W/m}$$



**Comments:** The results of Table A.4 apply to gases at atmospheric pressure. Except for the kinematic viscosity, mass density, and thermal diffusivity, they may generally be used at other pressures without correction. The kinematic viscosity and thermal diffusivity for pressures other than 1 atm may be obtained by dividing the tabulated value by the pressure (atm).

### EXAMPLE 7.2


A flat plate of width  $w = 1$  m is maintained at a uniform surface temperature,  $T_s = 230^\circ\text{C}$ , by using independently controlled, electrical strip heaters, each of which is 50 mm long. If atmospheric air at  $25^\circ\text{C}$  flows over the plate at a velocity of 60 m/s, at what heater is the electrical input a maximum? What is the value of this input?

### SOLUTION

**Known:** Airflow over a flat plate with segmented heaters.

**Find:** Maximum heater power requirement.

**Schematic:**

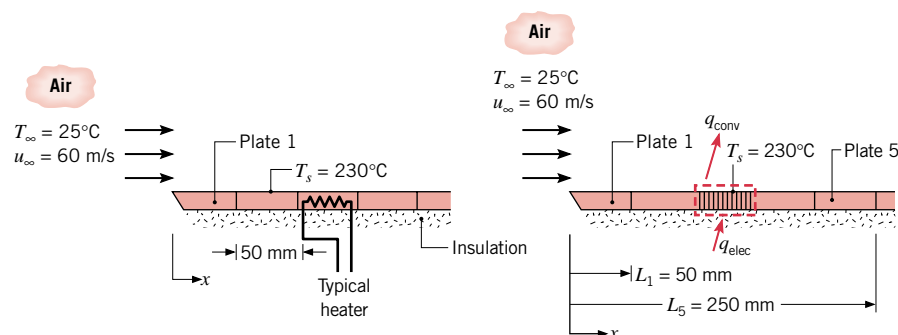

**Assumptions:**

1. Steady-state conditions.
2. Negligible radiation effects.
3. Bottom surface of plate adiabatic.

**Properties:** Table A.4, air ( $T_f = 400$  K,  $p = 1$  atm):  $\nu = 26.41 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k = 0.0338 \text{ W/m} \cdot \text{K}$ ,  $Pr = 0.690$ .

**Analysis:** The location of the heater requiring the maximum electrical power may be determined by first finding the point of boundary layer transition. The Reynolds number based on the length  $L_1$  of the first heater is

$$Re_1 = \frac{u_\infty L_1}{\nu} = \frac{60 \text{ m/s} \times 0.05 \text{ m}}{26.41 \times 10^{-6} \text{ m}^2/\text{s}} = 1.14 \times 10^5$$

If the transition Reynolds number is assumed to be  $Re_{x,c} = 5 \times 10^5$ , it follows that transition will occur on the fifth heater, or more specifically at

$$x_c = \frac{\nu}{u_\infty} Re_{x,c} = \frac{26.41 \times 10^{-6} \text{ m}^2/\text{s}}{60 \text{ m/s}} 5 \times 10^5 = 0.22 \text{ m}$$

The heater requiring the maximum electrical power is that for which the average convection coefficient is largest. Knowing how the local convection coefficient

varies with distance from the leading edge, we conclude that there are three possibilities:

1. Heater 1, since it corresponds to the largest local, laminar convection coefficient.
2. Heater 5, since it corresponds to the largest local, turbulent convection coefficient.
3. Heater 6, since turbulent conditions exist over the entire heater.

For each of these heaters, conservation of energy requires that

$$q_{\text{elec}} = q_{\text{conv}}$$

For the first heater,

$$q_{\text{conv},1} = \bar{h}_1 L_1 w (T_s - T_\infty)$$

where  $\bar{h}_1$  is determined from Equation 7.30,

$$\overline{Nu}_1 = 0.664 Re_1^{1/2} Pr^{1/3} = 0.664 (1.14 \times 10^5)^{1/2} (0.69)^{1/3} = 198$$

Hence

$$\bar{h}_1 = \frac{\overline{Nu}_1 k}{L_1} = \frac{198 \times 0.0338 \text{ W/m} \cdot \text{K}}{0.05 \text{ m}} = 134 \text{ W/m}^2 \cdot \text{K}$$

and

$$q_{\text{conv},1} = 134 \text{ W/m}^2 \cdot \text{K} (0.05 \times 1) \text{ m}^2 (230 - 25)^\circ\text{C} = 1370 \text{ W}$$

The power requirement for the fifth heater may be obtained by subtracting the total heat loss associated with the first four heaters from that associated with the first five heaters. Accordingly,

$$q_{\text{conv},5} = \bar{h}_{1-5} L_5 w (T_s - T_\infty) - \bar{h}_{1-4} L_4 w (T_s - T_\infty)$$

$$q_{\text{conv},5} = (\bar{h}_{1-5} L_5 - \bar{h}_{1-4} L_4) w (T_s - T_\infty)$$

The value of  $\bar{h}_{1-4}$  may be obtained from Equation 7.30, where

$$\overline{Nu}_4 = 0.664 Re_4^{1/2} Pr^{1/3}$$

With  $Re_4 = 4Re_1 = 4.56 \times 10^5$ ,

$$\overline{Nu}_4 = 0.664 (4.56 \times 10^5)^{1/2} (0.69)^{1/3} = 396$$

Hence

$$\bar{h}_{1-4} = \frac{\overline{Nu}_4 k}{L_4} = \frac{396 \times 0.0338 \text{ W/m} \cdot \text{K}}{0.2 \text{ m}} = 67 \text{ W/m}^2 \cdot \text{K}$$

In contrast, the fifth heater is characterized by mixed boundary layer conditions, and  $\bar{h}_{1-5}$  must be obtained from Equation 7.38, with  $A = 871$ . With  $Re_5 = 5Re_1 = 5.70 \times 10^5$ ,

$$\overline{Nu}_5 = (0.037 Re_5^{4/5} - 871) Pr^{1/3}$$

$$\overline{Nu}_5 = [0.037 (5.70 \times 10^5)^{4/5} - 871] (0.69)^{1/3} = 546$$

Hence

$$\bar{h}_{1-5} = \frac{\bar{Nu}_5 k}{L_5} = \frac{546 \times 0.0338 \text{ W/m} \cdot \text{K}}{0.25 \text{ m}} = 74 \text{ W/m}^2 \cdot \text{K}$$

The rate of heat transfer from the fifth heater is then

$$\begin{aligned} q_{\text{conv},5} &= (74 \text{ W/m}^2 \cdot \text{K} \times 0.25 \text{ m} - 67 \text{ W/m}^2 \cdot \text{K} \times 0.20 \text{ m}) \\ &\quad \times 1 \text{ m} (230 - 25)^\circ\text{C} \\ q_{\text{conv},5} &= 1050 \text{ W} \end{aligned}$$

Similarly, the power requirement for the sixth heater may be obtained by subtracting the total heat loss associated with the first five heaters from that associated with the first six heaters. Hence

$$q_{\text{conv},6} = (\bar{h}_{1-6} L_6 - \bar{h}_{1-5} L_5) w (T_s - T_\infty)$$

where  $\bar{h}_{1-6}$  may be obtained from Equation 7.38. With  $Re_6 = 6Re_1 = 6.84 \times 10^5$ ,

$$\bar{Nu}_6 = [0.037(6.84 \times 10^5)^{4/5} - 871](0.69)^{1/3} = 753$$

Hence

$$\bar{h}_{1-6} = \frac{\bar{Nu}_6 k}{L_6} = \frac{753 \times 0.0338 \text{ W/m} \cdot \text{K}}{0.30 \text{ m}} = 85 \text{ W/m}^2 \cdot \text{K}$$

and

$$\begin{aligned} q_{\text{conv},6} &= (85 \text{ W/m}^2 \cdot \text{K} \times 0.30 \text{ m} - 74 \text{ W/m}^2 \cdot \text{K} \times 0.25 \text{ m}) \\ &\quad \times 1 \text{ m} (230 - 25)^\circ\text{C} \\ q_{\text{conv},6} &= 1440 \text{ W} \end{aligned}$$

Hence  $q_{\text{conv},6} > q_{\text{conv},1} > q_{\text{conv},5}$ , and the sixth plate has the largest power requirement. ◀

### Comments:

1. An alternative, less accurate method of finding the convection heat transfer rate from a particular plate involves estimating an average local convection coefficient for the surface. For example, Equation 7.36 could be used to evaluate the local convection coefficient at the midpoint of the sixth plate. With  $x = 0.275 \text{ m}$ ,  $Re_x = 6.25 \times 10^5$ ,  $Nu_x = 1130$ , and  $h_x = 139 \text{ W/m}^2 \cdot \text{K}$ , the convection heat transfer rate from the sixth plate is


$$\begin{aligned} q_{\text{conv},6} &= h_x (L_6 - L_5) w (T_s - T_\infty) \\ q_{\text{conv},6} &= 139 \text{ W/m}^2 \cdot \text{K} (0.30 - 0.25) \text{ m} \times 1 \text{ m} (230 - 25)^\circ\text{C} = 1430 \text{ W} \end{aligned}$$

This procedure must be used with great caution and only when the variation of the local convection coefficient with distance is gradual, such as in turbulent flow. It could lead to significant error when used for a surface that experiences transition.

2. The variation of the local convection coefficient along the flat plate may be determined from Equations 7.23 and 7.36 for laminar and turbulent flow,



respectively, and the results are represented by the solid curves of the following schematic:

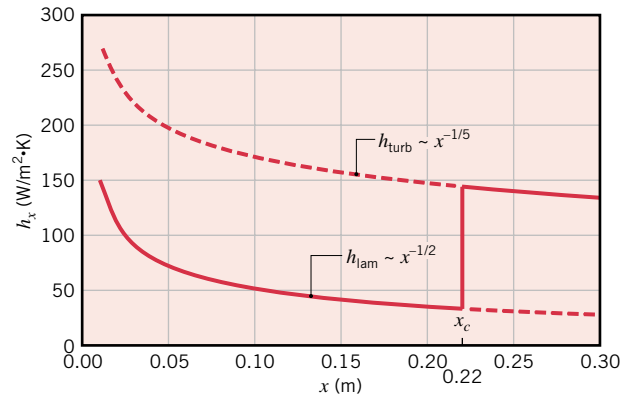

The  $x^{-1/2}$  decay of the laminar convection coefficient is presumed to conclude abruptly at  $x_c = 0.22$  m, where transition yields more than a fourfold increase in the local convection coefficient. For  $x > x_c$ , the decay in the convection coefficient is more gradual ( $x^{-1/5}$ ). The dashed lines represent extensions of the distributions, which would apply if the value of  $x_c$  were shifted. For example, if the free stream turbulence were to increase and/or the surface were to be roughened,  $Re_{x,c}$  would decrease. The smaller value of  $x_c$  would cause the laminar and turbulent distributions, respectively, to extend over smaller and larger portions of the plate. A similar effect may be achieved by increasing  $u_\infty$ . In this case larger values of  $h_x$  would be associated with the laminar and turbulent distributions ( $h_{\text{lam}} \sim u_\infty^{1/2}$ ,  $h_{\text{turb}} \sim u_\infty^{4/5}$ ).

3. This example is provided as a ready-to-solve model in *IHT*, which may be accessed in *Examples* from the menu. This model demonstrates how to use the *Correlations* and *Properties* tools, which can facilitate performing convection calculations.

### EXAMPLE 7.3


Drought conditions in the southwestern United States have prompted officials to question whether the operation of residential swimming pools should be permitted. As the chief engineer of a city that has a large number of pools, you have been asked to estimate the *daily* water loss due to pool evaporation. For representative conditions, you may assume water and ambient air temperatures of 25°C and an ambient relative humidity of 50%. Typical pool surface dimensions are 6 m by 12 m. There is a 1.5-m-wide deck around the pool, which is raised relative to the surrounding ground. Wind blows in the direction of the long side of the pool, with velocity 2 m/s. You may assume the free stream turbulence of the air to be negligible, the surface of the water to be smooth and level with the pool deck, and the deck to be dry. What is the water loss for the pool in kilograms per day?

### SOLUTION

**Known:** Ambient air conditions above a swimming pool, pool and deck dimensions.

**Find:** Daily evaporative water loss.

**Schematic:**

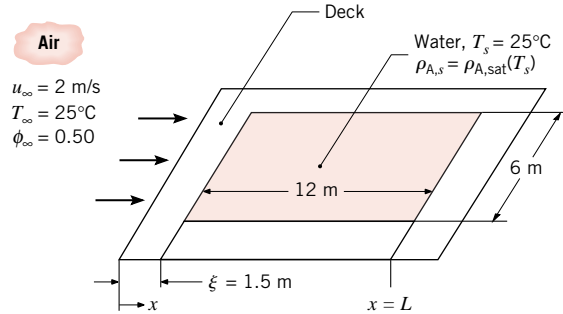

**Assumptions:**

1. Steady-state conditions.
2. Smooth water surface and negligible free stream turbulence.
3. Deck is dry.
4. Heat and mass transfer analogy applicable.
5. Flow is tripped to turbulence by the leading edge of the deck.
6. Ideal gas behavior for water vapor in free stream.

**Properties:** Table A.4, air (25°C):  $\nu = 15.7 \times 10^{-6} \text{ m}^2/\text{s}$ . Table A.8, water vapor–air (25°C):  $D_{AB} = 0.26 \times 10^{-4} \text{ m}^2/\text{s}$ ,  $Sc = \nu/D_{AB} = 0.60$ . Table A.6, saturated water vapor (25°C):  $\rho_{A,sat} = \nu_g^{-1} = 0.0226 \text{ kg/m}^3$ .

**Analysis:** The leading edge of the velocity boundary layer is at the edge of the deck; therefore, the trailing edge of the pool is at a distance of  $L = 13.5 \text{ m}$  from the leading edge. The Reynolds number at that point is

$$Re_L = \frac{u_\infty L}{\nu} = \frac{2 \text{ m/s} \times 13.5 \text{ m}}{15.7 \times 10^{-6} \text{ m}^2/\text{s}} = 1.72 \times 10^6$$

Applying the heat and mass transfer analogy to Equation 7.44 yields

$$\overline{Sh}_L = \overline{Sh}_L|_{\xi=0} \frac{L}{L-\xi} [1 - (\xi/L)^{(p+1)/(p+2)}]^{p/(p+1)} \quad (1)$$

The average Sherwood number,  $\overline{Sh}_L|_{\xi=0}$ , is evaluated from Equation 7.41 with  $A = 0$  because the boundary layer is tripped to turbulent conditions by the leading edge of the deck

$$\begin{aligned} \overline{Sh}_L|_{\xi=0} &= 0.037 Re_L^{4/5} Sc^{1/3} \\ \overline{Sh}_L|_{\xi=0} &= 0.037 (1.72 \times 10^6)^{4/5} \times (0.60)^{1/3} = 3040 \end{aligned}$$

With  $p = 8$  for turbulent flow, Equation 1 may be evaluated as

$$\overline{Sh}_L = 3040 \frac{13.5 \text{ m}}{(13.5 \text{ m} - 1.5 \text{ m})} [1 - (1.5 \text{ m}/13.5 \text{ m})^{(8+1)/(8+2)}]^{8/(8+1)} = 2990$$

It follows that

$$\bar{h}_{m,L} = \bar{Sh}_L \left( \frac{D_{AB}}{L} \right) = 2990 \frac{0.26 \times 10^{-4} \text{ m}^2/\text{s}}{13.5 \text{ m}} = 5.77 \times 10^{-3} \text{ m/s}$$

The evaporation rate for the pool is then

$$n_A = \bar{h}_m A (\rho_{A,s} - \rho_{A,\infty})$$

where  $A$  is the pool area (not including the deck). With the free stream vapor assumed to be an ideal gas,

$$\phi_\infty = \frac{\rho_{A,\infty}}{\rho_{A,\text{sat}}(T_\infty)}$$

and with  $\rho_{A,s} = \rho_{A,\text{sat}}(T_s)$ ,

$$n_A = \bar{h}_m A [\rho_{A,\text{sat}}(T_s) - \phi_\infty \rho_{A,\text{sat}}(T_\infty)]$$

Since  $T_s = T_\infty = 25^\circ\text{C}$ , it follows that

$$n_A = \bar{h}_m A \rho_{A,\text{sat}}(25^\circ\text{C}) [1 - \phi_\infty]$$

Hence


$$n_A = 5.77 \times 10^{-3} \text{ m/s} \times 72 \text{ m}^2 \times 0.0226 \text{ kg/m}^3 \times 0.5 \times 86,400 \text{ s/day}$$

$$n_A = 405 \text{ kg/day}$$



### Comments:

1. The water surface temperature is likely to be slightly less than the air temperature because of the evaporative cooling effect.
2. The volume loss, with a water density of  $996 \text{ kg/m}^3$ , is  $n_A/\rho = 0.4 \text{ m}^3/\text{day}$ . This would mean a drop in the pool level of 6 mm per day. Of course the loss would be greater in summer when the air temperature is higher.
3. The influence of the deck length on the daily evaporation rate is shown below. As the length of the deck is increased, the overall evaporation rate is reduced due to the extension of the leading edge of the velocity boundary layer farther away from the pool.

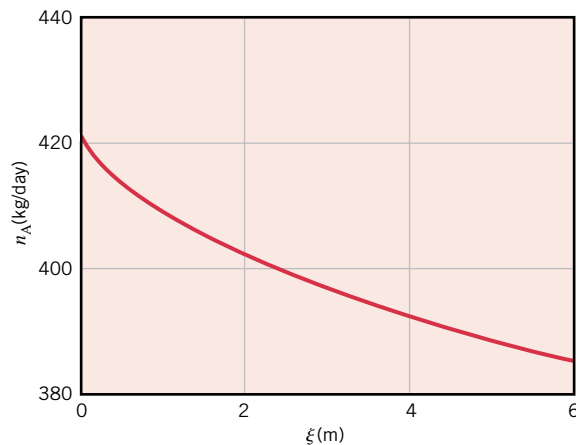

## 7.4

## The Cylinder in Cross Flow

## 7.4.1 Flow Considerations

Another common external flow involves fluid motion normal to the axis of a circular cylinder. As shown in Figure 7.5, the free stream fluid is brought to rest at the *forward stagnation point*, with an accompanying rise in pressure. From this point, the pressure decreases with increasing  $x$ , the streamline coordinate, and the boundary layer develops under the influence of a *favorable pressure gradient* ( $dp/dx < 0$ ). However, the pressure must eventually reach a minimum, and toward the rear of the cylinder further boundary layer development occurs in the presence of an *adverse pressure gradient* ( $dp/dx > 0$ ).

In Figure 7.5 the distinction between the upstream velocity  $V$  and the free stream velocity  $u_\infty$  should be noted. Unlike conditions for the flat plate in parallel flow, these velocities differ, with  $u_\infty$  now depending on the distance  $x$  from the stagnation point. From Euler's equation for an inviscid flow [9],  $u_\infty(x)$  must exhibit behavior opposite to that of  $p(x)$ . That is, from  $u_\infty = 0$  at the stagnation point, the fluid accelerates because of the favorable pressure gradient ( $du_\infty/dx > 0$  when  $dp/dx < 0$ ), reaches a maximum velocity when  $dp/dx = 0$ , and decelerates because of the adverse pressure gradient ( $du_\infty/dx < 0$  when  $dp/dx > 0$ ). As the fluid decelerates, the velocity gradient at the surface,  $\partial u/\partial y|_{y=0}$ , eventually becomes zero (Figure 7.6). At this location, termed the *separation point*, fluid near the surface lacks sufficient momentum to overcome the pressure gradient, and continued downstream movement is impossible. Since the oncoming fluid also precludes flow back upstream, *boundary layer separation* must occur. This is a condition for which the boundary layer detaches from the surface, and a *wake* is formed in the downstream region. Flow in this region is characterized by vortex formation and is highly irregular. The *separation point* is the location for which  $\partial u/\partial y|_{y=0} = 0$ . An excellent review of flow conditions in the wake of a circular cylinder is provided by Coutanceau and Defaye [10].

The occurrence of *boundary layer transition*, which depends on the Reynolds number, strongly influences the position of the separation point. For the circular


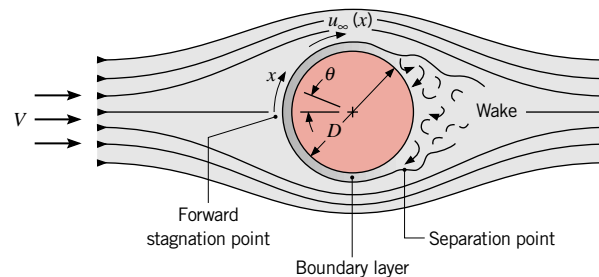


FIGURE 7.5 Boundary layer formation and separation on a circular cylinder in cross flow.

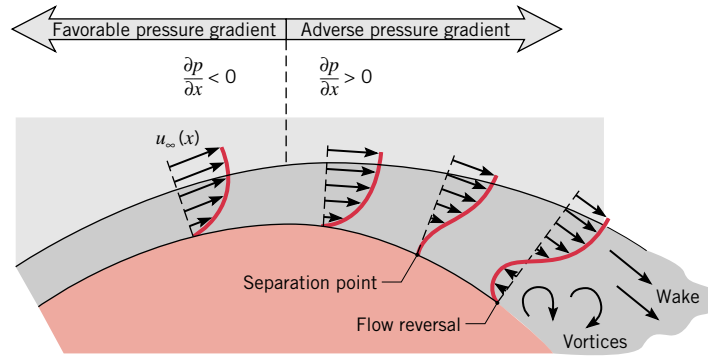

**FIGURE 7.6** Velocity profile associated with separation on a circular cylinder in cross flow.

cylinder the characteristic length is the diameter, and the Reynolds number is defined as


$$Re_D \equiv \frac{\rho V D}{\mu} = \frac{V D}{\nu}$$

Since the momentum of fluid in a turbulent boundary layer is larger than in the laminar boundary layer, it is reasonable to expect transition to delay the occurrence of separation. If  $Re_D \lesssim 2 \times 10^5$ , the boundary layer remains laminar, and separation occurs at  $\theta \approx 80^\circ$  (Figure 7.7). However, if  $Re_D \gtrsim 2 \times 10^5$ , boundary layer transition occurs, and separation is delayed to  $\theta \approx 140^\circ$ .


The foregoing processes strongly influence the drag force,  $F_D$ , acting on the cylinder. This force has two components, one of which is due to the boundary layer surface shear stress (*friction drag*). The other component is due to a pressure differential in the flow direction resulting from formation of the wake (*form*, or *pressure*, *drag*). A dimensionless *drag coefficient*  $C_D$  may be defined as

$$C_D \equiv \frac{F_D}{A_f(\rho V^2/2)} \quad (7.50)$$

where  $A_f$  is the cylinder frontal area (the area projected perpendicular to the free stream velocity). The drag coefficient is a function of the Reynolds number and

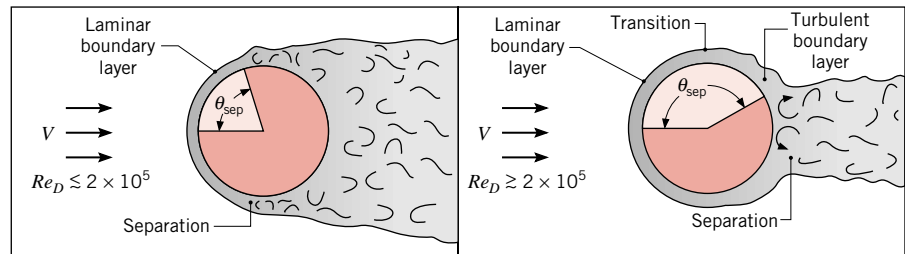

**FIGURE 7.7** The effect of turbulence on separation.

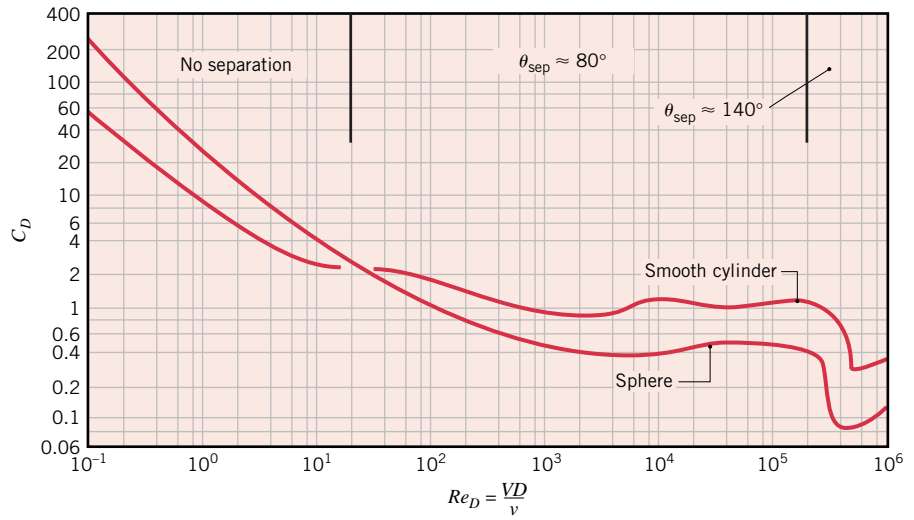

**FIGURE 7.8** Drag coefficients for a smooth circular cylinder in cross flow and for a sphere [2]. Boundary layer separation angles are for a cylinder. Adapted with permission.


results are presented in Figure 7.8. For  $Re_D \lesssim 2$  separation effects are negligible, and conditions are dominated by friction drag. However, with increasing Reynolds number, the effect of separation, and therefore form drag, becomes more important. The large reduction in  $C_D$  that occurs for  $Re_D \gtrsim 2 \times 10^5$  is due to boundary layer transition, which delays separation, thereby reducing the extent of the wake region and the magnitude of the form drag.

### 7.4.2 Convection Heat and Mass Transfer

Experimental results for the variation of the local Nusselt number with  $\theta$  are shown in Figure 7.9 for the cylinder in a cross flow of air. Not unexpectedly, the results are strongly influenced by the nature of boundary layer development on the surface. Consider conditions for  $Re_D \lesssim 10^5$ . Starting at the stagnation point,  $Nu_\theta$  decreases with increasing  $\theta$  as a result of laminar boundary layer development. However, a minimum is reached at  $\theta \approx 80^\circ$ , where separation occurs and  $Nu_\theta$  increases with  $\theta$  due to mixing associated with vortex formation in the wake. In contrast, for  $Re_D \gtrsim 10^5$  the variation of  $Nu_\theta$  with  $\theta$  is characterized by two minima. The decline in  $Nu_\theta$  from the value at the stagnation point is again due to laminar boundary layer development, but the sharp increase that occurs between  $80^\circ$  and  $100^\circ$  is now due to boundary layer transition to turbulence. With further development of the turbulent boundary layer,  $Nu_\theta$  again begins to decline. Eventually separation occurs ( $\theta \approx 140^\circ$ ), and  $Nu_\theta$  increases as a result of mixing in the wake region. The increase in  $Nu_\theta$  with increasing  $Re_D$  is due to a corresponding reduction in the boundary layer thickness.

Correlations may be obtained for the local Nusselt number, and at the forward stagnation point for  $Pr \gtrsim 0.6$ , boundary layer analysis [5] yields an expression of the following form, which is most accurate at low Reynolds number:

$$Nu_D(\theta = 0) = 1.15 Re_D^{1/2} Pr^{1/3} \quad (7.51)$$

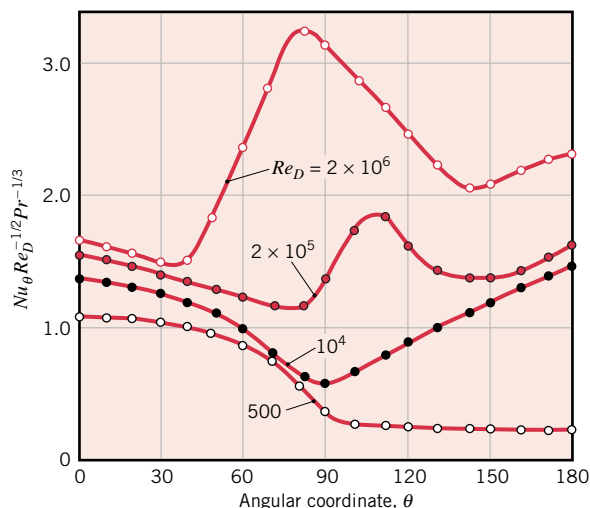

**FIGURE 7.9** Local Nusselt number for airflow normal to a circular cylinder. Adapted with permission from Zukauskas, A., “Convective Heat Transfer in Cross Flow,” in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Wiley, New York, 1987.

However, from the standpoint of engineering calculations, we are more interested in overall average conditions. The empirical correlation due to Hilpert [11]

$$\overline{Nu}_D \equiv \frac{\bar{h}D}{k} = C Re_D^m Pr^{1/3} \quad (7.52)$$






is widely used for  $Pr \geq 0.7$ , where the constants  $C$  and  $m$  are listed in Table 7.2. Equation 7.52 may also be used for flow over cylinders of noncircular cross section, with the characteristic length  $D$  and the constants obtained from Table 7.3. In working with Equations 7.51 and 7.52 all properties are evaluated at the film temperature.

Other correlations have been suggested for the circular cylinder in cross flow [14, 15, 16]. The correlation due to Zukauskas [15] is of the form

**TABLE 7.2** Constants of Equation 7.52 for the circular cylinder in cross flow [11, 12]

$Re_D$	$C$	$m$
0.4–4	0.989	0.330
4–40	0.911	0.385
40–4000	0.683	0.466
4000–40,000	0.193	0.618
40,000–400,000	0.027	0.805

**TABLE 7.3** Constants of Equation 7.52 for noncircular cylinders in cross flow of a gas [13]

Geometry	$Re_D$	$C$	$m$
Square 	$5 \times 10^3 - 10^5$	0.246	0.588
	$5 \times 10^3 - 10^5$	0.102	0.675
Hexagon 	$5 \times 10^3 - 1.95 \times 10^4$ $1.95 \times 10^4 - 10^5$	0.160 0.0385	0.638 0.782
	$5 \times 10^3 - 10^5$	0.153	0.638
Vertical plate 	$4 \times 10^3 - 1.5 \times 10^4$	0.228	0.731

$$\overline{Nu}_D = C Re_D^m Pr^n \left( \frac{Pr}{Pr_s} \right)^{1/4} \quad (7.53)$$

$$\left[ \begin{array}{l} 0.7 \leq Pr \leq 500 \\ 1 \leq Re_D \leq 10^6 \end{array} \right]$$

where all properties are evaluated at  $T_\infty$ , except  $Pr_s$ , which is evaluated at  $T_s$ . Values of  $C$  and  $m$  are listed in Table 7.4. If  $Pr \leq 10$ ,  $n = 0.37$ ; if  $Pr \geq 10$ ,  $n = 0.36$ . Churchill and Bernstein [16] have proposed a single comprehensive equation that covers the entire range of  $Re_D$  for which data are available, as well as a wide range of  $Pr$ . The equation is recommended for all  $Re_D Pr \geq 0.2$  and has the form

$$\overline{Nu}_D = 0.3 + \frac{0.62 Re_D^{1/2} Pr^{1/3}}{[1 + (0.4/Pr)^{2/3}]^{1/4}} \left[ 1 + \left( \frac{Re_D}{282,000} \right)^{5/8} \right]^{4/5} \quad (7.54)$$

where all properties are evaluated at the film temperature.

Again we caution the reader not to view any of the foregoing correlations as sacrosanct. Each correlation is reasonable over a certain range of conditions, but for most engineering calculations one should not expect accuracy to much better than 20%. Because they are based on more recent results encompassing a wide range of conditions, Equations 7.53 and 7.54 are used for the calculations of this text. A detailed review of the many correlations that have been developed for the circular cylinder is provided by Morgan [17].

Finally, we note that by invoking the heat and mass transfer analogy, Equations 7.51 through 7.54 may be applied to problems involving convection mass transfer from




**TABLE 7.4** Constants of Equation 7.53 for the circular cylinder in cross flow [16]

$Re_D$	$C$	$m$
1–40	0.75	0.4
40–1000	0.51	0.5
$10^3$ – $2 \times 10^5$	0.26	0.6
$2 \times 10^5$ – $10^6$	0.076	0.7

a cylinder in cross flow. It is simply a matter of replacing  $\overline{Nu}_D$  by  $\overline{Sh}_D$  and  $Pr$  by  $Sc$ . In mass transfer problems, boundary layer property variations are typically small. Hence, when using the mass transfer analog of Equation 7.53, the property ratio, which accounts for nonconstant property effects, may be neglected.

#### EXAMPLE 7.4

Experiments have been conducted on a metallic cylinder 12.7 mm in diameter and 94 mm long. The cylinder is heated internally by an electrical heater and is subjected to a cross flow of air in a low-speed wind tunnel. Under a specific set of operating conditions for which the upstream air velocity and temperature were maintained at  $V = 10$  m/s and  $26.2^\circ\text{C}$ , respectively, the heater power dissipation was measured to be  $P = 46$  W, while the average cylinder surface temperature was determined to be  $T_s = 128.4^\circ\text{C}$ . It is estimated that 15% of the power dissipation is lost through the cumulative effect of surface radiation and conduction through the endpieces.

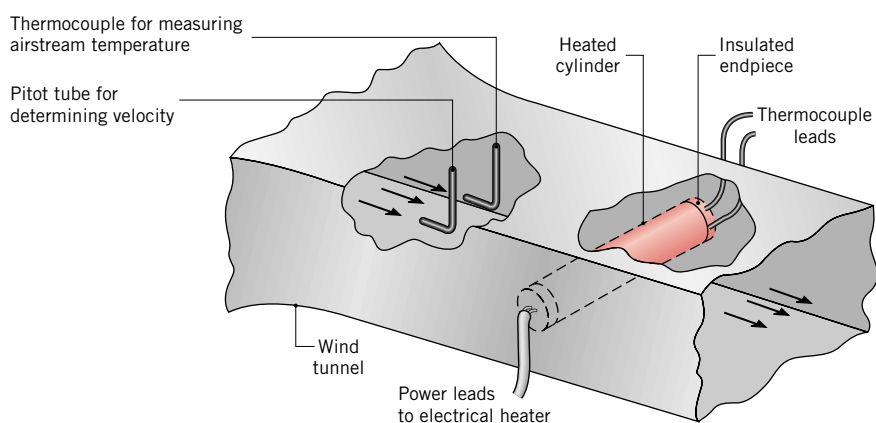

1. Determine the convection heat transfer coefficient from the experimental observations.
2. Compare the experimental result with the convection coefficient computed from an appropriate correlation.


**SOLUTION**

**Known:** Operating conditions for a heated cylinder.

**Find:**

1. Convection coefficient associated with the operating conditions.
2. Convection coefficient from an appropriate correlation.

**Schematic:**

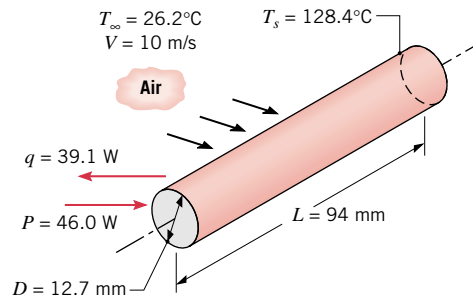

**Assumptions:**

1. Steady-state conditions.
2. Uniform cylinder surface temperature.

**Properties:** Table A.4, air ( $T_\infty = 26.2^\circ\text{C} \approx 300\text{ K}$ ):  $\nu = 15.89 \times 10^{-6}\text{ m}^2/\text{s}$ ,  $k = 26.3 \times 10^{-3}\text{ W/m}\cdot\text{K}$ ,  $Pr = 0.707$ . Table A.4, air ( $T_f \approx 350\text{ K}$ ):  $\nu = 20.92 \times 10^{-6}\text{ m}^2/\text{s}$ ,  $k = 30 \times 10^{-3}\text{ W/m}\cdot\text{K}$ ,  $Pr = 0.700$ . Table A.4, air ( $T_s = 128.4^\circ\text{C} = 401\text{ K}$ ):  $Pr = 0.690$ .

**Analysis:**

1. The convection heat transfer coefficient may be determined from the data by using Newton's law of cooling. That is,

$$\bar{h} = \frac{q}{A(T_s - T_\infty)}$$

With  $q = 0.85P$  and  $A = \pi DL$ , it follows that

$$\bar{h} = \frac{0.85 \times 46\text{ W}}{\pi \times 0.0127\text{ m} \times 0.094\text{ m} (128.4 - 26.2)^\circ\text{C}} = 102\text{ W/m}^2 \cdot \text{K} \quad \triangleleft$$

2. Working with the Zukauskas relation, Equation 7.53,

$$\overline{Nu}_D = C Re_D^m Pr^n \left( \frac{Pr}{Pr_s} \right)^{1/4}$$

all properties, except  $Pr_s$ , are evaluated at  $T_\infty$ . Accordingly,

$$Re_D = \frac{VD}{\nu} = \frac{10 \text{ m/s} \times 0.0127 \text{ m}}{15.89 \times 10^{-6} \text{ m}^2/\text{s}} = 7992$$

Hence, from Table 7.4,  $C = 0.26$  and  $m = 0.6$ . Also, since  $Pr < 10$ ,  $n = 0.37$ . It follows that

$$\overline{Nu}_D = 0.26(7992)^{0.6}(0.707)^{0.37} \left( \frac{0.707}{0.690} \right)^{0.25} = 50.5$$

$$\bar{h} = \overline{Nu}_D \frac{k}{D} = 50.5 \frac{0.0263 \text{ W/m} \cdot \text{K}}{0.0127 \text{ m}} = 105 \text{ W/m}^2 \cdot \text{K} \quad \triangleleft$$

### Comments:

1. Using the Churchill relation, Equation 7.54,

$$\overline{Nu}_D = 0.3 + \frac{0.62 Re_D^{1/2} Pr^{1/3}}{[1 + (0.4/Pr)^{2/3}]^{1/4}} \left[ 1 + \left( \frac{Re_D}{282,000} \right)^{5/8} \right]^{4/5}$$

With all properties evaluated at  $T_f$ ,  $Pr = 0.70$  and

$$Re_D = \frac{VD}{\nu} = \frac{10 \text{ m/s} \times 0.0127 \text{ m}}{20.92 \times 10^{-6} \text{ m}^2/\text{s}} = 6071$$

Hence the Nusselt number and the convection coefficient are

$$\overline{Nu}_D = 0.3 + \frac{0.62(6071)^{1/2}(0.70)^{1/3}}{[1 + (0.4/0.70)^{2/3}]^{1/4}} \left[ 1 + \left( \frac{6071}{282,000} \right)^{5/8} \right]^{4/5} = 40.6$$

$$\bar{h} = \overline{Nu}_D \frac{k}{D} = 40.6 \frac{0.030 \text{ W/m} \cdot \text{K}}{0.0127 \text{ m}} = 96.0 \text{ W/m}^2 \cdot \text{K}$$

Alternatively, from the Hilpert correlation, Equation 7.52,

$$\overline{Nu}_D = C Re_D^m Pr^{1/3}$$

With all properties evaluated at the film temperature,  $Re_D = 6071$  and  $Pr = 0.70$ . Hence, from Table 7.2,  $C = 0.193$  and  $m = 0.618$ . The Nusselt number and the convection coefficient are then

$$\overline{Nu}_D = 0.193(6071)^{0.618}(0.700)^{0.333} = 37.3$$

$$\bar{h} = \overline{Nu}_D \frac{k}{D} = 37.3 \frac{0.030 \text{ W/m} \cdot \text{K}}{0.0127 \text{ m}} = 88 \text{ W/m}^2 \cdot \text{K}$$

2. Uncertainties associated with measuring the air velocity, estimating the heat loss from cylinder ends, and averaging the cylinder surface temperature, which varies axially and circumferentially, render the experimental result accurate to no better than 15%. Accordingly, calculations based on each of the three correlations are within the experimental uncertainty of the measured result.
3. Recognize the importance of using the proper temperature when evaluating fluid properties.

### EXAMPLE 7.5

Because the molecular weight of hydrogen is very small, storing significant amounts in its gaseous form requires very large, high-pressure containers. In situations where use of such high-pressure storage is not feasible, such as in automotive applications, the  $H_2$  is typically stored by *adsorbing* it into a metal hydride powder. The hydrogen is subsequently *desorbed* as needed, by heating the metal hydride throughout its volume.

Gaseous, desorbed hydrogen is present within the interstitial regions of the powder at a pressure that depends on the metal hydride temperature as


$$p_{H_2} = \exp^{(-3550/T + 12.9)}$$

where  $p_{H_2}$  is the hydrogen pressure in atmospheres and  $T$  is the metal hydride temperature in kelvins. The desorption process is an *endothermic* chemical reaction corresponding to a thermal generation rate expressed as

$$\dot{E}_g = -\dot{m}_{H_2} \times (29.5 \times 10^3 \text{ kJ/kg})$$

where  $\dot{m}_{H_2}$  is the hydrogen desorption rate (kg/s). Thermal energy must be supplied to the metal hydride in order to maintain a sufficiently high operating temperature. The operating temperature is determined by the requirement that the hydrogen pressure remain above 1 atm so that hydrogen can be delivered to the fuel cell, which operates at  $p_{fc} = 1 \text{ atm}$ .

At a steady-state cruising speed of  $V = 25 \text{ m/s}$ , a fuel cell–powered automobile consumes  $\dot{m}_{H_2} = 1.35 \times 10^{-4} \text{ kg/s}$  of hydrogen, which is supplied from a cylindrical, stainless steel canister with inside diameter  $D_i = 0.1 \text{ m}$ , length  $L = 0.8 \text{ m}$ , and wall thickness  $t = 0.5 \text{ mm}$ . The canister, which is loaded with metal hydride powder, is installed in the vehicle so that it is subject to air in cross flow at  $V = 25 \text{ m/s}$ ,  $T_\infty = 23^\circ\text{C}$ . Determine how much additional heating, beyond that supplied by convection from the warm air, should be supplied to the canister so that  $p_{H_2} > p_{fc}$ .

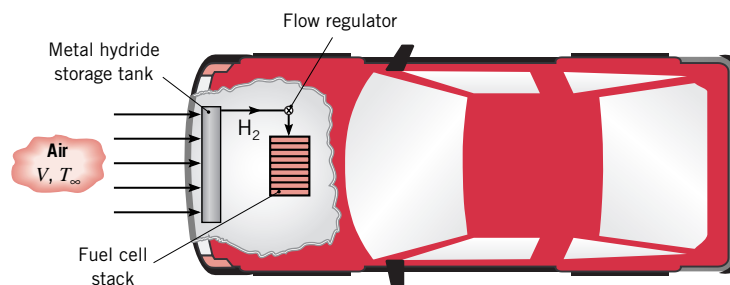


### SOLUTION

**Known:** Size of a hydrogen storage canister, hydrogen desorption rate, required hydrogen operating pressure, velocity and temperature of air in cross flow.

**Find:** The convective heat transfer to the canister and the additional heating needed to sustain  $p_{H_2} > p_{fc}$ .

**Schematic:**

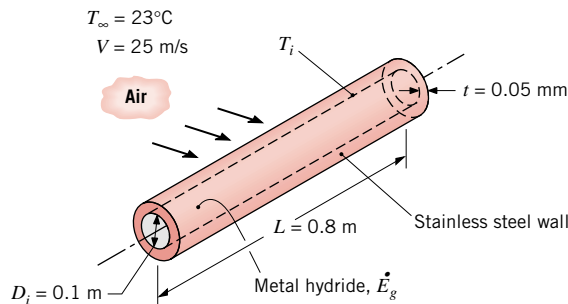

**Assumptions:**

1. Steady-state conditions.
2. Uniform cylinder surface temperature.
3. Negligible heat gain through the ends of the cylinder.
4. Uniform metal hydride temperature.
5. Negligible contact resistance between the canister wall and the metal hydride.

**Properties:** Table A.4, air ( $T_f \approx 285$  K):  $\nu = 14.56 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k = 25.2 \times 10^{-3} \text{ W/m} \cdot \text{K}$ ,  $Pr = 0.712$ . Table A.1, AISI 316 stainless steel ( $T_{ss} \approx 300$  K):  $k_{ss} = 13.4 \text{ W/m} \cdot \text{K}$ .

**Analysis:** We begin by finding the minimum allowable operating temperature of the metal hydride,  $T_{\min}$ , corresponding to  $p_{\text{H}_2, \min} = 1$  atm. The relationship between the operating temperature and pressure may be rearranged to yield

$$T_{\min} = \frac{-3550}{\ln(p_{\text{H}_2, \min}) - 12.9} = \frac{-3550}{\ln(1) - 12.9} = 275.2 \text{ K}$$

The thermal energy generation rate associated with the desorption of hydrogen from the metal hydride at the required flow rate is

$$\dot{E}_g = -(1.35 \times 10^{-4} \text{ kg/s}) \times (29.5 \times 10^6 \text{ J/kg}) = -3982 \text{ W}$$

To determine the convective heat transfer rate, we begin by calculating the Reynolds number:

$$Re_D = \frac{V(D_i + 2t)}{\nu} = \frac{23 \text{ m/s} \times (0.1 \text{ m} + 2 \times 0.005 \text{ m})}{14.56 \times 10^{-6} \text{ m}^2/\text{s}} = 173,760$$

Use of Equation 7.54

$$\overline{Nu}_D = 0.3 + \frac{0.62 Re_D^{1/2} Pr^{1/3}}{[1 + (0.4/Pr)^{2/3}]^{1/4}} \left[ 1 + \left( \frac{Re_D}{282,000} \right)^{5/8} \right]^{4/5}$$

yields

$$\overline{Nu}_D = 0.3 + \frac{0.62(173,760)^{1/2}(0.712)^{1/3}}{[1 + (0.4/0.712)^{2/3}]^{1/4}} \left[ 1 + \left( \frac{173,760}{282,000} \right)^{5/8} \right]^{4/5} = 315.8$$

Therefore, the average convective heat transfer coefficient is

$$\bar{h} = \overline{Nu}_D \frac{k}{(D_i + 2t)} = 315.8 \times \frac{25.3 \times 10^{-3} \text{ W/m} \cdot \text{K}}{(0.1 \text{ m} + 2 \times 0.005 \text{ m})} = 72.6 \text{ W/m}^2 \cdot \text{K}$$

Simplifying Equation 3.29, we find

$$q_{\text{conv}} = \frac{T_{\infty} - T_i}{\frac{1}{\pi L(D_i + 2t)\bar{h}} + \frac{\ln[(D_i + 2t)/D_i]}{2\pi k_{ss}L}}$$

or, substituting values,

$$\begin{aligned} q_{\text{conv}} &= \frac{296 \text{ K} - 275.2 \text{ K}}{\frac{1}{\pi(0.8 \text{ m})(0.1 \text{ m} + 2 \times 0.005 \text{ m})(72.6 \text{ W/m}^2 \cdot \text{K})} + \frac{\ln[(0.1 \text{ m} + 2 \times 0.005 \text{ m})/0.1 \text{ m}]}{2\pi(13.4 \text{ W/m} \cdot \text{K})(0.8 \text{ m})}} \\ &= 406 \text{ W} \end{aligned}$$

The additional thermal energy,  $q_{\text{add}}$ , that must be supplied to the canister to maintain the steady-state operating temperature may be found from an energy balance,  $q_{\text{add}} + q_{\text{conv}} + \dot{E}_g = 0$ . Therefore,

$$q_{\text{add}} = -q_{\text{conv}} - \dot{E}_g = -406 \text{ W} + 3982 \text{ W} = 3576 \text{ W} \quad \triangleleft$$

### Comments:

1. Additional heating will occur due to radiation, conduction from the canister mounting hardware and fuel lines, and possibly condensation of water vapor on the cool canister. Waste heat from the fuel cell (see Example 3.11) might also be used as a source of thermal energy for the hydrogen storage canister.
2. The thermal resistances associated with conduction in the canister wall and convection are 0.0014 K/W and 0.053 K/W, respectively. The convection resistance dominates and can be reduced by adding fins to the exterior of the canister.
3. The amount of additional heating that is required will increase if the automobile is operated at a higher speed, since the hydrogen consumption scales as  $V^3$ , while the convective heat transfer coefficient increases as  $V^{0.7}$  to  $V^{0.8}$ . Additional heating is also needed when the automobile is operated in a cooler climate.

## 7.5 The Sphere

Boundary layer effects associated with flow over a sphere are much like those for the circular cylinder, with transition and separation playing prominent roles. Results for the drag coefficient, which is defined by Equation 7.50, are presented in Figure 7.8. In the limit of very small Reynolds numbers (*creeping flow*), the coefficient is

inversely proportional to the Reynolds number and the specific relation is termed *Stokes' law*

$$C_D = \frac{24}{Re_D} \quad Re_D \lesssim 0.5 \quad (7.55)$$

Numerous heat transfer correlations have been proposed, and Whitaker [14] recommends an expression of the form

$$\overline{Nu}_D = 2 + (0.4Re_D^{1/2} + 0.06Re_D^{2/3})Pr^{0.4}\left(\frac{\mu}{\mu_s}\right)^{1/4} \quad (7.56)$$

$$\left[ \begin{array}{l} 0.71 \leq Pr \leq 380 \\ 3.5 \leq Re_D \leq 7.6 \times 10^4 \\ 1.0 \leq (\mu/\mu_s) \leq 3.2 \end{array} \right]$$

All properties except  $\mu_s$  are evaluated at  $T_\infty$ , and the result may be applied to mass transfer problems simply by replacing  $\overline{Nu}_D$  and  $Pr$  with  $\overline{Sh}_D$  and  $Sc$ , respectively. A special case of convection heat and mass transfer from spheres relates to transport from freely falling liquid drops, and the correlation of Ranz and Marshall [18] is often used

$$\overline{Nu}_D = 2 + 0.6Re_D^{1/2} Pr^{1/3} \quad (7.57)$$

In the limit  $Re_D \rightarrow 0$ , Equations 7.56 and 7.57 reduce to  $\overline{Nu}_D = 2$ , which corresponds to heat transfer by conduction from a spherical surface to a stationary, infinite medium around the surface, as may be derived from Case 1 of Table 4.1.

### EXAMPLE 7.6


The decorative plastic film on a copper sphere of 10-mm diameter is cured in an oven at 75°C. Upon removal from the oven, the sphere is subjected to an airstream at 1 atm and 23°C having a velocity of 10 m/s. Estimate how long it will take to cool the sphere to 35°C.

### SOLUTION

**Known:** Sphere cooling in an airstream.

**Find:** Time  $t$  required to cool from  $T_i = 75^\circ\text{C}$  to  $T(t) = 35^\circ\text{C}$ .

**Schematic:**

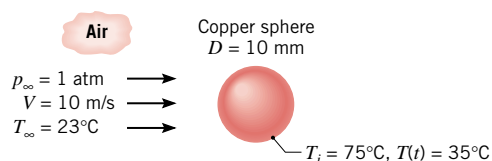

**Assumptions:**

1. Negligible thermal resistance and capacitance for the plastic film.
2. Spatially isothermal sphere.
3. Negligible radiation effects.

**Properties:** Table A.1, copper ( $T \approx 328$  K):  $\rho = 8933$  kg/m<sup>3</sup>,  $k = 399$  W/m · K,  $c_p = 388$  J/kg · K. Table A.4, air ( $T_\infty = 296$  K):  $\mu = 182.6 \times 10^{-7}$  N · s/m<sup>2</sup>,  $\nu = 15.53 \times 10^{-6}$  m<sup>2</sup>/s,  $k = 0.0251$  W/m · K,  $Pr = 0.708$ . Table A.4, air ( $T_s \approx 328$  K):  $\mu = 197.8 \times 10^{-7}$  N · s/m<sup>2</sup>.

**Analysis:** The time required to complete the cooling process may be obtained from results for a lumped capacitance. In particular, from Equations 5.4 and 5.5

$$t = \frac{\rho V c_p}{\bar{h} A_s} \ln \frac{T_i - T_\infty}{T - T_\infty}$$

or, with  $V = \pi D^3/6$  and  $A_s = \pi D^2$ ,

$$t = \frac{\rho c_p D}{6 \bar{h}} \ln \frac{T_i - T_\infty}{T - T_\infty}$$

From Equation 7.56

$$\overline{Nu}_D = 2 + (0.4 Re_D^{1/2} + 0.06 Re_D^{2/3}) Pr^{0.4} \left( \frac{\mu}{\mu_s} \right)^{1/4}$$

where

$$Re_D = \frac{VD}{\nu} = \frac{10 \text{ m/s} \times 0.01 \text{ m}}{15.53 \times 10^{-6} \text{ m}^2/\text{s}} = 6440$$

Hence the Nusselt number and the convection coefficient are

$$\begin{aligned} \overline{Nu}_D &= 2 + [0.4(6440)^{1/2} + 0.06(6440)^{2/3}](0.708)^{0.4} \\ &\times \left( \frac{182.6 \times 10^{-7} \text{ N} \cdot \text{s/m}^2}{197.8 \times 10^{-7} \text{ N} \cdot \text{s/m}^2} \right)^{1/4} = 47.1 \end{aligned}$$

$$\bar{h} = \overline{Nu}_D \frac{k}{D} = 47.1 \frac{0.0251 \text{ W/m} \cdot \text{K}}{0.01 \text{ m}} = 118 \text{ W/m}^2 \cdot \text{K}$$

The time required for cooling is then

$$t = \frac{8933 \text{ kg/m}^3 \times 387 \text{ J/kg} \cdot \text{K} \times 0.01 \text{ m}}{6 \times 118 \text{ W/m}^2 \cdot \text{K}} \ln \left( \frac{75 - 23}{35 - 23} \right) = 71.8 \text{ s} \quad \triangleleft$$

**Comments:**


1. The validity of the lumped capacitance method may be determined by calculating the Biot number. From Equation 5.10

$$Bi = \frac{\bar{h} L_c}{k_s} = \frac{\bar{h}(r_o/3)}{k_s} = \frac{118 \text{ W/m}^2 \cdot \text{K} \times 0.005 \text{ m/3}}{399 \text{ W/m} \cdot \text{K}} = 4.9 \times 10^{-4}$$


and the criterion is satisfied.



2. Although their definitions are similar, the Nusselt number is defined in terms of the thermal conductivity of the fluid, whereas the Biot number is defined in terms of the thermal conductivity of the solid.
3. Options for enhancing production rates include accelerating the cooling process by increasing the fluid velocity and/or using a different fluid. Applying the foregoing procedures, the cooling time is computed and plotted for air and helium over the range of velocities,  $5 \leq V \leq 25$  m/s.

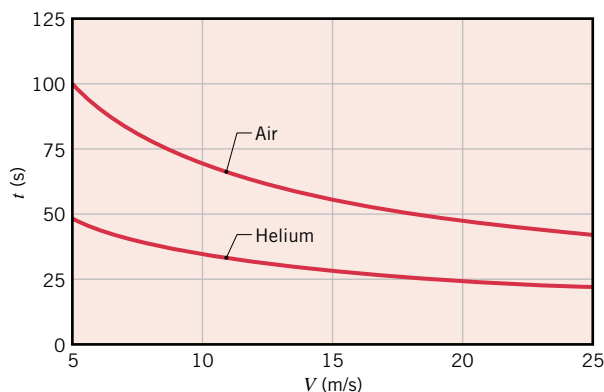

Although Reynolds numbers for He are much smaller than those for air, the thermal conductivity is much larger and, as shown below, convection heat transfer is enhanced.

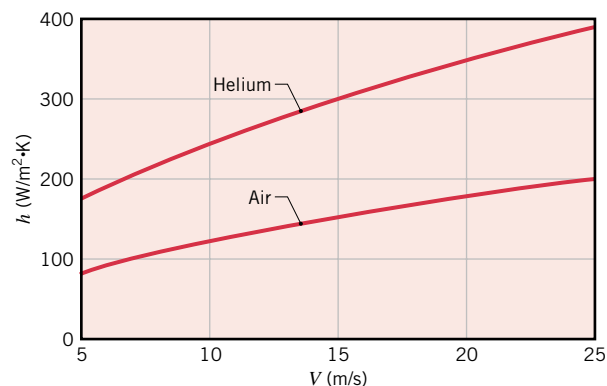

Hence production rates could be increased by substituting helium for air, albeit with a significant increase in cost.

## 7.6

### Flow across Banks of Tubes

Heat transfer to or from a bank (or bundle) of tubes in cross flow is relevant to numerous industrial applications, such as steam generation in a boiler or air cooling in the coil of an air conditioner. The geometric arrangement is shown schematically

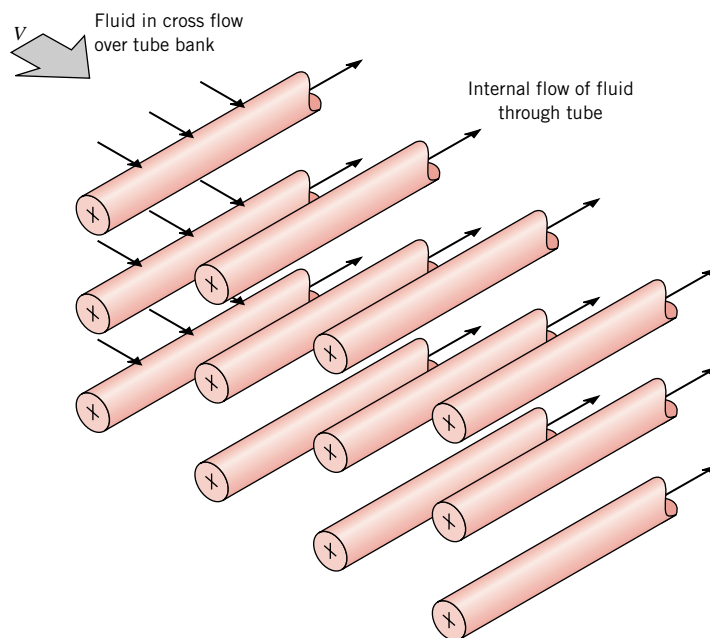


FIGURE 7.10 Schematic of a tube bank in cross flow.

in Figure 7.10. Typically, one fluid moves over the tubes, while a second fluid at a different temperature passes through the tubes. In this section we are specifically interested in the convection heat transfer associated with cross flow over the tubes.

The tube rows of a bank are either *staggered* or *aligned* in the direction of the fluid velocity  $V$  (Figure 7.11). The configuration is characterized by the tube diameter  $D$  and by the *transverse pitch*  $S_T$  and *longitudinal pitch*  $S_L$  measured between tube centers. Flow conditions within the bank are dominated by boundary layer separation effects and by wake interactions, which in turn influence convection heat transfer.

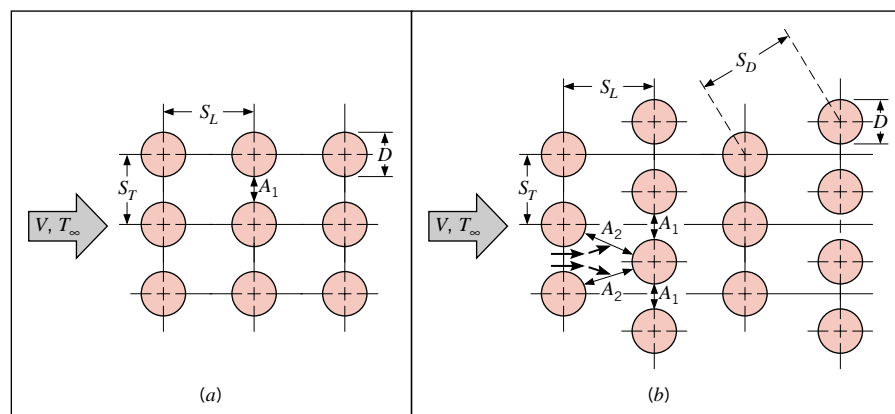


FIGURE 7.11 Tube arrangements in a bank. (a) Aligned. (b) Staggered.

The heat transfer coefficient associated with a tube is determined by its position in the bank. The coefficient for a tube in the first row is approximately equal to that for a single tube in cross flow, whereas larger heat transfer coefficients are associated with tubes of the inner rows. The tubes of the first few rows act as a turbulence-generating grid, which increases the heat transfer coefficient for tubes in the following rows. In most configurations, however, heat transfer conditions stabilize, such that little change occurs in the convection coefficient for a tube beyond the fourth or fifth row.

Generally, we wish to know the *average* heat transfer coefficient for the *entire* tube bundle. For airflow across tube bundles composed of 10 or more rows ( $N_L \geq 10$ ), Grimson [19] has obtained a correlation of the form

$$\overline{Nu}_D = C_1 Re_{D,\max}^m \left[ \begin{array}{l} N_L \geq 10 \\ 2000 \leq Re_{D,\max} \leq 40,000 \\ Pr = 0.7 \end{array} \right] \quad (7.58)$$

where  $C_1$  and  $m$  are listed in Table 7.5 and

$$Re_{D,\max} \equiv \frac{\rho V_{\max} D}{\mu} \quad (7.59)$$

It has become common practice to extend this result to other fluids through insertion of the factor  $1.13Pr^{1/3}$ , in which case

**TABLE 7.5** Constants of Equations 7.58 and 7.60 for airflow over a tube bank of 10 or more rows [19]

$S_L/D$	$S_T/D$							
	1.25		1.5		2.0		3.0	
	$C_1$	$m$	$C_1$	$m$	$C_1$	$m$	$C_1$	$m$
Aligned								
1.25	0.348	0.592	0.275	0.608	0.100	0.704	0.0633	0.752
1.50	0.367	0.586	0.250	0.620	0.101	0.702	0.0678	0.744
2.00	0.418	0.570	0.299	0.602	0.229	0.632	0.198	0.648
3.00	0.290	0.601	0.357	0.584	0.374	0.581	0.286	0.608
Staggered								
0.600	—	—	—	—	—	—	0.213	0.636
0.900	—	—	—	—	0.446	0.571	0.401	0.581
1.000	—	—	0.497	0.558	—	—	—	—
1.125	—	—	—	—	0.478	0.565	0.518	0.560
1.250	0.518	0.556	0.505	0.554	0.519	0.556	0.522	0.562
1.500	0.451	0.568	0.460	0.562	0.452	0.568	0.488	0.568
2.000	0.404	0.572	0.416	0.568	0.482	0.556	0.449	0.570
3.000	0.310	0.592	0.356	0.580	0.440	0.562	0.428	0.574

$$\overline{Nu}_D = 1.13 C_1 Re_{D,\max}^m Pr^{1/3} \quad (7.60)$$

$$\left[ \begin{array}{l} N_L \geq 10 \\ 2000 \leq Re_{D,\max} \leq 40,000 \\ Pr \geq 0.7 \end{array} \right]$$

All properties appearing in the above equations are evaluated at the film temperature. If  $N_L < 10$ , a correction factor may be applied such that

$$\overline{Nu}_D|_{(N_L < 10)} = C_2 \overline{Nu}_D|_{(N_L \geq 10)} \quad (7.61)$$

where  $C_2$  is given in Table 7.6.

The Reynolds number  $Re_{D,\max}$  for the foregoing correlations is based on the *maximum fluid velocity* occurring within the tube bank. For the aligned arrangement,  $V_{\max}$  occurs at the transverse plane  $A_1$  of Figure 7.11*a*, and from the mass conservation requirement for an incompressible fluid

$$V_{\max} = \frac{S_T}{S_T - D} V \quad (7.62)$$

For the staggered configuration, the maximum velocity may occur at either the transverse plane  $A_1$  or the diagonal plane  $A_2$  of Figure 7.11*b*. It will occur at  $A_2$  if the rows are spaced such that

$$2(S_D - D) < (S_T - D)$$

The factor of 2 results from the bifurcation experienced by the fluid moving from the  $A_1$  to the  $A_2$  planes. Hence  $V_{\max}$  occurs at  $A_2$  if

$$S_D = \left[ S_L^2 + \left( \frac{S_T}{2} \right)^2 \right]^{1/2} < \frac{S_T + D}{2}$$

in which case it is given by

$$V_{\max} = \frac{S_T}{2(S_D - D)} V \quad (7.63)$$

If  $V_{\max}$  occurs at  $A_1$  for the staggered configuration, it may again be computed from Equation 7.62.

**TABLE 7.6** Correction factor  $C_2$  of Equation 7.61 for  $N_L < 10$  [20]

$N_L$	1	2	3	4	5	6	7	8	9
Aligned	0.64	0.80	0.87	0.90	0.92	0.94	0.96	0.98	0.99
Staggered	0.68	0.75	0.83	0.89	0.92	0.95	0.97	0.98	0.99

**TABLE 7.7** Constants of Equation 7.64 for the tube bank in cross flow [15]

Configuration	$Re_{D,\max}$	$C$	$m$
Aligned	$10\text{--}10^2$	0.80	0.40
Staggered	$10\text{--}10^2$	0.90	0.40
Aligned	$10^2\text{--}10^3$	Approximate as a single (isolated) cylinder	
Staggered	$10^2\text{--}10^3$		
Aligned ( $S_T/S_L > 0.7$ ) <sup>a</sup>	$10^3\text{--}2 \times 10^5$	0.27	0.63
Staggered ( $S_T/S_L < 2$ )	$10^3\text{--}2 \times 10^5$	$0.35(S_T/S_L)^{1/5}$	0.60
Staggered ( $S_T/S_L > 2$ )	$10^3\text{--}2 \times 10^5$	0.40	0.60
Aligned	$2 \times 10^5\text{--}2 \times 10^6$	0.021	0.84
Staggered	$2 \times 10^5\text{--}2 \times 10^6$	0.022	0.84

<sup>a</sup>For  $S_T/S_L < 0.7$ , heat transfer is inefficient and aligned tubes should not be used.

More recent results have been obtained and Zukauskas [15] has proposed a correlation of the form

$$\overline{Nu}_D = C Re_{D,\max}^m Pr_s^{0.36} \left( \frac{Pr}{Pr_s} \right)^{1/4} \quad (7.64)$$

$$\left[ \begin{array}{l} N_L \geq 20 \\ 0.7 \leq Pr \leq 500 \\ 1000 \leq Re_{D,\max} \leq 2 \times 10^6 \end{array} \right]$$


where all properties except  $Pr_s$  are evaluated at the arithmetic mean of the fluid inlet and outlet temperatures and the constants  $C$  and  $m$  are listed in Table 7.7. The need to evaluate fluid properties at the arithmetic mean of the inlet ( $T_i = T_\infty$ ) and outlet ( $T_o$ ) temperatures is dictated by the fact that the fluid temperature will decrease or increase, respectively, due to heat transfer to or from the tubes. If the fluid temperature change,  $|T_i - T_o|$ , is large, significant error could result from evaluation of the properties at the inlet temperature. If  $N_L < 20$ , a correction factor may be applied such that

$$\overline{Nu}_D|_{(N_L < 20)} = C_2 \overline{Nu}_D|_{(N_L \geq 20)} \quad (7.65)$$

where  $C_2$  is given in Table 7.8.

**TABLE 7.8** Correction factor  $C_2$  of Equation 7.65 for  $N_L < 20$  ( $Re_{D,\max} \geq 10^3$ ) [15]

$N_L$	1	2	3	4	5	7	10	13	16
Aligned	0.70	0.80	0.86	0.90	0.92	0.95	0.97	0.98	0.99
Staggered	0.64	0.76	0.84	0.89	0.92	0.95	0.97	0.98	0.99

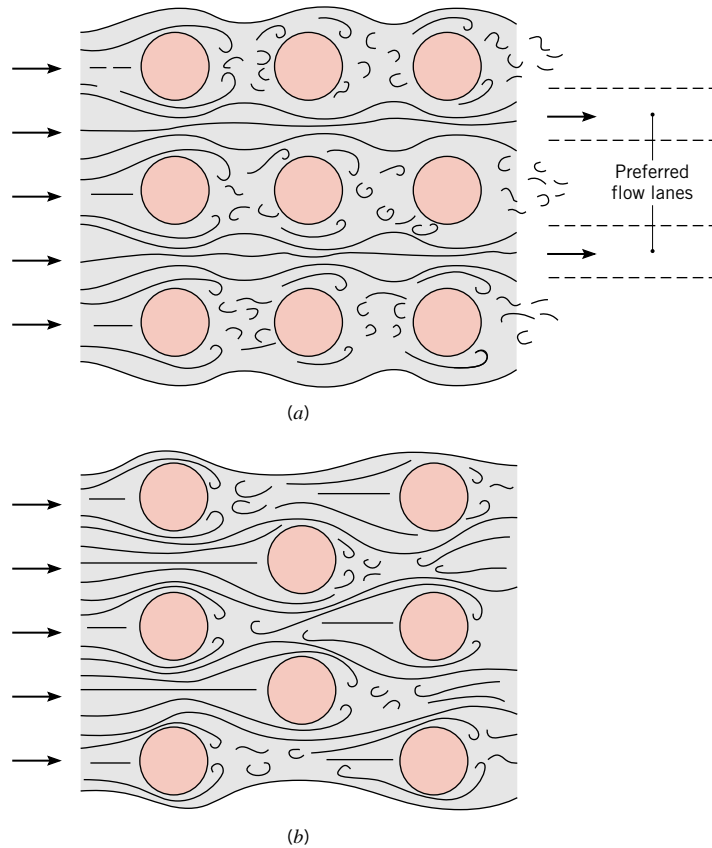

**FIGURE 7.12** Flow conditions for (a) aligned and (b) staggered tubes.

Flow around tubes in the first row of a tube bank corresponds to that for a single (isolated) cylinder in cross flow. However, for subsequent rows, flow depends strongly on the tube bank arrangement (Figure 7.12). Aligned tubes beyond the first row are in the turbulent wakes of upstream tubes, and for moderate values of  $S_L$  convection coefficients associated with downstream rows are enhanced by turbulence of the flow. Typically, the convection coefficient of a row increases with increasing row number until approximately the fifth row, after which there is little change in the turbulence and hence in the convection coefficient. However, for small values of  $S_T/S_L$ , upstream rows, in effect, shield downstream rows from much of the flow, and heat transfer is adversely affected. That is, the preferred flow path is in lanes between the tubes and much of the tube surface is not exposed to the main flow. For this reason, operation of aligned tube banks with  $S_T/S_L < 0.7$  (Table 7.7) is undesirable. For the staggered array, however, the path of the main flow is more tortuous and a greater portion of the surface area of downstream tubes remains in this path. In general, heat transfer enhancement is favored by the more tortuous flow of a staggered arrangement, particularly for small Reynolds number ( $Re_D \lesssim 100$ ).

Since the fluid may experience a large change in temperature as it moves through the tube bank, the heat transfer rate could be significantly overpredicted by using  $\Delta T = T_s - T_\infty$  as the temperature difference in Newton's law of cooling. As

the fluid moves through the bank, its temperature approaches  $T_s$  and  $|\Delta T|$  decreases. In Chapter 11 the appropriate form of  $\Delta T$  is shown to be a *log-mean temperature difference*,

$$\Delta T_{\text{lm}} = \frac{(T_s - T_i) - (T_s - T_o)}{\ln\left(\frac{T_s - T_i}{T_s - T_o}\right)} \quad (7.66)$$

where  $T_i$  and  $T_o$  are temperatures of the fluid as it enters and leaves the bank, respectively. The outlet temperature, which is needed to determine  $\Delta T_{\text{lm}}$ , may be estimated from


$$\frac{T_s - T_o}{T_s - T_i} = \exp\left(-\frac{\pi DN \bar{h}}{\rho V N_T S_T c_p}\right) \quad (7.67)$$

where  $N$  is the total number of tubes in the bank and  $N_T$  is the number of tubes in the transverse plane. Once  $\Delta T_{\text{lm}}$  is known, the heat transfer rate per unit length of the tubes may be computed from


$$q' = N(\bar{h}\pi D \Delta T_{\text{lm}}) \quad (7.68)$$

The foregoing results may be used to determine mass transfer rates associated with evaporation or sublimation from the surfaces of a bank of cylinders in cross flow. Once again it is only necessary to replace  $\bar{Nu}_D$  and  $Pr$  by  $Sh_D$  and  $Sc$ , respectively.

We close by recognizing that there is generally as much interest in the pressure drop associated with flow across a tube bank as in the overall heat transfer rate. The power required to move the fluid across the bank is often a major operating expense and is directly proportional to the pressure drop, which may be expressed as [15]

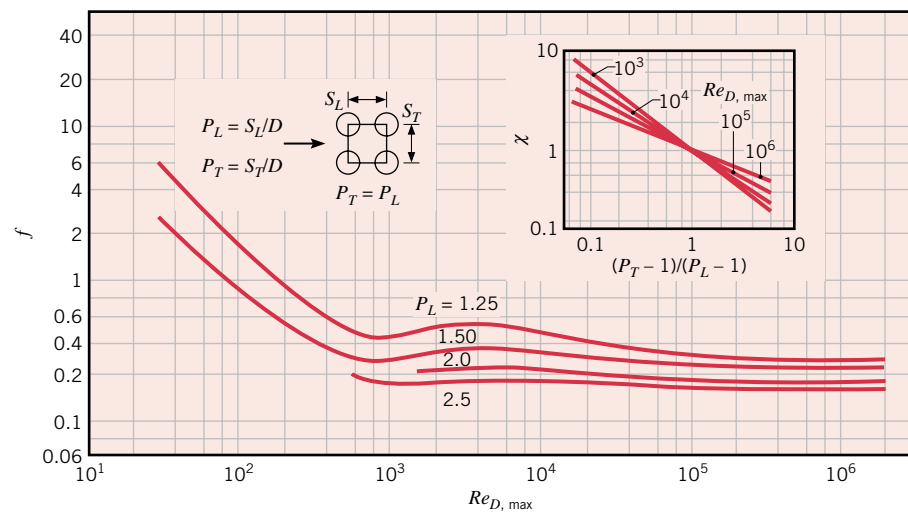

**FIGURE 7.13** Friction factor  $f$  and correction factor  $\chi$  for Equation 7.69. In-line tube bundle arrangement [15]. Used with permission.

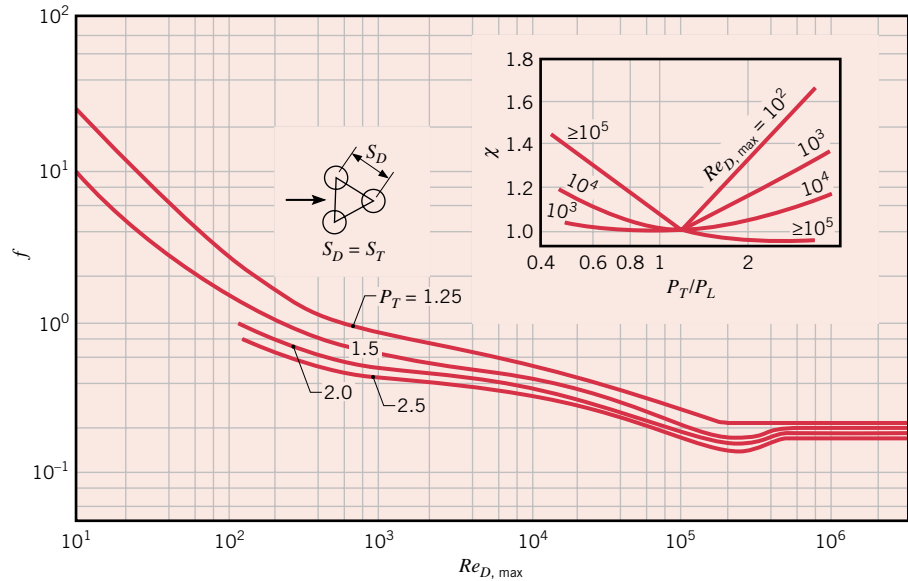

**FIGURE 7.14** Friction factor  $f$  and correction factor  $\chi$  for Equation 7.69. Staggered tube bundle arrangement [15]. Used with permission.

$$\Delta p = N_L \chi \left( \frac{\rho V_{\max}^2}{2} \right) f \quad (7.69)$$

The friction factor  $f$  and the correction factor  $\chi$  are plotted in Figures 7.13 and 7.14. Figure 7.13 pertains to a square, in-line tube arrangement for which the dimensionless longitudinal and transverse pitches,  $P_L = S_L/D$  and  $P_T = S_T/D$ , respectively, are equal. The correction factor  $\chi$ , plotted in the inset, is used to apply the results to other in-line arrangements. Similarly, Figure 7.14 applies to a staggered arrangement of tubes in the form of an equilateral triangle ( $S_T = S_D$ ), and the correction factor enables extension of the results to other staggered arrangements. Note that the Reynolds number appearing in Figures 7.13 and 7.14 is based on the maximum fluid velocity  $V_{\max}$ .

### EXAMPLE 7.7

Pressurized water is often available at elevated temperatures and may be used for space heating or industrial process applications. In such cases it is customary to use a tube bundle in which the water is passed through the tubes, while air is passed in cross flow over the tubes. Consider a staggered arrangement for which the tube outside diameter is 16.4 mm and the longitudinal and transverse pitches are  $S_L = 34.3$  mm and  $S_T = 31.3$  mm. There are seven rows of tubes in the airflow direction and eight tubes per row. Under typical operating conditions the cylinder surface temperature is at 70°C, while the air upstream temperature and velocity are 15°C and 6 m/s, respectively. Determine the air-side convection coefficient and the rate of heat transfer for the tube bundle. What is the air-side pressure drop?




**SOLUTION**

**Known:** Geometry and operating conditions of a tube bank.

**Find:**

1. Air-side convection coefficient and heat rate.
2. Pressure drop.

**Schematic:**

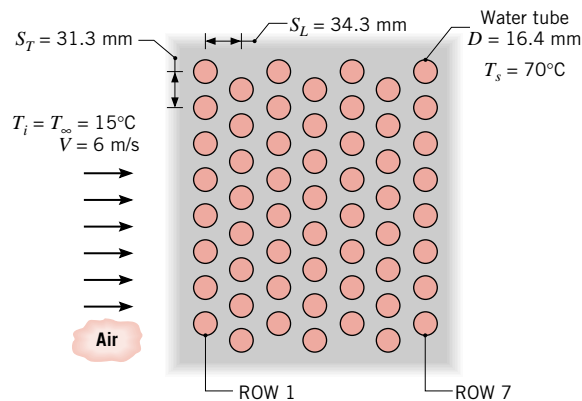

**Assumptions:**

1. Steady-state conditions.
2. Negligible radiation effects.
3. Negligible effect of change in air temperature across tube bank on air properties.

**Properties:** Table A.4, air ( $T_\infty = 15^\circ\text{C}$ ):  $\rho = 1.217 \text{ kg/m}^3$ ,  $c_p = 1007 \text{ J/kg} \cdot \text{K}$ ,  $\nu = 14.82 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k = 0.0253 \text{ W/m} \cdot \text{K}$ ,  $Pr = 0.710$ . Table A.4, air ( $T_s = 70^\circ\text{C}$ ):  $Pr = 0.701$ . Table A.4, air ( $T_f = 43^\circ\text{C}$ ):  $\nu = 17.4 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k = 0.0274 \text{ W/m} \cdot \text{K}$ ,  $Pr = 0.705$ .

**Analysis:**

1. From Equations 7.64 and 7.65, the air-side Nusselt number is

$$\overline{Nu}_D = C_2 C Re_{D,\max}^m Pr^{0.36} \left( \frac{Pr}{Pr_s} \right)^{1/4}$$

Since  $S_D = [S_L^2 + (S_T/2)^2]^{1/2} = 37.7 \text{ mm}$  is greater than  $(S_T + D)/2$ , the maximum velocity occurs on the transverse plane,  $A_1$ , of Figure 7.11. Hence from Equation 7.62

$$V_{\max} = \frac{S_T}{S_T - D} V = \frac{31.3 \text{ mm}}{(31.3 - 16.4) \text{ mm}} 6 \text{ m/s} = 12.6 \text{ m/s}$$

With

$$Re_{D,\max} = \frac{V_{\max} D}{\nu} = \frac{12.6 \text{ m/s} \times 0.0164 \text{ m}}{14.82 \times 10^{-6} \text{ m}^2/\text{s}} = 13,943$$

and

$$\frac{S_T}{S_L} = \frac{31.3 \text{ mm}}{34.3 \text{ mm}} = 0.91 < 2$$

it follows from Tables 7.7 and 7.8 that

$$C = 0.35 \left( \frac{S_T}{S_L} \right)^{1/5} = 0.34, \quad m = 0.60, \quad \text{and} \quad C_2 = 0.95$$

Hence

$$\overline{Nu}_D = 0.95 \times 0.34 (13,943)^{0.60} (0.71)^{0.36} \left( \frac{0.710}{0.701} \right)^{0.25} = 87.9$$

and

$$\bar{h} = \overline{Nu}_D \frac{k}{D} = 87.9 \times \frac{0.0253 \text{ W/m} \cdot \text{K}}{0.0164 \text{ m}} = 135.6 \text{ W/m}^2 \cdot \text{K}$$

From Equation 7.67

$$T_s - T_o = (T_s - T_i) \exp \left( - \frac{\pi D N \bar{h}}{\rho V N_T S_T C_p} \right)$$

$$T_s - T_o = (55^\circ\text{C}) \exp \left( - \frac{\pi (0.0164 \text{ m}) 56 (135.6 \text{ W/m}^2 \cdot \text{K})}{1.217 \text{ kg/m}^3 (6 \text{ m/s}) 8 (0.0313 \text{ m}) 1007 \text{ J/kg} \cdot \text{K}} \right)$$

$$T_s - T_o = 44.5^\circ\text{C}$$

Hence from Equations 7.66 and 7.68

$$\Delta T_{\text{lm}} = \frac{(T_s - T_i) - (T_s - T_o)}{\ln \left( \frac{T_s - T_i}{T_s - T_o} \right)} = \frac{(55 - 44.5)^\circ\text{C}}{\ln \left( \frac{55}{44.5} \right)} = 49.6^\circ\text{C}$$

and

$$q' = N(\bar{h} \pi D \Delta T_{\text{lm}}) = 56 \pi \times 135.6 \text{ W/m}^2 \cdot \text{K} \times 0.0164 \text{ m} \times 49.6^\circ\text{C}$$

$$q' = 19.4 \text{ kW/m}$$

2. The pressure drop may be obtained from Equation 7.69.

$$\Delta p = N_L \chi \left( \frac{\rho V_{\text{max}}^2}{2} \right) f$$

With  $Re_{D, \text{max}} = 13,943$ ,  $P_T = (S_T/D) = 1.91$ , and  $(P_T/P_L) = 0.91$ , it follows from Figure 7.14 that  $\chi \approx 1.04$  and  $f \approx 0.35$ . Hence with  $N_L = 7$

$$\Delta p = 7 \times 1.04 \left[ \frac{1.217 \text{ kg/m}^3 (12.6 \text{ m/s})^2}{2} \right] 0.35$$


$$\Delta p = 246 \text{ N/m}^2 = 2.46 \times 10^{-3} \text{ bars}$$

### Comments:


1. With properties evaluated at  $T_f$ ,  $Re_{D, \text{max}} = 11,876$ . With  $S_T/D \approx 2$  and  $S_L/D \approx 2$ , it follows from Tables 7.5 and 7.6 that  $C_1 = 0.482$ ,  $m = 0.556$ , and  $C_2 = 0.97$ . From

Equations 7.60 and 7.61, the Nusselt number is then  $\overline{Nu}_D = 86.7$ , and  $\bar{h} = 144.8 \text{ W/m}^2 \cdot \text{K}$ . Values of  $\bar{h}$  obtained from Equations 7.60 and 7.64 therefore agree to within 7%, which is well within their uncertainties.

2. Had  $\Delta T_i \equiv T_s - T_i$  been used in lieu of  $\Delta T_{lm}$  in Equation 7.68, the heat rate would have been overpredicted by 11%.
3. Since the air temperature is predicted to increase by only  $10.5^\circ\text{C}$ , evaluation of the air properties at  $T_i = 15^\circ\text{C}$  is a reasonable approximation. However, if improved accuracy is desired, the calculations could be repeated with the properties reevaluated at  $(T_i + T_o)/2 = 20.25^\circ\text{C}$ . An exception pertains to the density  $\rho$  in the exponential term of Equation 7.67. As it appears in the denominator of this term,  $\rho$  is matched with the inlet velocity to provide a product ( $\rho V$ ) that is linked to the mass flow rate of air entering the tube bank. Hence, in this term,  $\rho$  should be evaluated at  $T_i$ .
4. The air outlet temperature and heat rate may be increased by increasing the number of tube rows, and for a fixed number of rows, they may be varied by adjusting the air velocity. For  $5 \leq N_L \leq 25$  and  $V = 6 \text{ m/s}$ , parametric calculations based on Equations 7.64 through 7.68 yield the following results:

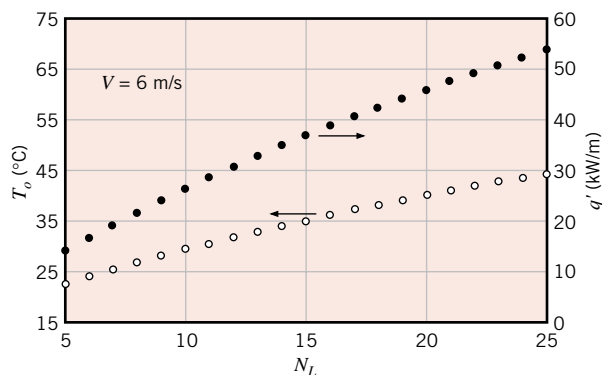

The air outlet temperature would asymptotically approach the surface temperature with increasing  $N_L$ , at which point the heat rate approaches a constant value and there is no advantage to adding more tube rows. Note that  $\Delta p$  increases linearly with increasing  $N_L$ . For  $N_L = 25$  and  $1 \leq V \leq 20 \text{ m/s}$ , we obtain

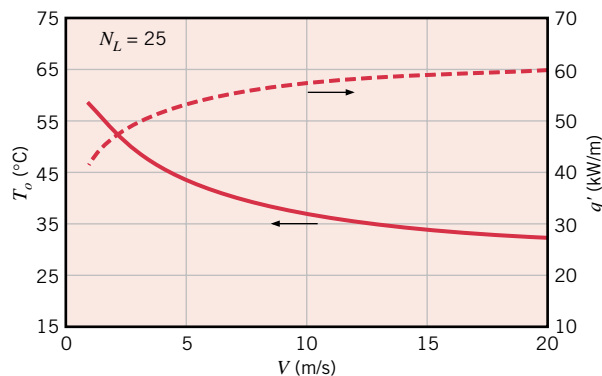

Although the heat rate increases with increasing  $V$ , the air outlet temperature decreases, approaching  $T_i$  as  $V \rightarrow \infty$ .

## 7.7 Impinging Jets

A single gas jet or an array of such jets, impinging normally on a surface, may be used to achieve enhanced coefficients for convective heating, cooling, or drying. Applications include tempering of glass plate, annealing of metal sheets, drying of textile and paper products, cooling of heated components in gas turbine engines, and deicing of aircraft systems.

### 7.7.1 Hydrodynamic and Geometric Considerations

As shown in Figure 7.15, gas jets are typically discharged into a quiescent ambient from a round nozzle of diameter  $D$  or a slot (rectangular) nozzle of width  $W$ . Typically, the jet is turbulent and, at the nozzle exit, is characterized by a uniform velocity profile. However, with increasing distance from the exit, momentum exchange between the jet and the ambient causes the free boundary of the jet to broaden and the *potential core*, within which the uniform exit velocity is retained, to contract. Downstream of the potential core the velocity profile is nonuniform over the entire

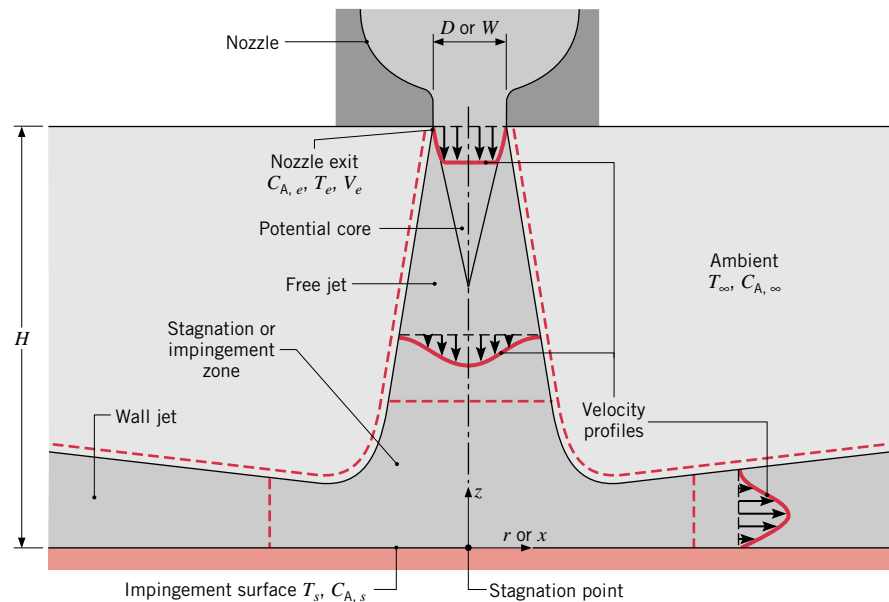



FIGURE 7.15 Surface impingement of a single round or slot gas jet.

jet cross section and the maximum (center) velocity decreases with increasing distance from the nozzle exit. The region of the flow over which conditions are unaffected by the impingement (target) surface is termed the *free jet*.


Within the *stagnation* or *impingement zone*, flow is influenced by the target surface and is decelerated and accelerated in the normal ( $z$ ) and transverse ( $r$  or  $x$ ) directions, respectively. However, since the flow continues to entrain zero momentum fluid from the ambient, transverse acceleration cannot continue indefinitely and accelerating flow in the stagnation zone is transformed to a decelerating *wall jet*. Hence, with increasing  $r$  or  $x$ , velocity components parallel to the surface increase from a value of zero to some maximum and subsequently decay to zero. Velocity profiles within the wall jet are characterized by zero velocity at both the impingement and free surfaces. If  $T_s \neq T_e$  and/or  $C_{A,s} \neq C_{A,e}$ , convection heat and/or mass transfer occurs in both the stagnation and wall jet regions.

Many impingement heat (mass) transfer schemes involve an array of jets, as, for example, the array of slot jets shown in Figure 7.16. In addition to flow from each nozzle exhibiting free jet, stagnation, and wall jet regions, secondary stagnation zones result from the interaction of adjoining wall jets. In many such schemes the jets are discharged into a restricted volume bounded by the target surface and the nozzle plate from which the jets originate. The overall rate of heat (mass) transfer depends strongly on the manner in which *spent gas*, whose temperature (species concentration) is between values associated with the nozzle exit and the impingement surface, is vented from the system. For the configuration of Figure 7.16, spent gas cannot flow upward between the nozzles but must instead flow symmetrically in the  $\pm y$  directions. As the temperature (surface cooling) or species concentration (surface evaporation) of the gas increases with increasing  $|y|$ , the local surface-to-gas temperature or concentration difference decreases, causing a reduction in local convection fluxes. A preferable situation is one for which the space between adjoining nozzles is open to the ambient, thereby permitting continuous upflow and direct discharge of the spent gas.

Plan (top) views of single round and slot nozzles, as well as regular arrays of round and slot nozzles, are shown in Figure 7.17. For the isolated nozzles (Figures 7.17a, d), local and average convection coefficients are associated with any  $r > 0$  and  $x > 0$ . For the arrays, with discharge of the spent gas in the vertical ( $z$ ) direction, symmetry dictates equivalent local and average values for each of the unit cells delineated by dashed lines. For a large number of square-in-line (Figure 7.17b)

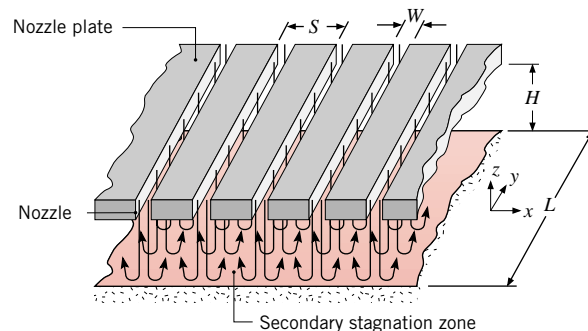

**FIGURE 7.16** Surface impingement of an array of slot jets.

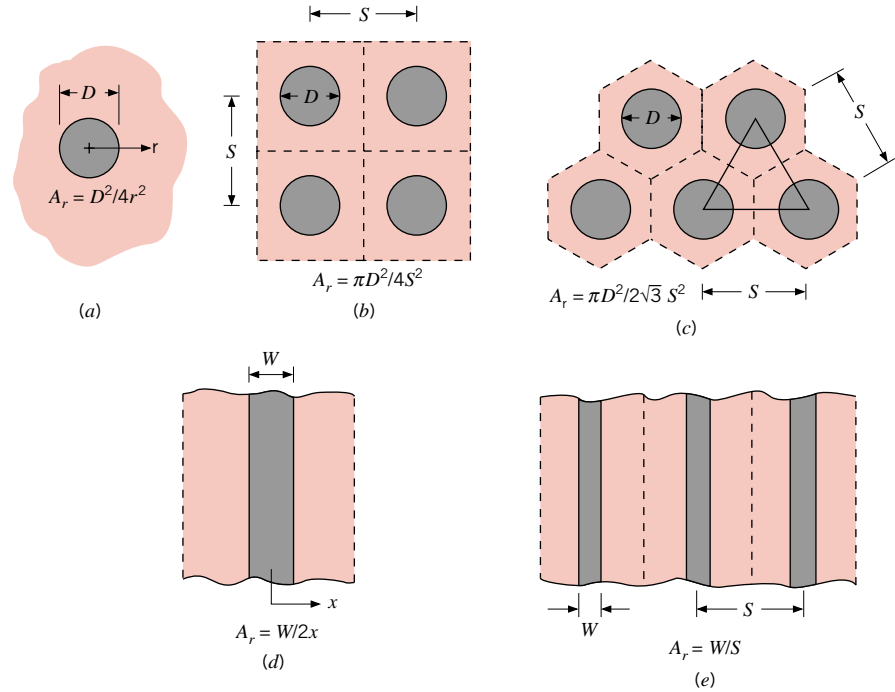

**FIGURE 7.17** Plan view of pertinent geometrical features for (a) single round jet, (b) in-line array of round jets, (c) staggered array of round jets, (d) single slot jet, and (e) array of slot jets.

or equilaterally staggered (Figure 7.17c) round jets, the unit cells correspond to a square or hexagon, respectively. A pertinent geometric parameter is the relative nozzle area, which is defined as the ratio of the nozzle exit cross-sectional area to the surface area of the cell ( $A_r \equiv A_{c,e}/A_{\text{cell}}$ ). In each case,  $S$  represents the pitch of the array.


### 7.7.2 Convection Heat and Mass Transfer

In the results that follow, it is presumed that the gas jet exits its nozzle with a uniform velocity  $V_e$ , temperature  $T_e$ , and species concentration  $C_{A,e}$ . Thermal and compositional equilibrium with the ambient are presumed ( $T_e = T_\infty$ ,  $C_{A,e} = C_{A,\infty}$ ), while convection heat and/or mass transfer may occur at an impingement surface of uniform temperature and/or species composition ( $T_s \neq T_e$ ,  $C_{A,s} \neq C_{A,e}$ ). Newton's law of cooling and its mass transfer analog are then

$$q'' = h(T_s - T_e) \quad (7.70)$$

$$N''_A = h_m(C_{A,s} - C_{A,e}) \quad (7.71)$$

Conditions are presumed to be uninfluenced by the level of turbulence at the nozzle exit, and the surface is presumed to be stationary. However, this requirement may be relaxed for surface velocities which are much less than the jet impact velocity.

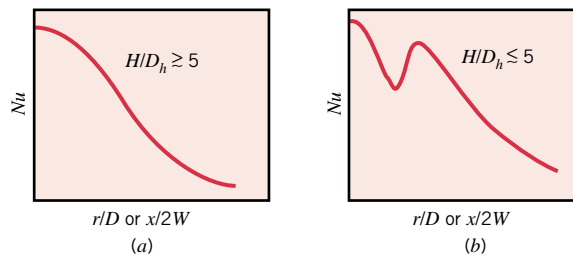

**FIGURE 7.18**  
Distribution of local Nusselt number associated with a single round or slot nozzle for (a) large and (b) small relative nozzle-to-plate spacings.

An extensive review of available convection coefficient data for impinging gas jets has been performed by Martin [21], and for a single round or slot nozzle, distributions of the *local* Nusselt number have the characteristic forms shown in Figure 7.18. The characteristic length is the *hydraulic diameter* of the nozzle, which is defined as four times its cross-sectional area divided by its wetted perimeter ( $D_h \equiv 4A_{c,e}/P$ ). Hence the characteristic length is the diameter of a round nozzle, and assuming  $L \gg W$ , it is twice the width of a slot nozzle. It follows that  $Nu = hD/k$  for a round nozzle and  $Nu = h(2W/k)$  for a slot nozzle. For large nozzle-to-plate separations, Figure 7.18a, the distribution is characterized by a bell-shaped curve for which  $Nu$  monotonically decays from a maximum value at the *stagnation point*,  $r/D$  or  $x/2W$  equal to zero.

For small separations, Figure 7.18b, the distribution is characterized by a second maximum, whose value increases with increasing jet Reynolds number and may exceed that of the first maximum. The threshold separation of  $H/D \approx 5$ , below which there is a second maximum, is loosely associated with the length of the potential core (Figure 7.15). Appearance of the second maximum is attributed to a sharp rise in the turbulence level which accompanies the transition from an accelerating stagnation region flow to a decelerating wall jet [21]. Additional maxima have been observed and attributed to the formation of vortices in the stagnation zone, as well as transition to a turbulent wall jet [22].

Secondary maxima in  $Nu$  are also associated with the interaction of adjoining wall jets for an array [21, 23]. However, distributions are two-dimensional, exhibiting, for example, variations with both  $x$  and  $y$  for the slot jet array of Figure 7.16. Variations with  $x$  could be expected to yield maxima at the jet centerline and halfway between adjoining jets, while constraint of the exhaust flow to the  $\pm y$  direction would induce acceleration with increasing  $|y|$  and hence a monotonically increasing  $Nu$  with  $|y|$ . However, variations with  $y$  decrease with increasing cross-sectional area of the outflow and may be neglected if  $S \times H \geq W \times L$  [21].

Average Nusselt numbers may be obtained by integrating local results over the appropriate surface area. The resulting correlations are reported in the form

$$\overline{Nu} = f(Re, Pr, A_r, H/D_h) \quad (7.72)$$

where

$$\overline{Nu} \equiv \frac{\overline{h}D_h}{k} \quad (7.73)$$

$$Re = \frac{V_e D_h}{\nu} \quad (7.74)$$

and  $D_h = D$  (round nozzle) or  $D_h = 2W$  (slot nozzle).

**Round Nozzles** Having assessed data from several sources, Martin [21] recommends the following correlation for a *single round nozzle* ( $A_r = D^2/4r^2$ )

$$\frac{\overline{Nu}}{Pr^{0.42}} = G\left(A_r, \frac{H}{D}\right) [2Re^{1/2}(1 + 0.005Re^{0.55})^{1/2}] \quad (7.75)$$

where

$$G = 2A_r^{1/2} \frac{1 - 2.2A_r^{1/2}}{1 + 0.2(H/D - 6)A_r^{1/2}} \quad (7.76)$$

The ranges of validity are

$$\left[ \begin{array}{l} 2000 \leq Re \leq 400,000 \\ 2 \leq H/D \leq 12 \\ 0.004 \leq A_r \leq 0.04 \end{array} \right]$$

For  $A_r \geq 0.04$ , results for  $\overline{Nu}$  are available in graphical form [21].

For an *array of round nozzles* ( $A_r = \pi D^2/4S^2$  or  $\pi D^2/2\sqrt{3}S^2$  (for in-line and staggered arrays, respectively),

$$\frac{\overline{Nu}}{Pr^{0.42}} = 0.5K\left(A_r, \frac{H}{D}\right) G\left(A_r, \frac{H}{D}\right) Re^{2/3} \quad (7.77)$$

where

$$K = \left[ 1 + \left( \frac{H/D}{0.6/A_r^{1/2}} \right)^6 \right]^{-0.05} \quad (7.78)$$

and  $G$  is the single nozzle function given by Equation 7.76. The function  $K$  accounts for the fact that, for  $H/D \geq 0.6/A_r^{1/2}$ , the average Nusselt number for the array decays more rapidly with increasing  $H/D$  than that for the single nozzle. The correlation is valid over the ranges

$$\left[ \begin{array}{l} 2000 \leq Re \leq 100,000 \\ 2 \leq H/D \leq 12 \\ 0.004 \leq A_r \leq 0.04 \end{array} \right]$$

**Slot Nozzles** For a *single slot nozzle* ( $A_r = W/2x$ ), the recommended correlation is

$$\frac{\overline{Nu}}{Pr^{0.42}} = \frac{3.06}{0.5/A_r + H/W + 2.78} Re^m \quad (7.79)$$

where

$$m = 0.695 - \left[ \left( \frac{1}{4A_r} \right) + \left( \frac{H}{2W} \right)^{1.33} + 3.06 \right]^{-1} \quad (7.80)$$

and the ranges of validity are

$$\left[ \begin{array}{l} 3000 \leq Re \leq 90,000 \\ 2 \leq H/W \leq 10 \\ 0.025 \leq A_r \leq 0.125 \end{array} \right]$$



As a *first approximation*, Equation 7.79 may be used for  $A_r \geq 0.125$ , yielding predictions for the stagnation point ( $x = 0, A_r \rightarrow \infty$ ) that are within 40% of measured values.

For an *array of slot nozzles* ( $A_r = W/S$ ), the recommended correlation is

$$\frac{\overline{Nu}}{Pr^{0.42}} = \frac{2}{3} A_{r,o}^{3/4} \left( \frac{2Re}{A_r/A_{r,o} + A_{r,o}/A_r} \right)^{2/3} \quad (7.81)$$

where

$$A_{r,o} = \left[ 60 + 4 \left( \frac{H}{2W} - 2 \right)^2 \right]^{-1/2} \quad (7.82)$$

The correlation pertains to conditions for which the outflow of spent gas is restricted to the  $\pm y$ -directions of Figure 7.16 and the outflow area is large enough to satisfy the requirement  $(S \times H)/(W \times L) \geq 1$ . Additional restrictions are

$$\begin{bmatrix} 1500 \leq Re \leq 40,000 \\ 2 \leq H/W \leq 80 \\ 0.008 \leq A_r \leq 2.5A_{r,o} \end{bmatrix}$$

An *optimal* arrangement of nozzles would be one for which the values of  $H$ ,  $S$ , and  $D_h$  yielded the largest value of  $\overline{Nu}$  for a prescribed total gas flow rate per unit surface area of the target. For fixed  $H$  and for arrays of both round and slot nozzles, optimal values of  $D_h$  and  $S$  have been found to be [21]

$$D_{h,op} \approx 0.2H \quad (7.83)$$

$$S_{op} \approx 1.4H \quad (7.84)$$

The optimum value of  $(D_h/H)^{-1} \approx 5$  coincides approximately with the length of the potential core. Beyond the potential core, the midline jet velocity decays, causing an attendant reduction in convection coefficients.

Invoking the heat and mass transfer analogy by substituting  $\overline{Sh}/Sc^{0.42}$  for  $\overline{Nu}/Pr^{0.42}$ , the foregoing correlations may also be applied to convection mass transfer. However, for both heat and mass transfer, application of the equations should be restricted to conditions for which they were developed. For example, in their present form, the correlations may not be used if the jets emanate from sharp-edged orifices instead of bell-shaped nozzles. The orifice jet is strongly affected by a flow contraction phenomenon that alters convection heat or mass transfer [21, 22]. In the case of convection heat transfer, conditions are also influenced by differences between the jet exit and ambient temperatures ( $T_e \neq T_\infty$ ). The exit temperature is then an inappropriate temperature in Newton's law of cooling, Equation 7.70, and should be replaced by what is commonly termed the recovery, or adiabatic wall, temperature [24, 25].

## 7.8

### Packed Beds

Gas flow through a *packed bed* of solid particles (Figure 7.19) is relevant to many industrial processes, which include the transfer and storage of thermal energy, heterogeneous catalytic reactions, and drying. The term *packed bed* refers to a




FIGURE 7.19

Gas flow through a packed bed of solid particles.

condition for which the position of the particles is *fixed*. In contrast, a *fluidized bed* is one for which the particles are in motion due to advection with the fluid.

For a packed bed a large amount of heat or mass transfer surface area can be obtained in a small volume, and the irregular flow that exists in the voids of the bed enhances transport through turbulent mixing. Many correlations that have been developed for different particle shapes, sizes, and packing densities are described in the literature [26–29]. One such correlation, which has been recommended for gas flow in a bed of spheres, is of the form

$$\varepsilon \bar{j}_H = \varepsilon \bar{j}_m = 2.06 Re_D^{-0.575} \left[ \begin{array}{l} Pr \text{ (or } Sc) \approx 0.7 \\ 90 \leq Re_D \leq 4000 \end{array} \right] \quad (7.85)$$

where  $\bar{j}_H$  and  $\bar{j}_m$  are the Colburn  $j$  factors defined by Equations 6.70 and 6.71. The Reynolds number  $Re_D = VD/\nu$  is defined in terms of the sphere diameter and the upstream velocity  $V$  that would exist in the empty channel without the packing. The quantity  $\varepsilon$  is the *porosity*, or *void fraction*, of the bed (volume of void space per unit volume of bed), and its value typically ranges from 0.30 to 0.50. The correlation may be applied to packing materials other than spheres by multiplying the right-hand side by an appropriate correction factor. For a bed of uniformly sized cylinders, with length-to-diameter ratio of 1, the factor is 0.79; for a bed of cubes it is 0.71.

In using Equation 7.85, properties should be evaluated at the arithmetic mean of the fluid temperatures entering and leaving the bed. If the particles are at a uniform temperature  $T_s$ , the heat transfer rate for the bed may be computed from

$$q = \bar{h} A_{p,t} \Delta T_{lm} \quad (7.86)$$

where  $A_{p,t}$  is the total surface area of the particles and  $\Delta T_{lm}$  is the log-mean temperature difference defined by Equation 7.66. The outlet temperature, which is needed to compute  $\Delta T_{lm}$ , may be estimated from

$$\frac{T_s - T_o}{T_s - T_i} = \exp \left( - \frac{\bar{h} A_{p,t}}{\rho V A_{c,b} c_p} \right) \quad (7.87)$$

where  $\rho$  and  $V$  are the inlet density and velocity, respectively, and  $A_{c,b}$  is the bed (channel) cross-sectional area.

## 7.9

## Summary

In this chapter we have considered *forced convection* heat and mass transfer for an important class of problems involving *external flow* at low-to-moderate speeds. Consideration was given to several common geometries, for which convection coefficients depend on the nature of boundary layer development. You should test your understanding of related concepts by addressing the following questions.

- What is an *external flow*?
- How does the velocity boundary layer thickness vary with distance from the leading edge for *laminar flow* over a flat plate? For *turbulent flow*? What determines the relative velocity, thermal, and concentration boundary layer thicknesses for laminar flow? For turbulent flow?
- How does the *local* convection heat or mass transfer coefficient vary with distance from the leading edge for *laminar flow* over a flat plate? For *turbulent flow*? For flow in which *transition* to turbulence occurs on the plate?
- How is local heat transfer from the surface of a flat plate affected by the existence of an *unheated starting length*?
- What are the manifestations of *boundary layer separation* from the surface of a circular cylinder in cross flow? How is separation influenced by whether the upstream flow is laminar or turbulent?
- How is variation of the local convection coefficient on the surface of a circular cylinder in cross flow affected by boundary layer separation? By boundary layer transition? Where do local maxima and minima in the convection coefficient occur on the surface?
- How does the average convection coefficient of a tube vary with its location in a tube bank?
- For jet impingement on a surface, what are distinguishing features of the *free jet*? The *potential core*? The *impingement zone*? The *wall jet*?
- At what location on the surface of an impinging jet will a maximum in the convection coefficient always exist? Under what conditions will there be a secondary maximum?
- For an *array* of impinging jets, how are flow and heat transfer affected by the manner in which *spent fluid* is discharged from the system?
- What is the difference between a *packed bed* and a *fluidized bed* of solid particles?
- What is an empirical heat or mass transfer correlation? What are the inherent dimensionless parameters for forced convection?
- What is the *film temperature*?
- What temperature difference must be used when computing the total rate of heat transfer from a bank of tubes or a packed bed?

In this chapter we have also compiled convection correlations that may be used to estimate convection transfer rates for a variety of external flow conditions. For simple surface geometries these results may be derived from a boundary layer analysis, but in most cases they are obtained from generalizations based on experiment.

You should know when and how to use the various expressions, and you should be familiar with the general methodology of a convection calculation. To facilitate their use, the correlations are summarized in Table 7.9.

**TABLE 7.9** Summary of convection heat transfer correlations for external flow<sup>a, b</sup>

Correlation		Geometry	Conditions <sup>c</sup>
$\delta = 5x Re_x^{-1/2}$	(7.19)	Flat plate	Laminar, $T_f$
$C_{f,x} = 0.664 Re_x^{-1/2}$	(7.20)	Flat plate	Laminar, local, $T_f$
$Nu_x = 0.332 Re_x^{1/2} Pr^{1/3}$	(7.23)	Flat plate	Laminar, local, $T_f$ , $Pr \geq 0.6$
$\delta_t = \delta Pr^{-1/3}$	(7.24)	Flat plate	Laminar, $T_f$
$\bar{C}_{f,x} = 1.328 Re_x^{-1/2}$	(7.29)	Flat plate	Laminar, average, $T_f$
$\bar{Nu}_x = 0.664 Re_x^{1/2} Pr^{1/3}$	(7.30)	Flat plate	Laminar, average, $T_f$ , $Pr \geq 0.6$
$Nu_x = 0.565 Pe_x^{1/2}$	(7.32)	Flat plate	Laminar, local, $T_f$ , $Pr \leq 0.05$ , $Pe_x \geq 100$
$C_{f,x} = 0.0592 Re_x^{-1/5}$	(7.34)	Flat plate	Turbulent, local, $T_f$ , $Re_x \leq 10^8$
$\delta = 0.37x Re_x^{-1/5}$	(7.35)	Flat plate	Turbulent, $T_f$ , $Re_x \leq 10^8$
$Nu_x = 0.0296 Re_x^{4/5} Pr^{1/3}$	(7.36)	Flat plate	Turbulent, local, $T_f$ , $Re_x \leq 10^8$ , $0.6 \leq Pr \leq 60$
$\bar{C}_{f,L} = 0.074 Re_L^{-1/5} - 1742 Re_L^{-1}$	(7.40)	Flat plate	Mixed, average, $T_f$ , $Re_{x,c} = 5 \times 10^5$ , $Re_L \leq 10^8$
$\bar{Nu}_L = (0.037 Re_L^{4/5} - 871) Pr^{1/3}$	(7.38)	Flat plate	Mixed, average, $T_f$ , $Re_{x,c} = 5 \times 10^5$ , $Re_L \leq 10^8$ , $0.6 \leq Pr \leq 60$
$\bar{Nu}_D = C Re_D^m Pr^{1/3}$ (Table 7.2)	(7.52)	Cylinder	Average, $T_f$ , $0.4 \leq Re_D \leq 4 \times 10^5$ , $Pr \geq 0.7$
$\bar{Nu}_D = C Re_D^m Pr^n (Pr/Pr_s)^{1/4}$ (Table 7.4)	(7.53)	Cylinder	Average, $T_\infty$ , $1 \leq Re_D \leq 10^6$ , $0.7 \leq Pr \leq 500$
$\bar{Nu}_D = 0.3 + [0.62 Re_D^{1/2} Pr^{1/3} \times [1 + (0.4/Pr)^{2/3}]^{-1/4}] \times [1 + (Re_D/282,000)^{5/8}]^{4/5}$	(7.54)	Cylinder	Average, $T_f$ , $Re_D Pr \geq 0.2$
$\bar{Nu}_D = 2 + (0.4 Re_D^{1/2} + 0.06 Re_D^{2/3}) Pr^{0.4} \times (\mu/\mu_s)^{1/4}$	(7.56)	Sphere	Average, $T_\infty$ , $3.5 \leq Re_D \leq 7.6 \times 10^4$ , $0.71 \leq Pr \leq 380$
$\bar{Nu}_D = 2 + 0.6 Re_D^{1/2} Pr^{1/3}$	(7.57)	Falling drop	Average, $T_\infty$
$\bar{Nu}_D = 1.13 C_1 C_2 Re_{D,\max}^m Pr^{1/3}$ (Tables 7.5, 7.6)	(7.60), (7.61)	Tube bank <sup>d</sup>	Average, $\bar{T}_f$ , $2000 \leq Re_{D,\max} \leq 4 \times 10^4$ , $Pr \geq 0.7$
$\bar{Nu}_D = CC_2 Re_{D,\max}^m Pr^{0.36} (Pr/Pr_s)^{1/4}$ (Tables 7.7, 7.8)	(7.64), (7.65)	Tube bank <sup>d</sup>	Average, $\bar{T}$ , $1000 \leq Re_D \leq 2 \times 10^6$ , $0.7 \leq Pr \leq 500$

TABLE 7.9 (Continued)

Correlation		Geometry	Conditions
Single round nozzle	(7.75)	Impinging jet	Average, $T_f$ , $2000 \leq Re \leq 4 \times 10^5$ , $2 \leq (H/D) \leq 12$ , $2.5 \leq (r/D) \leq 7.5$
Single slot nozzle	(7.79)	Impinging jet	Average, $T_f$ , $3000 \leq Re \leq 9 \times 10^4$ , $2 \leq (H/W) \leq 10$ , $4 \leq (x/W) \leq 20$
Array of round nozzles	(7.77)	Impinging jet	Average, $T_f$ , $2000 \leq Re \leq 10^5$ , $2 \leq (H/D) \leq 12$ , $0.004 \leq A_r \leq 0.04$
Array of slot nozzles	(7.81)	Impinging jet	Average, $T_f$ , $1500 \leq Re \leq 4 \times 10^4$ , $2 \leq (H/W) \leq 80$ , $0.008 \leq A_r \leq 2.5A_{r,o}$
$\bar{\varepsilon}_{jH} = \bar{\varepsilon}_{jm} = 2.06Re_D^{-0.575}$	(7.85)	Packed bed of spheres <sup>d</sup>	Average, $\bar{T}$ , $90 \leq Re_D \leq 4000$ , $Pr$ (or $Sc$ ) $\approx 0.7$

<sup>a</sup>Correlations in this table pertain to isothermal surfaces; for special cases involving an unheated starting length or a uniform surface heat flux, see Section 7.2.4 or 7.2.5.

<sup>b</sup>When the heat and mass transfer analogy is applicable, the corresponding mass transfer correlations may be obtained by replacing  $Nu$  and  $Pr$  by  $Sh$  and  $Sc$ , respectively.

<sup>c</sup>The temperature listed under “Conditions” is the temperature at which properties should be evaluated.

<sup>d</sup>For tube banks and packed beds, properties are evaluated at the average fluid temperature,  $\bar{T} = (T_i + T_o)/2$ , or the average film temperature,  $\bar{T}_f = (T_s + \bar{T})/2$ .

## References

- Blasius, H., *Z. Math. Phys.*, **56**, 1, 1908. English translation in National Advisory Committee for Aeronautics Technical Memo No. 1256.
- Schlichting, H., *Boundary Layer Theory*, Springer, New York, 2000.
- Howarth, L., *Proc. R. Soc. Lond., Ser. A*, **164**, 547, 1938.
- Pohlhausen, E., *Z. Angew. Math. Mech.*, **1**, 115, 1921.
- Kays, W. M., M. E. Crawford, and B. Weigand, *Convective Heat and Mass Transfer*, 4th ed. McGraw-Hill Higher Education, Boston, 2005.
- Churchill, S. W., and H. Ozoe, *J. Heat Transfer*, **95**, 78, 1973.
- Ameel, T. A., *Int. Comm. Heat Mass Transfer*, **24**, 1113, 1997.
- Blair, M. F., *J. Heat Transfer*, **105**, 33 and 41, 1983.
- Fox, R. W., A. T. McDonald, and P. J. Pritchard, *Introduction to Fluid Mechanics*, 6th ed., Wiley, New York, 2003.
- Coutanceau, M., and J. -R. Defaye, *Appl. Mech. Rev.*, **44**, 255, 1991.
- Hilpert, R., *Forsch. Geb. Ingenieurwes.*, **4**, 215, 1933.
- Knudsen, J. D., and D. L. Katz, *Fluid Dynamics and Heat Transfer*, McGraw-Hill, New York, 1958.
- Jakob, M., *Heat Transfer*, Vol. 1, Wiley, New York, 1949.
- Whitaker, S., *AIChE J.*, **18**, 361, 1972.
- Zukauskas, A., “Heat Transfer from Tubes in Cross Flow,” in J. P. Hartnett and T. F. Irvine, Jr., Eds., *Advances in Heat Transfer*, Vol. 8, Academic Press, New York, 1972.
- Churchill, S. W., and M. Bernstein, *J. Heat Transfer*, **99**, 300, 1977.
- Morgan, V. T., “The Overall Convective Heat Transfer from Smooth Circular Cylinders,” in T. F. Irvine, Jr. and J. P. Hartnett, Eds., *Advances in Heat Transfer*, Vol. 11, Academic Press, New York, 1975.
- Ranz, W., and W. Marshall, *Chem. Eng. Prog.*, **48**, 141, 1952.
- Grimison, E. D., *Trans. ASME*, **59**, 583, 1937.
- Kays, W. M., and R. K. Lo, Stanford University Technical Report No. 15, 1952.
- Martin, H., “Heat and Mass Transfer between Impinging Gas Jets and Solid Surfaces,” in J. P. Hartnett and T. F. Irvine, Jr., Eds., *Advances in Heat Transfer*, Vol. 13, Academic Press, New York, 1977.

22. Popiel, Cz. O., and L. Bogusiawski, "Mass or Heat Transfer in Impinging Single Round Jets Emitted by a Bell-Shaped Nozzle and Sharp-Ended Orifice," in C. L. Tien, V. P. Carey, and J. K. Ferrell, Eds., *Heat Transfer 1986*, Vol. 3, Hemisphere Publishing, New York, 1986.
23. Goldstein, R. J., and J. F. Timmers, *Int. J. Heat Mass Transfer*, **25**, 1857, 1982.
24. Hollworth, B. R., and L. R. Gero, *J. Heat Transfer*, **107**, 910, 1985.
25. Goldstein, R. J., A. I. Behbahani, and K. K. Heppelman, *Int. J. Heat Mass Transfer*, **29**, 1227, 1986.
26. Bird, R. B., W. E. Stewart, and E. N. Lightfoot, *Transport Phenomena*, 2nd ed. Wiley, New York, 2002.
27. Jakob, M., *Heat Transfer*, Vol. 2, Wiley, New York, 1957.
28. Geankoplis, C. J., *Mass Transport Phenomena*, Holt, Rinehart & Winston, New York, 1972.
29. Sherwood, T. K., R. L. Pigford, and C. R. Wilkie, *Mass Transfer*, McGraw-Hill, New York, 1975.

## Problems

### Flat Plate in Parallel Flow

- 7.1 Consider the following fluids at a film temperature of 300 K in parallel flow over a flat plate with velocity of 1 m/s: atmospheric air, water, engine oil, and mercury.
  - (a) For each fluid, determine the velocity and thermal boundary layer thicknesses at a distance of 40 mm from the leading edge.
  - (b) For each of the prescribed fluids and on the same coordinates, plot the boundary layer thicknesses as a function of distance from the leading edge to a plate length of 40 mm.
- 7.2 Engine oil at 100°C and a velocity of 0.1 m/s flows over both surfaces of a 1-m-long flat plate maintained at 20°C. Determine:
  - (a) The velocity and thermal boundary layer thicknesses at the trailing edge.
  - (b) The local heat flux and surface shear stress at the trailing edge.
  - (c) The total drag force and heat transfer per unit width of the plate.
  - (d) Plot the boundary layer thicknesses and local values of the surface shear stress, convection coefficient, and heat flux as a function of  $x$  for  $0 \leq x \leq 1$  m.
- 7.3 Consider steady, parallel flow of atmospheric air over a flat plate. The air has a temperature and free stream velocity of 300 K and 25 m/s.
  - (a) Evaluate the boundary layer thickness at distances of  $x = 1, 10$ , and 100 mm from the leading edge. If a second plate were installed parallel to and at a distance of 3 mm from the first plate, what is the distance from the leading edge at which boundary layer merger would occur?
  - (b) Evaluate the surface shear stress and the  $y$ -velocity component at the outer edge of the boundary layer for the single plate at  $x = 1, 10$ , and 100 mm.
  - (c) Comment on the validity of the boundary layer approximations.
- 7.4 Consider a liquid metal ( $Pr \ll 1$ ), with free stream conditions  $u_\infty$  and  $T_\infty$ , in parallel flow over an isothermal flat plate at  $T_s$ . Assuming that  $u = u_\infty$  throughout the thermal boundary layer, write the corresponding form of the boundary layer energy equation. Applying appropriate initial ( $x = 0$ ) and boundary conditions, solve this equation for the boundary layer temperature field,  $T(x, y)$ . Use the result to obtain an expression for the local Nusselt number  $Nu_x$ . *Hint:* This problem is analogous to one-dimensional heat transfer in a semi-infinite medium with a sudden change in surface temperature.
- 7.5 Consider the velocity boundary layer profile for flow over a flat plate to be of the form  $u = C_1 + C_2 y$ . Applying appropriate boundary conditions, obtain an expression for the velocity profile in terms of the boundary layer thickness  $\delta$  and the free stream velocity  $u_\infty$ . Using the integral form of the boundary layer momentum equation (Appendix F), obtain expressions for the boundary layer thickness and the local friction coefficient, expressing your result in terms of the local Reynolds number. Compare your results with those obtained from the exact solution (Section 7.2.1) and the integral solution with a cubic profile (Appendix F).
- 7.6 Consider a steady, turbulent boundary layer on an isothermal flat plate of temperature  $T_s$ . The boundary layer is "tripped" at the leading edge  $x = 0$  by a fine wire. Assume constant physical properties and velocity and temperature profiles of the form
 
$$\frac{u}{u_\infty} = \left(\frac{y}{\delta}\right)^{1/7} \quad \text{and} \quad \frac{T - T_\infty}{T_s - T_\infty} = 1 - \left(\frac{y}{\delta_t}\right)^{1/7}$$
  - (a) From experiment it is known that the surface shear stress is related to the boundary layer thickness by an expression of the form
 
$$\tau_s = 0.0228 \rho u_\infty^2 \left(\frac{u_\infty \delta}{\nu}\right)^{-1/4}$$


Beginning with the momentum integral equation (Appendix F), show that

$$\delta/x = 0.376Re_x^{-1/5}.$$

Determine the average friction coefficient  $\bar{C}_{f,x}$ .


- (b) Beginning with the energy integral equation, obtain an expression for the local Nusselt number  $Nu_x$  and use this result to evaluate the average Nusselt number  $\bar{Nu}_x$ .

**7.7** Consider flow over a flat plate for which it is desired to determine the average heat transfer coefficient over the short span  $x_1$  to  $x_2$ ,  $\bar{h}_{1-2}$ , where  $(x_2 - x_1) \ll L$ .

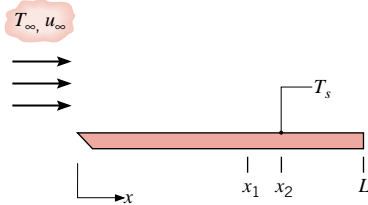

Provide three different expressions that can be used to evaluate  $\bar{h}_{1-2}$  in terms of (a) the local coefficient at  $x = (x_1 + x_2)/2$ , (b) the local coefficients at  $x_1$  and  $x_2$ , and (c) the average coefficients at  $x_1$  and  $x_2$ . Indicate which of the expressions is approximate. Considering whether the flow is laminar, turbulent, or mixed, indicate when it is appropriate or inappropriate to use each of the equations.

**7.8** A flat plate of width 1 m is maintained at a uniform surface temperature of  $T_s = 150^\circ\text{C}$  by using independently controlled, heat-generating rectangular modules of thickness  $a = 10$  mm and length  $b = 50$  mm. Each module is insulated from its neighbors, as well as on its back side. Atmospheric air at  $25^\circ\text{C}$  flows over the plate at a velocity of 30 m/s. The thermophysical properties of the module are  $k = 5.2$  W/m  $\cdot$  K,  $c_p = 320$  J/kg  $\cdot$  K, and  $\rho = 2300$  kg/m<sup>3</sup>.

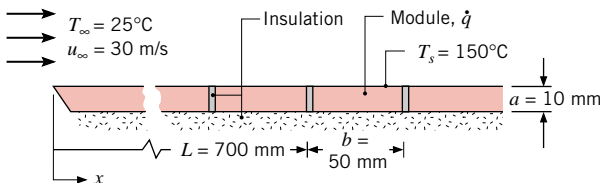

- (a) Find the required power generation,  $\dot{q}$  (W/m<sup>3</sup>), in a module positioned at a distance 700 mm from the leading edge.
- (b) Find the maximum temperature  $T_{\max}$  in the heat-generating module.

**7.9** An electric air heater consists of a horizontal array of thin metal strips that are each 10 mm long in the direction of an airstream that is in parallel flow over the top of

the strips. Each strip is 0.2 m wide, and 25 strips are arranged side by side, forming a continuous and smooth surface over which the air flows at 2 m/s. During operation, each strip is maintained at  $500^\circ\text{C}$  and the air is at  $25^\circ\text{C}$ .

- (a) What is the rate of convection heat transfer from the first strip? The fifth strip? The tenth strip? All the strips?
- (b) For air velocities of 2, 5, and 10 m/s, determine the convection heat rates for all the locations of part (a). Represent your results in tabular or bar graph form.
- (c) Repeat part (b), but under conditions for which the flow is fully turbulent over the entire array of strips.

**7.10** Consider atmospheric air at  $25^\circ\text{C}$  and a velocity of 25 m/s flowing over both surfaces of a 1-m-long flat plate that is maintained at  $125^\circ\text{C}$ . Determine the rate of heat transfer per unit width from the plate for values of the critical Reynolds number corresponding to  $10^5$ ,  $5 \times 10^5$ , and  $10^6$ .

**7.11** Consider a flat plate subject to parallel flow (top and bottom) characterized by  $u_\infty = 5$  m/s,  $T_\infty = 20^\circ\text{C}$ .

- (a) Determine the average convective heat transfer coefficient, convective heat transfer rate, and drag force associated with a  $L = 2$  m long,  $w = 2$  m wide flat plate for air flow and surface temperatures of  $T_s = 50^\circ\text{C}$  and  $80^\circ\text{C}$ .
- (b) Determine the average convective heat transfer coefficient, convective heat transfer rate, and drag force associated with a  $L = 0.1$  m long,  $w = 0.1$  m wide flat plate for water flow and surface temperatures of  $T_s = 50^\circ\text{C}$  and  $80^\circ\text{C}$ .

**7.12** Consider water at  $27^\circ\text{C}$  in parallel flow over an isothermal, 1-m-long flat plate with a velocity of 2 m/s.

- (a) Plot the variation of the local heat transfer coefficient,  $h_x(x)$ , with distance along the plate for three flow conditions corresponding to transition Reynolds numbers of (i)  $5 \times 10^5$ , (ii)  $3 \times 10^5$ , and (iii) 0 (the flow is fully turbulent).
- (b) Plot the variation of the average heat transfer coefficient,  $\bar{h}_x(x)$ , with distance for the three flow conditions of part (a).
- (c) What are the average heat transfer coefficients for the entire plate,  $\bar{h}_L$ , for the three flow conditions of part (a)?

**7.13** Explain under what conditions the total rate of heat transfer from an isothermal flat plate of dimensions  $L$  by  $2L$  would be the same, independent of whether parallel flow over the plate is directed along the side of length  $L$  or  $2L$ . With a critical Reynolds number of



$5 \times 10^5$ , for what values of  $Re_L$  would the total heat transfer be independent of orientation?

- 7.14** In fuel cell stacks, it is desirable to operate under conditions that promote uniform surface temperatures for the electrolytic membranes. This is especially true in high-temperature fuel cells where the membrane is constructed of a brittle ceramic material. Electrochemical reactions in the electrolytic membranes generate thermal energy, while gases flowing above and below the membranes cool it. The stack designer may specify top and bottom flows that are in the same, opposite, or orthogonal directions. A preliminary study of the effect of the relative flow directions is conducted whereby a  $150 \text{ mm} \times 150 \text{ mm}$  thin sheet of material, producing a uniform heat flux of  $100 \text{ W/m}^2$ , is cooled (top and bottom) by air with a free stream temperature and velocity of  $25^\circ\text{C}$  and  $2 \text{ m/s}$ , respectively.

- Determine the minimum and maximum local membrane temperatures for top and bottom flows that are in the same, opposite, and orthogonal directions. Which flow configuration minimizes the membrane temperature? *Hint:* For the opposite and orthogonal flow cases, the boundary layers are subject to boundary conditions that are neither uniform temperature nor uniform heat flux. It is, however, reasonable to expect that the resulting temperatures would be bracketed by your answers based on the constant heat flux and constant temperature boundary conditions.
- Plot the surface temperature distribution  $T(x)$  for the cases involving flow in the opposite and same directions. Thermal stresses are undesirable and are related to the spatial temperature gradient along the membrane. Which configuration minimizes spatial temperature gradients?

- 7.15** Air at a pressure of 1 atm and a temperature of  $50^\circ\text{C}$  is in parallel flow over the top surface of a flat plate that is heated to a uniform temperature of  $100^\circ\text{C}$ . The plate has a length of  $0.20 \text{ m}$  (in the flow direction) and a width of  $0.10 \text{ m}$ . The Reynolds number based on the plate length is 40,000. What is the rate of heat transfer from the plate to the air? If the free stream velocity of the air is doubled and the pressure is increased to 10 atm, what is the rate of heat transfer?


- 7.16** Consider a rectangular fin that is used to cool a motorcycle engine. The fin is  $0.15 \text{ m}$  long and at a temperature of  $250^\circ\text{C}$ , while the motorcycle is moving at  $80 \text{ km/h}$  in air at  $27^\circ\text{C}$ . The air is in parallel flow over both surfaces of the fin, and turbulent flow conditions may be assumed to exist throughout.

- What is the rate of heat removal per unit width of the fin?

- Generate a plot of the heat removal rate per unit width of the fin for motorcycle speeds ranging from 10 to  $100 \text{ km/h}$ .

- 7.17** The Weather channel reports that it is a hot, muggy day with an air temperature of  $90^\circ\text{F}$ , a  $10 \text{ mph}$  breeze out of the southwest, and bright sunshine with a solar insolation of  $400 \text{ W/m}^2$ . Consider the wall of a metal building over which the prevailing wind blows. The length of the wall in the wind direction is  $10 \text{ m}$ , and the emissivity is  $0.93$ . Assume that all the solar irradiation is absorbed, that irradiation from the sky is negligible, and that flow is fully turbulent over the wall. Estimate the average wall temperature.

- 7.18** A photovoltaic solar panel consists of a sandwich of (top to bottom) a 3-mm-thick ceria-doped glass ( $k_g = 1.4 \text{ W/m} \cdot \text{K}$ ), a 0.1-mm-thick optical grade adhesive ( $k_a = 145 \text{ W/m} \cdot \text{K}$ ), a very thin silicon semiconducting material, a 0.1-mm-thick solder layer ( $k_s = 50 \text{ W/m} \cdot \text{K}$ ) and a 2-mm-thick aluminum nitride substrate ( $k_{an} = 120 \text{ W/m} \cdot \text{K}$ ). The solar-to-electrical conversion efficiency within the semiconductor depends on the silicon temperature,  $T_{si}$ , and is described by the expression  $\eta = 0.28 - 0.001T_{si}$ , where  $T_{si}$  is in  $^\circ\text{C}$ , for  $25^\circ\text{C} \leq T_{si} \leq 250^\circ\text{C}$ . Ten percent of the solar irradiation is absorbed at the top surface of the glass, while 83% of the solar irradiation is transmitted to and absorbed by the silicon (the remaining 7% is reflected away from the cell). The glass has an emissivity of  $0.90$ .

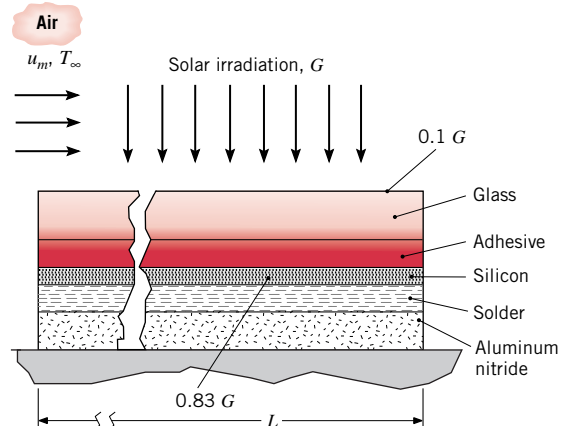


- Consider an  $L = 1 \text{ m}$  long,  $w = 0.1 \text{ m}$  wide solar cell that is placed on an insulated surface. Determine the silicon temperature and the electric power produced by the solar cell for an air velocity of  $4 \text{ m/s}$  parallel to the long direction, with air and surroundings temperatures of  $25^\circ\text{C}$ . The solar irradiation is  $700 \text{ W/m}^2$ . The boundary layer is tripped to a turbulent condition at the leading edge of the panel.



- (b) Repeat part (a), except now the panel is oriented with its short side parallel to the air flow, that is,  $L = 0.1$  m and  $w = 1$  m.
- (c) Plot the electric power output and the silicon temperature versus air velocity over the range  $0 \leq u_m \leq 10$  m/s for the  $L = 0.1$  m and  $w = 1$  m case.


**7.19** Concentration of sunlight onto photovoltaic cells is desired since the concentrating mirrors and lenses are less expensive than the photovoltaic material. Consider the solar photovoltaic cell of Problem 7.18. A 100 mm  $\times$  100 mm photovoltaic cell is irradiated with concentrated solar energy. Since the concentrating lens is glass, it absorbs 10% of the irradiation instead of the top surface of the solar cell, as in Problem 7.18. The remaining irradiation is reflected from the system (7%) or is absorbed in the silicon semiconductor material of the photovoltaic cell (83%). The photovoltaic cell is cooled by air directed parallel to its top and bottom surfaces. The air temperature and velocity are 25°C and 5 m/s, respectively, and the bottom surface is coated with a high-emissivity paint,  $\epsilon_b = 0.95$ .

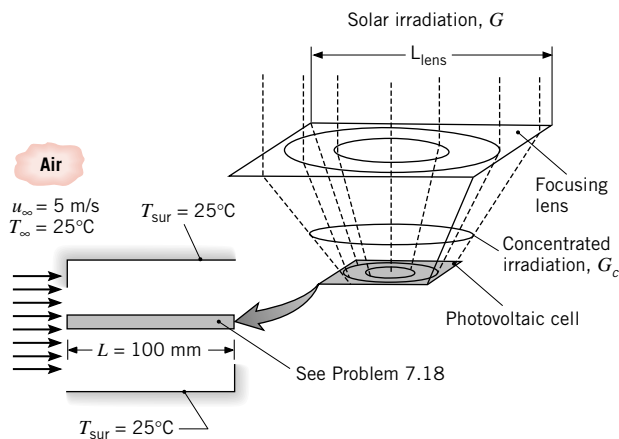

- (a) Determine the electric power produced by the photovoltaic cell and the silicon temperature for a square concentrating lens with  $L_{\text{lens}} = 400$  mm, which focuses the irradiation falling on the lens to the smaller area of the photovoltaic cell. Assume the concentrating lens temperature is 25°C and does not interfere with boundary layer development over the photovoltaic cell's top surface. The top and bottom boundary layers are both tripped to turbulent conditions at the leading edge of the photovoltaic material.
- (b) Determine the electric power output of the photovoltaic cell and the silicon temperature over the range  $100 \text{ mm} \leq L_{\text{lens}} \leq 600$  mm.


**7.20** The roof of a refrigerated truck compartment is of composite construction, consisting of a layer of foamed

urethane insulation ( $t_2 = 50$  mm,  $k_i = 0.026$  W/m  $\cdot$  K) sandwiched between aluminum alloy panels ( $t_1 = 5$  mm,  $k_p = 180$  W/m  $\cdot$  K). The length and width of the roof are  $L = 10$  m and  $W = 3.5$  m, respectively, and the temperature of the inner surface is  $T_{s,i} = -10^\circ\text{C}$ . Consider conditions for which the truck is moving at a speed of  $V = 105$  km/h, the air temperature is  $T_\infty = 32^\circ\text{C}$ , and the solar irradiation is  $G_s = 750$  W/m<sup>2</sup>. Turbulent flow may be assumed over the entire length of the roof.

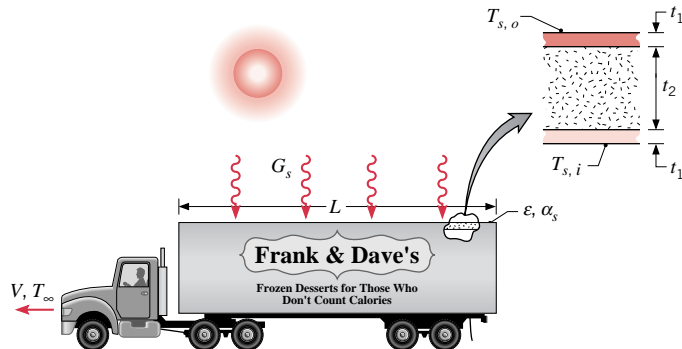


- (a) For equivalent values of the solar absorptivity and the emissivity of the outer surface ( $\alpha_s = \epsilon = 0.5$ ), estimate the average temperature  $T_{s,o}$  of the outer surface. What is the corresponding heat load imposed on the refrigeration system?
- (b) A special finish ( $\alpha_s = 0.15$ ,  $\epsilon = 0.8$ ) may be applied to the outer surface. What effect would such an application have on the surface temperature and the heat load?
- (c) If, with  $\alpha_s = \epsilon = 0.5$ , the roof is not insulated ( $t_2 = 0$ ), what are the corresponding values of the surface temperature and the heat load?


**7.21** The top surface of a heated compartment consists of very smooth (A) and highly roughened (B) portions, and the surface is placed in an atmospheric airstream. In the interest of minimizing total convection heat transfer from the surface, which orientation, (1) or (2), is preferred? If  $T_s = 100^\circ\text{C}$ ,  $T_\infty = 20^\circ\text{C}$ , and  $u_\infty = 20$  m/s, what is the convection heat transfer from the entire surface for this orientation?

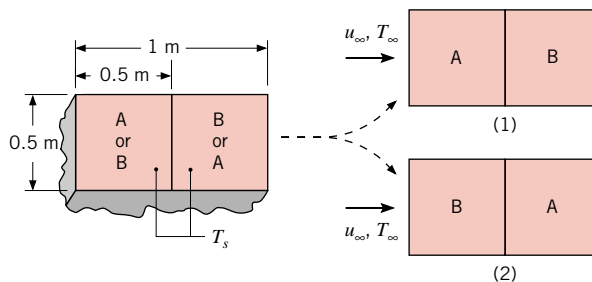

- 7.22 Consider weather conditions for which the prevailing wind blows past the penthouse tower on a tall building. The tower length in the wind direction is 10 m and there are 10 window panels.

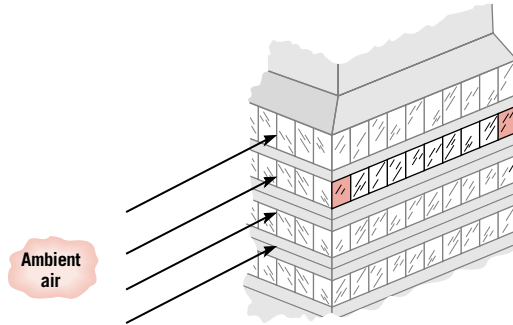


- (a) Calculate the average convection coefficient for the first, third, and tenth window panels when the wind speed is 5 m/s. Use a film temperature of 300 K to evaluate the thermophysical properties required of the correlation. Would this be a suitable value of the film temperature for ambient air temperatures in the range  $-15 \leq T_\infty \leq 38^\circ\text{C}$ ?
- (b) For the first, third, and tenth windows, on one graph, plot the variation of the average convection coefficient with wind speed for the range  $5 \leq u_\infty \leq 100$  km/h. Explain the major features of each curve and their relative magnitudes.
- 7.23 The proposed design for an anemometer to determine the velocity of an airstream in a wind tunnel is comprised of a thin metallic strip whose ends are supported by stiff rods serving as electrodes for passage of current used to heat the strip. A fine-wire thermocouple is attached to the trailing edge of the strip and serves as the sensor for a system that controls the power to maintain the strip at a constant operating temperature for variable airstream velocities. Design conditions pertain to an airstream at  $T_\infty = 25^\circ\text{C}$  and  $1 \leq u_\infty \leq 50$  m/s, with a strip temperature of  $T_s = 35^\circ\text{C}$ .

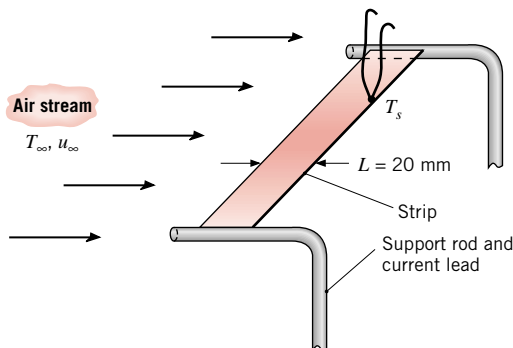

- (a) Determine the relationship between the electrical power dissipation per unit width of the strip in the transverse direction,  $P'$  (mW/mm), and the airstream velocity. Show this relationship graphically for the specified range of  $u_\infty$ .
- (b) If the accuracy with which the temperature of the operating strip can be measured and maintained constant is  $\pm 0.2^\circ\text{C}$ , what is the uncertainty in the airstream velocity?
- (c) The proposed design operates in a strip constant-temperature mode for which the airstream velocity is related to the measured power. Consider now an alternative mode wherein the strip is provided with a constant power, say, 30 mW/mm, and the airstream velocity is related to the measured strip temperature  $T_s$ . For this mode of operation, show the graphical relationship between the strip temperature and airstream velocity. If the temperature can be measured with an uncertainty of  $\pm 0.2^\circ\text{C}$ , what is the uncertainty in the airstream velocity?
- (d) Compare the features associated with each of the anemometer operating modes.


- 7.31 Steel (AISI 1010) plates of thickness  $\delta = 6$  mm and length  $L = 1$  m on a side are conveyed from a heat treatment process and are concurrently cooled by atmospheric air of velocity  $u_\infty = 10$  m/s and  $T_\infty = 20^\circ\text{C}$  in parallel flow over the plates.

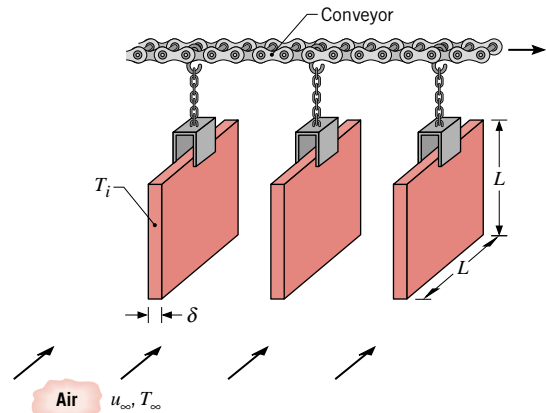

For an initial plate temperature of  $T_i = 300^\circ\text{C}$ , what is the rate of heat transfer from the plate? What is the corresponding rate of change of the plate temperature? The velocity of the air is much larger than that of the plate.

- 7.25 In the production of sheet metals or plastics, it is customary to cool the material before it leaves the production process for storage or shipment to the customer. Typically, the process is continuous, with a sheet of thickness  $\delta$  and width  $W$  cooled as it transits the


distance  $L$  between two rollers at a velocity  $V$ . In this problem, we consider cooling of an aluminum alloy (2024-T6) by an air stream moving at a velocity  $u_\infty$  in counter flow over the top surface of the sheet. A turbulence promoter is used to provide turbulent boundary layer development over the entire surface.

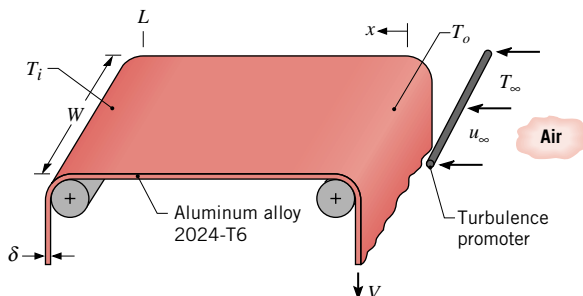

- By applying conservation of energy to a differential control surface of length  $dx$ , which either moves with the sheet or is stationary and through which the sheet passes, derive a differential equation that governs the temperature distribution along the sheet. Because of the low emissivity of the aluminum, radiation effects may be neglected. Express your result in terms of the velocity, thickness, and properties of the sheet ( $V$ ,  $\delta$ ,  $\rho$ ,  $c_p$ ), the local convection coefficient  $h_x$  associated with the counter flow, and the air temperature. For a known temperature of the sheet ( $T_i$ ) at the onset of cooling and a negligible effect of the sheet velocity on boundary layer development, solve the equation to obtain an expression for the outlet temperature  $T_o$ .
- For  $\delta = 2$  mm,  $V = 0.10$  m/s,  $L = 5$  m,  $W = 1$  m,  $u_\infty = 20$  m/s,  $T_\infty = 20^\circ\text{C}$ , and  $T_i = 300^\circ\text{C}$ , what is the outlet temperature  $T_o$ ?

**7.26** In the production of sheet metals or plastics, it is customary to cool the material before it leaves the production process for storage or shipment to the customer. Typically, the process is continuous, with a sheet of thickness  $\delta$  and width  $W$  cooled as it transits the distance  $L$  between two rollers at a velocity  $V$ . In this problem, we consider cooling of plain carbon steel by an air stream moving at a velocity  $u_\infty$  in cross flow over the top and bottom surfaces of the sheet. A turbulence promoter is used to provide turbulent boundary layer development over the entire surface.


- By applying conservation of energy to a differential control surface of length  $dx$ , which either moves with the sheet or is stationary and through which the sheet passes, and assuming a uniform sheet temperature in the direction of air flow, derive a differential equation that governs the temperature

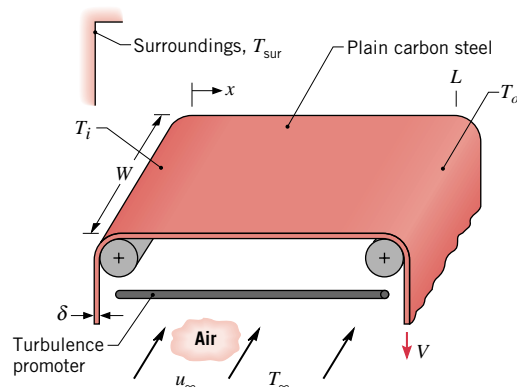

distribution,  $T(x)$ , along the sheet. Consider the effects of radiation, as well as convection, and express your result in terms of the velocity, thickness, and properties of the sheet ( $V$ ,  $\delta$ ,  $\rho$ ,  $c_p$ ,  $\varepsilon$ ), the average convection coefficient  $\bar{h}_W$  associated with the cross flow, and the environmental temperatures ( $T_\infty$ ,  $T_{sur}$ ).

- Neglecting radiation, obtain a closed form solution to the foregoing equation. For  $\delta = 3$  mm,  $V = 0.10$  m/s,  $L = 10$  m,  $W = 1$  m,  $u_\infty = 20$  m/s,  $T_\infty = 20^\circ\text{C}$ , and a sheet temperature of  $T_i = 500^\circ\text{C}$  at the onset of cooling, what is the outlet temperature  $T_o$ ? Assume a negligible effect of the sheet velocity on boundary layer development in the direction of air flow. The density and specific heat of the steel are  $\rho = 7850$  kg/m<sup>3</sup> and  $c_p = 620$  J/kg  $\cdot$  K, while properties of the air may be taken to be  $k = 0.044$  W/m  $\cdot$  K,  $\nu = 4.5 \times 10^{-5}$  m<sup>2</sup>/s,  $Pr = 0.68$ .
- Accounting for the effects of radiation, with  $\varepsilon = 0.70$  and  $T_{sur} = 20^\circ\text{C}$ , numerically integrate the differential equation derived in part (a) to determine the temperature of the sheet at  $L = 10$  m. Explore the effect of  $V$  on the temperature distribution along the sheet.

**7.27** A steel strip emerges from the hot roll section of a steel mill at a speed of 20 m/s and a temperature of 1200 K. Its length and thickness are  $L = 100$  m and  $\delta = 0.003$  m, respectively, and its density and specific heat are 7900 kg/m<sup>3</sup> and 640 J/kg  $\cdot$  K, respectively.

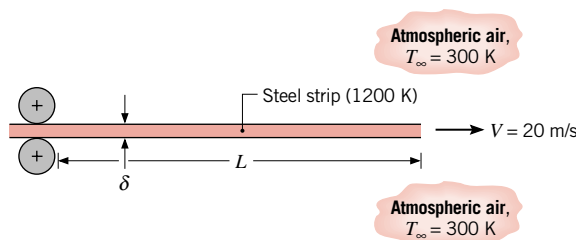


Accounting for heat transfer from the top and bottom surfaces and neglecting radiation and strip conduction effects, determine the time rate of change of the strip temperature at a distance of 1 m from the leading edge and at the trailing edge. Determine the distance from the leading edge at which the minimum cooling rate is achieved.

- 7.28** In Problem 7.23, an anemometer design was explored, and the assumption was made that the strip temperature was uniform. This is a good assumption when the heat transfer coefficient is low or the strip thermal conductivity high, because then conduction within the strip redistributes the generated heat and makes the strip temperature uniform. However, as the heat transfer coefficient increases or strip thermal conductivity decreases, heat generated at a point in the strip leaves the surface close to that point, and the thermal condition is closer to one of uniform surface heat flux.

- Develop the calibration equations for both the constant surface temperature and constant heat flux conditions, that is, find the equations that predict the velocity as a function of the power per unit strip width,  $P'$  (mW/mm), and the temperature measured at the trailing edge (as in Problem 7.23). Assume laminar flow conditions.
- If the true condition is uniform surface heat flux, but the uniform surface temperature calibration is used, what percentage error will be incurred in the velocity determination?
- Where could the thermocouple be placed so that the calibration is insensitive to whether the thermal condition is uniform surface temperature or uniform surface heat flux?

- 7.29** An array of electronic chips is mounted within a sealed rectangular enclosure, and cooling is implemented by attaching an aluminum heat sink ( $k = 180 \text{ W/m} \cdot \text{K}$ ). The base of the heat sink has dimensions of  $w_1 = w_2 = 100 \text{ mm}$ , while the 6 fins are of thickness  $t = 10 \text{ mm}$  and pitch  $S = 18 \text{ mm}$ . The fin length is  $L_f = 50 \text{ mm}$ , and the base of the heat sink has a thickness of  $L_b = 10 \text{ mm}$ .

If cooling is implemented by water flow through the heat sink, with  $u_\infty = 3 \text{ m/s}$  and  $T_\infty = 17^\circ\text{C}$ , what is the base temperature  $T_b$  of the heat sink when power dissipation by the chips is  $P_{\text{elec}} = 1800 \text{ W}$ ? The average convection coefficient for surfaces of the fins and the exposed base may be estimated by assuming parallel flow over a flat plate. Properties of the water may be approximated as  $k = 0.62 \text{ W/m} \cdot \text{K}$ ,  $\nu = 7.73 \times 10^{-7} \text{ m}^2/\text{s}$ , and  $Pr = 5.2$ .

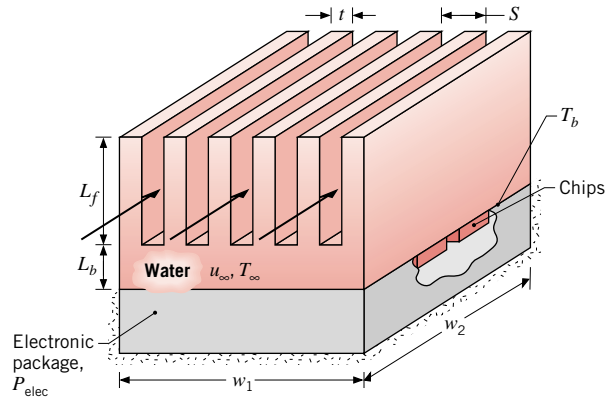


- 7.30** The heat sink of Problem 7.29 is considered for an application in which the power dissipation is only  $70 \text{ W}$ , and the engineer proposes to use air at  $T_\infty = 20^\circ\text{C}$  for cooling. If the base temperature,  $T_b$ , must remain below  $70^\circ\text{C}$ , what air velocity is required? Properties of the air may be approximated as  $k = 0.027 \text{ W/m} \cdot \text{K}$ ,  $\nu = 16.4 \times 10^{-6} \text{ m}^2/\text{s}$ , and  $Pr = 0.706$ . *Hint:* An iterative solution is required. One approach is to assume the fin efficiency is unity to initiate the iterations.

- 7.31** Consider the concentrating photovoltaic apparatus of Problem 7.19. The apparatus is to be installed in a desert environment, so the space between the concentrating lens and top of the photovoltaic cell is enclosed to protect the cell from sand abrasion in windy conditions. Since convection cooling from the top of the cell is reduced by the enclosure, an engineer proposes to cool the photovoltaic cell by attaching an aluminum heat sink to its bottom surface. The heat sink dimensions and material are the same as those of Problem 7.29. A contact resistance of  $0.5 \times 10^{-4} \text{ m}^2 \cdot \text{K/W}$  exists at the photovoltaic cell/heat sink interface and a dielectric liquid ( $k = 0.064 \text{ W/m} \cdot \text{K}$ ,  $\nu = 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 25$ ) flows between the heat sink fins at  $u_\infty = 3 \text{ m/s}$ ,  $T_\infty = 25^\circ\text{C}$ .

- Determine the electric power produced by the photovoltaic cell and the silicon temperature for a square concentrating lens with  $L_{\text{lens}} = 400 \text{ mm}$ .
- Compare the electric power produced by the photovoltaic cell with the heat sink in place and with the bottom surface cooled directly by the dielectric fluid (i.e., no heat sink) for  $L_{\text{lens}} = 1.5 \text{ m}$ .
- Determine the electric power output and the silicon temperature over the range  $100 \text{ mm} \leq L_{\text{lens}} < 3000 \text{ mm}$  with the aluminum heat sink in place.


- 7.32** One hundred electrical components, each dissipating  $25 \text{ W}$ , are attached to one surface of a square ( $0.2 \text{ m} \times 0.2 \text{ m}$ ) copper plate, and all the dissipated energy is transferred to water in parallel flow over the opposite surface.

A protuberance at the leading edge of the plate acts to trip the boundary layer, and the plate itself may be assumed to be isothermal. The water velocity and temperature are  $u_\infty = 2$  m/s and  $T_\infty = 17^\circ\text{C}$ , and the water's thermophysical properties may be approximated as  $\nu = 0.96 \times 10^{-6}$  m<sup>2</sup>/s,  $k = 0.620$  W/m · K, and  $Pr = 5.2$ .

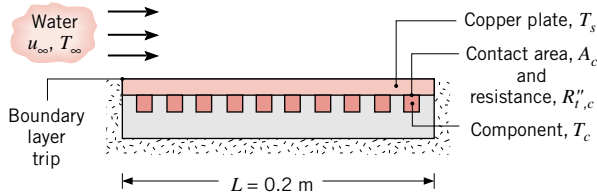


- What is the temperature of the copper plate?
- If each component has a plate contact surface area of 1 cm<sup>2</sup> and the corresponding contact resistance is  $2 \times 10^{-4}$  m<sup>2</sup> · K/W, what is the component temperature? Neglect the temperature variation across the thickness of the copper plate.

**7.33** Air at  $27^\circ\text{C}$  with a free stream velocity of 10 m/s is used to cool electronic devices mounted on a printed circuit board. Each device, 4 mm by 4 mm, dissipates 40 mW, which is removed from the top surface. A turbulator is located at the leading edge of the board, causing the boundary layer to be turbulent.

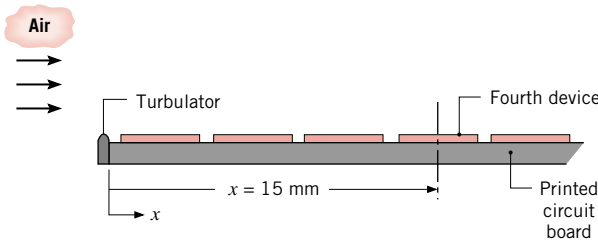

- Estimate the surface temperature of the fourth device located 15 mm from the leading edge of the board.
- Generate a plot of the surface temperature of the first four devices as a function of the free stream velocity for  $5 \leq u_\infty \leq 15$  m/s.
- What is the minimum free stream velocity if the surface temperature of the hottest device is not to exceed  $80^\circ\text{C}$ ?

**7.34** Forced air at  $25^\circ\text{C}$  and 10 m/s is used to cool electronic elements mounted on a circuit board. Consider a chip of length 4 mm and width 4 mm located 120 mm from the leading edge. Because the board surface is irregular, the flow is disturbed and the appropriate convection correlation is of the form  $Nu_x = 0.04Re_x^{0.85} Pr^{0.33}$ .

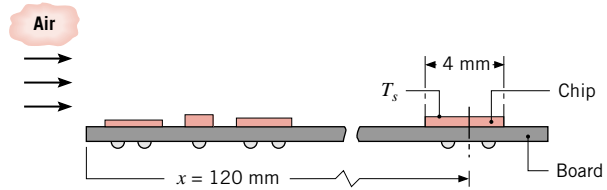

Estimate the surface temperature of the chip,  $T_s$ , if its heat dissipation rate is 30 mW.


**7.35** Air at atmospheric pressure and a temperature of  $25^\circ\text{C}$  is in parallel flow at a velocity of 5 m/s over a 1-m-long flat plate that is heated with a uniform heat flux of 1250 W/m<sup>2</sup>. Assume the flow is fully turbulent over the length of the plate.

- Calculate the plate surface temperature,  $T_s(L)$ , and the local convection coefficient,  $h_x(L)$ , at the trailing edge,  $x = L$ .
- Calculate the average temperature of the plate surface,  $\bar{T}_s$ .
- Plot the variation of the surface temperature,  $T_s(x)$ , and the convection coefficient,  $h_x(x)$ , with distance on the same graph. Explain the key features of these distributions.

**7.36** Consider atmospheric air at  $u_\infty = 2$  m/s and  $T_\infty = 300$  K in parallel flow over an isothermal flat plate of length  $L = 1$  m and temperature  $T_s = 350$  K.

- Compute the local convection coefficient at the leading and trailing edges of the heated plate with and without an unheated starting length of  $\xi = 1$  m.
- Compute the average convection coefficient for the plate for the same conditions as part (a).
- Plot the variation of the local convection coefficient over the plate with and without an unheated starting length.

**7.37** The cover plate of a flat-plate solar collector is at  $15^\circ\text{C}$ , while ambient air at  $10^\circ\text{C}$  is in parallel flow over the plate, with  $u_\infty = 2$  m/s.

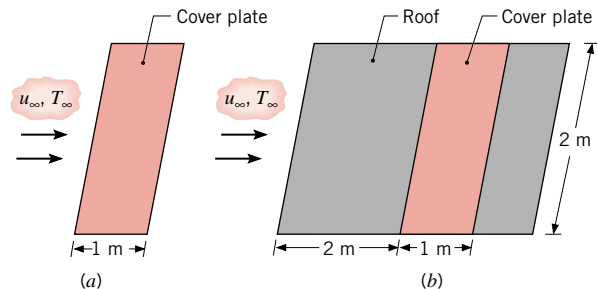


- What is the rate of convective heat loss from the plate?



- (b) If the plate is installed 2 m from the leading edge of a roof and flush with the roof surface, what is the rate of convective heat loss?

**7.38** An array of 10 silicon chips, each of length  $L = 10$  mm on a side, is insulated on one surface and cooled on the opposite surface by atmospheric air in parallel flow with  $T_\infty = 24^\circ\text{C}$  and  $u_\infty = 40$  m/s. When in use, the same electrical power is dissipated in each chip, maintaining a uniform heat flux over the entire cooled surface.

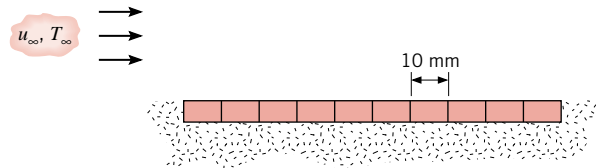


If the temperature of each chip may not exceed  $80^\circ\text{C}$ , what is the maximum allowable power per chip? What is the maximum allowable power if a turbulence promoter is used to trip the boundary layer at the leading edge? Would it be preferable to orient the array normal, instead of parallel, to the airflow?

**7.39** A square ( $10\text{ mm} \times 10\text{ mm}$ ) silicon chip is insulated on one side and cooled on the opposite side by atmospheric air in parallel flow at  $u_\infty = 20$  m/s and  $T_\infty = 24^\circ\text{C}$ . When in use, electrical power dissipation within the chip maintains a uniform heat flux at the cooled surface. If the chip temperature may not exceed  $80^\circ\text{C}$  at any point on its surface, what is the maximum allowable power? What is the maximum allowable power if the chip is flush mounted in a substrate that provides for an unheated starting length of 20 mm?

**7.40** Working in groups of two, our students design and perform experiments on forced convection phenomena using the general arrangement shown schematically. The air box consists of two muffin fans, a plenum chamber, and flow straighteners discharging a nearly uniform airstream over the flat *test-plate*. The objectives of one experiment were to measure the heat transfer coefficient and to compare the results with standard convection correlations. The velocity of the airstream was measured using a thermistor-based anemometer, and thermocouples were used to determine the temperatures of the airstream and the *test-plate*.

With the airstream from the box fully stabilized at  $T_\infty = 20^\circ\text{C}$ , an aluminum plate was preheated in a convection oven and quickly mounted in the test-plate holder. The subsequent temperature history of the plate was determined from thermocouple measurements, and histories obtained for airstream velocities of 3 and 9 m/s were fitted by the following polynomial:

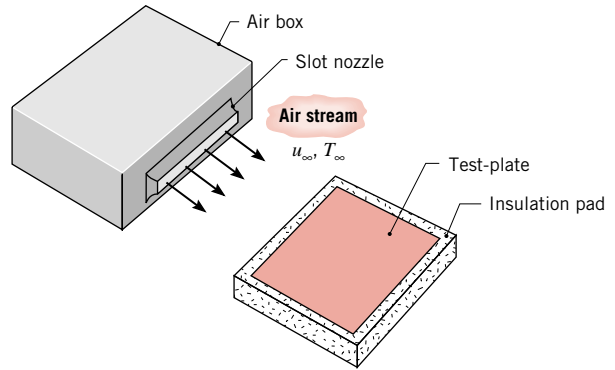

$$T(t) = a + bt + ct^2 + dt^3 + et^4$$

The temperature  $T$  and time  $t$  have units of  $^\circ\text{C}$  and s, respectively, and values of the coefficients appropriate for the time interval of the experiments are tabulated as follows:

Velocity (m/s)	3	9
Elapsed Time (s)	300	160
a ( $^\circ\text{C}$ )	56.87	57.00
b ( $^\circ\text{C/s}$ )	$-0.1472$	$-0.2641$
c ( $^\circ\text{C/s}^2$ )	$3 \times 10^{-4}$	$9 \times 10^{-4}$
d ( $^\circ\text{C/s}^3$ )	$-4 \times 10^{-7}$	$-2 \times 10^{-6}$
e ( $^\circ\text{C/s}^4$ )	$2 \times 10^{-10}$	$1 \times 10^{-9}$

The plate is square, 133 mm to a side, with a thickness of 3.2 mm, and is made from a highly polished aluminum alloy ( $\rho = 2770$  kg/m<sup>3</sup>,  $c = 875$  J/kg  $\cdot$  K,  $k = 177$  W/m  $\cdot$  K).

- Determine the heat transfer coefficients for the two cases, assuming the plate behaves as a spacewise isothermal object.
- Evaluate the coefficients  $C$  and  $m$  for a correlation of the form

$$\overline{Nu}_L = C Re^m Pr^{1/3}$$

Compare this result with a standard flat-plate correlation. Comment on the *goodness* of the comparison and explain any differences.

## Cylinder in Cross Flow

**7.41** Consider the following fluids, each with a velocity of  $V = 5$  m/s and a temperature of  $T_\infty = 20^\circ\text{C}$ , in cross flow over a 10-mm diameter cylinder maintained at  $50^\circ\text{C}$ : atmospheric air, saturated water, and engine oil.

- Calculate the rate of heat transfer per unit length,  $q'$ , using the Churchill–Bernstein correlation.

- (b) Generate a plot of  $q'$  as a function of fluid velocity for  $0.5 \leq V \leq 10$  m/s.

**7.42** A circular pipe of 25-mm outside diameter is placed in an airstream at 25°C and 1-atm pressure. The air moves in cross flow over the pipe at 15 m/s, while the outer surface of the pipe is maintained at 100°C. What is the drag force exerted on the pipe per unit length? What is the rate of heat transfer from the pipe per unit length?

**7.43** A long, cylindrical, electrical heating element of diameter  $D = 10$  mm, thermal conductivity  $k = 240$  W/m · K, density  $\rho = 2700$  kg/m<sup>3</sup>, and specific heat  $c_p = 900$  J/kg · K is installed in a duct for which air moves in cross flow over the heater at a temperature and velocity of 27°C and 10 m/s, respectively.


- Neglecting radiation, estimate the steady-state surface temperature when, per unit length of the heater, electrical energy is being dissipated at a rate of 1000 W/m.
- If the heater is activated from an initial temperature of 27°C, estimate the time required for the surface temperature to come within 10°C of its steady-state value.

**7.44** Consider the conditions of Problem 7.43, but now allow for radiation exchange between the surface of the heating element ( $\varepsilon = 0.8$ ) and the walls of the duct, which form a large enclosure at 27°C.

- Evaluate the steady-state surface temperature.
- If the heater is activated from an initial temperature of 27°C, estimate the time required for the surface temperature to come within 10°C of the steady-state value.
- To guard against overheating due to unanticipated excursions in the blower output, the heater controller is designed to maintain a fixed surface temperature of 275°C. Determine the power dissipation required to maintain this temperature for air velocities in the range  $5 \leq V \leq 10$  m/s.


**7.45** A pin fin of 10-mm diameter dissipates 30 W by forced convection to air in cross flow with a Reynolds number of 4000. If the diameter of the fin is doubled and all other conditions remain the same, estimate the fin heat rate. Assume the pin to be infinitely long.

**7.46** Air at 27°C and a velocity of 5 m/s passes over the small region  $A_s$  (20 mm × 20 mm) on a large surface, which is maintained at  $T_s = 127^\circ\text{C}$ . For these conditions, 0.5 W is removed from the surface  $A_s$ . In order to increase the heat removal rate, a stainless steel (AISI 304) pin fin of diameter 5 mm is affixed to  $A_s$ , which is assumed to remain at  $T_s = 127^\circ\text{C}$ .

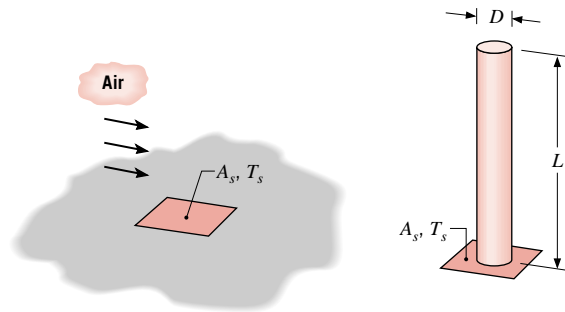

- Determine the maximum possible heat removal rate through the fin.
- What fin length would provide a close approximation to the heat rate found in part (a)? *Hint:* Refer to Example 3.9.
- Determine the fin effectiveness,  $\varepsilon_f$ .
- What is the percentage increase in the heat rate from  $A_s$  due to installation of the fin?

**7.47** To enhance heat transfer from a silicon chip of width  $W = 4$  mm on a side, a copper pin fin is brazed to the surface of the chip. The pin length and diameter are  $L = 12$  mm and  $D = 2$  mm, respectively, and atmospheric air at  $V = 10$  m/s and  $T_\infty = 300$  K is in cross flow over the pin. The surface of the chip, and hence the base of the pin, are maintained at a temperature of  $T_b = 350$  K.

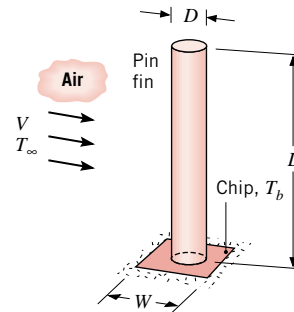

- Assuming the chip to have a negligible effect on flow over the pin, what is the average convection coefficient for the surface of the pin?
- Neglecting radiation and assuming the convection coefficient at the pin tip to equal that calculated in part (a), determine the pin heat transfer rate.
- Neglecting radiation and assuming the convection coefficient at the exposed chip surface to equal that calculated in part (a), determine the total rate of heat transfer from the chip.

- (d) Independently determine and plot the effect of increasing velocity ( $10 \leq V \leq 40$  m/s) and pin

diameter ( $2 \leq D \leq 4$  mm) on the total rate of heat transfer from the chip. What is the heat rate for  $V = 40$  m/s and  $D = 4$  mm?

- 7.48** Consider the Nichrome wire ( $D = 1$  mm,  $\rho_e = 10^{-6} \Omega \cdot \text{m}$ ,  $k = 25 \text{ W/m} \cdot \text{K}$ ,  $\varepsilon = 0.20$ ) used to fabricate the air heater of Problem 3.86, but now under conditions for which the convection heat transfer coefficient must be determined.

(a) For atmospheric air at  $50^\circ\text{C}$  and a cross-flow velocity of  $5$  m/s, what are the surface and centerline temperatures of the wire when it carries a current of  $25$  A and the housing of the heater is also at  $50^\circ\text{C}$ ?

(b) Explore the effect of variations in the flow velocity and electrical current on the surface and centerline temperatures of the wire.

- 7.49** A fine wire of diameter  $D$  is positioned across a passage to determine flow velocity from heat transfer characteristics. Current is passed through the wire to heat it, and the heat is dissipated to the flowing fluid by convection. The resistance of the wire is determined from electrical measurements, and the temperature is known from the resistance.

(a) For a fluid of arbitrary Prandtl number, develop an expression for its velocity in terms of the difference between the temperature of the wire and the free stream temperature of the fluid.

(b) What is the velocity of an airstream at  $1$  atm and  $25^\circ\text{C}$ , if a wire of  $0.5$ -mm diameter achieves a temperature of  $40^\circ\text{C}$  while dissipating  $35 \text{ W/m}$ ?

- 7.50** To determine air velocity changes, it is proposed to measure the electric current required to maintain a platinum wire of  $0.5$ -mm diameter at a constant temperature of  $77^\circ\text{C}$  in a stream of air at  $27^\circ\text{C}$ .

(a) Assuming Reynolds numbers in the range  $40 < Re_D < 1000$ , develop a relationship between the wire current and the velocity of the air that is in cross flow over the wire. Use this result to establish a relation between fractional changes in the current,  $\Delta I/I$ , and the air velocity,  $\Delta V/V$ .

(b) Calculate the current required when the air velocity is  $10$  m/s and the electrical resistivity of the platinum wire is  $17.1 \times 10^{-5} \Omega \cdot \text{m}$ .

- 7.51** A computer code is being developed to analyze a temperature sensor of  $12.5$ -mm diameter experiencing cross flow of water with a free stream temperature of  $80^\circ\text{C}$  and variable velocity. Derive an expression for the convection heat transfer coefficient as a function of the sensor surface temperature  $T_s$  for the range  $20 < T_s < 80^\circ\text{C}$  and for velocities  $V$  in the range  $0.005 < V < 0.20$  m/s. Use the Zukauskas correlation for the

range  $40 < Re_D < 1000$  and assume that the Prandtl number of water has a linear temperature dependence.

- 7.52** A  $25$ -mm-diameter, high-tension line has an electrical resistance of  $10^{-4} \Omega/\text{m}$  and is transmitting a current of  $1000$  A.

(a) If ambient air at  $10^\circ\text{C}$  and  $5$  m/s is in cross flow over the line, what is its surface temperature?

(b) If the line may be approximated as a solid copper rod, what is its centerline temperature?

(c) Generate a plot that depicts the variation of the surface temperature with air velocity for  $1 \leq V \leq 10$  m/s.


- 7.53** An aluminum transmission line with a diameter of  $20$  mm has an electrical resistance of  $R'_{\text{elec}} = 2.636 \times 10^{-4} \Omega/\text{m}$  and carries a current of  $700$  A. The line is subjected to frequent and severe cross winds, increasing the probability of contact between adjacent lines, thereby causing sparks and creating a potential fire hazard for nearby vegetation. The remedy is to insulate the line, but with the adverse effect of increasing the conductor operating temperature.

(a) Calculate the conductor temperature when the air temperature is  $20^\circ\text{C}$  and the line is subjected to cross flow with a velocity of  $10$  m/s.

(b) Calculate the conductor temperature for the same conditions, but with a  $2$ -mm-thick insulation having a thermal conductivity of  $0.15 \text{ W/m} \cdot \text{K}$ .

(c) Calculate and plot the temperatures of the bare and insulated conductors for wind velocities in the range from  $2$  to  $20$  m/s. Comment on features of the curves and the effect of the wind velocity on the conductor temperatures.

- 7.54** To augment heat transfer between two flowing fluids, it is proposed to insert a  $100$ -mm-long,  $5$ -mm-diameter

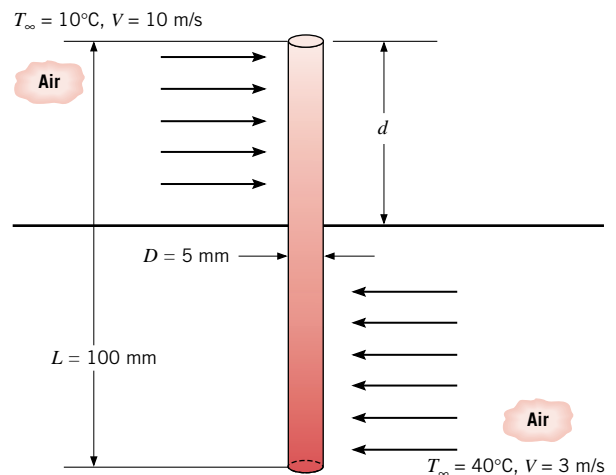



2024 aluminum pin fin through the wall separating the two fluids. The pin is inserted to a depth of  $d$  into fluid 1. Fluid 1 is air with a mean temperature of  $10^\circ\text{C}$  and nearly uniform velocity of  $10\text{ m/s}$ . Fluid 2 is air with a mean temperature of  $40^\circ\text{C}$  and mean velocity of  $3\text{ m/s}$ .

- (a) Determine the rate of heat transfer from the warm air to the cool air through the pin fin for  $d = 50\text{ mm}$ .
- (b) Plot the variation of the heat transfer rate with the insertion distance,  $d$ . Does an optimal insertion distance exist?

**7.55** Repeat Problem 7.54, except now fluid 1 is ethylene glycol with a mean temperature of  $10^\circ\text{C}$  and nearly uniform velocity of  $10\text{ m/s}$ . Fluid 2 is water with a mean temperature of  $40^\circ\text{C}$  and mean velocity of  $3\text{ m/s}$ .

**7.56** Hot water at  $50^\circ\text{C}$  is routed from one building in which it is generated to an adjoining building in which it is used for space heating. Transfer between the buildings occurs in a steel pipe ( $k = 60\text{ W/m}\cdot\text{K}$ ) of  $100\text{-mm}$  outside diameter and  $8\text{-mm}$  wall thickness. During the winter, representative environmental conditions involve air at  $T_\infty = -5^\circ\text{C}$  and  $V = 3\text{ m/s}$  in cross flow over the pipe.


- (a) If the cost of producing the hot water is  $\$0.05\text{ per kW}\cdot\text{h}$ , what is the representative daily cost of heat loss from an uninsulated pipe to the air per meter of pipe length? The convection resistance associated with water flow in the pipe may be neglected.
- (b) Determine the savings associated with application of a  $10\text{-mm-thick}$  coating of urethane insulation ( $k = 0.026\text{ W/m}\cdot\text{K}$ ) to the outer surface of the pipe.

**7.57** An uninsulated steam pipe is used to transport high-temperature steam from one building to another. The pipe is of  $0.5\text{-m}$  diameter, has a surface temperature of  $150^\circ\text{C}$ , and is exposed to ambient air at  $-10^\circ\text{C}$ . The air moves in cross flow over the pipe with a velocity of  $5\text{ m/s}$ .

- (a) What is the heat loss per unit length of pipe?
- (b) Consider the effect of insulating the pipe with a rigid urethane foam ( $k = 0.026\text{ W/m}\cdot\text{K}$ ). Evaluate and plot the heat loss as a function of the thickness  $\delta$  of the insulation layer for  $0 \leq \delta \leq 50\text{ mm}$ .

**7.58** A thermocouple is inserted into a hot air duct to measure the air temperature. The thermocouple ( $T_1$ ) is soldered to the tip of a steel *thermocouple well* of length  $L = 0.15\text{ m}$  and inner and outer diameters of  $D_i = 5\text{ mm}$  and  $D_o = 10\text{ mm}$ . A second thermocouple ( $T_2$ ) is used to measure the duct wall temperature.

Consider conditions for which the air velocity in the duct is  $V = 3\text{ m/s}$  and the two thermocouples register temperatures of  $T_1 = 450\text{ K}$  and  $T_2 = 375\text{ K}$ . Neglecting radiation, determine the air temperature  $T_\infty$ . Assume that,

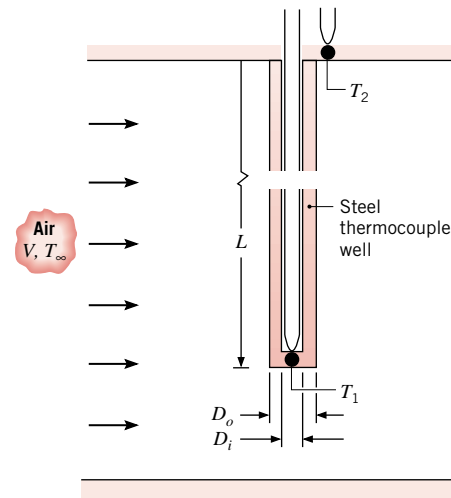


for steel,  $k = 35\text{ W/m}\cdot\text{K}$ , and, for air,  $\rho = 0.774\text{ kg/m}^3$ ,  $\mu = 251 \times 10^{-7}\text{ N}\cdot\text{s/m}^2$ ,  $k = 0.0373\text{ W/m}\cdot\text{K}$ , and  $Pr = 0.686$ .

**7.59** Consider conditions for which a mercury-in-glass thermometer of  $4\text{-mm}$  diameter is inserted to a length  $L$  through the wall of a duct in which air at  $77^\circ\text{C}$  is flowing. If the stem of the thermometer at the duct wall is at the wall temperature  $T_w = 15^\circ\text{C}$ , conduction heat transfer through the glass causes the bulb temperature to be lower than that of the airstream.

- (a) Develop a relationship for the *immersion error*,  $\Delta T_i = T(L) - T_\infty$ , as a function of air velocity, thermometer diameter, and insertion length  $L$ .
- (b) To what length  $L$  must the thermometer be inserted if the immersion error is not to exceed  $0.25^\circ\text{C}$  when the air velocity is  $10\text{ m/s}$ ?
- (c) Using the insertion length determined in part (b), calculate and plot the immersion error as a function of air velocity for the range  $2$  to  $20\text{ m/s}$ .
- (d) For a given insertion length, will the immersion error increase or decrease if the diameter of the thermometer is increased? Is the immersion error more sensitive to the diameter or air velocity?

**7.60** Fluid velocities can be measured using hot-film sensors, and a common design is one for which the sensing element forms a thin film about the circumference of a quartz rod. The film is typically comprised of a thin ( $\sim 100\text{ nm}$ ) layer of platinum, whose electrical resistance is proportional to its temperature. Hence, when submerged in a fluid stream, an electric current may be passed through the film to maintain its temperature above that of the fluid. The temperature of the film is

controlled by monitoring its electric resistance, and with concurrent measurement of the electric current, the power dissipated in the film may be determined.

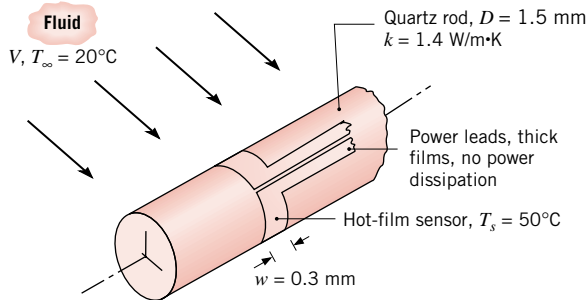

Proper operation is assured only if the heat generated in the film is transferred to the fluid, rather than conducted from the film into the quartz rod. Thermally, the film should therefore be strongly coupled to the fluid and weakly coupled to the quartz rod. This condition is satisfied if the Biot number is very large,  $Bi = \bar{h}D/2k \gg 1$ , where  $\bar{h}$  is the convection coefficient between the fluid and the film and  $k$  is the thermal conductivity of the rod.

- For the following fluids and velocities, calculate and plot the convection coefficient as a function of velocity: (i) water,  $0.5 \leq V \leq 5$  m/s; (ii) air,  $1 \leq V \leq 20$  m/s.
- Comment on the suitability of using this hot-film sensor for the foregoing conditions.

**7.61** Consider use of the hot-film sensor described in Problem 7.60 to determine the velocity of water entering the cooling system of an electric power plant from an adjoining lake. The sensor is mounted within an intake pipe, and its controls are set to maintain an average hot-film temperature that is  $5^\circ\text{C}$  larger than the fluid temperature ( $T_{s, \text{hf}} - T_\infty = 5^\circ\text{C}$ ).


- If an independent measurement of the water temperature yields a value of  $T_\infty = 17^\circ\text{C}$ , use the Churchill–Bernstein correlation to estimate the velocity of the water under conditions for which the power input to the sensor maintains a heat flux of  $q''_{\text{hf}} = 4 \times 10^4$  W/m<sup>2</sup> from the film to the water.
- If the sensor is exposed to the water for an extended period, its surface will be *fouled* by an accumulation of deposits from the water. Consider conditions for which the deposits form a 0.1-mm-thick shell around the sensor and have a thermal conductivity of  $k_d = 2$  W/m·K. For  $T_\infty = 17^\circ\text{C}$  and the flow velocity determined in part (a), what heat flux must be supplied to the sensor to maintain its temperature at  $T_{s, \text{hf}} = 22^\circ\text{C}$ ? What is the corre-

sponding error in the velocity measurement? *Note:* conduction across the deposit may be approximated as that across a plane wall.

**7.62** In a manufacturing process, a long coated plastic rod ( $\rho = 2200$  kg/m<sup>3</sup>,  $c = 800$  J/kg·K,  $k = 1$  W/m·K) of diameter  $D = 20$  mm is initially at a uniform temperature of  $25^\circ\text{C}$  and is suddenly exposed to a cross flow of air at  $T_\infty = 350^\circ\text{C}$  and  $V = 50$  m/s.

- How long will it take for the surface of the rod to reach  $175^\circ\text{C}$ , the temperature above which the special coating will cure?
- Generate a plot of the time-to-reach  $175^\circ\text{C}$  as a function of air velocity for  $5 \leq V \leq 50$  m/s.


**7.63** In an extrusion process, copper wire emerges from the extruder at a velocity  $V_e$  and is cooled by convection heat transfer to air in cross flow over the wire, as well as by radiation to the surroundings.

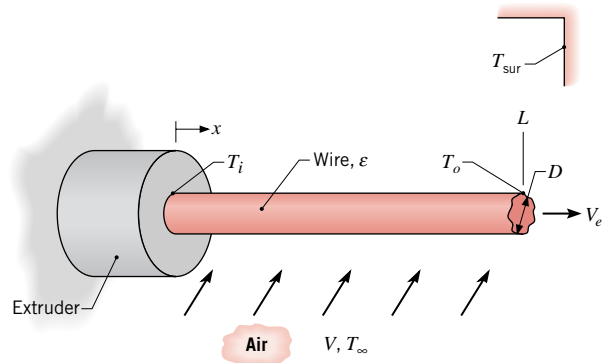

- By applying conservation of energy to a differential control surface of length  $dx$ , which either moves with the wire *or* is stationary and through which the wire passes, derive a differential equation that governs the temperature distribution,  $T(x)$ , along the wire. In your derivation, the effect of axial conduction along the wire may be neglected. Express your result in terms of the velocity, diameter, and properties of the wire ( $V_e$ ,  $D$ ,  $\rho$ ,  $c_p$ ,  $\varepsilon$ ), the convection coefficient associated with the cross flow ( $\bar{h}$ ), and the environmental temperatures ( $T_\infty$ ,  $T_{\text{sur}}$ ).
- Neglecting radiation, obtain a closed form solution to the foregoing equation. For  $V_e = 0.2$  m/s,  $D = 5$  mm,  $V = 5$  m/s,  $T_\infty = 25^\circ\text{C}$ , and an initial wire temperature of  $T_i = 600^\circ\text{C}$ , compute the temperature  $T_o$  of the wire at  $x = L = 5$  m. The density and specific heat of the copper are  $\rho = 8900$  kg/m<sup>3</sup> and  $c_p = 400$  J/kg·K, while properties of the air may be taken to be  $k = 0.037$  W/m·K,  $\nu = 3 \times 10^{-5}$  m<sup>2</sup>/s, and  $Pr = 0.69$ .

- (c) Accounting for the effects of radiation, with  $\varepsilon = 0.55$  and  $T_{\text{sur}} = 25^\circ\text{C}$ , numerically integrate the differential equation derived in part (a) to determine the temperature of the wire at  $L = 5$  m. Explore the effects of  $V_e$  and  $\varepsilon$  on the temperature distribution along the wire.

- 7.64** The objective of an experiment performed by our students is to determine the effect of pin fins on the thermal resistance between a flat plate and an airstream. A 25.9-mm-square polished aluminum plate is subjected to an airstream in parallel flow at  $T_\infty = 20^\circ\text{C}$  and  $u_\infty = 6$  m/s. An electrical heating patch is attached to the backside of the plate and dissipates 15.5 W under all conditions. Pin fins of diameter  $D = 4.8$  mm and length  $L = 25.4$  mm are fabricated from brass and can be firmly attached to the plate at various locations over its surface. Thermocouples are attached to the plate surface and the tip of one of the fins.

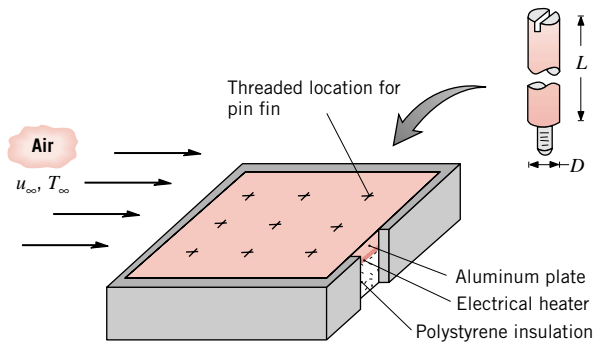

Measured temperatures for five pin-fin configurations are tabulated.

Number of Pin Fins	Temperature ( $^\circ\text{C}$ )	
	Fin Tip	Plate Base
0	—	70.2
1	40.6	67.4
2	39.5	64.7
5	36.4	57.4
8	34.2	52.1

- (a) Using the experimental observations and neglecting the effect of flow interactions between pins, determine the thermal resistance between the plate and the airstream for the five configurations.
- (b) Develop a model of the plate–pin fin system and using appropriate convection correlations, predict the thermal resistances for the five configurations.

Compare your predictions with the observations and explain any differences.

- (c) Use your model to predict the thermal resistances when the airstream velocity is doubled.

- 7.65** Consider the enclosure and heat sink of Problem 7.30. The heat sink is rotated  $90^\circ$  so that the air is no longer directed between the fins, but normal to one of the  $(L_b + L_f) \times w_2$  surfaces. Estimate the required air velocity if the height of the enclosure is  $L_e = 10$  mm. Neglect heat transfer from the enclosure surfaces and assume isothermal fins, no heat transfer in the gaps between the fins, and negligible heat transfer from the downstream  $(L_b + L_f) \times w_2$  surface. Include heat transfer from the  $(L_b + L_f) \times w_1$  sides and the fin tips.

## Spheres

- 7.66** Air at  $25^\circ\text{C}$  flows over a 10-mm-diameter sphere with a velocity of 25 m/s, while the surface of the sphere is maintained at  $75^\circ\text{C}$ .

- (a) What is the drag force on the sphere?
- (b) What is the rate of heat transfer from the sphere?

- (c) Generate a plot of the heat transfer from the sphere as a function of the air velocity for the range 1 to 25 m/s.

- 7.67** Consider a sphere with a diameter of 20 mm and a surface temperature of  $60^\circ\text{C}$  that is immersed in a fluid at a temperature of  $30^\circ\text{C}$  and a velocity of 2.5 m/s. Calculate the drag force and the heat rate when the fluid is (a) water and (b) air at atmospheric pressure. Explain why the results for the two fluids are so different.

- 7.68** Atmospheric air at  $25^\circ\text{C}$  and a velocity of 0.5 m/s flows over a 50-W incandescent bulb whose surface temperature is at  $140^\circ\text{C}$ . The bulb may be approximated as a sphere of 50-mm diameter. What is the rate of heat loss by convection to the air?

- 7.69** Consider the material processing experiment of Problem 5.24, with atmospheric nitrogen used to implement cooling by convection. However, instead of using a prescribed value of the convection coefficient, compute the coefficient from an appropriate correlation.

- (a) Neglecting radiation, determine the time required to cool the sphere from  $900^\circ\text{C}$  to  $300^\circ\text{C}$  if the velocity and temperature of the nitrogen are  $V = 5$  m/s and  $T_\infty = 25^\circ\text{C}$ .


- (b) Accounting for the effects of both convection and radiation, with  $\varepsilon = 0.6$  and  $T_{\text{sur}} = 25^\circ\text{C}$ , determine the time required to cool the sphere. Explore the effects of the flow velocity on your result.

**7.70** A spherical, underwater instrument pod used to make soundings and to measure conditions in the water has a diameter of 85 mm and dissipates 300 W.

- Estimate the surface temperature of the pod when suspended in a bay where the current is 1 m/s and the water temperature is 15°C.
- Inadvertently, the pod is hauled out of the water and suspended in ambient air without deactivating the power. Estimate the surface temperature of the pod if the air temperature is 15°C and the wind speed is 3 m/s.

**7.71** Worldwide, over a billion solder balls must be manufactured daily for assembling electronics packages. The *uniform droplet spray* method uses a piezoelectric device to vibrate a shaft in a pot of molten solder that, in turn, ejects small droplets of solder through a precision-machined nozzle. As they traverse a collection chamber, the droplets cool and solidify. The collection chamber is flooded with an inert gas such as nitrogen to prevent oxidation of the solder ball surfaces.

- Molten solder droplets of diameter 130  $\mu\text{m}$  are ejected at a velocity of 2 m/s at an initial temperature of 225°C into gaseous nitrogen that is at 30°C and slightly above atmospheric pressure. Determine the terminal velocity of the particles and the distance the particles have traveled when they become completely solidified. The solder properties are  $\rho = 8230 \text{ kg/m}^3$ ,  $c = 240 \text{ J/kg} \cdot \text{K}$ ,  $k = 38 \text{ W/m} \cdot \text{K}$ ,  $h_{sf} = 42 \text{ kJ/kg}$ . The solder's melting temperature is 183°C.
- The piezoelectric device oscillates at 1.8 kHz, producing 1800 particles per second. Determine the separation distance between the particles as they traverse the nitrogen gas and the pot volume needed in order to produce the solder balls continuously for one week.

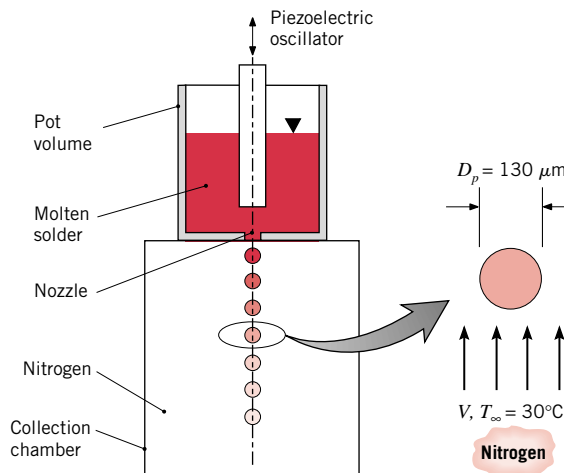

**7.72** A spherical workpiece of pure copper with a diameter of 15 mm and an emissivity of 0.5 is suspended in a large furnace with walls at a uniform temperature of 600°C. Air flows over the workpiece at a temperature of 900°C and a velocity of 7.5 m/s.

- Determine the steady-state temperature of the workpiece.
- Estimate the time required for the workpiece to come within 5°C of the steady-state temperature if it is at an initial, uniform temperature of 25°C.
- In order to decrease the time to heat the workpiece, the air velocity is doubled, with all other conditions remaining the same. Determine the steady-state temperature of the workpiece and the time required for it to come within 5°C of this value. Plot on the same graph the workpiece temperature histories for the two velocities.

**7.73** Copper spheres of 20-mm diameter are quenched by being dropped into a tank of water that is maintained at 280 K. The spheres may be assumed to reach the terminal velocity on impact and to drop freely through the water. Estimate the terminal velocity by equating the drag and gravitational forces acting on the sphere. What is the approximate height of the water tank needed to cool the spheres from an initial temperature of 360 K to a center temperature of 320 K?


**7.74** For the conditions of Problem 7.73, what are the terminal velocity and the tank height if engine oil at 300 K, rather than water, is used as the coolant?

**7.75** Consider the plasma spray coating process of Problem 5.25. In addition to the prescribed conditions, the argon plasma jet is known to have a mean velocity of  $V = 400 \text{ m/s}$ , while the *initial* velocity of the injected alumina particles may be approximated as zero. The nozzle exit and the substrate are separated by a distance of  $L = 100 \text{ mm}$ , and pertinent properties of the argon plasma may be approximated as  $k = 0.671 \text{ W/m} \cdot \text{K}$ ,  $c_p = 1480 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 2.70 \times 10^{-4} \text{ kg/s} \cdot \text{m}$ , and  $\nu = 5.6 \times 10^{-3} \text{ m}^2/\text{s}$ .

- Assuming the motion of particles entrained by the plasma jet to be governed by Stokes' law, derive expressions for the particle velocity,  $V_p(t)$ , and its distance of travel from the nozzle exit,  $x_p(t)$ , as a function of time,  $t$ , where  $t = 0$  corresponds to particle injection. Evaluate the time-in-flight required for a particle to traverse the separation distance,  $x_p = L$ , and the velocity  $V_p$  at this time.
- Assuming an average relative velocity of  $(\overline{V - V_p}) = 315 \text{ m/s}$  during the time-of-flight, estimate the convection coefficient associated with heat transfer from the plasma to the particle. Using this coefficient and assuming an initial particle temperature of  $T_i = 300$

K, estimate the time-in-flight required to heat a particle to its melting point,  $T_{mp}$ , and, once at  $T_{mp}$ , for the particle to experience complete melting. Is the prescribed value of  $L$  sufficient to ensure complete particle melting before surface impact?

- 7.76** Highly reflective aluminum coatings may be formed on the surface of a substrate by impacting the surface with molten drops of aluminum. The droplets are discharged from an injector, proceed through an inert gas (helium), and must still be in a molten state at the time of impact.

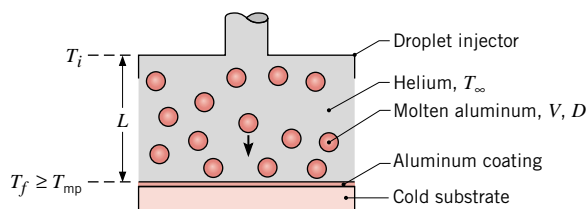


Consider conditions for which droplets with a diameter, velocity, and initial temperature of  $D = 500 \mu\text{m}$ ,  $V = 3 \text{ m/s}$ , and  $T_i = 1100 \text{ K}$ , respectively, traverse a stagnant layer of atmospheric helium that is at a temperature of  $T_\infty = 300 \text{ K}$ . What is the maximum allowable thickness of the helium layer needed to ensure that the temperature of droplets impacting the substrate is greater than or equal to the melting point of aluminum ( $T_f \geq T_{mp} = 933 \text{ K}$ )? Properties of the molten aluminum may be approximated as  $\rho = 2500 \text{ kg/m}^3$ ,  $c = 1200 \text{ J/kg} \cdot \text{K}$ , and  $k = 200 \text{ W/m} \cdot \text{K}$ .

- 7.77** Tissue engineering involves the development of biological substitutes that restore or improve tissue function. Once manufactured, engineered organs can be implanted and grow within the patient, obviating chronic shortages of natural organs that arise when traditional organ transplant procedures are used. Artificial organ manufacture involves two major steps. First, a porous *scaffold* is fabricated with a specific pore size and pore distribution, as well as overall shape and size. Second, the top surface of the scaffold is seeded with human cells that grow into the pores of the scaffold. The scaffold material is biodegradable and is eventually replaced with healthy tissue. The artificial organ is then ready to be implanted in the patient.


The complex pore shapes, small pore sizes, and unusual organ shapes preclude use of traditional manufacturing methods to fabricate the scaffolds. A method that has been used with success is a *solid freeform fabrication* technique whereby small spherical drops are directed to a substrate. The drops are initially molten and solidify when they impact the room-temperature substrate. By controlling the location of the droplet deposition, complex scaffolds can be built up, one drop

at a time. A device similar to that of Problem 7.71 is used to generate uniform,  $75\text{-}\mu\text{m}$ -diameter drops at an initial temperature of  $T_i = 150^\circ\text{C}$ . The particles are sent through quiescent air at  $T_\infty = 25^\circ\text{C}$ . The droplet properties are  $\rho = 2200 \text{ kg/m}^3$ ,  $c = 700 \text{ J/kg} \cdot \text{K}$ .

- (a) It is desirable for the droplets to exit the nozzle at their terminal velocity. Determine the terminal velocity of the drops.
- (b) It is desirable for the droplets to impact the structure at a temperature of  $T_2 = 120^\circ\text{C}$ . What is the required distance between the exit nozzle and the structure,  $L$ ?

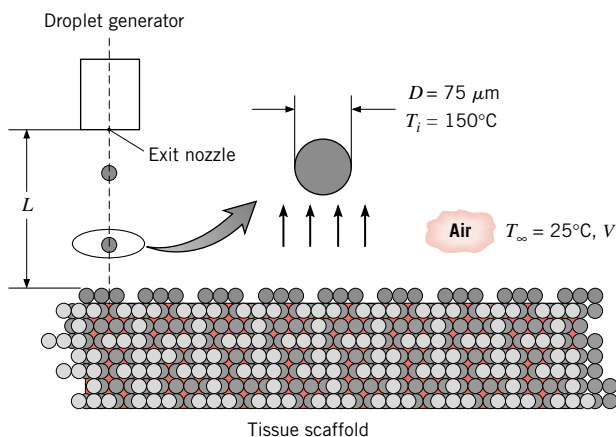

- 7.78** A spherical thermocouple junction  $1.0 \text{ mm}$  in diameter is inserted in a combustion chamber to measure the temperature  $T_\infty$  of the products of combustion. The hot gases have a velocity of  $V = 5 \text{ m/s}$ .

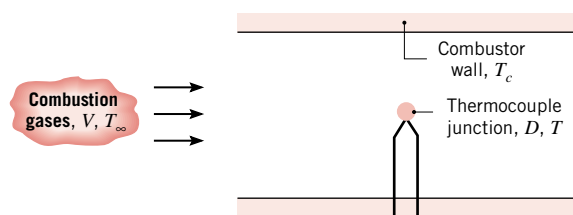


- (a) If the thermocouple is at room temperature,  $T_i$ , when it is inserted in the chamber, estimate the time required for the temperature difference,  $T_\infty - T$ , to reach 2% of the initial temperature difference,  $T_\infty - T_i$ . Neglect radiation and conduction through the leads. Properties of the thermocouple junction are approximated as  $k = 100 \text{ W/m} \cdot \text{K}$ ,  $c = 385 \text{ J/kg} \cdot \text{K}$ , and  $\rho = 8920 \text{ kg/m}^3$ , while those of the combustion gases may be approximated as  $k = 0.05 \text{ W/m} \cdot \text{K}$ ,  $\nu = 50 \times 10^{-6} \text{ m}^2/\text{s}$ , and  $Pr = 0.69$ .
- (b) If the thermocouple junction has an emissivity of 0.5 and the cooled walls of the combustor are at



$T_c = 400$  K, what is the steady-state temperature of the thermocouple junction if the combustion gases are at 1000 K? Conduction through the lead wires may be neglected.

- (c) To determine the influence of the gas velocity on the thermocouple measurement error, compute the steady-state temperature of the thermocouple junction for velocities in the range  $1 \leq V \leq 25$  m/s. The emissivity of the junction can be controlled through application of a thin coating. To reduce the measurement error, should the emissivity be increased or decreased? For  $V = 5$  m/s, compute the steady-state junction temperature for emissivities in the range  $0.1 \leq \varepsilon \leq 1.0$ .

- 7.79** A thermocouple junction is inserted in a large duct to measure the temperature of hot gases flowing through the duct.

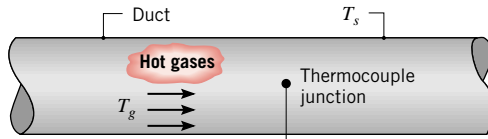


- (a) If the duct surface temperature  $T_s$  is less than the gas temperature  $T_g$ , will the thermocouple sense a temperature that is less than, equal to, or greater than  $T_g$ ? Justify your answer on the basis of a simple analysis.
- (b) A thermocouple junction in the shape of a 2-mm-diameter sphere with a surface emissivity of 0.60 is placed in a gas stream moving at 3 m/s. If the thermocouple senses a temperature of 320°C when the duct surface temperature is 175°C, what is the actual gas temperature? The gas may be assumed to have the properties of air at atmospheric pressure.
- (c) How would changes in velocity and emissivity affect the temperature measurement error? Determine the measurement error for velocities in the range  $1 \leq V \leq 25$  m/s ( $\varepsilon = 0.6$ ) and for emissivities in the range  $0.1 \leq \varepsilon \leq 1.0$  ( $V = 3$  m/s).

- 7.80** Consider temperature measurement in a gas stream using the thermocouple junction described in Problem 7.79 ( $D = 2$  mm,  $\varepsilon = 0.60$ ). If the gas velocity and temperature are 3 m/s and 500°C, respectively, what temperature will be indicated by the thermocouple if the duct surface temperature is 200°C? The gas may be assumed to have the properties of atmospheric air. What temperature will be indicated by the thermocouple if the gas pressure is doubled and all other conditions remain the same?

- 7.81** A high-temperature gas reactor (HTGR) consists of spherical, uranium oxide fuel elements in which there


is uniform volumetric heating ( $\dot{q}$ ). Each fuel element is embedded in a graphite spherical shell, which is cooled by a helium gas flow at 1 atm.

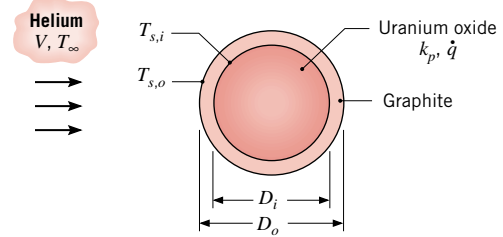

Consider steady-state conditions for which radiation effects may be neglected, the gas velocity and temperature are  $V = 20$  m/s and  $T_\infty = 500$  K, the pellet and shell diameters are  $D_i = 10$  mm and  $D_o = 12$  mm, and the shell surface temperature is  $T_{s,o} = 1300$  K. The uranium oxide and graphite each have a thermal conductivity of  $k_p = k_g = 2$  W/m · K.

- (a) What is the rate of heat transfer from a single pellet to the gas stream?
- (b) What is the volumetric rate of heat generation in the pellet and what is the temperature at the pellet-graphite interface ( $T_{s,i}$ )?
- (c) Obtain an expression for the radial temperature distribution,  $T(r)$ , in the pellet, expressing your result in terms of the temperature at the center of the pellet,  $T(0)$ . Evaluate  $T(0)$  for the prescribed conditions.
- (d) Determine  $T_{s,o}$ ,  $T_{s,i}$  and  $T(0)$  as a function of the gas velocity for  $5 \leq V \leq 20$  m/s and  $\dot{q} = 1.50 \times 10^8$  W/m<sup>3</sup>.

- 7.82** A silicon chip ( $k = 150$  W/m · K,  $\rho = 2300$  kg/m<sup>3</sup>,  $c_p = 700$  J/kg · K), 10 mm on a side and 1 mm thick, is connected to a substrate by solder balls ( $k = 40$  W/m · K,  $\rho = 10,000$  kg/m<sup>3</sup>,  $c_p = 150$  J/kg · K) of 1 mm diameter, and during an accelerated thermal stress test, the system is exposed to the flow of a dielectric liquid ( $k = 0.064$  W/m · K,  $\nu = 10^{-6}$  m<sup>2</sup>/s,  $Pr = 25$ ). As first approximations, treat the top and bottom surfaces of the chip as flat plates in turbulent, parallel flow and assume the substrate and lower chip surfaces to have a negligible effect on flow over the solder balls. Also assume point contact between the chip and the solder, thereby neglecting heat transfer by conduction between the components.

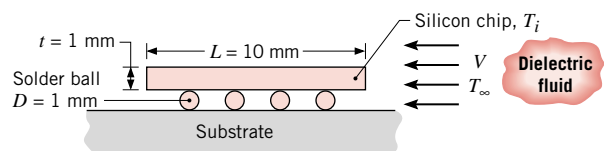


- (a) The stress test begins with the components at ambient temperature ( $T_i = 20^\circ\text{C}$ ) and proceeds with heating by the fluid at  $T_\infty = 80^\circ\text{C}$ . If the fluid velocity is  $V = 0.2\text{ m/s}$ , estimate the ratio of the time constant of the chip to that of a solder ball. Which component responds more rapidly to the heating process?
- (b) The thermal stress acting on the solder joint is proportional to the chip-to-solder temperature difference. What is this temperature difference 0.25 s after the start of heating?

### Tube Banks

- 7.83** Repeat Example 7.7 for a more compact tube bank in which the longitudinal and transverse pitches are  $S_L = S_T = 20.5\text{ mm}$ . All other conditions remain the same.
- 7.84** A preheater involves the use of condensing steam at  $100^\circ\text{C}$  on the inside of a bank of tubes to heat air that enters at 1 atm and  $25^\circ\text{C}$ . The air moves at  $5\text{ m/s}$  in cross flow over the tubes. Each tube is 1 m long and has an outside diameter of 10 mm. The bank consists of 196 tubes in a square, aligned array for which  $S_T = S_L = 15\text{ mm}$ . What is the total rate of heat transfer to the air? What is the pressure drop associated with the airflow?
- 7.85** Consider the in-line tube bank of Problem 7.84 ( $D = 10\text{ mm}$ ,  $L = 1\text{ m}$ , and  $S_T = S_L = 15\text{ mm}$ ), with condensing steam used to heat atmospheric air entering the tube bank at  $T_i = 25^\circ\text{C}$  and  $V = 5\text{ m/s}$ . In this case, however, the desired outlet temperature, not the number of tube rows, is known. What is the minimum value of  $N_L$  needed to achieve an outlet temperature of  $T_o \geq 75^\circ\text{C}$ ? What is the corresponding pressure drop across the tube bank?
- 7.86** A tube bank uses an aligned arrangement of 10-mm-diameter tubes with  $S_T = S_L = 20\text{ mm}$ . There are 10 rows of tubes with 50 tubes in each row. Consider an application for which cold water flows through the tubes, maintaining the outer surface temperature at  $27^\circ\text{C}$ , while flue gases at  $427^\circ\text{C}$  and a velocity of  $5\text{ m/s}$  are in cross flow over the tubes. The properties of the flue gas may be approximated as those of atmospheric air at  $427^\circ\text{C}$ . What is the total rate of heat transfer per unit length of the tubes in the bank?
- 7.87** An air duct heater consists of an aligned array of electrical heating elements in which the longitudinal and transverse pitches are  $S_L = S_T = 24\text{ mm}$ . There are 3 rows of elements in the flow direction ( $N_L = 3$ ) and 4 elements per row ( $N_T = 4$ ). Atmospheric air with an upstream velocity of  $12\text{ m/s}$  and a temperature of  $25^\circ\text{C}$  moves in cross flow over the elements, which have a diameter of

12 mm, a length of 250 mm, and are maintained at a surface temperature of  $350^\circ\text{C}$ .

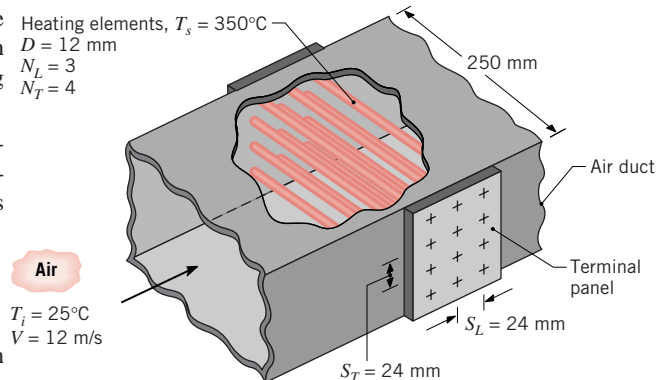


- (a) Determine the total heat transfer to the air and the temperature of the air leaving the duct heater.
- (b) Determine the pressure drop across the element bank and the fan power requirement.
- (c) Compare the average convection coefficient obtained in your analysis with the value for an isolated (single) element. Explain the difference between the results.
- (d) What effect would increasing the longitudinal and transverse pitches to 30 mm have on the exit temperature of the air, the total heat rate, and the pressure drop?
- 7.88** A tube bank uses an aligned arrangement of 30-mm-diameter tubes with  $S_T = S_L = 60\text{ mm}$  and a tube length of 1 m. There are 10 tube rows in the flow direction ( $N_L = 10$ ) and 7 tubes per row ( $N_T = 7$ ). Air with upstream conditions of  $T_\infty = 27^\circ\text{C}$  and  $V = 15\text{ m/s}$  is in cross flow over the tubes, while a tube wall temperature of  $100^\circ\text{C}$  is maintained by steam condensation inside the tubes. Determine the temperature of air leaving the tube bank, the pressure drop across the bank, and the fan power requirement.

- 7.89** Electrical components mounted to each of two isothermal plates are cooled by passing atmospheric air between the plates, and an in-line array of aluminum pin fins is used to enhance heat transfer to the air.

The pins are of diameter  $D = 2\text{ mm}$ , length  $L = 100\text{ mm}$ , and thermal conductivity  $k = 240\text{ W/m} \cdot \text{K}$ . The longitudinal and transverse pitches are  $S_L = S_T = 4\text{ mm}$ , with a square array of 625 pins ( $N_T = N_L = 25$ ) mounted to square plates that are each of width  $W = 100\text{ mm}$  on a side. Air enters the pin array with a velocity of  $10\text{ m/s}$  and a temperature of  $300\text{ K}$ .

- (a) Evaluating air properties at  $300\text{ K}$ , estimate the average convection coefficient for the array of pin fins.

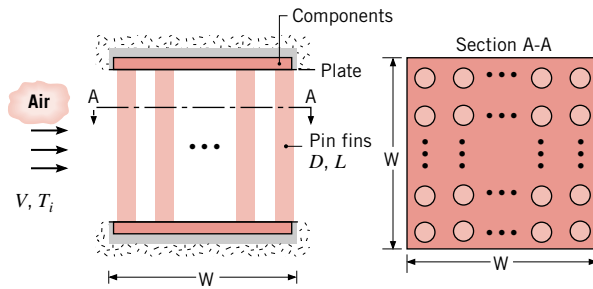

- (b) Assuming a uniform convection coefficient over all heat transfer surfaces (plates and pins), use the result of part (a) to determine the air outlet temperature and total heat rate when the plates are maintained at 350 K. *Hint:* The air outlet temperature is governed by an exponential relation of the form  $[(T_s - T_o)/(T_s - T_i)] = \exp [-(\bar{h}A_i\eta_o)/\dot{m}c_p]$ , where  $\dot{m} = \rho VLN_T S_T$  is the mass flow rate of air passing through the array,  $A_i$  is the total heat transfer surface area (plates and fins), and  $\eta_o$  is the overall surface efficiency defined by Equation 3.102.

**7.90** Consider the chip cooling scheme of Problem 3.134, but with an insulated top wall placed at the pin tips to force airflow across the pin array. Air enters the array at 20°C and with a velocity  $V$  that may be varied but cannot exceed 10 m/s due to pressure drop considerations. The pin fin geometry, which includes the number of pins in the  $N \times N$  square array, as well as the pin diameter  $D_p$  and length  $L_p$ , may also be varied, subject to the constraint that the product  $ND_p$  not exceed 9 mm. Neglecting heat transfer through the board, assess the effect of changes in air velocity, and hence  $h_o$ , as well as pin fin geometry, on the air outlet temperature and the chip heat rate, if the remaining conditions of Problems 3.134 and 3.27, including a maximum allowable chip temperature of 75°C, remain in effect. Recommend design and operating conditions for which chip cooling is enhanced. *Hint:* The air outlet temperature is governed by a relation of the form  $[(T_s - T_o)/(T_s - T_i)] = \exp [-(\bar{h}A_i\eta_o)/\dot{m}c_p]$ , where  $\dot{m}$  is the mass flow rate of air passing through the array,  $A_i$  is the total heat transfer surface area (chip and pins), and  $\eta_o$  is the overall surface efficiency defined by Equation 3.102.


**7.91** An air-cooled steam condenser is operated with air in cross flow over a square, in-line array of 400 tubes ( $N_L = N_T = 20$ ), with an outside tube diameter of 20 mm and longitudinal and transverse pitches of  $S_L = 60$  mm and  $S_T = 30$  mm, respectively. Saturated steam at a pressure of 2.455 bars enters the tubes, and a uniform tube outer surface temperature of  $T_s = 390$  K may

be assumed to be maintained as condensation occurs within the tubes.

- (a) If the temperature and velocity of the air upstream of the array are  $T_i = 300$  K and  $V = 4$  m/s, what is the temperature  $T_o$  of the air that leaves the array? As a first approximation, evaluate the properties of air at 300 K.
- (b) If the tubes are 2 m long, what is the total heat transfer rate for the array? What is the rate at which steam is condensed in kg/s?
- (c) Assess the effect of increasing  $N_L$  by a factor of 2, while reducing  $S_L$  to 30 mm. For this configuration, explore the effect of changes in the air velocity.

### Impinging Jets

**7.92** A circular transistor of 10-mm diameter is cooled by impingement of an air jet exiting a 2-mm-diameter round nozzle with a velocity of 20 m/s and a temperature of 15°C. The jet exit and the exposed surface of the transistor are separated by a distance of 10 mm.

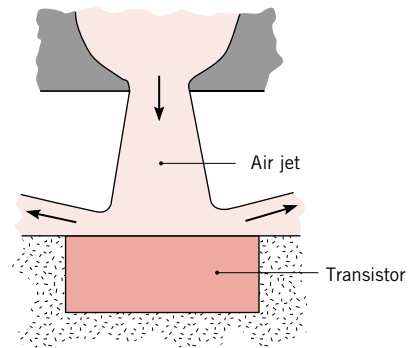

If the transistor is well insulated at all but its exposed surface and the surface temperature is not to exceed 85°C, what is the transistor's maximum allowable operating power?

**7.93** A long rectangular plate of AISI 304 stainless steel is initially at 1200 K and is cooled by an array of slot jets (see Figure 7.16). The nozzle width and pitch are  $W = 10$  mm and  $S = 100$  mm, respectively, and the nozzle-to-plate separation is  $H = 200$  mm. The plate thickness and width are  $t = 8$  mm and  $L = 1$  m, respectively. If air exits the nozzles at a temperature of 400 K and a velocity of 30 m/s, what is the initial cooling rate of the plate?

**7.94** Air at 10 m/s and 15°C is used to cool a square hot molded plastic plate 0.5 m to a side having a surface temperature of 140°C. To increase the throughput of the



production process, it is proposed to cool the plate using an array of slotted nozzles with width and pitch of 4 mm and 56 mm, respectively, and a nozzle-to-plate separation of 40 mm. The air exits the nozzle at a temperature of 15°C and a velocity of 10 m/s.

- Determine the improvement in cooling rate that can be achieved using the slotted nozzle arrangement in lieu of turbulent air at 10 m/s and 15°C in parallel flow over the plate.
- Would the heat rates for both arrangements change significantly if the air velocities were increased by a factor of 2?
- What is the air mass rate requirement for the slotted nozzle arrangement?

**7.95** Consider Problem 7.94 in which the improvement in performance of slot-jet cooling over parallel-flow cooling was demonstrated. Design an optimal round nozzle array, using the same air jet velocity and temperature, 10 m/s and 15°C, respectively, and compare the cooling rates and supply air requirements. Discuss the features associated with each of the three methods relevant to selecting one for this application of cooling the plastic part.


**7.96** Consider the plasma spraying process of Problems 5.25 and 7.75. For a nozzle exit diameter of  $D = 10$  mm and a substrate radius of  $r = 25$  mm, estimate the rate of heat transfer by convection,  $q_{\text{conv}}$ , from the argon plasma to the substrate, if the substrate temperature is maintained at 300 K. Energy transfer to the substrate is also associated with the release of latent heat,  $q_{\text{lat}}$ , which occurs during solidification of the impacted molten droplets. If the mass rate of droplet impingement is  $\dot{m}_p = 0.02 \text{ kg/s} \cdot \text{m}^2$ , estimate the rate of latent heat release.

**7.97** Consider the plasma jet of Problem 7.96. When new ceramic coating materials are developed, *spray trials* are performed using small, circular substrates called *coupons* that can be coated easily and subsequently tested for the new coating material's wear or corrosion resistance. Consider a 50-mm-diameter, 3-mm-thick 304 stainless steel coupon to be used in a spray trial with the goal of building up a 100- $\mu\text{m}$ -thick ceramic coating.

- For a coupon that is insulated on its backside, determine how long the plasma torch can be in place before the coupon melts. How thick would the sprayed ceramic layer be when the coupon melts? The plasma heat transfer coefficient is  $609 \text{ W/m}^2 \cdot \text{K}$ , and the heat transfer rate due to the impinging droplets is 140 W. The initial temperature of the coupon is 300 K.

- It is proposed to cool the backside of the coupon with an air jet at an exit temperature and velocity of  $T_{e,a} = 300 \text{ K}$  and  $V_{e,a} = 30 \text{ m/s}$ , respectively. The air jet nozzle diameter is  $D_a = 10 \text{ mm}$ . The nozzle and the coupon's backside surface are separated by  $L_a = 50 \text{ mm}$ . Will this scheme significantly increase the thickness of the sprayed ceramic layer that can be deposited?

**7.98** You have been asked to determine the feasibility of using an impinging jet in a soldering operation for electronic assemblies. The schematic illustrates the use of a single, round nozzle to direct high velocity, hot air to a location where a *surface mount* joint is to be formed.

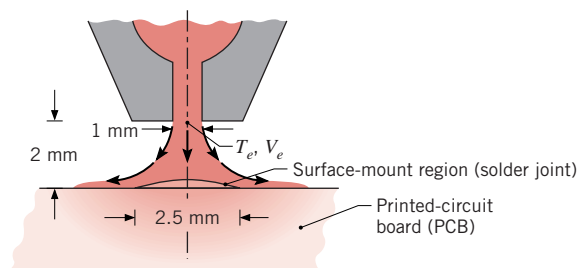

For your study, consider a round nozzle with a diameter of 1 mm located a distance of 2 mm from the region of the surface mount, which has a diameter of 2.5 mm.


- For an air jet velocity of 70 m/s and a temperature of 500°C, estimate the average convection coefficient over the area of the surface mount.
- Assume that the surface mount region on the printed circuit board (PCB) can be modeled as a semi-infinite medium, which is initially at a uniform temperature of 25°C and suddenly experiences convective heating by the jet. Estimate the time required for the surface to reach 183°C. The thermophysical properties of a typical solder are  $\rho = 8333 \text{ kg/m}^3$ ,  $c_p = 188 \text{ J/kg} \cdot \text{K}$ , and  $k = 51 \text{ W/m} \cdot \text{K}$ .
- For three air jet temperatures of 500, 600, and 700°C, calculate and plot the surface temperature as a function of time for  $0 \leq t \leq 150 \text{ s}$ . On this plot, identify important temperature limits for the soldering process: the lower limit corresponding to the solder's eutectic temperature,  $T_{\text{sol}} = 183^\circ\text{C}$ , and the upper limit corresponding to the glass transition temperature,  $T_{\text{gl}} = 250^\circ\text{C}$ , at which the PCB becomes plastic. Comment on the outcome of your study, the appropriateness of the assumptions, and the feasibility of using the jet for a soldering application.

## Packed Beds

**7.99** Consider the packed bed of aluminum spheres described in Problem 5.12 under conditions for which the bed is charged by hot air with an inlet velocity of  $V = 1 \text{ m/s}$  and temperature of  $T_{g,i} = 300^\circ\text{C}$ , but for which the convection coefficient is not prescribed. If the porosity of the bed is  $\varepsilon = 0.40$  and the initial temperature of the spheres is  $T_i = 25^\circ\text{C}$ , how long does it take a sphere near the inlet of the bed to accumulate 90% of its maximum possible energy?

**7.100** The use of rock pile thermal energy storage systems has been considered for solar energy and industrial process heat applications. A particular system involves a cylindrical container, 2 m long by 1 m in diameter, in which nearly spherical rocks of 0.03-m diameter are packed. The bed has a void space of 0.42, and the density and specific heat of the rock are  $\rho = 2300 \text{ kg/m}^3$  and  $c_p = 879 \text{ J/kg} \cdot \text{K}$ , respectively. Consider conditions for which atmospheric air is supplied to the rock pile at a steady flow rate of  $1 \text{ kg/s}$  and a temperature of  $90^\circ\text{C}$ . The air flows in the axial direction through the container. If the rock is at a temperature of  $25^\circ\text{C}$ , what is the total rate of heat transfer from the air to the rock pile?


**7.101** The cylindrical chamber of a *pebble bed nuclear reactor* is of length  $L = 10 \text{ m}$  and diameter  $D = 3 \text{ m}$ . The chamber is filled with spherical uranium oxide pellets of core diameter  $D_p = 50 \text{ mm}$ . Each pellet generates thermal energy in its core at a rate of  $E_g$  and is coated with a layer of non-heat-generating graphite, which is of uniform thickness  $\delta = 5 \text{ mm}$ , to form a pebble. The uranium oxide and graphite each have a thermal conductivity of  $2 \text{ W/m} \cdot \text{K}$ . The packed bed has a porosity of  $\varepsilon = 0.4$ . Pressurized helium at 40 bars is used to absorb the thermal energy from the pebbles. The helium enters the packed bed at  $T_i = 450^\circ\text{C}$  with a velocity of  $3.2 \text{ m/s}$ . The properties of the helium may be assumed to be  $c_p = 5193 \text{ J/kg} \cdot \text{K}$ ,  $k = 0.3355 \text{ W/m} \cdot \text{K}$ ,  $\rho = 2.1676 \text{ kg/m}^3$ ,  $\mu = 4.214 \times 10^{-5} \text{ kg/s} \cdot \text{m}$ ,  $Pr = 0.654$ .

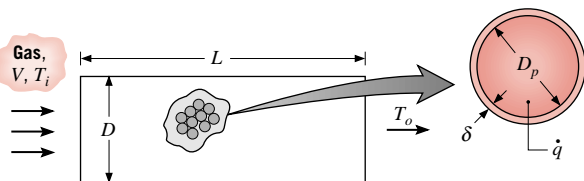

(a) For a desired overall thermal energy transfer rate of  $q = 125 \text{ MW}$ , determine the mean outlet temperature of the helium leaving the bed,  $T_o$ , and the amount of thermal energy generated by each pellet,  $E_g$ .

(b) The amount of energy generated by the fuel decreases if a maximum operating temperature of approximately  $2100^\circ\text{C}$  is exceeded. Determine the maximum internal temperature of the hottest pellet in the packed bed. For Reynolds numbers in the range  $4000 \leq Re_D \leq 10,000$ , Equation 7.85 may be replaced by  $\varepsilon_{j_H} = 2.876 Re_D^{-1} + 0.3023 Re_D^{-0.35}$ .

**7.102** *Latent heat capsules* consist of a thin-walled spherical shell within which a solid-liquid, phase-change material (PCM) of melting point  $T_{mp}$  and latent heat of fusion  $h_{sf}$  is enclosed. As shown schematically, the capsules may be packed in a cylindrical vessel through which there is fluid flow. If the PCM is in its solid state and  $T_{mp} < T_b$ , heat is transferred from the fluid to the capsules and latent energy is stored in the PCM as it melts. Conversely, if the PCM is a liquid and  $T_{mp} > T_b$ , energy is released from the PCM as it freezes and heat is transferred to the fluid. In either situation, all of the capsules within the packed bed would remain at  $T_{mp}$  through much of the phase change process, in which case the fluid outlet temperature would remain at a fixed value  $T_o$ .

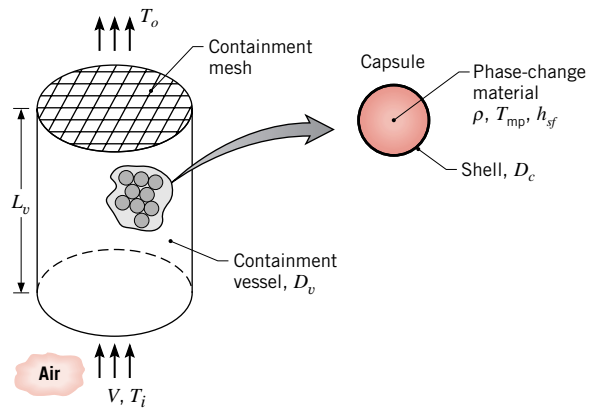

Consider an application for which air is chilled by passing it through a packed bed ( $\varepsilon = 0.5$ ) of capsules ( $D_c = 50 \text{ mm}$ ) containing an organic compound with a melting point of  $T_{mp} = 4^\circ\text{C}$ . The air enters a cylindrical vessel ( $L_v = D_v = 0.40 \text{ m}$ ) at  $T_i = 25^\circ\text{C}$  and  $V = 1.0 \text{ m/s}$ .

(a) If the PCM in each capsule is in the solid state at  $T_{mp}$  as melting occurs within the capsule, what is the outlet temperature of the air? If the density and latent heat of fusion of the PCM are  $\rho = 1200 \text{ kg/m}^3$  and  $h_{sf} = 165 \text{ kJ/kg}$ , what is the mass rate (kg/s) at which the PCM is converted from solid to liquid in the vessel?

(b) Explore the effect of the inlet air velocity and capsule diameter on the outlet temperature.

- (c) At what location in the vessel will complete melting of the PCM in a capsule first occur? Once complete melting begins to occur, how will the outlet temperature vary with time and what is its asymptotic value?

**7.103** Consider the packed bed ( $\varepsilon = 0.5$ ) of latent heat capsules ( $D_c = 50$  mm) described in Problem 7.102, but now for an application in which ambient air is to be heated by passing it through the bed. In this case the capsules contain an organic compound with a melting point of  $T_{mp} = 50^\circ\text{C}$ , and the air enters the vessel ( $L_v = D_v = 0.40$  m) at  $T_i = 20^\circ\text{C}$  and  $V = 1.0$  m/s.

- (a) If the PCM in each capsule is in the liquid state at  $T_{mp}$  as solidification occurs within the capsule what is the outlet temperature of the air? If the density and latent heat of fusion of the PCM are  $\rho = 900$  kg/m<sup>3</sup> and  $h_{sf} = 200$  kJ/kg, what is the mass rate (kg/s) at which the PCM is converted from liquid to solid in the vessel?
- (b) Explore the effect of the inlet air velocity and capsule diameter on the outlet temperature.
- (c) At what location in the vessel will complete freezing of the PCM in a capsule first occur? Once complete freezing begins to occur, how will the outlet temperature vary with time and what is its asymptotic value?

## Heat and Mass Transfer


**7.104** Consider mass loss from a smooth wet flat plate due to forced convection at atmospheric pressure. The plate is 0.5 m long and 3 m wide. Dry air at 300 K and a free stream velocity of 35 m/s flows over the surface, which is also at a temperature of 300 K. Estimate the average mass transfer coefficient  $\bar{h}_m$  and determine the water vapor mass loss rate (kg/s) from the plate.

**7.105** Consider dry, atmospheric air in parallel flow over a 0.5-m-long plate whose surface is wetted. The air velocity is 35 m/s, and the air and water are each at a temperature of 300 K.

- (a) Estimate the heat loss and evaporation rate per unit width of the plate,  $q'$  and  $n'_A$ , respectively.
- (b) Assuming the air temperature remains at 300 K, generate plots of  $q'$  and  $n'_A$  for a range of water temperatures from 300 to 350 K, with air velocities of 10, 20, and 35 m/s.
- (c) For the air velocities and air temperature of part (b), determine the water temperatures for which the heat loss will be zero.

**7.106** A flat plate coated with a volatile substance (species A) is exposed to dry, atmospheric air in parallel flow with

$T_\infty = 20^\circ\text{C}$  and  $u_\infty = 8$  m/s. The plate is maintained at a constant temperature of  $134^\circ\text{C}$  by an electrical heating element, and the substance evaporates from the surface. The plate has a width of 0.25 m (normal to the plane of the sketch) and is well insulated on the bottom.

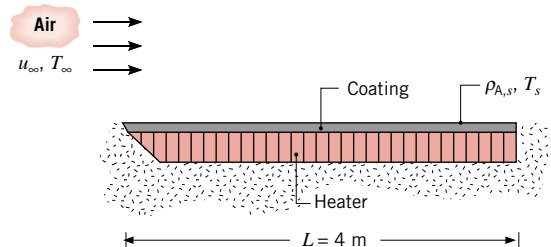


The molecular weight and the latent heat of vaporization of species A are  $\mathcal{M}_A = 150$  kg/kmol and  $h_{fg} = 5.44 \times 10^6$  J/kg, respectively, and the mass diffusivity is  $D_{AB} = 7.75 \times 10^{-7}$  m<sup>2</sup>/s. If the saturated vapor pressure of the substance is 0.12 atm at  $134^\circ\text{C}$ , what is the electrical power required to maintain steady-state conditions?

**7.107** Dry air at atmospheric pressure and 350 K, with a free stream velocity of 25 m/s, flows over a smooth, porous plate 1 m long.

- (a) Assuming the plate to be saturated with liquid water at 350 K, estimate the mass rate of evaporation per unit width of the plate,  $n'_A$  (kg/s · m).
- (b) For air and liquid water temperatures of 300, 325, and 350 K, generate plots of  $n'_A$  as a function of velocity for the range from 1 to 25 m/s.


**7.108** A scheme for dissipating heat from an array of  $N = 100$  integrated circuits involves joining the circuits to the bottom of a plate and exposing the top of the plate to a water bath. The water container is of length  $L = 100$  mm on a side and is exposed to airflow at its top surface. The flow is turbulent by the protruding lip of the side wall.

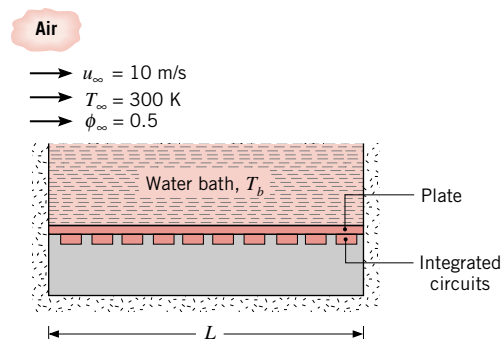

If the sides and bottom of the container are well insulated from the surroundings and heat is uniformly

dissipated in each circuit, at what rate may heat be dissipated from each circuit when the water temperature is maintained at  $T_b = 350$  K?

- 7.109** A series of water-filled trays, each 222 mm long, experiences an evaporative drying process. Dry air at  $T_\infty = 300$  K flows over the trays with a velocity of 15 m/s, while radiant heaters maintain the surface temperature at  $T_s = 330$  K.

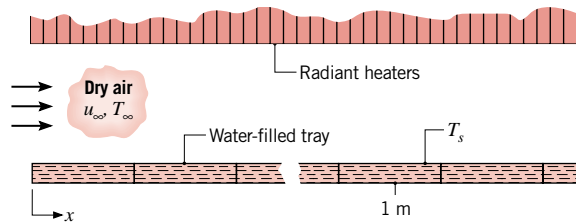

- What is the evaporative flux ( $\text{kg/s} \cdot \text{m}^2$ ) at a distance 1 m from the leading edge?
  - What is the irradiation ( $\text{W/m}^2$ ) that should be supplied to the tray surface at this location to maintain the water temperature at 330 K?
  - Assuming the water temperature is uniform over the tray at this location, what is the evaporation rate ( $\text{kg/s} \cdot \text{m}$ ) from the tray per unit width of the tray?
  - What irradiation should be applied to each of the first four trays such that the corresponding evaporation rates are identical to that found in part (c)?
- 7.110** Consider the physical system of Problem 7.109 (a series of water-filled trays heated radiatively), but under operating conditions for which each tray is 0.25 m long by 1 m wide and is uniformly irradiated, with  $G = 10^4$   $\text{W/m}^2$ . Dry air at  $T_\infty = 300$  K continues to flow over the trays at a velocity of 15 m/s.
- What is the rate of water loss ( $\text{kg/s}$ ) from the first, third, and fourth trays?
  - Estimate the temperature of the water in each of the designated trays.
- 7.111** The apparatus described in Problem 7.40 is used by our students to experimentally determine convection heat and mass transfer coefficients, to confirm the heat–mass analogy, and to compare measured results with predictions based on standard correlations. The velocity,  $V$ , of the airstream is measured using a thermistor-based anemometer, and its relative humidity is determined from measurements of the wet and dry bulb temperatures,  $T_{wb}$  and  $T_{db}$ , respectively. Thermocouples are attached to the *test-plate*, which is covered with a sheet of wet paper in the mass transfer experiments.

- Convection heat transfer coefficient.** Using the data provided in Problem 7.40, determine the heat transfer coefficients for the two velocities, assuming the plate to behave as a spacewise isothermal object. Evaluate the coefficients  $C$  and  $m$  for a correlation of the form  $\overline{Nu}_L = C Re^m Pr^{1/3}$ . Compare this result with a standard flat-plate correlation. Comment on the *goodness* of the comparison and provide reasons for any differences.
- Convection mass transfer coefficient.** A sheet of water-saturated paper, 133 mm to a side, was used as the test surface and its mass measured at two different times,  $m(t)$  and  $m(t + \Delta t)$ . Thermocouples were used to monitor the paper temperature as a function of time, from which the average temperature,  $\overline{T}_s$ , was determined. The wet and dry bulb temperatures were  $T_{wb} = 13^\circ\text{C}$  and  $T_{db} = 27^\circ\text{C}$ , and data recorded for two airstream velocities are as follows:

Water Mass Loss Observations				
$V$ (m/s)	$\overline{T}_s$ ( $^\circ\text{C}$ )	$m(t)$ (g)	$m(t + \Delta t)$ (g)	$\Delta t$ (s)
3	15.3	55.62	54.45	475
9	16.0	55.60	54.50	240


Determine the convection mass transfer coefficients for the two flow conditions. Evaluate the coefficients  $C$  and  $m$  for a correlation of the form  $\overline{Sh}_L = C Re^m Sc^{1/3}$ .

- Using the heat–mass analogy, compare the experimental results with each other and against standard correlations. Comment on the *goodness* of the comparison and provide reasons for any differences.
- 7.112** Dry air at  $35^\circ\text{C}$  and a velocity of 20 m/s flows over a wetted plate of length 500 mm and width 150 mm. An imbedded electrical heater supplies power to maintain the plate surface temperature at  $20^\circ\text{C}$ .
- What is the evaporation rate ( $\text{kg/h}$ ) of water from the plate? What electrical power is required to maintain steady-state conditions?
  - After a long period of operation, all the water is evaporated from the plate and its surface is dry. For the same free stream conditions and heater power of part (a), estimate the temperature of the plate.
- 7.113** A minivan traveling 90 km/h has just passed through a thunderstorm that left a film of water 0.1 mm thick on the top of the van. The top of the van can be assumed

to be a flat plate 6 m long. Assume isothermal conditions at 27°C, an ambient air relative humidity of 80%, and turbulent flow over the entire surface. What location on the van top will be the last to dry? What is the water evaporation rate per unit area ( $\text{kg/s} \cdot \text{m}^2$ ) at the trailing edge of the van top?


**7.114** Benzene, a known carcinogen, has been spilled on the laboratory floor and has spread to a length of 2 m. If a film 1 mm deep is formed, how long will it take for the benzene to completely evaporate? Ventilation in the laboratory provides for airflow parallel to the surface at 1 m/s, and the benzene and air are both at 25°C. The mass densities of benzene in the saturated vapor and liquid states are known to be 0.417 and 900  $\text{kg/m}^3$ , respectively.

**7.115** Atmospheric air of 40% relative humidity and temperature  $T_\infty = 300 \text{ K}$  is in parallel flow over a series of water-filled trays, with  $u_\infty = 12 \text{ m/s}$ .

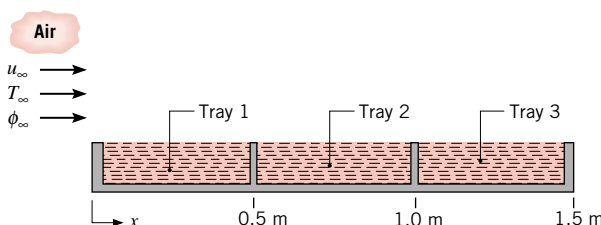

What is the rate at which energy must be supplied to each of the first three trays to maintain the water at 300 K?

**7.116** A stream of atmospheric air is used to dry a series of biological samples on plates that are each of length  $L_i = 0.25 \text{ m}$  in the direction of the airflow. The air is dry and at a temperature equal to that of the plates ( $T_\infty = T_s = 50^\circ\text{C}$ ). The air speed is  $u_\infty = 9.1 \text{ m/s}$ .

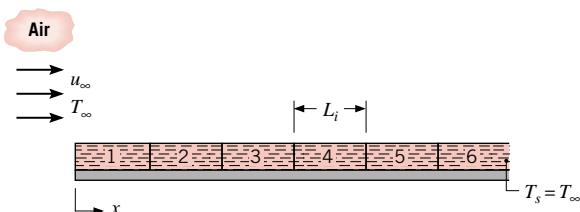

- Sketch the variation of the local convection mass transfer coefficient  $h_{m,x}$  with distance  $x$  from the leading edge. Indicate the specific nature of the  $x$  dependence.
- Which of the plates will dry the fastest? Calculate the drying rate per meter of width for this plate ( $\text{kg/s} \cdot \text{m}$ ).

(c) At what rate would heat have to be supplied to the fastest drying plate to maintain it at  $T_s = 50^\circ\text{C}$  during the drying process?

**7.117** Condenser cooling water for a power plant is stored in a cooling pond that is 1000 m long by 500 m wide. However, because of evaporative losses, it is necessary to periodically add “makeup” water to the pond in order to maintain a suitable water level. Assuming isothermal conditions at 27°C for the water and the air, that the free stream air is dry and moving at a velocity of 2 m/s in the direction of the 1000-m pond length, and that the boundary layer on the water surface is everywhere turbulent, determine the amount of makeup water that should be added to the pond daily.

**7.118** Consider the plate conveyor system of Problem 7.24, but now under conditions for which the plates are being transported from a liquid bath used for surface cleaning. The initial plate temperature is  $T_i = 40^\circ\text{C}$ , and the surfaces are covered with a thin liquid film. If the air velocity and temperature are  $u_\infty = 1 \text{ m/s}$  and  $T_\infty = 20^\circ\text{C}$ , respectively, what is the initial rate of heat transfer from the plate? What is the corresponding rate of change of the plate temperature? The latent heat of vaporization of the solvent, the diffusion coefficient associated with transport of its vapor in air, and its saturated vapor density at 40°C are  $h_{fg} = 900 \text{ kJ/kg}$ ,  $D_{AB} = 10^{-5} \text{ m}^2/\text{s}$ , and  $\rho_{A,\text{sat}} = 0.75 \text{ kg/m}^3$ , respectively. The velocity of the conveyor can be neglected relative to that of the air.


**7.119** In a paper drying process, the paper moves on a conveyor belt at 0.2 m/s, while dry air from an in-line array of round jets (Figure 7.17b) impinges normal to its surface. The nozzle diameter and pitch are  $D = 20 \text{ mm}$  and  $S = 100 \text{ mm}$ , respectively, and the nozzle-to-paper separation is  $H = 200 \text{ mm}$ . Air exits the nozzle at a velocity and temperature of 20 m/s and 300 K, while the wet paper is maintained at 300 K. In  $\text{kg/s} \cdot \text{m}^2$ , what is the average drying rate of the paper?

**7.120** In a paper mill drying process, a sheet of paper slurry (water–fiber mixture) has a linear velocity of 5 m/s as it is rolled. Radiant heaters maintain a sheet temperature of  $T_s = 330 \text{ K}$ , as evaporation occurs to dry, ambient air at 300 K above and below the sheet.

(a) What is the evaporative flux at a distance of  $x = 1 \text{ m}$  from the leading edge of the roll? What is the corresponding value of the radiant flux (irradiation,  $G$ ) that must be supplied to the sheet to maintain its temperature at 330 K? The sheet has an absorptivity of  $\alpha = 1$ .


(b) To accelerate the drying and paper production processes, the velocity and temperature of the strip are increased to 10 m/s and 340 K, respectively.



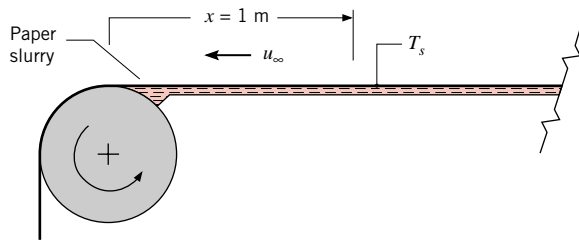

To maintain a uniform strip temperature, the irradiation  $G$  must be varied with  $x$  along the strip. For  $0 \leq x \leq 1$  m, compute and plot the variations  $h_{m,x}(x)$ ,  $N_A''(x)$ , and  $G(x)$ .

- 7.121** A channel of triangular cross section, which is 25 m long and 1 m deep, is used for the storage of water.



The water and the surrounding air are each at a temperature of 25°C, and the relative humidity of the air is 50%.

- If the air moves at a velocity of 5 m/s along the length of the channel, what is the rate of water loss due to evaporation from the surface?
- Obtain an expression for the rate at which the water depth would decrease with time due to evaporation. For the above conditions, how long would it take for all the water to evaporate?

- 7.122** Mass transfer experiments have been conducted on a naphthalene cylinder of 18.4-mm diameter and 88.9-mm length subjected to a cross flow of air in a low-speed wind tunnel. After exposure for 39 min to the airstream at a temperature of 26°C and a velocity of 12 m/s, it was determined that the cylinder mass decreased by 0.35 g. The barometric pressure was recorded at 750.6 mm Hg. The saturation pressure  $p_{\text{sat}}$  of naphthalene vapor in equilibrium with solid naphthalene is given by the relation  $p_{\text{sat}} = p \times 10^E$ , where  $E = 8.67 - (3766/T)$ , with  $T$  (K) and  $p$  (bar) being the temperature and pressure of air. Naphthalene has a molecular weight of 128.16 kg/kmol.

- Determine the convection mass transfer coefficient from the experimental observations.
- Compare this result with an estimate from an appropriate correlation for the prescribed flow conditions.

- 7.123** Dry air at 1-atm pressure and a velocity of 15 m/s is to be humidified by passing it in cross flow over a porous


cylinder of diameter  $D = 40$  mm, which is saturated with water.

- Assuming the water and air to be at 300 K, calculate the mass rate of water evaporated under steady-state conditions from the cylindrical medium per unit length.
- How will the evaporation rate change if the air and water are maintained at a higher temperature? Generate a plot for the temperature range 300 to 350 K to illustrate the effect of temperature on the evaporation rate.

- 7.124** Dry air at 35°C and a velocity of 15 m/s flows over a long cylinder of 20-mm diameter. The cylinder is covered with a thin porous coating saturated with water, and an imbedded electrical heater supplies power to maintain the coating surface temperature at 20°C.

- What is the evaporation rate of water from the cylinder per unit length (kg/h · m)? What electrical power per unit length of the cylinder (W/m) is required to maintain steady-state conditions?
- After a long period of operation, all the water is evaporated from the coating and its surface is dry. For the same free stream conditions and heater power of part (a), estimate the temperature of the surface.

- 7.125** Dry air at 20°C and a velocity of 15 m/s flows over a 20-mm-diameter rod covered with a thin porous coating that is saturated with water. The rod ( $k = 175$  W/m · K) is 250 mm long and its ends are attached to heat sinks maintained at 35°C.

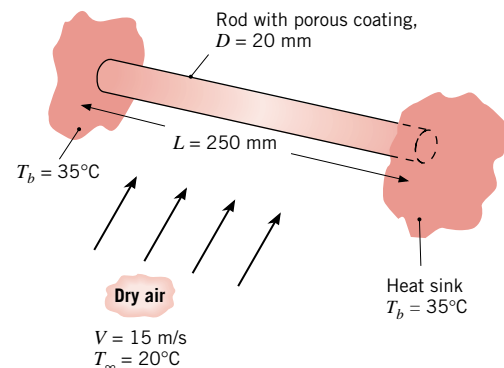

Perform a steady-state, finite-difference analysis of the rod-porous coating system, considering conduction in the rod as well as energy transfer from the surface by convection heat and mass transfer. Use the analysis to estimate the temperature at the midspan of the rod and the evaporation rate from the surface. (Suggestions: Use 10 nodes to represent the half-length of the system.)

Estimate the overall average convection heat transfer coefficient based on an average film temperature for the system, and use the heat–mass transfer analogy to determine the average convection mass transfer coefficient. Validate your code by using it to predict a temperature distribution that agrees with the analytical solution for a fin without evaporation.)

- 7.126** Approximate the human form as an unclothed vertical cylinder of 0.3-m diameter and 1.75-m length with a surface temperature of 30°C.

- Calculate the heat loss in a 10-m/s wind at 20°C.
- What is the heat loss if the skin is covered with a thin layer of water at 30°C and the relative humidity of the air is 60%?

- 7.127** It has been suggested that heat transfer from a surface can be augmented by wetting it with water. As a specific example, consider a horizontal tube that is exposed to a transverse stream of dry air. You may assume that the tube, which is maintained at a temperature  $T_s > T_\infty$ , is completely wetted on the outside with a thin film of water. Derive an equation to determine the extent of heat transfer enhancement due to wetting. Evaluate the enhancement for  $V = 10$  m/s,  $D = 10$  mm,  $T_s = 320$  K, and  $T_\infty = 300$  K.

- 7.128** In the first stage of a paper drying process, a cylinder of diameter 0.15 m is covered by moisture-soaked paper. The temperature of the paper is maintained at 70°C by imbedded electrical heaters. Dry air at a velocity of 10 m/s and temperature of 20°C flows over the cylinder.

- Calculate the required electrical power and the evaporation rate per unit length of the cylinder,  $q'$  and  $n'_A$ , respectively.


- Generate plots of  $q'$  and  $n'_A$  as a function of the dry air velocity for  $5 \leq V \leq 20$  m/s and for paper temperatures of 65, 70, and 75°C.

- 7.129** Cylindrical dry-bulb and wet-bulb thermometers are installed in a large-diameter duct to obtain the temperature  $T_\infty$  and the relative humidity  $\phi_\infty$  of moist air flowing through the duct at a velocity  $V$ . The dry-bulb thermometer has a bare glass surface of diameter  $D_{db}$  and emissivity  $\varepsilon_g$ . The wet-bulb thermometer is covered with a thin wick that is saturated with water flowing continuously by capillary action from a bottom reservoir. Its diameter and emissivity are designated as  $D_{wb}$  and  $\varepsilon_w$ . The duct inside surface is at a known temperature  $T_s$ , which is less than  $T_\infty$ . Develop expressions that may be used to obtain  $T_\infty$  and  $\phi_\infty$  from knowledge of the dry-bulb and wet-bulb temperatures  $T_{db}$  and  $T_{wb}$  and the foregoing parameters. Determine  $T_\infty$  and  $\phi_\infty$

when  $T_{db} = 45^\circ\text{C}$ ,  $T_{wb} = 25^\circ\text{C}$ ,  $T_s = 35^\circ\text{C}$ ,  $p = 1$  atm,  $V = 5$  m/s,  $D_{db} = 3$  mm,  $D_{wb} = 4$  mm, and  $\varepsilon_g = \varepsilon_w = 0.95$ . As a first approximation, evaluate the dry- and wet-bulb air properties at 45 and 25°C, respectively.

- 7.130** The thermal pollution problem is associated with discharging warm water from an electrical power plant or from an industrial source to a natural body of water. Methods for alleviating this problem involve cooling the warm water before allowing the discharge to occur. Two such methods, involving wet cooling towers or spray ponds, rely on heat transfer from the warm water in droplet form to the surrounding atmosphere. To develop an understanding of the mechanisms that contribute to this cooling, consider a spherical droplet of diameter  $D$  and temperature  $T$ , which is moving at a velocity  $V$  relative to air at a temperature  $T_\infty$  and relative humidity  $\phi_\infty$ . The surroundings are characterized by the temperature  $T_{sur}$ . Develop expressions for the droplet evaporation and cooling rates. Calculate the evaporation rate (kg/s) and cooling rate (K/s) when  $D = 3$  mm,  $V = 7$  m/s,  $T = 40^\circ\text{C}$ ,  $T_\infty = 25^\circ\text{C}$ ,  $T_{sur} = 15^\circ\text{C}$ , and  $\phi_\infty = 0.60$ . The emissivity of water is  $\varepsilon_w = 0.96$ .

- 7.131** Cranberries are harvested by flooding the bogs in which they are grown and raking them into troughs for transport. At the processing plant, the surface moisture on the berries is removed as they roll over a fine screen through which warm air is blown. The berries have an average diameter of 15 mm, and the thickness of the water layer is 0.2 mm.

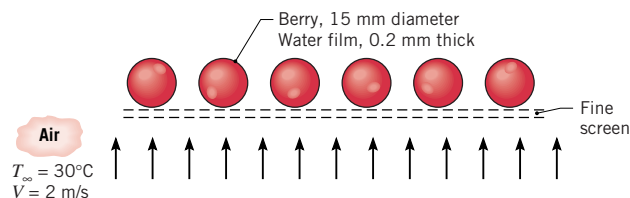

If the velocity and temperature of the heated air are 2 m/s and 30°C, respectively, estimate the time required to dry the berries. Assume that the water film on the berries is also at 30°C.

- 7.132** A spherical drop of water, 0.5 mm in diameter, is falling at a velocity of 2.15 m/s through dry still air at 1-atm pressure. Estimate the instantaneous rate of evaporation from the drop if the drop surface is at 60°C and the air is at 100°C.


- 7.133** A spherical droplet of alcohol, 0.5 mm in diameter, is falling freely through quiescent air at a velocity of 1.8 m/s. The concentration of alcohol vapor at the surface

of the droplet is  $0.0573 \text{ kg/m}^3$ , and the diffusion coefficient for alcohol in air is  $10^{-5} \text{ m}^2/\text{s}$ . Neglecting radiation and assuming steady-state conditions, calculate the surface temperature of the droplet if the ambient air temperature is  $300 \text{ K}$ . The latent heat of vaporization is  $8.42 \times 10^5 \text{ J/kg}$ .

- 7.134** As described in Problem 7.77, the second step in tissue engineering is to seed the top surface of the scaffold with human cells that subsequently grow into the pores of the scaffold. A seeding method that has been proposed is to use a droplet generator similar to that of Problem 7.77 to generate  $D_p = 50 \mu\text{m}$  diameter drops. The material in the droplet generator is a slurry consisting of a mixture of a host liquid and human liver cells. The host liquid has properties similar to water, and the liver cells are spherical with a diameter of  $D_{lc} = 20 \mu\text{m}$  and density  $\rho_{lc} = 2400 \text{ kg/m}^3$ . Droplets are injected into atmospheric air with a relative humidity and temperature of  $\phi = 0.50$  and  $T_\infty = 25^\circ\text{C}$ , respectively. The particles are injected with an initial temperature of  $T_i = 25^\circ\text{C}$ .


- It is desirable for each drop to contain one liver cell. Determine the volume fraction,  $f$ , of liver cells in the slurry and the terminal velocity for a drop containing one liver cell.
- The droplet containing one liver cell is injected at its terminal velocity. Determine the time of flight for a distance between the ejector nozzle and the scaffold of  $L = 4 \text{ mm}$ .
- Determine the initial evaporation rate from the droplet.
- The tissue engineer is concerned that evaporation will change the mass of the droplet and, in turn, will affect its time of flight and the precision with which the seeds can be placed on the scaffold. Estimate the maximum change in mass due to evaporation during the time of flight. Compare the variation of mass due to evaporation to the variation associated with there being one to three liver cells per droplet. Does evaporation or the liver cell population per droplet influence the variability of the droplet mass most significantly?

- 7.135** Motile bacteria are equipped with flagella that are rotated by tiny, biological electrochemical engines

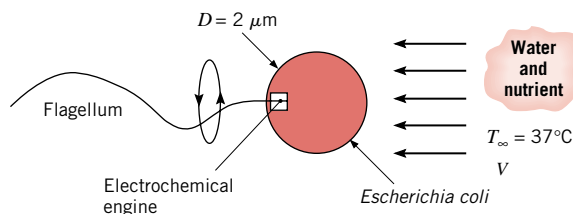


which, in turn, propel the bacteria through a host liquid. Consider a nominally spherical *Escherichia coli* bacterium that is of diameter  $D = 2 \mu\text{m}$ . The bacterium is in a water-based solution at  $37^\circ\text{C}$  containing a nutrient which is characterized by a binary diffusion coefficient of  $D_{AB} = 0.7 \times 10^{-9} \text{ m}^2/\text{s}$  and a food energy value of  $\mathcal{N} = 16,000 \text{ kJ/kg}$ . There is a nutrient density difference between the fluid and the shell of the bacterium of  $\Delta\rho_A = 860 \times 10^{-12} \text{ kg/m}^3$ . Assuming a propulsion efficiency of  $\eta = 0.5$ , determine the maximum speed of the *E. coli*. Report your answer in body diameters per second.

- 7.136** In a home furnace humidification system, water droplets of diameter  $D$  are discharged in a direction opposing the motion of warm air emerging from the heater. The air is humidified by evaporation from the droplets, and the excess water is collected on a *splash plate*, from which it is routed to a drain.

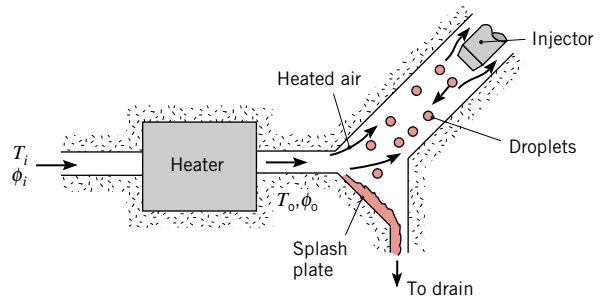

Consider conditions for which air enters the heater at a temperature and relative humidity of  $17^\circ\text{C}$  and  $70\%$ , respectively, and leaves the heater at a temperature of  $47^\circ\text{C}$ . The droplet diameter is  $1 \text{ mm}$ , and the relative velocity between the droplets and the heated air is  $15 \text{ m/s}$ . During the time-of-flight, the change in droplet diameter may be neglected and the droplet temperature may be assumed to remain at  $47^\circ\text{C}$ . What is the rate of evaporation from a single droplet?

- 7.137** Evaporation of liquid fuel droplets is often studied in the laboratory by using a porous sphere technique in which the fuel is supplied at a rate just sufficient to maintain a completely wetted surface on the sphere.

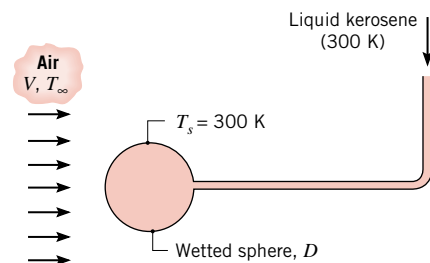



Consider the use of kerosene at 300 K with a porous sphere of 1-mm diameter. At this temperature the kerosene has a saturated vapor density of  $0.015 \text{ kg/m}^3$  and a latent heat of vaporization of  $300 \text{ kJ/kg}$ . The mass diffusivity for the vapor–air mixture is  $10^{-5} \text{ m}^2/\text{s}$ . If dry, atmospheric air at  $V = 15 \text{ m/s}$  and  $T_\infty = 300 \text{ K}$  flows over the sphere, what is the minimum mass rate at which kerosene must be supplied to maintain a wetted surface? For this condition, by how much must  $T_\infty$  actually exceed  $T_s$  to maintain the wetted surface at 300 K?

**7.138** Consider an air conditioning system composed of a bank of tubes arranged normal to air flowing in a duct at a mass rate of  $\dot{m}_a$  (kg/s). A coolant flowing through the tubes is able to maintain the surface temperature of the tubes at a constant value of  $T_s < T_{a,i}$ , where  $T_{a,i}$  is the inlet air temperature (upstream of the tube bank). It has been suggested that air cooling may be enhanced if a thin, uniform film of water is maintained on the outer surface of each of the tubes.

- (a) Assuming the water film to be at the temperature  $T_s$ , develop an expression for the ratio of the amount of cooling that occurs with the water film to the amount of cooling that occurs without the film. The amount of cooling may be defined as  $T_{a,i} - T_{a,o}$ , where  $T_{a,o}$  is the outlet air temperature


(downstream of the tube bank). The upstream air may be assumed to be dry, and the driving potentials for convection heat and mass transfer may be approximated as  $(T_{a,i} - T_s)$  and  $\rho_{A,\text{sat}}(T_s)$ , respectively. *Note:* The total rate of heat loss from the air may be expressed as  $q = \dot{m}_a c_{p,a}(T_{a,i} - T_{a,o})$ . Estimate the value of this ratio under conditions for which  $T_{a,i} = 35^\circ\text{C}$  and  $T_s = 10^\circ\text{C}$ .

- (b) Consider a tube bank that is 5 rows deep, with 12 tubes in a row. Each tube is 0.5 m long, with an outside diameter of 8 mm, and a staggered arrangement is used for which  $S_T = S_L = 24 \text{ mm}$ . Under conditions for which  $\dot{m}_a = 0.5 \text{ kg/s}$ ,  $V = 3 \text{ m/s}$ ,  $T_{a,i} = 35^\circ\text{C}$ , and  $T_s = 10^\circ\text{C}$ , what is the value of  $T_{a,o}$  if the tubes are wetted? What is the specific humidity of the air leaving the tube bank?

**7.139** In a paper-drying process, the paper moves on a conveyor belt at  $0.2 \text{ m/s}$ , while dry air from an array of slot jets (Figure 7.16) impinges normal to its surface. The nozzle width and pitch are  $W = 10 \text{ mm}$  and  $S = 100 \text{ mm}$ , respectively, and the nozzle-to-plate separation is  $H = 200 \text{ mm}$ . The wet paper is of width  $L = 1 \text{ m}$  and is maintained at  $300 \text{ K}$ , while the air exits the nozzles at a temperature of  $300 \text{ K}$  and a velocity of  $20 \text{ m/s}$ . In  $\text{kg/s} \cdot \text{m}^2$ , what is the average drying rate per unit surface area of the paper?

# *CHAPTER* 8

## Internal Flow

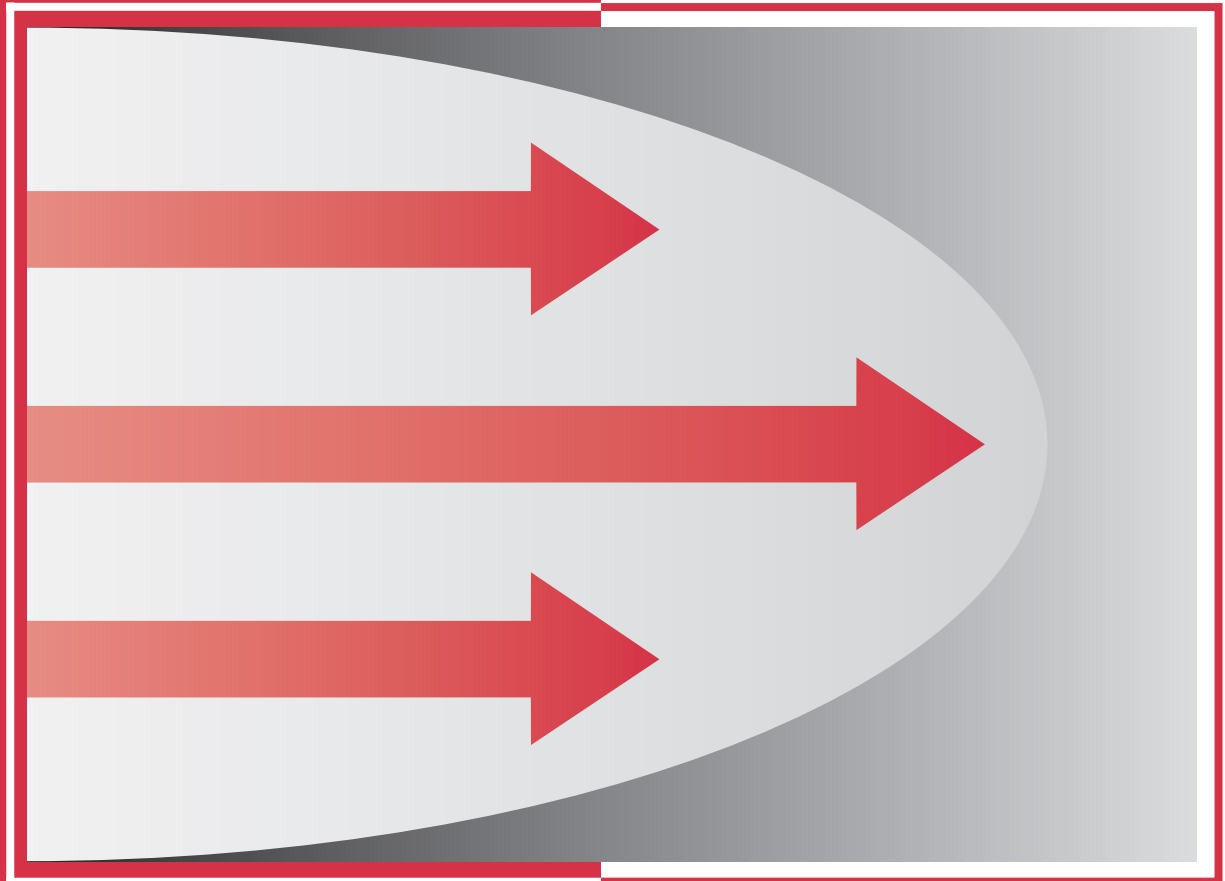

**H**aving acquired the means to compute convection transfer rates for external flow, we now consider the convection transfer problem for *internal flow*. Recall that an external flow is one for which boundary layer development on a surface is allowed to continue without external constraints, as for the flat plate of Figure 6.6. In contrast, an internal flow, such as flow in a pipe, is one for which the fluid is *confined* by a surface. Hence the boundary layer is unable to develop without eventually being constrained. The internal flow configuration represents a convenient geometry for heating and cooling fluids used in chemical processing, environmental control, and energy conversion technologies.

Our objectives are to develop an appreciation for the physical phenomena associated with internal flow and to obtain convection coefficients for flow conditions of practical importance. We begin by considering velocity (hydrodynamic) effects pertinent to internal flows, focusing on certain unique features of boundary layer development. Thermal boundary layer effects are considered next, and an overall energy balance is applied to determine fluid temperature variations in the flow direction. Finally, correlations for estimating the convection heat transfer coefficient are presented for a variety of internal flow conditions.


## 8.1

### Hydrodynamic Considerations

When considering external flow, it is necessary to ask only whether the flow is laminar or turbulent. However, for an internal flow we must also be concerned with the existence of *entrance* and *fully developed* regions.

#### 8.1.1 Flow Conditions

Consider laminar flow in a circular tube of radius  $r_o$  (Figure 8.1), where fluid enters the tube with a uniform velocity. We know that when the fluid makes contact with the surface, viscous effects become important, and a boundary layer develops with increasing  $x$ . This development occurs at the expense of a shrinking inviscid flow

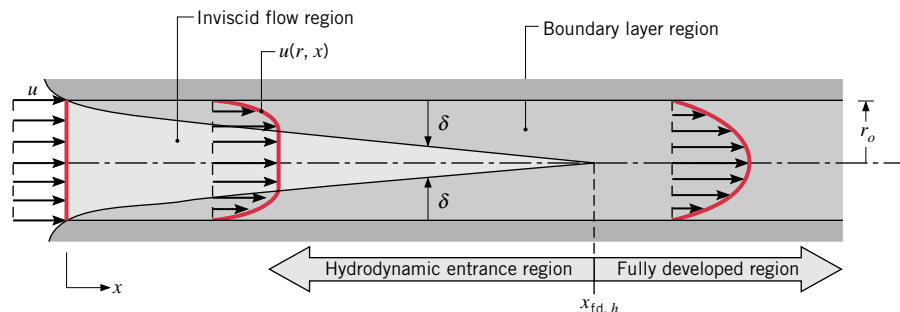

**FIGURE 8.1** Laminar, hydrodynamic boundary layer development in a circular tube.

region and concludes with boundary layer merger at the centerline. Following this merger, viscous effects extend over the entire cross section and the velocity profile no longer changes with increasing  $x$ . The flow is then said to be *fully developed*, and the distance from the entrance at which this condition is achieved is termed the *hydrodynamic entry length*,  $x_{fd,h}$ . As shown in Figure 8.1, the *fully developed velocity profile* is parabolic for laminar flow in a circular tube. For turbulent flow, the profile is *flatter* due to turbulent mixing in the radial direction.

When dealing with internal flows, it is important to be cognizant of the extent of the entry region, which depends on whether the flow is laminar or turbulent. The Reynolds number for flow in a circular tube is defined as

$$Re_D \equiv \frac{\rho u_m D}{\mu} = \frac{u_m D}{\nu} \quad (8.1)$$

where  $u_m$  is the mean fluid velocity over the tube cross section and  $D$  is the tube diameter. In a fully developed flow, the critical Reynolds number corresponding to the *onset* of turbulence is

$$Re_{D,c} \approx 2300 \quad (8.2)$$

although much larger Reynolds numbers ( $Re_D \approx 10,000$ ) are needed to achieve fully turbulent conditions. The transition to turbulence is likely to begin in the developing boundary layer of the entrance region.

For laminar flow ( $Re_D \leq 2300$ ), the hydrodynamic entry length may be obtained from an expression of the form [1]

$$\left( \frac{x_{fd,h}}{D} \right)_{\text{lam}} \approx 0.05 Re_D \quad (8.3)$$

This expression is based on the presumption that fluid enters the tube from a rounded converging nozzle and is hence characterized by a nearly uniform velocity profile at the entrance (Figure 8.1). Although there is no satisfactory general expression for the entry length in turbulent flow, we know that it is approximately independent of Reynolds number and that, as a first approximation [2],

$$10 \leq \left( \frac{x_{fd,h}}{D} \right)_{\text{turb}} \leq 60 \quad (8.4)$$

For the purposes of this text, we shall assume fully developed turbulent flow for  $(x/D) > 10$ .

### 8.1.2 The Mean Velocity

Because the velocity varies over the cross section and there is no well-defined free stream, it is necessary to work with a mean velocity  $u_m$  when dealing with internal flows. This velocity is defined such that, when multiplied by the fluid density  $\rho$  and the cross-sectional area of the tube  $A_c$ , it provides the rate of mass flow through the tube. Hence

$$\dot{m} = \rho u_m A_c \quad (8.5)$$

For steady, incompressible flow in a tube of uniform cross-sectional area,  $\dot{m}$  and  $u_m$  are constants independent of  $x$ . From Equations 8.1 and 8.5 it is evident that, for flow in a *circular tube* ( $A_c = \pi D^2/4$ ), the Reynolds number reduces to

$$Re_D = \frac{4\dot{m}}{\pi D \mu} \quad (8.6)$$

Since the mass flow rate may also be expressed as the integral of the mass flux ( $\rho u$ ) over the cross section

$$\dot{m} = \int_{A_c} \rho u(r, x) dA_c \quad (8.7)$$

it follows that, for *incompressible* flow in a *circular tube*,

$$u_m = \frac{\int_{A_c} \rho u(r, x) dA_c}{\rho A_c} = \frac{2\pi \rho}{\rho \pi r_o^2} \int_0^{r_o} u(r, x) r dr = \frac{2}{r_o^2} \int_0^{r_o} u(r, x) r dr \quad (8.8)$$

The foregoing expression may be used to determine  $u_m$  at any axial location  $x$  from knowledge of the velocity profile  $u(r)$  at that location.

### 8.1.3 Velocity Profile in the Fully Developed Region

The form of the velocity profile may readily be determined for the *laminar flow* of an *incompressible, constant property fluid* in the *fully developed region* of a *circular tube*. An important feature of hydrodynamic conditions in the fully developed region is that both the radial velocity component  $v$  and the gradient of the axial velocity component ( $\partial u / \partial x$ ) are everywhere zero.

$$v = 0 \quad \text{and} \quad \left( \frac{\partial u}{\partial x} \right) = 0 \quad (8.9)$$


Hence the axial velocity component depends only on  $r$ ,  $u(x, r) = u(r)$ .

The radial dependence of the axial velocity may be obtained by solving the appropriate form of the  $x$ -momentum equation. This form is determined by first recognizing that, for the conditions of Equation 8.9, the net momentum flux is everywhere zero in the fully developed region. Hence the momentum conservation requirement reduces to a simple balance between shear and pressure forces in the flow. For the annular differential element of Figure 8.2, this force balance may be expressed as

$$\begin{aligned} \tau_r(2\pi r dx) - \left\{ \tau_r(2\pi r dx) + \frac{d}{dr} [\tau_r(2\pi r dx)] dx \right\} \\ + p(2\pi r dr) - \left\{ p(2\pi r dr) + \frac{d}{dx} [p(2\pi r dr)] dx \right\} = 0 \end{aligned}$$

which reduces to

$$-\frac{d}{dr}(r\tau_r) = r \frac{dp}{dx} \quad (8.10)$$

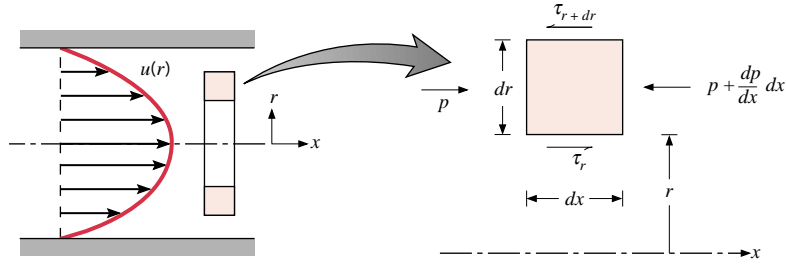

**FIGURE 8.2** Force balance on a differential element for laminar, fully developed flow in a circular tube.

With  $y = r_o - r$ , Newton's law of viscosity, Equation 6S.10, assumes the form

$$\tau_r = -\mu \frac{du}{dr} \quad (8.11)$$

and Equation 8.10 becomes

$$\frac{\mu}{r} \frac{d}{dr} \left( r \frac{du}{dr} \right) = \frac{dp}{dx} \quad (8.12)$$

Since the axial pressure gradient is independent of  $r$ , Equation 8.12 may be solved by integrating twice to obtain

$$r \frac{du}{dr} = \frac{1}{\mu} \left( \frac{dp}{dx} \right) \frac{r^2}{2} + C_1$$

and

$$u(r) = \frac{1}{\mu} \left( \frac{dp}{dx} \right) \frac{r^2}{4} + C_1 \ln r + C_2$$

The integration constants may be determined by invoking the boundary conditions

$$u(r_o) = 0 \quad \text{and} \quad \left. \frac{\partial u}{\partial r} \right|_{r=0} = 0$$

which, respectively, impose the requirements of zero slip at the tube surface and radial symmetry about the centerline. It is a simple matter to evaluate the constants, and it follows that

$$u(r) = -\frac{1}{4\mu} \left( \frac{dp}{dx} \right) r_o^2 \left[ 1 - \left( \frac{r}{r_o} \right)^2 \right] \quad (8.13)$$

Hence the fully developed velocity profile is *parabolic*. Note that the pressure gradient must always be negative.

The foregoing result may be used to determine the mean velocity of the flow. Substituting Equation 8.13 into Equation 8.8 and integrating, we obtain

$$u_m = -\frac{r_o^2}{8\mu} \frac{dp}{dx} \quad (8.14)$$

Substituting this result into Equation 8.13, the velocity profile is then

$$\frac{u(r)}{u_m} = 2 \left[ 1 - \left( \frac{r}{r_o} \right)^2 \right] \quad (8.15)$$

Since  $u_m$  can be computed from knowledge of the mass flow rate, Equation 8.14 can be used to determine the pressure gradient.

### 8.1.4 Pressure Gradient and Friction Factor in Fully Developed Flow

The engineer is frequently interested in the pressure drop needed to sustain an internal flow because this parameter determines pump or fan power requirements. To determine the pressure drop, it is convenient to work with the *Moody* (or Darcy) *friction factor*, which is a dimensionless parameter defined as

$$f \equiv \frac{-(dp/dx)D}{\rho u_m^2/2} \quad (8.16)$$

This quantity is not to be confused with the *friction coefficient*, sometimes called the Fanning friction factor, which is defined as

$$C_f \equiv \frac{\tau_s}{\rho u_m^2/2} \quad (8.17)$$

Since  $\tau_s = -\mu(du/dr)_{r=r_o}$ , it follows from Equation 8.13 that

$$C_f = \frac{f}{4} \quad (8.18)$$

Substituting Equations 8.1 and 8.14 into 8.16, it follows that, for fully developed laminar flow,

$$f = \frac{64}{Re_D} \quad (8.19)$$

For fully developed turbulent flow, the analysis is much more complicated, and we must ultimately rely on experimental results. Friction factors for a wide Reynolds number range are presented in the *Moody diagram* of Figure 8.3. In addition to depending on the Reynolds number, the friction factor is a function of the tube surface condition. It is a minimum for *smooth* surfaces and increases with increasing surface roughness,  $e$ . Correlations that reasonably approximate the smooth surface condition are of the form

$$f = 0.316 Re_D^{-1/4} \quad Re_D \lesssim 2 \times 10^4 \quad (8.20a)$$

$$f = 0.184 Re_D^{-1/5} \quad Re_D \gtrsim 2 \times 10^4 \quad (8.20b)$$

Alternatively, a single correlation that encompasses a large Reynolds number range has been developed by Petukhov [4] and is of the form

$$f = (0.790 \ln Re_D - 1.64)^{-2} \quad 3000 \lesssim Re_D \lesssim 5 \times 10^6 \quad (8.21)$$

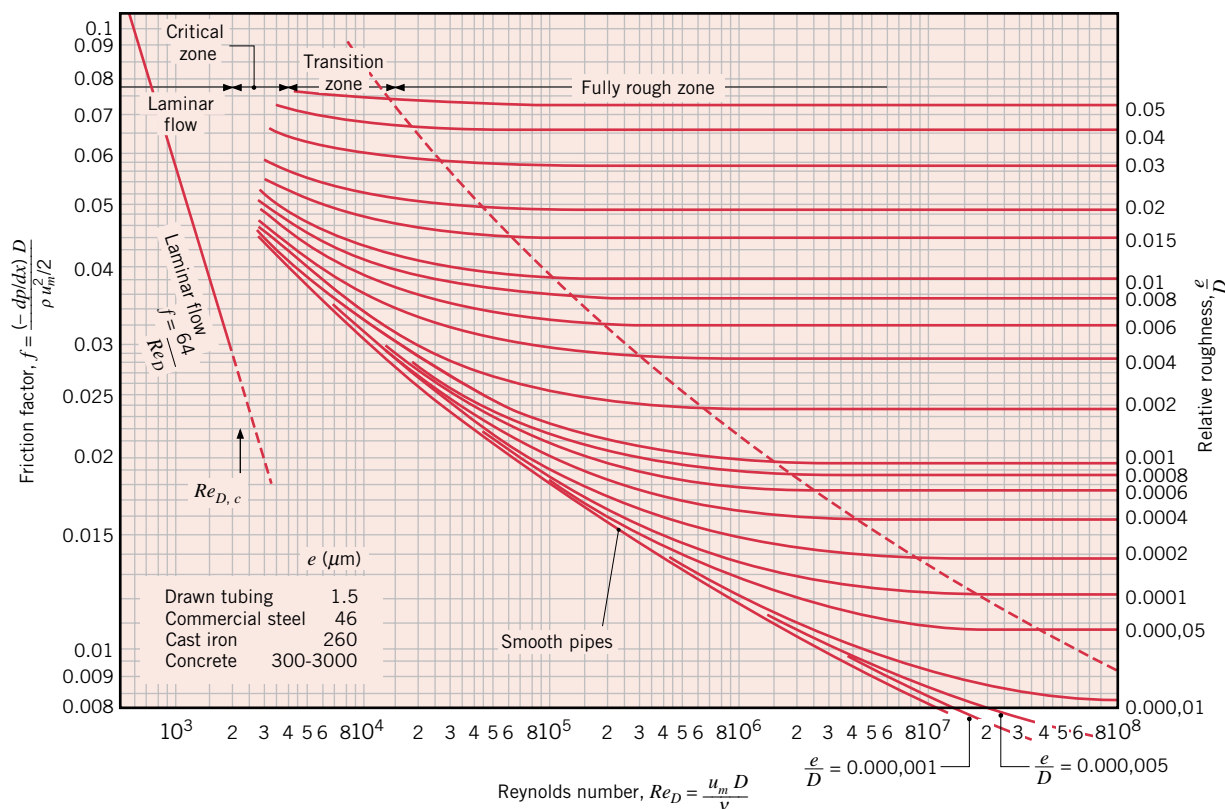


FIGURE 8.3 Friction factor for fully developed flow in a circular tube [3]. Used with permission.

Note that  $f$ , hence  $dp/dx$ , is a constant in the fully developed region. From Equation 8.16 the pressure drop  $\Delta p = p_1 - p_2$  associated with fully developed flow from the axial position  $x_1$  to  $x_2$  may then be expressed as

$$\Delta p = - \int_{p_1}^{p_2} dp = f \frac{\rho u_m^2}{2D} \int_{x_1}^{x_2} dx = f \frac{\rho u_m^2}{2D} (x_2 - x_1) \quad (8.22a)$$

where  $f$  is obtained from Figure 8.3 or from Equation 8.19 for laminar flow and from Equation 8.20 or 8.21 for turbulent flow in smooth tubes. The pump or fan power required to overcome the resistance to flow associated with this pressure drop may be expressed as

$$P = (\Delta p) \dot{V} \quad (8.22b)$$


where the volumetric flow rate  $\dot{V}$  may, in turn, be expressed as  $\dot{V} = \dot{m}/\rho$  for an incompressible fluid.

## 8.2

### Thermal Considerations

Having reviewed the fluid mechanics of internal flow, we now consider thermal effects. If fluid enters the tube of Figure 8.4 at a uniform temperature  $T(r, 0)$  that is



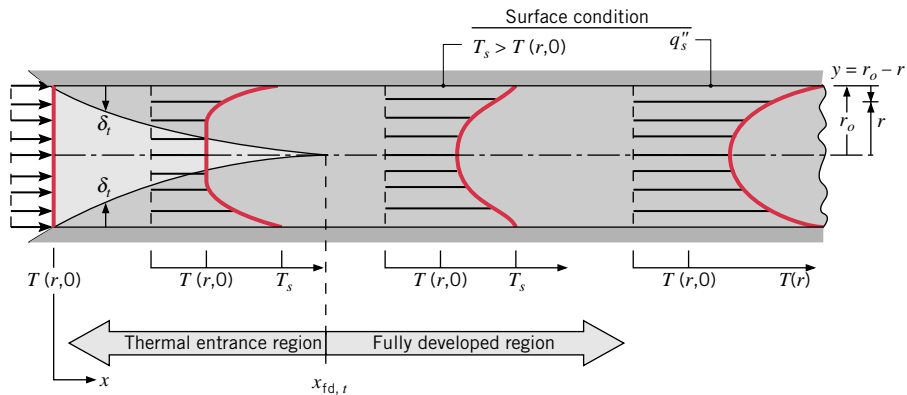

**FIGURE 8.4** Thermal boundary layer development in a heated circular tube.

less than the surface temperature, convection heat transfer occurs and a *thermal boundary layer* begins to develop. Moreover, if the tube *surface* condition is fixed by imposing either a uniform temperature ( $T_s$  is constant) or a uniform heat flux ( $q_s''$  is constant), a *thermally fully developed condition* is eventually reached. The shape of the fully developed temperature profile  $T(r, x)$  differs according to whether a uniform surface temperature or heat flux is maintained. For both surface conditions, however, the amount by which fluid temperatures exceed the entrance temperature increases with increasing  $x$ .

For laminar flow the *thermal entry length* may be expressed as [2]

$$\left( \frac{x_{fd,t}}{D} \right)_{\text{lam}} \approx 0.05 Re_D Pr \quad (8.23)$$

Comparing Equations 8.3 and 8.23, it is evident that, if  $Pr > 1$ , the hydrodynamic boundary layer develops more rapidly than the thermal boundary layer ( $x_{fd,h} < x_{fd,t}$ ), while the inverse is true for  $Pr < 1$ . For extremely large Prandtl number fluids, such as oils ( $Pr \gtrsim 100$ ),  $x_{fd,h}$  is very much smaller than  $x_{fd,t}$  and it is reasonable to assume a fully developed velocity profile throughout the thermal entry region. In contrast, for turbulent flow, conditions are nearly independent of Prandtl number, and to a first approximation, we shall assume  $(x_{fd,t}/D) = 10$ .

Thermal conditions in the fully developed region are characterized by several interesting and useful features. Before we can consider these features (Section 8.2.3), however, it is necessary to introduce the concept of a mean temperature and the appropriate form of Newton's law of cooling.

### 8.2.1 The Mean Temperature

Just as the absence of a free stream velocity requires use of a mean velocity to describe an internal flow, the absence of a fixed free stream temperature necessitates using a *mean* (or *bulk*) *temperature*. To provide a definition of the mean temperature, we begin by returning to Equation 1.11e:

$$q = \dot{m} c_p (T_{\text{out}} - T_{\text{in}}) \quad (1.11e)$$

Recall that the terms on the right-hand side represent the thermal energy for an incompressible liquid or the enthalpy (thermal energy plus flow work) for an ideal gas, which is carried by the fluid. In developing this equation, it was implicitly assumed that the temperature was uniform across the inlet and outlet cross-sectional areas. In reality, this is not true if convection heat transfer occurs, and we *define* the mean temperature so that the term  $\dot{m}c_p T_m$  is equal to the true rate of thermal energy (or enthalpy) advection integrated over the cross section. This true advection rate may be obtained by integrating the product of mass flux ( $\rho u$ ) and the thermal energy (or enthalpy) per unit mass,  $c_p T$ , over the cross section. Therefore, we define  $T_m$  from

$$\dot{m}c_p T_m = \int_{A_c} \rho u c_p T dA_c \quad (8.24)$$

or

$$T_m = \frac{\int_{A_c} \rho u c_p T dA_c}{\dot{m}c_p} \quad (8.25)$$

For flow in a circular tube with constant  $\rho$  and  $c_p$ , it follows from Equations 8.5 and 8.25 that

$$T_m = \frac{2}{u_m r_o^2} \int_0^{r_o} u T r dr \quad (8.26)$$

It is important to note that, when multiplied by the mass flow rate and the specific heat,  $T_m$  provides the rate at which thermal energy (or enthalpy) is advected with the fluid as it moves along the tube.

### 8.2.2 Newton's Law of Cooling

The mean temperature  $T_m$  is a convenient reference temperature for internal flows, playing much the same role as the free stream temperature  $T_\infty$  for external flows. Accordingly, Newton's law of cooling may be expressed as

$$q_s'' = h(T_s - T_m) \quad (8.27)$$

where  $h$  is the *local* convection heat transfer coefficient. However, there is an essential difference between  $T_m$  and  $T_\infty$ . Whereas  $T_\infty$  is constant in the flow direction,  $T_m$  must vary in this direction. That is,  $dT_m/dx$  is never zero if heat transfer is occurring. The value of  $T_m$  increases with  $x$  if heat transfer is from the surface to the fluid ( $T_s > T_m$ ); it decreases with  $x$  if the opposite is true ( $T_s < T_m$ ).

### 8.2.3 Fully Developed Conditions

Since the existence of convection heat transfer between the surface and the fluid dictates that the fluid temperature must continue to change with  $x$ , one might legitimately question whether fully developed thermal conditions can ever be reached. The situation is certainly different from the hydrodynamic case, for which  $(\partial u / \partial x) = 0$  in the fully developed region. In contrast, if there is heat transfer,  $(dT_m / dx)$ , as well as  $(\partial T / \partial x)$  at any radius  $r$ , is not zero. Accordingly, the temperature profile  $T(r)$  is

continuously changing with  $x$ , and it would seem that a fully developed condition could never be reached. This apparent contradiction may be reconciled by working with a dimensionless form of the temperature.

Analyses may be simplified by working with dimensionless temperature differences, as for transient conduction (Chapter 5) and the energy conservation equation (Chapter 6). Introducing a dimensionless temperature difference of the form  $(T_s - T)/(T_s - T_m)$ , conditions for which this ratio becomes independent of  $x$  are known to exist [2]. That is, although the temperature profile  $T(r)$  continues to change with  $x$ , the *relative* shape of the profile no longer changes and the flow is said to be *thermally fully developed*. The requirement for such a condition is formally stated as

$$\frac{\partial}{\partial x} \left[ \frac{T_s(x) - T(r, x)}{T_s(x) - T_m(x)} \right]_{\text{fd},t} = 0 \quad (8.28)$$

where  $T_s$  is the tube surface temperature,  $T$  is the local fluid temperature, and  $T_m$  is the mean temperature of the fluid over the cross section of the tube.

The condition given by Equation 8.28 is eventually reached in a tube for which there is either a *uniform surface heat flux* ( $q_s''$  is constant) or a *uniform surface temperature* ( $T_s$  is constant). These surface conditions arise in many engineering applications. For example, a constant surface heat flux would exist if the tube wall were heated electrically or if the outer surface were uniformly irradiated. In contrast, a constant surface temperature would exist if a phase change (due to boiling or condensation) were occurring at the outer surface. Note that it is impossible to *simultaneously* impose the conditions of constant surface heat flux and constant surface temperature. If  $q_s''$  is constant,  $T_s$  must vary with  $x$ ; conversely, if  $T_s$  is constant,  $q_s''$  must vary with  $x$ .

Several important features of thermally developed flow may be inferred from Equation 8.28. Since the temperature ratio is independent of  $x$ , the derivative of this ratio with respect to  $r$  must also be independent of  $x$ . Evaluating this derivative at the tube surface (note that  $T_s$  and  $T_m$  are constants insofar as differentiation with respect to  $r$  is concerned), we then obtain

$$\frac{\partial}{\partial r} \left( \frac{T_s - T}{T_s - T_m} \right) \bigg|_{r=r_o} = \frac{-\partial T / \partial r|_{r=r_o}}{T_s - T_m} \neq f(x)$$

Substituting for  $\partial T / \partial r$  from Fourier's law, which, from Figure 8.4, is of the form


$$q_s'' = -k \frac{\partial T}{\partial y} \bigg|_{y=0} = k \frac{\partial T}{\partial r} \bigg|_{r=r_o}$$

and for  $q_s''$  from Newton's law of cooling, Equation 8.27, we obtain

$$\frac{h}{k} \neq f(x) \quad (8.29)$$

Hence *in the thermally fully developed flow of a fluid with constant properties*, the *local convection coefficient is a constant, independent of  $x$* .

Equation 8.28 is not satisfied in the entrance region, where  $h$  varies with  $x$ , as shown in Figure 8.5. Because the thermal boundary layer thickness is zero at the tube entrance, the convection coefficient is extremely large at  $x = 0$ . However,  $h$  decays rapidly as the thermal boundary layer develops, until the constant value associated with fully developed conditions is reached.

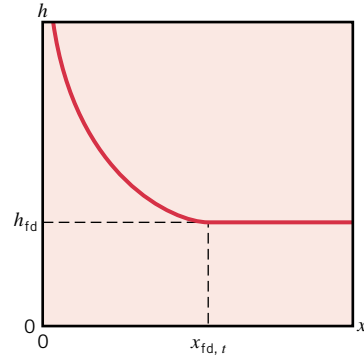

**FIGURE 8.5**

Axial variation of the convection heat transfer coefficient for flow in a tube.

Additional simplifications are associated with the special case of *uniform surface heat flux*. Since both  $h$  and  $q_s''$  are constant in the fully developed region, it follows from Equation 8.27 that

$$\left. \frac{dT_s}{dx} \right|_{fd,t} = \left. \frac{dT_m}{dx} \right|_{fd,t} \quad q_s'' = \text{constant} \quad (8.30)$$

If we expand Equation 8.28 and solve for  $\partial T / \partial x$ , it also follows that

$$\left. \frac{\partial T}{\partial x} \right|_{fd,t} = \left. \frac{dT_s}{dx} \right|_{fd,t} - \frac{(T_s - T)}{(T_s - T_m)} \left. \frac{dT_s}{dx} \right|_{fd,t} + \frac{(T_s - T)}{(T_s - T_m)} \left. \frac{dT_m}{dx} \right|_{fd,t} \quad (8.31)$$

Substituting from Equation 8.30, we then obtain

$$\left. \frac{\partial T}{\partial x} \right|_{fd,t} = \left. \frac{dT_m}{dx} \right|_{fd,t} \quad q_s'' = \text{constant} \quad (8.32)$$

Hence the axial temperature gradient is independent of the radial location. For the case of *constant surface temperature* ( $dT_s/dx = 0$ ), it also follows from Equation 8.31 that

$$\left. \frac{\partial T}{\partial x} \right|_{fd,t} = \frac{(T_s - T)}{(T_s - T_m)} \left. \frac{dT_m}{dx} \right|_{fd,t} \quad T_s = \text{constant} \quad (8.33)$$

in which case the value of  $\partial T / \partial x$  depends on the radial coordinate.

From the foregoing results, it is evident that the mean temperature is a very important variable for internal flows. To describe such flows, its variation with  $x$  must be known. This variation may be obtained by applying an *overall energy balance* to the flow, as will be shown in the next section.

### EXAMPLE 8.1


For flow of a liquid metal through a circular tube, the velocity and temperature profiles at a particular axial location may be approximated as being uniform and parabolic, respectively. That is,  $u(r) = C_1$  and  $T(r) - T_s = C_2[1 - (r/r_o)^2]$ , where  $C_1$  and  $C_2$  are constants. What is the value of the Nusselt number  $Nu_D$  at this location?

### SOLUTION

**Known:** Form of the velocity and temperature profiles at a particular axial location for flow in a circular tube.

**Find:** Nusselt number at the prescribed location.

**Schematic:**

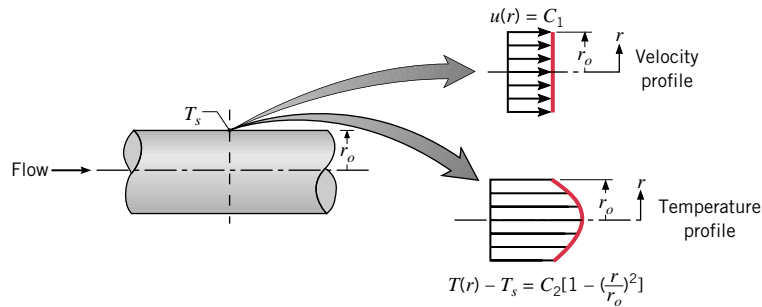

**Assumptions:** Incompressible, constant property flow.

**Analysis:** The Nusselt number may be obtained by first determining the convection coefficient, which, from Equation 8.27, is given as

$$h = \frac{q_s''}{T_s - T_m}$$

From Equation 8.26, the mean temperature is

$$T_m = \frac{2}{u_m r_o^2} \int_0^{r_o} u T r dr = \frac{2C_1}{u_m r_o^2} \int_0^{r_o} \left\{ T_s + C_2 \left[ 1 - \left( \frac{r}{r_o} \right)^2 \right] \right\} r dr$$

or, since  $u_m = C_1$  from Equation 8.8,

$$\begin{aligned} T_m &= \frac{2}{r_o^2} \int_0^{r_o} \left\{ T_s + C_2 \left[ 1 - \left( \frac{r}{r_o} \right)^2 \right] \right\} r dr \\ T_m &= \frac{2}{r_o^2} \left[ T_s \frac{r^2}{2} + C_2 \frac{r^2}{2} - \frac{C_2}{4} \frac{r^4}{r_o^2} \right] \bigg|_0^{r_o} \\ T_m &= \frac{2}{r_o^2} \left( T_s \frac{r_o^2}{2} + \frac{C_2}{2} r_o^2 - \frac{C_2}{4} r_o^2 \right) = T_s + \frac{C_2}{2} \end{aligned}$$

The heat flux may be obtained from Fourier's law, in which case

$$q_s'' = k \frac{\partial T}{\partial r} \bigg|_{r=r_o} = -k C_2 2 \frac{r}{r_o^2} \bigg|_{r=r_o} = -2 C_2 \frac{k}{r_o}$$

Hence

$$h = \frac{q_s''}{T_s - T_m} = \frac{-2 C_2 (k/r_o)}{-C_2/2} = \frac{4k}{r_o}$$

and

$$Nu_D = \frac{hD}{k} = \frac{(4k/r_o) \times 2r_o}{k} = 8$$

◁

## 8.3

### The Energy Balance

#### 8.3.1 General Considerations

Because the flow in a tube is completely enclosed, an energy balance may be applied to determine how the mean temperature  $T_m(x)$  varies with position along the tube and how the total convection heat transfer  $q_{\text{conv}}$  is related to the difference in temperatures at the tube inlet and outlet. Consider the tube flow of Figure 8.6. Fluid moves at a constant flow rate  $\dot{m}$ , and convection heat transfer occurs at the inner surface. Typically, it will be reasonable to make one of the four assumptions in Section 1.3 that leads to the simplified steady-flow thermal energy equation, Equation 1.11e. For example, it is often the case that viscous dissipation is negligible (see Problem 8.10) and that the fluid can be modeled as either an incompressible liquid or an ideal gas with negligible pressure variation. In addition, it is usually reasonable to neglect heat transfer by conduction in the axial direction, so the heat transfer term in Equation 1.11e includes only  $q_{\text{conv}}$ . Therefore, Equation 1.11e may be written in the form

$$q_{\text{conv}} = \dot{m}c_p(T_{m,o} - T_{m,i}) \quad (8.34)$$

for a tube of finite length. This simple overall energy balance relates three important thermal variables ( $q_{\text{conv}}$ ,  $T_{m,o}$ ,  $T_{m,i}$ ). *It is a general expression that applies irrespective of the nature of the surface thermal or tube flow conditions.*

Applying Equation 1.11e to the differential control volume of Figure 8.6 and recalling that the mean temperature is defined such that  $\dot{m}c_p T_m$  represents the true rate of thermal energy (or enthalpy) advection integrated over the cross-section, we obtain

$$dq_{\text{conv}} = \dot{m}c_p[(T_m + dT_m) - T_m] \quad (8.35)$$

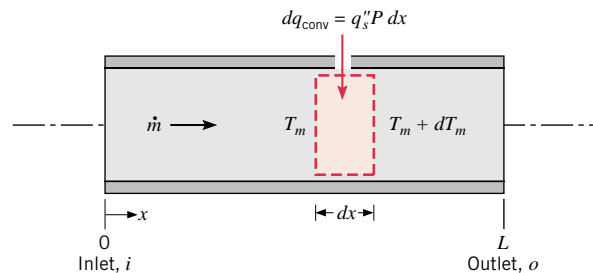


FIGURE 8.6 Control volume for internal flow in a tube.

or

$$dq_{\text{conv}} = \dot{m}c_p dT_m \quad (8.36)$$

Equation 8.36 may be cast in a convenient form by expressing the rate of convection heat transfer to the differential element as  $dq_{\text{conv}} = q_s'' P dx$ , where  $P$  is the surface perimeter ( $P = \pi D$  for a circular tube). Substituting from Equation 8.27, it follows that

$$\frac{dT_m}{dx} = \frac{q_s'' P}{\dot{m}c_p} = \frac{P}{\dot{m}c_p} h(T_s - T_m) \quad (8.37)$$

This expression is an extremely useful result, from which the axial variation of  $T_m$  may be determined. If  $T_s > T_m$ , heat is transferred to the fluid and  $T_m$  increases with  $x$ ; if  $T_s < T_m$ , the opposite is true.

The manner in which quantities on the right-hand side of Equation 8.37 vary with  $x$  should be noted. Although  $P$  may vary with  $x$ , most commonly it is a constant (a tube of constant cross-sectional area). Hence the quantity  $(P/\dot{m}c_p)$  is a constant. In the fully developed region, the convection coefficient  $h$  is also constant, although it varies with  $x$  in the entrance region (Figure 8.5). Finally, although  $T_s$  may be constant,  $T_m$  must always vary with  $x$  (except for the trivial case of no heat transfer,  $T_s = T_m$ ).

The solution to Equation 8.37 for  $T_m(x)$  depends on the surface thermal condition. Recall that the two special cases of interest are *constant surface heat flux* and *constant surface temperature*. It is common to find one of these conditions existing to a reasonable approximation.

### 8.3.2 Constant Surface Heat Flux

For constant surface heat flux we first note that it is a simple matter to determine the total heat transfer rate  $q_{\text{conv}}$ . Since  $q_s''$  is independent of  $x$ , it follows that

$$q_{\text{conv}} = q_s''(P \cdot L) \quad (8.38)$$

This expression could be used with Equation 8.34 to determine the fluid temperature change,  $T_{m,o} - T_{m,i}$ .


For constant  $q_s''$  it also follows that the middle expression in Equation 8.37 is a constant independent of  $x$ . Hence

$$\frac{dT_m}{dx} = \frac{q_s'' P}{\dot{m}c_p} = f(x) \quad (8.39)$$

Integrating from  $x = 0$ , it follows that

$$T_m(x) = T_{m,i} + \frac{q_s'' P}{\dot{m}c_p} x \quad q_s'' = \text{constant} \quad (8.40)$$

Accordingly, the mean temperature varies *linearly* with  $x$  along the tube (Figure 8.7a). Moreover, from Equation 8.27 and Figure 8.5 we also expect the temperature difference ( $T_s - T_m$ ) to vary with  $x$ , as shown in Figure 8.7a. This difference is initially

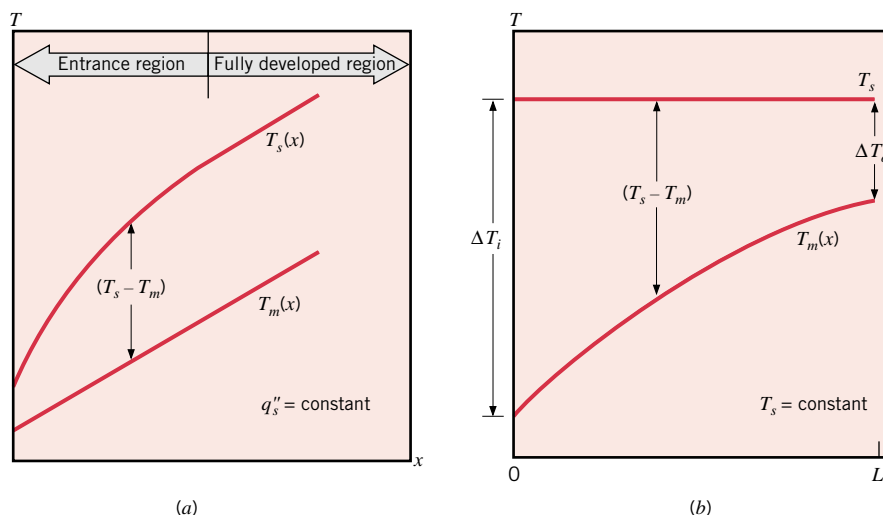

**FIGURE 8.7** Axial temperature variations for heat transfer in a tube. (a) Constant surface heat flux. (b) Constant surface temperature.

small (due to the large value of  $h$  near the entrance) but increases with increasing  $x$  due to the decrease in  $h$  that occurs as the boundary layer develops. However, in the fully developed region we know that  $h$  is independent of  $x$ . Hence from Equation 8.27 it follows that  $(T_s - T_m)$  must also be independent of  $x$  in this region.

It should be noted that, if the heat flux is not constant but is, instead, a known function of  $x$ , Equation 8.37 may still be integrated to obtain the variation of the mean temperature with  $x$ . Similarly, the total heat rate may be obtained from the requirement that  $q_{\text{conv}} = \int_0^L q_s''(x)P \, dx$ .

### EXAMPLE 8.2

A system for heating water from an inlet temperature of  $T_{m,i} = 20^\circ\text{C}$  to an outlet temperature of  $T_{m,o} = 60^\circ\text{C}$  involves passing the water through a thick-walled tube having inner and outer diameters of 20 and 40 mm. The outer surface of the tube is well insulated, and electrical heating within the wall provides for a uniform generation rate of  $\dot{q} = 10^6 \, \text{W/m}^3$ .

1. For a water mass flow rate of  $\dot{m} = 0.1 \, \text{kg/s}$ , how long must the tube be to achieve the desired outlet temperature?
2. If the inner surface temperature of the tube is  $T_s = 70^\circ\text{C}$  at the outlet, what is the local convection heat transfer coefficient at the outlet?

### SOLUTION


**Known:** Internal flow through thick-walled tube having uniform heat generation.

**Find:**

1. Length of tube needed to achieve the desired outlet temperature.
2. Local convection coefficient at the outlet.



**Schematic:**

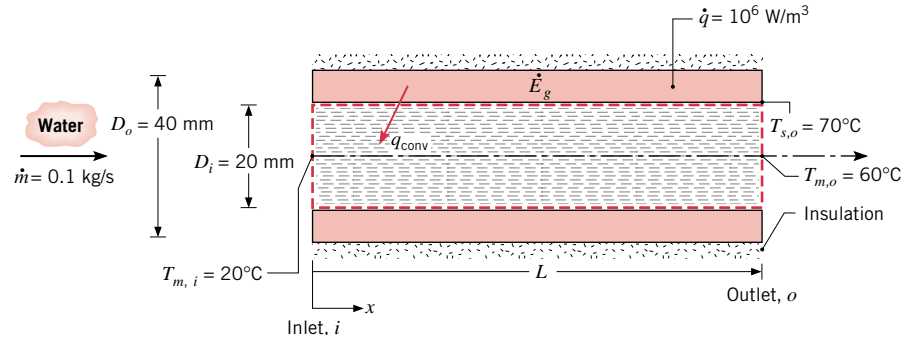

**Assumptions:**

1. Steady-state conditions.
2. Uniform heat flux.
3. Incompressible liquid and negligible viscous dissipation.
4. Constant properties.
5. Adiabatic outer tube surface.

**Properties:** Table A.6, water ( $\bar{T}_m = 313$  K):  $c_p = 4179$  J/kg · K.

**Analysis:**

1. Since the outer surface of the tube is adiabatic, the rate at which energy is generated within the tube wall must equal the rate at which it is convected to the water.

$$\dot{E}_g = q_{\text{conv}}$$

With

$$\dot{E}_g = \dot{q} \frac{\pi}{4} (D_o^2 - D_i^2) L$$

it follows from Equation 8.34 that

$$\dot{q} \frac{\pi}{4} (D_o^2 - D_i^2) L = \dot{m} c_p (T_{m,o} - T_{m,i})$$

or

$$L = \frac{4 \dot{m} c_p}{\pi (D_o^2 - D_i^2) \dot{q}} (T_{m,o} - T_{m,i})$$

$$L = \frac{4 \times 0.1 \text{ kg/s} \times 4179 \text{ J/kg} \cdot \text{K}}{\pi (0.04^2 - 0.02^2) \text{ m}^2 \times 10^6 \text{ W/m}^3} (60 - 20)^\circ\text{C} = 17.7 \text{ m}$$

2. From Newton's law of cooling, Equation 8.27, the local convection coefficient at the tube exit is

$$h_o = \frac{q_s''}{T_{s,o} - T_{m,o}}$$

Assuming that uniform heat generation in the wall provides a constant surface heat flux, with

$$q_s'' = \frac{\dot{E}_g}{\pi D_i L} = \frac{\dot{q}}{4} \frac{D_o^2 - D_i^2}{D_i}$$

$$q_s'' = \frac{10^6 \text{ W/m}^3}{4} \frac{(0.04^2 - 0.02^2) \text{ m}^2}{0.02 \text{ m}} = 1.5 \times 10^4 \text{ W/m}^2$$

it follows that

$$h_o = \frac{1.5 \times 10^4 \text{ W/m}^2}{(70 - 60)^\circ\text{C}} = 1500 \text{ W/m}^2 \cdot \text{K}$$

**Comments:**

1. If conditions are fully developed over the entire tube, the local convection coefficient and the temperature difference ( $T_s - T_m$ ) are independent of  $x$ . Hence  $h = 1500 \text{ W/m}^2 \cdot \text{K}$  and  $(T_s - T_m) = 10^\circ\text{C}$  over the entire tube. The inner surface temperature at the tube inlet is then  $T_{s,i} = 30^\circ\text{C}$ .
2. The required tube length  $L$  could have been computed by applying the expression for  $T_m(x)$ , Equation 8.40, at  $x = L$ .

### 8.3.3 Constant Surface Temperature

Results for the total heat transfer rate and the axial distribution of the mean temperature are entirely different for the *constant surface temperature* condition. Defining  $\Delta T$  as  $T_s - T_m$ , Equation 8.37 may be expressed as

$$\frac{dT_m}{dx} = -\frac{d(\Delta T)}{dx} = \frac{P}{\dot{m}c_p} h \Delta T$$

Separating variables and integrating from the tube inlet to the outlet,

$$\int_{\Delta T_i}^{\Delta T_o} \frac{d(\Delta T)}{\Delta T} = -\frac{P}{\dot{m}c_p} \int_0^L h dx$$

or

$$\ln \frac{\Delta T_o}{\Delta T_i} = -\frac{PL}{\dot{m}c_p} \left( \frac{1}{L} \int_0^L h dx \right)$$

From the definition of the average convection heat transfer coefficient, Equation 6.13, it follows that

$$\ln \frac{\Delta T_o}{\Delta T_i} = -\frac{PL}{\dot{m}c_p} \bar{h}_L \quad T_s = \text{constant} \quad (8.41a)$$

where  $\bar{h}_L$ , or simply  $\bar{h}$ , is the average value of  $h$  for the entire tube. Rearranging,

$$\frac{\Delta T_o}{\Delta T_i} = \frac{T_s - T_{m,o}}{T_s - T_{m,i}} = \exp\left(-\frac{PL}{\dot{m}c_p} \bar{h}\right) \quad T_s = \text{constant} \quad (8.41b)$$

Had we integrated from the tube inlet to some axial position  $x$  within the tube, we would have obtained the similar, but more general, result that

$$\frac{T_s - T_m(x)}{T_s - T_{m,i}} = \exp\left(-\frac{Px}{\dot{m}c_p} \bar{h}\right) \quad T_s = \text{constant} \quad (8.42)$$

where  $\bar{h}$  is now the average value of  $h$  from the tube inlet to  $x$ . This result tells us that the temperature difference ( $T_s - T_m$ ) *decays exponentially* with distance along the tube axis. The axial surface and mean temperature distributions are therefore as shown in Figure 8.7b.

Determination of an expression for the total heat transfer rate  $q_{\text{conv}}$  is complicated by the exponential nature of the temperature decay. Expressing Equation 8.34 in the form

$$q_{\text{conv}} = \dot{m}c_p[(T_s - T_{m,i}) - (T_s - T_{m,o})] = \dot{m}c_p(\Delta T_i - \Delta T_o)$$

and substituting for  $\dot{m}c_p$  from Equation 8.41a, we obtain

$$q_{\text{conv}} = \bar{h}A_s\Delta T_{\text{lm}} \quad T_s = \text{constant} \quad (8.43)$$

where  $A_s$  is the tube surface area ( $A_s = P \cdot L$ ) and  $\Delta T_{\text{lm}}$  is the *log mean temperature difference*,

$$\Delta T_{\text{lm}} \equiv \frac{\Delta T_o - \Delta T_i}{\ln(\Delta T_o/\Delta T_i)} \quad (8.44)$$


Equation 8.43 is a form of Newton's law of cooling for the entire tube, and  $\Delta T_{\text{lm}}$  is the appropriate *average* of the temperature difference over the tube length. The logarithmic nature of this average temperature difference [in contrast, e.g., to an *arithmetic mean temperature* difference of the form  $\Delta T_{\text{am}} = (\Delta T_i + \Delta T_o)/2$ ] is due to the exponential nature of the temperature decay.

Before concluding this section, it is important to note that, in many applications, it is the temperature of an *external* fluid, rather than the tube surface temperature, that is fixed (Figure 8.8). In such cases, it is readily shown that the results of this section may still be used if  $T_s$  is replaced by  $T_\infty$  (the free stream temperature of the external fluid) and  $\bar{h}$  is replaced by  $\bar{U}$  (the average overall heat transfer coefficient). For such cases, it follows that

$$\frac{\Delta T_o}{\Delta T_i} = \frac{T_\infty - T_{m,o}}{T_\infty - T_{m,i}} = \exp\left(-\frac{\bar{U}A_s}{\dot{m}c_p}\right) \quad (8.45a)$$

and

$$q = \bar{U}A_s\Delta T_{\text{lm}} \quad (8.46a)$$

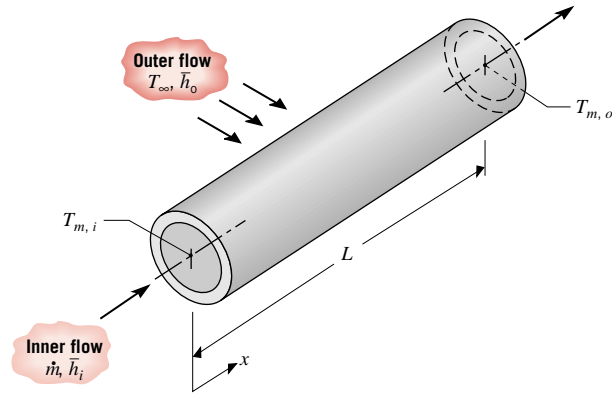

**FIGURE 8.8** Heat transfer between fluid flowing over a tube and fluid passing through the tube.

The overall heat transfer coefficient is defined in Section 3.3.1, and for this application it would include contributions due to convection at the tube inner and outer surfaces. For a thick-walled tube of small thermal conductivity, it would also include the effect of conduction across the tube wall. Note that the product  $\bar{U}A_s$  yields the same result, irrespective of whether it is defined in terms of the inner ( $\bar{U}_iA_{s,i}$ ) or outer ( $\bar{U}_oA_{s,o}$ ) surface areas of the tube (see Equation 3.32). Also note that  $(\bar{U}A_s)^{-1}$  is equivalent to the total thermal resistance between the two fluids, in which case Equations 8.45a and 8.46a may be expressed as

$$\frac{\Delta T_o}{\Delta T_i} = \frac{T_{\infty} - T_{m,o}}{T_{\infty} - T_{m,i}} = \exp\left(-\frac{1}{\dot{m}c_p R_{\text{tot}}}\right) \quad (8.45b)$$

and

$$q = \frac{\Delta T_{\text{lm}}}{R_{\text{tot}}} \quad (8.46b)$$

A common variation of the foregoing conditions is one for which the uniform temperature of an *outer* surface,  $T_{s,o}$ , rather than the free stream temperature of an external fluid,  $T_{\infty}$ , is known. In the foregoing equations,  $T_{\infty}$  is then replaced by  $T_{s,o}$ , and the total resistance embodies the convection resistance associated with the internal flow, as well as the total resistance due to conduction between the inner surface of the tube and the surface corresponding to  $T_{s,o}$ .

### EXAMPLE 8.3


Steam condensing on the outer surface of a thin-walled circular tube of diameter  $D = 50$  mm and length  $L = 6$  m maintains a uniform outer surface temperature of  $100^\circ\text{C}$ . Water flows through the tube at a rate of  $\dot{m} = 0.25$  kg/s, and its inlet and outlet temperatures are  $T_{m,i} = 15^\circ\text{C}$  and  $T_{m,o} = 57^\circ\text{C}$ . What is the average convection coefficient associated with the water flow?

**SOLUTION**

**Known:** Flow rate and inlet and outlet temperatures of water flowing through a tube of prescribed dimensions and surface temperature.

**Find:** Average convection heat transfer coefficient.

**Schematic:**

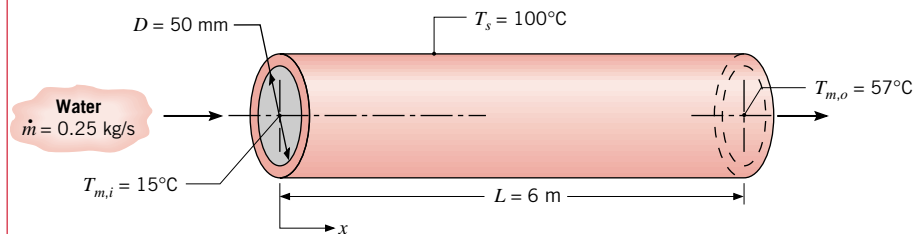

**Assumptions:**

1. Negligible tube wall conduction resistance.
2. Incompressible liquid and negligible viscous dissipation.
3. Constant properties.

**Properties:** Table A.6, water (36°C):  $c_p = 4178 \text{ J/kg} \cdot \text{K}$ .

**Analysis:** Combining the energy balance, Equation 8.34, with the rate equation, Equation 8.43, the average convection coefficient is given by

$$\bar{h} = \frac{\dot{m} c_p (T_{m,o} - T_{m,i})}{\pi D L \Delta T_{\text{lm}}}$$

From Equation 8.44

$$\Delta T_{\text{lm}} = \frac{(T_s - T_{m,o}) - (T_s - T_{m,i})}{\ln [(T_s - T_{m,o}) / (T_s - T_{m,i})]}$$

$$\Delta T_{\text{lm}} = \frac{(100 - 57) - (100 - 15)}{\ln [(100 - 57) / (100 - 15)]} = 61.6^\circ\text{C}$$

Hence

$$\bar{h} = \frac{0.25 \text{ kg/s} \times 4178 \text{ J/kg} \cdot \text{K} (57 - 15)^\circ\text{C}}{\pi \times 0.05 \text{ m} \times 6 \text{ m} \times 61.6^\circ\text{C}}$$

or

$$\bar{h} = 755 \text{ W/m}^2 \cdot \text{K}$$



**Comments:** If conditions were fully developed over the entire tube, the local convection coefficient would be everywhere equal to  $755 \text{ W/m}^2 \cdot \text{K}$ .

## 8.4

### Laminar Flow in Circular Tubes: Thermal Analysis and Convection Correlations

To use many of the foregoing results, the convection coefficients must be known. In this section we outline the manner in which such coefficients may be obtained theoretically for laminar flow in a circular tube. In subsequent sections we consider empirical correlations pertinent to turbulent flow in a circular tube, as well as to flows in tubes of noncircular cross section.

#### 8.4.1 The Fully Developed Region


Here, the problem of heat transfer in *laminar flow* of an *incompressible, constant property fluid* in the *fully developed region* of a *circular tube* is treated theoretically. The resulting temperature distribution is used to determine the convection coefficient.

A differential equation governing the temperature distribution is determined by applying the simplified, steady-flow, thermal energy equation, Equation 1.11e [ $q = \dot{m}c_p(T_{\text{out}} - T_{\text{in}})$ ], to the annular differential element of Figure 8.9. If we neglect the effects of net axial conduction, the heat input,  $q$ , is due only to conduction through the radial surfaces. Since the radial velocity is zero in the fully developed region, there is no advection of thermal energy through the radial control surfaces, and the only advection is in the axial direction. Thus, Equation 1.11e leads to Equation 8.47, which expresses a balance between radial conduction and axial advection:

$$q_r - q_{r+dr} = (\dot{m})c_p \left[ \left( T + \frac{\partial T}{\partial x} dx \right) - T \right] \quad (8.47a)$$

or

$$(\dot{m})c_p \frac{\partial T}{\partial x} dx = q_r - \left( q_r + \frac{\partial q_r}{\partial r} dr \right) = -\frac{\partial q_r}{\partial r} dr \quad (8.47b)$$

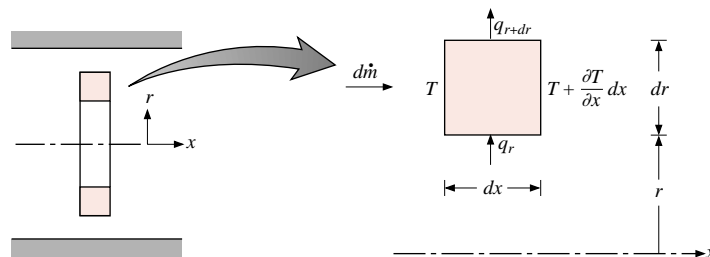

**FIGURE 8.9** Thermal energy balance on a differential element for laminar, fully developed flow in a circular tube.

The differential mass flow rate in the axial direction is  $d\dot{m} = \rho u 2\pi r dr$ , and the radial heat transfer rate is  $q_r = -k(\partial T/\partial r)2\pi r dx$ . If we assume constant properties, Equation 8.47b becomes

$$u \frac{\partial T}{\partial x} = \frac{\alpha}{r} \frac{\partial}{\partial r} \left( r \frac{\partial T}{\partial r} \right) \quad (8.48)$$

We will now proceed to solve for the temperature distribution for the case of *constant surface heat flux*. In this case, the assumption of negligible net axial conduction is exactly satisfied, that is,  $(\partial^2 T/\partial x^2) = 0$ . Substituting for the axial temperature gradient from Equation 8.32 and for the axial velocity component,  $u$ , from Equation 8.15, the energy equation, Equation 8.48, reduces to

$$\frac{1}{r} \frac{\partial}{\partial r} \left( r \frac{\partial T}{\partial r} \right) = \frac{2u_m}{\alpha} \left( \frac{dT_m}{dx} \right) \left[ 1 - \left( \frac{r}{r_o} \right)^2 \right] \quad q_s'' = \text{constant} \quad (8.49)$$

where  $T_m(x)$  varies linearly with  $x$  and  $(2u_m/\alpha)(dT_m/dx)$  is a constant. Separating variables and integrating twice, we obtain an expression for the radial temperature distribution:

$$T(r, x) = \frac{2u_m}{\alpha} \left( \frac{dT_m}{dx} \right) \left[ \frac{r^2}{4} - \frac{r^4}{16r_o^2} \right] + C_1 \ln r + C_2$$

The constants of integration may be evaluated by applying appropriate boundary conditions. From the requirement that the temperature remain finite at  $r = 0$ , it follows that  $C_1 = 0$ . From the requirement that  $T(r_o) = T_s$ , where  $T_s$  varies with  $x$ , it also follows that

$$C_2 = T_s(x) - \frac{2u_m}{\alpha} \left( \frac{dT_m}{dx} \right) \left( \frac{3r_o^2}{16} \right)$$

Accordingly, for the fully developed region with constant surface heat flux, the temperature profile is of the form

$$T(r, x) = T_s(x) - \frac{2u_m r_o^2}{\alpha} \left( \frac{dT_m}{dx} \right) \left[ \frac{3}{16} + \frac{1}{16} \left( \frac{r}{r_o} \right)^4 - \frac{1}{4} \left( \frac{r}{r_o} \right)^2 \right] \quad (8.50)$$

From knowledge of the temperature profile, all other thermal parameters may be determined. For example, if the velocity and temperature profiles, Equations 8.15 and 8.50, respectively, are substituted into Equation 8.26 and the integration over  $r$  is performed, the mean temperature is found to be

$$T_m(x) = T_s(x) - \frac{11}{48} \left( \frac{u_m r_o^2}{\alpha} \right) \left( \frac{dT_m}{dx} \right) \quad (8.51)$$

From Equation 8.39, where  $P = \pi D$  and  $\dot{m} = \rho u_m (\pi D^2/4)$ , we then obtain

$$T_m(x) - T_s(x) = -\frac{11}{48} \frac{q_s'' D}{k} \quad (8.52)$$

Combining Newton's law of cooling, Equation 8.27, and Equation 8.52, it follows that

$$h = \frac{48}{11} \left( \frac{k}{D} \right)$$

or

$$Nu_D \equiv \frac{hD}{k} = 4.36 \quad q_s'' = \text{constant} \quad (8.53)$$

Hence in a *circular tube* characterized by *uniform surface heat flux* and *laminar, fully developed conditions*, the *Nusselt number* is a *constant*, independent of  $Re_D$ ,  $Pr$ , and axial location.

For *laminar, fully developed conditions* with a *constant surface temperature*, the assumption of negligible axial conduction is often reasonable. Substituting for the velocity profile from Equation 8.15 and for the axial temperature gradient from Equation 8.33, the energy equation becomes

$$\frac{1}{r} \frac{\partial}{\partial r} \left( r \frac{\partial T}{\partial r} \right) = \frac{2u_m}{\alpha} \left( \frac{dT_m}{dx} \right) \left[ 1 - \left( \frac{r}{r_o} \right)^2 \right] \frac{T_s - T}{T_s - T_m} \quad T_s = \text{constant} \quad (8.54)$$


A solution to this equation may be obtained by an iterative procedure, which involves making successive approximations to the temperature profile. The resulting profile is not described by a simple algebraic expression, but the resulting Nusselt number may be shown to be [2]

$$Nu_D = 3.66 \quad T_s = \text{constant} \quad (8.55)$$

Note that in using Equation 8.53 or 8.55 to determine  $h$ , the thermal conductivity should be evaluated at  $T_m$ .

#### EXAMPLE 8.4

One concept used for solar energy collection involves placing a tube at the focal point of a parabolic reflector and passing a fluid through the tube.

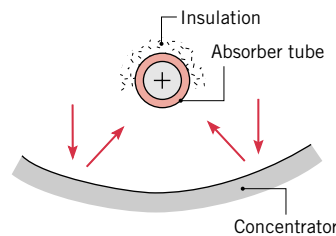

The net effect of this arrangement *may be approximated* as one of creating a condition of uniform heating at the surface of the tube. That is, the resulting heat flux to the fluid  $q_s''$  may be assumed to be a constant along the circumference and axis of the tube. Consider operation with a tube of diameter  $D = 60$  mm on a sunny day for which  $q_s'' = 2000$  W/m<sup>2</sup>.

1. If pressurized water enters the tube at  $\dot{m} = 0.01$  kg/s and  $T_{m,i} = 20^\circ\text{C}$ , what tube length  $L$  is required to obtain an exit temperature of  $80^\circ\text{C}$ ?
2. What is the surface temperature at the outlet of the tube, where fully developed conditions may be assumed to exist?




**SOLUTION**

**Known:** Internal flow with uniform surface heat flux.

**Find:**

1. Length of tube  $L$  to achieve required heating.
2. Surface temperature  $T_s(L)$  at the outlet section,  $x = L$ .

**Schematic:**

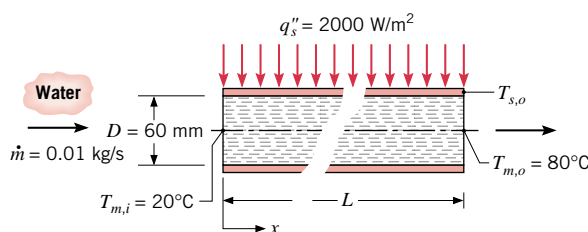

**Assumptions:**

1. Steady-state conditions.
2. Incompressible liquid and negligible viscous dissipation.
3. Constant properties.
4. Fully developed conditions at tube outlet.

**Properties:** Table A.6, water ( $\bar{T}_m = 323 \text{ K}$ ):  $c_p = 4181 \text{ J/kg} \cdot \text{K}$ . Table A.6, water ( $T_{m,o} = 353 \text{ K}$ ):  $k = 0.670 \text{ W/m} \cdot \text{K}$ ,  $\mu = 352 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ,  $Pr = 2.2$ .

**Analysis:**

1. For constant surface heat flux, Equation 8.38 may be used with the energy balance, Equation 8.34, to obtain

$$A_s = \pi DL = \frac{\dot{m}c_p(T_{m,o} - T_{m,i})}{q_s''}$$

$$L = \frac{\dot{m}c_p}{\pi D q_s''}(T_{m,o} - T_{m,i})$$

Hence

$$L = \frac{0.01 \text{ kg/s} \times 4181 \text{ J/kg} \cdot \text{K}}{\pi \times 0.060 \text{ m} \times 2000 \text{ W/m}^2} (80 - 20)^\circ\text{C} = 6.65 \text{ m} \quad \triangleleft$$

2. The surface temperature at the outlet may be obtained from Newton's law of cooling, Equation 8.27, where

$$T_{s,o} = \frac{q_s''}{h} + T_{m,o}$$

To find the local convection coefficient at the tube outlet, the nature of the flow condition must first be established. From Equation 8.6,

$$Re_D = \frac{4\dot{m}}{\pi D \mu} = \frac{4 \times 0.01 \text{ kg/s}}{\pi \times 0.060 \text{ m} \times 352 \times 10^{-6} \text{ N} \cdot \text{s/m}^2} = 603$$

Hence the flow is laminar. With the assumption of fully developed conditions, the appropriate heat transfer correlation is then

$$Nu_D = \frac{hD}{k} = 4.36$$

and

$$h = 4.36 \frac{k}{D} = 4.36 \frac{0.670 \text{ W/m} \cdot \text{K}}{0.06 \text{ m}} = 48.7 \text{ W/m}^2 \cdot \text{K}$$

The surface temperature at the tube outlet is then

$$T_{s,o} = \frac{2000 \text{ W/m}^2}{48.7 \text{ W/m}^2 \cdot \text{K}} + 80^\circ\text{C} = 121^\circ\text{C}$$

**Comments:** For the conditions given,  $(x_{fd}/D) = 0.05 Re_D Pr = 66.3$ , while  $L/D = 110$ . Hence the assumption of fully developed conditions is justified. Note, however, that with  $T_{s,o} > 100^\circ\text{C}$ , boiling may occur at the tube surface.

### EXAMPLE 8.5

In the human body, blood flows from the heart in a series of branching blood vessels having successively smaller diameters. The capillaries are the smallest blood vessels. In developing the bioheat equation (Section 3.7), Pennes assumed that blood enters the capillaries at the arterial temperature and exits at the temperature of the surrounding tissue. This problem tests that assumption [5,6]. The diameters and average blood velocities for three different types of blood vessels are given in the table below. For each of these blood vessels, estimate the length required for the mean blood temperature to closely approach the tissue temperature, specifically, to satisfy  $(T_t - T_{m,o})/(T_t - T_{m,i}) = 0.05$ . The heat transfer between the vessel wall and surrounding tissue can be approximated by an effective heat transfer coefficient,  $h_t = k_t/D$ , where  $k_t = 0.5 \text{ W/m} \cdot \text{K}$ .


Vessel	Diameter, $D$ (mm)	Blood Velocity, $u_m$ (mm/s)
Large artery	3	130
Arteriole	0.02	3
Capillary	0.008	0.7

### SOLUTION

**Known:** Blood vessel diameter and average blood velocity. Tissue thermal conductivity and effective heat transfer coefficient.

**Find:** Length of blood vessel needed to satisfy  $(T_t - T_{m,o})/(T_t - T_{m,i}) = 0.05$ .

**Schematic:**

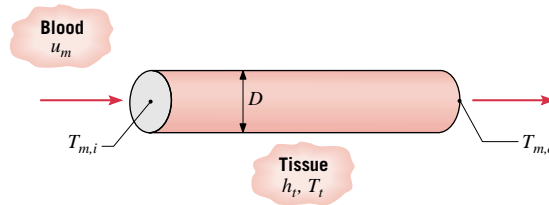

**Assumptions:**

1. Steady-state conditions.
2. Constant properties.
3. Negligible blood vessel wall thermal resistance.
4. Thermal properties of blood can be approximated by those of water.
5. Blood is incompressible liquid with negligible viscous dissipation.
6. Tissue temperature is fixed.
7. Effects of pulsation of flow are negligible.

**Properties:** Table A.6, water ( $\bar{T}_m = 310$  K)  $\rho = \nu_f^{-1} = 993$  kg/m<sup>3</sup>,  $c_p = 4178$  J/kg · K,  $\mu = 695 \times 10^{-6}$  N · s/m<sup>2</sup>,  $k = 0.628$  W/m · K,  $Pr = 4.62$ .

**Analysis:** Since the tissue temperature is fixed and heat transfer between the blood vessel wall and the tissue can be represented by an effective heat transfer coefficient, Equation 8.45a is applicable, with the “free stream” temperature equal to the tissue temperature,  $T_t$ . This equation can be used to find the required length  $L$ , since  $A_s = \pi DL$ . However, we must first find  $\bar{U}$ , which requires knowledge of the heat transfer coefficient for the blood flow,  $h_b$ . Taking the large artery as an example, the Reynolds number is given by

$$Re_D = \frac{\rho u_m D}{\mu} = \frac{993 \text{ kg/m}^3 \times 130 \times 10^{-3} \text{ m/s} \times 3 \times 10^{-3} \text{ m}}{695 \times 10^{-6} \text{ N} \cdot \text{s/m}^2} = 557$$

so the flow is laminar. Since the other blood vessels have smaller diameters and velocities, their flows will also be laminar. Because we don’t yet know the length of the vessel, we don’t know whether the flow becomes fully developed. However, we will begin by assuming fully developed conditions. Moreover, because the situation is neither one of constant surface temperature nor constant surface heat flux, we will estimate the required length by approximating the Nusselt number as  $Nu \approx 4$ , in which case  $h_b = 4k_b/D$ . Neglecting the thermal resistance of the vessel wall, for the large artery

$$\begin{aligned} \frac{1}{\bar{U}} &= \frac{1}{h_b} + \frac{1}{h_t} = \frac{D}{4k_b} + \frac{D}{k_t} = \frac{3 \times 10^{-3} \text{ m}}{4 \times 0.628 \text{ W/m} \cdot \text{K}} + \frac{3 \times 10^{-3} \text{ m}}{0.5 \text{ W/m} \cdot \text{K}} \\ &= 7.2 \times 10^{-3} \text{ m}^2 \cdot \text{K/W} \end{aligned}$$

or

$$\bar{U} = 140 \text{ W/m}^2 \cdot \text{K}$$

The length can then be found by solving Equation 8.45a, with  $\dot{m} = \rho u_m \pi D^2/4$ :

$$\begin{aligned} L &= -\frac{\rho u_m D c_p}{4 \bar{U}} \ln \left( \frac{T_t - T_{m,o}}{T_t - T_{m,i}} \right) \\ &= -\frac{993 \text{ kg/m}^3 \times 130 \times 10^{-3} \text{ m/s} \times 3 \times 10^{-3} \text{ m} \times 4178 \text{ J/kg} \cdot \text{K}}{4 \times 140 \text{ W/m}^2 \cdot \text{K}} \ln(0.05) \\ &= 8.7 \text{ m} \end{aligned}$$

We can now test the assumption that the flow is hydrodynamically and thermally fully developed, using Equations 8.3 and 8.23:

$$x_{fd,h} = 0.05 Re_D D = 0.05 \times 557 \times 3 \times 10^{-3} \text{ m} = 0.08 \text{ m}$$

$$x_{fd,t} = x_{fd,h} Pr = 0.08 \text{ m} \times 4.62 = 0.4 \text{ m}$$

The flow would indeed be fully developed well within the length of 8.7 m. The calculations can be repeated for the other two cases and are tabulated below.

Vessel	$Re_D$	$\bar{U}$ (W/m <sup>2</sup> · K)	$L$ (m)	$x_{fd,h}$ (m)	$x_{fd,t}$ (m)
Large artery	557	140	8.7	0.08	0.4
Arteriole	0.086	21,000	$8.9 \times 10^{-6}$	$9 \times 10^{-8}$	$4 \times 10^{-7}$
Capillary	0.0080	52,000	$3.3 \times 10^{-7}$	$3 \times 10^{-9}$	$1 \times 10^{-8}$


### Comments:

1. The blood temperature in the large artery approaches the tissue temperature very slowly. This is due to its relatively large diameter, which leads to a small overall heat transfer coefficient. Thus, the temperature in large arteries remains close to the inlet arterial blood temperature.
2. In arterioles, the blood temperature comes close to the tissue temperature within a length on the order of 10  $\mu\text{m}$ . Since arterioles are on the order of millimeters in length, the blood temperature exiting them would be essentially the same as the tissue temperature. There would then be no further temperature drop in the capillaries, which are the next smallest vessel. Thus, it is in the arterioles and slightly larger vessels in which the blood temperature equilibrates to the tissue temperature, not in the capillaries as Pennes described. Despite this flaw, the bioheat equation has proved a useful tool in analyzing heat transfer in the human body.
3. The properties of blood are moderately close to those of water. The property which differs most is the viscosity, as blood is more viscous than water. However, that change would have no effect on the foregoing calculations. Since the Reynolds number would be even smaller, the flow would still be laminar and the heat transfer would be unaffected.
4. Individual blood cells have dimensions on the order of the capillary diameter. Thus, for the capillaries, an accurate model of blood flow would account for the individual cells surrounded by plasma.

### 8.4.2 The Entry Region

The energy equation for the entry region is more complicated than Equation 8.48 because there would be a radial advection term (since  $v \neq 0$  in the entry region). In addition, both velocity and temperature now depend on  $x$ , as well as  $r$ , and the axial temperature gradient  $\partial T/\partial x$  may no longer be simplified through Equation 8.32 or 8.33. However, two different entry length solutions have been obtained. The simplest solution is for the *thermal entry length problem*, and it is based on assuming that thermal conditions develop in the presence of a *fully developed velocity profile*. Such a situation would exist if the location at which heat transfer begins were preceded by an *unheated starting length*. It could also be assumed to a reasonable approximation for large Prandtl number fluids, such as oils. Even in the absence of an unheated starting length, velocity boundary layer development would occur far more rapidly than thermal boundary layer development for large Prandtl number fluids, and a thermal entry length approximation could be made. In contrast, the *combined* (thermal and velocity) *entry length problem* corresponds to the case for which the temperature and velocity profiles develop simultaneously.

Solutions have been obtained for both entry length conditions [2], and selected results are shown in Figure 8.10. As evident in Figure 8.10a, local Nusselt numbers,  $Nu_D$ , are, in principle, infinite at  $x = 0$  and decay to their asymptotic (fully developed) values with increasing  $x$ . When plotted against the dimensionless parameter

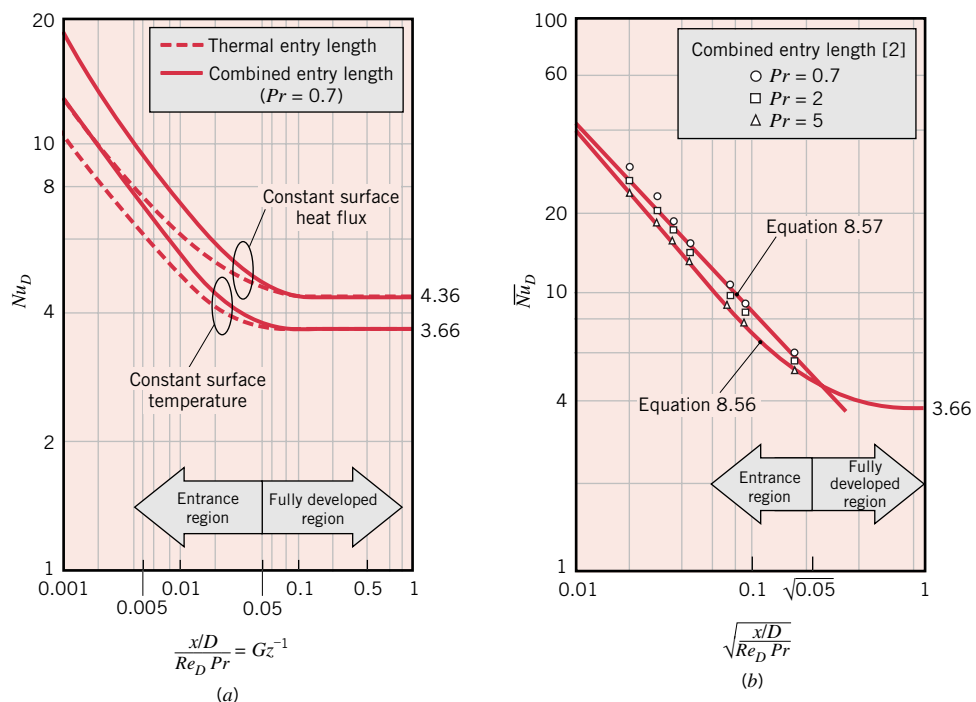

**FIGURE 8.10** Results obtained from entry length solutions for laminar flow in a circular tube: (a) local Nusselt numbers and (b) average Nusselt numbers [2].

$x\alpha/(u_m D^2) = x/(D Re_D Pr)$ , which is the reciprocal of the *Graetz* number,  $Gz_D \equiv (D/x) Re_D Pr$ , the manner in which  $Nu_D$  varies with  $Gz_D^{-1}$  is independent of  $Pr$  for the thermal entry problem, since the fully developed velocity profile, given by Equation 8.13, is independent of the fluid viscosity. In contrast, for the combined entry length problem, results depend on the manner in which the velocity distribution develops, which is highly sensitive to the fluid viscosity. Hence, heat transfer results depend on the Prandtl number for the combined entry length case and are presented in Figure 8.10a for  $Pr = 0.7$ , which is representative of most gases. At any location within the entry region,  $Nu_D$  decreases with increasing  $Pr$  and approaches the thermal entry length condition as  $Pr \rightarrow \infty$ . Note that fully developed conditions are reached for  $[(x/D)/Re_D Pr] \approx 0.05$ .

For the *constant surface temperature* condition, it is desirable to know the *average* convection coefficient for use with Equation 8.43. Kays [7] presents a correlation attributed to Hausen [8], which is of the form

$$\overline{Nu}_D = 3.66 + \frac{0.0668(D/L)Re_D Pr}{1 + 0.04[(D/L)Re_D Pr]^{2/3}} \quad (8.56)$$

$\left[ \begin{array}{l} \text{thermal entrance length} \\ \text{or} \\ \text{combined entrance length with } Pr \gtrsim 5 \end{array} \right]$

where  $\overline{Nu}_D \equiv \bar{h}D/k$ . Because this result is for the thermal entry length problem, it is applicable to all situations where the velocity profile is already fully developed. For the combined entry length, a suitable correlation for use at moderate Prandtl numbers, due to Sieder and Tate [9], is of the form

$$\overline{Nu}_D = 1.86 \left( \frac{Re_D Pr}{L/D} \right)^{1/3} \left( \frac{\mu}{\mu_s} \right)^{0.14} \quad (8.57)$$

$$0.60 \leq Pr \leq 5$$

$$0.0044 \leq \left( \frac{\mu}{\mu_s} \right) \leq 9.75$$

Equation 8.57 is recommended for use when  $0.60 \leq Pr \leq 5$ , provided  $\overline{Nu}_D \geq 3.66$  [2, 10]. If  $\overline{Nu}_D$  falls below this value, it is reasonable to use  $\overline{Nu}_D = 3.66$ , since fully developed conditions then encompass much of the tube. For larger Prandtl numbers ( $Pr \gtrsim 5$ ), hydrodynamic conditions develop much faster than thermal conditions, and Equation 8.56 is recommended instead of Equation 8.57 [2]. Equations 8.56 and 8.57, along with numerical predictions of  $\overline{Nu}_D$  versus  $\sqrt{x/(D Re_D Pr)}$  and  $Pr$ , are shown in Figure 8.10b. All properties appearing in Equations 8.56 and 8.57, except  $\mu_s$ , should be evaluated at the average value of the mean temperature,  $\bar{T}_m = (T_{m,i} + T_{m,o})/2$ .

The subject of laminar flow in ducts has been studied extensively, and numerous results are available for a variety of duct cross sections and surface conditions. These results have been compiled in a monograph by Shah and London [11] and in an updated review by Shah and Bhatti [12].

## 8.5

### Convection Correlations: Turbulent Flow in Circular Tubes

Since the analysis of turbulent flow conditions is a good deal more involved, greater emphasis is placed on determining empirical correlations. A classical expression for computing the *local* Nusselt number for *fully developed* (hydrodynamically and thermally) turbulent flow in a *smooth circular tube* is due to Colburn [13] and may be obtained from the Chilton–Colburn analogy. Substituting Equation 6.70 into Equation 8.18, the analogy is of the form

$$\frac{C_f}{2} = \frac{f}{8} = St Pr^{2/3} = \frac{Nu_D}{Re_D Pr} Pr^{2/3} \quad (8.58)$$

Substituting for the friction factor from Equation 8.21, the *Colburn equation* is then

$$Nu_D = 0.023 Re_D^{4/5} Pr^{1/3} \quad (8.59)$$

The *Dittus–Boelter equation* [14] is a slightly different and preferred version of the above result and is of the form<sup>1</sup>

$$Nu_D = 0.023 Re_D^{4/5} Pr^n \quad (8.60)$$

where  $n = 0.4$  for heating ( $T_s > T_m$ ) and  $0.3$  for cooling ( $T_s < T_m$ ). These equations have been confirmed experimentally for the range of conditions

$$\left[ \begin{array}{l} 0.7 \leq Pr \leq 160 \\ Re_D \geq 10,000 \\ \frac{L}{D} \geq 10 \end{array} \right]$$

The equations may be used for small to moderate temperature differences,  $T_s - T_m$ , with all properties evaluated at  $T_m$ . For flows characterized by large property variations, the following equation, due to Sieder and Tate [9], is recommended:

$$Nu_D = 0.027 Re_D^{4/5} Pr^{1/3} \left( \frac{\mu}{\mu_s} \right)^{0.14} \quad (8.61)$$

$$\left[ \begin{array}{l} 0.7 \leq Pr \leq 16,700 \\ Re_D \geq 10,000 \\ \frac{L}{D} \geq 10 \end{array} \right]$$

<sup>1</sup>Although it has become common practice to refer to Equation 8.60 as the *Dittus–Boelter equation*, the original Dittus–Boelter equations are actually of the form

$$Nu_D = 0.0243 Re_D^{4/5} Pr^{0.4} \quad (\text{Heating})$$

$$Nu_D = 0.0265 Re_D^{4/5} Pr^{0.3} \quad (\text{Cooling})$$

The historical origins of Equation 8.60 are discussed by Winterton [14].

where all properties except  $\mu_s$  are evaluated at  $T_m$ . To a good approximation, the foregoing correlations may be applied for both the uniform surface temperature and heat flux conditions.

Although Equations 8.60 and 8.61 are easily applied and are certainly satisfactory for the purposes of this text, errors as large as 25% may result from their use. Such errors may be reduced to less than 10% through the use of more recent, but generally more complex, correlations [4, 15]. One correlation, valid over a large Reynolds number range including the transition region, is provided by Gnielinski [16]:

$$Nu_D = \frac{(f/8)(Re_D - 1000)Pr}{1 + 12.7(f/8)^{1/2}(Pr^{2/3} - 1)} \quad (8.62)$$

where the friction factor may be obtained from the Moody diagram, or, for smooth tubes, from Equation 8.21. The correlation is valid for  $0.5 \leq Pr \leq 2000$  and  $3000 \leq Re_D \leq 5 \times 10^6$ . In using Equation 8.62, which applies for both uniform surface heat flux and temperature, properties should be evaluated at  $T_m$ . If temperature differences are large, additional consideration must be given to variable-property effects and available options are reviewed by Kakac [17].

We note that, unless specifically developed for the transition region ( $2300 < Re_D < 10^4$ ), caution should be exercised when applying a turbulent flow correlation for  $Re_D < 10^4$ . If the correlation was developed for fully turbulent conditions ( $Re_D > 10^4$ ), it may be used as a first approximation at smaller Reynolds numbers, with the understanding that the convection coefficient will be overpredicted. If a higher level of accuracy is desired, the Gnielinski correlation, Equation 8.62, may be used. A comprehensive discussion of heat transfer in the transition region is provided by Ghajar and Tam [18].

We also note that Equations 8.59 through 8.62 pertain to smooth tubes. For turbulent flow, the heat transfer coefficient increases with wall roughness, and, as a first approximation, it may be computed by using Equation 8.62 with friction factors obtained from the Moody diagram, Figure 8.3. However, although the general trend is one of increasing  $h$  with increasing  $f$ , the increase in  $f$  is proportionately larger, and when  $f$  is approximately four times larger than the corresponding value for a smooth surface,  $h$  no longer changes with additional increases in  $f$  [19]. Procedures for estimating the effect of wall roughness on convection heat transfer in fully developed turbulent flow are discussed by Bhatti and Shah [15].

Since entry lengths for turbulent flow are typically short,  $10 \leq (x_{fd}/D) \leq 60$ , it is often reasonable to assume that the average Nusselt number for the entire tube is equal to the value associated with the fully developed region,  $\overline{Nu}_D \approx Nu_{D,fd}$ . However, for short tubes  $\overline{Nu}_D$  will exceed  $Nu_{D,fd}$  and may be calculated from an expression of the form

$$\frac{\overline{Nu}_D}{Nu_{D,fd}} = 1 + \frac{C}{(x/D)^m} \quad (8.63)$$

where  $C$  and  $m$  depend on the nature of the inlet (e.g., sharp-edged or nozzle) and entry region (thermal or combined), as well as on the Prandtl and Reynolds numbers [2, 15, 20]. Typically, errors of less than 15% are associated with assuming



$\overline{Nu}_D = Nu_{D,fd}$  for  $(L/D) > 60$ . When determining  $\overline{Nu}_D$ , all fluid properties should be evaluated at the arithmetic average of the mean temperature,  $\overline{T}_m \equiv (T_{m,i} + T_{m,o})/2$ .

Finally, we note that the foregoing correlations do not apply to liquid metals ( $3 \times 10^{-3} \leq Pr \leq 5 \times 10^{-2}$ ). For fully developed turbulent flow in smooth circular tubes with constant surface heat flux, Skupinski et al. [21] recommend a correlation of the form

$$Nu_D = 4.82 + 0.0185 Pe_D^{0.827} \quad q_s'' = \text{constant} \quad (8.64)$$

$$\left[ \begin{array}{l} 3.6 \times 10^3 \leq Re_D \leq 9.05 \times 10^5 \\ 10^2 \leq Pe_D \leq 10^4 \end{array} \right]$$

Similarly, for constant surface temperature Seban and Shimazaki [22] recommend the following correlation for  $Pe_D \geq 100$ :

$$Nu_D = 5.0 + 0.025 Pe_D^{0.8} \quad T_s = \text{constant} \quad (8.65)$$

Extensive data and additional correlations are available in the literature [23].

### EXAMPLE 8.6

Hot air flows with a mass rate of  $\dot{m} = 0.050$  kg/s through an uninsulated sheet metal duct of diameter  $D = 0.15$  m, which is in the crawlspace of a house. The hot air enters at  $103^\circ\text{C}$  and, after a distance of  $L = 5$  m, cools to  $77^\circ\text{C}$ . The heat transfer coefficient between the duct outer surface and the ambient air at  $T_\infty = 0^\circ\text{C}$  is known to be  $h_o = 6$  W/m<sup>2</sup> · K.

1. Calculate the heat loss (W) from the duct over the length  $L$ .
2. Determine the heat flux and the duct surface temperature at  $x = L$ .


### SOLUTION

**Known:** Hot air flowing in a duct.

**Find:**

1. Heat loss from the duct over the length  $L$ ,  $q$  (W).
2. Heat flux and surface temperature at  $x = L$ .

**Schematic:**

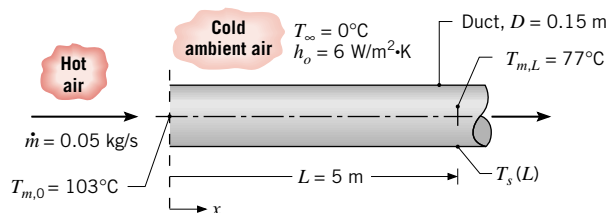

**Assumptions:**

1. Steady-state conditions.
2. Constant properties.

3. Ideal gas behavior.
4. Negligible viscous dissipation and negligible pressure variations.
5. Negligible duct wall thermal resistance.
6. Uniform convection coefficient at outer surface of duct.

**Properties:** Table A.4, air ( $\bar{T}_m = 363$  K):  $c_p = 1010$  J/kg · K. Table A.4, air ( $T_{m,L} = 350$  K):  $k = 0.030$  W/m · K,  $\mu = 208.2 \times 10^{-7}$  N · s/m<sup>2</sup>,  $Pr = 0.70$ .


**Analysis:**

1. From the energy balance for the entire tube, Equation 8.34,

$$q = \dot{m}c_p(T_{m,L} - T_{m,0})$$

$$q = 0.05 \text{ kg/s} \times 1010 \text{ J/kg} \cdot \text{K} (77 - 103)^\circ\text{C} = -1313 \text{ W}$$

2. An expression for the heat flux at  $x = L$  may be inferred from the resistance network



where  $h_x(L)$  is the inside convection heat transfer coefficient at  $x = L$ . Hence

$$q_s''(L) = \frac{T_{m,L} - T_{\infty}}{[1/h_x(L)] + (1/h_o)}$$

The inside convection coefficient may be obtained from knowledge of the Reynolds number. From Equation 8.6

$$Re_D = \frac{4\dot{m}}{\pi D \mu} = \frac{4 \times 0.05 \text{ kg/s}}{\pi \times 0.15 \text{ m} \times 208.2 \times 10^{-7} \text{ N} \cdot \text{s/m}^2} = 20,384$$

Hence the flow is turbulent. Moreover, with  $(L/D) = (5/0.15) = 33.3$ , it is reasonable to assume fully developed conditions at  $x = L$ . Hence from Equation 8.60, with  $n = 0.3$ ,

$$Nu_D = \frac{h_x(L)D}{k} = 0.023 Re_D^{4/5} Pr^{0.3} = 0.023(20,384)^{4/5} (0.70)^{0.3} = 57.9$$

$$h_x(L) = Nu_D \frac{k}{D} = 57.9 \frac{0.030 \text{ W/m} \cdot \text{K}}{0.15 \text{ m}} = 11.6 \text{ W/m}^2 \cdot \text{K}$$

Hence

$$q_s''(L) = \frac{(77 - 0)^\circ\text{C}}{[(1/11.6) + (1/6.0)] \text{ m}^2 \cdot \text{K/W}} = 304.5 \text{ W/m}^2$$

Referring back to the network, it also follows that

$$q_s''(L) = \frac{T_{m,L} - T_{s,L}}{1/h_x(L)}$$

in which case

$$T_{s,L} = T_{m,L} - \frac{q_s''(L)}{h_x(L)} = 77^\circ\text{C} - \frac{304.5 \text{ W/m}^2}{11.6 \text{ W/m}^2 \cdot \text{K}} = 50.7^\circ\text{C}$$

**Comments:**

1. In using the energy balance of part 1 for the entire tube, properties (in this case, only  $c_p$ ) are evaluated at  $\bar{T}_m = (T_{m,0} + T_{m,L})/2$ . However, in using the correlation for a local heat transfer coefficient, Equation 8.60, properties are evaluated at the local mean temperature,  $T_{m,L} = 77^\circ\text{C}$ .
2. This problem is characterized neither by constant surface temperature nor by constant surface heat flux. It would therefore be erroneous to presume that the total heat loss from the tube is given by  $q_s''(L)\pi DL = 717\text{ W}$ . This result is substantially less than the actual heat loss of 1313 W because  $q_s''(x)$  decreases with increasing  $x$ . This decrease in  $q_s''(x)$  is due to reductions in both  $h_x(x)$  and  $[T_m(x) - T_\infty]$  with increasing  $x$ .

**8.6****Convection Correlations: Noncircular Tubes and the Concentric Tube Annulus**

Although we have thus far restricted our consideration to internal flows of circular cross section, many engineering applications involve convection transport in *noncircular tubes*. At least to a first approximation, however, many of the circular tube results may be applied by using *an effective diameter* as the characteristic length. It is termed the *hydraulic diameter* and is defined as

$$D_h \equiv \frac{4A_c}{P} \quad (8.66)$$












where  $A_c$  and  $P$  are the *flow* cross-sectional area and the *wetted perimeter*, respectively. It is this diameter that should be used in calculating parameters such as  $Re_D$  and  $Nu_D$ .

For turbulent flow, which still occurs if  $Re_D \gtrsim 2300$ , it is reasonable to use the correlations of Section 8.5 for  $Pr \gtrsim 0.7$ . However, in a noncircular tube the convection coefficients vary around the periphery, approaching zero in the corners. Hence in using a circular tube correlation, the coefficient is presumed to be an average over the perimeter.

For laminar flow, the use of circular tube correlations is less accurate, particularly with cross sections characterized by sharp corners. For such cases the Nusselt number corresponding to fully developed conditions may be obtained from Table 8.1, which is based on solutions of the differential momentum and energy equations for flow through the different duct cross sections. As for the circular tube, results differ according to the surface thermal condition. Nusselt numbers tabulated for a uniform surface heat flux presume a constant flux in the axial (flow) direction, but a constant temperature around the perimeter at any cross section. This condition is typical of highly conductive tube wall materials. Results tabulated for a uniform surface temperature apply when the temperature is constant in both the axial and peripheral directions.


Although the foregoing procedures are generally satisfactory, exceptions do exist. Detailed discussions of heat transfer in noncircular tubes are provided in several sources [11, 12, 24].

**TABLE 8.1** Nusselt numbers and friction factors for fully developed laminar flow in tubes of differing cross section

Cross Section	$\frac{b}{a}$	$Nu_D \equiv \frac{hD_h}{k}$		$f Re_{D_h}$
		(Uniform $q_s''$ )	(Uniform $T_s$ )	
	—	4.36	3.66	64
	1.0	3.61	2.98	57
	1.43	3.73	3.08	59
	2.0	4.12	3.39	62
	3.0	4.79	3.96	69
	4.0	5.33	4.44	73
	8.0	6.49	5.60	82
	$\infty$	8.23	7.54	96
	$\infty$	5.39	4.86	96
	$\infty$	5.39	4.86	96
	—	3.11	2.49	53

Used with permission from W. M. Kays and M. E. Crawford, *Convection Heat and Mass Transfer*, 3rd ed. McGraw-Hill, New York, 1993.

Many internal flow problems involve heat transfer in a *concentric tube annulus* (Figure 8.11). Fluid passes through the space (annulus) formed by the concentric tubes, and convection heat transfer may occur to or from both the inner and outer tube surfaces. It is possible to independently specify the heat flux or temperature,

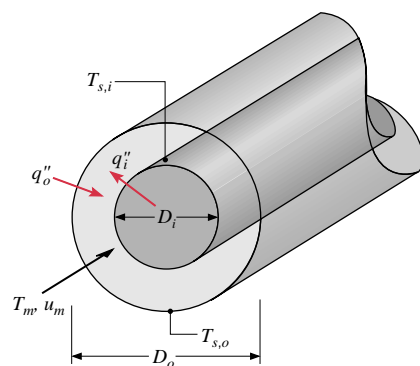

**FIGURE 8.11**  
The concentric tube annulus.

that is, the thermal condition, at each of these surfaces. In any case the heat flux from each surface may be computed with expressions of the form

$$q_i'' = h_i(T_{s,i} - T_m) \quad (8.67)$$

$$q_o'' = h_o(T_{s,o} - T_m) \quad (8.68)$$

Note that separate convection coefficients are associated with the inner and outer surfaces. The corresponding Nusselt numbers are of the form

$$Nu_i \equiv \frac{h_i D_h}{k} \quad (8.69)$$

$$Nu_o \equiv \frac{h_o D_h}{k} \quad (8.70)$$

where, from Equation 8.66, the hydraulic diameter  $D_h$  is

$$D_h = \frac{4(\pi/4)(D_o^2 - D_i^2)}{\pi D_o + \pi D_i} = D_o - D_i \quad (8.71)$$

For the case of fully developed laminar flow with one surface insulated and the other surface at a constant temperature,  $Nu_i$  or  $Nu_o$  may be obtained from Table 8.2. Note that in such cases we would be interested only in the convection coefficient associated with the isothermal (nonadiabatic) surface.

If uniform heat flux conditions exist at both surfaces, the Nusselt numbers may be computed from expressions of the form

$$Nu_i = \frac{Nu_{ii}}{1 - (q_o''/q_i'')\theta_i^*} \quad (8.72)$$

$$Nu_o = \frac{Nu_{oo}}{1 - (q_i''/q_o'')\theta_o^*} \quad (8.73)$$

The influence coefficients ( $Nu_{ii}$ ,  $Nu_{oo}$ ,  $\theta_i^*$ , and  $\theta_o^*$ ) appearing in these equations may be obtained from Table 8.3. Note that  $q_i''$  and  $q_o''$  may be positive or negative, depending on whether heat transfer is to or from the fluid, respectively. Moreover, situations may arise for which the values of  $h_i$  and  $h_o$  are negative. Such results,

**TABLE 8.2** Nusselt number for fully developed laminar flow in a circular tube annulus with one surface insulated and the other at constant temperature

$D_i/D_o$	$Nu_i$	$Nu_o$	Comments
0	—	3.66	See Equation 8.55
0.05	17.46	4.06	
0.10	11.56	4.11	
0.25	7.37	4.23	
0.50	5.74	4.43	
$\approx 1.00$	4.86	4.86	See Table 8.1, $b/a \rightarrow \infty$

Used with permission from W. M. Kays and H. C. Perkins, in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, Chap. 7, McGraw-Hill, New York, 1972.

**TABLE 8.3** Influence coefficients for fully developed laminar flow in a circular tube annulus with uniform heat flux maintained at both surfaces

$D_i/D_o$	$Nu_{ii}$	$Nu_{oo}$	$\theta_i^*$	$\theta_o^*$
0	—	4.364	$\infty$	0
0.05	17.81	4.792	2.18	0.0294
0.10	11.91	4.834	1.383	0.0562
0.20	8.499	4.833	0.905	0.1041
0.40	6.583	4.979	0.603	0.1823
0.60	5.912	5.099	0.473	0.2455
0.80	5.58	5.24	0.401	0.299
1.00	5.385	5.385	0.346	0.346

Used with permission from W. M. Kays and H. C. Perkins, in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, Chap. 7, McGraw-Hill, New York, 1972.

when used with the sign convention implicit in Equations 8.67 and 8.68, reveal the relative magnitudes of  $T_s$  and  $T_m$ .


For fully developed turbulent flow, the influence coefficients are a function of the Reynolds and Prandtl numbers [24]. However, to a first approximation the inner and outer convection coefficients may be assumed to be equal, and they may be evaluated by using the hydraulic diameter, Equation 8.71, with the Dittus–Boelter equation, Equation 8.60.

## 8.7

### Heat Transfer Enhancement


Several options are available for enhancing heat transfer associated with internal flows. Enhancement may be achieved by increasing the convection coefficient and/or by increasing the convection surface area. For example,  $h$  may be increased by introducing surface roughness to enhance turbulence, as, for example, through machining or insertion of a coil-spring wire. The wire insert (Figure 8.12a) provides a helical roughness element in contact with the tube inner surface. Alternatively, the convection coefficient may be increased by inducing swirl through insertion of a twisted tape (Figure 8.12b). The insert consists of a thin strip that is periodically twisted through  $360^\circ$ . Introduction of a tangential velocity component increases the speed of the flow, particularly near the tube wall. The heat transfer area may be increased by manufacturing a tube with a grooved inner surface (Figure 8.12c), while both the convection coefficient and area may be increased by using spiral fins or ribs (Figure 8.12d). In evaluating any heat transfer enhancement scheme, attention must also be given to the attendant increase in pressure drop and hence fan or pump power requirements. Comprehensive assessments of enhancement options have been published [25–28], and the *Journal of Enhanced Heat Transfer* provides access to recent developments in the field.

By coiling a tube (Figure 8.13), heat transfer may be enhanced without turbulence or additional heat transfer surface area. In this case, centrifugal forces within

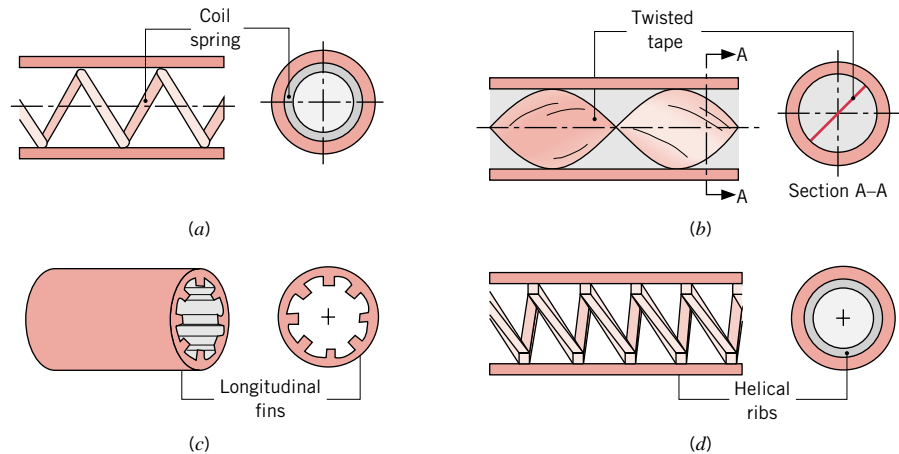

**FIGURE 8.12** Internal flow heat transfer enhancement schemes: (a) longitudinal section and end view of coil-spring wire insert, (b) longitudinal section and cross-sectional view of twisted tape insert, (c) cut-away section and end view of longitudinal fins, and (d) longitudinal section and end view of helical ribs.

the fluid induce a *secondary flow* consisting of a pair of longitudinal vortices that, in contrast to conditions in a straight tube, can result in highly nonuniform local heat transfer coefficients around the periphery of the tube. Hence, local heat transfer coefficients vary with  $\theta$  as well as  $x$ . If constant heat flux conditions are applied, the mean fluid temperature,  $T_m(x)$ , may be calculated using the conservation of energy principle, Equation 8.40. For situations where the fluid is heated, maximum fluid temperatures occur at the tube wall, but calculation of the maximum local temperature is not straightforward because of the  $\theta$ -dependence of the heat transfer coefficient. Therefore, correlations for the *peripherally averaged* Nusselt number are of little use if constant heat flux conditions are applied. In contrast, correlations for the peripherally averaged Nusselt number for constant wall temperature boundary conditions are useful, and the relationships recommended by Shah and Joshi [29] are provided in the next paragraphs.

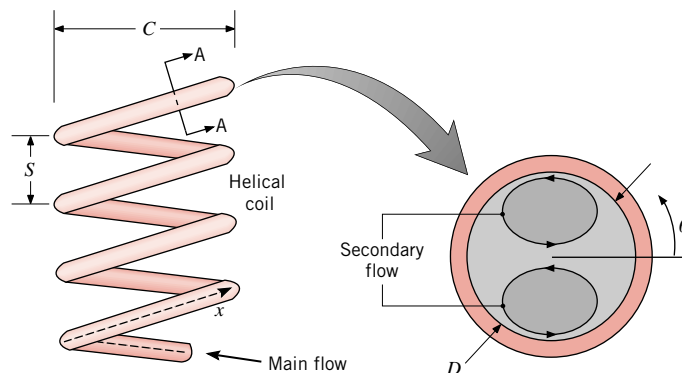

**FIGURE 8.13** Schematic of helically coiled tube and secondary flow in enlarged cross-sectional view.

The secondary flow increases friction losses and heat transfer rates. In addition, the secondary flow decreases entrance lengths and reduces the difference between laminar and turbulent heat transfer rates, relative to the straight tube cases considered previously in this chapter. Pressure drops and heat transfer rates exhibit little dependence on the coil pitch,  $S$ . The critical Reynolds number corresponding to the onset of turbulence for the helical tube,  $Re_{D,c,h}$ , is

$$Re_{D,c,h} = Re_{D,c}[1 + 12(D/C)^{0.5}] \quad (8.74)$$

where  $Re_{D,c}$  is given in Equation 8.2 and  $C$  is defined in Figure 8.13. Strong secondary flow associated with tightly wound helically coiled tubes delays the transition to turbulence.

For fully developed laminar flow with  $C/D \gtrsim 3$ , the friction factor is

$$f = \frac{64}{Re_D} \quad Re_D(D/C)^{1/2} \lesssim 30 \quad (8.19)$$

$$f = \frac{27}{Re_D^{0.725}} (D/C)^{0.1375} \quad 30 \lesssim Re_D(D/C)^{1/2} \lesssim 300 \quad (8.75a)$$

$$f = \frac{7.2}{Re_D^{0.5}} (D/C)^{0.25} \quad 300 \lesssim Re_D(D/C)^{1/2} \quad (8.75b)$$

For cases where  $C/D \lesssim 3$ , recommendations provided in [29] should be followed. The heat transfer coefficient for use in Equation 8.27 may be evaluated from a correlation of the form

$$Nu_D = \left[ \left( 3.66 + \frac{4.343}{a} \right)^3 + 1.158 \left( \frac{Re_D(D/C)^{1/2}}{b} \right)^{3/2} \right]^{1/3} \left( \frac{\mu}{\mu_s} \right)^{0.14} \quad (8.76)$$

where

$$a = \left( 1 + \frac{927(C/D)}{Re_D^2 Pr} \right) \quad \text{and} \quad b = 1 + \frac{0.477}{Pr} \quad (8.77a,b)$$

$$\left[ \begin{array}{l} 0.005 \leq Pr \leq 1600 \\ 1 \leq Re_D(D/C)^{1/2} \leq 1000 \end{array} \right]$$

Friction factor correlations for turbulent flow are based on limited data. Furthermore, heat transfer augmentation due to the secondary flow is minor when the flow is turbulent and is less than 10% for  $C/D \gtrsim 20$ . As such, augmentation by using helically coiled tubes is typically employed only for laminar flow situations. In laminar flow, the entrance length is 20% to 50% shorter than that of a straight tube, while the flow becomes fully developed within the first half-turn of the helically coiled tube under turbulent conditions. Therefore, the entrance region may be neglected in most engineering calculations.

When a gas or liquid is heated in a straight tube, a fluid parcel that enters near the centerline of the tube will exit the tube faster, and always be cooler than, a fluid parcel



that enters near the tube wall. Hence, the *time-temperature histories* of individual fluid parcels, processed in the same heating tube, can be dramatically different. In addition to augmenting heat transfer, the secondary flow associated with the helically coiled tube serves to *mix* the fluid relative to laminar flow in a straight tube, resulting in similar time-temperature histories for all the fluid parcels. It is for this reason that coiled tubes are routinely used to process and manufacture highly viscous, high value-added fluids, such as pharmaceuticals, cosmetics, and personal care products.

## 8.8

### Microscale Internal Flow

---

The tubes and channels considered so far have been characterized by hydraulic diameters of conventional size. Many new technologies involve microscale internal flows where the hydraulic diameters are in the range  $D_h \lesssim 100 \mu\text{m}$ . An important motivation for developing various *microfluidic devices* is readily evident by inspecting the correlations for the Nusselt numbers associated with laminar, fully developed flow. Specifically, heat transfer coefficients are inversely proportional to the hydraulic diameter. Therefore, as the size of the flow channel is decreased significantly, a dramatic increase in heat transfer coefficients will occur [30].

#### 8.8.1 Flow Conditions in Microscale Internal Flow

In Section 2.2.1, we saw that heat transfer in gases can be affected significantly as the characteristic length scale of the material volume,  $L$ , is reduced to the same order of magnitude as the mean free path of the gas,  $\lambda_{\text{mfp}}$ . At very small values of the hydraulic diameter  $D_h$ , therefore, the gas will no longer behave as a continuum. Because the continuum assumption has been made throughout our discussion of convection so far, the results of Chapters 6 through 8 are not expected to apply for gases when  $D_h/\lambda_{\text{mfp}} \lesssim 10$ , and recourse must be made to advanced methods to estimate the velocity distribution and pressure drops associated with internal flow [31].

For liquids, experiments have shown that, for laminar flow in circular tubes with diameters as small as  $50 \mu\text{m}$ , Equations 8.19 and 8.22a successfully predict the pressure drop over the tube length [32]. These equations are expected to be valid for most liquids for hydraulic diameters as small as  $1 \mu\text{m}$  [32, 33].

From the discussion in Section 6.3.1 one might anticipate that, since turbulence is characterized by the motion of relatively large parcels of fluid in conventional-sized devices, Equations 8.20 and 8.21 will not be applicable for flow in microfluidic devices because the volume of the fluid parcel is restricted by the hydraulic diameter of the channel. One may similarly anticipate that the criterion for the onset of turbulence, Equation 8.2, will be different for microscale internal flows. Careful measurements using various liquids have shown that the critical Reynolds number corresponding to the onset of turbulence is, in fact, well described by Equation 8.2 for liquid flow in tubes with diameters as small as  $50 \mu\text{m}$  [32]. Since extremely high mean velocities are necessary to achieve  $Re_D = 2300$ , one is seldom concerned about turbulent microscale convection.

### 8.8.2 Thermal Considerations in Microscale Internal Flow

Convective heat transfer in microscale internal flows continues to be the subject of ongoing research. The analytical results and convection correlations of Chapters 6 and 8 should not be used for gases when  $D_h/\lambda_{\text{mfp}} \lesssim 10$  and should be used with caution for liquids when  $D_h \lesssim 1 \mu\text{m}$ .

#### EXAMPLE 8.7

Combinatorial chemistry and biology are used in the pharmaceutical and biotechnology industries to reduce the time and cost associated with producing new drugs. Scientists desire to create large populations of molecules, or *libraries*, that can be subsequently screened en masse. Producing vast libraries increases the probability that novel compounds of significant therapeutic value will be discovered. A crucial variable in producing new compounds is the temperature at which the reactants are processed.


A *microreactor chip* is fabricated by first coating a 1-mm-thick glass microscope slide with a photoresist material. Lines are subsequently etched into the photoresist and a second glass plate is attached to the top of the structure, resulting in multiple parallel channels of rectangular cross section that are  $a = 40 \mu\text{m}$  deep,  $b = 160 \mu\text{m}$  wide, and  $L = 20 \text{ mm}$  long. The spacing between channels is  $s = 40 \mu\text{m}$ , so that  $N = L/(w + s) = 100$  channels are present within the  $20 \text{ mm} \times 20 \text{ mm}$  microreactor. A mixture of two reactants, both initially at  $T_{m,i} = 5^\circ\text{C}$ , is introduced into each channel, and the edges of the chip are maintained at temperatures  $T_1 = 125^\circ\text{C}$  and  $T_2 = 25^\circ\text{C}$  so that the reactants in each channel are subject to a unique processing temperature. Flow is induced through the structure by applying an overall pressure difference of  $\Delta P = 500 \text{ kPa}$ . The reactants and the product of reaction have thermo-physical properties similar to ethylene glycol. Estimate the time that elapses for the entering reactants to come within  $1^\circ\text{C}$  of the desired processing temperature.

#### SOLUTION

**Known:** Dimensions and operating conditions for flow of reactants and product of reaction in a microreactor.

**Find:** Time needed to bring the reactants to within  $1^\circ\text{C}$  of the processing temperature.

**Schematic:**

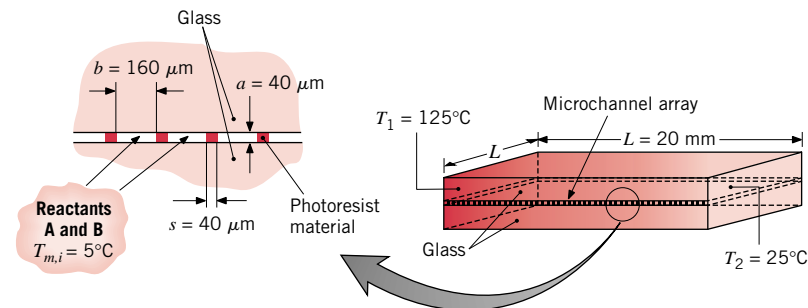

**Assumptions:**

1. Laminar flow.
2. Linear temperature distribution across the width of the microreactor.
3. Steady-state conditions.
4. Incompressible liquid with constant properties.
5. Negligible viscous dissipation.

**Properties:** Table A.5, ethylene glycol ( $\bar{T}_m = 288 \text{ K}$ ):  $\rho = 1120.2 \text{ kg/m}^3$ ,  $c_p = 2359 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 2.82 \times 10^{-2} \text{ N} \cdot \text{s/m}^2$ ,  $k = 247 \times 10^{-3} \text{ W/m} \cdot \text{K}$ ,  $Pr = 269$ . ( $\bar{T}_m = 338 \text{ K}$ ):  $\rho = 1085 \text{ kg/m}^3$ ,  $c_p = 2583 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 0.427 \times 10^{-2} \text{ N} \cdot \text{s/m}^2$ ,  $k = 261 \times 10^{-3} \text{ W/m} \cdot \text{K}$ ,  $Pr = 45.2$ .

**Analysis:** We will bracket the heat transfer and fluid flow behavior by evaluating the performance at the extreme processing temperatures.

The flow of reactants is induced by the applied pressure difference between the inlet and outlet of the microreactor. Because of the large variation of the viscosity with temperature, we expect the flow rate that is associated with the highest processing temperature to be the largest.

The perimeter of each microchannel is

$$P = 2a + 2b = 2 \times 40 \times 10^{-6} \text{ m} + 2 \times 160 \times 10^{-6} \text{ m} = 0.4 \times 10^{-3} \text{ m}$$

and the hydraulic diameter of each microchannel is found from Equation 8.66 as

$$D_h = \frac{4A_c}{P} = \frac{4ab}{P} = \frac{4 \times 40 \times 10^{-6} \text{ m} \times 160 \times 10^{-6} \text{ m}}{0.4 \times 10^{-3} \text{ m}} = 64 \times 10^{-6} \text{ m}$$

We begin by assuming a relatively short entrance length, to be verified later, so the flow rate may be estimated by using the friction factor for fully developed conditions. From Table 8.1 for  $b/a = 4$ ,  $f = 73/Re_{D_h}$ . Substituting this expression into Equation 8.22a, rearranging terms, and using properties at  $T = 125^\circ\text{C}$  (in this equation and those following) results in

$$u_m = \frac{2}{73} \frac{D_h^2 \Delta p}{\mu L} = \frac{2}{73} \times \frac{(64 \times 10^{-6} \text{ m})^2 \times 500 \times 10^3 \text{ N/m}^2}{0.427 \times 10^{-2} \text{ N} \cdot \text{s/m}^2 \times 20 \times 10^{-3} \text{ m}} = 0.657 \text{ m/s}$$

Hence, the Reynolds number is

$$Re_{D_h} = \frac{u_m D_h \rho}{\mu} = \frac{0.657 \text{ m/s} \times 64 \times 10^{-6} \text{ m} \times 1085 \text{ kg/m}^3}{0.427 \times 10^{-2} \text{ N} \cdot \text{s/m}^2} = 10.7$$

and the flow is deep in the laminar regime. Equation 8.3 may be used to determine the hydrodynamic entrance length, which is

$$x_{fd,h} \approx 0.05 D_h Re_D = 0.05 \times 64 \times 10^{-6} \text{ m} \times 10.7 = 34.2 \times 10^{-6} \text{ m}$$

and the thermal entrance length may be obtained from Equation 8.23, yielding

$$x_{fd,t} \approx x_{fd,h} Pr = 34.2 \times 10^{-6} \text{ m} \times 45.2 = 1.55 \times 10^{-3} \text{ m}$$

Both entrance lengths occupy less than 10% of the total microchannel length,  $L = 20 \text{ mm}$ . Therefore, use of fully developed values of  $f$  are justified, and the mass flow rate for the  $T = 125^\circ\text{C}$  microchannel is

$$\begin{aligned} \dot{m} &= \rho A_c u_m = \rho a b u_m = 1085 \text{ kg/m}^3 \times 40 \times 10^{-6} \text{ m} \times 160 \times 10^{-6} \text{ m} \times 0.657 \text{ m/s} \\ &= 4.56 \times 10^{-6} \text{ kg/s} \end{aligned}$$

Equation 8.42 may now be used to determine the distance from the entrance of the microchannel to the location,  $x_c$ , where  $T_{m,c} = 124^\circ\text{C}$ , that is, within  $1^\circ\text{C}$  of the surface temperature. The average heat transfer coefficient,  $\bar{h}$ , is replaced by the fully developed value of the heat transfer coefficient,  $h$ , because of the relatively short thermal entrance length. From Table 8.1, we see that for  $b/a = 4$ ,  $Nu_D = hD_h/k = 4.44$ . Therefore,

$$\bar{h} \approx h = Nu_D \frac{k}{D_h} = 4.44 \times \frac{0.261 \text{ W/m} \cdot \text{K}}{64 \times 10^{-6} \text{ m}} = 1.81 \times 10^4 \text{ W/m}^2 \cdot \text{K}$$

As expected from our discussion of microscale flows, the convection coefficient is extremely large.

Rearranging Equation 8.42 yields

$$\begin{aligned} x_c &= \frac{\dot{m} c_p}{Ph} \ln \left[ \frac{T_s - T_{m,i}}{T_s - T_{m,c}} \right] = \frac{4.56 \times 10^{-6} \text{ kg/s} \times 2583 \text{ J/kg} \cdot \text{K}}{0.4 \times 10^{-3} \text{ m} \times 1.81 \times 10^4 \text{ W/m}^2 \cdot \text{K}} \ln \left[ \frac{(125 - 5)^\circ\text{C}}{(125 - 124)^\circ\text{C}} \right] \\ &= 7.79 \times 10^{-3} \text{ m} \end{aligned}$$

Therefore, the time needed for the reactant to reach a mean temperature that is within  $1^\circ\text{C}$  of the processing temperature is


$$t_c = x_c / u_m = 7.79 \times 10^{-3} \text{ m} / 0.657 \text{ m/s} = 0.012 \text{ s} \quad \triangleleft$$

Repeating the calculations for the microchannel associated with the smallest processing temperature of  $25^\circ\text{C}$  yields  $u_m = 0.0995 \text{ m/s}$ ,  $Re_D = 0.253$ ,  $x_{fd,h} = 8.09 \times 10^{-7} \text{ m}$ ,  $x_{fd,t} = 0.218 \times 10^{-3} \text{ m}$ ,  $h = 1.71 \times 10^4 \text{ W/m}^2 \cdot \text{K}$ ,  $x_c = 0.73 \times 10^{-3} \text{ m}$ , and  $t_c = 0.007 \text{ s}$ .

### Comments:

1. The total thickness of the glass (2 mm) is 50 times greater than the depth of each microchannel, while the thermal conductivity of the glass,  $k_{\text{glass}} \approx 1.4 \text{ W/m} \cdot \text{K}$  (Table A.3), is 5 times greater than that of the fluid. The presence of such a small amount of fluid is expected to have a negligible effect on the linear temperature distribution that is established across the chip. The temperature difference across the bottom or top surface of each channel is approximately  $\Delta T = (T_1 - T_2)b/L = (125 - 25)^\circ\text{C} \times (160 \times 10^{-6} \text{ m}) / (20 \times 10^{-3} \text{ m}) = 0.8^\circ\text{C}$ .

2. Solving Equation 8.42 over the range  $0 \leq x \leq L$  yields the axial variation of the mean temperature for the two extreme processing temperature channels, as shown below.

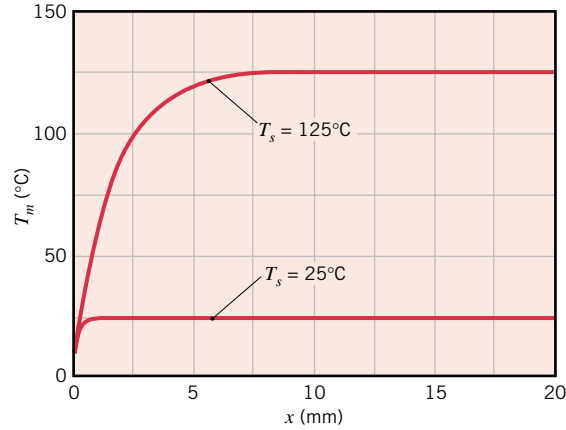

## 8.9

### Convection Mass Transfer

Mass transfer by convection may also occur for internal flows. For example, a gas may flow through a tube whose surface has been wetted or is sublimable. Evaporation or sublimation will then occur, and a concentration boundary layer will develop. Just as the mean temperature is the appropriate reference temperature for heat transfer, the mean species concentration  $\rho_{A,m}$  plays an analogous role for mass transfer. Defining the mass flow rate of species A in a duct of arbitrary cross section  $A_c$  as  $\dot{m}_A = \rho_{A,m} u_m A_c = \int_{A_c} (\rho_A u) dA_c$ , the mean species density is, accordingly,

$$\rho_{A,m} = \frac{\int_{A_c} (\rho_A u) dA_c}{u_m A_c} \quad (8.78a)$$

or for a circular tube,

$$\rho_{A,m} = \frac{2}{u_m r_o^2} \int_0^{r_o} (\rho_A u r) dr \quad (8.78b)$$

The concentration boundary layer development is characterized by entrance and fully developed regions, and Equation 8.23 may be used (with  $Pr$  replaced by  $Sc$ ) to determine the *concentration entry length*  $x_{fd,c}$  for laminar flow. Equation 8.4 may again be used as a first approximation for turbulent flow. Moreover, by analogy to Equation 8.28, for both laminar and turbulent flows, fully developed conditions exist when

$$\frac{\partial}{\partial x} \left[ \frac{\rho_{A,s} - \rho_A(r, x)}{\rho_{A,s} - \rho_{A,m}(x)} \right]_{fd,c} = 0 \quad (8.79)$$

where a uniform species concentration  $\rho_{A,s}$  is presumed to exist at the surface.

The local mass flux of species A from the surface may be computed from an expression of the form

$$n_A'' = h_m(\rho_{A,s} - \rho_{A,m}) \quad (8.80)$$

while the total rate of species transfer for a duct of surface area  $A_s$  may be expressed as

$$n_A = \bar{h}_m A_s \Delta\rho_{A,lm} \quad (8.81)$$

where the *log mean concentration difference*

$$\Delta\rho_{A,lm} = \frac{\Delta\rho_{A,o} - \Delta\rho_{A,i}}{\ln(\Delta\rho_{A,o}/\Delta\rho_{A,i})} \quad (8.82)$$

is analogous to the log mean temperature difference of Equation 8.44 and the concentration difference is defined as  $\Delta\rho_A = \rho_{A,s} - \rho_{A,m}$ . From application of conservation of species A to a control volume about the duct, the total rate of species transfer may also be expressed as

$$n_A = \frac{\dot{m}}{\rho} (\rho_{A,o} - \rho_{A,i}) \quad (8.83)$$

where  $\rho$  and  $\dot{m}$  are the total mass density and flow rate, respectively, and  $\dot{m}/\rho = u_m A_c$ . Equations 8.81 and 8.83 are the mass transfer equivalents of Equations 8.43 and 8.34, respectively, for heat transfer. In addition, the analog to Equation 8.42 that characterizes the variation of the mean vapor density with distance  $x$  from the duct entrance may be expressed as

$$\frac{\rho_{A,s} - \rho_{A,m}(x)}{\rho_{A,s} - \rho_{A,m,i}} = \exp\left(-\frac{\bar{h}_m \rho P}{\dot{m}} x\right) \quad (8.84)$$

where  $P$  is the duct perimeter.

The convection mass transfer coefficients,  $h_m$  and  $\bar{h}_m$ , may be obtained from appropriate correlations for the corresponding Sherwood numbers, which are defined as  $Sh_D = h_m D/D_{AB}$  and  $\bar{Sh}_D = \bar{h}_m D/D_{AB}$ . The specific form of a correlation may be inferred from the foregoing heat transfer results by invoking the heat and mass transfer analogy, with  $Sh_D$  and  $Sc$  substituted for  $Nu_D$  and  $Pr$ , respectively. For example, with a uniform vapor density at the surface of a circular duct and fully developed laminar flow through the duct,

$$Sh_D = 3.66 \quad (8.85)$$

For fully developed turbulent flow, the mass transfer analog to the Dittus–Boelter equation is

$$Sh_D = 0.023 Re_D^{4/5} Sc^{0.4} \quad (8.86)$$

Microscale conditions for mass transfer are similar to those discussed for heat transfer in Section 8.8.

### EXAMPLE 8.8

A thin liquid film of ammonia ( $\text{NH}_3$ ), which has formed on the inner surface of a tube of diameter  $D = 10$  mm and length  $L = 1$  m, is removed by passing dry air


through the tube at a flow rate of  $3 \times 10^{-4}$  kg/s. The tube and the air are at  $25^\circ\text{C}$ . What is the average mass transfer convection coefficient?

### SOLUTION

**Known:** Liquid ammonia on the inner surface of a tube is removed by evaporation into an airstream.

**Find:** Average mass transfer convection coefficient for the tube.

**Schematic:**

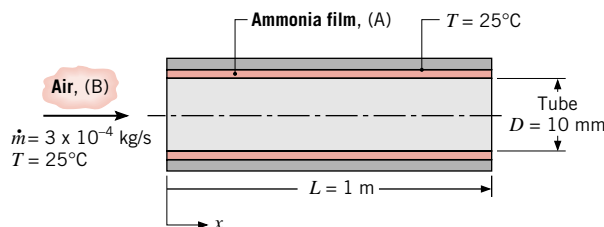

**Assumptions:**

1. Thin ammonia film with smooth surface.
2. Heat and mass transfer analogy is applicable.

**Properties:** Table A.4, air ( $25^\circ\text{C}$ ):  $\nu = 15.7 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $\mu = 183.6 \times 10^{-7} \text{ N} \cdot \text{s}/\text{m}^2$ . Table A.8, ammonia–air ( $25^\circ\text{C}$ ):  $D_{AB} = 0.28 \times 10^{-4} \text{ m}^2/\text{s}$ ,  $Sc = (\nu/D_{AB}) = 0.56$ .

**Analysis:** From Equation 8.6

$$Re_D = \frac{4 \times 3 \times 10^{-4} \text{ kg/s}}{\pi \times 0.01 \text{ m} \times 183.6 \times 10^{-7} \text{ N} \cdot \text{s}/\text{m}^2} = 2080$$

in which case the flow is laminar. Hence, since a constant ammonia vapor concentration is maintained at the surface of the film, which is analogous to a constant surface temperature, it follows from Equation 8.57 that

$$\overline{Sh}_D = 1.86 \left( \frac{Re_D Sc}{L/D} \right)^{1/3} = 1.86 \times 2.27 = 4.22$$

Since  $\overline{Sh}_D = 4.22 > 3.66$ , use of Equation 8.57 is valid. Finally,

$$\bar{h}_m = \overline{Sh}_D \frac{D_{AB}}{D} = \frac{4.22 \times 0.28 \times 10^{-4} \text{ m}^2/\text{s}}{0.01 \text{ m}} = 0.012 \text{ m/s} \quad \triangleleft$$

**Comments:** From Equation 8.23,  $x_{fd,c} \approx (0.05 Re_D Sc) D = 0.58 \text{ m}$ , and fully developed conditions exist over approximately 40% of the tube length. An assumption of fully developed conditions over the entire tube would provide a value of  $\overline{Sh}_D = 3.66$ , which is 13% less than the above result.

**8.10****Summary**

In this chapter we have considered forced convection heat and mass transfer for an important class of problems involving *internal flow*. Such flows are encountered in numerous applications, and you should be able to perform engineering calculations that involve an energy balance and appropriate convection correlations. The methodology involves determining whether the flow is laminar or turbulent and establishing the length of the entry region. After deciding whether you are interested in local conditions (at a particular axial location) or in average conditions (for the entire tube), the convection correlation may be selected and used with the appropriate form of the energy balance to solve the problem. A summary of the correlations is provided in Table 8.4.

You should test your understanding of related concepts by addressing the following questions.

- What are the salient features of a *hydrodynamic entry region*? A *thermal entry region*? Are hydrodynamic and thermal entry lengths equivalent? If not, on what do the relative lengths depend?
- What are the salient *hydrodynamic* features of *fully developed flow*? How is the friction factor for fully developed flow affected by wall roughness?
- To what important characteristic of an internal flow is the *mean* or *bulk temperature* linked?
- What are the salient *thermal* features of *fully developed flow*?
- If fluid enters a tube at a uniform temperature and there is heat transfer to or from the surface of the tube, how does the convection coefficient vary with distance along the tube?
- For fluid flow through a tube with a uniform surface heat flux, how does the mean temperature of the fluid vary with distance from the tube entrance in (a) the entrance region and (b) the fully developed region? How does the surface temperature vary with distance in the entrance and fully developed regions?
- For heat transfer to or from a fluid flowing through a tube with a uniform surface temperature, how does the mean temperature of the fluid vary with distance from the entrance? How does the surface heat flux vary with distance from the entrance?
- Why is a *log mean temperature difference*, rather than an arithmetic mean temperature difference, used to calculate the total rate of heat transfer to or from a fluid flowing through a tube with a constant surface temperature?
- What two equations may be used to calculate the total heat rate to a fluid flowing through a tube with a uniform surface heat flux? What two equations may be used to calculate the total heat rate to or from a fluid flowing through a tube with a uniform surface temperature?
- Under what conditions is the Nusselt number associated with internal flow equal to a constant value, independent of Reynolds number and Prandtl number?
- Is the average Nusselt number associated with flow through a tube larger than, equal to, or less than the Nusselt number for fully developed conditions? Why?
- How is the characteristic length defined for a noncircular tube?
- What are the salient features of a *concentration entry region*?



**TABLE 8.4** Summary of convection correlations for flow in a circular tube<sup>a,b,e</sup>

Correlation		Conditions
$f = 64/Re_D$	(8.19)	Laminar, fully developed
$Nu_D = 4.36$	(8.53)	Laminar, fully developed, uniform $q_s''$
$Nu_D = 3.66$	(8.55)	Laminar, fully developed, uniform $T_s$
$\overline{Nu}_D = 3.66 + \frac{0.0668(D/L)Re_D Pr}{1 + 0.04[(D/L)Re_D Pr]^{2/3}}$	(8.56)	Laminar, thermal entry (or combined entry with $Pr \geq 5$ ), uniform $T_s$
or		
$\overline{Nu}_D = 1.86 \left( \frac{Re_D Pr}{L/D} \right)^{1/3} \left( \frac{\mu}{\mu_s} \right)^{0.14}$	(8.57)	Laminar, combined entry, $0.6 \leq Pr \leq 5$ , $0.0044 \leq (\mu/\mu_s) \leq 9.75$ , uniform $T_s$
$f = 0.316 Re_D^{-1/4}$	(8.20a) <sup>c</sup>	Turbulent, fully developed, $Re_D \leq 2 \times 10^4$
$f = 0.184 Re_D^{-1/5}$	(8.20b) <sup>c</sup>	Turbulent, fully developed, $Re_D \geq 2 \times 10^4$
or		
$f = (0.790 \ln Re_D - 1.64)^{-2}$	(8.21) <sup>c</sup>	Turbulent, fully developed, $3000 \leq Re_D \leq 5 \times 10^6$
$Nu_D = 0.023 Re_D^{4/5} Pr^n$	(8.60) <sup>d</sup>	Turbulent, fully developed, $0.6 \leq Pr \leq 160$ , $Re_D \geq 10,000$ , $(L/D) \geq 10$ , $n = 0.4$ for $T_s > T_m$ and $n = 0.3$ for $T_s < T_m$
or		
$Nu_D = 0.027 Re_D^{4/5} Pr^{1/3} \left( \frac{\mu}{\mu_s} \right)^{0.14}$	(8.61) <sup>d</sup>	Turbulent, fully developed, $0.7 \leq Pr \leq 16,700$ , $Re_D \geq 10,000$ , $L/D \geq 10$
or		
$Nu_D = \frac{(f/8)(Re_D - 1000)Pr}{1 + 12.7(f/8)^{1/2}(Pr^{2/3} - 1)}$	(8.62) <sup>d</sup>	Turbulent, fully developed, $0.5 \leq Pr \leq 2000$ , $3000 \leq Re_D \leq 5 \times 10^6$ , $(L/D) \geq 10$
$Nu_D = 4.82 + 0.0185(Re_D Pr)^{0.827}$	(8.64)	Liquid metals, turbulent, fully developed, uniform $q_s''$ , $3.6 \times 10^3 \leq Re_D \leq 9.05 \times 10^5$ , $10^2 \leq Pe_D \leq 10^4$
$Nu_D = 5.0 + 0.025(Re_D Pr)^{0.8}$	(8.65)	Liquid metals, turbulent, fully developed, uniform $T_s$ , $Pe_D \geq 100$

<sup>a</sup>The mass transfer correlations may be obtained by replacing  $Nu_D$  and  $Pr$  by  $Sh_D$  and  $Sc$ , respectively.

<sup>b</sup>Properties in Equations 8.53, 8.55, 8.60, 8.61, 8.62, 8.64, and 8.65 are based on  $T_m$ ; properties in Equations 8.19, 8.20, and 8.21 are based on  $T_f \equiv (T_s + T_m)/2$ ; properties in Equations 8.56 and 8.57 are based on  $\overline{T}_m \equiv (T_{m,i} + T_{m,o})/2$ .

<sup>c</sup>Equations 8.20 and 8.21 pertain to smooth tubes. For rough tubes, Equation 8.62 should be used with the results of Figure 8.3.

<sup>d</sup>As a first approximation, Equations 8.60, 8.61, or 8.62 may be used to evaluate the average Nusselt number  $\overline{Nu}_D$  over the entire tube length, if  $(L/D) \geq 10$ . The properties should then be evaluated at the average of the mean temperature,  $\overline{T}_m \equiv (T_{m,i} + T_{m,o})/2$ .

<sup>e</sup>For tubes of noncircular cross section,  $Re_D \equiv D_h u_m / \nu$ ,  $D_h \equiv 4A_c/P$ , and  $u_m \equiv \dot{m}/\rho A_c$ . Results for fully developed laminar flow are provided in Table 8.1. For turbulent flow, Equation 8.60 may be used as a first approximation.

- What are the salient features of fully developed flow for mass transfer?
- How may convection mass transfer correlations be inferred?

Several features that complicate internal flows have not been considered in this chapter. For example, a situation may exist for which there is a prescribed axial variation in  $T_s$  or  $q_s''$ , rather than uniform surface conditions. Among other things, such a variation would preclude the existence of a fully developed region. There may also exist surface roughness effects, circumferential heat flux or temperature variations, widely varying fluid properties, or transition flow conditions. For a complete discussion of these effects, the literature should be consulted [11, 12, 15, 17, 24].

## References

1. Langhaar, H. L., *J. Appl. Mech.*, **64**, A-55, 1942.
2. Kays, W. M., and M. E. Crawford, *Convective Heat and Mass Transfer*, 3rd ed. McGraw-Hill, New York, 1993.
3. Moody, L. F., *Trans. ASME*, **66**, 671, 1944.
4. Petukhov, B. S., in T. F. Irvine and J. P. Hartnett, Eds., *Advances in Heat Transfer*, Vol. 6, Academic Press, New York, 1970.
5. Chen, M. M., and K. R. Holmes, *Ann. N. Y. Acad. Sci.*, **335**, 137, 1980.
6. Chato, J. C., *J. Biomech. Eng.*, **102**, 110, 1980.
7. Kays, W. M., *Trans. ASME*, **77**, 1265, 1955.
8. Hausen, H., *Z. VDI Beih. Verfahrenstech.*, **4**, 91, 1943.
9. Sieder, E. N., and G. E. Tate, *Ind. Eng. Chem.*, **28**, 1429, 1936.
10. Whitaker, S., *AIChE J.*, **18**, 361, 1972.
11. Shah, R. K., and A. L. London, *Laminar Flow Forced Convection in Ducts*, Academic Press, New York, 1978.
12. Shah, R. K., and M. S. Bhatti, in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 3, Wiley-Interscience, New York, 1987.
13. Colburn, A. P., *Trans. AIChE*, **29**, 174, 1933.
14. Winterton, R. H. S., *Int. J. Heat Mass Transfer*, **41**, 809, 1998.
15. Bhatti, M. S., and R. K. Shah, in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 4, Wiley-Interscience, New York, 1987.
16. Gnielinski, V., *Int. Chem. Eng.*, **16**, 359, 1976.
17. Kakac, S., in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 18, Wiley-Interscience, New York, 1987.
18. Ghajar, A. J., and L.-M. Tam, *Exp. Thermal and Fluid Science*, **8**, 79, 1994.
19. Norris, R. H., in A. E. Bergles and R. L. Webb, Eds., *Augmentation of Convective Heat and Mass Transfer*, ASME, New York, 1970.
20. Molki, M., and E. M. Sparrow, *J. Heat Transfer*, **108**, 482, 1986.
21. Skupinski, E. S., J. Tortel, and L. Vautrey, *Int. J. Heat Mass Transfer*, **8**, 937, 1965.
22. Seban, R. A., and T. T. Shimazaki, *Trans. ASME*, **73**, 803, 1951.
23. Reed, C. B., in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 8, Wiley-Interscience, New York, 1987.
24. Kays, W. M., and H. C. Perkins, in W. M. Rohsenow, J. P. Hartnett, and E. N. Ganic, Eds., *Handbook of Heat Transfer, Fundamentals*, Chap. 7, McGraw-Hill, New York, 1985.
25. Bergles, A. E., "Principles of Heat Transfer Augmentation," *Heat Exchangers, Thermal-Hydraulic Fundamentals and Design*, Hemisphere Publishing, New York, 1981, pp. 819–842.
26. Webb, R. L., in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 17, Wiley-Interscience, New York, 1987.
27. Webb, R. L., *Principles of Enhanced Heat Transfer*, Wiley, New York, 1993.
28. Manglik, R. M., and A. E. Bergles, in J. P. Hartnett, T. F. Irvine, Y. I. Cho, and R. E. Greene, Eds., *Advances in Heat Transfer*, Vol. 36, Academic Press, New York, 2002.
29. Shah, R. K., and S. D. Joshi, in *Handbook of Single-Phase Convective Heat Transfer*, Chap. 5, Wiley-Interscience, New York, 1987.

30. Jensen, K. F., *Chem. Eng. Sci.*, **56**, 293, 2001.  
 31. Kaviany, M., *Principles of Convective Heat Transfer*, Springer-Verlag, New York, 1994.  
 32. Sharp, K. V., and R. J. Adrian, *Exp. Fluids*, **36**, 741, 2004.  
 33. Travis, K. P., B. D. Todd, and D. J. Evans, *Phys. Rev. E*, **55**, 4288, 1997.

## Problems

### Hydrodynamic Considerations

- 8.1** Fully developed conditions are known to exist for water flowing through a 25-mm-diameter tube at 0.01 kg/s and 27°C. What is the maximum velocity of the water in the tube? What is the pressure gradient associated with the flow?
- 8.2** What is the pressure drop associated with water at 27°C flowing with a mean velocity of 0.2 m/s through a 600-m-long cast iron pipe of 0.15-m inside diameter?
- 8.3** Water at 27°C flows with a mean velocity of 1 m/s through a 1-km-long pipe of 0.25-m inside diameter.
- Determine the pressure drop over the pipe length and the corresponding pump power requirement, if the pipe surface is smooth.
  - If the pipe is made of cast iron and its surface is clean, determine the pressure drop and pump power requirement.
  - For the smooth pipe condition, generate a plot of pressure drop and pump power requirement for mean velocities in the range from 0.05 to 1.5 m/s.
- 8.4** An engine oil cooler consists of a bundle of 25 smooth tubes, each of length  $L = 2.5$  m and diameter  $D = 10$  mm.
- If oil at 300 K and a total flow rate of 24 kg/s is in fully developed flow through the tubes, what is the pressure drop and the pump power requirement?
  - Compute and plot the pressure drop and pump power requirement as a function of flow rate for  $10 \leq \dot{m} \leq 30$  kg/s.
- 8.5** For fully developed laminar flow through a parallel-plate channel, the  $x$ -momentum equation has the form

$$\mu \left( \frac{d^2 u}{dy^2} \right) = \frac{dp}{dx} = \text{constant}$$

The purpose of this problem is to develop expressions for the velocity distribution and pressure gradient analogous to those for the circular tube in Section 8.1.


- Show that the velocity profile,  $u(y)$ , is parabolic and of the form

$$u(y) = \frac{3}{2} u_m \left[ 1 - \frac{y^2}{(a/2)^2} \right]$$

where  $u_m$  is the mean velocity

$$u_m = -\frac{a^2}{12\mu} \left( \frac{dp}{dx} \right)$$

and  $-dp/dx = \Delta p/L$ , where  $\Delta p$  is the pressure drop across the channel of length  $L$ .

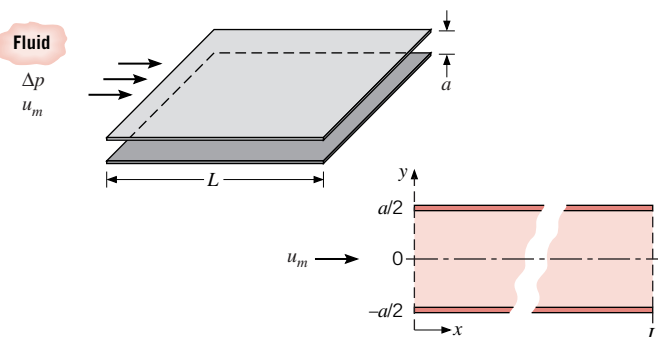

- Write an expression defining the friction factor,  $f$ , using the hydraulic diameter  $D_h$  as the characteristic length. What is the hydraulic diameter for the parallel-plate channel?
- The friction factor is estimated from the expression  $f = C/Re_{D_h}$ , where  $C$  depends upon the flow cross section, as shown in Table 8.1. What is the coefficient  $C$  for the parallel-plate channel?
- Air flow in a parallel-plate channel with a separation of 5 mm and a length of 200 mm experiences a pressure drop of  $\Delta p = 3.75$  N/m<sup>2</sup>. Calculate the mean velocity and the Reynolds number for air at atmospheric pressure and 300 K. Is the assumption of fully developed flow reasonable for this application? If not, what is the effect on the estimate for  $u_m$ ?

### Thermal Entry Length and Energy Balance Considerations

- 8.6** Consider pressurized water, engine oil (unused), and NaK (22%/78%) flowing in a 20-mm-diameter tube.
- Determine the mean velocity, the hydrodynamic entry length, and the thermal entry length for each of the fluids when the fluid temperature is 366 K and the flow rate is 0.01 kg/s.

- (b) Determine the mass flow rate, the hydrodynamic entry length, and the thermal entry length for water and engine oil at 300 and 400 K and a mean velocity of 0.02 m/s.

**8.7** Velocity and temperature profiles for laminar flow in a tube of radius  $r_o = 10$  mm have the form

$$u(r) = 0.1[1 - (r/r_o)^2]$$

$$T(r) = 344.8 + 75.0(r/r_o)^2 - 18.8(r/r_o)^4$$


with units of m/s and K, respectively. Determine the corresponding value of the mean (or bulk) temperature,  $T_m$ , at this axial position.

**8.8** At a particular axial station, velocity and temperature profiles for laminar flow in a parallel plate channel have the form

$$u(y) = 0.75[1 - (y/y_o)^2]$$

$$T(y) = 5.0 + 95.66(y/y_o)^2 - 47.83(y/y_o)^4$$

with units of m/s and °C, respectively.

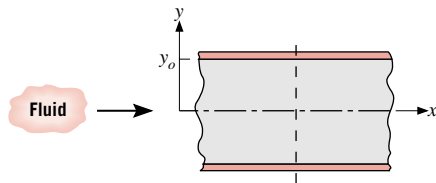

Determine corresponding values of the mean velocity,  $u_m$ , and mean (or bulk) temperature,  $T_m$ . Plot the velocity and temperature distributions. Do your values of  $u_m$  and  $T_m$  appear reasonable?

**8.9** In Chapter 1, it was stated that for incompressible liquids, flow work could usually be neglected in the steady-flow energy equation (Equation 1.11d). In the trans-Alaska pipeline, the high viscosity of the oil and long distances cause significant pressure drops, and it is reasonable to question whether flow work would be significant. Consider a  $L = 100$  km length of pipe of diameter  $D = 1.2$  m, with oil flow rate  $\dot{m} = 500$  kg/s. The oil properties are  $\rho = 900$  kg/m<sup>3</sup>,  $c_p = 2000$  J/kg · K,  $\mu = 0.765$  N · s/m<sup>2</sup>. Calculate the pressure drop, the flow work, and the temperature rise caused by the flow work.

**8.10** When viscous dissipation is included, Equation 8.48 (multiplied by  $\rho c_p$ ) becomes

$$\rho c_p u \frac{\partial T}{\partial x} = \frac{k}{r} \frac{\partial}{\partial r} \left( r \frac{\partial T}{\partial r} \right) + \mu \left( \frac{du}{dr} \right)^2$$


This problem explores the importance of viscous dissipation. The conditions under consideration are laminar, fully developed flow in a circular pipe, with  $u$  given by Equation 8.15.

- (a) By integrating the left-hand side over a section of a pipe of length  $L$  and radius  $r_o$ , show that this term yields the right-hand side of Equation 8.34.
- (b) Integrate the viscous dissipation term over the same volume.
- (c) Find the temperature rise caused by viscous dissipation by equating the two terms calculated above. Use the same conditions as in Problem 8.9.

**8.11** Water enters a tube at 27°C with a flow rate of 450 kg/h. The heat transfer from the tube wall to the fluid is given as  $q'_s$  (W/m) =  $ax$ , where the coefficient  $a$  is 20 W/m<sup>2</sup> and  $x$  (m) is the axial distance from the tube entrance.


- (a) Beginning with a properly defined differential control volume in the tube, derive an expression for the temperature distribution  $T_m(x)$  of the water.
- (b) What is the outlet temperature of the water for a heated section 30 m long?
- (c) Sketch the mean fluid temperature,  $T_m(x)$ , and the tube wall temperature,  $T_s(x)$ , as a function of distance along the tube for fully developed and developing flow conditions.
- (d) What value of a uniform wall heat flux,  $q''_s$  (instead of  $q'_s = ax$ ), would provide the same fluid outlet temperature as that determined in part (b)? For this type of heating, sketch the temperature distributions requested in part (c).

**8.12** Consider flow in a circular tube. Within the test section length (between 1 and 2) a constant heat flux  $q''_s$  is maintained.

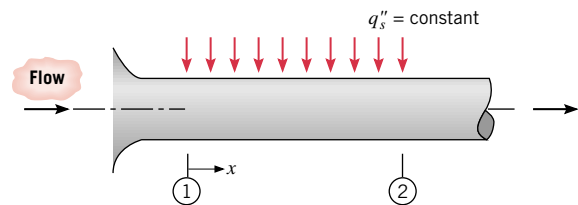

- (a) For the following two cases, sketch the surface temperature  $T_s(x)$  and the fluid mean temperature  $T_m(x)$  as a function of distance along the test section  $x$ . In case A, flow is hydrodynamically and thermally fully developed. In case B, flow is not developed.
- (b) Assuming that the surface flux  $q''_s$  and the inlet mean temperature  $T_{m,1}$  are identical for both cases, will the exit mean temperature  $T_{m,2}$  for case A be greater than, equal to, or less than  $T_{m,2}$  for case B? Briefly explain why.

**8.13** Consider a cylindrical nuclear fuel rod of length  $L$  and diameter  $D$  that is encased in a concentric tube. Pressurized water flows through the annular region between the rod and the tube at a rate  $\dot{m}$ , and the outer surface of the tube is well insulated. Heat generation occurs within the fuel rod, and the volumetric generation rate is known to vary sinusoidally with distance along the rod. That is,  $\dot{q}(x) = \dot{q}_o \sin(\pi x/L)$ , where  $\dot{q}_o$  ( $\text{W/m}^3$ ) is a constant. A uniform convection coefficient  $h$  may be assumed to exist between the surface of the rod and the water.

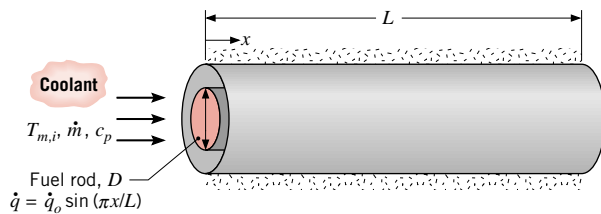


- Obtain expressions for the local heat flux  $q''(x)$  and the total heat transfer  $q$  from the fuel rod to the water.
- Obtain an expression for the variation of the mean temperature  $T_m(x)$  of the water with distance  $x$  along the tube.
- Obtain an expression for the variation of the rod surface temperature  $T_s(x)$  with distance  $x$  along the tube. Develop an expression for the  $x$  location at which this temperature is maximized.

**8.14** In a particular application involving fluid flow at a rate  $\dot{m}$  through a circular tube of length  $L$  and diameter  $D$ , the surface heat flux is known to have a sinusoidal variation with  $x$ , which is of the form  $q''_s(x) = q''_{s,m} \sin(\pi x/L)$ . The maximum flux,  $q''_{s,m}$ , is a known constant, and the fluid enters the tube at a known temperature,  $T_{m,i}$ . Assuming the convection coefficient to be constant, how do the mean temperature of the fluid and the surface temperature vary with  $x$ ?

**8.15** A flat-plate solar collector is used to heat atmospheric air flowing through a rectangular channel. The bottom surface of the channel is well insulated, while the top surface is subjected to a uniform heat flux  $q''_o$ , which is due to the net effect of solar radiation absorption and heat exchange between the absorber and cover plates.

- Beginning with an appropriate differential control volume, obtain an equation that could be used to determine the mean air temperature  $T_m(x)$  as a function of distance along the channel. Solve this equation to obtain an expression for the mean temperature of the air leaving the collector.

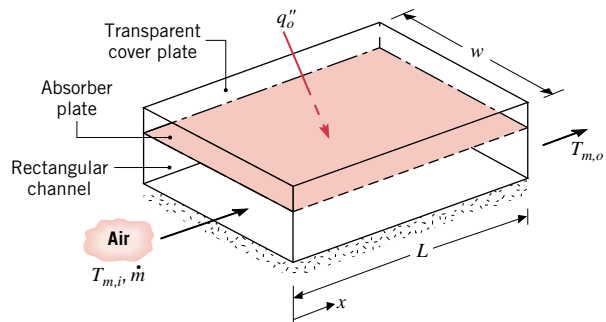


- With air inlet conditions of  $\dot{m} = 0.1 \text{ kg/s}$  and  $T_{m,i} = 40^\circ\text{C}$ , what is the air outlet temperature if  $L = 3 \text{ m}$ ,  $w = 1 \text{ m}$ , and  $q''_o = 700 \text{ W/m}^2$ ? The specific heat of air is  $c_p = 1008 \text{ J/kg} \cdot \text{K}$ .

**8.16** Atmospheric air enters the heated section of a circular tube at a flow rate of  $0.005 \text{ kg/s}$  and a temperature of  $20^\circ\text{C}$ . The tube is of diameter  $D = 50 \text{ mm}$ , and fully developed conditions with  $h = 25 \text{ W/m}^2 \cdot \text{K}$  exist over the entire length of  $L = 3 \text{ m}$ .

- For the case of uniform surface heat flux at  $q''_s = 1000 \text{ W/m}^2$ , determine the total heat transfer rate  $q$  and the mean temperature of the air leaving the tube  $T_{m,o}$ . What is the value of the surface temperature at the tube inlet  $T_{s,i}$  and outlet  $T_{s,o}$ ? Sketch the axial variation of  $T_s$  and  $T_m$ . On the same figure, also sketch (qualitatively) the axial variation of  $T_s$  and  $T_m$  for the more realistic case in which the local convection coefficient varies with  $x$ .
- If the surface heat flux varies linearly with  $x$ , such that  $q''_s (\text{W/m}^2) = 500x (\text{m})$ , what are the values of  $q$ ,  $T_{m,o}$ ,  $T_{s,i}$ , and  $T_{s,o}$ ? Sketch the axial variation of  $T_s$  and  $T_m$ . On the same figure, also sketch (qualitatively) the axial variation of  $T_s$  and  $T_m$  for the more realistic case in which the local convection coefficient varies with  $x$ .
- For the two heating conditions of parts (a) and (b), plot the mean fluid and surface temperatures,  $T_m(x)$  and  $T_s(x)$ , respectively, as functions of distance along the tube. What effect will a fourfold increase in the convection coefficient have on the temperature distributions?
- For each type of heating process, what heat fluxes are required to achieve an air outlet temperature of  $125^\circ\text{C}$ ? Plot the temperature distributions.

**8.17** Water at  $300 \text{ K}$  and a flow rate of  $5 \text{ kg/s}$  enters a black, thin-walled tube, which passes through a large furnace whose walls and air are at a temperature of  $700 \text{ K}$ . The diameter and length of the tube are  $0.25 \text{ m}$  and  $8 \text{ m}$ , respectively. Convection coefficients associated with

water flow through the tube and air flow over the tube are  $300 \text{ W/m}^2 \cdot \text{K}$  and  $50 \text{ W/m}^2 \cdot \text{K}$ , respectively.

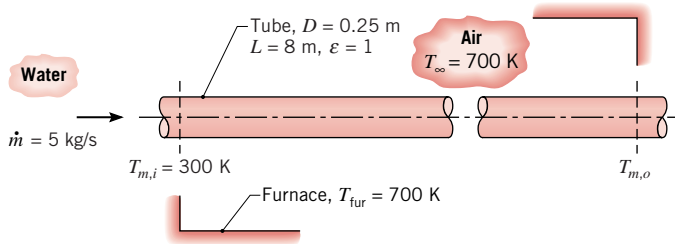

- (a) Write an expression for the linearized radiation coefficient corresponding to radiation exchange between the outer surface of the pipe and the furnace walls. Explain how to calculate this coefficient if the surface temperature of the tube is represented by the arithmetic mean of its inlet and outlet values.
- (b) Determine the outlet temperature of the water,  $T_{m,o}$ .
- 8.18** Slug flow is an idealized tube flow condition for which the velocity is assumed to be uniform over the entire tube cross section. For the case of laminar slug flow with a uniform surface heat flux, determine the form of the fully developed temperature distribution  $T(r)$  and the Nusselt number  $Nu_D$ .
- 8.19** Superimposing a control volume that is differential in  $x$  on the tube flow conditions of Figure 8.8, derive Equation 8.45a.
- 8.20** An experimental nuclear core simulation apparatus consists of a long thin-walled metallic tube of diameter  $D$  and length  $L$ , which is electrically heated to produce the sinusoidal heat flux distribution

$$q_s''(x) = q_o'' \sin\left(\frac{\pi x}{L}\right)$$

where  $x$  is the distance measured from the tube inlet. Fluid at an inlet temperature  $T_{m,i}$  flows through the tube at a rate of  $\dot{m}$ . Assuming the flow is turbulent and fully developed over the entire length of the tube, develop expressions for:

- the total rate of heat transfer,  $q$ , from the tube to the fluid;
  - the fluid outlet temperature,  $T_{m,o}$ ;
  - the axial distribution of the wall temperature,  $T_s(x)$ ; and
  - the magnitude and position of the highest wall temperature.
- (e) Consider a 40-mm-diameter tube of 4-m length with a sinusoidal heat flux distribution for which  $q_o'' = 10,000 \text{ W/m}^2$ . Fluid passing through the tube

has a flow rate of  $0.025 \text{ kg/s}$ , a specific heat of  $4180 \text{ J/kg} \cdot \text{K}$ , an entrance temperature of  $25^\circ\text{C}$ , and a convection coefficient of  $1000 \text{ W/m}^2 \cdot \text{K}$ . Plot the mean fluid and surface temperatures as a function of distance along the tube. Identify important features of the distributions. Explore the effect of  $\pm 25\%$  changes in the convection coefficient and the heat flux on the distributions.

- 8.21** Water at  $20^\circ\text{C}$  and a flow rate of  $0.1 \text{ kg/s}$  enters a heated, thin-walled tube with a diameter of  $15 \text{ mm}$  and length of  $2 \text{ m}$ . The wall heat flux provided by the heating elements depends on the wall temperature according to the relation

$$q_s''(x) = q_{s,o}'' [1 + \alpha(T_s - T_{\text{ref}})]$$

where  $q_{s,o}'' = 10^4 \text{ W/m}^2$ ,  $\alpha = 0.2 \text{ K}^{-1}$ ,  $T_{\text{ref}} = 20^\circ\text{C}$ , and  $T_s$  is the wall temperature in  $^\circ\text{C}$ . Assume fully developed flow and thermal conditions with a convection coefficient of  $3000 \text{ W/m}^2 \cdot \text{K}$ .

- Beginning with a properly defined differential control volume in the tube, derive expressions for the variation of the water,  $T_m(x)$ , and the wall,  $T_s(x)$ , temperatures as a function of distance from the tube inlet.
- Using a numerical integration scheme, calculate and plot the temperature distributions,  $T_m(x)$  and  $T_s(x)$ , on the same graph. Identify and comment on the main features of the distributions. *Hint:* The *IHT* integral function *DER*( $T_m, x$ ) can be used to perform the integration along the length of the tube.
- Calculate the total rate of heat transfer to the water.

## Heat Transfer Correlations: Circular Tubes

- 8.22** Engine oil is heated by flowing through a circular tube of diameter  $D = 50 \text{ mm}$  and length  $L = 25 \text{ m}$  and whose surface is maintained at  $150^\circ\text{C}$ .

- If the flow rate and inlet temperature of the oil are  $0.5 \text{ kg/s}$  and  $20^\circ\text{C}$ , what is the outlet temperature  $T_{m,o}$ ? What is the total heat transfer rate  $q$  for the tube?
- For flow rates in the range  $0.5 \leq \dot{m} \leq 2.0 \text{ kg/s}$ , compute and plot the variations of  $T_{m,o}$  and  $q$  with  $\dot{m}$ . For what flow rate(s) are  $q$  and  $T_{m,o}$  maximized? Explain your results.

- 8.23** Engine oil flows through a 25-mm-diameter tube at a rate of  $0.5 \text{ kg/s}$ . The oil enters the tube at a temperature of  $25^\circ\text{C}$ , while the tube surface temperature is maintained at  $100^\circ\text{C}$ .

- Determine the oil outlet temperature for a 5-m and for a 100-m long tube. For each case, compare the




log mean temperature difference to the arithmetic mean temperature difference.

- (b) For  $5 \leq L \leq 100$  m, compute and plot the average Nusselt number  $\bar{Nu}_D$  and the oil outlet temperature as a function of  $L$ .

- 8.24** An oil preheater consists of a single tube of 10 mm diameter and 5 m length, with its surface maintained at  $175^\circ\text{C}$  by swirling combustion gases. The engine oil (new) enters at  $75^\circ\text{C}$ . What flow rate must be supplied to maintain an oil outlet temperature of  $100^\circ\text{C}$ ? What is the corresponding heat transfer rate?
- 8.25** Engine oil flows at a rate of 1 kg/s through a 5-mm-diameter straight tube. The oil has an inlet temperature of  $45^\circ\text{C}$  and it is desired to heat the oil to a mean temperature of  $80^\circ\text{C}$  at the exit of the tube. The surface of the tube is maintained at  $150^\circ\text{C}$ . Determine the required length of the tube. *Hint*: Calculate the Reynolds numbers at the entrance and exit of the tube before proceeding with your analysis.
- 8.26** Ethylene glycol flows at 0.01 kg/s through a 3-mm-diameter, thin-walled tube. The tube is coiled and submerged in a well-stirred water bath maintained at  $25^\circ\text{C}$ . If the fluid enters the tube at  $85^\circ\text{C}$ , what heat rate and tube length are required for the fluid to leave at  $35^\circ\text{C}$ ? Neglect heat transfer enhancement associated with the coiling.
- 8.27** In the final stages of production, a pharmaceutical is sterilized by heating it from  $25$  to  $75^\circ\text{C}$  as it moves at  $0.2$  m/s through a straight thin-walled stainless steel tube of 12.7-mm diameter. A uniform heat flux is maintained by an electric resistance heater wrapped around the outer surface of the tube. If the tube is 10 m long, what is the required heat flux? If fluid enters the tube with a fully developed velocity profile and a uniform temperature profile, what is the surface temperature at the tube exit and at a distance of 0.5 m from the entrance? Fluid properties may be approximated as  $\rho = 1000$  kg/m<sup>3</sup>,  $c_p = 4000$  J/kg · K,  $\mu = 2 \times 10^{-3}$  kg/s · m,  $k = 0.8$  W/m · K, and  $Pr = 10$ .
- 8.28** Batch processes are often used in chemical and pharmaceutical operations to achieve a desired chemical composition for the final product. Related heat transfer processes are typically transient, involving a liquid of fixed volume that may be heated from room temperature to a desired process temperature, or cooled from the process temperature to room temperature. Consider a batch process for which a pharmaceutical (the cold fluid,  $c$ ) is poured into an insulated, highly agitated vessel (a *stirred reactor*) and heated by passing a hot fluid ( $h$ ) through a submerged heat exchanger coil of thin-walled tubing and surface area  $A_s$ . The flow rate,  $\dot{m}_h$ ,

mean inlet temperature,  $T_{h,i}$ , and specific heat,  $c_{p,h}$ , of the hot fluid are known, as are the initial temperature,  $T_{c,i} < T_{h,i}$ , the volume,  $V_c$ , mass density,  $\rho_c$ , and specific heat,  $c_{v,c}$ , of the pharmaceutical. Heat transfer from the hot fluid to the pharmaceutical is governed by an overall heat transfer coefficient  $U$ .

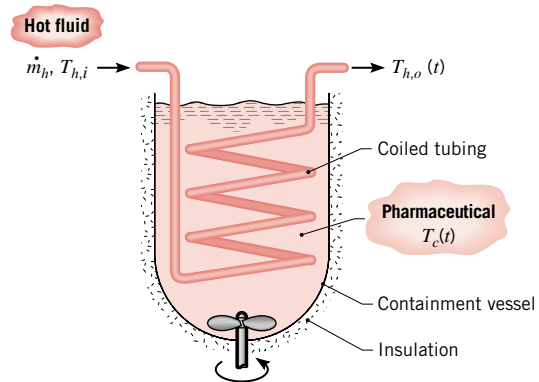

- (a) Starting from basic principles, derive expressions that can be used to determine the variation of  $T_c$  and  $T_{h,o}$  with time during the heating process. *Hint*: Two equations may be written for the rate of heat transfer,  $q(t)$ , to the pharmaceutical, one based on the log-mean temperature difference and the other on an energy balance for flow of the hot fluid through the tube. Equate these expressions to determine  $T_{h,o}(t)$  as a function of  $T_c(t)$  and prescribed parameters. Use the expression for  $T_{h,o}(t)$  and the energy balance for flow through the tube with an energy balance for a control volume containing the pharmaceutical to obtain an expression for  $T_c(t)$ .
- (b) Consider a pharmaceutical of volume  $V_c = 1$  m<sup>3</sup>, density  $\rho_c = 1100$  kg/m<sup>3</sup>, specific heat  $c_{v,c} = 2000$  J/kg · K, and an initial temperature of  $T_{c,i} = 25^\circ\text{C}$ . A coiled tube of length  $L = 40$  m, diameter  $D = 50$  mm, and coil diameter  $C = 500$  mm is submerged in the vessel, and hot fluid enters the tubing at  $T_{h,i} = 200^\circ\text{C}$  and  $\dot{m}_h = 2.4$  kg/s. The convection coefficient at the outer surface of the tubing may be approximated as  $h_o = 1000$  W/m<sup>2</sup> · K, and the fluid properties are  $c_{p,h} = 2500$  J/kg · K,  $\mu_h = 0.002$  N · s/m<sup>2</sup>,  $k_h = 0.260$  W/m · K, and  $Pr_h = 20$ . For the foregoing conditions, compute and plot the pharmaceutical temperature  $T_c$  and the outlet temperature  $T_{h,o}$  as a function of time over the range  $0 \leq t \leq 3600$  s. How long does it take to reach a batch temperature of  $T_c = 160^\circ\text{C}$ ? The process operator may control the heating time by varying  $\dot{m}_h$ . For  $1 \leq \dot{m}_h \leq 5$  kg/s, explore the effect of the

flow rate on the time  $t_c$  required to reach a value of  $T_c = 160^\circ\text{C}$ .

- 8.29** The mold that is used in an injection molding process is constructed of metal ( $\rho = 7800 \text{ kg/m}^3$ ,  $c = 450 \text{ J/kg} \cdot \text{K}$ ). The mold, to be heated to  $190^\circ\text{C}$  prior to injection of the thermoplastic material, must be subsequently cooled before ejection of the finished part. Pressurized water at  $30^\circ\text{C}$  is available for cooling. The mold has dimensions  $50 \text{ mm} \times 100 \text{ mm} \times 40 \text{ mm}$  and the mold designer must specify inclusion of  $N$  cooling passages, of diameter  $5 \text{ mm}$ , to be machined into the mold. If one passage can be placed every  $10 \text{ mm}$  along the length or width of the mold, the designer can therefore specify either five  $100\text{-mm-long}$  passages or ten  $50\text{-mm-long}$  passages. The total mass flow rate of water, divided equally among the channels, is  $0.02 \text{ kg/s}$ . Which configuration ( $N = 5$  long passages or  $N = 10$  short passages) should the mold designer specify in order to cool the mold faster and, in turn, increase the number of parts that can be manufactured daily? What is the initial rate of cooling of the mold ( $^\circ\text{C/s}$ )? The velocity profile in each channel is fully developed prior to entering the hot mold. Neglect the mass of the thermoplastic part.


- 8.30** The evaporator section of a heat pump is installed in a large tank of water, which is used as a heat source during the winter. As energy is extracted from the water, it begins to freeze, creating an ice/water bath at  $0^\circ\text{C}$ , which may be used for air conditioning during the summer. Consider summer cooling conditions for which air is passed through an array of copper tubes, each of inside diameter  $D = 50 \text{ mm}$ , submerged in the bath.

- (a) If air enters each tube at a mean temperature of  $T_{m,i} = 24^\circ\text{C}$  and a flow rate of  $\dot{m} = 0.01 \text{ kg/s}$ , what tube length  $L$  is needed to provide an exit temperature of  $T_{m,o} = 14^\circ\text{C}$ ? With 10 tubes passing through a tank of total volume  $V = 10 \text{ m}^3$ , which initially contains 80% ice by volume, how long would it take to completely melt the ice? The density and latent heat of fusion of ice are  $920 \text{ kg/m}^3$  and  $3.34 \times 10^5 \text{ J/kg}$ , respectively.

- (b) The air outlet temperature may be regulated by adjusting the tube mass flow rate. For the tube length determined in part (a), compute and plot  $T_{m,o}$  as a function of  $\dot{m}$  for  $0.005 \leq \dot{m} \leq 0.05 \text{ kg/s}$ . If the dwelling cooled by this system requires approximately  $0.05 \text{ kg/s}$  of air at  $16^\circ\text{C}$ , what design and operating conditions should be prescribed for the system?

- 8.31** To cool a summer home without using a vapor-compression refrigeration cycle, air is routed through a plastic pipe ( $k = 0.15 \text{ W/m} \cdot \text{K}$ ,  $D_i = 0.15 \text{ m}$ ,  $D_o =$

$0.17 \text{ m}$ ) that is submerged in an adjoining body of water. The water temperature is nominally at  $T_\infty = 17^\circ\text{C}$ , and a convection coefficient of  $h_o \approx 1500 \text{ W/m}^2 \cdot \text{K}$  is maintained at the outer surface of the pipe.

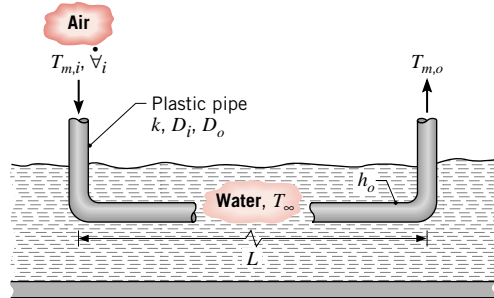

If air from the home enters the pipe at a temperature of  $T_{m,i} = 29^\circ\text{C}$  and a volumetric flow rate of  $\dot{V}_i = 0.025 \text{ m}^3/\text{s}$ , what pipe length  $L$  is needed to provide a discharge temperature of  $T_{m,o} = 21^\circ\text{C}$ ? What is the fan power required to move the air through this length of pipe if its inner surface is smooth?

- 8.32** Water flowing at  $2 \text{ kg/s}$  through a  $40\text{-mm-diameter}$  tube is to be heated from  $25$  to  $75^\circ\text{C}$  by maintaining the tube surface temperature at  $100^\circ\text{C}$ .

- (a) What is the required tube length for these conditions?

- (b) In order to design a water heating system, we wish to consider using tube diameters in the range from  $30$  to  $50 \text{ mm}$ . What are the required tube lengths for water flow rates of  $1$ ,  $2$ , and  $3 \text{ kg/s}$ ? Represent this design information graphically.

- (c) Plot the pressure gradient as a function of tube diameter for the three flow rates. Assume the tube wall is smooth.

- 8.33** Consider the conditions associated with the hot water pipe of Problem 7.56, but now account for the convection resistance associated with water flow at a mean velocity of  $u_m = 0.5 \text{ m/s}$  in the pipe. What is the corresponding daily cost of heat loss per meter of the uninsulated pipe?

- 8.34** A thick-walled, stainless steel (AISI 316) pipe of inside and outside diameters  $D_i = 20 \text{ mm}$  and  $D_o = 40 \text{ mm}$  is heated electrically to provide a uniform heat generation rate of  $\dot{q} = 10^6 \text{ W/m}^3$ . The outer surface of the pipe is insulated, while water flows through the pipe at a rate of  $\dot{m} = 0.1 \text{ kg/s}$ .

- (a) If the water inlet temperature is  $T_{m,i} = 20^\circ\text{C}$  and the desired outlet temperature is  $T_{m,o} = 40^\circ\text{C}$ , what is the required pipe length?



- (b) What are the location and value of the maximum pipe temperature?

**8.35** Consider the encased pipe of Problem 4.29, but now allow for the difference between the mean temperature of the fluid, which changes along the pipe length, and that of the pipe.

- (a) For the prescribed values of  $k$ ,  $D$ ,  $w$ ,  $h$ , and  $T_\infty$  and a pipe of length  $L = 100$  m, what is the outlet temperature  $T_{m,o}$  of water that enters the pipe at a temperature of  $T_{m,i} = 90^\circ\text{C}$  and a flow rate of  $\dot{m} = 2$  kg/s?
- (b) What is the pressure drop of the water and the corresponding pump power requirement?
- (c) Subject to the constraint that the width of the duct is fixed at  $w = 0.30$  m, explore the effects of the flow rate and the pipe diameter on the outlet temperature.


**8.36** Water flows through a thick-walled tube with an inner diameter of 12 mm and a length of 8 m. The tube is immersed in a well-stirred, hot reaction tank maintained at  $85^\circ\text{C}$ , and the conduction resistance of the tube wall (based on the inner surface area) is  $R''_{cd} = 0.002$  m<sup>2</sup> · K/W. The inlet temperature of the process fluid is  $T_{m,i} = 20^\circ\text{C}$ , and the flow rate is 33 kg/h.

- (a) Estimate the outlet temperature of the process fluid,  $T_{m,o}$ . Assume, and then justify, fully developed flow and thermal conditions within the tube.
- (b) Do you expect  $T_{m,o}$  to increase or decrease if combined thermal and hydrodynamic entry conditions exist within the tube? Estimate the outlet temperature of the water for this condition.

**8.37** Atmospheric air enters a 10-m-long, 150-mm-diameter uninsulated heating duct at  $60^\circ\text{C}$  and 0.04 kg/s. The duct surface temperature is approximately constant at  $T_s = 15^\circ\text{C}$ .

- (a) What are the outlet air temperature, the heat rate  $q$ , and pressure drop  $\Delta p$  for these conditions?
- (b) To illustrate the tradeoff between heat transfer rate and pressure drop considerations, calculate  $q$  and  $\Delta p$  for diameters in the range from 0.1 to 0.2 m. In your analysis, maintain the total surface area,  $A_s = \pi DL$ , at the value computed for part (a). Plot  $q$ ,  $\Delta p$ , and  $L$  as a function of the duct diameter.

**8.38** An air heater for an industrial application consists of an insulated, concentric tube annulus, for which air flows through a thin-walled inner tube. Saturated steam flows through the outer annulus, and condensation of the steam maintains a uniform temperature  $T_s$  on the tube surface.

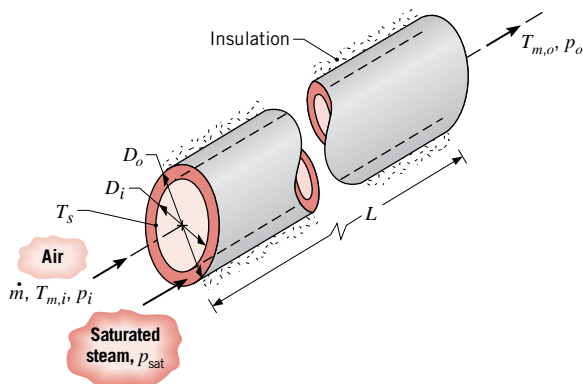

Consider conditions for which air enters a 50-mm-diameter tube at a pressure of 5 atm, a temperature of  $T_{m,i} = 17^\circ\text{C}$ , and a flow rate of  $\dot{m} = 0.03$  kg/s, while saturated steam at 2.455 bars condenses on the outer surface of the tube. If the length of the annulus is  $L = 5$  m, what are the outlet temperature  $T_{m,o}$  and pressure  $p_o$  of the air? What is the mass rate at which condensate leaves the annulus?

**8.39** The products of combustion from a burner are routed to an industrial application through a thin-walled metallic duct of diameter  $D_i = 1$  m and length  $L = 100$  m. The gas enters the duct at atmospheric pressure and a mean temperature and velocity of  $T_{m,i} = 1600$  K and  $u_{m,i} = 10$  m/s, respectively. It must exit the duct at a temperature that is no less than  $T_{m,o} = 1400$  K. What is the minimum thickness of an alumina-silica insulation ( $k_{ins} = 0.125$  W/m · K) needed to meet the outlet requirement under worst case conditions for which the duct is exposed to ambient air at  $T_\infty = 250$  K and a cross-flow velocity of  $V = 15$  m/s? The properties of the gas may be approximated as those of air, and as a first estimate, the effect of the insulation thickness on the convection coefficient and thermal resistance associated with the cross flow may be neglected.

**8.40** Liquid mercury at 0.5 kg/s is to be heated from 300 to 400 K by passing it through a 50-mm-diameter tube whose surface is maintained at 450 K. Calculate the required tube length by using an appropriate liquid metal convection heat transfer correlation. Compare your result with that which would have been obtained by using a correlation appropriate for  $Pr \geq 0.7$ .

**8.41** The surface of a 50-mm-diameter, thin-walled tube is maintained at  $100^\circ\text{C}$ . In one case air is in cross flow over the tube with a temperature of  $25^\circ\text{C}$  and a velocity of 30 m/s. In another case air is in fully developed flow through the tube with a temperature of  $25^\circ\text{C}$  and a mean velocity of 30 m/s. Compare the heat flux from the tube to the air for the two cases.

**8.42** Cooling water flows through the 25.4-mm-diameter thin-walled tubes of a steam condenser at 1 m/s, and a surface temperature of 350 K is maintained by the condensing steam. The water inlet temperature is 290 K, and the tubes are 5 m long.

(a) What is the water outlet temperature? Evaluate water properties at an assumed average mean temperature,  $\bar{T}_m = 300$  K.

(b) Was the assumed value for  $\bar{T}_m$  reasonable? If not, repeat the calculation using properties evaluated at a more appropriate temperature.

(c) A range of tube lengths from 4 to 7 m is available to the engineer designing this condenser. Generate a plot to show what coolant mean velocities are possible if the water outlet temperature is to remain at the value found for part (b). All other conditions remain the same.

**8.43** The air passage for cooling a gas turbine vane can be approximated as a tube of 3-mm diameter and 75-mm length. The operating temperature of the vane is 650°C, and air enters the tube at 427°C.

(a) For an air flow rate of 0.18 kg/h, calculate the air outlet temperature and the heat removed from the vane.

(b) Generate a plot of the air outlet temperature as a function of flow rate for  $0.1 \leq \dot{m} \leq 0.6$  kg/h. Compare this result with those for vanes having 2- and 4-mm-diameter tubes, with all other conditions remaining the same.

**8.44** The core of a high-temperature, gas-cooled nuclear reactor has coolant tubes of 20-mm diameter and 780-mm length. Helium enters at 600 K and exits at 1000 K when the flow rate is  $8 \times 10^{-3}$  kg/s per tube.

(a) Determine the uniform tube wall surface temperature for these conditions.

(b) If the coolant gas is air, determine the required flow rate if the heat removal rate and tube wall surface temperature remain the same. What is the outlet temperature of the air?

**8.45** Air at 200 kPa enters a 2-m-long, thin-walled tube of 25-mm diameter at 150°C and 6 m/s. Steam at 20 bars condenses on the outer surface.

(a) Determine the outlet temperature and pressure drop of the air, as well as the rate of heat transfer to the air.

(b) Calculate the parameters of part (a) if the pressure of the air is doubled.


**8.46** Heated air required for a food-drying process is generated by passing ambient air at 20°C through long, circular tubes ( $D = 50$  mm,  $L = 5$  m) housed in a steam

condenser. Saturated steam at atmospheric pressure condenses on the outer surface of the tubes, maintaining a uniform surface temperature of 100°C.

(a) If an air flow rate of 0.01 kg/s is maintained in each tube, determine the air outlet temperature  $T_{m,o}$  and the total heat rate  $q$  for the tube.

(b) The air outlet temperature may be controlled by adjusting the tube mass flow rate. Compute and plot  $T_{m,o}$  as a function of  $\dot{m}$  for  $0.005 \leq \dot{m} \leq 0.050$  kg/s. If a particular drying process requires approximately 1 kg/s of air at 75°C, what design and operating conditions should be prescribed for the air heater, subject to the constraint that the tube diameter and length be fixed at 50 mm and 5 m, respectively?

**8.47** Consider a horizontal, thin-walled circular tube of diameter  $D = 0.025$  m submerged in a container of *n*-octadecane (paraffin), which is used to store thermal energy. As hot water flows through the tube, heat is transferred to the paraffin, converting it from the solid to liquid state at the phase change temperature of  $T_\infty = 27.4^\circ\text{C}$ . The latent heat of fusion and density of paraffin are  $h_{sf} = 244$  kJ/kg and  $\rho = 770$  kg/m<sup>3</sup>, respectively, and thermophysical properties of the water may be taken as  $c_p = 4.185$  kJ/kg · K,  $k = 0.653$  W/m · K,  $\mu = 467 \times 10^{-6}$  kg/s · m, and  $Pr = 2.99$ .

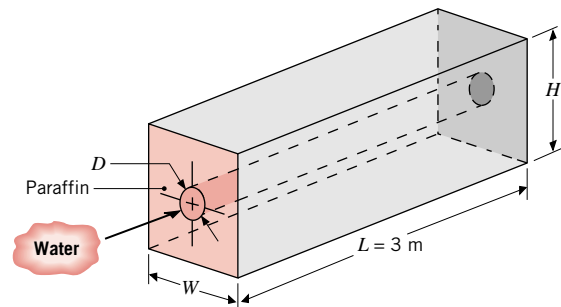


(a) Assuming the tube surface to have a uniform temperature corresponding to that of the phase change, determine the water outlet temperature and total heat transfer rate for a water flow rate of 0.1 kg/s and an inlet temperature of 60°C. If  $H = W = 0.25$  m, how long would it take to completely liquefy the paraffin, from an initial state for which all the paraffin is solid and at 27.4°C?

(b) The liquefaction process can be accelerated by increasing the flow rate of the water. Compute and plot the heat rate and outlet temperature as a function of flow rate for  $0.1 \leq \dot{m} \leq 0.5$  kg/s. How long would it take to melt the paraffin for  $\dot{m} = 0.5$  kg/s?

**8.48** A common procedure for cooling a high-performance computer chip involves joining the chip to a heat sink


within which circular microchannels are machined. During operation, the chip produces a uniform heat flux  $q_c''$  at its interface with the heat sink, while a liquid coolant (water) is routed through the channels. Consider a square chip and heat sink, each  $L \times L$  on a side, with microchannels of diameter  $D$  and pitch  $S = C_1 D$ , where the constant  $C_1$  is greater than unity. Water is supplied at an inlet temperature  $T_{m,i}$  and a total mass flow rate  $\dot{m}$  (for the entire heat sink).

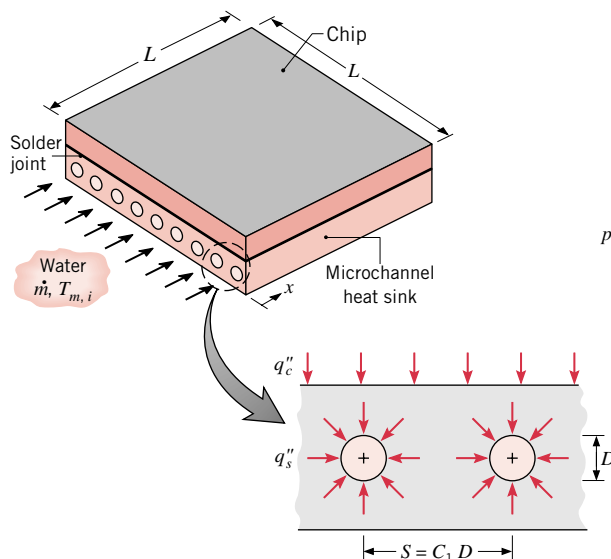

- Assuming that  $q_c''$  is dispersed in the heat sink such that a uniform heat flux  $q_s''$  is maintained at the surface of each channel, obtain expressions for the longitudinal distributions of the mean fluid,  $T_m(x)$ , and surface,  $T_s(x)$ , temperatures in each channel. Assume laminar, fully developed flow throughout each channel, and express your results in terms of  $\dot{m}$ ,  $q_c''$ ,  $C_1$ ,  $D$ , and/or  $L$ , as well as appropriate thermophysical properties.
- For  $L = 12$  mm,  $D = 1$  mm,  $C_1 = 2$ ,  $q_c'' = 20$  W/cm<sup>2</sup>,  $\dot{m} = 0.010$  kg/s, and  $T_{m,i} = 290$  K, compute and plot the temperature distributions  $T_m(x)$  and  $T_s(x)$ .
- A common objective in designing such heat sinks is to maximize  $q_c''$  while maintaining the heat sink at an acceptable temperature. Subject to prescribed values of  $L = 12$  mm and  $T_{m,i} = 290$  K and the constraint that  $T_{s,max} \leq 50^\circ\text{C}$ , explore the effect on  $q_c''$  of variations in heat sink design and operating conditions.

**8.49** One way to cool chips mounted on the circuit boards of a computer is to encapsulate the boards in metal frames that provide efficient pathways for conduction to supporting *cold plates*. Heat generated by the chips is

then dissipated by transfer to water flowing through passages drilled in the plates. Because the plates are made from a metal of large thermal conductivity (typically aluminium or copper), they may be assumed to be at a temperature,  $T_{s,cp}$ .

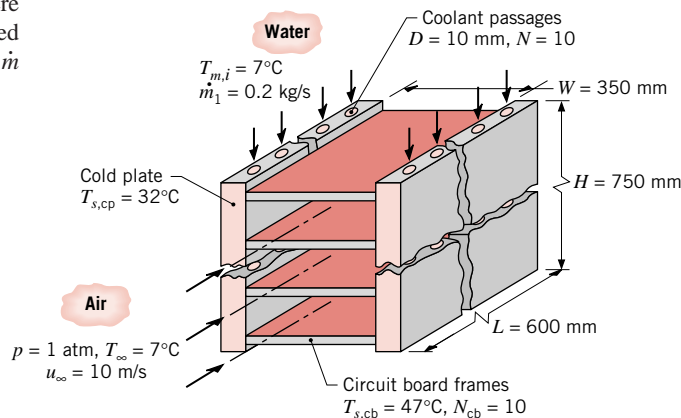


- Consider circuit boards attached to cold plates of height  $H = 750$  mm and width  $L = 600$  mm, each with  $N = 10$  holes of diameter  $D = 10$  mm. If operating conditions maintain plate temperatures of  $T_{s,cp} = 32^\circ\text{C}$  with water flow at  $\dot{m}_1 = 0.2$  kg/s per passage and  $T_{m,i} = 7^\circ\text{C}$ , how much heat may be dissipated by the circuit boards?
- To enhance cooling, thereby allowing increased power generation without an attendant increase in system temperatures, a hybrid cooling scheme may be used. The scheme involves forced air flow over the encapsulated circuit boards, as well as water flow through the cold plates. Consider conditions for which  $N_{cb} = 10$  circuit boards of width  $W = 350$  mm are attached to the cold plates and their average surface temperature is  $T_{s,cb} = 47^\circ\text{C}$  when  $T_{s,cp} = 32^\circ\text{C}$ . If air is in parallel flow over the plates with  $u_\infty = 10$  m/s and  $T_\infty = 7^\circ\text{C}$ , how much of the heat generated by the circuit boards is transferred to the air?

**8.50** Refrigerant-134a is being transported at 0.1 kg/s through a Teflon tube of inside diameter  $D_i = 25$  mm and outside diameter  $D_o = 28$  mm, while atmospheric air at  $V = 25$  m/s and 300 K is in cross flow over the tube. What is the heat transfer per unit length of tube to Refrigerant-134a at 240 K?

**8.51** Oil at  $150^\circ\text{C}$  flows *slowly* through a long, thin-walled pipe of 30-mm inner diameter. The pipe is suspended in a room for which the air temperature is  $20^\circ\text{C}$  and the convection coefficient at the outer tube surface is  $11$  W/m<sup>2</sup> · K. Estimate the heat loss per unit length of tube.

- 8.52** Exhaust gases from a wire processing oven are discharged into a tall stack, and the gas and stack surface temperatures at the outlet of the stack must be estimated. Knowledge of the outlet gas temperature  $T_{m,o}$  is useful for predicting the dispersion of effluents in the thermal plume, while knowledge of the outlet stack surface temperature  $T_{s,o}$  indicates whether condensation of the gas products will occur. The thin-walled, cylindrical stack is 0.5 m in diameter and 6.0 m high. The exhaust gas flow rate is 0.5 kg/s, and the inlet temperature is 600°C.

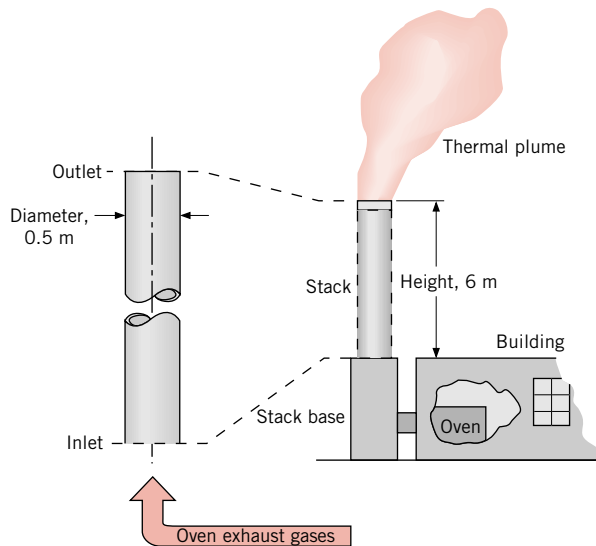


- (a) Consider conditions for which the ambient air temperature and wind velocity are 4°C and 5 m/s, respectively. Approximating the thermophysical properties of the gas as those of atmospheric air, estimate the outlet gas and stack surface temperatures for the given conditions.
- (b) The gas outlet temperature is sensitive to variations in the ambient air temperature and wind velocity. For  $T_\infty = -25^\circ\text{C}$ ,  $5^\circ\text{C}$ , and  $35^\circ\text{C}$ , compute and plot the gas outlet temperature as a function of wind velocity for  $2 \leq V \leq 10$  m/s.

- 8.53** A hot fluid passes through a thin-walled tube of 10-mm diameter and 1-m length, and a coolant at  $T_\infty = 25^\circ\text{C}$  is in cross flow over the tube. When the flow rate is  $\dot{m} = 18$  kg/h and the inlet temperature is  $T_{m,i} = 85^\circ\text{C}$ , the outlet temperature is  $T_{m,o} = 78^\circ\text{C}$ .

Assuming fully developed flow and thermal conditions in the tube, determine the outlet temperature,  $T_{m,o}$ , if the flow rate is increased by a factor of 2. That is,  $\dot{m} = 36$  kg/h, with all other conditions the same. The thermophysical properties of the hot fluid are

$\rho = 1079$  kg/m<sup>3</sup>,  $c_p = 2637$  J/kg · K,  $\mu = 0.0034$  N · s/m<sup>2</sup>, and  $k = 0.261$  W/m · K.

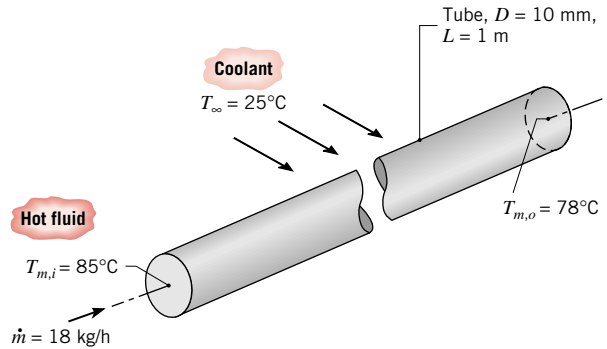

- 8.54** Consider a thin-walled tube of 10-mm diameter and 2-m length. Water enters the tube from a large reservoir at  $\dot{m} = 0.2$  kg/s and  $T_{m,i} = 47^\circ\text{C}$ .

- (a) If the tube surface is maintained at a uniform temperature of  $27^\circ\text{C}$ , what is the outlet temperature of the water,  $T_{m,o}$ ? To obtain the properties of water, assume an average mean temperature of  $\bar{T}_m = 300$  K.
- (b) What is the exit temperature of the water if it is heated by passing air at  $T_\infty = 100^\circ\text{C}$  and  $V = 10$  m/s in cross flow over the tube? The properties of air may be evaluated at an assumed film temperature of  $T_f = 350$  K.
- (c) In the foregoing calculations, were the assumed values of  $\bar{T}_m$  and  $T_f$  appropriate? If not, use properly evaluated properties and recompute  $T_{m,o}$  for the conditions of part (b).

- 8.55** Water at a flow rate of  $\dot{m} = 0.215$  kg/s is cooled from  $70^\circ\text{C}$  to  $30^\circ\text{C}$  by passing it through a thin-walled tube of diameter  $D = 50$  mm and maintaining a coolant at  $T_\infty = 15^\circ\text{C}$  in cross flow over the tube.

- (a) What is the required tube length if the coolant is air and its velocity is  $V = 20$  m/s?
- (b) What is the tube length if the coolant is water and  $V = 2$  m/s?

- 8.56** Consider a thin-walled, metallic tube of length  $L = 1$  m and inside diameter  $D_i = 3$  mm. Water enters the tube at  $\dot{m} = 0.015$  kg/s and  $T_{m,i} = 97^\circ\text{C}$ .

- (a) What is the outlet temperature of the water if the tube surface temperature is maintained at  $27^\circ\text{C}$ ?
- (b) If a 0.5-mm-thick layer of insulation of  $k = 0.05$  W/m · K is applied to the tube and its outer surface is maintained at  $27^\circ\text{C}$ , what is the outlet temperature of the water?
- (c) If the outer surface of the insulation is no longer maintained at  $27^\circ\text{C}$  but is allowed to exchange heat


by free convection with ambient air at 27°C, what is the outlet temperature of the water? The free convection heat transfer coefficient is 5 W/m<sup>2</sup> · K.

**8.57** A thick-walled steel pipe ( $k = 60$  W/m · K) carrying hot water is cooled externally by a cross-flow airstream at a velocity of 20 m/s and a temperature of 25°C. The inner and outer diameters of the pipe are  $D_i = 20$  mm and  $D_o = 25$  mm, respectively. At a certain location along the pipe, the mean temperature of the water is 80°C. Assuming the flow inside the tube is fully developed with a Reynolds number of 20,000, find the heat transfer rate to the airstream per unit pipe length.

**8.58** Heat is to be removed from a reaction vessel operating at 75°C by supplying water at 27°C and 0.12 kg/s through a thin-walled tube of 15-mm diameter. The convection coefficient between the tube outer surface and the fluid in the vessel is 3000 W/m<sup>2</sup> · K.

- If the outlet water temperature cannot exceed 47°C, what is the maximum rate of heat transfer from the vessel?
- What tube length is required to accomplish the heat transfer rate of part (a)?

**8.59** A heating contractor must heat 0.2 kg/s of water from 15°C to 35°C using hot gases in cross flow over a thin-walled tube.

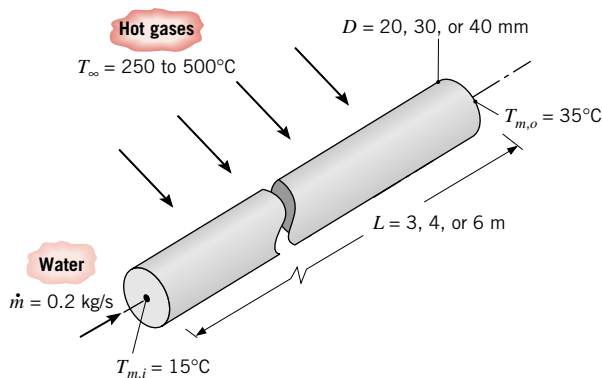

Your assignment is to develop a series of design graphs that can be used to demonstrate acceptable combinations of tube dimensions ( $D$  and  $L$ ) and of hot gas conditions ( $T_\infty$  and  $V$ ) that satisfy this requirement. In your analysis, consider the following parameter ranges:  $D = 20, 30, \text{ or } 40$  mm;  $L = 3, 4, \text{ or } 6$  m;  $T_\infty = 250, 375, \text{ or } 500^\circ\text{C}$ ; and  $20 \leq V \leq 40$  m/s.

**8.60** A thin-walled tube with a diameter of 6 mm and length of 20 m is used to carry exhaust gas from a smoke stack to the laboratory in a nearby building for analysis. The gas enters the tube at 200°C and with a mass flow rate

of 0.003 kg/s. Autumn winds at a temperature of 15°C blow directly across the tube at a velocity of 5 m/s. Assume the thermophysical properties of the exhaust gas are those of air.

- Estimate the average heat transfer coefficient for the exhaust gas flowing inside the tube.
- Estimate the heat transfer coefficient for the air flowing across the outside of the tube.
- Estimate the overall heat transfer coefficient  $U$  and the temperature of the exhaust gas when it reaches the laboratory.

**8.61** A 50-mm-diameter, thin-walled metal pipe covered with a 25-mm-thick layer of insulation (0.085 W/m · K) and carrying superheated steam at atmospheric pressure is suspended from the ceiling of a large room. The steam temperature entering the pipe is 120°C, and the air temperature is 20°C. The convection heat transfer coefficient on the outer surface of the covered pipe is 10 W/m<sup>2</sup> · K. If the velocity of the steam is 10 m/s, at what point along the pipe will the steam begin condensing?


**8.62** A thin-walled, uninsulated 0.3-m-diameter duct is used to route chilled air at 0.05 kg/s through the attic of a large commercial building. The attic air is at 37°C, and natural circulation provides a convection coefficient of 2 W/m<sup>2</sup> · K at the outer surface of the duct. If chilled air enters a 15-m-long duct at 7°C, what is its exit temperature and the rate of heat gain? Properties of the chilled air may be evaluated at an assumed average temperature of 300 K.

**8.63** The problem of heat losses from a fluid moving through a buried pipeline has received considerable attention. Practical applications include the trans-Alaska pipeline, as well as power plant steam and water distribution lines. Consider a steel pipe of diameter  $D$  that is used to transport oil flowing at a rate  $\dot{m}_o$  through a cold region. The pipe is covered with a layer of insulation of thickness  $t$  and thermal conductivity  $k_i$  and is buried in soil to a depth  $z$  (distance from the soil surface to the pipe centerline). Each section of pipe is of length  $L$  and extends between pumping stations in which the oil is heated to ensure low viscosity and hence low pump power requirements. The temperature of the oil entering the pipe from a pumping station and the temperature of the ground above the pipe are designated as  $T_{m,i}$  and  $T_s$ , respectively, and are known.

Consider conditions for which the oil ( $o$ ) properties may be approximated as  $\rho_o = 900$  kg/m<sup>3</sup>,  $c_{p,o} = 2000$  J/kg · K,  $\nu_o = 8.5 \times 10^{-4}$  m<sup>2</sup>/s,  $k_o = 0.140$  W/m · K,  $Pr_o = 10^4$ ; the oil flow rate is  $\dot{m}_o = 500$  kg/s; and the pipe diameter is 1.2 m.




- (a) Expressing your results in terms of  $D$ ,  $L$ ,  $z$ ,  $t$ ,  $\dot{m}_o$ ,  $T_{m,i}$ , and  $T_s$ , as well as the appropriate oil ( $o$ ), insulation ( $i$ ), and soil ( $s$ ) properties, obtain all the expressions needed to estimate the temperature  $T_{m,o}$  of the oil leaving the pipe.
- (b) If  $T_s = -40^\circ\text{C}$ ,  $T_{m,i} = 120^\circ\text{C}$ ,  $t = 0.15\text{ m}$ ,  $k_i = 0.05\text{ W/m}\cdot\text{K}$ ,  $k_s = 0.5\text{ W/m}\cdot\text{K}$ ,  $z = 3\text{ m}$ , and  $L = 100\text{ km}$ , what is the value of  $T_{m,o}$ ? What is the total rate of heat transfer  $q$  from a section of the pipeline?
- (c) The operations manager wants to know the tradeoff between the burial depth of the pipe and insulation thickness on the heat loss from the pipe. Develop a graphical representation of this design information.
- 8.64** In order to maintain pump power requirements per unit flow rate below an acceptable level, operation of the oil pipeline of the preceding problem is subject to the constraint that the oil exit temperature  $T_{m,o}$  exceed  $110^\circ\text{C}$ . For the values of  $T_{m,i}$ ,  $T_s$ ,  $D$ ,  $t$ ,  $z$ ,  $L$ , and  $k_i$  prescribed in Problem 8.63, operating parameters that are variable and affect  $T_{m,o}$  are the thermal conductivity of the soil and the flow rate of the oil. Depending on soil composition and moisture and the demand for oil, representative variations are  $0.25 \leq k_s \leq 1.0\text{ W/m}\cdot\text{K}$  and  $250 \leq \dot{m}_o \leq 500\text{ kg/s}$ . Using the properties prescribed in Problem 8.63, determine the effect of the foregoing variations on  $T_{m,o}$  and the total heat rate  $q$ . What is the worst case operating condition? If necessary, what adjustments could be made to ensure that  $T_{m,o} \geq 110^\circ\text{C}$  for the worst case conditions?
- 8.65** You are designing an operating room heat exchange device to cool blood (bypassed from a patient) from  $40$  to  $30^\circ\text{C}$  by passing the fluid through a coiled tube sitting in a vat of water-ice mixture. The volumetric flow rate ( $\dot{V}$ ) is  $10^{-4}\text{ m}^3/\text{min}$ ; the tube diameter ( $D$ ) is  $2.5\text{ mm}$ ; and  $T_{m,i}$  and  $T_{m,o}$  represent the inlet and outlet temperatures of the blood. Neglect heat transfer enhancement associated with the coiling.
- (a) At what temperature would you evaluate the fluid properties in determining  $\bar{h}$  for the entire tube length?
- (b) If the properties of blood evaluated at the temperature for part (a) are  $\rho = 1000\text{ kg/m}^3$ ,  $\nu = 7 \times 10^{-7}\text{ m}^2/\text{s}$ ,  $k = 0.5\text{ W/m}\cdot\text{K}$ , and  $c_p = 4.0\text{ kJ/kg}\cdot\text{K}$ , what is the Prandtl number for the blood?
- (c) Is the blood flow laminar or turbulent?
- (d) Neglecting all entrance effects and assuming fully developed conditions, calculate the value of  $\bar{h}$  for heat transfer from the blood.
- (e) What is the total heat rate loss from the blood as it passes through the tube?
- (f) When free convection effects on the outside of the tube are included, the average overall heat transfer coefficient  $\bar{U}$  between the blood and the ice-water mixture can be approximated as  $300\text{ W/m}^2\cdot\text{K}$ . Determine the tube length  $L$  required to obtain the outlet temperature  $T_{m,o}$ .
- 8.66** Pressurized water at  $T_{m,i} = 200^\circ\text{C}$  is pumped at  $\dot{m} = 2\text{ kg/s}$  from a power plant to a nearby industrial user through a thin-walled, round pipe of inside diameter  $D = 1\text{ m}$ . The pipe is covered with a layer of insulation of thickness  $t = 0.15\text{ m}$  and thermal conductivity  $k = 0.05\text{ W/m}\cdot\text{K}$ . The pipe, which is of length  $L = 500\text{ m}$ , is exposed to a cross flow of air at  $T_\infty = -10^\circ\text{C}$  and  $V = 4\text{ m/s}$ . Obtain a differential equation that could be used to solve for the variation of the mixed mean temperature of the water  $T_m(x)$  with the axial coordinate. As a first approximation, the internal flow may be assumed to be fully developed throughout the pipe. Express your results in terms of  $\dot{m}$ ,  $V$ ,  $T_\infty$ ,  $D$ ,  $t$ ,  $k$ , and appropriate water ( $w$ ) and air ( $a$ ) properties. Evaluate the heat loss per unit length of the pipe at the inlet. What is the mean temperature of the water at the outlet?
- 8.67** Water at  $290\text{ K}$  and  $0.2\text{ kg/s}$  flows through a Teflon tube ( $k = 0.35\text{ W/m}\cdot\text{K}$ ) of inner and outer radii equal to  $10$  and  $13\text{ mm}$ , respectively. A thin electrical heating tape wrapped around the outer surface of the tube delivers a uniform surface heat flux of  $2000\text{ W/m}^2$ , while a convection coefficient of  $25\text{ W/m}^2\cdot\text{K}$  is maintained on the outer surface of the tape by ambient air at  $300\text{ K}$ . What is the fraction of the power dissipated by the tape, which is transferred to the water? What is the outer surface temperature of the Teflon tube?
- 8.68** The temperature of flue gases flowing through the large stack of a boiler is measured by means of a thermocouple enclosed within a cylindrical tube as shown. The tube axis is oriented normal to the gas flow, and the thermocouple senses a temperature  $T_i$  corresponding to that of the tube surface. The gas flow rate and temperature are designated as  $\dot{m}_g$  and  $T_g$ , respectively, and the gas flow may be assumed to be fully developed. The stack is fabricated from sheet metal that is at a uniform temperature  $T_s$  and is exposed to ambient air at  $T_\infty$  and large surroundings at  $T_{\text{sur}}$ . The convection coefficient associated with the outer surface of the duct is designated as  $h_o$ , while those associated with the inner surface of the duct and the tube surface are designated as  $h_i$  and  $h_t$ , respectively. The tube and duct surface emissivities are designated as  $\epsilon_t$  and  $\epsilon_s$ , respectively.
- (a) Neglecting conduction losses along the thermocouple tube, develop an analysis that could be used to predict the error  $(T_g - T_i)$  in the temperature measurement.

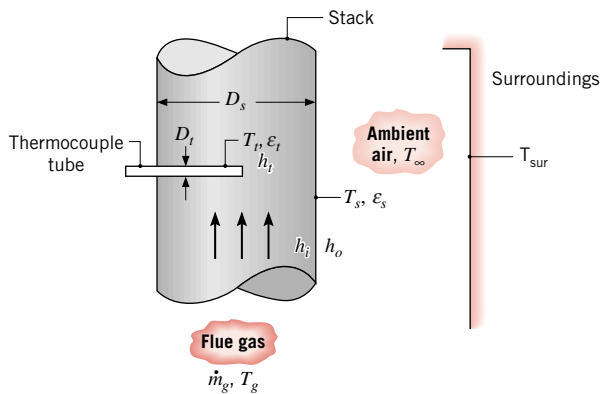


- (b) Assuming the flue gas to have the properties of atmospheric air, evaluate the error for  $T_t = 300^\circ\text{C}$ ,  $D_s = 0.6\text{ m}$ ,  $D_t = 10\text{ mm}$ ,  $\dot{m}_g = 1\text{ kg/s}$ ,  $T_\infty = T_{\text{sur}} = 27^\circ\text{C}$ ,  $\epsilon_t = \epsilon_s = 0.8$ , and  $h_o = 25\text{ W/m}^2 \cdot \text{K}$ .

- 8.69** In a biomedical supplies manufacturing process, a requirement exists for a large platen that is to be maintained at  $45 \pm 0.25^\circ\text{C}$ . The proposed design features the attachment of heating tubes to the platen at a relative spacing  $S$ . The thick-walled, copper tubes have an inner diameter of  $D_i = 8\text{ mm}$  and are attached to the platen with a high thermal conductivity solder, which provides a contact width of  $2D_i$ . The heating fluid (ethylene glycol) flows through each tube at a fixed rate of  $\dot{m} = 0.06\text{ kg/s}$ . The platen has a thickness of  $w = 25\text{ mm}$  and is fabricated from a stainless steel with a thermal conductivity of  $15\text{ W/m} \cdot \text{K}$ .

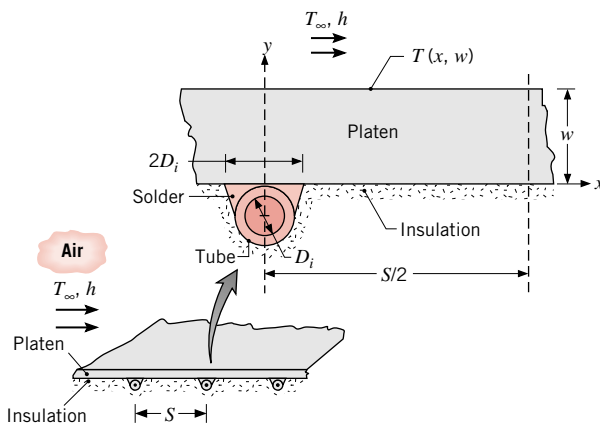

Considering the two-dimensional cross section of the platen shown in the inset, perform an analysis to determine the heating fluid temperature  $T_m$  and the tube spacing  $S$  required to maintain the surface temperature of the platen,  $T(x, w)$ , at  $45 \pm 0.25^\circ\text{C}$ , when the ambient temperature is  $25^\circ\text{C}$  and the convection coefficient is  $100\text{ W/m}^2 \cdot \text{K}$ .

- 8.70** Ground source heat pumps operate by using a liquid, rather than ambient air, as the heat source (or sink) for winter heating (or summer cooling). The liquid flows in a closed loop through plastic tubing that is buried at a depth for which annual variations in the temperature of the soil are much less than those of the ambient air. For example, at a location such as South Bend, Indiana, deep-ground temperatures may remain at approximately  $11^\circ\text{C}$ , while annual excursions in the ambient air temperature may range from  $-25^\circ\text{C}$  to  $+37^\circ\text{C}$ .

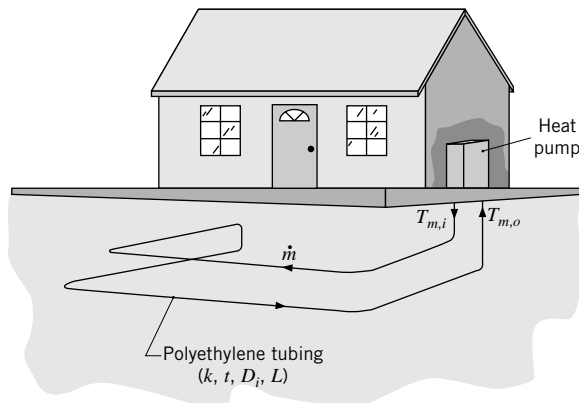

Consider winter conditions for which the liquid is discharged from the heat pump into high-density polyethylene tubing of thickness  $t = 8\text{ mm}$  and thermal conductivity  $k = 0.47\text{ W/m} \cdot \text{K}$ . The tubing is routed through soil that maintains a uniform temperature of approximately  $10^\circ\text{C}$  at the tube outer surface. The properties of the fluid may be approximated as those of water.

- (a) For a tube inner diameter and flow rate of  $D_i = 25\text{ mm}$  and  $\dot{m} = 0.03\text{ kg/s}$  and a fluid inlet temperature of  $T_{m,i} = 0^\circ\text{C}$ , determine the tube outlet temperature (heat pump inlet temperature),  $T_{m,o}$ , as a function of the tube length  $L$  for  $10 \leq L \leq 50\text{ m}$ .
- (b) Recommend an appropriate length for the system. How would your recommendation be affected by variations in the liquid flow rate?


- 8.71** Compare Nusselt predictions based on the Colburn, Dittus–Boelter, Sieder and Tate, and Gnielinski correlations for the fully developed turbulent flow of water in a smooth circular tube at Reynolds numbers of  $4000$ ,  $10^4$ , and  $10^5$  when the average mean temperature is  $295\text{ K}$  and the surface temperature is  $305\text{ K}$ .

- 8.72** For a sharp-edged inlet and a combined entry region, the average Nusselt number may be computed from Equation 8.63, with  $C = 24Re_D^{-0.23}$  and  $m = 0.815 - 2.08 \times 10^{-6}Re_D$  [20]. Determine  $\overline{Nu}_D/Nu_{D,\text{fd}}$  at  $x/D = 10$  and  $60$  for  $Re_D = 10^4$  and  $10^5$ .


- 8.73** Fluid enters a thin-walled tube of 5-mm diameter and 2-m length with a flow rate of 0.04 kg/s and a temperature of  $T_{m,i} = 85^\circ\text{C}$ . The tube surface is maintained at a temperature of  $T_s = 25^\circ\text{C}$ , and for this operating condition, the outlet temperature is  $T_{m,o} = 31.1^\circ\text{C}$ . What is the outlet temperature if the flow rate is doubled? Fully developed, turbulent flow may be assumed to exist in both cases, and the fluid properties may be assumed to be independent of temperature.

### Noncircular Ducts

- 8.74** Air at  $3 \times 10^{-4}$  kg/s and  $27^\circ\text{C}$  enters a rectangular duct that is 1 m long and 4 mm by 16 mm on a side. A uniform heat flux of  $600 \text{ W/m}^2$  is imposed on the duct surface. What is the temperature of the air and of the duct surface at the outlet?
- 8.75** Air at  $4 \times 10^{-4}$  kg/s and  $27^\circ\text{C}$  enters a triangular duct that is 20 mm on a side and 2 m long. The duct surface is maintained at  $100^\circ\text{C}$ . Assuming fully developed flow throughout the duct, determine the air outlet temperature.
- 8.76** Air at  $25^\circ\text{C}$  flows at  $30 \times 10^{-6}$  kg/s within 100-mm-long channels used to cool a high thermal conductivity metal mold. Assume the flow is hydrodynamically and thermally fully developed.
- Determine the heat transferred to the air for a circular channel ( $D = 10$  mm) when the mold temperature is  $50^\circ\text{C}$  (case A).
  - Using new manufacturing methods (see Problem 8.99), channels of complex cross section can be readily fabricated within metal objects, such as molds. Consider air flowing under the same conditions as in case A, except now the channel is segmented into six smaller triangular sections. The flow area of case A is equal to the total flow area of case B. Determine the heat transferred to the air for the segmented channel.
  - Compare the pressure drops for cases A and B.

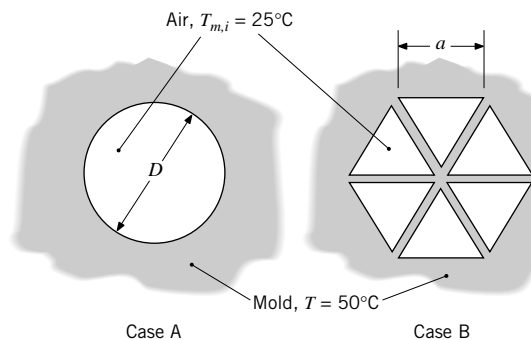

- 8.77** A device that recovers heat from high-temperature combustion products involves passing the combustion gas between parallel plates, each of which is maintained at 350 K by water flow on the opposite surface. The plate separation is 40 mm, and the gas flow is fully developed. The gas may be assumed to have the properties of atmospheric air, and its mean temperature and velocity are 1000 K and 60 m/s, respectively.
- What is the heat flux at the plate surface?
  - If a third plate, 20 mm thick, is suspended midway between the original plates, what is the surface heat flux for the original plates? Assume the temperature and flow rate of the gas to be unchanged and radiation effects to be negligible.
- 8.78** Air at 1 atm and 285 K enters a 2-m-long rectangular duct with cross section 75 mm by 150 mm. The duct is maintained at a constant surface temperature of 400 K, and the air mass flow rate is 0.10 kg/s. Determine the heat transfer rate from the duct to the air and the air outlet temperature.
- 8.79** A double-wall heat exchanger is used to transfer heat between liquids flowing through semicircular copper tubes. Each tube has a wall thickness of  $t = 3$  mm and an inner radius of  $r_i = 20$  mm, and good contact is maintained at the plane surfaces by tightly wound straps. The tube outer surfaces are well insulated.

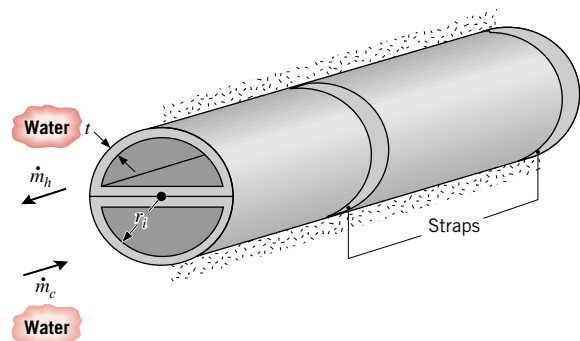


- If hot and cold water at mean temperatures of  $T_{h,m} = 330$  K and  $T_{c,m} = 290$  K flow through the adjoining tubes at  $\dot{m}_h = \dot{m}_c = 0.2$  kg/s, what is the rate of heat transfer per unit length of tube? The wall contact resistance is  $10^{-5} \text{ m}^2 \cdot \text{K/W}$ . Approximate the properties of both the hot and cold water as  $\mu = 800 \times 10^{-6} \text{ kg/s} \cdot \text{m}$ ,  $k = 0.625 \text{ W/m} \cdot \text{K}$ , and  $Pr = 5.35$ . *Hint:* Heat transfer is enhanced by conduction through the semicircular portions of the tube walls, and each portion may be subdivided into two straight fins with adiabatic tips.
- Using the thermal model developed for part (a), determine the heat transfer rate per unit length




when the fluids are ethylene glycol. Also, what effect will fabricating the exchanger from an aluminum alloy have on the heat rate? Will increasing the thickness of the tube walls have a beneficial effect?

- 8.80** You have been asked to perform a feasibility study on the design of a blood warmer to be used during the transfusion of blood to a patient. This exchanger is to heat blood taken from the bank at  $10^\circ\text{C}$  to  $37^\circ\text{C}$  at a flow rate of 200 ml/min. The blood passes through a rectangular cross-section tube, 6.4 mm by 1.6 mm, which is sandwiched between two plates held at a constant temperature of  $40^\circ\text{C}$ .

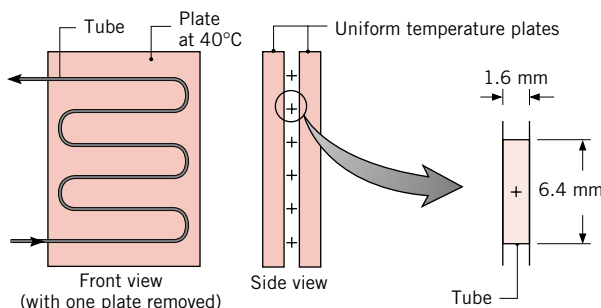


- Compute the length of the tubing required to achieve the desired outlet conditions at the specified flow rate. Assume the flow is fully developed and the blood has the same properties as water.
- Assess your assumptions and indicate whether your analysis over- or underestimates the necessary length.

- 8.81** A coolant flows through a rectangular channel (*gallery*) within the body of a mold used to form metal injection parts. The *gallery* dimensions are  $a = 90$  mm and  $b = 9.5$  mm, and the fluid flow rate is  $1.3 \times 10^{-3}$  m<sup>3</sup>/s. The coolant temperature is  $15^\circ\text{C}$ , and the mold wall is at an approximately uniform temperature of  $140^\circ\text{C}$ .

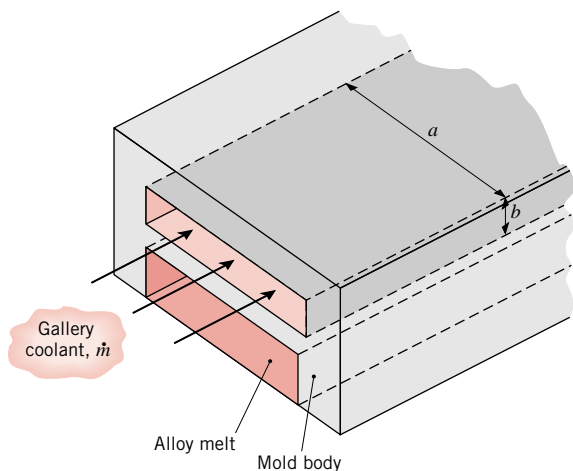

To minimize corrosion damage to the expensive mold, it is customary to use a heat transfer fluid such as ethylene glycol, rather than process water. Compare the convection coefficients of water and ethylene glycol for this application. What is the trade-off between thermal performance and minimizing corrosion?

- 8.82** A *cold plate* is an active cooling device that is attached to a heat-generating system in order to dissipate the heat while maintaining the system at an acceptable temperature. It is typically fabricated from a material of high thermal conductivity,  $k_{cp}$ , within which channels are machined and a coolant is passed. Consider a copper cold plate of height  $H$  and width  $W$  on a side, within which water passes through square channels of width  $w = h$ . The transverse spacing between channels  $\delta$  is twice the spacing between the sidewall of an outer channel and the sidewall of the cold plate.

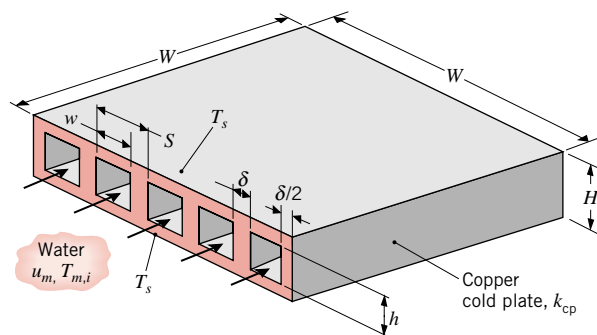


Consider conditions for which *equivalent* heat-generating systems are attached to the top and bottom of the cold plate, maintaining the corresponding surfaces at the same temperature  $T_s$ . The mean velocity and inlet temperature of the coolant are  $u_m$  and  $T_{m,i}$ , respectively.

- Assuming fully developed turbulent flow throughout each channel, obtain a system of equations that may be used to evaluate the total rate of heat transfer to the cold plate,  $q$ , and the outlet temperature of the water,  $T_{m,o}$ , in terms of the specified parameters.
- Consider a cold plate of width  $W = 100$  mm and height  $H = 10$  mm, with 10 square channels of width  $w = 6$  mm and a spacing of  $\delta = 4$  mm between channels. Water enters the channels at a temperature of  $T_{m,i} = 300$  K and a velocity of  $u_m = 2$  m/s. If the top and bottom cold plate surfaces are at  $T_s = 360$  K, what is the outlet water temperature and the total rate of heat transfer to the cold plate? The thermal conductivity of the copper is  $400$  W/m  $\cdot$  K, while average properties of the water may be taken to be  $\rho = 984$  kg/m<sup>3</sup>,  $c_p = 4184$  J/kg  $\cdot$  K,  $\mu = 489 \times 10^{-6}$  N  $\cdot$  s/m<sup>2</sup>,  $k = 0.65$  W/m  $\cdot$  K, and  $Pr = 3.15$ . Is

this a good cold plate design? How could its performance be improved?


**8.83** The cold plate design of Problem 8.82 has not been optimized with respect to selection of the channel width, and we wish to explore conditions for which the rate of heat transfer may be enhanced. Assume that the width and height of the copper cold plate are fixed at  $W = 100$  mm and  $H = 10$  mm, while the channel height and spacing between channels are fixed at  $h = 6$  mm and  $\delta = 4$  mm. The mean velocity and inlet temperature of the water are maintained at  $u_m = 2$  m/s and  $T_{m,i} = 300$  K, while equivalent heat-generating systems attached to the top and bottom of the cold plate maintain the corresponding surfaces at 360 K. Evaluate the effect of changing the channel width, and hence the number of channels, on the rate of heat transfer to the cold plate. Include consideration of the limiting case for which  $w = 96$  mm (one channel).

**8.84** An electronic circuit board dissipating 50 W is sandwiched between two ducted, forced-air-cooled heat sinks. The sinks are 150 mm in length and have 24 rectangular passages 6 mm by 25 mm. Atmospheric air at a volumetric flow rate of  $0.060$  m<sup>3</sup>/s and 27°C is drawn through the sinks by a blower. Estimate the operating temperature of the board and the pressure drop across the sinks.

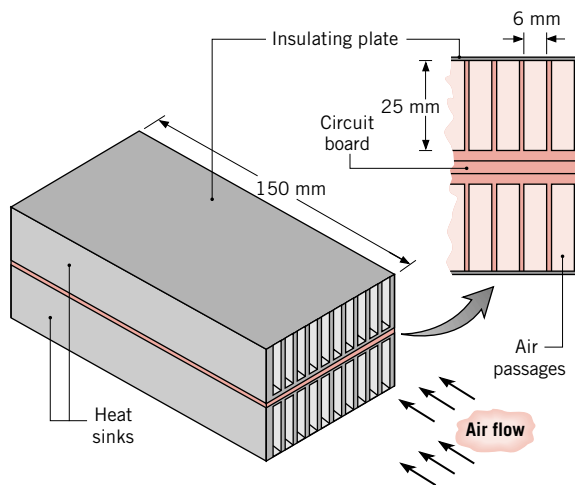


**8.85** To slow down large prime movers like locomotives, a process termed dynamic electric braking is used to switch the traction motor to a generator mode in which mechanical power from the drive wheels is absorbed and used to generate electrical current. As shown in the schematic, the electric power is passed through a resistor grid (a), which consists of an array of metallic blades electrically connected in series (b). The blade

material is a high-temperature, high electrical resistivity alloy, and the electrical power is dissipated as heat by internal volumetric generation. To cool the blades, a motor-fan moves high-velocity air through the grid.

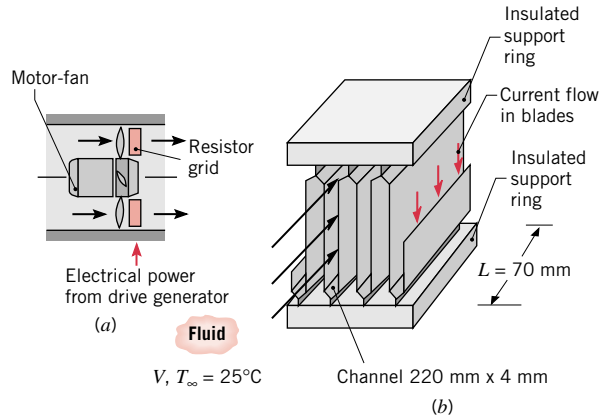


- Treating the space between the blades as a rectangular channel of 220-mm  $\times$  4-mm cross section and 70-mm length, estimate the heat removal rate per blade if the air stream has an inlet temperature and velocity of 25°C and 50 m/s, respectively, while the blade has an operating temperature of 600°C.
- On a locomotive pulling a 10-car train, there may be 2000 of these blades. Based on your result from part (a), how long will it take to slow a train whose total mass is  $10^6$  kg from a speed of 120 km/h to 50 km/h using dynamic electric braking?

**8.86** To cool electronic components that are mounted to a printed circuit board and hermetically sealed from their surroundings, two boards may be joined to form an intermediate channel through which the coolant is passed. Termed a hollow-core PCB, all of the heat generated by the components may be assumed to be transferred to the coolant.

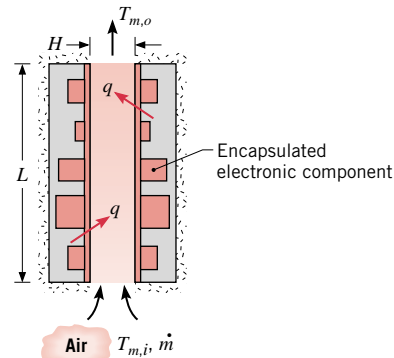

Consider a hollow-core PCB of length  $L = 300$  mm and equivalent width  $W$  (normal to the page). Under normal operating conditions, 40 W of power are dissipated on each side of the PCB and a uniform distribution of the attendant heat transfer may be assumed for each of the hollow-core surfaces. If air enters a core of height  $H = 4$  mm at a temperature of  $T_{m,i} = 20^\circ\text{C}$  and a flow rate of  $\dot{m} = 0.002$  kg/s, what is its outlet temperature  $T_{m,o}$ ? What are the surface temperatures at the inlet and outlet of the core? What are the foregoing temperatures if the flow rate is increased by a factor of five?

- 8.87** A printed circuit board (PCB) is cooled by laminar, fully developed air flow in adjoining, parallel-plate channels of length  $L$  and separation distance  $a$ . The channels may be assumed to be of infinite extent in the transverse direction, and the upper and lower surfaces are insulated. The temperature  $T_s$  of the PCB board is uniform, and air flow with an inlet temperature of  $T_{m,i}$  is driven by a pressure difference,  $\Delta p$ .

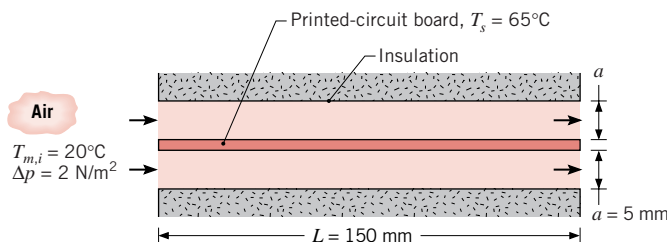

Calculate the average heat removal rate per unit area ( $\text{W/m}^2$ ) from the PCB.

- 8.88** Referring to Figure 8.11, consider conditions in an annulus having an outer surface that is insulated ( $q_o'' = 0$ ) and a uniform heat flux  $q_i''$  at the inner surface. Fully developed, laminar flow may be assumed to exist.


- Determine the velocity profile  $u(r)$  in the annular region.
- Determine the temperature profile  $T(r)$  and obtain an expression for the Nusselt number  $Nu_i$  associated with the inner surface.

- 8.89** Consider the air heater of Problem 8.38, but now with air flow through the annulus and steam flow through the inner tube. For the prescribed conditions and an outer tube diameter of  $D_o = 65$  mm, determine the outlet temperature and pressure of the air, as well as the mass rate of steam condensation.

- 8.90** Consider a concentric tube annulus for which the inner and outer diameters are 25 and 50 mm. Water enters the annular region at 0.04 kg/s and  $25^\circ\text{C}$ . If the inner tube wall is heated electrically at a rate (per unit length) of  $q' = 4000$  W/m, while the outer tube wall is insulated,

how long must the tubes be for the water to achieve an outlet temperature of  $85^\circ\text{C}$ ? What is the inner tube surface temperature at the outlet, where fully developed conditions may be assumed?

- 8.91** It is common practice to recover waste heat from an oil- or gas-fired furnace by using the exhaust gases to pre-heat the combustion air. A device commonly used for this purpose consists of a concentric pipe arrangement for which the exhaust gases are passed through the inner pipe, while the cooler combustion air flows through an annular passage around the pipe.

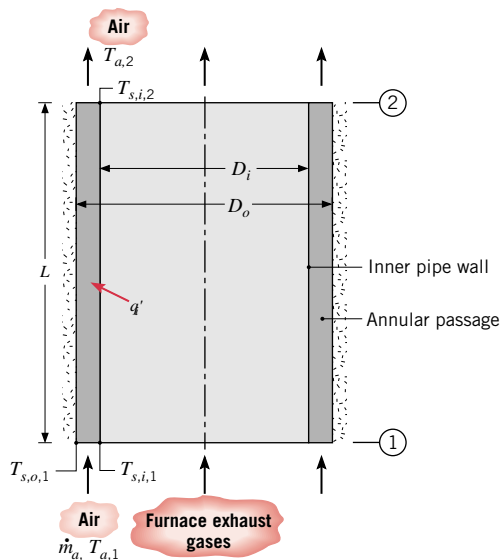


Consider conditions for which there is a uniform heat transfer rate per unit length,  $q'_i = 1.25 \times 10^5$  W/m, from the exhaust gases to the pipe inner surface, while air flows through the annular passage at a rate of  $\dot{m}_a = 2.1$  kg/s. The thin-walled inner pipe is of diameter  $D_i = 2$  m, while the outer pipe, which is well insulated from the surroundings, is of diameter  $D_o = 2.05$  m. The air properties may be taken to be  $c_p = 1030$  J/kg  $\cdot$  K,  $\mu = 270 \times 10^{-7}$  N  $\cdot$  s/m<sup>2</sup>,  $k = 0.041$  W/m  $\cdot$  K, and  $Pr = 0.68$ .

- If air enters at  $T_{a,1} = 300$  K and  $L = 7$  m, what is the air outlet temperature  $T_{a,2}$ ?
- If the airflow is fully developed throughout the annular region, what is the temperature of the inner pipe at the inlet ( $T_{s,i,1}$ ) and outlet ( $T_{s,i,2}$ ) sections of the device? What is the outer surface temperature  $T_{s,o,1}$  at the inlet?

- 8.92** A concentric tube arrangement, for which the inner and outer diameters are 80 mm and 100 mm, respectively, is used to remove heat from a biochemical reaction occurring in a 1-m-long settling tank. Heat is generated uniformly

within the tank at a rate of  $10^5 \text{ W/m}^3$ , and water is supplied to the annular region at a rate of  $0.2 \text{ kg/s}$ .

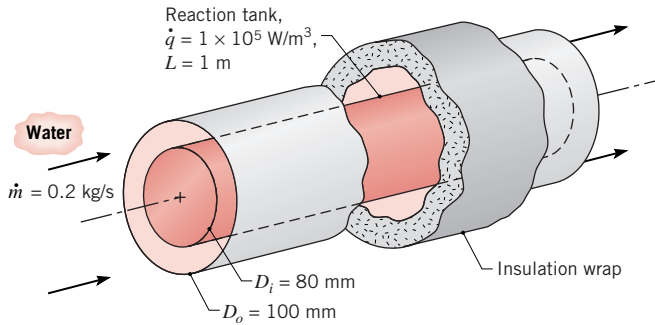

- (a) Determine the inlet temperature of the supply water that will maintain an average tank surface temperature of  $37^\circ\text{C}$ . Assume fully developed flow and thermal conditions. Is this assumption reasonable?
- (b) It is desired to have a slight, axial temperature gradient on the tank surface, since the rate of the biochemical reaction is highly temperature dependent. Sketch the axial variation of the water and surface temperatures along the flow direction for the following two cases: (i) the fully developed conditions of part (a), and (ii) conditions for which entrance effects are important. Comment on features of the temperature distributions. What change to the system or operating conditions would you make to reduce the surface temperature gradient?
- 8.93** Water at  $\dot{m} = 0.02 \text{ kg/s}$  and  $T_{m,i} = 20^\circ\text{C}$  enters an annular region formed by an inner tube of diameter  $D_i = 25 \text{ mm}$  and an outer tube of diameter  $D_o = 100 \text{ mm}$ . Saturated steam flows through the inner tube, maintaining its surface at a uniform temperature of  $T_{s,i} = 100^\circ\text{C}$ , while the outer surface of the outer tube is well insulated. If fully developed conditions may be assumed throughout the annulus, how long must the system be to provide an outlet water temperature of  $75^\circ\text{C}$ ? What is the heat flux from the inner tube at the outlet?
- 8.94** For the conditions of Problem 8.93, how long must the annulus be if the water flow rate is  $0.30 \text{ kg/s}$  instead of  $0.02 \text{ kg/s}$ ?

### Heat Transfer Enhancement

- 8.95** Consider the air cooling system and conditions of Problem 8.31, but with a prescribed pipe length of  $L = 15 \text{ m}$ .
- (a) What is the air outlet temperature,  $T_{m,o}$ ? What is the fan power requirement?
- (b) The convection coefficient associated with airflow in the pipe may be increased twofold by inserting a


coiled spring along the length of the pipe to disrupt flow conditions near the inner surface. If such a heat transfer enhancement scheme is adopted, what is the attendant value of  $T_{m,o}$ ? Use of the insert would not come without a corresponding increase in the fan power requirement. What is the power requirement if the friction factor is increased by 50%?

- (c) After extended exposure to the water, a thin coating of organic matter forms on the outer surface of the pipe, and its thermal resistance (for a unit area of the outer surface) is  $R''_{t,o} = 0.050 \text{ m}^2 \cdot \text{K/W}$ . What is the corresponding value of  $T_{m,o}$  without the insert of part (b)?

- 8.96** Consider sterilization of the pharmaceutical product of Problem 8.27. To avoid any possibility of heating the product to an unacceptably high temperature, atmospheric steam is condensed on the exterior of the tube instead of using the resistance heater, providing a uniform surface temperature,  $T_s = 100^\circ\text{C}$ .

- (a) For the conditions of Problem 8.27, determine the required length of straight tube,  $L_s$ , that would be needed to increase the mean temperature of the pharmaceutical product from  $25^\circ\text{C}$  to  $75^\circ\text{C}$ .
- (b) Consider replacing the straight tube with a coiled tube characterized by a coil diameter  $C = 100 \text{ mm}$  and a coil pitch  $S = 25 \text{ mm}$ . Determine the overall length of the coiled tube,  $L_{cl}$  (i.e., the product of the tube pitch and the number of coils), necessary to increase the mean temperature of the pharmaceutical to the desired value.
- (c) Calculate the pressure drop through the straight tube and through the coiled tube.
- (d) Calculate the steam condensation rate.


- 8.97** An electrical power transformer of diameter  $230 \text{ mm}$  and height  $500 \text{ mm}$  dissipates  $1000 \text{ W}$ . It is desired to maintain its surface temperature at  $47^\circ\text{C}$  by supplying ethylene glycol at  $24^\circ\text{C}$  through thin-walled tubing of  $20\text{-mm}$  diameter welded to the lateral surface of the transformer. All the heat dissipated by the transformer is assumed to be transferred to the ethylene glycol.

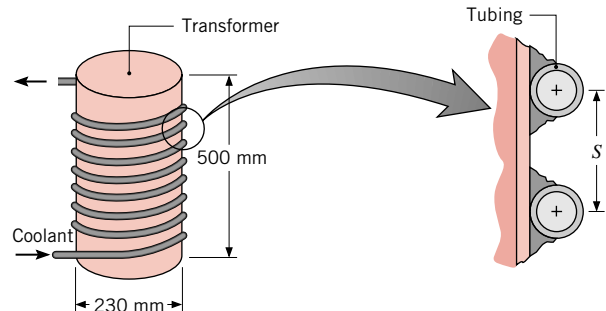

Assuming the maximum allowable temperature rise of the coolant to be  $6^\circ\text{C}$ , determine the required coolant flow rate, the total length of tubing, and the coil pitch  $S$  between turns of the tubing.

- 8.98** A *bayonet cooler* is used to reduce the temperature of a pharmaceutical fluid. The pharmaceutical fluid flows through the cooler, which is fabricated of 10-mm-diameter, thin-walled tubing with two 250-mm-long straight sections and a coil with six and a half turns and a coil diameter of 75 mm. A coolant flows outside the cooler, with a convection coefficient at the outside surface of  $h_o = 500 \text{ W/m}^2 \cdot \text{K}$  and a coolant temperature of  $20^\circ\text{C}$ . Consider the situation where the pharmaceutical fluid enters at  $90^\circ\text{C}$  with a mass flow rate of  $0.005 \text{ kg/s}$ . The pharmaceutical has the following properties:  $\rho = 1200 \text{ kg/m}^3$ ,  $\mu = 4 \times 10^{-3} \text{ N} \cdot \text{s/m}^2$ ,  $c_p = 2000 \text{ J/kg} \cdot \text{K}$ , and  $k = 0.5 \text{ W/m} \cdot \text{K}$ .

- Determine the outlet temperature of the pharmaceutical fluid.
- It is desired to further reduce the outlet temperature of the pharmaceutical. However, because the cooling process is just one part of an intricate processing operation, flow rates cannot be changed. A young engineer suggests that the outlet temperature might be reduced by inserting stainless steel coiled springs into the straight sections of the cooler with the notion that the springs will disturb the flow adjacent to the inner tube wall and, in turn, increase the heat transfer coefficient at the inner tube wall. A senior engineer asserts that insertion of the springs should double the heat transfer coefficient at the straight inner tube walls. Determine the outlet temperature of the pharmaceutical fluid with the springs inserted into the tubes, assuming the senior engineer is correct in his assertion.

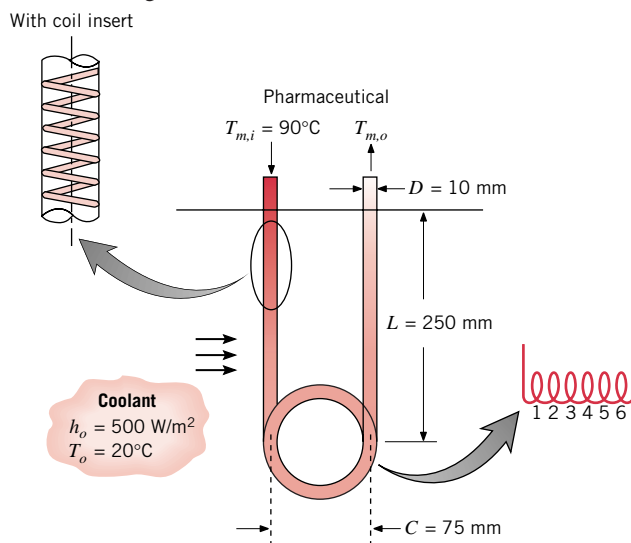

- Would you expect the outlet temperature of the pharmaceutical to depend on whether the springs have a left-hand or right-hand spiral? Why?


- 8.99** The mold used in an injection molding process consists of a top half and a bottom half. Each half is  $60 \text{ mm} \times 60 \text{ mm} \times 20 \text{ mm}$  and is constructed of metal ( $\rho = 7800 \text{ kg/m}^3$ ,  $c = 450 \text{ J/kg} \cdot \text{K}$ ). The cold mold ( $100^\circ\text{C}$ ) is to be heated to  $200^\circ\text{C}$  with pressurized water (available at  $275^\circ\text{C}$  and a total flow rate of  $0.02 \text{ kg/s}$ ) prior to injecting the thermoplastic material. The injection takes only a fraction of a second, and the hot mold ( $200^\circ\text{C}$ ) is subsequently cooled with cold water (available at  $25^\circ\text{C}$  and a total flow rate of  $0.02 \text{ kg/s}$ ) prior to ejecting the molded part. After part ejection, which also takes a fraction of a second, the process is repeated.

- In conventional mold design, straight cooling (heating) passages are bored through the mold in a location where the passages will not interfere with the molded part. Determine the initial heating rate and the initial cooling rate of the mold when five 5-mm-diameter, 60-mm-long passages are bored in each half of the mold (10 passages total). The velocity distribution of the water is fully developed at the entrance of each passage in the hot (or cold) mold.
- New additive manufacturing processes, known as *selective freeform fabrication*, or *SFF*, are used to construct molds that are configured with *conformal cooling passages*. Consider the same mold as before, but now a 5-mm-diameter, coiled, conformal cooling passage is designed within each half of the SFF-manufactured mold. Each of the two coiled passages has  $N = 2$  turns. The coiled passage does not interfere with the molded part. The conformal channels have a coil diameter  $C = 50 \text{ mm}$ . The total water flow remains the same as in part (a) ( $0.01 \text{ kg/s}$  per coil). Determine the initial heating rate and the initial cooling rate of the mold.
- Compare the surface areas of the conventional and conformal cooling passages. Compare the rate at which the mold temperature changes for molds configured with the conventional and conformal heating and cooling passages. Which cooling passage, conventional or conformal, will enable production of more parts per day? Neglect the presence of the thermoplastic material.

- 8.100** Consider the pharmaceutical product of Problem 8.27. Prior to finalizing the manufacturing process, test trials are performed to experimentally determine the dependence of the shelf life of the drug as a




function of the sterilization temperature. Hence, the sterilization temperature must be carefully controlled in the trials. To promote good mixing of the pharmaceutical and, in turn, relatively uniform outlet temperatures across the exit tube area, experiments are performed using a device that is constructed of two interwoven coiled tubes, each of 10-mm diameter. The thin-walled tubing is welded to a solid high thermal conductivity rod of diameter  $D_r = 40$  mm. One tube carries the pharmaceutical product at a mean velocity of  $u_p = 0.1$  m/s and inlet temperature of  $25^\circ\text{C}$ , while the second tube carries pressurized liquid water at  $u_w = 0.12$  m/s with an inlet temperature of  $127^\circ\text{C}$ . The tubes do not contact each other but are each welded to the solid metal rod, with each tube making 20 turns around the rod. The exterior of the apparatus is well insulated.

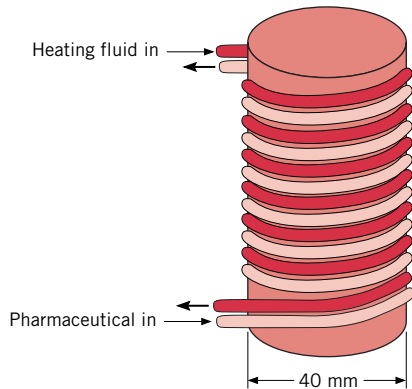

- Determine the outlet temperature of the pharmaceutical product. Evaluate the liquid water properties at 380 K.
- Investigate the sensitivity of the pharmaceutical's outlet temperature to the velocity of the pressurized water over the range  $0.10 < u_w < 0.25$  m/s.

### Microscale Internal Flow


- 8.101** An extremely effective method of cooling high-power-density silicon chips involves etching microchannels in the back (noncircuit) surface of the chip. The channels are covered with a silicon cap, and cooling is maintained by passing water through the channels.

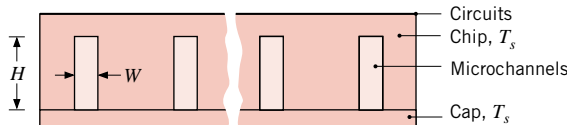

Consider a chip that is 10 mm by 10 mm on a side and in which fifty 10-mm-long rectangular microchannels, each

of width  $W = 50 \mu\text{m}$  and height  $H = 200 \mu\text{m}$ , have been etched. Consider operating conditions for which water enters each microchannel at a temperature of 290 K and a flow rate of  $10^{-4}$  kg/s, while the chip and cap are at a uniform temperature of 350 K. Assuming fully developed flow in the channel and that all the heat dissipated by the circuits is transferred to the water, determine the water outlet temperature and the chip power dissipation. Water properties may be evaluated at 300 K.

- 8.102** Consider the microchannel cooling arrangement of Problem 8.101. However, instead of assuming the entire chip and cap to be at a uniform temperature, adopt a more conservative (and realistic) approach that prescribes a temperature of  $T_s = 350$  K at the base of the channels ( $x = 0$ ) and allows for a decrease in temperature with increasing  $x$  along the side walls of each channel.

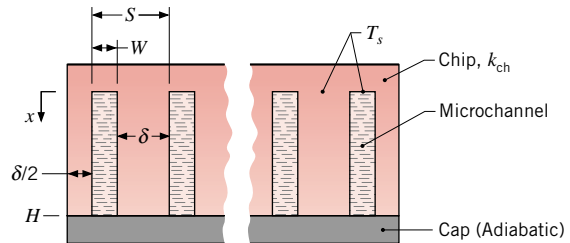

- For the operating conditions prescribed in Problem 8.101 and a chip thermal conductivity of  $k_{ch} = 140 \text{ W/m} \cdot \text{K}$ , determine the water outlet temperature and the chip power dissipation. Heat transfer from the sides of the chip to the surroundings and from the side walls of a channel to the cap may be neglected. Note that the spacing between channels,  $\delta = S - W$ , is twice the spacing between the side wall of an outer channel and the outer surface of the chip. The channel pitch is  $S = L/N$ , where  $L = 10$  mm is the chip width and  $N = 50$  is the number of channels.
- The channel geometry prescribed in Problem 8.101 and considered in part (a) is not optimized, and larger heat rates may be dissipated by adjusting related dimensions. Consider the effect of reducing the pitch to a value of  $S = 100 \mu\text{m}$ , while retaining a width of  $W = 50 \mu\text{m}$  and a flow rate per channel of  $\dot{m}_1 = 10^{-4}$  kg/s.


- 8.103** Due to its comparatively large thermal conductivity, water is a preferred fluid for convection cooling. However, in applications involving electronic devices, water must not come into contact with the devices, which would therefore have to be hermetically sealed. To circumvent related design and operational complexities

and to ensure that the devices are not rendered inoperable by contact with the coolant, a dielectric fluid is commonly used in lieu of water. Many gases have excellent dielectric characteristics, and despite its poor heat transfer properties, air is the common choice for electronic cooling. However, there is an alternative, which involves a class of *perfluorinated liquids* that are excellent dielectrics and have heat transfer properties superior to those of gases.

Consider the microchannel chip cooling application of Problem 8.102, but now for a perfluorinated liquid with properties of  $c_p = 1050 \text{ J/kg} \cdot \text{K}$ ,  $k = 0.065 \text{ W/m} \cdot \text{K}$ ,  $\mu = 0.0012 \text{ N} \cdot \text{s/m}^2$  and  $Pr = 15$ .

- For channel dimensions of  $H = 200 \mu\text{m}$ ,  $W = 50 \mu\text{m}$  and  $S = 200 \mu\text{m}$ , a chip thermal conductivity of  $k_{\text{ch}} = 140 \text{ W/m} \cdot \text{K}$  and width  $L = 10 \text{ mm}$ , a channel base temperature ( $x = 0$ ) of  $T_s = 350 \text{ K}$ , a channel inlet temperature of  $T_{m,i} = 290 \text{ K}$ , and a flow rate of  $\dot{m}_1 = 10^{-4} \text{ kg/s}$  per channel, determine the outlet temperature and the chip power dissipation for the dielectric liquid.
- Consider the foregoing conditions, but with air at a flow rate of  $\dot{m}_1 = 10^{-6} \text{ kg/s}$  used as the coolant. Using properties of  $c_p = 1007 \text{ J/kg} \cdot \text{K}$ ,  $k = 0.0263 \text{ W/m} \cdot \text{K}$ , and  $\mu = 185 \times 10^{-7} \text{ N} \cdot \text{s/m}^2$ , determine the air outlet temperature and the chip power dissipation.

**8.104** A novel scheme for dissipating heat from the chips of a multichip array involves machining coolant channels in the ceramic substrate to which the chips are attached. The square chips ( $L_c = 5 \text{ mm}$ ) are aligned above each of the channels, with longitudinal and transverse pitches of  $S_L = S_T = 20 \text{ mm}$ . Water flows through the square cross section ( $W = 5 \text{ mm}$ ) of each channel with a mean velocity of  $u_m = 1 \text{ m/s}$ , and its properties may be approximated as  $\rho = 1000 \text{ kg/m}^3$ ,  $c_p = 4180 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 855 \times 10^{-6} \text{ kg/s} \cdot \text{m}$ ,  $k = 0.610 \text{ W/m} \cdot \text{K}$ , and  $Pr = 5.8$ . Symmetry in the transverse direction dictates the existence of equivalent conditions for each substrate section of length  $L_s$  and width  $S_T$ .

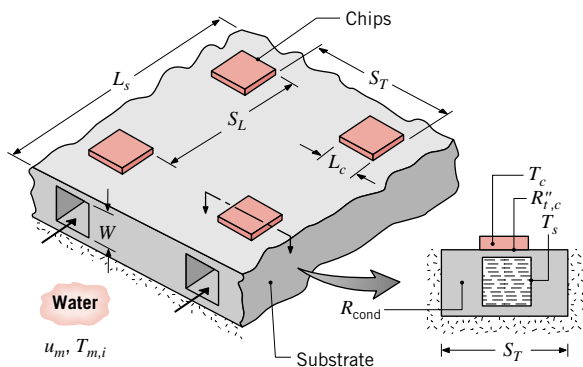

- Consider a substrate whose length in the flow direction is  $L_s = 200 \text{ mm}$ , thereby providing a total of  $N_L = 10$  chips attached in-line above each flow channel. To a good approximation, all the heat dissipated by the chips above a channel may be assumed to be transferred to the water flowing through the channel. If each chip dissipates  $5 \text{ W}$ , what is the temperature rise of the water passing through the channel?
- The chip–substrate contact resistance is  $R''_{t,c} = 0.5 \times 10^{-4} \text{ m}^2 \cdot \text{K/W}$ , and the three-dimensional conduction resistance for the  $L_s \times S_T$  substrate section is  $R_{\text{cond}} = 0.120 \text{ K/W}$ . If water enters the substrate at  $25^\circ\text{C}$  and is in fully developed flow, estimate the temperature  $T_c$  of the chips and the temperature  $T_s$  of the substrate channel surface.

**8.105** An experiment is designed to study microscale forced convection. Water at  $T_{m,i} = 300 \text{ K}$  is to be heated in a straight, circular glass tube with a  $50\text{-}\mu\text{m}$  inner diameter and a wall thickness of  $1 \text{ mm}$ . Warm water at  $T_\infty = 350 \text{ K}$ ,  $V = 2 \text{ m/s}$  is in cross flow over the exterior tube surface. The experiment is to be designed to cover the operating range  $1 \leq Re_D \leq 2000$ , where  $Re_D$  is the Reynolds number associated with the internal flow.

- Determine the tube length  $L$  that meets a design requirement that the tube be twice as long as the thermal entrance length associated with the highest Reynolds number of interest. Evaluate water properties at  $305 \text{ K}$ .
- Determine the water outlet temperature,  $T_{m,o}$ , that is expected to be associated with  $Re_D = 2000$ . Evaluate the heating water (water in cross flow over the tube) properties at  $330 \text{ K}$ .
- Calculate the pressure drop from the entrance to the exit of the tube for  $Re_D = 2000$ .
- Based on the calculated flow rate and pressure drop in the tube, estimate the height of a column of water (at  $300 \text{ K}$ ) necessary to supply the necessary pressure at the tube entrance and the time needed to collect  $0.1$  liter of water. Discuss how the outlet temperature of the water flowing from the tube,  $T_{m,o}$ , might be measured.

**8.106** An experiment is devised to measure liquid flow and convective heat transfer rates in microscale channels. The mass flow rate through a channel is determined by measuring the amount of liquid that has flowed through the channel and dividing by the duration of the experiment. The mean temperature of the outlet fluid is also measured. To minimize the time needed to perform the experiment (that is, to collect a significant amount of liquid so that its mass and temperature can be accurately measured), arrays of microchannels are

typically used. Consider an array of microchannels of circular cross section, each with a nominal diameter of  $50\ \mu\text{m}$ , fabricated into a copper block. The channels are  $20\ \text{mm}$  long, and the block is held at  $310\ \text{K}$ . Water at an inlet temperature of  $300\ \text{K}$  is forced into the channels from a pressurized plenum, so that a pressure difference of  $2.5 \times 10^6\ \text{Pa}$  exists from the entrance to the exit of each channel.


In many microscale systems, the characteristic dimensions are similar to the tolerances that can be controlled during the manufacture of the experimental apparatus. Hence, careful consideration of the effect of machining tolerances must be made when interpreting the experimental results.

- Consider the case in which three microchannels are machined in the copper block. The channel diameters exhibit some deviation due to manufacturing constraints and are of actual diameter  $45\ \mu\text{m}$ ,  $50\ \mu\text{m}$ , and  $55\ \mu\text{m}$ , respectively. Calculate the mass flow rate through each of the three channels, along with the mean outlet temperature of each channel.
- If the water exiting each of the three channels is collected and mixed in a single container, calculate the average flow rate through each of the three channels and the average mixed temperature of the water that is collected from all three channels.
- The enthusiastic experimentalist uses the average flow rate and the average mixed outlet temperature to analyze the performance of the average ( $50\ \mu\text{m}$ ) diameter channel and concludes that flow rates and heat transfer coefficients are increased and decreased, respectively, by about 5% when forced convection occurs in microchannels. Comment on the validity of the experimentalist's conclusion.


## Mass Transfer

- In the processing of very long plastic tubes of  $2\text{-mm}$  inside diameter, air flows inside the tubing with a Reynolds number of 1000. The interior layer of the plastic material evaporates into the air under fully developed conditions. Both plastic and air are at  $400\ \text{K}$ , and the Schmidt number for the mixture of the plastic vapor and air is 2.0. Determine the convection mass transfer coefficient.
- Air at  $300\ \text{K}$  and a flow rate of  $3\ \text{kg/h}$  passes upward through a  $30\text{-mm}$  tube, as shown in the sketch. A thin film of water, also at  $300\ \text{K}$ , slowly falls downward on the inner surface of the tube.

Determine the convection mass transfer coefficient for this situation.

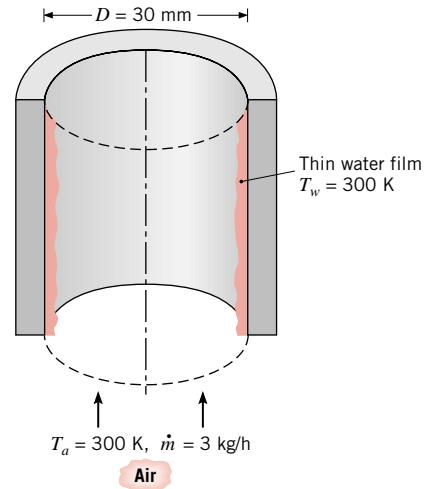

- What is the convection mass transfer coefficient associated with fully developed atmospheric airflow at  $27^\circ\text{C}$  and  $0.04\ \text{kg/s}$  through a  $50\text{-mm}$ -diameter tube whose surface has been coated with a thin layer of naphthalene? Determine the velocity and concentration entry lengths.
- Air flowing through a tube of  $75\text{-mm}$  diameter passes over a  $150\text{-mm}$ -long roughened section that is constructed from naphthalene having the properties  $\mathcal{M} = 128.16\ \text{kg/kmol}$  and  $p_{\text{sat}}(300\ \text{K}) = 1.31 \times 10^{-4}\ \text{bar}$ . The air is at  $1\ \text{atm}$  and  $300\ \text{K}$ , and the Reynolds number is  $Re_D = 35,000$ . In an experiment for which flow was maintained for  $3\ \text{h}$ , mass loss due to sublimation from the roughened surface was determined to be  $0.01\ \text{kg}$ . What is the associated convection mass transfer coefficient? What would be the corresponding convection heat transfer coefficient? Contrast these results with those predicted by conventional smooth tube correlations.
- Dry air at  $35^\circ\text{C}$  and a velocity of  $10\ \text{m/s}$  flows over a thin-walled tube of  $20\text{-mm}$  diameter and  $200\text{-mm}$  length, having a fibrous coating that is water-saturated.

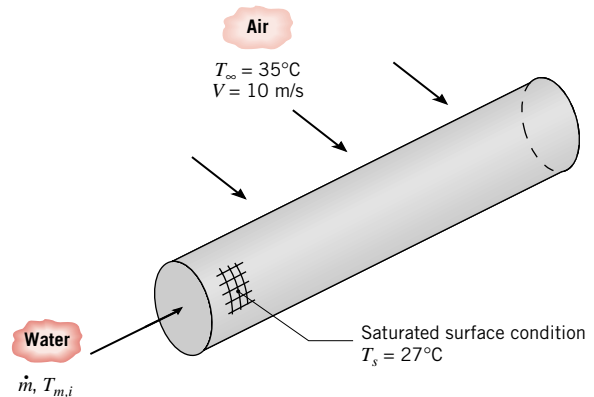



To maintain an approximately uniform surface temperature of 27°C, water at a prescribed flow rate and temperature passes through the tube.

- Considering the heat and mass transfer processes on the external surface of the tube, determine the heat rate from the tube.
- For a flow rate of 0.025 kg/s, determine the inlet temperature,  $T_{m,i}$ , at which water must be supplied to the tube.

**8.112** Consider gas flow of mass density  $\rho$  and rate  $\dot{m}$  through a tube whose inner surface is coated with a liquid or a sublimable solid of uniform vapor density  $\rho_{A,s}$ . Derive Equation 8.84 for variation of the mean vapor density,  $\rho_{A,m}$ , with distance  $x$  from the tube entrance and Equation 8.81 for the total rate of vapor transfer from a tube of length  $L$ .

**8.113** Atmospheric air at 25°C and  $3 \times 10^{-4}$  kg/s flows through a 10-mm-diameter, 1-m-long circular tube whose inner surface is wetted with a water film. Determine the water vapor density at the tube outlet, assuming the inlet air to be dry. What is the rate at which vapor is added to the air?

**8.114** Air at 25°C and 1 atm is in fully developed flow at  $\dot{m} = 10^{-3}$  kg/s through a 10-mm-diameter circular tube whose inner surface is wetted with water. Determine the tube length required for the water vapor in the air to reach 99% of saturation. The inlet air is dry.


**8.115** A humidifier consists of a bundle of vertical tubes, each of 20-mm diameter, through which dry atmospheric air is in fully developed flow at  $10^{-3}$  kg/s and 298 K. The inner tube surface is wetted with a water film. Determine the tube length required for the water vapor to reach 99% of saturation. What is the rate at which energy must be supplied to each tube to maintain its temperature at 298 K?

**8.116** The final step of a manufacturing process in which a protective coating is applied to the inner surface of a circular tube involves passage of dry, atmosphere air through the tube to remove a residual liquid associated with the process. Consider a coated 5-m-long tube with an inner diameter of 50 mm. The tube is maintained at a temperature of 300 K, and the residual liquid exists as a thin film whose corresponding vapor pressure is 15 mm Hg. The molecular weight and diffusion coefficient of the vapor are  $\mathcal{M}_A = 70$  kg/kmol and  $D_{AB} = 10^{-5}$  m<sup>2</sup>/s, respectively. Air enters the tube at a mean velocity of 0.5 m/s and a temperature of 300 K.

- Estimate the partial pressure and mass density of vapor in the air exiting the tube.


- What is the rate of liquid removal from the tube in kg/s?

**8.117** Dry air is inhaled at a rate of 10 liter/min through a trachea with a diameter of 20 mm and a length of 125 mm. The inner surface of the trachea is at a normal body temperature of 37°C and may be assumed to be saturated with water.

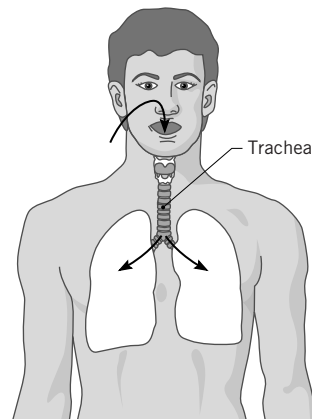

- Assuming steady, fully developed flow in the trachea, estimate the mass transfer convection coefficient.
- Estimate the daily water loss (liter/day) associated with evaporation in the trachea.

**8.118** A mass transfer operation is preceded by laminar flow of a gaseous species B through a circular tube that is sufficiently long to achieve a fully developed velocity profile. Once the fully developed condition is reached, the gas enters a section of the tube that is wetted with a liquid film (A). The film maintains a uniform vapor density  $\rho_{A,s}$  along the tube surface.

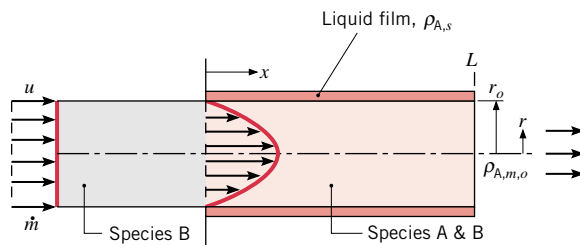

- Write the differential equation and boundary conditions that govern the species A mass density distribution,  $\rho_A(x, r)$ , for  $x > 0$ .
- What is the heat transfer analog to this problem? From this analog, write an expression for the

- average Sherwood number associated with mass exchange over the region  $0 \leq x \leq L$ .
- (c) Beginning with application of conservation of species to a differential control volume of extent  $\pi r_o^2 dx$ , derive an expression (Equation 8.84) that may be used to determine the mean vapor density  $\rho_{A,m,o}$  at  $x = L$ .
- (d) Consider conditions for which species B is air at 25°C and 1 atm and the liquid film consists of water, also at 25°C. The flow rate is  $\dot{m} = 2.5 \times 10^{-4}$  kg/s, and the tube diameter is  $D = 10$  mm. What is the mean vapor density at the tube outlet if  $L = 1$  m?



# *CHAPTER* 9

## Free Convection



**I**n preceding chapters we considered convection transfer in fluid flows that originate from an *external forcing* condition. For example, fluid motion may be induced by a fan or a pump, or it may result from propulsion of a solid through the fluid. In the presence of a temperature gradient, *forced convection* heat transfer will occur.

Now we consider situations for which there is no *forced* velocity, yet convection currents exist within the fluid. Such situations are referred to as *free* or *natural convection*, and they originate when a *body force* acts on a fluid in which there are *density gradients*. The net effect is a *buoyancy force*, which induces free convection currents. In the most common case, the density gradient is due to a temperature gradient, and the body force is due to the gravitational field.

Since free convection flow velocities are generally much smaller than those associated with forced convection, the corresponding convection transfer rates are also smaller. It is perhaps tempting to therefore attach less significance to free convection processes. This temptation should be resisted. In many systems involving multimode heat transfer effects, free convection provides the largest resistance to heat transfer and therefore plays an important role in the design or performance of the system. Moreover, when it is desirable to minimize heat transfer rates or to minimize operating cost, free convection is often preferred to forced convection.

There are, of course, many applications. Free convection strongly influences the operating temperatures of power generating and electronic devices. It plays a major role in a vast array of thermal manufacturing applications. Free convection is important in establishing temperature distributions within buildings and in determining heat losses or heat loads for heating, ventilating, and air conditioning systems. Free convection distributes the poisonous products of combustion during fires and is relevant to the environmental sciences, where it drives oceanic and atmospheric motions, as well as the related heat transfer and mass transfer processes.

In this chapter our objectives are to obtain an appreciation for the physical origins and nature of buoyancy-driven flows and to acquire tools for performing related heat transfer calculations.


## 9.1

### *Physical Considerations*

---

In free convection fluid motion is due to buoyancy forces within the fluid, while in forced convection it is externally imposed. *Buoyancy is due to the combined presence of a fluid density gradient and a body force that is proportional to density.* In practice, the body force is usually *gravitational*, although it may be a centrifugal force in rotating fluid machinery or a Coriolis force in atmospheric and oceanic rotational motions. There are also several ways in which a mass density gradient may arise in a fluid, but for the most common situation it is due to the presence of a temperature gradient. We know that the density of gases and liquids depends on temperature, generally decreasing (due to fluid expansion) with increasing temperature ( $\partial\rho/\partial T < 0$ ).

In this text we focus on free convection problems in which the density gradient is due to a temperature gradient and the body force is gravitational. However, the

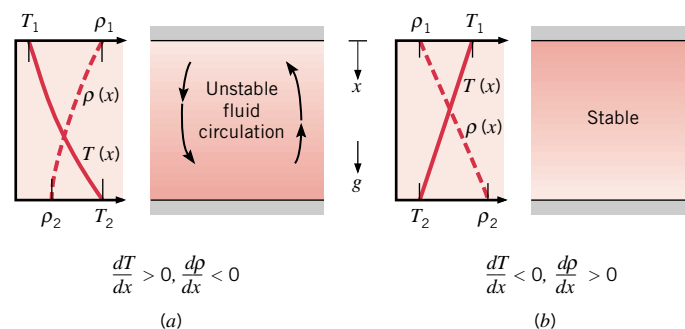


**FIGURE 9.1** Conditions in a fluid between large horizontal plates at different temperatures. (a) Unstable temperature gradient. (b) Stable temperature gradient.

presence of a fluid density gradient in a gravitational field does not ensure the existence of free convection currents. Consider the conditions of Figure 9.1. A fluid is enclosed by two large, horizontal plates of different temperature ( $T_1 \neq T_2$ ). In case *a* the temperature of the lower plate exceeds that of the upper plate, and the density decreases in the direction of the gravitational force. If the temperature difference exceeds a critical value, conditions are *unstable* and buoyancy forces are able to overcome the retarding influence of viscous forces. The gravitational force on the denser fluid in the upper layers exceeds that acting on the lighter fluid in the lower layers, and the designated circulation pattern will exist. The heavier fluid will descend, being warmed in the process, while the lighter fluid will rise, cooling as it moves. However, this condition does not characterize case *b*, for which  $T_1 > T_2$  and the density no longer decreases in the direction of the gravitational force. Conditions are now *stable*, and there is no bulk fluid motion. In case *a* heat transfer occurs from the bottom to the top surface by free convection; for case *b* heat transfer (from top to bottom) occurs by conduction.

Free convection flows may be classified according to whether the flow is bounded by a surface. In the absence of an adjoining surface, *free boundary flows* may occur in the form of a *plume* or a *buoyant jet* (Figure 9.2). A plume is associated with fluid rising from a submerged heated object. Consider the heated wire of Figure 9.2a, which is immersed in an *extensive, quiescent* fluid.<sup>1</sup> Fluid that is heated by the wire rises due to buoyancy forces, entraining fluid from the quiescent region. Although the width of the plume increases with distance from the wire, the plume itself will eventually dissipate as a result of viscous effects and a reduction in the buoyancy force caused by cooling of the fluid in the plume. The distinction between a plume and a buoyant jet is generally made on the basis of the *initial* fluid velocity. This velocity is zero for the plume, but finite for the buoyant jet. Figure 9.2b shows a heated fluid being discharged as a horizontal jet into a quiescent medium of lower temperature. The vertical motion that the jet begins to assume is due to the buoyancy force. Such a condition occurs when warm water


<sup>1</sup>An extensive medium is, in principle, an infinite medium. Since a quiescent fluid is one that is otherwise at rest, the velocity of fluid far from the heated wire is zero.

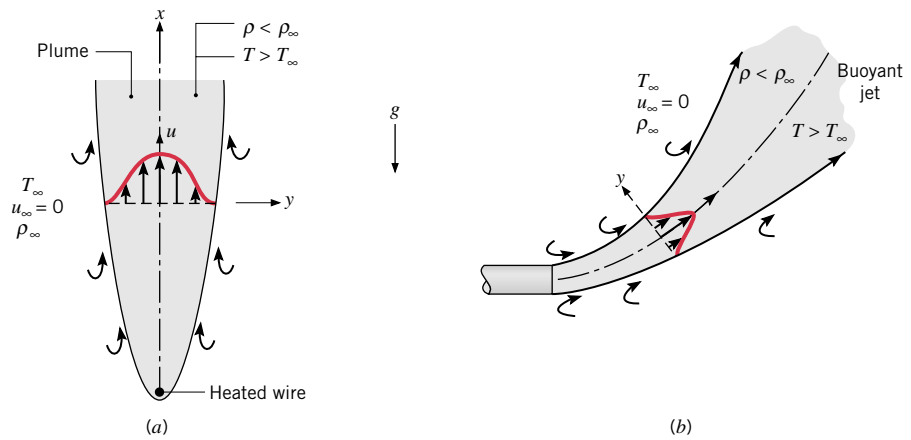

**FIGURE 9.2** Buoyancy-driven free boundary layer flows in an extensive, quiescent medium. (a) Plume formation above a heated wire. (b) Buoyant jet associated with a heated discharge.

from the condenser of a central power station is discharged into a reservoir of cooler water. Free boundary flows are discussed in considerable detail by Jaluria [1] and Gebhart et al. [2].

In this text we focus on free convection flows bounded by a surface, and a classic example relates to boundary layer development on a heated vertical plate (Figure 9.3). The plate is immersed in an extensive, quiescent fluid, and with  $T_s > T_\infty$  the fluid close to the plate is less dense than fluid that is further removed. Buoyancy forces therefore induce a free convection boundary layer in which the heated fluid rises vertically, entraining fluid from the quiescent region. The resulting velocity distribution is unlike that associated with forced convection boundary layers. In particular, the velocity is zero as  $y \rightarrow \infty$ , as well as at  $y = 0$ . A free convection boundary layer also develops if  $T_s < T_\infty$ . In this case, however, fluid motion is downward.

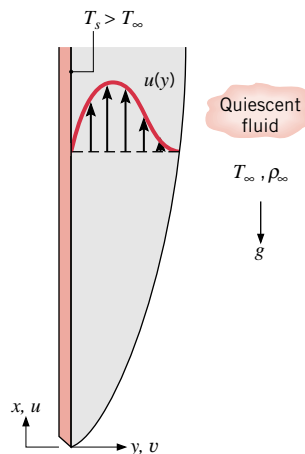

**FIGURE 9.3** Boundary layer development on a heated vertical plate.

## 9.2

### The Governing Equations

As for forced convection, the equations that describe momentum and energy transfer in free convection originate from the related conservation principles. Moreover, the specific processes are much like those that dominate in forced convection. Inertia and viscous forces remain important, as does energy transfer by advection and diffusion. The difference between the two flows is that, in free convection, a major role is played by buoyancy forces. It is such forces that, in fact, sustain the flow.

Consider a laminar boundary layer flow (Figure 9.3) that is driven by buoyancy forces. Assume steady, two-dimensional, constant property conditions in which the gravity force acts in the negative  $x$  direction. Also, with one exception, assume the fluid to be incompressible. The exception involves accounting for the effect of variable density in the buoyancy force, since it is this variation that induces fluid motion. Finally, assume that the boundary layer approximations are valid.

With the foregoing simplifications the  $x$ -momentum equation (Equation D.2) reduces to the boundary layer equation (Equation 6.28), except that the body force term  $X$  is retained. If the only contribution to this force is made by gravity, the body force per unit volume is  $X = -\rho g$ , where  $g$  is the local acceleration due to gravity. The appropriate form of the  $x$ -momentum equation is then

$$u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} = -\frac{1}{\rho} \frac{dp_{\infty}}{dx} - g + \nu \frac{\partial^2 u}{\partial y^2} \quad (9.1)$$

where  $dp_{\infty}/dx$  is the free stream pressure gradient in the quiescent region *outside* the boundary layer. In this region,  $u = 0$  and Equation 9.1 reduces to

$$\frac{dp_{\infty}}{dx} = -\rho_{\infty} g \quad (9.2)$$

Substituting Equation 9.2 into 9.1, we obtain the following expression:

$$u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} = g (\Delta \rho / \rho) + \nu \frac{\partial^2 u}{\partial y^2} \quad (9.3)$$

where  $\Delta \rho = \rho_{\infty} - \rho$ . This expression must apply at every point in the free convection boundary layer.

The first term on the right-hand side of Equation 9.3 is the buoyancy force, and flow originates because the density  $\rho$  is a variable. If density variations are due only to temperature variations, the term may be related to a fluid property known as the *volumetric thermal expansion coefficient*

$$\beta = -\frac{1}{\rho} \left( \frac{\partial \rho}{\partial T} \right)_p \quad (9.4)$$

This *thermodynamic* property of the fluid provides a measure of the amount by which the density changes in response to a change in temperature at constant pressure. If it is expressed in the following approximate form,

$$\beta \approx -\frac{1}{\rho} \frac{\Delta \rho}{\Delta T} = -\frac{1}{\rho} \frac{\rho_{\infty} - \rho}{T_{\infty} - T}$$



it follows that

$$(\rho_\infty - \rho) \approx \rho\beta(T - T_\infty)$$

This simplification is known as the *Boussinesq approximation*, and substituting into Equation 9.3, the  $x$ -momentum equation becomes

$$u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} = g\beta(T - T_\infty) + \nu \frac{\partial^2 u}{\partial y^2} \quad (9.5)$$

where it is now apparent how the buoyancy force, which drives the flow, is related to the temperature difference.

Since buoyancy effects are confined to the momentum equation, the mass and energy conservation equations are unchanged from forced convection. Equations 6.27 and 6.29 may then be used to complete the problem formulation. The set of governing equations is then

$$\frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} = 0 \quad (9.6)$$

$$u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} = g\beta(T - T_\infty) + \nu \frac{\partial^2 u}{\partial y^2} \quad (9.7)$$

$$u \frac{\partial T}{\partial x} + v \frac{\partial T}{\partial y} = \alpha \frac{\partial^2 T}{\partial y^2} \quad (9.8)$$

Note that viscous dissipation has been neglected in the energy equation, (9.8), an assumption that is certainly reasonable for the small velocities associated with free convection. In the mathematical sense the appearance of the buoyancy term in Equation 9.7 complicates matters. No longer may the hydrodynamic problem, given by Equations 9.6 and 9.7, be uncoupled from and solved to the exclusion of the thermal problem, given by Equation 9.8. The solution to the momentum equation depends on knowledge of  $T$ , and hence on the solution to the energy equation. Equations 9.6 through 9.8 are therefore strongly coupled and must be solved simultaneously.

Free convection effects obviously depend on the expansion coefficient  $\beta$ . The manner in which  $\beta$  is obtained depends on the fluid. For an ideal gas,  $\rho = p/RT$  and

$$\beta = -\frac{1}{\rho} \left( \frac{\partial \rho}{\partial T} \right)_p = \frac{1}{\rho} \frac{p}{RT^2} = \frac{1}{T} \quad (9.9)$$

where  $T$  is the *absolute* temperature. For liquids and nonideal gases,  $\beta$  must be obtained from appropriate property tables (Appendix A).

### 9.3

#### Similarity Considerations

Let us now consider the dimensionless parameters that govern free convective flow and heat transfer. As for forced convection (Chapter 6), the parameters may be obtained by nondimensionalizing the governing equations. Introducing

$$x^* \equiv \frac{x}{L} \quad y^* \equiv \frac{y}{L}$$

$$u^* \equiv \frac{u}{u_0} \quad v^* \equiv \frac{v}{u_0} \quad T^* \equiv \frac{T - T_\infty}{T_s - T_\infty}$$

where  $L$  is a characteristic length and  $u_0$  is an *arbitrary* reference velocity,<sup>2</sup> the  $x$ -momentum and energy equations (9.7 and 9.8) reduce to

$$u^* \frac{\partial u^*}{\partial x^*} + v^* \frac{\partial u^*}{\partial y^*} = \frac{g\beta(T_s - T_\infty)L}{u_0^2} T^* + \frac{1}{Re_L} \frac{\partial^2 u^*}{\partial y^{*2}} \quad (9.10)$$

$$u^* \frac{\partial T^*}{\partial x^*} + v^* \frac{\partial T^*}{\partial y^*} = \frac{1}{Re_L Pr} \frac{\partial^2 T^*}{\partial y^{*2}} \quad (9.11)$$

The dimensionless parameter in the first term on the right-hand side of Equation 9.10 is a direct consequence of the buoyancy force. Since the reference velocity  $u_0$  is arbitrary, it can be chosen to simplify the form of the equation. It is convenient to choose  $u_0^2 = g\beta(T_s - T_\infty)L$ , so that the term multiplying  $T^*$  becomes unity. Then,  $Re_L$  becomes  $[g\beta(T_s - T_\infty)L^3/\nu^2]^{1/2}$ . It is customary to define the *Grashof number*  $Gr_L$  as the square of this Reynolds number:

$$Gr_L \equiv \frac{g\beta(T_s - T_\infty)L^3}{\nu^2} \quad (9.12)$$

As a result,  $Re_L$  in Equations 9.10 and 9.11 is replaced by  $Gr_L^{1/2}$ , and we see that the Grashof number (or more precisely,  $Gr_L^{1/2}$ ) plays the same role in free convection that the Reynolds number plays in forced convection. Based on the resulting form of Equations 9.10 and 9.11, we expect heat transfer correlations of the form  $Nu_L = f(Gr_L, Pr)$  in free convection. Recall that the *Reynolds number* provides a measure of the *ratio of the inertial to viscous forces* acting on a fluid element. In contrast, the *Grashof number* is a measure of the *ratio of the buoyancy forces to the viscous forces* acting on the fluid.

When forced and free convection effects are comparable, the situation is more complex. For example, consider the boundary layer of Figure 9.3, but with a non zero free stream velocity,  $u_\infty$ . In this case, it is more convenient to choose the characteristic velocity as  $u_\infty$  (so that the free stream boundary condition for the dimensionless velocity,  $u^*$ , is simply  $u^*(y^* \rightarrow \infty) \rightarrow 1$ ). Then the  $T^*$  term in Equation 9.10 will be multiplied by  $Gr_L/Re_L^2$ , and the resulting Nusselt number expressions will be of the form  $Nu_L = f(Re_L, Gr_L, Pr)$ . Generally, the combined effects of free and forced convection must be considered when  $Gr_L/Re_L^2 \approx 1$ . If the inequality  $Gr_L/Re_L^2 \ll 1$  is satisfied, free convection effects may be neglected and  $Nu_L = f(Re_L, Pr)$ . Conversely, if  $Gr_L/Re_L^2 \gg 1$ , forced convection effects may be neglected and  $Nu = f(Gr_L, Pr)$ , as indicated in the preceding paragraph for pure free convection.

<sup>2</sup>Since free stream conditions are quiescent in free convection, there is no logical external reference velocity ( $V$  or  $u_\infty$ ), as in forced convection.

## 9.4

### Laminar Free Convection on a Vertical Surface

Numerous solutions to the laminar free convection boundary layer equations have been obtained, and a special case that has received much attention involves free convection from an isothermal vertical surface in an extensive quiescent medium (Figure 9.3). For this geometry Equations 9.6 through 9.8 must be solved subject to boundary conditions of the form<sup>3</sup>

$$\begin{aligned} y = 0: \quad & u = v = 0 \quad T = T_s \\ y \rightarrow \infty: \quad & u \rightarrow 0 \quad T \rightarrow T_\infty \end{aligned}$$

A similarity solution to the foregoing problem has been obtained by Ostrach [3]. The solution involves transforming variables by introducing a *similarity parameter* of the form

$$\eta \equiv \frac{y}{x} \left( \frac{Gr_x}{4} \right)^{1/4} \quad (9.13)$$

and representing the velocity components in terms of a stream function defined as

$$\psi(x, y) \equiv f(\eta) \left[ 4\nu \left( \frac{Gr_x}{4} \right)^{1/4} \right] \quad (9.14)$$

With the foregoing definition of the stream function, the  $x$ -velocity component may be expressed as

$$\begin{aligned} u &= \frac{\partial \psi}{\partial y} = \frac{\partial \psi}{\partial \eta} \frac{\partial \eta}{\partial y} = 4\nu \left( \frac{Gr_x}{4} \right)^{1/4} f'(\eta) \frac{1}{x} \left( \frac{Gr_x}{4} \right)^{1/4} \\ &= \frac{2\nu}{x} Gr_x^{1/2} f'(\eta) \end{aligned} \quad (9.15)$$

where primed quantities indicate differentiation with respect to  $\eta$ . Hence  $f'(\eta) \equiv df/d\eta$ . Evaluating the  $y$ -velocity component  $v = -\partial\psi/\partial x$  in a similar fashion and introducing the dimensionless temperature


$$T^* \equiv \frac{T - T_\infty}{T_s - T_\infty} \quad (9.16)$$

the three original partial differential equations (9.6 through 9.8) may then be reduced to two ordinary differential equations of the form

$$f''' + 3ff'' - 2(f')^2 + T^* = 0 \quad (9.17)$$

$$T^{*''} + 3PrfT^{*'} = 0 \quad (9.18)$$

<sup>3</sup>The boundary layer approximations are assumed in using Equations 9.6 through 9.8. However, the approximations are only valid for  $(Gr_x Pr) \gtrsim 10^4$ . Below this value (close to the leading edge), the boundary layer thickness is too large relative to the characteristic length  $x$  to ensure the validity of the approximations.

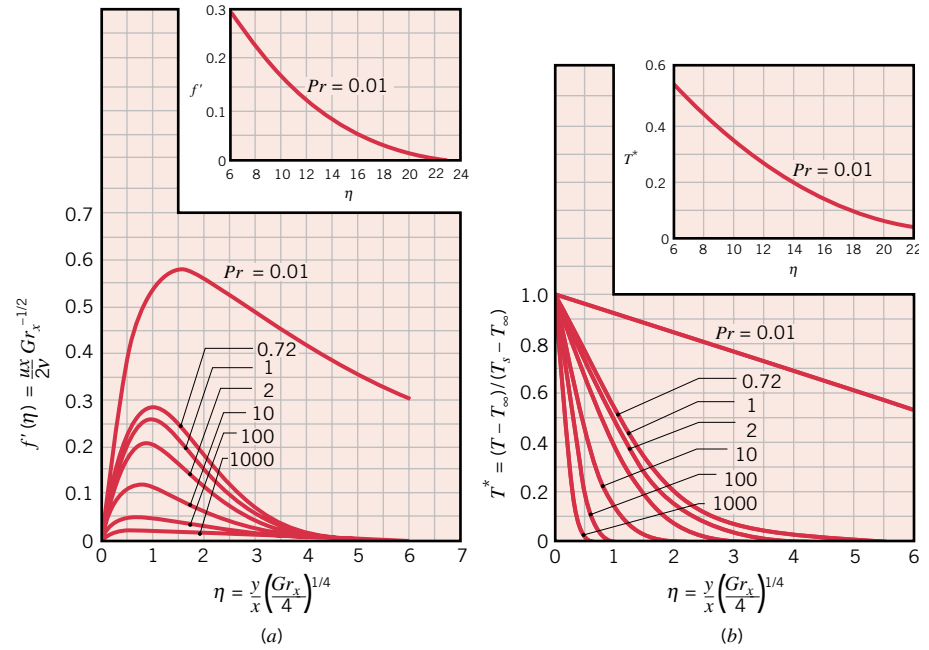

**FIGURE 9.4** Laminar, free convection boundary layer conditions on an isothermal, vertical surface. (a) Velocity profiles. (b) Temperature profiles [3].

where  $f$  and  $T^*$  are functions of only  $\eta$  and the double and triple primes, respectively, refer to second and third derivatives with respect to  $\eta$ . Note that  $f$  is the key dependent variable for the velocity boundary layer and that the continuity equation (9.6) is automatically satisfied through introduction of the stream function.

The transformed boundary conditions required to solve the momentum and energy equations (9.17 and 9.18) are of the form

$$\begin{aligned} \eta = 0: \quad & f = f' = 0 \quad T^* = 1 \\ \eta \rightarrow \infty: \quad & f' \rightarrow 0 \quad T^* \rightarrow 0 \end{aligned}$$

A numerical solution has been obtained by Ostrach [3], and selected results are shown in Figure 9.4. Note that the  $x$ -velocity component  $u$  may readily be obtained from Figure 9.4a through the use of Equation 9.15. Note also that, through the definition of the similarity parameter  $\eta$ , Figure 9.4 may be used to obtain values of  $u$  and  $T$  for any value of  $x$  and  $y$ .

Figure 9.4b may also be used to infer the appropriate form of the heat transfer correlation. Using Newton's law of cooling for the local convection coefficient  $h$ , the local Nusselt number may be expressed as

$$Nu_x = \frac{hx}{k} = \frac{[q_s''/(T_s - T_\infty)]x}{k}$$

Using Fourier's law to obtain  $q_s''$  and expressing the surface temperature gradient in terms of  $\eta$ , Equation 9.13, and  $T^*$ , Equation 9.16, it follows that

$$q_s'' = -k \frac{\partial T}{\partial y} \bigg|_{y=0} = -\frac{k}{x} (T_s - T_\infty) \left( \frac{Gr_x}{4} \right)^{1/4} \frac{dT^*}{d\eta} \bigg|_{\eta=0}$$

Hence

$$Nu_x = \frac{hx}{k} = - \left( \frac{Gr_x}{4} \right)^{1/4} \frac{dT^*}{d\eta} \bigg|_{\eta=0} = \left( \frac{Gr_x}{4} \right)^{1/4} g(Pr) \quad (9.19)$$

which acknowledges that the dimensionless temperature gradient at the surface is a function of the Prandtl number  $g(Pr)$ . This dependence is evident from Figure 9.4b and has been determined numerically for selected values of  $Pr$  [3]. The results have been correlated to within 0.5% by an interpolation formula of the form [4]

$$g(Pr) = \frac{0.75Pr^{1/2}}{(0.609 + 1.221Pr^{1/2} + 1.238Pr)^{1/4}} \quad (9.20)$$

which applies for  $0 \leq Pr \leq \infty$ .

Using Equation 9.19 for the local convection coefficient and substituting for the local Grashof number,

$$Gr_x = \frac{g\beta(T_s - T_\infty)x^3}{\nu^2}$$

the average convection coefficient for a surface of length  $L$  is then

$$\bar{h} = \frac{1}{L} \int_0^L h \, dx = \frac{k}{L} \left[ \frac{g\beta(T_s - T_\infty)}{4\nu^2} \right]^{1/4} g(Pr) \int_0^L \frac{dx}{x^{1/4}}$$

Integrating, it follows that

$$\overline{Nu}_L = \frac{\bar{h}L}{k} = \frac{4}{3} \left( \frac{Gr_L}{4} \right)^{1/4} g(Pr) \quad (9.21)$$

or substituting from Equation 9.19, with  $x = L$ ,


$$\overline{Nu}_L = \frac{4}{3} Nu_L \quad (9.22)$$

The foregoing results apply irrespective of whether  $T_s > T_\infty$  or  $T_s < T_\infty$ . If  $T_s < T_\infty$ , conditions are inverted from those of Figure 9.3. The leading edge is at the top of the plate, and positive  $x$  is defined in the direction of the gravity force.

## 9.5

### The Effects of Turbulence

It is important to note that free convection boundary layers are not restricted to laminar flow. As with forced convection, *hydrodynamic instabilities* may arise. That is,

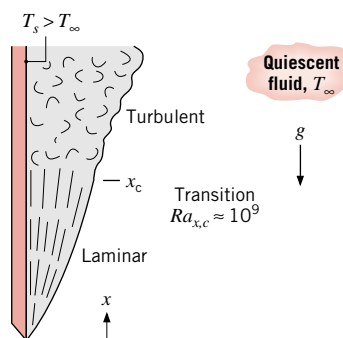

**FIGURE 9.5**

Free convection boundary layer transition on a vertical plate.

disturbances in the flow may be amplified, leading to transition from laminar to turbulent flow. This process is shown schematically in Figure 9.5 for a heated vertical plate.

Transition in a free convection boundary layer depends on the relative magnitude of the buoyancy and viscous forces in the fluid. It is customary to correlate its occurrence in terms of the *Rayleigh number*, which is simply the product of the Grashof and Prandtl numbers. For vertical plates the critical Rayleigh number is

$$Ra_{x,c} = Gr_{x,c} Pr = \frac{g\beta(T_s - T_\infty)x^3}{\nu\alpha} \approx 10^9 \quad (9.23)$$

An extensive discussion of stability and transition effects is provided by Gebhart et al. [2].

As in forced convection, transition to turbulence has a strong effect on heat transfer. Hence the results of the foregoing section apply only if  $Ra_L \lesssim 10^9$ . To obtain appropriate correlations for turbulent flow, emphasis is placed on experimental results.

### EXAMPLE 9.1


Consider a 0.25-m-long vertical plate that is at 70°C. The plate is suspended in air that is at 25°C. Estimate the boundary layer thickness at the trailing edge of the plate if the air is quiescent. How does this thickness compare with that which would exist if the air were flowing over the plate at a free stream velocity of 5 m/s?

### SOLUTION

**Known:** Vertical plate is in quiescent air at a lower temperature.

**Find:** Boundary layer thickness at trailing edge. Compare with thickness corresponding to an air speed of 5 m/s.

**Schematic:**

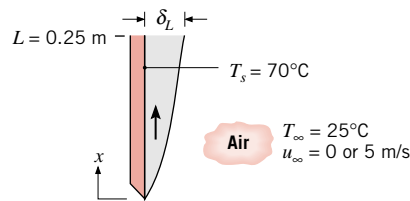

**Assumptions:**

1. Constant properties.
2. Buoyancy effects negligible when  $u_\infty = 5 \text{ m/s}$ .

**Properties:** Table A.4, air ( $T_f = 320.5 \text{ K}$ ):  $\nu = 17.95 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 0.7$ ,  $\beta = T_f^{-1} = 3.12 \times 10^{-3} \text{ K}^{-1}$ .

**Analysis:** For the quiescent air, Equation 9.12 gives

$$Gr_L = \frac{g\beta(T_s - T_\infty)L^3}{\nu^2} = \frac{9.8 \text{ m/s}^2 \times (3.12 \times 10^{-3} \text{ K}^{-1})(70 - 25)^\circ\text{C}(0.25 \text{ m})^3}{(17.95 \times 10^{-6} \text{ m}^2/\text{s})^2} = 6.69 \times 10^7$$

Hence  $Ra_L = Gr_L Pr = 4.68 \times 10^7$  and, from Equation 9.23, the free convection boundary layer is laminar. The analysis of Section 9.4 is therefore applicable. From the results of Figure 9.4, it follows that, for  $Pr = 0.7$ ,  $\eta \approx 6.0$  at the edge of the boundary layer, that is, at  $y \approx \delta$ . Hence

$$\delta_L \approx \frac{6L}{(Gr_L/4)^{1/4}} = \frac{6(0.25 \text{ m})}{(1.67 \times 10^7)^{1/4}} = 0.024 \text{ m} \quad \triangleleft$$

For airflow at  $u_\infty = 5 \text{ m/s}$

$$Re_L = \frac{u_\infty L}{\nu} = \frac{(5 \text{ m/s}) \times 0.25 \text{ m}}{17.95 \times 10^{-6} \text{ m}^2/\text{s}} = 6.97 \times 10^4$$

and the boundary layer is laminar. Hence, from Equation 7.19,

$$\delta_L \approx \frac{5L}{Re_L^{1/2}} = \frac{5(0.25 \text{ m})}{(6.97 \times 10^4)^{1/2}} = 0.0047 \text{ m} \quad \triangleleft$$

**Comments:**

1. Boundary layer thicknesses are typically larger for free convection than for forced convection.
2.  $(Gr_L/Re_L^2) = 0.014 \ll 1$ , and the assumption of negligible buoyancy effects for  $u_\infty = 5 \text{ m/s}$  is justified.

## 9.6

### Empirical Correlations: External Free Convection Flows

In this section we summarize empirical correlations that have been developed for common *immersed* (external flow) geometries. The correlations are suitable for most engineering calculations and are generally of the form

$$\overline{Nu}_L = \frac{\bar{h}L}{k} = C Ra_L^n \quad (9.24)$$

where the Rayleigh number,

$$Ra_L = Gr_L Pr = \frac{g\beta(T_s - T_\infty)L^3}{\nu\alpha} \quad (9.25)$$

is based on the characteristic length  $L$  of the geometry. Typically,  $n = \frac{1}{4}$  and  $\frac{1}{3}$  for laminar and turbulent flows, respectively. For turbulent flow it then follows that  $\bar{h}_L$  is independent of  $L$ . Note that all properties are evaluated at the film temperature,  $T_f \equiv (T_s + T_\infty)/2$ .

#### 9.6.1 The Vertical Plate

Expressions of the form given by Equation 9.24 have been developed for the vertical plate [5–7]. For laminar flow ( $10^4 \lesssim Ra_L \lesssim 10^9$ ),  $C = 0.59$  and  $n = 1/4$ , and for turbulent flow ( $10^9 \lesssim Ra_L \lesssim 10^{13}$ ),  $C = 0.10$  and  $n = 1/3$ . A correlation that may be applied over the *entire* range of  $Ra_L$  has been recommended by Churchill and Chu [8] and is of the form

$$\overline{Nu}_L = \left\{ 0.825 + \frac{0.387Ra_L^{1/6}}{[1 + (0.492/Pr)^{9/16}]^{8/27}} \right\}^2 \quad (9.26)$$

Although Equation 9.26 is suitable for most engineering calculations, slightly better accuracy may be obtained for laminar flow by using [8]

$$\overline{Nu}_L = 0.68 + \frac{0.670Ra_L^{1/4}}{[1 + (0.492/Pr)^{9/16}]^{4/9}} \quad Ra_L \lesssim 10^9 \quad (9.27)$$

When the Rayleigh number is moderately large, the second term on the right-hand side of Equations 9.26 and 9.27 dominates, and the correlations are the same form as Equation 9.24, except that the constant,  $C$ , is replaced by a function of  $Pr$ . Equation 9.27 is then in excellent quantitative agreement with the analytical solution given by Equations 9.21 and 9.20. In contrast, when the Rayleigh number is small, the first term on the right-hand side of Equations 9.26 and 9.27 dominates, and the



equations yield the same behavior since  $0.825^2 \approx 0.68$ . The presence of leading constants in Equations 9.26 and 9.27 accounts for the fact that, for small Rayleigh number, the boundary layer assumption becomes invalid and conduction parallel to the plate is important.

It is important to recognize that the foregoing results have been obtained for an isothermal plate (constant  $T_s$ ). If the surface condition is, instead, one of uniform heat flux (constant  $q_s''$ ), the temperature difference ( $T_s - T_\infty$ ) will vary with  $x$ , increasing from a value of zero at the leading edge. An approximate procedure for determining this variation may be based on results [8, 9] showing that  $\overline{Nu}_L$  correlations obtained for the isothermal plate may still be used to an excellent approximation, if  $\overline{Nu}_L$  and  $Ra_L$  are defined in terms of the temperature difference at the midpoint of the plate,  $\Delta T_{L/2} = T_s(L/2) - T_\infty$ . Hence, with  $\bar{h} \equiv q_s''/\Delta T_{L/2}$ , a correlation such as Equation 9.27 could be used to determine  $\Delta T_{L/2}$  (for example, using a trial-and-error technique), and hence the midpoint surface temperature  $T_s(L/2)$ . If it is assumed that  $Nu_x \propto Ra_x^{1/4}$  over the entire plate, it follows that

$$\frac{q_s'' x}{k \Delta T} \propto \Delta T^{1/4} x^{3/4}$$

or

$$\Delta T \propto x^{1/5}$$

Hence the temperature difference at any  $x$  is

$$\Delta T_x \approx \frac{x^{1/5}}{(L/2)^{1/5}} \Delta T_{L/2} = 1.15 \left( \frac{x}{L} \right)^{1/5} \Delta T_{L/2} \quad (9.28)$$

A more detailed discussion of constant heat flux results is provided by Churchill [10].

The foregoing results may also be applied to *vertical* cylinders of height  $L$ , if the boundary layer thickness  $\delta$  is much less than the cylinder diameter  $D$ . This condition is known to be satisfied [11] when

$$\frac{D}{L} \gtrsim \frac{35}{Gr_L^{1/4}}$$

Cebeci [12] and Minkowycz and Sparrow [13] present results for slender, vertical cylinders not meeting this condition, where transverse curvature influences boundary layer development and enhances the rate of heat transfer.

### EXAMPLE 9.2


A glass-door firescreen, used to reduce exfiltration of room air through a chimney, has a height of 0.71 m and a width of 1.02 m and reaches a temperature of 232°C. If the room temperature is 23°C, estimate the convection heat rate from the fireplace to the room.

### SOLUTION

**Known:** Glass screen situated in fireplace opening.

**Find:** Heat transfer by convection between screen and room air.

**Schematic:**

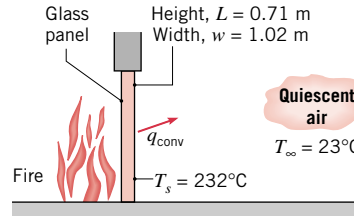

**Assumptions:**

1. Screen is at a uniform temperature  $T_s$ .
2. Room air is quiescent.

**Properties:** Table A.4, air ( $T_f = 400$  K):  $k = 33.8 \times 10^{-3}$  W/m · K,  $\nu = 26.4 \times 10^{-6}$  m<sup>2</sup>/s,  $\alpha = 38.3 \times 10^{-6}$  m<sup>2</sup>/s,  $Pr = 0.690$ ,  $\beta = (1/T_f) = 0.0025$  K<sup>-1</sup>.

**Analysis:** The rate of heat transfer by free convection from the panel to the room is given by Newton's law of cooling

$$q = \bar{h}A_s(T_s - T_\infty)$$

where  $\bar{h}$  may be obtained from knowledge of the Rayleigh number. Using Equation 9.25,

$$\begin{aligned} Ra_L &= \frac{g\beta(T_s - T_\infty)L^3}{\alpha\nu} \\ &= \frac{9.8 \text{ m/s}^2 \times 1/400 \text{ K} (232 - 23)^\circ\text{C} \times (0.71 \text{ m})^3}{38.3 \times 10^{-6} \text{ m}^2/\text{s} \times 26.4 \times 10^{-6} \text{ m}^2/\text{s}} = 1.813 \times 10^9 \end{aligned}$$

and from Equation 9.23 it follows that transition to turbulence occurs on the panel. The appropriate correlation is then given by Equation 9.26

$$\begin{aligned} \overline{Nu}_L &= \left\{ 0.825 + \frac{0.387Ra_L^{1/6}}{[1 + (0.492/Pr)^{9/16}]^{8/27}} \right\}^2 \\ \overline{Nu}_L &= \left\{ 0.825 + \frac{0.387(1.813 \times 10^9)^{1/6}}{[1 + (0.492/0.690)^{9/16}]^{8/27}} \right\}^2 = 147 \end{aligned}$$

Hence

$$\bar{h} = \frac{\overline{Nu}_L \cdot k}{L} = \frac{147 \times 33.8 \times 10^{-3} \text{ W/m} \cdot \text{K}}{0.71 \text{ m}} = 7.0 \text{ W/m}^2 \cdot \text{K}$$

and

$$q = 7.0 \text{ W/m}^2 \cdot \text{K} (1.02 \times 0.71) \text{ m}^2 (232 - 23)^\circ\text{C} = 1060 \text{ W}$$



**Comments:**

1. Radiation heat transfer effects are often significant relative to free convection. Using Equation 1.7 and assuming  $\varepsilon = 1.0$  for the glass surface and  $T_{\text{sur}} = 23^\circ\text{C}$ , the net rate of radiation heat transfer between the glass and the surroundings is


$$q_{\text{rad}} = \varepsilon A_s \sigma (T_s^4 - T_{\text{sur}}^4)$$

$$q_{\text{rad}} = 1(1.02 \times 0.71) \text{ m}^2 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (505^4 - 296^4) \text{ K}^4$$

$$q_{\text{rad}} = 2355 \text{ W}$$

Hence in this case radiation heat transfer exceeds free convection heat transfer by more than a factor of 2.


2. The effects of radiation and free convection on heat transfer from the glass depend strongly on its temperature. With  $q \propto T_s^4$  for radiation and  $q \propto T_s^n$  for free convection, where  $1.25 < n < 1.33$ , we expect the relative influence of radiation to increase with increasing temperature. This behavior is revealed by computing and plotting the heat rates as a function of temperature for  $50 \leq T_s \leq 250^\circ\text{C}$ .

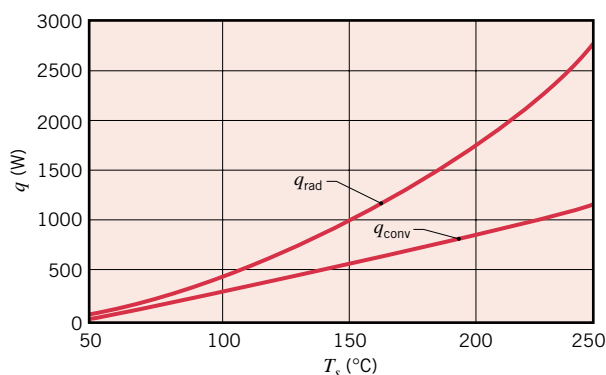

For each value of  $T_s$  used to generate the foregoing free convection results, air properties were determined at the corresponding value of  $T_f$ .

### 9.6.2 Inclined and Horizontal Plates


For a vertical plate, heated (or cooled) relative to an ambient fluid, the plate is aligned with the gravitational vector, and the buoyancy force acts exclusively to induce fluid motion in the upward (or downward) direction. However, if the plate is inclined with respect to gravity, the buoyancy force has a component normal, as well as parallel, to the plate surface. With a reduction in the buoyancy force parallel to the surface, there is a reduction in fluid velocities along the plate, and one might expect there to be an attendant reduction in convection heat transfer. Whether, in fact, there is such a reduction depends on whether one is interested in heat transfer from the top or bottom surface of the plate.

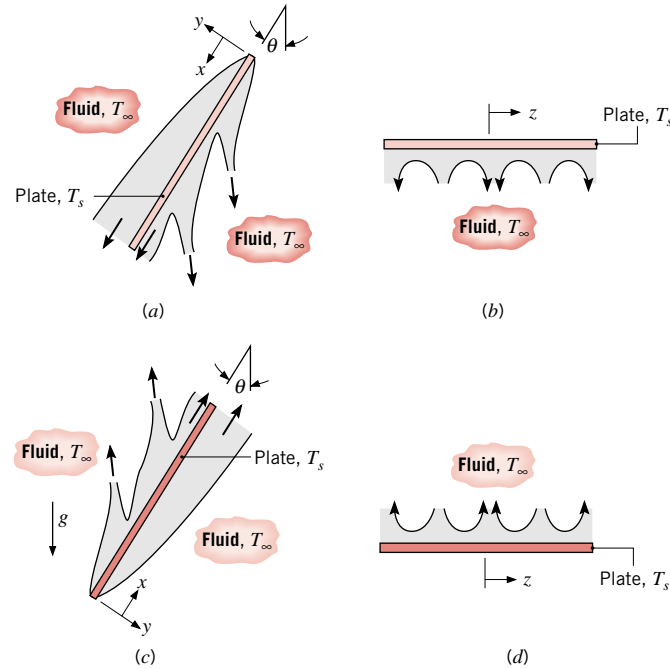

**FIGURE 9.6** Buoyancy-driven flows on an inclined plate: (a) side view of flows at top and bottom surfaces of a cold plate ( $T_s < T_\infty$ ), (b) end view of flow at bottom surface of cold plate, (c) side view of flows at top and bottom surfaces of a hot plate ( $T_s > T_\infty$ ), and (d) end view of flow at top surface of hot plate.

As shown in Figure 9.6a, if the plate is cooled, the  $y$  component of the buoyancy force, which is normal to the plate, acts to maintain the descending boundary layer flow in contact with the top surface of the plate. Since the  $x$  component of the gravitational acceleration is reduced to  $g \cos \theta$ , fluid velocities along the plate are reduced and there is an attendant reduction in convection heat transfer to the top surface. However, at the bottom surface, the  $y$  component of the buoyancy force acts to move fluid from the surface, and boundary layer development is interrupted by the discharge of parcels of cool fluid from the surface (Figure 9.6a). The resulting flow is three-dimensional, and, as shown by the spanwise ( $z$ -direction) variations of Figure 9.6b, the cool fluid discharged from the bottom surface is continuously replaced by the warmer ambient fluid. The displacement of cool boundary layer fluid by the warmer ambient and the attendant reduction in the thermal boundary layer thickness act to increase convection heat transfer to the bottom surface. In fact, heat transfer enhancement due to the three-dimensional flow typically exceeds the reduction associated with the reduced  $x$  component of  $g$ , and the combined effect is to increase heat transfer to the bottom surface. Similar trends characterize a heated plate (Figure 9.6c,d), and the three-dimensional flow is now associated with the upper surface, from which parcels of warm fluid are discharged. Such flows have been observed by several investigators [14–16].

In an early study of heat transfer from inclined plates, Rich [17] suggested that convection coefficients could be determined from vertical plate correlations, if  $g$  is

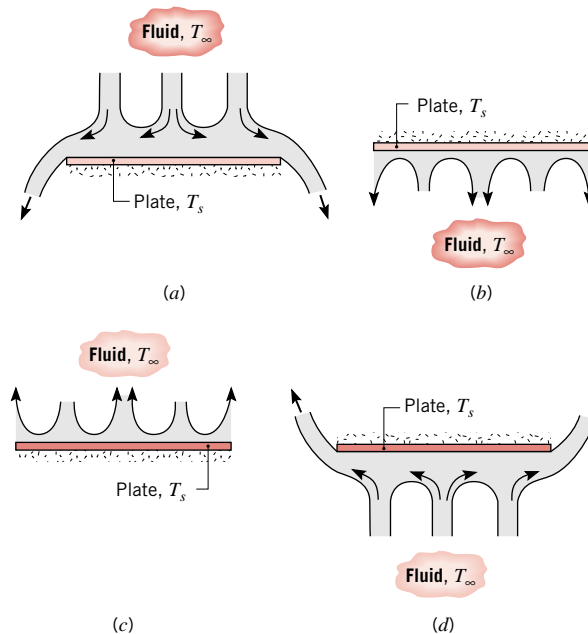**FIGURE 9.7**

Buoyancy-driven flows on horizontal cold ( $T_s < T_\infty$ ) and hot ( $T_s > T_\infty$ ) plates: (a) top surface of cold plate, (b) bottom surface of cold plate, (c) top surface of hot plate, and (d) bottom surface of hot plate.

replaced by  $g \cos \theta$  in computing the plate Rayleigh number. Since then, however, it has been determined that this approach is only satisfactory for the top and bottom surfaces of cooled and heated plates, respectively. It is not appropriate for the top and bottom surfaces of heated and cooled plates, respectively, where the three-dimensionality of the flow has limited the ability to develop generalized correlations. At the top and bottom surfaces of cooled and heated inclined plates, respectively, it is therefore recommended that, for  $0 \leq \theta \leq 60^\circ$ ,  $g$  be replaced by  $g \cos \theta$  and that Equation 9.26 or 9.27 be used to compute the average Nusselt number. For the opposite surfaces, no recommendations are made and the literature should be consulted [14–16].

If the plate is horizontal, the buoyancy force is exclusively normal to the surface. As for the inclined plate, flow patterns and heat transfer depend strongly on whether the surface is cooled or heated and on whether it is facing upward or downward. For a cold surface facing upward (Figure 9.7a) and a hot surface facing downward (Figure 9.7d), the tendency of the fluid to descend and ascend, respectively, is impeded by the plate. The flow must move horizontally before it can descend or ascend from the edges of the plate, and convection heat transfer is somewhat ineffective. In contrast, for a cold surface facing downward (Figure 9.7b) and a hot surface facing upward (Figure 9.7c), flow is driven by descending and ascending parcels of fluid, respectively. Conservation of mass dictates that cold (warm) fluid descending (ascending) from a surface be replaced by ascending (descending) warmer (cooler) fluid from the ambient, and heat transfer is much more effective.

Although correlations suggested by McAdams [5] are widely used for horizontal plates, improved accuracy may be obtained by altering the form of the

characteristic length on which the correlations are based [18, 19]. In particular with the characteristic length defined as

$$L \equiv \frac{A_s}{P} \quad (9.29)$$

where  $A_s$  and  $P$  are the plate surface area and perimeter, respectively, recommended correlations for the average Nusselt number are

**Upper Surface of Hot Plate or Lower Surface of Cold Plate:**

$$\overline{Nu}_L = 0.54Ra_L^{1/4} \quad (10^4 \lesssim Ra_L \lesssim 10^7) \quad (9.30)$$

$$\overline{Nu}_L = 0.15Ra_L^{1/3} \quad (10^7 \lesssim Ra_L \lesssim 10^{11}) \quad (9.31)$$

**Lower Surface of Hot Plate or Upper Surface of Cold Plate:**

$$\overline{Nu}_L = 0.27Ra_L^{1/4} \quad (10^5 \lesssim Ra_L \lesssim 10^{10}) \quad (9.32)$$

### EXAMPLE 9.3


Airflow through a long rectangular heating duct that is 0.75 m wide and 0.3 m high maintains the outer duct surface at 45°C. If the duct is uninsulated and exposed to air at 15°C in the crawlspace beneath a home, what is the heat loss from the duct per meter of length?

### SOLUTION

**Known:** Surface temperature of a long rectangular duct.

**Find:** Heat loss from duct per meter of length.

**Schematic:**

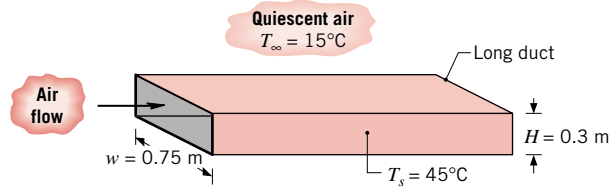

**Assumptions:**

1. Ambient air is quiescent.
2. Surface radiation effects are negligible.

**Properties:** Table A.4, air ( $T_f = 303$  K):  $\nu = 16.2 \times 10^{-6}$  m<sup>2</sup>/s,  $\alpha = 22.9 \times 10^{-6}$  m<sup>2</sup>/s,  $k = 0.0265$  W/m · K,  $\beta = 0.0033$  K<sup>-1</sup>,  $Pr = 0.71$ .

**Analysis:** Surface heat loss is by free convection from the vertical sides and the horizontal top and bottom. From Equation 9.25

$$Ra_L = \frac{g\beta(T_s - T_\infty)L^3}{\nu\alpha} = \frac{(9.8 \text{ m/s}^2)(0.0033 \text{ K}^{-1})(30 \text{ K})L^3 (\text{m}^3)}{(16.2 \times 10^{-6} \text{ m}^2/\text{s})(22.9 \times 10^{-6} \text{ m}^2/\text{s})}$$

$$Ra_L = 2.62 \times 10^9 L^3$$

For the two sides,  $L = H = 0.3 \text{ m}$ . Hence  $Ra_L = 7.07 \times 10^7$ . The free convection boundary layer is therefore laminar, and from Equation 9.27

$$\overline{Nu}_L = 0.68 + \frac{0.670 Ra_L^{1/4}}{[1 + (0.492/Pr)^{9/16}]^{4/9}}$$

The convection coefficient associated with the sides is then

$$\begin{aligned} \bar{h}_s &= \frac{k}{H} \overline{Nu}_L \\ \bar{h}_s &= \frac{0.0265 \text{ W/m} \cdot \text{K}}{0.3 \text{ m}} \left\{ 0.68 + \frac{0.670(7.07 \times 10^7)^{1/4}}{[1 + (0.492/0.71)^{9/16}]^{4/9}} \right\} = 4.23 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

For the top and bottom,  $L = (A_s/P) \approx (w/2) = 0.375 \text{ m}$ . Hence  $Ra_L = 1.38 \times 10^8$ , and from Equations 9.31 and 9.32, respectively,

$$\begin{aligned} \bar{h}_t &= [k/(w/2)] \times 0.15 Ra_L^{1/3} = \frac{0.0265 \text{ W/m} \cdot \text{K}}{0.375 \text{ m}} \times 0.15(1.38 \times 10^8)^{1/3} \\ &= 5.47 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

$$\begin{aligned} \bar{h}_b &= [k/(w/2)] \times 0.27 Ra_L^{1/4} = \frac{0.0265 \text{ W/m} \cdot \text{K}}{0.375 \text{ m}} \times 0.27(1.38 \times 10^8)^{1/4} \\ &= 2.07 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$


The rate of heat loss per unit length of duct is then

$$\begin{aligned} q' &= 2q'_s + q'_t + q'_b = (2\bar{h}_s \cdot H + \bar{h}_t \cdot w + \bar{h}_b \cdot w)(T_s - T_\infty) \\ q' &= (2 \times 4.23 \times 0.3 + 5.47 \times 0.75 + 2.07 \times 0.75)(45 - 15) \text{ W/m} \\ q' &= 246 \text{ W/m} \end{aligned}$$



**Comments:**

1. The heat loss may be reduced by insulating the duct. We consider this option for a 25-mm-thick layer of blanket insulation ( $k = 0.035 \text{ W/m} \cdot \text{K}$ ) that is wrapped around the duct.

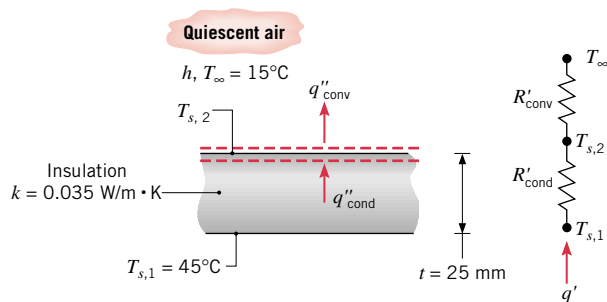

The heat loss at each surface may be expressed as

$$q' = \frac{T_{s,1} - T_{\infty}}{R'_{\text{cond}} + R'_{\text{conv}}}$$

where  $R'_{\text{conv}}$  is associated with free convection from the outer surface and hence depends on the unknown temperature  $T_{s,2}$ . This temperature may be determined by applying an energy balance to the outer surface, from which it follows that

$$q''_{\text{cond}} = q''_{\text{conv}}$$

or

$$\frac{(T_{s,1} - T_{s,2})}{(t/k)} = \frac{(T_{s,2} - T_{\infty})}{(1/\bar{h})}$$

Since different convection coefficients are associated with the sides, top, and bottom ( $\bar{h}_s$ ,  $\bar{h}_t$ , and  $\bar{h}_b$ ), a separate solution to this equation must be obtained for each of the three surfaces. The solutions are iterative, since the properties of air and the convection coefficients depend on  $T_s$ . Performing the calculations, we obtain

Sides	$T_{s,2} = 24^{\circ}\text{C}$ ,	$\bar{h}_s = 3.18 \text{ W/m}^2 \cdot \text{K}$
Top	$T_{s,2} = 23^{\circ}\text{C}$ ,	$\bar{h}_t = 3.66 \text{ W/m}^2 \cdot \text{K}$
Bottom	$T_{s,2} = 29^{\circ}\text{C}$ ,	$\bar{h}_b = 1.71 \text{ W/m}^2 \cdot \text{K}$

Neglecting heat loss through the corners of the insulation, the total heat rate per unit length of duct is then

$$q' = 2q'_s + q'_t + q'_b$$

$$q' = \frac{2H(T_{s,1} - T_{\infty})}{(t/k) + (1/\bar{h}_s)} + \frac{w(T_{s,1} - T_{\infty})}{(t/k) + (1/\bar{h}_t)} + \frac{w(T_{s,1} - T_{\infty})}{(t/k) + (1/\bar{h}_b)}$$

which yields

$$q' = (17.5 + 22.8 + 17.3) \text{ W/m} = 57.6 \text{ W/m}$$

The insulation therefore provides a 77% reduction in heat loss to the ambient air by natural convection.

- Although they have been neglected, radiation losses may still be significant. From Equation 1.7 with  $\varepsilon$  assumed to be unity and  $T_{\text{sur}} = 288 \text{ K}$ ,  $q'_{\text{rad}} = 398 \text{ W/m}$  for the uninsulated duct. Inclusion of radiation effects in the energy balance for the insulated duct would reduce the outer surface temperatures, thereby reducing the convection heat rates. With radiation, however, the total heat rate ( $q'_{\text{conv}} + q'_{\text{rad}}$ ) would increase.

### 9.6.3 The Long Horizontal Cylinder

This important geometry has been studied extensively, and many existing correlations have been reviewed by Morgan [20]. For an isothermal cylinder, Morgan suggests an expression of the form

$$\overline{Nu}_D = \frac{\bar{h}D}{k} = C Ra_D^n \quad (9.33)$$




where  $C$  and  $n$  are given in Table 9.1 and  $Ra_D$  and  $\overline{Nu}_D$  are based on the cylinder diameter. In contrast, Churchill and Chu [21] have recommended a single correlation for a wide Rayleigh number range:

$$\overline{Nu}_D = \left\{ 0.60 + \frac{0.387 Ra_D^{1/6}}{[1 + (0.559/Pr)^{9/16}]^{8/27}} \right\}^2 \quad Ra_D \lesssim 10^{12} \quad (9.34)$$

**TABLE 9.1** Constants of Equation 9.33 for free convection on a horizontal circular cylinder [20]

$Ra_D$	$C$	$n$
$10^{-10}$ – $10^{-2}$	0.675	0.058
$10^{-2}$ – $10^2$	1.02	0.148
$10^2$ – $10^4$	0.850	0.188
$10^4$ – $10^7$	0.480	0.250
$10^7$ – $10^{12}$	0.125	0.333

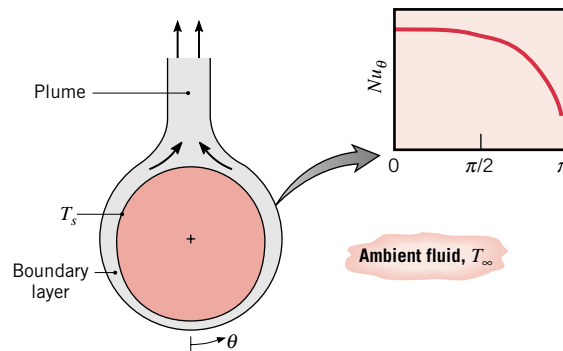

**FIGURE 9.8** Boundary layer development and Nusselt number distribution on a heated horizontal cylinder.

The foregoing correlations provide the average Nusselt number over the entire circumference of an isothermal cylinder. As shown in Figure 9.8 for a heated cylinder, local Nusselt numbers are influenced by boundary layer development, which begins at  $\theta = 0$  and concludes at  $\theta < \pi$  with formation of a plume ascending from the cylinder. If the flow remains laminar over the entire surface, the distribution of the local Nusselt number with  $\theta$  is characterized by a maximum at  $\theta = 0$  and a monotonic decay with increasing  $\theta$ . This decay would be disrupted at Rayleigh numbers sufficiently large ( $Ra_D \gtrsim 10^9$ ) to permit transition to turbulence within the boundary layer. If the cylinder is cooled relative to the ambient fluid, boundary layer development begins at  $\theta = \pi$ , the local Nusselt number is a maximum at this location, and the plume descends from the cylinder.

#### EXAMPLE 9.4

A horizontal, high-pressure steam pipe of 0.1-m outside diameter passes through a large room whose wall and air temperatures are 23°C. The pipe has an outside


surface temperature of  $165^\circ\text{C}$  and an emissivity of  $\varepsilon = 0.85$ . Estimate the heat loss from the pipe per unit length.

**SOLUTION**

**Known:** Surface temperature of a horizontal steam pipe.

**Find:** Heat loss from the pipe per unit length  $q'$  (W/m).

**Schematic:**

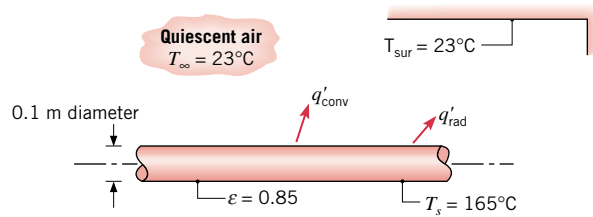

**Assumptions:**

1. Pipe surface area is small compared to surroundings.
2. Room air is quiescent.

**Properties:** Table A.4, air ( $T_f = 367\text{ K}$ ):  $k = 0.0313\text{ W/m} \cdot \text{K}$ ,  $\nu = 22.8 \times 10^{-6}\text{ m}^2/\text{s}$ ,  $\alpha = 32.8 \times 10^{-6}\text{ m}^2/\text{s}$ ,  $Pr = 0.697$ ,  $\beta = 2.725 \times 10^{-3}\text{ K}^{-1}$ .

**Analysis:** The total heat loss per unit length of pipe is

$$q' = q'_{\text{conv}} + q'_{\text{rad}} = \bar{h}\pi D(T_s - T_\infty) + \varepsilon\pi D\sigma(T_s^4 - T_{\text{sur}}^4)$$

The convection coefficient may be obtained from Equation 9.34

$$\overline{Nu}_D = \left\{ 0.60 + \frac{0.387 Ra_D^{1/6}}{[1 + (0.559/Pr)^{9/16}]^{8/27}} \right\}^2$$

where

$$Ra_D = \frac{g\beta(T_s - T_\infty)D^3}{\nu\alpha}$$

$$Ra_D = \frac{9.8\text{ m/s}^2 \times 2.725 \times 10^{-3}\text{ K}^{-1} (165 - 23)^\circ\text{C} (0.1\text{ m})^3}{22.8 \times 10^{-6}\text{ m}^2/\text{s} \times 32.8 \times 10^{-6}\text{ m}^2/\text{s}} = 5.073 \times 10^6$$

Hence

$$\overline{Nu}_D = \left\{ 0.60 + \frac{0.387(5.073 \times 10^6)^{1/6}}{[1 + (0.559/0.697)^{9/16}]^{8/27}} \right\}^2 = 23.3$$

and


$$\bar{h} = \frac{k}{D} \overline{Nu}_D = \frac{0.0313\text{ W/m} \cdot \text{K}}{0.1\text{ m}} \times 23.3 = 7.29\text{ W/m}^2 \cdot \text{K}$$

The total heat loss is then

$$\begin{aligned} q' &= 7.29 \text{ W/m}^2 \cdot \text{K} (\pi \times 0.1 \text{ m})(165 - 23)^\circ\text{C} \\ &\quad + 0.85(\pi \times 0.1 \text{ m})5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (438^4 - 296^4) \text{ K}^4 \\ q' &= (325 + 441) \text{ W/m} = 766 \text{ W/m} \end{aligned}$$

**Comments:**

1. Equation 9.33 could also be used to estimate the Nusselt number, with the result that  $\overline{Nu}_D = 22.8$ .
2. To explore the effect of an insulating layer on heat loss from the pipe, we consider a 25-mm-thick layer of urethane for which  $k = 0.026 \text{ W/m} \cdot \text{K}$  and  $\varepsilon = 0.85$ .

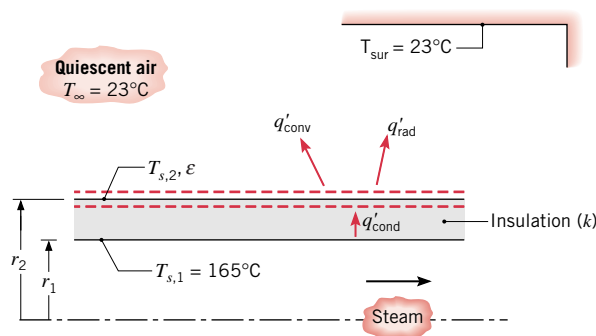

Free convection heat transfer to the ambient air and net radiation transfer to the surroundings depend on the temperature  $T_{s,2}$  of the insulation, which may be obtained by performing an energy balance at the outer surface:

$$q'_{\text{cond}} = q'_{\text{conv}} + q'_{\text{rad}}$$

Substituting from Equations 1.7 and 3.27, it follows that

$$\frac{2\pi k(T_{s,1} - T_{s,2})}{\ln(r_2/r_1)} = \bar{h}(2\pi r_2)(T_{s,2} - T_\infty) + \varepsilon 2\pi r_2 \sigma (T_{s,2}^4 - T_{\text{sur}}^4)$$

The unknown temperature is determined from an iterative solution for which Equation 9.34 is used to reevaluate the convection coefficient, and hence the properties of air, at each step of the iteration. For the prescribed conditions, the solution yields  $T_{s,2} = 35.3^\circ\text{C}$  and  $\bar{h} = 3.71 \text{ W/m}^2 \cdot \text{K}$ , from which it follows that

$$\begin{aligned} q' &= q'_{\text{conv}} + q'_{\text{rad}} \\ q' &= 3.71 \text{ W/m}^2 \cdot \text{K} (\pi \times 0.15 \text{ m})(35.3 - 23)^\circ\text{C} \\ &\quad + 0.85(\pi \times 0.15 \text{ m})5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (308.3^4 - 296^4) \text{ K}^4 \\ q' &= (21.5 + 30.8) \text{ W/m} = 52.3 \text{ W/m} \end{aligned}$$

As expected, the insulation significantly reduces heat loss from the pipe.

### 9.6.4 Spheres





The following correlation due to Churchill [10] is recommended for spheres in fluids of  $Pr \gtrsim 0.7$  and for  $Ra_D \lesssim 10^{11}$ .

$$\overline{Nu}_D = 2 + \frac{0.589Ra_D^{1/4}}{[1 + (0.469/Pr)^{9/16}]^{4/9}} \quad (9.35)$$



In the limit as  $Ra_D \rightarrow 0$ , Equation 9.35 reduces to  $\overline{Nu}_D = 2$ , which corresponds to heat transfer by conduction between a spherical surface and a stationary infinite medium, in a manner consistent with Equations 7.56 and 7.57.

Recommended correlations from this section are summarized in Table 9.2. Results for other immersed geometries and special conditions are presented in comprehensive reviews by Churchill [10] and Raithby and Hollands [22].

**TABLE 9.2** Summary of free convection empirical correlations for immersed geometries

Geometry	Recommended Correlation	Restrictions
1. Vertical plates <sup>a</sup>		
	Equation 9.26	None
2. Inclined plates Cold surface up or hot surface down		
	Equation 9.26 $g \rightarrow g \cos \theta$	$0 \leq \theta \leq 60^\circ$
3. Horizontal plates (a) Hot surface up or cold surface down		
	Equation 9.30 Equation 9.31	$10^4 \lesssim Ra_L \lesssim 10^7$ $10^7 \lesssim Ra_L \lesssim 10^{11}$
(b) Cold surface up or hot surface down		
	Equation 9.32	$10^5 \lesssim Ra_L \lesssim 10^{10}$

**TABLE 9.2** Continued

Geometry	Recommended Correlation	Restrictions
4. Horizontal cylinder 	Equation 9.34	$Ra_D \lesssim 10^{12}$
5. Sphere 	Equation 9.35	$Ra_D \lesssim 10^{11}$ $Pr \gtrsim 0.7$


<sup>a</sup> The correlation may be applied to a vertical cylinder if  $(D/L) \gtrsim (35/Gr_L^{1/4})$ .

## 9.7

### Free Convection within Parallel Plate Channels

A common free convection geometry involves vertical (or inclined) parallel plate channels that are open to the ambient at opposite ends (Figure 9.9). The plates could constitute a fin array used to enhance free convection heat transfer from a base surface to which the fins are attached, or they could constitute an array of circuit boards with heat-dissipating electronic components. Surface thermal conditions may be idealized as being isothermal or isoflux and symmetrical ( $T_{s,1} = T_{s,2}$ ;  $q''_{s,1} = q''_{s,2}$ ) or asymmetrical ( $T_{s,1} \neq T_{s,2}$ ;  $q''_{s,1} \neq q''_{s,2}$ ).

For vertical channels ( $\theta = 0$ ) buoyancy acts exclusively to induce motion in the streamwise ( $x$ ) direction and, beginning at  $x = 0$ , boundary layers develop on each surface. For short channels and/or large spacings (small  $L/S$ ), independent boundary layer development occurs at each surface and conditions correspond to those for an *isolated plate* in an infinite, quiescent medium. For large  $L/S$ , however, boundary

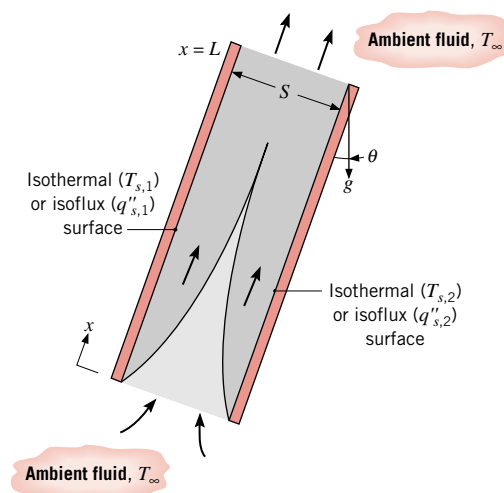

**FIGURE 9.9**

Free convection flow between heated parallel plates with opposite ends exposed to a quiescent fluid.

layers developing on opposing surfaces eventually merge to yield a fully developed condition. If the channel is inclined, there is a component of the buoyancy force normal, as well as parallel, to the streamwise direction, and conditions may strongly be influenced by development of a three-dimensional, secondary flow.

### 9.7.1 Vertical Channels

Beginning with the benchmark paper by Elenbaas [23], the vertical orientation has been studied extensively for symmetrically and asymmetrically heated plates with isothermal or isoflux surface conditions. For *symmetrically heated, isothermal plates*, Elenbaas obtained the following semiempirical correlation:

$$\overline{Nu}_S = \frac{1}{24} Ra_S \left( \frac{S}{L} \right) \left\{ 1 - \exp \left[ - \frac{35}{Ra_S(S/L)} \right] \right\}^{3/4} \quad (9.36)$$

where the average Nusselt and Rayleigh numbers are defined as

$$\overline{Nu}_S = \left( \frac{q/A}{T_s - T_\infty} \right) \frac{S}{k} \quad (9.37)$$

and

$$Ra_S = \frac{g\beta(T_s - T_\infty)S^3}{\alpha\nu} \quad (9.38)$$

Equation 9.36 was developed for air as the working fluid, and its range of applicability is

$$\left[ 10^{-1} \leq \frac{S}{L} Ra_S \leq 10^5 \right]$$

Knowledge of the average Nusselt number for a plate therefore permits determination of the total heat rate for the plate. In the fully developed limit ( $S/L \rightarrow 0$ ), Equation 9.36 reduces to

$$\overline{Nu}_{S(fd)} = \frac{Ra_S(S/L)}{24} \quad (9.39)$$

Retention of the  $L$  dependence results from defining  $\overline{Nu}_S$  in terms of the fixed inlet (ambient) temperature and not in terms of the fluid mixed-mean temperature, which is not explicitly known. For the common condition corresponding to adjoining isothermal ( $T_{s,1}$ ) and insulated ( $q''_{s,2} = 0$ ) plates, the fully developed limit yields the following expression for the isothermal surface [24]:

$$\overline{Nu}_{S(fd)} = \frac{Ra_S(S/L)}{12} \quad (9.40)$$

For isoflux surfaces, it is more convenient to define a local Nusselt number as

$$Nu_{S,L} = \left( \frac{q''_s}{T_{s,L} - T_\infty} \right) \frac{S}{k} \quad (9.41)$$

and to correlate results in terms of a modified Rayleigh number defined as

$$Ra_S^* = \frac{g\beta q''_s S^4}{k\alpha\nu} \quad (9.42)$$

The subscript  $L$  refers to conditions at  $x = L$ , where the plate temperature is a maximum. For symmetric, isoflux plates the fully developed limit corresponds to [24]

$$Nu_{S,L(\text{fd})} = 0.144[Ra_S^*(S/L)]^{1/2} \quad (9.43)$$

and for asymmetric isoflux conditions with one surface insulated ( $q''_{s,2} = 0$ ) the limit is

$$Nu_{S,L(\text{fd})} = 0.204[Ra_S^*(S/L)]^{1/2} \quad (9.44)$$

Combining the foregoing relations for the fully developed limit with available results for the isolated plate limit, Bar-Cohen and Rohsenow [24] obtained Nusselt number correlations applicable to the complete range of  $S/L$ . For isothermal and isoflux conditions, respectively, the correlations are of the form

$$\overline{Nu}_S = \left[ \frac{C_1}{(Ra_S S/L)^2} + \frac{C_2}{(Ra_S S/L)^{1/2}} \right]^{-1/2} \quad (9.45)$$

$$Nu_{S,L} = \left[ \frac{C_1}{Ra_S^* S/L} + \frac{C_2}{(Ra_S^* S/L)^{2/5}} \right]^{-1/2} \quad (9.46)$$

where the constants  $C_1$  and  $C_2$  are given in Table 9.3 for the different surface thermal conditions. In each case the fully developed and isolated plate limits correspond to  $Ra_S$  (or  $Ra_S^* S/L \lesssim 10$ ) and  $Ra_S$  (or  $Ra_S^* S/L \gtrsim 100$ ), respectively.

Bar-Cohen and Rohsenow [24] used the foregoing correlations to infer the optimum plate spacing  $S_{\text{opt}}$  for maximizing heat transfer from an array of isothermal plates, as well as the spacing  $S_{\text{max}}$  needed to maximize heat transfer from each plate in the array. Existence of an optimum for the array results from the fact that, although heat transfer from each plate decreases with decreasing  $S$ , the number of plates that may be placed in a prescribed volume increases. Hence  $S_{\text{opt}}$  maximizes heat transfer from the array by yielding a maximum for the product of  $\bar{h}$  and the total plate surface area. In contrast, to maximize heat transfer from each plate,  $S_{\text{max}}$  must be large enough to preclude overlap of adjoining boundary layers, such that the isolated plate limit remains valid over the entire plate.

Consideration of the optimum plate spacing is particularly important for vertical parallel plates used as fins to enhance heat transfer by natural convection from a base surface of fixed width  $W$ . With the temperature of the fins exceeding that of the ambient fluid, flow between the fins is induced by buoyancy forces. However, resistance to the flow is associated with viscous forces imposed by the surface of the

**TABLE 9.3** Heat transfer parameters for free convection between vertical parallel plates

Surface Condition	$C_1$	$C_2$	$S_{\text{opt}}$	$S_{\text{max}}/S_{\text{opt}}$
Symmetric isothermal plates ( $T_{s,1} = T_{s,2}$ )	576	2.87	$2.71(Ra_S/S^3 L)^{-1/4}$	1.71
Symmetric isoflux plates ( $q''_{s,1} = q''_{s,2}$ )	48	2.51	$2.12(Ra_S^*/S^4 L)^{-1/5}$	4.77
Isothermal/adiabatic plates ( $T_{s,1}, q''_{s,2} = 0$ )	144	2.87	$2.15(Ra_S/S^3 L)^{-1/4}$	1.71
Isoflux/adiabatic plates ( $q''_{s,1}, q''_{s,2} = 0$ )	24	2.51	$1.69(Ra_S^*/S^4 L)^{-1/5}$	4.77

fins, and the rate of mass flow between adjoining fins is governed by a balance between buoyancy and viscous forces. Since viscous forces increase with decreasing  $S$ , there is an accompanying reduction in the flow rate, and hence  $\bar{h}$ . However, for fixed  $W$ , the attendant increase in the number of fins increases the total surface area  $A_s$  and yields a maximum in  $\bar{h}A_s$  for  $S = S_{\text{opt}}$ . For  $S < S_{\text{opt}}$ , the amount by which  $\bar{h}$  is diminished by viscous effects exceeds the increase in  $A_s$ ; for  $S > S_{\text{opt}}$ , the amount by which  $A_s$  is diminished exceeds the increase in  $\bar{h}$ .

For isoflux plates, the total volumetric heat rate simply increases with decreasing  $S$ . However, the need to maintain  $T_s$  below prescribed limits precludes reducing  $S$  to extremely small values. Hence  $S_{\text{opt}}$  may be defined as that value of  $S$  which yields the maximum volumetric heat dissipation per unit temperature difference,  $T_s(L) - T_\infty$ . The spacing  $S_{\text{max}}$  that yields the lowest possible surface temperature for a prescribed heat flux, without regard to volumetric considerations, is again the value of  $S$  that precludes boundary layer merger. Values of  $S_{\text{opt}}$  and  $S_{\text{max}}/S_{\text{opt}}$  are presented in Table 9.3 for plates of negligible thickness.

In using the foregoing correlations, fluid properties are evaluated at average temperatures of  $\bar{T} = (T_s + T_\infty)/2$  for isothermal surfaces and  $\bar{T} = (T_{s,L} + T_\infty)/2$  for isoflux surfaces.

### 9.7.2 Inclined Channels

Experiments have been performed by Azevedo and Sparrow [16] for inclined channels in water. Symmetric isothermal plates and isothermal–insulated plates were considered for  $0 \leq \theta \leq 45^\circ$  and conditions within the isolated plate limit,  $Ra_s(S/L) > 200$ . Although three-dimensional secondary flows were observed at the lower plate, when it was heated, data for all experimental conditions were correlated to within  $\pm 10\%$  by

$$\overline{Nu}_s = 0.645[Ra_s(S/L)]^{1/4} \quad (9.47)$$

Departures of the data from the correlation were most pronounced at large tilt angles with bottom surface heating and were attributed to heat transfer enhancement by the three-dimensional secondary flow. Fluid properties are evaluated at  $\bar{T} = (T_s + T_\infty)/2$ .

## 9.8

### Empirical Correlations: Enclosures


---

The foregoing results pertain to free convection between a surface and an extensive fluid medium. However, engineering applications frequently involve heat transfer between surfaces that are at different temperatures and are separated by an *enclosed* fluid. In this section we present correlations that are pertinent to the most common geometries.

#### 9.8.1 Rectangular Cavities

The rectangular cavity (Figure 9.10) has been studied extensively, and comprehensive reviews of both experimental and theoretical results are available [25, 26]. Two



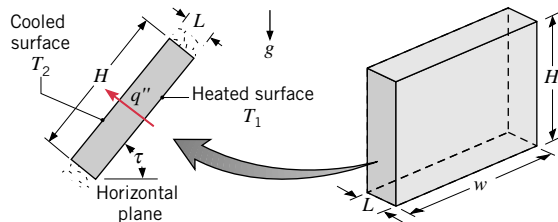

**FIGURE 9.10**  
Free convection in a rectangular cavity.

of the opposing walls are maintained at different temperatures ( $T_1 > T_2$ ), while the remaining walls are insulated from the surroundings. The tilt angle  $\tau$  between the heated and cooled surfaces and the horizontal can vary from  $0^\circ$  (*horizontal cavity* with bottom heating) to  $90^\circ$  (*vertical cavity* with sidewall heating) to  $180^\circ$  (*horizontal cavity* with top heating). The heat flux across the cavity, which is expressed as

$$q'' = h(T_1 - T_2) \quad (9.48)$$

can depend strongly on the aspect ratio  $H/L$ , as well as the value of  $\tau$ . For large values of the aspect ratio  $w/L$ , its dependence on  $w/L$  is small and may be neglected for the purposes of this text.


The horizontal cavity heated from below ( $\tau = 0$ ) has been considered by many investigators. For  $H/L$ ,  $w/L \gg 1$ , and Rayleigh numbers less than a critical value of  $Ra_{L,c} = 1708$ , buoyancy forces cannot overcome the resistance imposed by viscous forces and there is no advection within the cavity. Hence heat transfer from the bottom to the top surface occurs by conduction or, for a gas, by conduction and radiation. Since conditions correspond to one-dimensional conduction through a plane fluid layer, the convection coefficient is  $h = k/L$  and  $Nu_L = 1$ . However, for

$$Ra_L \equiv \frac{g\beta(T_1 - T_2)L^3}{\alpha\nu} > 1708$$


conditions are thermally unstable and there is advection within the cavity. For Rayleigh numbers in the range  $1708 < Ra_L \lesssim 5 \times 10^4$ , fluid motion consists of regularly spaced roll cells (Figure 9.11), while for larger Rayleigh numbers, the cells break down and the fluid motion is turbulent.

As a first approximation, convection coefficients for the horizontal cavity heated from below may be obtained from the following correlation proposed by Globe and Dropkin [27]:

$$\overline{Nu}_L = \frac{\overline{h}L}{k} = 0.069Ra_L^{1/3} Pr^{0.074} \quad 3 \times 10^5 \lesssim Ra_L \lesssim 7 \times 10^9 \quad (9.49)$$

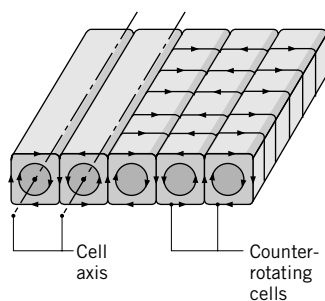

**FIGURE 9.11**  
Longitudinal roll cells characteristic of advection in a horizontal fluid layer heated from below ( $1708 < Ra_L \lesssim 5 \times 10^4$ ).

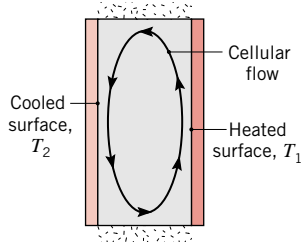

**FIGURE 9.12**  
Cellular flow in a vertical cavity with different sidewall temperatures.

where all properties are evaluated at the average temperature,  $\bar{T} \equiv (T_1 + T_2)/2$ . The correlation applies for values of  $L/H$  sufficiently small to ensure a negligible effect of the sidewalls. More detailed correlations, which apply over a wider range of  $Ra_L$ , have been proposed [28, 29]. In concluding the discussion of horizontal cavities, it is noted that in the absence of radiation, for  $\tau = 180^\circ$ , heat transfer from the top to bottom surface is exclusively by conduction ( $Nu_L = 1$ ), irrespective of the value of  $Ra_L$ .

In the vertical rectangular cavity ( $\tau = 90^\circ$ ), the vertical surfaces are heated and cooled, while the horizontal surfaces are adiabatic. As shown in Figure 9.12, fluid motion is characterized by a recirculating or cellular flow for which fluid ascends along the hot wall and descends along the cold wall. For small Rayleigh numbers,  $Ra_L \lesssim 10^3$ , the buoyancy-driven flow is weak and heat transfer is primarily by conduction across the fluid. Hence, from Fourier's law, the Nusselt number is again  $Nu_L = 1$ . With increasing Rayleigh number, the cellular flow intensifies and becomes concentrated in thin boundary layers adjoining the sidewalls. The core becomes nearly stagnant, although additional cells can develop in the corners and the sidewall boundary layers eventually undergo transition to turbulence. For aspect ratios in the range  $1 \lesssim (H/L) \lesssim 10$ , the following correlations have been suggested [26]:

$$\overline{Nu}_L = 0.22 \left( \frac{Pr}{0.2 + Pr} Ra_L \right)^{0.28} \left( \frac{H}{L} \right)^{-1/4} \quad (9.50)$$

$$\left[ \begin{array}{l} 2 \lesssim \frac{H}{L} \lesssim 10 \\ Pr \lesssim 10^5 \\ 10^3 \lesssim Ra_L \lesssim 10^{10} \end{array} \right]$$

$$\overline{Nu}_L = 0.18 \left( \frac{Pr}{0.2 + Pr} Ra_L \right)^{0.29} \quad (9.51)$$

$$\left[ \begin{array}{l} 1 \lesssim \frac{H}{L} \lesssim 2 \\ 10^{-3} \lesssim Pr \lesssim 10^5 \\ 10^3 \lesssim \frac{Ra_L Pr}{0.2 + Pr} \end{array} \right]$$

while for larger aspect ratios, the following correlations have been proposed [30]:

$$\overline{Nu}_L = 0.42 Ra_L^{1/4} Pr^{0.012} \left( \frac{H}{L} \right)^{-0.3} \quad (9.52)$$

$$\left[ \begin{array}{l} 10 \lesssim \frac{H}{L} \lesssim 40 \\ 1 \lesssim Pr \lesssim 2 \times 10^4 \\ 10^4 \lesssim Ra_L \lesssim 10^7 \end{array} \right]$$

$$\overline{Nu}_L = 0.046 Ra_L^{1/3} \quad (9.53)$$

$$\left[ \begin{array}{l} 1 \lesssim \frac{H}{L} \lesssim 40 \\ 1 \lesssim Pr \lesssim 20 \\ 10^6 \lesssim Ra_L \lesssim 10^9 \end{array} \right]$$

**TABLE 9.4** Critical angle for inclined rectangular cavities

(H/L)	1	3	6	12	>12
$\tau^*$	25°	53°	60°	67°	70°

Convection coefficients computed from the foregoing expressions are to be used with Equation 9.48. Again, all properties are evaluated at the mean temperature,  $(T_1 + T_2)/2$ .

Studies of free convection in tilted cavities are often stimulated by applications involving flat-plate solar collectors [31–36]. For such cavities, the fluid motion consists of a combination of the roll structure of Figure 9.11 and the cellular structure of Figure 9.12. Typically, transition between the two types of fluid motion occurs at a critical tilt angle,  $\tau^*$ , with a corresponding change in the value of  $\overline{Nu}_L$ . For large aspect ratios,  $(H/L) \geq 12$ , and tilt angles less than the critical value  $\tau^*$  given in Table 9.4, the following correlation due to Hollands et al. [36] is in excellent agreement with available data:

$$\overline{Nu}_L = 1 + 1.44 \left[ 1 - \frac{1708}{Ra_L \cos \tau} \right] \cdot \left[ 1 - \frac{1708(\sin 1.8\tau)^{1.6}}{Ra_L \cos \tau} \right] + \left[ \left( \frac{Ra_L \cos \tau}{5830} \right)^{1/3} - 1 \right] \cdot \left[ \begin{array}{l} \frac{H}{L} \geq 12 \\ 0 < \tau \leq \tau^* \end{array} \right] \quad (9.54)$$

The notation [ ] implies that, if the quantity in brackets is negative, it must be set equal to zero. The implication is that, if the Rayleigh number is less than a critical value  $Ra_{L,c} = 1708/\cos \tau$ , there is no flow within the cavity. For small aspect ratios Catton [26] suggests that reasonable results may be obtained from a correlation of the form

$$\overline{Nu}_L = \overline{Nu}_L(\tau = 0) \left[ \frac{\overline{Nu}_L(\tau = 90^\circ)}{\overline{Nu}_L(\tau = 0)} \right]^{\tau/\tau^*} (\sin \tau^*)^{(\tau/4\tau^*)} \left[ \begin{array}{l} \frac{H}{L} \leq 12 \\ 0 < \tau \leq \tau^* \end{array} \right] \quad (9.55)$$


Beyond the critical tilt angle, the following correlations due to Ayyaswamy and Catton [31] and Arnold et al. [34], respectively, have been recommended [26] for all aspect ratios  $(H/L)$ :

$$\overline{Nu}_L = \overline{Nu}_L(\tau = 90^\circ)(\sin \tau)^{1/4} \quad \tau^* \leq \tau < 90^\circ \quad (9.56)$$

$$\overline{Nu}_L = 1 + [\overline{Nu}_L(\tau = 90^\circ) - 1] \sin \tau \quad 90^\circ < \tau < 180^\circ \quad (9.57)$$

### 9.8.2 Concentric Cylinders

Free convection heat transfer in the annular space between *long*, horizontal concentric cylinders (Figure 9.13) has been considered by Raithby and Hollands [37]. Flow in the annular region is characterized by two cells that are symmetric about the vertical midplane. If the inner cylinder is heated and the outer cylinder is cooled ( $T_i > T_o$ ), fluid ascends and descends along the inner and outer cylinders, respectively. If  $T_i < T_o$ , the cellular flows are reversed. The heat transfer rate ( $\dot{Q}$ ) between

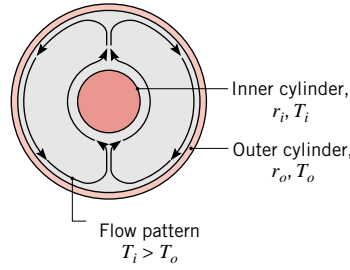

**FIGURE 9.13**

Free convection flow in the annular space between long, horizontal, concentric cylinders or concentric spheres of inner radius  $r_i$  and outer radius  $r_o$ .

the two cylinders, each of length  $L$ , is expressed by Equation 3.27 (with an *effective thermal conductivity*,  $k_{\text{eff}}$ , replacing the molecular thermal conductivity,  $k$ ) as

$$q = \frac{2\pi L k_{\text{eff}} (T_i - T_o)}{\ln(r_o/r_i)} \quad (9.58)$$

We see that the effective conductivity of a fictitious *stationary* fluid will transfer the same amount of heat as the actual *moving* fluid. The suggested correlation for  $k_{\text{eff}}$  is

$$\frac{k_{\text{eff}}}{k} = 0.386 \left( \frac{Pr}{0.861 + Pr} \right)^{1/4} Ra_c^{1/4} \quad (9.59)$$

where the length scale in  $Ra_c$  is given by

$$L_c = \frac{2[\ln(r_o/r_i)]^{4/3}}{(r_i^{-3/5} + r_o^{-3/5})^{5/3}} \quad (9.60)$$

Equation 9.59 may be used for the range  $0.7 \leq Pr \leq 6000$  and  $Ra_c \leq 10^7$ . Properties are evaluated at the mean temperature,  $T_m = (T_i + T_o)/2$ . Of course, the minimum heat transfer rate between the cylinders cannot fall below the conduction limit; therefore,  $k_{\text{eff}} = k$  if the value of  $k_{\text{eff}}/k$  predicted by Equation 9.59 is less than unity. A more detailed correlation, which accounts for cylinder eccentricity effects, has been developed by Kuehn and Goldstein [38].

### 9.8.3 Concentric Spheres

Raithby and Hollands [37] have also considered free convection heat transfer between concentric spheres (Figure 9.14) and express the total heat transfer rate by Equation 3.35 (with an effective thermal conductivity,  $k_{\text{eff}}$ , replacing the molecular thermal conductivity,  $k$ ) as

$$q = \frac{4\pi k_{\text{eff}} (T_i - T_o)}{(1/r_i) - (1/r_o)} \quad (9.61)$$

The effective thermal conductivity is

$$\frac{k_{\text{eff}}}{k} = 0.74 \left( \frac{Pr}{0.861 + Pr} \right)^{1/4} Ra_s^{1/4} \quad (9.62)$$

where the length scale in  $Ra_s$  is given by

$$L_s = \frac{\left(\frac{1}{r_i} - \frac{1}{r_o}\right)^{4/3}}{2^{1/3}(r_i^{-7/5} + r_o^{-7/5})^{5/3}} \quad (9.63)$$

The result may be used to a reasonable approximation for  $0.7 \lesssim Pr \lesssim 4000$  and  $Ra_s \lesssim 10^4$ . Properties are evaluated at  $T_m = (T_i + T_o)/2$ , and  $k_{\text{eff}} = k$  if the value of  $k_{\text{eff}}/k$  predicted by Equation 9.62 is less than unity.

### EXAMPLE 9.5

A long tube of 0.1-m diameter is maintained at  $120^\circ\text{C}$  by passing steam through its interior. A radiation shield is installed concentric to the tube with an air gap of 10 mm. If the shield is at  $35^\circ\text{C}$ , estimate the heat transfer by free convection from the tube per unit length. What is the heat loss if the space between the tube and the shield is filled with glass-fiber blanket insulation?


### SOLUTION

**Known:** Temperatures and diameters of a steam tube and a concentric radiation shield.

**Find:**

1. Heat loss per unit length of tube.
2. Heat loss if air space is filled with glass-fiber blanket insulation.

**Schematic:**

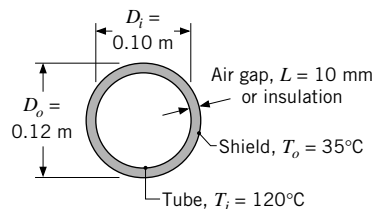

**Assumptions:**

1. Radiation heat transfer may be neglected.
2. Contact resistance with insulation is negligible.

**Properties:** Table A.4, air [ $T = (T_i + T_o)/2 = 350 \text{ K}$ ]:  $k = 0.030 \text{ W/m} \cdot \text{K}$ ,  $\nu = 20.92 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $\alpha = 29.9 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 0.70$ ,  $\beta = 0.00285 \text{ K}^{-1}$ . Table A.3, insulation, glass-fiber ( $T \approx 300 \text{ K}$ ):  $k = 0.038 \text{ W/m} \cdot \text{K}$ .

**Analysis:**

1. From Equation 9.58, the heat loss per unit length by free convection is

$$q' = \frac{2\pi k_{\text{eff}}(T_i - T_o)}{\ln(r_o/r_i)}$$

where  $k_{\text{eff}}$  may be obtained from Equations 9.59 and 9.60. With

$$L_c = \frac{2[\ln(r_o/r_i)]^{4/3}}{(r_i^{-3/5} + r_o^{-3/5})^{5/3}} = \frac{2[\ln(0.06 \text{ m}/0.05 \text{ m})]^{4/3}}{(0.05^{-3/5} + 0.06^{-3/5})^{5/3} \text{ m}^{-1}} = 0.00117 \text{ m}$$

we find

$$Ra_c = \frac{g\beta(T_i - T_o)L_c^3}{\nu\alpha} = \frac{9.8 \text{ m/s}^2 \times 0.00285 \text{ K}^{-1} \times (120 - 35)^\circ\text{C} \times (0.00117 \text{ m})^3}{20.92 \times 10^{-6} \text{ m}^2/\text{s} \times 29.9 \times 10^{-6} \text{ m}^2/\text{s}} = 171$$

The effective thermal conductivity is then

$$\begin{aligned} k_{\text{eff}} &= 0.386k \left( \frac{Pr}{0.861 + Pr} \right)^{1/4} Ra_c^{1/4} \\ &= 0.386 \times 0.030 \text{ W/m} \cdot \text{K} \left( \frac{0.70}{0.861 + 0.70} \right)^{1/4} (171)^{1/4} = 0.0343 \text{ W/m} \cdot \text{K} \end{aligned}$$

and the heat loss is

$$q' = \frac{2\pi k_{\text{eff}}(T_i - T_o)}{\ln(r_o/r_i)} = \frac{2\pi(0.0343 \text{ W/m} \cdot \text{K})}{\ln(0.06 \text{ m}/0.05 \text{ m})} (120 - 35)^\circ\text{C} = 100 \text{ W/m}$$

2. With insulation in the space between the tube and the shield, heat loss is by conduction; comparing Equation 3.27 and Equation 9.58,

$$q'_{\text{ins}} = q' \frac{k_{\text{ins}}}{k_{\text{eff}}} = 100 \text{ W/m} \frac{0.038 \text{ W/m} \cdot \text{K}}{0.0343 \text{ W/m} \cdot \text{K}} = 111 \text{ W/m}$$

**Comments:** Although there is slightly more heat loss by conduction through the insulation than by free convection across the air space, the total heat loss across the air space may exceed that through the insulation because of the effects of radiation. The heat loss due to radiation may be minimized by using a radiation shield of low emissivity, and the means for calculating the loss will be developed in Chapter 13.

## 9.9

### Combined Free and Forced Convection

In dealing with forced convection (Chapters 6 through 8), we ignored the effects of free convection. This was, of course, an assumption; for, as we now know, free convection is likely when there is an unstable temperature gradient. Similarly, in the preceding sections of this chapter, we assumed that forced convection was negligible.

It is now time to acknowledge that situations may arise for which free and forced convection effects are comparable, in which case it is inappropriate to neglect either process. In Section 9.3 we indicated that free convection is negligible if  $(Gr_L/Re_L^2) \ll 1$  and that forced convection is negligible if  $(Gr_L/Re_L^2) \gg 1$ . Hence the *combined free and forced* (or *mixed*) *convection* regime is generally one for which  $(Gr_L/Re_L^2) \approx 1$ .

The effect of buoyancy on heat transfer in a forced flow is strongly influenced by the direction of the buoyancy force relative to that of the flow. Three special cases that have been studied extensively correspond to buoyancy-induced and forced motions having the same direction (*assisting* flow), opposite directions (*opposing* flow), and perpendicular directions (*transverse* flow). Upward and downward forced motions over a heated vertical plate are examples of assisting and opposing flows, respectively. Examples of transverse flow include horizontal motion over a heated cylinder, sphere, or horizontal plate. In assisting and transverse flows, buoyancy acts to enhance the rate of heat transfer associated with pure forced convection; in opposing flows, it acts to decrease this rate.

It has become common practice to correlate mixed convection heat transfer results for external and internal flows by an expression of the form

$$Nu^n = Nu_F^n \pm Nu_N^n \quad (9.64)$$

For the specific geometry of interest, the Nusselt numbers  $Nu_F$  and  $Nu_N$  are determined from existing correlations for pure forced and natural (free) convection, respectively. The plus sign on the right-hand side of Equation 9.64 applies for assisting and transverse flows, while the minus sign applies for opposing flow. The best correlation of data is often obtained for  $n = 3$ , although values of 7/2 and 4 may be better suited for transverse flows involving horizontal plates and cylinders (or spheres), respectively.

Equation 9.64 should be viewed as a first approximation, and any serious treatment of a mixed convection problem should be accompanied by an examination of the open literature. Mixed convection flows received considerable attention in the late 1970s to middle 1980s, and comprehensive literature reviews are available [39–42]. The flows are endowed with a variety of rich and unusual features that can complicate heat transfer predictions. For example, in a horizontal, parallel-plate channel, three-dimensional flows in the form of longitudinal vortices are induced by bottom heating, and the longitudinal variation of the Nusselt number is characterized by a decaying oscillation [43, 44]. Moreover, in channel flows, significant asymmetries may be associated with convection heat transfer at top and bottom surfaces [45]. Finally, we note that, although buoyancy effects can significantly enhance heat transfer for laminar forced convection flows, enhancement is typically negligible if the forced flow is turbulent [46].

## 9.10

### Convection Mass Transfer

---

The buoyancy term on the right-hand side of Equation 9.3 is due to density variations in the fluid, which may arise from species concentration gradients, as well as

temperature gradients. Hence, a more general form of the Grashof number, Equation 9.12, is

$$Gr_L = \frac{g(\Delta\rho/\rho)L^3}{\nu^2} = \frac{g(\rho_s - \rho_\infty)L^3}{\rho\nu^2} \quad (9.65)$$

which may be applied to natural convection flows driven by concentration gradients and/or temperature gradients. As shown in Section 9.2, if density variations are due only to temperature gradients,  $(\Delta\rho/\rho) = -\beta\Delta T$ . However, if there are no temperature gradients, motion may still be induced by spatial variations in the species composition, and similarity considerations lead to the conclusion that  $Sh_L = f(Gr_L, Sc)$ . Moreover, correlations for convection mass transfer may be inferred from those for heat transfer by invoking the heat and mass transfer analogy. For example, if species A is evaporating or sublimating from a vertical surface into a quiescent ambient fluid B, the convection mass transfer coefficient may be obtained from the analogous form of Equation 9.24. That is,

$$\overline{Sh}_L = \frac{\overline{h}_m L}{D_{AB}} = C(Gr_L Sc)^n \quad (9.66)$$

where  $Gr_L$  is given by Equation 9.65. If the molecular weight of species A is less than that of species B,  $\rho_s < \rho_\infty$  and the buoyancy-induced flow is upward along the surface. If the opposite is true,  $\rho_s > \rho_\infty$  and the flow is descending.

The analogy may only be applied in the foregoing manner for isothermal conditions. If there are gradients in both temperature and species concentration, heat and mass transfer will occur concurrently by natural convection. Similarity considerations then yield  $\overline{Nu}_L = f(Gr_L, Pr, Sc)$  and  $\overline{Sh}_L = f(Gr_L, Sc, Pr)$ , where the density difference  $\Delta\rho$  is due to both temperature and concentration variations. As a first approximation, existing correlations of the form  $\overline{Nu}_L = f(Gr_L, Pr)$  and  $\overline{Sh}_L = f(Gr_L, Sc)$  may be used to determine the convection transfer coefficients, so long as the value of  $\Delta\rho = \rho_s - \rho_\infty$  is calculated by including the effects of both temperature and concentration variations on  $\rho_s$  and  $\rho_\infty$  and  $Le = Pr/Sc \approx 1$ . In a binary mixture of species A and B, the surface and free stream densities are defined as  $\rho_s = \rho_{s,A} + \rho_{s,B}$  and  $\rho_\infty = \rho_{\infty,A} + \rho_{\infty,B}$ , respectively, where the species densities depend on the surface and free stream temperatures. The average density across the boundary layer(s) is  $\rho = (\rho_s + \rho_\infty)/2$ .

## 9.11 Summary

---

We have considered convective flows that originate in part or exclusively from buoyancy forces, and we have introduced the dimensionless parameters needed to characterize such flows. You should be able to discern when free convection effects are important and to quantify the associated heat transfer rates. An assortment of empirical correlations has been provided for this purpose.

To test your understanding of related concepts, consider the following questions.

- What is an *extensive, quiescent* fluid?
- What conditions are required for a buoyancy-driven flow?



- How does the velocity profile in the free convection boundary layer on a heated vertical plate differ from the velocity profile in the boundary layer associated with forced flow over a parallel plate?
- What is the general form of the buoyancy term in the  $x$ -momentum equation for a free convection boundary layer? How may it be approximated if the flow is due to temperature variations? What is the name of the approximation?
- What is the physical interpretation of the *Grashof number*? What is the *Rayleigh number*? How does each parameter depend on the characteristic length?
- For a heated horizontal plate in quiescent air, do you expect heat transfer to be larger for the top or bottom surface? Why? For a cooled horizontal plate in quiescent air, do you expect heat transfer to be larger for the top or bottom surface? Why?
- For free convection within a vertical parallel plate channel, what kind of force balance governs the flow rate in the channel?
- For a vertical channel with isothermal plates, what is the physical basis for existence of an optimum spacing?
- What is the nature of flow in a cavity whose vertical surfaces are heated and cooled? What is the nature of flow in an annular space between concentric cylindrical surfaces that are heated and cooled?
- What is meant by the term *mixed convection*? How can one determine if mixed convection effects should be considered in a heat transfer analysis? Under what conditions is heat transfer enhanced by mixed convection? Under what conditions is it reduced?
- Consider transport of species A from a horizontal surface facing upward in a quiescent fluid B. If  $T_s = T_\infty$  and the molecular weight of A is less than that of B, what is the analogous heat transfer problem? What is the analogous heat transfer problem if the molecular weight of A exceeds that of B?

## References

---

1. Jaluria, Y., *Natural Convection Heat and Mass Transfer*, Pergamon Press, New York, 1980.
2. Gebhart, B., Y. Jaluria, R. L. Mahajan, and B. Sammakia, *Buoyancy-Induced Flows and Transport*, Hemisphere Publishing, Washington, DC, 1988.
3. Ostrach, S., "An Analysis of Laminar Free Convection Flow and Heat Transfer About a Flat Plate Parallel to the Direction of the Generating Body Force," National Advisory Committee for Aeronautics, Report 1111, 1953.
4. LeFevre, E. J., "Laminar Free Convection from a Vertical Plane Surface," *Proc. Ninth Int. Congr. Appl. Mech.*, Brussels, Vol. 4, 168, 1956.
5. McAdams, W. H., *Heat Transmission*, 3rd ed., McGraw-Hill, New York, 1954, Chap. 7.
6. Warner, C. Y., and V. S. Arpaci, *Int. J. Heat Mass Transfer*, **11**, 397, 1968.
7. Bayley, F. J., *Proc. Inst. Mech. Eng.*, **169**, 361, 1955.
8. Churchill, S. W., and H. H. S. Chu, *Int. J. Heat Mass Transfer*, **18**, 1323, 1975.
9. Sparrow, E. M., and J. L. Gregg, *Trans. ASME*, **78**, 435, 1956.
10. Churchill, S. W., "Free Convection Around Immersed Bodies," in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.5.7, Begell House, New York, 2002.
11. Sparrow, E. M., and J. L. Gregg, *Trans. ASME*, **78**, 1823, 1956.
12. Cebeci, T., "Laminar-Free-Convective Heat Transfer from the Outer Surface of a Vertical Slender Circular Cylinder," *Proc. Fifth Int. Heat Transfer Conf.*, Paper NC1.4, pp. 15–19, 1974.
13. Minkowycz, W. J., and E. M. Sparrow, *J. Heat Transfer*, **96**, 178, 1974.
14. Vliet, G. C., *Trans. ASME*, **91C**, 511, 1969.

15. Fujii, T., and H. Imura, *Int. J. Heat Mass Transfer*, **15**, 755, 1972.
16. Azevedo, L. F. A., and E. M. Sparrow, *J. Heat Transfer*, **107**, 893, 1985.
17. Rich, B. R., *Trans. ASME*, **75**, 489, 1953.
18. Goldstein, R. J., E. M. Sparrow, and D. C. Jones, *Int. J. Heat Mass Transfer*, **16**, 1025, 1973.
19. Lloyd, J. R., and W. R. Moran, "Natural Convection Adjacent to Horizontal Surfaces of Various Planforms," ASME Paper 74-WA/HT-66, 1974.
20. Morgan, V. T., "The Overall Convective Heat Transfer from Smooth Circular Cylinders," in T. F. Irvine and J. P. Hartnett, Eds., *Advances in Heat Transfer*, Vol. 11, Academic Press, New York, 1975, pp. 199–264.
21. Churchill, S. W., and H. H. S. Chu, *Int. J. Heat Mass Transfer*, **18**, 1049, 1975.
22. Raithby, G. D., and K. G. T. Hollands, in W. M. Rohsenow, J. P. Hartnett, and Y. I. Cho, Eds., *Handbook of Heat Transfer Fundamentals*, Chap. 4, McGraw-Hill, New York, 1998.
23. Elenbaas, W., *Physica*, **9**, 1, 1942.
24. Bar-Cohen, A., and W. M. Rohsenow, *J. Heat Transfer*, **106**, 116, 1984.
25. Ostrach, S., "Natural Convection in Enclosures," in J. P. Hartnett and T. F. Irvine, Eds., *Advances in Heat Transfer*, Vol. 8, Academic Press, New York, 1972, pp. 161–227.
26. Catton, I., "Natural Convection in Enclosures," *Proc. 6th Int. Heat Transfer Conf.*, Toronto, Canada, 1978, Vol. 6, pp. 13–31.
27. Globe, S., and D. Dropkin, *J. Heat Transfer*, **81C**, 24, 1959.
28. Hollands, K. G. T., G. D. Raithby, and L. Konicek, *Int. J. Heat Mass Transfer*, **18**, 879, 1975.
29. Churchill, S. W., "Free Convection in Layers and Enclosures," in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.5.8, Begell House, New York, 2002.
30. MacGregor, R. K., and A. P. Emery, *J. Heat Transfer*, **91**, 391, 1969.
31. Ayyaswamy, P. S., and I. Catton, *J. Heat Transfer*, **95**, 543, 1973.
32. Catton, I., P. S. Ayyaswamy, and R. M. Clever, *Int. J. Heat Mass Transfer*, **17**, 173, 1974.
33. Clever, R. M., *J. Heat Transfer*, **95**, 407, 1973.
34. Arnold, J. N., I. Catton, and D. K. Edwards, "Experimental Investigation of Natural Convection in Inclined Rectangular Regions of Differing Aspect Ratios," ASME Paper 75-HT-62, 1975.
35. Buchberg, H., I. Catton, and D. K. Edwards, *J. Heat Transfer*, **98**, 182, 1976.
36. Hollands, K. G. T., S. E. Unny, G. D. Raithby, and L. Konicek, *J. Heat Transfer*, **98**, 189, 1976.
37. Raithby, G. D., and K. G. T. Hollands, "A General Method of Obtaining Approximate Solutions to Laminar and Turbulent Free Convection Problems," in T. F. Irvine and J. P. Hartnett, Eds., *Advances in Heat Transfer*, Vol. 11, Academic Press, New York, 1975, pp. 265–315.
38. Kuehn, T. H., and R. J. Goldstein, *Int. J. Heat Mass Transfer*, **19**, 1127, 1976.
39. Churchill, S. W., "Combined Free and Forced Convection around Immersed Bodies," in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.5.9, Begell House, New York, 2002.
40. Churchill, S. W., "Combined Free and Forced Convection in Channels," in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.5.10, Begell House, New York, 2002.
41. Chen, T. S., and B. F. Armaly, in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 14, Wiley-Interscience, New York, 1987.
42. Aung, W., in S. Kakac, R. K. Shah, and W. Aung, Eds., *Handbook of Single-Phase Convective Heat Transfer*, Chap. 15, Wiley-Interscience, New York, 1987.
43. Incropera, F. P., A. J. Knox, and J. R. Maughan, *J. Heat Transfer*, **109**, 434, 1987.
44. Maughan, J. R., and F. P. Incropera, *Int. J. Heat Mass Transfer*, **30**, 1307, 1987.
45. Osborne, D. G., and F. P. Incropera, *Int. J. Heat Mass Transfer*, **28**, 207, 1985.
46. Osborne, D. G., and F. P. Incropera, *Int. J. Heat Mass Transfer*, **28**, 1337, 1985.

## Problems

### Properties and General Considerations

- 9.1 Using the values of density for water in Table A.6, calculate the volumetric thermal expansion coefficient at 300 K from its definition, Equation 9.4, and compare your result with the tabulated value.
- 9.2 Consider an object of characteristic length 0.01 m and a situation for which the temperature difference is 30°C.


Evaluating thermophysical properties at the prescribed conditions, determine the Rayleigh number for the following fluids: air (1 atm, 400 K), helium (1 atm, 400 K), glycerin (285 K), and water (310 K).

- 9.3** To assess the efficacy of different liquids for cooling by natural convection, it is convenient to introduce a *figure of merit*,  $F_N$ , which combines the influence of all pertinent fluid properties on the convection coefficient. If the Nusselt number is governed by an expression of the form,  $Nu_L \sim Ra^n$ , obtain the corresponding relationship between  $F_N$  and the fluid properties. For a representative value of  $n = 0.33$ , calculate values of  $F_N$  for air ( $k = 0.026 \text{ W/m} \cdot \text{K}$ ,  $\beta = 0.0035 \text{ K}^{-1}$ ,  $\nu = 1.5 \times 10^{-5} \text{ m}^2/\text{s}$ ,  $Pr = 0.70$ ), water ( $k = 0.600 \text{ W/m} \cdot \text{K}$ ,  $\beta = 2.7 \times 10^{-4} \text{ K}^{-1}$ ,  $\nu = 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 5.0$ ), and a dielectric liquid ( $k = 0.064 \text{ W/m} \cdot \text{K}$ ,  $\beta = 0.0014 \text{ K}^{-1}$ ,  $\nu = 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 25$ ). What fluid is the most effective cooling agent?
- 9.4** In many cases, we are concerned with free convection involving gases that are contained within sealed enclosures. Consider air at  $27^\circ\text{C}$  and pressures of 1, 10, and 100 bars. Determine the *figure of merit* described in Problem 9.3 for each of these three pressures. Which air pressure will provide the most effective cooling? *Hint*: See Problem 6.17.

### Vertical Plates

- 9.5** The heat transfer rate due to free convection from a vertical surface, 1 m high and 0.6 m wide, to quiescent air that is 20 K colder than the surface is known. What is the ratio of the heat transfer rate for that situation to the rate corresponding to a vertical surface, 0.6 m high and 1 m wide, when the quiescent air is 20 K warmer than the surface? Neglect heat transfer by radiation and any influence of temperature on the relevant thermophysical properties of air.
- 9.6** Consider a large vertical plate with a uniform surface temperature of  $130^\circ\text{C}$  suspended in quiescent air at  $25^\circ\text{C}$  and atmospheric pressure.
- Estimate the boundary layer thickness at a location 0.25 m measured from the lower edge.
  - What is the maximum velocity in the boundary layer at this location and at what position in the boundary layer does the maximum occur?
  - Using the similarity solution result, Equation 9.19, determine the heat transfer coefficient 0.25 m from the lower edge.
  - At what location on the plate measured from the lower edge will the boundary layer become turbulent?

- 9.7** A number of thin plates are to be cooled by vertically suspending them in a water bath at a temperature of  $20^\circ\text{C}$ . If the plates are initially at  $54^\circ\text{C}$  and are 0.15 m long, what minimum spacing would prevent interference between their free convection boundary layers?
- 9.8** A square aluminum plate 5 mm thick and 200 mm on a side is heated while vertically suspended in quiescent air at  $40^\circ\text{C}$ . Determine the average heat transfer coefficient for the plate when its temperature is  $15^\circ\text{C}$  by two methods: using results from the similarity solution to the boundary layer equations, and using results from an empirical correlation.
- 9.9** Consider an array of vertical rectangular fins, which is to be used to cool an electronic device mounted in quiescent, atmospheric air at  $T_\infty = 27^\circ\text{C}$ . Each fin has  $L = 20 \text{ mm}$  and  $H = 150 \text{ mm}$  and operates at an approximately uniform temperature of  $T_s = 77^\circ\text{C}$ .

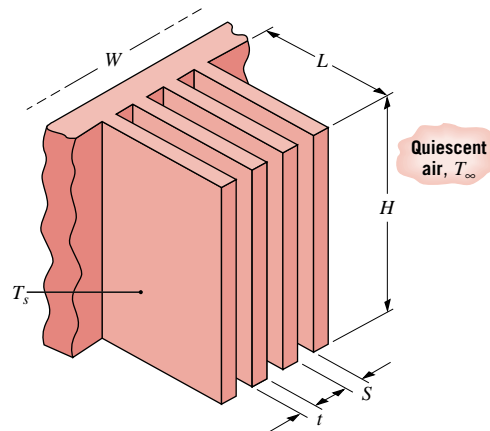

- Viewing each fin surface as a vertical plate in an infinite, quiescent medium, briefly describe why there exists an optimum fin spacing  $S$ . Using Figure 9.4, estimate the optimum value of  $S$  for the prescribed conditions.
  - For the optimum value of  $S$  and a fin thickness of  $t = 1.5 \text{ mm}$ , estimate the rate of heat transfer from the fins for an array of width  $W = 355 \text{ mm}$ .
- 9.10** Determine the average convection heat transfer coefficient for the 2.5-m-high vertical walls of a home having respective interior air and wall surface temperatures of (a) 20 and  $10^\circ\text{C}$  and (b) 27 and  $37^\circ\text{C}$ .
- 9.11** Beginning with the free convection correlation of the form given by Equation 9.24, show that for air at atmospheric pressure and a film temperature of 400 K,

the average heat transfer coefficient for a vertical plate can be expressed as

$$\begin{aligned}\bar{h}_L &= 1.40 \left( \frac{\Delta T}{L} \right)^{1/4} & 10^4 < Ra_L < 10^9 \\ \bar{h}_L &= 0.98 \Delta T^{1/3} & 10^9 < Ra_L < 10^{13}\end{aligned}$$

- 9.12** A solid object is to be cooled by submerging it in a quiescent fluid, and the associated free convection coefficient is given by  $\bar{h} = C\Delta T^{1/4}$ , where  $C$  is a constant and  $\Delta T = T - T_\infty$ .

- Invoking the lumped capacitance approximation, obtain an expression for the time required for the object to cool from an initial temperature  $T_i$  to a final temperature  $T_f$ .
- Consider a highly polished, 150-mm square aluminum alloy (2024) plate of 5-mm thickness, initially at 225°C, and suspended in ambient air at 25°C. Using the appropriate approximate correlation from Problem 9.11, determine the time required for the plate to reach 80°C.
- Plot the temperature–time history obtained from part (b) and compare with the results from a lumped capacitance analysis using a constant free convection coefficient,  $\bar{h}_o$ . Evaluate  $\bar{h}_o$  from an appropriate correlation based on an average surface temperature of  $\bar{T} = (T_i + T_f)/2$ .

- 9.13** A household oven door of 0.5-m height and 0.7-m width reaches an average surface temperature of 32°C during operation. Estimate the heat loss to the room with ambient air at 22°C. If the door has an emissivity of 1.0 and the surroundings are also at 22°C, comment on the heat loss by free convection relative to that by radiation.

- 9.14** An aluminum alloy (2024) plate, heated to a uniform temperature of 227°C, is allowed to cool while vertically suspended in a room where the ambient air and surroundings are at 27°C. The plate is 0.3 m square with a thickness of 15 mm and an emissivity of 0.25.


- Develop an expression for the time rate of change of the plate temperature, assuming the temperature to be uniform at any time.
- Determine the initial rate of cooling (K/s) when the plate temperature is 227°C.
- Justify the uniform plate temperature assumption.
- Compute and plot the temperature history of the plate from  $t = 0$  to the time required to reach a temperature of 30°C. Compute and plot the corresponding variations in the convection and radiation heat transfer rates.

- 9.15** The plate described in Problem 9.14 has been used in an experiment to determine the free convection heat transfer coefficient. At an instant of time when the plate temperature was 127°C, the time rate of change of this temperature was observed to be  $-0.0465$  K/s. What is the corresponding free convection heat transfer coefficient? Compare this result with an estimate based on a standard empirical correlation.

- 9.16** The ABC Evening News Report in a news segment on hypothermia research studies at the University of Minnesota claimed that heat loss from the body is 30 times faster in 10°C water than in air at the same temperature. Is that a realistic statement?

- 9.17** Consider a vertical, single-pane window of equivalent width and height ( $W = L = 1$  m). The interior surface is exposed to the air and walls of a room, which are each at 18°C. Under cold ambient conditions for which a thin layer of frost has formed on the inner surface, what is the heat loss through the window? How would your analysis be affected by a frost layer whose thickness is not negligible? During incipience of frost formation, where would you expect the frost to begin to develop on the window? The frost may be assumed to have an emissivity of  $\varepsilon = 0.90$ .


- 9.18** During a winter day, the window of a patio door with a height of 1.8 m and width of 1.0 m shows a frost line near its base. The room wall and air temperatures are 15°C.

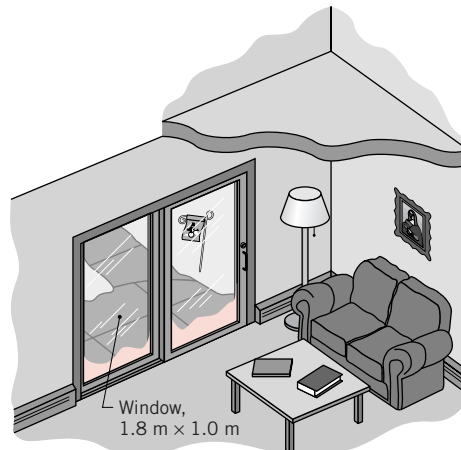

- Explain why the window would show a frost layer at the base rather than at the top.
- Estimate the heat loss through the window due to free convection and radiation. Assume the window has a uniform temperature of 0°C and the

emissivity of the glass surface is 0.94. If the room has electric baseboard heating, estimate the corresponding daily cost of the window heat loss for a utility rate of 0.08 \$/kW · h.

- 9.19** A vertical, thin pane of window glass that is 1 m on a side separates quiescent room air at  $T_{\infty,i} = 20^\circ\text{C}$  from quiescent ambient air at  $T_{\infty,o} = -20^\circ\text{C}$ . The walls of the room and the external surroundings (landscape, buildings, etc.) are also at  $T_{\text{sur},i} = 20^\circ\text{C}$  and  $T_{\text{sur},o} = -20^\circ\text{C}$ , respectively.

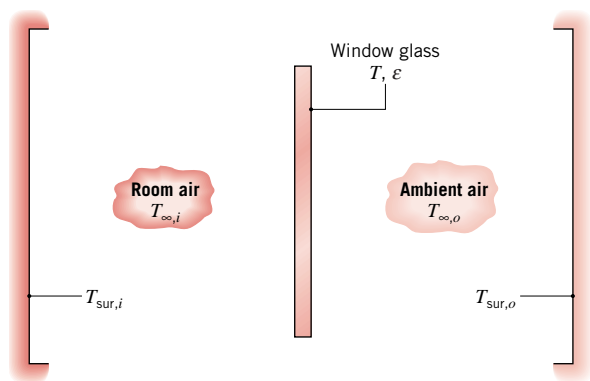


If the glass has an emissivity of  $\epsilon = 1$ , what is its temperature  $T$ ? What is the rate of heat loss through the glass?

- 9.20** Consider the conditions of Problem 9.19, but now allow for a difference between the inner and outer surface temperatures,  $T_{s,i}$  and  $T_{s,o}$ , of the window. For a glass thickness and thermal conductivity of  $t_g = 10$  mm and  $k_g = 1.4$  W/m · K, respectively, evaluate  $T_{s,i}$  and  $T_{s,o}$ . What is the heat loss through the window?

- 9.21** Consider the conveyor system described in Problem 7.24, but under conditions for which the conveyor is not moving and the air is quiescent. Radiation effects and interactions between boundary layers on adjoining surfaces may be neglected.

- For the prescribed plate dimensions and initial temperature, as well as the prescribed air temperature, what is the initial rate of heat transfer from one of the plates?
- How long does it take for a plate to cool from  $300^\circ\text{C}$  to  $100^\circ\text{C}$ ? Comment on the assumption of negligible radiation.

- 9.22** A thin-walled container with a hot process fluid at  $50^\circ\text{C}$  is placed in a quiescent, cold water bath at  $10^\circ\text{C}$ . Heat transfer at the inner and outer surfaces of the container may be approximated by free convection from a vertical plate.

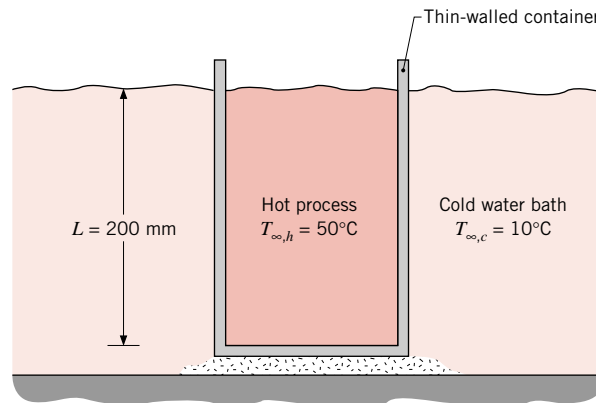

- Determine the overall heat transfer coefficient between the hot process fluid and the cold water bath. Assume the properties of the hot process fluid are those of water.
- Generate a plot of the overall heat transfer coefficient as a function of the hot process fluid temperature  $T_{\infty,h}$  for the range 20 to  $60^\circ\text{C}$ , with all other conditions remaining the same.

- 9.23** Consider an experiment to investigate the transition to turbulent flow in a free convection boundary layer that develops along a vertical plate suspended in a large room. The plate is constructed of a thin heater that is sandwiched between two aluminum plates and may be assumed to be isothermal. The heated plate is 1 m high and 2 m wide. The quiescent air and the surroundings are both at  $25^\circ\text{C}$ .

- The exposed surfaces of the aluminum plate are painted with a very thin coating of high emissivity ( $\epsilon = 0.95$ ) paint. Determine the electrical power that must be supplied to the heater to sustain the plate at a temperature of  $T_s = 35^\circ\text{C}$ . How much of the plate is exposed to turbulent conditions in the free convection boundary layer?
- The experimentalist speculates that the roughness of the paint is affecting the transition to turbulence in the boundary layer and decides to remove the paint and polish the aluminum surface ( $\epsilon = 0.05$ ). If the same power is supplied to the plate as in part (a), what is the steady-state plate temperature? How much of the plate is exposed to turbulent conditions in the free convection boundary layer?

- 9.24** A square plate of pure aluminum, 0.5 m on a side and 16 mm thick, is initially at  $300^\circ\text{C}$  and is suspended in a large chamber. The walls of the chamber are maintained at  $27^\circ\text{C}$ , as is the enclosed air. If the surface emissivity of the plate is 0.25, what is the initial cooling rate? Is it




reasonable to assume a uniform plate temperature during the cooling process?

- 9.25** The vertical rear window of an automobile is of thickness  $L = 8$  mm and height  $H = 0.5$  m and contains fine-meshed heating wires that can induce nearly uniform volumetric heating,  $\dot{q}$  ( $\text{W}/\text{m}^3$ ).

(a) Consider steady-state conditions for which the interior surface of the window is exposed to quiescent air at  $10^\circ\text{C}$ , while the exterior surface is exposed to air at  $-10^\circ\text{C}$  moving in parallel flow over the surface with a velocity of  $20$  m/s. Determine the volumetric heating rate needed to maintain the interior window surface at  $T_{s,i} = 15^\circ\text{C}$ .


(b) The interior and exterior window temperatures,  $T_{s,i}$  and  $T_{s,o}$ , depend on the compartment and ambient temperatures,  $T_{\infty,i}$  and  $T_{\infty,o}$ , as well as on the velocity  $u_\infty$  of air flowing over the exterior surface and the volumetric heating rate  $\dot{q}$ . Subject to the constraint that  $T_{s,i}$  is to be maintained at  $15^\circ\text{C}$ , we wish to develop guidelines for varying the heating rate in response to changes in  $T_{\infty,i}$ ,  $T_{\infty,o}$ , and/or  $u_\infty$ . If  $T_{\infty,i}$  is maintained at  $10^\circ\text{C}$ , how will  $\dot{q}$  and  $T_{s,o}$  vary with  $T_{\infty,o}$  for  $-25 \leq T_{\infty,o} \leq 5^\circ\text{C}$  and  $u_\infty = 10$ ,  $20$ , and  $30$  m/s? If a constant vehicle speed is maintained, such that  $u_\infty = 30$  m/s, how will  $\dot{q}$  and  $T_{s,o}$  vary with  $T_{\infty,i}$  for  $5 \leq T_{\infty,i} \leq 20^\circ\text{C}$  and  $T_{\infty,o} = -25$ ,  $-10$ , and  $5^\circ\text{C}$ ?

- 9.26** Determine the maximum allowable uniform heat flux that may be imposed at a wall heating panel  $1$  m high if the maximum temperature is not to exceed  $37^\circ\text{C}$  when the ambient air temperature is  $25^\circ\text{C}$ .
- 9.27** The components of a vertical circuit board,  $150$  mm on a side, dissipate  $5$  W. The back surface is well insulated and the front surface is exposed to quiescent air at  $27^\circ\text{C}$ .

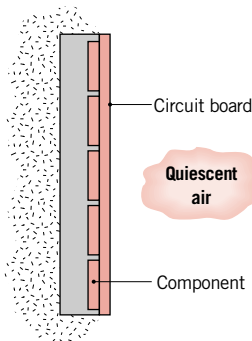


Assuming a uniform surface heat flux, what is the maximum temperature of the board? What is the temperature of the board for an isothermal surface condition?

- 9.28** Circuit boards are mounted to interior vertical surfaces of a rectangular duct of height  $H = 400$  mm and length  $L = 800$  mm. Although the boards are cooled by forced convection heat transfer to air flowing through the duct, not all of the heat dissipated by the electronic components is transferred to the flow. Some of the heat is instead transferred by conduction to the vertical walls of the duct and then by natural convection and radiation to the ambient (atmospheric) air and surroundings, which are at equivalent temperatures of  $T_\infty = T_{\text{sur}} = 20^\circ\text{C}$ . The walls are metallic and, to a first approximation, may be assumed to be isothermal at a temperature  $T_s$ .

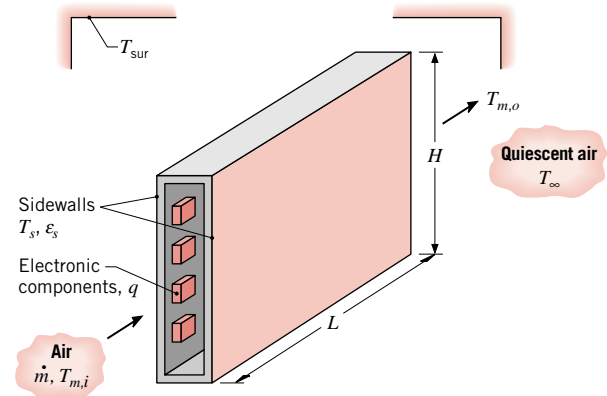


- (a) Consider conditions for which the electronic components dissipate  $200$  W and air enters the duct at a flow rate of  $\dot{m} = 0.015$  kg/s and a temperature of  $T_{m,i} = 20^\circ\text{C}$ . If the emissivity of the side walls is  $\varepsilon_s = 0.15$  and the outlet temperature of the air is  $T_{m,o} = 30^\circ\text{C}$ , what is the surface temperature  $T_s$ ?
- (b) To reduce the temperature of the electronic components, it is desirable to enhance heat transfer from the side walls. Assuming no change in the air flow conditions, what is the effect on  $T_s$  of applying a high emissivity coating ( $\varepsilon_s = 0.90$ ) to the side walls?
- (c) If there is a loss of air flow while power continues to be dissipated, what are the resulting values of  $T_s$  for  $\varepsilon_s = 0.15$  and  $\varepsilon_s = 0.90$ ?
- 9.29** A refrigerator door has a height and width of  $H = 1$  m and  $W = 0.65$  m, respectively, and is situated in a large room for which the air and walls are at  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ . The door consists of a layer of polystyrene insulation ( $k = 0.03$  W/m  $\cdot$  K) sandwiched between thin sheets of steel ( $\varepsilon = 0.6$ ) and polypropylene. Under normal operating conditions, the inner surface of the door is maintained at a fixed temperature of  $T_{s,i} = 5^\circ\text{C}$ .

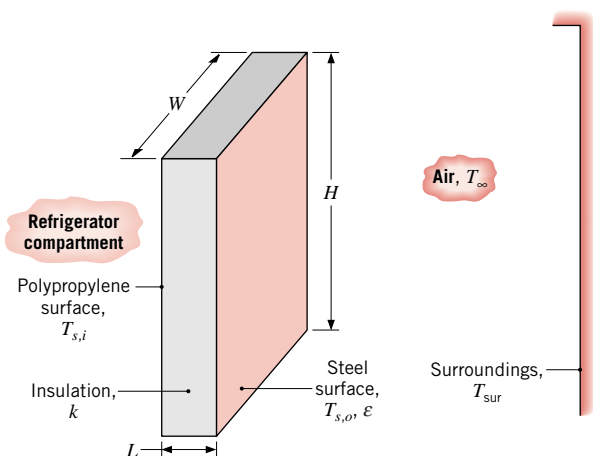

- Estimate the heat gain through the door for the worst case condition corresponding to no insulation ( $L = 0$ ).
- Compute and plot the heat gain and the outer surface temperature  $T_{s,o}$  as a function of insulation thickness for  $0 \leq L \leq 25$  mm.


**9.30** Air at 3 atm and  $100^\circ\text{C}$  is discharged from a compressor into a vertical receiver of 2.5-m height and 0.75-m diameter. Assume that the receiver wall has negligible thermal resistance, is at a uniform temperature, and that heat transfer at its inner and outer surfaces is by free convection from a vertical plate. Neglect radiation exchange and any losses from the top.

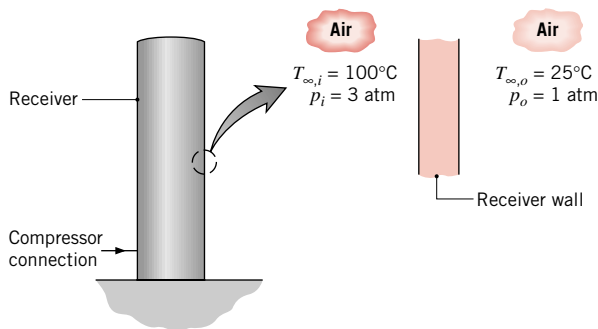

- Estimate the receiver wall temperature and the heat transfer to the ambient air at  $25^\circ\text{C}$ . To facilitate use of the free convection correlations with appropriate film temperatures, assume that the receiver wall temperature is  $60^\circ\text{C}$ .
- Were the assumed film temperatures of part (a) reasonable? If not, use an iteration procedure to find consistent values.
- Now consider two features of the receiver neglected in the previous analysis: (i) radiation exchange from

the exterior surface of emissivity 0.85 to large surroundings, also at  $25^\circ\text{C}$ ; and (ii) the thermal resistance of a 20-mm-thick wall with a thermal conductivity of  $0.25 \text{ W/m} \cdot \text{K}$ . Represent the system by a thermal circuit and estimate the wall temperatures and the heat transfer rate.


**9.31** In the *central receiver* concept of a solar power plant, many heliostats at ground level are used to direct a concentrated solar flux  $q_s''$  to the receiver, which is positioned at the top of a tower. However, even with absorption of all the solar flux by the outer surface of the receiver, losses due to free convection and radiation reduce the collection efficiency below the maximum possible value of 100%. Consider a cylindrical receiver of diameter  $D = 7$  m, length  $L = 12$  m, and emissivity  $\varepsilon = 0.20$ .

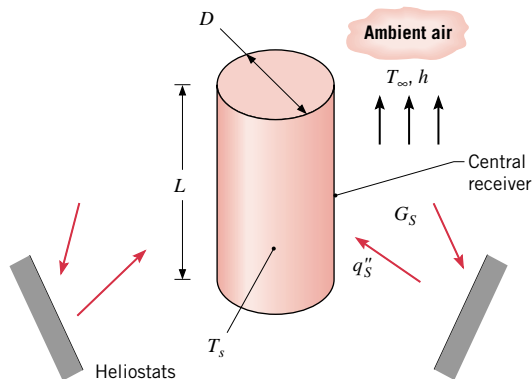

- If all of the solar flux is absorbed by the receiver and a surface temperature of  $T_s = 800 \text{ K}$  is maintained, what is the rate of heat loss from the receiver? The ambient air is quiescent at a temperature of  $T_{\infty} = 300 \text{ K}$ , and irradiation from the surroundings may be neglected. If the corresponding value of the solar flux is  $q_s'' = 10^5 \text{ W/m}^2$ , what is the collector efficiency?
- The surface temperature of the receiver is affected by design and operating conditions within the power plant. Over the range from 600 to 1000 K, plot the variation of the convection, radiation, and total heat rates as a function of  $T_s$ . For a fixed value of  $q_s'' = 10^5 \text{ W/m}^2$ , plot the corresponding variation of the receiver efficiency.

**9.32** An experimental apparatus is shown in the schematic for measuring the local convection coefficient and the boundary layer temperature distribution for a heated vertical plate immersed in an extensive, quiescent fluid. The plate is maintained at a uniform temperature by circulating a thermostatically controlled fluid through imbedded

flow channels. The heat flux and surface temperature are measured at discrete locations along the  $x$ -axis by miniature sensors using thin-film thermocouple technology. The fluid temperature in the boundary layer is measured using a microwire thermocouple probe. The plate is mounted within a room under stable climate control. For the series of observations tabulated below, the quiescent air and room wall temperatures were 296 K. Your task is to process the experimental observations and compare them to results from the similarity solution for laminar free convection (Section 9.4).

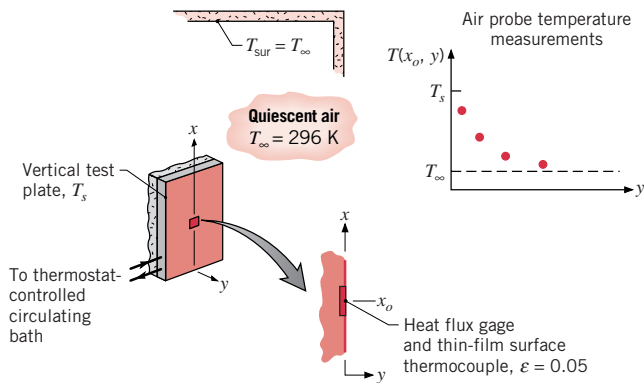

The following table provides measurements from the heat flux sensor at six  $x$ -locations for the specified plate–air temperature difference.

	$T_s - T_\infty = 7.7 \text{ K}$					
$x \text{ (mm)}$	25	75	175	275	375	475
$q''_{\text{tot}} \text{ (W/m}^2\text{)}$	41.4	27.2	22.0	20.1	18.3	17.2

Measurements obtained from the air temperature probe are provided next for three discrete  $y$ -locations at two  $x$ -locations. The local Grashof numbers corresponding to the  $x$ -locations have been calculated to simplify your analysis.

	$T_s - T_\infty = 7.3 \text{ K}$					
	$x = 200 \text{ mm,}$ $Gr_x = 7.6 \times 10^6$			$x = 400 \text{ mm,}$ $Gr_x = 6.0 \times 10^7$		
$y \text{ (mm)}$	2.5	5.0	10.0	2.5	5.0	10.0
$T(x, y) - T_\infty \text{ (K)}$	5.5	3.8	1.6	5.9	4.5	2.0

- The surfaces of the heat flux sensors experience free convection and radiation exchange with the surroundings. Write an expression for estimating the radiation heat flux from the sensor as a function of the surface emissivity, the temperature of the surroundings, and the temperature difference ( $T_s - T_\infty$ ).
- Using the expression derived in part (a), apply a correction to the measured total heat flux,  $q''_{\text{tot}}$ , to


obtain the convection heat flux,  $q''_{\text{cv}}$ , and calculate the convection coefficient. Extend the first table above to include the results of your analysis.

- Calculate and plot the local convection coefficient,  $h_x(x)$ , as a function of the  $x$ -coordinate using the similarity solution, Eqs. 9.19 and 9.20. On the same graph, plot the experimental points. Comment on the comparison between the experimental and analytical results.
- For the conditions in the second table, compare the experimental boundary-layer air temperature measurements with those from the similarity solution, Figure 9.4b. Summarize the results of your analysis using the similarity parameter,  $\eta$ , and the dimensionless temperature,  $T^*$ . Comment on the comparison between the experimental and analytical results.

## Horizontal and Inclined Plates

**9.33** Consider the transformer of Problem 8.97, whose lateral surface is being maintained at  $47^\circ\text{C}$  by a forced convection coolant line removing 1000 W. It is desired to explore cooling of the transformer by free convection and radiation, assuming the surface to have an emissivity of 0.80.

- Determine how much power could be removed by free convection and radiation from the lateral and the upper horizontal surfaces when the ambient temperature and the surroundings are at  $27^\circ\text{C}$ .

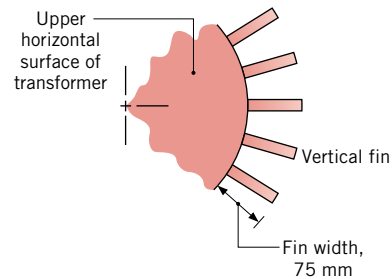

- Vertical fins, 5 mm thick, 75 mm wide, and 500 mm long, can easily be welded to the lateral surface. What is the heat removal rate by free convection if 30 such fins are attached?

**9.34** Airflow through a long, 0.2-m-square air conditioning duct maintains the outer duct surface temperature at  $10^\circ\text{C}$ . If the horizontal duct is uninsulated and exposed to air at  $35^\circ\text{C}$  in the crawlspace beneath a home, what is the heat gain per unit length of the duct?

**9.35** Consider the conditions of Example 9.3, including the effect of adding insulation of thickness  $t$  and thermal



conductivity  $k = 0.035 \text{ W/m} \cdot \text{K}$  to the duct. We wish to now include the effect of radiation on the outer surface temperatures and the total heat loss per unit length of duct.


- (a) If  $T_{s,1} = 45^\circ\text{C}$ ,  $t = 25 \text{ mm}$ ,  $\varepsilon = 1$ , and  $T_{\text{sur}} = 288 \text{ K}$ , what are the temperatures of the side, top, and bottom surfaces? What are the corresponding heat losses per unit length of duct?
- (b) For the top surface, compute and plot  $T_{s,2}$  and  $q'$  as a function of insulation thickness for  $0 \leq t \leq 50 \text{ mm}$ . The exposed duct surface ( $t = 0$ ) may also be assumed to have an emissivity of  $\varepsilon = 1$ .

**9.36** An electrical heater in the form of a horizontal disk of 400-mm diameter is used to heat the bottom of a tank filled with engine oil at a temperature of  $5^\circ\text{C}$ . Calculate the power required to maintain the heater surface temperature at  $70^\circ\text{C}$ .

**9.37** Consider a horizontal 6-mm-thick, 100-mm-long straight fin fabricated from plain carbon steel ( $k = 57 \text{ W/m} \cdot \text{K}$ ,  $\varepsilon = 0.5$ ). The base of the fin is maintained at  $150^\circ\text{C}$ , while the quiescent ambient air and the surroundings are at  $25^\circ\text{C}$ . Assume the fin tip is adiabatic.

- (a) Estimate the fin heat rate per unit width,  $q'_f$ . Use an average fin surface temperature of  $125^\circ\text{C}$  to estimate the free convection coefficient and the linearized radiation coefficient. How sensitive is your estimate to the choice of the average fin surface temperature?
- (b) Generate a plot of  $q'_f$  as a function of the fin emissivity for  $0.05 \leq \varepsilon \leq 0.95$ . On the same coordinates, show the fraction of the total heat rate due to radiation exchange.


**9.38** The thermal conductivity and surface emissivity of a material may be determined by heating its bottom surface and exposing its top surface to quiescent air and large surroundings of equivalent temperatures,  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ . The remaining surfaces of the sample/heater are well insulated.

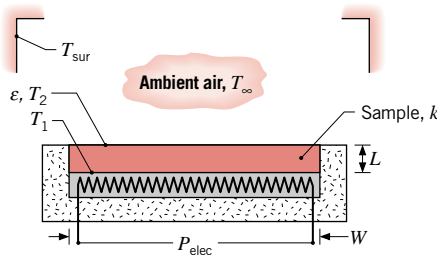

Consider a sample of thickness  $L = 25 \text{ mm}$  and a square planform of width  $W = 250 \text{ mm}$ . In an experi-

ment performed under steady-state conditions, temperature measurements made at the lower and upper surface of the sample yield values of  $T_1 = 150^\circ\text{C}$  and  $T_2 = 100^\circ\text{C}$ , respectively, for a power input of  $P_{\text{elec}} = 70 \text{ W}$ . What are the thermal conductivity and emissivity of the sample?

**9.39** Convection heat transfer coefficients for a heated horizontal surface facing upward may be determined by a gage whose specific features depend on whether the temperature of the surroundings is known. For configuration A, a copper disk, which is electrically heated from below, is encased in an insulating material such that all of the heat is transferred by convection and radiation from the top surface. If the surface emissivity and the temperatures of the air and surroundings are known, the convection coefficient may be determined from measurement of the electrical power and the surface temperature of the disk. Configuration B is used in situations for which the temperature of the surroundings is not known. A thin, insulating strip separates semicircular disks with independent electrical heaters and different emissivities. If the emissivities and temperature of the air are known, the convection coefficient may be determined from measurement of the electrical power supplied to each of the disks in order to maintain them at a common temperature.

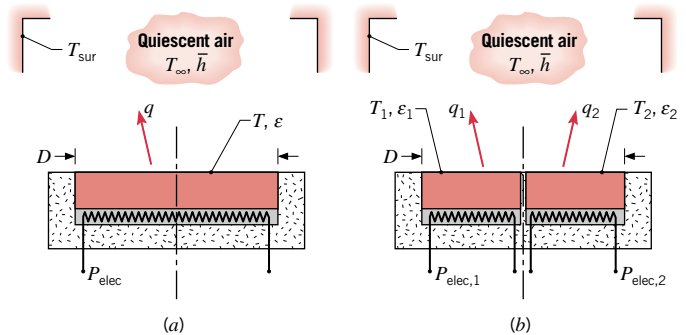

- (a) In an application of configuration A to a disk of diameter  $D = 160 \text{ mm}$  and emissivity  $\varepsilon = 0.8$ , values of  $P_{\text{elec}} = 10.8 \text{ W}$  and  $T = 67^\circ\text{C}$  are measured for  $T_\infty = T_{\text{sur}} = 27^\circ\text{C}$ . What is the corresponding value of the average convection coefficient? How does it compare with predictions based on a standard correlation?
- (b) Now consider an application of configuration B for which  $T_\infty = 17^\circ\text{C}$  and  $T_{\text{sur}}$  is unknown. With  $D = 160 \text{ mm}$ ,  $\varepsilon_1 = 0.8$  and  $\varepsilon_2 = 0.1$ , values of  $P_{\text{elec},1} = 9.70 \text{ W}$  and  $P_{\text{elec},2} = 5.67 \text{ W}$  are measured when  $T_1 = T_2 = 77^\circ\text{C}$ . Determine the corresponding

values of the convection coefficient and the temperature of the surroundings. How does the convection coefficient compare with predictions by an appropriate correlation?

- 9.40** A circular grill of diameter 0.25 m and emissivity 0.9 is maintained at a constant surface temperature of 130°C. What electrical power is required when the room air and surroundings are at 24°C?

- 9.41** Many laptop computers are equipped with thermal management systems that involve liquid cooling of the central processing unit (CPU), transfer of the heated liquid to the back of the laptop screen assembly, and dissipation of heat from the back of the screen assembly by way of a flat, isothermal heat spreader. The cooled liquid is recirculated to the CPU and the process continues. Consider an aluminum heat spreader that is of width  $w = 275$  mm and height  $L = 175$  mm. The screen assembly is oriented at an angle  $\theta = 30^\circ$  from the vertical direction, and the heat spreader is attached to the  $t = 3$  mm thick plastic housing with a thermally conducting adhesive. The plastic housing has a thermal conductivity of  $k = 0.21$  W/m · K and emissivity of  $\varepsilon = 0.85$ . The contact resistance associated with the heat spreader-housing interface is  $R''_{t,c} = 2.0 \times 10^{-4}$  m<sup>2</sup> · K/W. If the CPU generates, on average, 15 W of thermal energy, what is the temperature of the heat spreader when  $T_\infty = T_{\text{sur}} = 23^\circ\text{C}$ ? Which thermal resistance (contact, conduction, radiation, or free convection) is the largest?

- 9.42** Consider the roof of the refrigerated truck compartment described in Problem 7.20, but under conditions for which the truck is parked ( $V = 0$ ). All other conditions remain unchanged. For  $\alpha_s = \varepsilon = 0.5$ , determine the outer surface temperature,  $T_{s,o}$ , and the heat load imposed on the refrigeration system. *Hint:* Assume  $T_{s,o} > T_\infty$  and  $Ra_L > 10^7$ .


- 9.43** The 4-m by 4-m horizontal roof of an uninsulated aluminum melting furnace is comprised of a 0.08-m-thick fireclay brick refractory covered by a 5-mm-thick steel (AISI 1010) plate. The refractory surface exposed to the furnace gases is maintained at 1700 K during operation, while the outer surface of the steel is exposed to the air and walls of a large room at 25°C. The emissivity of the steel is  $\varepsilon = 0.3$ .

- What is the rate of heat loss from the roof?
- If a 20-mm-thick layer of alumina-silica insulation (64 kg/m<sup>3</sup>) is placed between the refractory and the steel, what is the new rate of heat loss from the roof? What is the temperature at the inner surface of the insulation?
- One of the process engineers claims that the temperature at the inner surface of the insulation found

in part (b) is too high for safe, long-term operation. What thickness of fireclay brick would reduce this temperature to 1350 K?


- 9.44** A stereo receiver/amplifier is enclosed in a thin metallic case for which the top, horizontal surface is 0.5 m × 0.5 m on a side. The surface, which is not vented, has an emissivity of  $\varepsilon = 0.8$  and is exposed to quiescent ambient air and large surroundings for which  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ . For surface temperatures in the range  $50 \leq T_s \leq 75^\circ\text{C}$ , compute and plot the total heat rate from the surface, as well as the contributions due to convection and radiation.

- 9.45** At the end of its manufacturing process, a silicon wafer of diameter  $D = 150$  mm, thickness  $\delta = 1$  mm, and emissivity  $\varepsilon = 0.65$  is at an initial temperature of  $T_i = 325^\circ\text{C}$  and is allowed to cool in quiescent, ambient air and large surroundings for which  $T_\infty = T_{\text{sur}} = 25^\circ\text{C}$ .

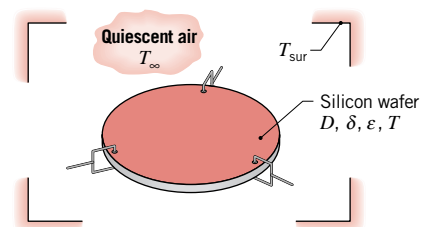

- What is the initial rate of cooling?
- How long does it take for the wafer to reach a temperature of 50°C? Comment on how the relative effects of convection and radiation vary with time during the cooling process.

- 9.46** A 200-mm-square, 10-mm-thick tile has the thermo-physical properties of pyrex ( $\varepsilon = 0.80$ ) and emerges from a curing process at an initial temperature of  $T_i = 140^\circ\text{C}$ . The backside of the tile is insulated while the upper surface is exposed to ambient air and surroundings at 25°C.

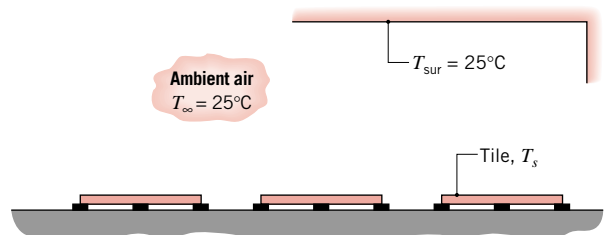


- Estimate the time required for the tile to cool to a final, safe-to-touch temperature of  $T_f = 40^\circ\text{C}$ . Use

an average tile surface temperature of  $\bar{T} = (T_i + T_j)/2$  to estimate the average free convection coefficient and the linearized radiation coefficient. How sensitive is your estimate to the assumed value for  $\bar{T}$ ?

- (b) Estimate the required cooling time if ambient air is blown in parallel flow over the tile with a velocity of 10 m/s.


**9.47** Integrated circuit (IC) boards are stacked within a duct and dissipate a total of 500 W. The duct has a square cross section with  $w = H = 150$  mm and a length of 0.5 m. Air flows into the duct at 25°C and 1.2 m<sup>3</sup>/min, and the convection coefficient between the air and the inner surfaces of the duct is  $\bar{h}_i = 50$  W/m<sup>2</sup> · K. The entire outer surface of the duct, which is anodized with an emissivity of 0.5, is exposed to ambient air and large surroundings at 25°C.

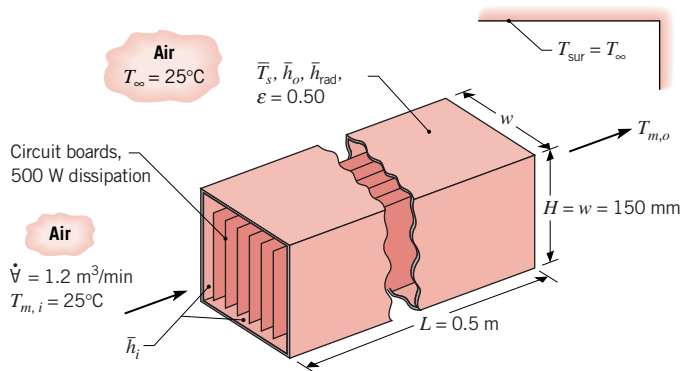

Your assignment is to develop a model to estimate the outlet temperature of the air,  $T_{m,o}$ , and the average surface temperature of the duct,  $\bar{T}_s$ .

- Assuming a surface temperature of 37°C, estimate the average free convection coefficient,  $\bar{h}_o$ , for the outer surface of the duct.
- Assuming a surface temperature of 37°C, estimate the average linearized radiation coefficient,  $\bar{h}_{rad}$ , for the outer surface of the duct.
- Perform an energy balance on the duct by considering the dissipation of electrical power in the ICs, the rate of change in the energy of air flowing through the duct, and the rate of heat transfer from the air in the duct to the surroundings. Express the last process in terms of thermal resistances between the mean temperature,  $\bar{T}_m$ , of the air in the duct and the temperature of the ambient air and the surroundings.
- Substitute numerical values into the expression of part (c) and calculate the air outlet temperature,  $T_{m,o}$ . Estimate the corresponding value of  $\bar{T}_s$ . Comment on your results and the assumptions inherent in your model.

**9.48** A highly polished aluminum plate of length 0.5 m and width 0.2 m is subjected to an airstream at a temperature of 23°C and a velocity of 10 m/s. Because of upstream conditions, the flow is turbulent over the entire length of the plate. A series of segmented, independently controlled heaters is attached to the lower side of the plate to maintain approximately isothermal conditions over the entire plate. The electrical heater covering the section between the positions  $x_1 = 0.2$  m and  $x_2 = 0.3$  m is shown in the schematic.

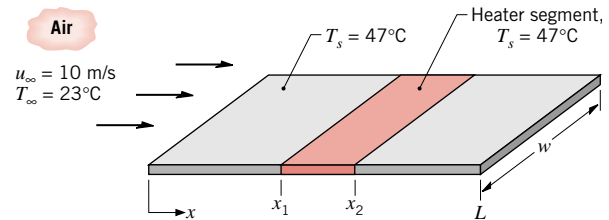

- Estimate the electrical power that must be supplied to the designated heater segment to maintain the plate surface temperature at  $T_s = 47^\circ\text{C}$ .
- If the blower that maintains the airstream velocity over the plate malfunctions, but the power to the heaters remains constant, estimate the surface temperature of the designated segment. Assume that the ambient air is extensive, quiescent, and at 23°C.

**9.49** The average free convection coefficient for the exterior surfaces of a long, horizontal rectangular duct exposed to a quiescent fluid can be estimated from the Hahn–Didion (H–D) correlation [ASHRAE Proceedings, Part 1, pp. 262–67, 1972]

$$\overline{Nu}_p = 0.55 \text{Ra}_p^{1/4} \left( \frac{H}{P} \right)^{1/8} \quad \text{Ra}_p \leq 10^7$$

where the characteristic length is the half-perimeter,  $P = (w + H)$ , and  $w$  and  $H$  are the horizontal width and vertical height, respectively, of the duct. The thermophysical properties are evaluated at the film temperature.

- Consider a horizontal 0.15-m-square duct with a surface temperature of 35°C in ambient air at 15°C. Calculate the average convection coefficient and the heat rate per unit length using the H–D correlation.
- Calculate the average convection coefficient and the heat rate per unit length considering the duct as formed by vertical plates (sides) and horizontal plates (top and bottom). Do you expect this estimate to be lower or higher than that obtained with the H–D correlation? Explain the difference, if any.
- Using an appropriate correlation, calculate the average convection coefficient and the heat rate per unit


length for a duct of circular cross section having a perimeter equal to the wetted perimeter of the rectangular duct of part (a). Do you expect this estimate to be lower or higher than that obtained with the H-D correlation? Explain the difference, if any.

- 9.50** It is desired to estimate the effectiveness of a horizontal, straight fin of rectangular cross section when applied to a surface operating at  $45^\circ\text{C}$  in an environment for which the surroundings and ambient air are at  $25^\circ\text{C}$ . The fin is to be fabricated from aluminum alloy (2024-T6) with an anodized finish ( $\varepsilon = 0.82$ ) and is 2 mm thick and 100 mm long.

- Considering only free convection from the fin surface and estimating an average heat transfer coefficient, determine the effectiveness of the fin.
- Estimate the effectiveness of the fin, including the influence of radiation exchange with the surroundings.

- (c) Using a numerical method, develop the finite-difference equations and obtain the fin effectiveness. The free convection and radiation exchange modes should be based on local, rather than average, values for the fin.

- 9.51** Certain wood stove designs rely exclusively on heat transfer by radiation and natural convection to the surroundings. Consider a stove that forms a cubical enclosure,  $L_s = 1$  m on a side, in a large room. The exterior walls of the stove have an emissivity of  $\varepsilon = 0.8$  and are at an operating temperature of  $T_{s,s} = 500$  K.

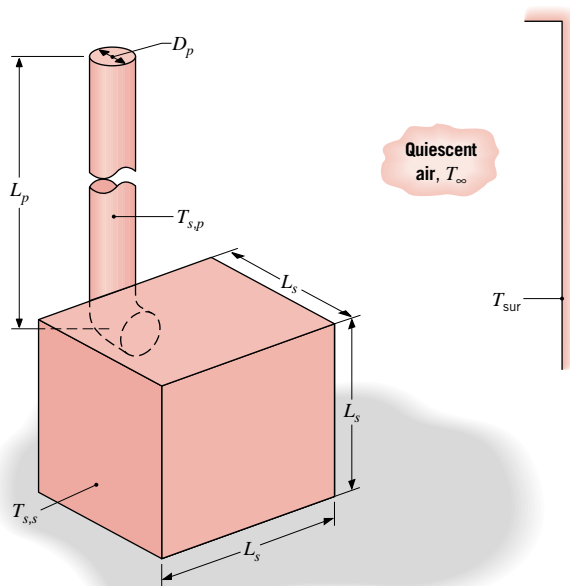

The stove pipe, which may be assumed to be isothermal at an operating temperature of  $T_{s,p} = 400$  K, has a diameter of  $D_p = 0.25$  m and a height of  $L_p = 2$  m, extending from stove to ceiling. The stove is in a large room whose air and walls are at  $T_\infty = T_{sur} = 300$  K. Neglecting heat transfer from the small horizontal section of the pipe and radiation exchange between the pipe and stove, estimate the rate at which heat is transferred from the stove and pipe to the surroundings.

- 9.52** A plate 1 m by 1 m, inclined at an angle of  $45^\circ$ , is exposed to a net radiation heat flux of  $300$  W/m<sup>2</sup> at its bottom surface. If the top surface of the plate is well insulated, estimate the temperature the plate reaches when the ambient air is quiescent and at a temperature of  $0^\circ\text{C}$ .

### Horizontal Cylinders and Spheres

- 9.53** A horizontal rod 5 mm in diameter is immersed in water maintained at  $18^\circ\text{C}$ . If the rod surface temperature is  $56^\circ\text{C}$ , estimate the free convection heat transfer rate per unit length of the rod.

- 9.54** A horizontal uninsulated steam pipe passes through a large room whose walls and ambient air are at  $300$  K. The pipe of 150-mm diameter has an emissivity of 0.85 and an outer surface temperature of  $400$  K. Calculate the heat loss per unit length from the pipe.

- 9.55** Examine the conditions of Example 9.4, including the effect of adding insulation of thickness  $t$ , thermal conductivity  $k = 0.026$  W/m · K, and emissivity  $\varepsilon = 0.85$ . Compute and plot the surface temperature  $T_{s,2}$  and the heat loss  $q'$  as a function of insulation thickness for  $0 \leq t \leq 50$  mm. In addition to adding insulation, the heat loss may be reduced by decreasing the surface emissivity of the insulation. For  $t = 25$  mm compute and plot  $T_{s,2}$  and  $q'$  as a function of the emissivity for  $0.1 \leq \varepsilon \leq 1.0$ .

- 9.56** Beverage in cans 150 mm long and 60 mm in diameter is initially at  $27^\circ\text{C}$  and is to be cooled by placement in a refrigerator compartment at  $4^\circ\text{C}$ . In the interest of maximizing the cooling rate, should the cans be laid horizontally or vertically in the compartment? As a first approximation, neglect heat transfer from the ends.

- 9.57** Consider Problem 8.47. A more realistic solution would account for the resistance to heat transfer due to free convection in the paraffin during melting. Assuming the tube surface to have a uniform temperature of  $55^\circ\text{C}$  and the paraffin to be an infinite, quiescent liquid, determine the convection coefficient associated with the outer surface. Using this result and recognizing that the tube surface temperature is not known, determine the water outlet temperature, the total heat transfer rate, and the

time required to completely liquefy the paraffin, for the prescribed conditions. Thermophysical properties associated with the liquid state of the paraffin are  $k = 0.15 \text{ W/m} \cdot \text{K}$ ,  $\beta = 8 \times 10^{-4} \text{ K}^{-1}$ ,  $\rho = 770 \text{ kg/m}^3$ ,  $\nu = 5 \times 10^{-6} \text{ m}^2/\text{s}$ , and  $\alpha = 8.85 \times 10^{-8} \text{ m}^2/\text{s}$ .

- 9.58** A long, uninsulated steam line with a diameter of 89 mm and a surface emissivity of 0.8 transports steam at  $200^\circ\text{C}$  and is exposed to atmospheric air and large surroundings at an equivalent temperature of  $20^\circ\text{C}$ .

- Calculate the heat loss per unit length for a calm day.
- Calculate the heat loss on a breezy day when the wind speed is 8 m/s.
- For the conditions of part (a), calculate the heat loss with a 20-mm-thick layer of insulation ( $k = 0.08 \text{ W/m} \cdot \text{K}$ ). Would the heat loss change significantly with an appreciable wind speed?

- 9.59** A horizontal tube of 12.5-mm diameter with an outer surface temperature of  $240^\circ\text{C}$  is located in a room with an air temperature of  $20^\circ\text{C}$ . Estimate the heat transfer rate per unit length of the tube due to free convection.


- 9.60** Saturated steam at 4 bars absolute pressure with a mean velocity of 3 m/s flows through a horizontal pipe whose inner and outer diameters are 55 and 65 mm, respectively. The heat transfer coefficient for the steam flow is known to be  $11,000 \text{ W/m}^2 \cdot \text{K}$ .

- If the pipe is covered with a 25-mm-thick layer of 85% magnesia insulation and is exposed to atmospheric air at  $25^\circ\text{C}$ , determine the rate of heat transfer by free convection to the room per unit length of the pipe. If the steam is saturated at the inlet of the pipe, estimate its quality at the outlet of a pipe 30 m long.
- Net radiation to the surroundings also contributes to heat loss from the pipe. If the insulation has a surface emissivity of  $\varepsilon = 0.8$  and the surroundings are at  $T_{\text{sur}} = T_\infty = 25^\circ\text{C}$ , what is the rate of heat transfer to the room per unit length of pipe? What is the quality of the outlet flow?
- The heat loss may be reduced by increasing the insulation thickness and/or reducing its emissivity. What is the effect of increasing the insulation thickness to 50 mm if  $\varepsilon = 0.8$ ? Of decreasing the emissivity to 0.2 if the insulation thickness is 25 mm? Of reducing the emissivity to 0.2 and increasing the insulation thickness to 50 mm?

- 9.61** A horizontal electrical cable of 25-mm diameter has a heat dissipation rate of  $30 \text{ W/m}$ . If the ambient air temperature is  $27^\circ\text{C}$ , estimate the surface temperature of the cable.

- 9.62** An electric immersion heater, 10 mm in diameter and 300 mm long, is rated at 550 W. If the heater is horizontally positioned in a large tank of water at  $20^\circ\text{C}$ , estimate its surface temperature. Estimate the surface temperature if the heater is accidentally operated in air at  $20^\circ\text{C}$ .

- 9.63** The maximum surface temperature of the 20-mm-diameter shaft of a motor operating in ambient air at  $27^\circ\text{C}$  should not exceed  $87^\circ\text{C}$ . Because of power dissipation within the motor housing, it is desirable to reject as much heat as possible through the shaft to the ambient air. In this problem, we will investigate several methods for heat removal.

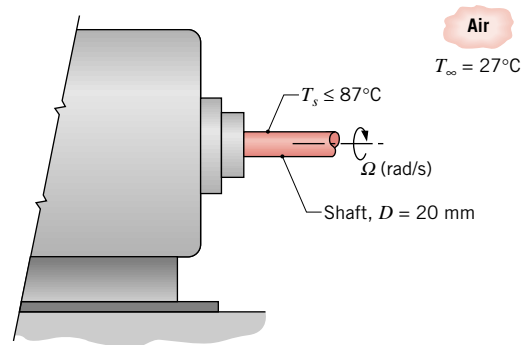

- For horizontal rotating cylinders, a suitable correlation for estimating the convection coefficient is of the form

$$\overline{Nu}_D = 0.133 Re_D^{2/3} Pr^{1/3} \quad (Re_D < 4.3 \times 10^5, \quad 0.7 < Pr < 670)$$

where  $Re_D \equiv \Omega D^2/\nu$  and  $\Omega$  is the rotational velocity (rad/s). Determine the convection coefficient and the maximum heat rate per unit length as a function of rotational speed in the range from 5000 to 15,000 rpm.

- Estimate the free convection coefficient and the maximum heat rate per unit length for the stationary shaft. Mixed free and forced convection effects may become significant for  $Re_D < 4.7(Gr_D^3/Pr)^{0.137}$ . Are free convection effects important for the range of rotational speeds designated in part (a)?
- Assuming the emissivity of the shaft is 0.8 and the surroundings are at the ambient air temperature, is radiation exchange important?
- If ambient air is in cross flow over the shaft, what air velocities are required to remove the heat rates determined in part (a)?

- 9.64** Consider a horizontal pin fin of 6-mm diameter and 60-mm length fabricated from plain carbon steel ( $k = 57$



$\text{W/m} \cdot \text{K}$ ,  $\varepsilon = 0.5$ ). The base of the fin is maintained at  $150^\circ\text{C}$ , while the quiescent ambient air and the surroundings are at  $25^\circ\text{C}$ . Assume the fin tip is adiabatic.

(a) Estimate the fin heat rate,  $q_f$ . Use an average fin surface temperature of  $125^\circ\text{C}$  in estimating the free convection coefficient and the linearized radiation coefficient. How sensitive is this estimate to your choice of the average fin surface temperature?

(b) Use the finite-difference method of solution to obtain  $q_f$  when the convection and radiation coefficients are based on local, rather than average, temperatures for the fin. How does your result compare with the analytical solution of part (a)?


**9.65** Consider the hot water pipe of Problem 7.56, but under conditions for which the ambient air is not in cross flow over the pipe and is, instead, quiescent. Accounting for the effect of radiation with a pipe emissivity of  $\varepsilon_p = 0.6$ , what is the corresponding daily cost of heat loss per unit length of the uninsulated pipe?

**9.66** Common practice in chemical processing plants is to clad pipe insulation with a durable, thick aluminum foil. The functions of the foil are to confine the batt insulation and to reduce heat transfer by radiation to the surroundings. Because of the presence of chlorine (at chlorine or seaside plants), the aluminum foil surface, which is initially bright, becomes etched with in-service time. Typically, the emissivity might change from 0.12 at installation to 0.36 with extended service. For a 300-mm-diameter foil-covered pipe whose surface temperature is  $90^\circ\text{C}$ , will this increase in emissivity due to degradation of the foil finish have a significant effect on heat loss from the pipe? Consider two cases with surroundings and ambient air at  $25^\circ\text{C}$ : (a) quiescent air and (b) a cross-wind velocity of 10 m/s.

**9.67** Consider the electrical heater of Problem 7.43. If the blower were to malfunction, terminating airflow while the heater continued to operate at  $1000 \text{ W/m}^2$ , what temperature would the heater assume? How long would it take to come within  $10^\circ\text{C}$  of this temperature? Allow for radiation exchange between the heater ( $\varepsilon = 0.8$ ) and the duct walls, which are also at  $27^\circ\text{C}$ .

**9.68** A computer code is being developed to analyze a 12.5-mm-diameter, cylindrical sensor used to determine ambient air temperature. The sensor experiences free convection while positioned horizontally in quiescent air at  $T_\infty = 27^\circ\text{C}$ . For the temperature range from  $30$  to  $80^\circ\text{C}$ , derive an expression for the convection coefficient as a function of only  $\Delta T = T_s - T_\infty$ , where  $T_s$  is the sensor temperature. Evaluate properties at an appropriate film temperature and show what effect this approximation has on the convection coefficient estimate.

**9.69** A thin-walled tube of 20-mm diameter passes hot fluid at a mean temperature of  $45^\circ\text{C}$  in an experimental flow loop. The tube is mounted horizontally in quiescent air at a temperature of  $15^\circ\text{C}$ . To satisfy the stringent temperature control requirements of the experiment, it was decided to wind thin electrical heating tape on the outer surface of the tube to prevent heat loss from the hot fluid to the ambient air.

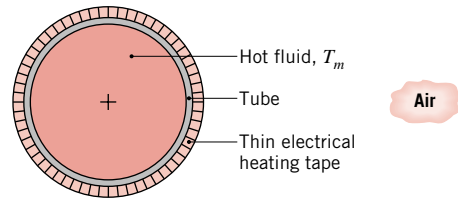

(a) Neglecting radiation heat loss, calculate the heat flux  $q_e''$  that must be supplied by the electrical tape to ensure a uniform fluid temperature.

(b) Assuming the emissivity of the tape is 0.95 and the surroundings are also at  $15^\circ\text{C}$ , calculate the required heat flux.

(c) The heat loss may be reduced by wrapping the heating tape in a layer of insulation. For 85% magnesia insulation ( $k = 0.050 \text{ W/m} \cdot \text{K}$ ) having a surface emissivity of  $\varepsilon = 0.60$ , compute and plot the required heat flux  $q_e''$  as a function of insulation thickness in the range from 0 to 20 mm. For this range, compute and plot the convection and radiation heat rates per unit tube length as a function of insulation thickness.

**9.70** A billet of stainless steel, AISI 316, with a diameter of 150 mm and a length of 500 mm emerges from a heat treatment process at  $200^\circ\text{C}$  and is placed in an unstirred oil bath maintained at  $20^\circ\text{C}$ .



(a) Determine whether it is advisable to position the billet in the bath with its centerline horizontal or vertical in order to decrease the cooling time.

(b) Estimate the time for the billet to cool to  $30^\circ\text{C}$  for the preferred arrangement.

**9.71** Long stainless steel rods of 50-mm diameter are preheated to a uniform temperature of 1000 K before being suspended from an overhead conveyor for transport to a hot forming operation. The conveyor is in a large room whose walls and air are at 300 K.

(a) Assuming the linear motion of the rod to have a negligible effect on convection heat transfer from its surface, determine the average convection coefficient at the start of the transport process.

(b) If the surface emissivity of the rod is  $\varepsilon = 0.40$ , what is the effective radiation heat transfer coefficient at the start of the transport process?

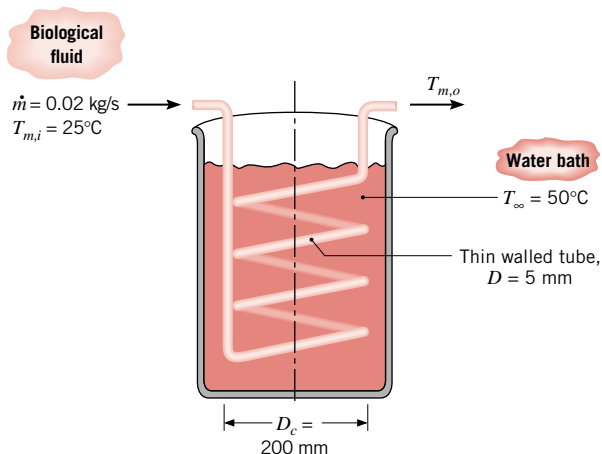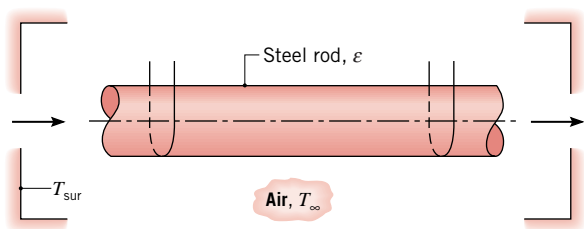

(c) Assuming a constant cumulative (radiation plus convection) heat transfer coefficient corresponding to the results of parts (a) and (b), what is the maximum allowable conveyor transit time, if the center-line temperature of the rod must exceed 900 K for the forming operation? Properties of the steel are  $k = 25 \text{ W/m} \cdot \text{K}$  and  $\alpha = 5.2 \times 10^{-6} \text{ m}^2/\text{s}$ .

(d) Heat transfer by convection and radiation are actually decreasing during the transfer operation. Accounting for this reduction, reconsider the conditions of part (c) and obtain a more accurate estimate of the maximum allowable conveyor transit time.

**9.72** Hot air flows from a furnace through a 0.15-m-diameter, thin-walled steel duct with a velocity of 3 m/s. The duct passes through the crawlspace of a house, and its uninsulated exterior surface is exposed to quiescent air and surroundings at 0°C.

(a) At a location in the duct for which the mean air temperature is 70°C, determine the heat loss per unit duct length and the duct wall temperature. The duct outer surface has an emissivity of 0.5.

(b) If the duct is wrapped with a 25-mm-thick layer of 85% magnesia insulation ( $k = 0.050 \text{ W/m} \cdot \text{K}$ ) having a surface emissivity of  $\varepsilon = 0.60$ , what are the duct wall temperature, the outer surface temperature, and the heat loss per unit length?


**9.73** A biological fluid moves at a flow rate of  $\dot{m} = 0.02 \text{ kg/s}$  through a coiled, thin-walled, 5-mm-diameter tube submerged in a large water bath maintained at 50°C. The fluid enters the tube at 25°C.

(a) Estimate the length of the tube and the number of coil turns required to provide an exit temperature of  $T_{m,o} = 38^\circ\text{C}$  for the biological fluid. Assume that the water bath is an extensive, quiescent medium, that the coiled tube approximates a horizontal tube, and that the biological fluid has the thermophysical properties of water.

(b) The flow rate through the tube is controlled by a pump that experiences throughput variations of approximately  $\pm 10\%$  at any one setting. This condition is of concern to the project engineer because the

corresponding variation of the exit temperature of the biological fluid could influence the downstream process. What variation would you expect in  $T_{m,o}$  for a  $\pm 10\%$  change in  $\dot{m}$ ?

**9.74** Consider a batch process in which 200 liters of a pharmaceutical are heated from 25°C to 70°C by saturated steam condensing at 2.455 bars as it flows through a coiled tube of 15-mm diameter and 15-m length. At any time during the process, the liquid may be approximated as an infinite, quiescent medium of uniform temperature and may be assumed to have constant properties of  $\rho = 1100 \text{ kg/m}^3$ ,  $c = 2000 \text{ J/kg} \cdot \text{K}$ ,  $k = 0.25 \text{ W/m} \cdot \text{K}$ ,  $\nu = 4.0 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $Pr = 10$ , and  $\beta = 0.002 \text{ K}^{-1}$ . The thermal resistances of the condensing steam and tube wall may be neglected.

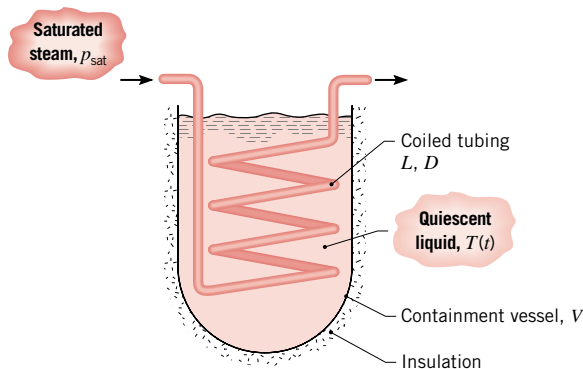

(a) What is the initial rate of heat transfer to the pharmaceutical?


(b) Neglecting heat transfer between the tank and its surroundings, how long does it take to heat the pharmaceutical to 70°C? Plot the corresponding variation with time of the fluid temperature and the

convection coefficient at the outer surface of the tube. How much steam is condensed during the heating process?

- 9.75** In the analytical treatment of the fin with uniform cross-sectional area, it was assumed that the convection heat transfer coefficient is constant along the length of the fin. Consider an AISI 316 steel fin of 6-mm diameter and 50-mm length (with insulated tip) operating under conditions for which  $T_b = 125^\circ\text{C}$ ,  $T_\infty = 27^\circ\text{C}$ ,  $T_{\text{sur}} = 27^\circ\text{C}$ , and  $\varepsilon = 0.6$ .

- Estimate average values of the fin heat transfer coefficients for free convection ( $h_c$ ) and radiation exchange ( $h_r$ ). Use these values to predict the tip temperature and fin effectiveness.
- Use a numerical method of solution to estimate the foregoing parameters when the convection and radiation coefficients are based on local, rather than average, values for the fin.

- 9.76** A hot fluid at  $35^\circ\text{C}$  is to be transported through a tube horizontally positioned in quiescent air at  $25^\circ\text{C}$ . Which of the tube shapes, each of equal cross-sectional area, would you use in order to minimize heat losses to the ambient air by free convection?

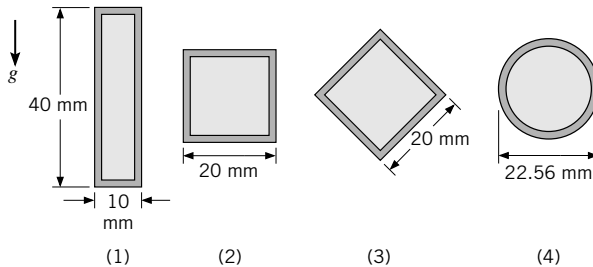

Use the following correlation of Lienhard (*Int. J. Heat Mass Transfer*, **16**, 2121, 1973) to approximate the laminar convection coefficient for an immersed body on which the boundary layer does not separate from the surface,

$$\overline{Nu}_l = 0.52 Ra_l^{1/4}$$

The characteristic length  $l$  is the length of travel of the fluid in the boundary layer across the shape surface. Compare this correlation to that given for a sphere to test its utility.

- 9.77** Consider a 2-mm-diameter sphere immersed in a fluid at 300 K and 1 atm.
- If the fluid around the sphere is quiescent and extensive, show that the conduction limit of heat transfer from the sphere can be expressed as  $Nu_{D,\text{cond}} = 2$ . *Hint:* Begin with the expression for the thermal resistance of a hollow sphere, Equation 3.36, letting

$r_2 \rightarrow \infty$ , and then expressing the result in terms of the Nusselt number.


- Considering free convection, at what surface temperature will the Nusselt number be twice that for the conduction limit? Consider air and water as the fluids.
  - Considering forced convection, at what velocity will the Nusselt number be twice that for the conduction limit? Consider air and water as the fluids.
- 9.78** A sphere of 25-mm diameter contains an embedded electrical heater. Calculate the power required to maintain the surface temperature at  $94^\circ\text{C}$  when the sphere is exposed to a quiescent medium at  $20^\circ\text{C}$  for: (a) air at atmospheric pressure, (b) water, and (c) ethylene glycol.
- 9.79** Under steady-state operation the surface temperature of a small 20-W incandescent light bulb is  $125^\circ\text{C}$  when the temperature of the room air and walls is  $25^\circ\text{C}$ . Approximating the bulb as a sphere 40 mm in diameter with a surface emissivity of 0.8, what is the rate of heat transfer from the surface of the bulb to the surroundings?
- 9.80** A 25-mm-diameter copper sphere with a low emissivity coating is removed from an oven at a uniform temperature of  $85^\circ\text{C}$  and allowed to cool in a quiescent fluid maintained at  $25^\circ\text{C}$ .

- Calculate convection coefficients associated with the initial condition for immersion in air and water.
- Using two different approaches, estimate the time for the sphere to reach  $30^\circ\text{C}$  when immersed in air and water. In the simpler, but more approximate, approach, use an average convection coefficient based on the average temperature of the sphere during the cooling process. In the more accurate method, treat the convection coefficient as a variable and numerically integrate the energy balance equation.

## Parallel Plate Channels

- 9.81** Consider two long vertical plates maintained at uniform temperatures  $T_{s,1} > T_{s,2}$ . The plates are open at their ends and are separated by the distance  $2L$ .
- Sketch the velocity distribution in the space between the plates.
  - Write appropriate forms of the continuity, momentum, and energy equations for laminar flow between the plates.
  - Evaluate the temperature distribution, and express your result in terms of the mean temperature,  $T_m = (T_{s,1} + T_{s,2})/2$ .




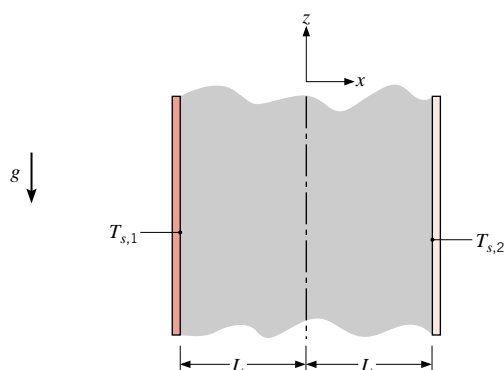

- (d) Estimate the vertical pressure gradient by assuming the density to be a constant  $\rho_m$  corresponding to  $T_m$ . Substituting from the Boussinesq approximation, obtain the resulting form of the momentum equation.
- (e) Determine the velocity distribution.

**9.82** Consider the conditions of Problem 9.9, but now view the problem as one involving free convection between vertical, parallel plate channels. What is the optimum fin spacing  $S$ ? For this spacing and the prescribed values of  $t$  and  $W$ , what is the rate of heat transfer from the fins?

**9.83** A vertical array of circuit boards is immersed in quiescent ambient air at  $T_\infty = 17^\circ\text{C}$ . Although the components protrude from their substrates, it is reasonable, as a first approximation, to assume *flat* plates with uniform surface heat flux  $q_s''$ . Consider boards of length and width  $L = W = 0.4$  m and spacing  $S = 25$  mm. If the maximum allowable board temperature is  $77^\circ\text{C}$ , what is the maximum allowable power dissipation per board?

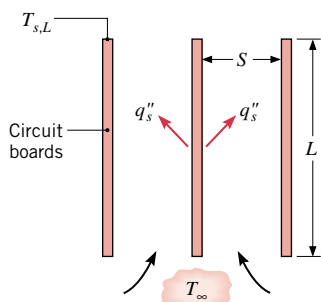


**9.84** Determined to reduce the \$3 per week cost associated with heat loss through their patio window by convection and radiation, the tenants of Problem 9.18 cover the inside of the window with a 50-mm-thick sheet of extruded insulation. Because they are not very handy around the house, the insulation is installed poorly, resulting in a  $S = 5$  mm gap between the extruded insulation and the window pane, allowing the room

air to infiltrate into the space between the pane and the insulation.


- (a) Determine the window heat loss and associated weekly cost with the ill-fitting insulation in place. The insulation will significantly reduce the radiation losses through the window. Losses will be due almost entirely to convection.
- (b) Plot the heat loss through the patio window as a function of the gap spacing for  $1 \text{ mm} \leq S \leq 20 \text{ mm}$ .

**9.85** The front door of a dishwasher has a vertical air vent that is 500 mm in height with a 20-mm spacing between the inner tub operating at  $52^\circ\text{C}$  and an outer plate that is thermally insulated.

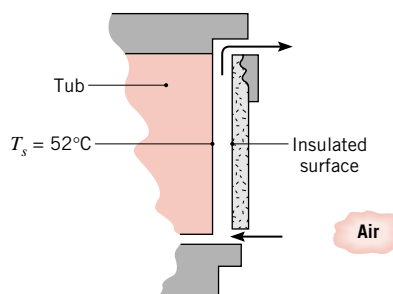

- (a) Determine the heat loss from the tub surface when the ambient air is  $27^\circ\text{C}$ .
- (b) A change in the design of the door provides the opportunity to increase or decrease the 20-mm spacing by 10 mm. What recommendations would you offer with regard to how the change in spacing will alter heat losses?


**9.86** A natural convection air heater consists of an array of parallel, equally spaced vertical plates, which may be

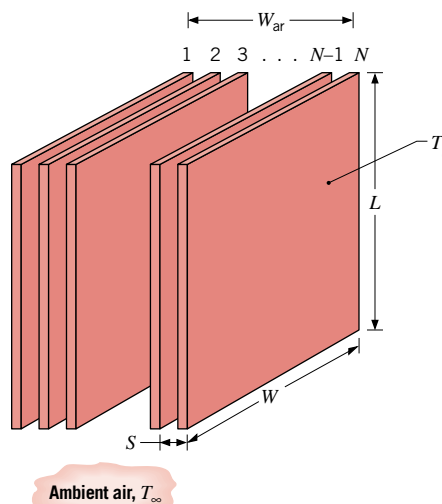

maintained at a fixed temperature  $T_s$  by embedded electrical heaters. The plates are of length and width  $L = W = 300$  mm and are in quiescent, atmospheric air at  $T_\infty = 20^\circ\text{C}$ . The total width of the array cannot exceed a value of  $W_{\text{ar}} = 150$  mm.

For  $T_s = 75^\circ\text{C}$ , what is the plate spacing  $S$  that maximizes heat transfer from the array? For this spacing, how many plates comprise the array and what is the corresponding rate of heat transfer from the array?

- 9.87** A bank of drying ovens is mounted on a rack in a room with an ambient air temperature of  $27^\circ\text{C}$ . The cubical ovens are 500 mm to a side, and the spacing between the ovens is 15 mm.

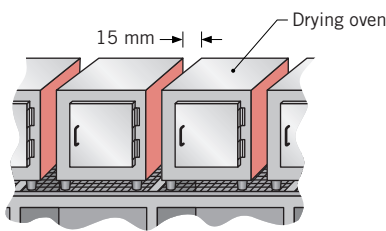

- (a) Estimate the heat loss from a facing side of an oven when its surface temperature is  $47^\circ\text{C}$ .

- (b) Explore the effect of the spacing on the heat loss. At what spacing is the heat loss a maximum? Describe the boundary layer behavior for this condition. Can this condition be analyzed by treating the side of an oven as an isolated vertical plate?

- 9.88** A solar collector consists of a parallel plate channel that is connected to a water storage plenum at the bottom and to a heat sink at the top. The channel is inclined  $\theta = 30^\circ$  from the vertical and has a transparent cover plate. Solar radiation transmitted through the cover plate and the water maintains the isothermal absorber

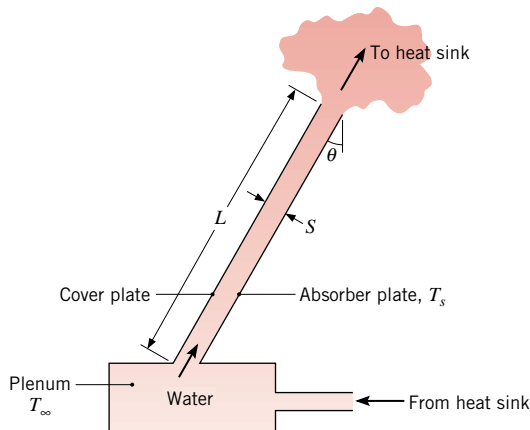


plate at a temperature  $T_s = 67^\circ\text{C}$ , while water returned to the reservoir from the heat sink is at  $T_\infty = 27^\circ\text{C}$ . The system operates as a *thermosyphon*, for which water flow is driven exclusively by buoyancy forces. The plate spacing and length are  $S = 15$  mm and  $L = 1.5$  m.

Assuming the cover plate to be adiabatic with respect to convection heat transfer to or from the water, estimate the rate of heat transfer per unit width normal to the flow direction (W/m) from the absorber plate to the water.

## Rectangular Cavities

- 9.89** As is evident from the property data of Tables A.3 and A.4, the thermal conductivity of glass at room temperature is more than 50 times larger than that of air. It is therefore desirable to use windows of double-pane construction, for which the two panes of glass enclose an air space. If heat transfer across the air space is by conduction, the corresponding thermal resistance may be increased by increasing the thickness  $L$  of the space. However, there are limits to the efficacy of such a measure, since convection currents are induced if  $L$  exceeds a critical value, beyond which the thermal resistance decreases.

Consider atmospheric air enclosed by vertical panes at temperatures of  $T_1 = 22^\circ\text{C}$  and  $T_2 = -20^\circ\text{C}$ . If the critical Rayleigh number for the onset of convection is  $Ra_L \approx 2000$ , what is the maximum allowable spacing for conduction across the air? How is this spacing affected by the temperatures of the panes? How is it affected by the pressure of the air, as, for example, by partial evacuation of the space?

- 9.90** A building window pane that is 1.2 m high and 0.8 m wide is separated from the ambient air by a storm window of the same height and width. The air space between the two windows is 0.06 m thick. If the building and storm windows are at 20 and  $-10^\circ\text{C}$ , respectively, what is the rate of heat loss by free convection across the air space?

- 9.91** The absorber plate and the adjoining cover plate of a flat-plate solar collector are at 70 and  $35^\circ\text{C}$ , respectively, and are separated by an air space of 0.05 m. What is the rate of free convection heat transfer per unit surface area between the two plates if they are inclined at an angle of  $60^\circ$  from the horizontal?

- 9.92** Consider a thermal storage system in which the phase change material (paraffin) is housed in a large container whose bottom, horizontal surface is maintained at  $T_s = 50^\circ\text{C}$  by warm water delivered from a solar collector.


- (a) Neglecting the change in sensible energy of the liquid phase, estimate the amount of paraffin that is melted over a five-hour period beginning with an

initial liquid layer at the bottom of the container of thickness  $s_i = 10$  mm. The paraffin of Problems 8.47 and 9.57 is used as the phase change material and is initially at the phase change temperature,  $T_{mp} = 27.4^\circ\text{C}$ . The bottom surface area of the container is  $A = 2.5$  m<sup>2</sup>.

- Compare the amount of energy needed to melt the paraffin to the amount of energy required to increase the temperature of the same amount of liquid from the phase change temperature to the average liquid temperature,  $(T_s + T_{mp})/2$ .
- Neglecting the change in sensible energy of the liquid phase, estimate the amount of paraffin that would melt over a five-hour time period if the hot plate is placed at the top of the container and  $s_i = 10$  mm.

**9.93** A rectangular cavity consists of two parallel, 0.5-m-square plates separated by a distance of 50 mm, with the lateral boundaries insulated. The heated plate is maintained at 325 K and the cooled plate at 275 K. Estimate the heat flux between the surfaces for three orientations of the cavity using the notation of Figure 9.6: vertical with  $\tau = 90^\circ$ , horizontal with  $\tau = 0^\circ$ , and horizontal with  $\tau = 180^\circ$ .


**9.94** Consider a horizontal flat roof section having the same dimensions as a vertical wall section. For both sections, the surfaces exposed to the air gap are at  $18^\circ\text{C}$  (inside) and  $-10^\circ\text{C}$  (outside).

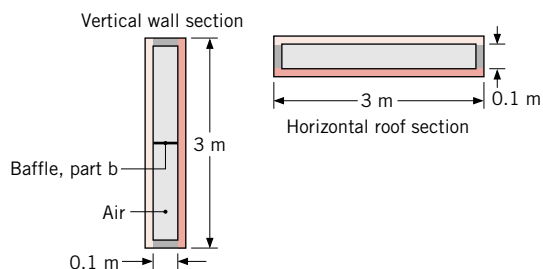

- Estimate the ratio of the convection heat rate for the horizontal section to that of the vertical section.
- What effect will inserting a baffle at the mid-height of the vertical section have on the convection heat rate for that section?

**9.95** A 50-mm-thick air gap separates two horizontal metal plates that form the top surface of an industrial furnace. The bottom plate is at  $T_h = 200^\circ\text{C}$  and the top plate is at  $T_c = 50^\circ\text{C}$ . The plant operator wishes to provide insulation between the plates to minimize heat loss. The relatively hot temperatures preclude use of foamed or felt insulation materials. Evacuated insulation materials cannot be used due to the harsh industrial environment and


their expense. A young engineer suggests that equally spaced, extremely thin horizontal sheets of aluminum foil may be inserted in the gap to eliminate natural convection and minimize heat loss through the air gap.

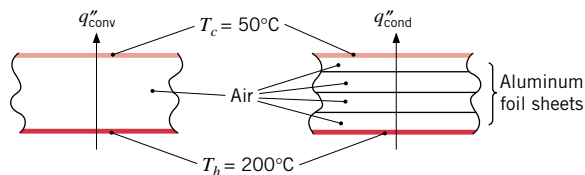

- Determine the convective heat flux across the gap when no insulation is in place.
- Determine the minimum number of foil sheets that must be inserted in the gap to eliminate free convection.
- Determine the conduction heat flux across the air gap with the foil sheets in place.

**9.96** The space between the panes of a double-glazed window can be filled with either air or carbon dioxide at atmospheric pressure. The window is 1.5 m high and the spacing between the panes can be varied. Develop an analysis to predict the convection heat transfer rate across the window as a function of pane spacing and determine, under otherwise identical conditions, whether air or carbon dioxide will yield the smaller rate. Illustrate the results of your analysis for two conditions: winter ( $-10^\circ\text{C}$ ,  $20^\circ\text{C}$ ) and summer ( $35^\circ\text{C}$ ,  $25^\circ\text{C}$ ).


**9.97** A vertical, double-pane window, which is 1 m on a side and has a 25-mm gap filled with atmospheric air, separates quiescent room air at  $T_{\infty,i} = 20^\circ\text{C}$  from quiescent ambient air at  $T_{\infty,o} = -20^\circ\text{C}$ . Radiation exchange between the window panes, as well as between each pane and its surroundings, may be neglected.

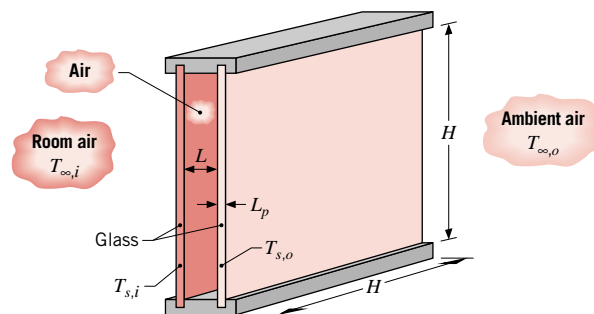

- Neglecting the thermal resistance associated with conduction heat transfer across each pane, determine the corresponding temperature of each pane and the rate of heat transfer through the window.


- (b) Comment on the validity of neglecting the conduction resistance of the panes if each is of thickness  $L_p = 6$  mm.

**9.98** The top surface ( $0.5 \text{ m} \times 0.5 \text{ m}$ ) of an oven is  $60^\circ\text{C}$  for a particular operating condition when the room air is  $23^\circ\text{C}$ . To reduce heat loss from the oven and to minimize burn hazard, it is proposed to create a 50-mm air space by adding a cover plate.

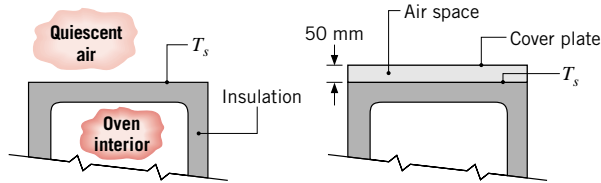


- (a) Assuming the same oven surface temperature  $T_s$  for both situations, estimate the reduction in the convection heat loss resulting from installation of the cover plate. What is the temperature of the cover plate?
- (b) Explore the effect of the cover plate spacing on the convection heat loss and the cover plate temperature for spacings in the range  $5 \leq L \leq 50$  mm. Is there an optimum spacing?

**9.99** Consider window blinds that are installed in the air space between the two panes of a vertical double-pane window. The window is  $H = 0.5$  m high and  $w = 0.5$  m wide, and includes  $N = 19$  individual blinds that are each  $L = 25$  mm wide. When the blinds are open, 20 smaller, square enclosures are formed along the height of the window. In the closed position, the blinds form a nearly continuous sheet with two  $t = 12.5$  mm open gaps at the top and bottom of the enclosure. Determine the convection heat transfer rate between the inner pane, which is held at  $T_{s,i} = 20^\circ\text{C}$ , and the outer pane, which is at  $T_{s,o} = -20^\circ\text{C}$ , when the blinds are in the open and closed positions, respectively. Explain why the closed blinds have little effect on the convection heat transfer rate across the cavity.

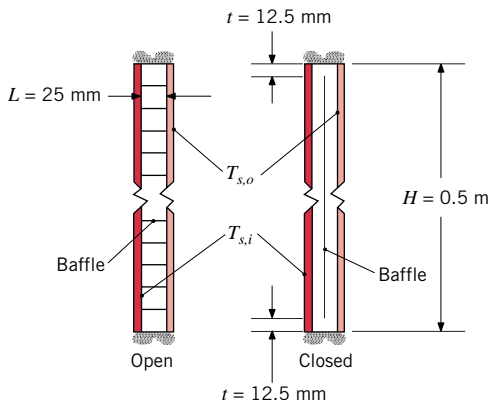

**9.100** A solar water heater consists of a flat-plate collector that is coupled to a storage tank. The collector consists of a transparent cover plate and an absorber plate that are separated by an air gap.

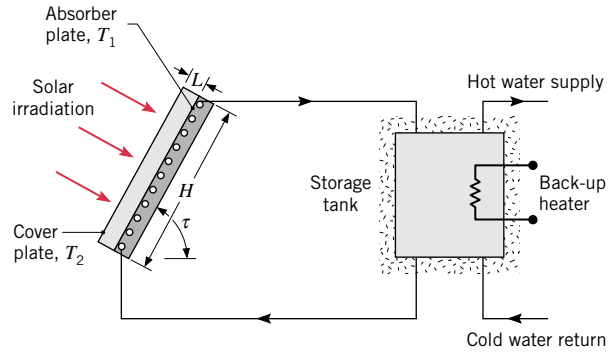

Although much of the solar energy collected by the absorber plate is transferred to a working fluid passing through a coiled tube brazed to the back of the absorber, some of the energy is lost by free convection and net radiation transfer across the air gap. In Chapter 13, we will evaluate the contribution of radiation exchange to this loss. For now, we restrict our attention to the free convection effect.

- (a) Consider a collector that is inclined at an angle of  $\tau = 60^\circ$  and has dimensions of  $H = w = 2$  m on a side, with an air gap of  $L = 30$  mm. If the absorber and cover plates are at  $T_1 = 70^\circ\text{C}$  and  $T_2 = 30^\circ\text{C}$ , respectively, what is the rate of heat transfer by free convection from the absorber plate?
- (b) The heat loss by free convection depends on the spacing between the plates. Compute and plot the heat loss as a function of spacing for  $5 \leq L \leq 50$  mm. Is there an optimum spacing?

## Concentric Cylinders and Spheres

**9.101** Consider the cylindrical, 0.12-m-diameter radiation shield of Example 9.5 that is installed concentric with a 0.10-m-diameter tube carrying steam. The spacing provides an air gap of  $L = 10$  mm.

- (a) Calculate the heat loss per unit length of the tube by convection when a second shield of 0.14-m diameter is installed, with the second shield maintained at  $35^\circ\text{C}$ . Compare the result to that for the single shield of the example.
- (b) In the two-shield configuration of part (a), the air gaps formed by the annular concentric tubes are  $L = 10$  mm. Calculate the heat loss per unit length if the gap dimension is  $L = 15$  mm. Do you expect the heat loss to increase or decrease?


**9.102** A solar collector design consists of an inner tube enclosed concentrically in an outer tube that is transparent to solar radiation. The tubes are thin walled with inner and outer diameters of 0.10 and 0.15 m, respectively. The annular space between the tubes is completely enclosed and filled with air at atmospheric pressure. Under operating conditions for which the inner and outer tube surface temperatures are 70 and 30°C, respectively, what is the convective heat loss per meter of tube length across the air space?

**9.103** It has been proposed to use large banks of rechargeable, lithium ion batteries to power hybrid electric vehicles. The cylindrical batteries, each of which is of radius  $r_i = 9$  mm and length  $L = 65$  mm, undergo exothermic electrochemical reactions while being discharged. Since excessively high temperatures damage the batteries, it is proposed to encase them in a phase change material that melts when the batteries discharge (and resolidifies when the batteries are charged; charging is associated with an endothermic electrochemical reaction). Consider the paraffin of Problems 8.47 and 9.57.

- At an instant in time during the discharge of a battery, liquid paraffin occupies an annular region of outer radius  $r_o = 19$  mm around the battery, which is generating  $\dot{E}_g = 1$  W of thermal energy. Determine the surface temperature of the battery.
- At the time of interest in part (a), what is the rate at which the liquid annulus radius is increasing?
- Graph the battery surface temperature versus the outer radius of the liquid-filled annulus. Explain the relative insensitivity of the battery surface temperature to the size of the annulus for 15 mm  $\leq r_o \leq 30$  mm.


**9.104** The surfaces of two long, horizontal, concentric thin-walled tubes having radii of 100 and 125 mm are maintained at 300 and 400 K, respectively. If the annular space is pressurized with nitrogen at 5 atm, estimate the convection heat transfer rate per unit length of the tubes.

**9.105** Liquid nitrogen is stored in a thin-walled spherical vessel of diameter  $D_i = 1$  m. The vessel is positioned concentrically within a larger, thin-walled spherical container of diameter  $D_o = 1.10$  m, and the intervening cavity is filled with atmospheric helium.

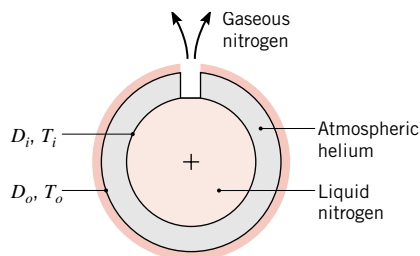

Under normal operating conditions, the inner and outer surface temperatures are  $T_i = 77$  K and  $T_o = 283$  K. If the latent heat of vaporization of nitrogen is  $2 \times 10^5$  J/kg, what is the mass rate  $\dot{m}$  (kg/s) at which gaseous nitrogen is vented from the system?

**9.106** The human eye contains aqueous humor, which separates the external cornea and the internal iris–lens structure. It is hypothesized that, in some individuals, small flakes of pigment are intermittently liberated from the iris and migrate to, and subsequently damage, the cornea. Approximating the geometry of the enclosure formed by the cornea and iris–lens structure as a pair of concentric hemispheres of outer radius  $r_o = 10$  mm and inner radius  $r_i = 7$  mm, respectively, investigate whether free convection can occur in the aqueous humor by evaluating the effective thermal conductivity ratio,  $k_{\text{eff}}/k$ . If free convection can occur, it is possible that the damaging particles are advected from the iris to the cornea. The iris–lens structure is at the core temperature,  $T_i = 37^\circ\text{C}$ , while the cornea temperature is measured to be  $T_o = 34^\circ\text{C}$ . The properties of the aqueous humor are  $\rho = 990$  kg/m<sup>3</sup>,  $k = 0.58$  W/m · K,  $c_p = 4.2 \times 10^3$  J/kg · K,  $\mu = 7.1 \times 10^{-4}$  N · s/m<sup>2</sup>, and  $\beta = 3.2 \times 10^{-4}$  K<sup>-1</sup>.

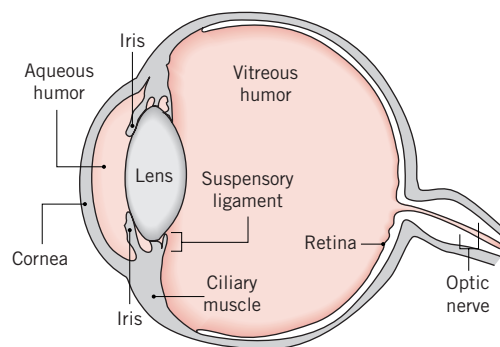


## Mixed Convection

**9.107** Water at 35°C with a velocity of 0.05 m/s flows over a horizontal, 50-mm-diameter cylinder maintained at a uniform surface temperature of 20°C. Do you anticipate that heat transfer by free convection will be significant? What would be the situation if the fluid were air at atmospheric pressure?

**9.108** According to experimental results for parallel airflow over a uniform temperature, heated vertical plate, the effect of free convection on the heat transfer convection coefficient will be 5% when  $Gr_L/Re_L^2 = 0.08$ . Consider a heated vertical plate 0.3 m long, maintained at a surface temperature of 60°C in atmospheric air at 25°C. What is the minimum vertical velocity


required of the airflow such that free convection effects will be less than 5% of the heat transfer rate?

- 9.109** A vertical array of circuit boards of 150-mm height is to be air cooled such that the board temperature does not exceed 60°C when the ambient temperature is 25°C.

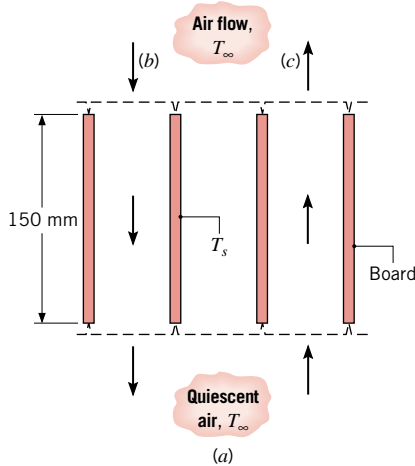

Assuming isothermal surface conditions, determine the allowable electrical power dissipation per board for the cooling arrangements:


- Free convection only (no forced airflow).
  - Airflow with a downward velocity of 0.6 m/s.
  - Airflow with an upward velocity of 0.3 m/s.
  - Airflow with a velocity (upward or downward) of 5 m/s.
- 9.110** A horizontal 100-mm-diameter pipe passing hot oil is to be used in the design of an industrial water heater. Based on a typical water draw rate, the velocity over the pipe is 0.5 m/s. The hot oil maintains the outer surface temperature at 85°C and the water temperature is 37°C.

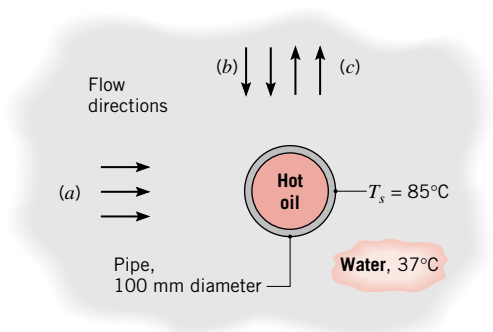

Investigate the effect of flow direction on the heat rate (W/m) for (a) horizontal, (b) downward, and (c) upward flow.

- 9.111** Determine the heat transfer rate from the steel plates of Problem 7.24 accounting for free convection from the plate surfaces. What is the corresponding rate of change of the plate temperature? Plot the heat transfer coefficient associated with free convection, forced convection, and mixed convection for air velocities ranging from  $2 \leq u_\infty \leq 10$  m/s. The velocity of the plate is small compared to the air velocity.

- 9.112** Square panels (250 mm  $\times$  250 mm) with a decorative, highly reflective plastic finish are cured in an oven at 125°C and cooled in quiescent air at 29°C. Quality considerations dictate that the panels remain horizontal and that the cooling rate be controlled. To increase productivity in the plant, it is proposed to replace the batch cooling method with a conveyor system having a velocity of 0.5 m/s.

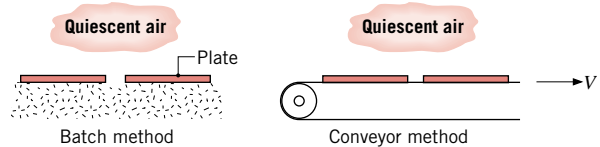

Compare the initial (immediately after leaving the oven) convection heat transfer rates for the two methods.


## Mass Transfer

- 9.113** A garment soaked with water is hung up to dry in a warm room at atmospheric pressure. The still air is dry and at a temperature of 40°C. The garment may be assumed to have a temperature of 25°C and a characteristic length of 1 m in the vertical direction. Estimate the drying rate per unit width of the garment.

- 9.114** A water bath is used to maintain canisters containing experimental biological reactions at a uniform temperature of 37°C. The top of the bath has a width and length of 0.25 m and 0.50 m, respectively, and is uncovered to allow easy access for removal or insertion of the canisters. The bath is located in a draft-free laboratory with air at atmospheric pressure, a temperature of 20°C, and a relative humidity of 60%. The walls of the laboratory are at a uniform temperature of 25°C.

- Estimate the heat loss from the surface of the bath by radiation exchange with the surroundings.
- Calculate the Grashof number using Equation 9.65, which can be applied to natural convection flows driven by temperature and concentration gradients. Use a characteristic length  $L$  that is appropriate for the exposed surface of the water bath.
- Estimate the free convection heat transfer coefficient using the result for  $Gr_L$  obtained in part (b).



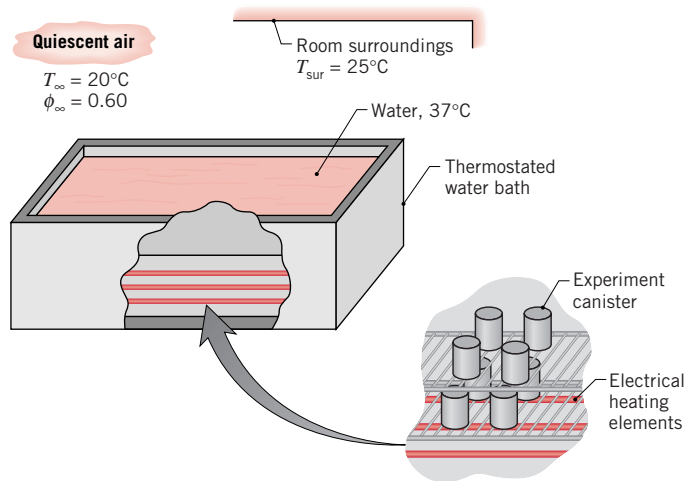

- (d) Invoke the heat and mass transfer analogy and use an appropriate correlation to estimate the mass transfer coefficient using  $Gr_L$ . Calculate the water evaporation rate on a daily basis and the heat loss by evaporation.
- (e) Calculate the total heat loss from the surface, and compare the relative contributions of the sensible, latent, and radiative effects. Review the assumptions made in your analysis, especially those relating to the heat and mass transfer analogy.


**9.115** On a very still morning, the surface temperature of a lake used to cool the condenser of a power plant is  $30^\circ\text{C}$  while the air temperature is  $23^\circ\text{C}$  with a relative humidity of 80%. Assume a surroundings temperature of 285 K. The lake is nominally circular in shape with

a diameter of approximately 4 km. Determine the heat loss from the surface of the lake by radiation, free convection, and evaporation. This heat loss determines the capacity of the lake to cool the condenser. Justify why the heat transfer correlation you select is useful, even though  $Ra_L$  is outside of its specified range. *Hint:* See Problem 9.114.

**9.116** Fuel cells similar to the PEM cell of Example 1.4 operate with a mixture of liquid water and methanol instead of hydrogen; the anode is placed in direct contact with the liquid fuel. Oxygen (species A) is delivered to the exposed cathode by free convection. Hence, no fans or pumps are needed to operate the device. The power output of *passive, direct methanol fuel cells* (DMFCs) can become *mass transfer limited*, since the electric current produced by the DMFC is related to the rate at which oxygen is consumed at the cathode by the expression  $I = 4n_A\mathcal{F}\mathcal{M}_A$ , where  $\mathcal{F}$  is Faraday's constant,  $\mathcal{F} = 96489$  coulombs/mol. Consider a passive DMFC with a  $120\text{ mm} \times 120\text{ mm}$  membrane. Determine the maximum possible electric current produced by the DMFC when the oxygen mass fraction at the cathode is  $m_{A,s} = 0.10$  for cases where the cathode is facing up or is vertical. As a first approximation and to illustrate the sensitivity of the device to its orientation relative to the vertical direction, assume buoyancy forces are dominated by the difference in density associated with the change in the oxygen mass fraction between the cathode surface and the quiescent environment, which is atmospheric air at  $T_\infty = 25^\circ\text{C}$ . Assume the quiescent air is composed of nitrogen and oxygen, with an oxygen mass fraction  $m_{A,\infty} = 0.233$ .

# *CHAPTER* **10**

## **Boiling and Condensation**

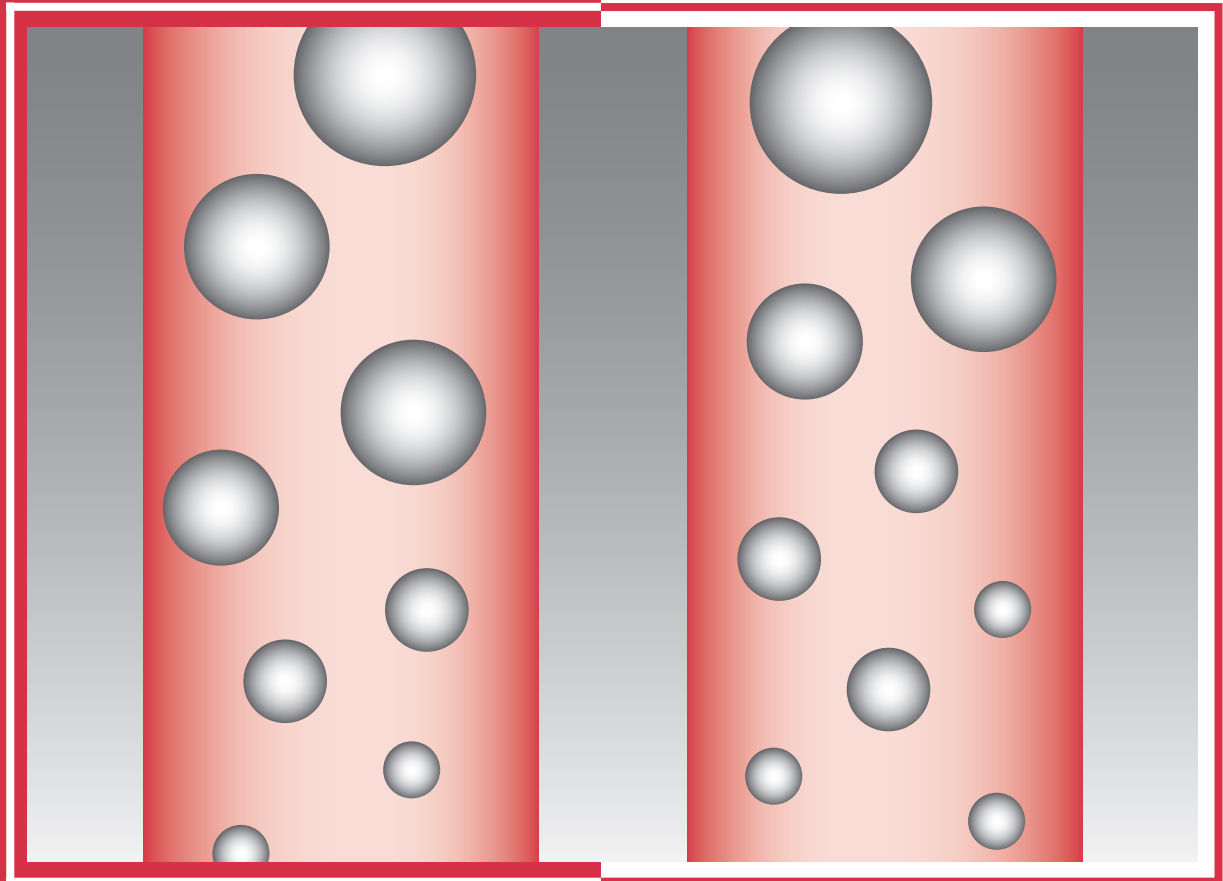



**I**n this chapter we focus on convection processes associated with the change in phase of a fluid. In particular, we consider processes that can occur at a solid–liquid or solid–vapor interface, namely, *boiling* and *condensation*. For these cases *latent* heat effects associated with the phase change are significant. The change from the liquid to the vapor state due to boiling is sustained by heat transfer from the solid surface; conversely, condensation of a vapor to the liquid state results in heat transfer to the solid surface.

Since they involve fluid motion, boiling and condensation are classified as forms of the convection mode of heat transfer. However, they are characterized by unique features. Because there is a phase change, heat transfer to or from the fluid can occur without influencing the fluid temperature. In fact, through boiling or condensation, large heat transfer rates may be achieved with small temperature differences. In addition to the *latent heat*  $h_{fg}$ , two other parameters are important in characterizing the processes, namely, the *surface tension*  $\sigma$  at the liquid–vapor interface and the *density difference* between the two phases. This difference induces a *buoyancy force*, which is proportional to  $g(\rho_l - \rho_v)$ . Because of combined latent heat and buoyancy-driven flow effects, boiling and condensation heat transfer coefficients and rates are generally much larger than those characteristic of convection heat transfer without phase change.

Many engineering applications that are characterized by high heat fluxes involve boiling and condensation. In a closed-loop power cycle, pressurized liquid is converted to vapor in a *boiler*. After expansion in a turbine, the vapor is restored to its liquid state in a *condenser*, whereupon it is pumped to the boiler to repeat the cycle. *Evaporators*, in which the boiling process occurs, and condensers are also essential components in vapor-compression refrigeration cycles. The high heat transfer coefficients associated with boiling make it attractive to consider for purposes of managing the thermal performance of advanced electronics equipment. The rational design of such components dictates that the associated phase change processes be well understood.

In this chapter our objectives are to develop an appreciation for the physical conditions associated with boiling and condensation and to provide a basis for performing related heat transfer calculations.

## 10.1

### ***Dimensionless Parameters in Boiling and Condensation***

---

In our treatment of boundary layer phenomena (Chapter 6), we nondimensionalized the governing equations to identify relevant dimensionless groups. This approach enhanced our understanding of related physical mechanisms and suggested simplified procedures for generalizing and representing heat transfer results.

Since it is difficult to develop governing equations for boiling and condensation processes, the appropriate dimensionless parameters can be obtained by using the Buckingham pi theorem [1]. For either process, the convection coefficient could depend on the difference between the surface and saturation temperatures,

$\Delta T = |T_s - T_{\text{sat}}|$ , the body force arising from the liquid–vapor density difference,  $g(\rho_l - \rho_v)$ , the latent heat  $h_{fg}$ , the surface tension  $\sigma$ , a characteristic length  $L$ , and the thermophysical properties of the liquid or vapor:  $\rho$ ,  $c_p$ ,  $k$ ,  $\mu$ . That is,

$$h = h[\Delta T, g(\rho_l - \rho_v), h_{fg}, \sigma, L, \rho, c_p, k, \mu] \quad (10.1)$$

Since there are 10 variables in 5 dimensions (m, kg, s, J, K), there are  $(10 - 5) = 5$  pi-groups, which can be expressed in the following forms:

$$\frac{hL}{k} = f\left[\frac{\rho g(\rho_l - \rho_v)L^3}{\mu^2}, \frac{c_p \Delta T}{h_{fg}}, \frac{\mu c_p}{k}, \frac{g(\rho_l - \rho_v)L^2}{\sigma}\right] \quad (10.2a)$$

or, defining the dimensionless groups,

$$Nu_L = f\left[\frac{\rho g(\rho_l - \rho_v)L^3}{\mu^2}, Ja, Pr, Bo\right] \quad (10.2b)$$

The Nusselt and Prandtl numbers are familiar from our earlier single-phase convection analyses. The new dimensionless parameters are the Jakob number  $Ja$ , the Bond number  $Bo$ , and a nameless parameter that bears a strong resemblance to the Grashof number (see Equation 9.12 and recall that  $\beta\Delta T \approx \Delta\rho/\rho$ ). This unnamed parameter represents the effect of buoyancy-induced fluid motion on heat transfer. The Jakob number is the ratio of the maximum sensible energy absorbed by the liquid (vapor) to the latent energy absorbed by the liquid (vapor) during condensation (boiling). In many applications, the sensible energy is much less than the latent energy and  $Ja$  has a small numerical value. The Bond number is the ratio of the buoyancy force to the surface tension force. In subsequent sections, we will delineate the role of these parameters in boiling and condensation.

## 10.2 Boiling Modes

When evaporation occurs at a solid–liquid interface, it is termed *boiling*. The process occurs when the temperature of the surface  $T_s$  exceeds the saturation temperature  $T_{\text{sat}}$  corresponding to the liquid pressure. Heat is transferred from the solid surface to the liquid, and the appropriate form of Newton's law of cooling is

$$q_s'' = h(T_s - T_{\text{sat}}) = h \Delta T_e \quad (10.3)$$

where  $\Delta T_e \equiv T_s - T_{\text{sat}}$  is termed the *excess temperature*. The process is characterized by the formation of vapor bubbles, which grow and subsequently detach from the surface. Vapor bubble growth and dynamics depend, in a complicated manner, on the excess temperature, the nature of the surface, and thermophysical properties of the fluid, such as its surface tension. In turn, the dynamics of vapor bubble formation affect liquid motion near the surface and therefore strongly influence the heat transfer coefficient.

Boiling may occur under various conditions. For example, in *pool boiling* the liquid is quiescent and its motion near the surface is due to free convection and to mixing induced by bubble growth and detachment. In contrast, for *forced convection boiling*, fluid motion is induced by external means, as well as by free convection and bubble-induced mixing. Boiling may also be classified according to whether it is *subcooled* or *saturated*. In subcooled boiling, the temperature of the liquid is below the saturation temperature and bubbles formed at the surface may condense in the liquid. In contrast, the temperature of the liquid slightly exceeds the saturation temperature in *saturated boiling*. Bubbles formed at the surface are then propelled through the liquid by buoyancy forces, eventually escaping from a free surface.


## 10.3

### Pool Boiling


*Saturated pool boiling*, as shown in Figure 10.1, has been studied extensively. Although there is a sharp increase in the liquid temperature close to the solid surface, the temperature through most of the liquid remains slightly above saturation. Bubbles generated at the liquid–solid interface therefore rise to and are transported across the liquid–vapor interface. An appreciation for the underlying physical mechanisms may be obtained by examining the *boiling curve*.

#### 10.3.1 The Boiling Curve

Nukiyama [2] was the first to identify different regimes of pool boiling using the apparatus of Figure 10.2. The heat flux from a horizontal *nichrome* wire to saturated water was determined by measuring the current flow  $I$  and potential drop  $E$ . The wire temperature was determined from knowledge of the manner in which its electrical resistance varied with temperature. This arrangement is termed *power-controlled* heating, wherein the wire temperature  $T_s$  (hence the excess temperature  $\Delta T_e$ ) is the dependent variable and the power setting (hence the heat flux  $q_s''$ ) is the independent variable. Following the arrows of the *heating curve* of Figure 10.3, it is evident that as power is applied, the heat flux increases, at first slowly and then very rapidly, with excess temperature.

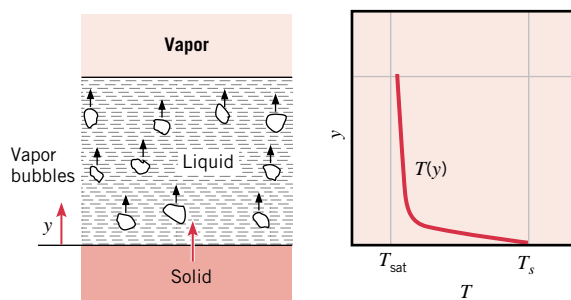


**FIGURE 10.1**  
Temperature distribution in saturated pool boiling with a liquid–vapor interface.

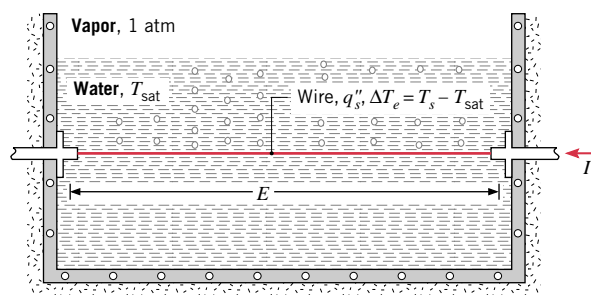

**FIGURE 10.2** Nukiyama's power-controlled heating apparatus for demonstrating the boiling curve.

Nukiyama observed that boiling, as evidenced by the presence of bubbles, did not begin until  $\Delta T_e \approx 5^\circ\text{C}$ . With further increase in power, the heat flux increased to very high levels until *suddenly*, for a value slightly larger than  $q''_{\max}$ , the wire temperature jumped to the melting point and burnout occurred. However, repeating the experiment with a *platinum* wire having a higher melting point (2045 K vs. 1500 K), Nukiyama was able to maintain heat fluxes above  $q''_{\max}$  without burnout. When he subsequently reduced the power, the variation of  $\Delta T_e$  with  $q''_s$  followed the *cooling curve* of Figure 10.3. When the heat flux reached the minimum point  $q''_{\min}$ , a further decrease in power caused the excess temperature to drop abruptly, and the process followed the original heating curve back to the saturation point.

Nukiyama believed that the hysteresis effect of Figure 10.3 was a consequence of the power-controlled method of heating, where  $\Delta T_e$  is a dependent variable. He also believed that by using a heating process permitting the independent control of  $\Delta T_e$ , the missing (dashed) portion of the curve could be obtained. His conjecture was subsequently confirmed by Drew and Mueller [3]. By condensing steam inside a tube at different pressures, they were able to control the value of  $\Delta T_e$  for boiling of

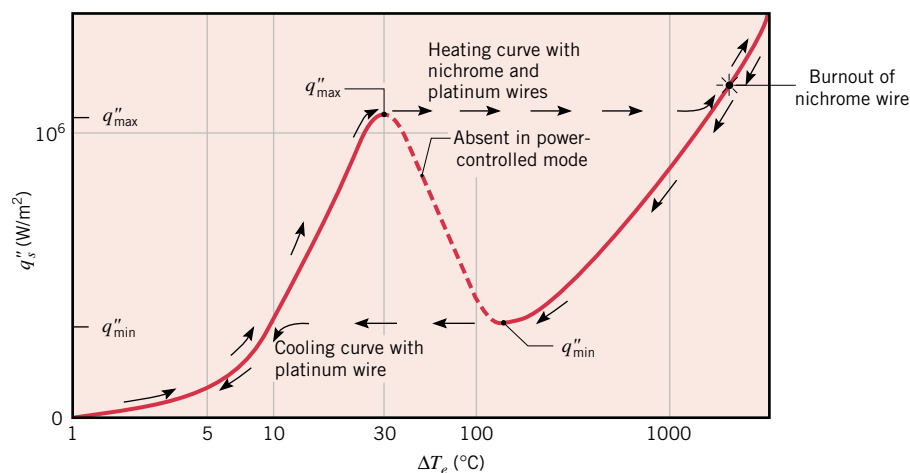


**FIGURE 10.3** Nukiyama's boiling curve for saturated water at atmospheric pressure.

a low boiling point organic fluid at the tube outer surface and thereby obtain the missing portion of the boiling curve.

### 10.3.2 Modes of Pool Boiling

An appreciation for the underlying physical mechanisms may be obtained by examining the different modes, or regimes, of pool boiling. These regimes are identified in the boiling curve of Figure 10.4. The specific curve pertains to water at 1 atm, although similar trends characterize the behavior of other fluids. From Equation 10.3 we note that  $q_s''$  depends on the convection coefficient  $h$ , as well as on the excess temperature  $\Delta T_e$ . Different boiling regimes may be delineated according to the value of  $\Delta T_e$ .

**Free Convection Boiling** Free convection boiling is said to exist if  $\Delta T_e \leq \Delta T_{e,A}$ , where  $\Delta T_{e,A} \approx 5^\circ\text{C}$ . The surface temperature must be somewhat above the saturation temperature in order to sustain bubble formation. As the excess temperature is increased, bubble inception will eventually occur, but below point A (referred to as

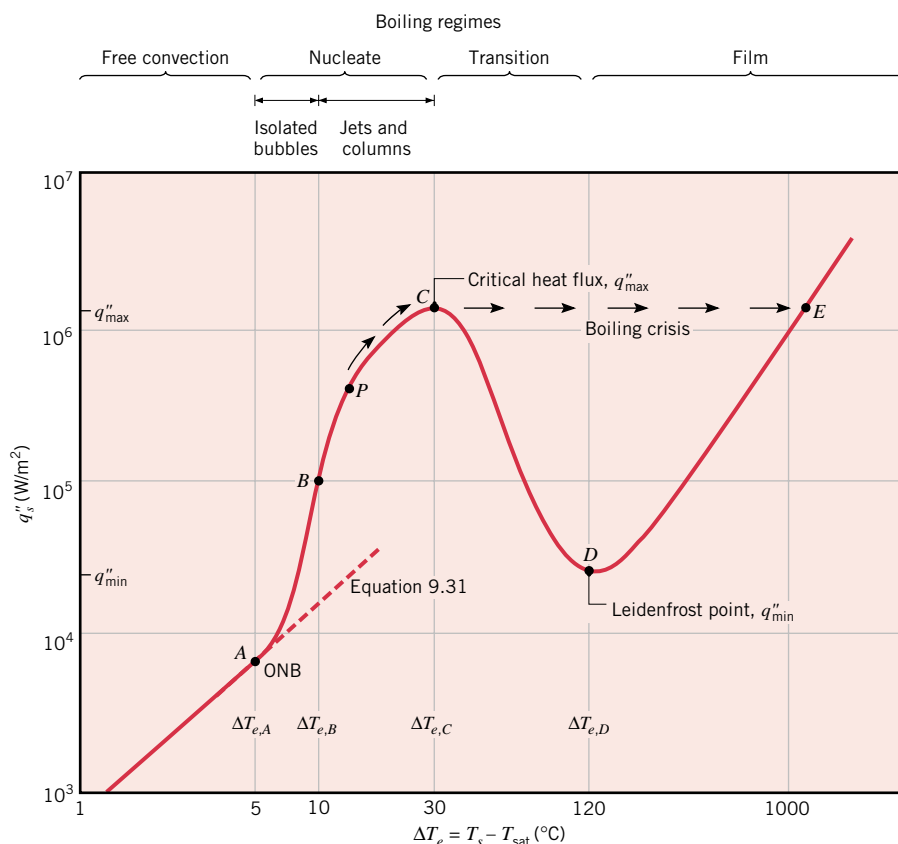

**FIGURE 10.4** Typical boiling curve for water at 1 atm: surface heat flux  $q_s''$  as a function of excess temperature,  $\Delta T_e \equiv T_s - T_{\text{sat}}$ .


the *onset of nucleate boiling*, ONB), fluid motion is determined principally by free convection effects. According to whether the flow is laminar or turbulent,  $h$  varies as  $\Delta T_e$  to the  $\frac{1}{4}$  or  $\frac{1}{3}$  power, respectively, in which case  $q_s''$  varies as  $\Delta T_e$  to the  $\frac{5}{4}$  or  $\frac{4}{3}$  power. For a large horizontal plate, the fluid flow is turbulent and Equation 9.31 can be used to predict the free convection portion of the boiling curve, as shown in Figure 10.4.

**Nucleate Boiling** Nucleate boiling exists in the range  $\Delta T_{e,A} \leq \Delta T_e \leq \Delta T_{e,C}$ , where  $\Delta T_{e,C} \approx 30^\circ\text{C}$ . In this range, two different flow regimes may be distinguished. In region A–B, *isolated bubbles* form at nucleation sites and separate from the surface, as illustrated in Figure 10.2. This separation induces considerable fluid mixing near the surface, substantially increasing  $h$  and  $q_s''$ . In this regime most of the heat exchange is through direct transfer from the surface to liquid in motion at the surface, and not through the vapor bubbles rising from the surface. As  $\Delta T_e$  is increased beyond  $\Delta T_{e,B}$ , more nucleation sites become active and increased bubble formation causes bubble interference and coalescence. In the region B–C, the vapor escapes as *jets* or *columns*, which subsequently merge into slugs of the vapor. This condition is illustrated in Figure 10.5a. Interference between the densely populated bubbles inhibits the motion of liquid near the surface. Point P of Figure 10.4 corresponds to an inflection in the boiling curve at which the heat transfer coefficient is a maximum. At this point  $h$  begins to decrease with increasing  $\Delta T_e$ , although  $q_s''$ , which is the product of  $h$  and  $\Delta T_e$ , continues to increase. This trend results because, for  $\Delta T_e > \Delta T_{e,P}$ , the relative increase in  $\Delta T_e$  exceeds the relative reduction in  $h$ . At point C, however, further increase in  $\Delta T_e$  is balanced by the reduction in  $h$ . The maximum heat flux,  $q_{s,C}'' = q_{\max}''$ , is usually termed the *critical heat flux*, and in water at atmospheric pressure it exceeds  $1 \text{ MW/m}^2$ . At the point of this maximum, considerable vapor is being formed, making it difficult for liquid to continuously wet the surface.

Because high heat transfer rates and convection coefficients are associated with small values of the excess temperature, it is desirable to operate many engineering devices in the nucleate boiling regime. The approximate magnitude of the convection coefficient may be inferred by using Equation 10.3 with the boiling curve of Figure 10.4. Dividing  $q_s''$  by  $\Delta T_e$ , it is evident that convection coefficients in excess of  $10^4 \text{ W/m}^2 \cdot \text{K}$  are characteristic of this regime. These values are considerably larger than those normally corresponding to convection with no phase change.

**Transition Boiling** The region corresponding to  $\Delta T_{e,C} \leq \Delta T_e \leq \Delta T_{e,D}$ , where  $\Delta T_{e,D} \approx 120^\circ\text{C}$ , is termed *transition boiling*, *unstable film boiling*, or *partial film boiling*. Bubble formation is now so rapid that a vapor film or blanket begins to form on the surface. At any point on the surface, conditions may oscillate between film and nucleate boiling, but the fraction of the total surface covered by the film increases with increasing  $\Delta T_e$ . Because the thermal conductivity of the vapor is much less than that of the liquid,  $h$  (and  $q_s''$ ) must decrease with increasing  $\Delta T_e$ .

**Film Boiling** Film boiling exists for  $\Delta T_e \geq \Delta T_{e,D}$ . At point D of the boiling curve, referred to as the *Leidenfrost point*, the heat flux is a minimum,  $q_{s,D}'' = q_{\min}''$ , and the surface is completely covered by a *vapor blanket*. Heat transfer from the surface to the liquid occurs by conduction and radiation through the vapor. It was Leidenfrost who in 1756 observed that water droplets supported by the vapor film

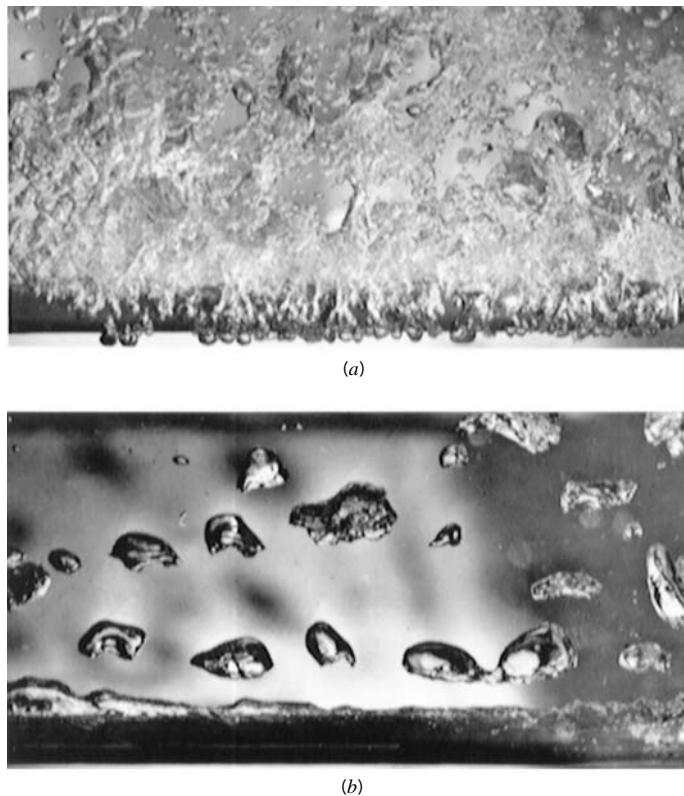

**FIGURE 10.5** Boiling of methanol on a horizontal tube. (a) Nucleate boiling in the jets and columns regime. (b) Film boiling. Photographs courtesy of Professor J. W. Westwater, University of Illinois at Champaign-Urbana.

slowly boil away as they move about a hot surface. As the surface temperature is increased, radiation through the vapor film becomes more significant and the heat flux increases with increasing  $\Delta T_e$ .

Figure 10.5 illustrates the nature of the vapor formation and bubble dynamics associated with nucleate and film boiling. The photographs were obtained for the boiling of methanol on a horizontal tube.

Although the foregoing discussion of the boiling curve assumes that control may be maintained over  $T_s$ , it is important to remember the Nukiyama experiment and the many applications that involve controlling  $q_s''$  (e.g., in a nuclear reactor or in an electric resistance heating device). Consider starting at some point  $P$  in Figure 10.4 and gradually increasing  $q_s''$ . The value of  $\Delta T_e$ , and hence the value of  $T_s$ , will also increase, following the boiling curve to point  $C$ . However, any increase in  $q_s''$  beyond this point will induce a sharp departure from the boiling curve in which surface conditions change abruptly from  $\Delta T_{e,C}$  to  $\Delta T_{e,E} \equiv T_{s,E} - T_{\text{sat}}$ . Because  $T_{s,E}$  may exceed the melting point of the solid, destruction or failure of the system may occur. For this reason point  $C$  is often termed the *burnout point* or the *boiling crisis*, and accurate knowledge of the *critical heat flux* (CHF),  $q_{s,C}'' \equiv q_{\text{max}}''$ , is important. We may want to operate a heat transfer surface close to this value, but rarely would we want to exceed it.



## 10.4

### Pool Boiling Correlations

From the shape of the boiling curve and the fact that various physical mechanisms characterize the different regimes, it is no surprise that a multiplicity of heat transfer correlations exist for the boiling process. For the region below  $\Delta T_{e,A}$  of the boiling curve (Figure 10.4), appropriate free convection correlations from Chapter 9 can be used to estimate heat transfer coefficients and heat rates. In this section we review some of the more widely used correlations for nucleate and film boiling.

#### 10.4.1 Nucleate Pool Boiling

The analysis of nucleate boiling requires prediction of the number of surface nucleation sites and the rate at which bubbles originate from each site. While mechanisms associated with this boiling regime have been studied extensively, complete and reliable mathematical models have yet to be developed. Yamagata et al. [4] were the first to show the influence of nucleation sites on the heat rate and to demonstrate that  $q_s''$  is approximately proportional to  $\Delta T_e^3$ . It is desirable to develop correlations that reflect this relationship between the surface heat flux and the excess temperature.

In Section 10.3.2 we noted that within region *A-B* of Figure 10.4, most of the heat exchange is due to direct transfer from the heated surface to the liquid. Hence, the boiling phenomena in this region may be thought of as a type of liquid phase forced convection in which the fluid motion is induced by the rising bubbles. We have seen that forced convection correlations are generally of the form

$$\overline{Nu}_L = C_{fc} Re_L^{m_{fc}} Pr^{n_{fc}} \quad (7.1)$$

and Equation 7.1 may provide insight into how pool boiling data can be correlated, provided that a length scale and a characteristic velocity can be identified for inclusion in the Nusselt and Reynolds numbers. The subscript *fc* is added to the constants that appear in Equation 7.1 to remind us that they apply to this *forced convection* expression. As we saw in Chapter 7, these constants are determined experimentally for complicated flows. Because it is postulated that the rising bubbles mix the liquid, an appropriate length scale for relatively large heater surfaces is the bubble diameter,  $D_b$ . The diameter of the bubble upon its departure from the heated surface may be determined from a force balance in which the buoyancy force (which promotes bubble departure and is proportional to  $D_b^3$ ) is equal to the surface tension force (which adheres the bubble to the surface and is proportional to  $D_b$ ), resulting in the expression

$$D_b \propto \sqrt{\frac{\sigma}{g(\rho_l - \rho_v)}} \quad (10.4a)$$

The constant of proportionality depends on the angle of contact between the liquid, its vapor, and the solid surface; the contact angle depends on the particular liquid and solid surface that is considered. The subscripts *l* and *v* denote the saturated liquid and vapor states, respectively and  $\sigma$  (N/m) is the surface tension.



A characteristic velocity for the agitation of the liquid may be found by dividing the distance the liquid travels to fill in behind a departing bubble (proportional to  $D_b$ ) by the time between bubble departures,  $t_b$ . The time  $t_b$  is equal to the energy it takes to form a vapor bubble (proportional to  $D_b^3$ ), divided by the rate at which heat is added over the solid–vapor contact area (proportional to  $D_b^2$ ). Thus,

$$V \propto \frac{D_b}{t_b} \propto \frac{D_b}{\left( \frac{\rho_l h_{fg} D_b^3}{q_s'' D_b^2} \right)} \propto \frac{q_s''}{\rho_l h_{fg}} \quad (10.4b)$$

Substituting Equations 10.4a and 10.4b into Equation 7.1, absorbing the proportionalities into the constant  $C_{fc}$ , and substituting the resulting expression for  $h$  into Equation 10.3 provides the following expression, where the constants  $C_{s,f}$  and  $n$  are newly introduced and the exponent  $m_{fc}$  in Equation 7.1 has an experimentally determined value of 2/3:

$$q_s'' = \mu_l h_{fg} \left[ \frac{g(\rho_l - \rho_v)}{\sigma} \right]^{1/2} \left( \frac{c_{p,l} \Delta T_e}{C_{s,f} h_{fg} Pr_l^n} \right)^3 \quad (10.5)$$

Equation 10.5 was developed by Rohsenow [5] and is the first and most widely used correlation for nucleate boiling. The coefficient  $C_{s,f}$  and the exponent  $n$  depend on the solid–liquid combination, and representative experimentally determined values are presented in Table 10.1. Values for other surface–liquid combinations may be obtained from the literature [6–8]. Values of the surface tension and the latent heat of vaporization for water are presented in Table A.6 and for selected fluids in Table A.5. Values for other liquids may be obtained from any recent edition of the

**TABLE 10.1** Values of  $C_{s,f}$  for various surface–fluid combinations [5–7]

Surface–Fluid Combination	$C_{s,f}$	$n$
Water–copper		
Scored	0.0068	1.0
Polished	0.0128	1.0
Water–stainless steel		
Chemically etched	0.0133	1.0
Mechanically polished	0.0132	1.0
Ground and polished	0.0080	1.0
Water–brass	0.0060	1.0
Water–nickel	0.006	1.0
Water–platinum	0.0130	1.0
<i>n</i> -Pentane–copper		
Polished	0.0154	1.7
Lapped	0.0049	1.7
Benzene–chromium	0.0101	1.7
Ethyl alcohol–chromium	0.0027	1.7

*Handbook of Chemistry and Physics*. If Equation 10.5 is rewritten in terms of a Nusselt number based on an arbitrary length scale  $L$ , it will be in the form  $Nu_L \propto Ja^2 Pr^{1-3n} Bo^{1/2}$ , with all the properties being for the liquid, except for  $\rho_v$ . Comparing with Equation 10.2b, we see that only the first dimensionless parameter does not appear. If the Nusselt number is based on the characteristic bubble diameter given in Equation 10.4a, the expression reduces to the simpler form  $Nu_{D_b} \propto Ja^2 Pr^{1-3n}$ .

The Rohsenow correlation applies only for clean surfaces. When it is used to estimate the heat flux, errors can amount to  $\pm 100\%$ . However, since  $\Delta T_e \propto (q''_s)^{1/3}$ , this error is reduced by a factor of 3 when the expression is used to estimate  $\Delta T_e$  from knowledge of  $q''_s$ . Also, since  $q''_s \propto h_{fg}^{-2}$  and  $h_{fg}$  decreases with increasing saturation pressure (temperature), the nucleate boiling heat flux will increase as the liquid is pressurized.

### 10.4.2 Critical Heat Flux for Nucleate Pool Boiling

We recognize that the critical heat flux,  $q''_{s,C} = q''_{\max}$ , represents an important point on the boiling curve. We may wish to operate a boiling process close to this point, but we appreciate the danger of dissipating heat in excess of this amount. Kutateladze [9], through dimensional analysis, and Zuber [10], through a hydrodynamic stability analysis, obtained an expression which can be approximated as

$$q''_{\max} = Ch_{fg}\rho_v \left[ \frac{\sigma g(\rho_l - \rho_v)}{\rho_v^2} \right]^{1/4} \quad (10.6)$$

which is independent of surface material and is weakly dependent upon the heated surface geometry through the leading constant,  $C$ . For large horizontal cylinders, for spheres, and for many large finite heated surfaces, use of a leading constant with the value  $C = \pi/24 \approx 0.131$  (the Zuber constant) agrees with experimental data to within 16% [11]. For large horizontal plates, a value of  $C = 0.149$  gives better agreement with experimental data. The properties in Equation 10.6 are evaluated at the saturation temperature. Equation 10.6 applies when the characteristic length of the heater surface,  $L$ , is large relative to the bubble diameter,  $D_b$ . However, when the heater is small, such that the Confinement number,  $Co = \sqrt{\sigma/(g[\rho_l - \rho_v])}/L = Bo^{-1/2}$  [12], is greater than approximately 0.2, a correction factor must be applied to account for the small size of the heater. Lienhard [11] reports correction factors for various geometries, including horizontal plates, cylinders, spheres, and vertically and horizontally oriented ribbons.

It is important to note that the critical heat flux depends strongly on pressure, mainly through the pressure dependence of surface tension and the heat of vaporization. Cichelli and Bonilla [13] have experimentally demonstrated that the peak flux increases with pressure up to one-third of the critical pressure, after which it falls to zero at the critical pressure.

### 10.4.3 Minimum Heat Flux

The transition boiling regime is of little practical interest, as it may be obtained only by controlling the surface heater temperature. While no adequate theory has been

developed for this regime, conditions can be characterized by periodic, *unstable* contact between the liquid and the heated surface. However, the upper limit of this regime is of interest because it corresponds to formation of a *stable* vapor blanket or film and to a minimum heat flux condition. If the heat flux drops below this minimum, the film will collapse, causing the surface to cool and nucleate boiling to be reestablished.

Zuber [10] used stability theory to derive the following expression for the minimum heat flux,  $q''_{s,D} = q''_{\min}$ , from a large horizontal plate.

$$q''_{\min} = C\rho_v h_{fg} \left[ \frac{g\sigma(\rho_l - \rho_v)}{(\rho_l + \rho_v)^2} \right]^{1/4} \quad (10.7)$$

where the properties are evaluated at the saturation temperature. The constant,  $C = 0.09$ , has been experimentally determined by Berenson [14]. This result is accurate to approximately 50% for most fluids at moderate pressures but provides poorer estimates at higher pressures [15]. A similar result has been obtained for horizontal cylinders [16].

#### 10.4.4 Film Pool Boiling

At excess temperatures beyond the Leidenfrost point, a continuous vapor film blankets the surface and there is no contact between the liquid phase and the surface. Because conditions in the stable vapor film bear a strong resemblance to those of laminar film condensation (Section 10.7), it is customary to base film boiling correlations on results obtained from condensation theory. One such result, which applies to film boiling on a cylinder or sphere of diameter  $D$ , is of the form

$$\overline{Nu}_D = \frac{\bar{h}_{\text{conv}} D}{k_v} = C \left[ \frac{g(\rho_l - \rho_v) h'_{fg} D^3}{\nu_v k_v (T_s - T_{\text{sat}})} \right]^{1/4} \quad (10.8)$$

The correlation constant  $C$  is 0.62 for horizontal cylinders [17] and 0.67 for spheres [11]. The corrected latent heat  $h'_{fg}$  accounts for the sensible energy required to maintain temperatures within the vapor blanket above the saturation temperature. Although it may be approximated as  $h'_{fg} = h_{fg} + 0.80c_{p,v}(T_s - T_{\text{sat}})$ , it is known to depend weakly on the Prandtl number of the vapor [18]. Vapor properties are evaluated at the film temperature,  $T_f = (T_s + T_{\text{sat}})/2$ , and the liquid density is evaluated at the saturation temperature.

At elevated surface temperatures ( $T_s \gtrsim 300^\circ\text{C}$ ), radiation heat transfer across the vapor film becomes significant. Since radiation acts to increase the film thickness, it is not reasonable to assume that the radiative and convective processes are simply additive. Bromley [17] investigated film boiling from the outer surface of horizontal tubes and suggested calculating the total heat transfer coefficient from a transcendental equation of the form

$$\bar{h}^{4/3} = \bar{h}_{\text{conv}}^{4/3} + \bar{h}_{\text{rad}} \bar{h}^{1/3} \quad (10.9)$$

If  $\bar{h}_{\text{rad}} < \bar{h}_{\text{conv}}$ , a simpler form may be used:

$$\bar{h} = \bar{h}_{\text{conv}} + \frac{3}{4} \bar{h}_{\text{rad}} \quad (10.10)$$

The effective radiation coefficient  $\bar{h}_{\text{rad}}$  is expressed as

$$\bar{h}_{\text{rad}} = \frac{\varepsilon \sigma (T_s^4 - T_{\text{sat}}^4)}{T_s - T_{\text{sat}}} \quad (10.11)$$

where  $\varepsilon$  is the emissivity of the solid (Table A.11) and  $\sigma$  is the Stefan–Boltzmann constant.

Note that the analogy between film boiling and film condensation does not hold for small surfaces with high curvature because of the large disparity between vapor and liquid film thicknesses for the two processes. The analogy is also questionable for a vertical surface, although satisfactory predictions have been obtained for limited conditions.

### 10.4.5 Parametric Effects on Pool Boiling


In this section we briefly consider other parameters that can affect pool boiling, confining our attention to the gravitational field, liquid subcooling, and solid surface conditions.

The influence of the *gravitational field* on boiling must be considered in applications involving space travel and rotating machinery. This influence is evident from appearance of the gravitational acceleration  $g$  in the foregoing expressions. Siegel [19], in his review of low gravity effects, confirms that the  $g^{1/4}$  dependence in Equations 10.6, 10.7, and 10.8 (for the maximum and minimum heat fluxes and for film boiling) is correct for values of  $g$  as low as  $0.10 \text{ m/s}^2$ . For nucleate boiling, however, evidence indicates that the heat flux is nearly independent of gravity, which is in contrast to the  $g^{1/2}$  dependence of Equation 10.5. Above-normal gravitational forces show similar effects, although near the ONB, gravity can influence bubble-induced convection.


If liquid in a pool boiling system is maintained at a temperature that is less than the saturation temperature, the liquid is said to be *subcooled*, where  $\Delta T_{\text{sub}} \equiv T_{\text{sat}} - T_l$ . In the natural convection regime, the heat flux increases typically as  $(T_s - T_l)^{5/4}$  or  $(\Delta T_e + \Delta T_{\text{sub}})^{5/4}$ . In contrast, for nucleate boiling, the influence of subcooling is considered to be negligible, although the maximum and minimum heat fluxes,  $q''_{\text{max}}$  and  $q''_{\text{min}}$ , are known to increase linearly with  $\Delta T_{\text{sub}}$ . For film boiling, the heat flux increases strongly with increasing  $\Delta T_{\text{sub}}$ .

The influence of *surface roughness* (by machining, grooving, scoring or sand-blasting) on the maximum and minimum heat fluxes and on film boiling is negligible. However, as demonstrated by Berensen [20], increased surface roughness can cause a large increase in heat flux for the nucleate boiling regime. As Figure 10.6 illustrates, a roughened surface has numerous cavities that serve to trap vapor, providing more and larger sites for bubble growth. It follows that the nucleation site density for a rough surface can be substantially larger than that for a smooth surface. However, under prolonged boiling, the effects of surface roughness generally diminish, indicating that the new, large sites created by roughening are not stable sources of vapor entrapment.

Special surface arrangements that provide stable *augmentation (enhancement)* of nucleate boiling are available commercially and have been reviewed by Webb [21]. *Enhancement surfaces* are of two types: (1) coatings of very porous material

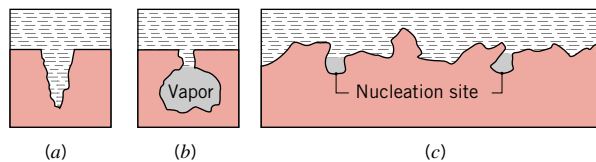

**FIGURE 10.6** Formation of nucleation sites. (a) Wetted cavity with no trapped vapor. (b) Reentrant cavity with trapped vapor. (c) Enlarged profile of a roughened surface.

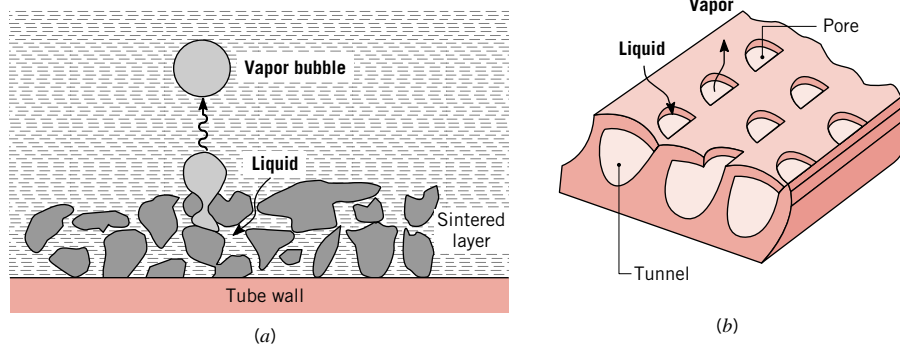

**FIGURE 10.7** Typical structured enhancement surfaces for augmentation of nucleate boiling. (a) Sintered metallic coating. (b) Mechanically formed double-reentrant cavity.

formed by sintering, brazing, flame spraying, electrolytic deposition, or foaming, and (2) mechanically machined or formed double-reentrant cavities to ensure continuous vapor trapping (see Figure 10.7). Such surfaces provide for continuous renewal of vapor at the nucleation sites and heat transfer augmentation by more than an order of magnitude. Active augmentation techniques, such as surface wiping–rotation, surface vibration, fluid vibration, and electrostatic fields, have also been reviewed by Bergles [22, 23]. However, because such techniques complicate the boiling system and, in many instances, impair reliability, they have found little practical application.

### EXAMPLE 10.1

The bottom of a copper pan, 0.3 m in diameter, is maintained at  $118^{\circ}\text{C}$  by an electric heater. Estimate the power required to boil water in this pan. What is the evaporation rate? Estimate the critical heat flux.


### SOLUTION

**Known:** Water boiling in a copper pan of prescribed surface temperature.

**Find:**

1. Power required by electric heater to cause boiling.
2. Rate of water evaporation due to boiling.
3. Critical heat flux corresponding to the burnout point.

**Schematic:**

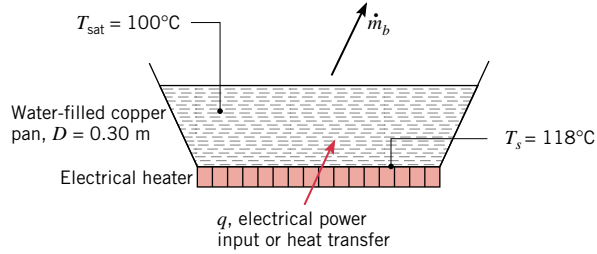

**Assumptions:**

1. Steady-state conditions.
2. Water exposed to standard atmospheric pressure, 1.01 bar.
3. Water at uniform temperature  $T_{\text{sat}} = 100^\circ\text{C}$ .
4. Large pan bottom surface of polished copper.
5. Negligible losses from heater to surroundings.

**Properties:** Table A.6, saturated water, liquid ( $100^\circ\text{C}$ ):  $\rho_l = 1/v_f = 957.9\text{ kg/m}^3$ ,  $c_{p,l} = c_{p,f} = 4.217\text{ kJ/kg} \cdot \text{K}$ ,  $\mu_l = \mu_f = 279 \times 10^{-6}\text{ N} \cdot \text{s/m}^2$ ,  $Pr_l = Pr_f = 1.76$ ,  $h_{fg} = 2257\text{ kJ/kg}$ ,  $\sigma = 58.9 \times 10^{-3}\text{ N/m}$ . Table A.6, saturated water, vapor ( $100^\circ\text{C}$ ):  $\rho_v = 1/v_g = 0.5956\text{ kg/m}^3$ .

**Analysis:**

1. From knowledge of the saturation temperature  $T_{\text{sat}}$  of water boiling at 1 atm and the temperature of the heated copper surface  $T_s$ , the excess temperature  $\Delta T_e$  is

$$\Delta T_e \equiv T_s - T_{\text{sat}} = 118^\circ\text{C} - 100^\circ\text{C} = 18^\circ\text{C}$$

According to the boiling curve of Figure 10.4, nucleate pool boiling will occur and the recommended correlation for estimating the heat transfer rate per unit area of plate surface is given by Equation 10.5.

$$q_s'' = \mu_l h_{fg} \left[ \frac{g(\rho_l - \rho_v)}{\sigma} \right]^{1/2} \left( \frac{c_{p,l} \Delta T_e}{C_{s,f} h_{fg} Pr_l^n} \right)^3$$

The values of  $C_{s,f}$  and  $n$  corresponding to the polished copper surface–water combination are determined from the experimental results of Table 10.1,

where  $C_{s,f} = 0.0128$  and  $n = 1.0$ . Substituting numerical values, the boiling heat flux is

$$\begin{aligned} q_s'' &= 279 \times 10^{-6} \text{ N} \cdot \text{s/m}^2 \times 2257 \times 10^3 \text{ J/kg} \\ &\times \left[ \frac{9.8 \text{ m/s}^2 (957.9 - 0.5956) \text{ kg/m}^3}{58.9 \times 10^{-3} \text{ N/m}} \right]^{1/2} \\ &\times \left( \frac{4.217 \times 10^3 \text{ J/kg} \cdot \text{K} \times 18^\circ\text{C}}{0.0128 \times 2257 \times 10^3 \text{ J/kg} \times 1.76} \right)^3 = 836 \text{ kW/m}^2 \end{aligned}$$

Hence the boiling heat transfer rate is

$$\begin{aligned} q_s &= q_s'' \times A = q_s'' \times \frac{\pi D^2}{4} \\ q_s &= 8.36 \times 10^5 \text{ W/m}^2 \times \frac{\pi (0.30 \text{ m})^2}{4} = 59.1 \text{ kW} \end{aligned} \quad \triangleleft$$

2. Under steady-state conditions all heat addition to the pan will result in water evaporation from the pan. Hence

$$q_s = \dot{m}_b h_{fg}$$

where  $\dot{m}_b$  is the rate at which water evaporates from the free surface to the room. It follows that

$$\dot{m}_b = \frac{q_s}{h_{fg}} = \frac{5.91 \times 10^4 \text{ W}}{2257 \times 10^3 \text{ J/kg}} = 0.0262 \text{ kg/s} = 94 \text{ kg/h} \quad \triangleleft$$

3. The critical heat flux for nucleate pool boiling can be estimated from Equation 10.6:

$$q_{\max}'' = 0.149 h_{fg} \rho_v \left[ \frac{\sigma g (\rho_l - \rho_v)}{\rho_v^2} \right]^{1/4}$$

Substituting the appropriate numerical values,

$$\begin{aligned} q_{\max}'' &= 0.149 \times 2257 \times 10^3 \text{ J/kg} \times 0.5956 \text{ kg/m}^3 \\ &\times \left[ \frac{58.9 \times 10^{-3} \text{ N/m} \times 9.8 \text{ m/s}^2 (957.9 - 0.5956) \text{ kg/m}^3}{(0.5956)^2 (\text{kg/m}^3)^2} \right]^{1/4} \\ q_{\max}'' &= 1.26 \text{ MW/m}^2 \end{aligned} \quad \triangleleft$$

### Comments:

- Note that the critical heat flux  $q_{\max}'' = 1.26 \text{ MW/m}^2$  represents the maximum heat flux for boiling water at normal atmospheric pressure. Operation of the heater at  $q_s'' = 0.836 \text{ MW/m}^2$  is therefore below the critical condition.
- Using Equation 10.7, the minimum heat flux at the Leidenfrost point is  $q_{\min}'' = 18.9 \text{ kW/m}^2$ . Note from Figure 10.4 that, for this condition,  $\Delta T_e \approx 120^\circ\text{C}$ .

### EXAMPLE 10.2


A metal-clad heating element of 6-mm diameter and emissivity  $\varepsilon = 1$  is horizontally immersed in a water bath. The surface temperature of the metal is  $255^\circ\text{C}$  under steady-state boiling conditions. Estimate the power dissipation per unit length of the heater.

### SOLUTION

**Known:** Boiling from outer surface of horizontal cylinder in water.

**Find:** Power dissipation per unit length for the cylinder,  $q'_s$ .

**Schematic:**

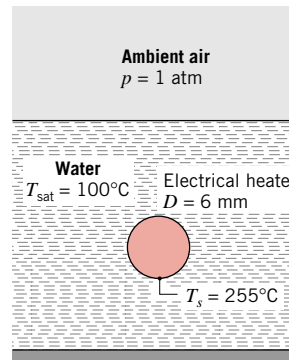

**Assumptions:**

1. Steady-state conditions.
2. Water exposed to standard atmospheric pressure and at uniform temperature  $T_{\text{sat}}$ .

**Properties:** Table A.6, saturated water, liquid ( $100^\circ\text{C}$ ):  $\rho_l = 1/v_f = 957.9 \text{ kg/m}^3$ ,  $h_{fg} = 2257 \text{ kJ/kg}$ . Table A.4, water vapor at atmospheric pressure ( $T_f \approx 450 \text{ K}$ ):  $\rho_v = 0.4902 \text{ kg/m}^3$ ,  $c_{p,v} = 1.980 \text{ kJ/kg} \cdot \text{K}$ ,  $k_v = 0.0299 \text{ W/m} \cdot \text{K}$ ,  $\mu_v = 15.25 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ .

**Analysis:** The excess temperature is

$$\Delta T_e = T_s - T_{\text{sat}} = 255^\circ\text{C} - 100^\circ\text{C} = 155^\circ\text{C}$$

According to the boiling curve of Figure 10.4, film pool boiling conditions are achieved, in which case heat transfer is due to both convection and radiation. The heat transfer rate follows from Equation 10.3, written on a per unit length basis for a cylindrical surface of diameter  $D$ :

$$q'_s = q''_s \pi D = \bar{h} \pi D \Delta T_e$$

The heat transfer coefficient  $\bar{h}$  is calculated from Equation 10.9,

$$\bar{h}^{4/3} = \bar{h}_{\text{conv}}^{4/3} + \bar{h}_{\text{rad}} \bar{h}^{1/3}$$



where the convection and radiation heat transfer coefficients follow from Equations 10.8 and 10.11, respectively. For the convection coefficient:

$$\begin{aligned}\bar{h}_{\text{conv}} &= 0.62 \left[ \frac{k_v^3 \rho_v (\rho_l - \rho_v) g (h_{fg} + 0.8 c_{p,v} \Delta T_e)}{\mu_v D \Delta T_e} \right]^{1/4} \\ \bar{h}_{\text{conv}} &= 0.62 \\ &\times \left[ \frac{(0.0299)^3 (\text{W/m} \cdot \text{K})^3 \times 0.4902 \text{ kg/m}^3 (957.9 - 0.4902) \text{ kg/m}^3 \times 9.8 \text{ m/s}^2}{1} \right. \\ &\times \left. \frac{(2257 \times 10^3 \text{ J/kg} + 0.8 \times 1.98 \times 10^3 \text{ J/kg} \cdot \text{K} \times 155^\circ\text{C})}{15.25 \times 10^{-6} \text{ N} \cdot \text{s/m}^2 \times 6 \times 10^{-3} \text{ m} \times 155^\circ\text{C}} \right]^{1/4} \\ \bar{h}_{\text{conv}} &= 238 \text{ W/m}^2 \cdot \text{K}\end{aligned}$$

For the radiation heat transfer coefficient:

$$\begin{aligned}\bar{h}_{\text{rad}} &= \frac{\varepsilon \sigma (T_s^4 - T_{\text{sat}}^4)}{T_s - T_{\text{sat}}} \\ \bar{h}_{\text{rad}} &= \frac{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (528^4 - 373^4) \text{ K}^4}{(528 - 373) \text{ K}} = 21.3 \text{ W/m}^2 \cdot \text{K}\end{aligned}$$

Solving Equation 10.9 by trial and error,

$$\bar{h}^{4/3} = 238^{4/3} + 21.3 \bar{h}^{1/3}$$

it follows that

$$\bar{h} = 254.1 \text{ W/m}^2 \cdot \text{K}$$

Hence the heat transfer rate per unit length of heater element is

$$q'_s = 254.1 \text{ W/m}^2 \cdot \text{K} \times \pi \times 6 \times 10^{-3} \text{ m} \times 155^\circ\text{C} = 742 \text{ W/m} \quad \triangleleft$$

**Comments:** Equation 10.10 is appropriate for estimating  $\bar{h}$ ; it provides a value of  $254.0 \text{ W/m}^2 \cdot \text{K}$ .

## 10.5

### Forced Convection Boiling

In *pool boiling* fluid flow is due primarily to the buoyancy-driven motion of bubbles originating from the heated surface. In contrast, for *forced convection boiling*, flow is due to a directed (bulk) motion of the fluid, as well as to buoyancy effects. Conditions depend strongly on geometry, which may involve *external* flow over heated plates and cylinders or *internal* (duct) flow. Internal, forced convection boiling is commonly referred to as *two-phase flow* and is characterized by rapid changes from liquid to vapor in the flow direction.

### 10.5.1 External Forced Convection Boiling

For external flow over a heated plate, the heat flux can be estimated by standard forced convection correlations up to the inception of boiling. As the temperature of the heated plate is increased, nucleate boiling will occur, causing the heat flux to increase. If vapor generation is not extensive and the liquid is subcooled, Bergles and Rohsenow [24] suggest a method for estimating the total heat flux in terms of components associated with pure forced convection and pool boiling.

Both forced convection and subcooling are known to increase the critical heat flux  $q''_{\max}$  for nucleate boiling. Experimental values as high as 35 MW/m<sup>2</sup> (compared with 1.3 MW/m<sup>2</sup> for pool boiling of water at 1 atm) have been reported [25]. For a liquid of velocity  $V$  moving in cross flow over a cylinder of diameter  $D$ , Lienhard and Eichhorn [26] have developed the following expressions for low- and high-velocity flows, where properties are evaluated at the saturation temperature.

**Low Velocity:**

$$\frac{q''_{\max}}{\rho_v h_{fg} V} = \frac{1}{\pi} \left[ 1 + \left( \frac{4}{We_D} \right)^{1/3} \right] \quad (10.12)$$

**High Velocity:**

$$\frac{q''_{\max}}{\rho_v h_{fg} V} = \frac{(\rho_l/\rho_v)^{3/4}}{169\pi} + \frac{(\rho_l/\rho_v)^{1/2}}{19.2\pi We_D^{1/3}} \quad (10.13)$$

The Weber number  $We_D$  is the ratio of inertia to surface tension forces and has the form


$$We_D \equiv \frac{\rho_v V^2 D}{\sigma} \quad (10.14)$$

The high- and low-velocity regions, respectively, are determined by whether the heat flux parameter  $q''_{\max}/\rho_v h_{fg} V$  is less than or greater than  $[(0.275/\pi) (\rho_l/\rho_v)^{1/2} + 1]$ . In most cases, Equations 10.12 and 10.13 correlate  $q''_{\max}$  data within 20%.

### 10.5.2 Two-Phase Flow

Internal forced convection boiling is associated with bubble formation at the inner surface of a heated tube through which a liquid is flowing. Bubble growth and separation are strongly influenced by the flow velocity, and hydrodynamic effects differ significantly from those corresponding to pool boiling. The process is accompanied by the existence of a variety of two-phase flow patterns.

Consider flow development in a vertical tube that is subjected to a constant surface heat flux, as shown in Figure 10.8. Heat transfer to the subcooled liquid that enters the tube is initially by *single-phase forced convection* and may be predicted using the correlations of Chapter 8. Farther down the tube, the wall temperature exceeds the saturation temperature of the liquid, and vaporization is initiated in the *subcooled flow boiling region*. This region is characterized by significant radial

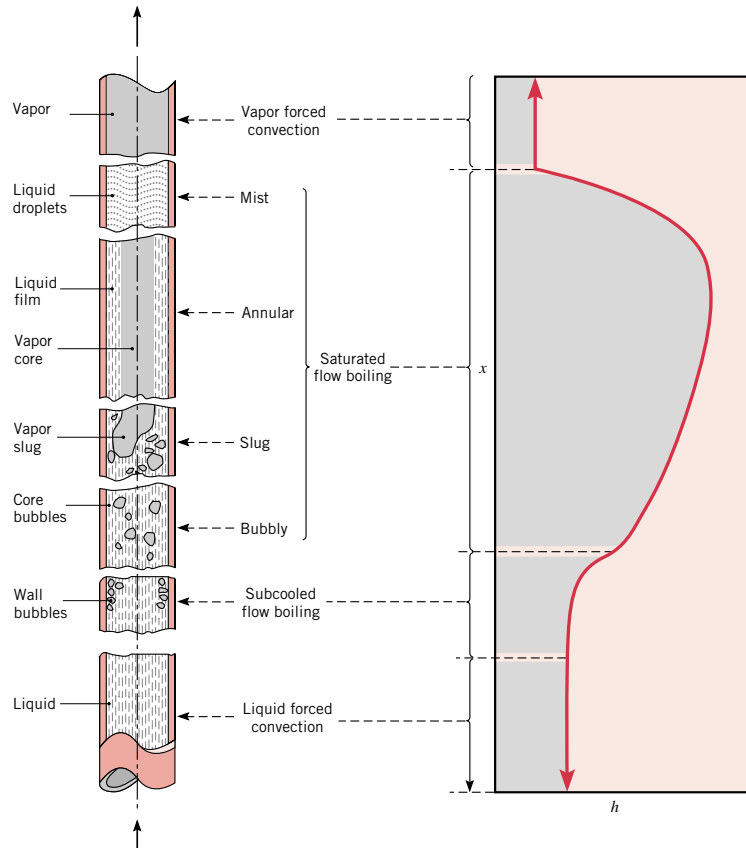

**FIGURE 10.8** Flow regimes for forced convection boiling in a tube.

temperature gradients, with bubbles forming adjacent to the heated wall and subcooled liquid flowing near the center of the tube. The thickness of the bubble region increases farther downstream, and eventually, the core of the liquid reaches the saturation temperature of the fluid. Bubbles can then exist at any radial location, and the time-averaged mass fraction of vapor in the fluid,<sup>1</sup>  $\bar{X}$ , exceeds zero at any radial location. This marks the beginning of the *saturated flow boiling region*. Within the saturated flow boiling region, the mean vapor mass fraction defined as

$$\bar{X} \equiv \frac{\int_{A_c} \rho u(r, x) X dA_c}{\dot{m}}$$

increases and, due to the large density difference between the vapor and liquid phases, the mean velocity of the fluid,  $u_m$ , increases significantly.

The first stage of the saturated flow boiling region corresponds to the *bubbly flow regime*. As  $\bar{X}$  increases further, individual bubbles coalesce to form slugs of

<sup>1</sup>This term is often referred to as the *quality* of a two-phase fluid.

vapor. This *slug-flow regime* is followed by an *annular-flow regime* in which the liquid forms a film on the tube wall. This film moves along the inner surface of the tube, while vapor moves at a larger velocity through the core of the tube. Dry spots eventually appear on the inner surface of the tube and grow in size within a *transition regime*. Eventually, the entire tube surface is completely dry, and all remaining liquid is in the form of droplets that travel at high velocity within the core of the tube in the *mist regime*. After the droplets are completely vaporized, the fluid consists of superheated vapor in a *second* single-phase forced convection region. The increase in the vapor fraction along the tube length, along with the significant difference in the densities of the liquid and vapor phases, increases the mean velocity of the fluid by several orders of magnitude between the first and the second single-phase forced convection regions.

The local heat transfer coefficient varies significantly as  $\bar{X}$  and  $u_m$  decrease and increase, respectively, along the length of the tube,  $x$ . In general, the heat transfer coefficient can increase by approximately an order of magnitude through the subcooled flow boiling region. Heat transfer coefficients are further increased in the early stages of the saturated flow boiling region. Conditions become more complex deeper in the saturated flow boiling region since the convection coefficient, defined in Equation 10.3, *either* increases or decreases with increasing  $\bar{X}$ , depending on the fluid and tube wall material. Typically, the smallest convection coefficients exist in the second (vapor) forced convection region owing to the low thermal conductivity of the vapor relative to that of the liquid.

The following correlation has been developed for the saturated flow boiling region in smooth circular tubes [27, 28]:

$$\frac{h}{h_{sp}} = 0.6683 \left( \frac{\rho_l}{\rho_v} \right)^{0.1} \bar{X}^{0.16} (1 - \bar{X})^{0.64} f(Fr) + 1058 \left( \frac{q_s''}{\dot{m}'' h_{fg}} \right)^{0.7} (1 - \bar{X})^{0.8} G_{s,f} \quad (10.15a)$$

or

$$\frac{h}{h_{sp}} = 1.136 \left( \frac{\rho_l}{\rho_v} \right)^{0.45} \bar{X}^{0.72} (1 - \bar{X})^{0.08} f(Fr) + 667.2 \left( \frac{q_s''}{\dot{m}'' h_{fg}} \right)^{0.7} (1 - \bar{X})^{0.8} G_{s,f} \quad (10.15b)$$

$$0 < \bar{X} \leq 0.8$$

where  $\dot{m}'' = \dot{m}/A_c$  is the mass flow rate per unit cross-sectional area. In utilizing Equation 10.15, the larger value of the heat transfer coefficient,  $h$ , should be used. In this expression, the liquid phase *Froude number* is  $Fr = (\dot{m}''/\rho_l)^2/gD$  and the coefficient  $G_{s,f}$  depends on the surface–liquid combination, with representative values given in Table 10.2. Equation 10.15 applies for horizontal as well as vertical tubes, where the *stratification parameter*,  $f(Fr)$ , accounts for stratification of the liquid and vapor phases that may occur for horizontal tubes. Its value is unity for vertical tubes and for horizontal tubes with  $Fr \geq 0.04$ . For horizontal tubes with  $Fr \leq 0.04$ ,  $f(Fr) = 2.63Fr^{0.3}$ . All properties are evaluated at the saturation temperature,  $T_{sat}$ . The single-phase convection coefficient,  $h_{sp}$ , is associated with the liquid forced convection region of Figure 10.8 and is obtained from Equation 8.62 with properties evaluated at  $T_{sat}$ . Because Equation 8.62 is for turbulent flow, it is recommended that Equation 10.15 not be applied to situations where the liquid single-phase

**TABLE 10.2** Values of  $G_{s,f}$  for various surface–liquid combinations [27, 28].

Fluid in Commercial Copper Tubing	$G_{s,f}$
Kerosene	0.488
Refrigerant R-134a	1.63
Refrigerant R-152a	1.10
Water	1.00
For stainless steel tubing, use $G_{s,f} = 1$ .	

convection is laminar. Equation 10.15 is applicable when the channel dimension is large relative to the bubble diameter, that is, for Confinement numbers,  $Co = \sqrt{\sigma/(\rho_l - \rho_v)}/D_h \lesssim 1/2$  [3].

In order to use Equation 10.15, the mean vapor mass fraction,  $\bar{X}$ , must be known. For negligible changes in the fluid's kinetic and potential energy as well as negligible work, Equation 1.11d may be rearranged to yield

$$\bar{X}(x) = \frac{q_s'' \pi D x}{\dot{m} h_{fg}} \quad (10.16)$$

where the origin of the  $x$ -coordinate,  $x = 0$ , corresponds to the axial location where  $\bar{X}$  begins to exceed zero, and the change in enthalpy,  $u_t + pv$ , is equal to the change in  $\bar{X}$  multiplied by the enthalpy of vaporization,  $h_{fg}$ .

Correlations for the subcooled flow boiling region and annular as well as mist regimes are available in the literature [28]. For constant heat flux conditions, critical heat fluxes may occur in the subcooled flow boiling region, in the saturated flow boiling region where  $\bar{X}$  is large, or in the vapor forced convection region. Critical heat flux conditions may lead to melting of the tube material in extreme conditions [29]. Additional discussions of flow boiling are available in the literature [7, 30–33]. Extensive databases consisting of thousands of experimentally measured values of the critical heat flux for wide ranges of operating conditions are also available [34, 35].

### 10.5.3 Two-Phase Flow in Microchannels


Two-phase microchannels feature forced convection boiling of a liquid through circular or noncircular tubes having hydraulic diameters ranging from 10 to 1000  $\mu\text{m}$ , resulting in extremely high heat transfer rates [36]. In these situations, the characteristic bubble size can occupy a significant fraction of the tube diameter and the Confinement number can become very large. Hence, different types of flow regimes exist, including regimes where the bubbles occupy nearly the full diameter of the heated tube [37]. This can lead to a dramatic increase in the convection coefficient,  $h$ , corresponding to the peak in Figure 10.8. Thereafter,  $h$  decreases with increasing  $x$  as it does in Figure 10.8. Equation 10.15 cannot be used to predict correct values of the heat transfer coefficient and does not even predict correct trends for microchannel flow boiling cases. Recourse must be made to more sophisticated modeling [38].

## 10.6

## Condensation: Physical Mechanisms

Condensation occurs when the temperature of a vapor is reduced below its saturation temperature. In industrial equipment, the process commonly results from contact between the vapor and a cool *surface* (Figures 10.9a, b). The latent energy of the vapor is released, heat is transferred to the surface, and the condensate is formed. Other common modes are *homogeneous* condensation (Figure 10.9c), where vapor condenses out as droplets suspended in a gas phase to form a fog, and *direct contact* condensation (Figure 10.9d), which occurs when vapor is brought into contact with a cold liquid. In this chapter we will consider only surface condensation.

As shown in Figures 10.9a, b, condensation may occur in one of two ways, depending on the condition of the surface. The dominant form of condensation is one in which a liquid film covers the entire condensing surface, and under the action of gravity the film flows continuously from the surface. *Film condensation* is generally characteristic of clean, uncontaminated surfaces. However, if the surface is coated with a substance that inhibits wetting, it is possible to maintain *dropwise condensation*. The drops form in cracks, pits, and cavities on the surface and may grow and coalesce through continued condensation. Typically, more than 90% of the surface is covered by drops, ranging from a few micrometers in diameter to

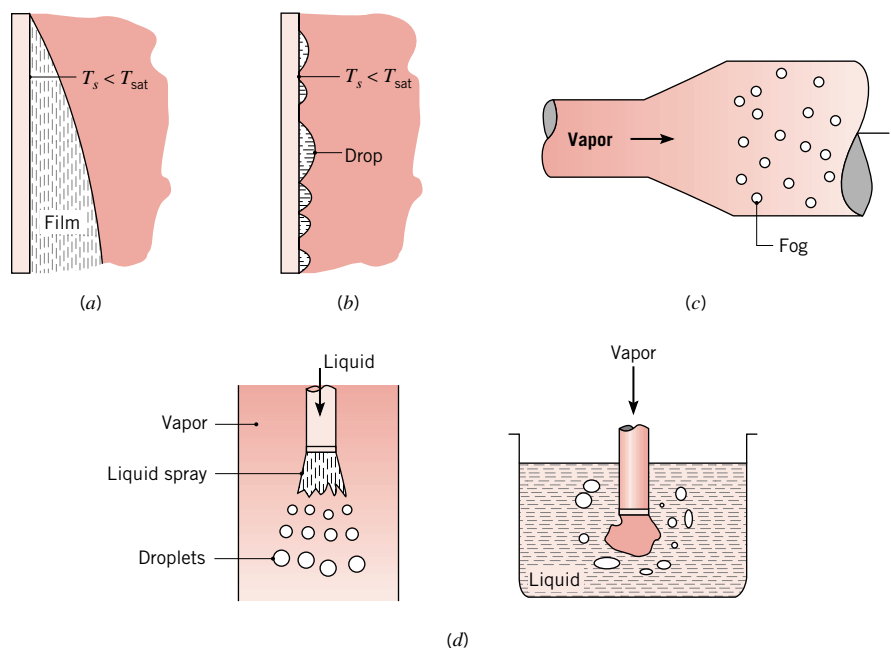


**FIGURE 10.9** Modes of condensation. (a) Film. (b) Dropwise condensation on a surface. (c) Homogeneous condensation or fog formation resulting from increased pressure due to expansion. (d) Direct contact condensation.

agglomerations visible to the naked eye. The droplets flow from the surface due to the action of gravity. Film and dropwise condensation of steam on a vertical copper surface are shown in Figure 10.10. A thin coating of cupric oleate was applied to the left-hand portion of the surface to promote the dropwise condensation. A thermocouple probe of 1-mm diameter extends across the photograph.

Regardless of whether it is in the form of a film or droplets, the condensate provides a resistance to heat transfer between the vapor and the surface. Because this resistance increases with condensate thickness, which increases in the flow direction, it is desirable to use short vertical surfaces or horizontal cylinders in situations involving film condensation. Most condensers therefore consist of horizontal tube bundles through which a liquid coolant flows and around which the vapor to be condensed is circulated. In terms of maintaining high condensation and heat transfer rates, droplet formation is superior to film formation. In dropwise condensation most of the heat transfer is through drops of less than  $100\text{-}\mu\text{m}$  diameter, and transfer rates that are more than an order of magnitude larger than those associated with film condensation may be achieved. It is therefore common practice to use surface coatings that inhibit wetting, and hence stimulate dropwise condensation. Silicones, Teflon, and an assortment of waxes and fatty acids are often used for this purpose. However, such coatings gradually lose their effectiveness due to oxidation, fouling, or outright removal, and film condensation eventually occurs.

Although it is desirable to achieve dropwise condensation in industrial applications, it is often difficult to maintain this condition. For this reason and because the convection coefficients for film condensation are smaller than those for the dropwise case, condenser design calculations are often based on the assumption of film condensation. In the remaining sections of this chapter, we focus on film condensation and mention only briefly results available for dropwise condensation.

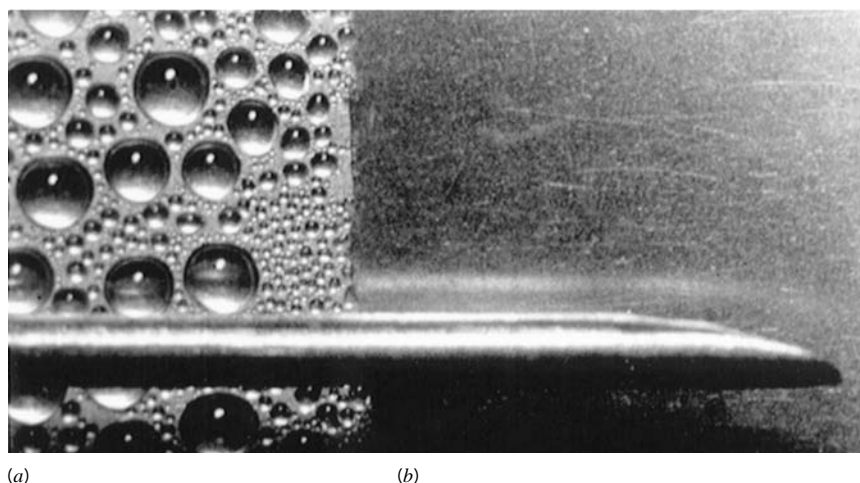

**FIGURE 10.10** Condensation on a vertical surface. (a) Dropwise. (b) Film. Photograph courtesy of Professor J. W. Westwater, University of Illinois at Champaign-Urbana.


## 10.7

### Laminar Film Condensation on a Vertical Plate

As shown in Figure 10.11a, there may be several complicating features associated with film condensation. The film originates at the top of the plate and flows downward under the influence of gravity. The thickness  $\delta$  and the condensate mass flow rate  $\dot{m}$  increase with increasing  $x$  because of continuous condensation at the liquid–vapor interface, which is at  $T_{\text{sat}}$ . There is then heat transfer from this interface through the film to the surface, which is maintained at  $T_s < T_{\text{sat}}$ . In the most general case the vapor may be superheated ( $T_{v,\infty} > T_{\text{sat}}$ ) and may be part of a mixture containing one or more non-condensable gases. Moreover, there exists a finite shear stress at the liquid–vapor interface, as well as in the film [39, 40].

Despite the complexities associated with film condensation, useful results may be obtained by making assumptions that originated with an analysis by Nusselt [41].

1. Laminar flow and constant properties are assumed for the liquid film.
2. The gas is assumed to be a pure vapor and at a uniform temperature equal to  $T_{\text{sat}}$ . With no temperature gradient in the vapor, heat transfer to the liquid–vapor

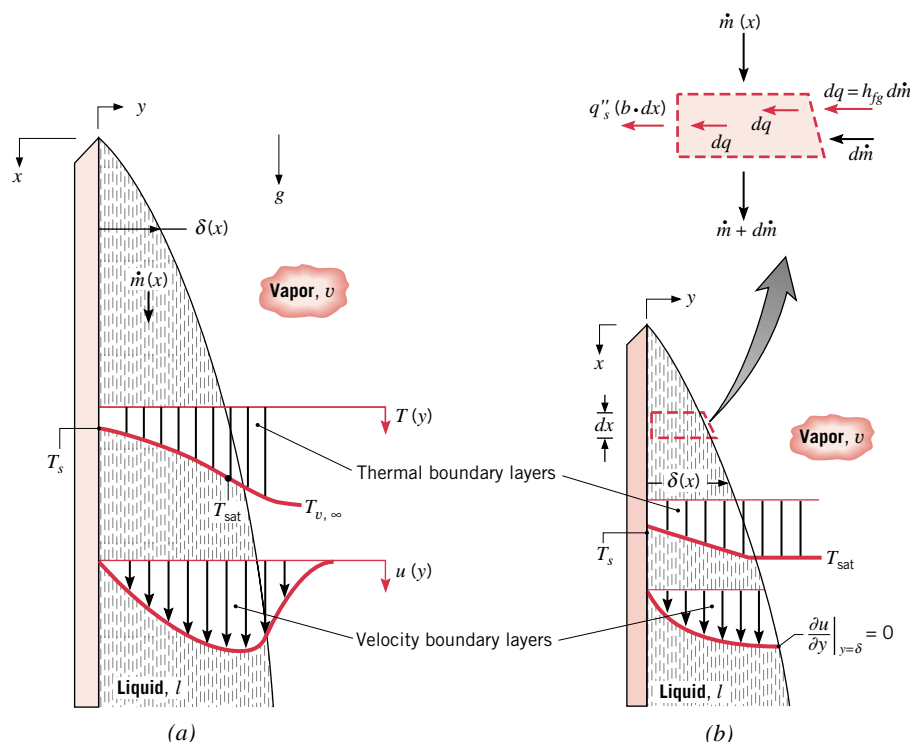

**FIGURE 10.11** Boundary layer effects related to film condensation on a vertical surface. (a) Without approximation. (b) With assumptions associated with Nusselt's analysis, for a vertical plate of width  $b$ .



interface can occur only by condensation at the interface and not by conduction from the vapor.

3. The shear stress at the liquid–vapor interface is assumed to be negligible, in which case  $\partial u / \partial y|_{y=\delta} = 0$ . With this assumption and the foregoing assumption of a uniform vapor temperature, there is no need to consider the vapor velocity or thermal boundary layers shown in Figure 10.11a.
4. Momentum and energy transfer by advection in the condensate film are assumed to be negligible. This assumption is reasonable by virtue of the low velocities associated with the film. It follows that heat transfer across the film occurs only by conduction, in which case the liquid temperature distribution is linear.

Film conditions resulting from the assumptions are shown in Figure 10.11b.

The  $x$ -momentum equation for the film can be found from Equation 9.1, with  $\rho = \rho_l$  and  $\nu = \nu_l$  for the liquid, and with the sign of the gravity term changed since  $x$  is now in the direction of gravity. The pressure gradient is obtained from Equation 9.2 and is  $dp_\infty/dx = +\rho_v g$ , since the free stream density is the vapor density. From the fourth approximation, momentum advection terms may be neglected, and the  $x$ -momentum equation may be expressed as

$$\frac{\partial^2 u}{\partial y^2} = -\frac{g}{\mu_l}(\rho_l - \rho_v) \quad (10.17)$$

Integrating twice and applying boundary conditions of the form  $u(0) = 0$  and  $\partial u / \partial y|_{y=\delta} = 0$ , the velocity profile in the film becomes

$$u(y) = \frac{g(\rho_l - \rho_v)\delta^2}{\mu_l} \left[ \frac{y}{\delta} - \frac{1}{2} \left( \frac{y}{\delta} \right)^2 \right] \quad (10.18)$$

From this result the condensate mass flow rate per unit width  $\Gamma(x)$  may be obtained in terms of an integral involving the velocity profile:

$$\frac{\dot{m}(x)}{b} = \int_0^{\delta(x)} \rho_l u(y) dy \equiv \Gamma(x) \quad (10.19)$$

Substituting from Equation 10.18, it follows that

$$\Gamma(x) = \frac{g\rho_l(\rho_l - \rho_v)\delta^3}{3\mu_l} \quad (10.20)$$

The specific variation with  $x$  of  $\delta$ , and hence of  $\Gamma$ , may be obtained by first applying the conservation of energy requirement to the differential element shown in Figure 10.11b. At a portion of the liquid–vapor interface of unit width and length  $dx$ , the rate of heat transfer into the film,  $dq$ , must equal the rate of energy release due to condensation at the interface. Hence

$$dq = h_{fg} d\dot{m} \quad (10.21)$$

Since advection is neglected, it also follows that the rate of heat transfer across the interface must equal the rate of heat transfer to the surface. Hence

$$dq = q_s''(b \cdot dx) \quad (10.22)$$

Since the liquid temperature distribution is linear, Fourier's law may be used to express the surface heat flux as

$$q_s'' = \frac{k_l(T_{\text{sat}} - T_s)}{\delta} \quad (10.23)$$

Combining Equations 10.19 and 10.21 through 10.23, we then obtain

$$\frac{d\Gamma}{dx} = \frac{k_l(T_{\text{sat}} - T_s)}{\delta h_{fg}} \quad (10.24)$$

Differentiating Equation 10.20, we also obtain

$$\frac{d\Gamma}{dx} = \frac{g\rho_l(\rho_l - \rho_v)\delta^2}{\mu_l} \frac{d\delta}{dx} \quad (10.25)$$

Combining Equations 10.24 and 10.25, it follows that

$$\delta^3 d\delta = \frac{k_l\mu_l(T_{\text{sat}} - T_s)}{g\rho_l(\rho_l - \rho_v)h_{fg}} dx$$

Integrating from  $x = 0$ , where  $\delta = 0$ , to any  $x$  location of interest on the surface,

$$\delta(x) = \left[ \frac{4k_l\mu_l(T_{\text{sat}} - T_s)x}{g\rho_l(\rho_l - \rho_v)h_{fg}} \right]^{1/4} \quad (10.26)$$

This result may then be substituted into Equation 10.20 to obtain  $\Gamma(x)$ .

An improvement to the foregoing result for  $\delta(x)$  was made by Nusselt [41] and Rohsenow [42], who showed that, with the inclusion of thermal advection effects, a term is added to the latent heat of vaporization. In lieu of  $h_{fg}$ , Rohsenow recommended using a modified latent heat of the form  $h'_{fg} = h_{fg} + 0.68c_{p,l}(T_{\text{sat}} - T_s)$ , or in terms of the Jakob number,

$$h'_{fg} = h_{fg}(1 + 0.68Ja) \quad (10.27)$$

More recently, Sadasivan and Lienhard [18] have shown that the modified latent heat depends weakly on the Prandtl number of the liquid.

The surface heat flux may be expressed as

$$q_s'' = h_x(T_{\text{sat}} - T_s) \quad (10.28)$$

Substituting from Equation 10.23, the local convection coefficient is then

$$h_x = \frac{k_l}{\delta} \quad (10.29)$$

or, from Equation 10.26, with  $h_{fg}$  replaced by  $h'_{fg}$ ,

$$h_x = \left[ \frac{g\rho_l(\rho_l - \rho_v)k_l^3 h'_{fg}}{4\mu_l(T_{\text{sat}} - T_s)x} \right]^{1/4} \quad (10.30)$$

Since  $h_x$  depends on  $x^{-1/4}$ , it follows that the average convection coefficient for the entire plate is

$$\bar{h}_L = \frac{1}{L} \int_0^L h_x dx = \frac{4}{3} h_L$$

or

$$\bar{h}_L = 0.943 \left[ \frac{g\rho_l(\rho_l - \rho_v)k_l^3 h'_{fg}}{\mu_l(T_{\text{sat}} - T_s)L} \right]^{1/4} \quad (10.31)$$

The average Nusselt number then has the form

$$\overline{Nu}_L = \frac{\bar{h}_L L}{k_l} = 0.943 \left[ \frac{\rho_l g(\rho_l - \rho_v) h'_{fg} L^3}{\mu_l k_l (T_{\text{sat}} - T_s)} \right]^{1/4} \quad (10.32)$$

In using this equation all liquid properties should be evaluated at the film temperature  $T_f = (T_{\text{sat}} + T_s)/2$ , and  $\rho_v$  and  $h'_{fg}$  should be evaluated at  $T_{\text{sat}}$ .

A more detailed boundary layer analysis of film condensation on a vertical plate has been performed by Sparrow and Gregg [39]. Their results, confirmed by Chen [43], indicate that errors associated with using Equation 10.32 are less than 3% for  $Ja \leq 0.1$  and  $1 \leq Pr \leq 100$ . Dhira and Lienhard [44] have also shown that Equation 10.32 may be used for inclined plates, if  $g$  is replaced by  $g \cdot \cos \theta$ , where  $\theta$  is the angle between the vertical and the surface. However, it must be used with caution for large values of  $\theta$  and does not apply if  $\theta = \pi/2$ . The expression may be used for condensation on the inner or outer surface of a vertical tube of radius  $R$ , if  $R \gg \delta$ .

The total heat transfer to the surface may be obtained by using Equation 10.31 with the following form of Newton's law of cooling:

$$q = \bar{h}_L A (T_{\text{sat}} - T_s) \quad (10.33)$$

The total condensation rate may then be determined from the relation

$$\dot{m} = \frac{q}{h'_{fg}} = \frac{\bar{h}_L A (T_{\text{sat}} - T_s)}{h'_{fg}} \quad (10.34)$$

Equations 10.33 and 10.34 are generally applicable to any surface geometry, although the form of  $\bar{h}_L$  will vary according to geometry and flow conditions.

## 10.8


### Turbulent Film Condensation

As for all previously discussed convection phenomena, turbulent flow conditions may exist in film condensation. Consider the vertical surface of Figure 10.12a. The transition criterion may be expressed in terms of a Reynolds number defined as

$$Re_\delta \equiv \frac{4\Gamma}{\mu_l} \quad (10.35)$$

With the condensate mass flow rate given by  $\dot{m} = \rho_l u_m b \delta$ , the Reynolds number may be expressed as

$$Re_\delta = \frac{4\dot{m}}{\mu_l b} = \frac{4\rho_l u_m \delta}{\mu_l} \quad (10.36)$$

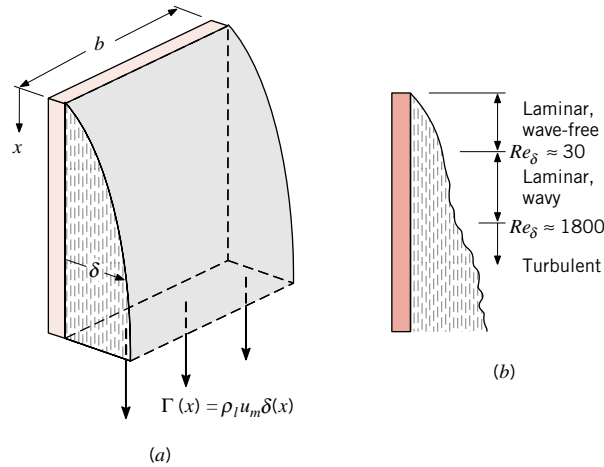

**FIGURE 10.12** Film condensation on a vertical plate. (a) Condensate rate for plate of width  $b$ . (b) Flow regimes.

where  $u_m$  is the average velocity in the film and  $\delta$ , the film thickness, is the characteristic length. As in the case of single-phase boundary layers, the Reynolds number is an indicator of flow conditions. As shown in Figure 10.12b, for  $Re_\delta \leq 30$ , the film is laminar and wave free. For increased  $Re_\delta$ , ripples or waves form on the condensate film, and at  $Re_\delta \approx 1800$  the transition from laminar to turbulent flow is complete.

For the wave-free laminar region ( $Re_\delta \leq 30$ ), Equations 10.35 and 10.20 may be combined to yield

$$Re_\delta = \frac{4g\rho_l(\rho_l - \rho_v)\delta^3}{3\mu_l^2} \quad (10.37)$$

Assuming  $\rho_l \gg \rho_v$  and substituting from Equations 10.26 and 10.31, Equation 10.37 can be expressed in terms of a modified Nusselt number:

$$\frac{\bar{h}_L(v_l^2/g)^{1/3}}{k_l} = 1.47Re_\delta^{-1/3} \quad Re_\delta \leq 30 \quad (10.38)$$

In the laminar wavy region, Kutateladze [45] recommends a correlation of the form

$$\frac{\bar{h}_L(v_l^2/g)^{1/3}}{k_l} = \frac{Re_\delta}{1.08Re_\delta^{1.22} - 5.2} \quad 30 \leq Re_\delta \leq 1800 \quad (10.39)$$

and for the turbulent region, Labuntsov [46] recommends

$$\frac{\bar{h}_L(v_l^2/g)^{1/3}}{k_l} = \frac{Re_\delta}{8750 + 58Pr_l^{-0.5}(Re_\delta^{0.75} - 253)} \quad Re_\delta \geq 1800 \quad (10.40)$$

Graphical representation of the foregoing correlations is provided in Figure 10.13, and the trends have been verified experimentally by Gregorig et al. [47] for water over the range  $1 < Re_\delta < 7200$ . All properties are evaluated as for laminar film condensation, as explained beneath Equation 10.32.

The Reynolds number in Equations 10.38 through 10.40 is associated with the film thickness that exists at the bottom of the condensing surface,  $x = L$ . To use

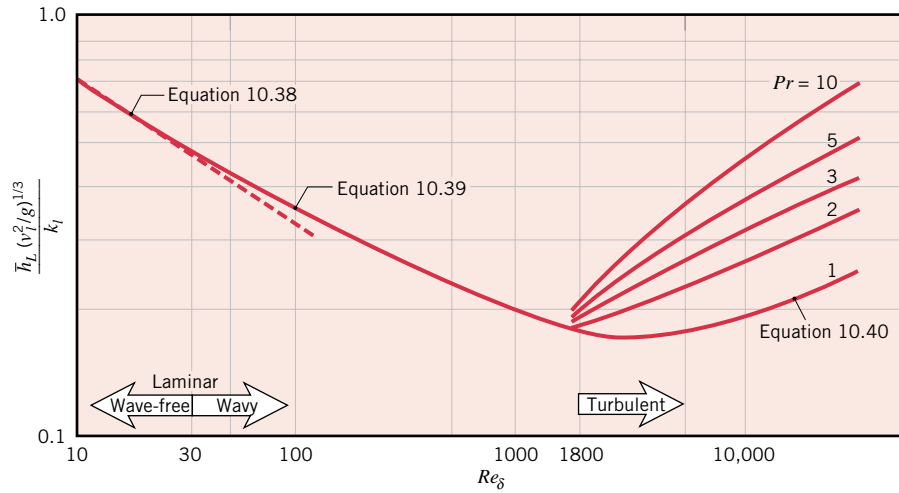


FIGURE 10.13 Modified Nusselt number for condensation on a vertical plate.

these equations, it is necessary to determine the value of the Reynolds number,  $Re_\delta$ . To do so, Equations 10.34 and 10.36 may be combined to provide

$$\bar{h}_L = \frac{Re_\delta \mu_l h'_{fg}}{4L(T_{\text{sat}} - T_s)} \quad (10.41)$$

and expressions for  $\bar{h}_L$  may be determined from Equations 10.38, 10.39, and 10.40 and substituted into Equation 10.41 to yield

$$Re_\delta = 3.78 \left[ \frac{k_l L (T_{\text{sat}} - T_s)}{\mu_l h'_{fg} (v_l^2/g)^{1/3}} \right]^{3/4} \quad Re_\delta \leq 30 \quad (10.42)$$

$$Re_\delta = \left[ \frac{3.70 k_l L (T_{\text{sat}} - T_s)}{\mu_l h'_{fg} (v_l^2/g)^{1/3}} + 4.8 \right]^{0.82} \quad 30 \leq Re_\delta \leq 1800 \quad (10.43)$$

$$Re_\delta = \left[ \frac{0.069 k_l L (T_{\text{sat}} - T_s)}{\mu_l h'_{fg} (v_l^2/g)^{1/3}} Pr_l^{0.5} - 151 Pr_l^{0.5} + 253 \right]^{4/3} \quad Re_\delta \geq 1800 \quad (10.44)$$

For a particular problem, Equations 10.42 through 10.44 may each be solved for  $Re_\delta$ , yielding three possible values of the Reynolds number. The correct value is the one that lies within the range of application listed with the equation. Once  $Re_\delta$  is known, the average convection coefficient can be found most readily from Equation 10.41.

### EXAMPLE 10.3


The outer surface of a vertical tube, which is 1 m long and has an outer diameter of 80 mm, is exposed to saturated steam at atmospheric pressure and is maintained at 50°C by the flow of cool water through the tube. What is the rate of heat transfer to the coolant, and what is the rate at which steam is condensed at the surface?

### SOLUTION

**Known:** Dimensions and temperature of a vertical tube experiencing condensation of steam at its outer surface.

**Find:** Heat transfer and condensation rates.

**Schematic:**

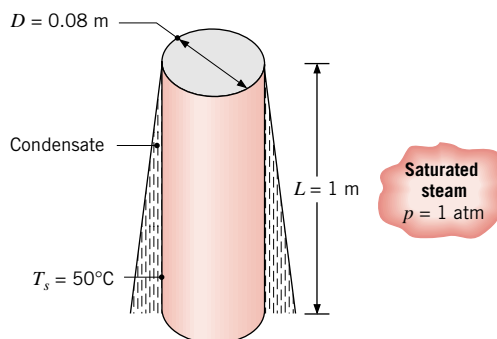

**Assumptions:** The condensate film thickness is small relative to the cylinder diameter.

**Properties:** Table A.6, saturated vapor ( $p = 1.0133 \text{ bars}$ ):  $T_{\text{sat}} = 100^\circ\text{C}$ ,  $\rho_v = (1/v_g) = 0.596 \text{ kg/m}^3$ ,  $h_{fg} = 2257 \text{ kJ/kg}$ . Table A.6, saturated liquid ( $T_f = 75^\circ\text{C}$ ):  $\rho_l = (1/v_f) = 975 \text{ kg/m}^3$ ,  $\mu_l = 375 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ,  $k_l = 0.668 \text{ W/m} \cdot \text{K}$ ,  $c_{p,l} = 4193 \text{ J/kg} \cdot \text{K}$ ,  $\nu_l = \mu_l/\rho_l = 385 \times 10^{-9} \text{ m}^2/\text{s}$ .

**Analysis:** Since we assume the film thickness is small relative to the cylinder diameter, we may use the correlations of Sections 10.7 and 10.8. With

$$Ja = \frac{c_{p,l}(T_{\text{sat}} - T_s)}{h_{fg}} = \frac{4193 \text{ J/kg} \cdot \text{K}(100 - 50) \text{ K}}{2257 \times 10^3 \text{ J/kg}} = 0.0929$$

it follows that

$$h'_{fg} = h_{fg}(1 + 0.68Ja) = 2257 \text{ kJ/kg}(1.0632) = 2400 \text{ kJ/kg}$$

Equations 10.42, 10.43, and 10.44 may each be solved for possible values of  $Re_\delta$ . In particular, Equation 10.43 yields

$$Re_\delta = \left[ \frac{3.70 \times 0.668 \text{ W/m} \cdot \text{K} \times 1 \text{ m} \times (100 - 50) \text{ K}}{375 \times 10^{-6} \text{ N} \cdot \text{s/m}^2 \times 2.4 \times 10^6 \text{ J/kg} \left( \frac{(385 \times 10^{-9} \text{ m}^2/\text{s})^2}{9.8 \text{ m/s}^2} \right)^{1/3}} + 4.8 \right]^{0.82}$$

$$= 1177$$

Since the range of applicability of Equation 10.43 is  $30 \leq Re_\delta \leq 1800$ , the correct Reynolds number is 1177. It follows from Equation 10.41 that

$$\bar{h}_L = \frac{1177 \times 375 \times 10^{-6} \text{ kg/s} \cdot \text{m} \times 2.4 \times 10^6 \text{ J/kg}}{4 \times 1 \text{ m} (100 - 50) \text{ K}} = 5300 \text{ W/m}^2 \cdot \text{K}$$

and from Equations 10.33 and 10.34

$$q = \bar{h}_L(\pi DL)(T_{\text{sat}} - T_s) = 5300 \text{ W/m}^2 \cdot \text{K} \times \pi \times 0.08 \text{ m} \times 1 \text{ m} (100 - 50) \text{ K} = 66.6 \text{ kW}$$

$$\dot{m} = \frac{q}{h'_{fg}} = \frac{66.6 \times 10^3 \text{ W}}{2.4 \times 10^6 \text{ J/kg}} = 0.0276 \text{ kg/s}$$

Note that using Equation 10.26, with the corrected latent heat, the film thickness at the bottom of the tube  $\delta(L)$  for the wave-free laminar assumption is

$$\delta(L) = \left[ \frac{4k_l\mu_l(T_{\text{sat}} - T_s)L}{g\rho_l(\rho_l - \rho_v)h'_{fg}} \right]^{1/4}$$


$$\delta(L) = \left[ \frac{4 \times 0.668 \text{ W/m} \cdot \text{K} \times 375 \times 10^{-6} \text{ kg/s} \cdot \text{m} (100 - 50) \text{ K} \times 1 \text{ m}}{9.8 \text{ m/s}^2 \times 975 \text{ kg/m}^3 (975 - 0.596) \text{ kg/m}^3 \times 2.4 \times 10^6 \text{ J/kg}} \right]^{1/4}$$

$$\delta(L) = 2.18 \times 10^{-4} \text{ m} = 0.218 \text{ mm}$$

Hence  $\delta(L) \ll (D/2)$ , and use of the vertical plate correlation for a vertical cylinder is justified.

### Comments:

1. Equations 10.43 and 10.45 yield Reynolds number values of 910 and 1019, respectively. These Reynolds number values lie outside the ranges of applicability of these equations, and therefore Equations 10.43 and 10.45 are not appropriate for use in this problem.
2. The condensation heat and mass rates may be increased by reducing the temperature of the water flowing through the tube. For  $10 \leq T_s \leq 50^\circ\text{C}$ , the calculations yield the following variations:

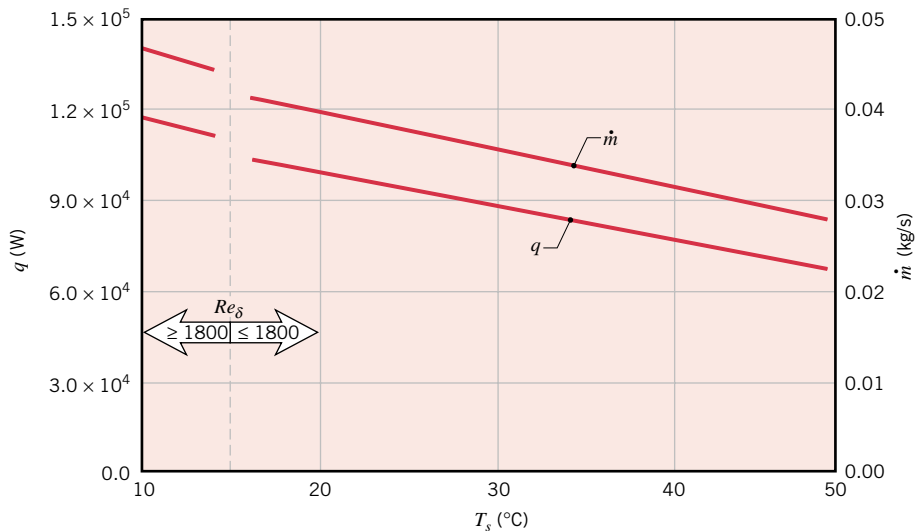


for which  $1969 \geq Re_\delta \geq 1173$  and  $5155 \leq \bar{h}_L \leq 5285 \text{ W/m}^2 \cdot \text{K}$ . Due to an increase in the condensation rate,  $Re_\delta$  increases with decreasing  $T_s$ . However, a corresponding increase in the thickness of the film causes a slight reduction in the average convection coefficient. The foregoing calculations were performed by using the wavy-laminar correlation, Equation 10.39, under conditions for which  $Re_\delta < 1800$  ( $T_s > 15^\circ\text{C}$ ) and the turbulent correlation, Equation 10.40, for  $Re_\delta > 1800$ . Note, however, that the correlations do not provide equivalent results at  $Re_\delta = 1800$ . Moreover, there is a narrow Reynolds number range about 1800 for which values of  $Re_\delta$  computed from Equation 10.39 slightly exceed 1800, while values of  $Re_\delta$  computed from Equation 10.40 are slightly less than 1800.

## 10.9

### Film Condensation on Radial Systems

The Nusselt analysis may be extended to laminar film condensation on the outer surface of a sphere and a horizontal tube (Figures 10.14*a, b*), and the average convection coefficient may be expressed as

$$\bar{h}_D = C \left[ \frac{g\rho_l(\rho_l - \rho_v)k_l^3 h'_{fg}}{\mu_l(T_{\text{sat}} - T_s)D} \right]^{1/4} \quad (10.45)$$

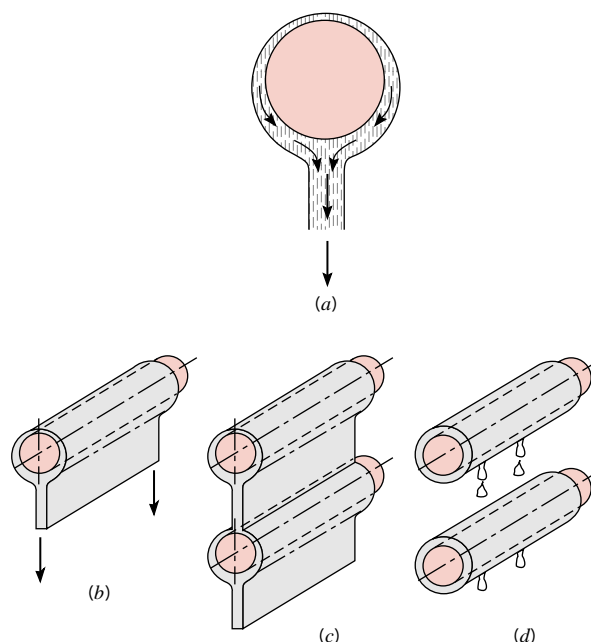

**FIGURE 10.14** Film condensation on (a) a sphere, (b) a single horizontal tube, (c) a vertical tier of horizontal tubes with a continuous condensate sheet, and (d) with dripping condensate.



where  $C = 0.826$  for the sphere [48] and  $0.729$  for the tube [44]. The properties in this equation and the one below are evaluated as explained beneath Equation 10.32.

For a vertical tier of  $N$  horizontal tubes, Figure 10.14c, the average convection coefficient (over the  $N$  tubes) may be expressed as

$$\bar{h}_{D,N} = 0.729 \left[ \frac{g\rho_l(\rho_l - \rho_v)k_l^3 h'_{fg}}{N\mu_l(T_{\text{sat}} - T_s)D} \right]^{1/4} \quad (10.46)$$

That is,  $\bar{h}_{D,N} = \bar{h}_D N^{-1/4}$ , where  $\bar{h}_D$  is the heat transfer coefficient for the first (upper) tube. Such an arrangement is often used in condenser design. The reduction in  $\bar{h}$  with increasing  $N$  may be attributed to an increase in the average film thickness for each successive tube. Equations 10.45 and 10.46 are generally in agreement with or slightly lower than experimental results for pure vapors. Departures may be attributed to ripples in the liquid surface for the single horizontal tube. For the tube bank, it is assumed that the condensate falls in a continuous sheet (Figure 10.14c) and two effects are neglected: heat transfer to the condensate sheet between the tubes and momentum gain as the sheet falls freely under gravity. These effects enhance heat transfer, and Chen [49] has accounted for their influence in terms of the Jakob number and the number of tubes. For  $Ja < 0.1$ , however, heat transfer is enhanced by less than 15%. Despite this correction, experimental results tend to be higher than the predictions. A plausible explanation for the discrepancy is that, rather than flow as a continuous sheet, the condensate drips from tube to tube, as illustrated in Figure 10.14d. Dripping reduces the sheet thickness and promotes turbulence, thereby enhancing heat transfer.

If the length-to-diameter ratio exceeds  $1.8 \tan \theta$  [50], the foregoing equations may be applied to inclined tubes by replacing  $g$  with  $g \cos \theta$ , where the angle  $\theta$  is measured from the horizontal position. In the presence of noncondensable gases, however, the convection coefficient will be less than predictions based on the foregoing correlations.

#### EXAMPLE 10.4


A steam condenser consists of a square array of 400 tubes, each 6 mm in diameter. If the tubes are exposed to saturated steam at a pressure of 0.15 bar and the tube surface temperature is maintained at 25°C, what is the rate at which steam is condensed per unit length of the tubes?

#### SOLUTION

**Known:** Configuration and surface temperature of condenser tubes exposed to saturated steam at 0.15 bar.

**Find:** Condensation rate per unit length of tubes.

**Schematic:**

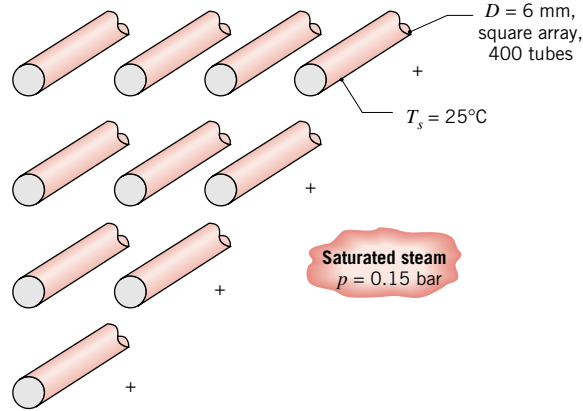

**Assumptions:**

1. Negligible concentration of noncondensable gases in the steam.
2. Laminar film condensation on the tubes.

**Properties:** Table A.6, saturated vapor ( $p = 0.15 \text{ bar}$ ):  $T_{\text{sat}} = 327 \text{ K} = 54^\circ\text{C}$ ,  $\rho_v = (1/v_g) = 0.098 \text{ kg/m}^3$ ,  $h_{fg} = 2373 \text{ kJ/kg}$ . Table A.6, saturated water ( $T_f = 312.5 \text{ K}$ ):  $\rho_l = (1/v_f) = 992 \text{ kg/m}^3$ ,  $\mu_l = 663 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ,  $k_l = 0.631 \text{ W/m} \cdot \text{K}$ ,  $c_{p,l} = 4178 \text{ J/kg} \cdot \text{K}$ .

**Analysis:** The average condensation rate for a single tube of the array may be obtained from Equation 10.34, where for a unit length of the tube,

$$\dot{m}'_1 = \frac{q'_1}{h'_{fg}} = \frac{\bar{h}_{D,N}(\pi D)(T_{\text{sat}} - T_s)}{h'_{fg}}$$

From Equation 10.46

$$\bar{h}_{D,N} = 0.729 \left[ \frac{g\rho_l(\rho_l - \rho_v)k_l^3 h'_{fg}}{N\mu_l(T_{\text{sat}} - T_s)D} \right]^{1/4}$$

or with  $N = 20$ ,  $Ja = 0.051$ , and  $h'_{fg} = 2455 \text{ kJ/kg}$ ,

$$\begin{aligned} \bar{h}_{D,N} &= 0.729 \{ [9.8 \text{ m/s}^2 \times 992 \text{ kg/m}^3 (992 - 0.098) \text{ kg/m}^3 \\ &\quad \times (0.631 \text{ W/m} \cdot \text{K})^3 2.455 \times 10^6 \text{ J/kg}] \\ &\quad \div [20 \times 663 \times 10^{-6} \text{ kg/s} \cdot \text{m} (54 - 25) \text{ K} \times 0.006 \text{ m}] \}^{1/4} \\ \bar{h}_{D,N} &= 5194 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

Hence the average condensation rate for a single tube is

$$\dot{m}'_1 = \frac{5194 \text{ W/m}^2 \cdot \text{K} (\pi \times 0.006 \text{ m}) (54 - 25) \text{ K}}{2.455 \times 10^6 \text{ J/kg}} = 1.16 \times 10^{-3} \text{ kg/s} \cdot \text{m}$$

For the complete array, the condensation rate per unit length is then

$$\dot{m}' = N^2 \dot{m}'_1 = 400 \times 1.16 \times 10^{-3} \text{ kg/s} \cdot \text{m} = 0.464 \text{ kg/s} \cdot \text{m}$$



**Comments:** Since  $Ja < 0.1$ , Equation 10.46 provides a reliable estimate of the average heat transfer coefficient.

## 10.10

### Film Condensation in Horizontal Tubes

Condensers used for refrigeration and air-conditioning systems generally involve vapor condensation inside horizontal or vertical tubes. Conditions within the tube are complicated and depend strongly on the velocity of the vapor flowing through the tube. If this velocity is small, condensation occurs in the manner depicted by Figure 10.15a for a horizontal tube. That is, the condensate flow is from the upper portion of the tube to the bottom, from whence it flows in a longitudinal direction with the vapor. For low vapor velocities such that

$$Re_{v,i} = \left( \frac{\rho_v u_{m,v} D}{\mu_v} \right)_i < 35,000$$

where  $i$  refers to the tube inlet, Chato [51] recommends an expression of the form


$$\bar{h}_D = 0.555 \left[ \frac{g \rho_l (\rho_l - \rho_v) k_l^3 h'_{fg}}{\mu_l (T_{\text{sat}} - T_s) D} \right]^{1/4} \quad (10.47)$$

where, for this case, the modified latent heat is

$$h'_{fg} = h_{fg} + \frac{3}{8} c_{p,l} (T_{\text{sat}} - T_s) \quad (10.48)$$

The properties in these equations are evaluated as explained beneath Equation 10.32.

At higher vapor velocities the two-phase flow regime becomes annular (Figure 10.15b). The vapor occupies the core of the annulus, diminishing in diameter as the thickness of the outer condensate layer increases in the flow direction. Results for this flow condition are provided by Marto [52].

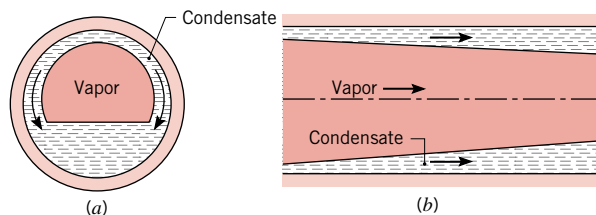

**FIGURE 10.15** Film condensation in a horizontal tube.  
(a) Cross section of condensate flow for low vapor velocities.  
(b) Longitudinal section of condensate flow for large vapor velocities.

## 10.11

### Dropwise Condensation

---

Typically, heat transfer coefficients for dropwise condensation are an order of magnitude larger than those for film condensation. In fact, in heat exchanger applications for which dropwise condensation is promoted, other thermal resistances may be significantly larger than that due to condensation and, therefore, reliable correlations for the condensation process are not needed.

Of the many surface–fluid systems studied [53], most of the data are for steam condensation on well-promoted copper surfaces—that is, surfaces for which wetting is inhibited—and are correlated by an expression of the form [54]

$$\bar{h}_{dc} = 51,104 + 2044T_{sat}(\text{°C}) \quad 22\text{°C} \leq T_{sat} \leq 100\text{°C} \quad (10.49)$$

$$\bar{h}_{dc} = 255,510 \quad 100\text{°C} \leq T_{sat} \quad (10.50)$$

where the heat transfer coefficient has units of ( $\text{W}/\text{m}^2 \cdot \text{K}$ ). The heat transfer rate and condensation rate can be calculated from Equations 10.33 and 10.34, where  $h'_{fg}$  is given by Equation 10.27, and properties are evaluated as explained beneath Equation 10.32. The effect of subcooling,  $T_{sat} - T_s$ , on  $\bar{h}_{dc}$  is small and may be neglected.

The effect of noncondensable vapors in the steam can be very important and has been studied by Shade and Mikic [55]. In addition, if the condensing surface material does not conduct as well as copper or silver, its thermal resistance becomes a factor. Since all the heat is transferred to the drops, which are very small and widely distributed over the surface, heat flow lines within the surface material near the active areas of condensation will *crowd*, inducing a *constriction* resistance. This effect has been studied by Hannemann and Mikic [56].

## 10.12

### Summary

---

It is apparent that boiling and condensation are complicated processes for which the existence of generalized relations is somewhat limited. This chapter identifies the essential physical features of the processes and presents correlations suitable for approximate engineering calculations. However, a great deal of additional information is available, and much of it has been summarized in several extensive reviews of the subject [7, 15, 25, 30–33, 52, 54, 56–61].

You may test your understanding of heat transfer with phase change by addressing the following questions.

- What is *pool boiling*? *Forced convection boiling*? *Subcooled boiling*? *Saturated boiling*?
- How is the *excess temperature* defined?
- Sketch the *boiling curve* and identify key regimes and features. What is the *critical heat flux*? What is the *Leidenfrost point*? How does progression along the boiling curve occur if the surface heat flux is controlled? What is the nature

of the hysteresis effect? How does progression along the boiling curve occur if the surface temperature is controlled?

- How does heat flux depend on the excess temperature in the *nucleate boiling* regime?
- What modes of heat transfer are associated with *film boiling*?
- How is the amount of liquid *subcooling* defined?
- To what extent is the boiling heat flux influenced by the magnitude of the gravitational field, liquid subcooling, and surface roughness?
- How do two-phase flow and heat transfer in microchannels differ from two-phase flow and heat transfer in larger tubes?
- How does *dropwise condensation* differ from *film condensation*? Which mode of condensation is characterized by larger heat transfer rates?
- For laminar film condensation on a vertical surface, how do the local and average convection coefficients vary with distance from the leading edge?
- How is the Reynolds number defined for film condensation on a vertical surface? What are the corresponding flow regimes?

## References

1. Fox, R. W., A. T. McDonald, and P. J. Pritchard, *Introduction to Fluid Mechanics*, 6th ed. Wiley, New York, 2003.
2. Nukiyama, S., *J. Japan Soc. Mech. Eng.*, **37**, 367, 1934 (Translation: *Int. J. Heat Mass Transfer*, **9**, 1419, 1966).
3. Drew, T. B., and C. Mueller, *Trans. AIChE*, **33**, 449, 1937.
4. Yamagata, K., F. Kirano, K. Nishiwaka, and H. Mat-suoka, *Mem. Fac. Eng. Kyushu*, **15**, 98, 1955.
5. Rohsenow, W. M., *Trans. ASME*, **74**, 969, 1952.
6. Vachon, R. I., G. H. Nix, and G. E. Tanger, *J. Heat Transfer*, **90**, 239, 1968.
7. Collier, J. G., and J. R. Thome, *Convective Boiling and Condensation*, 3rd ed., Oxford University Press, New York, 1996.
8. Pioro I. L., *Int. J. Heat Mass Transfer*, **42**, 2003, 1999.
9. Kutateladze, S. S., *Kotloturbostroenie*, **3**, 10, 1948.
10. Zuber, N., *Trans. ASME*, **80**, 711, 1958.
11. Lienhard, J. H., *A Heat Transfer Textbook*, 2nd ed., Prentice-Hall, Englewood Cliffs, NJ, 1987.
12. Nakayama, W., A. Yabe, P. Kew, K. Cornwell, S. G. Kandlikar, and V. K. Dhir, in S. G. Kandlikar, M. Shoji, and V. K. Dhir, Eds., *Handbook of Phase Change: Boiling and Condensation*, Chap. 16, Taylor & Francis, New York, 1999.
13. Cichelli, M. T., and C. F. Bonilla, *Trans. AIChE*, **41**, 755, 1945.
14. Berenson, P. J., *J. Heat Transfer*, **83**, 351, 1961.
15. Hahne, E., and U. Grigull, *Heat Transfer in Boiling*, Hemisphere/Academic Press, New York, 1977.
16. Lienhard, J. H., and P. T. Y. Wong, *J. Heat Transfer*, **86**, 220, 1964.
17. Bromley, L. A., *Chem. Eng. Prog.*, **46**, 221, 1950.
18. Sadasivan, P., and J. H. Lienhard, *J. Heat Transfer*, **109**, 545, 1987.
19. Siegel, R., *Adv. Heat Transfer*, **4**, 143, 1967.
20. Berensen, P. J., *Int. J. Heat Mass Transfer*, **5**, 985, 1962.
21. Webb, R. L., *Heat Transfer Eng.*, **2**, 46, 1981, and *Heat Transfer Eng.*, **4**, 71, 1983.
22. Bergles, A. E., "Enhancement of Heat Transfer," *Heat Transfer 1978*, Vol. 6, pp. 89–108, Hemisphere Publishing, New York, 1978.
23. Bergles, A. E., in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.7.9, Begell House, New York, 2002.
24. Bergles, A. E., and W. H. Rohsenow, *J. Heat Transfer*, **86**, 365, 1964.
25. van Stralen, S., and R. Cole, *Boiling Phenomena*, McGraw-Hill/Hemisphere, New York, 1979.
26. Lienhard, J. H., and R. Eichhorn, *Int. J. Heat Mass Transfer*, **19**, 1135, 1976.
27. Kandlikar, S. G., *J. Heat Transfer*, **112**, 219, 1990.
28. Kandlikar, S. G., and H. Nariyai, in S. G. Kandlikar, M. Shoji, and V. K. Dhir, Eds., *Handbook of Phase Change: Boiling and Condensation*, Chap. 15, Taylor & Francis, New York, 1999.

29. Celata, G. P., and A. Mariani, in S. G. Kandlikar, M. Shoji, and V. K. Dhir, Eds., *Handbook of Phase Change: Boiling and Condensation*, Chap. 17, Taylor & Francis, New York, 1999.
30. Tong, L. S., and Y. S. Tang, *Boiling Heat Transfer and Two Phase Flow*, 2nd ed., Taylor & Francis, New York, 1997.
31. Rohsenow, W. M., in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, Chap. 13, McGraw-Hill, New York, 1973.
32. Griffith, P., in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, Chap. 14, McGraw-Hill, New York, 1973.
33. Ginoux, J. N., *Two-Phase Flow and Heat Transfer*, McGraw-Hill/Hemisphere, New York, 1978.
34. Hall, D. D., and I. Mudawar, *Int. J. Heat Mass Transfer*, **43**, 2573, 2000.
35. Hall, D. D., and I. Mudawar, *Int. J. Heat Mass Transfer*, **43**, 2605, 2000.
36. Qu, W., and I. Mudawar, *Int. J. Heat Mass Transfer*, **46**, 2755, 2003.
37. Ghiaasiaan, S. M., and S. I. Abdel-Khalik, in J. P. Hartnett, T. F. Irvine, Y. I. Cho, and G. A. Greene, Eds., *Advances in Heat Transfer*, Vol. 34, Academic Press, New York, 2001.
38. Qu, W., and I. Mudawar, *Int. J. Heat Mass Transfer*, **46**, 2773, 2003.
39. Sparrow, E. M., and J. L. Gregg, *J. Heat Transfer*, **81**, 13, 1959.
40. Koh, J. C. Y., E. M. Sparrow, and J. P. Hartnett, *Int. J. Heat Mass Transfer*, **2**, 69, 1961.
41. Nusselt, W., *Z. Ver. Deut. Ing.*, **60**, 541, 1916.
42. Rohsenow, W. M., *Trans. ASME*, **78**, 1645, 1956.
43. Chen, M. M., *J. Heat Transfer*, **83**, 48, 1961.
44. Dhir, V. K., and J. H. Lienhard, *J. Heat Transfer*, **93**, 97, 1971.
45. Kutateladze, S. S., *Fundamentals of Heat Transfer*, Academic Press, New York, 1963.
46. Labuntsov, D. A., *Teplotenergetika*, **4**, 72, 1957.
47. Gregorig, R., J. Kern, and K. Turek, *Wärme Stoffübertrag.*, **7**, 1, 1974.
48. Popiel, Cz. O., and L. Boguslawski, *Int. J. Heat Mass Transfer*, **18**, 1486, 1975.
49. Chen, M. M., *J. Heat Transfer*, **83**, 55, 1961.
50. Selin, G., "Heat Transfer by Condensing Pure Vapours Outside Inclined Tubes," *International Developments in Heat Transfer*, Part 2, International Heat Transfer Conference, University of Colorado, pp. 278–289, ASME, New York, 1961.
51. Chato, J. C., *J. ASHRAE*, **4**, 52, 1962.
52. Marto, P. J., in W. M. Rohsenow, J. P. Hartnett, and Y. I. Cho, Eds., *Handbook of Heat Transfer*, 3rd ed., Chap. 14, McGraw-Hill, New York, 1998.
53. Tanner, D. W., D. Pope, C. J. Potter, and D. West, *Int. J. Heat Mass Transfer*, **11**, 181, 1968.
54. Griffith, P., in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.6.5, Hemisphere Publishing, New York, 1990.
55. Shade, R., and B. Mikic, "The Effects of Non-condensable Gases on Heat Transfer During Dropwise Condensation," Paper 67b presented at the 67th Annual Meeting of the American Institute of Chemical Engineers, Washington, DC, 1974.
56. Hannemann, R., and B. Mikic, *Int. J. Heat Mass Transfer*, **19**, 1309, 1976.
57. Collier, J. G., and V. Wadekar, in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.7.2, Begell House, New York, 2002.
58. Butterworth, D., in D. Butterworth and G. F. Hewitt, Eds., *Two-Phase Flow and Heat Transfer*, Oxford University Press, London, 1977, pp. 426–462.
59. McNaught, J., and D. Butterworth, in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 2.6.2, Begell House, New York, 2002.
60. Rose, J. W., *Int. J. Heat Mass Transfer*, **24**, 191, 1981.
61. Pioro, L. S., and I. L. Pioro, *Industrial Two-Phase Thermosyphons*, Begell House, New York, 1997.

## Problems

### General Considerations

- 10.1** Show that, for water at 1-atm pressure with  $T_s - T_{\text{sat}} = 10^\circ\text{C}$ , the Jakob number is much less than unity. What is the physical significance of this result? Verify that this conclusion applies to other fluids.

- 10.2** The surface of a horizontal, 20-mm-diameter cylinder is maintained at an excess temperature of  $5^\circ\text{C}$  in saturated water at 1 atm. Estimate the heat flux using the appropriate free convection correlation and compare your result with the boiling curve of Figure 10.4. For nucleate boiling, estimate the

maximum value of the heat transfer coefficient from the boiling curve.

- 10.3** The role of surface tension in bubble formation can be demonstrated by considering a spherical bubble of pure saturated vapor in *mechanical* and *thermal* equilibrium with its superheated liquid.

- (a) Beginning with an appropriate free-body diagram of the bubble, perform a force balance to obtain an expression of the bubble radius,

$$r_b = \frac{2\sigma}{p_{\text{sat}} - p_l}$$

where  $p_{\text{sat}}$  is the pressure of the saturated vapor and  $p_l$  is the pressure of the superheated liquid outside the bubble.

- (b) On a  $p$ - $v$  diagram, represent the bubble and liquid states. Discuss what changes in these conditions will cause the bubble to grow or collapse.
- (c) Calculate the bubble size under equilibrium conditions for which the vapor is saturated at  $101^\circ\text{C}$  and the liquid pressure corresponds to a saturation temperature of  $100^\circ\text{C}$ .

### Nucleate Boiling and Critical Heat Flux

- 10.4** A long, 1-mm-diameter wire passes an electrical current dissipating  $3150\text{ W/m}$  and reaches a surface temperature of  $126^\circ\text{C}$  when submerged in water at 1 atm. What is the boiling heat transfer coefficient? Estimate the value of the correlation coefficient  $C_{s,f}$ .

- 10.5** Estimate the nucleate pool boiling heat transfer coefficient for water boiling at atmospheric pressure on the outer surface of a platinum-plated 10-mm-diameter tube maintained  $10^\circ\text{C}$  above the saturation temperature.

- 10.6** Plot the nucleate boiling heat flux for saturated water at atmospheric pressure on a large, horizontal polished copper plate, over the excess temperature range  $5^\circ\text{C} \leq \Delta T_e \leq 30^\circ\text{C}$ . Compare your results with Figure 10.4. Also find the excess temperature corresponding to the critical heat flux.

- 10.7** A simple expression to account for the effect of pressure on the nucleate boiling convection coefficient in water ( $\text{W/m}^2 \cdot \text{K}$ ) is

$$h = C(\Delta T_e)^n \left( \frac{p}{p_a} \right)^{0.4}$$

where  $p$  and  $p_a$  are the system pressure and standard atmospheric pressure, respectively. For a horizontal plate and the range  $15 < q'' < 235\text{ kW/m}^2$ ,  $C = 5.56$

and  $n = 3$ . Units of  $\Delta T_e$  are kelvins. Compare predictions from this expression with the Rohsenow correlation ( $C_{s,f} = 0.013$ ,  $n = 1$ ) for pressures of 2 and 5 bars with  $\Delta T_e = 10^\circ\text{C}$ .


- 10.8** In Example 10.1 we considered conditions for which vigorous boiling occurs in a pan of water, and we determined the electric power (heat rate) required to maintain a prescribed temperature for the bottom of the pan. However, the electric power is, in fact, the control (independent) variable, from which the temperature of the pan follows.

- (a) For nucleate boiling in the copper pan of Example 10.1, compute and plot the temperature of the pan as a function of the heat rate for  $1 \leq q \leq 100\text{ kW}$ .
- (b) If the water is initially at room temperature, it must, of course, be heated for a period of time before it will boil. Consider conditions shortly after heating is initiated and the water is at  $20^\circ\text{C}$ . Estimate the temperature of the pan bottom for a heat rate of  $8\text{ kW}$ .

- 10.9** Calculate the critical heat flux on a large horizontal surface for the following fluids at 1 atm: mercury, ethanol, and refrigerant R-134a. Compare these results to the critical heat flux for water at 1 atm.

- 10.10** The bottom of a copper pan, 150 mm in diameter, is maintained at  $115^\circ\text{C}$  by the heating element of an electric range. Estimate the power required to boil the water in this pan. Determine the evaporation rate. What is the ratio of the surface heat flux to the critical heat flux? What pan temperature is required to achieve the critical heat flux?

- 10.11** A nickel-coated heater element with a thickness of 15 mm and a thermal conductivity of  $50\text{ W/m} \cdot \text{K}$  is exposed to saturated water at atmospheric pressure. A thermocouple is attached to the back surface, which is well insulated. Measurements at a particular operating condition yield an electrical power dissipation in the heater element of  $6.950 \times 10^7\text{ W/m}^3$  and a temperature of  $T_o = 266.4^\circ\text{C}$ .

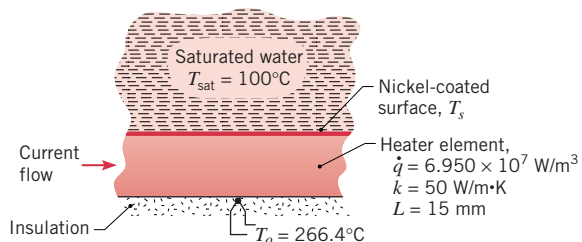

- (a) From the foregoing data, calculate the surface temperature,  $T_s$ , and the heat flux at the exposed surface.



- (b) Using the surface heat flux determined in part (a), estimate the surface temperature by applying an appropriate boiling correlation.

**10.12** Advances in very large scale integration (VLSI) of electronic devices on a chip are often restricted by the ability to cool the chip. For mainframe computers, an array of several hundred chips, each of area  $25 \text{ mm}^2$ , may be mounted on a ceramic substrate. A method of cooling the array is by immersion in a low boiling point fluid such as refrigerant R-134a. At 1 atm and 247 K, properties of the saturated liquid are  $\mu = 1.46 \times 10^{-4} \text{ N} \cdot \text{s/m}^2$ ,  $c_p = 1551 \text{ J/kg} \cdot \text{K}$ , and  $Pr = 3.2$ . Assume values of  $C_{s,f} = 0.004$  and  $n = 1.7$ .

- (a) Estimate the power dissipated by a single chip if it is operating at 50% of the critical heat flux. What is the corresponding value of the chip temperature?

- (b) Compute and plot the chip temperature as a function of surface heat flux for  $0.25 \leq q''/q''_{\max} \leq 0.90$ .


**10.13** Saturated ethylene glycol at 1 atm is heated by a horizontal chromium-plated surface which has a diameter of 200 mm and is maintained at 480 K. Estimate the heating power requirement and the rate of evaporation. What fraction is the power requirement of the maximum power associated with the critical heat flux? At 470 K, properties of the saturated liquid are  $\mu = 0.38 \times 10^{-3} \text{ N} \cdot \text{s/m}^2$ ,  $c_p = 3280 \text{ J/kg} \cdot \text{K}$ , and  $Pr = 8.7$ . The saturated vapor density is  $\rho = 1.66 \text{ kg/m}^3$ . Assume nucleate boiling constants of  $C_{s,f} = 0.01$  and  $n = 1.0$ .

**10.14** Copper tubes 25 mm in diameter and 0.75 m long are used to boil saturated water at 1 atm.

- (a) If the tubes are operated at 75% of the critical heat flux, how many tubes are needed to provide a vapor production rate of 750 kg/h? What is the corresponding tube surface temperature?

- (b) Compute and plot the tube surface temperature as a function of heat flux for  $0.25 \leq q''/q''_{\max} \leq 0.90$ . On the same graph, plot the corresponding number of tubes needed to provide the prescribed vapor production rate.

**10.15** Consider a gas-fired boiler in which five coiled, thin-walled, copper tubes of 25-mm diameter and 8-m length are submerged in pressurized water at 4.37 bars. The walls of the tubes are polished and may be assumed to be isothermal. Combustion gases enter each of the tubes at a temperature of  $T_{m,i} = 700^\circ\text{C}$  and a flow rate of  $\dot{m} = 0.08 \text{ kg/s}$ , respectively.

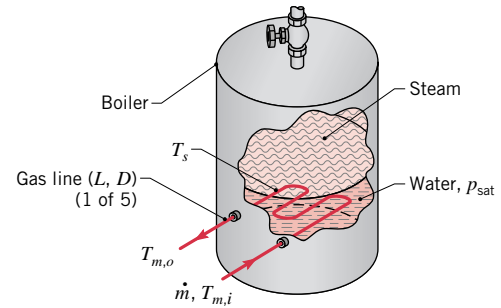

Determine the tube wall temperature  $T_s$  and the gas outlet temperature  $T_{m,o}$  for the prescribed conditions. As a first approximation, the properties of the combustion gases may be taken as those of air at 700 K.

**10.16** Estimate the current at which a 1-mm-diameter nickel wire will burn out when submerged in water at atmospheric pressure. The electrical resistance of the wire is  $0.129 \Omega/\text{m}$ .

**10.17** Estimate the power ( $\text{W/m}^2$ ) required to maintain a brass plate at  $\Delta T_e = 15^\circ\text{C}$  while boiling saturated water at 1 atm. What is the power requirement if the water is pressurized to 10 atm? At what fraction of the critical heat flux is the plate operating?

**10.18** It has been demonstrated experimentally that the critical heat flux is highly dependent on pressure, primarily through the pressure dependence of the fluid surface tension and latent heat of vaporization. Using Equation 10.6, calculate values of  $q''_{\max}$  for water on a large horizontal surface as a function of pressure. Demonstrate that the peak critical heat flux occurs at approximately one-third the critical pressure ( $p_c = 221 \text{ bars}$ ). Since all common fluids have this characteristic, suggest what coordinates should be used to plot critical heat flux–pressure values to obtain a universal curve.

**10.19** In applying dimensional analysis, Kutateladze [9] postulated that the critical heat flux varies with the heat of vaporization, vapor density, surface tension, and the bubble diameter parameter given in Equation 10.4a. Verify that dimensional analysis would yield the following expression for the critical heat flux:

$$q''_{\max} = Ch_{fg}\rho_v^{1/2}D_b^{-1/2}\sigma^{1/2}$$

**10.20** A dielectric fluid at atmospheric pressure is heated with a 0.5-mm-diameter, horizontal platinum wire. Determine the temperature of the wire when the wire is heated at 50% of the critical heat flux. The properties of the fluid are  $c_{p,l} = 1300 \text{ J/kg} \cdot \text{K}$ ,  $h_{fg} = 142 \text{ kJ/kg}$ ,




$k_l = 0.075 \text{ W/m} \cdot \text{K}$ ,  $\nu_l = 0.32 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $\rho_l = 1400 \text{ kg/m}^3$ ,  $\rho_v = 7.2 \text{ kg/m}^3$ ,  $\sigma = 12.4 \times 10^{-3} \text{ N/m}$ ,  $T_{\text{sat}} = 34^\circ\text{C}$ . Assume the nucleate boiling constants are  $C_{s,f} = 0.005$  and  $n = 1.7$ . For small horizontal cylinders, the critical heat flux is found by multiplying the value associated with large horizontal cylinders by a correction factor  $F$ , where  $F = 0.89 + 2.27 \exp(-3.44Co^{-1/2})$ . The Confinement number is based on the radius of the cylinder, and the range of applicability for the correction factor is  $1.3 \lesssim Co \lesssim 6.7$  [11].

**10.21** What is the critical heat flux for boiling water at 1 atm on a large horizontal surface on the surface of the moon, where the gravitational acceleration is one-sixth that of the earth?

**10.22** A heater for boiling a saturated liquid consists of two concentric stainless steel tubes packed with dense boron nitride powder. Electrical current is passed through the inner tube, creating uniform volumetric heating  $\dot{q}$  ( $\text{W/m}^3$ ). The exposed surface of the outer tube is in contact with the liquid and the boiling heat flux is given as

$$q''_s = C(T_s - T_{\text{sat}})^3$$

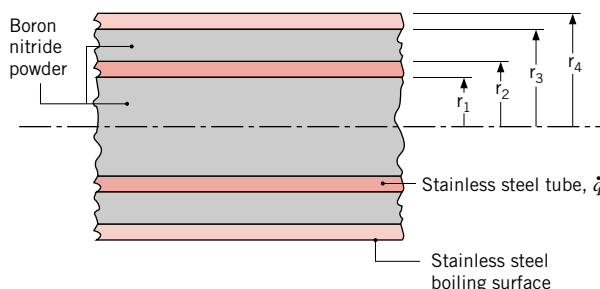


It is feared that under high-power operation the stainless steel tubes would severely oxidize if temperatures exceed  $T_{\text{ss},x}$  or that the boron nitride would deteriorate if its temperature exceeds  $T_{\text{bn},x}$ . Presuming that the saturation temperature of the liquid ( $T_{\text{sat}}$ ) and the boiling surface temperature ( $T_s$ ) are prescribed, derive expressions for the maximum temperatures in the stainless steel (ss) tubes and in the boron nitride (bn). Express your results in terms of geometric parameters ( $r_1$ ,  $r_2$ ,  $r_3$ ,  $r_4$ ), thermal conductivities ( $k_{\text{ss}}$ ,  $k_{\text{bn}}$ ), and the boiling parameters ( $C$ ,  $T_{\text{sat}}$ ,  $T_s$ ).

**10.23** A silicon chip of thickness  $L = 2.5 \text{ mm}$  and thermal conductivity  $k_s = 135 \text{ W/m} \cdot \text{K}$  is cooled by boiling a saturated fluorocarbon liquid ( $T_{\text{sat}} = 57^\circ\text{C}$ ) on its surface. The electronic circuits on the bottom of the chip produce a uniform heat flux of  $q''_o = 5 \times 10^4 \text{ W/m}^2$ , while the sides of the chip are perfectly insulated.

Properties of the saturated fluorocarbon are  $c_{p,l} = 1100 \text{ J/kg} \cdot \text{K}$ ,  $h_{fg} = 84,400 \text{ J/kg}$ ,  $\rho_l = 1619.2 \text{ kg/m}^3$ ,


$\rho_v = 13.4 \text{ kg/m}^3$ ,  $\sigma = 8.1 \times 10^{-3} \text{ kg/s}^2$ ,  $\mu_l = 440 \times 10^{-6} \text{ kg/m} \cdot \text{s}$ , and  $Pr_l = 9.01$ . In addition, the nucleate boiling constants are  $C_{s,f} = 0.005$  and  $n = 1.7$ .

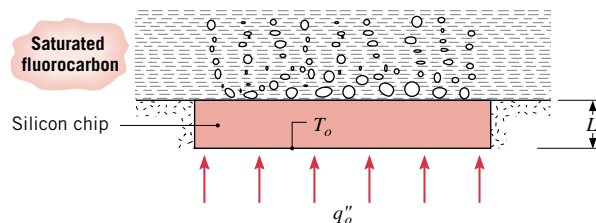

(a) What is the steady-state temperature  $T_o$  at the bottom of the chip? If, during testing of the chip,  $q''_o$  is increased to 90% of the critical heat flux, what is the new steady-state value of  $T_o$ ?

(b) Compute and plot the chip surface temperatures (top and bottom) as a function of heat flux for  $0.20 \leq q''_o/q''_{\text{max}} \leq 0.90$ . If the maximum allowable chip temperature is  $80^\circ\text{C}$ , what is the maximum allowable value of  $q''_o$ ?

**10.24** A device for performing boiling experiments consists of a copper bar ( $k = 400 \text{ W/m} \cdot \text{K}$ ), which is exposed to a boiling liquid at one end, encapsulates an electrical heater at the other end, and is well insulated from its surroundings at all but the exposed surface. Thermocouples inserted in the bar are used to measure temperatures at distances of  $x_1 = 10 \text{ mm}$  and  $x_2 = 25 \text{ mm}$  from the surface.

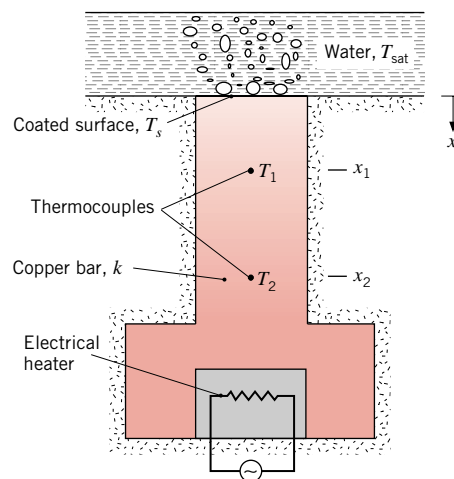

(a) An experiment is performed to determine the boiling characteristics of a special coating applied to the exposed surface. Under steady-state conditions, nucleate boiling is maintained in saturated water at

atmospheric pressure, and values of  $T_1 = 133.7^\circ\text{C}$  and  $T_2 = 158.6^\circ\text{C}$  are recorded. If  $n = 1$ , what value of the coefficient  $C_{s,f}$  is associated with the Rohsenow correlation?

- (b) Assuming applicability of the Rohsenow correlation with the value of  $C_{s,f}$  determined from part (a), compute and plot the excess temperature  $\Delta T_e$  as a function of the boiling heat flux for  $10^5 \leq q_s'' \leq 10^6 \text{ W/m}^2$ . What are the corresponding values of  $T_1$  and  $T_2$  for  $q_s'' = 10^6 \text{ W/m}^2$ ? If  $q_s''$  were increased to  $1.5 \times 10^6 \text{ W/m}^2$ , could the foregoing results be extrapolated to infer the corresponding values of  $\Delta T_e$ ,  $T_1$ , and  $T_2$ ?

### Minimum Heat Flux and Film Boiling

**10.25** A small copper sphere, initially at a uniform, elevated temperature  $T(0) = T_i$ , is suddenly immersed in a large fluid bath maintained at  $T_{\text{sat}}$ . The initial temperature of the sphere exceeds the Leidenfrost point corresponding to the temperature  $T_D$  of Figure 10.4.

- (a) Sketch the variation of the average sphere temperature,  $\bar{T}(t)$ , with time during the quenching process. Indicate on this sketch the temperatures  $T_i$ ,  $T_D$ , and  $T_{\text{sat}}$ , as well as the regimes of film, transition, and nucleate boiling and the regime of single-phase convection. Identify key features of the temperature history.
- (b) At what time(s) in this cooling process do you expect the surface temperature of the sphere to deviate most from its center temperature? Explain your answer.

**10.26** A sphere made of aluminum alloy 2024 with a diameter of 20 mm and a uniform temperature of  $500^\circ\text{C}$  is suddenly immersed in a saturated water bath maintained at atmospheric pressure. The surface of the sphere has an emissivity of 0.25.

- (a) Calculate the total heat transfer coefficient for the initial condition. What fraction of the total coefficient is contributed by radiation?
- (b) Estimate the temperature of the sphere 30 s after it is immersed in the bath.

**10.27** A steel bar, 20 mm in diameter and 200 mm long, with an emissivity of 0.9, is removed from a furnace at  $455^\circ\text{C}$  and suddenly submerged horizontally in a water bath under atmospheric pressure. Estimate the initial heat transfer rate from the bar.

**10.28** Electrical current passes through a horizontal, 2-mm-diameter conductor of emissivity 0.5 when immersed in water under atmospheric pressure.

- (a) Estimate the power dissipation per unit length of the conductor required to maintain the surface temperature at  $555^\circ\text{C}$ .

- (b) For conductor diameters of 1.5, 2.0, and 2.5 mm, compute and plot the power dissipation per unit length as a function of surface temperature for  $250 \leq T_s \leq 650^\circ\text{C}$ . On a separate figure, plot the percentage contribution of radiation as a function of  $T_s$ .

**10.29** Consider a horizontal,  $D = 1\text{-mm}$ -diameter platinum wire suspended in saturated water at atmospheric pressure. The wire is heated by an electrical current. Determine the heat flux from the wire at the instant when the surface of the wire reaches its melting point. Determine the corresponding centerline temperature of the wire. Due to oxidation at very high temperature, the wire emissivity is  $\varepsilon = 0.80$  when it burns out. The water vapor properties at the film temperature of  $1209 \text{ K}$  are  $\rho_v = 0.189 \text{ kg/m}^3$ ,  $c_{p,v} = 2404 \text{ J/kg} \cdot \text{K}$ ,  $\nu_v = 231 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k_v = 0.113 \text{ W/m} \cdot \text{K}$ .


**10.30** A heater element of 5-mm diameter is maintained at a surface temperature of  $350^\circ\text{C}$  when immersed horizontally in water under atmospheric pressure. The element sheath is stainless steel with a mechanically polished finish having an emissivity of 0.25.

- (a) Calculate the electrical power dissipation and the rate of vapor production per unit heater length.
- (b) If the heater were operated at the same power dissipation rate in the nucleate boiling regime, what temperature would the surface achieve? Calculate the rate of vapor production per unit length for this operating condition.
- (c) Sketch the boiling curve and represent the two operating conditions of parts (a) and (b). Compare the results of your analysis. If the heater element is operated in the power-controlled mode, explain how you would achieve these two operating conditions beginning with a cold element.

**10.31** The thermal energy generated by a silicon chip increases in proportion to its clock speed. The silicon chip of Problem 10.23 is designed to operate in the nucleate boiling regime at approximately 30% of the critical heat flux. A sudden surge in the chip's clock speed triggers film boiling, after which the clock speed and power dissipation return to their design values.

- (a) In which boiling regime does the chip operate after the power dissipation returns to its design value?
- (b) To return to the nucleate boiling regime, how much must the clock speed be reduced relative to the design value?

- 10.32** A cylinder of 120-mm diameter at 1000 K is quenched in saturated water at 1 atm. Describe the quenching process and estimate the maximum heat removal rate per unit length during the process.
- 10.33** A 1-mm-diameter horizontal platinum wire of emissivity  $\varepsilon = 0.25$  is operated in saturated water at 1-atm pressure.
- What is the surface heat flux if the surface temperature is  $T_s = 800$  K?
  - For emissivities of 0.1, 0.25, and 0.95, generate a log-log plot of the heat flux as a function of surface excess temperature,  $\Delta T_e \equiv T_s - T_{\text{sat}}$ , for  $150 \leq \Delta T_e \leq 550$  K. Show the critical heat flux and the Leidenfrost point on your plot. Separately, plot the percentage contribution of radiation to the total heat flux for  $150 \leq \Delta T_e \leq 550$  K.
- 10.34** As strip steel leaves the last set of rollers in a hot rolling mill, it is quenched by planar water jets before being coiled. Due to the large plate temperatures, film boiling is achieved shortly downstream of the jet impingement region.

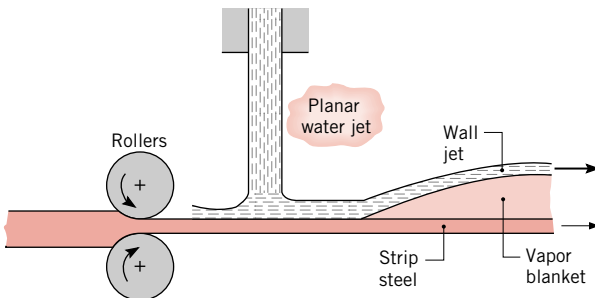

Consider conditions for which the strip steel beneath the vapor blanket is at a temperature of 907 K and has an emissivity of 0.35. Neglecting the effects of the strip and jet motions and assuming boiling within the film to be approximated by that associated with a large horizontal cylinder of 1-m diameter, estimate the rate of heat transfer per unit surface area from the strip to the wall jet.

- 10.35** A copper sphere of 10-mm diameter, initially at a prescribed elevated temperature  $T_i$ , is quenched in a saturated (1 atm) water bath. Using the lumped capacitance method, estimate the time for the sphere to cool (a) from  $T_i = 130^\circ\text{C}$  to  $110^\circ\text{C}$  and (b) from  $T_i = 550^\circ\text{C}$  to  $220^\circ\text{C}$ . Plot the temperature history for each quenching process.

### Forced Convection Boiling

- 10.36** A tube of 2-mm diameter is used to heat saturated water at 1 atm, which is in cross flow over the tube.

Calculate and plot the critical heat flux as a function of water velocity over the range 0 to 2 m/s. On your plot, identify the pool boiling region and the transition region between the low- and high-velocity ranges. *Hint:* Problem 10.20 contains relevant information for pool boiling on small-diameter cylinders.

- 10.37** Saturated water at 1 atm and velocity 2 m/s flows over a cylindrical heating element of diameter 5 mm. What is the maximum heating rate (W/m) for nucleate boiling?
- 10.38** A vertical steel tube carries water at a pressure of 10 bars. Saturated liquid water is pumped into the  $D = 0.1$  m diameter tube at its bottom end ( $x = 0$ ) with a mean velocity of  $u_m = 0.05$  m/s. The tube is exposed to combusting pulverized coal, providing a uniform heat flux of  $q'' = 100,000$  W/m<sup>2</sup>.
- Determine the tube wall temperature and the quality of the flowing water at  $x = 15$  m. Assume  $G_{s,f} = 1$ .
  - Determine the tube wall temperature at a location beyond  $x = 15$  m where single-phase flow of the vapor exists at a mean temperature of  $T_{\text{sat}}$ . Assume the vapor at this location is also at a pressure of 10 bars.
- (c) Plot the tube wall temperature in the range  $-5 \text{ m} \leq x \leq 30 \text{ m}$ .


- 10.39** Consider refrigerant R-134a flowing in a smooth, horizontal, 10-mm-inner-diameter tube of wall thickness 2 mm. The refrigerant is at a saturation temperature of  $15^\circ\text{C}$  (for which  $\rho_{v,\text{sat}} = 23.75$  kg/m<sup>3</sup>) and flows at a rate of 0.01 kg/s. Determine the maximum wall temperature associated with a heat flux of  $10^5$  W/m<sup>2</sup> at the inner wall at a location 0.4 m downstream from the onset of boiling for tubes fabricated of (a) pure copper and (b) AISI 316 stainless steel.

- 10.40** Determine the tube diameter associated with  $p = 1$  atm and a critical Confinement number of 0.5 for ethanol, mercury, water, R-134a, and the dielectric fluid of Problem 10.23.

### Film Condensation

- 10.41** Saturated steam at 0.1 bar condenses with a convection coefficient of  $6800$  W/m<sup>2</sup> · K on the outside of a brass tube having inner and outer diameters of 16.5 and 19 mm, respectively. The convection coefficient for water flowing inside the tube is  $5200$  W/m<sup>2</sup> · K. Estimate the steam condensation rate per unit length of the tube when the mean water temperature is  $30^\circ\text{C}$ .

- 10.42** Consider a container exposed to a saturated vapor,  $T_{\text{sat}}$ , having a cold bottom surface,  $T_s < T_{\text{sat}}$ , and with insulated sidewalls.



Assuming a linear temperature distribution for the liquid, perform a surface energy balance on the liquid–vapor interface to obtain the following expression for the growth rate of the liquid layer:

$$\delta(t) = \left[ \frac{2k_l(T_{\text{sat}} - T_s)}{\rho_l h_{fg}} t \right]^{1/2}$$

Calculate the thickness of the liquid layer formed in 1 h for a 200-mm<sup>2</sup> bottom surface maintained at 80°C and exposed to saturated steam at 1 atm. Compare this result with the condensate formed by a *vertical* plate of the same dimensions for the same period of time.

- 10.43** Saturated steam at 1 atm condenses on the outer surface of a vertical, 100-mm-diameter pipe 1 m long, having a uniform surface temperature of 94°C. Estimate the total condensation rate and the heat transfer rate to the pipe.
- 10.44** Determine the total condensation rate and the heat transfer rate for Problem 10.43 when the steam is saturated at 1.5 bars.
- 10.45** A vertical plate 500 mm high and 200 mm wide is to be used to condense saturated steam at 1 atm.
- At what surface temperature must the plate be maintained to achieve a condensation rate of  $\dot{m} = 25 \text{ kg/h}$ ?
  - Compute and plot the surface temperature as a function of condensation rate for  $15 \leq \dot{m} \leq 50 \text{ kg/h}$ .
  - On the same graph and for the same range of  $\dot{m}$ , plot the surface temperature as a function of condensation rate if the plate is 200 mm high and 500 mm wide.
- 10.46** A 2 m  $\times$  2 m vertical plate is exposed on one side to saturated steam at atmospheric pressure and on the other side to cooling water that maintains a plate temperature of 50°C.
- What is the rate of heat transfer to the coolant? What is the rate at which steam condenses on the plate?
  - For plates inclined at an angle  $\theta$  from the vertical, the average convection coefficient for condensation on


the upper surface,  $\bar{h}_{L(\text{incl})}$ , may be approximated by an expression of the form,  $\bar{h}_{L(\text{incl})} \approx (\cos \theta)^{1/4} \bar{h}_{L(\text{vert})}$ , where  $\bar{h}_{L(\text{vert})}$  is the average coefficient for the vertical orientation. If the 2 m  $\times$  2 m plate is inclined 45° from the normal, what are the rates of heat transfer and condensation?

- 10.47** Saturated ethylene glycol vapor at 1 atm is exposed to a vertical plate 300 mm high and 100 mm wide having a uniform temperature of 420 K. Estimate the heat transfer rate to the plate and the condensation rate. Approximate the liquid properties as those corresponding to saturated conditions at 373 K (Table A.5).
- 10.48** A vertical plate 2.5 m high, maintained at a uniform temperature of 54°C, is exposed to saturated steam at atmospheric pressure.
- Estimate the condensation and heat transfer rates per unit width of the plate.
  - If the plate height were halved, would the flow regime stay the same or change?
  - For  $54 \leq T_s \leq 90^\circ\text{C}$ , plot the condensation rate as a function of plate temperature for the two plate heights of parts (a) and (b).
- 10.49** Two configurations are being considered in the design of a condensing system for steam at 1 atm employing a vertical plate maintained at 90°C. The first configuration is a single vertical plate  $L \times w$  and the second consists of two vertical plates  $(L/2) \times w$ , where  $L$  and  $w$  are the vertical and horizontal dimensions, respectively. Which configuration would you choose?
- 10.50** The condenser of a steam power plant consists of a square (in-line) array of 625 tubes, each of 25-mm diameter. Consider conditions for which saturated steam at 0.105 bars condenses on the outer surface of each tube, while a tube wall temperature of 17°C is maintained by the flow of cooling water through the tubes. What is the rate of heat transfer to the water per unit length of the tube array? What is the corresponding condensation rate?
- 10.51** The condenser of a steam power plant consists of AISI 302 stainless steel tubes ( $k_s = 15 \text{ W/m} \cdot \text{K}$ ), each of outer and inner diameters  $D_o = 30 \text{ mm}$  and  $D_i = 26 \text{ mm}$ , respectively. Saturated steam at 0.135 bar condenses on the outer surface of a tube, while water at a mean temperature of  $T_m = 290 \text{ K}$  is in fully developed flow through the tube.
- For a water flow rate of  $\dot{m} = 0.25 \text{ kg/s}$ , what is the outer surface temperature  $T_{s,o}$  of the tube and the rates of heat transfer and steam condensation per unit tube length? As a first estimate, you may

evaluate the properties of the liquid film at the saturation temperature. If one wishes to increase the transfer rates, what is the limiting factor that should be addressed?

- (b) Explore the effect of the water flow rate on  $T_{s,o}$  and the rate of heat transfer per unit length.

- 10.52** Saturated vapor from a chemical process condenses at a slow rate on the inner surface of a vertical, thin-walled cylindrical container of length  $L$  and diameter  $D$ . The container wall is maintained at a uniform temperature  $T_s$  by flowing cold water across its outer surface.

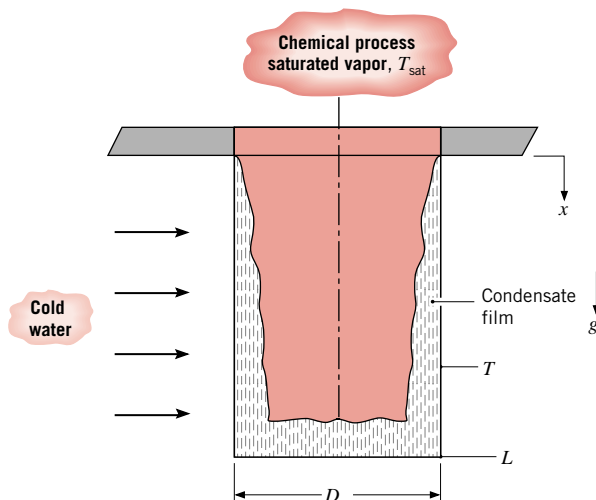

Derive an expression for the time,  $t_f$ , required to fill the container with condensate, assuming that the condensate film is laminar. Express your result in terms of  $D$ ,  $L$ ,  $(T_{\text{sat}} - T_s)$ ,  $g$ , and appropriate fluid properties.

- 10.53** Determine the total condensation rate and heat transfer rate for the condensation process of Problem 10.43 when the pipe is horizontal.
- 10.54** An uninsulated, 25-mm-diameter pipe with a surface temperature of  $15^\circ\text{C}$  passes through a room having an air temperature of  $37^\circ\text{C}$  and relative humidity of 75%. Estimate the condensation rate per unit length of the pipe assuming film, rather than dropwise, condensation.
- 10.55** A horizontal tube of 50-mm diameter, with a surface temperature of  $34^\circ\text{C}$ , is exposed to steam at 0.2 bar. Estimate the condensation rate and heat transfer rate per unit length of the tube.
- 10.56** A horizontal tube 1 m long with a surface temperature of  $70^\circ\text{C}$  is used to condense saturated steam at 1 atm.
- (a) What diameter is required to achieve a condensation rate of 125 kg/h?

- (b) Plot the condensation rate as a function of surface temperature for  $70 \leq T_s \leq 90^\circ\text{C}$  and tube diameters of 125, 150, 175 mm.

- 10.57** The Clean Air Act prohibited the production of chlorofluorocarbons (CFCs) in the United States as of 1996. One widely used CFC, refrigerant R-12, has been replaced by R-134a in many applications because of their similar properties, including a low boiling point at atmospheric pressure,  $T_{\text{sat}} = 243\text{ K}$  and  $246.9\text{ K}$  for R-12 and R-134a, respectively. Compare the performance of these two refrigerants under the following conditions. The saturated refrigerant vapor at 310 K is condensed as it flows through a 30-mm-diameter, 0.8-m-long tube whose wall temperature is maintained at 290 K. If vapor enters the tube at a flow rate of 0.010 kg/s, what is the rate of condensation and the flow rate of vapor leaving the tube? The relevant properties of R-12 at  $T_{\text{sat}} = 310\text{ K}$  are  $\rho_v = 50.1\text{ kg/m}^3$ ,  $h_{fg} = 160\text{ kJ/kg}$ , and  $\mu_v = 150 \times 10^{-7}\text{ N}\cdot\text{s/m}^2$  and those of liquid R-12 at  $T_f = 300\text{ K}$  are  $\rho_l = 1306\text{ kg/m}^3$ ,  $c_{p,l} = 978\text{ J/kg}\cdot\text{K}$ ,  $\mu_l = 2.54 \times 10^{-4}\text{ N}\cdot\text{s/m}^2$ ,  $k_l = 0.072\text{ W/m}\cdot\text{K}$ . The properties of the saturated R-134a vapor are  $\rho_v = 46.1\text{ kg/m}^3$ ,  $h_{fg} = 166\text{ kJ/kg}$ , and  $\mu_v = 136 \times 10^{-7}\text{ N}\cdot\text{s/m}^2$ .

- 10.58** Saturated steam at a pressure of 0.1 bar is condensed over a square array of 100 tubes each of diameter 8 mm.


- (a) If the tube surfaces are maintained at  $27^\circ\text{C}$ , estimate the condensation rate per unit tube length.
- (b) Subject to the requirement that the total number of tubes and the tube diameter are fixed at 100 and 8 mm, respectively, what options are available for increasing the condensation rate? Assess these options quantitatively.

- 10.59** A thin-walled concentric tube heat exchanger of 0.19-m length is to be used to heat deionized water from  $40$  to  $60^\circ\text{C}$  at a flow rate of 5 kg/s. The deionized water flows through the inner tube of 30-mm diameter while saturated steam at 1 atm is supplied to the annulus formed with the outer tube of 60-mm diameter. The thermophysical properties of the deionized water are  $\rho = 982.3\text{ kg/m}^3$ ,  $c_p = 4181\text{ J/kg}\cdot\text{K}$ ,  $k = 0.643\text{ W/m}\cdot\text{K}$ ,  $\mu = 548 \times 10^{-6}\text{ N}\cdot\text{s/m}^2$ , and  $Pr = 3.56$ . Estimate the convection coefficients for both sides of the tube and determine the inner tube wall outlet temperature. Does condensation provide a fairly uniform inner tube wall temperature equal approximately to the saturation temperature of the steam?

- 10.60** A technique for cooling a multichip module involves submerging the module in a saturated fluorocarbon



liquid. Vapor generated due to boiling at the module surface is condensed on the outer surface of copper tubing suspended in the vapor space above the liquid. The thin-walled tubing is of diameter  $D = 10$  mm and is coiled in a horizontal plane. It is cooled by water that enters at 285 K and leaves at 315 K. All the heat dissipated by the chips within the module is transferred from a 100-mm by 100-mm boiling surface, at which the flux is  $10^5$  W/m<sup>2</sup>, to the fluorocarbon liquid, which is at  $T_{\text{sat}} = 57^\circ\text{C}$ . Liquid properties are  $k_l = 0.0537$  W/m · K,  $c_{p,l} = 1100$  J/kg · K,  $h'_{fg} \approx h_{fg} = 84,400$  J/kg,  $\rho_l = 1619.2$  kg/m<sup>3</sup>,  $\rho_v = 13.4$  kg/m<sup>3</sup>,  $\sigma = 8.1 \times 10^{-3}$  kg/s<sup>2</sup>,  $\mu_l = 440 \times 10^{-6}$  kg/m · s, and  $Pr_l = 9$ .

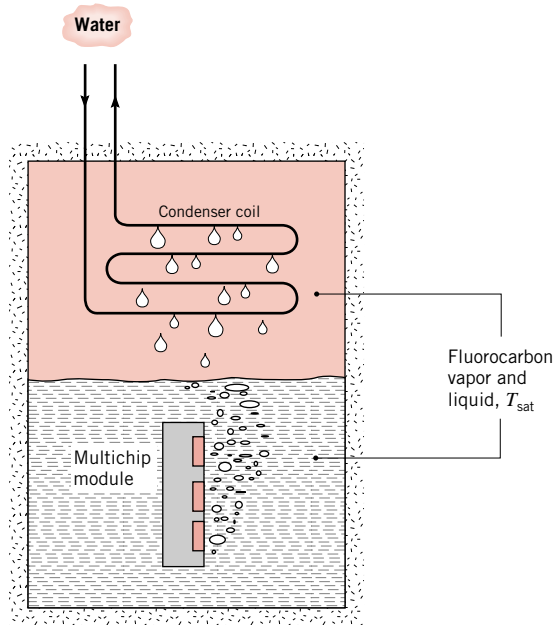

- (a) For the prescribed heat dissipation, what is the required condensation rate (kg/s) and water flowrate (kg/s)?
  - (b) Assuming fully developed flow throughout the tube, determine the tube surface temperature at the coil inlet and outlet.
  - (c) Assuming a uniform tube surface temperature of  $T_s = 53.0^\circ\text{C}$ , determine the required length of the coil.
- 10.61** Determine the rate of condensation on a 100-mm-diameter sphere with a surface temperature of  $150^\circ\text{C}$  in saturated ethylene glycol vapor at 1 atm. Approximate the liquid properties as those corresponding to saturated conditions at 373 K (Table A.5).

**10.62** A 10-mm-diameter copper sphere, initially at a uniform temperature of  $50^\circ\text{C}$ , is placed in a large container filled with saturated steam at 1 atm. Using the lumped capacitance method, estimate the time required for the sphere to reach an equilibrium condition. How much condensate (kg) was formed during this period?

**10.63** Saturated steam at 1.5 bars condenses inside a horizontal, 75-mm-diameter pipe whose surface is maintained at  $100^\circ\text{C}$ . Assuming low vapor velocities and film condensation, estimate the heat transfer coefficient and the condensation rate per unit length of the pipe.

### Dropwise Condensation

**10.64** Consider Problem 10.41. In an effort to increase the condensation rate, an engineer proposes to apply a  $L = 100$   $\mu\text{m}$  thick Teflon coating to the exterior surface of the brass tube to promote dropwise condensation. Estimate the new condensation convection coefficient and the steam condensation rate per unit length of the tube after application of the coating. Comment on the proposed scheme's effect on the condensation rate (the condensation rate per unit length in Problem 10.41 is approximately  $1 \times 10^{-3}$  kg/s).

**10.65** Consider the conditions of Problem 10.54. Estimate the condensation rate for dropwise condensation.


**10.66** A beverage can with a diameter of 65 mm and a height of 120 mm has a uniform temperature of  $5^\circ\text{C}$  when it is removed from the refrigerator. The can is set on a table in a room with an ambient air temperature of  $32^\circ\text{C}$  and a relative humidity of 75%.

Estimate the condensation rate assuming (a) dropwise condensation and (b) film condensation. Compare the rates and explain under what conditions dropwise condensation can occur.



### Combined Boiling/Condensation


**10.67** A passive technique for cooling heat-dissipating integrated circuits involves submerging the ICs in a low boiling point dielectric fluid. Vapor generated in cooling the circuits is condensed on vertical plates suspended in the vapor cavity above the liquid. The temperature of the plates is maintained below the saturation temperature, and during steady-state operation a balance is established between the rate of heat transfer to the condenser plates and the rate of heat dissipation by the ICs.

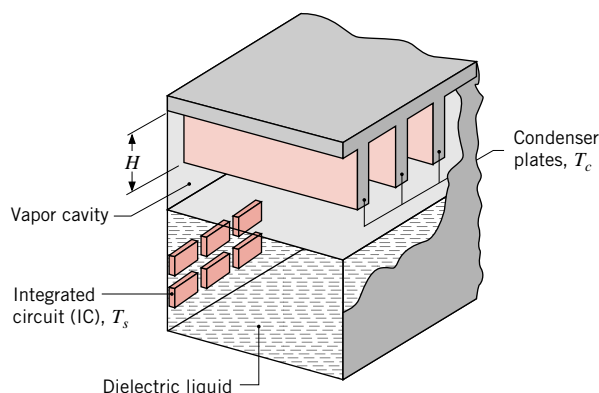

Consider conditions for which the 25-mm<sup>2</sup> surface area of each IC is submerged in a fluorocarbon liquid for which  $T_{\text{sat}} = 50^\circ\text{C}$ ,  $\rho_l = 1700 \text{ kg/m}^3$ ,  $c_{p,l} = 1005 \text{ J/kg} \cdot \text{K}$ ,  $\mu_l = 6.80 \times 10^{-4} \text{ kg/s} \cdot \text{m}$ ,  $k_l = 0.062 \text{ W/m} \cdot \text{K}$ ,  $Pr_l = 11.0$ ,  $\sigma = 0.013 \text{ kg/s}^2$ ,  $h_{fg} = 1.05 \times 10^5 \text{ J/kg}$ ,  $C_{s,f} = 0.004$ , and  $n = 1.7$ . If the integrated circuits are operated at a surface temperature of  $T_s = 75^\circ\text{C}$ , what is the rate at which heat is dissipated by each circuit? If the condenser plates are of height  $H = 50 \text{ mm}$  and are maintained at a temperature of  $T_c = 15^\circ\text{C}$  by an internal coolant, how much condenser surface area must be provided to balance the heat generated by 500 integrated circuits?


**10.68** A thermosyphon consists of a closed container that absorbs heat along its boiling section and rejects heat along its condensation section. Consider a thermosyphon made from a thin-walled mechanically polished stainless steel cylinder of diameter  $D$ . Heat supplied to the thermosyphon boils saturated water at atmospheric pressure on the surfaces of the lower boiling section of length  $L_b$  and is then rejected by condensing vapor into a thin film, which falls by gravity along the wall of the condensation section of length  $L_c$  back into the boiling section. The two sections are separated by an insulated section of length  $L_i$ . The top surface of the condensation section may be treated as being insu-

lated. The thermosyphon dimensions are  $D = 20 \text{ mm}$ ,  $L_b = 20 \text{ mm}$ ,  $L_c = 40 \text{ mm}$ , and  $L_i = 40 \text{ mm}$ .

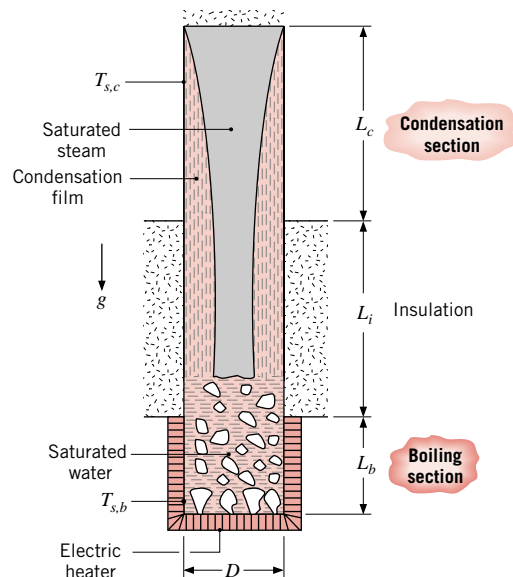

- Find the mean surface temperature,  $T_{s,b}$ , of the boiling surface if the nucleate boiling heat flux is to be maintained at 30% of the critical heat flux.
- Find the total condensation flow rate,  $\dot{m}$ , and the mean surface temperature of the condensation section,  $T_{s,c}$ .

**10.69** A novel scheme for cooling computer chips uses a thermosyphon containing a saturated fluorocarbon. The chip is brazed to the bottom of a cuplike container, within which heat is dissipated by boiling and subsequently transferred to an external coolant (water) via condensation on the inner surface of a thin-walled tube.

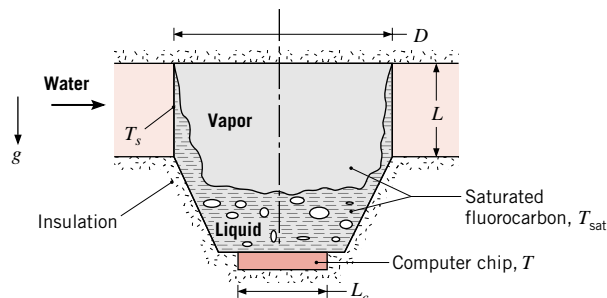



The nucleate boiling constants and the properties of the fluorocarbon are provided in Problem 10.23. In addition,  $k_l = 0.054 \text{ W/m} \cdot \text{K}$ .

- If the chip operates under steady-state conditions and its surface heat flux is maintained at 90% of

the critical heat flux, what is its temperature  $T$ ? What is the total power dissipation if the chip width is  $L_c = 20$  mm on a side?

- (b) If the tube diameter is  $D = 30$  mm and its surface is maintained at  $T_s = 25^\circ\text{C}$  by the water, what tube length  $L$  is required to maintain the designated conditions?


- 10.70** A condenser–boiler section contains a 2-m  $\times$  2-m copper plate operating at a uniform temperature of  $T_s = 100^\circ\text{C}$  and separating saturated steam, which is condensing, from a saturated liquid-X, which experiences nucleate pool boiling. A portion of the boiling

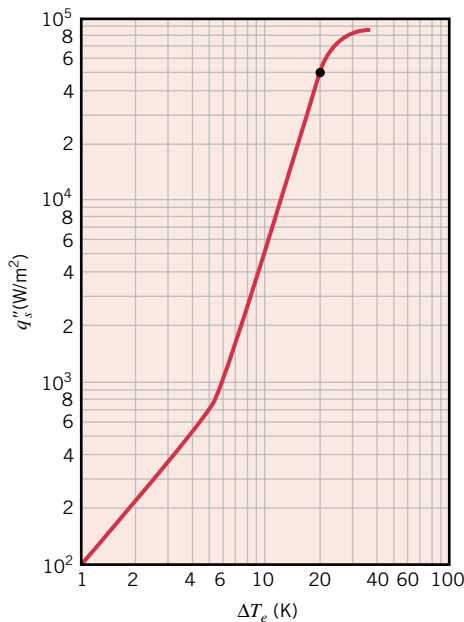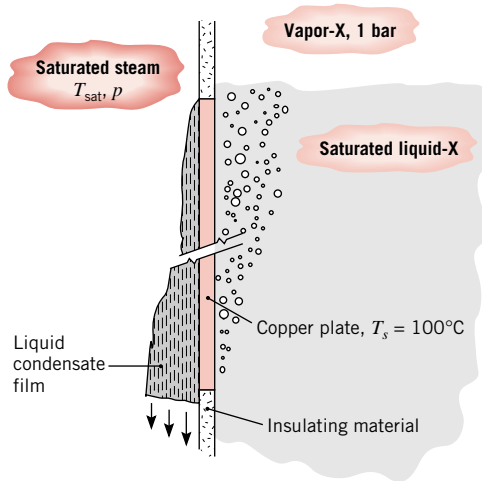

curve for liquid-X is shown as follows. Both saturated steam and saturated liquid-X are supplied to the system, while water condensate and vapor-X are removed by means not shown in the sketch. At a pressure of 1 bar, fluid-X has a saturation temperature and a latent heat of vaporization of  $T_{\text{sat}} = 80^\circ\text{C}$  and  $h_{fg} = 700,000$  J/kg, respectively.

- (a) Estimate the rates of evaporation and condensation (kg/s) for the two fluids.  
 (b) Determine the saturation temperature  $T_{\text{sat}}$  and pressure  $p$  for the steam, assuming that film condensation occurs.

- 10.71** A thin-walled cylindrical container of diameter  $D$  and height  $L$  is filled to a height  $y$  with a low boiling point liquid (A) at  $T_{\text{sat,A}}$ . The container is located in a large chamber filled with the vapor of a high boiling point fluid (B). Vapor-B condenses into a laminar film on the outer surface of the cylindrical container, extending from the location of the liquid-A free surface. The condensation process sustains nucleate boiling in liquid-A along the container wall according to the relation  $q'' = C(T_s - T_{\text{sat}})^3$ , where  $C$  is a known empirical constant.

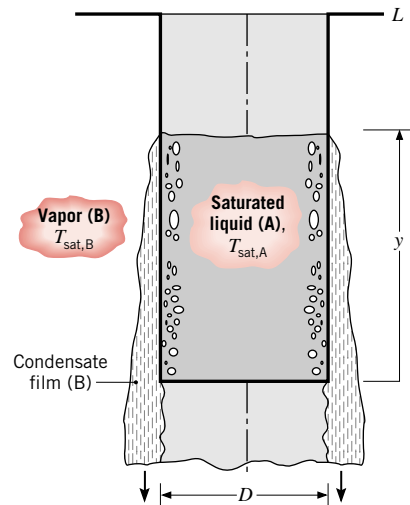

- (a) For the portion of the wall covered with the condensate film, derive an equation for the average temperature of the container wall,  $T_s$ . Assume that the properties of fluids A and B are known.  
 (b) At what rate is heat supplied to liquid-A?  
 (c) Assuming the container is initially filled completely with liquid, that is,  $y = L$ , derive an expression for the time required to evaporate all the liquid in the container.




**10.72** It has been proposed that the very hot air trapped inside the attic of a house in the summer may be used as the energy source for a *passive* water heater installed in the attic. Energy costs associated with heating the cool water and air conditioning the house are both reduced. Ten thermosyphons, similar to that of Problem 10.68, are inserted in the bottom of a well-insulated water heater. Each thermosyphon has a condensing section that is  $L_c = 50$  mm long, an insulated section that is of length  $L_i = 40$  mm, and a boiling section that is  $L_b = 30$  mm long. The diameter of each thermosyphon is  $D = 20$  mm. The working fluid within the thermosyphons is water at a pressure of  $p = 0.047$  bars.

- (a) Determine the heating rate delivered by the 10 thermosyphons when boiling occurs at 25% of the CHF. What are the mean temperatures of the boiling and condensing sections?
- (b) At night the attic air temperature drops below the temperature of the water. Estimate the heat loss from the hot water tank to the cool attic, assuming losses through the tank insulation are negligible and the stainless steel tube wall thickness of each thermosyphon is very small.

# *CHAPTER* **11**

## **Heat Exchangers**

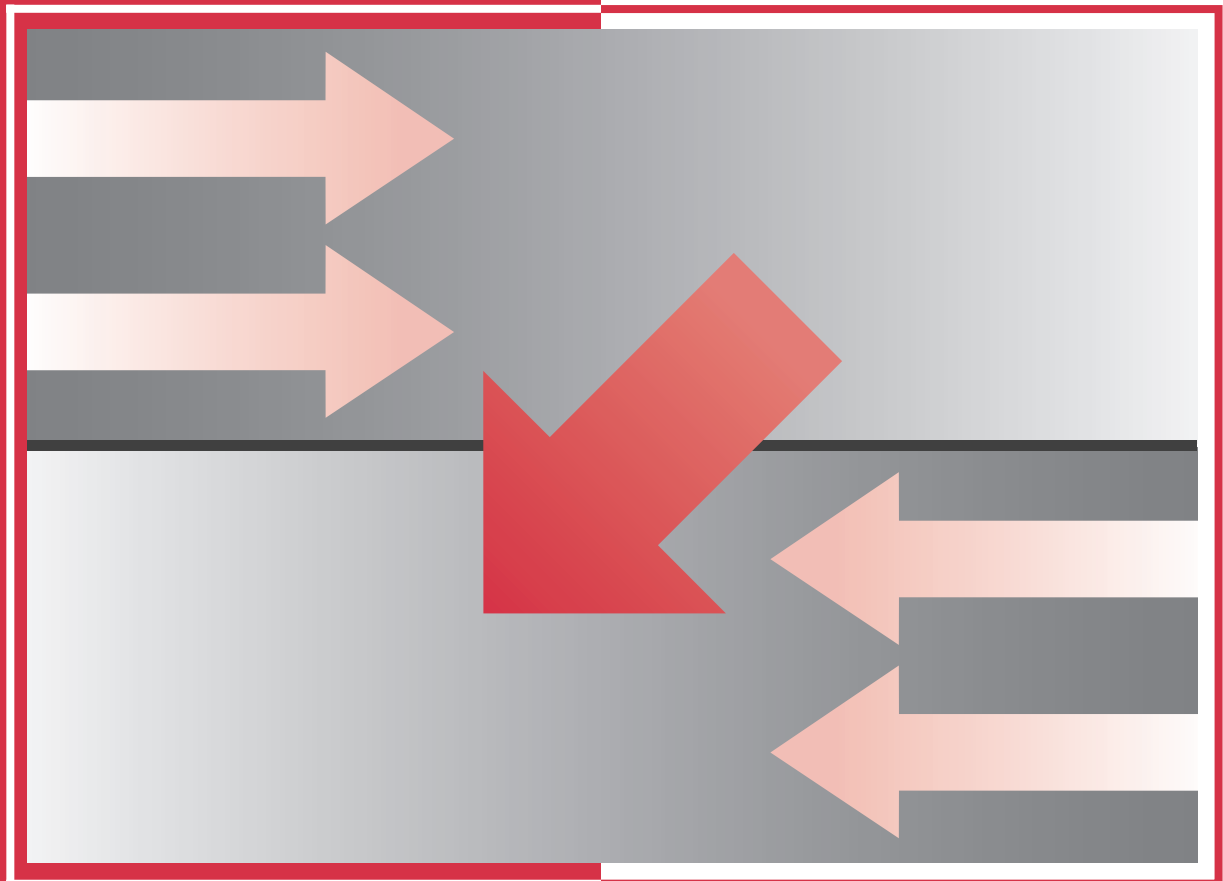

The process of heat exchange between two fluids that are at different temperatures and separated by a solid wall occurs in many engineering applications. The device used to implement this exchange is termed a *heat exchanger*, and specific applications may be found in space heating and air-conditioning, power production, waste heat recovery, and chemical processing.

In this chapter our objectives are to introduce performance parameters for assessing the efficacy of a heat exchanger and to develop methodologies for designing a heat exchanger or for predicting the performance of an existing exchanger operating under prescribed conditions.

## 11.1

### Heat Exchanger Types

Heat exchangers are typically classified according to *flow arrangement* and *type of construction*. The simplest heat exchanger is one for which the hot and cold fluids move in the same or opposite directions in a *concentric tube* (or *double-pipe*) construction. In the *parallel-flow* arrangement of Figure 11.1a, the hot and cold fluids enter at the same end, flow in the same direction, and leave at the same end. In the *counterflow* arrangement of Figure 11.1b, the fluids enter at opposite ends, flow in opposite directions, and leave at opposite ends.

Alternatively, the fluids may move in *cross flow* (perpendicular to each other), as shown by the *finned* and *unfinned* tubular heat exchangers of Figure 11.2. The two configurations are typically differentiated by an idealization that treats fluid motion over the tubes as *unmixed* or *mixed*. In Figure 11.2a, the fluid is said to be unmixed because the fins inhibit motion in a direction ( $y$ ) that is transverse to the main-flow direction ( $x$ ). In this case the fluid temperature varies with  $x$  and  $y$ . In contrast, for the unfinned tube bundle of Figure 11.2b, fluid motion, hence mixing, in the transverse direction is possible, and temperature variations are primarily in the main-flow direction. Since the tube flow is unmixed, both fluids are unmixed in the finned exchanger, while one fluid is mixed and the other unmixed in the unfinned exchanger. The nature of the mixing condition can significantly influence heat exchanger performance.

Another common configuration is the *shell-and-tube* heat exchanger [1]. Specific forms differ according to the number of shell-and-tube passes, and the simplest form,


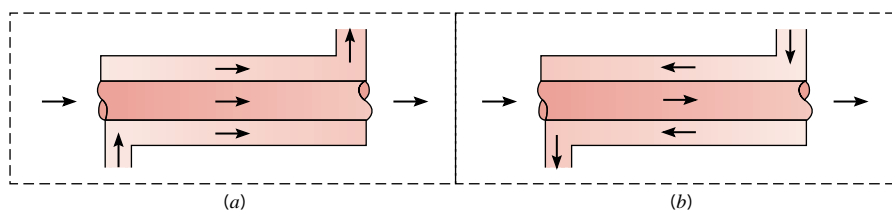



FIGURE 11.1 Concentric tube heat exchangers. (a) Parallel flow. (b) Counterflow.

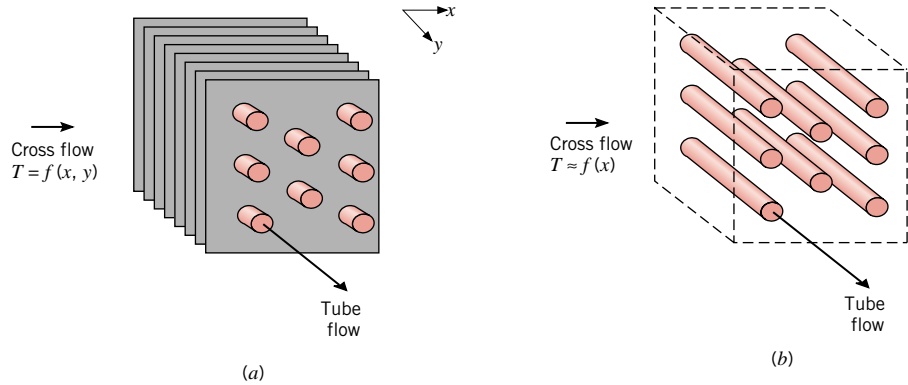


**FIGURE 11.2** Cross-flow heat exchangers. (a) Finned with both fluids unmixed. (b) Unfinned with one fluid mixed and the other unmixed.

which involves single tube and shell *passes*, is shown in Figure 11.3. Baffles are usually installed to increase the convection coefficient of the shell-side fluid by inducing turbulence and a cross-flow velocity component. In addition, the baffles physically support the tubes, reducing flow-induced tube vibration. Baffled heat exchangers with one shell pass and two tube passes and with two shell passes and four tube passes are shown in Figures 11.4a and 11.4b, respectively.


A special and important class of heat exchangers is used to achieve a very large ( $\geq 400 \text{ m}^2/\text{m}^3$  for liquids and  $\geq 700 \text{ m}^2/\text{m}^3$  for gases) heat transfer surface area per unit volume. Termed *compact heat exchangers*, these devices have dense arrays of finned tubes or plates and are typically used when at least one of the fluids is a gas, and is hence characterized by a small convection coefficient. The tubes may be *flat* or *circular*, as in Figures 11.5a and 11.5b, c, respectively, and the fins may be *plate* or *circular*, as in Figures 11.5a, b and 11.5c, respectively. Parallel-plate heat exchangers may be finned or corrugated and may be used in single-pass (Figure 11.5d) or multipass (Figure 11.5e) modes of operation. Flow passages associated with compact heat exchangers are typically small ( $D_h \lesssim 5 \text{ mm}$ ), and the flow is usually laminar.

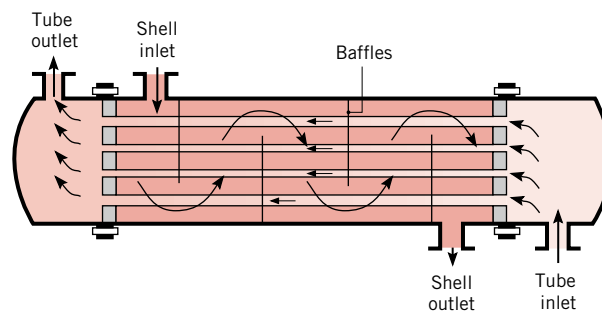

**FIGURE 11.3** Shell-and-tube heat exchanger with one shell pass and one tube pass (cross-counterflow mode of operation).

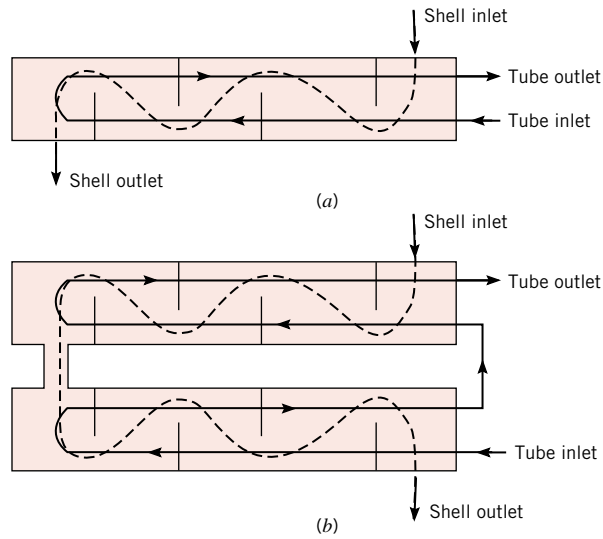

**FIGURE 11.4** Shell-and-tube heat exchangers. (a) One shell pass and two tube passes. (b) Two shell passes and four tube passes.

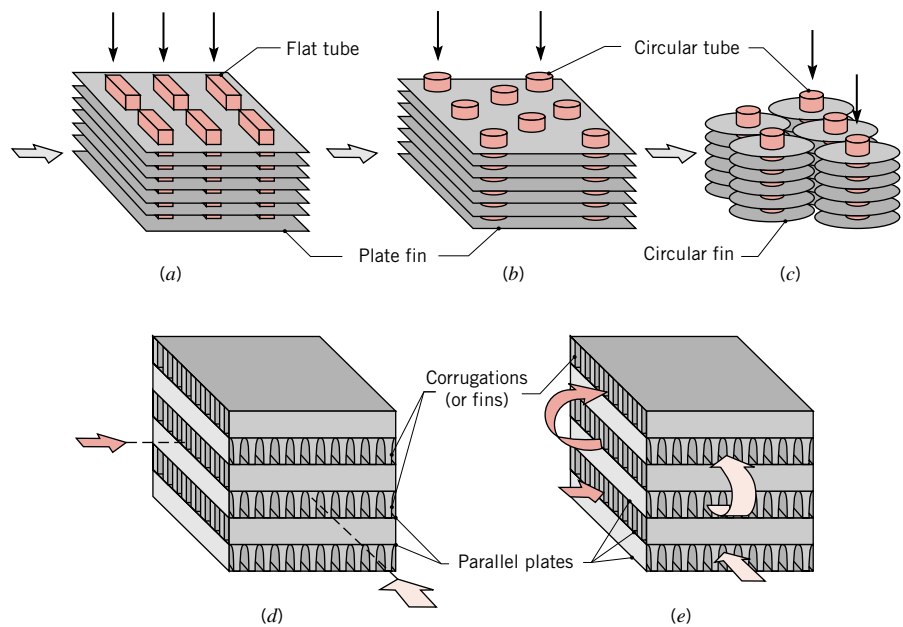

**FIGURE 11.5** Compact heat exchanger cores. (a) Fin-tube (flat tubes, continuous plate fins). (b) Fin-tube (circular tubes, continuous plate fins). (c) Fin-tube (circular tubes, circular fins). (d) Plate-fin (single pass). (e) Plate-fin (multipass).

## 11.2

### The Overall Heat Transfer Coefficient

An essential, and often the most uncertain, part of any heat exchanger analysis is determination of the *overall heat transfer coefficient*. Recall from Equation 3.19 that this coefficient is defined in terms of the total thermal resistance to heat transfer between two fluids. In Equations 3.18 and 3.31, the coefficient was determined by accounting for conduction and convection resistances between fluids separated by composite plane and cylindrical walls, respectively. It is important to acknowledge, however, that such results apply only to *clean, unfinned* surfaces.

During normal heat exchanger operation, surfaces are often subject to fouling by fluid impurities, rust formation, or other reactions between the fluid and the wall material. The subsequent deposition of a film or scale on the surface can greatly increase the resistance to heat transfer between the fluids. This effect can be treated by introducing an additional thermal resistance, termed the *fouling factor*,  $R_f$ . Its value depends on the operating temperature, fluid velocity, and length of service of the heat exchanger.

In addition, we know that fins are often added to surfaces exposed to either or both fluids and that, by increasing the surface area, they reduce the resistance to convection heat transfer. Accordingly, with inclusion of surface fouling and fin (extended surface) effects, the overall heat transfer coefficient may be expressed as

$$\begin{aligned} \frac{1}{UA} &= \frac{1}{U_c A_c} = \frac{1}{U_h A_h} \\ &= \frac{1}{(\eta_o h A)_c} + \frac{R_{f,c}''}{(\eta_o A)_c} + R_w + \frac{R_{f,h}''}{(\eta_o A)_h} + \frac{1}{(\eta_o h A)_h} \end{aligned} \quad (11.1)$$

where  $c$  and  $h$  refer to the cold and hot fluids, respectively. Note that calculation of the  $UA$  product does not require designation of the hot or cold side ( $U_c A_c = U_h A_h$ ). However, calculation of an overall coefficient depends on whether it is based on the cold or hot side surface area, since  $U_c \neq U_h$  if  $A_c \neq A_h$ . The conduction resistance  $R_w$  is obtained from Equation 3.6 for a plane wall or Equation 3.28 for a cylindrical wall. Although representative fouling factors are listed in Table 11.1, the factor is a variable during heat exchanger operation (increasing from zero for a clean surface, as deposits accumulate on the surface). Comprehensive discussions of fouling are provided in References 2 through 4.

The quantity  $\eta_o$  in Equation 11.1 is termed the *overall surface efficiency* or *temperature effectiveness* of a finned surface. It is defined such that, for the hot or cold surface without fouling, the heat transfer rate is

$$q = \eta_o h A (T_b - T_\infty) \quad (11.2)$$

where  $T_b$  is the base surface temperature (Figure 3.20) and  $A$  is the total (fin plus exposed base) surface area. The quantity was introduced in Section 3.6.5, and the following expression was derived:

$$\eta_o = 1 - \frac{A_f}{A} (1 - \eta_f) \quad (11.3)$$

**TABLE 11.1** Representative Fouling Factors [1]

Fluid	$R_f''$ ( $\text{m}^2 \cdot \text{K}/\text{W}$ )
Seawater and treated boiler feedwater (below 50°C)	0.0001
Seawater and treated boiler feedwater (above 50°C)	0.0002
River water (below 50°C)	0.0002–0.001
Fuel oil	0.0009
Refrigerating liquids	0.0002
Steam (nonoil bearing)	0.0001

where  $A_f$  is the entire fin surface area and  $\eta_f$  is the efficiency of a single fin. To be consistent with the nomenclature commonly used in heat exchanger analysis, the ratio of fin surface area to the total surface area has been expressed as  $A_f/A$ . This representation differs from that of Section 3.6.5, where the ratio is expressed as  $NA_f/A_t$ , with  $A_f$  representing the area of a single fin and  $A_t$  the total surface area. If a straight or pin fin of length  $L$  (Figure 3.16) is used and an adiabatic tip is assumed, Equations 3.76 and 3.86 yield

$$\eta_f = \frac{\tanh(mL)}{mL} \quad (11.4)$$

where  $m = (2h/kt)^{1/2}$  and  $t$  is the fin thickness. For several common fin shapes, the efficiency may be obtained from Table 3.5.

Note that, as written, Equation 11.2 corresponds to negligible fouling. However, if fouling is significant, the convection coefficient in Equation 11.2 must be replaced by a *partial* overall heat transfer coefficient of the form  $U_p = h/(1 + hR_f'')$ . In contrast to Equation 11.1, which provides the overall heat transfer coefficient between the hot and cold fluids,  $U_p$  is termed a partial coefficient because it only includes the convection coefficient and fouling factor associated with one fluid and its adjoining surface. Partial coefficients for the hot and cold sides are then  $U_{p,h} = h_h/(1 + h_hR_{f,h}'')$  and  $U_{p,c} = h_c/(1 + h_cR_{f,c}'')$ , respectively. Equation 11.3 may still be used to evaluate  $\eta_o$  for the hot and/or cold side, but  $U_p$  must be used in lieu of  $h$  to evaluate the corresponding fin efficiency. Moreover, it is readily shown that the second and fourth terms on the right-hand side of Equation 11.1 may be deleted if the convection coefficients in the first and fifth terms are replaced by  $U_{p,c}$  and  $U_{p,h}$ , respectively.

The wall conduction term in Equation 11.1 may often be neglected, since a thin wall of large thermal conductivity is generally used. Also, one of the convection coefficients is often much smaller than the other and hence dominates determination of the overall coefficient. For example, if one of the fluids is a gas and the other is a liquid or a liquid–vapor mixture experiencing boiling or condensation, the gas-side convection coefficient is much smaller. It is in such situations that fins are used to enhance gas-side convection. Representative values of the overall coefficient are summarized in Table 11.2.

**TABLE 11.2** Representative Values of the Overall Heat Transfer Coefficient

Fluid Combination	$U$ (W/m <sup>2</sup> · K)
Water to water	850–1700
Water to oil	110–350
Steam condenser (water in tubes)	1000–6000
Ammonia condenser (water in tubes)	800–1400
Alcohol condenser (water in tubes)	250–700
Finned-tube heat exchanger (water in tubes, air in cross flow)	25–50

For the unfinned, tubular heat exchangers of Figures 11.1 through 11.4, Equation 11.1 reduces to

$$\begin{aligned} \frac{1}{UA} &= \frac{1}{U_i A_i} = \frac{1}{U_o A_o} \\ &= \frac{1}{h_i A_i} + \frac{R''_{f,i}}{A_i} + \frac{\ln(D_o/D_i)}{2\pi kL} + \frac{R''_{f,o}}{A_o} + \frac{1}{h_o A_o} \end{aligned} \quad (11.5)$$

where subscripts  $i$  and  $o$  refer to inner and outer tube surfaces ( $A_i = \pi D_i L$ ,  $A_o = \pi D_o L$ ), which may be exposed to either the hot or the cold fluid.

The overall heat transfer coefficient may be determined from knowledge of the hot and cold fluid convection coefficients and fouling factors and from appropriate geometric parameters. For unfinned surfaces, the convection coefficients may be estimated from correlations presented in Chapters 7 and 8. For standard fin configurations, the coefficients may be obtained from results compiled by Kays and London [5].


## 11.3

### Heat Exchanger Analysis: Use of the Log Mean Temperature Difference

To design or to predict the performance of a heat exchanger, it is essential to relate the total heat transfer rate to quantities such as the inlet and outlet fluid temperatures, the overall heat transfer coefficient, and the total surface area for heat transfer. Two such relations may readily be obtained by applying overall energy balances to the hot and cold fluids, as shown in Figure 11.6. In particular, if  $q$  is the total rate of heat transfer between the hot and cold fluids and there is negligible heat transfer between the exchanger and its surroundings, as well as negligible potential and kinetic energy changes, application of the steady flow energy equation, Equation 1.11d, gives

$$q = \dot{m}_h(i_{h,i} - i_{h,o}) \quad (11.6a)$$



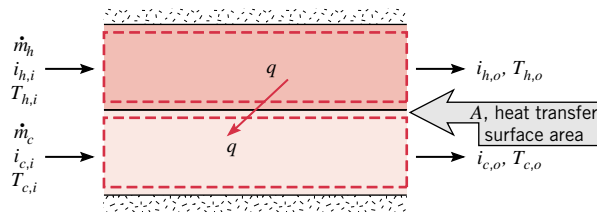

**FIGURE 11.6** Overall energy balances for the hot and cold fluids of a two-fluid heat exchanger.

and

$$q = \dot{m}_c(i_{c,o} - i_{c,i}) \quad (11.7a)$$

where  $i$  is the fluid enthalpy. The subscripts  $h$  and  $c$  refer to the hot and cold fluids, whereas  $i$  and  $o$  designate the fluid inlet and outlet conditions. If the fluids are not undergoing a phase change and constant specific heats are assumed, these expressions reduce to

$$q = \dot{m}_h c_{p,h}(T_{h,i} - T_{h,o}) \quad (11.6b)$$

and

$$q = \dot{m}_c c_{p,c}(T_{c,o} - T_{c,i}) \quad (11.7b)$$

where the temperatures appearing in the expressions refer to the *mean* fluid temperatures at the designated locations. Note that Equations 11.6 and 11.7 are independent of the flow arrangement and heat exchanger type.

Another useful expression may be obtained by relating the total heat transfer rate  $q$  to the temperature difference  $\Delta T$  between the hot and cold fluids, where

$$\Delta T \equiv T_h - T_c \quad (11.8)$$


Such an expression would be an extension of Newton's law of cooling, with the overall heat transfer coefficient  $U$  used in place of the single convection coefficient  $h$ . However, since  $\Delta T$  varies with position in the heat exchanger, it is necessary to work with a rate equation of the form

$$q = UA \Delta T_m \quad (11.9)$$

where  $\Delta T_m$  is an appropriate *mean* temperature difference. Equation 11.9 may be used with Equations 11.6 and 11.7 to perform a heat exchanger analysis. Before this can be done, however, the specific form of  $\Delta T_m$  must be established.

### 11.3.1 The Parallel-Flow Heat Exchanger

The hot and cold fluid temperature distributions associated with a parallel-flow heat exchanger are shown in Figure 11.7. The temperature difference  $\Delta T$  is initially large but decays with increasing  $x$ , approaching zero asymptotically. It is important to note that, for such an exchanger, the outlet temperature of the cold fluid never exceeds that of the hot fluid. In Figure 11.7 the subscripts 1 and 2 designate opposite ends of the

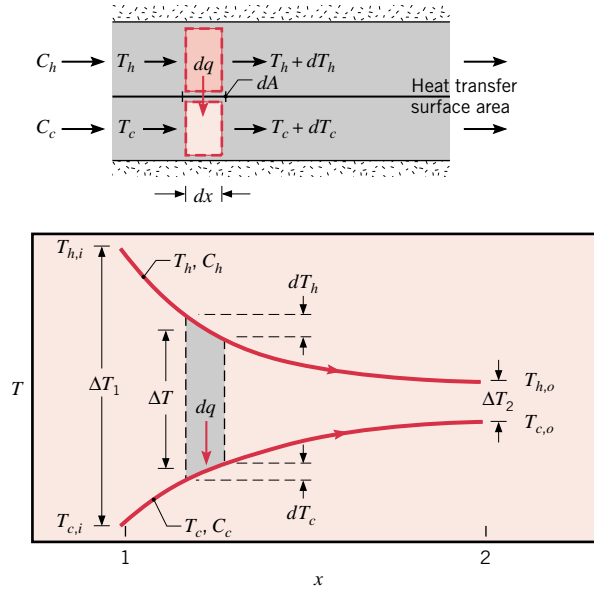

**FIGURE 11.7** Temperature distributions for a parallel-flow heat exchanger.

heat exchanger. This convention is used for all types of heat exchangers considered. For parallel flow, it follows that  $T_{h,i} = T_{h,1}$ ,  $T_{h,o} = T_{h,2}$ ,  $T_{c,i} = T_{c,1}$ , and  $T_{c,o} = T_{c,2}$ .

The form of  $\Delta T_m$  may be determined by applying an energy balance to differential elements in the hot and cold fluids. Each element is of length  $dx$  and heat transfer surface area  $dA$ , as shown in Figure 11.7. The energy balances and the subsequent analysis are subject to the following assumptions.

1. The heat exchanger is insulated from its surroundings, in which case the only heat exchange is between the hot and cold fluids.
2. Axial conduction along the tubes is negligible.
3. Potential and kinetic energy changes are negligible.
4. The fluid specific heats are constant.
5. The overall heat transfer coefficient is constant.

The specific heats may of course change as a result of temperature variations, and the overall heat transfer coefficient may change because of variations in fluid properties and flow conditions. However, in many applications such variations are not significant, and it is reasonable to work with average values of  $c_{p,c}$ ,  $c_{p,h}$ , and  $U$  for the heat exchanger.

Applying an energy balance to each of the differential elements of Figure 11.7, it follows that

$$dq = -\dot{m}_h c_{p,h} dT_h \equiv -C_h dT_h \quad (11.10)$$

and

$$dq = \dot{m}_c c_{p,c} dT_c \equiv C_c dT_c \quad (11.11)$$

where  $C_h$  and  $C_c$  are the hot and cold fluid *heat capacity rates*, respectively. These expressions may be integrated across the heat exchanger to obtain the overall

energy balances given by Equations 11.6b and 11.7b. The heat transfer across the surface area  $dA$  may also be expressed as

$$dq = U \Delta T dA \quad (11.12)$$

where  $\Delta T = T_h - T_c$  is the *local* temperature difference between the hot and cold fluids.

To determine the integrated form of Equation 11.12, we begin by substituting Equations 11.10 and 11.11 into the differential form of Equation 11.8

$$d(\Delta T) = dT_h - dT_c$$

to obtain

$$d(\Delta T) = -dq \left( \frac{1}{C_h} + \frac{1}{C_c} \right)$$

Substituting for  $dq$  from Equation 11.12 and integrating across the heat exchanger, we obtain

$$\int_1^2 \frac{d(\Delta T)}{\Delta T} = -U \left( \frac{1}{C_h} + \frac{1}{C_c} \right) \int_1^2 dA$$

or

$$\ln \left( \frac{\Delta T_2}{\Delta T_1} \right) = -UA \left( \frac{1}{C_h} + \frac{1}{C_c} \right) \quad (11.13)$$

Substituting for  $C_h$  and  $C_c$  from Equations 11.6b and 11.7b, respectively, it follows that

$$\begin{aligned} \ln \left( \frac{\Delta T_2}{\Delta T_1} \right) &= -UA \left( \frac{T_{h,i} - T_{h,o}}{q} + \frac{T_{c,o} - T_{c,i}}{q} \right) \\ &= -\frac{UA}{q} [(T_{h,i} - T_{c,i}) - (T_{h,o} - T_{c,o})] \end{aligned}$$

Recognizing that, for the parallel-flow heat exchanger of Figure 11.7,  $\Delta T_1 = (T_{h,i} - T_{c,i})$  and  $\Delta T_2 = (T_{h,o} - T_{c,o})$ , we then obtain

$$q = UA \frac{\Delta T_2 - \Delta T_1}{\ln (\Delta T_2 / \Delta T_1)}$$

Comparing the above expression with Equation 11.9, we conclude that the appropriate average temperature difference is a *log mean temperature difference*,  $\Delta T_{\text{lm}}$ . Accordingly, we may write

$$q = UA \Delta T_{\text{lm}} \quad (11.14)$$

where

$$\Delta T_{\text{lm}} = \frac{\Delta T_2 - \Delta T_1}{\ln (\Delta T_2 / \Delta T_1)} = \frac{\Delta T_1 - \Delta T_2}{\ln (\Delta T_1 / \Delta T_2)} \quad (11.15)$$

Remember that, for the *parallel-flow exchanger*,

$$\begin{aligned} \Delta T_1 &\equiv T_{h,1} - T_{c,1} = T_{h,i} - T_{c,i} \\ \Delta T_2 &\equiv T_{h,2} - T_{c,2} = T_{h,o} - T_{c,o} \end{aligned} \quad (11.16)$$

### 11.3.2 The Counterflow Heat Exchanger

The hot and cold fluid temperature distributions associated with a counterflow heat exchanger are shown in Figure 11.8. In contrast to the parallel-flow exchanger, this configuration provides for heat transfer between the hotter portions of the two fluids at one end, as well as between the colder portions at the other. For this reason, the change in the temperature difference,  $\Delta T = T_h - T_c$ , with respect to  $x$  is nowhere as large as it is for the inlet region of the parallel-flow exchanger. Note that the outlet temperature of the cold fluid may now exceed the outlet temperature of the hot fluid.


Equations 11.6b and 11.7b apply to any heat exchanger and hence may be used for the counterflow arrangement. Moreover, from an analysis like that performed in Section 11.3.1, it may be shown that Equations 11.14 and 11.15 also apply. However, for the *counterflow exchanger* the endpoint temperature differences must now be defined as

$$\begin{bmatrix} \Delta T_1 \equiv T_{h,1} - T_{c,1} = T_{h,i} - T_{c,o} \\ \Delta T_2 \equiv T_{h,2} - T_{c,2} = T_{h,o} - T_{c,i} \end{bmatrix} \quad (11.17)$$


Note that, for the same inlet and outlet temperatures, the log mean temperature difference for counterflow exceeds that for parallel flow,  $\Delta T_{\text{lm,CF}} > \Delta T_{\text{lm,PF}}$ . Hence the surface area required to effect a prescribed heat transfer rate  $q$  is smaller for the counterflow than for the parallel-flow arrangement, assuming the same value of  $U$ . Also note that  $T_{c,o}$  can exceed  $T_{h,o}$  for counterflow but not for parallel flow.

### 11.3.3 Special Operating Conditions

It is useful to note certain special conditions under which heat exchangers may be operated. Figure 11.9a shows temperature distributions for a heat exchanger in

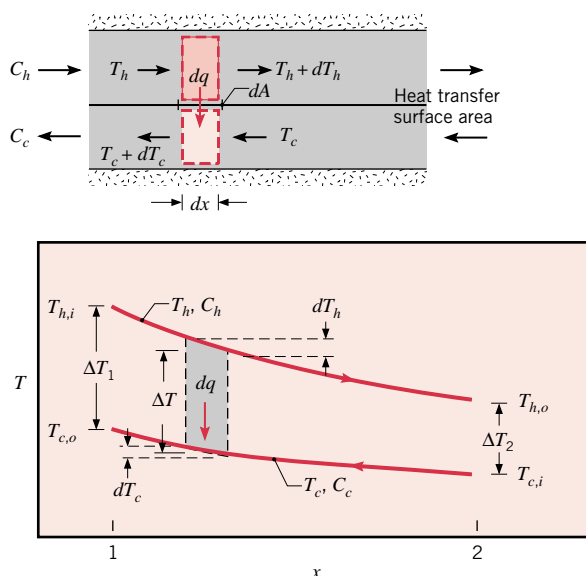


**FIGURE 11.8** Temperature distributions for a counterflow heat exchanger.

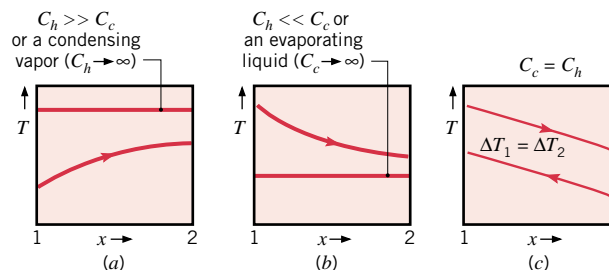

**FIGURE 11.9** Special heat exchanger conditions. (a)  $C_h \gg C_c$  or a condensing vapor. (b) An evaporating liquid or  $C_h \ll C_c$ . (c) A counterflow heat exchanger with equivalent fluid heat capacities ( $C_h = C_c$ ).

which the hot fluid has a heat capacity rate,  $C_h \equiv \dot{m}_h c_{p,h}$ , which is much larger than that of the cold fluid,  $C_c \equiv \dot{m}_c c_{p,c}$ . For this case the temperature of the hot fluid remains approximately constant throughout the heat exchanger, while the temperature of the cold fluid increases. The same condition is achieved if the hot fluid is a condensing vapor. Condensation occurs at constant temperature, and, for all practical purposes,  $C_h \rightarrow \infty$ . Conversely, in an evaporator or a boiler (Figure 11.9b), it is the cold fluid that experiences a change in phase and remains at a nearly uniform temperature ( $C_c \rightarrow \infty$ ). The same effect is achieved without phase change if  $C_h \ll C_c$ . Note that, with condensation or evaporation, the heat rate is given by Equation 11.6a or 11.7a. The third special case (Figure 11.9c) involves a counterflow heat exchanger for which the heat capacity rates are equal ( $C_h = C_c$ ). The temperature difference  $\Delta T$  must then be a constant throughout the exchanger, in which case  $\Delta T_1 = \Delta T_2 = \Delta T_{lm}$ .

Although flow conditions are more complicated in multipass and cross-flow heat exchangers, Equations 11.6, 11.7, 11.14, and 11.15 may still be used if modifications are made to the definition of the log mean temperature difference [6].

 Methodologies for using the LMTD method for other heat exchanger types are included in Section 11S.1.

### EXAMPLE 11.1


A counterflow, concentric tube heat exchanger is used to cool the lubricating oil for a large industrial gas turbine engine. The flow rate of cooling water through the inner tube ( $D_i = 25$  mm) is 0.2 kg/s, while the flow rate of oil through the outer annulus ( $D_o = 45$  mm) is 0.1 kg/s. The oil and water enter at temperatures of 100 and 30°C, respectively. How long must the tube be made if the outlet temperature of the oil is to be 60°C?

### SOLUTION

**Known:** Fluid flow rates and inlet temperatures for a counterflow, concentric tube heat exchanger of prescribed inner and outer diameter.

**Find:** Tube length to achieve a desired hot fluid outlet temperature.

**Schematic:**

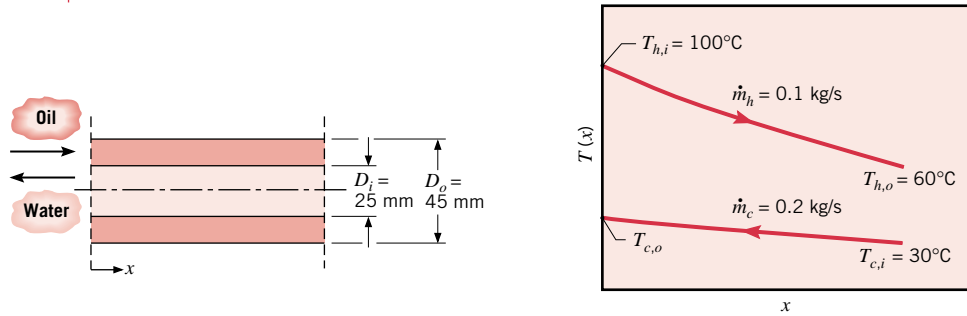

**Assumptions:**

1. Negligible heat loss to the surroundings.
2. Negligible kinetic and potential energy changes.
3. Constant properties.
4. Negligible tube wall thermal resistance and fouling factors.
5. Fully developed conditions for the water and oil ( $U$  independent of  $x$ ).

**Properties:** Table A.5, unused engine oil ( $\bar{T}_h = 80^\circ\text{C} = 353\text{ K}$ ):  $c_p = 2131\text{ J/kg} \cdot \text{K}$ ,  $\mu = 3.25 \times 10^{-2}\text{ N} \cdot \text{s/m}^2$ ,  $k = 0.138\text{ W/m} \cdot \text{K}$ . Table A.6, water ( $\bar{T}_c \approx 35^\circ\text{C}$ ):  $c_p = 4178\text{ J/kg} \cdot \text{K}$ ,  $\mu = 725 \times 10^{-6}\text{ N} \cdot \text{s/m}^2$ ,  $k = 0.625\text{ W/m} \cdot \text{K}$ ,  $Pr = 4.85$ .

**Analysis:** The required heat transfer rate may be obtained from the overall energy balance for the hot fluid, Equation 11.6b.

$$q = \dot{m}_h c_{p,h} (T_{h,i} - T_{h,o})$$

$$q = 0.1\text{ kg/s} \times 2131\text{ J/kg} \cdot \text{K} (100 - 60)^\circ\text{C} = 8524\text{ W}$$

Applying Equation 11.7b, the water outlet temperature is

$$T_{c,o} = \frac{q}{\dot{m}_c c_{p,c}} + T_{c,i}$$

$$T_{c,o} = \frac{8524\text{ W}}{0.2\text{ kg/s} \times 4178\text{ J/kg} \cdot \text{K}} + 30^\circ\text{C} = 40.2^\circ\text{C}$$

Accordingly, use of  $\bar{T}_c = 35^\circ\text{C}$  to evaluate the water properties was a good choice. The required heat exchanger length may now be obtained from Equation 11.14,

$$q = UA \Delta T_{\text{lm}}$$

where  $A = \pi D_i L$  and from Equations 11.15 and 11.17

$$\Delta T_{\text{lm}} = \frac{(T_{h,i} - T_{c,o}) - (T_{h,o} - T_{c,i})}{\ln [(T_{h,i} - T_{c,o}) / (T_{h,o} - T_{c,i})]} = \frac{59.8 - 30}{\ln (59.8/30)} = 43.2^\circ\text{C}$$

From Equation 11.5 the overall heat transfer coefficient is

$$U = \frac{1}{(1/h_i) + (1/h_o)}$$

For water flow through the tube,

$$Re_D = \frac{4\dot{m}_c}{\pi D_i \mu} = \frac{4 \times 0.2 \text{ kg/s}}{\pi (0.025 \text{ m}) 725 \times 10^{-6} \text{ N} \cdot \text{s/m}^2} = 14,050$$

Accordingly, the flow is turbulent and the convection coefficient may be computed from Equation 8.60

$$\begin{aligned} Nu_D &= 0.023 Re_D^{4/5} Pr^{0.4} \\ Nu_D &= 0.023 (14,050)^{4/5} (4.85)^{0.4} = 90 \end{aligned}$$

Hence

$$h_i = Nu_D \frac{k}{D_i} = \frac{90 \times 0.625 \text{ W/m} \cdot \text{K}}{0.025 \text{ m}} = 2250 \text{ W/m}^2 \cdot \text{K}$$

For the flow of oil through the annulus, the hydraulic diameter is, from Equation 8.71,  $D_h = D_o - D_i = 0.02 \text{ m}$ , and the Reynolds number is

$$\begin{aligned} Re_D &= \frac{\rho u_m D_h}{\mu} = \frac{\rho (D_o - D_i)}{\mu} \times \frac{\dot{m}_h}{\rho \pi (D_o^2 - D_i^2)/4} \\ Re_D &= \frac{4\dot{m}_h}{\pi (D_o + D_i) \mu} = \frac{4 \times 0.1 \text{ kg/s}}{\pi (0.045 + 0.025) \text{ m} \times 3.25 \times 10^{-2} \text{ kg/s} \cdot \text{m}} = 56.0 \end{aligned}$$

The annular flow is therefore laminar. Assuming uniform temperature along the inner surface of the annulus and a perfectly insulated outer surface, the convection coefficient at the inner surface may be obtained from Table 8.2. With  $(D_i/D_o) = 0.56$ , linear interpolation provides

$$Nu_i = \frac{h_o D_h}{k} = 5.63$$

and

$$h_o = 5.63 \frac{0.138 \text{ W/m} \cdot \text{K}}{0.020 \text{ m}} = 38.8 \text{ W/m}^2 \cdot \text{K}$$

The overall convection coefficient is then

$$U = \frac{1}{(1/2250 \text{ W/m}^2 \cdot \text{K}) + (1/38.8 \text{ W/m}^2 \cdot \text{K})} = 38.1 \text{ W/m}^2 \cdot \text{K}$$

and from the rate equation it follows that

$$L = \frac{q}{U \pi D_i \Delta T_{lm}} = \frac{8524 \text{ W}}{38.1 \text{ W/m}^2 \cdot \text{K} \pi (0.025 \text{ m}) (43.2^\circ\text{C})} = 65.9 \text{ m} \quad \triangleleft$$

### Comments:

1. The hot side convection coefficient controls the rate of heat transfer between the two fluids, and the low value of  $h_o$  is responsible for the large value of  $L$ . Incorporation of heat transfer enhancement methods, such as described in Section 8.8, could be used to decrease the size of the heat exchanger.
2. Because  $h_i \gg h_o$ , the tube wall temperature will follow closely that of the coolant water. Accordingly, the assumption of uniform wall temperature, which is inherent in the use of Table 8.2 to obtain  $h_o$ , is reasonable.

### EXAMPLE 11.2

The counterflow, concentric tube heat exchanger of Example 11.1 is replaced with a compact, plate-type heat exchanger that consists of a stack of thin metal sheets, separated by  $N$  gaps of width  $a$ . The oil and water flows are subdivided into  $N/2$  individual flow streams, with the oil and water moving in opposite directions within alternating gaps. It is desirable for the stack to be of a cubical geometry, with a characteristic exterior dimension  $L$ . Determine the exterior dimensions of the heat exchanger as a function of the number of gaps if the flow rates, inlet temperatures, and desired oil outlet temperature are the same as in Example 11.1. Compare the pressure drops of the water and oil streams within the plate-type heat exchanger to the pressure drops of the flow streams in Example 11.1, if 60 gaps are specified.


### SOLUTION

**Known:** Configuration of a plate-type heat exchanger. Fluid flow rates, inlet temperatures, and desired oil outlet temperature.

### Find:

1. Exterior dimensions of the heat exchanger.
2. Pressure drops within the plate-type heat exchanger with  $N = 60$  gaps, and the concentric tube heat exchanger of Example 11.1.

### Schematic:

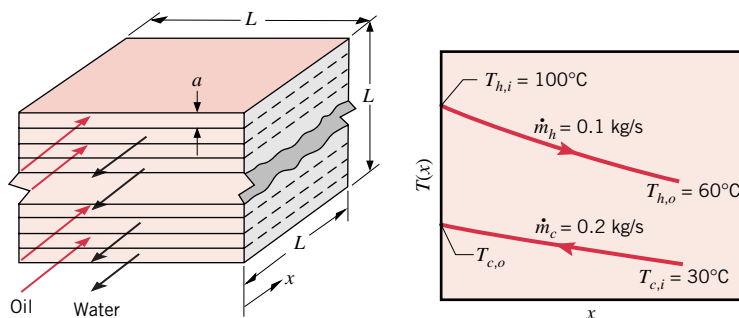

### Assumptions:

1. Negligible heat loss to the surroundings.
2. Negligible kinetic and potential energy changes.
3. Constant properties.
4. Negligible plate thermal resistance and fouling factors.
5. Fully developed conditions for the water and oil.
6. Identical gap-to-gap heat transfer coefficients.
7. Heat exchanger exterior dimension is large compared to the gap width.

**Properties:** See Example 11.1. In addition, Table A.5, unused engine oil ( $\bar{T}_h = 353$  K):  $\rho = 852.1$  kg/m<sup>3</sup>. Table A.6, water ( $\bar{T}_c \approx 35^\circ\text{C}$ ):  $\rho = \nu_f^{-1} = 994$  kg/m<sup>3</sup>.



**Analysis:**

1. The gap width may be related to the overall dimension of the heat exchanger by the expression  $a = L/N$ , and the total heat transfer area is  $A = L^2 (N - 1)$ . Assuming  $a \ll L$  and the existence of laminar flow, the Nusselt number for each interior gap is provided in Table 8.1 and is

$$Nu_D = \frac{hD_h}{k} = 7.54$$

From Equation 8.66, the hydraulic diameter is  $D_h = 2a$ . Combining the preceding expressions yields for the water:

$$h_c = 7.54kN/2L = 7.54 \times 0.625 \text{ W/m} \cdot \text{K} \times N/2L = (2.36 \text{ W/m} \cdot \text{K})N/L$$

Likewise, for the oil:

$$h_h = 7.54kN/2L = 7.54 \times 0.138 \text{ W/m} \cdot \text{K} \times N/2L = (0.520 \text{ W/m} \cdot \text{K})N/L$$

and the overall convection coefficient is

$$U = \frac{1}{1/h_c + 1/h_h}$$


From Example 11.1, the required log mean temperature difference and heat transfer rate are  $\Delta T_{\text{lm}} = 43.2^\circ\text{C}$  and  $q = 8524 \text{ W}$ , respectively. From Equation 11.14 it follows that

$$UA = \frac{L^2(N - 1)}{1/h_c + 1/h_h} = \frac{q}{\Delta T_{\text{lm}}}$$

which may be rearranged to yield

$$\begin{aligned} L &= \frac{q}{\Delta T_{\text{lm}}(N - 1)} \left[ \frac{1}{h_c L} + \frac{1}{h_h L} \right] \\ &= \frac{8524 \text{ W}}{43.2^\circ\text{C}(N - 1)N} \left[ \frac{1}{2.36 \text{ W/m} \cdot \text{K}} + \frac{1}{0.520 \text{ W/m} \cdot \text{K}} \right] = \frac{463 \text{ m}}{N(N - 1)} \quad \triangleleft \end{aligned}$$

The size of the compact heat exchanger decreases as the number of gaps is increased, as shown in the figure below.

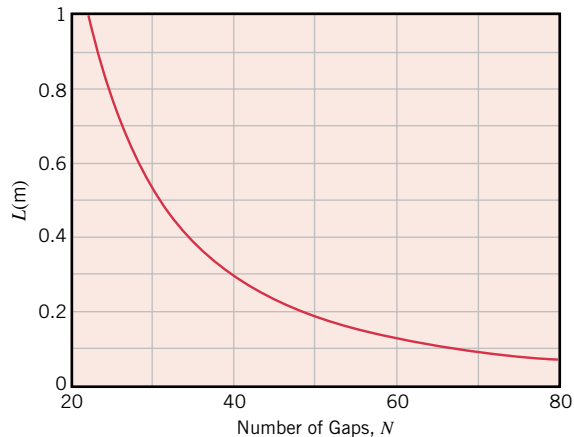

2. For  $N = 60$  gaps, the stack dimension is  $L = 0.131$  m from the results of part 1, and the gap width is  $a = L/N = 0.131$  m/60 = 0.00218 m.

The hydraulic diameter is  $D_h = 0.00436$  m, and the mean velocity in each water-filled gap is

$$u_m = \frac{\dot{m}}{\rho L^2/2} = \frac{2 \times 0.2 \text{ kg/s}}{994 \text{ kg/m}^3 \times 0.131^2 \text{ m}^2} = 0.0235 \text{ m/s}$$

providing a Reynolds number of

$$Re_D = \frac{\rho u_m D_h}{\mu} = \frac{994 \text{ kg/m}^3 \times 0.0235 \text{ m/s} \times 0.00436 \text{ m}}{725 \times 10^{-6} \text{ N} \cdot \text{s/m}^2} = 141$$

For the oil-filled gaps

$$u_m = \frac{\dot{m}}{\rho L^2/2} = \frac{2 \times 0.1 \text{ kg/s}}{852.1 \text{ kg/m}^3 \times 0.131^2 \text{ m}^2} = 0.0137 \text{ m/s}$$

yielding a Reynolds number of

$$Re_D = \frac{\rho u_m D_h}{\mu} = \frac{852.1 \text{ kg/m}^3 \times 0.0137 \text{ m/s} \times 0.00436 \text{ m}}{3.25 \times 10^{-2} \text{ N} \cdot \text{s/m}^2} = 1.57$$

Therefore, the flow is laminar for both fluids, as assumed in part 1. Equations 8.19 and 8.22a may be used to calculate the pressure drop for the water:

$$\begin{aligned} \Delta p &= \frac{64}{Re_D} \cdot \frac{\rho u_m^2}{2D_h} \cdot L = \frac{64}{141} \times \frac{994 \text{ kg/m}^3 \times 0.0235^2 \text{ m}^2/\text{s}^2}{2 \times 0.00436 \text{ m}} \times 0.131 \text{ m} \\ &= 3.76 \text{ N/m}^2 \end{aligned}$$

Similarly, for the oil

$$\begin{aligned} \Delta p &= \frac{64}{Re_D} \cdot \frac{\rho u_m^2}{2D_h} \cdot L = \frac{64}{1.57} \times \frac{852.1 \text{ kg/m}^3 \times 0.0137^2 \text{ m}^2/\text{s}^2}{2 \times 0.00436 \text{ m}} \times 0.131 \text{ m} \\ &= 98.2 \text{ N/m}^2 \end{aligned}$$

For Example 11.1, the friction factor associated with the water flow may be calculated using Equation 8.21, and for a smooth surface condition is  $f = (0.790 \ln(14,050) - 1.64)^{-2} = 0.0287$ . The mean velocity is  $u_m = 4\dot{m}/[\rho\pi D_i^2] = 4 \times 0.2 \text{ kg/s}/(994 \text{ kg/m}^3 \times \pi \times 0.025^2 \text{ m}^2) = 0.410 \text{ m/s}$ , and the pressure drop is

$$\begin{aligned} \Delta p &= f \cdot \frac{\rho u_m^2}{2D_h} \cdot L = 0.0287 \times \frac{994 \text{ kg/m}^3 \times 0.410^2 \text{ m}^2/\text{s}^2}{2 \times 0.025 \text{ m}} \times 65.9 \text{ m} \\ &= 6310 \text{ N/m}^2 \end{aligned}$$

For the oil flowing in the annular region, the mean velocity is  $u_m = 4\dot{m}/[\rho\pi(D_o^2 - D_i^2)] = 4 \times 0.1 \text{ kg/s}/[852.1 \text{ kg/m}^3 \times \pi \times (0.045^2 - 0.025^2) \text{ m}^2] = 0.107 \text{ m/s}$ , and the pressure drop is

$$\begin{aligned} \Delta p &= \frac{64}{Re_D} \cdot \frac{\rho u_m^2}{2D_h} \cdot L = \frac{64}{56} \times \frac{852.1 \text{ kg/m}^3 \times 0.107^2 \text{ m}^2/\text{s}^2}{2 \times 0.020 \text{ m}} \times 65.9 \text{ m} \\ &= 18,300 \text{ N/m}^2 \end{aligned}$$

**Comments:**

1. Increasing the number of gaps increases the  $UA$  product by simultaneously providing more surface area and increasing the heat transfer coefficients associated with the flow of the fluids through smaller passages.
2. The area-to-volume ratio of the  $N = 60$  heat exchanger is  $L^2(N - 1)/L^3 = (N - 1)/L = (60 - 1)/0.131 \text{ m} = 451 \text{ m}^2/\text{m}^3$ .
3. The volume occupied by the concentric tube heat exchanger is  $V = \pi D_o^2 L/4 = \pi \times 0.045^2 \text{ m}^2 \times 65.9 \text{ m}/4 = 0.10 \text{ m}^3$ , while the volume of the compact plate-type exchanger is  $V = L^3 = 0.131^3 \text{ m}^3 = 0.0022 \text{ m}^3$ . Use of the plate-type heat exchanger results in a 97.8% reduction in volume relative to the conventional, concentric tube heat exchanger.
4. The pressure drops associated with use of the compact heat exchanger are significantly less than for a conventional concentric tube configuration. Pressure drops are reduced by 99.9% and 99.5% for the water and oil flows, respectively.
5. Fouling of the heat transfer surfaces may result in a decrease in the gap width, as well as an associated reduction in heat transfer rate and increase in pressure drop.
6. Because  $h_c > h_h$ , the temperatures of the thin metal sheets will follow closely that of the water, and, as in Example 11.1, the assumption of uniform temperature conditions to obtain  $h_c$  and  $h_h$  is reasonable.
7. One method to fabricate such a heat exchanger is presented in C. F. McDonald, *Appl. Thermal Engin.*, **20**, 471, 2000.

**11.4****Heat Exchanger Analysis: The Effectiveness–NTU Method**

It is a simple matter to use the log mean temperature difference (LMTD) method of heat exchanger analysis when the fluid inlet temperatures are known and the outlet temperatures are specified or readily determined from the energy balance expressions, Equations 11.6b and 11.7b. The value of  $\Delta T_{\text{lm}}$  for the exchanger may then be determined. However, if only the inlet temperatures are known, use of the LMTD method requires a cumbersome iterative procedure. It is therefore preferable to use an alternative approach termed the *effectiveness–NTU* (or NTU) method.

**11.4.1 Definitions**

To define the *effectiveness of a heat exchanger*, we must first determine the *maximum possible heat transfer rate*,  $q_{\text{max}}$ , for the exchanger. This heat transfer rate could, in principle, be achieved in a counterflow heat exchanger (Figure 11.8) of infinite length. In such an exchanger, one of the fluids would experience the maximum possible temperature difference,  $T_{h,i} - T_{c,i}$ . To illustrate this point, consider a situation for which  $C_c < C_h$ , in which case, from Equations 11.10 and 11.11,  $|dT_c| > |dT_h|$ . The cold fluid would then experience the larger temperature change, and since  $L \rightarrow \infty$ , it would be heated to the inlet temperature of the hot fluid ( $T_{c,o} = T_{h,i}$ ). Accordingly, from Equation 11.7b,

$$C_c < C_h: \quad q_{\max} = C_c(T_{h,i} - T_{c,i})$$

Similarly, if  $C_h < C_c$ , the hot fluid would experience the larger temperature change and would be cooled to the inlet temperature of the cold fluid ( $T_{h,o} = T_{c,i}$ ). From Equation 11.6b, we then obtain

$$C_h < C_c: \quad q_{\max} = C_h(T_{h,i} - T_{c,i})$$

From the foregoing results we are then prompted to write the general expression

$$q_{\max} = C_{\min}(T_{h,i} - T_{c,i}) \quad (11.18)$$

where  $C_{\min}$  is equal to  $C_c$  or  $C_h$ , whichever is smaller. For prescribed hot and cold fluid inlet temperatures, Equation 11.18 provides the maximum heat transfer rate that could possibly be delivered by the exchanger. A quick mental exercise should convince the reader that the maximum possible heat transfer rate is *not* equal to  $C_{\max}(T_{h,i} - T_{c,i})$ . If the fluid having the larger heat capacity rate were to experience the maximum possible temperature change, conservation of energy in the form  $C_c(T_{c,o} - T_{c,i}) = C_h(T_{h,i} - T_{h,o})$  would require that the other fluid experience yet a larger temperature change. For example, if  $C_{\max} = C_c$  and one argues that it is possible for  $T_{c,o}$  to be equal to  $T_{h,i}$ , it follows that  $(T_{h,i} - T_{h,o}) = (C_c/C_h)(T_{h,i} - T_{c,i})$ , in which case  $(T_{h,i} - T_{h,o}) > (T_{h,i} - T_{c,i})$ . Such a condition is clearly impossible.

It is now logical to define the *effectiveness*,  $\varepsilon$ , as the ratio of the actual heat transfer rate for a heat exchanger to the maximum possible heat transfer rate:

$$\varepsilon \equiv \frac{q}{q_{\max}} \quad (11.19)$$

From Equations 11.6b, 11.7b, and 11.18, it follows that

$$\varepsilon = \frac{C_h(T_{h,i} - T_{h,o})}{C_{\min}(T_{h,i} - T_{c,i})} \quad (11.20)$$

or

$$\varepsilon = \frac{C_c(T_{c,o} - T_{c,i})}{C_{\min}(T_{h,i} - T_{c,i})} \quad (11.21)$$

By definition the effectiveness, which is dimensionless, must be in the range  $0 \leq \varepsilon \leq 1$ . It is useful because, if  $\varepsilon$ ,  $T_{h,i}$ , and  $T_{c,i}$  are known, the actual heat transfer rate may readily be determined from the expression

$$q = \varepsilon C_{\min}(T_{h,i} - T_{c,i}) \quad (11.22)$$

For any heat exchanger it can be shown that [5]

$$\varepsilon = f\left(\text{NTU}, \frac{C_{\min}}{C_{\max}}\right) \quad (11.23)$$

where  $C_{\min}/C_{\max}$  is equal to  $C_c/C_h$  or  $C_h/C_c$ , depending on the relative magnitudes of the hot and cold fluid heat capacity rates. The *number of transfer units* (NTU) is a dimensionless parameter that is widely used for heat exchanger analysis and is defined as

$$\text{NTU} \equiv \frac{UA}{C_{\min}} \quad (11.24)$$

### 11.4.2 Effectiveness–NTU Relations

To determine a specific form of the effectiveness–NTU relation, Equation 11.23, consider a *parallel-flow* heat exchanger for which  $C_{\min} = C_h$ . From Equation 11.20 we then obtain

$$\varepsilon = \frac{T_{h,i} - T_{h,o}}{T_{h,i} - T_{c,i}} \quad (11.25)$$

and from Equations 11.6b and 11.7b it follows that

$$\frac{C_{\min}}{C_{\max}} = \frac{\dot{m}_h c_{p,h}}{\dot{m}_c c_{p,c}} = \frac{T_{c,o} - T_{c,i}}{T_{h,i} - T_{h,o}} \quad (11.26)$$

Now consider Equation 11.13, which may be expressed as

$$\ln \left( \frac{T_{h,o} - T_{c,o}}{T_{h,i} - T_{c,i}} \right) = -\frac{UA}{C_{\min}} \left( 1 + \frac{C_{\min}}{C_{\max}} \right)$$

or from Equation 11.24

$$\frac{T_{h,o} - T_{c,o}}{T_{h,i} - T_{c,i}} = \exp \left[ -NTU \left( 1 + \frac{C_{\min}}{C_{\max}} \right) \right] \quad (11.27)$$

Rearranging the left-hand side of this expression as

$$\frac{T_{h,o} - T_{c,o}}{T_{h,i} - T_{c,i}} = \frac{T_{h,o} - T_{h,i} + T_{h,i} - T_{c,o}}{T_{h,i} - T_{c,i}}$$

and substituting for  $T_{c,o}$  from Equation 11.26, it follows that

$$\frac{T_{h,o} - T_{c,o}}{T_{h,i} - T_{c,i}} = \frac{(T_{h,o} - T_{h,i}) + (T_{h,i} - T_{c,i}) - (C_{\min}/C_{\max})(T_{h,i} - T_{h,o})}{T_{h,i} - T_{c,i}}$$

or from Equation 11.25

$$\frac{T_{h,o} - T_{c,o}}{T_{h,i} - T_{c,i}} = -\varepsilon + 1 - \left( \frac{C_{\min}}{C_{\max}} \right) \varepsilon = 1 - \varepsilon \left( 1 + \frac{C_{\min}}{C_{\max}} \right)$$

Substituting the above expression into Equation 11.27 and solving for  $\varepsilon$ , we obtain for the *parallel-flow heat exchanger*

$$\varepsilon = \frac{1 - \exp \{ -NTU[1 + (C_{\min}/C_{\max})] \}}{1 + (C_{\min}/C_{\max})} \quad (11.28a)$$

Since precisely the same result may be obtained for  $C_{\min} = C_c$ , Equation 11.28a applies for any parallel-flow heat exchanger, irrespective of whether the minimum heat capacity rate is associated with the hot or cold fluid.

Similar expressions have been developed for a variety of heat exchangers [5], and representative results are summarized in Table 11.3, where  $C_r$  is the *heat capacity ratio*  $C_r \equiv C_{\min}/C_{\max}$ . In deriving Equation 11.31a for a shell-and-tube heat exchanger with multiple shell passes, it is assumed that the total NTU is equally distributed between shell passes of the same arrangement,  $NTU = n(NTU)_1$ . In order to determine  $\varepsilon$ ,  $(NTU)_1$  would first be calculated using the heat transfer area for one shell,  $\varepsilon_1$  would then be calculated from Equation 11.30a, and  $\varepsilon$  would finally be

**TABLE 11.3** Heat Exchanger Effectiveness Relations [5]

Flow Arrangement	Relation	
<b>Concentric tube</b>		
Parallel flow	$\varepsilon = \frac{1 - \exp[-NTU(1 + C_r)]}{1 + C_r}$	(11.28a)
Counterflow	$\varepsilon = \frac{1 - \exp[-NTU(1 - C_r)]}{1 - C_r \exp[-NTU(1 - C_r)]}$	$(C_r < 1)$
	$\varepsilon = \frac{NTU}{1 + NTU}$	$(C_r = 1)$ (11.29a)
<b>Shell-and-tube</b>		
One shell pass (2, 4, . . . tube passes)	$\varepsilon_1 = 2 \left\{ 1 + C_r + (1 + C_r^2)^{1/2} \right. \\ \left. \times \frac{1 + \exp[-(NTU)_1(1 + C_r^2)^{1/2}]}{1 - \exp[-(NTU)_1(1 + C_r^2)^{1/2}]} \right\}^{-1}$	(11.30a)
$n$ Shell passes ( $2n, 4n, . . .$ tube passes)	$\varepsilon = \left[ \left( \frac{1 - \varepsilon_1 C_r}{1 - \varepsilon_1} \right)^n - 1 \right] \left[ \left( \frac{1 - \varepsilon_1 C_r}{1 - \varepsilon_1} \right)^n - C_r \right]^{-1}$	(11.31a)
<b>Cross-flow (single pass)</b>		
Both fluids unmixed	$\varepsilon = 1 - \exp \left[ \left( \frac{1}{C_r} \right) (NTU)^{0.22} \{ \exp[-C_r(NTU)^{0.78}] - 1 \} \right]$	(11.32)
$C_{\max}$ (mixed), $C_{\min}$ (unmixed)	$\varepsilon = \left( \frac{1}{C_r} \right) (1 - \exp \{ -C_r [1 - \exp(-NTU)] \})$	(11.33a)
$C_{\min}$ (mixed), $C_{\max}$ (unmixed)	$\varepsilon = 1 - \exp(-C_r^{-1} \{ 1 - \exp[-C_r(NTU)] \})$	(11.34a)
<b>All exchangers (<math>C_r = 0</math>)</b>	$\varepsilon = 1 - \exp(-NTU)$	(11.35a)

calculated from Equation 11.31a. Note that for  $C_r = 0$ , as in a boiler or condenser,  $\varepsilon$  is given by Equation 11.35a for *all flow arrangements*. Hence, for this special case, it follows that heat exchanger behavior is independent of flow arrangement. For the cross-flow heat exchanger with both fluids unmixed, Equation 11.32 is exact only for  $C_r = 1$ . However, it may be used to a good approximation for all  $0 < C_r \leq 1$ . For  $C_r = 0$ , Equation 11.35a must be used.

In heat exchanger design calculations (Section 11.5), it is more convenient to work with  $\varepsilon$ –NTU relations of the form

$$NTU = f \left( \varepsilon, \frac{C_{\min}}{C_{\max}} \right)$$


Explicit relations for NTU as a function of  $\varepsilon$  and  $C_r$  are provided in Table 11.4. Note that Equation 11.32 may not be manipulated to yield a direct relationship for NTU as a function of  $\varepsilon$  and  $C_r$ . Note also that to determine the NTU for a shell-and-tube heat exchanger with multiple shell passes,  $\varepsilon$  would first be calculated for the entire heat exchanger. The variables  $F$  and  $\varepsilon_1$  would then be calculated using Equations 11.31c and 11.31b, respectively. The parameter  $E$  would subsequently be determined from Equation 11.30c and substituted into Equation 11.30b to find

**TABLE 11.4** Heat Exchanger NTU Relations


Flow Arrangement	Relation
<b>Concentric tube</b>	
Parallel flow	$NTU = -\frac{\ln[1 - \varepsilon(1 + C_r)]}{1 + C_r} \quad (11.28b)$
Counterflow	$NTU = \frac{1}{C_r - 1} \ln\left(\frac{\varepsilon - 1}{\varepsilon C_r - 1}\right) \quad (C_r < 1)$
	$NTU = \frac{\varepsilon}{1 - \varepsilon} \quad (C_r = 1) \quad (11.29b)$
<b>Shell-and-tube</b>	
One shell pass (2, 4, . . . tube passes)	$(NTU)_1 = -(1 + C_r^2)^{-1/2} \ln\left(\frac{E - 1}{E + 1}\right) \quad (11.30b)$
	$E = \frac{2/\varepsilon_1 - (1 + C_r)}{(1 + C_r^2)^{1/2}} \quad (11.30c)$
$n$ Shell passes ( $2n, 4n, . . .$ tube passes)	Use Equations 11.30b and 11.30c with $\varepsilon_1 = \frac{F - 1}{F - C_r} \quad F = \left(\frac{\varepsilon C_r - 1}{\varepsilon - 1}\right)^{1/n} \quad NTU = n(NTU)_1 \quad (11.31b, c, d)$
<b>Cross-flow (single pass)</b>	
$C_{\max}$ (mixed), $C_{\min}$ (unmixed)	$NTU = -\ln\left[1 + \left(\frac{1}{C_r}\right) \ln(1 - \varepsilon C_r)\right] \quad (11.33b)$
$C_{\min}$ (mixed), $C_{\max}$ (unmixed)	$NTU = -\left(\frac{1}{C_r}\right) \ln[C_r \ln(1 - \varepsilon) + 1] \quad (11.34b)$
All exchangers ( $C_r = 0$ )	$NTU = -\ln(1 - \varepsilon) \quad (11.35b)$

$(NTU)_1$ . Finally, this result would be multiplied by  $n$  to obtain the NTU for the entire exchanger, as indicated in Equation 11.31d.


The foregoing expressions are represented graphically in Figures 11.10 through 11.15. When using Figure 11.13, the abscissa corresponds to the total number of

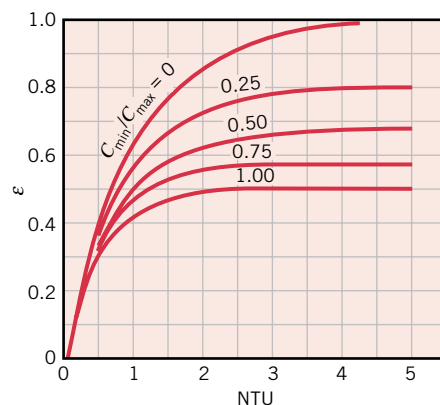


**FIGURE 11.10** Effectiveness of a parallel-flow heat exchanger (Equation 11.28).

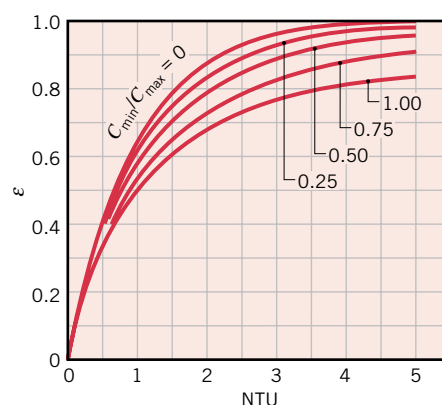

**FIGURE 11.11** Effectiveness of a counterflow heat exchanger (Equation 11.29).

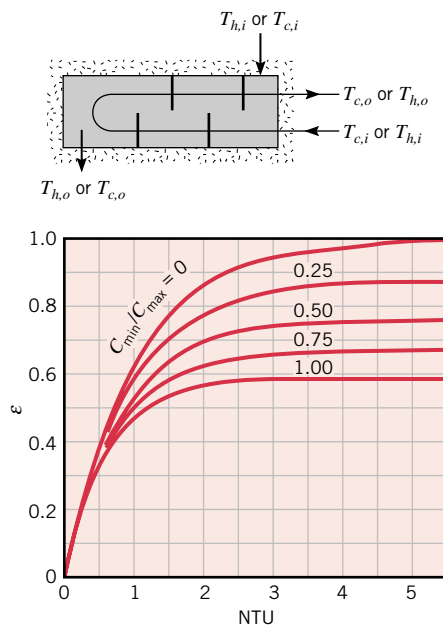

**FIGURE 11.12** Effectiveness of a shell-and-tube heat exchanger with one shell and any multiple of two tube passes (two, four, etc. tube passes) (Equation 11.30).

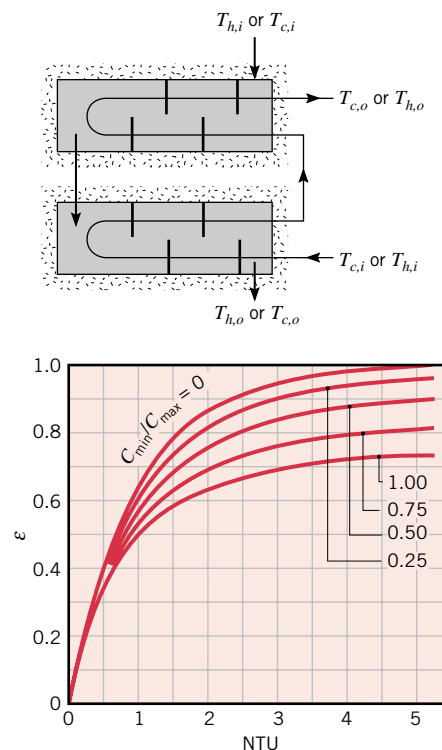


**FIGURE 11.13** Effectiveness of a shell-and-tube heat exchanger with two shell passes and any multiple of four tube passes (four, eight, etc. tube passes) (Equation 11.31 with  $n = 2$ ).

transfer units,  $NTU = n(NTU)_1$ . For Figure 11.15 the solid curves correspond to  $C_{min}$  mixed and  $C_{max}$  unmixed, while the dashed curves correspond to  $C_{min}$  unmixed and  $C_{max}$  mixed. Note that for  $C_r = 0$ , all heat exchangers have the same effectiveness, which may be computed from Equation 11.35a. Moreover, if  $NTU \lesssim 0.25$ , all heat exchangers have approximately the same effectiveness, regardless of the value of  $C_r$ , and  $\epsilon$  may again be computed from Equation 11.35a. More generally, for  $C_r > 0$  and  $NTU \gtrsim 0.25$ , the counterflow exchanger is the most effective. For any exchanger, maximum and minimum values of the effectiveness are associated with  $C_r = 0$  and  $C_r = 1$ , respectively.


As noted previously, in the context of cross-flow heat exchangers, the terms *mixed* and *unmixed* are idealizations representing limiting cases of actual flow conditions. That is, most flows are neither completely mixed nor unmixed, but exhibit partial degrees of mixing. This issue has been addressed by DiGiovanni and Webb [7], and algebraic expressions have been developed to determine the  $\epsilon$ – $NTU$  relationship for arbitrary values of partial mixing.

We also note that both the LMTD and  $\epsilon$ – $NTU$  methods approach heat exchanger analysis from a global perspective and provide no information concerning conditions within the exchanger. Although flow and temperature variations within a



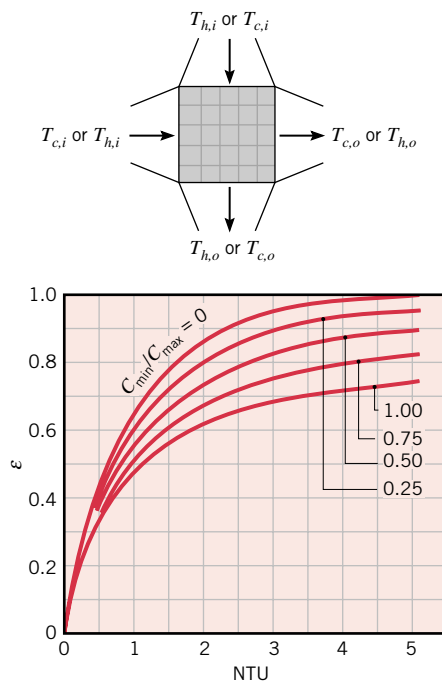

**FIGURE 11.14** Effectiveness of a single-pass, cross-flow heat exchanger with both fluids unmixed (Equation 11.32).

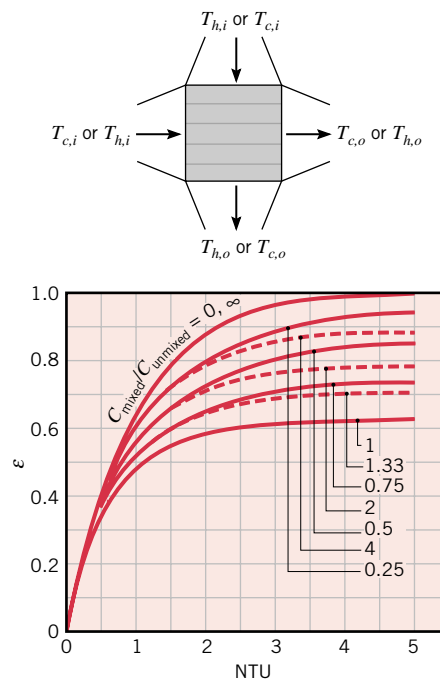

**FIGURE 11.15** Effectiveness of a single-pass, cross-flow heat exchanger with one fluid mixed and the other unmixed (Equations 11.33, 11.34).

heat exchanger may be determined using commercial CFD (computational fluid dynamic) computer codes, simpler numerical procedures may be adopted. Such procedures have been applied by Ribando et al. to determine temperature variations in concentric tube and shell-and-tube heat exchangers [8].

### EXAMPLE 11.3


Hot exhaust gases, which enter a finned-tube, cross-flow heat exchanger at 300°C and leave at 100°C, are used to heat pressurized water at a flow rate of 1 kg/s from 35 to 125°C. The exhaust gas specific heat is approximately 1000 J/kg · K, and the overall heat transfer coefficient based on the gas-side surface area is  $U_h = 100$  W/m<sup>2</sup> · K. Determine the required gas-side surface area  $A_h$  using the NTU method.

### SOLUTION

**Known:** Inlet and outlet temperatures of hot gases and water used in a finned-tube, cross-flow heat exchanger. Water flow rate and gas-side overall heat transfer coefficient.

**Find:** Required gas-side surface area.

**Schematic:**

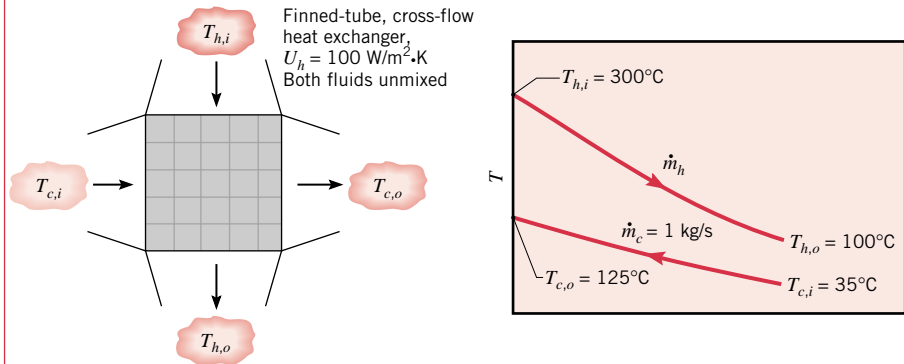

**Assumptions:**

1. Negligible heat loss to the surroundings and kinetic and potential energy changes.
2. Constant properties.

**Properties:** Table A.6, water ( $\bar{T}_c = 80^\circ\text{C}$ ):  $c_{p,c} = 4197 \text{ J/kg} \cdot \text{K}$ . Exhaust gases:  $c_{p,h} = 1000 \text{ J/kg} \cdot \text{K}$ .

**Analysis:** The required surface area may be obtained from knowledge of the number of transfer units, which, in turn, may be obtained from knowledge of the ratio of heat capacity rates and the effectiveness. To determine the minimum heat capacity rate, we begin by computing

$$C_c = \dot{m}_c c_{p,c} = 1 \text{ kg/s} \times 4197 \text{ J/kg} \cdot \text{K} = 4197 \text{ W/K}$$

Since  $\dot{m}_h$  is not specified,  $C_h$  is obtained by combining the overall energy balances, Equations 11.6b and 11.7b:

$$C_h = \dot{m}_h c_{p,h} = C_c \frac{T_{c,o} - T_{c,i}}{T_{h,i} - T_{h,o}} = 4197 \frac{125 - 35}{300 - 100} = 1889 \text{ W/K} = C_{\min}$$

From Equation 11.18

$$q_{\max} = C_{\min}(T_{h,i} - T_{c,i}) = 1889 \text{ W/K} (300 - 35)^\circ\text{C} = 5.00 \times 10^5 \text{ W}$$

From Equation 11.7b the actual heat transfer rate is

$$q = \dot{m}_c c_{p,c} (T_{c,o} - T_{c,i}) = 1 \text{ kg/s} \times 4197 \text{ J/kg} \cdot \text{K} (125 - 35)^\circ\text{C}$$

$$q = 3.78 \times 10^5 \text{ W}$$

Hence from Equation 11.19 the effectiveness is

$$\varepsilon = \frac{q}{q_{\max}} = \frac{3.78 \times 10^5 \text{ W}}{5.00 \times 10^5 \text{ W}} = 0.75$$

With

$$\frac{C_{\min}}{C_{\max}} = \frac{1889}{4197} = 0.45$$


it follows from Figure 11.14 that

$$\text{NTU} = \frac{U_h A_h}{C_{\min}} \approx 2.1$$

or

$$A_h = \frac{2.1(1889 \text{ W/K})}{100 \text{ W/m}^2 \cdot \text{K}} = 39.7 \text{ m}^2$$

**Comments:** With the heat exchanger sized ( $A_h = 39.7 \text{ m}^2$ ) and placed into operation, its actual performance is subject to uncontrolled variations in the exhaust gas inlet temperature ( $200 \leq T_{h,i} \leq 400^\circ\text{C}$ ) and to gradual degradation of the heat exchanger surfaces due to fouling ( $U_h$  decreasing from 100 to  $60 \text{ W/m}^2 \cdot \text{K}$ ). For a fixed value of  $C_{\min} = C_h = 1889 \text{ W/K}$ , the reduction in  $U_h$  corresponds to a reduction in the NTU (to  $\text{NTU} \approx 1.26$ ) and hence to a reduction in the heat exchanger effectiveness, which can be computed from Equation 11.32. The effect of the variations on the water outlet temperature has been computed and is plotted as follows:

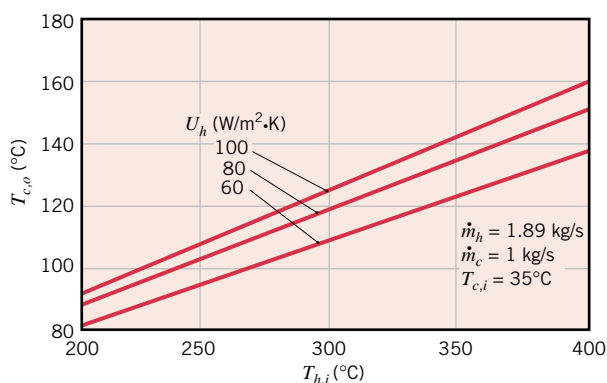

If the intent is to maintain a fixed water outlet temperature of  $T_{c,o} = 125^\circ\text{C}$ , adjustments in the flow rates,  $\dot{m}_c$  and  $\dot{m}_h$ , could be made to compensate for the variations. The model equations could be used to determine the adjustments and hence as a basis for designing the requisite *controller*.

## 11.5

### Heat Exchanger Design and Performance

#### Calculations: Using the Effectiveness–NTU Method

Two general types of heat exchanger problems are commonly encountered by the practicing engineer.

In the *heat exchanger design problem*, the fluid inlet temperatures and flow rates, as well as a desired hot or cold fluid outlet temperature, are prescribed. The design problem is then one of specifying a specific heat exchanger type and determining its size—that is, the heat transfer surface area  $A$ —required to achieve the desired outlet temperature. The design problem is commonly encountered when a heat exchanger is to be custom-built for a specific application. Alternatively, in a *heat exchanger performance calculation*, an existing heat exchanger is analyzed to determine the heat transfer rate and the fluid outlet temperatures for prescribed flow

rates and inlet temperatures. The performance calculation is commonly associated with the use of off-the-shelf heat exchanger types and sizes available from a vendor.

For heat exchanger design problems, the NTU method may be used by first calculating  $\varepsilon$  and  $(C_{\min}/C_{\max})$ . The appropriate equation (or chart) may then be used to obtain the NTU value, which in turn may be used to determine  $A$ . For a performance calculation, the NTU and  $(C_{\min}/C_{\max})$  values may be computed and  $\varepsilon$  may then be determined from the appropriate equation (or chart) for a particular exchanger type. Since  $q_{\max}$  may also be computed from Equation 11.18, it is a simple matter to determine the actual heat transfer rate from the requirement that  $q = \varepsilon q_{\max}$ . Both fluid outlet temperatures may then be determined from Equations 11.6b and 11.7b.

#### EXAMPLE 11.4


Consider the heat exchanger design of Example 11.3, that is, a finned-tube, cross-flow heat exchanger with a gas-side overall heat transfer coefficient and area of  $100 \text{ W/m}^2 \cdot \text{K}$  and  $40 \text{ m}^2$ , respectively. The water flow rate and inlet temperature remain at  $1 \text{ kg/s}$  and  $35^\circ\text{C}$ . However, a change in operating conditions for the hot gas generator causes the gases to now enter the heat exchanger with a flow rate of  $1.5 \text{ kg/s}$  and a temperature of  $250^\circ\text{C}$ . What is the rate of heat transfer by the exchanger, and what are the gas and water outlet temperatures?

#### SOLUTION

**Known:** Hot and cold fluid inlet conditions for a finned-tube, cross-flow heat exchanger of known surface area and overall heat transfer coefficient.

**Find:** Heat transfer rate and fluid outlet temperatures.

**Schematic:**

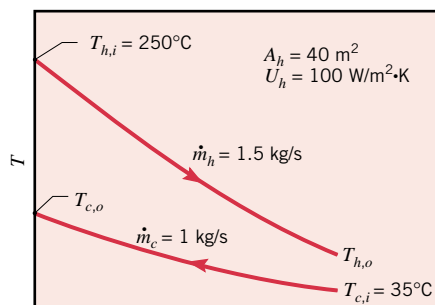

**Assumptions:**

1. Negligible heat loss to surroundings and kinetic and potential energy changes.
2. Constant properties (unchanged from Example 11.3).

**Analysis:** The problem may be classified as one requiring a heat exchanger *performance calculation*. The heat capacity rates are

$$C_c = \dot{m}_c c_{p,c} = 1 \text{ kg/s} \times 4197 \text{ J/kg} \cdot \text{K} = 4197 \text{ W/K}$$

$$C_h = \dot{m}_h c_{p,h} = 1.5 \text{ kg/s} \times 1000 \text{ J/kg} \cdot \text{K} = 1500 \text{ W/K} = C_{\min}$$

in which case

$$\frac{C_{\min}}{C_{\max}} = \frac{1500}{4197} = 0.357$$

The number of transfer units is

$$\text{NTU} = \frac{U_h A_h}{C_{\min}} = \frac{100 \text{ W/m}^2 \cdot \text{K} \times 40 \text{ m}^2}{1500 \text{ W/K}} = 2.67$$

From Figure 11.14 the heat exchanger effectiveness is then  $\varepsilon \approx 0.82$ , and from Equation 11.18 the maximum possible heat transfer rate is

$$q_{\max} = C_{\min}(T_{h,i} - T_{c,i}) = 1500 \text{ W/K} (250 - 35)^\circ\text{C} = 3.23 \times 10^5 \text{ W}$$

Accordingly, from the definition of  $\varepsilon$ , Equation 11.19, the actual heat transfer rate is

$$q = \varepsilon q_{\max} = 0.82 \times 3.23 \times 10^5 \text{ W} = 2.65 \times 10^5 \text{ W} \quad \triangleleft$$

It is now a simple matter to determine the outlet temperatures from the overall energy balances. From Equation 11.6b

$$T_{h,o} = T_{h,i} - \frac{q}{\dot{m}_h c_{p,h}} = 250^\circ\text{C} - \frac{2.65 \times 10^5 \text{ W}}{1500 \text{ W/K}} = 73.3^\circ\text{C} \quad \triangleleft$$

and from Equation 11.7b

$$T_{c,o} = T_{c,i} + \frac{q}{\dot{m}_c c_{p,c}} = 35^\circ\text{C} + \frac{2.65 \times 10^5 \text{ W}}{4197 \text{ W/K}} = 98.1^\circ\text{C} \quad \triangleleft$$

### Comments:

1. From Equation 11.32,  $\varepsilon = 0.845$ , which is in good agreement with the estimate obtained from the charts.
2. The overall heat transfer coefficient has tacitly been assumed to be unaffected by the change in  $\dot{m}_h$ . In fact, with an approximately 20% reduction in  $\dot{m}_h$ , there would be a significant, albeit smaller percentage, reduction in  $U_h$ .
3. As discussed in the Comment of Example 11.3, flow rate adjustments could be made to maintain a fixed water outlet temperature. If, for example, the outlet temperature must be maintained at  $T_{c,o} = 125^\circ\text{C}$ , the water flow rate could be reduced to an amount prescribed by Equation 11.7b. That is,

$$\dot{m}_c = \frac{q}{c_{p,c}(T_{c,o} - T_{c,i})} = \frac{2.65 \times 10^5 \text{ W}}{4197 \text{ J/kg} \cdot \text{K} (125 - 35)^\circ\text{C}} = 0.702 \text{ kg/s}$$

The change in flow rate has again been presumed to have a negligible effect on  $U_h$ . In this case the assumption is good, since the dominant contribution to  $U_h$  is made by the gas-side, and not the water-side, convection coefficient.

### EXAMPLE 11.5

The condenser of a large steam power plant is a heat exchanger in which steam is condensed to liquid water. Assume the condenser to be a *shell-and-tube* heat exchanger consisting of a single shell and 30,000 tubes, each executing two passes. The tubes are of thin wall construction with  $D = 25 \text{ mm}$ , and steam condenses on their outer surface with an associated convection coefficient of  $h_o = 11,000 \text{ W/m}^2 \cdot \text{K}$ . The heat transfer rate that must be effected by the exchanger is  $q = 2 \times 10^9 \text{ W}$ , and

this is accomplished by passing cooling water through the tubes at a rate of  $3 \times 10^4$  kg/s (the flow rate per tube is therefore 1 kg/s). The water enters at  $20^\circ\text{C}$ , while the steam condenses at  $50^\circ\text{C}$ . What is the temperature of the cooling water emerging from the condenser? What is the required tube length  $L$  per pass?


### SOLUTION

**Known:** Heat exchanger consisting of single shell and 30,000 tubes with two passes each.

### Find:

1. Outlet temperature of the cooling water.
2. Tube length per pass to achieve required heat transfer.

### Schematic:

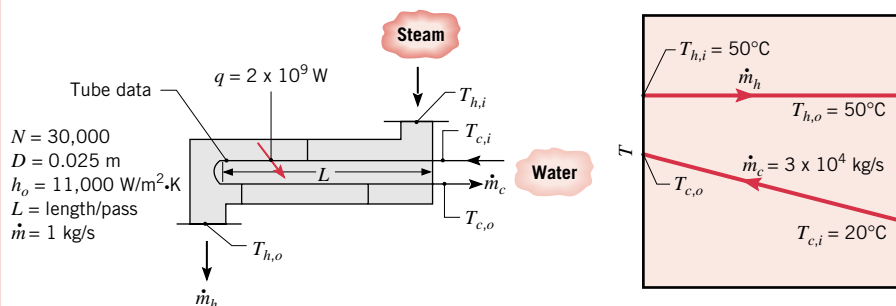

### Assumptions:

1. Negligible heat transfer between exchanger and surroundings and negligible kinetic and potential energy changes.
2. Tube internal flow and thermal conditions fully developed.
3. Negligible thermal resistance of tube material and fouling effects.
4. Constant properties.

**Properties:** Table A.6, water (assume  $\bar{T}_c \approx 27^\circ\text{C} = 300 \text{ K}$ ):  $\rho = 997 \text{ kg/m}^3$ ,  $c_p = 4179 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 855 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ,  $k = 0.613 \text{ W/m} \cdot \text{K}$ ,  $Pr = 5.83$ .

### Analysis:

1. The cooling water outlet temperature may be obtained from the overall energy balance, Equation 11.7b. Accordingly,

$$T_{c,o} = T_{c,i} + \frac{q}{\dot{m}_c c_{p,c}} = 20^\circ\text{C} + \frac{2 \times 10^9 \text{ W}}{3 \times 10^4 \text{ kg/s} \times 4179 \text{ J/kg} \cdot \text{K}}$$

$$T_{c,o} = 36.0^\circ\text{C}$$

2. The problem may be classified as one requiring a *heat exchanger design calculation*. First, we determine the overall heat transfer coefficient for use in the NTU method.

From Equation 11.5

$$U = \frac{1}{(1/h_i) + (1/h_o)}$$

where  $h_i$  may be estimated from an internal flow correlation. With

$$Re_D = \frac{4\dot{m}}{\pi D \mu} = \frac{4 \times 1 \text{ kg/s}}{\pi (0.025 \text{ m}) 855 \times 10^{-6} \text{ N} \cdot \text{s/m}^2} = 59,567$$

the flow is turbulent and from Equation 8.60

$$Nu_D = 0.023 Re_D^{4/5} Pr^{0.4} = 0.023 (59,567)^{0.8} (5.83)^{0.4} = 308$$

Hence

$$h_i = Nu_D \frac{k}{D} = 308 \frac{0.613 \text{ W/m} \cdot \text{K}}{0.025 \text{ m}} = 7543 \text{ W/m}^2 \cdot \text{K}$$

$$U = \frac{1}{[(1/7543) + (1/11,000)] \text{ m}^2 \cdot \text{K/W}} = 4474 \text{ W/m}^2 \cdot \text{K}$$

Using the design calculation methodology, we note that

$$C_h = C_{\max} = \infty$$

and

$$C_{\min} = \dot{m}_c c_{p,c} = 3 \times 10^4 \text{ kg/s} \times 4179 \text{ J/kg} \cdot \text{K} = 1.25 \times 10^8 \text{ W/K}$$

from which

$$\frac{C_{\min}}{C_{\max}} = C_r = 0$$

The maximum possible heat transfer rate is

$$q_{\max} = C_{\min}(T_{h,i} - T_{c,i}) = 1.25 \times 10^8 \text{ W/K} \times (50 - 20) \text{ K} = 3.76 \times 10^9 \text{ W}$$

from which


$$\varepsilon = \frac{q}{q_{\max}} = \frac{2 \times 10^9 \text{ W}}{3.76 \times 10^9 \text{ W}} = 0.532$$

From Equation 11.35b or Figure 11.12, we find  $NTU = 0.759$ . From Equation 11.24, it follows that the tube length per pass is

$$L = \frac{NTU \cdot C_{\min}}{U(N2\pi D)} = \frac{0.759 \times 1.25 \times 10^8 \text{ W/K}}{4474 \text{ W/m}^2 \cdot \text{K} (30,000 \times 2 \times \pi \times 0.025 \text{ m})} = 4.51 \text{ m} \quad \triangleleft$$

### Comments:

1. Recognize that  $L$  is the tube length per pass, in which case the total length per tube is 9.0 m. The entire length of tubing in the condenser is  $N \times L \times 2 = 30,000 \times 4.51 \text{ m} \times 2 = 271,000 \text{ m}$  or 271 km.
2. Over time, the performance of the heat exchanger would be degraded by fouling on both the inner and outer tube surfaces. A representative maintenance schedule would call for taking the heat exchanger off-line and cleaning the tubes when fouling factors reached values of  $R''_{f,i} = R''_{f,o} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ . To determine the effect of fouling on performance, the  $\varepsilon$ -NTU method may be used to calculate the total heat rate as a function of the fouling factor, with  $R''_{f,o}$  assumed to equal  $R''_{f,i}$ . The following results are obtained:

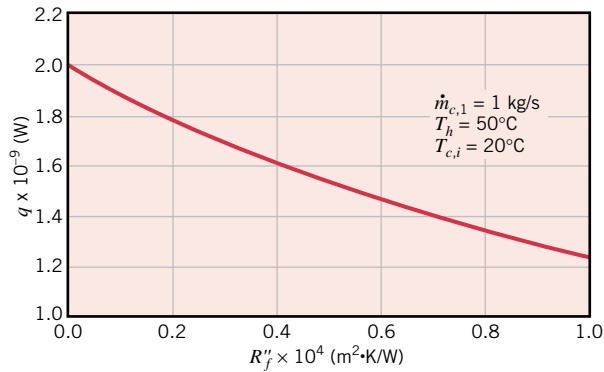

To maintain the requirement of  $q = 2 \times 10^9 \text{ W}$  with the maximum allowable fouling and the restriction of  $\dot{m}_{c,1} = 1 \text{ kg/s}$ , the tube length or the number of tubes would have to be increased. Keeping the length per pass at  $L = 4.51 \text{ m}$ ,  $N = 48,300$  tubes would be needed to transfer  $2 \times 10^9 \text{ W}$  for  $R_{f,i}'' = R_{f,o}'' = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ . The corresponding increase in the total flow rate to  $\dot{m}_c = N\dot{m}_{c,1} = 48,300 \text{ kg/s}$  would have the beneficial effect of reducing the water outlet temperature to  $T_{c,o} = 29.9^\circ\text{C}$ , thereby ameliorating potentially harmful effects associated with discharge into the environment. The additional tube length associated with increasing the number of tubes to  $N = 48,300$  is 165 km, which would result in a significant increase in the capital cost of the condenser.

3. The steam plant generates 1250 MW of electricity with a wholesale value of \$0.05 per kW·h. If the plant is shut down for 48 hours to clean the condenser tubes, the loss in revenue for the plant's owner is  $48 \text{ h} \times 1250 \times 10^6 \text{ W} \times \$0.05/(1 \times 10^3 \text{ W} \cdot \text{h}) = \$3 \text{ million}$ .
4. Assuming a smooth surface condition within each tube, the friction factor may be determined from Equation 8.20b,  $f = 0.184(59,567)^{-0.2} = 0.020$ . The pressure drop within one tube of length  $L = 9 \text{ m}$  may be determined from Equation 8.22a, where  $u_m = 4\dot{m}/(\rho\pi D^2) = (4 \times 1 \text{ kg/s})/(997 \text{ kg/m}^3 \times \pi \times 0.025^2 \text{ m}^2) = 2.04 \text{ m/s}$ .

$$\Delta p = f \frac{\rho u_m^2}{2D} L = 0.020 \frac{997 \text{ kg/m}^3 (2.04 \text{ m/s})^2}{2(0.025 \text{ m})} 9.0 \text{ m} = 15,300 \text{ N/m}^2$$

Therefore, the power required to pump the cooling water through the 48,300 tubes may be found by using Equation 8.22b and is

$$P = \frac{\Delta p \dot{m}}{\rho} = \frac{15,300 \text{ N/m}^2 \times 48,300 \text{ kg/s}}{997 \text{ kg/m}^3} = 742,000 \text{ W} = 0.742 \text{ MW}$$

The cooling water pump is driven by an electric motor. If the combined efficiency of the pump and motor is 87%, the annual cost to overcome friction losses in the condenser tubes is  $24 \text{ h/day} \times 365 \text{ days/yr} \times 0.742 \times 10^6 \text{ W} \times \$0.05/(1 \times 10^3 \text{ W} \cdot \text{h}/0.87) = \$374,000$ .

5. Optimal condenser designs are based on the desired thermal performance and environmental considerations as well as on the capital cost, operating cost, and maintenance cost associated with the device.




## 11.6

### Compact Heat Exchangers


As discussed in Section 11.1, *compact heat exchangers* are typically used when a large heat transfer surface area per unit volume is desired and at least one of the fluids is a gas. Many different tubular and plate configurations have been considered, where differences are due primarily to fin design and arrangement. Heat transfer and flow characteristics have been determined for specific configurations and are typically presented in the format of Figures 11.16 and 11.17. Heat transfer results are correlated in terms of the Colburn  $j$  factor  $j_H = St Pr^{2/3}$  and the Reynolds number, where both the Stanton ( $St = h/Gc_p$ ) and Reynolds ( $Re = GD_h/\mu$ ) numbers are based on the maximum mass velocity

$$G \equiv \rho V_{\max} = \frac{\rho V A_{\text{fr}}}{A_{\text{ff}}} = \frac{\dot{m}}{A_{\text{ff}}} = \frac{\dot{m}}{\sigma A_{\text{fr}}} \quad (11.36)$$

The quantity  $\sigma$  is the ratio of the minimum free-flow area of the finned passages (cross-sectional area perpendicular to flow direction),  $A_{\text{ff}}$ , to the frontal area,  $A_{\text{fr}}$ , of the exchanger. Values of  $\sigma$ ,  $D_h$  (the hydraulic diameter of the flow passage),  $\alpha$  (the heat transfer surface area per total heat exchanger volume),  $A_f/A$  (the ratio of fin to total heat transfer surface area), and other geometrical parameters are listed for each configuration. The ratio  $A_f/A$  is used in Equation 11.3 to evaluate the temperature effectiveness  $\eta_o$ . In a design calculation,  $\alpha$  would be used to determine the required heat exchanger volume, after the total heat transfer surface area has been found; in a performance calculation it would be used to determine the surface area from knowledge of the heat exchanger volume.

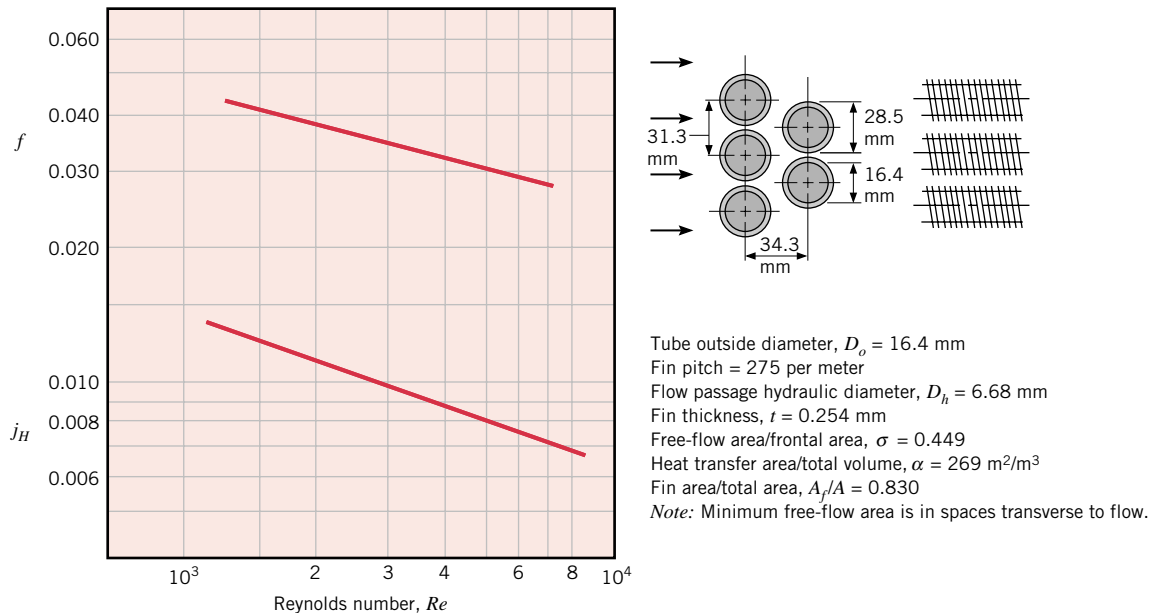

**FIGURE 11.16** Heat transfer and friction factor for a circular tube–circular fin heat exchanger, surface CF-7.0-5/8J from Kays and London [5].

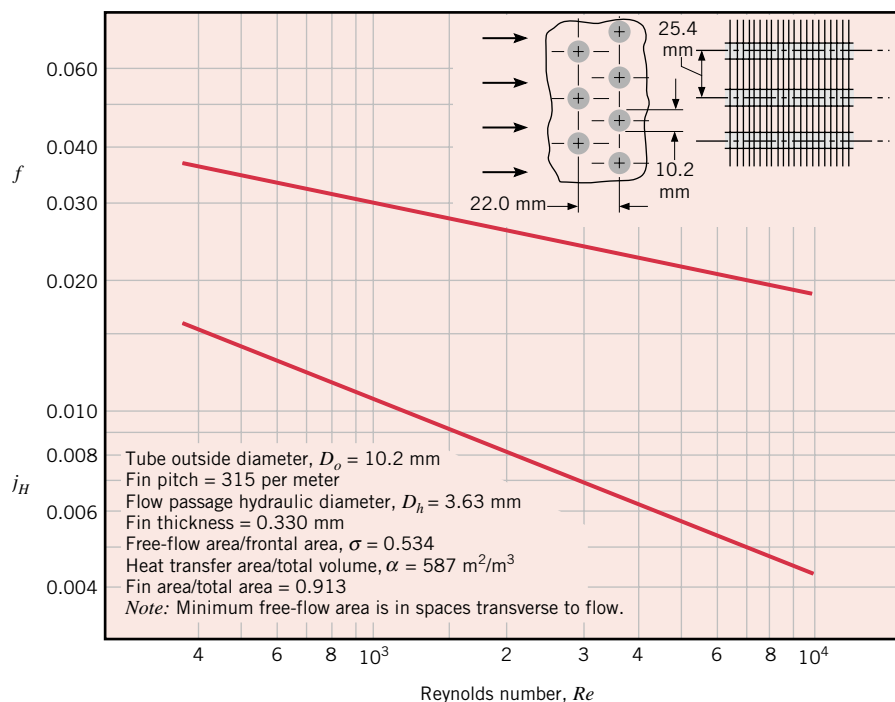

**FIGURE 11.17** Heat transfer and friction factor for a circular tube–continuous fin heat exchanger, surface 8.0-3/8T from Kays and London [5].

In a compact heat exchanger calculation, empirical information, such as that provided in Figures 11.16 and 11.17, would first be used to determine the average convection coefficient of the finned surfaces. The overall heat transfer coefficient would then be determined, and using the  $\varepsilon$ -NTU method, the heat exchanger design or performance calculations would be performed.

The pressure drop associated with flow across finned-tube banks, such as those of Figures 11.16 and 11.17, may be computed from the expression

$$\Delta p = \frac{G^2 v_i}{2} \left[ (1 + \sigma^2) \left( \frac{v_o}{v_i} - 1 \right) + f \frac{A}{A_{ff}} \frac{v_m}{v_i} \right] \quad (11.37)$$

where  $v_i$  and  $v_o$  are the fluid inlet and outlet specific volumes and  $v_m = (v_i + v_o)/2$ . The first term on the right-hand side of Equation 11.37 accounts for the cumulative effects of pressure change due to inviscid fluid acceleration and deceleration at the exchanger inlet and outlet, respectively. The effects are *reversible*, and if fluid density variations may be neglected ( $v_o \approx v_i$ ), the term is negligible. The second term accounts for losses due to fluid friction in the heat exchanger core, with fully developed conditions presumed to exist throughout the core. For a prescribed core configuration, the friction factor is known as a function of Reynolds number, as, for example, from Figures 11.16 and 11.17; and for a prescribed heat exchanger size, the area ratio may be evaluated from the relation  $(A/A_{ff}) = (\alpha V/\sigma A_{ff})$ , where  $V$  is the total heat exchanger volume.

Equation 11.37 does not account for irreversible losses due to viscous effects at the inlet and outlet of the heat exchanger. The losses depend on the nature of the ductwork used to transport fluids to and from the heat exchanger core. If the

transition between the ductwork and the core occurs with little flow separation, the losses are small. However, if there are abrupt changes between the duct cross-sectional area and the free-flow area of the heat exchanger, separation is pronounced and the attendant losses are large. Inlet and exit losses may be estimated from empirical *contraction* and *expansion coefficients* obtained for a variety of core geometries [5].

The classic work of Kays and London [5] provides Colburn  $j$  and friction factor data for many different compact heat exchanger cores, which include flat tube (Figure 11.5a) and plate-fin (Figure 11.5d, e) configurations, as well as other circular tube configurations (Figure 11.5b, c). Other excellent sources of information are provided by References 3, 4, 9, and 10.

### EXAMPLE 11.6


Consider a finned-tube, compact heat exchanger having the core configuration of Figure 11.16. The core is fabricated from aluminum, and the tubes have an inside diameter of 13.8 mm. In a waste heat recovery application, water flow through the tubes provides an inside convection coefficient of  $h_i = 1500 \text{ W/m}^2 \cdot \text{K}$ , while combustion gases at 1 atm and 825 K are in cross flow over the tubes. If the gas flow rate is 1.25 kg/s and the frontal area is  $0.20 \text{ m}^2$ , what is the gas-side overall heat transfer coefficient? If a water flow rate of 1 kg/s is to be heated from 290 to 370 K, what is the required heat exchanger volume?

### SOLUTION

**Known:** Compact heat exchanger geometry, gas-side flow rate and temperature, and water-side convection coefficient. Water flow rate and inlet and outlet temperatures.

**Find:** Gas-side overall heat transfer coefficient. Heat exchanger volume.

**Schematic:**

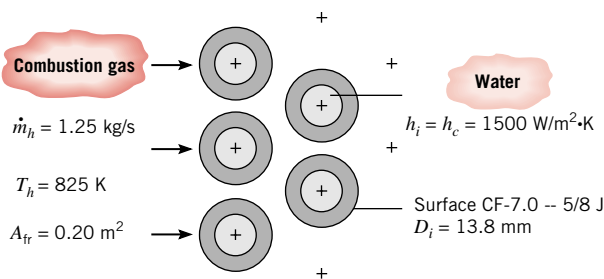

**Assumptions:**

1. Gas has properties of atmospheric air at an assumed mean temperature of 700 K.
2. Fouling is negligible.

**Properties:** Table A.1, aluminum ( $T \approx 300 \text{ K}$ ):  $k = 237 \text{ W/m} \cdot \text{K}$ . Table A.4, air ( $p = 1 \text{ atm}$ ,  $\bar{T} = 700 \text{ K}$ ):  $c_p = 1075 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 338.8 \times 10^{-7} \text{ N} \cdot \text{s/m}^2$ ,  $\text{Pr} = 0.695$ . Table A.6, water ( $\bar{T} = 330 \text{ K}$ ):  $c_p = 4184 \text{ J/kg} \cdot \text{K}$ .

**Analysis:** Referring to Equation 11.1, the combustion gas and the water are the hot and cold fluids, respectively. Hence, neglecting fouling effects and acknowledging that the tube inner surface is not finned ( $\eta_{o,c} = 1$ ), the overall heat transfer coefficient based on the gas- (hot) side surface area is given by

$$\frac{1}{U_h} = \frac{1}{h_c(A_c/A_h)} + A_h R_w + \frac{1}{\eta_{o,h} h_h}$$

where  $A_h$  and  $A_c$  are the total gas-side (hot) and water-side (cold) surface areas, respectively. If the fin thickness is assumed to be negligible, it is readily shown that

$$\frac{A_c}{A_h} \approx \frac{D_i}{D_o} \left( 1 - \frac{A_{f,h}}{A_h} \right)$$

where  $A_{f,h}$  is that portion of the total gas-side area associated with the fins. The approximation is valid to within 10%, and for the heat exchanger core conditions (Figure 11.16)

$$\frac{A_c}{A_h} \approx \frac{13.8}{16.4} (1 - 0.830) = 0.143$$

Obtaining the wall conduction resistance from Equation 3.28, it follows that

$$A_h R_w = \frac{\ln(D_o/D_i)}{2\pi L k / A_h} = \frac{D_i \ln(D_o/D_i)}{2k(A_c/A_h)}$$

Hence

$$A_h R_w = \frac{(0.0138 \text{ m}) \ln(16.4/13.8)}{2(237 \text{ W/m} \cdot \text{K})(0.143)} = 3.51 \times 10^{-5} \text{ m}^2 \cdot \text{K/W}$$

The gas-side convection coefficient may be obtained by first using Equation 11.36 to evaluate the mass velocity:

$$G = \frac{\dot{m}}{\sigma A_{fr}} = \frac{1.25 \text{ kg/s}}{0.449 \times 0.20 \text{ m}^2} = 13.9 \text{ kg/s} \cdot \text{m}^2$$

Hence

$$Re = \frac{13.9 \text{ kg/s} \cdot \text{m}^2 \times 6.68 \times 10^{-3} \text{ m}}{338.8 \times 10^{-7} \text{ kg/s} \cdot \text{m}} = 2740$$

and from Figure 11.16,  $j_H \approx 0.010$ . Hence

$$\begin{aligned} h_h &\approx 0.010 \frac{G c_p}{Pr^{2/3}} = 0.010 \frac{(13.9 \text{ kg/s} \cdot \text{m}^2)(1075 \text{ J/kg} \cdot \text{K})}{(0.695)^{2/3}} \\ &= 190 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

To obtain the hot-side temperature effectiveness from Equation 11.3, the fin efficiency must first be determined from Figure 3.19. With  $r_{2c} = 14.38 \text{ mm}$ ,  $r_{2c}/r_1 = 1.75$ ,  $L_c = 6.18 \text{ mm}$ ,  $A_p = 1.57 \times 10^{-6} \text{ m}^2$ , and  $L_c^{3/2}(h_h/kA_p)^{1/2} = 0.34$ , it follows that  $\eta_f \approx 0.89$ . Hence

$$\eta_{o,h} = 1 - \frac{A_f}{A} (1 - \eta_f) = 1 - 0.830(1 - 0.89) = 0.91$$

We then obtain

$$\frac{1}{U_h} = \left( \frac{1}{1500 \times 0.143} + 3.51 \times 10^{-5} + \frac{1}{0.91 \times 190} \right) \text{ m}^2 \cdot \text{K/W}$$

$$\frac{1}{U_h} = (4.66 \times 10^{-3} + 3.51 \times 10^{-5} + 5.78 \times 10^{-3}) = 0.010 \text{ m}^2 \cdot \text{K/W}$$

or

$$U_h = 100 \text{ W/m}^2 \cdot \text{K}$$

With  $C_c = \dot{m}_c c_{p,c} = 1 \text{ kg/s} \times 4184 \text{ J/kg} \cdot \text{K} = 4184 \text{ W/K}$ , the heat exchanger must be large enough to transfer heat in the amount

$$q = C_c(T_{c,o} - T_{c,i}) = 4184 \text{ W/K} (370 - 290) \text{ K} = 3.35 \times 10^5 \text{ W}$$

With  $C_h = \dot{m}_h c_{p,h} = 1.25 \text{ kg/s} \times 1075 \text{ J/kg} \cdot \text{K} = 1344 \text{ W/K}$ , the minimum heat capacity rate corresponds to the hot fluid and the maximum possible heat transfer rate is

$$q_{\max} = C_{\min}(T_{h,i} - T_{c,i}) = 1344 \text{ W/K} (825 - 290) \text{ K} = 7.19 \times 10^5 \text{ W}$$

It follows that

$$\varepsilon = \frac{q}{q_{\max}} = \frac{3.35 \times 10^5 \text{ W}}{7.19 \times 10^5 \text{ W}} = 0.466$$

Hence, with  $(C_{\min}/C_{\max}) = 0.321$ , Figure 11.14 (cross-flow heat exchanger with both fluids unmixed) yields

$$\text{NTU} = \frac{U_h A_h}{C_{\min}} \approx 0.65$$

The required gas-side heat transfer surface area is then

$$A_h = \frac{0.65 \times 1344 \text{ W/K}}{100 \text{ W/m}^2 \cdot \text{K}} = 8.7 \text{ m}^2$$

With the gas-side surface area per unit heat exchanger volume corresponding to  $\alpha = 269 \text{ m}^2/\text{m}^3$  (Figure 11.16), the required heat exchanger volume is

$$V = \frac{A_h}{\alpha} = \frac{8.7 \text{ m}^2}{269 \text{ m}^2/\text{m}^3} = 0.032 \text{ m}^3$$

### Comments:

1. The effect of the tube wall thermal conduction resistance is negligible, while contributions due to the cold- and hot-side convection resistances are comparable.
2. Knowledge of the heat exchanger volume yields the heat exchanger length in the gas-flow direction,  $L = V/A_{fr} = 0.032 \text{ m}^3/0.20 \text{ m}^2 = 0.16 \text{ m}$ , from which the number of tube rows in the flow direction may be determined.

$$N_L \approx \frac{L - D_f}{S_L} + 1 = \frac{(160 - 28.5) \text{ mm}}{34.3 \text{ mm}} + 1 = 4.8 \approx 5$$

3. The temperature of the gas leaving the heat exchanger is

$$T_{h,o} = T_{h,i} - \frac{q}{C_h} = 825 \text{ K} - \frac{3.35 \times 10^5 \text{ W}}{1344 \text{ W/K}} = 576 \text{ K}$$

Hence the assumption of  $\bar{T}_h = 700 \text{ K}$  is excellent.

4. From Figure 11.16, the friction factor is  $f \approx 0.033$ . With  $(A/A_{ff}) = (\alpha V/\sigma A_{ff}) = (269 \times 0.032/0.449 \times 0.20) = 96$ ,  $v_i(825 \text{ K}) = 2.37 \text{ m}^3/\text{kg}$ ,  $v_o(576 \text{ K}) = 1.65 \text{ m}^3/\text{kg}$ , and  $v_m = 2.01 \text{ m}^3/\text{kg}$ , Equation 11.37 yields a pressure drop of

$$\Delta p = \frac{(13.9 \text{ kg/s} \cdot \text{m}^2)^2 (2.37 \text{ m}^3/\text{kg})}{2} [(1 + 0.202)(0.696 - 1) + 0.033 \times 96 \times 0.848]$$

$$\Delta p = 530 \text{ kg/s}^2 \cdot \text{m} = 530 \text{ N/m}^2$$

## 11.7 Summary

Because there are many important applications, heat exchanger research and development has had a long history. Such activity is by no means complete, however, as many talented workers continue to seek ways of improving design and performance. In fact, with heightened concern for energy conservation, there has been a steady and substantial increase in activity. A focal point for this work has been *heat transfer enhancement*, which includes the search for special heat exchanger surfaces through which enhancement may be achieved. In this chapter we have attempted to develop tools that will allow you to perform approximate heat exchanger calculations. More detailed considerations of the subject are available in the literature, including treatment of the uncertainties associated with heat exchanger analysis [3, 4, 7, 9–15].

Although we have restricted ourselves to heat exchangers involving separation of hot and cold fluids by a stationary wall, there are other important options. For example, *evaporative* heat exchangers enable *direct contact* between a liquid and a gas (there is no separating wall), and because of latent energy effects, large heat transfer rates per unit volume are possible. Also, for gas-to-gas heat exchange, use is often made of *regenerators* in which the same space is alternately occupied by the hot and cold gases. In a fixed regenerator such as a packed bed, the hot and cold gases alternately enter a stationary, porous solid. In a rotary regenerator, the porous solid is a rotating wheel, which alternately exposes its surfaces to the continuously flowing hot and cold gases. Detailed descriptions of such heat exchangers are available in the literature [3, 4, 9, 12, 16–19].

You should test your understanding of fundamental issues by addressing the following questions.

- What are the two possible arrangements for a *concentric tube heat exchanger*? For each arrangement, what restrictions are associated with the fluid outlet temperatures?
- As applied to a *cross-flow heat exchanger*, what is meant by the terms *mixed* and *unmixed*? In what sense are they idealizations of actual conditions?
- Why are baffles used in a *shell-and-tube heat exchanger*?
- What is the principal distinguishing feature of a *compact heat exchanger*?
- What effect does *fouling* have on the overall heat transfer coefficient and hence the performance of a heat exchanger?

- What effect do *finned surfaces* have on the overall heat transfer coefficient and hence the performance of a heat exchanger? When is the use of fins most appropriate?
- When can the overall heat transfer coefficient be expressed as  $U = (h_i^{-1} + h_o^{-1})^{-1}$ ?
- What is the appropriate form of the mean temperature difference for the two fluids of a parallel or counter-flow heat exchanger?
- What can be said about the change in temperature of a saturated fluid undergoing evaporation or condensation in a heat exchanger?
- Will the fluid having the minimum or the maximum heat capacity rate experience the largest temperature change in a heat exchanger?
- Why is the maximum possible heat rate for a heat exchanger *not* equal to  $C_{\max}(T_{h,i} - T_{c,i})$ ? Can the outlet temperature of the cold fluid ever exceed the inlet temperature of the hot fluid?
- What is the *effectiveness* of a heat exchanger? What is its range of possible values? What is the *number of transfer units*? What is its range of possible values?
- Generally, how does the effectiveness change if the size (surface area) of a heat exchanger is increased? If the overall heat transfer coefficient is increased? If the ratio of heat capacity rates is decreased? As manifested by the number of transfer units, are there limitations to the foregoing trends? What penalty is associated with increasing the size of a heat exchanger? With increasing the overall heat transfer coefficient?


## References

1. *Standards of the Tubular Exchange Manufacturers Association*, 6th ed., Tubular Exchanger Manufacturers Association, New York, 1978.
2. Chenoweth, J. M., and M. Impagliazzo, Eds., *Fouling in Heat Exchange Equipment*, American Society of Mechanical Engineers Symposium Volume HTD-17, ASME, New York, 1981.
3. Kakac, S., A. E. Bergles, and F. Mayinger, Eds., *Heat Exchangers*, Hemisphere Publishing, New York, 1981.
4. Kakac, S., R. K. Shah, and A. E. Bergles, Eds., *Low Reynolds Number Flow Heat Exchangers*, Hemisphere Publishing, New York, 1983.
5. Kays, W. M., and A. L. London, *Compact Heat Exchangers*, 3rd ed., McGraw-Hill, New York, 1984.
6. Bowman, R. A., A. C. Mueller, and W. M. Nagle, *Trans. ASME*, **62**, 283, 1940.
7. DiGiovanni, M. A., and R. L. Webb, *Heat Transfer Eng.*, **10**, 61, 1989.
8. Ribando, R. J., G. W. O'Leary, and S. Carlson-Skalak, *Comp. Appl. Eng. Educ.*, **5**, 231, 1997.
9. Shah, R. K., C. F. McDonald, and C. P. Howard, Eds., *Compact Heat Exchangers*, American Society of Mechanical Engineers Symposium Volume HTD-10, ASME, New York, 1980.
10. Webb, R. L., in G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Section 3.9, Begell House, New York, 2002.
11. Marner, W. J., A. E. Bergles, and J. M. Chenoweth, *Trans. ASME, J. Heat Transfer*, **105**, 358, 1983.
12. G. F. Hewitt, Exec. Ed., *Heat Exchanger Design Handbook*, Vols. 1–5, Begell House, New York, 2002.
13. Webb, R. L., and N.-H. Kim, *Principles of Enhanced Heat Transfer*, 2nd ed., Taylor & Francis, New York, 2005.
14. Andrews, M. J., and L. S. Fletcher, *ASME/JSME Thermal Eng. Conf.*, **4**, 359, 1995.
15. James, C. A., R. P. Taylor, and B. K. Hodge, *ASME/JSME Thermal Eng. Conf.*, **4**, 337, 1995.
16. Coppage, J. E., and A. L. London, *Trans. ASME*, **75**, 779, 1953.
17. Treybal, R. E., *Mass-Transfer Operations*, 3rd ed., McGraw-Hill, New York, 1980.
18. Sherwood, T. K., R. L. Pigford, and C. R. Wilkie, *Mass Transfer*, McGraw-Hill, New York, 1975.
19. Schmidt, F. W., and A. J. Willmott, *Thermal Energy Storage and Regeneration*, Hemisphere Publishing, New York, 1981.

## Problems

### Overall Heat Transfer Coefficient

- 11.1** In a fire-tube boiler, hot products of combustion flowing through an array of thin-walled tubes are used to boil water flowing over the tubes. At the time of installation, the overall heat transfer coefficient was  $400 \text{ W/m}^2 \cdot \text{K}$ . After 1 year of use, the inner and outer tube surfaces are fouled, with corresponding fouling factors of  $R''_{f,i} = 0.0015$  and  $R''_{f,o} = 0.0005 \text{ m}^2 \cdot \text{K/W}$ , respectively. Should the boiler be scheduled for cleaning of the tube surfaces?
- 11.2** A type-302 stainless steel tube of inner and outer diameters  $D_i = 22 \text{ mm}$  and  $D_o = 27 \text{ mm}$ , respectively, is used in a cross-flow heat exchanger. The fouling factors,  $R''_f$ , for the inner and outer surfaces are estimated to be  $0.0004$  and  $0.0002 \text{ m}^2 \cdot \text{K/W}$ , respectively.

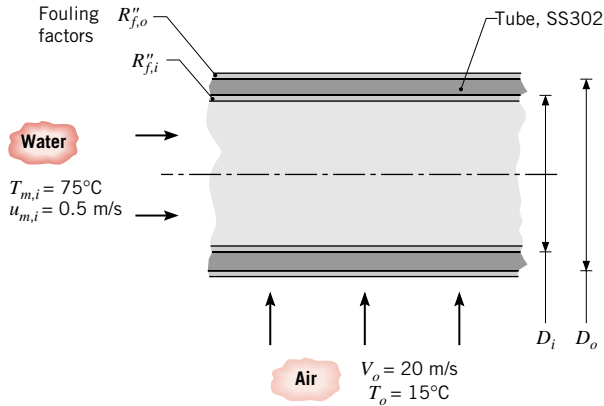


- (a) Determine the overall heat transfer coefficient based on the outside area of the tube,  $U_o$ . Compare the thermal resistances due to convection, tube wall conduction, and fouling.
- (b) Instead of air flowing over the tube, consider a situation for which the cross-flow fluid is water at  $15^\circ\text{C}$  with a velocity of  $V_o = 1 \text{ m/s}$ . Determine the overall heat transfer coefficient based on the outside area of the tube,  $U_o$ . Compare the thermal resistances due to convection, tube wall conduction, and fouling.
- (c) For the water–air conditions of part (a) and mean velocities,  $u_{m,i}$ , of  $0.2$ ,  $0.5$ , and  $1.0 \text{ m/s}$ , plot the overall heat transfer coefficient as a function of the cross-flow velocity for  $5 \leq V_o \leq 30 \text{ m/s}$ .
- (d) For the water–water conditions of part (b) and cross-flow velocities,  $V_o$ , of  $1$ ,  $3$ , and  $8 \text{ m/s}$ , plot the overall heat transfer coefficient as a function of the mean velocity for  $0.5 \leq u_{m,i} \leq 2.5 \text{ m/s}$ .

- 11.3** A shell-and-tube heat exchanger is to heat an acidic liquid that flows in unfinned tubes of inside and outside diameters  $D_i = 10 \text{ mm}$  and  $D_o = 11 \text{ mm}$ , respectively. A hot gas flows on the shell side. To avoid corrosion of the tube material, the engineer may specify either a Ni-Cr-Mo corrosion-resistant metal alloy ( $\rho_m = 8900 \text{ kg/m}^3$ ,  $k_m = 8 \text{ W/m} \cdot \text{K}$ ) or a polyvinylidene fluoride (PVDF) plastic ( $\rho_p = 1780 \text{ kg/m}^3$ ,  $k_p = 0.17 \text{ W/m} \cdot \text{K}$ ). The inner and outer heat transfer coefficients are  $h_i = 1500 \text{ W/m}^2 \cdot \text{K}$  and  $h_o = 200 \text{ W/m}^2 \cdot \text{K}$ , respectively.

- (a) Determine the ratio of plastic to metal tube surface areas needed to transfer the same amount of heat.
- (b) Determine the ratio of plastic to metal mass associated with the two heat exchanger designs.
- (c) The cost of the metal alloy per unit mass is three times that of the plastic. Determine which tube material should be specified on the basis of cost.

- 11.4** A steel tube ( $k = 50 \text{ W/m} \cdot \text{K}$ ) of inner and outer diameters  $D_i = 20 \text{ mm}$  and  $D_o = 26 \text{ mm}$ , respectively, is used to transfer heat from hot gases flowing over the tube ( $h_h = 200 \text{ W/m}^2 \cdot \text{K}$ ) to cold water flowing through the tube ( $h_c = 8000 \text{ W/m}^2 \cdot \text{K}$ ). What is the cold-side overall heat transfer coefficient  $U_c$ ? To enhance heat transfer, 16 straight fins of rectangular profile are installed longitudinally along the outer surface of the tube. The fins are equally spaced around the circumference of the tube, each having a thickness of  $2 \text{ mm}$  and a length of  $15 \text{ mm}$ . What is the corresponding overall heat transfer coefficient  $U_c$ ?

- 11.5** A heat recovery device involves transferring energy from the hot flue gases passing through an annular

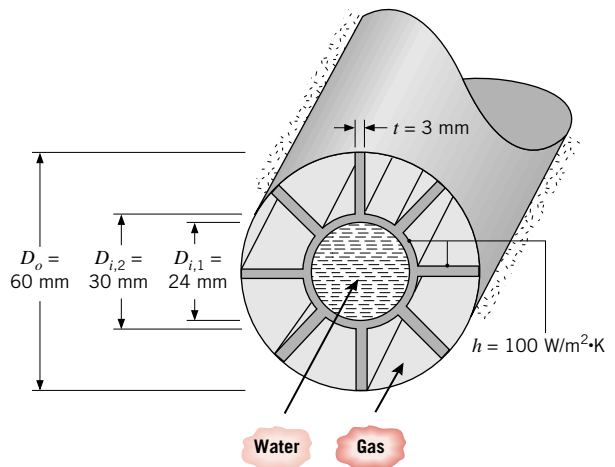




region to pressurized water flowing through the inner tube of the annulus. The inner tube has inner and outer diameters of 24 and 30 mm and is connected by eight struts to an insulated outer tube of 60-mm diameter. Each strut is 3 mm thick and is integrally fabricated with the inner tube from carbon steel ( $k = 50 \text{ W/m} \cdot \text{K}$ ).

Consider conditions for which water at 300 K flows through the inner tube at 0.161 kg/s while flue gases at 800 K flow through the annulus, maintaining a convection coefficient of  $100 \text{ W/m}^2 \cdot \text{K}$  on both the struts and the outer surface of the inner tube. What is the rate of heat transfer per unit length of tube from gas to the water?

- 11.6** A novel design for a condenser consists of a tube of thermal conductivity  $200 \text{ W/m} \cdot \text{K}$  with longitudinal fins snugly fitted into a larger tube. Condensing refrigerant at  $45^\circ\text{C}$  flows axially through the inner tube, while water at a flow rate of  $0.012 \text{ kg/s}$  passes through the six channels around the inner tube. The pertinent diameters are  $D_1 = 10 \text{ mm}$ ,  $D_2 = 14 \text{ mm}$ , and  $D_3 = 50 \text{ mm}$ , while the fin thickness is  $t = 2 \text{ mm}$ . Assume that the convection coefficient associated with the condensing refrigerant is extremely large.

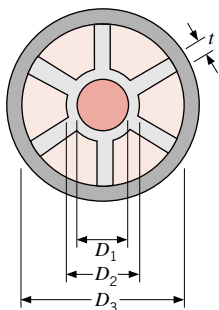

Determine the heat removal rate per unit tube length in a section of the tube for which the water is at  $15^\circ\text{C}$ .

- 11.7** The condenser of a steam power plant contains  $N = 1000$  brass tubes ( $k_t = 110 \text{ W/m} \cdot \text{K}$ ), each of inner and outer diameters,  $D_i = 25 \text{ mm}$  and  $D_o = 28 \text{ mm}$ , respectively. Steam condensation on the outer surfaces of the tubes is characterized by a convection coefficient of  $h_o = 10,000 \text{ W/m}^2 \cdot \text{K}$ .
- (a) If cooling water from a large lake is pumped through the condenser tubes at  $\dot{m}_c = 400 \text{ kg/s}$ , what is the overall heat transfer coefficient  $U_o$  based on the outer surface area of a tube? Properties of the water may be approximated as  $\mu = 9.60 \times 10^{-4} \text{ N} \cdot \text{s/m}^2$ ,  $k = 0.60 \text{ W/m} \cdot \text{K}$ , and  $\text{Pr} = 6.6$ .
- (b) If, after extended operation, fouling provides a resistance of  $R''_{fi} = 10^{-4} \text{ m}^2 \cdot \text{K/W}$ , at the inner surface, what is the value of  $U_o$ ?

- (c) If water is extracted from the lake at  $15^\circ\text{C}$  and  $10 \text{ kg/s}$  of steam at  $0.0622 \text{ bars}$  are to be condensed, what is the corresponding temperature of the water leaving the condenser? The specific heat of the water is  $4180 \text{ J/kg} \cdot \text{K}$ .

- 11.8** Thin-walled aluminum tubes of diameter  $D = 10 \text{ mm}$  are used in the condenser of an air conditioner. Under normal operating conditions, a convection coefficient of  $h_i = 5000 \text{ W/m}^2 \cdot \text{K}$  is associated with condensation on the inner surface of the tubes, while a coefficient of  $h_o = 100 \text{ W/m}^2 \cdot \text{K}$  is maintained by airflow over the tubes.

- (a) What is the overall heat transfer coefficient if the tubes are unfinned?


- (b) What is the overall heat transfer coefficient based on the inner surface,  $U_i$ , if aluminum annular fins of thickness  $t = 1.5 \text{ mm}$ , outer diameter  $D_o = 20 \text{ mm}$ , and pitch  $S = 3.5 \text{ mm}$  are added to the outer surface? Base your calculations on a 1-m-long section of tube. Subject to the requirements that  $t \geq 1 \text{ mm}$  and  $(S - t) \geq 1.5 \text{ mm}$ , explore the effect of variations in  $t$  and  $S$  on  $U_i$ . What combination of  $t$  and  $S$  would yield the best heat transfer performance?

- 11.9** A finned-tube, cross-flow heat exchanger is to use the exhaust of a gas turbine to heat pressurized water. Laboratory measurements are performed on a prototype version of the exchanger, which has a surface area of  $10 \text{ m}^2$ , to determine the overall heat transfer coefficient as a function of operating conditions. Measurements made under particular conditions, for which  $\dot{m}_h = 2 \text{ kg/s}$ ,  $T_{h,i} = 325^\circ\text{C}$ ,  $\dot{m}_c = 0.5 \text{ kg/s}$ , and  $T_{c,i} = 25^\circ\text{C}$ , reveal a water outlet temperature of  $T_{c,o} = 150^\circ\text{C}$ . What is the overall heat transfer coefficient of the exchanger?

- 11.10** Water at a rate of  $45,500 \text{ kg/h}$  is heated from  $80$  to  $150^\circ\text{C}$  in a heat exchanger having two shell passes and eight tube passes with a total surface area of  $925 \text{ m}^2$ . Hot exhaust gases having approximately the same thermophysical properties as air enter at  $350^\circ\text{C}$  and exit at  $175^\circ\text{C}$ . Determine the overall heat transfer coefficient.

- 11.11** A novel heat exchanger concept consists of a large number of extruded polypropylene sheets ( $k = 0.17 \text{ W/m} \cdot \text{K}$ ), each having a fin-like geometry, that are subsequently stacked and melted together to form the heat exchanger core. Besides being inexpensive, the heat exchanger can be easily recycled at the end of its life. Carbon dioxide at a mean temperature of  $10^\circ\text{C}$  and pressure of  $2 \text{ atm}$  flows in the cool channels at a

mean velocity of  $u_m = 0.1$  m/s. Air at  $30^\circ\text{C}$  and 2 atm flows at 0.2 m/s in the warm channels. Neglecting the thermal contact resistance at the welded interface, determine the product of the overall heat transfer coefficient and heat transfer area,  $UA$ , for a heat exchanger core consisting of 200 cool channels and 200 warm channels.

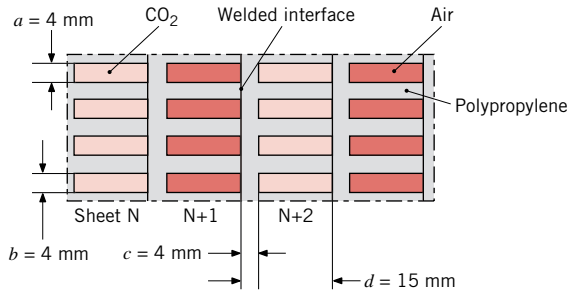

## Design and Performance Calculations

**11.12** The properties and flow rates for the hot and cold fluids of a heat exchanger are shown in the following table. Which fluid limits the heat transfer rate of the exchanger? Explain your choice.

	Hot fluid	Cold fluid
Density, $\text{kg/m}^3$	997	1247
Specific heat, $\text{J/kg} \cdot \text{K}$	4179	2564
Thermal conductivity, $\text{W/m} \cdot \text{K}$	0.613	0.287
Viscosity, $\text{N} \cdot \text{s/m}^2$	$8.55 \times 10^{-4}$	$1.68 \times 10^{-4}$
Flow rate, $\text{m}^3/\text{h}$	14	16

**11.13** A process fluid having a specific heat of  $3500 \text{ J/kg} \cdot \text{K}$  and flowing at  $2 \text{ kg/s}$  is to be cooled from  $80^\circ\text{C}$  to  $50^\circ\text{C}$  with chilled water, which is supplied at a temperature of  $15^\circ\text{C}$  and a flow rate of  $2.5 \text{ kg/s}$ . Assuming an overall heat transfer coefficient of  $2000 \text{ W/m}^2 \cdot \text{K}$ , calculate the required heat transfer areas for the following exchanger configurations: (a) parallel flow, (b) counterflow, (c) shell-and-tube, one shell pass and 2 tube passes, and (d) cross-flow, single pass, both fluids unmixed. Compare the results of your analysis. Your work can be reduced by using the *Tools/Heat Exchanger* models of *IHT*.

**11.14** A shell-and-tube exchanger (two shells, four tube passes) is used to heat  $10,000 \text{ kg/h}$  of pressurized water from  $35$  to  $120^\circ\text{C}$  with  $5000 \text{ kg/h}$  pressurized water entering the exchanger at  $300^\circ\text{C}$ . If the overall heat transfer coefficient is  $1500 \text{ W/m}^2 \cdot \text{K}$ , determine the required heat exchanger area.

**11.15** Consider the heat exchanger of Problem 11.14. After several years of operation, it is observed that the outlet

temperature of the cold water reaches only  $95^\circ\text{C}$  rather than the desired  $120^\circ\text{C}$  for the same flow rates and inlet temperatures of the fluids. Determine the cumulative (inner and outer surface) fouling factor that is the cause of the poorer performance.

**11.16** A counterflow, concentric tube heat exchanger is designed to heat water from  $20$  to  $80^\circ\text{C}$  using hot oil, which is supplied to the annulus at  $160^\circ\text{C}$  and discharged at  $140^\circ\text{C}$ . The thin-walled inner tube has a diameter of  $D_i = 20 \text{ mm}$ , and the overall heat transfer coefficient is  $500 \text{ W/m}^2 \cdot \text{K}$ . The design condition calls for a total heat transfer rate of  $3000 \text{ W}$ .

- What is the length of the heat exchanger?
- After 3 years of operation, performance is degraded by fouling on the water side of the exchanger, and the water outlet temperature is only  $65^\circ\text{C}$  for the same fluid flow rates and inlet temperatures. What are the corresponding values of the heat transfer rate, the outlet temperature of the oil, the overall heat transfer coefficient, and the water-side fouling factor,  $R''_{f,c}$ ?

**11.17** Consider the counterflow, concentric tube heat exchanger of Example 11.1. The designer wishes to consider the effect of the cooling water flow rate on the tube length. All other conditions, including the outlet oil temperature of  $60^\circ\text{C}$ , remain the same.

- From the analysis of Example 11.1, we saw that the overall coefficient  $U$  is dominated by the hot-side convection coefficient. Assuming the water properties are independent of temperature, calculate  $U$  as a function of the water flow rate. Justify a constant value of  $U$  in the calculations of part (b).
- Calculate and plot the required exchanger tube length  $L$  and the water outlet temperature  $T_{c,o}$  as a function of the cooling water flow rate for  $0.15 \leq \dot{m}_c \leq 0.30 \text{ kg/s}$ .

**11.18** Consider a concentric tube heat exchanger with an area of  $50 \text{ m}^2$  operating under the following conditions:

	Hot fluid	Cold fluid
Heat capacity rate, $\text{kW/K}$	6	3
Inlet temperature, $^\circ\text{C}$	60	30
Outlet temperature, $^\circ\text{C}$	—	54

- Determine the outlet temperature of the hot fluid.
- Is the heat exchanger operating in counterflow or parallel flow, or can't you tell from the available information?
- Calculate the overall heat transfer coefficient.
- Calculate the effectiveness of this exchanger.

- (e) What would be the effectiveness of this exchanger if its length were made very large?


**11.19** For a senior project, a student was given the assignment to design a heat exchanger that meets the following specifications:

	$\dot{m}$ (kg/s)	$T_{m,i}$ (°C)	$T_{m,o}$ (°C)
Hot water	28	90	—
Cold water	27	34	60

Like many real-world situations, the customer hasn't revealed, or doesn't know, additional requirements that would allow you to proceed directly to a final configuration. At the outset, it is helpful to make a first-cut design based upon simplifying assumptions, which can be evaluated to determine what additional requirements and trade-offs should be considered by the customer.

- (a) Design a heat exchanger to meet the foregoing specifications. List and explain your assumptions. *Hint:* Begin by finding the required value for  $UA$  and using representative values of  $U$  to determine  $A$ .
- (b) Evaluate your design by identifying what features and configurations could be explored with your customer in order to develop more complete specifications.

**11.20** A concentric tube heat exchanger for cooling lubricating oil is comprised of a thin-walled inner tube of 25-mm diameter carrying water and an outer tube of 45-mm diameter carrying the oil. The exchanger operates in counterflow with an overall heat transfer coefficient of  $60 \text{ W/m}^2 \cdot \text{K}$  and the tabulated average properties.

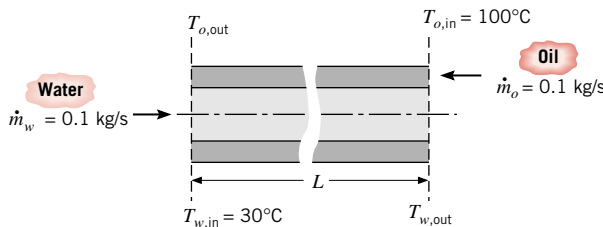

Properties	Water	Oil
$\rho$ (kg/m <sup>3</sup> )	1000	800
$c_p$ (J/kg · K)	4200	1900
$\nu$ (m <sup>2</sup> /s)	$7 \times 10^{-7}$	$1 \times 10^{-5}$
$k$ (W/m · K)	0.64	0.134
Pr	4.7	140

- (a) If the outlet temperature of the oil is 60°C, determine the total heat transfer and the outlet temperature of the water.

- (b) Determine the length required for the heat exchanger.

**11.21** A counterflow, concentric tube heat exchanger used for engine cooling has been in service for an extended period of time. The heat transfer surface area of the exchanger is  $5 \text{ m}^2$ , and the *design value* of the overall convection coefficient is  $38 \text{ W/m}^2 \cdot \text{K}$ . During a test run, engine oil flowing at  $0.1 \text{ kg/s}$  is cooled from  $110^\circ\text{C}$  to  $66^\circ\text{C}$  by water supplied at a temperature of  $25^\circ\text{C}$  and a flow rate of  $0.2 \text{ kg/s}$ . Determine whether fouling has occurred during the service period. If so, calculate the fouling factor,  $R_f''$  ( $\text{m}^2 \cdot \text{K/W}$ ).

**11.22** A shell-and-tube heat exchanger must be designed to heat  $2.5 \text{ kg/s}$  of water from  $15$  to  $85^\circ\text{C}$ . The heating is to be accomplished by passing hot engine oil, which is available at  $160^\circ\text{C}$ , through the shell side of the exchanger. The oil is known to provide an average convection coefficient of  $h_o = 400 \text{ W/m}^2 \cdot \text{K}$  on the outside of the tubes. Ten tubes pass the water through the shell. Each tube is thin walled, of diameter  $D = 25 \text{ mm}$ , and makes eight passes through the shell. If the oil leaves the exchanger at  $100^\circ\text{C}$ , what is its flow rate? How long must the tubes be to accomplish the desired heating?

**11.23** An automobile radiator may be viewed as a cross-flow heat exchanger with both fluids unmixed. Water, which has a flow rate of  $0.05 \text{ kg/s}$ , enters the radiator at  $400 \text{ K}$  and is to leave at  $330 \text{ K}$ . The water is cooled by air that enters at  $0.75 \text{ kg/s}$  and  $300 \text{ K}$ .

- (a) If the overall heat transfer coefficient is  $200 \text{ W/m}^2 \cdot \text{K}$ , what is the required heat transfer surface area?

- (b) A manufacturing engineer claims ridges can be stamped on the finned surface of the exchanger, which could greatly increase the overall heat transfer coefficient. With all other conditions remaining the same and the heat transfer surface area determined from part (a), generate a plot of the air and water outlet temperatures as a function of  $U$  for  $200 \leq U \leq 400 \text{ W/m}^2 \cdot \text{K}$ . What benefits result from increasing the overall convection coefficient for this application?

**11.24** Hot air for a large-scale drying operation is to be produced by routing the air over a tube bank (unmixed), while products of combustion are routed through the tubes. The surface area of the cross-flow heat exchanger is  $A = 25 \text{ m}^2$ , and for the proposed operating conditions, the manufacturer specifies an overall heat transfer coefficient of  $U = 35 \text{ W/m}^2 \cdot \text{K}$ . The air

and the combustion gases may each be assumed to have a specific heat of  $c_p = 1040 \text{ J/kg} \cdot \text{K}$ . Consider conditions for which combustion gases flowing at  $1 \text{ kg/s}$  enter the heat exchanger at  $800 \text{ K}$ , while air at  $5 \text{ kg/s}$  has an inlet temperature of  $300 \text{ K}$ .

- What are the air and gas outlet temperatures?
- After extended operation, deposits on the inner tube surfaces are expected to provide a fouling resistance of  $R_f'' = 0.004 \text{ m}^2 \cdot \text{K/W}$ . Should operation be suspended in order to clean the tubes?


- The heat exchanger performance may be improved by increasing the surface area and/or the overall heat transfer coefficient. Explore the effect of such changes on the air outlet temperature for  $500 \leq UA \leq 2500 \text{ W/K}$ .

**11.25** In a dairy operation, milk at a flow rate of  $250 \text{ liter/hour}$  and a *cow-body* temperature of  $38.6^\circ\text{C}$  must be chilled to a safe-to-store temperature of  $13^\circ\text{C}$  or less. Ground water at  $10^\circ\text{C}$  is available at a flow rate of  $0.72 \text{ m}^3/\text{h}$ . The density and specific heat of milk are  $1030 \text{ kg/m}^3$  and  $3860 \text{ J/kg} \cdot \text{K}$ , respectively.

- Determine the  $UA$  product of a counterflow heat exchanger required for the chilling process. Determine the length of the exchanger if the inner pipe has a  $50\text{-mm}$  diameter and the overall heat transfer coefficient is  $U = 1000 \text{ W/m}^2 \cdot \text{K}$ .
- Determine the outlet temperature of the water.
- Using the value of  $UA$  found in part (a), determine the milk outlet temperature if the water flow rate is doubled. What is the outlet temperature if the flow rate is halved?

**11.26** A shell-and-tube heat exchanger with one shell pass and two tube passes is used as a *regenerator*, to pre-heat milk before it is pasteurized. Cold milk enters the regenerator at  $T_{c,i} = 5^\circ\text{C}$ , while hot milk, which has completed the pasteurization process, enters at  $T_{h,i} = 70^\circ\text{C}$ . After leaving the regenerator, the heated milk enters a second heat exchanger, which raises its temperature from  $T_{c,o}$  to  $70^\circ\text{C}$ .

- A regenerator is to be used in a pasteurization process for which the flow rate of the milk is  $\dot{m}_c = \dot{m}_h = 5 \text{ kg/s}$ . For this flow rate, the manufacturer of the regenerator specifies an overall heat transfer coefficient of  $2000 \text{ W/m}^2 \cdot \text{K}$ . If the desired effectiveness of the regenerator is  $0.5$ , what is the requisite heat transfer area? What are the corresponding rate of heat recovery and the fluid outlet temperatures? Milk may be assumed to have the properties of water.

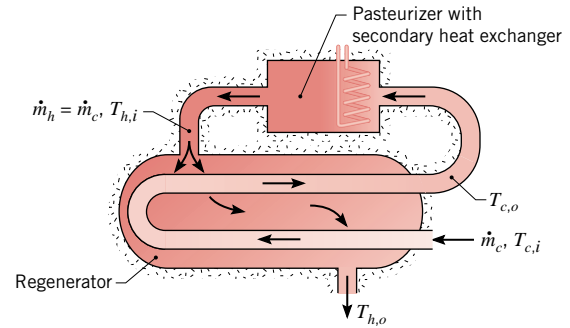


- If the hot fluid in the secondary heat exchanger derives its energy from the combustion of natural gas and the burner has an efficiency of  $90\%$ , what would be the annual savings in energy and fuel costs associated with installation of the regenerator? The facility operates continuously throughout the year, and the cost of natural gas is  $C_{ng} = \$0.0075/\text{MJ}$ .

**11.27** The compartment heater of an automobile exchanges heat between warm radiator fluid and cooler outside air. The flow rate of water is large compared to the air, and the effectiveness,  $\varepsilon$ , of the heater is known to depend on the flow rate of air according to the relation,  $\varepsilon \sim \dot{m}_{\text{air}}^{-0.2}$ .


- If the fan is switched to high and  $\dot{m}_{\text{air}}$  is doubled, determine the percentage increase in the heat added to the car, if fluid inlet temperatures remain the same.
- For the low-speed fan condition, the heater warms outdoor air from  $0$  to  $30^\circ\text{C}$ . When the fan is turned to medium, the airflow rate increases  $50\%$  and the heat transfer increases  $20\%$ . Find the new outlet temperature.

**11.28** A counterflow, twin-tube heat exchanger is made by brazing two circular nickel tubes, each  $40 \text{ m}$  long, together as shown below. Hot water flows through the smaller tube of  $10\text{-mm}$  diameter and air at atmospheric pressure flows through the larger tube of  $30\text{-mm}$  diameter. Both tubes have a wall thickness of  $2 \text{ mm}$ . The thermal contact conductance per unit length of the brazed joint is  $100 \text{ W/m} \cdot \text{K}$ . The mass flow rates of the water and air are  $0.04$  and  $0.12 \text{ kg/s}$ , respectively. The inlet temperatures of the water and air are  $85$  and  $23^\circ\text{C}$ , respectively.

Employ the  $\varepsilon$ -NTU method to determine the outlet temperature of the air. *Hint:* Account for the effects of circumferential conduction in the walls of the tubes by treating them as extended surfaces.

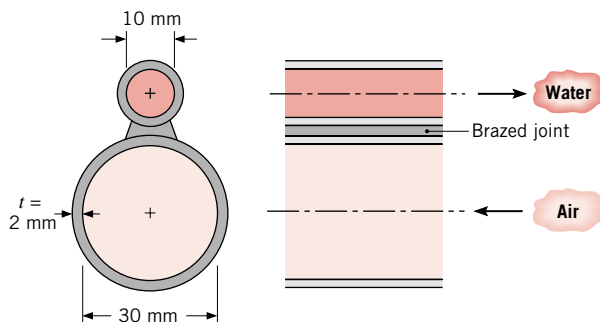

- 11.29** A twin-tube, counterflow heat exchanger operates with balanced flow rates of 0.003 kg/s for the hot and cold airstreams. The cold stream enters at 280 K and must be heated to 340 K using hot air at 360 K. The average pressure of the airstreams is 1 atm and the maximum allowable pressure drop for the cold air is 10 kPa. The tube walls may be assumed to act as fins, each with an efficiency of 100%.

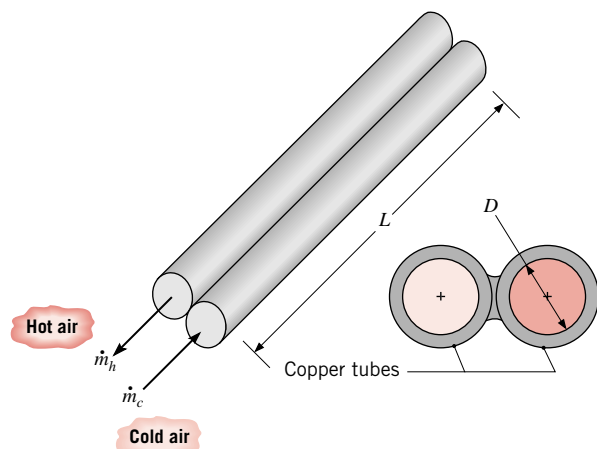

- Determine the tube diameter  $D$  and length  $L$  that satisfy the prescribed heat transfer and pressure drop requirements.
- For the diameter  $D$  and length  $L$  found in part (a), generate plots of the cold stream outlet temperature, the heat transfer rate, and pressure drop as a function of balanced flow rates in the range from 0.002 to 0.004 kg/s. Comment on your results.

- 11.30** A 5-m-long, twin-tube, counterflow heat exchanger, such as that illustrated in Problem 11.29, is used to heat air for a drying operation. Each tube is made from plain carbon steel ( $k = 60 \text{ W/m} \cdot \text{K}$ ) and has an inner diameter and wall thickness of 50 mm and 4 mm, respectively. The thermal resistance per unit length of the brazed joint connecting the tubes is

$R'_j = 0.01 \text{ m} \cdot \text{K/W}$ . Consider conditions for which air enters one tube at a pressure of 5 atm, a temperature of  $17^\circ\text{C}$ , and flow rate of 0.030 kg/s, while saturated steam at 2.455 bar condenses in the other tube. The convection coefficient for condensation may be approximated as  $5000 \text{ W/m}^2 \cdot \text{K}$ . What is the air outlet temperature? What is the mass rate at which condensate leaves the system? *Hint:* Account for the effects of circumferential conduction in the tubes by treating them as extended surfaces.

- 11.31** Hot water for an industrial washing operation is produced by recovering heat from the flue gases of a furnace. A cross-flow heat exchanger is used, with the gases passing over the tubes and the water making a single pass through the tubes. The steel tubes ( $k = 60 \text{ W/m} \cdot \text{K}$ ) have inner and outer diameters of  $D_i = 15 \text{ mm}$  and  $D_o = 20 \text{ mm}$ , while the staggered tube array has longitudinal and transverse pitches of  $S_T = S_L = 40 \text{ mm}$ . The plenum in which the array is installed has a width (corresponding to the tube length) of  $W = 2 \text{ m}$  and a height (normal to the tube axis) of  $H = 1.2 \text{ m}$ . The number of tubes in the transverse plane is therefore  $N_T \approx H/S_T = 30$ . The gas properties may be approximated as those of atmospheric air, and the convection coefficient associated with water flow in the tubes may be approximated as  $3000 \text{ W/m}^2 \cdot \text{K}$ .

- If 50 kg/s of water are to be heated from 290 to 350 K by 40 kg/s of flue gases entering the exchanger at 700 K, what is the gas outlet temperature and how many tube rows  $N_L$  are required?
- The water outlet temperature may be controlled by varying the gas flow rate and/or inlet temperature. For the value of  $N_L$  determined in part (a) and the prescribed values of  $H$ ,  $W$ ,  $S_T$ ,  $\dot{m}_c$ , and  $T_{c,i}$ , compute and plot  $T_{c,o}$  as a function of  $\dot{m}_h$  over the range  $20 \leq \dot{m}_h \leq 40 \text{ kg/s}$  for values of  $T_{h,i} = 500, 600$ , and  $700 \text{ K}$ . Also plot the corresponding variations of  $T_{h,o}$ . If  $T_{h,o}$  must not drop below 400 K to prevent condensation of corrosive vapors on the heat exchanger surfaces, are there any constraints on  $\dot{m}_h$  and  $T_{h,i}$ ?

- 11.32** A single-pass, cross-flow heat exchanger uses hot exhaust gases (mixed) to heat water (unmixed) from 30 to  $80^\circ\text{C}$  at a rate of 3 kg/s. The exhaust gases, having thermophysical properties similar to air, enter and exit the exchanger at 225 and  $100^\circ\text{C}$ , respectively. If the overall heat transfer coefficient is  $200 \text{ W/m}^2 \cdot \text{K}$ , estimate the required surface area.

- 11.33** Consider the fluid conditions and overall heat transfer coefficient of Problem 11.32 for a concentric tube heat exchanger operating in parallel flow. The thin-walled separator tube has a diameter of 100 mm.



- (a) Determine the required length for the exchanger.
- (b) Assuming water flow inside the separator tube to be fully developed, estimate the convection heat transfer coefficient.
- (c) Using the overall coefficient and the inlet temperatures from Problem 11.32, plot the heat transfer rate and fluid outlet temperatures as a function of the tube length for  $60 \leq L \leq 400$  m and the parallel-flow configuration.
- (d) If the exchanger were operated in counterflow with the same overall coefficient and inlet temperatures, what would be the reduction in the required length relative to the value found in part (a)?
- (e) For the counterflow configuration, plot the effectiveness and fluid outlet temperatures as a function of the tube length for  $60 \leq L \leq 400$  m.
- 11.34** A cross-flow heat exchanger used in a cardiopulmonary bypass procedure cools blood flowing at 5 liter/min from a body temperature of  $37^\circ\text{C}$  to  $25^\circ\text{C}$  in order to induce body hypothermia, which reduces metabolic and oxygen requirements. The coolant is ice water at  $0^\circ\text{C}$ , and its flow rate is adjusted to provide an outlet temperature of  $15^\circ\text{C}$ . The heat exchanger operates with both fluids unmixed, and the overall heat transfer coefficient is  $750 \text{ W/m}^2 \cdot \text{K}$ . The density and specific heat of the blood are  $1050 \text{ kg/m}^3$  and  $3740 \text{ J/kg} \cdot \text{K}$ , respectively.
- (a) Determine the heat transfer rate for the exchanger.
- (b) Calculate the water flow rate.
- (c) What is the surface area of the heat exchanger?
- (d) Calculate and plot the blood and water outlet temperatures as a function of the water flow rate for the range 2 to 4 liter/min, assuming all other parameters remain unchanged. Comment on how the changes in the outlet temperatures are affected by changes in the water flow rate. Explain this behavior and why it is an advantage for this application.
- 11.35** Saturated steam at 0.14 bar is condensed in a shell-and-tube heat exchanger with one shell pass and two tube passes consisting of 130 brass tubes, each with a length per pass of 2 m. The tubes have inner and outer diameters of 13.4 and 15.9 mm, respectively. Cooling water enters the tubes at  $20^\circ\text{C}$  with a mean velocity of 1.25 m/s. The heat transfer coefficient for condensation on the outer surfaces of the tubes is  $13,500 \text{ W/m}^2 \cdot \text{K}$ .
- (a) Determine the overall heat transfer coefficient, the cooling water outlet temperature, and the steam condensation rate.
- (b) With all other conditions remaining the same, but accounting for changes in the overall coefficient, plot the cooling water outlet temperature and the steam condensation rate as a function of the water flow rate for  $10 \leq \dot{m}_c \leq 30 \text{ kg/s}$ .
- 11.36** A feedwater heater that supplies a boiler consists of a shell-and-tube heat exchanger with one shell pass and two tube passes. One hundred thin-walled tubes each have a diameter of 20 mm and a length (per pass) of 2 m. Under normal operating conditions water enters the tubes at  $10 \text{ kg/s}$  and  $290 \text{ K}$  and is heated by condensing saturated steam at 1 atm on the outer surface of the tubes. The convection coefficient of the saturated steam is  $10,000 \text{ W/m}^2 \cdot \text{K}$ .
- (a) Determine the water outlet temperature.
- (b) With all other conditions remaining the same, but accounting for changes in the overall heat transfer coefficient, plot the water outlet temperature as a function of the water flow rate for  $5 \leq \dot{m}_c \leq 20 \text{ kg/s}$ .
- (c) On the plot of part (b), generate two additional curves for the water outlet temperature as a function of flow rate for fouling factors of  $R_f'' = 0.0002$  and  $0.0005 \text{ m}^2 \cdot \text{K/W}$ .
- 11.37** Saturated steam at  $110^\circ\text{C}$  is condensed in a shell-and-tube heat exchanger (1 shell pass; 2, 4, ... tube passes) with a  $UA$  value of  $2.5 \text{ kW/K}$ . Cooling water enters at  $40^\circ\text{C}$ .
- (a) Calculate the cooling water flow rate required to maintain a heat rate of  $150 \text{ kW}$ .
- (b) Assuming that  $UA$  is independent of flow rate, calculate and plot the water flow rate required to provide heat rates over the range from 130 to 160 kW. Comment on the validity of your assumption.
- 11.38** A shell-and-tube heat exchanger (1 shell pass, 2 tube passes) is to be used to condense  $2.73 \text{ kg/s}$  of saturated steam at  $340 \text{ K}$ . Condensation occurs on the outer tube surfaces, and the corresponding convection coefficient is  $10,000 \text{ W/m}^2 \cdot \text{K}$ . The temperature of the cooling water entering the tubes is  $15^\circ\text{C}$ , and the exit temperature is not to exceed  $30^\circ\text{C}$ . Thin-walled tubes of 19-mm diameter are specified, and the mean velocity of water flow through the tubes is to be maintained at  $0.5 \text{ m/s}$ .
- (a) What is the minimum number of tubes that should be used, and what is the corresponding tube length per pass?
- (b) To reduce the size of the heat exchanger, it is proposed to increase the water-side convection coefficient by inserting a wire mesh in the tubes. If the

mesh increases the convection coefficient by a factor of two, what is the required tube length per pass?

- 11.39** Saturated water vapor leaves a steam turbine at a flow rate of 1.5 kg/s and a pressure of 0.51 bar. The vapor is to be completely condensed to saturated liquid in a shell-and-tube heat exchanger that uses city water as the cold fluid. The water enters the thin-walled tubes at 17°C and is to leave at 57°C. Assuming an overall heat transfer coefficient of  $2000 \text{ W/m}^2 \cdot \text{K}$ , determine the required heat exchanger surface area and the water flow rate. After extended operation, fouling causes the overall heat transfer coefficient to decrease to  $1000 \text{ W/m}^2 \cdot \text{K}$ , and to completely condense the vapor, there must be an attendant reduction in the vapor flow rate. For the same water inlet temperature and flow rate, what is the new vapor flow rate required for complete condensation?


- 11.40** A two-fluid heat exchanger has inlet and outlet temperatures of 65 and 40°C for the hot fluid and 15 and 30°C for the cold fluid. Can you tell whether this exchanger is operating under counterflow or parallel-flow conditions? Determine the effectiveness of the heat exchanger.

- 11.41** The human brain is especially sensitive to elevated temperatures. The cool blood in the veins leaving the face and neck and returning to the heart may contribute to thermal regulation of the brain by cooling the arterial blood flowing to the brain. Consider a vein and artery running between the chest and the base of the skull for a distance  $L = 250 \text{ mm}$ , with mass flow rates of  $3 \times 10^{-3} \text{ kg/s}$  in opposite directions in the two vessels. The vessels are of diameter  $D = 5 \text{ mm}$  and are separated by a distance  $w = 7 \text{ mm}$ . The thermal conductivity of the surrounding tissue is  $k_t = 0.5 \text{ W/m} \cdot \text{K}$ . If the arterial blood enters at 37°C and the venous blood enters at 27°C, at what temperature will the arterial blood exit? If the arterial blood becomes overheated, and the body responds by halving the blood flow rate, how much hotter can the entering arterial blood be and still maintain its exit temperature below 37°C? *Hint:* If we assume that all the heat leaving the artery enters the vein, then heat transfer between the two vessels can be modeled using a relationship found in Table 4.1. Approximate the blood properties as those of water.

- 11.42** Consider a *very long*, concentric tube heat exchanger having hot and cold water inlet temperatures of 85 and 15°C. The flow rate of the hot water is twice that of the cold water. Assuming equivalent hot and cold water specific heats, determine the hot water outlet

temperature for the following modes of operation: (a) counterflow and (b) parallel flow.

- 11.43** A plate-fin heat exchanger is used to condense a saturated refrigerant vapor in an air-conditioning system. The vapor has a saturation temperature of 45°C, and a condensation rate of 0.015 kg/s is dictated by system performance requirements. The frontal area of the condenser is fixed at  $A_{fr} = 0.25 \text{ m}^2$  by installation requirements, and a value of  $h_{fg} = 135 \text{ kJ/kg}$  may be assumed for the refrigerant.

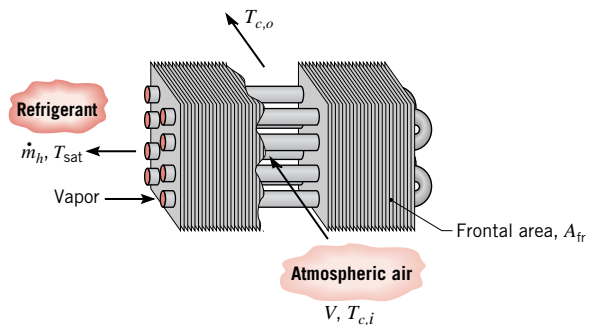

- (a) The condenser design is to be based on a nominal air inlet temperature of  $T_{c,i} = 30^\circ\text{C}$  and nominal air inlet velocity of  $V = 2 \text{ m/s}$  for which the manufacturer of the heat exchanger core indicates an overall coefficient of  $U = 50 \text{ W/m}^2 \cdot \text{K}$ . What is the corresponding value of the heat transfer surface area required to achieve the prescribed condensation rate? What is the air outlet temperature?

- (b) From the manufacturer of the heat exchanger core, it is also known that  $U \propto V^{0.7}$ . During daily operation the air inlet temperature is not controllable and may vary from 27 to 38°C. If the heat exchanger area is fixed by the result of part (a), what is the range of air velocities needed to maintain the prescribed condensation rate? Plot the velocity as a function of the air inlet temperature.


- 11.44** A shell-and-tube heat exchanger is to heat 10,000 kg/h of water from 16 to 84°C by hot engine oil flowing through the shell. The oil makes a single shell pass, entering at 160°C and leaving at 94°C, with an average heat transfer coefficient of  $400 \text{ W/m}^2 \cdot \text{K}$ . The water flows through 11 brass tubes of 22.9-mm inside diameter and 25.4-mm outside diameter, with each tube making four passes through the shell.

- (a) Assuming fully developed flow for the water, determine the required tube length per pass.

- (b) For the tube length found in part (a), plot the effectiveness, fluid outlet temperatures, and water-side convection coefficient as a function of the water

flow rate for  $5000 \leq \dot{m}_c \leq 15,000$  kg/h, with all other conditions remaining the same.

- 11.45** In a supercomputer, signal propagation delays are reduced by resorting to high-density circuit arrangements which are cooled by immersing them in a special dielectric liquid. The fluid is pumped in a closed loop through the computer and an adjoining shell-and-tube heat exchanger having one shell and two tube passes.

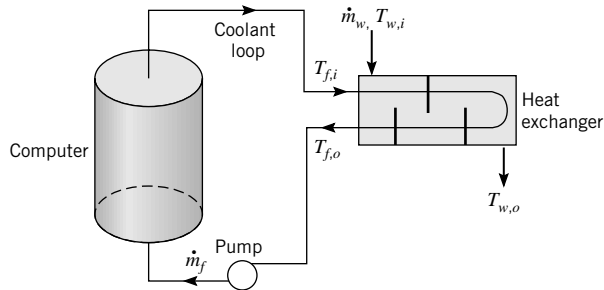

During normal operation, heat generated within the computer is transferred to the dielectric fluid passing through the computer at a flow rate of  $\dot{m}_f = 4.81$  kg/s. In turn, the fluid passes through the tubes of the heat exchanger and the heat is transferred to water passing over the tubes. The dielectric fluid may be assumed to have constant properties of  $c_p = 1040$  J/kg · K,  $\mu = 7.65 \times 10^{-4}$  kg/s · m,  $k = 0.058$  W/m · K, and  $Pr = 14$ . During normal operation, chilled water at a flow rate of  $\dot{m}_w = 2.5$  kg/s and an inlet temperature of  $T_{w,i} = 5^\circ\text{C}$  passes over the tubes. The water has a specific heat of  $4200$  J/kg · K and provides an average convection coefficient of  $10,000$  W/m<sup>2</sup> · K over the outer surface of the tubes.

- If the heat exchanger consists of 72 thin-walled tubes, each of 10-mm diameter, and fully developed flow is assumed to exist within the tubes, what is the convection coefficient associated with flow through the tubes?
- If the dielectric fluid enters the heat exchanger at  $T_{f,i} = 25^\circ\text{C}$  and is to leave at  $T_{f,o} = 15^\circ\text{C}$ , what is the required tube length per pass?
- For the exchanger with the tube length per pass determined in part (b), plot the outlet temperature of the dielectric fluid as a function of its flow rate for  $4 \leq \dot{m}_f \leq 6$  kg/s. Account for corresponding changes in the overall heat transfer coefficient, but assume all other conditions to remain the same.
- The site specialist for the computer facilities is concerned about changes in the performance of the water chiller supplying the cold water ( $\dot{m}_w$ ,

$T_{w,i}$ ) and their effect on the outlet temperature  $T_{f,o}$  of the dielectric fluid. With all other conditions remaining the same, determine the effect of a  $\pm 10\%$  change in the cold water flow rate on  $T_{f,o}$ .

- Repeat the performance analysis of part (d) to determine the effect of a  $\pm 3^\circ\text{C}$  change in the water inlet temperature on  $T_{f,o}$ , with all other conditions remaining the same.

- 11.46** A shell-and-tube heat exchanger consists of 135 thin-walled tubes in a double-pass arrangement, each of 12.5-mm diameter with a total surface area of  $47.5$  m<sup>2</sup>. Water (the tube-side fluid) enters the heat exchanger at  $15^\circ\text{C}$  and  $6.5$  kg/s and is heated by exhaust gas entering at  $200^\circ\text{C}$  and  $5$  kg/s. The gas may be assumed to have the properties of atmospheric air, and the overall heat transfer coefficient is approximately  $200$  W/m<sup>2</sup> · K.

- What are the gas and water outlet temperatures?
- Assuming fully developed flow, what is the tube-side convection coefficient?
- With all other conditions remaining the same, plot the effectiveness and fluid outlet temperatures as a function of the water flow rate over the range from 6 to 12 kg/s.
- What gas inlet temperature is required for the exchanger to supply 10 kg/s of hot water at an outlet temperature of  $42^\circ\text{C}$ , all other conditions remaining the same? What is the effectiveness for this operating condition?

- 11.47** An ocean thermal energy conversion system is being proposed for electric power generation. Such a system is based on the standard power cycle for which the working fluid is evaporated, passed through a turbine, and subsequently condensed. The system is to be used in very special locations for which the oceanic water temperature near the surface is approximately  $300$  K, while the temperature at reasonable depths is approximately  $280$  K. The warmer water is used as a heat source to evaporate the working fluid, while the colder water is used as a heat sink for condensation of the fluid. Consider a power plant that is to generate  $2$  MW of electricity at an efficiency (electric power output per heat input) of  $3\%$ . The evaporator is a heat exchanger consisting of a single shell with many tubes executing two passes. If the working fluid is evaporated at its phase change temperature of  $290$  K, with ocean water entering at  $300$  K and leaving at  $292$  K, what is the heat exchanger area required for the evaporator? What flow rate must be maintained for the water passing through the evaporator? The overall heat transfer coefficient may be approximated as  $1200$  W/m<sup>2</sup> · K.




**11.48** A single-pass, cross-flow heat exchanger with both fluids unmixed is being used to heat water ( $\dot{m}_c = 2 \text{ kg/s}$ ,  $c_p = 4200 \text{ J/kg} \cdot \text{K}$ ) from  $20^\circ\text{C}$  to  $100^\circ\text{C}$  with hot exhaust gases ( $c_p = 1200 \text{ J/kg} \cdot \text{K}$ ) entering at  $320^\circ\text{C}$ . What mass flow rate of exhaust gases is required? Assume that  $UA$  is equal to its design value of  $4700 \text{ W/K}$ , independent of the gas mass flow rate.

**11.49** Saturated process steam at 1 atm is condensed in a shell-and-tube heat exchanger (one shell, two tube passes). Cooling water enters the tubes at  $15^\circ\text{C}$  with an average velocity of  $3.5 \text{ m/s}$ . The tubes are thin-walled and made of copper with a diameter of  $14 \text{ mm}$  and length of  $0.5 \text{ m}$ . The convective heat transfer coefficient for condensation on the outer surface of the tubes is  $21,800 \text{ W/m}^2 \cdot \text{K}$ .

- Find the number of tubes/pass required to condense  $2.3 \text{ kg/s}$  of steam.
- Find the outlet water temperature.
- Find the maximum possible condensation rate that could be achieved with this heat exchanger using the same water flow rate and inlet temperature.
- Using the heat transfer surface area found in part (a), plot the water outlet temperature and steam condensation rate for water mean velocities in the range from  $1$  to  $5 \text{ m/s}$ . Assume that the shell-side convection coefficient remains unchanged.

**11.50** The chief engineer at a university that is constructing a large number of new student dormitories decides to install a counterflow concentric tube heat exchanger on each of the dormitory shower drains. The thin-walled copper drains are of diameter  $D_i = 50 \text{ mm}$ . Wastewater from the shower enters the heat exchanger at  $T_{h,i} = 38^\circ\text{C}$  while fresh water enters the dormitory at  $T_{c,i} = 10^\circ\text{C}$ . The wastewater flows down the vertical wall of the drain in a thin, *falling film*, providing  $h_h = 10,000 \text{ W/m}^2 \cdot \text{K}$ .

- If the annular gap is  $d = 10 \text{ mm}$ , the heat exchanger length is  $L = 1 \text{ m}$ , and the water flow rate is  $\dot{m} = 10 \text{ kg/min}$ , determine the heat transfer rate and the outlet temperature of the warmed fresh water.
- If a helical spring is installed in the annular gap so the fresh water is forced to follow a spiral path from the inlet to the fresh water outlet, resulting in  $h_c = 9050 \text{ W/m}^2 \cdot \text{K}$ , determine the heat transfer rate and the outlet temperature of the fresh water.
- Based on the result for part (b), calculate the daily savings if  $15,000$  students each take a  $10$ -minute shower per day and the cost of water heating is  $\$0.07/\text{kW} \cdot \text{h}$ .

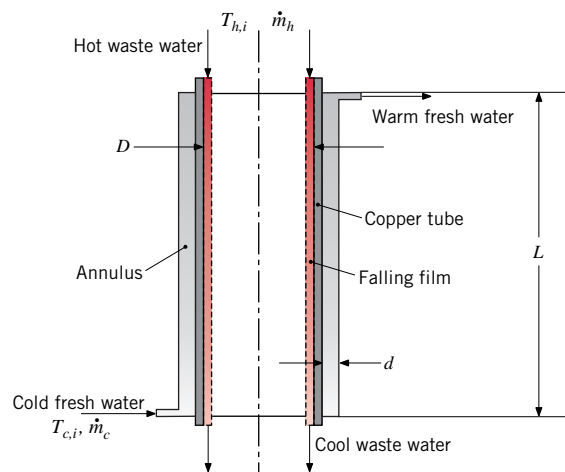

**11.51** A shell-and-tube heat exchanger with single shell and tube passes (Figure 11.3) is used to cool the oil of a large marine engine. Lake water (the shell-side fluid) enters the heat exchanger at  $2 \text{ kg/s}$  and  $15^\circ\text{C}$ , while the oil enters at  $1 \text{ kg/s}$  and  $140^\circ\text{C}$ . The oil flows through  $100$  copper tubes, each  $500 \text{ mm}$  long and having inner and outer diameters of  $6$  and  $8 \text{ mm}$ . The shell-side convection coefficient is approximately  $500 \text{ W/m}^2 \cdot \text{K}$ .


- What is the oil outlet temperature?
- Over time there is some degradation in the performance of the engine's water pump, as well as an accumulation of deposits on the outer surface of the tubes. To assess the effect of these changes on heat exchanger performance, obtain two plots of the oil outlet temperature as a function of water flow rate in the range from  $1$  to  $2 \text{ kg/s}$ . One should correspond to a clean outer surface ( $R'_{f,c} = 0$ ) and the other to surface conditions for which  $R'_{f,c} = 0.0003 \text{ m}^2 \cdot \text{K/W}$ .

**11.52** A shell-and-tube heat exchanger with one shell pass and  $20$  tube passes uses hot water on the tube side to heat oil on the shell side. The single copper tube has inner and outer diameters of  $20$  and  $24 \text{ mm}$  and a length per pass of  $3 \text{ m}$ . The water enters at  $87^\circ\text{C}$  and  $0.2 \text{ kg/s}$  and leaves at  $27^\circ\text{C}$ . Inlet and outlet temperatures of the oil are  $7$  and  $37^\circ\text{C}$ . What is the average convection coefficient for the tube outer surface?

**11.53** The oil in an engine is cooled by air in a cross-flow heat exchanger where both fluids are unmixed. Atmospheric air enters at  $30^\circ\text{C}$  and  $0.53 \text{ kg/s}$ . Oil at  $0.026 \text{ kg/s}$  enters at  $75^\circ\text{C}$  and flows through a tube of  $10\text{-mm}$  diameter. Assuming fully developed flow and constant wall heat flux, estimate the oil-side heat transfer coefficient. If the overall convection coefficient is  $53 \text{ W/m}^2 \cdot \text{K}$  and the

total heat transfer area is  $1 \text{ m}^2$ , determine the effectiveness. What is the exit temperature of the oil?


- 11.54** It is proposed that the exhaust gas from a diesel-powered electric generation plant be used to generate steam in a shell-and-tube heat exchanger with one shell and one tube pass. The steel tubes have a thermal conductivity of  $40 \text{ W/m} \cdot \text{K}$ , an inner diameter of  $50 \text{ mm}$ , and a wall thickness of  $4 \text{ mm}$ . The exhaust gas, whose flow rate is  $2 \text{ kg/s}$ , enters the heat exchanger at  $400^\circ\text{C}$  and must leave at  $215^\circ\text{C}$ . To limit the pressure drop within the tubes, the tube gas velocity should not exceed  $25 \text{ m/s}$ . If saturated water at  $11.7 \text{ bar}$  is supplied to the shell side of the exchanger, determine the required number of tubes and their length. Assume that the properties of the exhaust gas can be approximated as those of atmospheric air and that the water-side thermal resistance is negligible. However, account for fouling on the gas-side of the tubes and use a fouling resistance of  $0.0015 \text{ m}^2 \cdot \text{K/W}$ .
- 11.55** A recuperator is a heat exchanger that heats air used in a combustion process by extracting energy from the products of combustion. It can be used to increase the efficiency of a gas turbine by increasing the temperature of air entering the combustor.

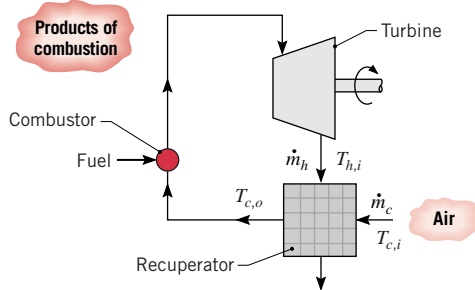

Consider a system for which the recuperator is a cross-flow heat exchanger with both fluids unmixed and the flow rates associated with the turbine exhaust and the air are  $\dot{m}_h = 6.5 \text{ kg/s}$  and  $\dot{m}_c = 6.2 \text{ kg/s}$ , respectively. The corresponding value of the overall heat transfer coefficient is  $U = 100 \text{ W/m}^2 \cdot \text{K}$ .

- (a) If the gas and air inlet temperatures are  $T_{h,i} = 700 \text{ K}$  and  $T_{c,i} = 300 \text{ K}$ , respectively, what heat transfer surface area is needed to provide an air outlet temperature of  $T_{c,o} = 500 \text{ K}$ ? Both the air and the products of combustion may be assumed to have a specific heat of  $1040 \text{ J/kg} \cdot \text{K}$ .
- (b) For the prescribed conditions, compute and plot the air outlet temperature as a function of the heat transfer surface area.

- 11.56** A concentric tube heat exchanger uses water, which is available at  $15^\circ\text{C}$ , to cool ethylene glycol from  $100$  to  $60^\circ\text{C}$ . The water and glycol flow rates are each  $0.5 \text{ kg/s}$ . What are the maximum possible heat transfer rate and effectiveness of the exchanger? Which is preferred, a parallel-flow or counterflow mode of operation?
- 11.57** Water is used for both fluids (unmixed) flowing through a single-pass, cross-flow heat exchanger. The hot water enters at  $90^\circ\text{C}$  and  $10,000 \text{ kg/h}$ , while the cold water enters at  $10^\circ\text{C}$  and  $20,000 \text{ kg/h}$ . If the effectiveness of the exchanger is  $60\%$ , determine the cold water exit temperature.
- 11.58** A cross-flow heat exchanger consists of a bundle of  $32$  tubes in a  $0.6\text{-m}^2$  duct. Hot water at  $150^\circ\text{C}$  and a mean velocity of  $0.5 \text{ m/s}$  enters the tubes having inner and outer diameters of  $10.2$  and  $12.5 \text{ mm}$ . Atmospheric air at  $10^\circ\text{C}$  enters the exchanger with a volumetric flow rate of  $1.0 \text{ m}^3/\text{s}$ . The convection heat transfer coefficient on the tube outer surfaces is  $400 \text{ W/m}^2 \cdot \text{K}$ . Estimate the fluid outlet temperatures.
- 11.59** Exhaust gas from a furnace is used to preheat the combustion air supplied to the furnace burners. The gas, which has a flow rate of  $15 \text{ kg/s}$  and an inlet temperature of  $1100 \text{ K}$ , passes through a bundle of tubes, while the air, which has a flow rate of  $10 \text{ kg/s}$  and an inlet temperature of  $300 \text{ K}$ , is in cross flow over the tubes. The tubes are unfinned, and the overall heat transfer coefficient is  $100 \text{ W/m}^2 \cdot \text{K}$ . Determine the total tube surface area required to achieve an air outlet temperature of  $850 \text{ K}$ . The exhaust gas and the air may each be assumed to have a specific heat of  $1075 \text{ J/kg} \cdot \text{K}$ .
- 11.60** A recuperator is a heat exchanger that heats the air used in a combustion process by extracting energy from the products of combustion (the flue gas). Consider using a single-pass, cross-flow heat exchanger as a recuperator.

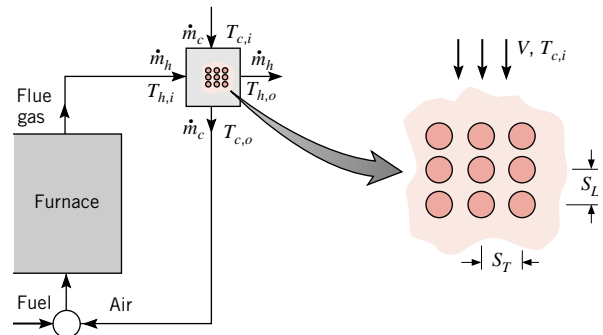

Eighty (80) silicon carbide ceramic tubes ( $k = 20 \text{ W/m} \cdot \text{K}$ ) of inner and outer diameters equal to  $55$  and  $80 \text{ mm}$ , respectively, and of length  $L = 1.4 \text{ m}$  are

arranged as an aligned tube bank of longitudinal and transverse pitches  $S_L = 100$  mm and  $S_T = 120$  mm, respectively. Cold air is in cross flow over the tube bank with upstream conditions of  $V = 1$  m/s and  $T_{c,i} = 300$  K, while hot flue gases of inlet temperature  $T_{h,i} = 1400$  K pass through the tubes. The tube outer surface is clean, while the inner surface is characterized by a fouling factor of  $R_f'' = 2 \times 10^{-4}$  m<sup>2</sup> · K/W. The air and flue gas flow rates are  $\dot{m}_c = 1.0$  kg/s and  $\dot{m}_h = 1.05$  kg/s, respectively. As first approximations, (1) evaluate all required air properties at 1 atm and 300 K, (2) assume the flue gas to have the properties of air at 1 atm and 1400 K, and (3) assume the tube wall temperature to be at 800 K for the purpose of treating the effect of variable properties on convection heat transfer.

- (a) If there is a 1% fuel savings associated with each 10°C increase in the temperature of the combustion air ( $T_{c,o}$ ) above 300 K, what is the percentage fuel savings for the prescribed conditions?

- (b) The performance of the recuperator is strongly influenced by the product of the overall heat transfer coefficient and the total surface area,  $UA$ . Compute and plot  $T_{c,o}$  and the percentage fuel savings as a function of  $UA$  for  $300 \leq UA \leq 600$  W/K. Without changing the flow rates, what measures may be taken to increase  $UA$ ?

- 11.61** Consider operation of the furnace–recuperator combination of Problem 11.60 under conditions for which chemical energy is converted to thermal energy in the combustor at a rate of  $\dot{q}_{\text{comb}} = 2.0 \times 10^6$  W and energy is transferred from the combustion gases to the load in the furnace at a rate of  $\dot{q}_{\text{load}} = 1.4 \times 10^6$  W. Assuming equivalent flow rates ( $\dot{m}_c = \dot{m}_h = 1.0$  kg/s) and specific heats ( $c_{p,c} = c_{p,h} = 1200$  J/kg · K) for the cold air and flue gases in the recuperator, determine  $T_{h,i}$ ,  $T_{h,o}$ , and  $T_{c,o}$  when  $T_{c,i} = 300$  K and the recuperator has an effectiveness of  $\varepsilon = 0.30$ . What value of the effectiveness would be needed to achieve a combustor air inlet temperature of 800 K?

- 11.62** A shell-and-tube heat exchanger consisting of one shell pass and two tube passes is used to transfer heat from an ethylene glycol–water solution (shell side) supplied from a rooftop solar collector to pure water (tube side) used for household purposes. The tubes are of inner and outer diameters  $D_i = 3.6$  mm and  $D_o = 3.8$  mm, respectively. Each of the 100 tubes is 0.8 m long (0.4 m per pass), and the heat transfer coefficient associated with the ethylene glycol–water mixture is  $h_o = 11,000$  W/m<sup>2</sup> · K.

- (a) For pure copper tubes, calculate the heat transfer rate from the ethylene glycol–water solution

( $\dot{m} = 2.5$  kg/s,  $T_{h,i} = 80^\circ\text{C}$ ) to the pure water ( $\dot{m} = 2.5$  kg/s,  $T_{c,i} = 20^\circ\text{C}$ ). Determine the outlet temperatures of both streams of fluid. The density and specific heat of the ethylene glycol–water mixture are 1040 kg/m<sup>3</sup> and 3660 J/kg · K, respectively.

- (b) It is proposed to replace the copper tube bundle with a bundle composed of high-temperature nylon tubes of the same diameter and tube wall thickness. The nylon is characterized by a thermal conductivity of  $k_n = 0.31$  W/m · K. Determine the tube length required to transfer the same amount of energy as in part (a).

- 11.63** Consider a concentric tube heat exchanger characterized by a uniform overall heat transfer coefficient and operating under the following conditions:

	$\dot{m}$ (kg/s)	$c_p$ (J/kg · K)	$T_i$ (°C)	$T_o$ (°C)
Cold fluid	0.125	4200	40	95
Hot fluid	0.125	2100	210	—

What is the maximum possible heat transfer rate? What is the heat exchanger effectiveness? Should the heat exchanger be operated in parallel flow or in counterflow? What is the ratio of the required areas for these two flow conditions?

- 11.64** Consider a concentric tube heat exchanger with hot and cold water inlet temperatures of 200 and 35°C, respectively. The flow rates of the hot and cold fluids are 42 and 84 kg/h, respectively. Assume the overall heat transfer coefficient is 180 W/m<sup>2</sup> · K.

- (a) What is the maximum heat transfer rate that could be achieved for the prescribed inlet conditions?  
(b) If the exchanger is operated in counterflow with a heat transfer area of 0.33 m<sup>2</sup>, determine the outlet fluid temperatures.

- (c) With all other conditions remaining the same, plot the effectiveness and fluid outlet temperatures as a function of the product  $UA$  for the range from 50 to 1000 W/K. As  $UA$  becomes very large, what is the asymptotic value for  $T_{h,o}$ ?

- (d) What is the largest possible heat transfer rate that could be achieved for the prescribed inlet conditions, if the exchanger is operated in parallel flow and is very long? What is the effectiveness of the exchanger in this configuration?

- (e) For operation in parallel flow, plot the effectiveness and fluid outlet temperatures as a function of the product  $UA$  for the range from 50 to 1000 W/K.

As  $UA$  becomes very large, what are the asymptotic values for  $T_{h,o}$  and  $T_{c,o}$ ?

- 11.65** The floor space of any facility that houses shell-and-tube heat exchangers must be sufficiently large so the tube bundle can be serviced easily. A rule of thumb is that the floor space must be at least 2.5 times the length of the tube bundle so that the bundle can be completely removed from the shell (hence the absolute minimum floor space is twice the tube bundle length) and subsequently cleaned, repaired, or replaced easily (associated with the extra half bundle length floor space). The room in which the heat exchanger of Problem 11.22 is to be installed is 8 m long and, therefore, the 4.7-m-long heat exchanger is too large for the facility. Will a shell-and-tube heat exchanger with two shells, one above the other, be sufficiently small to fit into the facility? Each shell has 10 tubes and 8 tube passes.
- 11.66** Consider the influence of a finite sheet thickness in Example 11.2, when there are 40 gaps.
- Determine the exterior dimension,  $L$ , of the heat exchanger core for a sheet thickness of  $t = 0.8$  mm for pure aluminum ( $k_{al} = 237$  W/m · K) and polyvinylidene fluoride (PVDF,  $k_{pv} = 0.17$  W/m · K) sheets. Neglect the thickness of the top and bottom exterior plates.
  - Plot the heat exchanger core dimension as a function of the sheet thickness for aluminum and PVDF over the range  $0 \leq t \leq 1$  mm.
- 11.67** Hot exhaust gases are used in a shell-and-tube exchanger to heat 2.5 kg/s of water from 35 to 85°C. The gases, assumed to have the properties of air, enter at 200°C and leave at 93°C. The overall heat transfer coefficient is 180 W/m<sup>2</sup> · K. Using the effectiveness–NTU method, calculate the area of the heat exchanger.
- 11.68** In open heart surgery under hypothermic conditions, the patient's blood is cooled before the surgery and rewarmed afterward. It is proposed that a concentric tube, counterflow heat exchanger of length 0.5 m be used for this purpose, with the thin-walled inner tube having a diameter of 55 mm. The specific heat of the blood is 3500 J/kg · K.
- If water at  $T_{h,i} = 60^\circ\text{C}$  and  $\dot{m}_h = 0.10$  kg/s is used to heat blood entering the exchanger at  $T_{c,i} = 18^\circ\text{C}$  and  $\dot{m}_c = 0.05$  kg/s, what is the temperature of the blood leaving the exchanger? The overall heat transfer coefficient is 500 W/m<sup>2</sup> · K.
  - The surgeon may wish to control the heat rate  $q$  and the outlet temperature  $T_{c,o}$  of the blood by altering the flow rate and/or inlet temperature of the water during the rewarming process. To assist in the development of an appropriate controller for the prescribed values of  $\dot{m}_c$  and  $T_{c,i}$ , compute and plot  $q$  and  $T_{c,o}$  as a function of  $\dot{m}_h$  for  $0.05 \leq \dot{m}_h \leq 0.20$  kg/s and values of  $T_{h,i} = 50, 60$ , and  $70^\circ\text{C}$ . Since the dominant influence on the overall heat transfer coefficient is associated with the blood flow conditions, the value of  $U$  may be assumed to remain at 500 W/m<sup>2</sup> · K. Should certain operating conditions be excluded?
- 11.69** Ethylene glycol and water, at 60 and 10°C, respectively, enter a shell-and-tube heat exchanger for which the total heat transfer area is 15 m<sup>2</sup>. With ethylene glycol and water flow rates of 2 and 5 kg/s, respectively, the overall heat transfer coefficient is 800 W/m<sup>2</sup> · K.
- Determine the rate of heat transfer and the fluid outlet temperatures.
  - Assuming all other conditions to remain the same, plot the effectiveness and fluid outlet temperatures as a function of the flow rate of ethylene glycol for  $0.5 \leq \dot{m}_h \leq 5$  kg/s.
- 11.70** A boiler used to generate saturated steam is in the form of an unfinned, cross-flow heat exchanger, with water flowing through the tubes and a high-temperature gas in cross flow over the tubes. The gas, which has a specific heat of 1120 J/kg · K and a mass flow rate of 10 kg/s, enters the heat exchanger at 1400 K. The water, which has a flow rate of 3 kg/s, enters as saturated liquid at 450 K and leaves as saturated vapor at the same temperature. If the overall heat transfer coefficient is 50 W/m<sup>2</sup> · K and there are 500 tubes, each of 0.025-m diameter, what is the required tube length?
- 11.71** Waste heat from the exhaust gas of an industrial furnace is recovered by mounting a bank of unfinned tubes in the furnace stack. Pressurized water at a flow rate of 0.025 kg/s makes a single pass through *each* of the tubes, while the exhaust gas, which has an upstream velocity of 5.0 m/s, moves in cross flow over the tubes at 2.25 kg/s. The tube bank consists of a square array of 100 thin-walled tubes ( $10 \times 10$ ), each 25 mm in diameter and 4 m long. The tubes are aligned with a transverse pitch of 50 mm. The inlet temperatures of the water and the exhaust gas are 300 and 800 K, respectively. The water flow is fully developed, and the gas properties may be assumed to be those of atmospheric air.
- What is the overall heat transfer coefficient?
  - What are the fluid outlet temperatures?
  - Operation of the heat exchanger may vary according to the demand for hot water. For the prescribed

heat exchanger design and inlet conditions, compute and plot the rate of heat recovery and the fluid outlet temperatures as a function of water flow rate per tube for  $0.02 \leq \dot{m}_{c,1} \leq 0.20$  kg/s.

**11.72** A heat exchanger consists of a bank of 1200 thin-walled tubes with air in cross flow over the tubes. The tubes are arranged in-line, with 40 longitudinal rows (along the direction of airflow) and 30 transverse rows. The tubes are 0.07 m in diameter and 2 m long, with transverse and longitudinal pitches of 0.14 m. The hot fluid flowing through the tubes consists of saturated steam condensing at 400 K. The convection coefficient of the condensing steam is much larger than that of the air.

(a) If air enters the heat exchanger at  $\dot{m}_c = 12$  kg/s, 300 K, and 1 atm, what is its outlet temperature?

(b) The condensation rate may be controlled by varying the airflow rate. Compute and plot the air outlet temperature, the heat rate, and the condensation rate as a function of flow rate for  $10 \leq \dot{m}_c \leq 50$  kg/s.

**11.73** In analyzing thermodynamic cycles involving heat exchangers, it is useful to express the heat rate in terms of an overall thermal resistance  $R_t$  and the inlet temperatures of the hot and cold fluids,

$$q = \frac{(T_{h,i} - T_{c,i})}{R_t}$$

The heat transfer rate can also be expressed in terms of the rate equations,

$$q = UA \Delta T_{lm} = \frac{1}{R_{lm}} \Delta T_{lm}$$

(a) Derive a relation for  $R_{lm}/R_t$  for a *parallel-flow* heat exchanger in terms of a single dimensionless parameter  $B$ , which does not involve any fluid temperatures but only  $U$ ,  $A$ ,  $C_h$ ,  $C_c$  (or  $C_{min}$ ,  $C_{max}$ ).

(b) Calculate and plot  $R_{lm}/R_t$  for values of  $B = 0.1$ , 1.0, and 5.0. What conclusions can be drawn from the plot?

**11.74** The power needed to overcome wind and friction drag associated with an automobile traveling at a constant velocity of 25 m/s is 9 kW.

(a) Determine the required heat transfer area of the radiator if the vehicle is equipped with an internal combustion engine operating at an efficiency of 35%. (Assume 65% of the energy generated by the engine is in the form of waste heat removed by the radiator.) The inlet and outlet mean temperatures of the water with respect to the radiator are  $T_{m,i} = 400$  K and  $T_{m,o} = 330$  K, respectively.

Cooling air is available at 3 kg/s and 300 K. The radiator may be analyzed as a cross-flow heat exchanger with both fluids unmixed with an overall heat transfer coefficient of  $400 \text{ W/m}^2 \cdot \text{K}$ .

(b) Determine the required water mass flow rate and heat transfer area of the radiator if the vehicle is equipped with a fuel cell operating at 50% efficiency. The fuel cell operating temperature is limited to approximately 85°C, so the inlet and outlet mean temperatures of the water with respect to the radiator are  $T_{m,i} = 355$  K and  $T_{m,o} = 330$  K, respectively. The air inlet temperature is as in part (a). Assume the flow rate of air is proportional to the surface area of the radiator. *Hint:* Iteration is required.

(c) Determine the required heat transfer area of the radiator and the outlet mean temperature of the water for the fuel cell-equipped vehicle if the mass flow rate of the water is the same as in part (a).


**11.75** An air conditioner operating between indoor and outdoor temperatures of 23 and 43°C, respectively, removes 5 kW from a building. The air conditioner can be modeled as a reversed Carnot heat engine with refrigerant as the working fluid. The efficiency of the motor for the compressor and fan is 80%, and 0.2 kW is required to operate the fan.

(a) Assuming negligible thermal resistances (Problem 11.73) between the refrigerant in the condenser and the outside air and between the refrigerant in the evaporator and the inside air, calculate the power required by the motor.

(b) If the thermal resistances between the refrigerant and the air in the evaporator and condenser sections are the same,  $3 \times 10^{-3} \text{ K/W}$ , determine the temperature required by the refrigerant in each section. Calculate the power required by the motor.

**11.76** In a Rankine power system, 1.5 kg/s of steam leaves the turbine as saturated vapor at 0.51 bar. The steam is condensed to saturated liquid by passing it over the tubes of a shell-and-tube heat exchanger, while liquid water, having an inlet temperature of  $T_{c,i} = 280$  K, is passed through the tubes. The condenser contains 100 thin-walled tubes, each of 10-mm diameter, and the total water flow rate through the tubes is 15 kg/s. The average convection coefficient associated with condensation on the outer surface of the tubes may be approximated as  $\bar{h}_o = 5000 \text{ W/m}^2 \cdot \text{K}$ . Appropriate property values for the liquid water are  $c_p = 4178 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 700 \times 10^{-6} \text{ kg/s} \cdot \text{m}$ ,  $k = 0.628 \text{ W/m} \cdot \text{K}$ , and  $Pr = 4.6$ .



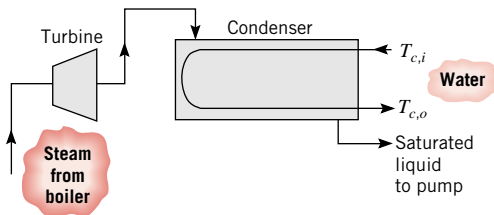

- (a) What is the water outlet temperature?
- (b) What is the required tube length (per tube)?
- (c) After extended use, deposits accumulating on the inner and outer tube surfaces provide a cumulative fouling factor of  $0.0003 \text{ m}^2 \cdot \text{K/W}$ . For the prescribed inlet conditions and the computed tube length, what mass fraction of the vapor is condensed?
- (d) For the tube length computed in part (b) and the fouling factor prescribed in part (c), explore the extent to which the water flow rate and inlet temperature may be varied (within physically plausible ranges) to improve the condenser performance. Represent your results graphically, and draw appropriate conclusions.
- 11.77** Consider a Rankine cycle with saturated steam leaving the boiler at a pressure of 2 MPa and a condenser pressure of 10 kPa.
- (a) Calculate the thermal efficiency of the ideal Rankine cycle for these operating conditions.
- (b) If the net reversible work for the cycle is 0.5 MW, calculate the required flow rate of cooling water supplied to the condenser at  $15^\circ\text{C}$  with an allowable temperature rise of  $10^\circ\text{C}$ .
- (c) Design a shell-and-tube heat exchanger (one-shell, multiple-tube passes) that will meet the heat rate and temperature conditions required of the condenser. Your design should specify the number of tubes and their diameter and length.
- 11.78** Consider the Rankine cycle of Problem 11.77, which rejects 2.3 MW to the condenser, which is supplied with a cooling water flow rate of 70 kg/s at  $15^\circ\text{C}$ .
- (a) Calculate  $UA$ , a parameter that is indicative of the size of the condenser required for this operating condition.
- (b) Consider now the situation where the overall heat transfer coefficient for the condenser,  $U$ , is reduced by 10% because of fouling. Determine the reduction in the thermal efficiency of the cycle caused by fouling, assuming that the cooling water flow rate and water temperature remain the same and that the condenser is operated at the same steam pressure.
- Compact Heat Exchangers**
- 11.79** Consider the compact heat exchanger conditions of Example 11.6. After extended use, fouling factors of  $0.0005$  and  $0.001 \text{ m}^2 \cdot \text{K/W}$  are associated with the water- and gas-side conditions, respectively. What is the gas-side overall heat transfer coefficient?
- 11.80** Consider the heat exchanger core geometry and frontal area prescribed in Example 11.6. The exchanger must heat 2 kg/s of water from 300 to 350 K, using 1.25 kg/s of combustion gases entering at 700 K. Using the overall heat transfer coefficient determined in the example, find the required heat exchanger volume, assuming single-pass operation. What is the number of tube rows  $N_L$  in the longitudinal (gas-flow) direction? If the velocity of water flowing through the tubes is 100 mm/s, what is the number of tube rows  $N_T$  in the transverse direction? What is the required tube length?
- 11.81** Consider the conditions of Example 11.6, but with the continuous fin arrangement of Figure 11.17 used in lieu of the circular fins of Figure 11.16. The heat exchanger core is fabricated from aluminum, and the tubes have an inside diameter of 8.2 mm. An inside convection coefficient of  $1500 \text{ W/m}^2 \cdot \text{K}$  may again be assumed for water flow through the tubes, with combustion gases at 1 atm and 825 K in cross flow over the tubes. For a gas flow rate of 1.25 kg/s and a frontal area of  $0.20 \text{ m}^2$ , what is the gas-side overall heat transfer coefficient? If water at a flow rate of 1 kg/s is to be heated from 290 to 370 K, what is the required heat exchanger volume? *Hint:* Estimate the fin efficiency by assuming a hypothetical circular fin of radius  $r_2 = 15.8 \text{ mm}$  for each tube. You may use the aluminum and fluid properties provided in Example 11.6.
- 11.82** A cooling coil consists of a bank of aluminum ( $k = 237 \text{ W/m} \cdot \text{K}$ ) finned tubes having the core configuration of Figure 11.16 and an inner diameter of 13.8 mm. The tubes are installed in a plenum whose square cross section is 0.4 m on a side, thereby providing a frontal area of  $0.16 \text{ m}^2$ . Atmospheric air at 1.5 kg/s is in cross flow over the tubes, while saturated refrigerant-134a at 1 atm experiences evaporation in the tubes. If the air enters at  $37^\circ\text{C}$  and its exit temperature must not exceed  $17^\circ\text{C}$ , what is the minimum allowable number of tube rows in the flow direction? A convection coefficient of  $5000 \text{ W/m}^2 \cdot \text{K}$  is associated with evaporation in the tubes.
- 11.83** A cooling coil consists of a bank of aluminum ( $k = 237 \text{ W/m} \cdot \text{K}$ ) finned tubes having the core configuration of Figure 11.16 and an inner diameter of 13.8 mm. The tubes are installed in a plenum whose square cross section is 0.4 m on a side, thereby providing a

frontal area of  $0.16 \text{ m}^2$ . Atmospheric air at  $1.5 \text{ kg/s}$  is in cross flow over the tubes, while saturated refrigerant-134a at 1 atm passes through the tubes. There are four rows of tubes in the airflow direction. If the air enters at  $37^\circ\text{C}$ , what is its exit temperature? A convection coefficient of  $5000 \text{ W/m}^2 \cdot \text{K}$  is associated with evaporation in the tubes.

- 11.84** A steam generator consists of a bank of stainless steel ( $k = 15 \text{ W/m} \cdot \text{K}$ ) tubes having the core configuration of Figure 11.16 and an inner diameter of 13.8 mm. The tubes are installed in a plenum whose square cross section is 0.6 m on a side, thereby providing a frontal area of  $0.36 \text{ m}^2$ . Combustion gases, whose properties may be approximated as those of atmospheric air, enter the plenum at 900 K and pass in cross flow over the tubes at  $3 \text{ kg/s}$ . If saturated water enters the tubes at a pressure of 2.455 bars and a flow rate of  $0.5 \text{ kg/s}$ ,

how many tube rows are required to provide saturated steam at the tube outlet? A convection coefficient of  $10,000 \text{ W/m}^2 \cdot \text{K}$  is associated with boiling in the tubes.

- 11.85** A steam generator consists of a bank of stainless steel ( $k = 15 \text{ W/m} \cdot \text{K}$ ) tubes having the core configuration of Figure 11.16 and an inner diameter of 13.8 mm. The tubes are installed in a plenum whose square cross section is 0.6 m on a side, thereby providing a frontal area of  $0.36 \text{ m}^2$ . Combustion gases, whose properties may be approximated as those of atmospheric air, enter the plenum at 900 K and pass in cross flow over the tubes at  $3 \text{ kg/s}$ . There are 11 rows of tubes in the gas flow direction. If saturated water at 2.455 bar experiences boiling in the tubes, what is the gas exit temperature? A convection coefficient of  $10,000 \text{ W/m}^2 \cdot \text{K}$  is associated with boiling in the tubes.

## 11S.1


### Log Mean Temperature Difference Method for Multipass and Cross-Flow Heat Exchangers

Although flow conditions are more complicated in multipass and cross-flow heat exchangers, Equations 11.6, 11.7, 11.14, and 11.15 may still be used if the following modification is made to the log mean temperature difference [1]:

$$\Delta T_{\text{lm}} = F \Delta T_{\text{lm,CF}} \quad (11S.1)$$


That is, the appropriate form of  $\Delta T_{\text{lm}}$  is obtained by applying a correction factor to the value of  $\Delta T_{\text{lm}}$  that would be computed *under the assumption of counterflow conditions*. Hence from Equation 11.17,  $\Delta T_1 = T_{h,i} - T_{c,o}$  and  $\Delta T_2 = T_{h,o} - T_{c,i}$ .

Algebraic expressions for the correction factor  $F$  have been developed for various shell-and-tube and cross-flow heat exchanger configurations [1–3], and the results may be represented graphically. Selected results are shown in Figures 11S.1 through 11S.4 for common heat exchanger configurations. The notation  $(T, t)$  is used to specify the fluid temperatures, with the variable  $t$  always assigned to the tube-side

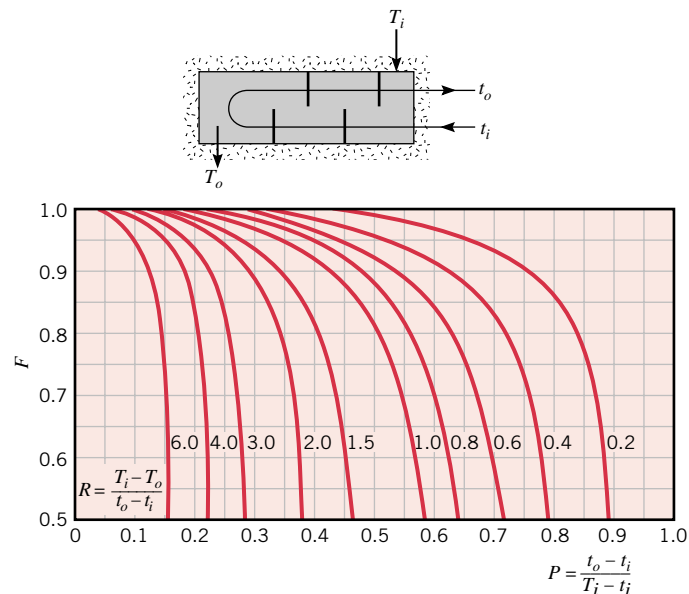


**FIGURE 11S.1** Correction factor for a shell-and-tube heat exchanger with one shell and any multiple of two tube passes (two, four, etc. tube passes).




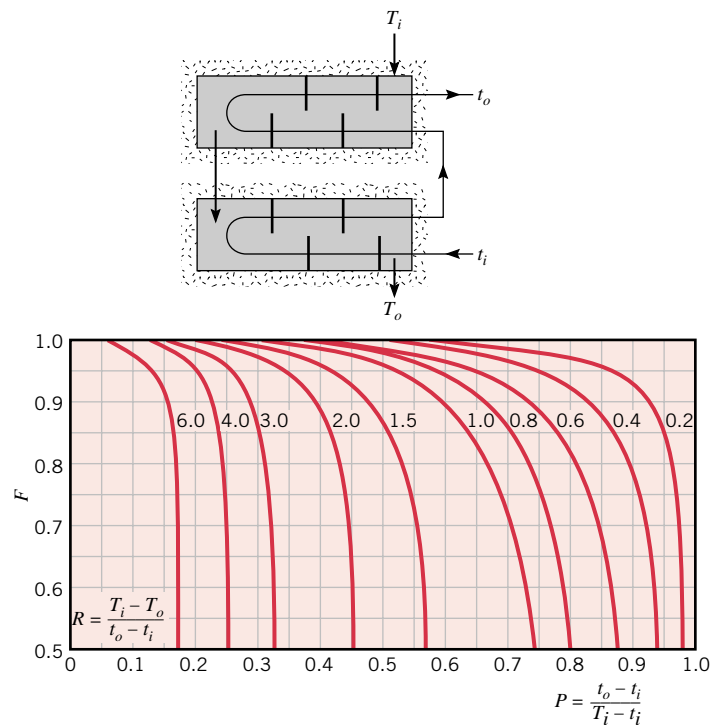

**FIGURE 11S.2** Correction factor for a shell-and-tube heat exchanger with two shell passes and any multiple of four tube passes (four, eight, etc. tube passes).

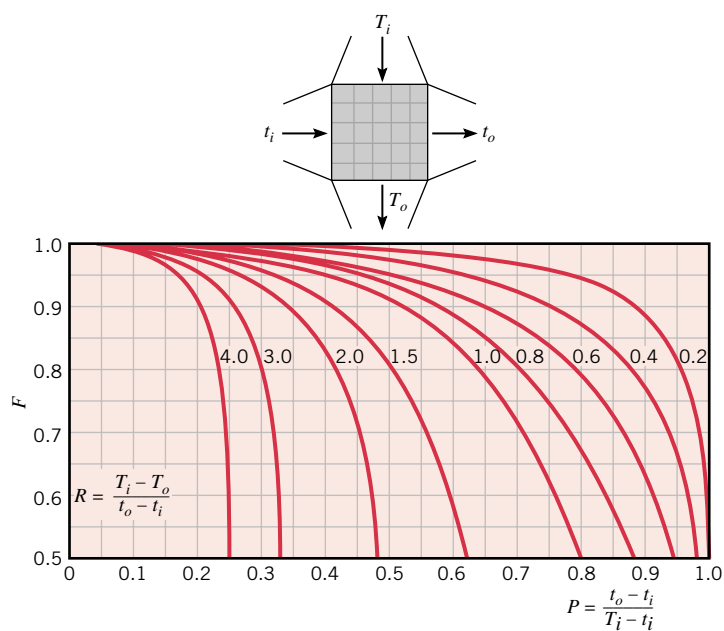

**FIGURE 11S.3** Correction factor for a single-pass, cross-flow heat exchanger with both fluids unmixed.

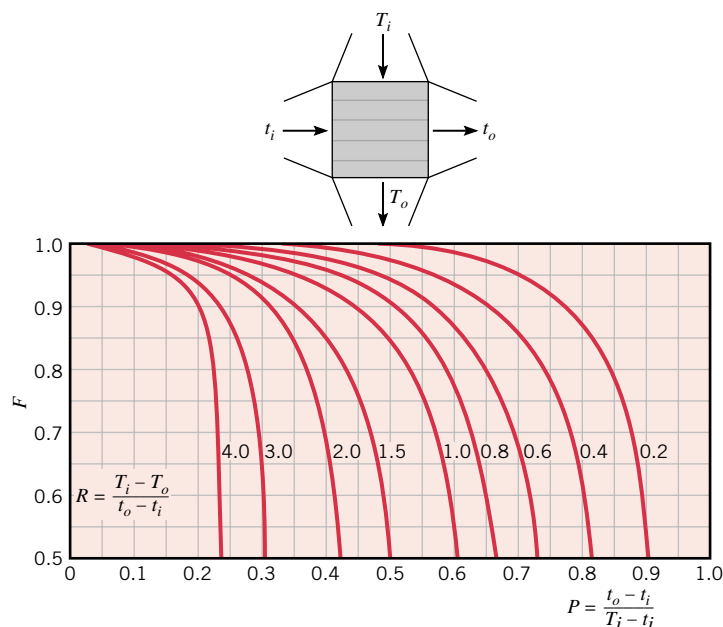

**FIGURE 11S.4** Correction factor for a single-pass, cross-flow heat exchanger with one fluid mixed and the other unmixed.

fluid. With this convention it does not matter whether the hot fluid or the cold fluid flows through the shell or the tubes. An important implication of Figures 11S.1 through 11S.4 is that, *if the temperature change of one fluid is negligible, either  $P$  or  $R$  is zero and  $F$  is 1. Hence heat exchanger behavior is independent of the specific configuration.* Such would be the case if one of the fluids underwent a phase change.

### EXAMPLE 11S.1


A shell-and-tube heat exchanger must be designed to heat 2.5 kg/s of water from 15 to 85°C. The heating is to be accomplished by passing hot engine oil, which is available at 160°C, through the shell side of the exchanger. The oil is known to provide an average convection coefficient of  $h_o = 400 \text{ W/m}^2 \cdot \text{K}$  on the outside of the tubes. Ten tubes pass the water through the shell. Each tube is thin walled, of diameter  $D = 25 \text{ mm}$ , and makes eight passes through the shell. If the oil leaves the exchanger at 100°C, what is its flow rate? How long must the tubes be to accomplish the desired heating?

### SOLUTION

**Known:** Fluid inlet and outlet temperatures for a shell-and-tube heat exchanger with 10 tubes making eight passes.

**Find:**

1. Oil flow rate required to achieve specified outlet temperature.
2. Tube length required to achieve specified water heating.

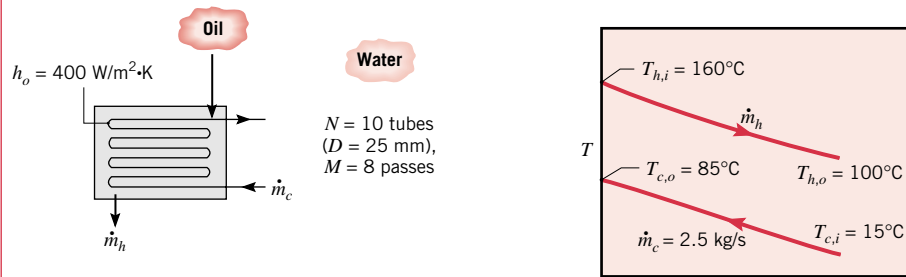**Schematic:****Assumptions:**

1. Negligible heat loss to the surroundings and kinetic and potential energy changes.
2. Constant properties.
3. Negligible tube wall thermal resistance and fouling effects.
4. Fully developed water flow in tubes.

**Properties:** Table A.5, unused engine oil ( $\bar{T}_h = 130^\circ\text{C}$ ):  $c_p = 2350 \text{ J/kg} \cdot \text{K}$ . Table A.6, water ( $\bar{T}_c = 50^\circ\text{C}$ ):  $c_p = 4181 \text{ J/kg} \cdot \text{K}$ ,  $\mu = 548 \times 10^{-6} \text{ N} \cdot \text{s/m}^2$ ,  $k = 0.643 \text{ W/m} \cdot \text{K}$ ,  $Pr = 3.56$ .

**Analysis:**

1. From the overall energy balance, Equation 11.7b, the heat transfer required of the exchanger is

$$q = \dot{m}_c c_{p,c} (T_{c,o} - T_{c,i}) = 2.5 \text{ kg/s} \times 4181 \text{ J/kg} \cdot \text{K} (85 - 15)^\circ\text{C}$$

$$q = 7.317 \times 10^5 \text{ W}$$

Hence, from Equation 11.6b,

$$\dot{m}_h = \frac{q}{c_{p,h} (T_{h,i} - T_{h,o})} = \frac{7.317 \times 10^5 \text{ W}}{2350 \text{ J/kg} \cdot \text{K} \times (160 - 100)^\circ\text{C}} = 5.19 \text{ kg/s} \quad \triangleleft$$

2. The required tube length may be obtained from Equations 11.14 and 11S.1, where

$$q = UAF \Delta T_{\text{lm,CF}}$$

From Equation 11.5,

$$U = \frac{1}{(1/h_i) + (1/h_o)}$$

where  $h_i$  may be obtained by first calculating  $Re_D$ . With  $\dot{m}_1 \equiv \dot{m}_c/N = 0.25 \text{ kg/s}$  defined as the water flow rate per tube, Equation 8.6 yields

$$Re_D = \frac{4\dot{m}_1}{\pi D \mu} = \frac{4 \times 0.25 \text{ kg/s}}{\pi (0.025 \text{ m}) 548 \times 10^{-6} \text{ kg/s} \cdot \text{m}} = 23,234$$

Hence the water flow is turbulent, and from Equation 8.60

$$Nu_D = 0.023 Re_D^{4/5} Pr^{0.4} = 0.023(23,234)^{4/5} (3.56)^{0.4} = 119$$

$$h_i = \frac{k}{D} Nu_D = \frac{0.643 \text{ W/m} \cdot \text{K}}{0.025 \text{ m}} 119 = 3061 \text{ W/m}^2 \cdot \text{K}$$

Hence

$$U = \frac{1}{(1/400) + (1/3061)} = 354 \text{ W/m}^2 \cdot \text{K}$$

The correction factor  $F$  may be obtained from Figure 11S.1, where

$$R = \frac{160 - 100}{85 - 15} = 0.86 \quad P = \frac{85 - 15}{160 - 15} = 0.48$$

Hence  $F \approx 0.87$ . From Equations 11.15 and 11.17, it follows that

$$\Delta T_{\text{lm,CF}} = \frac{(T_{h,i} - T_{c,o}) - (T_{h,o} - T_{c,i})}{\ln [(T_{h,i} - T_{c,o}) / (T_{h,o} - T_{c,i})]} = \frac{75 - 85}{\ln (75/85)} = 79.9^\circ\text{C}$$

Hence, since  $A = N\pi DL$ , where  $N = 10$  is the number of tubes,

$$L = \frac{q}{UN\pi DF \Delta T_{\text{lm,CF}}} = \frac{7.317 \times 10^5 \text{ W}}{354 \text{ W/m}^2 \cdot \text{K} \times 10\pi(0.025 \text{ m})0.87(79.9^\circ\text{C})}$$

$$L = 37.9 \text{ m}$$



### Comments:

1. With  $(L/D) = 37.9 \text{ m}/0.025 \text{ m} = 1516$ , the assumption of fully developed conditions throughout the tube is justified.
2. With eight passes, the shell length is approximately  $L/M = 4.7 \text{ m}$ .

## References

1. Bowman, R. A., A. C. Mueller, and W. M. Nagle, *Trans. ASME*, **62**, 283, 1940.
2. *Standards of the Tubular Exchange Manufacturers Association*, 6th ed., Tubular Exchange Manufacturers Association, New York, 1978.
3. Jakob, M., *Heat Transfer*, Vol. 2, Wiley, New York, 1957.

## Problems

### Log Mean Temperature Difference Method

- 11S.1** Solve Problem 11.9 using the LMTD method.
- 11S.2** Solve Problem 11.10 using the LMTD method.
- 11S.3** Solve Problem 11.14 using the LMTD method.
- 11S.4** Solve Problem 11.15 using the LMTD method.
- 11S.5** Solve Problem 11.23 using the LMTD method.

**11S.6** Solve Problem 11.32 using the LMTD method.

**11S.7** Solve Problem 11.44 using the LMTD method.

**11S.8** Solve Problem 11.47 using the LMTD method.

**11S.9** Solve Problem 11.52 using the LMTD method.


**11S.10** Solve Problem 11.59 using the LMTD method.

**11S.11** Solve Problem 11.70 using the LMTD method.



# *CHAPTER* **12**

## **Radiation: Processes and Properties**

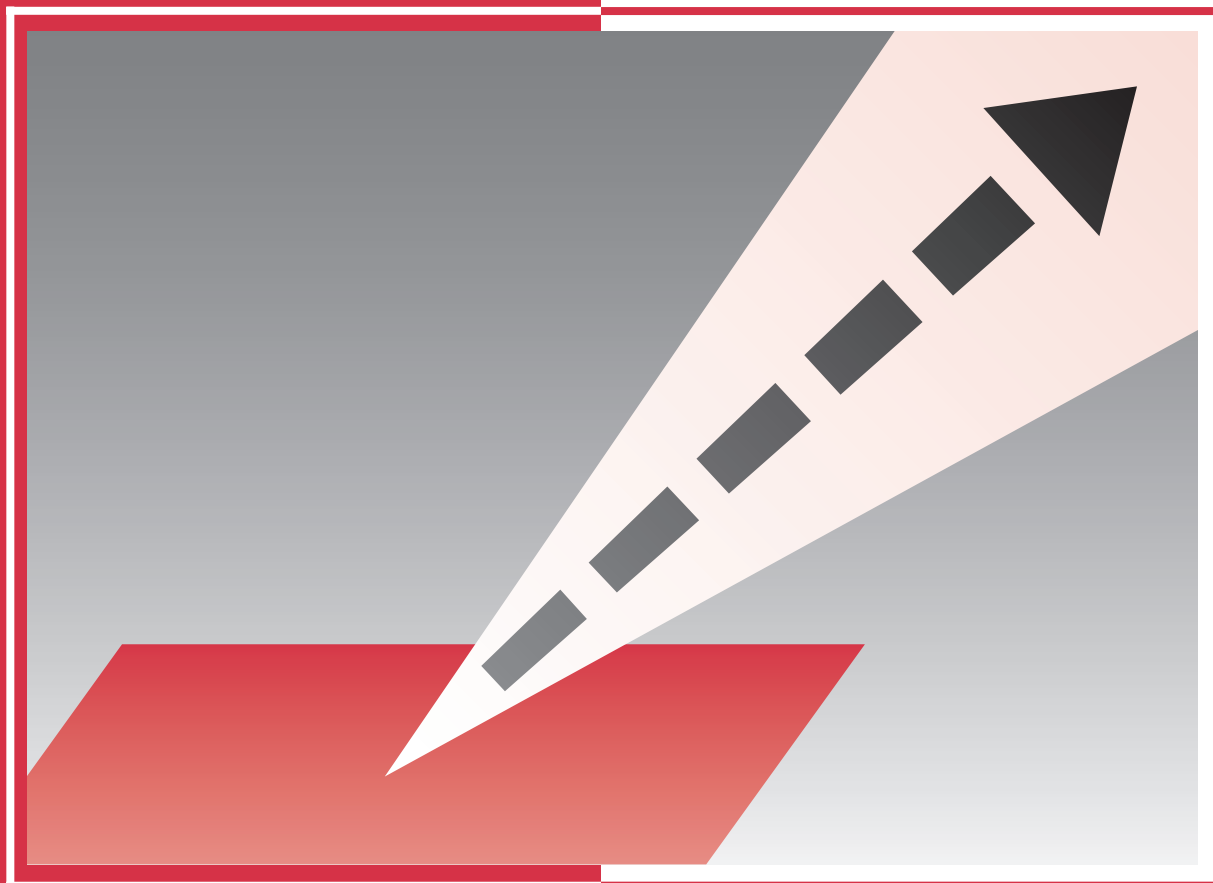

**W**e have come to recognize that heat transfer by conduction and convection requires the presence of a temperature gradient in some form of matter. In contrast, heat transfer by *thermal radiation* requires no matter. It is an extremely important process, and in the physical sense it is perhaps the most interesting of the heat transfer modes. It is relevant to many industrial heating, cooling, and drying processes, as well as to energy conversion methods that involve fossil fuel combustion and solar radiation.


In this chapter our objective is to consider the means by which thermal radiation is generated, the specific nature of the radiation, and the manner in which it interacts with matter. We give particular attention to radiative interactions at a surface and to the properties that must be introduced to describe these interactions. In Chapter 13 we focus on means for computing radiative exchange between two or more surfaces.

## 12.1

### Fundamental Concepts

Consider a solid that is initially at a higher temperature  $T_s$  than that of its surroundings  $T_{\text{sur}}$ , but around which there exists a vacuum (Figure 12.1). The presence of the vacuum precludes energy loss from the surface of the solid by conduction or convection. However, our intuition tells us that the solid will cool and eventually achieve thermal equilibrium with its surroundings. This cooling is associated with a reduction in the internal energy stored by the solid and is a direct consequence of the *emission* of thermal radiation from the surface. In turn, the surface will intercept and absorb radiation originating from the surroundings. However, if  $T_s > T_{\text{sur}}$  the *net* heat transfer rate by radiation  $q_{\text{rad, net}}$  is *from* the surface, and the surface will cool until  $T_s$  reaches  $T_{\text{sur}}$ .

We associate thermal radiation with the rate at which energy is emitted by matter as a result of its finite temperature. At this moment thermal radiation is being emitted by all the matter that surrounds you: by the furniture and walls of the room, if you are indoors, or by the ground, buildings, and the atmosphere and sun if you are

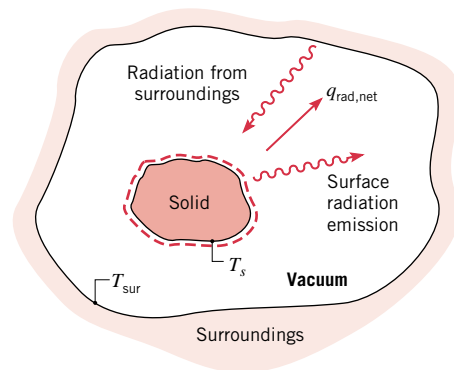

**FIGURE 12.1**

Radiation cooling of a heated solid.


outdoors. The mechanism of emission is related to energy released as a result of oscillations or transitions of the many electrons that constitute matter. These oscillations are, in turn, sustained by the internal energy, and therefore the temperature, of the matter. Hence we associate the emission of thermal radiation with thermally excited conditions within the matter.

All forms of matter emit radiation. For gases and for semitransparent solids, such as glass and salt crystals at elevated temperatures, emission is a *volumetric phenomenon*, as illustrated in Figure 12.2. That is, radiation emerging from a finite volume of matter is the integrated effect of local emission throughout the volume. However, in this text we concentrate on situations for which radiation is a *surface phenomenon*. In most solids and liquids, radiation emitted from interior molecules is strongly absorbed by adjoining molecules. Accordingly, radiation that is emitted from a solid or a liquid originates from molecules that are within a distance of approximately  $1\ \mu\text{m}$  from the exposed surface. It is for this reason that emission from a solid or a liquid into an adjoining gas or a vacuum can be viewed as a surface phenomenon, except in situations involving nanoscale or microscale devices.

We know that radiation originates due to emission by matter and that its subsequent transport does not require the presence of any matter. But what is the nature of this transport? One theory views radiation as the propagation of a collection of particles termed *photons* or *quanta*. Alternatively, radiation may be viewed as the propagation of *electromagnetic waves*. In any case we wish to attribute to radiation the standard wave properties of frequency  $\nu$  and wavelength  $\lambda$ . For radiation propagating in a particular medium, the two properties are related by


$$\lambda = \frac{c}{\nu} \quad (12.1)$$

where  $c$  is the speed of light in the medium. For propagation in a vacuum,  $c_o = 2.998 \times 10^8\ \text{m/s}$ . The unit of wavelength is commonly the micrometer ( $\mu\text{m}$ ), where  $1\ \mu\text{m} = 10^{-6}\ \text{m}$ .

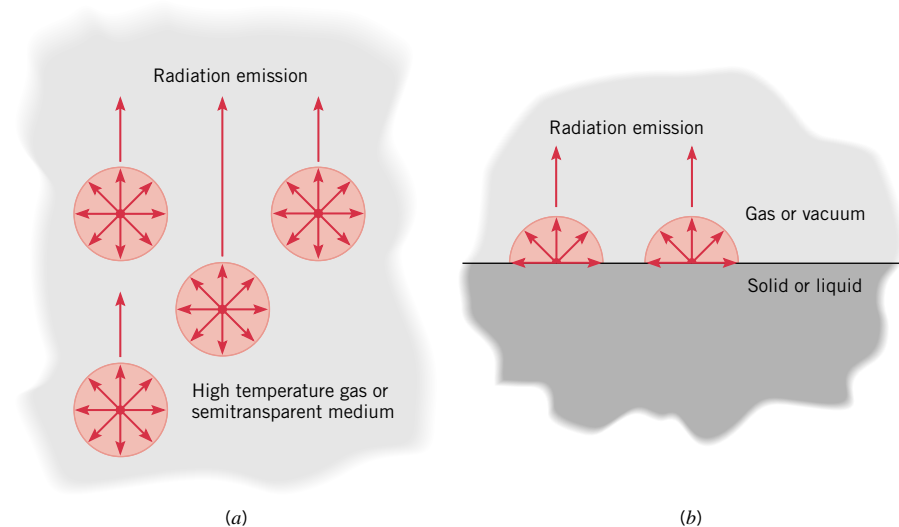

**FIGURE 12.2** The emission process. (a) As a volumetric phenomenon. (b) Surface phenomenon.



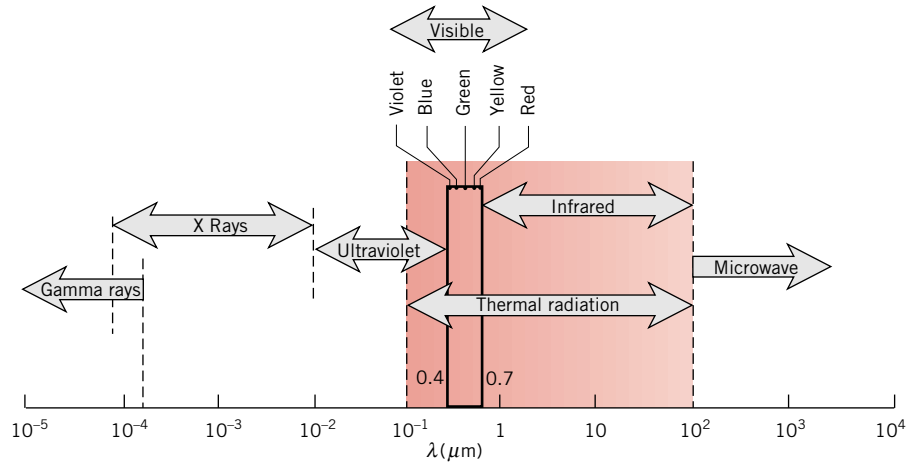


**FIGURE 12.3** Spectrum of electromagnetic radiation.

The complete electromagnetic spectrum is delineated in Figure 12.3. The short wavelength gamma rays, X rays, and ultraviolet (UV) radiation are primarily of interest to the high-energy physicist and the nuclear engineer, while the long wavelength microwaves and radio waves ( $\lambda > 10^5 \mu\text{m}$ ) are of concern to the electrical engineer. It is the intermediate portion of the spectrum, which extends from approximately 0.1 to 100  $\mu\text{m}$  and includes a portion of the UV and all of the visible and infrared (IR), that is termed *thermal radiation* because it is both caused by and affects the thermal state or temperature of matter. For this reason, thermal radiation is pertinent to heat transfer.

Thermal radiation emitted by a surface encompasses a range of wavelengths. As shown in Figure 12.4a, the magnitude of the radiation varies with wavelength, and the term *spectral* is used to refer to the nature of this dependence. As we will find, both the magnitude of the radiation at any wavelength and the *spectral distribution* vary with the nature and temperature of the emitting surface.

The spectral nature of thermal radiation is one of two features that complicates its description. The second feature relates to its *directionality*. As shown in Figure 12.4b, a surface may emit preferentially in certain directions, creating a *directional distribution* of the emitted radiation. To quantify the emission, absorption, reflection, and transmission concepts introduced in Chapter 1, we must be able to treat both spectral and directional effects.

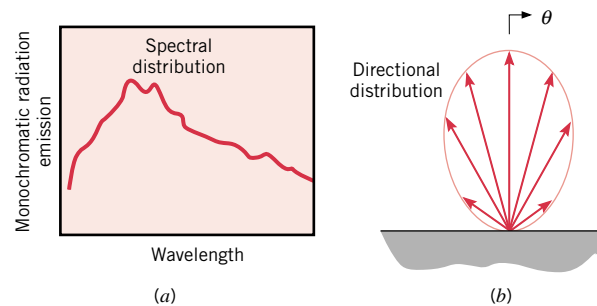

**FIGURE 12.4** Radiation emitted by a surface. (a) Spectral distribution. (b) Directional distribution.

## 12.2


### Radiation Intensity

Radiation that leaves a surface can propagate in all possible directions (Figure 12.4b), and we are often interested in knowing its directional distribution. Also, radiation incident upon a surface may come from different directions, and the manner in which the surface responds to this radiation depends on the direction. Such directional effects can be of primary importance in determining the net radiative heat transfer rate and may be treated by introducing the concept of *radiation intensity*.


#### 12.2.1 Mathematical Definitions

Due to its nature, mathematical treatment of radiation heat transfer involves the extensive use of the spherical coordinate system. From Figure 12.5a, we recall that the differential plane angle  $d\alpha$  is defined by a region between the rays of a circle and is measured as the ratio of the arc length  $dl$  on the circle to the radius  $r$  of the circle. Similarly, from Figure 12.5b, the differential solid angle  $d\omega$  is defined by a region between the rays of a sphere and is measured as the ratio of the area  $dA_n$  on the sphere to the sphere's radius squared. Accordingly,

$$d\omega \equiv \frac{dA_n}{r^2} \quad (12.2)$$

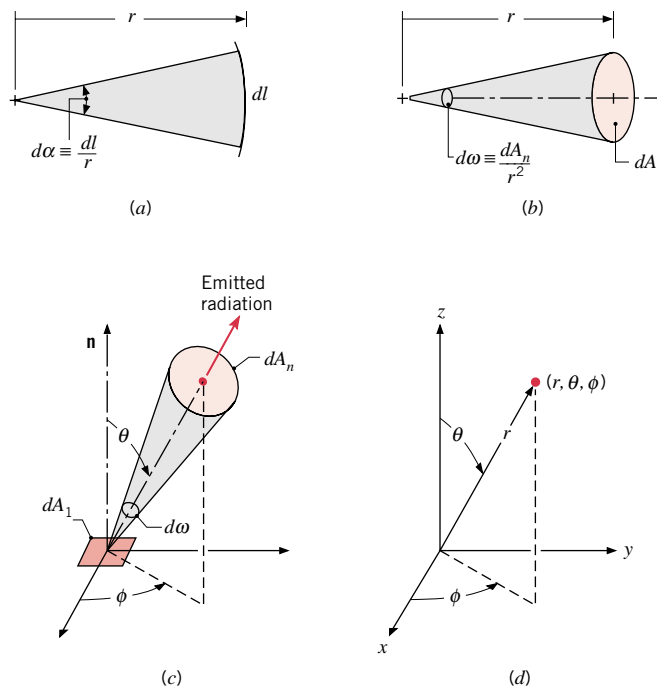

**FIGURE 12.5** Mathematical definitions. (a) Plane angle. (b) Solid angle. (c) Emission of radiation from a differential area  $dA_1$  into a solid angle  $d\omega$  subtended by  $dA_n$  at a point on  $dA_1$ . (d) The spherical coordinate system.

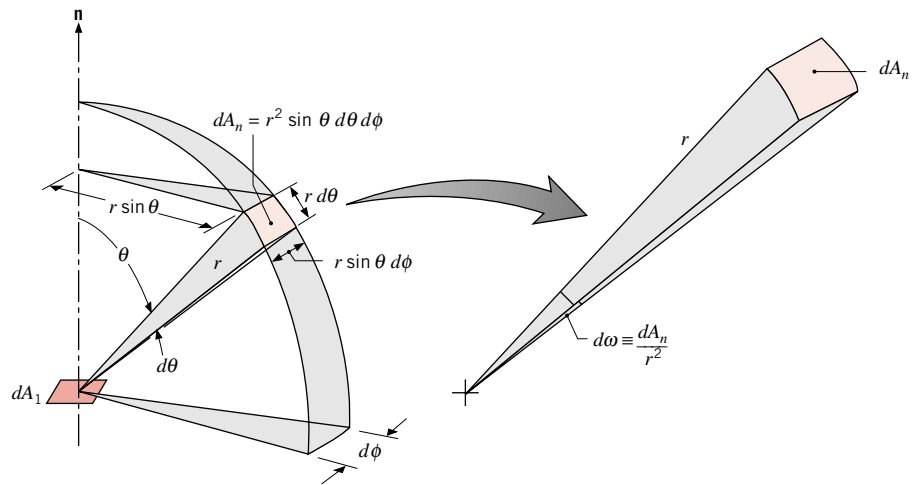

**FIGURE 12.6** The solid angle subtended by  $dA_n$  at a point on  $dA_1$  in the spherical coordinate system.

Consider emission in a particular direction from an element of surface area  $dA_1$ , as shown in Figure 12.5c. The direction may be specified in terms of the zenith and azimuthal angles,  $\theta$  and  $\phi$ , respectively, of a spherical coordinate system (Figure 12.5d). The area  $dA_n$ , through which the radiation passes, subtends a differential solid angle  $d\omega$  when viewed from a point on  $dA_1$ . As shown in Figure 12.6, the area  $dA_n$  is a rectangle of dimension  $r d\theta \times r \sin \theta d\phi$ ; thus,  $dA_n = r^2 \sin \theta d\theta d\phi$ . Accordingly,

$$d\omega = \sin \theta d\theta d\phi \quad (12.3)$$


When viewed from a point on an *opaque* surface area element  $dA_1$ , radiation may be emitted into any direction defined by a hypothetical hemisphere above the surface. The solid angle associated with the entire hemisphere may be obtained by integrating Equation 12.3 over the limits  $\phi = 0$  to  $\phi = 2\pi$  and  $\theta = 0$  to  $\theta = \pi/2$ . Hence,

$$\int_h d\omega = \int_0^{2\pi} \int_0^{\pi/2} \sin \theta d\theta d\phi = 2\pi \int_0^{\pi/2} \sin \theta d\theta = 2\pi \text{ sr} \quad (12.4)$$

where the subscript  $h$  refers to integration over the hemisphere. Note that the unit of the solid angle is the steradian (sr), analogous to radians for plane angles.

## 12.2.2 Radiation Intensity and Its Relation to Emission

Returning to Figure 12.5c, we now consider the rate at which emission from  $dA_1$  passes through  $dA_n$ . This quantity may be expressed in terms of the *spectral intensity*  $I_{\lambda,e}$  of the emitted radiation. We formally define  $I_{\lambda,e}$  as the *rate at which radiant energy is emitted at the wavelength  $\lambda$  in the  $(\theta, \phi)$  direction, per unit area of the emitting surface normal to this direction, per unit solid angle about this direction, and*

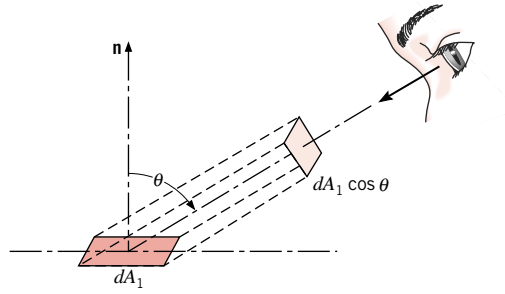

**FIGURE 12.7**

The projection of  $dA_1$  normal to the direction of radiation.

per unit wavelength interval  $d\lambda$  about  $\lambda$ . Note that the area used to define the intensity is the component of  $dA_1$  perpendicular to the direction of the radiation. From Figure 12.7, we see that this projected area is equal to  $dA_1 \cos \theta$ . In effect it is how  $dA_1$  would appear to an observer situated on  $dA_n$ . The spectral intensity, which has units of  $\text{W/m}^2 \cdot \text{sr} \cdot \mu\text{m}$ , is then

$$I_{\lambda,e}(\lambda, \theta, \phi) \equiv \frac{dq}{dA_1 \cos \theta \cdot d\omega \cdot d\lambda} \quad (12.5)$$

where  $(dq/d\lambda) \equiv dq_\lambda$  is the rate at which radiation of wavelength  $\lambda$  leaves  $dA_1$  and passes through  $dA_n$ . Rearranging Equation 12.5, it follows that

$$dq_\lambda = I_{\lambda,e}(\lambda, \theta, \phi) dA_1 \cos \theta d\omega \quad (12.6)$$


where  $dq_\lambda$  has the units of  $\text{W}/\mu\text{m}$ . This important expression allows us to compute the rate at which radiation emitted by a surface propagates into the region of space defined by the solid angle  $d\omega$  about the  $(\theta, \phi)$  direction. However, to compute this rate, the spectral intensity  $I_{\lambda,e}$  of the emitted radiation must be known. The manner in which this quantity may be determined is discussed later, in Sections 12.3 and 12.4. Expressing Equation 12.6 per unit area of the emitting surface and substituting from Equation 12.3, the spectral radiation flux associated with  $dA_1$  is

$$dq''_\lambda = I_{\lambda,e}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi \quad (12.7)$$

If the spectral and directional distributions of  $I_{\lambda,e}$  are known, that is,  $I_{\lambda,e}(\lambda, \theta, \phi)$  is known, the heat flux associated with emission into any finite solid angle or over any finite wavelength interval may be determined by integrating Equation 12.7. For example, we define the *spectral, hemispherical emissive power*  $E_\lambda$  ( $\text{W/m}^2 \cdot \mu\text{m}$ ) as the rate at which radiation of wavelength  $\lambda$  is emitted in *all directions* from a surface per unit wavelength interval  $d\lambda$  about  $\lambda$  and per unit surface area. Thus,  $E_\lambda$  is the spectral heat flux associated with emission into a hypothetical hemisphere above  $dA_1$ , as shown in Figure 12.8, or

$$E_\lambda(\lambda) = q''_\lambda(\lambda) = \int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,e}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi \quad (12.8)$$

Note that  $E_\lambda$  is a flux based on the *actual* surface area, whereas  $I_{\lambda,e}$  is based on the *projected* area. The  $\cos \theta$  term appearing in the integrand is a consequence of this difference.

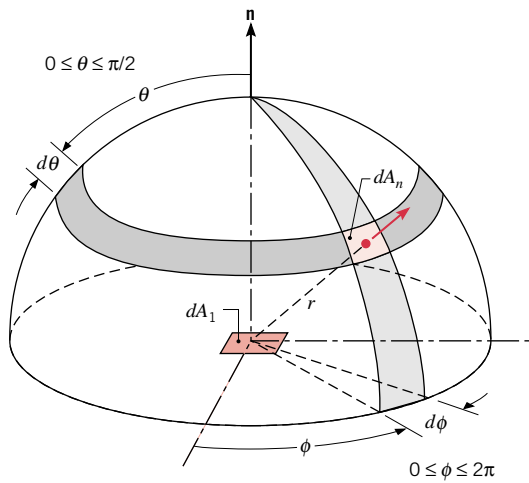

**FIGURE 12.8**  
Emission from a differential element of area  $dA_1$  into a hypothetical hemisphere centered at a point on  $dA_1$ .

The *total, hemispherical emissive power*,  $E$  ( $\text{W}/\text{m}^2$ ), is the rate at which radiation is emitted per unit area at all possible wavelengths and in all possible directions. Accordingly,

$$E = \int_0^{\infty} E_{\lambda}(\lambda) d\lambda \quad (12.9)$$

or from Equation 12.8

$$E = \int_0^{\infty} \int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,e}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi d\lambda \quad (12.10)$$

Since the term “emissive power” implies emission in all directions, the adjective “hemispherical” is redundant and is often dropped. One then speaks of the *spectral emissive power*  $E_{\lambda}$ , or the *total emissive power*  $E$ .

Although the directional distribution of surface emission varies according to the nature of the surface, there is a special case that provides a reasonable approximation for many surfaces. We speak of a *diffuse emitter* as a surface for which the intensity of the emitted radiation is independent of direction, in which case  $I_{\lambda,e}(\lambda, \theta, \phi) = I_{\lambda,e}(\lambda)$ . Removing  $I_{\lambda,e}$  from the integrand of Equation 12.8 and performing the integration, it follows that

$$E_{\lambda}(\lambda) = \pi I_{\lambda,e}(\lambda) \quad (12.11)$$


Similarly, from Equation 12.10

$$E = \pi I_e \quad (12.12)$$

where  $I_e$  is the *total intensity* of the emitted radiation. Note that the constant appearing in the above expressions is  $\pi$ , not  $2\pi$ , and has the unit steradians.

### EXAMPLE 12.1

A small surface of area  $A_1 = 10^{-3} \text{ m}^2$  is known to emit diffusely, and from measurements the total intensity associated with emission in the normal direction is  $I_n = 7000 \text{ W/m}^2 \cdot \text{sr}$ .



Radiation emitted from the surface is intercepted by three other surfaces of area  $A_2 = A_3 = A_4 = 10^{-3} \text{ m}^2$ , which are 0.5 m from  $A_1$  and are oriented as shown. What is the intensity associated with emission in each of the three directions? What are the solid angles subtended by the three surfaces when viewed from  $A_1$ ? What is the rate at which radiation emitted by  $A_1$  is intercepted by the three surfaces?


### SOLUTION

**Known:** Normal intensity of diffuse emitter of area  $A_1$  and orientation of three surfaces relative to  $A_1$ .

**Find:**

1. Intensity of emission in each of the three directions.
2. Solid angles subtended by the three surfaces.
3. Rate at which radiation is intercepted by the three surfaces.

**Schematic:**

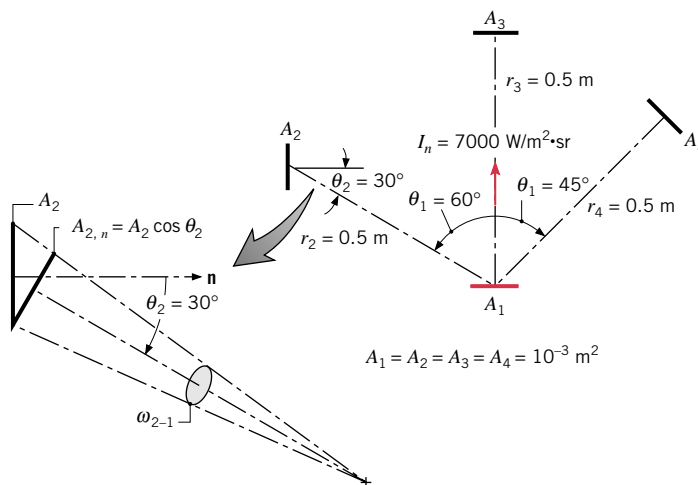

**Assumptions:**

1. Surface  $A_1$  emits diffusely.
2.  $A_1, A_2, A_3$ , and  $A_4$  may be approximated as differential surfaces,  $(A_j/r_j^2) \ll 1$ .

**Analysis:**

1. From the definition of a diffuse emitter, we know that the intensity of the emitted radiation is independent of direction. Hence

$$I = 7000 \text{ W/m}^2 \cdot \text{sr} \quad \triangleleft$$

for each of the three directions.

2. Treating  $A_2, A_3$ , and  $A_4$  as differential surface areas, the solid angles may be computed from Equation 12.2

$$d\omega \equiv \frac{dA_n}{r^2}$$

where  $dA_n$  is the projection of the surface normal to the direction of the radiation. Since surfaces  $A_3$  and  $A_4$  are normal to the direction of radiation, the solid angles subtended by these surfaces can be directly found from this equation as

$$\omega_{3-1} = \omega_{4-1} = \frac{A_3}{r^2} = \frac{10^{-3} \text{ m}^2}{(0.5 \text{ m})^2} = 4.00 \times 10^{-3} \text{ sr} \quad \triangleleft$$

Since surface  $A_2$  is not normal to the direction of radiation, we use  $dA_{n,2} = dA_2 \cos \theta_2$ , where  $\theta_2$  is the angle between the surface normal and the direction of the radiation. Thus

$$\omega_{2-1} = \frac{A_2 \cos \theta_2}{r^2} = \frac{10^{-3} \text{ m}^2 \times \cos 30^\circ}{(0.5 \text{ m})^2} = 3.46 \times 10^{-3} \text{ sr} \quad \triangleleft$$

3. Approximating  $A_1$  as a differential surface, the rate at which radiation is intercepted by each of the three surfaces may be found from Equation 12.6, which, for the total radiation, may be expressed as

$$q_{1-j} = I \times A_1 \cos \theta_1 \times \omega_{j-1}$$

where  $\theta_1$  is the angle between the normal to surface 1 and the direction of the radiation. Hence

$$\begin{aligned} q_{1-2} &= 7000 \text{ W/m}^2 \cdot \text{sr} (10^{-3} \text{ m}^2 \times \cos 60^\circ) 3.46 \times 10^{-3} \text{ sr} \\ &= 12.1 \times 10^{-3} \text{ W} \end{aligned} \quad \triangleleft$$

$$\begin{aligned} q_{1-3} &= 7000 \text{ W/m}^2 \cdot \text{sr} (10^{-3} \text{ m}^2 \times \cos 0^\circ) 4.00 \times 10^{-3} \text{ sr} \\ &= 28.0 \times 10^{-3} \text{ W} \end{aligned} \quad \triangleleft$$

$$\begin{aligned} q_{1-4} &= 7000 \text{ W/m}^2 \cdot \text{sr} (10^{-3} \text{ m}^2 \times \cos 45^\circ) 4.00 \times 10^{-3} \text{ sr} \\ &= 19.8 \times 10^{-3} \text{ W} \end{aligned} \quad \triangleleft$$

**Comments:**

1. Note the different values of  $\theta_1$  for the emitting surface and the values of  $\theta_2, \theta_3$ , and  $\theta_4$  for the receiving surfaces.
2. If the surfaces were not small relative to the square of the separation distance, the solid angles and radiation heat transfer rates would have to be obtained

by integrating Equations 12.3 and 12.6, respectively, over the appropriate surface areas.

3. Any spectral component of the radiation rate can also be obtained using these procedures, if the spectral intensity  $I_\lambda$  is known.
4. Even though the intensity of the emitted radiation is independent of direction, the rate at which radiation is intercepted by the three surfaces differs significantly due to differences in the solid angles and projected areas.

### 12.2.3 Relation to Irradiation


Although we have focused on radiation emitted by a surface, the foregoing concepts may be extended to *incident* radiation (Figure 12.9). Such radiation may originate from emission and reflection occurring at other surfaces and will have spectral and directional distributions determined by the spectral intensity  $I_{\lambda,i}(\lambda, \theta, \phi)$ . This quantity is defined as the rate at which radiant energy of wavelength  $\lambda$  is incident from the  $(\theta, \phi)$  direction, per unit area of the *intercepting surface* normal to this direction, per unit solid angle about this direction, and per unit wavelength interval  $d\lambda$  about  $\lambda$ .

The intensity of the incident radiation may be related to an important radiative flux, termed the *irradiation*, which encompasses radiation incident *from all directions*. The *spectral irradiation*  $G_\lambda$  ( $\text{W}/\text{m}^2 \cdot \mu\text{m}$ ) is defined as the rate at which radiation of wavelength  $\lambda$  is incident on a surface, per unit area of the surface and per unit wavelength interval  $d\lambda$  about  $\lambda$ . Accordingly,

$$G_\lambda(\lambda) = \int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,i}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi \quad (12.13)$$

where  $\sin \theta d\theta d\phi$  is the unit solid angle. The  $\cos \theta$  factor originates because  $G_\lambda$  is a flux based on the actual surface area, whereas  $I_{\lambda,i}$  is defined in terms of the projected area. If the *total irradiation*  $G$  ( $\text{W}/\text{m}^2$ ) represents the rate at which radiation is incident per unit area from all directions and at all wavelengths, it follows that

$$G = \int_0^\infty G_\lambda(\lambda) d\lambda \quad (12.14)$$

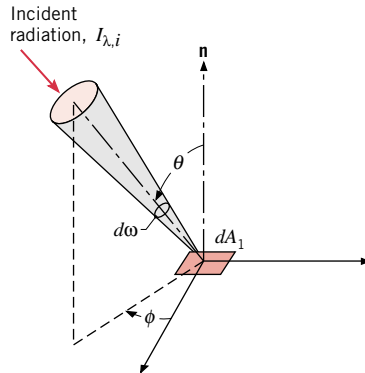

**FIGURE 12.9**

Directional nature of incident radiation.



or from Equation 12.13

$$G = \int_0^\infty \int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,i}(\lambda, \theta, \phi) \cos \theta \sin \theta \, d\theta \, d\phi \, d\lambda \quad (12.15)$$

If the incident radiation is *diffuse*,  $I_{\lambda,i}$  is independent of  $\theta$  and  $\phi$  and it follows that


$$G_\lambda(\lambda) = \pi I_{\lambda,i}(\lambda) \quad (12.16)$$

and

$$G = \pi I_i \quad (12.17)$$

### EXAMPLE 12.2

The spectral distribution of surface irradiation is as follows:

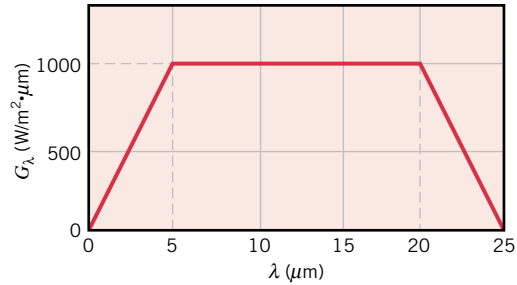

What is the total irradiation?

### SOLUTION

**Known:** Spectral distribution of surface irradiation.

**Find:** Total irradiation.

**Analysis:** The total irradiation may be obtained from Equation 12.14

$$G = \int_0^\infty G_\lambda \, d\lambda$$

The integral is readily evaluated by breaking it into parts. That is,

$$G = \int_0^{5\mu\text{m}} G_\lambda \, d\lambda + \int_{5\mu\text{m}}^{20\mu\text{m}} G_\lambda \, d\lambda + \int_{20\mu\text{m}}^{25\mu\text{m}} G_\lambda \, d\lambda + \int_{25\mu\text{m}}^\infty G_\lambda \, d\lambda$$

Hence

$$G = \frac{1}{2}(1000 \, \text{W/m}^2 \cdot \mu\text{m})(5 - 0) \, \mu\text{m} + (1000 \, \text{W/m}^2 \cdot \mu\text{m})(20 - 5) \, \mu\text{m} + \frac{1}{2}(1000 \, \text{W/m}^2 \cdot \mu\text{m})(25 - 20) \, \mu\text{m} + 0$$

$$= (2500 + 15,000 + 2500) \, \text{W/m}^2$$

$$G = 20,000 \, \text{W/m}^2$$



**Comments:** Generally, radiation sources do not provide such a regular spectral distribution for the irradiation. However, the procedure of computing the total irradiation from knowledge of the spectral distribution remains the same, although evaluation of the integral is likely to involve more detail.

### 12.2.4 Relation to Radiosity

The last radiative flux of interest, termed *radiosity*, accounts for *all* the radiant energy leaving a surface. Since this radiation includes the *reflected* portion of the irradiation, as well as direct emission (Figure 12.10), the radiosity is generally different from the emissive power. The *spectral radiosity*  $J_\lambda$  ( $\text{W}/\text{m}^2 \cdot \mu\text{m}$ ) represents the rate at which radiation of wavelength  $\lambda$  leaves a unit area of the surface, per unit wavelength interval  $d\lambda$  about  $\lambda$ . Since it accounts for radiation leaving in all directions, it is related to the intensity associated with emission and reflection,  $I_{\lambda,e+r}(\lambda, \theta, \phi)$ , by the expression

$$J_\lambda(\lambda) = \int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,e+r}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi \quad (12.18)$$

Hence the *total radiosity*  $J$  ( $\text{W}/\text{m}^2$ ) associated with the entire spectrum is

$$J = \int_0^\infty J_\lambda(\lambda) d\lambda \quad (12.19)$$

or

$$J = \int_0^\infty \int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,e+r}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi d\lambda \quad (12.20)$$


If the surface is both a *diffuse reflector* and a *diffuse emitter*,  $I_{\lambda,e+r}$  is independent of  $\theta$  and  $\phi$ , and it follows that

$$J_\lambda(\lambda) = \pi I_{\lambda,e+r} \quad (12.21)$$

and

$$J = \pi I_{e+r} \quad (12.22)$$

Again, note that the radiation flux, in this case the radiosity, is based on the actual surface area, while the intensity is based on the projected area.

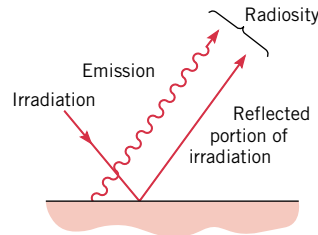

**FIGURE 12.10**  
Surface radiosity.

## 12.3


### Blackbody Radiation

To evaluate the emissive power, irradiation, or radiosity of a real surface, we must quantify the spectral intensities used in Equations 12.8, 12.13, and 12.18. To do so, it is useful and necessary to first introduce the concept of a *blackbody*.

1. A blackbody absorbs all incident radiation, regardless of wavelength and direction.
2. For a prescribed temperature and wavelength, no surface can emit more energy than a blackbody.
3. Although the radiation emitted by a blackbody is a function of wavelength and temperature, it is independent of direction. That is, the blackbody is a diffuse emitter.

As the perfect absorber and emitter, the blackbody serves as a *standard* against which the radiative properties of actual surfaces may be compared.

Although closely approximated by some surfaces, it is important to note that no surface has precisely the properties of a blackbody. The closest approximation is achieved by a *cavity* whose inner surface is at a uniform temperature. If radiation enters the cavity through a small aperture (Figure 12.11a), it is likely to experience many reflections before reemergence. Hence it is almost entirely absorbed by the cavity, and blackbody behavior is approximated. From thermodynamic principles it may then be argued that radiation leaving the aperture depends only on the surface temperature and corresponds to blackbody emission (Figure 12.11b). Since blackbody emission is diffuse, the spectral intensity  $I_{\lambda,b}$  of radiation leaving the cavity is independent of direction. Moreover, since the radiation field in the cavity, which is the cumulative effect of emission and reflection from the cavity surface, must be of the same form as the radiation emerging from the aperture, it also follows that a blackbody radiation field exists within the cavity. Accordingly, any small surface in

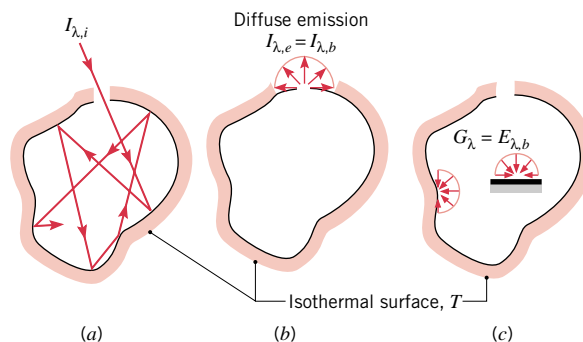

**FIGURE 12.11** Characteristics of an isothermal blackbody cavity. (a) Complete absorption. (b) Diffuse emission from an aperture. (c) Diffuse irradiation of interior surfaces.

the cavity (Figure 12.11c) experiences irradiation for which  $G_\lambda = E_{\lambda,b}(\lambda, T)$ . This surface is diffusely irradiated, regardless of its orientation. *Blackbody radiation exists within the cavity irrespective of whether the cavity surface is highly reflecting or absorbing.*

### 12.3.1 The Planck Distribution

The blackbody spectral intensity is well known, having first been determined by Planck [1]. It is

$$I_{\lambda,b}(\lambda, T) = \frac{2hc_o^2}{\lambda^5 [\exp(hc_o/\lambda kT) - 1]} \quad (12.23)$$

where  $h = 6.626 \times 10^{-34} \text{ J} \cdot \text{s}$  and  $k = 1.381 \times 10^{-23} \text{ J/K}$  are the universal Planck and Boltzmann constants, respectively,  $c_o = 2.998 \times 10^8 \text{ m/s}$  is the speed of light in vacuum, and  $T$  is the *absolute* temperature of the blackbody (K). Since the blackbody is a diffuse emitter, it follows from Equation 12.11 that its spectral emissive power is

$$E_{\lambda,b}(\lambda, T) = \pi I_{\lambda,b}(\lambda, T) = \frac{C_1}{\lambda^5 [\exp(C_2/\lambda T) - 1]} \quad (12.24)$$

where the first and second radiation constants are  $C_1 = 2\pi hc_o^2 = 3.742 \times 10^8 \text{ W} \cdot \mu\text{m}^4/\text{m}^2$  and  $C_2 = (hc_o/k) = 1.439 \times 10^4 \mu\text{m} \cdot \text{K}$ .

Equation 12.24, known as the *Planck distribution*, is plotted in Figure 12.12 for selected temperatures. Several important features should be noted.

1. The emitted radiation varies *continuously* with wavelength.
2. At any wavelength the magnitude of the emitted radiation increases with increasing temperature.
3. The spectral region in which the radiation is concentrated depends on temperature, with *comparatively* more radiation appearing at shorter wavelengths as the temperature increases.
4. A significant fraction of the radiation emitted by the sun, which may be approximated as a blackbody at 5800 K, is in the visible region of the spectrum. In contrast, for  $T \lesssim 800 \text{ K}$ , emission is predominantly in the infrared region of the spectrum and is not visible to the eye.

### 12.3.2 Wien's Displacement Law

From Figure 12.12 we see that the blackbody spectral distribution has a maximum and that the corresponding wavelength  $\lambda_{\max}$  depends on temperature. The nature of this dependence may be obtained by differentiating Equation 12.24 with respect to  $\lambda$  and setting the result equal to zero. In so doing, we obtain

$$\lambda_{\max} T = C_3 \quad (12.25)$$

where the third radiation constant is  $C_3 = 2898 \mu\text{m} \cdot \text{K}$ .

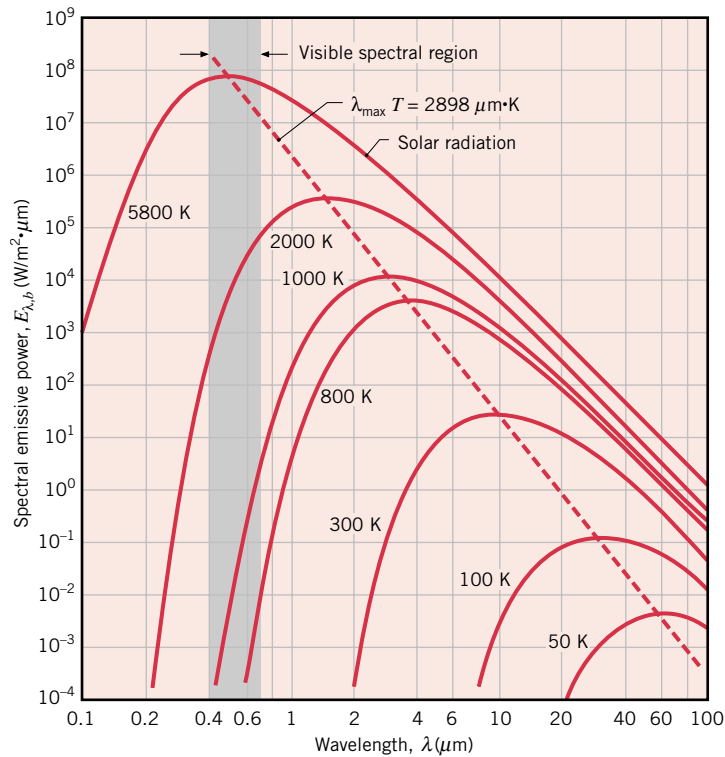


FIGURE 12.12 Spectral blackbody emissive power.

Equation 12.25 is known as *Wien's displacement law*, and the locus of points described by the law is plotted as the dashed line of Figure 12.12. According to this result, the maximum spectral emissive power is displaced to shorter wavelengths with increasing temperature. This emission is in the middle of the visible spectrum ( $\lambda \approx 0.50 \mu\text{m}$ ) for solar radiation, since the sun emits approximately as a blackbody at 5800 K. For a blackbody at 1000 K, peak emission occurs at  $2.90 \mu\text{m}$ , with some of the emitted radiation appearing visible as red light. With increasing temperature, shorter wavelengths become more prominent, until eventually significant emission occurs over the entire visible spectrum. For example, a tungsten filament lamp operating at 2900 K ( $\lambda_{\text{max}} = 1 \mu\text{m}$ ) emits white light, although most of the emission remains in the IR region.

### 12.3.3 The Stefan–Boltzmann Law

Substituting the Planck distribution, Equation 12.24, into Equation 12.9, the total emissive power of a blackbody  $E_b$  may be expressed as

$$E_b = \int_0^\infty \frac{C_1}{\lambda^5 [\exp(C_2/\lambda T) - 1]} d\lambda$$

Performing the integration, it may be shown that

$$E_b = \sigma T^4 \quad (12.26)$$


where the *Stefan–Boltzmann* constant, which depends on  $C_1$  and  $C_2$ , has the numerical value

$$\sigma = 5.670 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4$$

This simple, yet important, result is termed the *Stefan–Boltzmann law*. It enables calculation of the amount of radiation emitted in all directions and over all wavelengths simply from knowledge of the temperature of the blackbody. Because this emission is diffuse, it follows from Equation 12.12 that the total intensity associated with blackbody emission is

$$I_b = \frac{E_b}{\pi} \quad (12.27)$$

### 12.3.4 Band Emission



**FIGURE 12.13** Radiation emission from a blackbody in the spectral band 0 to  $\lambda$ .


It is often necessary to know the fraction of the total emission from a blackbody that is in a certain wavelength interval or *band*. For a prescribed temperature and the interval from 0 to  $\lambda$ , this fraction is determined by the ratio of the shaded section to the total area under the curve of Figure 12.13. Hence

$$F_{(0 \rightarrow \lambda)} \equiv \frac{\int_0^\lambda E_{\lambda,b} d\lambda}{\int_0^\infty E_{\lambda,b} d\lambda} = \frac{\int_0^\lambda E_{\lambda,b} d\lambda}{\sigma T^4} = \int_0^{\lambda T} \frac{E_{\lambda,b}}{\sigma T^5} d(\lambda T) = f(\lambda T) \quad (12.28)$$

Since the integrand  $(E_{\lambda,b}/\sigma T^5)$  is exclusively a function of the wavelength–temperature product  $\lambda T$ , the integral of Equation 12.28 may be evaluated to obtain  $F_{(0 \rightarrow \lambda)}$  as a function of only  $\lambda T$ . The results are presented in Table 12.1 and Figure 12.14. They may also be used to obtain the fraction of the radiation between any two wavelengths  $\lambda_1$  and  $\lambda_2$ , since

$$F_{(\lambda_1 \rightarrow \lambda_2)} = \frac{\int_{\lambda_1}^{\lambda_2} E_{\lambda,b} d\lambda}{\sigma T^4} = F_{(0 \rightarrow \lambda_2)} - F_{(0 \rightarrow \lambda_1)} \quad (12.29)$$

Additional blackbody functions are listed in the third and fourth columns of Table 12.1. The third column facilitates calculation of the spectral intensity for a prescribed wavelength and temperature. In lieu of computing this quantity from Equation 12.23, it may be obtained by simply multiplying the tabulated value of  $I_{\lambda,b}/\sigma T^5$  by  $\sigma T^5$ . The fourth column is used to obtain a quick estimate of the ratio of the spectral intensity at any wavelength to that at  $\lambda_{\max}$ .

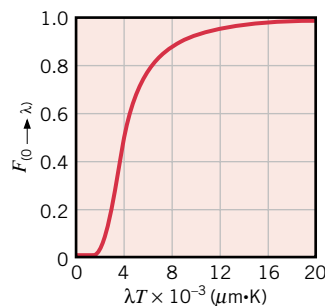

**FIGURE 12.14**

Fraction of the total blackbody emission in the spectral band from 0 to  $\lambda$  as a function of  $\lambda T$ .

**TABLE 12.1** Blackbody Radiation Functions

$\lambda T$ ( $\mu\text{m} \cdot \text{K}$ )	$F_{(0 \rightarrow \lambda)}$	$I_{\lambda,b}(\lambda, T)/\sigma T^5$ ( $\mu\text{m} \cdot \text{K} \cdot \text{sr}$ ) <sup>-1</sup>	$\frac{I_{\lambda,b}(\lambda, T)}{I_{\lambda,b}(\lambda_{\text{max}}, T)}$
200	0.000000	$0.375034 \times 10^{-27}$	0.000000
400	0.000000	$0.490335 \times 10^{-13}$	0.000000
600	0.000000	$0.104046 \times 10^{-8}$	0.000014
800	0.000016	$0.991126 \times 10^{-7}$	0.001372
1,000	0.000321	$0.118505 \times 10^{-5}$	0.016406
1,200	0.002134	$0.523927 \times 10^{-5}$	0.072534
1,400	0.007790	$0.134411 \times 10^{-4}$	0.186082
1,600	0.019718	0.249130	0.344904
1,800	0.039341	0.375568	0.519949
2,000	0.066728	0.493432	0.683123
2,200	0.100888	$0.589649 \times 10^{-4}$	0.816329
2,400	0.140256	0.658866	0.912155
2,600	0.183120	0.701292	0.970891
2,800	0.227897	0.720239	0.997123
2,898	0.250108	$0.722318 \times 10^{-4}$	1.000000
3,000	0.273232	$0.720254 \times 10^{-4}$	0.997143
3,200	0.318102	0.705974	0.977373
3,400	0.361735	0.681544	0.943551
3,600	0.403607	0.650396	0.900429
3,800	0.443382	$0.615225 \times 10^{-4}$	0.851737
4,000	0.480877	0.578064	0.800291
4,200	0.516014	0.540394	0.748139
4,400	0.548796	0.503253	0.696720
4,600	0.579280	0.467343	0.647004
4,800	0.607559	0.433109	0.599610
5,000	0.633747	0.400813	0.554898
5,200	0.658970	$0.370580 \times 10^{-4}$	0.513043
5,400	0.680360	0.342445	0.474092
5,600	0.701046	0.316376	0.438002
5,800	0.720158	0.292301	0.404671
6,000	0.737818	0.270121	0.373965
6,200	0.754140	$0.249723 \times 10^{-4}$	0.345724
6,400	0.769234	0.230985	0.319783
6,600	0.783199	0.213786	0.295973
6,800	0.796129	0.198008	0.274128
7,000	0.808109	0.183534	0.254090
7,200	0.819217	$0.170256 \times 10^{-4}$	0.235708
7,400	0.829527	0.158073	0.218842
7,600	0.839102	0.146891	0.203360
7,800	0.848005	0.136621	0.189143
8,000	0.856288	0.127185	0.176079
8,500	0.874608	$0.106772 \times 10^{-4}$	0.147819
9,000	0.890029	$0.901463 \times 10^{-5}$	0.124801

**TABLE 12.1** Continued

$\lambda T$ ( $\mu\text{m} \cdot \text{K}$ )	$F_{(0 \rightarrow \lambda)}$	$I_{\lambda,b}(\lambda, T)/\sigma T^5$ ( $\mu\text{m} \cdot \text{K} \cdot \text{sr}$ ) <sup>-1</sup>	$\frac{I_{\lambda,b}(\lambda, T)}{I_{\lambda,b}(\lambda_{\text{max}}, T)}$
9,500	0.903085	0.765338	0.105956
10,000	0.914199	$0.653279 \times 10^{-5}$	0.090442
10,500	0.923710	0.560522	0.077600
11,000	0.931890	0.483321	0.066913
11,500	0.939959	0.418725	0.057970
12,000	0.945098	$0.364394 \times 10^{-5}$	0.050448
13,000	0.955139	0.279457	0.038689
14,000	0.962898	0.217641	0.030131
15,000	0.969981	$0.171866 \times 10^{-5}$	0.023794
16,000	0.973814	0.137429	0.019026
18,000	0.980860	$0.908240 \times 10^{-6}$	0.012574
20,000	0.985602	0.623310	0.008629
25,000	0.992215	0.276474	0.003828
30,000	0.995340	$0.140469 \times 10^{-6}$	0.001945
40,000	0.997967	$0.473891 \times 10^{-7}$	0.000656
50,000	0.998953	0.201605	0.000279
75,000	0.999713	$0.418597 \times 10^{-8}$	0.000058
100,000	0.999905	0.135752	0.000019

### EXAMPLE 12.3

Consider a large isothermal enclosure that is maintained at a uniform temperature of 2000 K. Calculate the emissive power of the radiation that emerges from a small aperture on the enclosure surface. What is the wavelength  $\lambda_1$  below which 10% of the emission is concentrated? What is the wavelength  $\lambda_2$  above which 10% of the emission is concentrated? Determine the maximum spectral emissive power and the wavelength at which this emission occurs. What is the irradiation incident on a small object placed inside the enclosure?

### SOLUTION


**Known:** Large isothermal enclosure at uniform temperature.

**Find:**

1. Emissive power of a small aperture on the enclosure.
2. Wavelengths below which and above which 10% of the radiation is concentrated.
3. Spectral emissive power and wavelength associated with maximum emission.
4. Irradiation on a small object inside the enclosure.



**Schematic:**

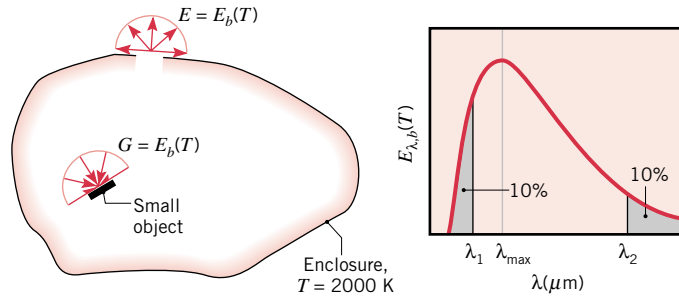

**Assumptions:** Areas of aperture and object are very small relative to enclosure surface.

**Analysis:**

1. Emission from the aperture of any isothermal enclosure will have the characteristics of blackbody radiation. Hence, from Equation 12.26,

$$E = E_b(T) = \sigma T^4 = 5.670 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (2000 \text{ K})^4$$

$$E = 9.07 \times 10^5 \text{ W/m}^2$$

2. The wavelength  $\lambda_1$  corresponds to the upper limit of the spectral band ( $0 \rightarrow \lambda_1$ ) containing 10% of the emitted radiation. With  $F_{(0 \rightarrow \lambda_1)} = 0.10$  it follows from Table 12.1 that  $\lambda_1 T = 2195 \mu\text{m} \cdot \text{K}$ . Hence

$$\lambda_1 = 1.1 \mu\text{m}$$

The wavelength  $\lambda_2$  corresponds to the lower limit of the spectral band ( $\lambda_2 \rightarrow \infty$ ) containing 10% of the emitted radiation. With

$$F_{(\lambda_2 \rightarrow \infty)} = 1 - F_{(0 \rightarrow \lambda_2)} = 0.1$$

$$F_{(0 \rightarrow \lambda_2)} = 0.9$$

it follows from Table 12.1 that  $\lambda_2 T = 9382 \mu\text{m} \cdot \text{K}$ . Hence

$$\lambda_2 = 4.69 \mu\text{m}$$

3. From Wien's law, Equation 12.25,  $\lambda_{\text{max}} T = 2898 \mu\text{m} \cdot \text{K}$ . Hence

$$\lambda_{\text{max}} = 1.45 \mu\text{m}$$

The spectral emissive power associated with this wavelength may be computed from Equation 12.24 or from the third column of Table 12.1. For  $\lambda_{\text{max}} T = 2898 \mu\text{m} \cdot \text{K}$  it follows from Table 12.1 that

$$I_{\lambda,b}(1.45 \mu\text{m}, T) = 0.722 \times 10^{-4} \sigma T^5$$

Hence

$$I_{\lambda,b}(1.45 \mu\text{m}, 2000 \text{ K}) = 0.722 \times 10^{-4} (1/\mu\text{m} \cdot \text{K} \cdot \text{sr}) 5.67$$

$$\times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (2000 \text{ K})^5$$

$$I_{\lambda,b}(1.45 \mu\text{m}, 2000 \text{ K}) = 1.31 \times 10^5 \text{ W/m}^2 \cdot \text{sr} \cdot \mu\text{m}$$

Since the emission is diffuse, it follows from Equation 12.11 that

$$E_{\lambda,b} = \pi I_{\lambda,b} = 4.12 \times 10^5 \text{ W/m}^2 \cdot \mu\text{m}$$

4. Irradiation of any small object inside the enclosure may be approximated as being equal to emission from a blackbody at the enclosure surface temperature. Hence  $G = E_b(T)$ , in which case

$$G = 9.07 \times 10^5 \text{ W/m}^2$$

### EXAMPLE 12.4


A surface emits as a blackbody at 1500 K. What is the rate per unit area ( $\text{W/m}^2$ ) at which it emits radiation over all directions corresponding to  $0^\circ \leq \theta \leq 60^\circ$  and over the wavelength interval  $2 \mu\text{m} \leq \lambda \leq 4 \mu\text{m}$ ?

### SOLUTION

**Known:** Temperature of a surface that emits as a blackbody.

**Find:** Rate of emission per unit area over all directions between  $\theta = 0^\circ$  and  $60^\circ$  and over all wavelengths between  $\lambda = 2$  and  $4 \mu\text{m}$ .

**Schematic:**



**Assumptions:** Surface emits as a blackbody.

**Analysis:** The desired emission may be inferred from Equation 12.10, with the limits of integration restricted as follows:

$$\Delta E = \int_2^4 \int_0^{2\pi} \int_0^{\pi/3} I_{\lambda,b} \cos \theta \sin \theta \, d\theta \, d\phi \, d\lambda$$

or, since a blackbody emits diffusely,

$$\Delta E = \int_2^4 I_{\lambda,b} \left( \int_0^{2\pi} \int_0^{\pi/3} \cos \theta \sin \theta \, d\theta \, d\phi \right) d\lambda$$

$$\Delta E = \int_2^4 I_{\lambda,b} \left( 2\pi \frac{\sin^2 \theta}{2} \bigg|_0^{\pi/3} \right) d\lambda = 0.75 \int_2^4 \pi I_{\lambda,b} \, d\lambda$$

Substituting from Equation 12.11 and multiplying and dividing by  $E_b$ , this result may be put in a form that allows for use of Table 12.1 in evaluating the spectral integration. In particular,

$$\Delta E = 0.75E_b \int_2^4 \frac{E_{\lambda,b}}{E_b} d\lambda = 0.75E_b [F_{(0 \rightarrow 4)} - F_{(0 \rightarrow 2)}]$$

where from Table 12.1

$$\lambda_1 T = 2 \mu\text{m} \times 1500 \text{ K} = 3000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow 2)} = 0.273$$

$$\lambda_2 T = 4 \mu\text{m} \times 1500 \text{ K} = 6000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow 4)} = 0.738$$

Hence

$$\Delta E = 0.75(0.738 - 0.273)E_b = 0.75(0.465)E_b$$

From Equation 12.26, it then follows that

$$\Delta E = 0.75(0.465)5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (1500 \text{ K})^4 = 10^5 \text{ W/m}^2 \quad \triangleleft$$

**Comments:** The total, hemispherical emissive power is reduced by 25% and 53.5% due to the directional and spectral restrictions, respectively.

## 12.4


### Emission from Real Surfaces

Having developed the notion of a blackbody to describe *ideal* surface behavior, we may now consider the behavior of *real* surfaces. Recall that the blackbody is an ideal emitter in the sense that no surface can emit more radiation than a blackbody at the same temperature. It is therefore convenient to choose the blackbody as a reference in describing emission from a real surface. A surface radiative property known as the *emissivity*<sup>1</sup> may then be defined as the *ratio* of the radiation emitted by the surface to the radiation emitted by a blackbody at the same temperature.

It is important to acknowledge that, in general, the spectral radiation emitted by a real surface differs from the Planck distribution (Figure 12.15*a*). Moreover, the directional distribution (Figure 12.15*b*) may be other than diffuse. Hence the emissivity may assume different values according to whether one is interested in emission at a given wavelength or in a given direction, or in integrated averages over wavelength and direction.

We define the *spectral, directional emissivity*  $\varepsilon_{\lambda,\theta}(\lambda, \theta, \phi, T)$  of a surface at the temperature  $T$  as the ratio of the intensity of the radiation emitted at the wavelength  $\lambda$

<sup>1</sup>In this text we use the *-ivity*, rather than the *-ance*, ending for material radiative properties (e.g., “emissivity” rather than “emittance”). Although efforts are being made to reserve the *-ivity* ending for optically smooth, uncontaminated surfaces, no such distinction is made in much of the literature, and none is made in this text.

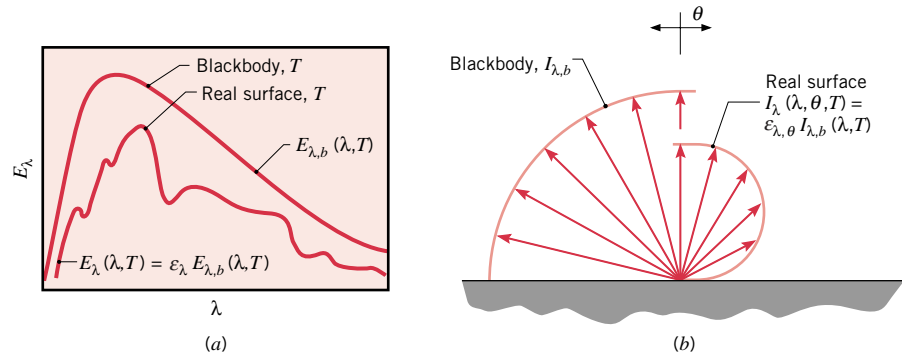

**FIGURE 12.15** Comparison of blackbody and real surface emission. (a) Spectral distribution. (b) Directional distribution.

and in the direction of  $\theta$  and  $\phi$  to the intensity of the radiation emitted by a blackbody at the same values of  $T$  and  $\lambda$ . Hence

$$\varepsilon_{\lambda,\theta}(\lambda, \theta, \phi, T) \equiv \frac{I_{\lambda,e}(\lambda, \theta, \phi, T)}{I_{\lambda,b}(\lambda, T)} \quad (12.30)$$

Note how the subscripts  $\lambda$  and  $\theta$  designate interest in a specific wavelength and direction for the emissivity. In contrast, terms appearing within parentheses designate functional dependence on wavelength, direction, and/or temperature. The absence of directional variables in the parentheses of the denominator in Equation 12.30 implies that the intensity is independent of direction, which is, of course, a characteristic of blackbody emission. In like manner a *total, directional emissivity*  $\varepsilon_\theta$ , which represents a spectral average of  $\varepsilon_{\lambda,\theta}$ , may be defined as

$$\varepsilon_\theta(\theta, \phi, T) \equiv \frac{I_e(\theta, \phi, T)}{I_b(T)} \quad (12.31)$$

For most engineering calculations, it is desirable to work with surface properties that represent directional averages. A *spectral, hemispherical emissivity* is therefore defined as

$$\varepsilon_\lambda(\lambda, T) \equiv \frac{E_\lambda(\lambda, T)}{E_{\lambda,b}(\lambda, T)} \quad (12.32)$$

It may be related to the directional emissivity  $\varepsilon_{\lambda,\theta}$  by substituting the expression for the spectral emissive power, Equation 12.8, to obtain

$$\varepsilon_\lambda(\lambda, T) = \frac{\int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,e}(\lambda, \theta, \phi, T) \cos \theta \sin \theta \, d\theta \, d\phi}{\int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,b}(\lambda, T) \cos \theta \sin \theta \, d\theta \, d\phi}$$

In contrast to Equation 12.8, the temperature dependence of emission is now acknowledged. From Equation 12.30 and the fact that  $I_{\lambda,b}$  is independent of  $\theta$  and  $\phi$ ,

it follows that

$$\varepsilon_\lambda(\lambda, T) = \frac{\int_0^{2\pi} \int_0^{\pi/2} \varepsilon_{\lambda,\theta}(\lambda, \theta, \phi, T) \cos \theta \sin \theta \, d\theta \, d\phi}{\int_0^{2\pi} \int_0^{\pi/2} \cos \theta \sin \theta \, d\theta \, d\phi} \quad (12.33)$$

Assuming  $\varepsilon_{\lambda,\theta}$  to be independent of  $\phi$ , which is a reasonable assumption for most surfaces, and evaluating the denominator, we obtain

$$\varepsilon_\lambda(\lambda, T) = 2 \int_0^{\pi/2} \varepsilon_{\lambda,\theta}(\lambda, \theta, T) \cos \theta \sin \theta \, d\theta \quad (12.34)$$

The *total, hemispherical emissivity*, which represents an average over all possible directions and wavelengths, is defined as


$$\varepsilon(T) \equiv \frac{E(T)}{E_b(T)} \quad (12.35)$$

Substituting from Equations 12.9 and 12.32, it follows that

$$\varepsilon(T) = \frac{\int_0^\infty \varepsilon_\lambda(\lambda, T) E_{\lambda,b}(\lambda, T) \, d\lambda}{E_b(T)} \quad (12.36)$$


If the emissivities of a surface are known, it is a simple matter to compute its emission characteristics. For example, if  $\varepsilon_\lambda(\lambda, T)$  is known, it may be used with Equations 12.24 and 12.32 to compute the spectral emissive power of the surface at any wavelength and temperature. Similarly, if  $\varepsilon(T)$  is known, it may be used with Equations 12.26 and 12.35 to compute the total emissive power of the surface at any temperature. Measurements have been performed to determine these properties for many different materials and surface coatings.

The directional emissivity of a *diffuse emitter* is a constant, independent of direction. However, although this condition is often a reasonable *approximation*, all surfaces exhibit some departure from diffuse behavior. Representative variations of  $\varepsilon_\theta$  with  $\theta$  are shown schematically in Figure 12.16 for conducting and nonconducting materials. For conductors  $\varepsilon_\theta$  is approximately constant over the range  $\theta \lesssim 40^\circ$ , after which it increases with increasing  $\theta$  but ultimately decays to zero. In contrast, for nonconductors  $\varepsilon_\theta$  is approximately constant for  $\theta \lesssim 70^\circ$ , beyond which it decreases sharply with increasing  $\theta$ . One implication of these variations is that, although there are preferential directions for emission, the hemispherical emissivity  $\varepsilon$  will not differ

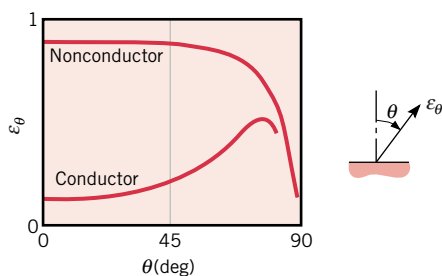

**FIGURE 12.16**

Representative directional distributions of the total, directional emissivity.

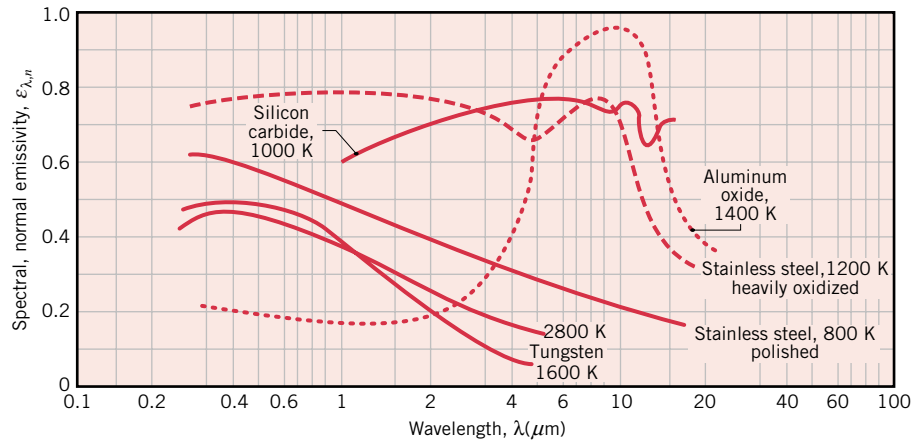


**FIGURE 12.17** Spectral dependence of the spectral, normal emissivity  $\varepsilon_{\lambda,n}$  of selected materials.

markedly from the normal emissivity  $\varepsilon_n$ , corresponding to  $\theta = 0$ . In fact the ratio rarely falls outside the range  $1.0 \leq (\varepsilon/\varepsilon_n) \leq 1.3$  for conductors and the range of  $0.95 \leq (\varepsilon/\varepsilon_n) \leq 1.0$  for nonconductors. Hence to a reasonable approximation,


$$\varepsilon \approx \varepsilon_n \quad (12.37)$$

Note that, although the foregoing statements were made for the total emissivity, they also apply to spectral components.

Since the spectral distribution of emission from real surfaces departs from the Planck distribution (Figure 12.15a), we do not expect the value of the spectral emissivity  $\varepsilon_\lambda$  to be independent of wavelength. Representative spectral distributions of  $\varepsilon_\lambda$  are shown in Figure 12.17. The manner in which  $\varepsilon_\lambda$  varies with  $\lambda$  depends on whether the solid is a conductor or nonconductor, as well as on the nature of the surface coating.

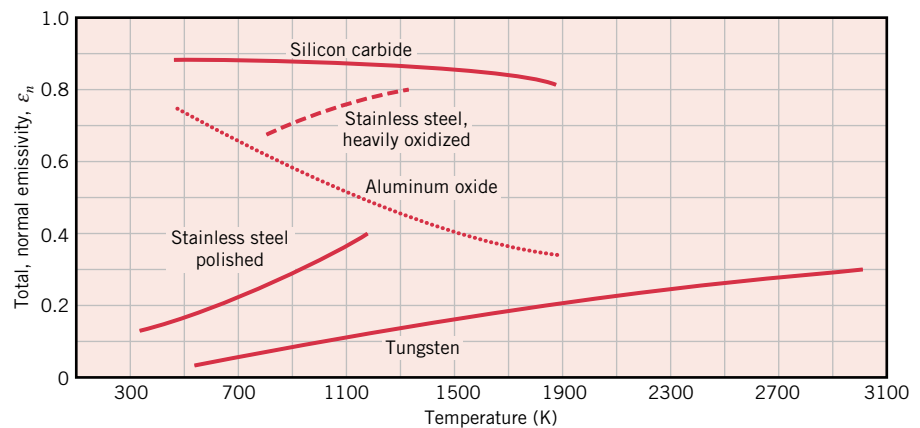

**FIGURE 12.18** Temperature dependence of the total, normal emissivity  $\varepsilon_n$  of selected materials.

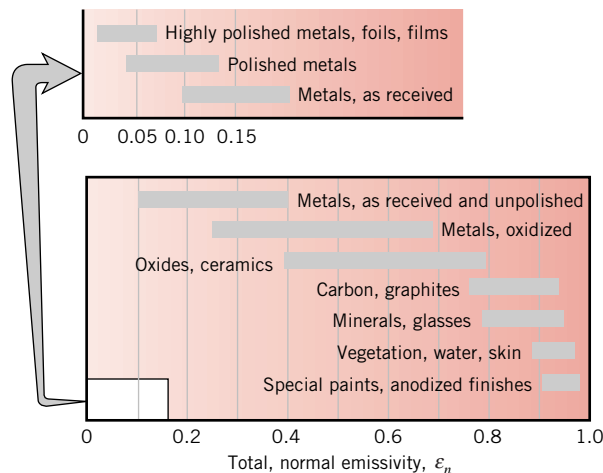

**FIGURE 12.19** Representative values of the total, normal emissivity  $\epsilon_n$ .


Representative values of the total, normal emissivity  $\epsilon_n$  are plotted in Figures 12.18 and 12.19 and listed in Table A.11. Several generalizations may be made.

1. The emissivity of metallic surfaces is generally small, achieving values as low as 0.02 for highly polished gold and silver.
2. The presence of oxide layers may significantly increase the emissivity of metallic surfaces. From Figure 12.18, contrast the values of 0.3 and 0.7 for stainless steel at 900 K, depending on whether it is polished or heavily oxidized.
3. The emissivity of nonconductors is comparatively large, generally exceeding 0.6.
4. The emissivity of conductors increases with increasing temperature; however, depending on the specific material, the emissivity of nonconductors may either increase or decrease with increasing temperature. Note that the variations of  $\epsilon_n$  with  $T$  shown in Figure 12.18 are consistent with the spectral distributions of  $\epsilon_{\lambda,n}$  shown in Figure 12.17. These trends follow from Equation 12.36. Although the spectral distribution of  $\epsilon_{\lambda,n}$  is approximately independent of temperature, there is proportionately more emission at lower wavelengths with increasing temperature. Hence, if  $\epsilon_{\lambda,n}$  increases with decreasing wavelength for a particular material,  $\epsilon_n$  will increase with increasing temperature for that material.

It should be recognized that the emissivity depends strongly on the nature of the surface, which can be influenced by the method of fabrication, thermal cycling, and chemical reaction with its environment. More comprehensive surface emissivity compilations are available in the literature [2–5].

### EXAMPLE 12.5

A diffuse surface at 1600 K has the spectral, hemispherical emissivity shown as follows.

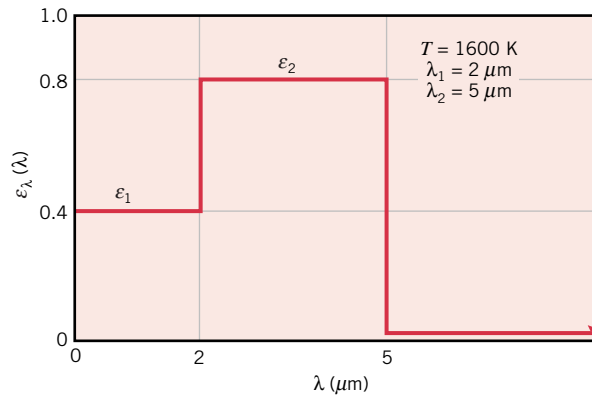

Determine the total, hemispherical emissivity and the total emissive power. At what wavelength will the spectral emissive power be a maximum?

### SOLUTION

**Known:** Spectral, hemispherical emissivity of a diffuse surface at 1600 K.

**Find:**

1. Total, hemispherical emissivity.
2. Total emissive power.
3. Wavelength at which spectral emissive power will be a maximum.

**Assumptions:** Surface is a diffuse emitter.

**Analysis:**

1. The total, hemispherical emissivity is given by Equation 12.36, where the integration may be performed in parts as follows:

$$\varepsilon = \frac{\int_0^{\infty} \varepsilon_{\lambda} E_{\lambda,b} d\lambda}{E_b} = \frac{\varepsilon_1 \int_0^2 E_{\lambda,b} d\lambda}{E_b} + \frac{\varepsilon_2 \int_2^5 E_{\lambda,b} d\lambda}{E_b}$$

or

$$\varepsilon = \varepsilon_1 F_{(0 \rightarrow 2 \mu\text{m})} + \varepsilon_2 [F_{(0 \rightarrow 5 \mu\text{m})} - F_{(0 \rightarrow 2 \mu\text{m})}]$$

From Table 12.1 we obtain

$$\lambda_1 T = 2 \mu\text{m} \times 1600 \text{ K} = 3200 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow 2 \mu\text{m})} = 0.318$$

$$\lambda_2 T = 5 \mu\text{m} \times 1600 \text{ K} = 8000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow 5 \mu\text{m})} = 0.856$$

Hence

$$\varepsilon = 0.4 \times 0.318 + 0.8[0.856 - 0.318] = 0.558 \quad \triangleleft$$

2. From Equation 12.35 the total emissive power is

$$E = \varepsilon E_b = \varepsilon \sigma T^4$$

$$E = 0.558(5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4)(1600 \text{ K})^4 = 207 \text{ kW/m}^2 \quad \triangleleft$$

3. If the surface emitted as a blackbody or if its emissivity were a constant, independent of  $\lambda$ , the wavelength corresponding to maximum spectral emission



could be obtained from Wien's law. However, because  $\varepsilon_\lambda$  varies with  $\lambda$ , it is not immediately obvious where peak emission occurs. From Equation 12.25 we know that

$$\lambda_{\max} = \frac{2898 \mu\text{m} \cdot \text{K}}{1600 \text{ K}} = 1.81 \mu\text{m}$$

The spectral emissive power at this wavelength may be obtained by using Equation 12.32 with Table 12.1. That is,

$$E_\lambda(\lambda_{\max}, T) = \varepsilon_\lambda(\lambda_{\max}) E_{\lambda,b}(\lambda_{\max}, T)$$

or, since the surface is a diffuse emitter,

$$\begin{aligned} E_\lambda(\lambda_{\max}, T) &= \pi \varepsilon_\lambda(\lambda_{\max}) I_{\lambda,b}(\lambda_{\max}, T) \\ &= \pi \varepsilon_\lambda(\lambda_{\max}) \frac{I_{\lambda,b}(\lambda_{\max}, T)}{\sigma T^5} \times \sigma T^5 \end{aligned}$$

$$\begin{aligned} E_\lambda(1.81 \mu\text{m}, 1600 \text{ K}) &= \pi \times 0.4 \times 0.722 \times 10^{-4} (1/\mu\text{m} \cdot \text{K} \cdot \text{sr}) 5.67 \\ &\quad \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 \times (1600 \text{ K})^5 = 54 \text{ kW/m}^2 \cdot \mu\text{m} \end{aligned}$$

Since  $\varepsilon_\lambda = 0.4$  from  $\lambda = 0$  to  $\lambda = 2 \mu\text{m}$ , the foregoing result provides the maximum spectral emissive power for the region  $\lambda < 2 \mu\text{m}$ . However, with the change in  $\varepsilon_\lambda$  that occurs at  $\lambda = 2 \mu\text{m}$ , the value of  $E_\lambda$  at  $\lambda = 2 \mu\text{m}$  may be larger than that for  $\lambda = 1.81 \mu\text{m}$ . To determine whether this is, in fact, the case, we compute

$$E_\lambda(\lambda_1, T) = \pi \varepsilon_\lambda(\lambda_1) \frac{I_{\lambda,b}(\lambda_1, T)}{\sigma T^5} \times \sigma T^5$$

where, for  $\lambda_1 T = 3200 \mu\text{m} \cdot \text{K}$ ,  $[I_{\lambda,b}(\lambda_1, T)/\sigma T^5] = 0.706 \times 10^{-4} (\mu\text{m} \cdot \text{K} \cdot \text{sr})^{-1}$ . Hence

$$\begin{aligned} E_\lambda(2 \mu\text{m}, 1600 \text{ K}) &= \pi \times 0.80 \times 0.706 \times 10^{-4} (1/\mu\text{m} \cdot \text{K} \cdot \text{sr}) 5.67 \\ &\quad \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (1600 \text{ K})^5 \end{aligned}$$


$$E_\lambda(2 \mu\text{m}, 1600 \text{ K}) = 105.5 \text{ kW/m}^2 \cdot \mu\text{m} > E_\lambda(1.81 \mu\text{m}, 1600 \text{ K})$$

and peak emission occurs at

$$\lambda = \lambda_1 = 2 \mu\text{m}$$




**Comments:** For the prescribed spectral distribution of  $\varepsilon_\lambda$ , the spectral emissive power will vary with wavelength as shown.

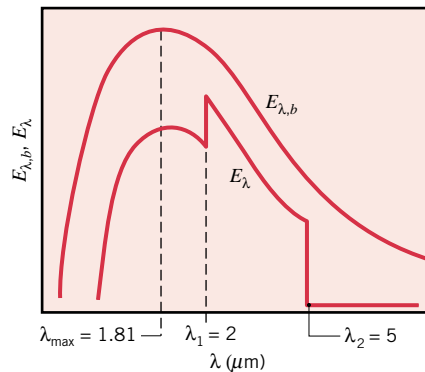

### EXAMPLE 12.6

Measurements of the spectral, directional emissivity of a metallic surface at  $T = 2000$  K and  $\lambda = 1.0 \mu\text{m}$  yield a directional distribution that may be approximated as follows:

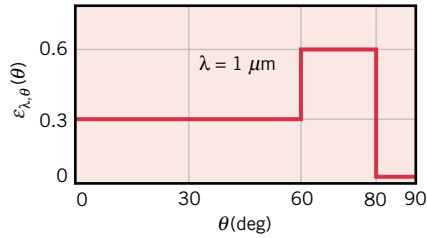

Determine corresponding values of the spectral, normal emissivity; the spectral, hemispherical emissivity; the spectral intensity of radiation emitted in the normal direction; and the spectral emissive power.

### SOLUTION

**Known:** Directional distribution of  $\varepsilon_{\lambda,\theta}$  at  $\lambda = 1 \mu\text{m}$  for a metallic surface at 2000 K.

**Find:**

1. Spectral, normal emissivity  $\varepsilon_{\lambda,n}$  and spectral, hemispherical emissivity  $\varepsilon_\lambda$ .
2. Spectral, normal intensity  $I_{\lambda,n}$  and spectral emissive power  $E_\lambda$ .

**Analysis:**

1. From the measurement of  $\varepsilon_{\lambda,\theta}$  at  $\lambda = 1 \mu\text{m}$ , we see that

$$\varepsilon_{\lambda,n} = \varepsilon_{\lambda,\theta}(1 \mu\text{m}, 0^\circ) = 0.3$$

From Equation 12.34, the spectral, hemispherical emissivity is

$$\varepsilon_\lambda(1 \mu\text{m}) = 2 \int_0^{\pi/2} \varepsilon_{\lambda,\theta} \cos \theta \sin \theta d\theta$$

or

$$\varepsilon_\lambda(1 \mu\text{m}) = 2 \left[ 0.3 \int_0^{\pi/3} \cos \theta \sin \theta d\theta + 0.6 \int_{\pi/3}^{4\pi/9} \cos \theta \sin \theta d\theta \right]$$

$$\begin{aligned} \varepsilon_\lambda(1 \mu\text{m}) &= 2 \left[ 0.3 \frac{\sin^2 \theta}{2} \Big|_0^{\pi/3} + 0.6 \frac{\sin^2 \theta}{2} \Big|_{\pi/3}^{4\pi/9} \right] \\ &= 2 \left[ \frac{0.3}{2} (0.75) + \frac{0.6}{2} (0.97 - 0.75) \right] \end{aligned}$$

$$\varepsilon_\lambda(1 \mu\text{m}) = 0.36$$

2. From Equation 12.30 the spectral intensity of radiation emitted at  $\lambda = 1 \mu\text{m}$  in the normal direction is

$$I_{\lambda,n}(1 \mu\text{m}, 0^\circ, 2000 \text{ K}) = \varepsilon_{\lambda,\theta}(1 \mu\text{m}, 0^\circ) I_{\lambda,b}(1 \mu\text{m}, 2000 \text{ K})$$

where  $\varepsilon_{\lambda,\theta}(1 \mu\text{m}, 0^\circ) = 0.3$  and  $I_{\lambda,b}(1 \mu\text{m}, 2000 \text{ K})$  may be obtained from Table 12.1. For  $\lambda T = 2000 \mu\text{m} \cdot \text{K}$ ,  $(I_{\lambda,b}/\sigma T^5) = 0.493 \times 10^{-4} (\mu\text{m} \cdot \text{K} \cdot \text{sr})^{-1}$  and

$$I_{\lambda,b} = 0.493 \times 10^{-4} (\mu\text{m} \cdot \text{K} \cdot \text{sr})^{-1} \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (2000 \text{ K})^5$$

$$I_{\lambda,b} = 8.95 \times 10^4 \text{ W/m}^2 \cdot \mu\text{m} \cdot \text{sr}$$

Hence

$$I_{\lambda,n}(1 \mu\text{m}, 0^\circ, 2000 \text{ K}) = 0.3 \times 8.95 \times 10^4 \text{ W/m}^2 \cdot \mu\text{m} \cdot \text{sr}$$

$$I_{\lambda,n}(1 \mu\text{m}, 0^\circ, 2000 \text{ K}) = 2.69 \times 10^4 \text{ W/m}^2 \cdot \mu\text{m} \cdot \text{sr} \quad \triangleleft$$

From Equation 12.32 the spectral emissive power for  $\lambda = 1 \mu\text{m}$  and  $T = 2000 \text{ K}$  is

$$E_\lambda(1 \mu\text{m}, 2000 \text{ K}) = \varepsilon_\lambda(1 \mu\text{m}) E_{\lambda,b}(1 \mu\text{m}, 2000 \text{ K})$$

where

$$E_{\lambda,b}(1 \mu\text{m}, 2000 \text{ K}) = \pi I_{\lambda,b}(1 \mu\text{m}, 2000 \text{ K})$$

$$\begin{aligned} E_{\lambda,b}(1 \mu\text{m}, 2000 \text{ K}) &= \pi \text{ sr} \times 8.95 \times 10^4 \text{ W/m}^2 \cdot \mu\text{m} \cdot \text{sr} \\ &= 2.81 \times 10^5 \text{ W/m}^2 \cdot \mu\text{m} \end{aligned}$$

Hence

$$E_\lambda(1 \mu\text{m}, 2000 \text{ K}) = 0.36 \times 2.81 \times 10^5 \text{ W/m}^2 \cdot \mu\text{m}$$

or


$$E_\lambda(1 \mu\text{m}, 2000 \text{ K}) = 1.01 \times 10^5 \text{ W/m}^2 \cdot \mu\text{m} \quad \triangleleft$$

## 12.5

### Absorption, Reflection, and Transmission by Real Surfaces

In Section 12.2.3 we defined the *spectral irradiation*  $G_\lambda$  ( $\text{W/m}^2 \cdot \mu\text{m}$ ) as the rate at which radiation of wavelength  $\lambda$  is incident on a surface per unit area of the surface and per unit wavelength interval  $d\lambda$  about  $\lambda$ . It may be incident from all possible directions, and it may originate from several different sources. The *total irradiation*  $G$  ( $\text{W/m}^2$ ) encompasses all spectral contributions and may be evaluated from Equation 12.14. In this section we consider the *processes* resulting from interception of this radiation by a solid (or liquid) medium.

In the most general situation the irradiation interacts with a *semitransparent medium*, such as a layer of water or a glass plate. As shown in Figure 12.20 for a spectral component of the irradiation, portions of this radiation may be

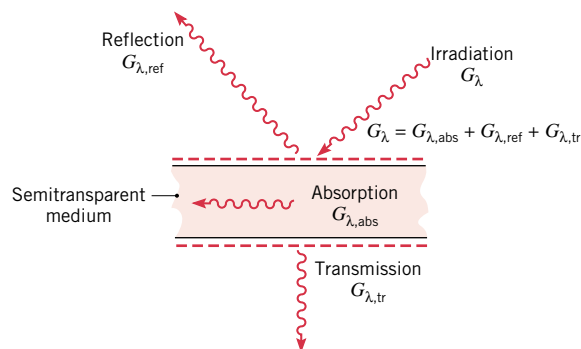
**FIGURE 12.20**

Absorption, reflection, and transmission processes associated with a semitransparent medium.

reflected, absorbed, and transmitted. From a radiation balance on the medium, it follows that

$$G_\lambda = G_{\lambda,ref} + G_{\lambda,abs} + G_{\lambda,tr} \quad (12.38)$$

In general, determination of these components is complex, depending on the upper and lower surface conditions, the wavelength of the radiation, and the composition and thickness of the medium. Moreover, conditions may be strongly influenced by *volumetric* effects occurring within the medium.

In a simpler situation, which pertains to most engineering applications, the medium is *opaque* to the incident radiation. In this case,  $G_{\lambda,tr} = 0$  and the remaining absorption and reflection processes may be treated as *surface phenomena*. That is, they are controlled by processes occurring within a fraction of a micrometer from the irradiated surface. It is therefore appropriate to speak of irradiation being absorbed and reflected *by the surface*, with the relative magnitudes of  $G_{\lambda,abs}$  and  $G_{\lambda,ref}$  depending on  $\lambda$  and the nature of the surface material. There is no net effect of the reflection process on the medium, while absorption has the effect of increasing the internal thermal energy of the medium.

It is interesting to note that surface absorption and reflection are responsible for our perception of *color*. Unless the surface is at a high temperature ( $T_s \geq 1000$  K), such that it is *incandescent*, color is in no way due to emission, which is concentrated in the IR region, and is hence imperceptible to the eye. Color is instead due to selective reflection and absorption of the visible portion of the irradiation that is incident from the sun or an artificial source of light. A shirt is “red” because it contains a pigment that preferentially absorbs the blue, green, and yellow components of the incident light. Hence the relative contributions of these components to the reflected light, which is seen, is diminished, and the red component is dominant. Similarly, a leaf is “green” because its cells contain chlorophyll, a pigment that shows strong absorption in the blue and the red and preferential reflection in the green. A surface appears “black” if it absorbs all incident visible radiation, and it is “white” if it reflects this radiation. However, we must be careful how we interpret such *visual* effects. For a prescribed irradiation, the “color” of a surface may not indicate its overall capacity as an absorber or reflector, since much of the irradiation may be in the IR region. A “white” surface such as snow, for example, is highly reflective to visible radiation but strongly absorbs IR radiation, thereby approximating blackbody behavior at long wavelengths.

In Section 12.4 we introduced a property, which we called the emissivity, to characterize the process of surface emission. In the subsections that follow we shall

introduce properties to characterize the absorption, reflection, and transmission processes. In general these properties depend on surface material and finish, surface temperature, and the wavelength and direction of the incident radiation.

### 12.5.1 Absorptivity

The absorptivity is a property that determines the fraction of the irradiation absorbed by a surface. Determination of the property is complicated by the fact that, like emission, it may be characterized by both a directional and spectral dependence. The *spectral, directional absorptivity*,  $\alpha_{\lambda,\theta}(\lambda, \theta, \phi)$ , of a surface is defined as the fraction of the spectral intensity incident in the direction of  $\theta$  and  $\phi$  that is absorbed by the surface. Hence

$$\alpha_{\lambda,\theta}(\lambda, \theta, \phi) \equiv \frac{I_{\lambda,i,\text{abs}}(\lambda, \theta, \phi)}{I_{\lambda,i}(\lambda, \theta, \phi)} \quad (12.39)$$

In this expression, we have neglected any dependence of the absorptivity on the surface temperature. Such a dependence is small for most spectral radiative properties.

It is implicit in the foregoing result that surfaces may exhibit selective absorption with respect to the wavelength and direction of the incident radiation. For most engineering calculations, however, it is desirable to work with surface properties that represent directional averages. We therefore define a *spectral, hemispherical absorptivity*  $\alpha_{\lambda}(\lambda)$  as

$$\alpha_{\lambda}(\lambda) \equiv \frac{G_{\lambda,\text{abs}}(\lambda)}{G_{\lambda}(\lambda)} \quad (12.40)$$

which, from Equations 12.13 and 12.39, may be expressed as

$$\alpha_{\lambda}(\lambda) = \frac{\int_0^{2\pi} \int_0^{\pi/2} \alpha_{\lambda,\theta}(\lambda, \theta, \phi) I_{\lambda,i}(\lambda, \theta, \phi) \cos \theta \sin \theta \, d\theta \, d\phi}{\int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,i}(\lambda, \theta, \phi) \cos \theta \sin \theta \, d\theta \, d\phi} \quad (12.41)$$

Hence  $\alpha_{\lambda}$  depends on the directional distribution of the incident radiation, as well as on the wavelength of the radiation and the nature of the absorbing surface. Note that, if the incident radiation is diffusely distributed and  $\alpha_{\lambda,\theta}$  is independent of  $\phi$ , Equation 12.41 reduces to

$$\alpha_{\lambda}(\lambda) = 2 \int_0^{\pi/2} \alpha_{\lambda,\theta}(\lambda, \theta) \cos \theta \sin \theta \, d\theta \quad (12.42)$$

The *total, hemispherical absorptivity*,  $\alpha$ , represents an integrated average over both direction and wavelength. It is defined as the fraction of the total irradiation absorbed by a surface

$$\alpha \equiv \frac{G_{\text{abs}}}{G} \quad (12.43)$$

and, from Equations 12.14 and 12.40, it may be expressed as

$$\alpha = \frac{\int_0^\infty \alpha_\lambda(\lambda) G_\lambda(\lambda) d\lambda}{\int_0^\infty G_\lambda(\lambda) d\lambda} \quad (12.44)$$

Accordingly,  $\alpha$  depends on the spectral distribution of the incident radiation, as well as on its directional distribution and the nature of the absorbing surface. Note that, although  $\alpha$  is approximately independent of surface temperature, the same may not be said for the total, hemispherical emissivity,  $\varepsilon$ . From Equation 12.36 it is evident that this property is strongly temperature dependent.

Because  $\alpha$  depends on the spectral distribution of the irradiation, its value for a surface exposed to solar radiation may differ appreciably from its value for the same surface exposed to longer wavelength radiation originating from a source of lower temperature. Since the spectral distribution of solar radiation is nearly proportional to that of emission from a blackbody at 5800 K, it follows from Equation 12.44 that the total absorptivity to solar radiation  $\alpha_s$  may be approximated as

$$\alpha_s \approx \frac{\int_0^\infty \alpha_\lambda(\lambda) E_{\lambda,b}(\lambda, 5800 \text{ K}) d\lambda}{\int_0^\infty E_{\lambda,b}(\lambda, 5800 \text{ K}) d\lambda} \quad (12.45)$$

The integrals appearing in this equation may be evaluated by using the blackbody radiation function  $F_{(0 \rightarrow \lambda)}$  of Table 12.1.

### 12.5.2 Reflectivity

The reflectivity is a property that determines the fraction of the incident radiation reflected by a surface. However, its specific definition may take several different forms, because the property is inherently *bidirectional* [6]. That is, in addition to depending on the direction of the incident radiation, it also depends on the direction of the reflected radiation. We shall avoid this complication by working exclusively with a reflectivity that represents an integrated average over the hemisphere associated with the reflected radiation and therefore provides no information concerning the directional distribution of this radiation. Accordingly, the *spectral, directional reflectivity*,  $\rho_{\lambda,\theta}(\lambda, \theta, \phi)$ , of a surface is defined as the fraction of the spectral intensity incident in the direction of  $\theta$  and  $\phi$ , which is reflected by the surface. Hence

$$\rho_{\lambda,\theta}(\lambda, \theta, \phi) \equiv \frac{I_{\lambda,i,\text{ref}}(\lambda, \theta, \phi)}{I_{\lambda,i}(\lambda, \theta, \phi)} \quad (12.46)$$

The *spectral, hemispherical reflectivity*  $\rho_\lambda(\lambda)$  is then defined as the fraction of the spectral irradiation that is reflected by the surface. Accordingly,

$$\rho_\lambda(\lambda) \equiv \frac{G_{\lambda,\text{ref}}(\lambda)}{G_\lambda(\lambda)} \quad (12.47)$$

which is equivalent to

$$\rho_{\lambda}(\lambda) = \frac{\int_0^{2\pi} \int_0^{\pi/2} \rho_{\lambda,\theta}(\lambda, \theta, \phi) I_{\lambda,i}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi}{\int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,i}(\lambda, \theta, \phi) \cos \theta \sin \theta d\theta d\phi} \quad (12.48)$$

The *total, hemispherical reflectivity*  $\rho$  is then defined as

$$\rho \equiv \frac{G_{\text{ref}}}{G} \quad (12.49)$$

in which case

$$\rho = \frac{\int_0^{\infty} \rho_{\lambda}(\lambda) G_{\lambda}(\lambda) d\lambda}{\int_0^{\infty} G_{\lambda}(\lambda) d\lambda} \quad (12.50)$$

Surfaces may be idealized as *diffuse* or *specular*, according to the manner in which they reflect radiation (Figure 12.21). Diffuse reflection occurs if, regardless of the direction of the incident radiation, the intensity of the reflected radiation is independent of the reflection angle. In contrast, if all the reflection is in the direction of  $\theta_2$ , which equals the incident angle  $\theta_1$ , specular reflection is said to occur. Although no surface is perfectly diffuse or specular, the latter condition is more closely approximated by polished, mirror-like surfaces and the former condition by rough surfaces. The assumption of diffuse reflection is reasonable for most engineering applications.

### 12.5.3 Transmissivity

Although treatment of the response of a semitransparent material to incident radiation is a complicated problem [6], reasonable results may often be obtained through the use of hemispherical transmissivities defined as

$$\tau_{\lambda} = \frac{G_{\lambda,\text{tr}}(\lambda)}{G_{\lambda}(\lambda)} \quad (12.51)$$

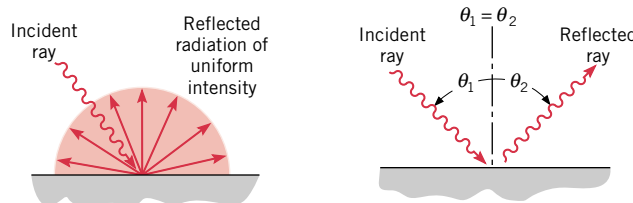


FIGURE 12.21 Diffuse and specular reflection.

and

$$\tau = \frac{G_{\text{tr}}}{G} \quad (12.52)$$

The total transmissivity  $\tau$  is related to the spectral component  $\tau_\lambda$  by

$$\tau = \frac{\int_0^\infty G_{\lambda,\text{tr}}(\lambda) d\lambda}{\int_0^\infty G_\lambda(\lambda) d\lambda} = \frac{\int_0^\infty \tau_\lambda(\lambda) G_\lambda(\lambda) d\lambda}{\int_0^\infty G_\lambda(\lambda) d\lambda} \quad (12.53)$$

### 12.5.4 Special Considerations

We conclude this section by noting that, from the radiation balance of Equation 12.38 and the foregoing definitions,

$$\rho_\lambda + \alpha_\lambda + \tau_\lambda = 1 \quad (12.54)$$

for a *semitransparent* medium. For properties that are averaged over the entire spectrum, it also follows that

$$\rho + \alpha + \tau = 1 \quad (12.55)$$

Of course, if the medium is *opaque*, there is no transmission, and absorption and reflection are surface processes for which

$$\alpha_\lambda + \rho_\lambda = 1 \quad (12.56)$$


and

$$\alpha + \rho = 1 \quad (12.57)$$


Hence knowledge of one property implies knowledge of the other.

Spectral distributions of the normal reflectivity and absorptivity are plotted in Figure 12.22 for selected *opaque* surfaces. A material such as glass or water, which is semitransparent at short wavelengths, becomes opaque at longer wavelengths. This behavior is shown in Figure 12.23, which presents the spectral transmissivity of several common *semitransparent* materials. Note that the transmissivity of glass is affected by its iron content and that the transmissivity of plastics, such as Tedlar, is greater than that of glass in the IR region. These factors have an important bearing on the selection of cover plate materials for solar collector applications, design and selection of windows for energy conservation, and specification of materials for fabrication of the optical components of infrared imaging systems. Values for the total transmissivity to solar radiation of common collector cover plate materials are presented in Table A.12, along with surface solar absorptivities and low-temperature emissivities.



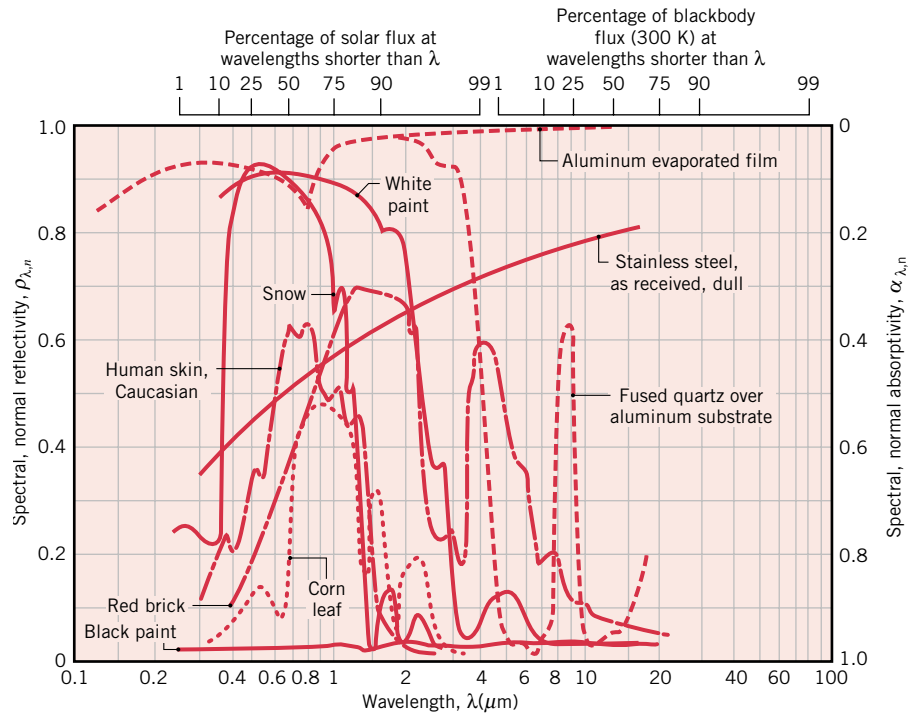


**FIGURE 12.22** Spectral dependence of the spectral, normal absorptivity  $\alpha_{\lambda,n}$  and reflectivity  $\rho_{\lambda,n}$  of selected opaque materials.

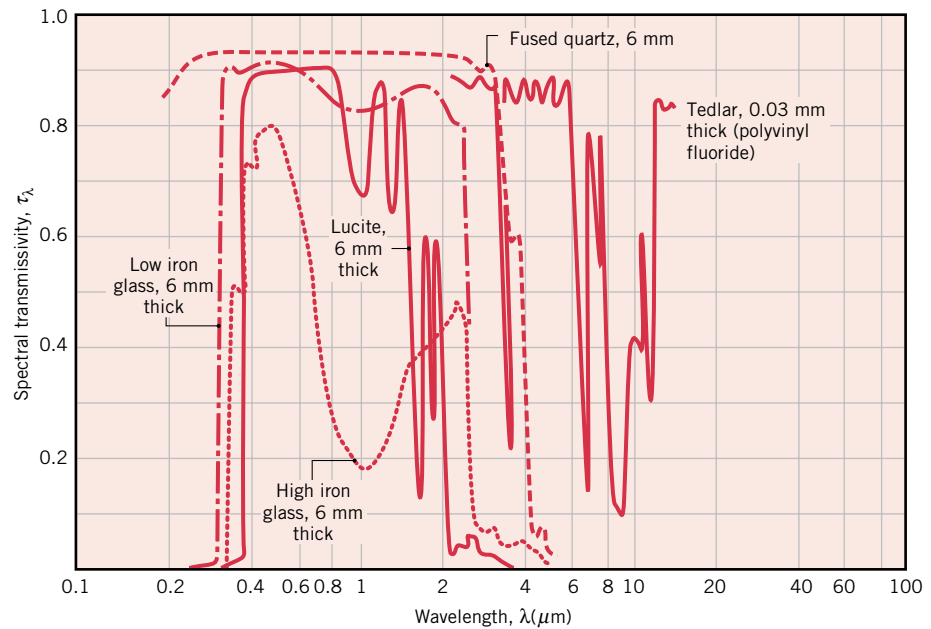

**FIGURE 12.23** Spectral dependence of the spectral transmissivities  $\tau_\lambda$  of selected semitransparent materials.

### EXAMPLE 12.7

The spectral, hemispherical absorptivity of an opaque surface and the spectral irradiation at the surface are as shown.

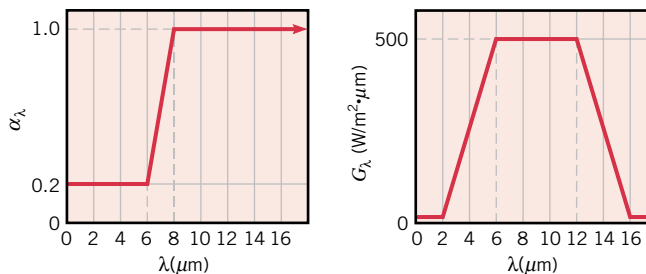

How does the spectral, hemispherical reflectivity vary with wavelength? What is the total, hemispherical absorptivity of the surface? If the surface is initially at 500 K and has a total, hemispherical emissivity of 0.8, how will its temperature change upon exposure to the irradiation?


### SOLUTION

**Known:** Spectral, hemispherical absorptivity and irradiation of a surface. Surface temperature (500 K) and total, hemispherical emissivity (0.8).

### Find:

1. Spectral distribution of reflectivity.
2. Total, hemispherical absorptivity.
3. Nature of surface temperature change.

### Schematic:

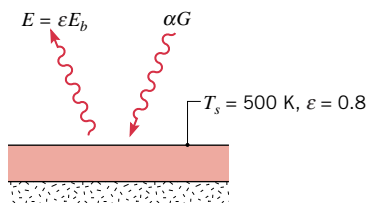


### Assumptions:

1. Surface is opaque.
2. Surface convection effects are negligible.
3. Back surface is insulated.

### Analysis:

1. From Equation 12.56,  $\rho_\lambda = 1 - \alpha_\lambda$ . Hence from knowledge of  $\alpha_\lambda(\lambda)$ , the spectral distribution of  $\rho_\lambda$  is as shown.

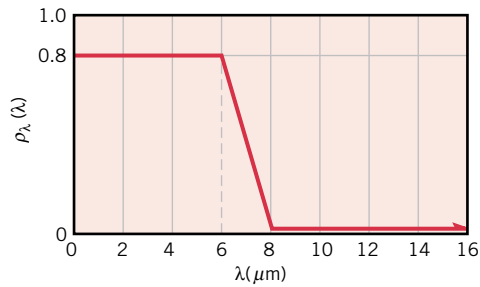

2. From Equations 12.43 and 12.44,

$$\alpha = \frac{G_{\text{abs}}}{G} = \frac{\int_0^{\infty} \alpha_{\lambda} G_{\lambda} d\lambda}{\int_0^{\infty} G_{\lambda} d\lambda}$$

or, subdividing the integral into parts,

$$\alpha = \frac{0.2 \int_2^6 G_{\lambda} d\lambda + 500 \int_6^8 \alpha_{\lambda} d\lambda + 1.0 \int_8^{16} G_{\lambda} d\lambda}{\int_2^6 G_{\lambda} d\lambda + \int_6^{12} G_{\lambda} d\lambda + \int_{12}^{16} G_{\lambda} d\lambda}$$

$$\begin{aligned} \alpha &= \left\{ 0.2 \left( \frac{1}{2} \right) 500 \text{ W/m}^2 \cdot \mu\text{m} (6 - 2) \mu\text{m} \right. \\ &\quad + 500 \text{ W/m}^2 \cdot \mu\text{m} [0.2(8 - 6) \mu\text{m} + (1 - 0.2) \left( \frac{1}{2} \right) (8 - 6) \mu\text{m}] \\ &\quad + [1 \times 500 \text{ W/m}^2 \cdot \mu\text{m} (12 - 8) \mu\text{m} \\ &\quad \left. + 1 \left( \frac{1}{2} \right) 500 \text{ W/m}^2 \cdot \mu\text{m} (16 - 12) \mu\text{m}] \right\} \\ &\quad \div \left[ \left( \frac{1}{2} \right) 500 \text{ W/m}^2 \cdot \mu\text{m} (6 - 2) \mu\text{m} + 500 \text{ W/m}^2 \cdot \mu\text{m} (12 - 6) \mu\text{m} \right. \\ &\quad \left. + \left( \frac{1}{2} \right) 500 \text{ W/m}^2 \cdot \mu\text{m} (16 - 12) \mu\text{m} \right] \end{aligned}$$

Hence

$$\alpha = \frac{G_{\text{abs}}}{G} = \frac{(200 + 600 + 3000) \text{ W/m}^2}{(1000 + 3000 + 1000) \text{ W/m}^2} = \frac{3800 \text{ W/m}^2}{5000 \text{ W/m}^2} = 0.76$$

3. Neglecting convection effects, the net heat flux to the surface is

$$q''_{\text{net}} = \alpha G - E = \alpha G - \varepsilon \sigma T^4$$

Hence


$$q''_{\text{net}} = 0.76(5000 \text{ W/m}^2) - 0.8 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (500 \text{ K})^4$$

$$q''_{\text{net}} = 3800 - 2835 = 965 \text{ W/m}^2$$

Since  $q''_{\text{net}} > 0$ , the surface temperature will *increase* with time.

### EXAMPLE 12.8

The cover glass on a flat-plate solar collector has a low iron content, and its spectral transmissivity may be approximated by the following distribution.

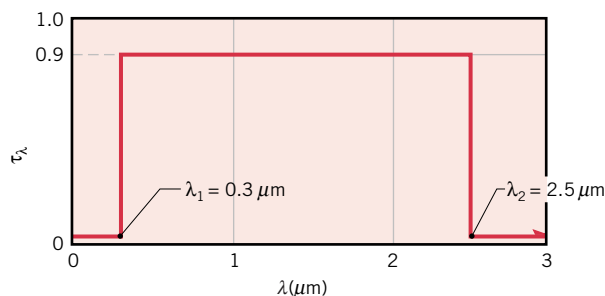

What is the total transmissivity of the cover glass to solar radiation?

### SOLUTION

**Known:** Spectral transmissivity of solar collector cover glass.

**Find:** Total transmissivity of cover glass to solar radiation.

**Assumptions:** Spectral distribution of solar irradiation is proportional to that of blackbody emission at 5800 K.

**Analysis:** From Equation 12.53 the total transmissivity of the cover is

$$\tau = \frac{\int_0^{\infty} \tau_{\lambda} G_{\lambda} d\lambda}{\int_0^{\infty} G_{\lambda} d\lambda}$$

where the irradiation  $G_{\lambda}$  is due to solar emission. Having assumed that the sun emits as a blackbody at 5800 K, it follows that

$$G_{\lambda}(\lambda) \propto E_{\lambda,b}(5800 \text{ K})$$

With the proportionality constant canceling from the numerator and denominator of the expression for  $\tau$ , we obtain

$$\tau = \frac{\int_0^{\infty} \tau_{\lambda} E_{\lambda,b}(5800 \text{ K}) d\lambda}{\int_0^{\infty} E_{\lambda,b}(5800 \text{ K}) d\lambda}$$

or, for the prescribed spectral distribution of  $\tau_{\lambda}(\lambda)$ ,

$$\tau = 0.90 \frac{\int_{0.3}^{2.5} E_{\lambda,b}(5800 \text{ K}) d\lambda}{E_b(5800 \text{ K})}$$

From Table 12.1

$$\begin{aligned}\lambda_1 &= 0.3 \mu\text{m}, T = 5800 \text{ K}: & \lambda_1 T &= 1740 \mu\text{m} \cdot \text{K}, F_{(0 \rightarrow \lambda_1)} = 0.0335 \\ \lambda_2 &= 2.5 \mu\text{m}, T = 5800 \text{ K}: & \lambda_2 T &= 14,500 \mu\text{m} \cdot \text{K}, F_{(0 \rightarrow \lambda_2)} = 0.9664\end{aligned}$$

Hence from Equation 12.29

$$\tau = 0.90[F_{(0 \rightarrow \lambda_2)} - F_{(0 \rightarrow \lambda_1)}] = 0.90(0.9660 - 0.1245) = 0.84 \quad \triangleleft$$

**Comments:** It is important to recognize that the irradiation at the cover plate is not equal to the emissive power of a blackbody at 5800 K,  $G_\lambda \neq E_{\lambda,b}$  (5800 K). It is simply assumed to be proportional to this emissive power, in which case it is assumed to have a spectral distribution of the same form. With  $G_\lambda$  appearing in both the numerator and denominator of the expression for  $\tau$ , it is then possible to replace  $G_\lambda$  by  $E_{\lambda,b}$ .

## 12.6


### Kirchhoff's Law

In the foregoing sections we separately considered real surface properties associated with emission and absorption. In Sections 12.6 and 12.7 we consider conditions for which these properties are equal.

Consider a *large, isothermal enclosure* of surface temperature  $T_s$ , within which several small bodies are confined (Figure 12.24). Since these bodies are small relative to the enclosure, they have a negligible influence on the radiation field, which is due to the cumulative effect of emission and reflection by the enclosure surface. Recall that, regardless of its radiative properties, such a surface forms a *blackbody cavity*. Accordingly, regardless of its orientation, the irradiation experienced by any body in the cavity is diffuse and equal to emission from a blackbody at  $T_s$ .

$$G = E_b(T_s) \quad (12.58)$$

Under steady-state conditions, *thermal equilibrium* must exist between the bodies and the enclosure. Hence  $T_1 = T_2 = \dots = T_s$ , and the net rate of energy transfer

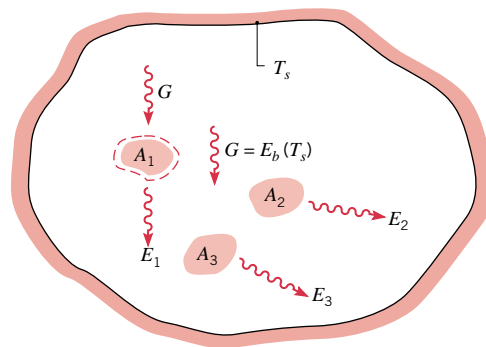

**FIGURE 12.24**

Radiative exchange in an isothermal enclosure.

to each surface must be zero. Applying an energy balance to a control surface about body 1, it follows that

$$\alpha_1 GA_1 - E_1(T_s)A_1 = 0$$

or, from Equation 12.58,

$$\frac{E_1(T_s)}{\alpha_1} = E_b(T_s)$$

Since this result must apply to each of the confined bodies, we then obtain

$$\frac{E_1(T_s)}{\alpha_1} = \frac{E_2(T_s)}{\alpha_2} = \dots = E_b(T_s) \quad (12.59)$$

This relation is known as *Kirchhoff's law*. A major implication is that, since  $\alpha \leq 1$ ,  $E(T_s) \leq E_b(T_s)$ . Hence *no real surface can have an emissive power exceeding that of a black surface at the same temperature*, and the notion of the blackbody as an ideal emitter is confirmed.

From the definition of the total, hemispherical emissivity, Equation 12.35, an alternative form of Kirchhoff's law, is

$$\frac{\varepsilon_1}{\alpha_1} = \frac{\varepsilon_2}{\alpha_2} = \dots = 1$$

Hence, for any surface in the enclosure,

$$\varepsilon = \alpha \quad (12.60)$$

That is, the total, hemispherical emissivity of the surface is equal to its total, hemispherical absorptivity.

We will later find that calculations of radiative exchange between surfaces are greatly simplified if Equation 12.60 may be applied to each of the surfaces. However, the restrictive conditions inherent in its derivation should be remembered. In particular, the surface irradiation has been assumed to correspond to emission from a blackbody at the same temperature as the surface. In Section 12.7 we consider other, less restrictive, conditions for which Equation 12.60 is applicable.

The preceding derivation may be repeated for spectral conditions, and for any surface in the enclosure it follows that

$$\varepsilon_\lambda = \alpha_\lambda \quad (12.61)$$

Conditions associated with the use of Equation 12.61 are less restrictive than those associated with Equation 12.60. In particular, it will be shown that Equation 12.61 is applicable if the irradiation is diffuse *or* if the surface is diffuse. A form of Kirchhoff's law for which there are *no restrictions* involves the spectral, directional properties.

$$\varepsilon_{\lambda,\theta} = \alpha_{\lambda,\theta} \quad (12.62)$$

This equality is always applicable because  $\varepsilon_{\lambda,\theta}$  and  $\alpha_{\lambda,\theta}$  are *inherent* surface properties. That is, respectively, they are independent of the spectral and directional distributions of the emitted and incident radiation.

More detailed developments of Kirchhoff's law are provided by Planck [1] and Siegel and Howell [6].

## 12.7

## The Gray Surface

In Chapter 13 we will find that the problem of predicting radiant energy exchange between surfaces is greatly simplified if Equation 12.60 may be assumed to apply for each individual surface. It is therefore important to examine whether this equality may be applied to conditions other than those for which it was derived, namely, irradiation due to emission from a blackbody at the same temperature as the surface.

Accepting the fact that the spectral, directional emissivity and absorptivity are equal under any conditions, Equation 12.62, we begin by considering the conditions associated with using Equation 12.61. According to the definitions of the spectral, hemispherical properties, Equations 12.33 and 12.41, we are really asking under what conditions, if any, the following equality will hold:

$$\varepsilon_\lambda = \frac{\int_0^{2\pi} \int_0^{\pi/2} \varepsilon_{\lambda,\theta} \cos \theta \sin \theta \, d\theta \, d\phi}{\int_0^{2\pi} \int_0^{\pi/2} \cos \theta \sin \theta \, d\theta \, d\phi} \stackrel{?}{=} \frac{\int_0^{2\pi} \int_0^{\pi/2} \alpha_{\lambda,\theta} I_{\lambda,i} \cos \theta \sin \theta \, d\theta \, d\phi}{\int_0^{2\pi} \int_0^{\pi/2} I_{\lambda,i} \cos \theta \sin \theta \, d\theta \, d\phi} = \alpha_\lambda \quad (12.63)$$

Since  $\varepsilon_{\lambda,\theta} = \alpha_{\lambda,\theta}$ , it follows by inspection that Equation 12.61 is applicable if *either* of the following conditions is satisfied:

1. The *irradiation is diffuse* ( $I_{\lambda,i}$  is independent of  $\theta$  and  $\phi$ ).
2. The *surface is diffuse* ( $\varepsilon_{\lambda,\theta}$  and  $\alpha_{\lambda,\theta}$  are independent of  $\theta$  and  $\phi$ ).

The first condition is a reasonable approximation for many engineering calculations; the second condition is reasonable for many surfaces, particularly for electrically nonconducting materials (Figure 12.16).

Assuming the existence of either diffuse irradiation or a diffuse surface, we now consider what *additional* conditions must be satisfied for Equation 12.60 to be valid. From Equations 12.36 and 12.44, the equality applies if


$$\varepsilon = \frac{\int_0^\infty \varepsilon_\lambda E_{\lambda,b}(\lambda, T) \, d\lambda}{E_b(T)} \stackrel{?}{=} \frac{\int_0^\infty \alpha_\lambda G_\lambda(\lambda) \, d\lambda}{G} = \alpha \quad (12.64)$$

Since  $\varepsilon_\lambda = \alpha_\lambda$ , it follows by inspection that Equation 12.60 applies if *either* of the following conditions is satisfied:

1. The irradiation corresponds to emission from a blackbody at the surface temperature  $T$ , in which case  $G_\lambda(\lambda) = E_{\lambda,b}(\lambda, T)$  and  $G = E_b(T)$ .
2. The *surface is gray* ( $\alpha_\lambda$  and  $\varepsilon_\lambda$  are independent of  $\lambda$ ).

Note that the first condition corresponds to the major assumption required for the derivation of Kirchhoff's law (Section 12.6).

Because the total absorptivity of a surface depends on the spectral distribution of the irradiation, it cannot be stated unequivocally that  $\alpha = \varepsilon$ . For example, a particular surface may be highly absorbing to radiation in one spectral region and virtually

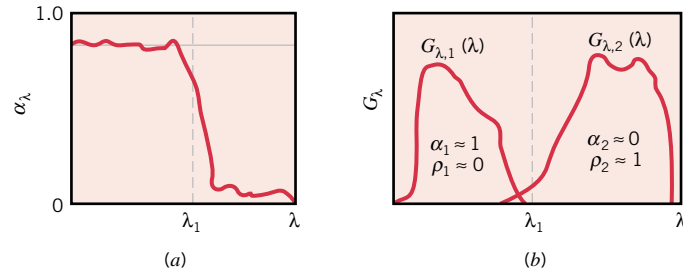


**FIGURE 12.25** Spectral distribution of (a) the spectral absorptivity of a surface and (b) the spectral irradiation at the surface.

nonabsorbing in another region (Figure 12.25a). Accordingly, for the two possible irradiation fields  $G_{\lambda,1}(\lambda)$  and  $G_{\lambda,2}(\lambda)$  of Figure 12.25b, the values of  $\alpha$  will differ drastically. In contrast, the value of  $\varepsilon$  is independent of the irradiation. Hence there is *no* basis for stating that  $\alpha$  is *always* equal to  $\varepsilon$ .

To assume gray surface behavior, hence the validity of Equation 12.60, it is not necessary for  $\alpha_\lambda$  and  $\varepsilon_\lambda$  to be independent of  $\lambda$  over the entire spectrum. Practically speaking, a *gray surface* may be defined as *one for which  $\alpha_\lambda$  and  $\varepsilon_\lambda$  are independent of  $\lambda$  over the spectral regions of the irradiation and the surface emission*. From Equation 12.64 it is readily shown that gray surface behavior may be assumed for the conditions of Figure 12.26. That is, the irradiation and surface emission are concentrated in a region for which the spectral properties of the surface are approximately constant. Accordingly,

$$\varepsilon = \frac{\varepsilon_{\lambda,o} \int_{\lambda_1}^{\lambda_2} E_{\lambda,b}(\lambda, T) d\lambda}{E_b(T)} = \varepsilon_{\lambda,o} \quad \text{and} \quad \alpha = \frac{\alpha_{\lambda,o} \int_{\lambda_3}^{\lambda_4} G_\lambda(\lambda) d\lambda}{G} = \alpha_{\lambda,o}$$

in which case  $\alpha = \varepsilon = \varepsilon_{\lambda,o}$ . However, if the irradiation were in a spectral region corresponding to  $\lambda < \lambda_1$  or  $\lambda > \lambda_4$ , gray surface behavior could not be assumed.

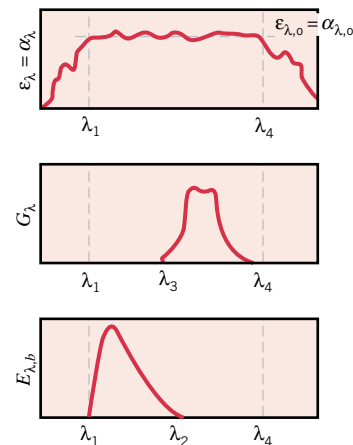

**FIGURE 12.26**


A set of conditions for which gray surface behavior may be assumed.



A surface for which  $\alpha_{\lambda,\theta}$  and  $\varepsilon_{\lambda,\theta}$  are independent of  $\theta$  and  $\lambda$  is termed a *diffuse, gray surface* (diffuse because of the directional independence and gray because of the wavelength independence). It is a surface for which both Equations 12.60 and 12.61 are satisfied. We assume such surface conditions in many of our subsequent considerations. However, although the assumption of a gray surface is reasonable for many practical applications, some caution should be exercised in its use, particularly if the spectral regions of the irradiation and emission are widely separated.

### EXAMPLE 12.9

A diffuse, fire brick wall of temperature  $T_s = 500$  K has the spectral emissivity shown and is exposed to a bed of coals at 2000 K.

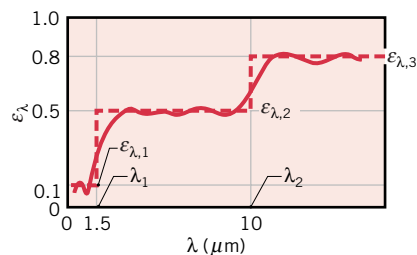

Determine the total, hemispherical emissivity and emissive power of the fire brick wall. What is the total absorptivity of the wall to irradiation resulting from emission by the coals?


### SOLUTION

**Known:** Brick wall of surface temperature  $T_s = 500$  K and prescribed  $\varepsilon_\lambda(\lambda)$  is exposed to coals at  $T_c = 2000$  K.

### Find:

1. Total, hemispherical emissivity of the fire brick wall.
2. Total emissive power of the brick wall.
3. Absorptivity of the wall to irradiation from the coals.

### Schematic:

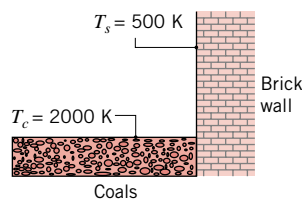

**Assumptions:**

1. Brick wall is opaque and diffuse.
2. Spectral distribution of irradiation at the brick wall approximates that due to emission from a blackbody at 2000 K.

**Analysis:**

1. The total, hemispherical emissivity follows from Equation 12.36.

$$\varepsilon(T_s) = \frac{\int_0^\infty \varepsilon_\lambda(\lambda) E_{\lambda,b}(\lambda, T_s) d\lambda}{E_b(T_s)}$$

Breaking the integral into parts,

$$\varepsilon(T_s) = \varepsilon_{\lambda,1} \frac{\int_0^{\lambda_1} E_{\lambda,b} d\lambda}{E_b} + \varepsilon_{\lambda,2} \frac{\int_{\lambda_1}^{\lambda_2} E_{\lambda,b} d\lambda}{E_b} + \varepsilon_{\lambda,3} \frac{\int_{\lambda_2}^\infty E_{\lambda,b} d\lambda}{E_b}$$

and introducing the blackbody functions, it follows that

$$\varepsilon(T_s) = \varepsilon_{\lambda,1} F_{(0 \rightarrow \lambda_1)} + \varepsilon_{\lambda,2} [F_{(0 \rightarrow \lambda_2)} - F_{(0 \rightarrow \lambda_1)}] + \varepsilon_{\lambda,3} [1 - F_{(0 \rightarrow \lambda_2)}]$$

From Table 12.1

$$\lambda_1 T_s = 1.5 \mu\text{m} \times 500 \text{ K} = 750 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow \lambda_1)} = 0.000$$

$$\lambda_2 T_s = 10 \mu\text{m} \times 500 \text{ K} = 5000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow \lambda_2)} = 0.634$$

Hence

$$\varepsilon(T_s) = 0.1 \times 0 + 0.5 \times 0.634 + 0.8 (1 - 0.634) = 0.610 \quad \triangleleft$$

2. From Equations 12.26 and 12.35, the total emissive power is

$$E(T_s) = \varepsilon(T_s) E_b(T_s) = \varepsilon(T_s) \sigma T_s^4$$

$$E(T_s) = 0.61 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (500 \text{ K})^4 = 2162 \text{ W/m}^2 \quad \triangleleft$$

3. From Equation 12.44, the total absorptivity of the wall to radiation from the coals is

$$\alpha = \frac{\int_0^\infty \alpha_\lambda(\lambda) G_\lambda(\lambda) d\lambda}{\int_0^\infty G_\lambda(\lambda) d\lambda}$$

Since the surface is diffuse,  $\alpha_\lambda(\lambda) = \varepsilon_\lambda(\lambda)$ . Moreover, since the spectral distribution of the irradiation approximates that due to emission from a blackbody at 2000 K,  $G_\lambda(\lambda) \propto E_{\lambda,b}(\lambda, T_c)$ . It follows that

$$\alpha = \frac{\int_0^\infty \varepsilon_\lambda(\lambda) E_{\lambda,b}(\lambda, T_c) d\lambda}{\int_0^\infty E_{\lambda,b}(\lambda, T_c) d\lambda}$$

Breaking the integral into parts and introducing the blackbody functions, we then obtain

$$\alpha = \varepsilon_{\lambda,1} F_{(0 \rightarrow \lambda_1)} + \varepsilon_{\lambda,2} [F_{(0 \rightarrow \lambda_2)} - F_{(0 \rightarrow \lambda_1)}] + \varepsilon_{\lambda,3} [1 - F_{(0 \rightarrow \lambda_2)}]$$

From Table 12.1

$$\lambda_1 T_c = 1.5 \mu\text{m} \times 2000 \text{ K} = 3000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow \lambda_1)} = 0.273$$


$$\lambda_2 T_c = 10 \mu\text{m} \times 2000 \text{ K} = 20,000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow \lambda_2)} = 0.986$$

Hence

$$\alpha = 0.1 \times 0.273 + 0.5(0.986 - 0.273) + 0.8(1 - 0.986) = 0.395 \quad \triangleleft$$

### Comments:

1. The emissivity depends on the surface temperature  $T_s$ , while the absorptivity depends on the spectral distribution of the irradiation, which depends on the temperature of the source  $T_c$ .
2. The surface is not gray,  $\alpha \neq \varepsilon$ . This result is to be expected. Since emission is associated with  $T_s = 500 \text{ K}$ , its spectral maximum occurs at  $\lambda_{\max} \approx 6 \mu\text{m}$ . In contrast, since irradiation is associated with emission from a source at  $T_c = 2000 \text{ K}$ , its spectral maximum occurs at  $\lambda_{\max} \approx 1.5 \mu\text{m}$ . Even though  $\varepsilon_\lambda$  and  $\alpha_\lambda$  are equal, because they are not constant over the spectral ranges of both emission and irradiation,  $\alpha \neq \varepsilon$ . For the prescribed spectral distribution of  $\varepsilon_\lambda = \alpha_\lambda$ ,  $\varepsilon$  and  $\alpha$  decrease with increasing  $T_s$  and  $T_c$ , respectively, and it is only for  $T_s = T_c$  that  $\varepsilon = \alpha$ . The foregoing expressions for  $\varepsilon$  and  $\alpha$  may be used to determine their equivalent variation with  $T_s$  and  $T_c$ , and the following result is obtained:

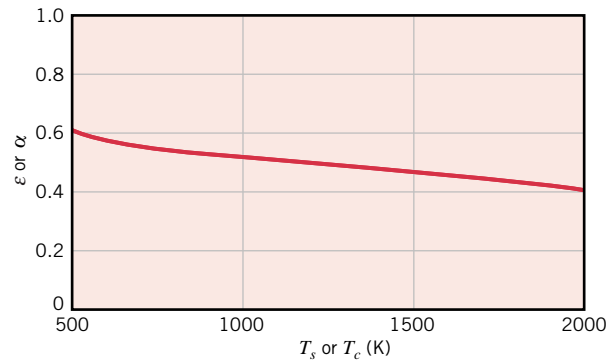

### EXAMPLE 12.10

A *small*, solid metallic sphere has an opaque, diffuse coating for which  $\alpha_\lambda = 0.8$  for  $\lambda \leq 5 \mu\text{m}$  and  $\alpha_\lambda = 0.1$  for  $\lambda > 5 \mu\text{m}$ . The sphere, which is initially at a uniform temperature of 300 K, is inserted into a *large* furnace whose walls are at 1200 K. Determine the total, hemispherical absorptivity and emissivity of the coating for the initial condition and for the final, steady-state condition.


### SOLUTION

**Known:** Small metallic sphere with spectrally selective absorptivity, initially at  $T_s = 300 \text{ K}$ , is inserted into a large furnace at  $T_f = 1200 \text{ K}$ .

**Find:**

1. Total, hemispherical absorptivity and emissivity of sphere coating for the initial condition.
2. Values of  $\alpha$  and  $\varepsilon$  after sphere has been in furnace a long time.

**Schematic:**

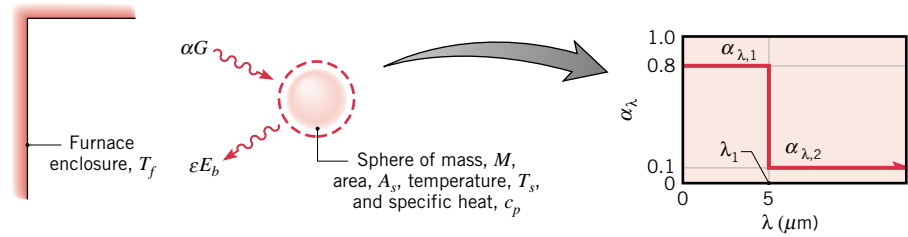

**Assumptions:**

1. Coating is opaque and diffuse.
2. Since furnace surface is much larger than that of sphere, irradiation approximates emission from a blackbody at  $T_f$ .

**Analysis:**

1. From Equation 12.44 the total, hemispherical absorptivity is

$$\alpha = \frac{\int_0^{\infty} \alpha_{\lambda}(\lambda) G_{\lambda}(\lambda) d\lambda}{\int_0^{\infty} G_{\lambda}(\lambda) d\lambda}$$

or, with  $G_{\lambda} = E_{\lambda,b}(T_f) = E_{\lambda,b}(\lambda, 1200 \text{ K})$ ,

$$\alpha = \frac{\int_0^{\infty} \alpha_{\lambda}(\lambda) E_{\lambda,b}(\lambda, 1200 \text{ K}) d\lambda}{E_b(1200 \text{ K})}$$

Hence

$$\alpha = \alpha_{\lambda,1} \frac{\int_0^{\lambda_1} E_{\lambda,b}(\lambda, 1200 \text{ K}) d\lambda}{E_b(1200 \text{ K})} + \alpha_{\lambda,2} \frac{\int_{\lambda_1}^{\infty} E_{\lambda,b}(\lambda, 1200 \text{ K}) d\lambda}{E_b(1200 \text{ K})}$$

or

$$\alpha = \alpha_{\lambda,1} F_{(0 \rightarrow \lambda_1)} + \alpha_{\lambda,2} [1 - F_{(0 \rightarrow \lambda_1)}]$$

From Table 12.1,

$$\lambda_1 T_f = 5 \mu\text{m} \times 1200 \text{ K} = 6000 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow \lambda_1)} = 0.738$$

Hence

$$\alpha = 0.8 \times 0.738 + 0.1 (1 - 0.738) = 0.62$$

The total, hemispherical emissivity follows from Equation 12.36.

$$\varepsilon(T_s) = \frac{\int_0^\infty \varepsilon_\lambda E_{\lambda,b}(\lambda, T_s) d\lambda}{E_b(T_s)}$$

Since the surface is diffuse,  $\varepsilon_\lambda = \alpha_\lambda$  and it follows that

$$\varepsilon = \alpha_{\lambda,1} \frac{\int_0^{\lambda_1} E_{\lambda,b}(\lambda, 300 \text{ K}) d\lambda}{E_b(300 \text{ K})} + \alpha_{\lambda,2} \frac{\int_{\lambda_1}^\infty E_{\lambda,b}(\lambda, 300 \text{ K}) d\lambda}{E_b(300 \text{ K})}$$

or,

$$\varepsilon = \alpha_{\lambda,1} F_{(0 \rightarrow \lambda_1)} + \alpha_{\lambda,2} [1 - F_{(0 \rightarrow \lambda_1)}]$$

From Table 12.1,

$$\lambda_1 T_s = 5 \mu\text{m} \times 300 \text{ K} = 1500 \mu\text{m} \cdot \text{K}: \quad F_{(0 \rightarrow \lambda_1)} = 0.014$$

Hence

$$\varepsilon = 0.8 \times 0.014 + 0.1 (1 - 0.014) = 0.11$$



2. Because the spectral characteristics of the coating and the furnace temperature remain fixed, there is no change in the value of  $\alpha$  with increasing time. However, as  $T_s$  increases with time, the value of  $\varepsilon$  will change. After a sufficiently long time,  $T_s = T_f$ , and  $\varepsilon = \alpha$  ( $\varepsilon = 0.62$ ).

### Comments:

1. The equilibrium condition that eventually exists ( $T_s = T_f$ ) corresponds precisely to the condition for which Kirchhoff's law was derived. Hence  $\alpha$  must equal  $\varepsilon$ .
2. Approximating the sphere as a lumped capacitance and neglecting convection, an energy balance for a control volume about the sphere yields

$$\begin{aligned} \dot{E}_{\text{in}} - \dot{E}_{\text{out}} &= \dot{E}_{\text{st}} \\ (\alpha G)A_s - (\varepsilon \sigma T_s^4)A_s &= M c_p \frac{dT_s}{dt} \end{aligned}$$

The differential equation could be solved to determine  $T(t)$  for  $t > 0$ , and the variation in  $\varepsilon$  that occurs with increasing time would have to be included in the solution.

## 12.8

### Environmental Radiation

It would be inappropriate to conclude this chapter without commenting on the radiation that comprises our natural environment. Solar radiation is, of course, essential

to all life on earth. Through the process of photosynthesis, it satisfies our need for food, fiber, and fuel. Moreover, through thermal and photovoltaic processes, it has the potential to satisfy much of our demand for space heat, process heat, and electricity.


The sun is a nearly spherical radiation source that is  $1.39 \times 10^9$  m in diameter and is located  $1.50 \times 10^{11}$  m from the earth. As noted previously, the sun emits approximately as a blackbody at 5800 K. As the radiation emitted by the sun travels through space, the radiation flux decreases because of the greater (spherical) area through which it passes. At the outer edge of the earth's atmosphere, the flux of solar energy has decreased by a factor of  $(r_s/r_d)^2$ , where  $r_s$  is the radius of the sun and  $r_d$  is the distance from the sun to the earth. The *solar constant*,  $S_c$ , is defined as the flux of solar energy incident on a surface oriented *normal* to the sun's rays, at the outer edge of the earth's atmosphere, when the earth is at its mean distance from the sun (Figure 12.27). It has a value of  $S_c = 1353 \text{ W/m}^2$ . For a *horizontal* surface (that is, parallel to earth's surface), solar radiation appears as a beam of nearly *parallel* rays that form an angle  $\theta$ , the *zenith angle*, relative to the surface normal. The *extraterrestrial solar irradiation*  $G_{s,o}$ , defined for a horizontal surface, depends on the geographic latitude, as well as the time of day and year. It may be determined from an expression of the form

$$G_{s,o} = S_c \cdot f \cdot \cos \theta \quad (12.65)$$

The quantity  $f$  is a small correction factor to account for the eccentricity of the earth's orbit about the sun ( $0.97 \lesssim f \lesssim 1.03$ ).


The spectral distribution of solar radiation is significantly different from that associated with emission by engineering surfaces. As shown in Figure 12.28, the extraterrestrial distribution approximates that of a blackbody at 5800 K. The radiation is concentrated in the low wavelength region ( $0.2 \lesssim \lambda \lesssim 3 \mu\text{m}$ ) of the thermal spectrum, with the peak occurring at approximately  $0.50 \mu\text{m}$ . It is this short wavelength concentration that frequently precludes the assumption of graybody behavior for solar irradiated surfaces, since emission is generally in the spectral region beyond  $4 \mu\text{m}$  and it is unlikely that surface spectral properties would be constant over such a wide spectral range.

As solar radiation passes through the earth's atmosphere, its magnitude and its spectral and directional distributions experience significant change. The change is due to *absorption* and *scattering* of the radiation by the atmospheric constituents. The effect of absorption by the atmospheric gases  $\text{O}_3$  (ozone),  $\text{H}_2\text{O}$ ,  $\text{O}_2$ , and  $\text{CO}_2$  is shown by the lower curve of Figure 12.28. Absorption by ozone is strong in the UV

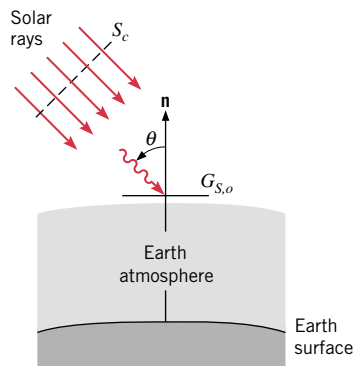

**FIGURE 12.27**

Directional nature of solar radiation outside the earth's atmosphere.

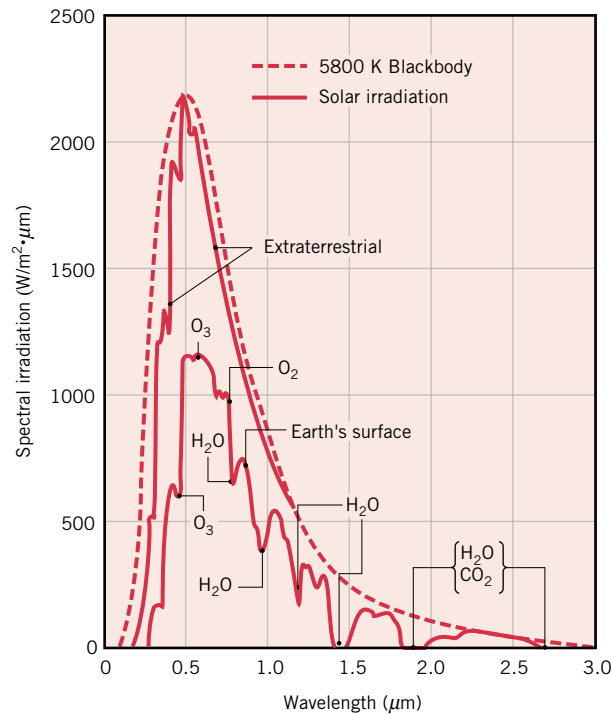


**FIGURE 12.28** Spectral distribution of solar radiation.

region, providing considerable attenuation below  $0.4 \mu\text{m}$  and complete attenuation below  $0.3 \mu\text{m}$ . In the visible region there is some absorption by  $\text{O}_3$  and  $\text{O}_2$ ; and in the near and far IR regions, absorption is dominated by water vapor. Throughout the solar spectrum, there is also continuous absorption of radiation by the dust and aerosol content of the atmosphere.

Atmospheric scattering provides for *redirection* of the sun's rays and consists of two kinds (Figure 12.29). *Rayleigh* (or *molecular*) *scattering* by very small gas molecules occurs when the ratio of the effective molecule diameter to the wavelength of the radiation,  $\pi D/\lambda$ , is much less than unity and provides for nearly uniform scattering of radiation in all directions. Hence approximately half of the scattered radiation is redirected to space, while the remaining portion strikes the earth's surface. At any point on this surface, the scattered radiation is incident from all directions. In contrast, *Mie scattering* by larger dust and aerosol particles of the atmosphere occurs when  $\pi D/\lambda$  is approximately unity and is concentrated in directions that are close to that of the incident rays. Hence virtually all this radiation strikes the earth's surface in directions close to that of the sun's rays.

The cumulative effect of the scattering processes on the directional distribution of solar radiation striking the earth's surface is shown in Figure 12.30a. That portion of the radiation that has penetrated the atmosphere without having been scattered (or absorbed) is in the direction of the zenith angle and is termed the *direct radiation*. The scattered radiation is incident from all directions, although its intensity is largest for directions close to that of the direct radiation. However, because the radiation intensity is often *assumed* to be independent of direction (Figure 12.30b),

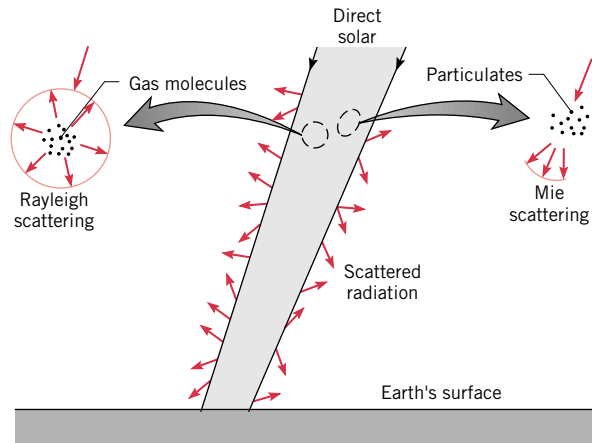

**FIGURE 12.29** Scattering of solar radiation in the earth's atmosphere.


the radiation is termed *diffuse*. The total solar radiation reaching the earth's surface is therefore the sum of direct and diffuse contributions. The diffuse contribution may vary from approximately 10% of the total solar radiation on a clear day to nearly 100% on a totally overcast day.

The foregoing discussion has focused on the *nature* of solar radiation. Heat transfer analyses related to its use are considered in many of the examples and problems of the text. Detailed treatment of solar energy technologies is left to the literature [7–11].

Long wavelength forms of environmental radiation include emission from the earth's surface, as well as emission from certain atmospheric constituents. The emissive power associated with the earth's surface may be computed in the conventional manner. That is,

$$E = \varepsilon \sigma T^4 \quad (12.66)$$

where  $\varepsilon$  and  $T$  are the surface emissivity and temperature, respectively. Emissivities are generally close to unity, and that of water, for example, is approximately 0.97.

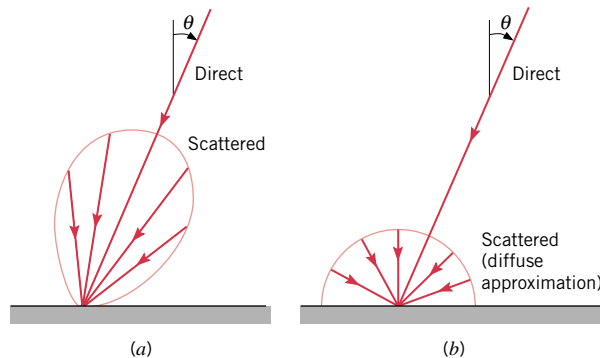

**FIGURE 12.30** Directional distribution of solar radiation at the earth's surface. (a) Actual distribution. (b) Diffuse approximation.



**TABLE 12.2** Solar Absorptivity  $\alpha_s$  and Emissivity  $\varepsilon$  of Surfaces Having Spectral Absorptivity Given in Figure 12.22

Surface	$\alpha_s$	$\varepsilon$ (300 K)	$\alpha_s/\varepsilon$
Evaporated aluminum film	0.09	0.03	3.0
Fused quartz on aluminum film	0.19	0.81	0.24
White paint on metallic substrate	0.21	0.96	0.22
Black paint on metallic substrate	0.97	0.97	1.0
Stainless steel, as received, dull	0.50	0.21	2.4
Red brick	0.63	0.93	0.68
Human skin (Caucasian)	0.62	0.97	0.64
Snow	0.28	0.97	0.29
Corn leaf	0.76	0.97	0.78

Since temperatures typically range from 250 to 320 K, emission is concentrated in the spectral region from approximately 4 to 40  $\mu\text{m}$ , with the peak occurring at approximately 10  $\mu\text{m}$ .

Atmospheric emission is largely from the  $\text{CO}_2$  and  $\text{H}_2\text{O}$  molecules and is concentrated in the spectral regions from 5 to 8  $\mu\text{m}$  and above 13  $\mu\text{m}$ . Although the spectral distribution of atmospheric emission does not correspond to that of a black-body, its contribution to irradiation of the earth's surface can be estimated using Equation 12.26. In particular, earth irradiation due to atmospheric emission may be expressed in the form

$$G_{\text{atm}} = \sigma T_{\text{sky}}^4 \quad (12.67)$$

where  $T_{\text{sky}}$  is termed the effective sky temperature. Its value depends on atmospheric conditions, ranging from a low of 230 K under a cold, clear sky to a high of approximately 285 K under warm, cloudy conditions. At night, atmospheric emission is the only source of earth irradiation. When its value is small, as on a cool, clear night, an exposed pool of water may freeze even though the air temperature exceeds 273 K.

We close by recalling that values of the spectral properties of a surface at short wavelengths may be appreciably different from values at long wavelengths (Figures 12.17 and 12.22). Since solar radiation is concentrated in the short wavelength region of the spectrum and surface emission is at much longer wavelengths, it follows that many surfaces may not be approximated as gray in their response to solar irradiation. In other words, the solar absorptivity of a surface  $\alpha_s$  may differ from its emissivity  $\varepsilon$ . Values of  $\alpha_s$  and the emissivity at moderate temperatures are presented in Table 12.2 for representative surfaces. Note that the ratio  $\alpha_s/\varepsilon$  is an important engineering parameter. Small values are desired if the surface is intended to reject heat; large values are required if the surface is intended to collect solar energy.

### EXAMPLE 12.11

A flat-plate solar collector with no cover plate has a selective absorber surface of emissivity 0.1 and solar absorptivity 0.95. At a given time of day the absorber surface

temperature  $T_s$  is  $120^\circ\text{C}$  when the solar irradiation is  $750\text{ W/m}^2$ , the effective sky temperature is  $-10^\circ\text{C}$ , and the ambient air temperature  $T_\infty$  is  $30^\circ\text{C}$ . Assume that the heat transfer convection coefficient for the calm day conditions can be estimated from

$$\bar{h} = 0.22(T_s - T_\infty)^{1/3} \text{ W/m}^2 \cdot \text{K}$$

Calculate the useful heat removal rate ( $\text{W/m}^2$ ) from the collector for these conditions. What is the corresponding efficiency of the collector?


### SOLUTION

**Known:** Operating conditions for a flat-plate solar collector.

**Find:**

1. Useful heat removal rate per unit area,  $q_u''$  ( $\text{W/m}^2$ ).
2. Efficiency  $\eta$  of the collector.

**Schematic:**

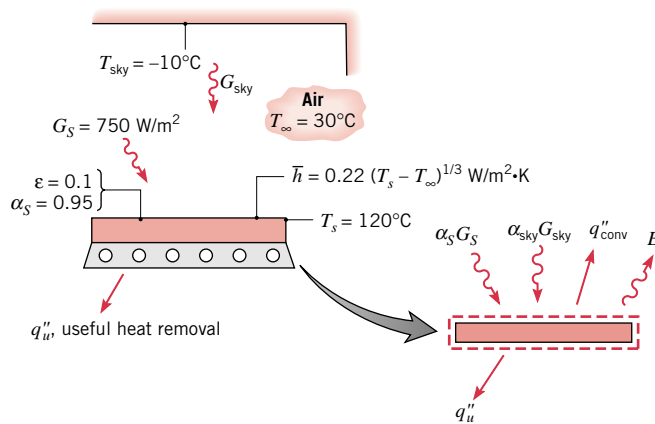

**Assumptions:**

1. Steady-state conditions.
2. Bottom of collector well insulated.
3. Absorber surface diffuse.

**Analysis:**

1. Performing an energy balance on the absorber,

$$\dot{E}_{\text{in}} - \dot{E}_{\text{out}} = 0$$

or, per unit surface area,

$$\alpha_s G_s + \alpha_{\text{sky}} G_{\text{sky}} - q_{\text{conv}}'' - E - q_u'' = 0$$

From Equation 12.67,

$$G_{\text{sky}} = \sigma T_{\text{sky}}^4$$

Since the sky radiation is concentrated in approximately the same spectral region as that of surface emission, it is reasonable to assume that

$$\alpha_{\text{sky}} \approx \varepsilon = 0.1$$

With

$$q''_{\text{conv}} = \bar{h}(T_s - T_\infty) = 0.22 (T_s - T_\infty)^{4/3} \quad \text{and} \quad E = \varepsilon \sigma T_s^4$$

it follows that

$$q''_u = \alpha_s G_s + \varepsilon \sigma T_{\text{sky}}^4 - 0.22(T_s - T_\infty)^{4/3} - \varepsilon \sigma T_s^4$$

$$q''_u = \alpha_s G_s - 0.22(T_s - T_\infty)^{4/3} - \varepsilon \sigma (T_s^4 - T_{\text{sky}}^4)$$

$$q''_u = 0.95 \times 750 \text{ W/m}^2 - 0.22(120 - 30)^{4/3} \text{ W/m}^2 \\ - 0.1 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (393^4 - 263^4) \text{ K}^4$$

$$q''_u = (712.5 - 88.7 - 108.1) \text{ W/m}^2 = 516 \text{ W/m}^2 \quad \triangleleft$$

2. The collector efficiency, defined as the fraction of the solar irradiation extracted as useful energy, is then

$$\eta = \frac{q''_u}{G_s} = \frac{516 \text{ W/m}^2}{750 \text{ W/m}^2} = 0.69 \quad \triangleleft$$

### Comments:

1. Since the spectral range of  $G_{\text{sky}}$  is entirely different from that of  $G_s$ , it would be *incorrect* to assume that  $\alpha_{\text{sky}} = \alpha_s$ .
2. The convection heat transfer coefficient is extremely low ( $\bar{h} \approx 1 \text{ W/m}^2 \cdot \text{K}$ ). With a modest increase to  $\bar{h} = 5 \text{ W/m}^2 \cdot \text{K}$ , the useful heat flux and the efficiency are reduced to  $q''_u = 154 \text{ W/m}^2$  and  $\eta = 0.21$ . A cover plate can contribute significantly to reducing convection (and radiation) heat loss from the absorber plate.

## 12.9

### Summary

Many new and important ideas have been introduced in this chapter, and at this stage you may well be confused, particularly by the terminology. However, the subject matter has been developed in a systematic fashion, and a careful rereading of the material should make you more comfortable with its application. A glossary has been provided in Table 12.3 to assist you in assimilating the terminology.

**TABLE 12.3** Glossary of Radiative Terms

Term	Definition
Absorption	The process of converting radiation intercepted by matter to internal thermal energy.
Absorptivity	Fraction of the incident radiation absorbed by matter. Equations 12.39, 12.40, and 12.43. Modifiers: <i>directional</i> , <i>hemispherical</i> , <i>spectral</i> , <i>total</i> .
Blackbody	The ideal emitter and absorber. Modifier referring to ideal behavior. Denoted by the subscript <i>b</i> .
Diffuse	Modifier referring to the directional independence of the intensity associated with emitted, reflected, or incident radiation.
Directional	Modifier referring to a particular direction. Denoted by the subscript $\theta$ .
Directional distribution	Refers to variation with direction.
Emission	The process of radiation production by matter at a finite temperature. Modifiers: <i>diffuse</i> , <i>blackbody</i> , <i>spectral</i> .
Emissive power	Rate of radiant energy emitted by a surface in all directions per unit area of the surface, $E$ (W/m <sup>2</sup> ). Modifiers: <i>spectral</i> , <i>total</i> , <i>blackbody</i> .
Emissivity	Ratio of the radiation emitted by a surface to the radiation emitted by a blackbody at the same temperature. Equations 12.30, 12.31, 12.32, and 12.35. Modifiers: <i>directional</i> , <i>hemispherical</i> , <i>spectral</i> , <i>total</i> .
Gray surface	A surface for which the spectral absorptivity and the emissivity are independent of wavelength over the spectral regions of surface irradiation and emission.
Hemispherical	Modifier referring to all directions in the space above a surface.
Intensity	Rate of radiant energy propagation in a particular direction, per unit area normal to the direction, per unit solid angle about the direction, $I$ (W/m <sup>2</sup> · sr). Modifier: <i>spectral</i> .
Irradiation	Rate at which radiation is incident on a surface from all directions per unit area of the surface, $G$ (W/m <sup>2</sup> ). Modifiers: <i>spectral</i> , <i>total</i> , <i>diffuse</i> .
Kirchhoff's law	Relation between emission and absorption properties for surfaces irradiated by a blackbody at the same temperature. Equations 12.59, 12.60, 12.61, and 12.62.
Planck's law	Spectral distribution of emission from a blackbody. Equations 12.23 and 12.24.
Radiosity	Rate at which radiation leaves a surface due to emission and reflection in all directions per unit area of the surface, $J$ (W/m <sup>2</sup> ). Modifiers: <i>spectral</i> , <i>total</i> .
Reflection	The process of redirection of radiation incident on a surface. Modifiers: <i>diffuse</i> , <i>specular</i> .
Reflectivity	Fraction of the incident radiation reflected by matter. Equations 12.46, 12.47, and 12.49. Modifiers: <i>directional</i> , <i>hemispherical</i> , <i>spectral</i> , <i>total</i> .

TABLE 12.3 Continued

Term	Definition
Semitransparent	Refers to a medium in which radiation absorption is a volumetric process.
Solid angle	Region subtended by an element of area on the surface of a sphere with respect to the center of the sphere, $\omega$ (sr). Equations 12.2 and 12.3.
Spectral	Modifier referring to a single-wavelength (monochromatic) component. Denoted by the subscript $\lambda$ .
Spectral distribution	Refers to variation with wavelength.
Specular	Refers to a surface for which the angle of reflected radiation is equal to the angle of incident radiation.
Stefan–Boltzmann law	Emissive power of a blackbody. Equation 12.26.
Thermal radiation	Electromagnetic energy emitted by matter at a finite temperature and concentrated in the spectral region from approximately 0.1 to 100 $\mu\text{m}$ .
Total	Modifier referring to all wavelengths.
Transmission	The process of thermal radiation passing through matter.
Transmissivity	Fraction of the incident radiation transmitted by matter. Equations 12.51 and 12.52. Modifiers: <i>hemispherical</i> , <i>spectral</i> , <i>total</i> .
Wien’s law	Locus of the wavelength corresponding to peak emission by a blackbody. Equation 12.25.

Test your understanding of the terms and concepts introduced in this chapter by addressing the following questions.

- What is the nature of radiation? What two important features characterize radiation?
- What is the physical origin of radiation *emission* from a surface? How does emission affect the thermal energy of a material?
- In what region of the electromagnetic spectrum is *thermal radiation* concentrated?
- What is the *spectral intensity* of radiation emitted by a surface? On what variables does it depend? How may knowledge of this dependence be used to determine the rate at which matter loses thermal energy due to emission from its surface?
- What is a *steradian*? How many steradians are associated with a hemisphere?
- What is the distinction between *spectral* and *total* radiation? Between *directional* and *hemispherical* radiation?
- What is *total emissive power*? What role does it play in a surface energy balance?
- What is a *diffuse emitter*? For such an emitter, how is the intensity related to the total emissive power?

- What is *irradiation*? How is it related to the intensity of incident radiation, if the radiation is diffuse?
- What is *radiosity*? What role do the total radiosity and the total irradiation play in a surface energy balance?
- What are the characteristics of a *blackbody*? Does such a thing actually exist in nature? What is the principal role of blackbody behavior in radiation analysis?
- What is the *Planck distribution*? What is *Wien's displacement law*?
- From memory, sketch the spectral distribution of radiation emission from a blackbody at three temperatures,  $T_1 < T_2 < T_3$ . Identify salient features of the distributions.
- In what region of the electromagnetic spectrum is radiation emission from a surface at room temperature concentrated? What is the spectral region of concentration for a surface at 1000°C? For the surface of the sun?
- What is the *Stefan–Boltzmann law*? How would you determine the total intensity of radiation emitted by a blackbody at a prescribed temperature?
- How would you approximate the total irradiation of a small surface in a large isothermal enclosure?
- In the term *total, hemispherical emissivity*, to what do the adjectives *total* and *hemispherical* refer?
- How does the directional emissivity of a material change as the zenith angle associated with emission approaches 90°?
- If the spectral emissivity of a material increases with increasing wavelength, how does its total emissivity vary with temperature?
- What is larger, the emissivity of a polished metal or an oxidized metal? A refractory brick or ice?
- What processes accompany irradiation of a *semitransparent* material? An *opaque* material?
- Are glass and water semitransparent or opaque materials?
- How is the perceived color of a material determined by its response to irradiation in the infrared portion of the spectrum? How is its color affected by its temperature?
- Can snow be thought of as a good absorber or reflector of incident radiation?
- How is the thermal energy of a material affected by the absorption of incident radiation? By the reflection of incident radiation?
- Can the total absorptivity of an opaque surface at a fixed temperature differ according to whether irradiation is from a source at room temperature or from the sun? Can its reflectivity differ? Its emissivity?
- What is a *diffuse reflector*? A *specular reflector*? How does the roughness of a surface affect the nature of reflection for the surface?
- Under what conditions is there equivalence between the spectral, directional emissivity of a surface and the spectral, directional absorptivity? The spectral, hemispherical emissivity and the spectral, hemispherical absorptivity? The total, hemispherical emissivity and the total, hemispherical absorptivity?
- What is a *gray surface*?
- What is the directional nature of solar radiation outside the earth's atmosphere? At the surface of the earth?
- What are representative values of the total, hemispherical emissivity for constituents of the natural environment, such as vegetation, water, and ice?
- What is *sky radiation*?


## References

1. Planck, M., *The Theory of Heat Radiation*, Dover Publications, New York, 1959.
2. Gubareff, G. G., J. E. Janssen, and R. H. Torberg, *Thermal Radiation Properties Survey*, 2nd ed., Honeywell Research Center, Minneapolis, 1960.
3. Wood, W. D., H. W. Deem, and C. F. Lucks, *Thermal Radiative Properties*, Plenum Press, New York, 1964.
4. Touloukian, Y. S., *Thermophysical Properties of High Temperature Solid Materials*, Macmillan, New York, 1967.
5. Touloukian, Y. S., and D. P. DeWitt, *Thermal Radiative Properties*, Vols. 7, 8, and 9, from *Thermophysical Properties of Matter*, TPRC Data Series, Y. S. Touloukian and C. Y. Ho, Eds., IFI Plenum, New York, 1970–1972.
6. Siegel, R., and J. R. Howell, *Thermal Radiation Heat Transfer*, 4th ed., Taylor & Francis, New York, 2002.
7. Duffie, J. A., and W. A. Beckman, *Solar Engineering of Thermal Processes*, 2nd ed., Wiley, New York, 1991.
8. Meinel, A. B., and M. P. Meinel, *Applied Solar Energy: An Introduction*, Addison-Wesley, Reading, MA, 1976.
9. Sayigh, A. A. M., Ed., *Solar Energy Engineering*, Academic Press, New York, 1977.
10. Goswami, D. Y., F. Kreith, and J. F. Kreider, *Principles of Solar Energy*, 2nd ed., Taylor & Francis, New York, 2002.
11. Howell, J. R., R. B. Bannerot, and G. C. Vliet, *Solar-Thermal Energy Systems, Analysis and Design*, McGraw-Hill, New York, 1982.

## Problems


### Intensity, Emissive Power, and Irradiation

- 12.1** What is the irradiation at surfaces  $A_2$ ,  $A_3$ , and  $A_4$  of Example 12.1 due to emission from  $A_1$ ?
- 12.2** Consider a small surface of area  $A_1 = 10^{-4} \text{ m}^2$ , which emits diffusely with a total, hemispherical emissive power of  $E_1 = 5 \times 10^4 \text{ W/m}^2$ .

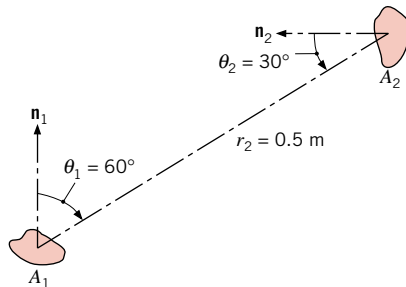

- (a) At what rate is this emission intercepted by a small surface of area  $A_2 = 5 \times 10^{-4} \text{ m}^2$ , which is oriented as shown?
  - (b) What is the irradiation  $G_2$  on  $A_2$ ?
  - (c) For zenith angles of  $\theta_2 = 0, 30$ , and  $60^\circ$ , plot  $G_2$  as a function of the separation distance for  $0.25 \leq r_2 \leq 1.0 \text{ m}$ .
- 12.3** A small stationary surface of area  $A_1 = 10^{-4} \text{ m}^2$  emits diffusely with a total intensity of  $I_e = 100 \text{ W/m}^2 \cdot \text{sr}$ . A second surface of equivalent area  $A_2 = 10^{-4} \text{ m}^2$  is located at a fixed distance of  $r = 0.5 \text{ m}$  from  $A_1$ . The connecting line between the two surfaces remains perpendicular


to  $A_1$ , while  $A_2$  rotates at an angular frequency of  $\dot{\theta}_2 = d\theta_2/dt = 2 \text{ rad/s}$ .

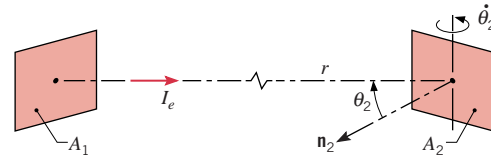

What is the amount of energy intercepted by the two sides of  $A_2$ , during one complete revolution?


- 12.4** A furnace with an aperture of 20-mm diameter and emissive power of  $3.72 \times 10^5 \text{ W/m}^2$  is used to calibrate a heat flux gage having a sensitive area of  $1.6 \times 10^{-5} \text{ m}^2$ .
- (a) At what distance, measured along a normal from the aperture, should the gage be positioned to receive irradiation of  $1000 \text{ W/m}^2$ ?
  - (b) If the gage is tilted off normal by  $20^\circ$ , what will be its irradiation?
  - (c) For tilt angles of  $0, 20$ , and  $60^\circ$ , plot the gage irradiation as a function of the separation distance for values ranging from 100 to 300 mm.
- 12.5** A small radiant source  $A_1$  emits diffusely with an intensity  $I_1 = 1.2 \times 10^5 \text{ W/m}^2 \cdot \text{sr}$ . The radiation detector  $A_2$  is aligned normal to the source at a distance of  $L_o = 0.2 \text{ m}$ . An opaque screen is positioned midway between  $A_1$  and  $A_2$  to prevent radiation from the source reaching the detector. The small surface  $A_m$  is a perfectly diffuse

mirror that permits radiation emitted from the source to be reflected into the detector.

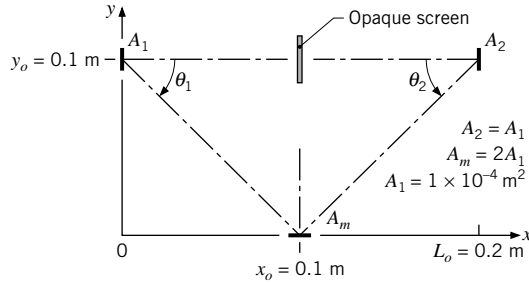

- Calculate the radiant power incident on  $A_m$  due to emission from the source  $A_1$ ,  $q_{1 \rightarrow m}$  (W).
- Assuming that the radiant power,  $q_{1 \rightarrow m}$ , is perfectly and diffusely reflected, calculate the intensity leaving  $A_m$ ,  $I_m$  ( $\text{W/m}^2 \cdot \text{sr}$ ).
- Calculate the radiant power incident on  $A_2$  due to the reflected radiation leaving  $A_m$ ,  $q_{m \rightarrow 2}$  ( $\mu\text{W}$ ).
- Plot the radiant power  $q_{m \rightarrow 2}$  as a function of the lateral separation distance  $y_o$  for the range  $0 \leq y_o \leq 0.2$  m. Explain the features of the resulting curve.

- 12.6** According to its directional distribution, solar radiation incident on the earth's surface may be divided into two components. The *direct* component consists of parallel rays incident at a fixed zenith angle  $\theta$ , while the *diffuse* component consists of radiation that may be approximated as being diffusely distributed with  $\theta$ .

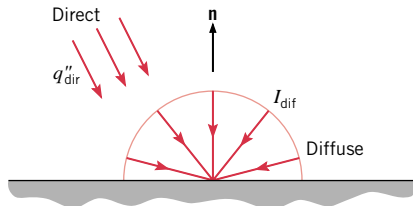


Consider clear sky conditions for which the direct radiation is incident at  $\theta = 30^\circ$ , with a total flux (based on an area that is normal to the rays) of  $q''_{\text{dir}} = 1000 \text{ W/m}^2$ , and the total intensity of the diffuse radiation is  $I_{\text{dif}} = 70 \text{ W/m}^2 \cdot \text{sr}$ . What is the total solar irradiation at the earth's surface?


- 12.7** Solar radiation incident on the earth's surface may be divided into the direct and diffuse components described in Problem 12.6. Consider conditions for a day in which the intensity of the direct solar radiation is  $I_{\text{dir}} = 2.10 \times 10^7 \text{ W/m}^2 \cdot \text{sr}$  in the solid angle subtended by the sun with respect to the earth,

$\Delta\omega_s = 6.74 \times 10^{-5} \text{ sr}$ . The intensity of the diffuse radiation is  $I_{\text{dif}} = 70 \text{ W/m}^2 \cdot \text{sr}$ .

- What is the total solar irradiation at the earth's surface when the direct radiation is incident at  $\theta = 30^\circ$ ?
  - Verify the prescribed value for  $\Delta\omega_s$ , recognizing that the diameter of the sun is  $1.39 \times 10^9 \text{ m}$  and the distance between the sun and the earth is  $1.496 \times 10^{11} \text{ m}$  (1 astronomical unit).
- 12.8** On an overcast day the directional distribution of the solar radiation incident on the earth's surface may be approximated by an expression of the form  $I_i = I_n \cos \theta$ , where  $I_n = 80 \text{ W/m}^2 \cdot \text{sr}$  is the total intensity of radiation directed normal to the surface and  $\theta$  is the zenith angle. What is the solar irradiation at the earth's surface?
- 12.9** Determine the fraction of the total, hemispherical emissive power that leaves a diffuse surface in the directions  $\pi/4 \leq \theta \leq \pi/2$  and  $0 \leq \phi \leq \pi$ .
- 12.10** The spectral distribution of the radiation emitted by a diffuse surface may be approximated as follows.

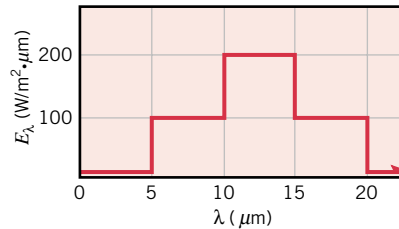

- What is the total emissive power?
  - What is the total intensity of the radiation emitted in the normal direction and at an angle of  $30^\circ$  from the normal?
  - Determine the fraction of the emissive power leaving the surface in the directions  $\pi/4 \leq \theta \leq \pi/2$ .
- 12.11** Consider a 5-mm-square, diffuse surface  $\Delta A_o$  having a total emissive power of  $E_o = 4000 \text{ W/m}^2$ . The radiation

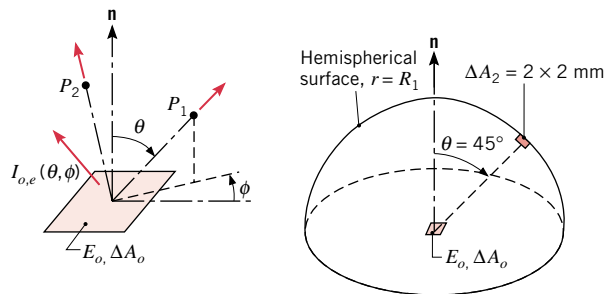




field due to emission into the hemispherical space above the surface is diffuse, thereby providing a uniform intensity  $I(\theta, \phi)$ . Moreover, if the space is a non-participating medium (nonabsorbing, nonscattering, and nonemitting), the intensity is independent of radius for any  $(\theta, \phi)$  direction. Hence intensities at any points  $P_1$  and  $P_2$  would be equal.

- What is the rate at which radiant energy is emitted by  $\Delta A_o$ ,  $q_{\text{emit}}$ ?
- What is the intensity  $I_{o,e}$  of the radiation field emitted from the surface  $\Delta A_o$ ?
- Beginning with Equation 12.8 and presuming knowledge of the intensity  $I_{o,e}$ , obtain an expression for  $q_{\text{emit}}$ .
- Consider the hemispherical surface located at  $r = R_1 = 0.5$  m. Using the conservation of energy requirement, determine the rate at which radiant energy is incident on this surface due to emission from  $\Delta A_o$ .
- Using Equation 12.6, determine the rate at which radiant energy leaving  $\Delta A_o$  is intercepted by the small area  $\Delta A_2$  located in the direction  $(45^\circ, \phi)$  on the hemispherical surface. What is the irradiation on  $\Delta A_2$ ?
- Repeat part (e) for the location  $(0^\circ, \phi)$ . Are the irradiations at the two locations equal?
- Using Equation 12.13, determine the irradiation  $G_1$  on the hemispherical surface at  $r = R_1$ .


**12.12** During radiant heat treatment of a thin-film material, its shape, which may be hemispherical (a) or spherical (b), is maintained by a relatively low air pressure (as in the case of a rubber balloon). Irradiation on the film is due to emission from a radiant heater of area  $A_h = 0.0052$  m<sup>2</sup>, which emits diffusely with an intensity of  $I_{e,h} = 169,000$  W/m<sup>2</sup> · sr.

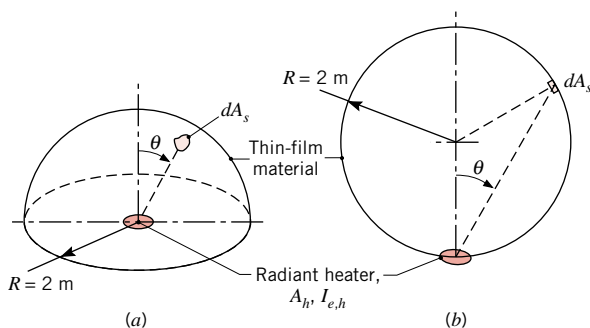

- Obtain an expression for the irradiation on the film as a function of the zenith angle  $\theta$ .


- Based on the expressions derived in part (a), which shape provides the more uniform irradiation  $G$  and hence provides better quality control for the treatment process?

**12.13** In order to initiate a process operation, an infrared motion sensor (radiation detector) is employed to determine the approach of a hot part on a conveyor system. To set the sensor's amplifier discriminator, the engineer needs a relationship between the sensor output signal,  $S$ , and the position of the part on the conveyor. The sensor output signal is proportional to the rate at which radiation is incident on the sensor.

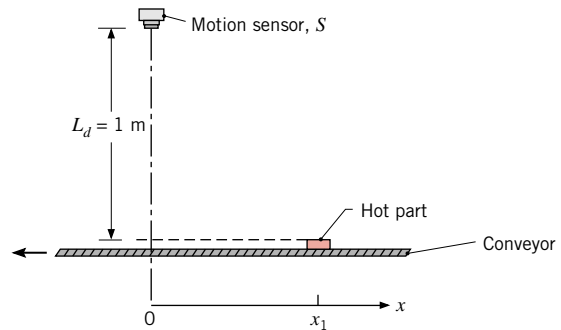

- For  $L_d = 1$  m, at what location  $x_1$  will the sensor signal  $S_1$  be 75% of the signal corresponding to the position directly beneath the sensor,  $S_o$  ( $x = 0$ )?
- For values of  $L_d = 0.8, 1.0$ , and  $1.2$  m, plot the signal ratio,  $S/S_o$ , versus part position,  $x$ , for signal ratios in the range from 1.0 to 0.2. Compare the  $x$ -locations for which  $S/S_o = 0.75$ .

**12.14** A small radiant heat source of area  $A_1 = 2 \times 10^{-4}$  m<sup>2</sup> emits diffusely with an intensity  $I_1 = 1000$  W/m<sup>2</sup> · sr. A second small area,  $A_2 = 1 \times 10^{-4}$  m<sup>2</sup>, is located as shown in the sketch.

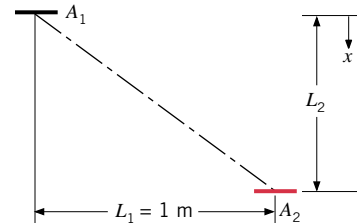


- Determine the irradiation of  $A_2$  for  $L_2 = 0.5$  m.
- Plot the irradiation of  $A_2$  over the range  $0 \leq L_2 \leq 10$  m.

## Blackbody Radiation

**12.15** Assuming blackbody behavior, determine the temperature of, and the energy emitted by, areas  $A_1$  in Example

12.1 and Problems 12.3, 12.5, and 12.14, as well as area  $A_h$  in Problem 12.12.

- 12.16** The dark surface of a ceramic stove top may be approximated as a blackbody. The “burners,” which are integral with the stove top, are heated from below by electric resistance heaters.

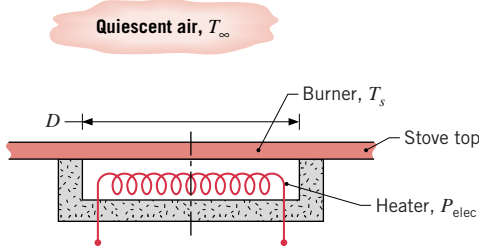

- (a) Consider a burner of diameter  $D = 200$  mm operating at a uniform surface temperature of  $T_s = 250^\circ\text{C}$  in ambient air at  $T_\infty = 20^\circ\text{C}$ . Without a pot or pan on the burner, what are the rates of heat loss by radiation and convection from the burner? If the efficiency associated with energy transfer from the heaters to the burners is 90%, what is the electric power requirement? At what wavelength is the spectral emission a maximum?
- (b) Compute and plot the effect of the burner temperature on the heat rates for  $100 \leq T_s \leq 350^\circ\text{C}$ .
- 12.17** A spherical aluminum shell of inside diameter  $D = 2$  m is evacuated and is used as a radiation test chamber. If the inner surface is coated with carbon black and maintained at 600 K, what is the irradiation on a small test surface placed in the chamber? If the inner surface were not coated and maintained at 600 K, what would the irradiation be?
- 12.18** An enclosure has an inside area of  $100\text{ m}^2$ , and its inside surface is black and is maintained at a constant temperature. A small opening in the enclosure has an area of  $0.02\text{ m}^2$ . The radiant power emitted from this opening is 70 W. What is the temperature of the interior enclosure wall? If the interior surface is maintained at this temperature, but is now polished, what will be the value of the radiant power emitted from the opening?
- 12.19** Assuming the earth's surface is black, estimate its temperature if the sun has an equivalent blackbody temperature of 5800 K. The diameters of the sun and earth are  $1.39 \times 10^9$  and  $1.29 \times 10^7$  m, respectively, and the distance between the sun and earth is  $1.5 \times 10^{11}$  m.
- 12.20** The energy flux associated with solar radiation incident on the outer surface of the earth's atmosphere has been accurately measured and is known to be  $1353\text{ W/m}^2$ . The diameters of the sun and earth are  $1.39 \times 10^9$  and  $1.29 \times 10^7$  m, respectively, and the distance between the sun and the earth is  $1.5 \times 10^{11}$  m.
- (a) What is the emissive power of the sun?
- (b) Approximating the sun's surface as black, what is its temperature?
- (c) At what wavelength is the spectral emissive power of the sun a maximum?
- (d) Assuming the earth's surface to be black and the sun to be the only source of energy for the earth, estimate the earth's surface temperature.
- 12.21** A small flat plate is positioned just beyond the earth's atmosphere and is oriented such that the normal to the plate passes through the center of the sun. Refer to Problem 12.20 for pertinent earth-sun dimensions.
- (a) What is the solid angle subtended by the sun about a point on the surface of the plate?
- (b) Determine the incident intensity,  $I_i$ , on the plate using the known value of the solar irradiation above the earth's atmosphere ( $G_s = 1353\text{ W/m}^2$ ).
- (c) Sketch the incident intensity  $I_i$  as a function of the zenith angle  $\theta$ , where  $\theta$  is measured from the normal to the plate.
- 12.22** Estimate the wavelength corresponding to maximum emission from each of the following surfaces: the sun, a tungsten filament at 2500 K, a heated metal at 1500 K, human skin at 305 K, and a cryogenically cooled metal surface at 60 K. Estimate the fraction of the solar emission that is in the following spectral regions: the ultraviolet, the visible, and the infrared.
- 12.23** The human eye, as well as the light-sensitive chemicals on color photographic film, respond differently to lighting sources with different spectral distributions. *Daylight* lighting corresponds to the spectral distribution of the solar disk, which may be approximated as a blackbody at 5800 K. *Incandescent* lighting from the usual household lamp bulb corresponds approximately to the spectral distribution of a blackbody at 2900 K.
- (a) Calculate the band emission fractions for the visible region,  $0.47\text{ }\mu\text{m}$  (blue) to  $0.65\text{ }\mu\text{m}$  (red), for each of the two lighting sources.
- (b) Calculate the wavelength corresponding to the maximum spectral intensity for each of the light sources. Comment on the results of your calculation in terms of the rendering of *true* colors under the different lighting conditions.
- 12.24** Thermal imagers have radiation detectors that are sensitive to a spectral region and provide white-black or color images with shading to indicate relative temperature differences in the scene. The imagers,


which have appearances similar to a video camcorder, have numerous applications, such as for equipment maintenance to identify overheated motors or electrical transformers and for fire-fighting service to determine the direction of fire spread and to aid search and rescue for victims. The most common operating spectral regions are 3 to 5  $\mu\text{m}$  and 8 to 14  $\mu\text{m}$ . The selection of a particular region typically depends on the temperature of the scene, although the atmospheric conditions (water vapor, smoke, etc.) may also be important.

- (a) Determine the band emission fractions for each of the spectral regions, 3 to 5  $\mu\text{m}$  and 8 to 14  $\mu\text{m}$ , for temperatures of 300 and 900 K.

- (b) Using the *IHT* model builder *Tools/Radiation/Band Emission Factor*, calculate and plot the band emission factors for each of the spectral regions for the temperature range 300 to 1000 K. Identify the temperatures at which the fractions are a maximum. What conclusions can you draw from this graph concerning the choice of an imager for an application?

- (c) The noise-equivalent temperature (NET) is a specification of the imager that indicates the minimum temperature change that can be resolved in the image scene. Consider imagers operating at the maximum-fraction temperatures identified in part (b). For each of these conditions, determine the sensitivity (%) required of the radiation detector in order to provide a NET of 5°C. Explain the significance of your results. *Note:* The sensitivity (%) can be defined as the difference in the band emission fractions for two temperatures differing by the NET, divided by the band emission fraction at one of the temperatures.


- 12.25** A furnace with a long isothermal, graphite tube of diameter  $D = 12.5$  mm is maintained at  $T_f = 2000$  K and is used as a blackbody source to calibrate heat flux gages. Traditional heat flux gages are constructed as blackened thin films with thermopiles to indicate the temperature change caused by absorption of the incident radiant power over the entire spectrum. The traditional gage of interest has a sensitive area of 5 mm<sup>2</sup> and is mounted coaxial with the furnace centerline, but

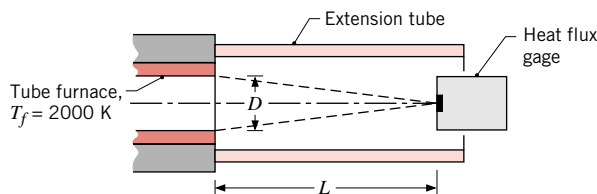

positioned at a distance of  $L = 60$  mm from the beginning of the heated section. The cool extension tube serves to shield the gage from extraneous radiation sources and to contain the inert gas required to prevent rapid oxidation of the graphite tube.

- (a) Calculate the heat flux (W/m<sup>2</sup>) on the traditional gage for this condition, assuming that the extension tube is cold relative to the furnace.
- (b) The traditional gage is replaced by a solid-state (photoconductive) heat flux gage of the same area, but sensitive only to the spectral region between 0.4 and 2.5  $\mu\text{m}$ . Calculate the radiant heat flux incident on the solid-state gage within the prescribed spectral region.
- (c) Calculate and plot the total heat flux and the heat flux in the prescribed spectral region for the solid-state gage as a function of furnace temperature for the range  $2000 \leq T_f \leq 3000$  K. Which gage will have an output signal that is more sensitive to changes in the furnace temperature?

- 12.26** An electrically powered, ring-shaped radiant heating element is maintained at a temperature of  $T_h = 3000$  K and is used in a manufacturing process to heat a small part having a surface area of  $A_p = 0.007$  m<sup>2</sup>. The surface of the heating element may be assumed to be black.

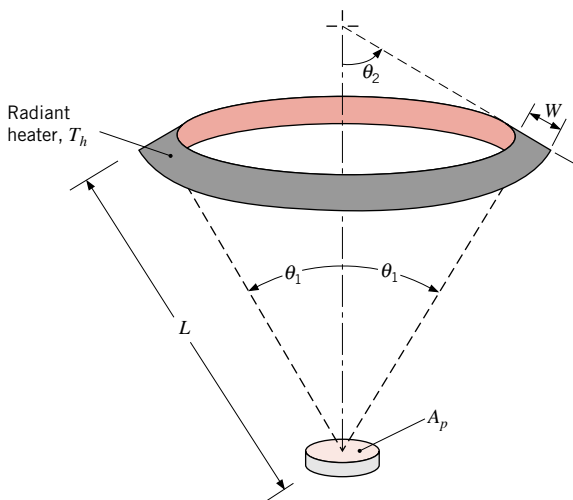

For  $\theta_1 = 30^\circ$ ,  $\theta_2 = 60^\circ$ ,  $L = 3$  m, and  $W = 30$  mm, what is the rate at which radiant energy emitted by the heater is incident on the part?

- 12.27** Approximations to Planck's law for the spectral emissive power are the Wien and Rayleigh-Jeans spectral distributions, which are useful for the extreme low and high limits of the product  $\lambda T$ , respectively.

- (a) Show that Planck's spectral distribution will have the form

$$E_{\lambda,b}(\lambda, T) \approx \frac{C_1}{\lambda^5} \exp\left(-\frac{C_2}{\lambda T}\right)$$

when  $C_2/\lambda T \gg 1$  and determine the error (compared to Planck's law) for the condition  $\lambda T = 2898 \mu\text{m} \cdot \text{K}$ . This form is known as Wien's law.

- (b) Show that the Planck distribution will have the form

$$E_{\lambda,b}(\lambda, T) \approx \frac{C_1}{C_2} \frac{T}{\lambda^4}$$

when  $C_2/\lambda T \ll 1$  and determine the error (compared to Planck's law) for the condition  $\lambda T = 100,000 \mu\text{m} \cdot \text{K}$ . This form is known as the Rayleigh-Jeans law.

**12.28** Isothermal furnaces with small apertures approximating a blackbody are frequently used to calibrate heat flux gages, radiation thermometers, and other radiometric devices. In such applications, it is necessary to control power to the furnace such that the variation of temperature and the spectral intensity of the aperture are within desired limits.


- (a) By considering the Planck spectral distribution, Equation 12.24, show that the ratio of the fractional change in the spectral intensity to the fractional change in the temperature of the furnace has the form

$$\frac{dI_\lambda/I_\lambda}{dT/T} = \frac{C_2}{\lambda T} \frac{1}{1 - \exp(-C_2/\lambda T)}$$

- (b) Using this relation, determine the allowable variation in temperature of the furnace operating at 2000 K to ensure that the spectral intensity at  $0.65 \mu\text{m}$  will not vary by more than 0.5%. What is the allowable variation at  $10 \mu\text{m}$ ?

### Properties: Emissivity


**12.29** The spectral, hemispherical emissivity of tungsten may be approximated by the distribution depicted below. Consider a cylindrical tungsten filament that is of diameter  $D = 0.8 \text{ mm}$  and length  $L = 20 \text{ mm}$ . The filament is enclosed in an evacuated bulb and is heated

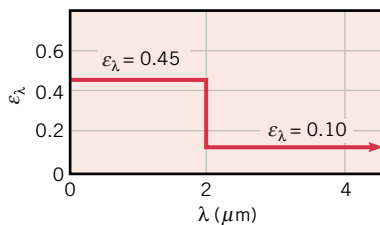

by an electrical current to a steady-state temperature of 2900 K.


- (a) What is the total hemispherical emissivity when the filament temperature is 2900 K?
- (b) Assuming the surroundings are at 300 K, what is the initial rate of cooling of the filament when the current is switched off?
- (c) Generate a plot of the emissivity as a function of filament temperature for  $1300 \leq T \leq 2900 \text{ K}$ .
- (d) Estimate the time required for the filament to cool from 2900 to 1300 K.

**12.30** A zirconia-based ceramic has the spectral, hemispherical emissivity shown below and is being considered for use as the filament of a light bulb.

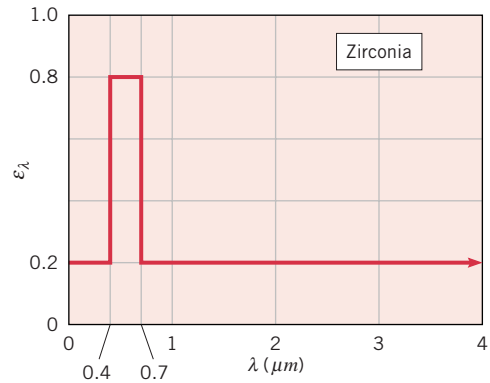


- (a) What is the total, hemispherical emissivity of a zirconia filament operating at 3000 K?
- (b) Using the spectral distribution provided in Problem 12.29, determine the total hemispherical emissivity of a tungsten filament at 3000 K and compare the result with that obtained for zirconia. For zirconia and tungsten operating at 3000 K in an evacuated bulb, what filament requires the larger power consumption?
- (c) With respect to the production of visible radiation, which of the two filaments is the more efficient? Justify your answer quantitatively.

**12.31** For materials A and B, whose spectral hemispherical emissivities vary with wavelength as shown below,

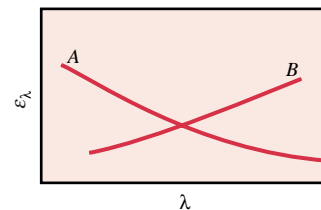


how does the total, hemispherical emissivity vary with temperature? Explain briefly.

- 12.32** Consider the metallic surface of Example 12.6. Additional measurements of the spectral, hemispherical emissivity yield a spectral distribution which may be approximated as follows:

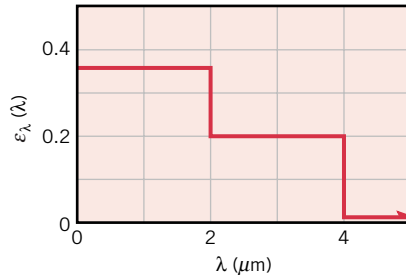


- Determine corresponding values of the total, hemispherical emissivity  $\varepsilon$  and the total emissive power  $E$  at 2000 K.
  - Plot the emissivity as a function of temperature for  $500 \leq T \leq 3000$  K. Explain the variation.
- 12.33** The spectral emissivity of unoxidized titanium at room temperature is well described by the expression  $\varepsilon_\lambda = 0.52\lambda^{-0.5}$  for  $0.3 \mu\text{m} \leq \lambda \leq 30 \mu\text{m}$ .
- Determine the emissive power associated with an unoxidized titanium surface at  $T = 300$  K. Assume the spectral emissivity is  $\varepsilon_\lambda = 0.1$  for  $\lambda > 30 \mu\text{m}$ .
  - Determine the value of  $\lambda_{\text{max}}$  for the emissive power of the surface in part (a).
- 12.34** The spectral, directional emissivity of a diffuse material at 2000 K has the following distribution:



Determine the total, hemispherical emissivity at 2000 K. Determine the emissive power over the spectral range  $0.8$  to  $2.5 \mu\text{m}$  and for the directions  $0 \leq \theta \leq 30^\circ$ .

- 12.35** Consider the directionally selective surface having the directional emissivity  $\varepsilon_\theta$ , as shown. Assuming that the surface is isotropic in the  $\phi$  direction, calculate the ratio of the normal emissivity  $\varepsilon_n$  to the hemispherical emissivity  $\varepsilon_h$ .



- 12.36** The directional total emissivity of nonmetallic materials may be approximated as  $\varepsilon_\theta = \varepsilon_n \cos \theta$ , where  $\varepsilon_n$  is the normal emissivity. Show that the total hemispherical emissivity for such materials is  $2/3$  of the normal emissivity.

- 12.37** A sphere is suspended in air in a dark room and maintained at a uniform incandescent temperature. When first viewed with the naked eye, the sphere appears to be brighter around the rim. After several hours, however, it appears to be brighter in the center. Of what type material would you reason the sphere is made? Give plausible reasons for the nonuniformity of brightness of the sphere and for the changing appearance with time.

- 12.38** A proposed *proximity meter* is based on the physical arrangement of Problem 12.14. The sensing area of a meter that is installed on a vehicle,  $A_2$ , is irradiated by a stationary warm object,  $A_1$ . The sensor's electrical output signal is proportional to its irradiation.

- The object temperature and emissivity are  $200^\circ\text{C}$  and  $\varepsilon = 0.85$ , respectively. Determine the distance,  $L_{2,\text{crit}}$ , associated with the maximum sensor output signal. Assume the object is a diffuse emitter.
- If the object emits as a nonmetallic material, the total directional emissivity may be approximated as  $\varepsilon_\theta = \varepsilon_n \cos \theta$ , where  $\varepsilon_n$  is the normal emissivity (Problem 12.36). Determine the distance  $L_{2,\text{crit}}$  associated with the maximum sensor output signal.
- Calculate and plot the irradiation of  $A_2$  over the range  $0 \leq L_2 \leq 10$  m.

- 12.39** A radiation thermometer is a device that responds to a radiant flux within a prescribed spectral interval and is calibrated to indicate the temperature of a blackbody that produces the same flux.

- When viewing a surface at an elevated temperature  $T_s$  and emissivity less than unity, the thermometer will indicate an apparent temperature referred to as the brightness or spectral radiance temperature  $T_\lambda$ . Will  $T_\lambda$  be greater than, less than, or equal to  $T_s$ ?


- (b) Write an expression for the spectral emissive power of the surface in terms of Wien's spectral distribution (see Problem 12.27) and the spectral emissivity of the surface. Write the equivalent expression using the spectral radiance temperature of the surface and show that

$$\frac{1}{T_s} = \frac{1}{T_\lambda} + \frac{\lambda}{C_2} \ln \varepsilon_\lambda$$

where  $\lambda$  represents the wavelength at which the thermometer operates.

- (c) Consider a radiation thermometer that responds to a spectral flux centered about the wavelength  $0.65 \mu\text{m}$ . What temperature will the thermometer indicate when viewing a surface with  $\varepsilon_\lambda$  ( $0.65 \mu\text{m}$ ) = 0.9 and  $T_s = 1000 \text{ K}$ ? Verify that Wien's spectral distribution is a reasonable approximation to Planck's law for this situation.
- 12.40** For a prescribed wavelength  $\lambda$ , measurement of the spectral intensity  $I_{\lambda,e}(\lambda, T) = \varepsilon_\lambda I_{\lambda,b}$  of radiation emitted by a diffuse surface may be used to determine the surface temperature, if the spectral emissivity  $\varepsilon_\lambda$  is known, or the spectral emissivity, if the temperature is known.
- (a) Defining the uncertainty of the temperature determination as  $dT/T$ , obtain an expression relating this uncertainty to that associated with the intensity measurement,  $dI_\lambda/I_\lambda$ . For a 10% uncertainty in the intensity measurement at  $\lambda = 10 \mu\text{m}$ , what is the uncertainty in the temperature for  $T = 500 \text{ K}$ ? For  $T = 1000 \text{ K}$ ?
- (b) Defining the uncertainty of the emissivity determination as  $d\varepsilon_\lambda/\varepsilon_\lambda$ , obtain an expression relating this uncertainty to that associated with the intensity measurement,  $dI_\lambda/I_\lambda$ . For a 10% uncertainty in the intensity measurement, what is the uncertainty in the emissivity?

- 12.41** Sheet steel emerging from the hot roll section of a steel mill has a temperature of  $1200 \text{ K}$ , a thickness of  $\delta = 3 \text{ mm}$ , and the following distribution for the spectral, hemispherical emissivity.

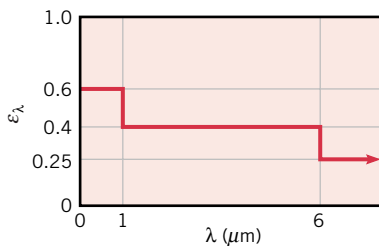


The density and specific heat of the steel are  $7900 \text{ kg/m}^3$  and  $640 \text{ J/kg} \cdot \text{K}$ , respectively. What is the total, hemispherical emissivity? Accounting for emission from both sides of the sheet and neglecting conduction, convection, and radiation from the surroundings, determine the initial time rate of change of the sheet temperature  $(dT/dt)_i$ . As the steel cools, it oxidizes and its total, hemispherical emissivity increases. If this increase may be correlated by an expression of the form  $\varepsilon = \varepsilon_{1200}[1200 \text{ K}/T \text{ (K)}]$ , how long will it take for the steel to cool from  $1200$  to  $600 \text{ K}$ ?


- 12.42** A large body of nonluminous gas at a temperature of  $1200 \text{ K}$  has emission bands between  $2.5$  and  $3.5 \mu\text{m}$  and between  $5$  and  $8 \mu\text{m}$ . The effective emissivity in the first band is  $0.8$  and in the second  $0.6$ . Determine the emissive power of this gas.

### Absorptivity, Reflectivity, and Transmissivity

- 12.43** An opaque surface with the prescribed spectral, hemispherical reflectivity distribution is subjected to the spectral irradiation shown.

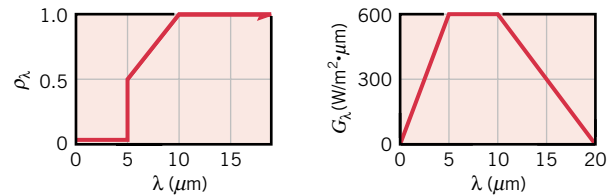

- (a) Sketch the spectral, hemispherical absorptivity distribution.
- (b) Determine the total irradiation on the surface.
- (c) Determine the radiant flux that is absorbed by the surface.
- (d) What is the total, hemispherical absorptivity of this surface?
- 12.44** A small, opaque, diffuse object at  $T_s = 400 \text{ K}$  is suspended in a large furnace whose interior walls are at  $T_f = 2000 \text{ K}$ . The walls are diffuse and gray and have an emissivity of  $0.20$ . The spectral, hemispherical emissivity for the surface of the small object is given below.

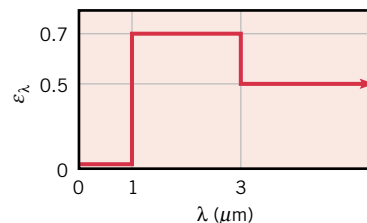



- Determine the total emissivity and absorptivity of the surface.
- Evaluate the reflected radiant flux and the net radiative flux *to* the surface.
- What is the spectral emissive power at  $\lambda = 2 \mu\text{m}$ ?
- What is the wavelength  $\lambda_{1/2}$  for which one-half of the total radiation emitted by the surface is in the spectral region  $\lambda \geq \lambda_{1/2}$ ?

**12.45** The spectral reflectivity distribution for white paint (Figure 12.22) can be approximated by the following stair-step function:

$\alpha_\lambda$	0.75	0.15	0.96
$\lambda (\mu\text{m})$	$<0.4$	$0.4\text{--}3.0$	$>3.0$


A small flat plate coated with this paint is suspended inside a large enclosure, and its temperature is maintained at 400 K. The surface of the enclosure is maintained at 3000 K and the spectral distribution of its emissivity has the following characteristics:

$\varepsilon_\lambda$	0.2	0.9
$\lambda (\mu\text{m})$	$<2.0$	$>2.0$

- Determine the total emissivity,  $\varepsilon$ , of the enclosure surface.
- Determine the total emissivity,  $\varepsilon$ , and absorptivity,  $\alpha$ , of the plate.


**12.46** An opaque surface, 2 m by 2 m, is maintained at 400 K and is simultaneously exposed to solar irradiation with  $G = 1200 \text{ W/m}^2$ . The surface is diffuse and its spectral absorptivity is  $\alpha_\lambda = 0, 0.8, 0$ , and  $0.9$  for  $0 \leq \lambda \leq 0.5 \mu\text{m}$ ,  $0.5 \mu\text{m} < \lambda \leq 1 \mu\text{m}$ ,  $1 \mu\text{m} < \lambda \leq 2 \mu\text{m}$ , and  $\lambda > 2 \mu\text{m}$ , respectively. Determine the absorbed irradiation, emissive power, radiosity, and net radiation heat transfer from the surface.

**12.47** A diffuse, opaque surface at 700 K has spectral emissivities of  $\varepsilon_\lambda = 0$  for  $0 \leq \lambda \leq 3 \mu\text{m}$ ,  $\varepsilon_\lambda = 0.5$  for  $3 \mu\text{m} < \lambda \leq 10 \mu\text{m}$ , and  $\varepsilon_\lambda = 0.9$  for  $10 \mu\text{m} < \lambda < \infty$ . A radiant flux of  $1000 \text{ W/m}^2$ , which is uniformly distributed between 1 and  $6 \mu\text{m}$ , is incident on the surface at an angle of  $30^\circ$  relative to the surface normal.

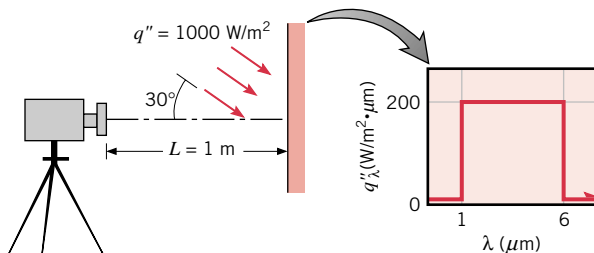


Calculate the total radiant power from a  $10^{-4} \text{ m}^2$  area of the surface that reaches a radiation detector positioned along the normal to the area. The aperture of the detector is  $10^{-5} \text{ m}^2$ , and its distance from the surface is 1 m.

**12.48** A small disk 5 mm in diameter is positioned at the center of an isothermal, hemispherical enclosure. The disk is diffuse and gray with an emissivity of 0.7 and is maintained at 900 K. The hemispherical enclosure, maintained at 300 K, has a radius of 100 mm and an emissivity of 0.85.

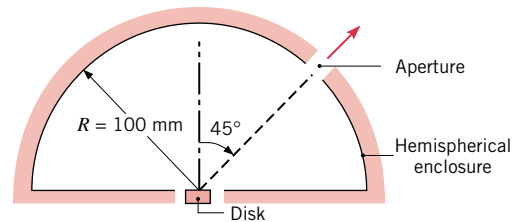


Calculate the radiant power leaving an aperture of diameter 2 mm located on the enclosure as shown.

**12.49** The spectral, hemispherical absorptivity of an opaque surface is as shown.

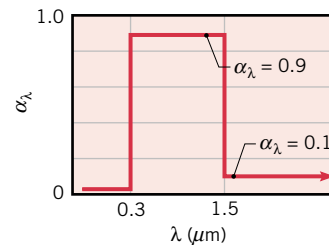

What is the solar absorptivity,  $\alpha_s$ ? If it is assumed that  $\varepsilon_\lambda = \alpha_\lambda$  and that the surface is at a temperature of 340 K, what is its total, hemispherical emissivity?


**12.50** The spectral, hemispherical absorptivity of an opaque surface and the spectral distribution of radiation incident on the surface are depicted below.

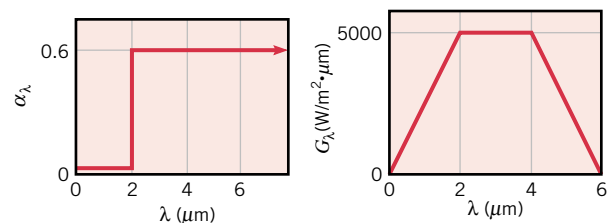

What is the total, hemispherical absorptivity of the surface? If it is assumed that  $\varepsilon_\lambda = \alpha_\lambda$  and that the surface is at 1000 K, what is its total, hemispherical


emissivity? What is the net radiant heat flux to the surface?

- 12.51** Consider an opaque, diffuse surface for which the spectral absorptivity and irradiation are as follows:

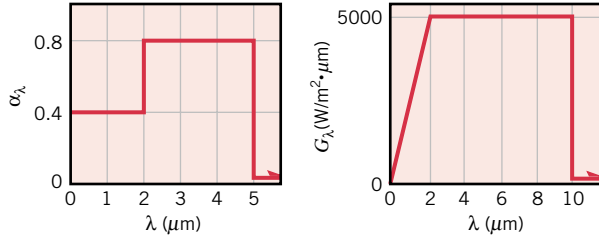


What is the total absorptivity of the surface for the prescribed irradiation? If the surface is at a temperature of 1250 K, what is its emissive power? How will the surface temperature vary with time, for the prescribed conditions?

- 12.52** The tungsten filament described in Problem 12.29 dissipates 75 W in an evacuated spherical light bulb of 75-mm diameter. The bulb is in quiescent air and large surroundings at a temperature of 25°C. The reflectivity of the glass is negligible, while the spectral absorptivity is characterized by the following distribution.

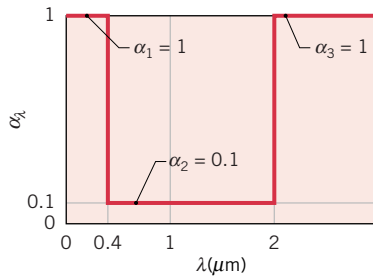

What is the steady-state temperature of the glass bulb for a tungsten filament operating at 3000 K?


- 12.53** The spectral emissivity of an opaque, diffuse surface is as shown.

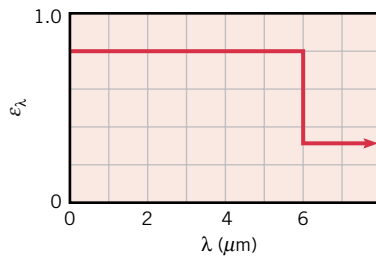

- (a) If the surface is maintained at 1000 K, what is the total, hemispherical emissivity?

- (b) What is the total, hemispherical absorptivity of the surface when irradiated by large surroundings of emissivity 0.8 and temperature 1500 K?
- (c) What is the radiosity of the surface when it is maintained at 1000 K and subjected to the irradiation prescribed in part (b)?
- (d) Determine the net radiation flux into the surface for the conditions of part (c).
- (e) Plot each of the parameters featured in parts (a)–(d) as a function of the surface temperature for  $750 \leq T \leq 2000$  K.

- 12.54** Radiation leaves a furnace of inside surface temperature 1500 K through an aperture 20 mm in diameter. A portion of the radiation is intercepted by a detector that is 1 m from the aperture, has a surface area of  $10^{-5} \text{ m}^2$ , and is oriented as shown.

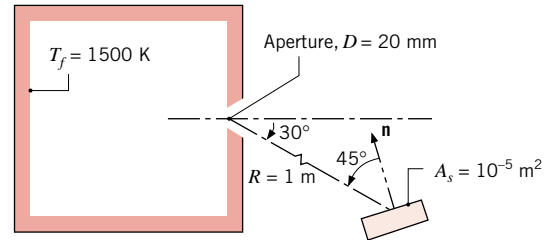

If the aperture is open, what is the rate at which radiation leaving the furnace is intercepted by the detector? If the aperture is covered with a diffuse, semitransparent material of spectral transmissivity  $\tau_\lambda = 0.8$  for  $\lambda \leq 2 \mu\text{m}$  and  $\tau_\lambda = 0$  for  $\lambda > 2 \mu\text{m}$ , what is the rate at which radiation leaving the furnace is intercepted by the detector?

- 12.55** The spectral transmissivity of a 1-mm-thick layer of liquid water can be approximated as follows:

$$\begin{aligned} \tau_{\lambda 1} &= 0.99 & 0 \leq \lambda \leq 1.2 \mu\text{m} \\ \tau_{\lambda 2} &= 0.54 & 1.2 \mu\text{m} < \lambda \leq 1.8 \mu\text{m} \\ \tau_{\lambda 3} &= 0 & 1.8 \mu\text{m} < \lambda \end{aligned}$$

- (a) Liquid water can exist only below its critical temperature,  $T_c = 647.3 \text{ K}$ . Determine the maximum possible total transmissivity of a 1-mm-thick layer of liquid water when the water is housed in an opaque container and boiling does not occur. Assume the irradiation is that of a blackbody.
- (b) Determine the transmissivity of a 1-mm-thick layer of liquid water associated with melting the platinum wire used in Nukiyama's boiling experiment, as described in Section 10.3.1.
- (c) Determine the total transmissivity of a 1-mm-thick layer of liquid water exposed to solar



irradiation. Assume the sun emits as a blackbody at  $T_s = 5800$  K.

- 12.56** The spectral transmissivity of plain and tinted glass can be approximated as follows:

$$\begin{array}{lll} \text{Plain glass:} & \tau_\lambda = 0.9 & 0.3 \leq \lambda \leq 2.5 \mu\text{m} \\ \text{Tinted glass:} & \tau_\lambda = 0.9 & 0.5 \leq \lambda \leq 1.5 \mu\text{m} \end{array}$$


Outside the specified wavelength ranges, the spectral transmissivity is zero for both glasses. Compare the solar energy that could be transmitted through the glasses. With solar irradiation on the glasses, compare the visible radiant energy that could be transmitted.

- 12.57** The research group of a glass manufacturer is working on development of a coating that would render glass highly transparent to radiation at wavelengths below  $0.7 \mu\text{m}$  and highly reflective to radiation above  $0.7 \mu\text{m}$ . An application of special interest is to the inner surface of glass light bulbs.

- Explain the advantages of having a light bulb whose inner surface is perfectly transparent ( $\tau_\lambda = 1$ ) to radiation for  $\lambda \leq 0.7 \mu\text{m}$  and perfectly reflecting ( $\rho_\lambda = 1$ ) for  $\lambda > 0.7 \mu\text{m}$ .
- Consider such a light bulb with a tungsten filament whose spectral emissivity is characterized by the distribution of Problem 12.29. What is the electric power required to maintain a filament temperature of  $3000$  K if the filament diameter and length are  $D = 0.8$  mm and  $L = 20$  mm? What is the power requirement if the coating can only provide complete reflection for  $\lambda > 2.0 \mu\text{m}$ , with complete transmission maintained at lower wavelengths?


- 12.58** Referring to the distribution of the spectral transmissivity of low iron glass (Figure 12.23), describe briefly what is meant by the “greenhouse effect.” That is, how does the glass influence energy transfer to and from the contents of a greenhouse?

- 12.59** The spectral absorptivity  $\alpha_\lambda$  and spectral reflectivity  $\rho_\lambda$  for a spectrally selective, diffuse material are as shown.

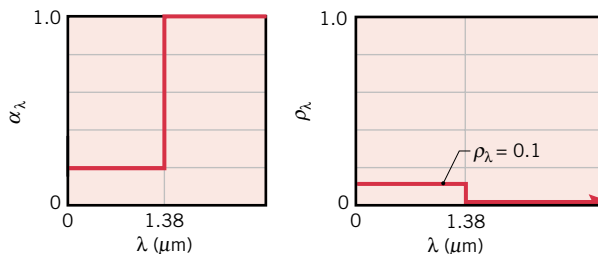


- Sketch the spectral transmissivity  $\tau_\lambda$ .
- If solar irradiation with  $G_s = 750$  W/m<sup>2</sup> and the spectral distribution of a blackbody at  $5800$  K is incident on this material, determine the fractions of the irradiation that are transmitted, reflected, and absorbed by the material.
- If the temperature of this material is  $350$  K, determine the emissivity  $\varepsilon$ .
- Determine the net heat flux by radiation to the material.

- 12.60** Consider a large furnace with opaque, diffuse, gray walls at  $3000$  K having an emissivity of  $0.85$ . A small, diffuse, spectrally selective object in the furnace is maintained at  $300$  K.

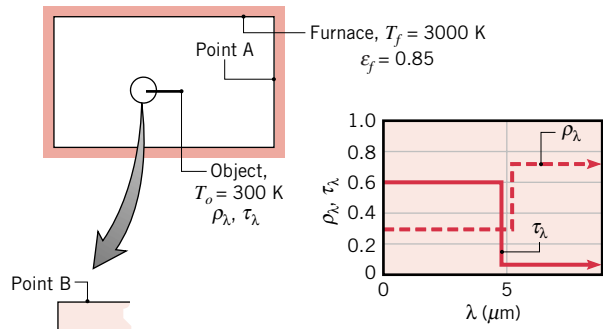

For the specified points on the furnace wall (A) and the object (B), indicate values for  $\varepsilon$ ,  $\alpha$ ,  $E$ ,  $G$ , and  $J$ .

- 12.61** Four diffuse surfaces having the spectral characteristics shown are at  $300$  K and are exposed to solar radiation.

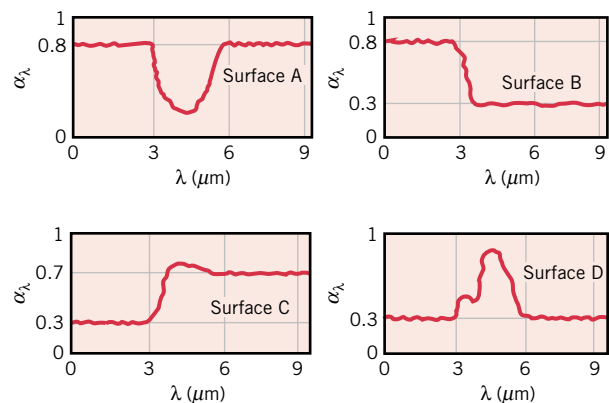

Which of the surfaces may be approximated as being gray?

- 12.62** Consider a material that is gray, but directionally selective with  $\alpha_\theta(\theta, \phi) = 0.5(1 - \cos \phi)$ . Determine the hemispherical absorptivity  $\alpha$  when collimated solar

flux irradiates the surface of the material in the direction  $\theta = 45^\circ$  and  $\phi = 0^\circ$ . Determine the hemispherical emissivity  $\varepsilon$  of the material.


- 12.63** The spectral transmissivity of a  $50\text{-}\mu\text{m}$ -thick polymer film is measured over the wavelength range  $2.5\text{ }\mu\text{m} \leq \lambda \leq 15\text{ }\mu\text{m}$ . The spectral distribution may be approximated as  $\tau_\lambda = 0.80$  for  $2.5\text{ }\mu\text{m} \leq \lambda \leq 7\text{ }\mu\text{m}$ ,  $\tau_\lambda = 0.05$  for  $7\text{ }\mu\text{m} < \lambda \leq 13\text{ }\mu\text{m}$ , and  $\tau_\lambda = 0.55$  for  $13\text{ }\mu\text{m} < \lambda \leq 15\text{ }\mu\text{m}$ . Transmissivity data outside the range cannot be acquired due to limitations associated with the instrumentation. An engineer wishes to determine the total transmissivity of the film.
- Estimate the *maximum possible* total transmissivity of the film associated with irradiation from a blackbody at  $T = 30^\circ\text{C}$ .
  - Estimate the *minimum possible* total transmissivity of the film associated with irradiation from a blackbody at  $T = 30^\circ\text{C}$ .
  - Repeat parts (a) and (b) for a blackbody at  $T = 600^\circ\text{C}$ .

### Energy Balances and Properties


- 12.64** An opaque, horizontal plate has a thickness of  $L = 21\text{ mm}$  and thermal conductivity  $k = 25\text{ W/m}\cdot\text{K}$ . Water flows adjacent to the bottom of the plate and is at a temperature of  $T_{\infty,w} = 25^\circ\text{C}$ . Air flows above the plate at  $T_{\infty,a} = 260^\circ\text{C}$  with  $h_a = 40\text{ W/m}^2\cdot\text{K}$ . The top of the plate is diffuse and is irradiated with  $G = 1450\text{ W/m}^2$ , of which  $435\text{ W/m}^2$  is reflected. The steady-state top and bottom plate temperatures are  $T_t = 43^\circ\text{C}$  and  $T_b = 35^\circ\text{C}$ , respectively. Determine the transmissivity, reflectivity, absorptivity, and emissivity of the plate. Is the plate gray? What is the radiosity associated with the top of the plate? What is the convective heat transfer coefficient associated with the water flow?
- 12.65** Two small surfaces, A and B, are placed inside an isothermal enclosure at a uniform temperature. The enclosure provides an irradiation of  $6300\text{ W/m}^2$  to each of the surfaces, and surfaces A and B absorb incident radiation at rates of  $5600$  and  $630\text{ W/m}^2$ , respectively. Consider conditions after a long time has elapsed.
- What are the net heat fluxes for each surface? What are their temperatures?
  - Determine the absorptivity of each surface.
  - What are the emissive powers of each surface?
  - Determine the emissivity of each surface.
- 12.66** Consider an opaque horizontal plate that is well insulated on its back side. The irradiation on the plate is

$2500\text{ W/m}^2$ , of which  $500\text{ W/m}^2$  is reflected. The plate is at  $227^\circ\text{C}$  and has an emissive power of  $1200\text{ W/m}^2$ . Air at  $127^\circ\text{C}$  flows over the plate with a heat transfer convection coefficient of  $15\text{ W/m}^2\cdot\text{K}$ . Determine the emissivity, absorptivity, and radiosity of the plate. What is the net heat transfer rate per unit area?

- 12.67** A horizontal, opaque surface at a steady-state temperature of  $77^\circ\text{C}$  is exposed to an airflow having a free stream temperature of  $27^\circ\text{C}$  with a convection heat transfer coefficient of  $28\text{ W/m}^2\cdot\text{K}$ . The emissive power of the surface is  $628\text{ W/m}^2$ , the irradiation is  $1380\text{ W/m}^2$ , and the reflectivity is  $0.40$ . Determine the absorptivity of the surface. Determine the net radiation heat transfer rate for this surface. Is this heat transfer to the surface or from the surface? Determine the combined heat transfer rate for the surface. Is this heat transfer to the surface or from the surface?
- 12.68** A diffuse surface having the following spectral characteristics is maintained at  $500\text{ K}$  when situated in a large furnace enclosure whose walls are maintained at  $1500\text{ K}$ :

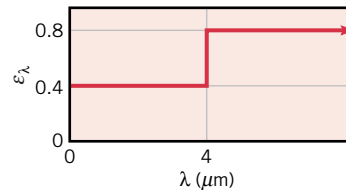

- Sketch the spectral distribution of the surface emissive power  $E_\lambda$  and the emissive power  $E_{\lambda,b}$  that the surface would have if it were a blackbody.
  - Neglecting convection effects, what is the net heat flux to the surface for the prescribed conditions?
  - Plot the net heat flux as a function of the surface temperature for  $500 \leq T \leq 1000\text{ K}$ . On the same coordinates, plot the heat flux for a diffuse, gray surface with total emissivities of  $0.4$  and  $0.8$ .
  - For the prescribed spectral distribution of  $\varepsilon_\lambda$ , how do the total emissivity and absorptivity of the surface vary with temperature in the range  $500 \leq T \leq 1000\text{ K}$ ?
- 12.69** Consider an opaque, diffuse surface whose spectral reflectivity varies with wavelength as shown. The

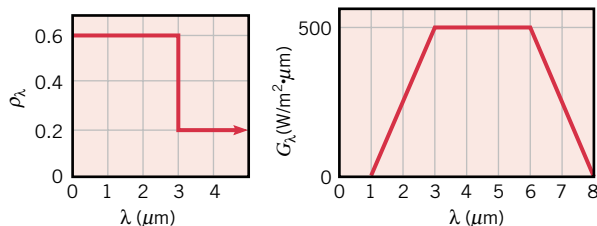


surface is at 750 K, and irradiation on one side varies with wavelength as shown. The other side of the surface is insulated.


What are the total absorptivity and emissivity of the surface? What is the net radiative heat flux to the surface?

- 12.70** A special diffuse glass with prescribed spectral radiative properties is heated in a large oven. The walls of the oven are lined with a diffuse, gray refractory brick having an emissivity of 0.75 and are maintained at  $T_w = 1800$  K. Consider conditions for which the glass temperature is  $T_g = 750$  K.

- What are the total transmissivity  $\tau$ , the total reflectivity  $\rho$ , and the total emissivity  $\varepsilon$  of the glass?
- What is the net radiative heat flux,  $q''_{\text{net},\text{in}}$  ( $\text{W/m}^2$ ), to the glass?
- For oven wall temperatures of 1500, 1800, and 2000 K, plot  $q''_{\text{net},\text{in}}$  as a function of glass temperature for  $500 \leq T_g \leq 800$  K.

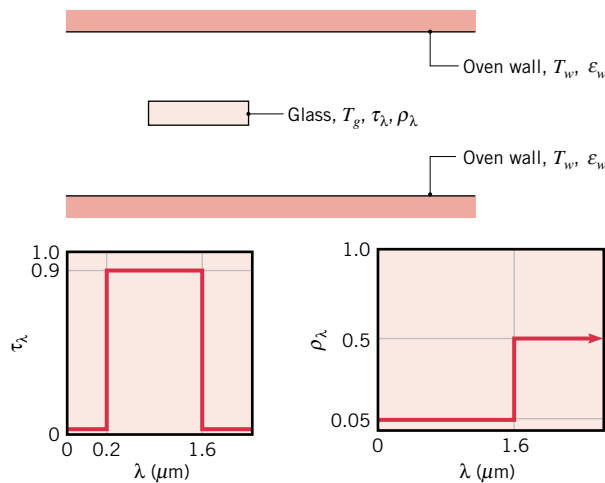

- 12.71** A horizontal semitransparent plate is uniformly irradiated from above and below, while air at  $T_\infty = 300$  K flows over the top and bottom surfaces, providing a uniform convection heat transfer coefficient of

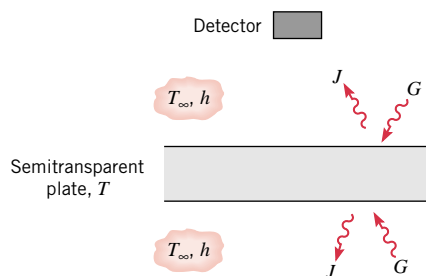


$h = 40 \text{ W/m}^2 \cdot \text{K}$ . The total, hemispherical absorptivity of the plate to the irradiation is 0.40. Under steady-state conditions measurements made with a radiation detector above the top surface indicate a radiosity (which includes transmission, as well as reflection and emission) of  $J = 5000 \text{ W/m}^2$ , while the plate is at a uniform temperature of  $T = 350$  K.

Determine the irradiation  $G$  and the total hemispherical emissivity of the plate. Is the plate gray for the prescribed conditions?

- 12.72** The 50-mm peephole of a large furnace operating at  $450^\circ\text{C}$  is covered with a material having  $\tau = 0.8$  and  $\rho = 0$  for irradiation originating from the furnace. The material has an emissivity of 0.8 and is opaque to irradiation from a source at room temperature. The outer surface of the cover is exposed to surroundings and ambient air at  $27^\circ\text{C}$  with a convection heat transfer coefficient of  $50 \text{ W/m}^2 \cdot \text{K}$ . Assuming that convection effects on the inner surface of the cover are negligible, calculate the heat loss by the furnace and the temperature of the cover.

- 12.73** The window of a large vacuum chamber is fabricated from a material of prescribed spectral characteristics. A collimated beam of radiant energy from a solar simulator is incident on the window and has a flux of  $3000 \text{ W/m}^2$ . The inside walls of the chamber, which are large compared to the window area, are maintained at  $77$  K. The outer surface of the window is subjected to surroundings and room air at  $25^\circ\text{C}$ , with a convection heat transfer coefficient of  $15 \text{ W/m}^2 \cdot \text{K}$ .

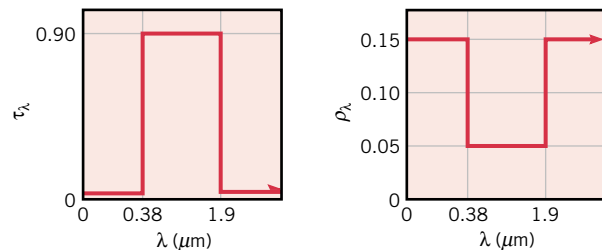

- Determine the transmissivity of the window material to radiation from the solar simulator, which approximates the solar spectral distribution.
- Assuming that the window is insulated from its chamber mounting arrangement, what steady-state temperature does the window reach?
- Calculate the net radiation transfer per unit area of the window to the vacuum chamber wall, excluding the transmitted simulated solar flux.


- 12.74** A thermocouple whose surface is diffuse and gray with an emissivity of 0.6 indicates a temperature of  $180^\circ\text{C}$  when used to measure the temperature of a gas

flowing through a large duct whose walls have an emissivity of 0.85 and a uniform temperature of 450°C.


- (a) If the convection heat transfer coefficient between the thermocouple and the gas stream is  $\bar{h} = 125 \text{ W/m}^2 \cdot \text{K}$  and there are negligible conduction losses from the thermocouple, determine the temperature of the gas.
- (b) Consider a gas temperature of 125°C. Compute and plot the thermocouple *measurement error* as a function of the convection coefficient for  $10 \leq \bar{h} \leq 1000 \text{ W/m}^2 \cdot \text{K}$ . What are the implications of your results?
- 12.75** A thermocouple inserted in a 4-mm-diameter stainless steel tube having a diffuse, gray surface with an emissivity of 0.4 is positioned horizontally in a large air-conditioned room whose walls and air temperature are 30 and 20°C, respectively.
- (a) What temperature will the thermocouple indicate if the air is quiescent?
- (b) Compute and plot the thermocouple *measurement error* as a function of the surface emissivity for  $0.1 \leq \varepsilon \leq 1.0$ .
- 12.76** A temperature sensor imbedded in the tip of a small tube having a diffuse, gray surface with an emissivity of 0.8 is centrally positioned within a large air-conditioned room whose walls and air temperature are 30 and 20°C, respectively.
- (a) What temperature will the sensor indicate if the convection coefficient between the sensor tube and the air is  $5 \text{ W/m}^2 \cdot \text{K}$ ?
- (b) What would be the effect of using a fan to induce airflow over the tube? Plot the sensor temperature as a function of the convection coefficient for  $2 \leq h \leq 25 \text{ W/m}^2 \cdot \text{K}$  and values of  $\varepsilon = 0.2, 0.5$ , and 0.8.
- 12.77** A sphere ( $k = 185 \text{ W/m} \cdot \text{K}$ ,  $\alpha = 7.25 \times 10^{-5} \text{ m}^2/\text{s}$ ) of 30-mm diameter whose surface is diffuse and gray with an emissivity of 0.8 is placed in a large oven whose walls are of uniform temperature at 600 K. The temperature of the air in the oven is 400 K, and the convection heat transfer coefficient between the sphere and the oven air is  $15 \text{ W/m}^2 \cdot \text{K}$ .
- (a) Determine the net heat transfer to the sphere when its temperature is 300 K.
- (b) What will be the steady-state temperature of the sphere?
- (c) How long will it take for the sphere, initially at 300 K, to come within 20 K of the steady-state temperature?
- (d) For emissivities of 0.2, 0.4, and 0.8, plot the elapsed time of part (c) as a function of the convection coefficient for  $10 \leq h \leq 25 \text{ W/m}^2 \cdot \text{K}$ .

## Radiation Detection

- 12.78** A thermograph is a device responding to the radiant power from the scene, which reaches its radiation detector within the spectral region 9–12  $\mu\text{m}$ . The thermograph provides an image of the scene, such as the side of a furnace, from which the surface temperature can be determined.

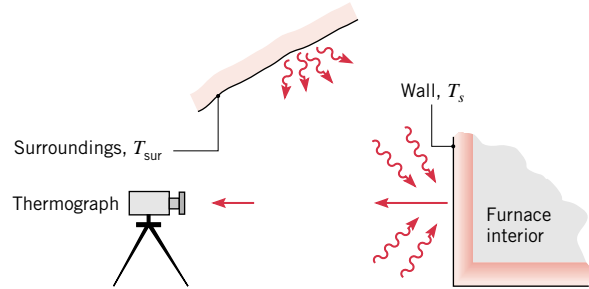

- (a) For a black surface at 60°C, determine the emissive power for the spectral region 9–12  $\mu\text{m}$ .
- (b) Calculate the radiant power (W) received by the thermograph in the same range (9–12  $\mu\text{m}$ ) when viewing, in a normal direction, a small black wall area, 200  $\text{mm}^2$ , at  $T_s = 60^\circ\text{C}$ . The solid angle  $\omega$  subtended by the aperture of the thermograph when viewed from the target is 0.001 sr.
- (c) Determine the radiant power (W) received by the thermograph for the same wall area (200  $\text{mm}^2$ ) and solid angle (0.001 sr) when the wall is a gray, opaque, diffuse material at  $T_s = 60^\circ\text{C}$  with emissivity 0.7 and the surroundings are black at  $T_{\text{sur}} = 23^\circ\text{C}$ .
- 12.79** A radiation thermometer is a radiometer calibrated to indicate the temperature of a blackbody. A steel billet having a diffuse, gray surface of emissivity 0.8 is heated in a furnace whose walls are at 1500 K. Estimate the temperature of the billet when the radiation thermometer viewing the billet through a small hole in the furnace indicates 1160 K.
- 12.80** A radiation detector has an aperture of area  $A_d = 10^{-6} \text{ m}^2$  and is positioned at a distance of  $r = 1 \text{ m}$  from a surface of area  $A_s = 10^{-4} \text{ m}^2$ . The angle formed by the normal to the detector and the surface normal is  $\theta = 30^\circ$ .




The surface is at 500 K and is opaque, diffuse, and gray with an emissivity of 0.7. If the surface irradiation is  $1500 \text{ W/m}^2$ , what is the rate at which the detector intercepts radiation from the surface?

- 12.81** A small anodized aluminum block at  $35^\circ\text{C}$  is heated in a large oven whose walls are diffuse and gray with  $\varepsilon = 0.85$  and maintained at a uniform temperature of  $175^\circ\text{C}$ . The anodized coating is also diffuse and gray with  $\varepsilon = 0.92$ . A radiation detector views the block through a small opening in the oven and receives the radiant energy from a small area, referred to as the target,  $A_t$ , on the block. The target has a diameter of 3 mm, and the detector receives radiation within a solid angle  $0.001 \text{ sr}$  centered about the normal from the block.

- If the radiation detector views a small, but deep, hole drilled into the block, what is the total power (W) received by the detector?
- If the radiation detector now views an area on the block surface, what is the total power (W) received by the detector?


- 12.82** Consider the diffuse, gray opaque disk  $A_1$ , which has a diameter of 10 mm, an emissivity of 0.3, and is at a temperature of 400 K. Coaxial to the disk  $A_1$ , there is a black, ring-shaped disk  $A_2$  at 1000 K having the dimensions shown in the sketch. The backside of  $A_2$  is insulated and does not directly irradiate the cryogenically cooled detector disk  $A_3$ , which is of diameter 10 mm and is located 2 m from  $A_1$ .

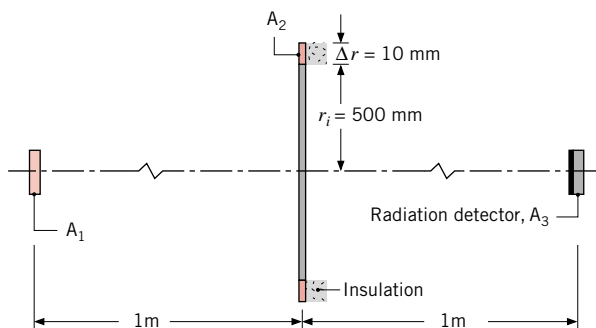


Calculate the rate at which radiation is incident on  $A_3$  due to emission and reflection from  $A_1$ .

- 12.83** A diffuse, spherical object of diameter and temperature 9 mm and 600 K, respectively, has an emissivity of 0.95. Two very sensitive radiation detectors, each with an aperture area of  $300 \times 10^{-6} \text{ m}^2$ , detect the object as it passes over at high velocity from left to right as shown in the schematic. The detectors capture hemispherical irradiation and are equipped with filters characterized by  $\tau_\lambda = 0.9$  for  $\lambda < 2.5 \mu\text{m}$  and  $\tau_\lambda = 0$  for  $\lambda \geq 2.5 \mu\text{m}$ . At time  $t_1 = 0$ , detectors A and B

indicate irradiances of  $G_{A,1} = 5.060 \text{ mW/m}^2$  and  $G_{B,1} = 5.000 \text{ mW/m}^2$ , respectively. At time  $t_2 = 4 \text{ ms}$ , detectors A and B indicate irradiances of  $G_{A,2} = 5.010 \text{ mW/m}^2$  and  $G_{B,2} = 5.050 \text{ mW/m}^2$ , respectively. The environment is at 300 K. Determine the velocity components of the particle,  $v_x$  and  $v_y$ . Determine when and where the particle will strike a horizontal plane located at  $y = 0$ . *Hint:* The object is located at an elevation above  $y = 2 \text{ m}$  when it is detected. Assume the object's trajectory is a straight line in the plane of the page. Recall that the projected area of a sphere is a circle.

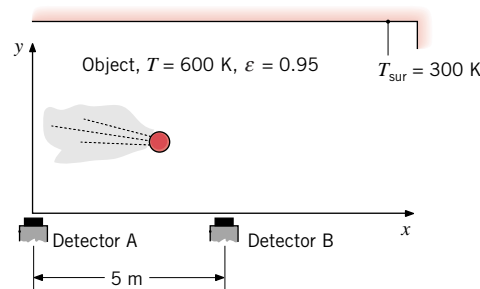


- 12.84** A radiation detector having a sensitive area of  $A_d = 4 \times 10^{-6} \text{ m}^2$  is configured to receive radiation from a target area of diameter  $D_t = 40 \text{ mm}$  when located a distance of  $L_t = 1 \text{ m}$  from the target. For the experimental apparatus shown in the sketch, we wish to determine the emitted radiation from a hot sample of diameter  $D_s = 20 \text{ mm}$ . The temperature of the aluminum sample is  $T_s = 700 \text{ K}$  and its emissivity is  $\varepsilon_s = 0.1$ . A ring-shaped cold shield is provided to minimize the effect of radiation from outside the sample area, but within the target area. The sample and the shield are diffuse emitters.

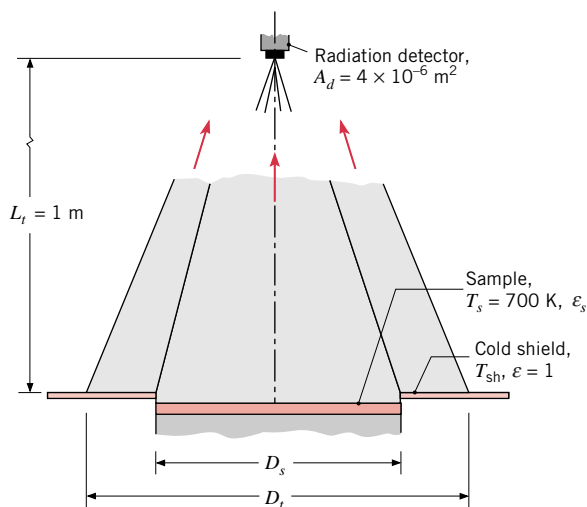



- (a) Assuming the shield is black, at what temperature,  $T_{sh}$ , should the shield be maintained so that its emitted radiation is 1% of the total radiant power received by the detector?
- (b) Subject to the parametric constraint that radiation emitted from the cold shield is 0.05, 1, or 1.5% of the total radiation received by the detector, plot the required cold shield temperature,  $T_{sh}$ , as a function of the sample emissivity for  $0.05 \leq \epsilon_s \leq 0.35$ .

**12.85** An infrared (IR) thermograph is a radiometer that provides an image of the target scene, indicating the apparent temperature of elements in the scene by a black–white brightness or blue–red color scale. Radiation originating from an element in the target scene is incident on the radiation detector, which provides a signal proportional to the incident radiant power. The signal sets the image brightness or color scale for the image pixel associated with that element. A scheme is proposed for field calibration of an infrared thermograph having a radiation detector with a 3- to 5- $\mu\text{m}$  spectral bandpass. A heated metal plate, which is maintained at 327°C and has four diffuse, gray coatings with different emissivities, is viewed by the IR thermograph in surroundings for which  $T_{sur} = 87^\circ\text{C}$ .

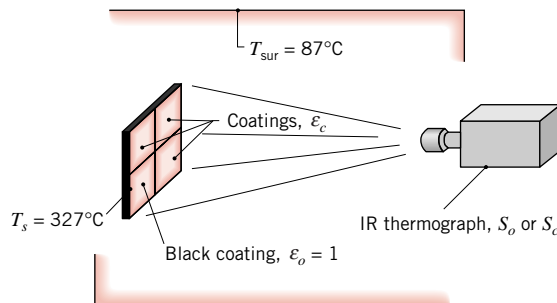

- (a) Consider the thermograph output when viewing the black coating,  $\epsilon_o = 1$ . The radiation reaching the detector is proportional to the product of the blackbody emissive power (or emitted intensity) at the temperature of the surface and the band emission fraction corresponding to the IR thermograph spectral bandpass. The proportionality constant is referred to as the responsivity,  $R(\mu\text{V} \cdot \text{m}^2/\text{W})$ . Write an expression for the thermograph output signal,  $S_o$ , in terms of  $R$ , the coating blackbody emissive power, and the appropriate band emission fraction. Assuming  $R = 1 \mu\text{V} \cdot \text{m}^2/\text{W}$ , evaluate  $S_o$  ( $\mu\text{V}$ ).
- (b) Consider the thermograph output when viewing one of the coatings for which the emissivity  $\epsilon_c$  is

less than unity. Radiation from the coating reaches the detector due to emission and the reflection of irradiation from the surroundings. Write an expression for the signal,  $S_c$ , in terms of  $R$ , the coating blackbody emissive power, the blackbody emissive power of the surroundings, the coating emissivity, and the appropriate band emission fractions. For the diffuse, gray coatings, the reflectivity is  $\rho_c = 1 - \epsilon_c$ .

- (c) Assuming  $R = 1 \mu\text{V} \cdot \text{m}^2/\text{W}$ , evaluate the thermograph signals,  $S_c$  ( $\mu\text{V}$ ), when viewing panels with emissivities of 0.8, 0.5, and 0.2.
- (d) The thermograph is calibrated so that the signal  $S_o$  (with the black coating) will give a correct scale indication of  $T_s = 327^\circ\text{C}$ . The signals from the other three coatings,  $S_c$ , are less than  $S_o$ . Hence the thermograph will indicate an apparent (blackbody) temperature less than  $T_s$ . Estimate the temperatures indicated by the thermograph for the three panels of part (c).


**12.86** A charge-coupled device (CCD) infrared imaging system (see Problem 12.85) operates in a manner similar to a digital video camera. Instead of being sensitive to irradiation in the visible part of the spectrum, however, each small sensor in the infrared system's CCD array is sensitive in the spectral region 9–12  $\mu\text{m}$ . Note that the system is designed to only view radiation coming from directly in front of it. An experimenter wishes to use the infrared imaging system to map the surface temperature distribution of a heated object in a wind tunnel experiment. The air temperature in the wind tunnel, as well as the surroundings temperature in the laboratory, is 23°C.

- (a) In a preliminary test of the concept, the experimenter views a small aluminum billet located in the wind tunnel that is at a billet temperature of 50°C. The aluminum is coated with a high-emissivity paint,  $\epsilon = 0.96$ . If the infrared imaging system is calibrated to indicate the temperature of a blackbody, what temperature will be indicated by the infrared imaging system as it is used to view the aluminum billet through a 6-mm-thick fused quartz window?
- (b) In a subsequent experiment, the experimenter replaces the quartz window with a thin (130- $\mu\text{m}$ -thick) household polyethylene film with  $\tau \approx 0.78$  within the spectral range of the imaging system. What temperature will be indicated by the infrared imaging system when it is used to view the aluminum billet through the polyethylene film?

- 12.87** A two-color pyrometer is a device that is used to measure the temperature of a diffuse surface,  $T_s$ . The device measures the spectral, directional intensity emitted by the surface at two distinct wavelengths separated by  $\Delta\lambda$ . Calculate and plot the ratio of the intensities  $I_{\lambda+\Delta\lambda,e}(\lambda + \Delta\lambda, \theta, \phi, T_s)$  and  $I_{\lambda,e}(\lambda, \theta, \phi, T_s)$  as a function of the surface temperature over the range  $500 \text{ K} \leq T_s \leq 1000 \text{ K}$  for  $\lambda = 5 \mu\text{m}$  and  $\Delta\lambda = 0.1, 0.5$ , and  $1 \mu\text{m}$ . Comment on the sensitivity to temperature and on whether the ratio depends on the emissivity of the surface. Discuss the tradeoffs associated with specification of the various values of  $\Delta\lambda$ . *Hint:* The change in the emissivity over small wavelength intervals is modest for most solids, as evident in Figure 12.17.

### Applications

- 12.88** Square plates freshly sprayed with an epoxy paint must be cured at  $140^\circ\text{C}$  for an extended period of time. The plates are located in a large enclosure and heated by a bank of infrared lamps. The top surface of each plate has an emissivity of  $\varepsilon = 0.8$  and experiences convection with a ventilation airstream that is at  $T_\infty = 27^\circ\text{C}$  and provides a convection coefficient of  $h = 20 \text{ W/m}^2 \cdot \text{K}$ . The irradiation from the enclosure walls is estimated to be  $G_{\text{wall}} = 450 \text{ W/m}^2$ , for which the plate absorptivity is  $\alpha_{\text{wall}} = 0.7$ .

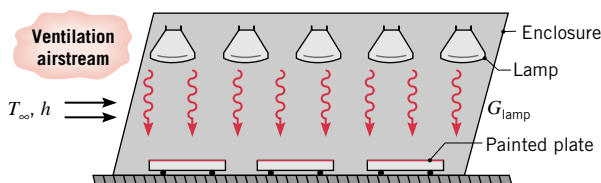


- Determine the irradiation that must be provided by the lamps,  $G_{\text{lamp}}$ . The absorptivity of the plate surface for this irradiation is  $\alpha_{\text{lamp}} = 0.6$ .
- For convection coefficients of  $h = 15, 20$ , and  $30 \text{ W/m}^2 \cdot \text{K}$ , plot the lamp irradiation,  $G_{\text{lamp}}$ , as a function of the plate temperature,  $T_s$ , for  $100 \leq T_s \leq 300^\circ\text{C}$ .
- For convection coefficients in the range from 10 to  $30 \text{ W/m}^2 \cdot \text{K}$  and a lamp irradiation of  $G_{\text{lamp}} = 3000 \text{ W/m}^2$ , plot the airstream temperature  $T_\infty$  required to maintain the plate at  $T_s = 140^\circ\text{C}$ .


- 12.89** An apparatus commonly used for measuring the reflectivity of materials is shown below. A water-cooled sample, of 30-mm diameter and temperature  $T_s = 300 \text{ K}$ , is mounted flush with the inner surface of a large enclosure. The walls of the enclosure are gray and diffuse with an emissivity of 0.8 and a uniform temperature

$T_f = 1000 \text{ K}$ . A small aperture is located at the bottom of the enclosure to permit sighting of the sample or the enclosure wall. The spectral reflectivity  $\rho_\lambda$  of an opaque, diffuse sample material is as shown. The heat transfer coefficient for convection between the sample and the air within the cavity, which is also at  $1000 \text{ K}$ , is  $h = 10 \text{ W/m}^2 \cdot \text{K}$ .

- Calculate the absorptivity of the sample.
- Calculate the emissivity of the sample.
- Determine the heat removal rate (W) by the coolant.
- The ratio of the radiation in the A direction to that in the B direction will give the reflectivity of the sample. Briefly explain why this is so.

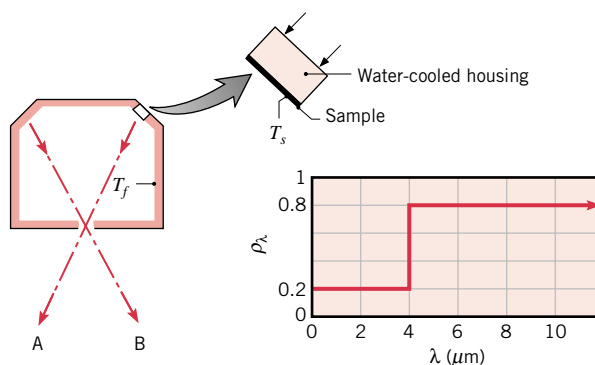

- 12.90** A very small sample of an opaque surface is initially at  $1200 \text{ K}$  and has the spectral, hemispherical absorptivity shown.

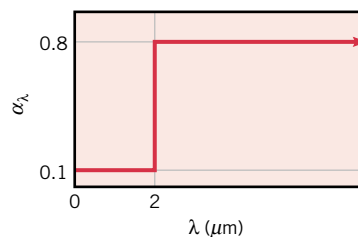

The sample is placed inside a very large enclosure whose walls have an emissivity of 0.2 and are maintained at  $2400 \text{ K}$ .

- What is the total, hemispherical absorptivity of the sample surface?
- What is its total, hemispherical emissivity?
- What are the values of the absorptivity and emissivity after the sample has been in the enclosure a long time?

- (d) For a 10-mm-diameter spherical sample in an evacuated enclosure, compute and plot the variation of the sample temperature with time, as it is heated from its initial temperature of 1200 K.


**12.91** A manufacturing process involves heating long copper rods, which are coated with a thin film, in a large furnace whose walls are maintained at an elevated temperature  $T_w$ . The furnace contains quiescent nitrogen gas at 1-atm pressure and a temperature of  $T_\infty = T_w$ . The film is a diffuse surface with a spectral emissivity of  $\varepsilon_\lambda = 0.9$  for  $\lambda \leq 2 \mu\text{m}$  and  $\varepsilon_\lambda = 0.4$  for  $\lambda > 2 \mu\text{m}$ .

- (a) Consider conditions for which a rod of diameter  $D$  and initial temperature  $T_i$  is inserted in the furnace, such that its axis is horizontal. Assuming validity of the lumped capacitance approximation, derive an equation that could be used to determine the rate of change of the rod temperature at the time of insertion. Express your result in terms of appropriate variables.

- (b) If  $T_w = T_\infty = 1500 \text{ K}$ ,  $T_i = 300 \text{ K}$ , and  $D = 10 \text{ mm}$ , what is the initial rate of change of the rod temperature? Confirm the validity of the lumped capacitance approximation.

- (c) Compute and plot the variation of the rod temperature with time during the heating process.


**12.92** A procedure for measuring the thermal conductivity of solids at elevated temperatures involves placement of a sample at the bottom of a large furnace. The sample is of thickness  $L$  and is placed in a square container of width  $W$  on a side. The sides are well insulated. The walls of the cavity are maintained at  $T_w$ , while the bottom surface of the sample is maintained at a much lower temperature  $T_c$  by circulating coolant through the sample container. The sample surface is diffuse and gray with an emissivity  $\varepsilon_s$ . Its temperature  $T_s$  is measured optically.

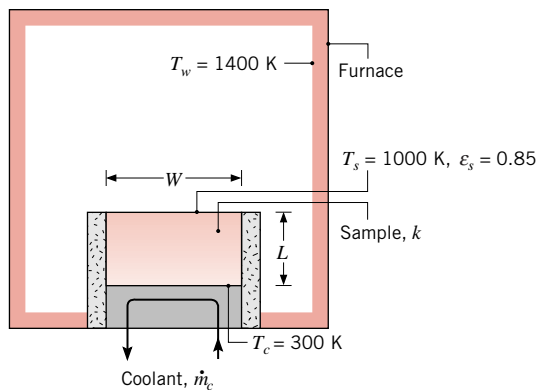

- (a) Neglecting convection effects, obtain an expression from which the sample thermal conductivity may be evaluated in terms of measured and known quantities ( $T_w$ ,  $T_s$ ,  $T_c$ ,  $\varepsilon_s$ ,  $L$ ). The measurements are made under steady-state conditions. If  $T_w = 1400 \text{ K}$ ,  $T_s = 1000 \text{ K}$ ,  $\varepsilon_s = 0.85$ ,  $L = 0.015 \text{ m}$ , and  $T_c = 300 \text{ K}$ , what is the sample thermal conductivity?

- (b) If  $W = 0.10 \text{ m}$  and the coolant is water with a flow rate of  $\dot{m}_c = 0.1 \text{ kg/s}$ , is it reasonable to assume a uniform bottom surface temperature  $T_c$ ?

**12.93** One scheme for extending the operation of gas turbine blades to higher temperatures involves applying a ceramic coating to the surfaces of blades fabricated from a superalloy such as inconel. To assess the reliability of such coatings, an apparatus has been developed for testing samples under laboratory conditions. The sample is placed at the bottom of a large vacuum chamber whose walls are cryogenically cooled and which is equipped with a radiation detector at the top surface. The detector has a surface area of  $A_d = 10^{-5} \text{ m}^2$ , is located at a distance of  $L_{s-d} = 1 \text{ m}$  from the sample, and views radiation originating from a portion of the ceramic surface having an area of  $\Delta A_c = 10^{-4} \text{ m}^2$ . An electric heater attached to the bottom of the sample dissipates a uniform heat flux,  $q''_h$ , which is transferred upward through the sample. The bottom of the heater and sides of the sample are well insulated.

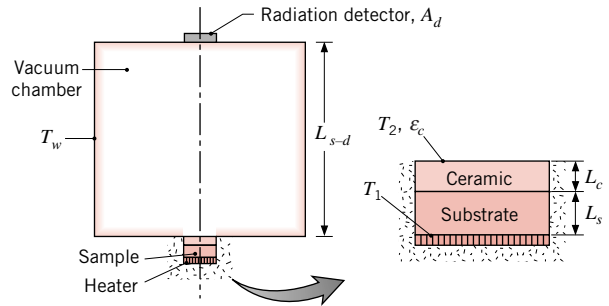

Consider conditions for which a ceramic coating of thickness  $L_c = 0.5 \text{ mm}$  and thermal conductivity  $k_c = 6 \text{ W/m} \cdot \text{K}$  has been sprayed on a metal substrate of thickness  $L_s = 8 \text{ mm}$  and thermal conductivity  $k_s = 25 \text{ W/m} \cdot \text{K}$ . The opaque surface of the ceramic may be approximated as diffuse and gray, with a total, hemispherical emissivity of  $\varepsilon_c = 0.8$ .


- (a) Consider steady-state conditions for which the bottom surface of the substrate is maintained at  $T_1 = 1500 \text{ K}$ , while the chamber walls (including the surface of the radiation detector) are maintained at  $T_w = 90 \text{ K}$ . Assuming negligible



thermal contact resistance at the ceramic–substrate interface, determine the ceramic top surface temperature  $T_2$  and the heat flux  $q''_h$ .

- (b) For the prescribed conditions, what is the rate at which radiation emitted by the ceramic is intercepted by the detector?
- (c) After repeated experiments, numerous cracks develop at the ceramic–substrate interface, creating an interfacial thermal contact resistance. If  $T_w$  and  $q''_h$  are maintained at the conditions associated with part (a), will  $T_1$  increase, decrease, or remain the same? Similarly, will  $T_2$  increase, decrease, or remain the same? In each case, justify your answer.

**12.94** The equipment for heating a wafer during a semiconductor manufacturing process is shown schematically. The wafer is heated by an ion beam source (not shown) to a uniform, steady-state temperature. The large chamber contains the process gas, and its walls are at a uniform temperature of  $T_{ch} = 400$  K. A  $5 \times 5$  mm target area on the wafer is viewed by a radiometer, whose objective lens has a diameter of 25 mm and is located 500 mm from the wafer. The line-of-sight of the radiometer is  $30^\circ$  off the wafer normal.

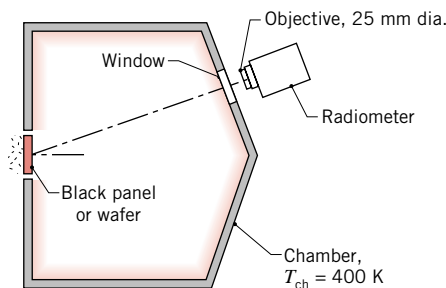


- (a) In a preproduction test of the equipment, a black panel ( $\varepsilon \approx 1.0$ ) is mounted in place of the wafer. Calculate the radiant power (W) received by the radiometer if the temperature of the panel is 800 K.
- (b) The wafer, which is opaque, diffuse-gray with an emissivity of 0.7, is now placed in the equipment, and the ion beam is adjusted so that the power received by the radiometer is the same as that found for part (a). Calculate the temperature of the wafer for this heating condition.

**12.95** The fire brick of Example 12.9 is used to construct the walls of a brick oven. The irradiation on the interior surface of the wall is  $G = 50,000$  W/m<sup>2</sup> and has a spectral distribution proportional to that of a blackbody at 2000 K. The temperature of the gases adjacent

to the inner wall of the oven is 500 K, and the convection heat transfer coefficient is 25 W/m<sup>2</sup>. Find the wall surface temperature if the heat loss through the wall is negligible. If the brick wall is 0.1 m thick and of thermal conductivity  $k_b = 1.0$  W/m · K, and is insulated with a 0.1-m-thick layer of thermal conductivity  $k_i = 0.05$  W/m · K, what is the steady-state interior wall surface temperature if the temperature of the external surface of the insulation is 300 K?

**12.96** A laser-materials-processing apparatus encloses a sample in the form of a disk of diameter  $D = 25$  mm and thickness  $w = 1$  mm. The sample has a diffuse surface for which the spectral distribution of the emissivity,  $\varepsilon_\lambda(\lambda)$ , is prescribed. To reduce oxidation, an inert gas stream of temperature  $T_\infty = 500$  K and convection coefficient  $h = 50$  W/m<sup>2</sup> · K flows over the sample upper and lower surfaces. The apparatus enclosure is large, with isothermal walls at  $T_{enc} = 300$  K. To maintain the sample at a suitable operating temperature of  $T_s = 2000$  K, a collimated laser beam with an operating wavelength of  $\lambda = 0.5$  μm irradiates its upper surface.

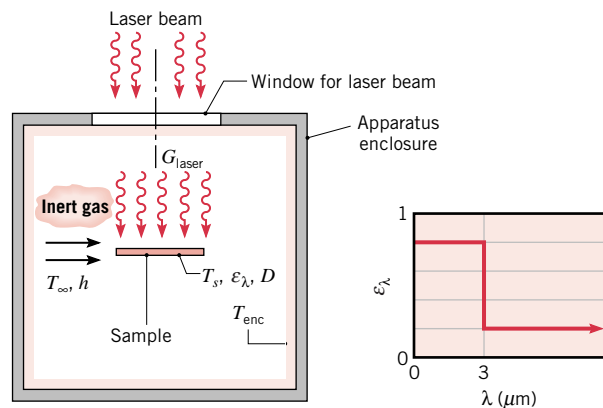


- (a) Determine the total emissivity  $\varepsilon$  of the sample.
- (b) Determine the total absorptivity  $\alpha$  of the sample for irradiation from the enclosure walls.
- (c) Perform an energy balance on the sample and determine the laser irradiation,  $G_{laser}$ , required to maintain the sample at  $T_s = 2000$  K.
- (d) Consider a *cool-down* process, when the laser and the inert gas flow are deactivated. Sketch the total emissivity as a function of the sample temperature,  $T_s(t)$ , during the process. Identify key features, including the emissivity for the final condition ( $t \rightarrow \infty$ ).
- (e) Estimate the time to cool a sample from its operating condition at  $T_s(0) = 2000$  K to a *safe-to-touch*

temperature of  $T_s(t) = 40^\circ\text{C}$ . Use the lumped capacitance method and include the effect of convection to the inert gas with  $h = 50 \text{ W/m}^2 \cdot \text{K}$  and  $T_\infty = T_{\text{enc}} = 300 \text{ K}$ . The thermophysical properties of the sample material are  $\rho = 3900 \text{ kg/m}^3$ ,  $c_p = 760 \text{ J/kg} \cdot \text{K}$ , and  $k = 45 \text{ W/m} \cdot \text{K}$ .

**12.97** A cylinder of 30-mm diameter and 150-mm length is heated in a large furnace having walls at 1000 K, while air at 400 K is circulating at 3 m/s. Estimate the steady-state cylinder temperature under the following specified conditions.

- The cylinder is in cross flow, and its surface is diffuse and gray with an emissivity of 0.5.
- The cylinder is in cross flow, but its surface is spectrally selective with  $\alpha_\lambda = 0.1$  for  $\lambda \leq 3 \mu\text{m}$  and  $\alpha_\lambda = 0.5$  for  $\lambda > 3 \mu\text{m}$ .
- The cylinder surface is positioned such that the airflow is longitudinal and its surface is diffuse and gray.
- For the conditions of part (a), compute and plot the cylinder temperature as a function of the air velocity for  $1 \leq V \leq 20 \text{ m/s}$ .


**12.98** An instrumentation transmitter pod is a box containing electronic circuitry and a power supply for sending sensor signals to a base receiver for recording. Such a pod is placed on a conveyor system, which passes through a large vacuum brazing furnace as shown in the sketch. The exposed surfaces of the pod have a special diffuse, opaque coating with spectral emissivity as shown.

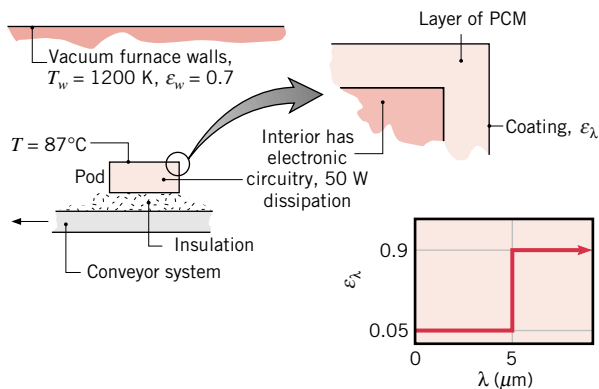

To stabilize the temperature of the pod and prevent overheating of the electronics, the inner surface of the pod is surrounded by a layer of a phase-change material (PCM) having a fusion temperature of  $87^\circ\text{C}$  and a heat of fusion of  $25 \text{ kJ/kg}$ . The pod has an

exposed surface area of  $0.040 \text{ m}^2$  and the mass of the PCM is  $1.6 \text{ kg}$ . Furthermore, it is known that the power dissipated by the electronics is  $50 \text{ W}$ . Consider the situation when the pod enters the furnace at a uniform temperature of  $87^\circ\text{C}$  and all the PCM is in the solid state. How long will it take before all the PCM changes to the liquid state?


**12.99** To simulate materials processing under the microgravity conditions of space, a niobium sphere of diameter 3 mm is levitated by an acoustical technique in a vacuum chamber. Initially the sphere is at 300 K and is suddenly irradiated with a laser providing an irradiation of  $10 \text{ W/mm}^2$  to raise its temperature as quickly as possible to its melting point (2741 K). When the melting point is reached, the laser is switched off and a radio frequency (RF) heater is energized, causing uniform internal volumetric generation  $\dot{q}$  to occur within the sphere. Assume that the niobium sphere is isothermal and diffuse and gray with an emissivity of 0.6, and that the chamber walls are at 300 K.

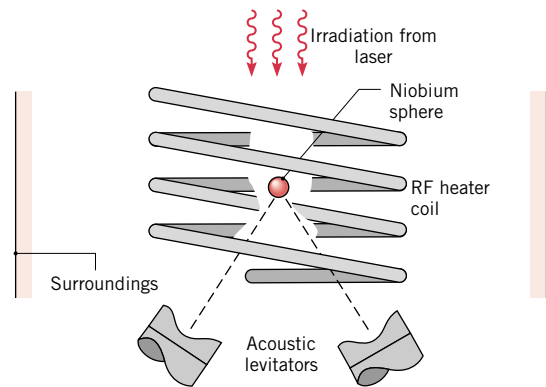

- How much time is required to reach the melting point? *Hint:* See Section 5.3 and modify the lumped capacitance analysis accordingly.
- How much power must be provided by the RF heater to maintain the sphere at its melting point?
- Is the spacewise isothermal assumption realistic for the conditions of parts (a) and (b)?


**12.100** A spherical niobium droplet of diameter  $D = 3 \text{ mm}$  is levitated by an acoustical technique in a vacuum chamber having walls that are diffuse and gray with an emissivity of  $\epsilon_w = 0.8$  and a temperature of  $T_w = 300 \text{ K}$ . The niobium surface is diffuse and has the prescribed spectral emissivity distribution.

Two heating methods for maintaining the drop at its melting temperature,  $T_{\text{mp}} = 2741 \text{ K}$ , are to be investigated.

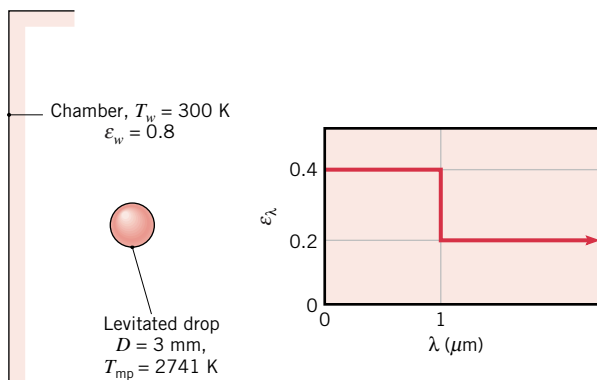

- (a) The effect of applying a radio frequency (RF) field to the drop is to create a uniform internal generation rate,  $\dot{q}$  ( $\text{W}/\text{m}^3$ ), within the drop. Calculate the value of  $\dot{q}$  required to maintain the drop at its melting temperature.
- (b) A laser beam, having a diameter larger than that of the drop and operating at  $10.6 \mu\text{m}$ , irradiates the drop. Determine the irradiation,  $G_{\text{laser}}$  ( $\text{W}/\text{mm}^2$ ), required to maintain the drop at its melting temperature. What irradiation would be required if the laser operating wavelength were  $0.632 \mu\text{m}$ ?
- (c) Estimate the time it would take for the drop to cool to  $400$  K if the RF field or laser heating were terminated.


**12.101** A thin-walled plate separates the interior of a large furnace from surroundings at  $300$  K. The plate is fabricated from a ceramic material for which diffuse surface behavior may be assumed and the exterior surface is air cooled. With the furnace operating at  $2400$  K, convection at the interior surface may be neglected.

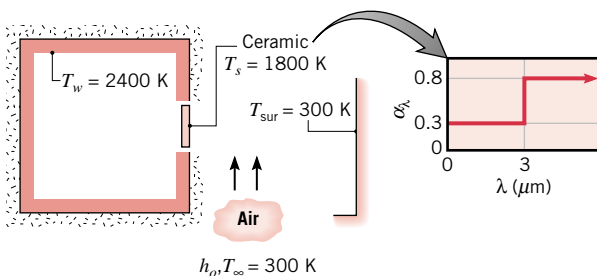

- (a) If the temperature of the ceramic plate is not to exceed  $1800$  K, what is the minimum value of the outside convection coefficient,  $h_o$ , that must be maintained by the air-cooling system?


- (b) Compute and plot the plate temperature as a function of  $h_o$  for  $50 \leq h_o \leq 250 \text{ W}/\text{m}^2 \cdot \text{K}$ .

**12.102** A thin coating, which is applied to long, cylindrical copper rods of  $10\text{-mm}$  diameter, is cured by placing the rods horizontally in a large furnace whose walls are maintained at  $1300$  K. The furnace is filled with nitrogen gas, which is also at  $1300$  K and at a pressure of  $1$  atm. The coating is diffuse, and its spectral emissivity has the distribution shown.

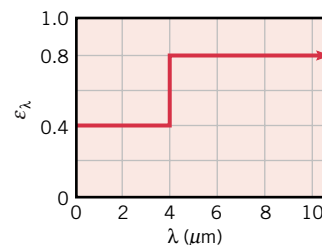


- (a) What are the emissivity and absorptivity of the coated rods when their temperature is  $300$  K?
- (b) What is the initial rate of change of their temperature?
- (c) What are the emissivity and absorptivity of the coated rods when they reach a steady-state temperature?
- (d) Estimate the time required for the rods to reach  $1000$  K.

**12.103** A large combination convection–radiation oven is used to heat-treat a small cylindrical product of diameter  $25$  mm and length  $0.2$  m. The oven walls are at a uniform temperature of  $1000$  K, and hot air at  $750$  K is in cross flow over the cylinder with a velocity of  $5$  m/s. The cylinder surface is opaque and diffuse with the spectral emissivity shown.

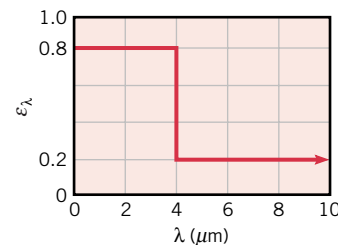

- (a) Determine the rate of heat transfer to the cylinder when it is first placed in the oven at  $300$  K.
- (b) What is the steady-state temperature of the cylinder?
- (c) How long will it take for the cylinder to reach a temperature that is within  $50^\circ\text{C}$  of its steady-state value?


- 12.104** A 10-mm-thick workpiece, initially at 25°C, is to be annealed at a temperature above 725°C for a period of at least 5 minutes and then cooled. The workpiece is opaque and diffuse, and the spectral distribution of its emissivity is shown schematically. Heating is effected in a large furnace with walls and circulating air at 750°C and a convection coefficient of 100 W/m<sup>2</sup> · K. The thermophysical properties of the workpiece are  $\rho = 2700$  kg/m<sup>3</sup>,  $c = 885$  J/kg · K, and  $k = 165$  W/m · K.

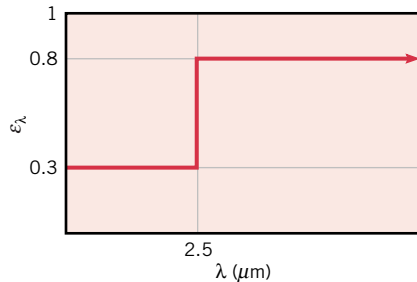

- Calculate the emissivity and the absorptivity of the workpiece when it is placed in the furnace at its initial temperature of 25°C.
- Determine the net heat flux into the workpiece for this initial condition. What is the corresponding rate of change in temperature,  $dT/dt$ , for the workpiece?
- Using the *Tools/Radiation/Band Emission* model of *IHT*, calculate and plot the emissivity of the workpiece as a function of temperature for the range from 25 to 750°C.
- Assuming applicability of the lumped capacitance method, calculate the time required for the workpiece to reach 725°C. Use the DER function in *IHT* to represent the temperature-time derivative in your energy balance. Also use the *IHT* code of part (c) to represent the emissivity as a function of workpiece temperature.
- Calculate the time for the workpiece to cool from 750°C to a safe-to-touch temperature of 40°C, if the surroundings and cooling air temperature are 25°C and the convection coefficient is 100 W/m<sup>2</sup> · K.
- Assuming that the workpiece temperature increases from 725°C to 750°C during a 5 minute annealing period, after which cooling is initiated, sketch the temperature history of the workpiece from the start of heating to the end of cooling. Identify key features of the process and determine the total time requirement.

Is the lumped-capacitance method of analysis justified?

- 12.105** After being cut from a large single-crystal boule and polished, silicon wafers undergo a high-temperature annealing process. One technique for heating the wafer is to irradiate its top surface using high-intensity, tungsten-halogen lamps having a spectral distribution approximating that of a blackbody at 2800 K. To determine the lamp power and the rate at which radiation is absorbed by the wafer, the equipment designer needs to know its absorptivity as a function of temperature. Silicon is a semiconductor material that exhibits a characteristic *band edge*, and its spectral absorptivity may be idealized as shown schematically. At low and moderate temperatures, silicon is semitransparent at wavelengths larger than that of the band edge, but becomes nearly opaque above 600°C.

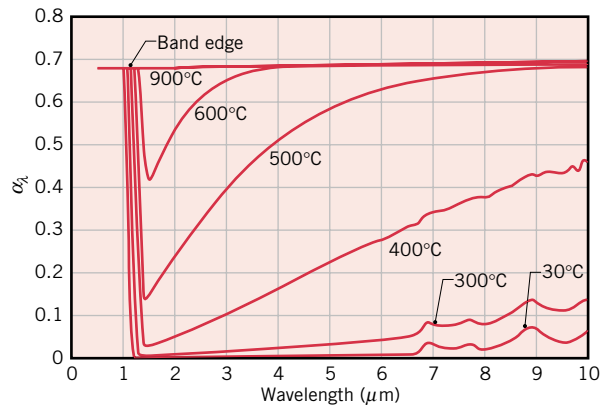

- What are the 1% limits of the spectral band that includes 98% of the blackbody radiation corresponding to the spectral distribution of the lamps? Over what spectral region do you need to know the spectral absorptivity?
- How do you expect the total absorptivity of silicon to vary as a function of its temperature? Sketch the variation and explain its key features.
- Calculate the total absorptivity of the silicon wafer for the lamp irradiation and each of the five temperatures shown schematically. From the data, calculate the emissivity of the wafer at 600 and 900°C. Explain your results and why the emissivity changes with temperature. *Hint:* Within *IHT*, create a *look-up* table to specify values of the spectral properties and the LOOKUPVAL and INTEGRAL functions to perform the necessary integrations.

- (d) If the wafer is in a vacuum and radiation exchange only occurs at one face, what is the irradiation needed to maintain a wafer temperature of  $600^\circ\text{C}$ ?


### Environmental Radiation

**12.106** Solar irradiation of  $1100\text{ W/m}^2$  is incident on a large, flat, horizontal metal roof on a day when the wind blowing over the roof causes a convection heat transfer coefficient of  $25\text{ W/m}^2 \cdot \text{K}$ . The outside air temperature is  $27^\circ\text{C}$ , the metal surface absorptivity for incident solar radiation is 0.60, the metal surface emissivity is 0.20, and the roof is well insulated from below.

(a) Estimate the roof temperature under steady-state conditions.

(b) Explore the effect of changes in the absorptivity, emissivity, and convection coefficient on the steady-state temperature.

**12.107** A deep cavity of 50-mm diameter approximates a blackbody and is maintained at  $250^\circ\text{C}$  while exposed to solar irradiation of  $800\text{ W/m}^2$  and surroundings and ambient air at  $25^\circ\text{C}$ . A thin window of spectral transmissivity and reflectivity 0.9 and 0, respectively, for the spectral range  $0.2$  to  $4\text{ }\mu\text{m}$  is placed over the cavity opening. In the spectral range beyond  $4\text{ }\mu\text{m}$ , the window behaves as an opaque, diffuse, gray body of emissivity 0.95. Assuming that the convection coefficient on the upper surface of the window is  $10\text{ W/m}^2 \cdot \text{K}$ , determine the temperature of the window and the power required to maintain the cavity at  $250^\circ\text{C}$ .

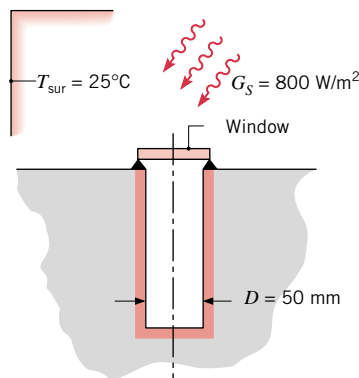

**12.108** Consider the evacuated tube solar collector described in part (d) of Problem 1.73 of Chapter 1. In the interest of maximizing collector efficiency, what spectral radiative characteristics are desired for the outer tube and for the inner tube?

**12.109** Solar flux of  $900\text{ W/m}^2$  is incident on the top side of a plate whose surface has a solar absorptivity of 0.9 and an emissivity of 0.1. The air and surroundings are at  $17^\circ\text{C}$  and the convection heat transfer coefficient between the plate and air is  $20\text{ W/m}^2 \cdot \text{K}$ . Assuming that the bottom side of the plate is insulated, determine the steady-state temperature of the plate.

**12.110** Consider an opaque, gray surface whose directional absorptivity is 0.8 for  $0 \leq \theta \leq 60^\circ$  and 0.1 for  $\theta > 60^\circ$ . The surface is horizontal and exposed to solar irradiation comprised of direct and diffuse components.

(a) What is the surface absorptivity to direct solar radiation that is incident at an angle of  $45^\circ$  from the normal? What is the absorptivity to diffuse irradiation?

(b) Neglecting convection heat transfer between the surface and the surrounding air, what would be the equilibrium temperature of the surface if the direct and diffuse components of the irradiation were 600 and  $100\text{ W/m}^2$ , respectively? The back side of the surface is insulated.

**12.111** The absorber plate of a solar collector may be coated with an opaque material for which the spectral, directional absorptivity is characterized by relations of the form

$$\alpha_{\lambda,\theta}(\lambda, \theta) = \alpha_1 \cos \theta \quad \lambda < \lambda_c$$

$$\alpha_{\lambda,\theta}(\lambda, \theta) = \alpha_2 \quad \lambda > \lambda_c$$

The zenith angle  $\theta$  is formed by the sun's rays and the plate normal, and  $\alpha_1$  and  $\alpha_2$  are constants.


(a) Obtain an expression for the total, hemispherical absorptivity,  $\alpha_s$ , of the plate to solar radiation incident at  $\theta = 45^\circ$ . Evaluate  $\alpha_s$  for  $\alpha_1 = 0.93$ ,  $\alpha_2 = 0.25$ , and a cut-off wavelength of  $\lambda_c = 2\text{ }\mu\text{m}$ .

(b) Obtain an expression for the total, hemispherical emissivity  $\varepsilon$  of the plate. Evaluate  $\varepsilon$  for a plate temperature of  $T_p = 60^\circ\text{C}$  and the prescribed values of  $\alpha_1$ ,  $\alpha_2$ , and  $\lambda_c$ .

(c) For a solar flux of  $q_s'' = 1000\text{ W/m}^2$  incident at  $\theta = 45^\circ$  and the prescribed values of  $\alpha_1$ ,  $\alpha_2$ ,  $\lambda_c$ , and  $T_p$ , what is the net radiant heat flux,  $q_{\text{net}}''$ , to the plate?


(d) Using the prescribed conditions and the *Radiation/Band Emission Factor* option in the *Tools* section of *IHT* to evaluate  $F_{(0 \rightarrow \lambda)}$ , explore the effect of  $\lambda_c$  on  $\alpha_s$ ,  $\varepsilon$ , and  $q_{\text{net}}''$  for the wavelength range  $0.7 \leq \lambda_c \leq 5\text{ }\mu\text{m}$ .

- 12.112** A contractor must select a roof covering material from the two diffuse, opaque coatings with  $\alpha_\lambda(\lambda)$  as shown. Which of the two coatings would result in a lower roof temperature? Which is preferred for summer use? For winter use? Sketch the spectral distribution of  $\alpha_\lambda$  that would be ideal for summer use. For winter use.

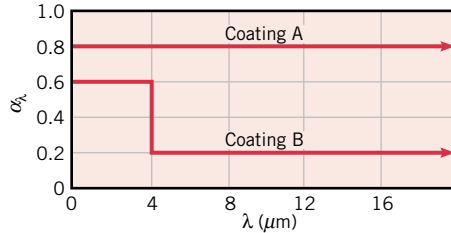

- 12.113** It is not uncommon for the night sky temperature in desert regions to drop to  $-40^\circ\text{C}$ . If the ambient air temperature is  $20^\circ\text{C}$  and the convection coefficient for still air conditions is approximately  $5 \text{ W/m}^2 \cdot \text{K}$ , can a shallow pan of water freeze?
- 12.114** Radiation from the atmosphere or sky can be estimated as a fraction of the blackbody radiation corresponding to the air temperature near the ground,  $T_{\text{air}}$ . That is, irradiation from the sky can be expressed as  $G_{\text{sky}} = \varepsilon_{\text{sky}} \sigma T_{\text{air}}^4$  and for a clear night sky, the emissivity is correlated by an expression of the form  $\varepsilon_{\text{sky}} = 0.741 + 0.0062T_{\text{dp}}$ , where  $T_{\text{dp}}$  is the dew point temperature ( $^\circ\text{C}$ ). Consider a flat plate exposed to the night sky and in ambient air at  $15^\circ\text{C}$  with a relative humidity of 70%. Assume the back side of the plate is insulated, and that the convection coefficient on the front side can be estimated by the correlation  $\bar{h}(\text{W/m}^2 \cdot \text{K}) = 1.25\Delta T^{1/3}$ , where  $\Delta T$  is the absolute value of the plate-to-air temperature difference. Will dew form on the plate if the surface is (a) clean and metallic with  $\varepsilon = 0.23$ , and (b) painted with  $\varepsilon = 0.85$ ?

- 12.115** A thin sheet of glass is used on the roof of a greenhouse and is irradiated as shown.

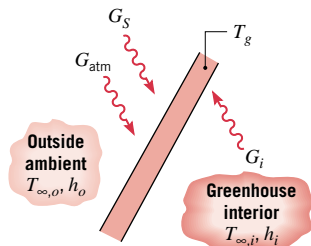


The irradiation comprises the total solar flux  $G_S$ , the flux  $G_{\text{atm}}$  due to atmospheric emission (sky radia-

tion), and the flux  $G_i$  due to emission from interior surfaces. The fluxes  $G_{\text{atm}}$  and  $G_i$  are concentrated in the far IR region ( $\lambda \geq 8 \mu\text{m}$ ). The glass may also exchange energy by convection with the outside and inside atmospheres. The glass may be assumed to be totally transparent for  $\lambda < 1 \mu\text{m}$  ( $\tau_\lambda = 1.0$  for  $\lambda < 1 \mu\text{m}$ ) and opaque, with  $\alpha_\lambda = 1.0$  for  $\lambda \geq 1 \mu\text{m}$ .

- (a) Assuming steady-state conditions, with all radiative fluxes uniformly distributed over the surfaces and the glass characterized by a uniform temperature  $T_g$ , write an appropriate energy balance for a unit area of the glass.
- (b) For  $T_g = 27^\circ\text{C}$ ,  $h_i = 10 \text{ W/m}^2 \cdot \text{K}$ ,  $G_S = 1100 \text{ W/m}^2$ ,  $T_{\infty,o} = 24^\circ\text{C}$ ,  $h_o = 55 \text{ W/m}^2 \cdot \text{K}$ ,  $G_{\text{atm}} = 250 \text{ W/m}^2$ , and  $G_i = 440 \text{ W/m}^2$ , calculate the temperature of the greenhouse ambient air,  $T_{\infty,i}$ .


- 12.116** A solar furnace consists of an evacuated chamber with transparent windows, through which concentrated solar radiation is passed. Concentration may be achieved by mounting the furnace at the focal point of a large curved reflector that tracks radiation incident directly from the sun. The furnace may be used to evaluate the behavior of materials at elevated temperatures, and we wish to design an experiment to assess the durability of a diffuse, spectrally selective coating for which  $\alpha_\lambda = 0.95$  in the range  $\lambda \leq 4.5 \mu\text{m}$  and  $\alpha_\lambda = 0.03$  for  $\lambda > 4.5 \mu\text{m}$ . The coating is applied to a plate that is suspended in the furnace.

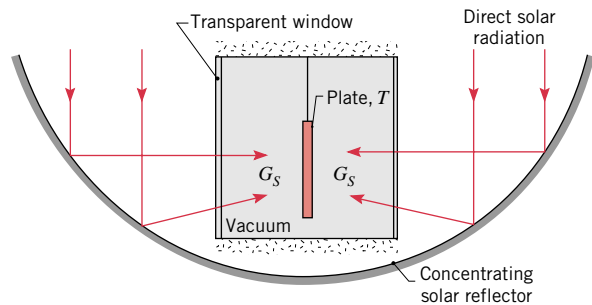

- (a) If the experiment is to be operated at a steady-state plate temperature of  $T = 2000 \text{ K}$ , how much solar irradiation  $G_S$  must be provided? The irradiation may be assumed to be uniformly distributed over the plate surface, and other sources of incident radiation may be neglected.
- (b) The solar irradiation may be *tuned* to allow operation over a range of plate temperatures. Compute and plot  $G_S$  as a function of temperature for  $500 \leq T \leq 3000 \text{ K}$ . Plot the corresponding values of  $\alpha$  and  $\varepsilon$  as a function of  $T$  for the designated range.




- 12.117** In the central receiver concept of solar energy collection, a large number of heliostats (reflectors) provide a concentrated solar flux of  $q_s'' = 80,000 \text{ W/m}^2$  to the receiver, which is positioned at the top of a tower.

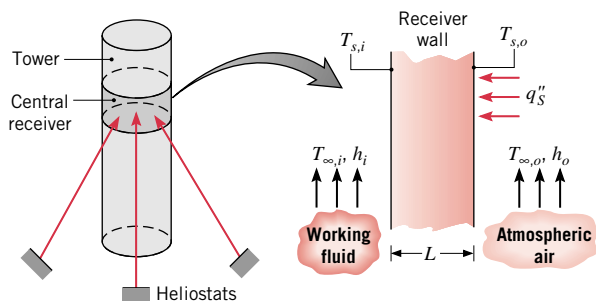

The receiver wall is exposed to the solar flux at its outer surface and to atmospheric air for which  $T_{\infty,o} = 300 \text{ K}$  and  $h_o = 25 \text{ W/m}^2 \cdot \text{K}$ . The outer surface is opaque and diffuse, with a spectral absorptivity of  $\alpha_\lambda = 0.9$  for  $\lambda < 3 \mu\text{m}$  and  $\alpha_\lambda = 0.2$  for  $\lambda > 3 \mu\text{m}$ . The inner surface is exposed to a working fluid (a pressurized liquid) for which  $T_{\infty,i} = 700 \text{ K}$  and  $h_i = 1000 \text{ W/m}^2 \cdot \text{K}$ . The outer surface is also exposed to surroundings for which  $T_{\text{sur}} = 300 \text{ K}$ . If the wall is fabricated from a high-temperature material for which  $k = 15 \text{ W/m} \cdot \text{K}$ , what is the minimum thickness  $L$  needed to ensure that the outer surface temperature does not exceed  $T_{s,o} = 1000 \text{ K}$ ? What is the collection efficiency associated with this thickness?

- 12.118** Consider the central receiver of Problem 12.117 to be a cylindrical shell of outer diameter  $D = 7 \text{ m}$  and length  $L = 12 \text{ m}$ . The outer surface is opaque and diffuse, with a spectral absorptivity of  $\alpha_\lambda = 0.9$  for  $\lambda < 3 \mu\text{m}$  and  $\alpha_\lambda = 0.2$  for  $\lambda > 3 \mu\text{m}$ . The surface is exposed to quiescent ambient air for which  $T_\infty = 300 \text{ K}$ .

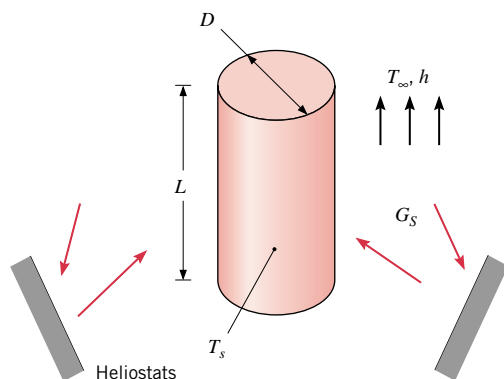


- (a) Consider representative operating conditions for which solar irradiation at  $G_s = 80,000 \text{ W/m}^2$  is

uniformly distributed over the receiver surface and the surface temperature is  $T_s = 800 \text{ K}$ . Determine the rate at which energy is collected by the receiver and the corresponding collector efficiency.

- (b) The surface temperature is affected by conditions internal to the receiver. For  $G_s = 80,000 \text{ W/m}^2$ , compute and plot the rate of energy collection and the collector efficiency for  $600 \leq T_s \leq 1000 \text{ K}$ .


- 12.119** The flat roof on the refrigeration compartment of a food delivery truck is of length  $L = 5 \text{ m}$  and width  $W = 2 \text{ m}$ . It is fabricated from thin sheet metal to which a fiberboard insulating material of thickness  $t = 25 \text{ mm}$  and thermal conductivity  $k = 0.05 \text{ W/m} \cdot \text{K}$  is bonded. During normal operation, the truck moves at a velocity of  $V = 30 \text{ m/s}$  in air at  $T_\infty = 27^\circ\text{C}$ , with a rooftop solar irradiation of  $G_s = 900 \text{ W/m}^2$  and with the interior surface temperature maintained at  $T_{s,i} = -13^\circ\text{C}$ .

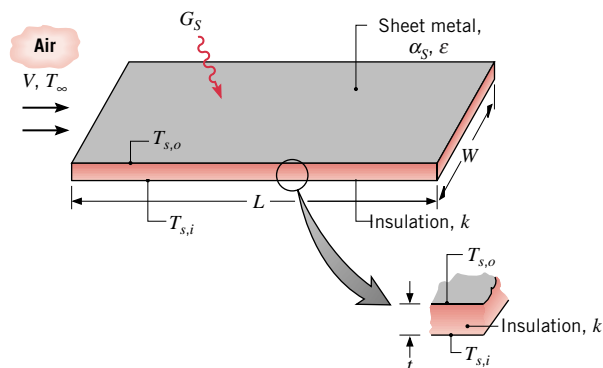

- (a) The owner has the option of selecting a roof coating from one of the three paints listed in Table A.12 (Parsons Black, Acrylic White, or Zinc Oxide White). Which should be chosen and why?
- (b) For the preferred paint of part (a), determine the steady-state value of the outer surface temperature  $T_{s,o}$ . The boundary layer is tripped at the leading edge of the roof, and turbulent flow may be assumed to exist over the entire roof. Properties of the air may be taken to be  $\nu = 15 \times 10^{-6} \text{ m}^2/\text{s}$ ,  $k = 0.026 \text{ W/m} \cdot \text{K}$ , and  $Pr = 0.71$ .
- (c) What is the load (W) imposed on the refrigeration system by heat transfer through the roof?
- (d) Explore the effect of the truck velocity on the outer surface temperature and the heat load.

- 12.120** Growers use giant fans to prevent grapes from freezing when the effective sky temperature is low. The

grape, which may be viewed as a thin skin of negligible thermal resistance enclosing a volume of sugar water, is exposed to ambient air and is irradiated from the sky above and ground below. Assume the grape to be an isothermal sphere of 15-mm diameter, and assume uniform blackbody irradiation over its top and bottom hemispheres due to emission from the sky and the earth, respectively.

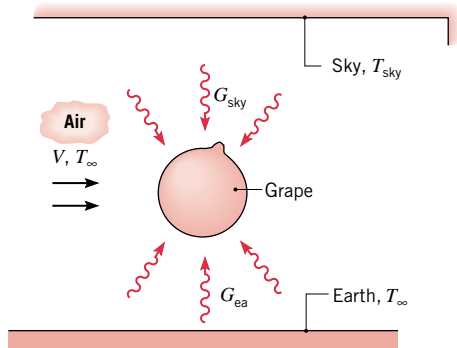

- Derive an expression for the rate of change of the grape temperature. Express your result in terms of a convection coefficient and appropriate temperatures and radiative quantities.
  - Under conditions for which  $T_{\text{sky}} = 235 \text{ K}$ ,  $T_{\infty} = 273 \text{ K}$ , and the fan is off ( $V = 0$ ), determine whether the grapes will freeze. To a good approximation, the skin emissivity is 1 and the grape thermophysical properties are those of sugarless water. However, because of the sugar content, the grape freezes at  $-5^{\circ}\text{C}$ .
  - With all conditions remaining the same, except that the fans are now operating with  $V = 1 \text{ m/s}$ , will the grapes freeze?
- 12.121** A circular metal disk having a diameter of 0.4 m is placed firmly against the ground in a barren horizontal region where the earth is at a temperature of 280 K. The effective sky temperature is also 280 K. The disk is exposed to quiescent ambient air at 300 K and direct solar irradiation of  $745 \text{ W/m}^2$ . The surface of the disk is diffuse with  $\epsilon_{\lambda} = 0.9$  for  $0 < \lambda < 1 \mu\text{m}$  and  $\epsilon_{\lambda} = 0.2$  for  $\lambda > 1 \mu\text{m}$ . After some time has elapsed, the disk achieves a uniform, steady-state temperature. The thermal conductivity of the soil is  $0.52 \text{ W/m} \cdot \text{K}$ .
- Determine the fraction of the incident solar irradiation that is absorbed.
  - What is the emissivity of the disk surface?
  - For a steady-state disk temperature of 340 K, employ a suitable correlation to determine the

average free convection heat transfer coefficient at the upper surface of the disk.


- Show that a disk temperature of 340 K does indeed yield a steady-state condition for the disk.

**12.122** The neighborhood cat likes to sleep on the roof of our shed in the backyard. The roofing surface is weathered galvanized sheet metal ( $\epsilon = 0.65$ ,  $\alpha_s = 0.8$ ). Consider a cool spring day when the ambient air temperature is  $10^{\circ}\text{C}$  and the convection coefficient can be estimated from an empirical correlation of the form  $\bar{h} = 1.0\Delta T^{1/3}$ , where  $\Delta T$  is the difference between the surface and ambient temperatures. Assume the sky temperature is  $-40^{\circ}\text{C}$ .

- Assuming the backside of the roof is well insulated, calculate the roof temperature when the solar irradiation is  $600 \text{ W/m}^2$ . Will the cat enjoy sleeping under these conditions?
- Consider the case when the backside of the roof is not insulated, but is exposed to ambient air with the same convection coefficient relation and experiences radiation exchange with the ground, also at the ambient air temperature. Calculate the roof temperature and comment on whether the roof will be a comfortable place for the cat to snooze.

**12.123** The exposed surface of a power amplifier for an earth satellite receiver of area 130 mm by 130 mm has a diffuse, gray, opaque coating with an emissivity of 0.5. For typical amplifier operating conditions, the surface temperature is  $58^{\circ}\text{C}$  under the following environmental conditions: air temperature,  $T_{\infty} = 27^{\circ}\text{C}$ ; sky temperature,  $T_{\text{sky}} = -20^{\circ}\text{C}$ ; convection coefficient,  $h = 15 \text{ W/m}^2 \cdot \text{K}$ ; and solar irradiation,  $G_s = 800 \text{ W/m}^2$ .


- For the above conditions, determine the electrical power being generated within the amplifier.
- It is desired to reduce the surface temperature by applying one of the diffuse coatings (A, B, C) shown as follows.

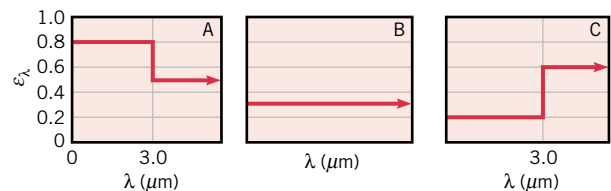

Which coating will result in the coolest surface temperature for the same amplifier operating and environmental conditions?




- 12.124** Consider a thin opaque, horizontal plate with an electrical heater on its backside. The front side is exposed to ambient air that is at  $20^\circ\text{C}$  and provides a convection heat transfer coefficient of  $10\text{ W/m}^2 \cdot \text{K}$ , solar irradiation of  $600\text{ W/m}^2$ , and an effective sky temperature of  $-40^\circ\text{C}$ .

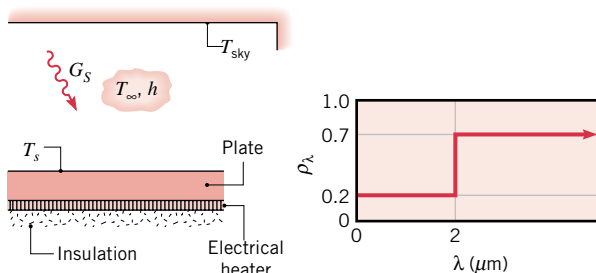

What is the electrical power ( $\text{W/m}^2$ ) required to maintain the plate surface temperature at  $T_s = 60^\circ\text{C}$  if the plate is diffuse and has the designated spectral, hemispherical reflectivity?

- 12.125** The oxidized-aluminum wing of an aircraft has a chord length of  $L_c = 4\text{ m}$  and a spectral, hemispherical emissivity characterized by the following distribution.

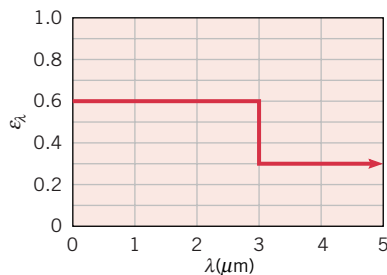


- (a) Consider conditions for which the plane is on the ground where the air temperature is  $27^\circ\text{C}$ , the solar irradiation is  $800\text{ W/m}^2$ , and the effective sky temperature is  $270\text{ K}$ . If the air is quiescent, what is the temperature of the top surface of the wing? The wing may be approximated as a horizontal, flat plate.
- (b) When the aircraft is flying at an elevation of approximately  $9000\text{ m}$  and a speed of  $200\text{ m/s}$ , the air temperature, solar irradiation, and effective sky temperature are  $-40^\circ\text{C}$ ,  $1100\text{ W/m}^2$ , and  $235\text{ K}$ , respectively. What is the temperature of the wing's top surface? The properties of the air may be approximated as  $\rho = 0.470\text{ kg/m}^3$ ,  $\mu = 1.50 \times 10^{-5}\text{ N} \cdot \text{s/m}^2$ ,  $k = 0.021\text{ W/m} \cdot \text{K}$ , and  $\text{Pr} = 0.72$ .

## Space Radiation

- 12.126** Two plates, one with a black painted surface and the other with a special coating (chemically oxidized copper) are in earth orbit and are exposed to solar radiation. The solar rays make an angle of  $30^\circ$  with the normal to the plate. Estimate the equilibrium temperature of each plate assuming they are diffuse and that the solar flux is  $1353\text{ W/m}^2$ . The spectral absorptivity of the black painted surface can be approximated by  $\alpha_\lambda = 0.95$  for  $0 \leq \lambda \leq \infty$  and that of the special coating by  $\alpha_\lambda = 0.95$  for  $0 \leq \lambda < 3\text{ } \mu\text{m}$  and  $\alpha_\lambda = 0.05$  for  $\lambda \geq 3\text{ } \mu\text{m}$ .

- 12.127** A spherical satellite of diameter  $D$  is in orbit about the earth and is coated with a diffuse material for which the spectral absorptivity is  $\alpha_\lambda = 0.6$  for  $\lambda \leq 3\text{ } \mu\text{m}$  and  $\alpha_\lambda = 0.3$  for  $\lambda > 3\text{ } \mu\text{m}$ . When it is on the "dark" side of the earth, the satellite sees irradiation from the earth's surface only. The irradiation may be assumed to be incident as parallel rays, and its magnitude is  $G_E = 340\text{ W/m}^2$ . On the "bright" side of the earth the satellite sees the earth irradiation  $G_E$  plus the solar irradiation  $G_S = 1353\text{ W/m}^2$ . The spectral distribution of radiation from the earth may be approximated as that of a blackbody at  $280\text{ K}$ , and the temperature of the satellite may be assumed to remain below  $500\text{ K}$ .

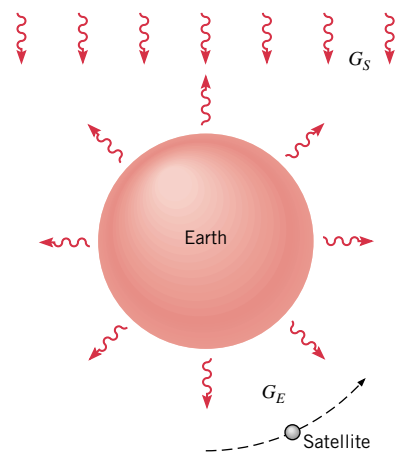


What is the steady-state temperature of the satellite when it is on the dark side of the earth and when it is on the bright side?

- 12.128** A radiator on a proposed satellite solar power station must dissipate heat being generated within the satellite by radiating it into space. The radiator surface has a solar absorptivity of  $0.5$  and an emissivity of  $0.95$ . What is the equilibrium surface temperature when the

solar irradiation is  $1000 \text{ W/m}^2$  and the required heat dissipation is  $1500 \text{ W/m}^2$ .

- 12.129** A spherical satellite in near-earth orbit is exposed to solar irradiation of  $1353 \text{ W/m}^2$ . To maintain a desired operating temperature, the thermal control engineer intends to use a checker pattern for which a fraction  $F$  of the satellite surface is coated with an evaporated aluminum film ( $\varepsilon = 0.03$ ,  $\alpha_S = 0.09$ ) and the fraction  $(1-F)$  is coated with a white, zinc-oxide paint ( $\varepsilon = 0.85$ ,  $\alpha_S = 0.22$ ). Assume the satellite is isothermal and has no internal power dissipation. Determine the fraction  $F$  of the checker pattern required to maintain the satellite at  $300 \text{ K}$ .


- 12.130** An annular fin of thickness  $t$  is used as a radiator to dissipate heat for a space power system. The fin is insulated on the bottom and may be exposed to solar irradiation  $G_S$ . The fin is coated with a diffuse, spectrally selective material whose spectral reflectivity is specified.

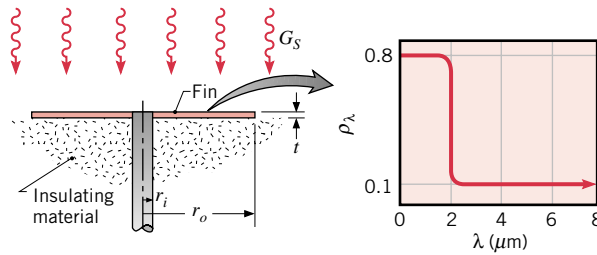

Heat is conducted to the fin through a solid rod of radius  $r_i$ , and the exposed upper surface of the fin radiates to free space, which is essentially at absolute zero temperature.


- (a) If conduction through the rod maintains a fin base temperature of  $T(r_i) = T_b = 400 \text{ K}$  and the fin efficiency is 100%, what is the rate of heat dissipation for a fin of radius  $r_o = 0.5 \text{ m}$ ? Consider two cases, one for which the radiator is exposed to the sun with  $G_S = 1000 \text{ W/m}^2$  and the other with no exposure ( $G_S = 0$ ).
- (b) In practice, the fin efficiency will be less than 100% and its temperature will decrease with increasing radius. Beginning with an appropriate control volume, derive the differential equation that determines the steady-state, radial temperature distribution in the fin. Specify appropriate boundary conditions.
- 12.131** A rectangular plate of thickness  $t$ , length  $L$ , and width  $W$  is proposed for use as a radiator in a spacecraft application. The plate material has a thermal conductivity of  $300 \text{ W/m} \cdot \text{K}$ , a solar absorptivity of 0.45,

and an emissivity of 0.9. The radiator is exposed to solar radiation only on its top surface, while both surfaces are exposed to deep space at a temperature of  $4 \text{ K}$ .

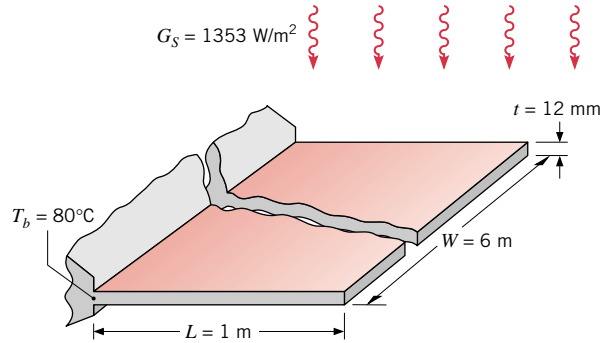


- (a) If the base of the radiator is maintained at  $T_b = 80^\circ\text{C}$ , what is its tip temperature and the rate of heat rejection? Use a computer-based, finite-difference method with a space increment of  $0.1 \text{ m}$  to obtain your solution.
- (b) Repeat the calculation of part (a) for the case when the space ship is on the dark side of the earth and is not exposed to the sun.
- (c) Use your computer code to calculate the heat rate and tip temperature for  $G_S = 0$  and an extremely large value of the thermal conductivity. Compare your results to those obtained from a hand calculation that assumes the radiator to be at a uniform temperature  $T_b$ . What other approach might you use to validate your code?

- 12.132** The directional absorptivity of a gray surface varies with  $\theta$  as follows.



- (a) What is the ratio of the normal absorptivity  $\alpha_n$  to the hemispherical emissivity of the surface?
- (b) Consider a plate with these surface characteristics on both sides in earth orbit. If the solar flux incident on one side of the plate is  $q_S'' = 1353 \text{ W/m}^2$ , what equilibrium temperature will the plate assume if it is oriented normal to the sun's rays? What temperature will it assume if it is oriented at  $75^\circ$  to the sun's rays?

- 12.133** Two special coatings are available for application to an absorber plate installed below the cover glass described in Example 12.8. Each coating is diffuse and is characterized by the spectral distributions shown.

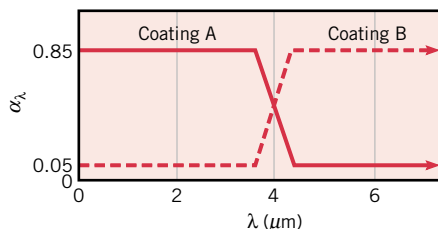

Which coating would you select for the absorber plate? Explain briefly. For the selected coating, what is the rate at which radiation is absorbed per unit area of the absorber plate if the total solar irradiation at the cover glass is  $G_s = 1000 \text{ W/m}^2$ ?

- 12.134** Consider the spherical satellite of Problem 12.127. Instead of the entire satellite being coated with a material that is spectrally selective, half of the satellite is covered with a diffuse gray coating characterized by  $\alpha_1 = 0.6$ . The other half of the satellite is coated with a diffuse gray material with  $\alpha_2 = 0.3$ .

- Determine the steady-state satellite temperature when the satellite is on the bright side of the earth with the high-absorptivity coating facing the sun. Determine the steady-state satellite temperature when the low-absorptivity coating faces the sun. *Hint:* Assume one hemisphere of the satellite is irradiated by the sun and the opposite hemisphere is irradiated by the earth.
- Determine the steady-state satellite temperature when the satellite is on the dark side of the earth with the high-absorptivity coating facing the earth. Determine the steady-state satellite temperature when the low-absorptivity coating faces the earth.
- Identify a scheme to minimize the temperature variations of the satellite as it travels between the bright and dark sides of the earth.

- 12.135** A spherical capsule of 3-m radius is fired from a space platform in earth orbit, such that it travels toward the center of the sun at 16,000 km/s. Assume that the capsule is a lumped capacitance body with a density-specific heat product of  $4 \times 10^6 \text{ J/m}^3 \cdot \text{K}$  and that its surface is black.

- Derive a differential equation for predicting the capsule temperature as a function of time. Solve this equation to obtain the temperature as a function of time in terms of capsule parameters and its initial temperature  $T_i$ .

- If the capsule begins its journey at  $20^\circ\text{C}$ , predict the position of the capsule relative to the sun at which its destruction temperature,  $150^\circ\text{C}$ , is reached.

- 12.136** Consider the spherical satellite of Problem 12.127. By changing the chemistry of the diffuse material used for the coating, engineers can control the *cutoff wavelength* that marks the boundary between  $\alpha_\lambda = 0.6$  and  $\alpha_\lambda = 0.3$ .

- What cutoff wavelength will minimize the steady-state temperature of the satellite when it is on the bright side of the earth? Using this coating, what will the steady-state temperature on the dark side of the earth be?
- What cutoff wavelength will maximize the steady-state temperature of the satellite when it is on the dark side of the earth? What will the corresponding steady-state temperature be on the bright side?

- 12.137** A solar panel mounted on a spacecraft has an area of  $1 \text{ m}^2$  and a solar-to-electrical power conversion efficiency of 12%. The side of the panel with the photovoltaic array has an emissivity of 0.8 and a solar absorptivity of 0.8. The back side of the panel has an emissivity of 0.7. The array is oriented normal to solar irradiation of  $1500 \text{ W/m}^2$ .


- Determine the steady-state temperature of the panel and the electrical power (W) produced for the prescribed conditions.
- If the panel were a thin plate without the solar cells, but with the same radiative properties, determine the temperature of the plate for the prescribed conditions. Compare this result with that from part (a). Are they the same or different? Explain why.
- Determine the temperature of the solar panel 1500 s after the spacecraft is eclipsed by the earth. The thermal capacity of the panel per unit area is  $9000 \text{ J/m}^2 \cdot \text{K}$ .

## Heat and Mass Transfer

- 12.138** It is known that on clear nights a thin layer of water on the ground will freeze before the air temperature drops below  $0^\circ\text{C}$ . Consider such a layer of water on a clear night for which the effective sky temperature is  $-30^\circ\text{C}$  and the convection heat transfer coefficient due to wind motion is  $h = 25 \text{ W/m}^2 \cdot \text{K}$ . The water may be assumed to have an emissivity of 1.0 and to be insulated from the ground as far as conduction is concerned. Neglecting evaporation, determine the lowest temperature that the air can have without the water freezing. Accounting now for the effect of

evaporation, what is the lowest temperature that the air can have without the water freezing? Assume the air to be dry.

- 12.139** A shallow layer of water is exposed to the natural environment as shown.

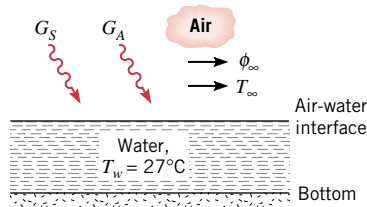


Consider conditions for which the solar and atmospheric irradiances are  $G_S = 600 \text{ W/m}^2$  and  $G_A = 300 \text{ W/m}^2$ , respectively, and the air temperature and relative humidity are  $T_\infty = 27^\circ\text{C}$  and  $\phi_\infty = 0.50$ , respectively. The reflectivities of the water surface to the solar and atmospheric irradiation are  $\rho_S = 0.3$  and  $\rho_A = 0$ , respectively, while the surface emissivity is  $\varepsilon = 0.97$ . The convection heat transfer coefficient at the air–water interface is  $h = 25 \text{ W/m}^2 \cdot \text{K}$ . If the water is at  $27^\circ\text{C}$ , will this temperature increase or decrease with time?

- 12.140** A roof-cooling system, which operates by maintaining a thin film of water on the roof surface, may be used to reduce air-conditioning costs or to maintain a cooler environment in nonconditioned buildings. To determine the effectiveness of such a system, consider a sheet metal roof for which the solar absorptivity  $\alpha_S$  is 0.50 and the hemispherical emissivity  $\varepsilon$  is 0.3. Representative conditions correspond to a surface convection coefficient  $h$  of  $20 \text{ W/m}^2 \cdot \text{K}$ , a solar irradiation  $G_S$  of  $700 \text{ W/m}^2$ , a sky temperature of  $-10^\circ\text{C}$ , an atmospheric temperature of  $30^\circ\text{C}$ , and a relative humidity of 65%. The roof may be assumed to be well insulated from below. Determine the roof surface temperature without the water film. Assuming the film and roof surface temperatures to be equal, determine the surface temperature with the film. The solar absorptivity and the hemispherical emissivity of the film–surface combination are  $\alpha_S = 0.8$  and  $\varepsilon = 0.9$ , respectively.


- 12.141** A wet towel hangs on a clothes line under conditions for which one surface receives solar irradiation of  $G_S = 900 \text{ W/m}^2$  and both surfaces are exposed to atmospheric (sky) and ground radiation of  $G_{\text{sky}} = 200 \text{ W/m}^2$  and  $G_g = 250 \text{ W/m}^2$ , respectively. Under moderately windy conditions, air flow at a temperature of  $27^\circ\text{C}$  and a relative humidity of 60% maintains a convection heat transfer coefficient of  $20 \text{ W/m}^2 \cdot \text{K}$  at both surfaces. The wet towel has an emissivity of

0.96 and a solar absorptivity of 0.65. As a first approximation the properties of the atmospheric air may be evaluated at a temperature of 300 K.

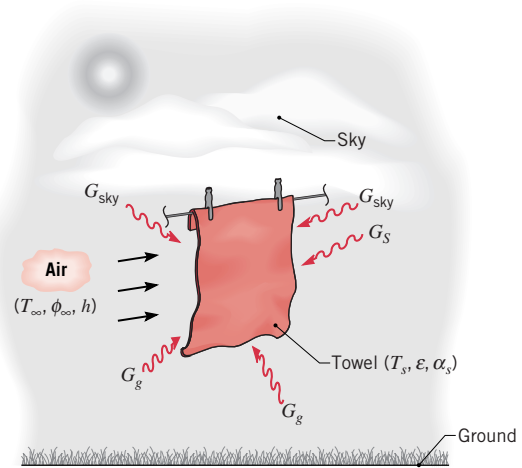

Determine the temperature  $T_s$  of the towel. What is the corresponding evaporation rate for a towel that is 0.75 m wide by 1.50 m long?

- 12.142** Our students perform a laboratory experiment to determine mass transfer from a wet paper towel experiencing forced convection and irradiation from radiant lamps. For the values of  $T_\infty$  and  $T_{\text{wb}}$  prescribed on the sketch, the towel temperature was found to be  $T_s = 310 \text{ K}$ . In addition, flat-plate correlations yielded average heat and mass transfer convection coefficients of  $\bar{h} = 28.7 \text{ W/m}^2 \cdot \text{K}$  and  $\bar{h}_m = 0.027 \text{ m/s}$ , respectively. The towel has dimensions of  $92.5 \text{ mm} \times 92.5 \text{ mm}$  and is diffuse and gray with an emissivity of 0.96.

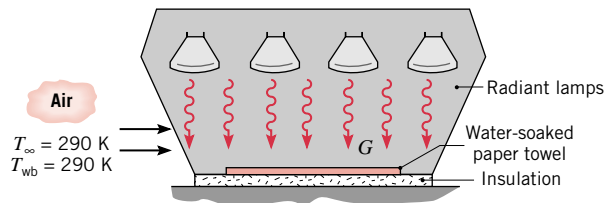

- From the foregoing results, determine the vapor densities,  $\rho_{A,s}$  and  $\rho_{A,\infty}$ , the evaporation rate,  $n_A$  (kg/s), and the net rate of radiation transfer to the towel,  $q_{\text{rad}}$  (W).
- Using results from part (a) and assuming that the irradiation  $G$  is uniform over the towel, determine the emissive power  $E$ , the irradiation  $G$ , and the radiosity  $J$ .



# *C H A P T E R* **13**

## **Radiation Exchange Between Surfaces**



**H**aving thus far restricted our attention to radiative processes that occur at a *single surface*, we now consider the problem of radiative exchange between two or more surfaces. This exchange depends strongly on the surface geometries and orientations, as well as on their radiative properties and temperatures. Initially, we assume that the surfaces are separated by a *nonparticipating medium*. Since such a medium neither emits, absorbs, nor scatters, it has no effect on the transfer of radiation between surfaces. A vacuum meets these requirements exactly, and most gases meet them to an excellent approximation.

Our first objective is to establish geometrical features of the radiation exchange problem by developing the notion of a *view factor*. Our second objective is to develop procedures for predicting radiative exchange between surfaces that form an *enclosure*. We conclude our consideration of radiation exchange between surfaces by considering the effects of a *participating medium*, namely, an intervening gas that emits and absorbs radiation.


## 13.1

### The View Factor

To compute radiation exchange between any two surfaces, we must first introduce the concept of a *view factor* (also called a *configuration* or *shape factor*).

#### 13.1.1 The View Factor Integral

The view factor  $F_{ij}$  is defined as the *fraction of the radiation leaving surface  $i$  that is intercepted by surface  $j$* . To develop a general expression for  $F_{ij}$ , we consider the arbitrarily oriented surfaces  $A_i$  and  $A_j$  of Figure 13.1. Elemental areas on each surface,  $dA_i$  and  $dA_j$ , are connected by a line of length  $R$ , which forms the polar angles  $\theta_i$  and  $\theta_j$ , respectively, with the surface normals  $\mathbf{n}_i$  and  $\mathbf{n}_j$ . The values of  $R$ ,  $\theta_i$ , and  $\theta_j$  vary with the position of the elemental areas on  $A_i$  and  $A_j$ .

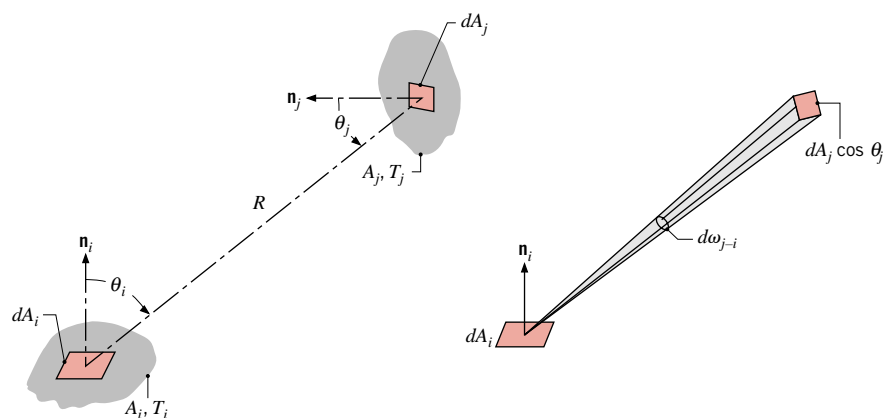

**FIGURE 13.1** View factor associated with radiation exchange between elemental surfaces of area  $dA_i$  and  $dA_j$ .

From the definition of the radiation intensity, Section 12.2.2, and Equation 12.6, the rate at which radiation *leaves*  $dA_i$  and is *intercepted* by  $dA_j$  may be expressed as

$$dq_{i \rightarrow j} = I_{e+r,i} \cos \theta_i dA_i d\omega_{j-i}$$

where  $I_{e+r,i}$  is the intensity of radiation leaving surface  $i$  by emission and reflection and  $d\omega_{j-i}$  is the solid angle subtended by  $dA_j$  when viewed from  $dA_i$ . With  $d\omega_{j-i} = (\cos \theta_j dA_j)/R^2$  from Equation 12.2, it follows that

$$dq_{i \rightarrow j} = I_{e+r,i} \frac{\cos \theta_i \cos \theta_j}{R^2} dA_i dA_j$$

Assuming that surface  $i$  *emits* and *reflects diffusely* and substituting from Equation 12.22, we then obtain

$$dq_{i \rightarrow j} = J_i \frac{\cos \theta_i \cos \theta_j}{\pi R^2} dA_i dA_j$$

The total rate at which radiation leaves surface  $i$  and is intercepted by  $j$  may then be obtained by integrating over the two surfaces. That is,

$$q_{i \rightarrow j} = J_i \int_{A_i} \int_{A_j} \frac{\cos \theta_i \cos \theta_j}{\pi R^2} dA_i dA_j$$

where it is assumed that the radiosity  $J_i$  is uniform over the surface  $A_i$ . From the definition of the view factor as the fraction of the radiation that leaves  $A_i$  and is intercepted by  $A_j$ ,

$$F_{ij} = \frac{q_{i \rightarrow j}}{A_i J_i}$$

it follows that

$$F_{ij} = \frac{1}{A_i} \int_{A_i} \int_{A_j} \frac{\cos \theta_i \cos \theta_j}{\pi R^2} dA_i dA_j \quad (13.1)$$

Similarly, the view factor  $F_{ji}$  is defined as the fraction of the radiation that leaves  $A_j$  and is intercepted by  $A_i$ . The same development then yields

$$F_{ji} = \frac{1}{A_j} \int_{A_i} \int_{A_j} \frac{\cos \theta_i \cos \theta_j}{\pi R^2} dA_i dA_j \quad (13.2)$$

Either Equation 13.1 or 13.2 may be used to determine the view factor associated with any two surfaces that are *diffuse emitters* and *reflectors* and have *uniform radiosity*.


### 13.1.2 View Factor Relations

An important view factor relation is suggested by Equations 13.1 and 13.2. In particular, equating the integrals appearing in these equations, it follows that

$$A_i F_{ij} = A_j F_{ji} \quad (13.3)$$

This expression, termed the *reciprocity relation*, is useful in determining one view factor from knowledge of the other.



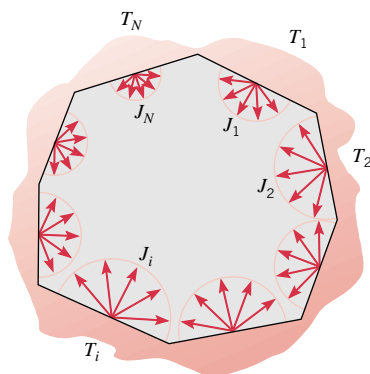

**FIGURE 13.2**

Radiation exchange in an enclosure.

Another important view factor relation pertains to the surfaces of an *enclosure* (Figure 13.2). From the definition of the view factor, the *summation rule*


$$\sum_{j=1}^N F_{ij} = 1 \quad (13.4)$$

may be applied to each of the  $N$  surfaces in the enclosure. This rule follows from the conservation requirement that all radiation leaving surface  $i$  must be intercepted by the enclosure surfaces. The term  $F_{ii}$  appearing in this summation represents the fraction of the radiation that leaves surface  $i$  and is directly intercepted by  $i$ . If the surface is concave, it *sees itself* and  $F_{ii}$  is nonzero. However, for a plane or convex surface,  $F_{ii} = 0$ .

To calculate radiation exchange in an enclosure of  $N$  surfaces, a total of  $N^2$  view factors is needed. This requirement becomes evident when the view factors are arranged in the matrix form:

$$\begin{bmatrix} F_{11} & F_{12} & \cdots & F_{1N} \\ F_{21} & F_{22} & \cdots & F_{2N} \\ \vdots & \vdots & & \vdots \\ F_{N1} & F_{N2} & \cdots & F_{NN} \end{bmatrix}$$

However, all the view factors need not be calculated *directly*. A total of  $N$  view factors may be obtained from the  $N$  equations associated with application of the




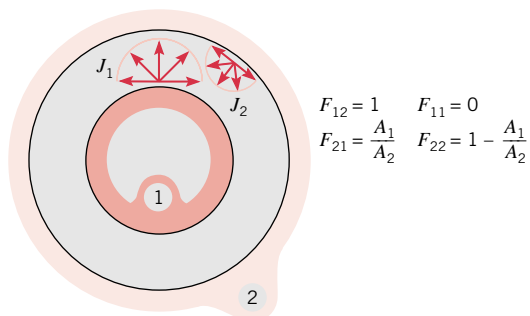


**FIGURE 13.3**

View factors for the enclosure formed by two spheres.




summation rule, Equation 13.4, to each of the surfaces in the enclosure. In addition,  $N(N - 1)/2$  view factors may be obtained from the  $N(N - 1)/2$  applications of the reciprocity relation, Equation 13.3, which are possible for the enclosure. Accordingly, only  $[N^2 - N - N(N - 1)/2] = N(N - 1)/2$  view factors need be determined directly. For example, in a three-surface enclosure this requirement corresponds to

**TABLE 13.1** View Factors for Two-Dimensional Geometries [4]

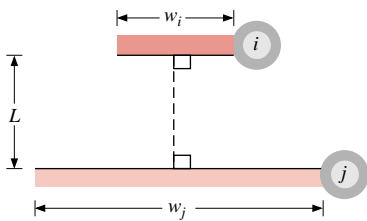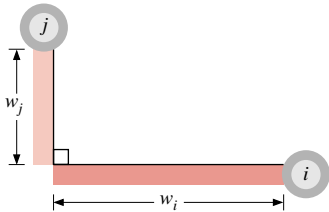Geometry	Relation
<b>Parallel Plates with Midlines Connected by Perpendicular</b> 	$F_{ij} = \frac{[(W_i + W_j)^2 + 4]^{1/2} - [(W_j - W_i)^2 + 4]^{1/2}}{2W_i}$ $W_i = w_i/L, W_j = w_j/L$
<b>Inclined Parallel Plates of Equal Width and a Common Edge</b> 	$F_{ij} = 1 - \sin\left(\frac{\alpha}{2}\right)$
<b>Perpendicular Plates with a Common Edge</b> 	$F_{ij} = \frac{1 + (w_j/w_i) - [1 + (w_j/w_i)^2]^{1/2}}{2}$
<b>Three-Sided Enclosure</b> 	$F_{ij} = \frac{w_i + w_j - w_k}{2w_i}$

(continues)




**TABLE 13.1** Continued

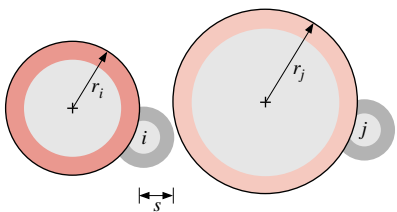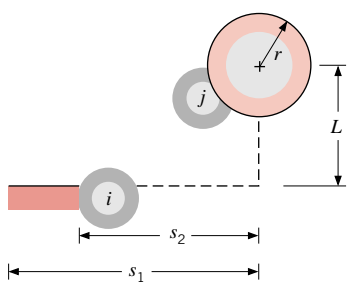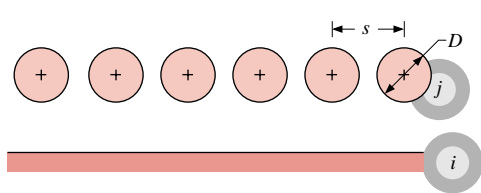Geometry	Relation
<p><b>Parallel Cylinders of Different Radii</b></p> 	$F_{ij} = \frac{1}{2\pi} \left\{ \pi + [C^2 - (R + 1)^2]^{1/2} - [C^2 - (R - 1)^2]^{1/2} + (R - 1) \cos^{-1} \left[ \left( \frac{R}{C} \right) - \left( \frac{1}{C} \right) \right] - (R + 1) \cos^{-1} \left[ \left( \frac{R}{C} \right) + \left( \frac{1}{C} \right) \right] \right\}$ $R = r_j/r_i, S = s/r_i$ $C = 1 + R + S$
<p><b>Cylinder and Parallel Rectangle</b></p> 	$F_{ij} = \frac{r}{s_1 - s_2} \left[ \tan^{-1} \frac{s_1}{L} - \tan^{-1} \frac{s_2}{L} \right]$
<p><b>Infinite Plane and Row of Cylinders</b></p> 	$F_{ij} = 1 - \left[ 1 - \left( \frac{D}{s} \right)^2 \right]^{1/2} + \left( \frac{D}{s} \right) \tan^{-1} \left[ \left( \frac{s^2 - D^2}{D^2} \right)^{1/2} \right]$

only  $3(3 - 1)/2 = 3$  view factors. The remaining six view factors may be obtained by solving the six equations that result from use of Equations 13.3 and 13.4.

To illustrate the foregoing procedure, consider a simple, two-surface enclosure involving the spherical surfaces of Figure 13.3. Although the enclosure is characterized by  $N^2 = 4$  view factors ( $F_{11}$ ,  $F_{12}$ ,  $F_{21}$ ,  $F_{22}$ ), only  $N(N - 1)/2 = 1$  view factor need be determined directly. In this case such a determination may be made by *inspection*. In particular, since all radiation leaving the inner surface must reach the outer surface, it follows that  $F_{12} = 1$ . The same may not be said of radiation leaving

**TABLE 13.2** View Factors for Three-Dimensional Geometries [4]

Geometry	Relation
<b>Aligned Parallel Rectangles</b> <b>(Figure 13.4)</b> 	$\bar{X} = X/L, \bar{Y} = Y/L$ $F_{ij} = \frac{2}{\pi \bar{X} \bar{Y}} \left\{ \ln \left[ \frac{(1 + \bar{X}^2)(1 + \bar{Y}^2)}{1 + \bar{X}^2 + \bar{Y}^2} \right]^{1/2} + \bar{X}(1 + \bar{Y}^2)^{1/2} \tan^{-1} \frac{\bar{X}}{(1 + \bar{Y}^2)^{1/2}} + \bar{Y}(1 + \bar{X}^2)^{1/2} \tan^{-1} \frac{\bar{Y}}{(1 + \bar{X}^2)^{1/2}} - \bar{X} \tan^{-1} \bar{X} - \bar{Y} \tan^{-1} \bar{Y} \right\}$
<b>Coaxial Parallel Disks</b> <b>(Figure 13.5)</b> 	$R_i = r_i/L, R_j = r_j/L$ $S = 1 + \frac{1 + R_j^2}{R_i^2}$ $F_{ij} = \frac{1}{2} \{ S - [S^2 - 4(r_j/r_i)^2]^{1/2} \}$
<b>Perpendicular Rectangles with a Common Edge</b> <b>(Figure 13.6)</b> 	$H = Z/X, W = Y/X$ $F_{ij} = \frac{1}{\pi W} \left( W \tan^{-1} \frac{1}{W} + H \tan^{-1} \frac{1}{H} - (H^2 + W^2)^{1/2} \tan^{-1} \frac{1}{(H^2 + W^2)^{1/2}} + \frac{1}{4} \ln \left[ \frac{(1 + W^2)(1 + H^2)}{1 + W^2 + H^2} \right] \frac{W^2(1 + W^2 + H^2)}{(1 + W^2)(W^2 + H^2)} \right]^{W^2} \times \left[ \frac{H^2(1 + H^2 + W^2)}{(1 + H^2)(H^2 + W^2)} \right]^{H^2} \right)$

the outer surface, since this surface sees itself. However, from the reciprocity relation, Equation 13.3, we obtain

$$F_{21} = \left( \frac{A_1}{A_2} \right) F_{12} = \left( \frac{A_1}{A_2} \right)$$

From the summation rule, we also obtain


$$F_{11} + F_{12} = 1$$

in which case  $F_{11} = 0$ , and

$$F_{21} + F_{22} = 1$$

in which case


$$F_{22} = 1 - \left( \frac{A_1}{A_2} \right)$$

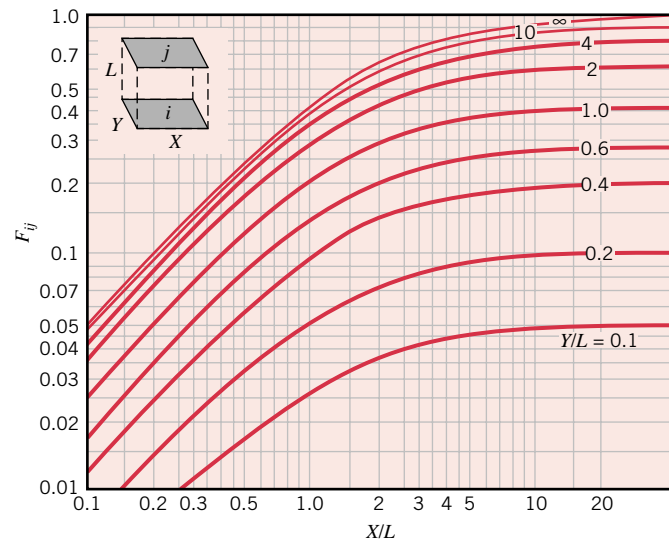


**FIGURE 13.4** View factor for aligned parallel rectangles.

For more complicated geometries, the view factor may be determined by solving the double integral of Equation 13.1. Such solutions have been obtained for many different surface arrangements and are available in equation, graphical, and tabular form [1–4]. Results for several common geometries are presented in Tables 13.1 and 13.2 and Figures 13.4 through 13.6. The configurations of Table 13.1 are assumed to be infinitely long (in a direction perpendicular to the page) and are hence two-dimensional. The configurations of Table 13.2 and Figures 13.4 through 13.6 are three-dimensional.

It is useful to note that the results of Figures 13.4 through 13.6 may be used to determine other view factors. For example, the view factor for an end surface of a

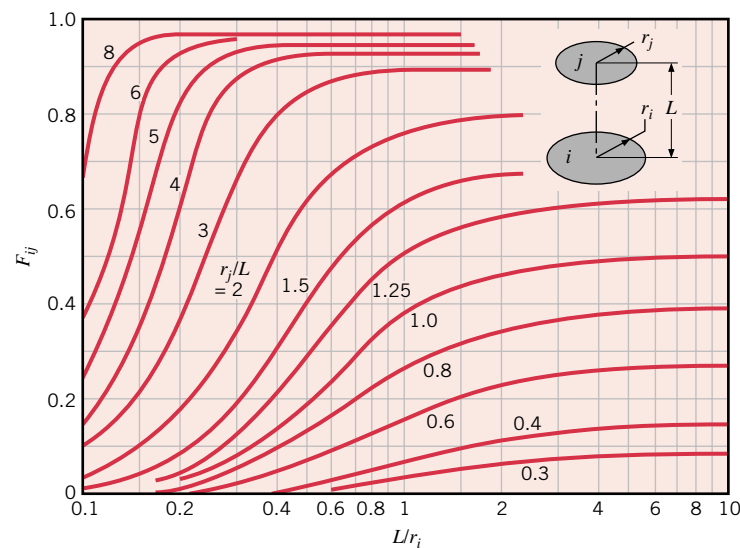

**FIGURE 13.5** View factor for coaxial parallel disks.

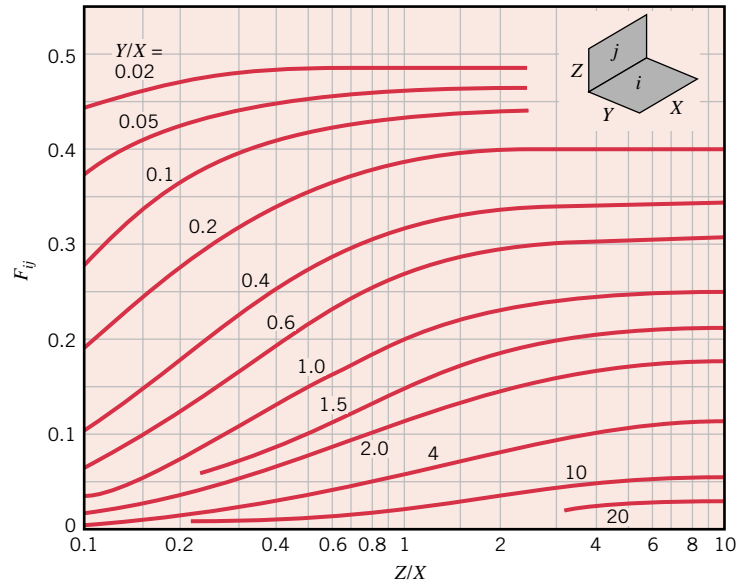


**FIGURE 13.6** View factor for perpendicular rectangles with a common edge.

cylinder (or a truncated cone) relative to the lateral surface may be obtained by using the results of Figure 13.5 with the summation rule, Equation 13.4. Moreover, Figures 13.4 and 13.6 may be used to obtain other useful results if two additional view factor relations are developed.

The first relation concerns the additive nature of the view factor for a subdivided surface and may be inferred from Figure 13.7. Considering radiation from surface  $i$  to surface  $j$ , which is divided into  $n$  components, it is evident that

$$F_{i(j)} = \sum_{k=1}^n F_{ik} \quad (13.5)$$

where the parentheses around a subscript indicate that it is a composite surface, in which case  $(j)$  is equivalent to  $(1, 2, \dots, k, \dots, n)$ . This expression simply states that radiation reaching a composite surface is the sum of the radiation reaching its parts. Although it pertains to subdivision of the receiving surface, it may also be used to obtain the second view factor relation, which pertains to subdivision of the originating

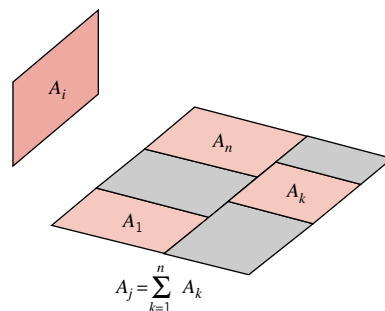

**FIGURE 13.7** Areas used to illustrate view factor relations.

surface. Multiplying Equation 13.5 by  $A_i$  and applying the reciprocity relation, Equation 13.3, to each of the resulting terms, it follows that

$$A_j F_{(j)i} = \sum_{k=1}^n A_k F_{ki} \quad (13.6)$$

or

$$F_{(j)i} = \frac{\sum_{k=1}^n A_k F_{ki}}{\sum_{k=1}^n A_k} \quad (13.7)$$

Equations 13.6 and 13.7 may be applied when the originating surface is composed of several parts.

For problems involving complicated geometries, analytical solutions to Equation 13.1 may not be obtainable, in which case values of the view factors must be estimated using numerical methods. In situations involving extremely complex structures that may have hundreds or thousands of radiative surfaces, considerable error may be associated with the numerically calculated view factors. In such situations, Equation 13.3 should be used to check the accuracy of individual view factors, and Equation 13.4 should be used to determine whether the conservation of energy principle is satisfied [5].

### EXAMPLE 13.1


Consider a diffuse circular disk of diameter  $D$  and area  $A_j$  and a plane diffuse surface of area  $A_i \ll A_j$ . The surfaces are parallel, and  $A_i$  is located at a distance  $L$  from the center of  $A_j$ . Obtain an expression for the view factor  $F_{ij}$ .

### SOLUTION

**Known:** Orientation of small surface relative to large circular disk.

**Find:** View factor of small surface with respect to disk,  $F_{ij}$ .

**Schematic:**

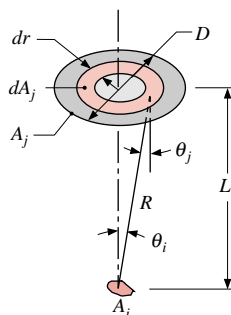

**Assumptions:**

1. Diffuse surfaces.
2.  $A_i \ll A_j$ .

**Analysis:** The desired view factor may be obtained from Equation 13.1.

$$F_{ij} = \frac{1}{A_i} \int_{A_i} \int_{A_j} \frac{\cos \theta_i \cos \theta_j}{\pi R^2} dA_i dA_j$$

Recognizing that  $\theta_i$ ,  $\theta_j$ , and  $R$  are approximately independent of position on  $A_i$ , this expression reduces to

$$F_{ij} = \int_{A_j} \frac{\cos \theta_i \cos \theta_j}{\pi R^2} dA_j$$

or, with  $\theta_i = \theta_j \equiv \theta$ ,

$$F_{ij} = \int_{A_j} \frac{\cos^2 \theta}{\pi R^2} dA_j$$

With  $R^2 = r^2 + L^2$ ,  $\cos \theta = (L/R)$ , and  $dA_j = 2\pi r dr$ , it follows that


$$F_{ij} = 2L^2 \int_0^{D/2} \frac{r dr}{(r^2 + L^2)^2} = \frac{D^2}{D^2 + 4L^2} \quad \triangleleft \quad (13.8)$$

**Comments:**

1. Equation 13.8 may be used to quantify the asymptotic behavior of the curves in Figure 13.5 as the radius of the lower circle,  $r_i$ , approaches zero.
2. The preceding geometry is one of the simplest cases for which the view factor may be obtained from Equation 13.1. Geometries involving more detailed integrations are considered in the literature [1, 3].

### EXAMPLE 13.2

Determine the view factors  $F_{12}$  and  $F_{21}$  for the following geometries:

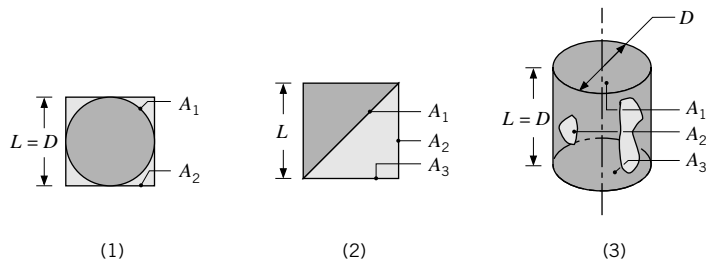

1. Sphere of diameter  $D$  inside a cubical box of length  $L = D$ .
2. One side of a diagonal partition within a long square duct.
3. End and side of a circular tube of equal length and diameter.

### SOLUTION

**Known:** Surface geometries.

**Find:** View factors.



**Assumptions:** Diffuse surfaces with uniform radiosities.

**Analysis:** The desired view factors may be obtained from inspection, the reciprocity rule, the summation rule, and/or use of the charts.

1. Sphere within a cube:

By inspection,  $F_{12} = 1$  ◁

By reciprocity,  $F_{21} = \frac{A_1}{A_2} F_{12} = \frac{\pi D^2}{6L^2} \times 1 = \frac{\pi}{6}$  ◁

2. Partition within a square duct:

From summation rule,  $F_{11} + F_{12} + F_{13} = 1$

where  $F_{11} = 0$

By symmetry,  $F_{12} = F_{13}$

Hence  $F_{12} = 0.50$  ◁

By reciprocity,  $F_{21} = \frac{A_1}{A_2} F_{12} = \frac{\sqrt{2}L}{L} \times 0.5 = 0.71$  ◁

3. Circular tube:

From Table 13.2 or Figure 13.5, with  $(r_3/L) = 0.5$  and  $(L/r_1) = 2$ ,  $F_{13} = 0.172$

From summation rule,  $F_{11} + F_{12} + F_{13} = 1$

or, with  $F_{11} = 0$ ,  $F_{12} = 1 - F_{13} = 0.828$  ◁

From reciprocity,  $F_{21} = \frac{A_1}{A_2} F_{12} = \frac{\pi D^2/4}{\pi DL} \times 0.828 = 0.207$  ◁

## 13.2

### Radiation Exchange Between Opaque, Diffuse, Gray Surfaces in an Enclosure

In general, radiation may leave an opaque surface due to both reflection and emission, and on reaching a second opaque surface, experience reflection as well as absorption. In an enclosure, such as that of Figure 13.8a, radiation may experience multiple reflections off all surfaces, with partial absorption occurring at each.

Analyzing radiation exchange in an enclosure may be simplified by making certain assumptions. Each surface of the enclosure is assumed to be *isothermal* and to be characterized by a *uniform radiosity* and a *uniform irradiation*. *Opaque, diffuse, gray* surface behavior is also assumed, and the medium within the enclosure is taken to be *nonparticipating*. The problem is generally one in which either the temperature  $T_i$  or the net radiative heat flux  $q_i$  associated with each of the surfaces is known. The objective is to use this information to determine the unknown radiative heat fluxes and temperatures associated with each of the surfaces.

### 13.2.1 Net Radiation Exchange at a Surface

The term  $q_i$ , which is the *net* rate at which radiation *leaves* surface  $i$ , represents the net effect of radiative interactions occurring at the surface (Figure 13.8b). It is the rate at which energy would have to be transferred to the surface by other means to maintain it at a constant temperature. It is equal to the difference between the surface radiosity and irradiation and may be expressed as

$$q_i = A_i(J_i - G_i) \quad (13.9)$$

From Equation 13.9 and the definition of the radiosity  $J_i$ ,


$$J_i \equiv E_i + \rho_i G_i \quad (13.10)$$

The net radiative transfer from the surface may also be expressed in terms of the surface emissive power and the absorbed irradiation:

$$q_i = A_i(E_i - \alpha_i G_i) \quad (13.11)$$

where use has been made of the relationship  $\alpha_i = 1 - \rho_i$  for an opaque surface. This relationship is illustrated in Figure 13.8c. Substituting from Equation 12.35 and recognizing that  $\rho_i = 1 - \alpha_i = 1 - \varepsilon_i$  for an opaque, diffuse, gray surface, the radiosity may also be expressed as

$$J_i = \varepsilon_i E_{bi} + (1 - \varepsilon_i) G_i \quad (13.12)$$

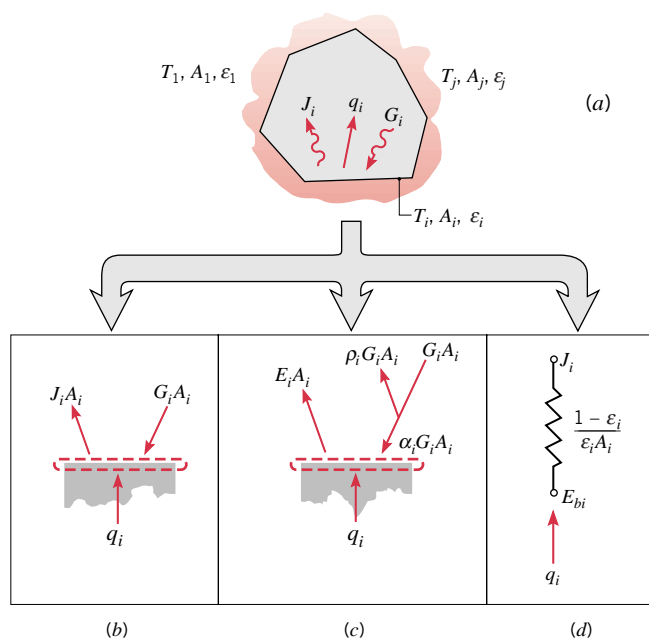

**FIGURE 13.8** Radiation exchange in an enclosure of diffuse, gray surfaces with a nonparticipating medium. (a) Schematic of the enclosure. (b) Radiative balance according to Equation 13.9. (c) Radiative balance according to Equation 13.11. (d) Network element representing the net radiation transfer from a surface.

Solving for  $G_i$  and substituting into Equation 13.9, it follows that

$$q_i = A_i \left( J_i - \frac{J_i - \varepsilon_i E_{bi}}{1 - \varepsilon_i} \right)$$

or

$$q_i = \frac{E_{bi} - J_i}{(1 - \varepsilon_i)/\varepsilon_i A_i} \quad (13.13)$$

Equation 13.13 provides a convenient representation for the net radiative heat transfer rate from a surface. This transfer, which may be represented by the network element of Figure 13.8d, is associated with the driving potential  $(E_{bi} - J_i)$  and a *surface radiative resistance* of the form  $(1 - \varepsilon_i)/\varepsilon_i A_i$ . Hence, if the emissive power that the surface would have if it were black exceeds its radiosity, there is net radiation heat transfer from the surface; if the inverse is true, the net transfer is to the surface.

It is sometimes the case that one of the surfaces is very large relative to the other surfaces under consideration. For example, the system might consist of multiple small surfaces in a large room. In this case, the area of the large surface is effectively infinite ( $A_i \rightarrow \infty$ ), and we see that its surface radiative resistance,  $(1 - \varepsilon_i)/\varepsilon_i A_i$ , is effectively zero, just as it would be for a black surface ( $\varepsilon_i = 1$ ). Hence,  $J_i = E_{bi}$ , and *a surface which is large relative to all other surfaces under consideration can be treated as if it were a blackbody*. This important conclusion was reached in Section 12.6 based on a physical argument and has now been confirmed from our treatment of gray surface radiation exchange. Again, the physical explanation is that, even though the large surface may reflect some of the irradiation incident upon it, it is so big that there is a high probability that the reflected radiation reaches another point on the same large surface. After many such reflections, all the radiation that was originally incident on the large surface is absorbed by the large surface, and none ever reaches any of the smaller surfaces.

### 13.2.2 Radiation Exchange Between Surfaces

To use Equation 13.13, the surface radiosity  $J_i$  must be known. To determine this quantity, it is necessary to consider radiation exchange between the surfaces of the enclosure.

The irradiation of surface  $i$  can be evaluated from the radiosities of all the surfaces in the enclosure. In particular, from the definition of the view factor, it follows that the total rate at which radiation reaches surface  $i$  from all surfaces, including  $i$ , is

$$A_i G_i = \sum_{j=1}^N F_{ji} A_j J_j$$

or from the reciprocity relation, Equation 13.3,

$$A_i G_i = \sum_{j=1}^N A_i F_{ij} J_j$$

Canceling the area  $A_i$  and substituting into Equation 13.9 for  $G_i$ ,

$$q_i = A_i \left( J_i - \sum_{j=1}^N F_{ij} J_j \right)$$

or, from the summation rule, Equation 13.4,

$$q_i = A_i \left( \sum_{j=1}^N F_{ij} J_i - \sum_{j=1}^N F_{ij} J_j \right)$$

Hence

$$q_i = \sum_{j=1}^N A_i F_{ij} (J_i - J_j) = \sum_{j=1}^N q_{ij} \quad (13.14)$$

This result equates the net rate of radiation transfer from surface  $i$ ,  $q_i$ , to the sum of components  $q_{ij}$  related to radiative exchange with the other surfaces. Each component may be represented by a network element for which  $(J_i - J_j)$  is the driving potential and  $(A_i F_{ij})^{-1}$  is a *space* or *geometrical resistance* (Figure 13.9).


Combining Equations 13.13 and 13.14, we then obtain

$$\frac{E_{bi} - J_i}{(1 - \varepsilon_i)/\varepsilon_i A_i} = \sum_{j=1}^N \frac{J_i - J_j}{(A_i F_{ij})^{-1}} \quad (13.15)$$

As shown in Figure 13.9, this expression represents a radiation balance for the radiosity *node* associated with surface  $i$ . The rate of radiation transfer (current flow) to  $i$  through its surface resistance must equal the net rate of radiation transfer (current flows) from  $i$  to all other surfaces through the corresponding geometrical resistances.

Note that Equation 13.15 is especially useful when the surface temperature  $T_i$  (hence  $E_{bi}$ ) is known. Although this situation is typical, it does not always apply. In particular, situations may arise for which the net radiation transfer rate at the surface  $q_i$ , rather than the temperature  $T_i$ , is known. In such cases the preferred form of the radiation balance is Equation 13.14, rearranged as

$$q_i = \sum_{j=1}^N \frac{J_i - J_j}{(A_i F_{ij})^{-1}} \quad (13.16)$$

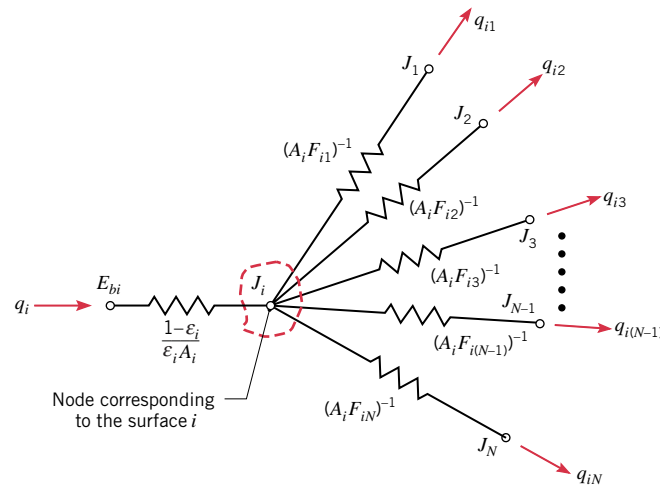


**FIGURE 13.9** Network representation of radiative exchange between surface  $i$  and the remaining surfaces of an enclosure.

Use of network representations was first suggested by Oppenheim [6]. The network is built by first identifying nodes associated with the radiosities of each of the  $N$  surfaces of the enclosure. The method provides a useful tool for visualizing radiation exchange in the enclosure and, at least for simple enclosures, may be used as the basis for predicting this exchange.

An alternative *direct approach* to solving radiation enclosure problems involves writing Equation 13.15 for each surface at which  $T_i$  is known, and writing Equation 13.16 for each surface at which  $q_i$  is known. The resulting set of  $N$  linear, algebraic equations is solved for  $J_1, J_2, \dots, J_N$ . With knowledge of the  $J_i$ , Equation 13.13 may then be used to determine the net radiation heat transfer rate  $q_i$  at each surface of known  $T_i$  or the value of  $T_i$  at each surface of known  $q_i$ . For any number  $N$  of surfaces in the enclosure, the foregoing problem may readily be solved by the iteration or matrix inversion methods of Chapter 4.

### EXAMPLE 13.3

In manufacturing, the special coating on a curved solar absorber surface of area  $A_2 = 15 \text{ m}^2$  is cured by exposing it to an infrared heater of width  $W = 1 \text{ m}$ . The absorber and heater are each of length  $L = 10 \text{ m}$  and are separated by a distance of  $H = 1 \text{ m}$ . The upper surface of the absorber and the lower surface of the heater are insulated.

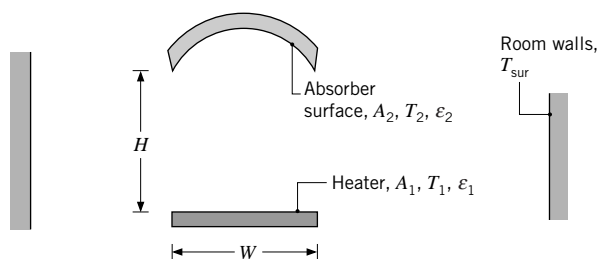


The heater is at  $T_1 = 1000 \text{ K}$  and has an emissivity of  $\varepsilon_1 = 0.9$ , while the absorber is at  $T_2 = 600 \text{ K}$  and has an emissivity of  $\varepsilon_2 = 0.5$ . The system is in a large room whose walls are at  $300 \text{ K}$ . What is the net rate of heat transfer to the absorber surface?

### SOLUTION

**Known:** A curved, solar absorber surface with a special coating is being cured by use of an infrared heater in a large room.

**Find:** Net rate of heat transfer to the absorber surface.

**Schematic:**

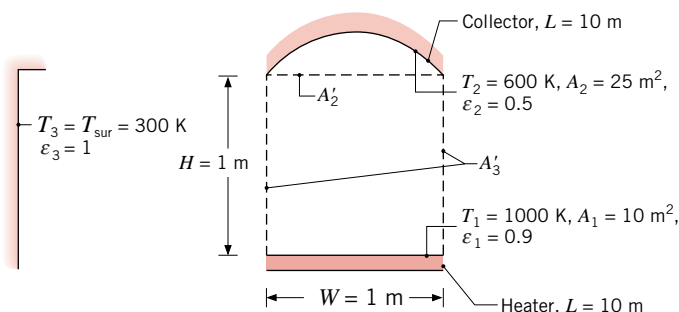


**Assumptions:**

1. Steady-state conditions exist.
2. Convection effects are negligible.
3. Absorber and heater surfaces are diffuse and gray.
4. The surrounding room is large and therefore behaves as a blackbody.

**Analysis:** The system may be viewed as a three-surface enclosure, with the third surface being the large surrounding room, which behaves as a blackbody. We are interested in obtaining the net rate of radiation transfer to surface 2. We solve the problem using both the radiation network and direct approaches.

**Radiation Network Approach** The radiation network is constructed by first identifying nodes associated with the radiosities of each surface, as shown in step 1 in the schematic below. Then each radiosity node is connected to each of the other radiosity nodes through the appropriate space resistance, as shown in step 2. We will treat the surroundings as having a large but unspecified area, which introduces difficulty in expressing the space resistances  $(A_3F_{31})^{-1}$  and  $(A_3F_{32})^{-1}$ . Fortunately, from the reciprocity relation (Equation 13.3), we can replace  $A_3F_{31}$  with  $A_1F_{13}$  and  $A_3F_{32}$  with  $A_2F_{23}$ , which are more readily obtained. The final step is to connect the blackbody emissive powers associated with the temperature of each surface to the radiosity nodes, using the appropriate form of the surface resistance.

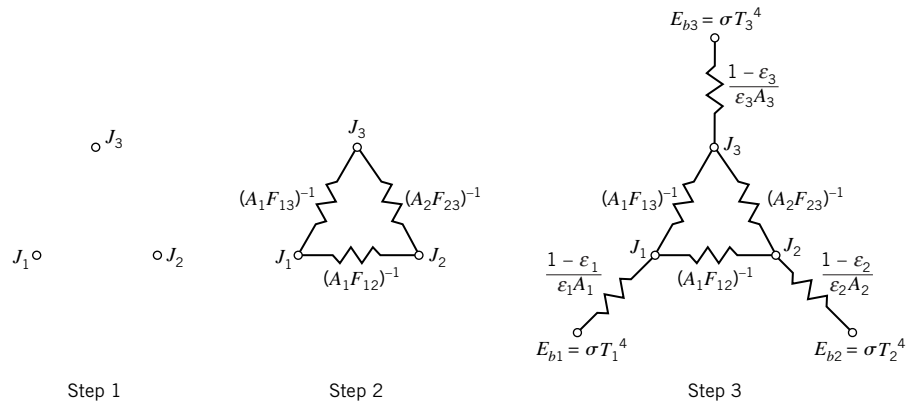

In this problem, the surface resistance associated with surface 3 is zero according to assumption 4; therefore,  $J_3 = E_{b3} = \sigma T_3^4 = 459 \text{ W/m}^2$ .

Summing currents at the  $J_1$  node yields

$$\frac{\sigma T_1^4 - J_1}{(1 - \epsilon_1)/\epsilon_1 A_1} = \frac{J_1 - J_2}{1/A_1 F_{12}} + \frac{J_1 - \sigma T_3^4}{1/A_1 F_{13}} \quad (1)$$

while summing the currents at the  $J_2$  node results in

$$\frac{\sigma T_2^4 - J_2}{(1 - \epsilon_2)/\epsilon_2 A_2} = \frac{J_2 - J_1}{1/A_1 F_{12}} + \frac{J_2 - \sigma T_3^4}{1/A_2 F_{23}} \quad (2)$$

The view factor  $F_{12}$  may be obtained by recognizing that  $F_{12} = F_{12}'$ , where  $A_2'$  is shown in the schematic as the rectangular base of the absorber surface. Then, from

Figure 13.4 or Table 13.2, with  $Y/L = 10/1 = 10$  and  $X/L = 1/1 = 1$ ,

$$F_{12} = 0.39$$

From the summation rule, and recognizing that  $F_{11} = 0$ , it also follows that

$$F_{13} = 1 - F_{12} = 1 - 0.39 = 0.61$$

The last needed view factor is  $F_{23}$ . We recognize that, since radiation propagating from surface 2 to surface 3 must pass through the hypothetical surface  $A'_2$ ,

$$A_2 F_{23} = A'_2 F_{2'3}$$

and from symmetry  $F_{2'3} = F_{13}$ . Thus

$$F_{23} = \frac{A'_2}{A_2} F_{13} = \frac{10 \text{ m}^2}{15 \text{ m}^2} \times 0.61 = 0.41$$

We may now solve Equations 1 and 2 for  $J_1$  and  $J_2$ . Recognizing that  $E_{b1} = \sigma T_1^4 = 56,700 \text{ W/m}^2$  and canceling the area  $A_1$ , we can express Equation 1 as

$$\frac{56,700 - J_1}{(1 - 0.9)/0.9} = \frac{J_1 - J_2}{1/0.39} + \frac{J_1 - 459}{1/0.61}$$

or

$$-10J_1 + 0.39J_2 = -510,582 \quad (3)$$

Noting that  $E_{b2} = \sigma T_2^4 = 7348 \text{ W/m}^2$  and dividing by the area  $A_2$ , we can express Equation 2 as

$$\frac{7348 - J_2}{(1 - 0.5)/0.5} = \frac{J_2 - J_1}{15 \text{ m}^2/(10 \text{ m}^2 \times 0.39)} + \frac{J_2 - 459}{1/0.41}$$

or

$$0.26J_1 - 1.67J_2 = -7536 \quad (4)$$

Solving Equations 3 and 4 simultaneously yields  $J_2 = 12,487 \text{ W/m}^2$ .

An expression for the net rate of heat transfer *from* the absorber surface,  $q_2$ , may be written upon inspection of the radiation network and is

$$q_2 = \frac{\sigma T_2^4 - J_2}{(1 - \varepsilon_2)/\varepsilon_2 A_2}$$

resulting in

$$q_2 = \frac{(7348 - 12,487) \text{ W/m}^2}{(1 - 0.5)/(0.5 \times 15 \text{ m}^2)} = -77.1 \text{ kW}$$

Hence, the net heat transfer rate *to* the absorber is  $q_{\text{net}} = -q_2 = 77.1 \text{ kW}$ . ◀

**Direct Approach** Using the direct approach, we write Equation 13.15 for each of the three surfaces. We use reciprocity to rewrite the space resistances in terms of the known view factors from above and to eliminate  $A_3$ .

Surface 1

$$\frac{\sigma T_1^4 - J_1}{(1 - \varepsilon_1)/\varepsilon_1 A_1} = \frac{J_1 - J_2}{1/A_1 F_{12}} + \frac{J_1 - J_3}{1/A_1 F_{13}} \quad (5)$$

Surface 2

$$\frac{\sigma T_2^4 - J_2}{(1 - \varepsilon_2)/\varepsilon_2 A_2} = \frac{J_2 - J_1}{1/A_2 F_{21}} + \frac{J_2 - J_3}{1/A_2 F_{23}} = \frac{J_2 - J_1}{1/A_1 F_{12}} + \frac{J_2 - J_3}{1/A_2 F_{23}} \quad (6)$$

Surface 3

$$\frac{\sigma T_3^4 - J_3}{(1 - \varepsilon_3)/\varepsilon_3 A_3} = \frac{J_3 - J_1}{1/A_3 F_{31}} + \frac{J_3 - J_2}{1/A_3 F_{32}} = \frac{J_3 - J_1}{1/A_1 F_{13}} + \frac{J_3 - J_2}{1/A_2 F_{23}} \quad (7)$$

Substituting values of the areas, temperatures, emissivities, and view factors into Equations 5 through 7 and solving them simultaneously, we obtain  $J_1 = 51,541 \text{ W/m}^2$ ,  $J_2 = 12,487 \text{ W/m}^2$ , and  $J_3 = 459 \text{ W/m}^2$ . Equation 13.13 may then be written for surface 2 as

$$q_2 = \frac{\sigma T_2^4 - J_2}{(1 - \varepsilon_2)/\varepsilon_2 A_2}$$

This expression is identical to the expression that was developed using the radiation network. Hence,  $q_2 = -77.1 \text{ kW}$ .

### Comments:

1. In order to solve Equations 5 through 7 simultaneously, we must first multiply both sides of Equation 7 by  $(1 - \varepsilon_3)/\varepsilon_3 A_3 = 0$  to avoid division by zero, resulting in the simplified form of Equation 7, which is  $J_3 = \sigma T_3^4$ .
2. If we substitute  $J_3 = \sigma T_3^4$  into Equations 5 and 6, it is evident that Equations 5 and 6 are identical to Equations 1 and 2, respectively.
3. The direct approach is recommended for problems involving  $N \geq 4$  surfaces, since radiation networks become quite complex as the number of surfaces increases.
4. As will be seen in Section 13.3, the radiation network approach is particularly useful when thermal energy is transferred to or from surfaces by additional means, that is, by conduction and/or convection. In these *multimode* heat transfer situations, the additional energy delivered to or taken from the surface can be represented by additional current into or out of a node.
5. Recognize the utility of using a hypothetical surface ( $A'_2$ ) to simplify the evaluation of view factors.
6. We could have approached the solution in a slightly different manner. Radiation leaving surface 1 must pass through the openings (hypothetical surface 3') in order to reach the surroundings. Thus, we can write.

$$F_{13} = F_{13'} \\ A_1 F_{13} = A_1 F_{13'} = A'_3 F_{3'1}$$

A similar relationship can be written for exchange between surface 2 and the surroundings, that is,  $A_2 F_{23} = A'_3 F_{3'2}$ . Thus, the space resistances which connect to radiosity node 3 in the radiation network above can be replaced by space resistances pertaining to surface 3'. The resistance network would be unchanged, and the space resistances would have the same values as those determined in the foregoing solution. However, it may be more convenient to calculate the view factors by utilizing the hypothetical surfaces 3'. With the surface resistance for surface 3 equal to zero, we see that *openings of enclosures that exchange radiation with large surroundings may be treated as hypothetical, nonreflecting black surfaces* ( $\varepsilon_3 = 1$ ) whose temperature is equal to that of the surroundings ( $T_3 = T_{\text{sur}}$ ).




### 13.2.3 Blackbody Radiation Exchange

In Example 13.3, we saw that large surroundings may be treated as hypothetical black surfaces. Real surfaces, such as those that are charred or coated with high-emissivity finishes, also exhibit near-black behavior. Matters are simplified significantly when all the surfaces of the enclosure are black. Since the absorptivity of a black surface is unity, there is no reflection and the radiosity is composed solely of the emitted energy. Hence, Equation 13.14 reduces to

$$q_i = \sum_{j=1}^N A_i F_{ij} \sigma (T_i^4 - T_j^4) \quad (13.17)$$

#### EXAMPLE 13.4

A furnace cavity, which is in the form of a cylinder of 75-mm diameter and 150-mm length, is open at one end to large surroundings that are at 27°C. The sides and bottom may be approximated as blackbodies, are heated electrically, are well insulated, and are maintained at temperatures of 1350 and 1650°C, respectively.

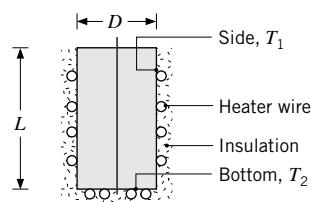


How much power is required to maintain the furnace conditions?

#### SOLUTION

**Known:** Surface temperatures of cylindrical furnace and surroundings.

**Find:** Power required to maintain prescribed temperatures.

**Schematic:**

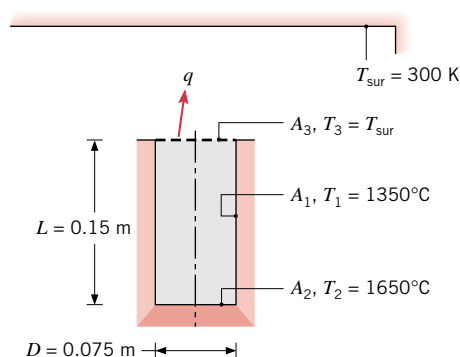

**Assumptions:**

1. Interior surfaces behave as blackbodies.
2. Heat transfer by convection is negligible.
3. Outer surface of furnace is adiabatic.
4. Treat opening as a hypothetical black surface at  $T_{\text{sur}}$ .

**Analysis:** The power needed to operate the furnace at the prescribed conditions must balance heat losses from the furnace. The heat loss may then be expressed as

$$q = q_{13} + q_{23}$$

or, from Equation 13.17,

$$q = A_1 F_{13} \sigma (T_1^4 - T_3^4) + A_2 F_{23} \sigma (T_2^4 - T_3^4)$$

From Table 13.2 (or Figure 13.5), with  $(r_i/L) = (r_j/L) = (0.0375 \text{ m}/0.15 \text{ m}) = 0.25$ ,  $F_{23} = 0.056$ . From the summation rule

$$F_{21} = 1 - F_{23} = 1 - 0.056 = 0.944$$

and from reciprocity

$$F_{12} = \frac{A_2}{A_1} F_{21} = \frac{\pi(0.075 \text{ m})^2/4}{\pi(0.075 \text{ m})(0.15 \text{ m})} \times 0.944 = 0.118$$

Hence, since  $F_{13} = F_{12}$  from symmetry,


$$\begin{aligned} q &= (\pi \times 0.075 \text{ m} \times 0.15 \text{ m}) 0.118 \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 \\ &\quad \times [(1623 \text{ K})^4 - (300 \text{ K})^4] + \left(\frac{\pi}{4}\right) (0.075 \text{ m})^2 \times 0.056 \\ &\quad \times 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 [(1923 \text{ K})^4 - (300 \text{ K})^4] \\ q &= 1639 \text{ W} + 191 \text{ W} = 1830 \text{ W} \end{aligned}$$

### 13.2.4 The Two-Surface Enclosure

The simplest example of an enclosure is one involving two surfaces that exchange radiation only with each other. Such a two-surface enclosure is shown schematically in Figure 13.10a. Since there are only two surfaces, the net rate of radiation transfer *from* surface 1,  $q_1$ , must equal the net rate of radiation transfer *to* surface 2,  $-q_2$ , and both quantities must equal the net rate at which radiation is exchanged between 1 and 2. Accordingly,

$$q_1 = -q_2 = q_{12}$$

The radiation transfer rate may be determined by applying Equation 13.15 to surfaces 1 and 2 and solving the resulting two equations for  $J_1$  and  $J_2$ . The results could then be used with Equation 13.13 to determine  $q_1$  (or  $q_2$ ). However, in this case the desired result is more readily obtained by working with the network representation of the enclosure shown in Figure 13.10b.

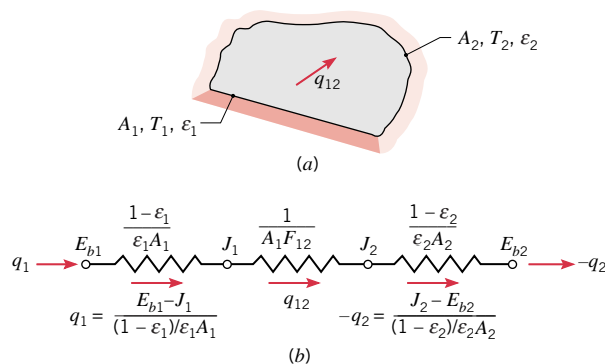

**FIGURE 13.10** The two-surface enclosure. (a) Schematic. (b) Network representation.

From Figure 13.10b we see that the total resistance to radiation exchange between surfaces 1 and 2 is comprised of the two surface resistances and the geometrical resistance. Hence, substituting from Equation 12.26, the net radiation exchange between surfaces may be expressed as

$$q_{12} = q_1 = -q_2 = \frac{\sigma(T_1^4 - T_2^4)}{\frac{1-\epsilon_1}{\epsilon_1 A_1} + \frac{1}{A_1 F_{12}} + \frac{1-\epsilon_2}{\epsilon_2 A_2}} \quad (13.18)$$

The foregoing result may be used for any two diffuse, gray surfaces *that form an enclosure*. Important special cases are summarized in Table 13.3.

### 13.2.5 Radiation Shields

*Radiation shields* constructed from low emissivity (high reflectivity) materials can be used to reduce the net radiation transfer between two surfaces. Consider placing a radiation shield, surface 3, between the two large, parallel planes of Figure 13.11a. Without the radiation shield, the net rate of radiation transfer between surfaces 1 and 2 is given by Equation 13.19. However, with the radiation shield, additional resistances are present, as shown in Figure 13.11b, and the heat transfer rate is reduced. Note that the emissivity associated with one side of the shield ( $\epsilon_{3,1}$ ) may differ from that associated with the opposite side ( $\epsilon_{3,2}$ ) and the radiosities will always differ. Summing the resistances and recognizing that  $F_{13} = F_{32} = 1$ , it follows that


$$q_{12} = \frac{A_1 \sigma (T_1^4 - T_2^4)}{\frac{1}{\epsilon_1} + \frac{1}{\epsilon_2} + \frac{1-\epsilon_{3,1}}{\epsilon_{3,1}} + \frac{1-\epsilon_{3,2}}{\epsilon_{3,2}}} \quad (13.23)$$

Note that the resistances associated with the radiation shield become very large when the emissivities  $\epsilon_{3,1}$  and  $\epsilon_{3,2}$  are very small.

Equation 13.23 may be used to determine the net heat transfer rate if  $T_1$  and  $T_2$  are known. From knowledge of  $q_{12}$  and the fact that  $q_{12} = q_{13} = q_{32}$ , the value of  $T_3$  may then be determined by expressing Equation 13.19 for  $q_{13}$  or  $q_{32}$ .


**TABLE 13.3** Special Diffuse, Gray, Two-Surface Enclosures

**Large (Infinite) Parallel Planes**




$$\begin{aligned} A_1 &= A_2 = A \\ F_{12} &= 1 \\ q_{12} &= \frac{A\sigma(T_1^4 - T_2^4)}{\frac{1}{\varepsilon_1} + \frac{1}{\varepsilon_2} - 1} \end{aligned} \quad (13.19)$$

**Long (Infinite) Concentric Cylinders**




$$\begin{aligned} \frac{A_1}{A_2} &= \frac{r_1}{r_2} \\ F_{12} &= 1 \\ q_{12} &= \frac{\sigma A_1(T_1^4 - T_2^4)}{\frac{1}{\varepsilon_1} + \frac{1 - \varepsilon_2}{\varepsilon_2} \left(\frac{r_1}{r_2}\right)} \end{aligned} \quad (13.20)$$

**Concentric Spheres**




$$\begin{aligned} \frac{A_1}{A_2} &= \frac{r_1^2}{r_2^2} \\ F_{12} &= 1 \\ q_{12} &= \frac{\sigma A_1(T_1^4 - T_2^4)}{\frac{1}{\varepsilon_1} + \frac{1 - \varepsilon_2}{\varepsilon_2} \left(\frac{r_1}{r_2}\right)^2} \end{aligned} \quad (13.21)$$

**Small Convex Object in a Large Cavity**



$$\begin{aligned} \frac{A_1}{A_2} &\approx 0 \\ F_{12} &= 1 \\ q_{12} &= \sigma A_1 \varepsilon_1 (T_1^4 - T_2^4) \end{aligned} \quad (13.22)$$

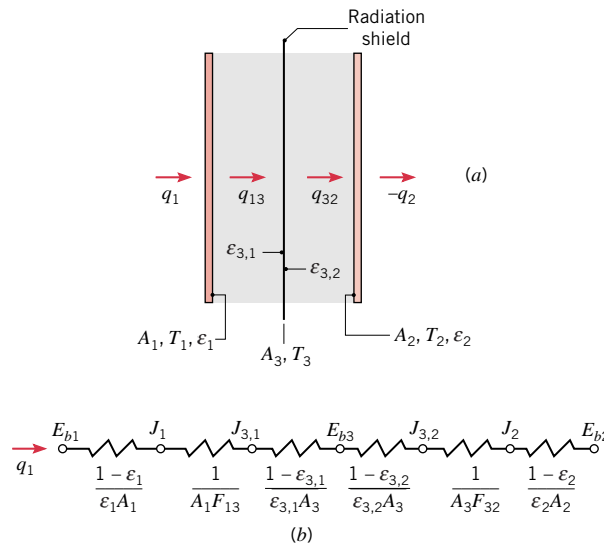

**FIGURE 13.11** Radiation exchange between large parallel planes with a radiation shield. (a) Schematic. (b) Network representation.

The foregoing procedure may readily be extended to problems involving multiple radiation shields. In the special case for which all the emissivities are equal, it may be shown that, with  $N$  shields,

$$(q_{12})_N = \frac{1}{N+1} (q_{12})_0 \quad (13.24)$$

where  $(q_{12})_0$  is the radiation transfer rate with no shields ( $N = 0$ ).

### EXAMPLE 13.5

A cryogenic fluid flows through a long tube of 20-mm diameter, the outer surface of which is diffuse and gray with  $\varepsilon_1 = 0.02$  and  $T_1 = 77$  K. This tube is concentric with a larger tube of 50-mm diameter, the inner surface of which is diffuse and gray with  $\varepsilon_2 = 0.05$  and  $T_2 = 300$  K. The space between the surfaces is evacuated. Calculate the heat gain by the cryogenic fluid per unit length of tubes. If a thin radiation shield of 35-mm diameter and  $\varepsilon_3 = 0.02$  (both sides) is inserted midway between the inner and outer surfaces, calculate the change (percentage) in heat gain per unit length of the tubes.


### SOLUTION

**Known:** Concentric tube arrangement with diffuse, gray surfaces of different emissivities and temperatures.

### Find:

1. Heat gain by the cryogenic fluid passing through the inner tube.
2. Percentage change in heat gain with radiation shield inserted midway between inner and outer tubes.

### Schematic:

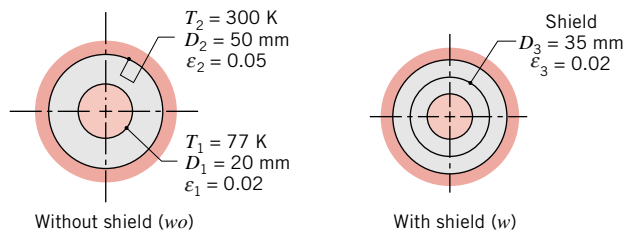

### Assumptions:

1. Surfaces are diffuse and gray.
2. Space between tubes is evacuated.
3. Conduction resistance for radiation shield is negligible.
4. Concentric tubes form a two-surface enclosure (end effects are negligible).

**Analysis:**

1. The network representation of the system without the shield is shown in Figure 13.10, and the desired heat rate may be obtained from Equation 13.20, where

$$q = \frac{\sigma(\pi D_1 L)(T_1^4 - T_2^4)}{\frac{1}{\varepsilon_1} + \frac{1 - \varepsilon_2}{\varepsilon_2} \left( \frac{D_1}{D_2} \right)}$$

Hence

$$q' = \frac{q}{L} = \frac{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (\pi \times 0.02 \text{ m}) [(77 \text{ K})^4 - (300 \text{ K})^4]}{\frac{1}{0.02} + \frac{1 - 0.05}{0.05} \left( \frac{0.02 \text{ m}}{0.05 \text{ m}} \right)}$$

$$q' = -0.50 \text{ W/m}$$

◁

2. The network representation of the system with the shield is shown in Figure 13.11, and the desired heat rate is now

$$q = \frac{E_{b1} - E_{b2}}{R_{\text{tot}}} = \frac{\sigma(T_1^4 - T_2^4)}{R_{\text{tot}}}$$

where

$$R_{\text{tot}} = \frac{1 - \varepsilon_1}{\varepsilon_1(\pi D_1 L)} + \frac{1}{(\pi D_1 L)F_{13}} + 2 \left[ \frac{1 - \varepsilon_3}{\varepsilon_3(\pi D_3 L)} \right] + \frac{1}{(\pi D_3 L)F_{32}} + \frac{1 - \varepsilon_2}{\varepsilon_2(\pi D_2 L)}$$

or

$$R_{\text{tot}} = \frac{1}{L} \left\{ \frac{1 - 0.02}{0.02(\pi \times 0.02 \text{ m})} + \frac{1}{(\pi \times 0.02 \text{ m})1} + 2 \left[ \frac{1 - 0.02}{0.02(\pi \times 0.035 \text{ m})} \right] + \frac{1}{(\pi \times 0.035 \text{ m})1} + \frac{1 - 0.05}{0.05(\pi \times 0.05 \text{ m})} \right\}$$

$$R_{\text{tot}} = \frac{1}{L} (779.9 + 15.9 + 891.3 + 9.1 + 121.0) = \frac{1817}{L} \left( \frac{1}{\text{m}^2} \right)$$

Hence

$$q' = \frac{q}{L} = \frac{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 [(77 \text{ K})^4 - (300 \text{ K})^4]}{1817 (1/\text{m})} = -0.25 \text{ W/m}$$


◁

The percentage change in the heat gain is then

$$\frac{q'_w - q'_{wo}}{q'_{wo}} \times 100 = \frac{(-0.25 \text{ W/m}) - (-0.50 \text{ W/m})}{-0.50 \text{ W/m}} \times 100 = -50\%$$

### 13.2.6 The Reradiating Surface

The assumption of a *reradiating surface* is common to many industrial applications. This idealized surface is characterized by *zero* net radiation transfer ( $q_i = 0$ ). It is closely approached by real surfaces that are well insulated on one side *and* for

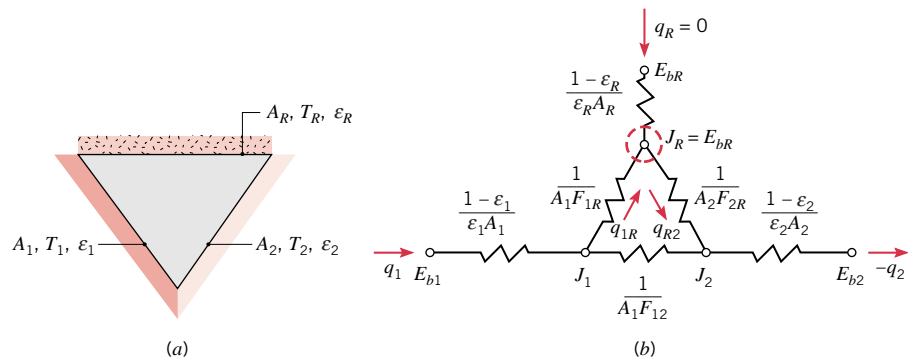

**FIGURE 13.12** A three-surface enclosure with one surface reradiating. (a) Schematic. (b) Network representation.

which convection effects may be neglected on the opposite (reradiating) side. With  $q_i = 0$ , it follows from Equations 13.9 and 13.13 that  $G_i = J_i = E_{bi}$ . Hence, if the radiosity of a reradiating surface is known, its temperature is readily determined. In an enclosure, the equilibrium temperature of a reradiating surface is determined by its interaction with the other surfaces, and it is *independent of the emissivity of the reradiating surface*.

A three-surface enclosure, for which the third surface, surface R, is reradiating, is shown in Figure 13.12a, and the corresponding network is shown in Figure 13.12b. Surface R is presumed to be well insulated, and convection effects are assumed to be negligible. Hence, with  $q_R = 0$ , the net radiation transfer from surface 1 must equal the net radiation transfer to surface 2. The network is a simple series-parallel arrangement, and from its analysis it is readily shown that

$$q_1 = -q_2 = \frac{E_{b1} - E_{b2}}{\frac{1-\epsilon_1}{\epsilon_1 A_1} + \frac{1}{A_1 F_{12} + [(1/A_1 F_{1R}) + (1/A_2 F_{2R})]^{-1}} + \frac{1-\epsilon_2}{\epsilon_2 A_2}} \quad (13.25)$$

Knowing  $q_1 = -q_2$ , Equation 13.13 may be applied to surfaces 1 and 2 to determine their radiosities  $J_1$  and  $J_2$ . Knowing  $J_1$ ,  $J_2$ , and the geometrical resistances, the radiosity of the reradiating surface  $J_R$  may be determined from the radiation balance

$$\frac{J_1 - J_R}{(1/A_1 F_{1R})} - \frac{J_R - J_2}{(1/A_2 F_{2R})} = 0 \quad (13.26)$$

The temperature of the reradiating surface may then be determined from the requirement that  $\sigma T_R^4 = J_R$ .

Note that the general procedure described in Section 13.2.2 may be applied to enclosures with reradiating surfaces. For each such surface, it is appropriate to use Equation 13.16 with  $q_i = 0$ .

### EXAMPLE 13.6

A paint baking oven consists of a long, triangular duct in which a heated surface is maintained at 1200 K and another surface is insulated. Painted panels, which are maintained at 500 K, occupy the third surface. The triangle is of width  $W = 1$  m on a side,

and the heated and insulated surfaces have an emissivity of 0.8. The emissivity of the panels is 0.4. During steady-state operation, at what rate must energy be supplied to the heated side per unit length of the duct to maintain its temperature at 1200 K? What is the temperature of the insulated surface?


### SOLUTION

**Known:** Surface properties of a long triangular duct that is insulated on one side and heated and cooled on the other sides.

**Find:**

1. Rate at which heat must be supplied per unit length of duct.
2. Temperature of the insulated surface.

**Schematic:**

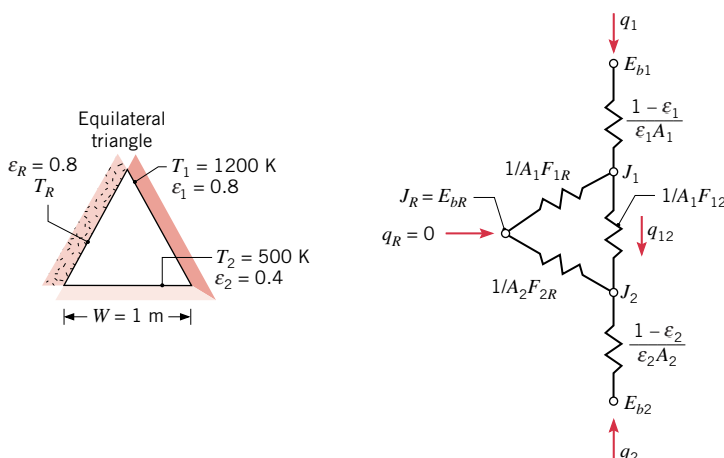

**Assumptions:**

1. Steady-state conditions exist.
2. All surfaces are opaque, diffuse, gray, and of uniform radiosity.
3. Convection effects are negligible.
4. Surface R is reradiating.
5. End effects are negligible.

**Analysis:**

1. The system may be modeled as a three-surface enclosure with one surface reradiating. The rate at which energy must be supplied to the heated surface may then be obtained from Equation 13.25:

$$q_1 = \frac{E_{b1} - E_{b2}}{\frac{1 - \epsilon_1}{\epsilon_1 A_1} + \frac{1}{A_1 F_{12} + [(1/A_1 F_{1R}) + (1/A_2 F_{2R})]^{-1}} + \frac{1 - \epsilon_2}{\epsilon_2 A_2}}$$



From symmetry,  $F_{12} = F_{1R} = F_{2R} = 0.5$ . Also,  $A_1 = A_2 = W \cdot L$ , where  $L$  is the duct length. Hence

$$q'_1 = \frac{q_1}{L} = \frac{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (1200^4 - 500^4) \text{ K}^4}{\frac{1 - 0.8}{0.8 \times 1 \text{ m}} + \frac{1}{1 \text{ m} \times 0.5 + (2 + 2)^{-1} \text{ m}} + \frac{1 - 0.4}{0.4 \times 1 \text{ m}}}$$

or

$$q'_1 = 37 \text{ kW/m} = -q'_2 \quad \triangleleft$$

- The temperature of the insulated surface may be obtained from the requirement that  $J_R = E_{bR}$ , where  $J_R$  may be obtained from Equation 13.26. However, to use this expression  $J_1$  and  $J_2$  must be known. Applying the surface energy balance, Equation 13.13, to surfaces 1 and 2, it follows that

$$\begin{aligned} J_1 &= E_{b1} - \frac{1 - \varepsilon_1}{\varepsilon_1 W} q'_1 = 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (1200 \text{ K})^4 \\ &\quad - \frac{1 - 0.8}{0.8 \times 1 \text{ m}} \times 37,000 \text{ W/m} = 108,323 \text{ W/m}^2 \\ J_2 &= E_{b2} - \frac{1 - \varepsilon_2}{\varepsilon_2 W} q'_2 = 5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 (500 \text{ K})^4 \\ &\quad - \frac{1 - 0.4}{0.4 \times 1 \text{ m}} (-37,000 \text{ W/m}) = 59,043 \text{ W/m}^2 \end{aligned}$$

From the energy balance for the reradiating surface, Equation 13.26, it follows that

$$\frac{108,323 - J_R}{\frac{1}{W \times L \times 0.5}} - \frac{J_R - 59,043}{\frac{1}{W \times L \times 0.5}} = 0$$

Hence

$$\begin{aligned} J_R &= 83,683 \text{ W/m}^2 = E_{bR} = \sigma T_R^4 \\ T_R &= \left( \frac{83,683 \text{ W/m}^2}{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4} \right)^{1/4} = 1102 \text{ K} \quad \triangleleft \end{aligned}$$

### Comments:

- Note that temperature and radiosity discontinuities cannot exist at the corners, and the assumptions of uniform temperature and radiosity are weakest in these regions.
- The results are independent of the value of  $\varepsilon_R$ .
- This problem may also be solved using the direct approach. The solution involves first determining the three unknown radiosities  $J_1$ ,  $J_2$ , and  $J_R$ . The governing equations are obtained by writing Equation 13.15 for the two surfaces of known temperature, 1 and 2, and Equation 13.16 for surface  $R$ . The three equations are

$$\begin{aligned} \frac{E_{b1} - J_1}{(1 - \varepsilon_1)/\varepsilon_1 A_1} &= \frac{J_1 - J_2}{(A_1 F_{12})^{-1}} + \frac{J_1 - J_R}{(A_1 F_{1R})^{-1}} \\ \frac{E_{b2} - J_2}{(1 - \varepsilon_2)/\varepsilon_2 A_2} &= \frac{J_2 - J_1}{(A_2 F_{21})^{-1}} + \frac{J_2 - J_R}{(A_2 F_{2R})^{-1}} \\ 0 &= \frac{J_R - J_1}{(A_R F_{R1})^{-1}} + \frac{J_R - J_2}{(A_R F_{R2})^{-1}} \end{aligned}$$

Canceling the area  $A_1$ , the first equation reduces to

$$\frac{117,573 - J_1}{0.25} = \frac{J_1 - J_2}{2} + \frac{J_1 - J_R}{2}$$

or

$$10J_1 - J_2 - J_R = 940,584 \quad (1)$$

Similarly, for surface 2,

$$\frac{3544 - J_2}{1.50} = \frac{J_2 - J_1}{2} + \frac{J_2 - J_R}{2}$$

or

$$-J_1 + 3.33J_2 - J_R = 4725 \quad (2)$$

and for the reradiating surface

$$0 = \frac{J_R - J_1}{2} + \frac{J_R - J_2}{2}$$

or

$$-J_1 - J_2 + 2J_R = 0 \quad (3)$$

Solving Equations 1, 2, and 3 simultaneously yields

$$J_1 = 108,328 \text{ W/m}^2 \quad J_2 = 59,018 \text{ W/m}^2 \quad \text{and} \quad J_R = 83,673 \text{ W/m}^2$$

Recognizing that  $J_R = \sigma T_R^4$ , it follows that

$$T_R = \left( \frac{J_R}{\sigma} \right)^{1/4} = \left( \frac{83,673 \text{ W/m}^2}{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4} \right)^{1/4} = 1102 \text{ K}$$

## 13.3


### Multimode Heat Transfer

Thus far, radiation exchange in an enclosure has been considered under conditions for which conduction and convection could be neglected. However, in many applications, convection and/or conduction are comparable to radiation and must be considered in the heat transfer analysis.

Consider the general surface condition of Figure 13.13a. In addition to exchanging energy by radiation with other surfaces of the enclosure, there may be external heat addition to the surface, as, for example, by electric heating, and heat transfer from the surface by convection and conduction. From a surface energy balance, it follows that

$$q_{i,\text{ext}} = q_{i,\text{rad}} + q_{i,\text{conv}} + q_{i,\text{cond}} \quad (13.27)$$

where  $q_{i,\text{rad}}$ , the net rate of radiation transfer from the surface, is determined by standard procedures for an enclosure. Hence, in general,  $q_{i,\text{rad}}$  may be determined from Equation 13.13 or 13.14, while for special cases such as a two-surface enclosure and a three-surface enclosure with one reradiating surface, it may be determined from Equations 13.18 and 13.25, respectively. The surface network element of the

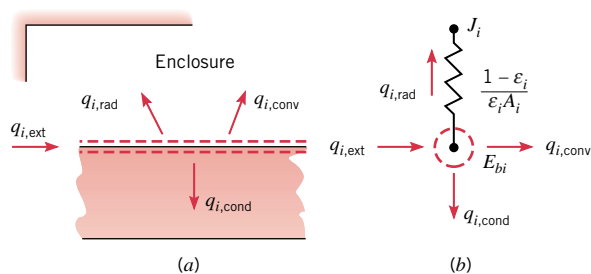

**FIGURE 13.13** Multimode heat transfer from a surface in an enclosure. (a) Surface energy balance. (b) Circuit representation.

radiation circuit is modified according to Figure 13.13b, where  $q_{i,ext}$ ,  $q_{i,cond}$ , and  $q_{i,conv}$  represent current flows to or from the surface node. Note, however, that while  $q_{i,cond}$  and  $q_{i,conv}$  are proportional to temperature differences,  $q_{i,rad}$  is proportional to the difference between temperatures raised to the fourth power. Conditions are simplified if the back of the surface is insulated, in which case  $q_{i,cond} = 0$ . Moreover, if there is no external heating and convection is negligible, the surface is reradiating.

### EXAMPLE 13.7


Consider an air heater consisting of a semicircular tube for which the plane surface is maintained at 1000 K and the other surface is well insulated. The tube radius is 20 mm, and both surfaces have an emissivity of 0.8. If atmospheric air flows through the tube at 0.01 kg/s and  $T_m = 400$  K, what is the rate at which heat must be supplied per unit length to maintain the plane surface at 1000 K? What is the temperature of the insulated surface?

### SOLUTION

**Known:** Airflow conditions in tubular heater and heater surface conditions.

**Find:** Rate at which heat must be supplied and temperature of insulated surface.

**Schematic:**

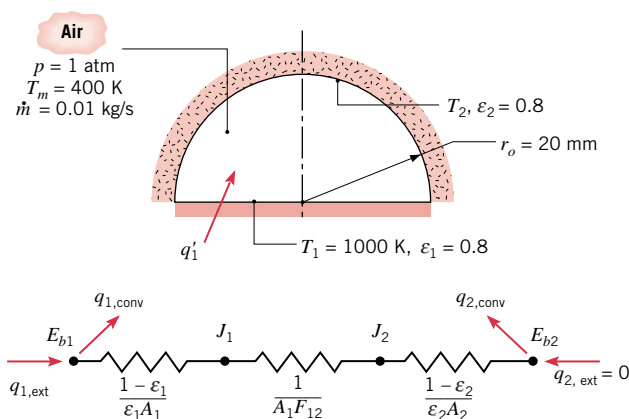

**Assumptions:**

1. Steady-state conditions.
2. Diffuse, gray surfaces.
3. Negligible tube end effects and axial variations in gas temperature.
4. Fully developed flow.

**Properties:** Table A.4, air (1 atm, 400 K):  $k = 0.0338 \text{ W/m} \cdot \text{K}$ ,  $\mu = 230 \times 10^{-7} \text{ kg/s} \cdot \text{m}$ ,  $c_p = 1014 \text{ J/kg} \cdot \text{K}$ ,  $Pr = 0.69$ .

**Analysis:** Since the semicircular surface is well insulated and there is no external heat addition, a surface energy balance yields

$$-q_{2,\text{rad}} = q_{2,\text{conv}}$$

Since the tube constitutes a two-surface enclosure, the net radiation transfer to surface 2 may be evaluated from Equation 13.18. Hence

$$\frac{\sigma(T_1^4 - T_2^4)}{\frac{1 - \varepsilon_1}{\varepsilon_1 A_1} + \frac{1}{A_1 F_{12}} + \frac{1 - \varepsilon_2}{\varepsilon_2 A_2}} = h A_2 (T_2 - T_m)$$

where the view factor is  $F_{12} = 1$  and, per unit length, the surface areas are  $A_1 = 2r_o$  and  $A_2 = \pi r_o$ . With

$$Re_D = \frac{\rho u_m D_h}{\mu} = \frac{\dot{m} D_h}{A_c \mu} = \frac{\dot{m} D_h}{(\pi r_o^2 / 2) \mu}$$

the hydraulic diameter is

$$D_h = \frac{4A_c}{P} = \frac{2\pi r_o}{\pi + 2} = \frac{0.04\pi \text{ m}}{\pi + 2} = 0.0244 \text{ m}$$

Hence

$$Re_D = \frac{0.01 \text{ kg/s} \times 0.0244 \text{ m}}{(\pi/2) (0.02 \text{ m})^2 \times 230 \times 10^{-7} \text{ kg/s} \cdot \text{m}} = 16,900$$

From the Dittus–Boelter equation,

$$\begin{aligned} Nu_D &= 0.023 Re_D^{4/5} Pr^{0.4} \\ Nu_D &= 0.023 (16,900)^{4/5} (0.69)^{0.4} = 47.8 \\ h &= \frac{k}{D_h} Nu_D = \frac{0.0338 \text{ W/m} \cdot \text{K}}{0.0244 \text{ m}} 47.8 = 66.2 \text{ W/m}^2 \cdot \text{K} \end{aligned}$$

Dividing both sides of the energy balance by  $A_1$ , it follows that

$$\frac{5.67 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4 [(1000)^4 - T_2^4] \text{ K}^4}{\frac{1 - 0.8}{0.8} + 1 + \frac{1 - 0.8}{0.8} \frac{2}{\pi}} = 66.2 \frac{\pi}{2} (T_2 - 400) \text{ W/m}^2$$

or

$$5.67 \times 10^{-8} T_2^4 + 146.5 T_2 - 115,313 = 0$$

A trial-and-error solution yields

$$T_2 = 696 \text{ K}$$



From an energy balance at the heated surface,

$$q_{1,\text{ext}} = q_{1,\text{rad}} + q_{1,\text{conv}} = q_{2,\text{conv}} + q_{1,\text{conv}}$$

Hence, on a unit length basis,

$$q'_{1,\text{ext}} = h\pi r_o(T_2 - T_m) + h2r_o(T_1 - T_m)$$

$$q'_{1,\text{ext}} = 66.2 \times 0.02[\pi(696 - 400) + 2(1000 - 400)] \text{ W/m}$$

$$q'_{1,\text{ext}} = (1231 + 1589) \text{ W/m} = 2820 \text{ W/m}$$



**Comments:** Applying an energy balance to a differential control volume about the air, it follows that

$$\frac{dT_m}{dx} = \frac{q'_1}{\dot{m}c_p} = \frac{2820 \text{ W/m}}{0.01 \text{ kg/s} (1014 \text{ J/kg} \cdot \text{K})} = 278 \text{ K/m}$$

Hence the air temperature change is significant, and a more representative analysis would subdivide the tube into axial zones and would allow for variations in air and insulated surface temperatures between zones. Moreover, a two-surface analysis of radiation exchange would no longer be appropriate.

## 13.4

### Radiation Exchange with Participating Media

Although we have developed means for predicting radiation exchange between surfaces, it is important to be cognizant of the inherent limitations. Recall that we have considered *isothermal*, *opaque*, *gray* surfaces that *emit* and *reflect diffusely* and that are characterized by *uniform* surface *radiosity* and *irradiation*. For enclosures we have also considered the medium that separates the surfaces to be *nonparticipating*; that is, it neither absorbs nor scatters the surface radiation, and it emits no radiation.

The foregoing conditions and the related equations may often be used to obtain reliable first estimates and, in most cases, highly accurate results for radiation transfer in an enclosure. Sometimes, however, the assumptions are grossly inappropriate and more refined prediction methods are needed. Although beyond the scope of this text, the methods are discussed in more advanced treatments of radiation transfer [3, 7–12].

We have said little about gaseous radiation, having confined our attention to radiation exchange at the surface of an opaque solid or liquid. For *nonpolar* gases, such as O<sub>2</sub> or N<sub>2</sub>, such neglect is justified, since the gases do not emit radiation and are essentially transparent to incident thermal radiation. However, the same may not be said for polar molecules, such as CO<sub>2</sub>, H<sub>2</sub>O (vapor), NH<sub>3</sub>, and hydrocarbon gases, which emit and absorb over a wide temperature range. For such gases matters are complicated by the fact that, unlike radiation from a solid or a liquid, which is distributed continuously with wavelength, gaseous radiation is concentrated in specific *wavelength intervals* (called bands). Moreover, gaseous radiation is not a surface phenomenon, but is instead a *volumetric* phenomenon.

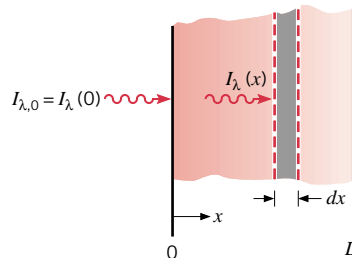


FIGURE 13.14

Absorption in a gas or liquid layer.

### 13.4.1 Volumetric Absorption

Spectral radiation absorption in a gas (or in a semitransparent liquid or solid) is a function of the absorption coefficient  $\kappa_{\lambda}$  (1/m) and the thickness  $L$  of the medium (Figure 13.14). If a monochromatic beam of intensity  $I_{\lambda,0}$  is incident on the medium, the intensity is reduced due to absorption, and the reduction occurring in an infinitesimal layer of thickness  $dx$  may be expressed as

$$dI_{\lambda}(x) = -\kappa_{\lambda}I_{\lambda}(x) dx \quad (13.28)$$

Separating variables and integrating over the entire layer, we obtain

$$\int_{I_{\lambda,0}}^{I_{\lambda,L}} \frac{dI_{\lambda}(x)}{I_{\lambda}(x)} = -\kappa_{\lambda} \int_0^L dx$$

where  $\kappa_{\lambda}$  is assumed to be independent of  $x$ . It follows that

$$\frac{I_{\lambda,L}}{I_{\lambda,0}} = e^{-\kappa_{\lambda}L} \quad (13.29)$$

This exponential decay, termed *Beer's law*, is a useful tool in approximate radiation analysis. It may, for example, be used to infer the overall spectral absorptivity of the medium. In particular, with the transmissivity defined as

$$\tau_{\lambda} = \frac{I_{\lambda,L}}{I_{\lambda,0}} = e^{-\kappa_{\lambda}L} \quad (13.30)$$

the absorptivity is

$$\alpha_{\lambda} = 1 - \tau_{\lambda} = 1 - e^{-\kappa_{\lambda}L} \quad (13.31)$$

If Kirchhoff's law is assumed to be valid,  $\alpha_{\lambda} = \varepsilon_{\lambda}$ , Equation 13.31 also provides the spectral emissivity of the medium.

### 13.4.2 Gaseous Emission and Absorption

A common engineering calculation is one that requires determination of the radiant heat flux from a gas to an adjoining surface. Despite the complicated spectral and directional effects inherent in such calculations, a simplified procedure may be used. The method was developed by Hottel [13] and involves determining radiation emission from a hemispherical gas mass of temperature  $T_g$  to a surface element  $dA_1$ , which is located at the center of the hemisphere's base. Emission from the gas per unit area of the surface is expressed as

$$E_g = \varepsilon_g \sigma T_g^4 \quad (13.32)$$

where the gas emissivity  $\varepsilon_g$  was determined by correlating available data. In particular,  $\varepsilon_g$  was correlated in terms of the temperature  $T_g$  and total pressure  $p$  of the gas, the partial pressure  $p_g$  of the radiating species, and the radius  $L$  of the hemisphere.


Results for the emissivity of water vapor are plotted in Figure 13.15 as a function of the gas temperature, for a total pressure of 1 atm, and for different values of the product of the vapor partial pressure and the hemisphere radius. To evaluate the emissivity for total pressures other than 1 atm, the emissivity from Figure 13.15 must be multiplied by the correction factor  $C_w$  from Figure 13.16. Similar results were obtained for carbon dioxide and are presented in Figures 13.17 and 13.18.

The foregoing results apply when water vapor or carbon dioxide appear *separately* in a mixture with other species that are nonradiating. However, the results may readily be extended to situations in which water vapor and carbon dioxide appear *together* in a mixture with other nonradiating gases. In particular, the total gas emissivity may be expressed as


$$\varepsilon_g = \varepsilon_w + \varepsilon_c - \Delta\varepsilon \quad (13.33)$$

where the correction factor  $\Delta\varepsilon$  is presented in Figure 13.19 for different values of the gas temperature. This factor accounts for the reduction in emission associated with the mutual absorption of radiation between the two species.


Recall that the foregoing results provide the emissivity of a hemispherical gas mass of radius  $L$  radiating to an element of area at the center of its base. However,

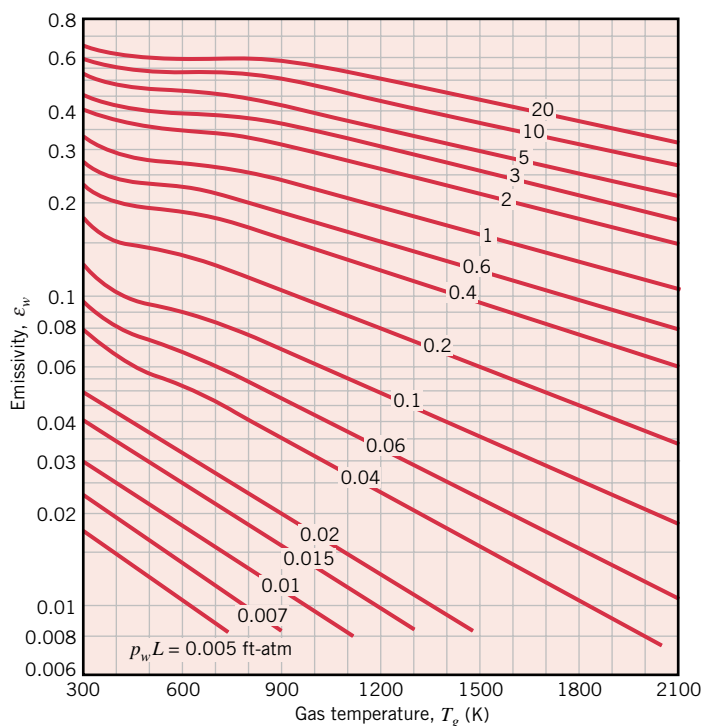

**FIGURE 13.15** Emissivity of water vapor in a mixture with nonradiating gases at 1-atm total pressure and of hemispherical shape [13]. Used with permission.

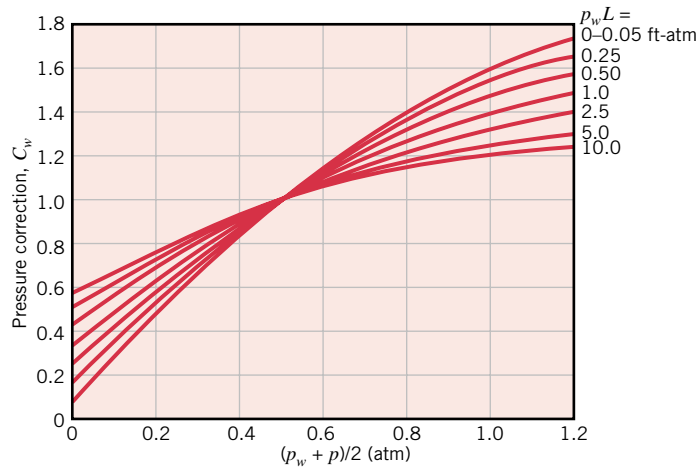


**FIGURE 13.16** Correction factor for obtaining water vapor emissivities at pressures other than 1 atm ( $\epsilon_{w,p \neq 1 \text{ atm}} = C_w \epsilon_{w,p=1 \text{ atm}}$ ) [13]. Used with permission.

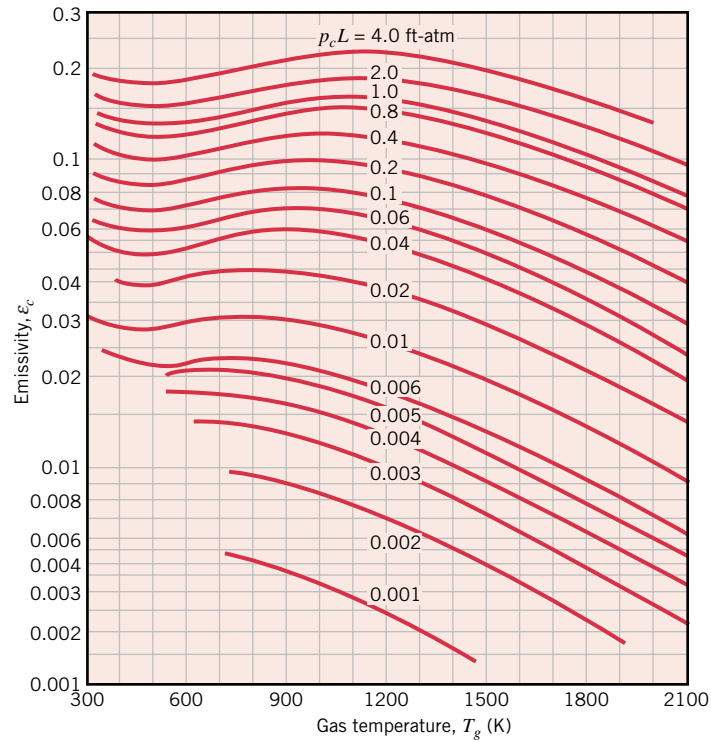

**FIGURE 13.17** Emissivity of carbon dioxide in a mixture with nonradiating gases at 1-atm total pressure and of hemispherical shape [13]. Used with permission.



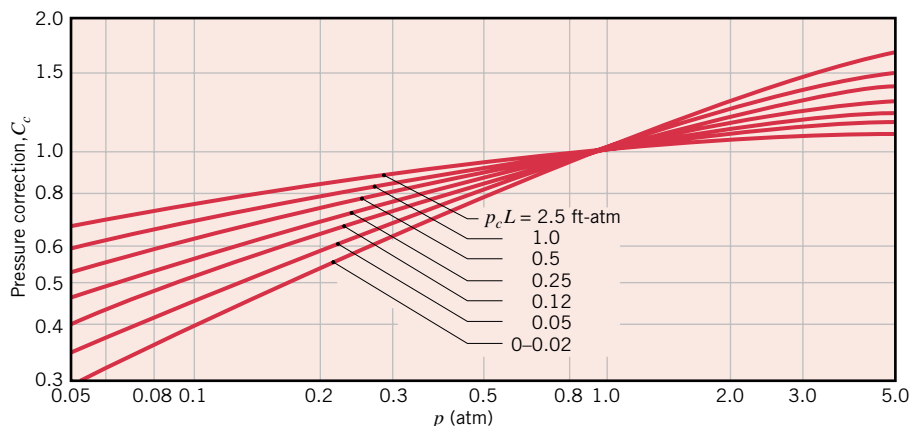


**FIGURE 13.18** Correction factor for obtaining carbon dioxide emissivities at pressures other than 1 atm ( $\epsilon_{c,p \neq 1 \text{ atm}} = C_c \epsilon_{c,p=1 \text{ atm}}$ ) [13]. Used with permission.

the results may be extended to other gas geometries by introducing the concept of a *mean beam length*,  $L_e$ . The quantity was introduced to correlate, in terms of a single parameter, the dependence of gas emissivity on both the size and the shape of the gas geometry. It may be interpreted as the radius of a hemispherical gas mass whose emissivity is equivalent to that for the geometry of interest. Its value has been determined for numerous gas shapes [13], and representative results are listed in Table 13.4. Replacing  $L$  by  $L_e$  in Figures 13.15 through 13.19, the emissivity associated with the geometry of interest may then be determined.

Using the results of Table 13.4 with Figures 13.15 through 13.19, it is possible to determine the rate of radiant heat transfer to a surface due to emission from an adjoining gas. This heat rate may be expressed as

$$q = \epsilon_g A_s \sigma T_g^4 \quad (13.34)$$

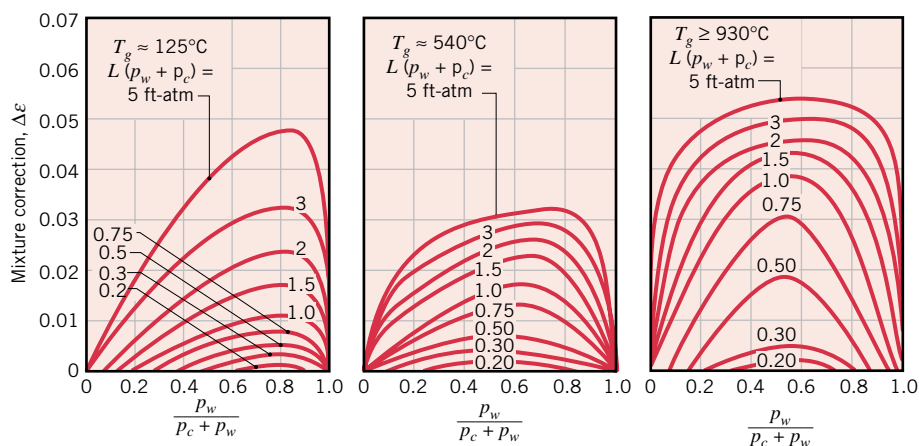

**FIGURE 13.19** Correction factor associated with mixtures of water vapor and carbon dioxide [13]. Used with permission.

**TABLE 13.4** Mean Beam Lengths  $L_e$  for Various Gas Geometries

Geometry	Characteristic Length	$L_e$
Sphere (radiation to surface)	Diameter ( $D$ )	$0.65D$
Infinite circular cylinder (radiation to curved surface)	Diameter ( $D$ )	$0.95D$
Semi-infinite circular cylinder (radiation to base)	Diameter ( $D$ )	$0.65D$
Circular cylinder of equal height and diameter (radiation to entire surface)	Diameter ( $D$ )	$0.60D$
Infinite parallel planes (radiation to planes)	Spacing between planes ( $L$ )	$1.80L$
Cube (radiation to any surface)	Side ( $L$ )	$0.66L$
Arbitrary shape of volume $V$ (radiation to surface of area $A$ )	Volume to area ratio ( $V/A$ )	$3.6V/A$

where  $A_s$  is the surface area. If the surface is black, it will, of course, absorb all this radiation. A black surface will also emit radiation, and the net rate at which radiation is exchanged between the surface at  $T_s$  and the gas at  $T_g$  is

$$q_{\text{net}} = A_s \sigma (\epsilon_g T_g^4 - \alpha_g T_s^4) \quad (13.35)$$

For water vapor and carbon dioxide the required gas absorptivity  $\alpha_g$  may be evaluated from the emissivity by expressions of the form [13]

**Water:**

$$\alpha_w = C_w \left( \frac{T_g}{T_s} \right)^{0.45} \times \epsilon_w \left( T_s, p_w L_e \frac{T_s}{T_g} \right) \quad (13.36)$$

**Carbon dioxide:**

$$\alpha_c = C_c \left( \frac{T_g}{T_s} \right)^{0.65} \times \epsilon_c \left( T_s, p_c L_e \frac{T_s}{T_g} \right) \quad (13.37)$$

where  $\epsilon_w$  and  $\epsilon_c$  are evaluated from Figures 13.15 and 13.17, respectively, and  $C_w$  and  $C_c$  are evaluated from Figures 13.16 and 13.18, respectively. Note, however, that in using Figures 13.15 and 13.17,  $T_g$  is replaced by  $T_s$  and  $p_w L_e$  or  $p_c L_e$  is replaced by  $p_w L_e (T_s/T_g)$  or  $p_c L_e (T_s/T_g)$ , respectively. Note also that, in the presence of both water vapor and carbon dioxide, the total gas absorptivity may be expressed as

$$\alpha_g = \alpha_w + \alpha_c - \Delta\alpha \quad (13.38)$$

where  $\Delta\alpha = \Delta\epsilon$  is obtained from Figure 13.19.

## 13.5 Summary

In this chapter we focused on the analysis of radiation exchange between the surfaces of an enclosure, and in treating this exchange we introduced the concept of a *view factor*. Because knowledge of this geometrical quantity is essential to determining radiation exchange between any two diffuse surfaces, you should be familiar

with the means by which it may be determined. You should also be adept at performing radiation calculations for an enclosure of *isothermal*, *opaque*, *diffuse*, and *gray* surfaces of *uniform radiosity* and *irradiation*. Moreover, you should be familiar with the results that apply to simple cases such as an enclosure of black surfaces, a two-surface enclosure, or a three-surface enclosure with a reradiating surface.

Test your understanding of pertinent concepts by addressing the following questions.

- What is a *view factor*? What assumptions are typically associated with computing the view factor between two surfaces?
- What is the *reciprocity relation* for view factors? What is the *summation rule*?
- Can the view factor of a surface with respect to itself be nonzero? If so, what kind of surface exhibits such behavior?
- What is a *nonparticipating medium*?
- What assumptions are inherent in treating radiation exchange between surfaces of an enclosure that may not be approximated as blackbodies? Comment on the validity of the assumptions and when or where they are most likely to break down.
- How is the radiative resistance of a surface in an enclosure defined? What is the driving potential that relates this resistance to the net rate of radiation transfer from the surface? What is the resistance if the surface may be approximated as a blackbody?
- How is the geometrical resistance associated with radiative exchange between two surfaces of an enclosure defined? What is the driving potential that relates this resistance to the net rate of radiation transfer between the surfaces?
- What is a *radiation shield* and how is net radiation transfer between two surfaces affected by an intervening shield? Is it advantageous for a shield to have a large surface absorptivity or reflectivity?
- What is a *reradiating surface*? Under what conditions may a surface be approximated as reradiating? What is the relation between radiosity, blackbody emissive power, and irradiation for a reradiating surface? Does the temperature of such a surface depend on its radiative properties?
- What can be said about a surface of an enclosure for which net radiation heat transfer to the surface is balanced by convection heat transfer from the surface to a gas in the enclosure? Is the surface reradiating? Is the back side of the surface adiabatic?
- Consider a surface in an enclosure for which net radiation transfer from the surface exceeds convection heat transfer from a gas in the enclosure. What other process or processes must occur at the surface, either independently or collectively?
- What molecular features render a gas nonemitting and nonabsorbing? What features allow for emission and absorption of radiation by a gas?
- What features distinguish emission and absorption of radiation by a gas from that of an opaque solid?
- How does the intensity of radiation propagating through a semitransparent medium vary with distance in the medium? What can be said about this variation if the absorption coefficient is very large? If the coefficient is very small?

## References


1. Hamilton, D. C., and W. R. Morgan, "Radiant Interchange Configuration Factors," National Advisory Committee for Aeronautics, Technical Note 2836, 1952.
2. Eckert, E. R. G., "Radiation: Relations and Properties," in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, 2nd ed., McGraw-Hill, New York, 1973.
3. Siegel, R., and J. R. Howell, *Thermal Radiation Heat Transfer*, 4th ed., Taylor & Francis, New York, 2002.
4. Howell, J. R., *A Catalog of Radiation Configuration Factors*, McGraw-Hill, New York, 1982.
5. Emery, A. F., O. Johansson, M. Lobo, and A. Abrous, *J. Heat Transfer*, **113**, 413, 1991.
6. Oppenheim, A. K., *Trans. ASME*, **65**, 725, 1956.
7. Hottel, H. C., and A. F. Sarofim, *Radiative Transfer*, McGraw-Hill, New York, 1967.
8. Tien, C. L., "Thermal Radiation Properties of Gases," in J. P. Hartnett and T. F. Irvine, Eds., *Advances in Heat Transfer*, Vol. 5, Academic Press, New York, 1968.
9. Sparrow, E. M., "Radiant Interchange Between Surfaces Separated by Nonabsorbing and Nonemitting Media," in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, McGraw-Hill, New York, 1973.
10. Dunkle, R. V., "Radiation Exchange in an Enclosure with a Participating Gas," in W. M. Rohsenow and J. P. Hartnett, Eds., *Handbook of Heat Transfer*, McGraw-Hill, New York, 1973.
11. Sparrow, E. M., and R. D. Cess, *Radiation Heat Transfer*, Hemisphere Publishing, New York, 1978.
12. Edwards, D. K., *Radiation Heat Transfer Notes*, Hemisphere Publishing, New York, 1981.
13. Hottel, H. C., "Radiant-Heat Transmission," in W. H. McAdams, Ed., *Heat Transmission*, 3rd ed., McGraw-Hill, New York, 1954.

## Problems


### View Factors

**13.1** Determine  $F_{12}$  and  $F_{21}$  for the following configurations using the reciprocity theorem and other basic shape factor relations. Do not use tables or charts.


(a) Long duct




(b) Small sphere of area  $A_1$  under a concentric hemisphere of area  $A_2 = 2A_1$




(c) Long duct. What is  $F_{22}$  for this case?




(d) Long inclined plates (point  $B$  is directly above the center of  $A_1$ )




(e) Sphere lying on infinite plane




(f) Hemisphere–disk arrangement




(g) Long, open channel



(h) Long concentric cylinders




**13.2** Consider the following grooves, each of width  $W$ , that have been machined from a solid block of material.

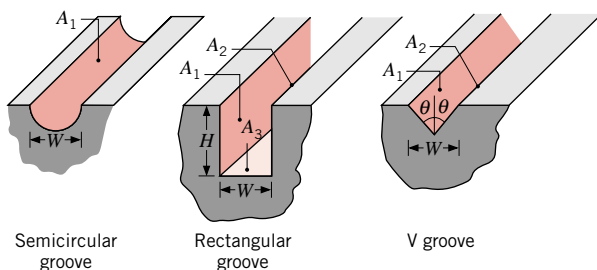

- For each case obtain an expression for the view factor of the groove with respect to the surroundings outside the groove.
- For the V groove, obtain an expression for the view factor  $F_{12}$ , where  $A_1$  and  $A_2$  are opposite surfaces.
- If  $H = 2W$  in the rectangular groove, what is the view factor  $F_{12}$ ?


**13.3** Derive expressions for the view factor  $F_{12}$  associated with the following arrangements. Express your results in terms of  $A_1$ ,  $A_2$  and any appropriate hypothetical surface area, as well as the view factor for coaxial parallel disks (Table 13.2, Figure 13.5).

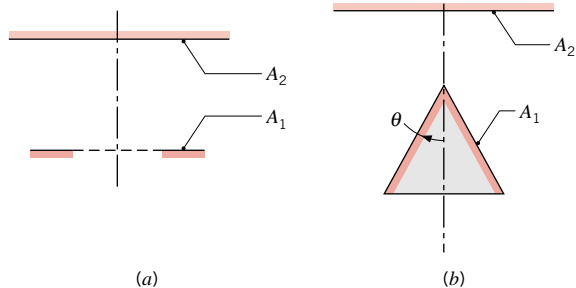

(a) A circular disk and a coaxial, ring-shaped disk.


(b) A circular disk and a coaxial, ring-shaped cone. Sketch the variation of  $F_{12}$  with  $\theta$  for  $0 \leq \theta \leq \pi/2$ , and explain the key features.

**13.4** A right-circular cone and a right-circular cylinder of the same diameter and length ( $A_2$ ) are positioned coaxially at a distance  $L_o$  from the circular disk ( $A_1$ ) shown schematically. The inner base and lateral surfaces of the cylinder may be treated as a single surface,  $A_2$ . The hypothetical area corresponding to the opening of the cone and cylinder is identified as  $A_3$ .

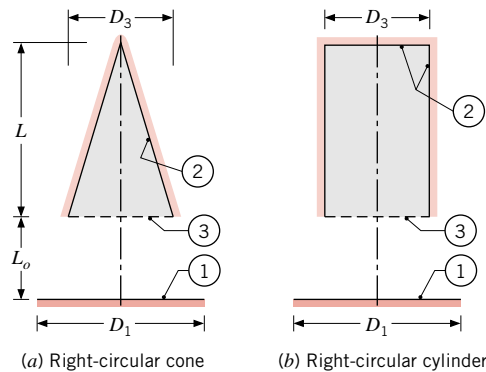

- Show that, for both arrangements,  $F_{21} = (A_1/A_2)F_{13}$  and  $F_{22} = 1 - (A_3/A_2)$ , where  $F_{13}$  is the view factor between two coaxial, parallel disks (Table 13.2).
- For  $L = L_o = 50$  mm and  $D_1 = D_3 = 50$  mm, calculate  $F_{21}$  and  $F_{22}$  for the conical and cylindrical configurations and compare their relative magnitudes. Explain any similarities and differences.
- Do the relative magnitudes of  $F_{21}$  and  $F_{22}$  change for the conical and cylindrical configurations as  $L$  increases and all other parameters remain fixed? In the limit of very large  $L$ , what do you expect will happen? Sketch the variations of  $F_{21}$  and  $F_{22}$  with  $L$ , and explain the key features.

**13.5** Consider the two parallel, coaxial, ring-shaped disks shown schematically.

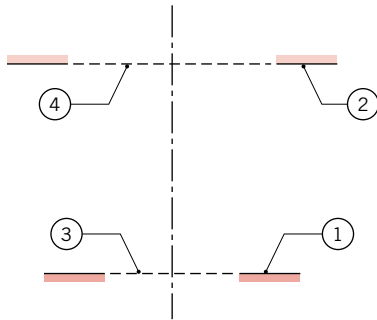


Show that  $F_{12}$  can be expressed as

$$F_{12} = \frac{1}{A_1} \{A_{(1,3)}F_{(1,3)(2,4)} - A_3F_{3(2,4)} - A_4(F_{4(1,3)} - F_{43})\}$$

where all view factors on the right-hand side of the equation can be evaluated from Figure 13.5 or Table 13.2 for coaxial parallel disks.


- 13.6** The “crossed-strings” method of Hottel [13] provides a simple means to calculate view factors between surfaces that are of infinite extent in one direction. For two such surfaces (a) with unobstructed views of one another, the view factor is of the form

$$F_{12} = \frac{1}{2w_1}[(ac + bd) - (ad + bc)]$$

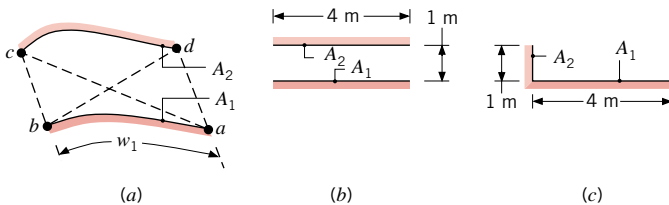


Use this method to evaluate the view factors  $F_{12}$  for sketches (b) and (c). Compare your results with those from the appropriate graphs and analytical expressions.

- 13.7** Consider the right-circular cylinder of diameter  $D$ , length  $L$ , and the areas  $A_1$ ,  $A_2$ , and  $A_3$  representing the base, inner, and top surfaces, respectively.

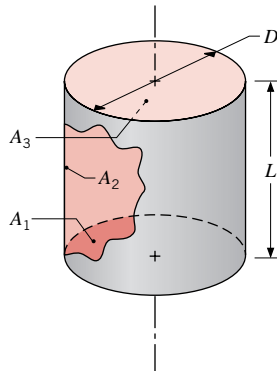

- (a) Show that the view factor between the base of the cylinder and the inner surface has the form  $F_{12} = 2H[(1 + H^2)^{1/2} - H]$ , where  $H = L/D$ .  
 (b) Show that the view factor for the inner surface to itself has the form  $F_{22} = 1 + H - (1 + H^2)^{1/2}$ .

- 13.8** Consider the parallel rectangles shown schematically.

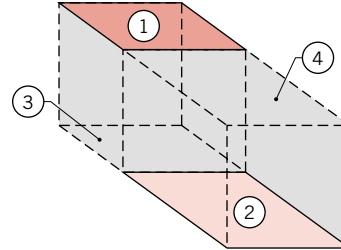


Show that the view factor  $F_{12}$  can be expressed as

$$F_{12} = \frac{1}{2A_1} [A_{(1,4)}F_{(1,4)(2,3)} - A_1F_{13} - A_4F_{42}]$$


where all view factors on the right-hand side of the equation can be evaluated from Figure 13.4 (see Table 13.2) for aligned parallel rectangles.

- 13.9** Consider the perpendicular rectangles shown schematically.

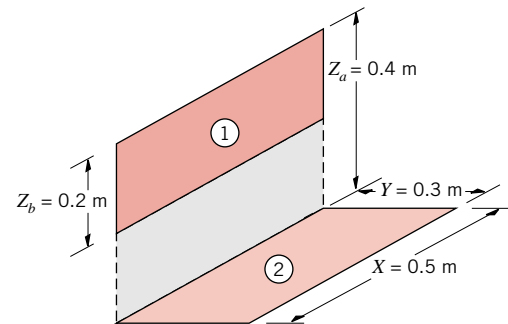

- (a) Determine the shape factor  $F_{12}$ .  
 (b) For rectangle widths of  $X = 0.5, 1.5,$  and  $5$  m, plot  $F_{12}$  as a function of  $Z_b$  for  $0.05 \leq Z_b \leq 0.4$  m. Compare your results with the view factor obtained from the two-dimensional relation for perpendicular plates with a common edge (Table 13.1).

- 13.10** The reciprocity relation, the summation rule, and Equations 13.5 to 13.7 can be used to develop view factor relations that allow for applications of Figure 13.4 and/or 13.6 to more complex configurations. Consider the view factor  $F_{14}$  for surfaces 1 and 4 of the following geometry. These surfaces are perpendicular but do not share a common edge.

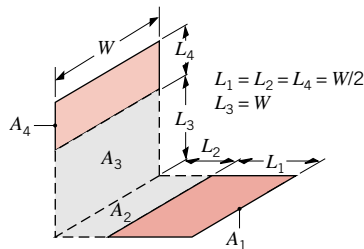


- (a) Obtain the following expression for the view factor  $F_{14}$ :

$$F_{14} = \frac{1}{A_1} [(A_1 + A_2)F_{(1,2)(3,4)} + A_2F_{23} - (A_1 + A_2)F_{(1,2)3} - A_2F_{2(3,4)}]$$

- (b) If  $L_1 = L_2 = L_4 = (W/2)$  and  $L_3 = W$ , what is the value of  $F_{14}$ ?


- 13.11** Determine the shape factor,  $F_{12}$ , for the rectangles shown.

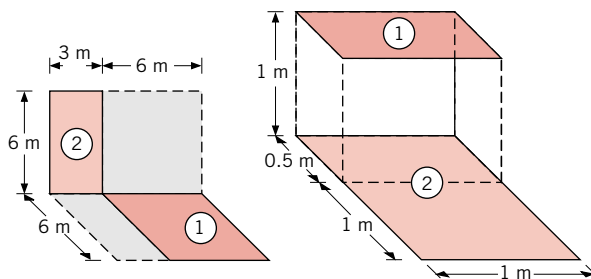


- (a) Perpendicular rectangles without a common edge. (b) Parallel rectangles of unequal areas.

- 13.12** Consider parallel planes of infinite extent normal to the page as shown in the sketch.

- Determine  $F_{12}$  using the results of Figure 13.4.
- Determine  $F_{12}$  using the first case of Table 13.1.
- Determine  $F_{12}$  using Hottel's crossed-string method described in Problem 13.6.
- Determine  $F_{12}$  using the second case of Table 13.1.
- Determine  $F_{12}$  using the results of Figure 13.4 if the dimensions are increased to  $w = L = 2$  m.

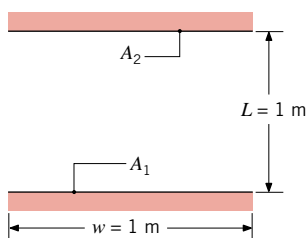


- 13.13** Consider the parallel planes of infinite extent normal to the page having opposite edges aligned as shown in the sketch.

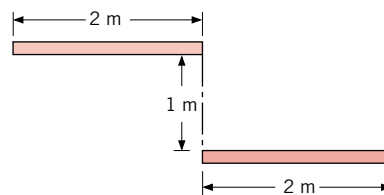


- Using appropriate view factor relations and the results for opposing parallel planes, develop an expression for the view factor  $F_{12}$ .
- Use Hottel's crossed-string method described in Problem 13.6 to determine the view factor.

- 13.14** Consider two diffuse surfaces  $A_1$  and  $A_2$  on the inside of a spherical enclosure of radius  $R$ . Using the following methods, derive an expression for the view factor  $F_{12}$  in terms of  $A_2$  and  $R$ .

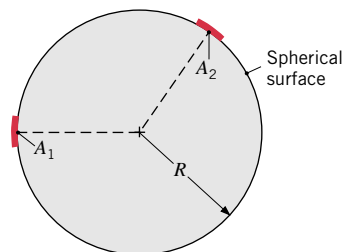


- Find  $F_{12}$  by beginning with the expression  $F_{ij} = q_{i \rightarrow j} / A_i J_i$ .
- Find  $F_{12}$  using the view factor integral, Equation 13.1.

- 13.15** As shown in the sketch, consider the disk  $A_1$  located coaxially 1 m distant, but tilted  $30^\circ$  off the normal, from the ring-shaped disk  $A_2$ .

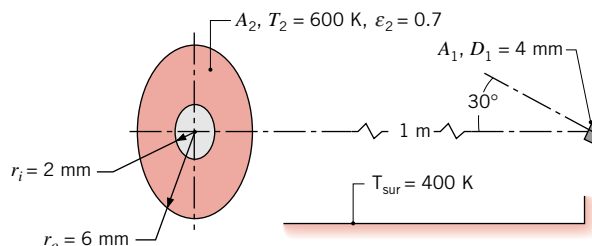

What is the irradiation on  $A_1$  due to radiation from  $A_2$ , which is a diffuse, gray surface with an emissivity of 0.7?


- 13.16** A heat flux gage of 4-mm diameter is positioned normal to and 1 m from the 5-mm-diameter aperture of a blackbody furnace at 1000 K. The diffuse, gray cover shield ( $\epsilon = 0.2$ ) of the furnace has an outer diameter of 100 mm and its temperature is 350 K. The furnace and gage are located in a large room whose walls have an emissivity of 0.8 and are at 300 K.

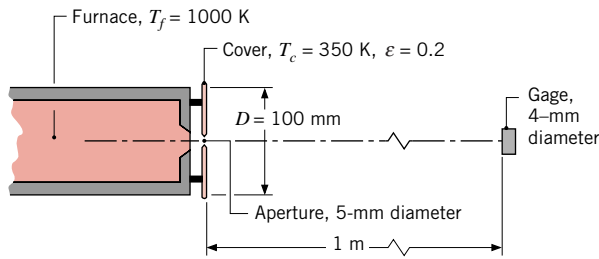

- (a) What is the irradiation on the gage,  $G_g$  ( $\text{W/m}^2$ ), considering only emission from the aperture of the furnace?
- (b) What is the irradiation on the gage due to radiation from the cover and aperture?


### Blackbody Radiation Exchange

- 13.17 A circular ice rink 25 m in diameter is enclosed by a hemispherical dome 35 m in diameter. If the ice and dome surfaces may be approximated as blackbodies and are at 0 and 15°C, respectively, what is the net rate of radiative transfer from the dome to the rink?
- 13.18 A drying oven consists of a long semicircular duct of diameter  $D = 1$  m.

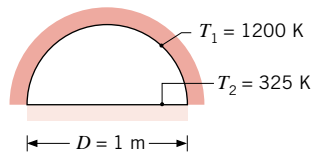


Materials to be dried cover the base of the oven while the wall is maintained at 1200 K. What is the drying rate per unit length of the oven ( $\text{kg/s} \cdot \text{m}$ ) if a water-coated layer of material is maintained at 325 K during the drying process? Blackbody behavior may be assumed for the water surface and the oven wall.

- 13.19 Consider the arrangement of the three black surfaces shown, where  $A_1$  is small compared to  $A_2$  or  $A_3$ .




Determine the value of  $F_{13}$ . Calculate the net radiation heat transfer from  $A_1$  to  $A_3$  if  $A_1 = 0.05 \text{ m}^2$ ,  $T_1 = 1000 \text{ K}$ , and  $T_3 = 500 \text{ K}$ .

- 13.20 A long, V-shaped part is heat treated by suspending it in a tubular furnace with a diameter of 2 m and a wall temperature of 1000 K. The “vee” is 1-m long on a side and has an angle of 60°.

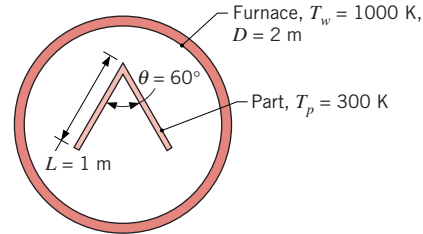


If the wall of the furnace and the surfaces of the part may be approximated as blackbodies and the part is at an initial temperature of 300 K, what is the net rate of radiation heat transfer per unit length to the part?

- 13.21 Consider coaxial, parallel, black disks separated a distance of 0.20 m. The lower disk of diameter 0.40 m is maintained at 500 K and the surroundings are at 300 K. What temperature will the upper disk of diameter 0.20 m achieve if electrical power of 17.5 W is supplied to the heater on the back side of the disk?

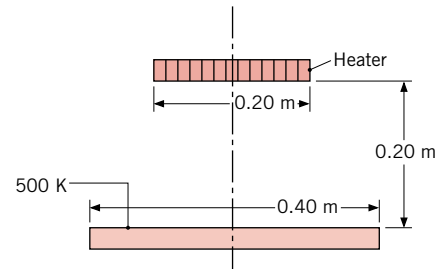

- 13.22 A tubular heater with a black inner surface of uniform temperature  $T_s = 1000 \text{ K}$  irradiates a coaxial disk.

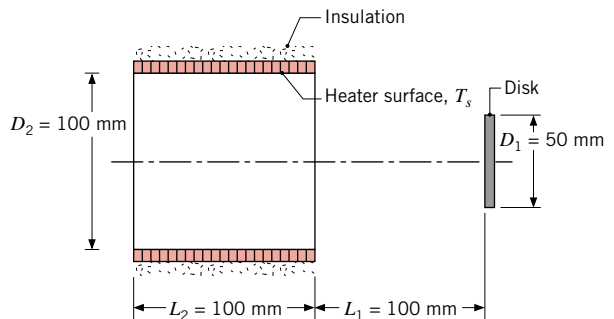


- (a) Determine the radiant power from the heater, which is incident on the disk,  $q_{s \rightarrow 1}$ . What is the irradiation on the disk,  $G_1$ ?




- (b) For disk diameters of  $D_1 = 25, 50$ , and  $100$  mm, plot  $q_{s \rightarrow 1}$  and  $G_1$  as a function of the separation distance  $L_1$  for  $0 \leq L_1 \leq 200$  mm.

**13.23** A long cylindrical rod of very high emissivity is heat treated within a long, evacuated oven of square cross section as shown in the sketch. The oven walls exhibit blackbody behavior. Due to nonuniform heat losses, the temperatures of the oven walls are slightly different and are  $T_2 = 600$  K,  $T_3 = 575$  K,  $T_4 = 555$  K, and  $T_5 = 585$  K, respectively.

- (a) Determine the steady-state temperature of the  $D = 0.2$ -m-diameter rod if each wall of the oven is  $w = 1$  m wide and  $a = b = 0.5$  m.
- (b) Determine the steady-state temperature of the rod when  $a = 0.5$  m and  $b = 0.25$  m.

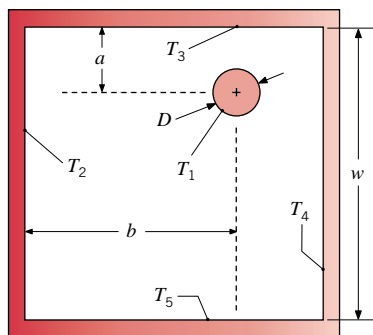

**13.24** A circular plate of 500-mm diameter is maintained at  $T_1 = 600$  K and is positioned coaxial to a conical shape. The back side of the cone is well insulated. The plate and the cone, whose surfaces are black, are located in a large, evacuated enclosure whose walls are at 300 K.

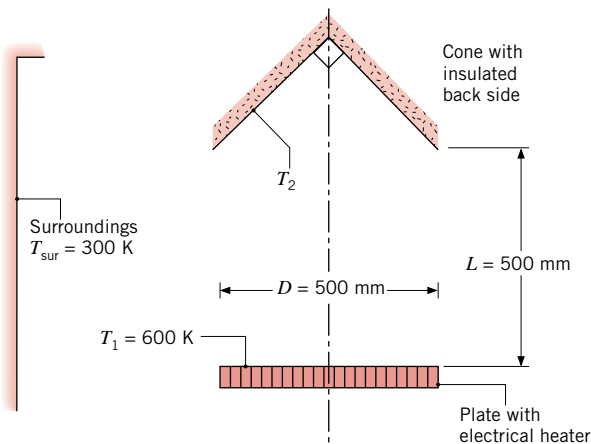


- (a) What is the temperature of the conical surface,  $T_2$ ?

- (b) What is the electrical power that would be required to maintain the circular plate at 600 K?

**13.25** Two furnace designs, as illustrated and dimensioned in Problem 13.4, are used to heat a disk-shaped work piece ( $A_1$ ). The power supplied to the conical and cylindrical furnaces ( $A_2$ ) is 50 W. The work piece is located in a large room at a temperature of 300 K, and its back side is well insulated. Assuming all surfaces are black, determine the temperature of the work piece,  $T_1$ , and the temperature of the furnace inner surface,  $T_2$ , for each of the designs. In your analysis, use the expressions provided in Problem 13.4 for the view factors,  $F_{21}$  and  $F_{22}$ .


**13.26** A furnace is constructed in three sections, which include insulated circular (2) and cylindrical (3) sections, as well as an intermediate cylindrical section (1) with imbedded electrical resistance heaters. The overall length and diameter are 200 mm and 100 mm, respectively, and the cylindrical sections are of equal length. The surroundings are at 0 K.

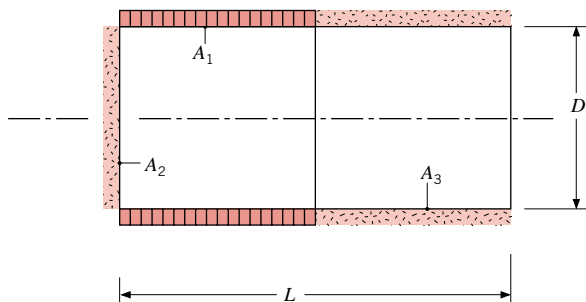

- (a) If all the surfaces are black, determine the electrical power,  $q_1$ , required to maintain the heated section at 1000 K.
- (b) What are the temperatures of the insulated sections,  $T_2$  and  $T_3$ ?
- (c) For  $D = 100$  mm, generate a plot of  $q_1$ ,  $T_2$ , and  $T_3$  as functions of the length-to-diameter ratio, with  $1 \leq L/D \leq 5$ .

**13.27** To enhance heat rejection from a spacecraft, an engineer proposes to attach an array of rectangular fins to the outer surface of the spacecraft and to coat all surfaces with a material that approximates blackbody behavior.


Consider the U-shaped region between adjoining fins and subdivide the surface into components associated with the base (1) and the side (2). Obtain an expression for the rate per unit length at which radiation is transferred from the surfaces to deep space, which may be approximated as a blackbody at

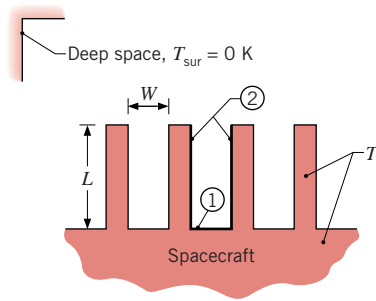

absolute zero temperature. The fins and the base may be assumed to be isothermal at a temperature  $T$ . Comment on your result. Does the engineer's proposal have merit?


- 13.28** A cylindrical cavity of diameter  $D$  and depth  $L$  is machined in a metal block, and conditions are such that the base and side surfaces of the cavity are maintained at  $T_1 = 1000$  K and  $T_2 = 700$  K, respectively. Approximating the surfaces as black, determine the emissive power of the cavity if  $L = 20$  mm and  $D = 10$  mm.

- 13.29** In the arrangement shown, the lower disk has a diameter of 30 mm and a temperature of 500 K. The upper surface, which is at 1000 K, is a ring-shaped disk with inner and outer diameters of 0.15 m and 0.2 m. This upper surface is aligned with and parallel to the lower disk and is separated by a distance of 1 m.

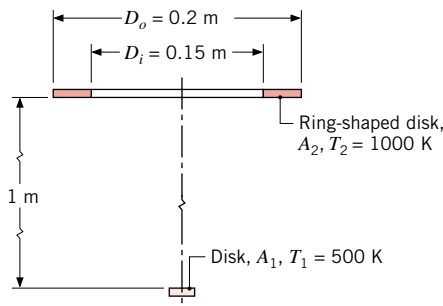


Assuming both surfaces to be blackbodies, calculate their net radiative heat exchange.

- 13.30** Two plane coaxial disks are separated by a distance  $L = 0.20$  m. The lower disk ( $A_1$ ) is solid with a diameter  $D_o = 0.80$  m and a temperature  $T_1 = 300$  K. The upper disk ( $A_2$ ), at temperature  $T_2 = 1000$  K, has the same outer diameter but is ring-shaped with an inner diameter  $D_i = 0.40$  m. Assuming the disks to be blackbodies, calculate the net radiative heat exchange between them.




- 13.31** A radiometer views a small target (1) that is being heated by a ring-shaped disk heater (2). The target has an area of  $A_1 = 0.0004$  m<sup>2</sup>, a temperature of  $T_1 = 500$  K, and a diffuse, gray emissivity of  $\epsilon_1 = 0.8$ . The heater operates at  $T_2 = 1000$  K and has a black surface. The radiometer views the entire sample area with a solid angle of  $\omega = 0.0008$  sr.

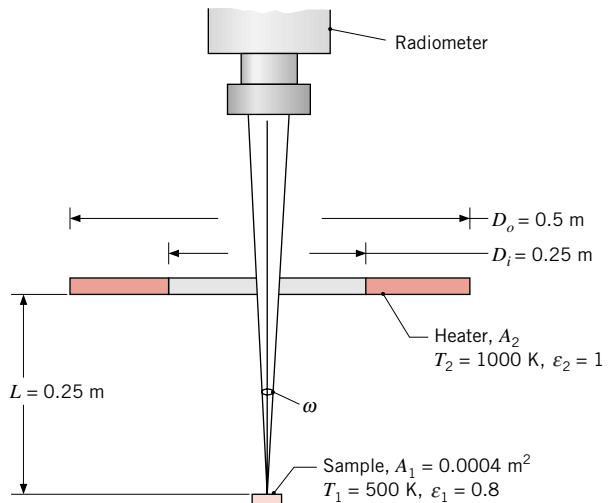


- Write an expression for the radiant power leaving the target, which is collected by the radiometer, in terms of the target radiosity  $J_1$  and relevant geometric parameters. Leave in symbolic form.
- Write an expression for the target radiosity  $J_1$  in terms of its irradiation, emissive power, and appropriate radiative properties. Leave in symbolic form.
- Write an expression for the irradiation on the target,  $G_1$ , due to emission from the heater in terms of the heater emissive power, the heater area, and an appropriate view factor. Use this expression to numerically evaluate  $G_1$ .
- Use the foregoing expressions and results to determine the radiant power collected by the radiometer.

- 13.32** A meter to measure the optical power of a laser beam is constructed with a thin-walled, black conical cavity that is well insulated from its housing. The cavity has an opening of  $D = 10$  mm and a depth of  $L = 12$  mm. The meter housing and surroundings are at a temperature of  $25.0^\circ\text{C}$ .

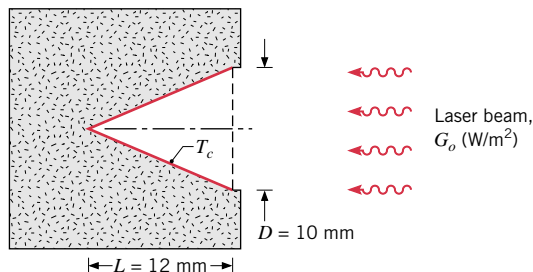


A fine-wire thermocouple attached to the surface indicates a temperature rise of  $10.1^\circ\text{C}$  when a laser beam is incident upon the meter. What is the optical (radiant) flux of the laser beam,  $G_o$  ( $\text{W}/\text{m}^2$ )?

- 13.33** An electrically heated sample is maintained at a surface temperature of  $T_s = 500$  K. The sample coating is diffuse but spectrally selective, with the spectral emissivity distribution shown schematically. The sample is irradiated by a furnace located coaxially at a distance of  $L_{sf} = 750$  mm. The furnace has isothermal walls with an emissivity of  $\epsilon_f = 0.7$  and a uniform temperature of  $T_f = 3000$  K. A radiation detector of area  $A_d = 8 \times 10^{-5} \text{ m}^2$  is positioned at a distance of  $L_{sd} = 1.0$  m from the sample along a direction that is  $45^\circ$  from the sample normal. The detector is sensitive to spectral radiant power only in the spectral region from 3 to  $5 \mu\text{m}$ . The sample surface experiences convection with a gas for which  $T_\infty = 300$  K and  $h = 20 \text{ W}/\text{m}^2 \cdot \text{K}$ . The surroundings of the sample mount are large and at a uniform temperature of  $T_{\text{sur}} = 300$  K.

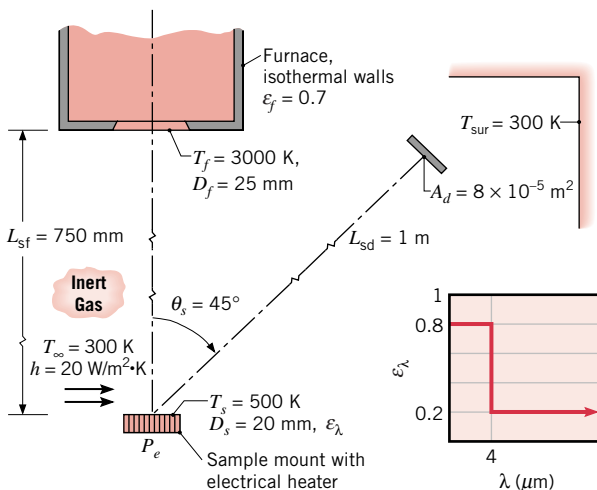


- (a) Determine the electrical power,  $P_e$ , required to maintain the sample at  $T_s = 500$  K.  
(b) Considering both emission and reflected irradiation from the sample, determine the radiant power that is incident on the detector within the spectral region from 3 to  $5 \mu\text{m}$ .

- 13.34** The arrangement shown is to be used to calibrate a heat flux gage. The gage has a black surface that is 10 mm in diameter and is maintained at  $17^\circ\text{C}$  by means of a water-cooled backing plate. The heater, 200 mm in diameter, has a black surface that is maintained at 800 K and is located 0.5 m from the gage. The surroundings and the air are at  $27^\circ\text{C}$  and the convection heat transfer coefficient between the gage and the air is  $15 \text{ W}/\text{m}^2 \cdot \text{K}$ .

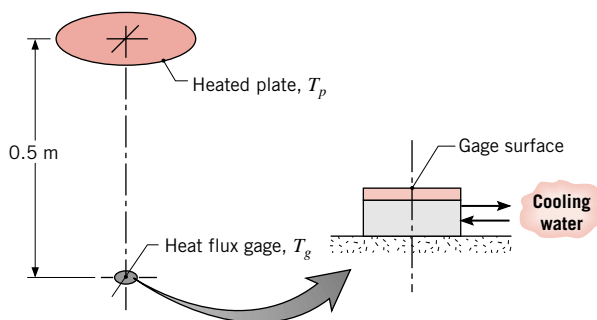

- (a) Determine the net radiation exchange between the heater and the gage.  
(b) Determine the net transfer of radiation to the gage per unit area of the gage.  
(c) What is the net heat transfer rate to the gage per unit area of the gage?  
(d) If the gage is constructed according to the description of Problem 3.98, what heat flux will it indicate?


- 13.35** A long, cylindrical heating element of 20-mm diameter operating at 700 K in vacuum is located 40 mm from an insulated wall of low thermal conductivity.

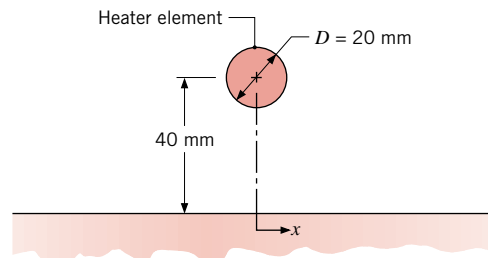

- (a) Assuming both the element and the wall are black, estimate the maximum temperature reached by the wall when the surroundings are at 300 K.


- (b) Calculate and plot the steady-state wall temperature distribution over the range  $-100 \text{ mm} \leq x \leq 100 \text{ mm}$ .

**13.36** Water flowing through a large number of long, circular, thin-walled tubes is heated by means of hot parallel plates above and below the tube array. The space between the plates is evacuated, and the plate and tube surfaces may be approximated as blackbodies.

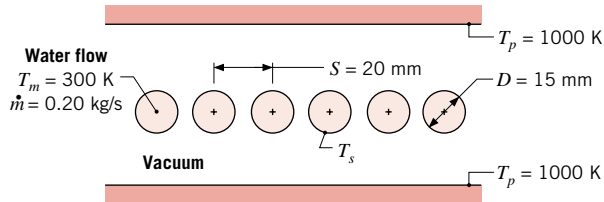

- (a) Neglecting axial variations, determine the tube surface temperature,  $T_s$ , if water flows through each tube at a mass rate of  $\dot{m} = 0.20 \text{ kg/s}$  and a mean temperature of  $T_m = 300 \text{ K}$ .
- (b) Compute and plot the surface temperature as a function of flow rate for  $0.05 \leq \dot{m} \leq 0.25 \text{ kg/s}$ .

**13.37** A row of regularly spaced, cylindrical heating elements is used to maintain an insulated furnace wall at 500 K. The opposite wall is at a uniform temperature of 300 K.

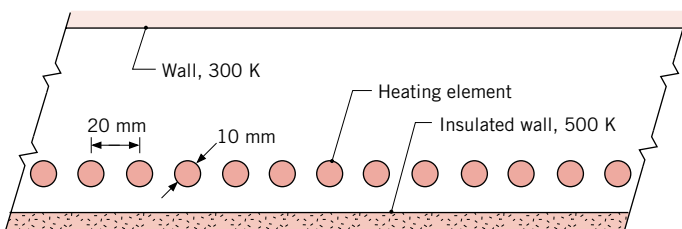


The insulated wall experiences convection with air at 450 K and a convection coefficient of  $200 \text{ W/m}^2 \cdot \text{K}$ . Assuming the walls and elements are black, estimate the required operating temperature for the elements.

**13.38** A manufacturing process calls for heating long copper rods, which are coated with a thin film having  $\varepsilon = 1$ , by placing them in a large evacuated oven whose surface is maintained at 1650 K. The rods are of 10-mm diameter and are placed in the oven with an initial temperature of 300 K.

- (a) What is the initial rate of change of the rod temperature?
- (b) How long must the rods remain in the oven to achieve a temperature of 1000 K?


- (c) The heating process may be accelerated by routing combustion gases, also at 1650 K, through the oven. For convection coefficients of 10, 100, and  $500 \text{ W/m}^2 \cdot \text{K}$ , determine the time required for the rods to reach 1000 K.

**13.39** Consider the very long, inclined black surfaces ( $A_1, A_2$ ) maintained at uniform temperatures of  $T_1 = 1000 \text{ K}$  and  $T_2 = 800 \text{ K}$ .



Determine the net radiation exchange between the surfaces per unit length of the surfaces. Consider the configuration when a black surface ( $A_3$ ), whose back side is insulated, is positioned along the dashed line shown. Calculate the net radiation transfer to surface  $A_2$  per unit length of the surface and determine the temperature of the insulated surface  $A_3$ .


**13.40** Many products are processed in a manner that requires a specified product temperature as a function of time. Consider a product in the shape of long, 10-mm-diameter cylinders that are conveyed slowly through a processing oven as shown in the schematic. The product exhibits near-black behavior and is attached to the conveying apparatus at the product's ends. The surroundings are at 300 K, while the radiation panel heaters are each isothermal at 500 K and have surfaces that exhibit near-black behavior. An engineer proposes a novel oven design with a tilting top surface so as to be able to quickly change the thermal response of the product.

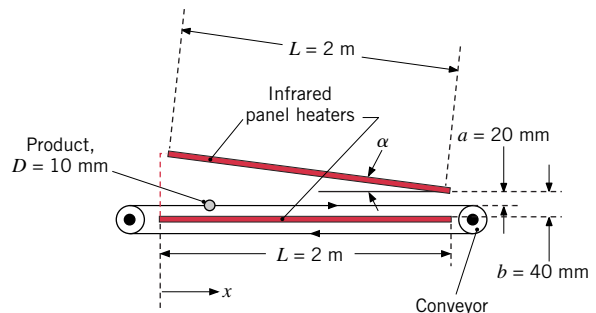

- Determine the radiation per unit length incident upon the product at  $x = 0.5$  m and  $x = 1$  m for  $\alpha = 0$ .
- Determine the radiation per unit length incident upon the product at  $x = 0.5$  m and  $x = 1$  m for  $\alpha = \pi/15$ . *Hint:* The view factor from the cylinder to the left-hand side surroundings can be found by summing the view factors from the cylinder to the two surfaces shown as red dashed lines in the schematic.

### Two-Surface Enclosures

- 13.41** Consider two very large parallel plates with diffuse, gray surfaces.

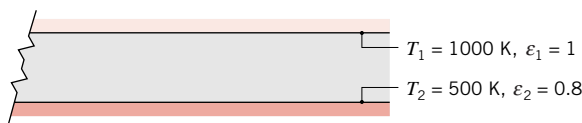


Determine the irradiation and radiosity for the upper plate. What is the radiosity for the lower plate? What is the net radiation exchange between the plates per unit area of the plates?

- 13.42** A flat-bottomed hole 6 mm in diameter is bored to a depth of 24 mm in a diffuse, gray material having an emissivity of 0.8 and a uniform temperature of 1000 K.

- Determine the radiant power leaving the opening of the cavity.
- The effective emissivity  $\epsilon_e$  of a cavity is defined as the ratio of the radiant power leaving the cavity to that from a blackbody having the area of the cavity opening and a temperature of the inner surfaces of the cavity. Calculate the effective emissivity of the cavity described above.
- If the depth of the hole were increased, would  $\epsilon_e$  increase or decrease? What is the limit of  $\epsilon_e$  as the depth increases?

- 13.43** Consider a long V groove 10 mm deep machined on a block that is maintained at 1000 K.

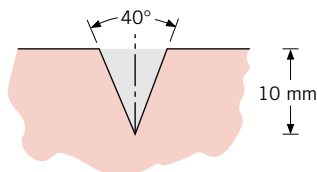


If the groove surfaces are diffuse and gray with an emissivity of 0.6, determine the radiant flux leaving the groove to its surroundings. Also determine the

effective emissivity of the cavity, as defined in Problem 13.42.


- 13.44** In Problems 12.19 and 12.20, we estimated the earth's surface temperature, assuming the earth is black. Most of the earth's surface is water, which has a hemispherical emissivity of  $\epsilon = 0.96$ . In reality, the water surface is not flat but has waves and ripples.

- Assuming the wave geometry can be closely approximated as two-dimensional and as shown in the schematic, determine the effective emissivity of the water surface, as defined in Problem 13.42, for  $\alpha = 3\pi/4$ .

- Calculate and plot the effective emissivity of the water surface, normalized by the hemispherical emissivity of water ( $\epsilon_{\text{eff}}/\epsilon$ ) over the range  $\pi/2 \leq \alpha \leq \pi$ .

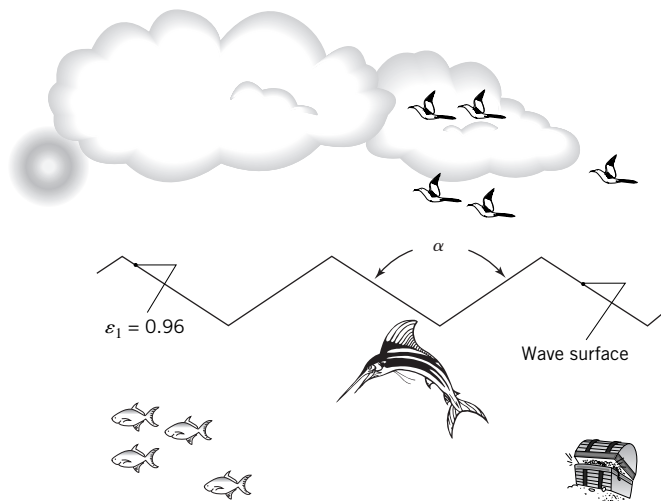

- 13.45** Consider the cavities formed by a cone, cylinder, and sphere having the same opening size ( $d$ ) and major dimension ( $L$ ), as shown in the diagram.

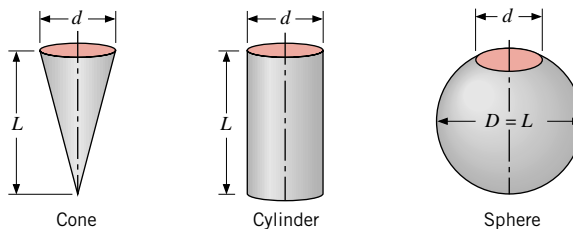

- Find the view factor between the inner surface of each cavity and the opening of the cavity.
- Find the effective emissivity of each cavity,  $\epsilon_e$ , as defined in Problem 13.42, assuming the

inner walls are diffuse and gray with an emissivity of  $\varepsilon_w$ .

- (c) For each cavity and wall emissivities of  $\varepsilon_w = 0.5, 0.7$ , and  $0.9$ , plot  $\varepsilon_e$  as a function of the major dimension-to-opening size ratio,  $L/d$ , over a range from 1 to 10.

**13.46** A  $t = 5$  mm thick sheet of anodized aluminum is used to reject heat in a space power application. The edge of the sheet is attached to a hot source, and the sheet is maintained at nearly isothermal conditions at  $T = 300$  K. The sheet is not subjected to irradiation.

- Determine the net radiation heat transfer from both sides of the  $200 \text{ mm} \times 200 \text{ mm}$  sheet to deep space.
- An engineer suggests boring 3-mm-diameter holes through the sheet. The holes are spaced 5 mm apart. The interior surfaces of the holes are anodized after they are bored. Determine the net radiation heat transfer from both sides of the sheet to deep space.
- As an alternative design, the 3-mm-diameter flat-bottomed holes are not bored completely through the sheet but are bored to depths of 2 mm on each side, leaving a 1-mm-thick web of aluminum separating the bottoms of the holes located on opposite sides of the sheet. Determine the net radiation heat transfer from both sides of the sheet to deep space.
- Compare the ratio of the net radiation heat transfer to the mass of the sheet for the three designs.

**13.47** Consider the spacecraft heat rejection scheme of Problem 13.27, but under conditions for which surfaces 1 and 2 may not be approximated as blackbodies.

- For isothermal surfaces of temperature  $T = 325$  K and emissivity  $\varepsilon = 0.7$  and a U-section of width  $W = 25$  mm and length  $L = 125$  mm, determine the rate per unit length (normal to the page) at which radiation is transferred from a section to deep space.
- Explore the effect of the emissivity on the rate of heat rejection, and contrast your results with those for emission exclusively from the base of the section.


**13.48** An electronic device dissipating 50 W is attached to the inner surface of an isothermal cubical container that is 120 mm on a side. The container is located in the much larger service bay of the space shuttle, which is evacuated and whose walls are at 150 K. If the outer surface of the container has an emissivity of 0.8 and the thermal resistance between the surface and

the device is 0.1 K/W, what are the temperatures of the surface and the device? All surfaces of the container may be assumed to exchange radiation with the service bay, and heat transfer through the container restraint may be neglected.

**13.49** A long, thin-walled horizontal tube 100 mm in diameter is maintained at  $120^\circ\text{C}$  by the passage of steam through its interior. A radiation shield is installed around the tube, providing an air gap of 10 mm between the tube and the shield, and reaches a surface temperature of  $35^\circ\text{C}$ . The tube and shield are diffuse, gray surfaces with emissivities of 0.80 and 0.10, respectively. What is the radiant heat transfer from the tube per unit length?

**13.50** A very long electrical conductor 10 mm in diameter is concentric with a cooled cylindrical tube 50 mm in diameter whose surface is diffuse and gray with an emissivity of 0.9 and temperature of  $27^\circ\text{C}$ . The electrical conductor has a diffuse, gray surface with an emissivity of 0.6 and is dissipating 6.0 W per meter of length. Assuming that the space between the two surfaces is evacuated, calculate the surface temperature of the conductor.

**13.51** An arrangement for direct conversion of thermal energy to electrical power is shown. The inner cylinder of diameter  $D_i = 25$  mm is heated internally by a combustion process that brings the ceramic cylinder ( $\varepsilon_i = 0.9$ ) to a surface temperature of  $T_i = 1675^\circ\text{C}$ . The outer cylinder of diameter  $D_o = 0.38$  m consists of a semiconductor material ( $\varepsilon_o = 0.5$ ) that converts absorbed incident irradiation to electrical current; the backing material for the semiconductor is a highly conducting metal that is water cooled to  $20^\circ\text{C}$ . The converter is assumed to be very long compared to the outer diameter. The space between the two concentric cylinders is evacuated.

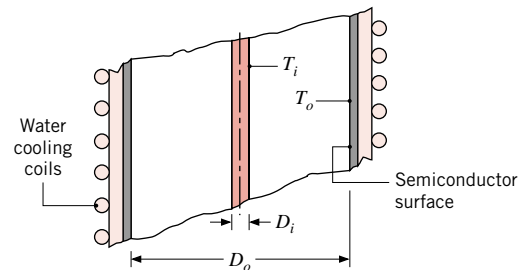

Assuming diffuse, gray surfaces, determine the heat transfer rate per unit area of the outer cylinder. The electrical output of the semiconductor surface is 10% of the absorbed irradiation in the wavelength region  $0.6$  to  $2.0 \mu\text{m}$ . For the prescribed conditions,



determine the power generation in watts per unit of outer surface area.

- 13.52** Liquid oxygen is stored in a thin-walled, spherical container 0.8 m in diameter, which is enclosed within a second thin-walled, spherical container 1.2 m in diameter. The opaque, diffuse, gray container surfaces have an emissivity of 0.05 and are separated by an evacuated space. If the outer surface is at 280 K and the inner surface is at 95 K, what is the mass rate of oxygen lost due to evaporation? (The latent heat of vaporization of oxygen is  $2.13 \times 10^5$  J/kg.)

- 13.53** Two concentric spheres of diameter  $D_1 = 0.8$  m and  $D_2 = 1.2$  m are separated by an air space and have surface temperatures of  $T_1 = 400$  K and  $T_2 = 300$  K.

- If the surfaces are black, what is the net rate of radiation exchange between the spheres?
- What is the net rate of radiation exchange between the surfaces if they are diffuse and gray with  $\varepsilon_1 = 0.5$  and  $\varepsilon_2 = 0.05$ ?
- What is the net rate of radiation exchange if  $D_2$  is increased to 20 m, with  $\varepsilon_2 = 0.05$ ,  $\varepsilon_1 = 0.5$ , and  $D_1 = 0.8$  m? What error would be introduced by assuming blackbody behavior for the outer surface ( $\varepsilon_2 = 1$ ), with all other conditions remaining the same?
- For  $D_2 = 1.2$  m and emissivities of  $\varepsilon_1 = 0.1, 0.5$ , and 1.0, compute and plot the net rate of radiation exchange as a function of  $\varepsilon_2$  for  $0.05 \leq \varepsilon_2 \leq 1.0$ .

- 13.54** Determine the steady-state temperatures of two radiation shields placed in the evacuated space between two infinite planes at temperatures of 600 and 325 K. All the surfaces are diffuse and gray with emissivities of 0.7.

- 13.55** Consider two large (infinite) parallel planes that are diffuse-gray with temperatures and emissivities of  $T_1, \varepsilon_1$  and  $T_2, \varepsilon_2$ . Show that the ratio of the radiation transfer rate with multiple shields,  $N$ , of emissivity  $\varepsilon_s$  to that with no shields,  $N = 0$ , is

$$\frac{q_{12,N}}{q_{12,0}} = \frac{[1/\varepsilon_1 + 1/\varepsilon_2 - 1]}{[1/\varepsilon_1 + 1/\varepsilon_2 - 1] + N[2/\varepsilon_s - 1]}$$


where  $q_{12,N}$  and  $q_{12,0}$  represent the radiation heat transfer rates for  $N$  shields and no shields, respectively.

- 13.56** Consider two large, diffuse, gray, parallel surfaces separated by a small distance. If the surface emissivities are 0.8, what emissivity should a thin radiation shield have to reduce the radiation heat transfer rate between the two surfaces by a factor of 10?

- 13.57** Heat transfer by radiation occurs between two large parallel plates, which are maintained at temperatures  $T_1$  and  $T_2$ , with  $T_1 > T_2$ . To reduce the rate of heat transfer between the plates, it is proposed that they be separated by a thin shield that has different emissivities on opposite surfaces. In particular, one surface has the emissivity  $\varepsilon_s < 0.5$ , while the opposite surface has an emissivity of  $2\varepsilon_s$ .


- How should the shield be oriented to provide the larger reduction in heat transfer between the plates? That is, should the surface of emissivity  $\varepsilon_s$  or that of emissivity  $2\varepsilon_s$  be oriented toward the plate at  $T_1$ ?
- What orientation will result in the larger value of the shield temperature  $T_s$ ?

- 13.58** The end of a cylindrical liquid cryogenic propellant tank in free space is to be protected from external (solar) radiation by placing a thin metallic shield in front of the tank. Assume the view factor  $F_{ts}$  between the tank and the shield is unity; all surfaces are diffuse and gray, and the surroundings are at 0 K.

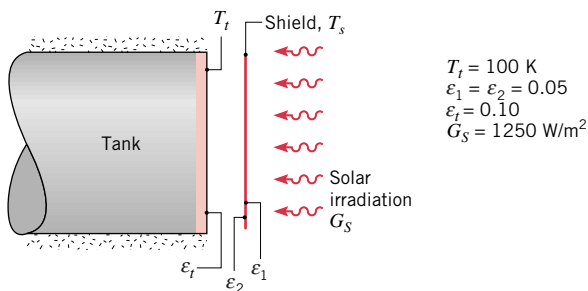


Find the temperature of the shield  $T_s$  and the heat flux ( $\text{W/m}^2$ ) to the end of the tank.

- 13.59** At the bottom of a very large vacuum chamber whose walls are at 300 K, a black panel 0.1 m in diameter is maintained at 77 K. To reduce the heat gain to this panel, a radiation shield of the same diameter  $D$  and an emissivity of 0.05 is placed very close to the panel. Calculate the net heat gain to the panel.



- 13.60** A furnace is located next to a dense array of cryogenic fluid piping. The ice-covered piping approximates a


plane surface with an average temperature of  $T_p = 0^\circ\text{C}$  and an emissivity of  $\varepsilon_p = 0.6$ . The furnace wall has a temperature of  $T_f = 200^\circ\text{C}$  and an emissivity of  $\varepsilon_f = 0.9$ . To protect the refrigeration equipment and piping from excessive heat loading, reflective aluminum radiation shielding with an emissivity of  $\varepsilon_s = 0.1$  is placed between the piping and the furnace wall, as shown in the schematic. Assume all surfaces are diffuse-gray.

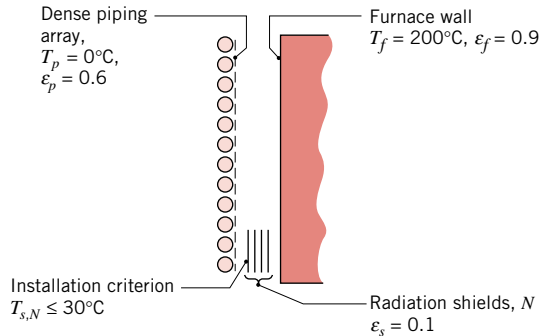

If the temperature of the shield closest to the piping  $T_{s,N}$  must be less than  $30^\circ\text{C}$ , how many radiation shields,  $N$ , must be installed between the piping and the furnace wall?

- 13.61** A cryogenic fluid flows through a tube 20 mm in diameter, the outer surface of which is diffuse and gray with an emissivity of 0.02 and temperature of 77 K. This tube is concentric with a larger tube of 50-mm diameter, the inner surface of which is diffuse and gray with an emissivity of 0.05 and temperature of 300 K. The space between the surfaces is evacuated. Determine the heat gain by the cryogenic fluid per unit length of the inner tube. If a thin-walled radiation shield that is diffuse and gray with an emissivity of 0.02 (both sides) is inserted midway between the inner and outer surfaces, calculate the change (percentage) in heat gain per unit length of the inner tube.


- 13.62** A diffuse, gray radiation shield of 60-mm diameter and emissivities of  $\varepsilon_{2,i} = 0.01$  and  $\varepsilon_{2,o} = 0.1$  on the inner and outer surfaces, respectively, is concentric with a long tube transporting a hot process fluid. The tube surface is black with a diameter of 20 mm. The

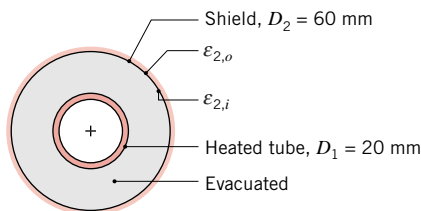

region interior to the shield is evacuated. The exterior surface of the shield is exposed to a large room whose walls are at  $17^\circ\text{C}$  and experiences convection with air at  $27^\circ\text{C}$  and a convection heat transfer coefficient of  $10 \text{ W/m}^2 \cdot \text{K}$ . Determine the operating temperature for the inner tube if the shield temperature is maintained at  $42^\circ\text{C}$ .


## Enclosures with a Reradiating Surface

- 13.63** Consider the three-surface enclosure shown. The lower plate ( $A_1$ ) is a black disk of 200-mm diameter and is supplied with a heat rate of 10,000 W. The upper plate ( $A_2$ ), a disk coaxial to  $A_1$ , is a diffuse, gray surface with  $\varepsilon_2 = 0.8$  and is maintained at  $T_2 = 473 \text{ K}$ . The diffuse, gray sides between the plates are perfectly insulated. Assume convection heat transfer is negligible.

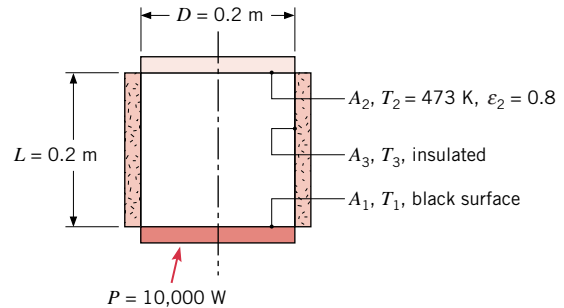

Determine the operating temperature of the lower plate  $T_1$  and the temperature of the insulated side  $T_3$ .

- 13.64** A furnace has the form of a truncated conical section, as shown in the schematic. The floor of the furnace has an emissivity of  $\varepsilon_1 = 0.7$  and is maintained at 1000 K with a heat flux of  $2200 \text{ W/m}^2$ . The lateral wall is perfectly insulated with an emissivity of  $\varepsilon_3 = 0.3$ . Assume that all the surfaces are diffuse-gray.

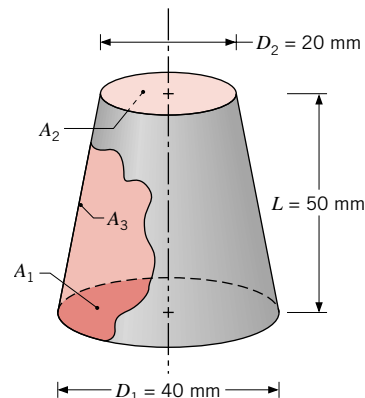




- (a) Determine the temperature of the upper surface,  $T_2$  if its emissivity is  $\varepsilon_2 = 0.5$ . What is the temperature of the lateral wall,  $T_3$ ?
- (b) If conditions for the furnace floor remain unchanged, but all surfaces are black instead of diffuse-gray, determine  $T_2$  and  $T_3$ . From the diffuse and blackbody enclosure analyses, what can you say about the influence of  $\varepsilon_2$  on your results?

**13.65** Consider two aligned, parallel, square planes ( $0.4 \text{ m} \times 0.4 \text{ m}$ ) spaced  $0.8 \text{ m}$  apart and maintained at  $T_1 = 500 \text{ K}$  and  $T_2 = 800 \text{ K}$ . Calculate the net radiative heat transfer *from surface 1* for the following special conditions:

- (a) Both planes are black and the surroundings are at  $0 \text{ K}$ .
- (b) Both planes are black with connecting, reradiating walls.
- (c) Both planes are diffuse and gray with  $\varepsilon_1 = 0.6$ ,  $\varepsilon_2 = 0.8$ , and the surroundings at  $0 \text{ K}$ .
- (d) Both planes are diffuse and gray ( $\varepsilon_1 = 0.6$  and  $\varepsilon_2 = 0.8$ ) with connecting, reradiating walls.

**13.66** Two parallel, aligned disks,  $0.4 \text{ m}$  in diameter and separated by  $0.1 \text{ m}$ , are located in a large room whose walls are maintained at  $300 \text{ K}$ . One of the disks is maintained at a uniform temperature of  $500 \text{ K}$  with an emissivity of  $0.6$ , while the backside of the second disk is well insulated. If the disks are diffuse, gray surfaces, determine the temperature of the insulated disk.


**13.67** Coatings applied to long metallic strips are cured by installing the strips along the walls of a long oven of square cross section.

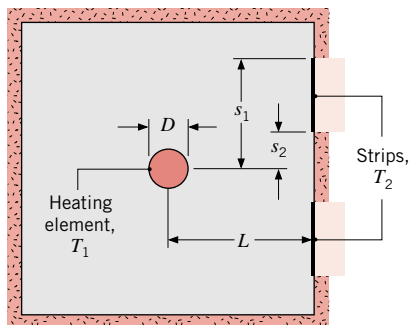

Thermal conditions in the oven are maintained by a long silicon carbide rod (heating element), which is of diameter  $D = 20 \text{ mm}$  and is operated at  $T_1 = 1700 \text{ K}$ . Each of two strips on one side wall has the same orientation relative to the rod ( $s_1 = 60 \text{ mm}$ ,  $s_2 = 20 \text{ mm}$ ,  $L = 80 \text{ mm}$ ) and is operated at  $T_2 = 600 \text{ K}$ . All surfaces are


diffuse and gray with  $\varepsilon_1 = 0.9$  and  $\varepsilon_2 = 0.4$ . Assuming the oven to be well insulated at all but the strip surfaces and neglecting convection effects, determine the heater power requirement per unit length ( $\text{W/m}$ ).

**13.68** A molten aluminum alloy at  $900 \text{ K}$  is poured into a cylindrical container that is well insulated from large surroundings at  $300 \text{ K}$ . The inner diameter of the container is  $250 \text{ mm}$ , and the distance from the surface of the melt to the top of the container is  $100 \text{ mm}$ .

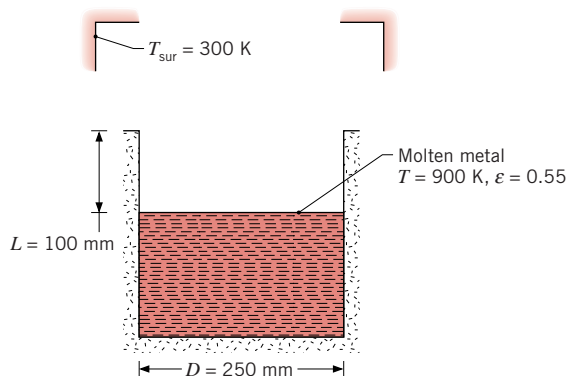

If the oxidized aluminum at the surface of the melt has an emissivity of  $0.55$ , what is the net rate of radiation heat transfer from the melt?


**13.69** The proposed design for a blackbody simulator consists of a diffuse, gray, circular plate with an emissivity of  $0.9$  maintained at  $T_p = 600 \text{ K}$  and mounted over a well-insulated hemispherical cavity of radius  $r_o = 100 \text{ mm}$ . The opening in the circular plate is  $r_o/2$ .



- (a) Calculate the radiant power leaving the opening when the surroundings are at  $300 \text{ K}$ .
- (b) Calculate the effective emissivity of the cavity,  $\varepsilon_c$ , which is defined as the ratio of the radiant power leaving the cavity to the rate at which the heated circular plate would emit radiation if it were black.
- (c) Determine the surface temperature of the hemispherical cavity,  $T_{hc}$ .
- (d) For plate emissivities of  $\varepsilon_p = 0.5, 0.7$ , and  $0.9$ , plot  $\varepsilon_c$  and  $T_{hc}$  as a function of the opening in


the circular plate over a range from  $r_o/8$  to  $r_o/2$ . All other conditions remain the same.

- 13.70** A long, hemicylindrical (1-m radius) shaped furnace used to heat treat sheet metal products is comprised of three zones. The heating zone (1) is constructed from a ceramic plate of emissivity 0.85 and is operated at 1600 K by gas burners. The load zone (2) consists of sheet metal products, assumed to be black surfaces, that are to be maintained at 500 K. The refractory zone (3) is fabricated from insulating bricks having an emissivity of 0.6. Assume steady-state conditions, diffuse, gray surfaces, and negligible convection.

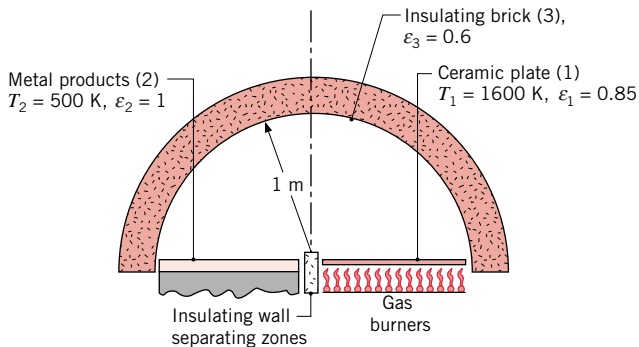

- (a) What is the heat rate per unit length of the furnace (normal to the page) that must be supplied by the gas burners for the prescribed conditions?
- (b) What is the temperature of the insulating brick surface for the prescribed conditions?


- 13.71** The bottom of a steam-producing still of 200-mm diameter is heated by radiation. The heater, maintained at 1000°C and separated 100 mm from the still, has the same diameter as the still bottom. The still bottom and heater surfaces are black.

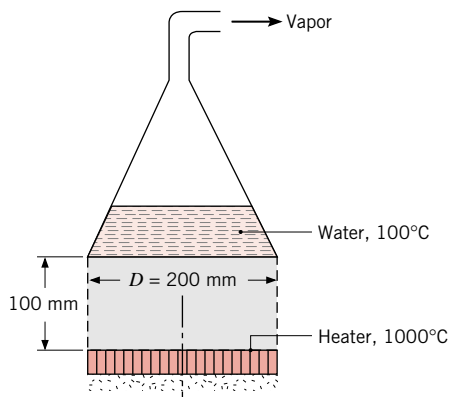

- (a) By what factor could the vapor production rate be increased if the cylindrical sides (dashed surface) were insulated rather than open to the surroundings maintained at 27°C?


- (b) For heater temperatures of 600, 800, and 1000°C, plot the net rate of radiation heat transfer to the still as a function of the separation distance over the range from 25 to 100 mm. Consider the cylindrical sides to be insulated and all other conditions to remain the same.

- 13.72** A long cylindrical heater element of diameter  $D = 10$  mm, temperature  $T_1 = 1500$  K, and emissivity  $\varepsilon_1 = 1$  is used in a furnace. The bottom area  $A_2$  is a diffuse, gray surface with  $\varepsilon_2 = 0.6$  and is maintained at  $T_2 = 500$  K. The side and top walls are fabricated from an insulating, refractory brick that is diffuse and gray with  $\varepsilon = 0.9$ . The length of the furnace normal to the page is very large compared to the width  $w$  and height  $h$ .

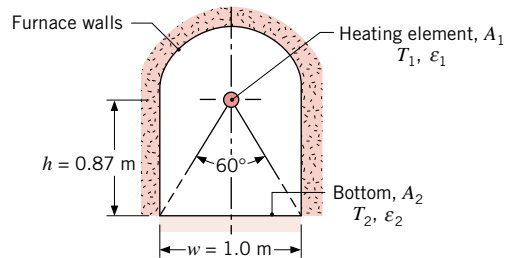


Neglecting convection and treating the furnace walls as isothermal, determine the power per unit length that must be provided to the heating element to maintain steady-state conditions. Calculate the temperature of the furnace wall.

- 13.73** A radiative heater consists of a bank of ceramic tubes with internal heating elements. The tubes are of diameter  $D = 20$  mm and are separated by a distance  $s = 50$  mm. A reradiating surface is positioned behind the heating tubes as shown in the schematic. Determine the net radiative heat flux to the heated material when the heating tubes ( $\varepsilon_h = 0.87$ ) are maintained at 1000 K. The heated material ( $\varepsilon_m = 0.26$ ) is at a temperature of 500 K.

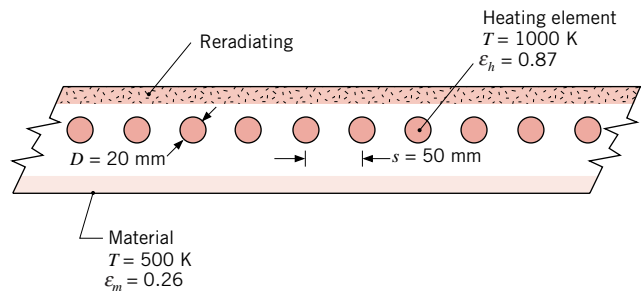


- 13.74** Consider a long duct constructed with diffuse, gray walls 1 m wide.

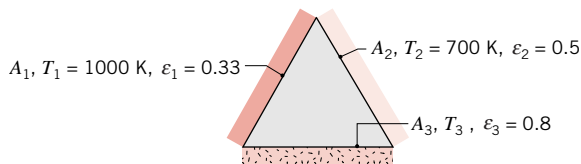

- Determine the net radiation transfer from surface  $A_1$  per unit length of the duct.
- Determine the temperature of the insulated surface  $A_3$ .
- What effect would changing the value of  $\epsilon_3$  have on your result? After considering your assumptions, comment on whether you expect your results to be exact.

- 13.75** The coating on a 1 m by 2 m metallic surface is cured by placing it 0.5 m below an electrically heated surface of equivalent dimensions, and the assembly is exposed to large surroundings at 300 K. The heater is well insulated on its top side and is aligned with the coated surface. Both the heater and coated surfaces are approximated as blackbodies. During the curing procedure, the heater and coated surfaces are maintained at 700 and 400 K, respectively. Convection effects may be neglected.

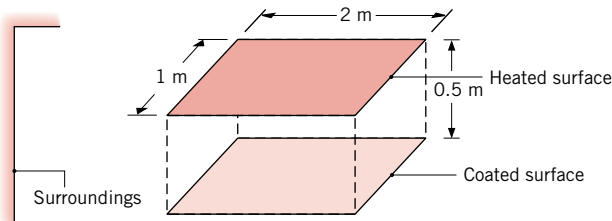


- What is the electric power,  $q_{\text{elec}}$ , required to operate the heater?
- What is  $q_{\text{elec}}$  if the surfaces are connected with reradiating sidewalls?
- The facility may be used to cure different surface coatings. With the heater still approximated as a blackbody, compute and plot  $q_{\text{elec}}$  as a function of the coating's emissivity for values ranging from 0.1 to 1.0. Perform the calculations for both open and reradiating sides.

- 13.76** A cubical furnace 2 m on a side is used for heat treating steel plate. The top surface of the furnace consists of electrical radiant heaters that have an emissivity of 0.8 and a power input of  $1.5 \times 10^5$  W. The sidewalls


consist of a well-insulated refractory material, while the bottom consists of the steel plate, which has an emissivity of 0.4. Assume diffuse, gray surface behavior for the heater and the plate, and consider conditions for which the plate is at 300 K. What are the corresponding temperatures of the heater surface and the sidewalls?

- 13.77** An electric furnace consisting of two heater sections, top and bottom, is used to heat treat a coating that is applied to both surfaces of a thin metal plate inserted midway between the heaters.

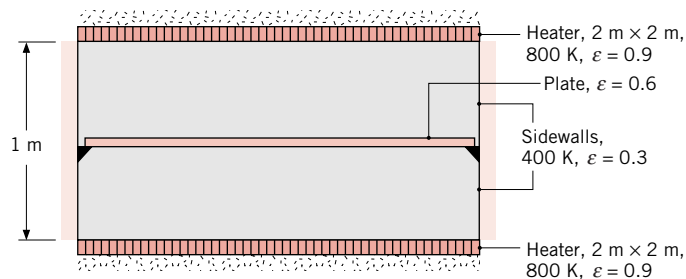


The heaters and the plate are 2 m by 2 m on a side, and each heater is separated from the plate by a distance of 0.5 m. Each heater is well insulated on its back side and has an emissivity of 0.9 at its exposed surface. The plate and the sidewalls have emissivities of 0.6 and 0.3, respectively. Sketch the equivalent radiation network for the system and label all pertinent resistances and potentials. For the prescribed conditions, obtain the required electrical power and the plate temperature.

- 13.78** A solar collector consists of a long duct through which air is blown; its cross section forms an equilateral triangle 1 m on a side. One side consists of a glass cover of emissivity  $\epsilon_1 = 0.9$ , while the other two sides are absorber plates with  $\epsilon_2 = \epsilon_3 = 1.0$ .

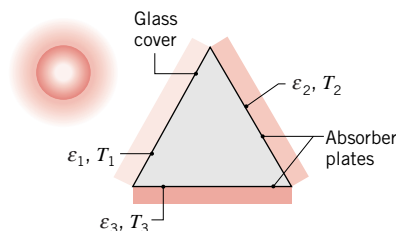


During operation the surface temperatures are known to be  $T_1 = 25^\circ\text{C}$ ,  $T_2 = 60^\circ\text{C}$ , and  $T_3 = 70^\circ\text{C}$ . What is the net rate at which radiation is transferred to the cover due to exchange with the absorber plates?

- 13.79** The cylindrical peephole in a furnace wall of thickness  $L = 250$  mm has a diameter of  $D = 125$  mm. The furnace interior has a temperature of 1300 K, and the surroundings outside the furnace have a temperature of 300 K.

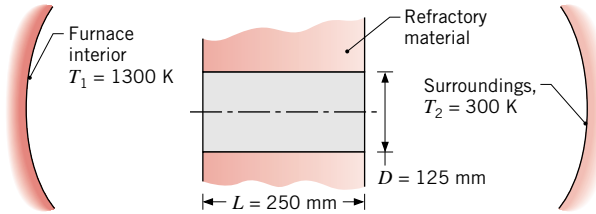


Determine the heat loss by radiation through the peephole.

- 13.80** A composite wall is comprised of two large plates separated by sheets of refractory insulation, as shown in the schematic. In the installation process, the sheets of thickness  $L = 50$  mm and thermal conductivity  $k = 0.05$  W/m · K are separated at 1-m intervals by gaps of width  $w = 10$  mm. The hot and cold plates have temperatures and emissivities of  $T_1 = 400^\circ\text{C}$ ,  $\varepsilon_1 = 0.85$  and  $T_2 = 35^\circ\text{C}$ ,  $\varepsilon_2 = 0.5$ , respectively. Assume that the plates and insulation are diffuse-gray surfaces.

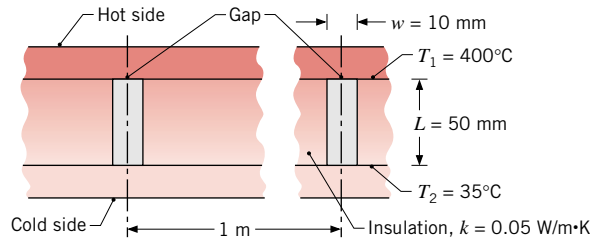

- Determine the heat loss by radiation through the gap per unit length of the composite wall (normal to the page).
  - Recognizing that the gaps are located on a 1-m spacing, determine what fraction of the total heat loss through the composite wall is due to transfer by radiation through the insulation gap.
- 13.81** A small disk of diameter  $D_1 = 50$  mm and emissivity  $\varepsilon_1 = 0.6$  is maintained at a temperature of  $T_1 = 900$  K. The disk is covered with a hemispherical radiation shield of the same diameter and an emissivity of  $\varepsilon_2 = 0.02$  (both sides). The disk and cap are located at the bottom of a large evacuated refractory container ( $\varepsilon_4 = 0.85$ ), facing another disk of diameter  $D_3 = D_1$ , emissivity  $\varepsilon_3 = 0.4$ , and temperature  $T_3 = 400$  K. The

view factor  $F_{23}$  of the shield with respect to the upper disk is 0.3.

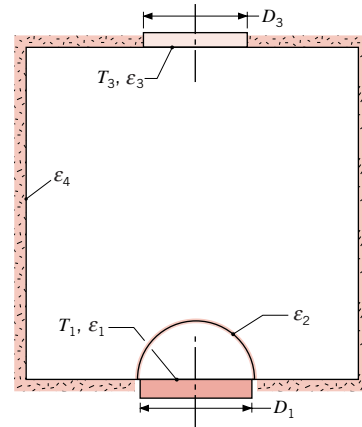

- Construct an equivalent thermal circuit for the above system. Label all nodes, resistances, and currents.
- Find the net rate of heat transfer between the hot disk and the rest of the system.

### Enclosures: Three or More Surfaces

- 13.82** Consider a cylindrical cavity of diameter  $D = 100$  mm and depth  $L = 50$  mm whose sidewall and bottom are diffuse and gray with an emissivity of 0.6 and are at a uniform temperature of 1500 K. The top of the cavity is open and exposed to surroundings that are large and at 300 K.


- Calculate the net radiation heat transfer from the cavity, treating the bottom and sidewall of the cavity as one surface ( $q_A$ ).
- Calculate the net radiation heat transfer from the cavity, treating the bottom and sidewall of the cavity as two separate surfaces ( $q_B$ ).
- Plot the percentage difference between  $q_A$  and  $q_B$  as a function of  $L$  over the range  $5 \text{ mm} \leq L \leq 100 \text{ mm}$ .

- 13.83** Consider a circular furnace that is 0.3 m long and 0.3 m in diameter. The two ends have diffuse, gray surfaces that are maintained at 400 and 500 K with emissivities of 0.4 and 0.5, respectively. The lateral surface is also diffuse and gray with an emissivity of 0.8 and a temperature of 800 K. Determine the net radiative heat transfer from each of the surfaces.


- 13.84** Consider two very large metal parallel plates. The top plate is at a temperature  $T_t = 400$  K while the bottom plate is at  $T_b = 300$  K. The desired net radiation heat flux between the two plates is  $q'' = 330$  W/m<sup>2</sup>.

- (a) If the two surfaces have the same radiative properties, show that the required surface emissivity is  $\varepsilon = 0.5$ .
- (b) Metal surfaces at relatively low temperatures tend to have emissivities much less than 0.5 (see Table A.11). An engineer proposes to apply a checker pattern, similar to that of Problem 12.129, onto each of the metal surfaces so that half of each surface is characterized by the low emissivity of the bare metal and the other half is covered with the high-emissivity paint. If the average of the high and low emissivities is 0.5, will the net radiative heat flux between the surfaces be the desired value?

**13.85** Consider the diffuse, gray, four-surface enclosure with all sides equal as shown. The temperatures of three surfaces are specified, while the fourth surface is well insulated and can be treated as a reradiating surface (4). Determine the temperature of the reradiating surface (4).

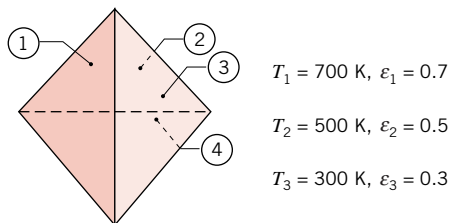


**13.86** A room is represented by the following enclosure, where the ceiling (1) has an emissivity of 0.8 and is maintained at  $40^\circ\text{C}$  by embedded electrical heating elements. Heaters are also used to maintain the floor (2) of emissivity 0.9 at  $50^\circ\text{C}$ . The right wall (3) of emissivity 0.7 reaches a temperature of  $15^\circ\text{C}$  on a cold winter day. The left wall (4) and end walls (5A) and (5B) are very well insulated. To simplify the analysis, treat the two end walls as a single surface (5).

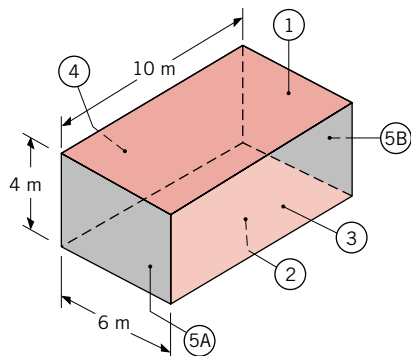

Assuming the surfaces are diffuse and gray, find the net radiation heat transfer from each surface.


**13.87** Work Problem 13.23, part (b), except with wall and cylinder emissivities of  $\varepsilon_w = 0.95$  and  $\varepsilon_c = 0.12$ , respectively.

**13.88** A cylindrical furnace for heat-treating materials in a spacecraft environment has a 90-mm diameter and an overall length of 180 mm. Heating elements in the 135-mm-long section (1) maintain a refractory lining of  $\varepsilon_1 = 0.8$  at  $800^\circ\text{C}$ . The linings for the bottom (2) and upper (3) sections are made of the same refractory material, but are insulated.

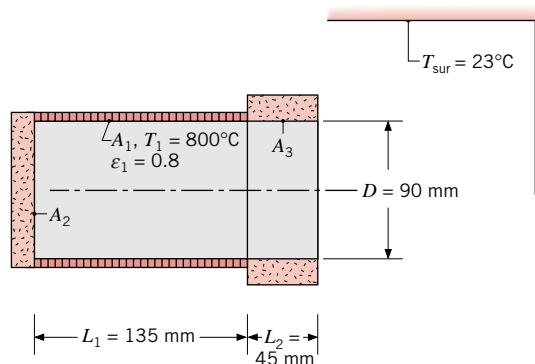

Determine the power required to maintain the furnace operating conditions with the surroundings at  $23^\circ\text{C}$ .

**13.89** In manufacturing semiconductors, rapid thermal processing (RTP) is used to rapidly heat a silicon wafer to an elevated temperature in order to induce effects such as ion diffusion, annealing, and oxidation. One type of RTP device consists of a cylindrical enclosure with a coaxially positioned wafer. The top side of the wafer

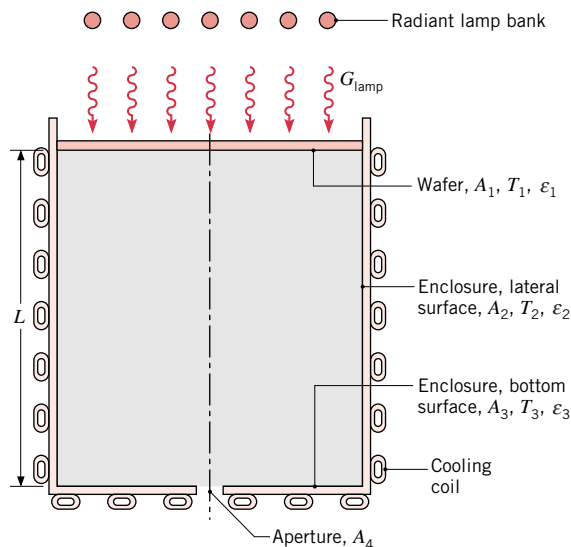


experiences uniform irradiation from a lamp bank,  $G_{\text{lamp}}$ . The enclosure lateral ( $A_2$ ) and bottom ( $A_3$ ) surfaces have a low emissivity  $\varepsilon_2 = \varepsilon_3 = 0.07$  and are maintained at 300 K by coolant passages. The wafer ( $A_1$ ) diameter is  $D = 300$  mm and the height of the enclosure is  $L = 300$  mm. The aperture ( $A_4$ ) diameter is  $D_a = 30$  mm and provides for optical access to the wafer.

(a) What lamp irradiation,  $G_{\text{lamp}}$ , is required to maintain the wafer at 1300 K if the wafer emissivity is  $\varepsilon_1 = 0.8$ ? What is the heat removal rate by the cooling coil? Assume there are no heat losses from the top side of the wafer.

(b) If the enclosure were perfectly reflecting, the radiosity of the wafer,  $J_1$ , would be equal to its blackbody emissive power,  $E_{b1}$ . As such, the radiosity would be independent of the wafer emissivity, thereby minimizing effects due to variation of that property from wafer-to-wafer. For wafer emissivities of  $\varepsilon_1 = 0.75, 0.8$ , and  $0.85$ , plot the fractional difference,  $(E_{b1} - J_1)/E_{b1}$ , as a function of the aspect ratio for  $0.5 \leq L/D \leq 2.5$ . How sensitive is this parameter to the enclosure surface emissivity,  $\varepsilon_2$ ?

**13.90** An observation cabin is located in a hot-strip mill directly over the line, as shown in the schematic. The cabin floor is exposed to a portion of the hot strip that is at a temperature of  $T_{ss} = 920^\circ\text{C}$  and has an emissivity of  $\varepsilon_{ss} = 0.85$ , as well as to *surroundings* within the mill (not shown) at a temperature of  $T_{\text{sur}} = 80^\circ\text{C}$ . To protect the operating personnel in the cabin, the floor must be maintained at  $T_f = 50^\circ\text{C}$ .

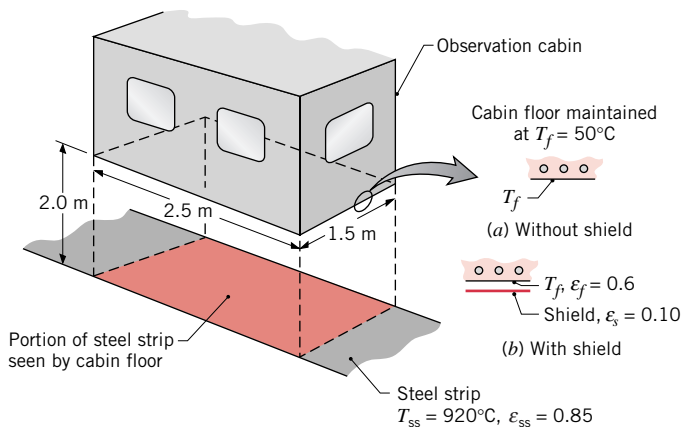


Determine the coolant system heat removal rate required to maintain the cabin floor at  $50^\circ\text{C}$  for the following conditions: (a) when the floor, with an emissivity of  $\varepsilon_f = 0.6$ , is directly exposed to the strip;

and (b) when a radiation shield of emissivity  $\varepsilon_s = 0.1$  is installed between the floor and the strip.

### Multimode Heat Transfer: Introductory

**13.91** An opaque, diffuse, gray (200 mm by 200 mm) plate with an emissivity of 0.8 is placed over the opening of a furnace and is known to be at 400 K at a certain instant. The bottom of the furnace, having the same dimensions as the plate, is black and operates at 1000 K. The side-walls of the furnace are well insulated. The top of the plate is exposed to ambient air with a convection coefficient of  $25 \text{ W/m}^2 \cdot \text{K}$  and to large surroundings. The air and surroundings are each at 300 K.

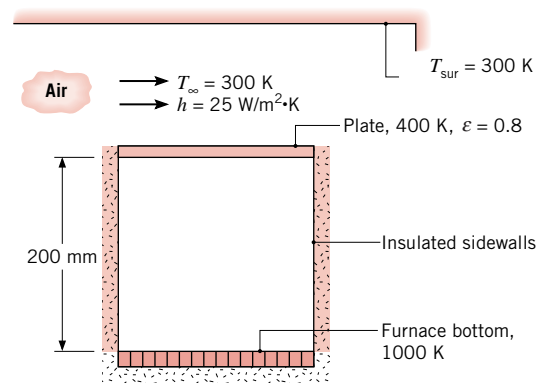

(a) Evaluate the net radiative heat transfer to the bottom surface of the plate.


(b) If the plate has mass and specific heat of 2 kg and  $900 \text{ J/kg} \cdot \text{K}$ , respectively, what will be the change in temperature of the plate with time,  $dT_p/dt$ ? Assume convection to the bottom surface of the plate to be negligible.

(c) Extending the analysis of part (b), generate a plot of the change in temperature of the plate with time,  $dT_p/dt$ , as a function of the plate temperature for  $350 \leq T_p \leq 900 \text{ K}$  and all other conditions remaining the same. What is the steady-state temperature of the plate?

**13.92** A tool for processing silicon wafers is housed within a vacuum chamber whose walls are black and maintained by a coolant at  $T_{vc} = 300 \text{ K}$ . The thin silicon wafer is mounted close to, but not touching, a chuck, which is electrically heated and maintained at the temperature  $T_c$ . The surface of the chuck facing the wafer is black. The wafer temperature is  $T_w = 700 \text{ K}$ , and its surface is diffuse and gray with an emissivity of  $\varepsilon_w = 0.6$ . The function of the grid, a thin metallic foil positioned coaxial with the wafer and of the same diameter, is to control the power of the ion beam reaching the




wafer. The grid surface is black with a temperature of  $T_g = 500$  K. The effect of the ion beam striking the wafer is to apply a uniform heat flux of  $q''_{ib} = 600$  W/m<sup>2</sup>. The top surface of the wafer is subjected to the flow of a process gas for which  $T_\infty = 500$  K and  $h = 10$  W/m<sup>2</sup> · K. Since the gap between the wafer and chuck,  $\delta$ , is very small, flow of the process gas in this region may be neglected.

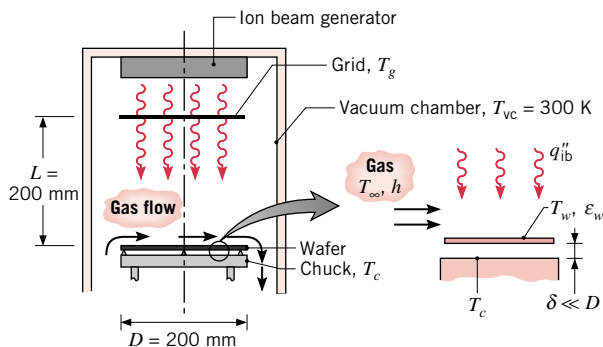

- Represent the wafer schematically, showing a control surface and all relevant thermal processes.
- Perform an energy balance on the wafer and determine the chuck temperature  $T_c$ .

**13.93** Most architects know that the ceiling of an ice-skating rink must have a high reflectivity. Otherwise, condensation may occur on the ceiling, and water may drip onto the ice, causing bumps on the skating surface. Condensation will occur on the ceiling when its surface temperature drops below the dew point of the rink air. Your assignment is to perform an analysis to determine the effect of the ceiling emissivity on the ceiling temperature, and hence the propensity for condensation.

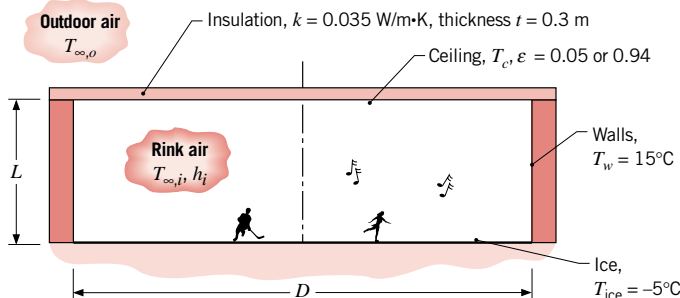


The rink has a diameter of  $D = 50$  m and a height of  $L = 10$  m, and the temperatures of the ice and walls are  $-5^\circ\text{C}$  and  $15^\circ\text{C}$ , respectively. The rink air temperature is  $15^\circ\text{C}$ , and a convection coefficient of  $5$  W/m<sup>2</sup> · K characterizes conditions on the ceiling surface. The thickness and thermal conductivity of the ceiling insu-

lation are  $0.3$  m and  $0.035$  W/m · K, respectively, and the temperature of the outdoor air is  $-5^\circ\text{C}$ . Assume that the ceiling is a diffuse-gray surface and that the walls and ice may be approximated as blackbodies.

- Consider a flat ceiling having an emissivity of  $0.05$  (highly reflective panels) or  $0.94$  (painted panels). Perform an energy balance on the ceiling to calculate the corresponding values of the ceiling temperature. If the relative humidity of the rink air is  $70\%$ , will condensation occur for either or both of the emissivities?
- For each of the emissivities, calculate and plot the ceiling temperature as a function of the insulation thickness for  $0.1 \leq t \leq 1$  m. Identify conditions for which condensation will occur on the ceiling.

**13.94** Boiler tubes exposed to the products of coal combustion in a power plant are subject to fouling by the ash (mineral) content of the combustion gas. The ash forms a solid deposit on the tube outer surface, which reduces heat transfer to a pressurized water/steam mixture flowing through the tubes. Consider a thin-walled boiler tube ( $D_i = 0.05$  m) whose surface is maintained at  $T_i = 600$  K by the boiling process. Combustion gases flowing over the tube at  $T_\infty = 1800$  K provide a convection coefficient of  $\bar{h} = 100$  W/m<sup>2</sup> · K, while radiation from the gas and boiler walls to the tube may be approximated as that originating from large surroundings at  $T_{\text{sur}} = 1500$  K.

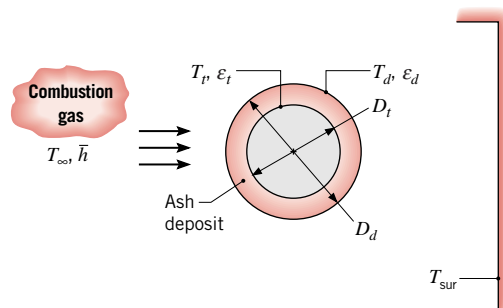

- If the tube surface is diffuse and gray, with  $\epsilon_i = 0.8$ , and there is no ash deposit layer, what is the rate of heat transfer per unit length,  $q'$ , to the boiler tube?
- If a deposit layer of diameter  $D_d = 0.06$  m and thermal conductivity  $k = 1$  W/m · K forms on the tube, what is the deposit surface temperature,  $T_d$ ? The deposit is diffuse and gray, with  $\epsilon_d = 0.9$ , and  $T_i$ ,  $T_\infty$ ,  $\bar{h}$ , and  $T_{\text{sur}}$  remain unchanged. What is the net rate of heat transfer per unit length,  $q'$ , to the boiler tube?


- (c) Explore the effect of variations in  $D_d$  and  $\bar{h}$  on  $q'$ , as well as on relative contributions of convection and radiation to the net heat transfer rate. Represent your results graphically.

**13.95** Consider two very large parallel plates. The bottom plate is warmer than the top plate, which is held at a constant temperature of  $T_1 = 330$  K. The plates are separated by  $L = 0.1$  m, and the gap between the two surfaces is filled with air at atmospheric pressure. The heat flux from the bottom plate is  $q'' = 250$  W/m<sup>2</sup>.

- (a) Determine the temperature of the bottom plate and the ratio of the convective to radiative heat fluxes for  $\varepsilon_1 = \varepsilon_2 = 0.5$ . Evaluate air properties at  $T = 350$  K.  
(b) Repeat part (a) for  $\varepsilon_1 = \varepsilon_2 = 0.25$  and  $0.75$ .

**13.96** Coated metallic disks are cured by placing them at the top of a cylindrical furnace whose bottom surface is electrically heated and whose sidewall may be approximated as a reradiating surface. Curing is accomplished by maintaining a disk at  $T_2 = 400$  K for an extended period. The electrically heated surface is maintained at  $T_1 = 800$  K and is mounted on a ceramic base material of thermal conductivity  $k = 20$  W/m·K. The bottom of the base material, as well as the ambient air and large surroundings above the disk, are maintained at a temperature of 300 K. Emissivities of the heater and the disk inner and outer surfaces are  $\varepsilon_1 = 0.9$ ,  $\varepsilon_{2,i} = 0.5$ , and  $\varepsilon_{2,o} = 0.9$ , respectively.


Assuming steady-state operation and neglecting convection within the cylindrical cavity, determine the electric power that must be supplied to the heater and the convection coefficient  $h$  that must be maintained at the outer surface of the disk in order to satisfy the prescribed conditions.

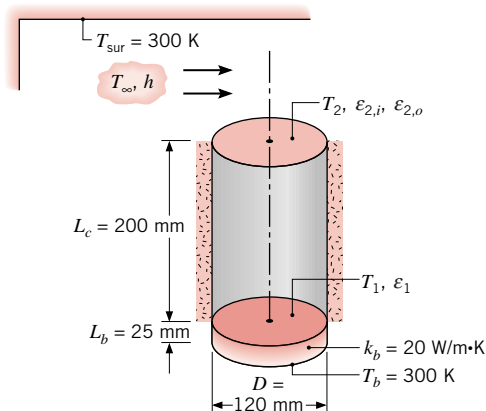

**13.97** Electrical conductors, in the form of parallel plates of length  $L = 40$  mm, have one edge mounted to a ceramic insulated base and are spaced a distance  $w = 10$  mm


apart. The plates are exposed to large isothermal surroundings at  $T_{\text{sur}} = 300$  K. The conductor (1) and ceramic (2) surfaces are diffuse and gray with emissivities of  $\varepsilon_1 = 0.8$  and  $\varepsilon_2 = 0.6$ , respectively. For a prescribed operating current in the conductors, their temperature is  $T_1 = 500$  K.

- (a) Determine the electrical power dissipated in a conductor plate per unit length,  $q'_1$ , considering only radiation exchange. What is the temperature of the insulated base,  $T_2$ ?  
(b) Determine  $q'_1$  and  $T_2$  when the surfaces experience convection with an airstream at 300 K and a convection coefficient of  $h = 25$  W/m<sup>2</sup>·K.

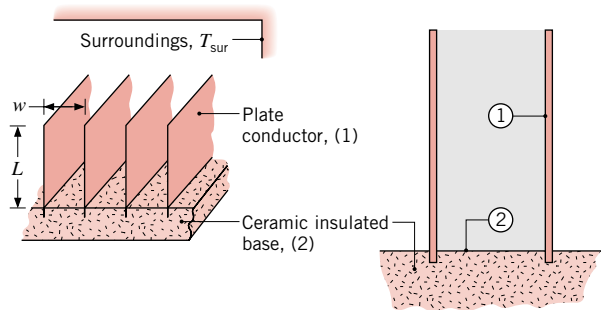

**13.98** The spectral absorptivity of a *large* diffuse surface is  $\alpha_\lambda = 0.9$  for  $\lambda < 1$  μm and  $\alpha_\lambda = 0.3$  for  $\lambda \geq 1$  μm. The bottom of the surface is well insulated, while the top may be exposed to one of two different conditions.

- (a) In case (a) the surface is exposed to the sun, which provides an irradiation of  $G_s = 1200$  W/m<sup>2</sup>, and to an airflow for which  $T_\infty = 300$  K. If the surface temperature is  $T_s = 320$  K, what is the convection coefficient associated with the airflow?

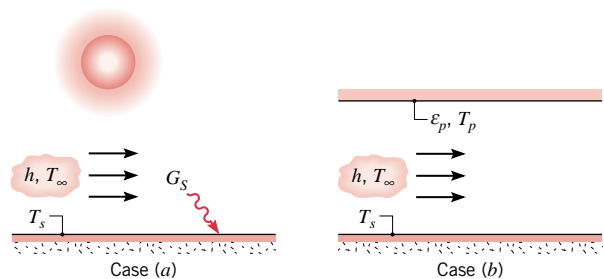


- (b) In case (b) the surface is shielded from the sun by a large plate and an airflow is maintained between the plate and the surface. The plate is diffuse and gray with an emissivity of  $\varepsilon_p = 0.8$ . If  $T_\infty = 300$  K and the convection coefficient is equivalent to the result obtained in part (a), what is the plate temperature  $T_p$  that is needed to maintain the surface at  $T_s = 320$  K?



**13.99** A long uniform rod of 50-mm diameter with a thermal conductivity of  $15 \text{ W/m} \cdot \text{K}$  is heated internally by volumetric energy generation of  $20 \text{ kW/m}^3$ . The rod is positioned coaxially within a larger circular tube of 60-mm diameter whose surface is maintained at  $500^\circ\text{C}$ . The annular region between the rod and the tube is evacuated, and their surfaces are diffuse and gray with an emissivity of 0.2.

- Determine the center and surface temperatures of the rod.
- Determine the center and surface temperatures of the rod if atmospheric air occupies the annular space.
- For tube diameter of 60, 100, and 1000 mm and for both the evacuated and atmospheric conditions, compute and plot the center and surface temperatures as a function of equivalent surface emissivities in the range from 0.1 to 1.0.


**13.100** The cross section of a long circular tube, which is divided into two semicylindrical ducts by a thin wall, is shown below.

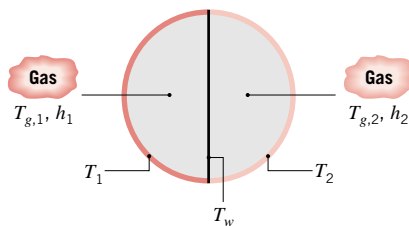

Sides 1 and 2 are maintained at temperatures of  $T_1 = 600 \text{ K}$  and  $T_2 = 400 \text{ K}$ , respectively, while the mean temperatures of gas flows through ducts 1 and 2 are  $T_{g,1} = 571 \text{ K}$  and  $T_{g,2} = 449 \text{ K}$ , respectively. The foregoing temperatures are invariant in the axial direction. The gases provide surface convection coefficients of  $h_1 = h_2 = 5 \text{ W/m}^2 \cdot \text{K}$ , while all duct surfaces may be approximated as blackbodies ( $\varepsilon_1 = \varepsilon_2 = \varepsilon_w = 1$ ). What is the duct wall temperature,  $T_w$ ? By performing an energy balance on the gas in side 1, verify that  $T_{g,1}$  is, in fact, equal to  $571 \text{ K}$ .

**13.101** A row of regularly spaced, cylindrical heating elements (1) is used to cure a surface coating that is applied to a large panel (2) positioned below the elements. A second large panel (3), whose top surface is well insulated, is positioned above the elements. The elements are black and maintained at  $T_1 = 600 \text{ K}$ , while the panel has an emissivity of  $\varepsilon_2 = 0.5$  and is maintained at  $T_2 = 400 \text{ K}$ . The cavity is filled with a nonparticipating gas and convection heat transfer


occurs at surfaces 1 and 2, with  $\bar{h}_1 = 10 \text{ W/m}^2 \cdot \text{K}$  and  $\bar{h}_2 = 2 \text{ W/m}^2 \cdot \text{K}$ . (Convection at the insulated panel may be neglected.)

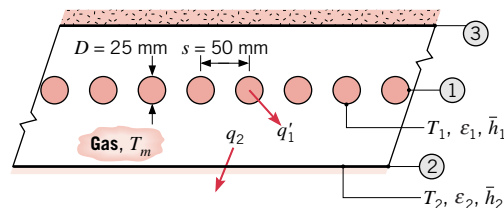

- Evaluate the mean gas temperature,  $T_m$ .
- What is the rate per unit axial length at which electrical energy must be supplied to each element to maintain its prescribed temperature?
- What is the rate of heat transfer to a portion of the coated panel that is 1 m wide by 1 m long?

**13.102** In recent years there has been considerable interest in developing flat-plate solar collectors for home heating needs. The typical collector configuration consists of an absorbing surface that is thermally insulated on the edges and on the back side. Solar radiation is transmitted through one or more glass cover plates before reaching the absorber. The collected energy is removed by circulating water through tubes that are in good thermal contact with the absorber.

Identify all the energy exchange processes that influence the performance of the collector. Suggest design features that would increase collection efficiency.

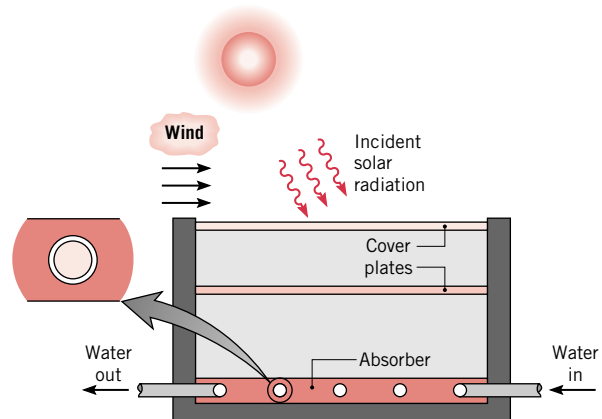


**13.103** Applying high-emissivity paints to radiating surfaces is a common technique used to enhance heat transfer by radiation.

- For large parallel plates, determine the radiation heat flux across the gap when the surfaces are at  $T_1 = 350 \text{ K}$ ,  $T_2 = 300 \text{ K}$ ,  $\varepsilon_1 = \varepsilon_2 = \varepsilon_s = 0.85$ .

- (b) Determine the radiation heat flux when a very thin layer of high-emissivity paint,  $\varepsilon_p = 0.98$ , is applied to both surfaces.
- (c) Determine the radiation heat flux when the paint layers are each  $L = 2$  mm thick and the thermal conductivity of the paint is  $k = 0.21$  W/m · K.
- (d) Plot the heat flux across the gap for the bare surface as a function of  $\varepsilon_s$ , with  $0.05 \leq \varepsilon_s \leq 0.95$ . Show on the same plot the heat flux for the painted surface with very thin paint layers and the painted surface with  $L = 2$ -mm thick paint layers.


### Multimode Heat Transfer: Advanced

- 13.104** Options for thermally shielding the top ceiling of a large furnace include the use of an insulating material of thickness  $L$  and thermal conductivity  $k$ , case (a), or an air space of equivalent thickness formed by installing a steel sheet above the ceiling, case (b).

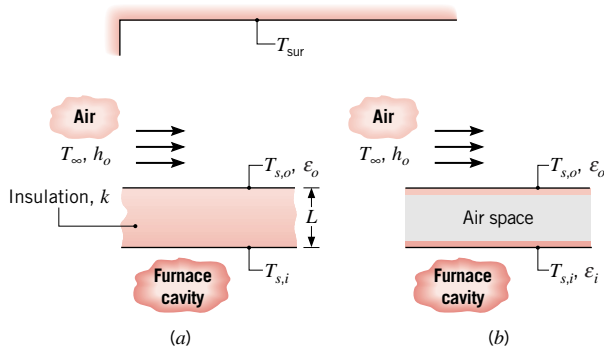


- (a) Develop mathematical models that could be used to assess which of the two approaches is better. In both cases the interior surface is maintained at the same temperature,  $T_{s,i}$ , and the ambient air and surroundings are at equivalent temperatures ( $T_{\infty} = T_{sur}$ ).
- (b) If  $k = 0.090$  W/m · K,  $L = 25$  mm,  $h_o = 25$  W/m<sup>2</sup> · K, the surfaces are diffuse and gray with  $\varepsilon_i = \varepsilon_o = 0.50$ ,  $T_{s,i} = 900$  K, and  $T_{\infty} = T_{sur} = 300$  K, what is the outer surface temperature  $T_{s,o}$  and the heat loss per unit surface area associated with each option?
- (c) For each case, assess the effect of surface radiative properties on the outer surface temperature and the heat loss per unit area for values of  $\varepsilon_i = \varepsilon_o$  ranging from 0.1 to 0.9. Plot your results.

- 13.105** The composite insulation shown, which was described in Chapter 1 (Problem 1.72e), is being considered as a ceiling material.

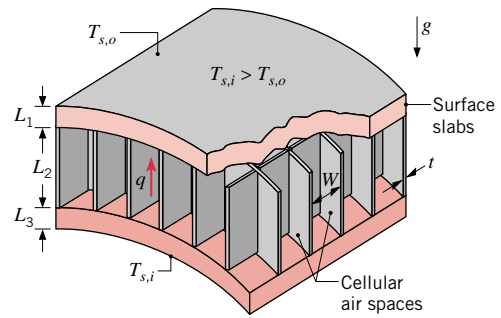

It is proposed that the outer and inner slabs be made from low-density particle board of thicknesses  $L_1 = L_3 = 12.5$  mm and that the honeycomb core be constructed from a high-density particle board. The square cells of the core are to have length  $L_2 = 50$  mm, width  $W = 10$  mm, and wall thickness  $t = 2$  mm. The emissivity of both particle boards is approximately 0.85, and the honeycomb cells are filled with air at 1-atm pressure. To assess the effectiveness of the insulation, its total thermal resistance must be evaluated under representative operating conditions for which the bottom (inner) surface temperature is  $T_{s,i} = 25^\circ\text{C}$  and the top (outer) surface temperature is  $T_{s,o} = -10^\circ\text{C}$ . To assess the effect of free convection in the air space, assume a cell temperature difference of  $20^\circ\text{C}$  and evaluate air properties at  $7.5^\circ\text{C}$ . To assess the effect of radiation across the air space, assume inner surface temperatures of the outer and inner slabs to be  $-5$  and  $15^\circ\text{C}$ , respectively.

- 13.106** Hot coffee is contained in a cylindrical thermos bottle that is of length  $L = 0.3$  m and is lying on its side (horizontally).

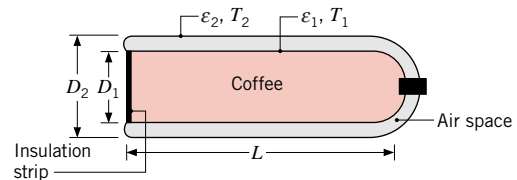

The coffee container consists of a glass flask of diameter  $D_1 = 0.07$  m, separated from an aluminum housing of diameter  $D_2 = 0.08$  m by air at atmospheric pressure. The outer surface of the flask and the inner surface of the housing are silver coated to provide emissivities of  $\varepsilon_1 = \varepsilon_2 = 0.25$ . If these surface temperatures are  $T_1 = 75^\circ\text{C}$  and  $T_2 = 35^\circ\text{C}$ , what is the heat loss from the coffee?

**13.107** A vertical air space in the wall of a home is 0.1 m thick and 3 m high. The air separates a brick exterior from a plaster board wall, with each surface having an emissivity of 0.9. Consider conditions for which the temperatures of the brick and plaster surfaces exposed to the air are  $-10$  and  $18^\circ\text{C}$ , respectively. What is the rate of heat loss per unit surface area? What would be the heat loss per unit area if the space were filled with urethane foam?


**13.108** Consider a vertical, double-pane window for the conditions prescribed in Problem 9.96. That is, vertical panes at temperatures of  $T_1 = 22^\circ$  and  $T_2 = -20^\circ\text{C}$  are separated by atmospheric air, and the critical Rayleigh number for the onset of convection is  $Ra_{L,c} = 2000$ .

- What is the conduction heat flux across the air gap for the optimal spacing  $L_{op}$  between the panes?
- If the glass has an emissivity of  $\varepsilon_g = 0.90$ , what is the total heat flux across the gap?
- What is the total heat flux if a special, low-emissivity coating ( $\varepsilon_c = 0.10$ ) is applied to one of the panes at its air–glass interface? What is the total heat flux if both panes are coated?


**13.109** Consider the double-pane window of Problem 9.97, for which  $1\text{ m} \times 1\text{ m}$  panes are separated by a 25-mm gap of atmospheric air. The window panes are approximately isothermal and separate quiescent room air at  $T_{\infty,i} = 20^\circ\text{C}$  from quiescent ambient air at  $T_{\infty,o} = -20^\circ\text{C}$ .

- For glass panes of emissivity  $\varepsilon_g = 0.90$ , determine the temperature of each pane and the rate of heat transfer through the window.
- Quantify the improvements in energy conservation that may be effected if the space between the panes is evacuated and/or a low emissivity coating ( $\varepsilon_c = 0.1$ ) is applied to the surface of each pane adjoining the gap.

**13.110** A flat-plate solar collector, consisting of an absorber plate and single cover plate, is inclined at an angle of  $\tau = 60^\circ$  relative to the horizontal.

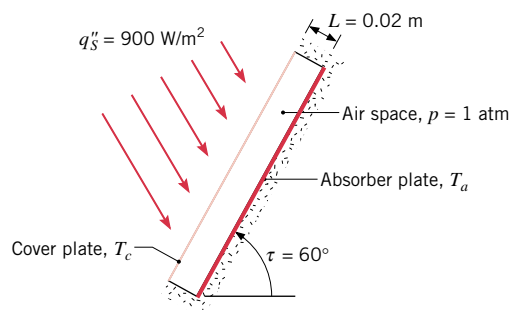

Consider conditions for which the incident solar radiation is collimated at an angle of  $60^\circ$  relative to the horizontal and the solar flux is  $900\text{ W/m}^2$ . The cover plate is perfectly transparent to solar radiation ( $\lambda \leq 3\text{ }\mu\text{m}$ ) and is opaque to radiation of larger wavelengths. The cover and absorber plates are diffuse surfaces having the spectral absorptivities shown.

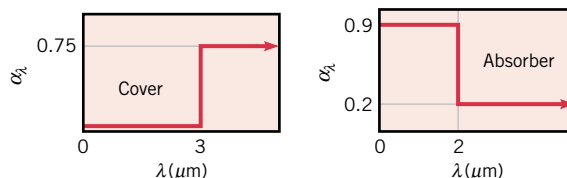

The length and width of the absorber and cover plates are much larger than the plate spacing  $L$ . What is the rate at which solar radiation is absorbed per unit area of the absorber plate? With the absorber plate well insulated from below and absorber and cover plate temperatures  $T_a$  and  $T_c$  of  $70$  and  $27^\circ\text{C}$ , respectively, what is the heat loss per unit area of the absorber plate?

**13.111** Consider the tube and radiation shield of Problem 13.49, but now account for free convection in the gap between the tube and the shield.

- What is the total rate of heat transfer per unit length between the tube and the shield?
- Explore the effect of variations in the shield diameter on the total heat rate, as well as on the contributions due to convection and radiation.


**13.112** Consider the tube and radiation shield of Problem 13.49, but now account for free convection in the gap between the tube and the shield, as well as for the fact that the temperature of the shield may not be arbitrarily prescribed but, in fact, depends on the nature of the surroundings. If the radiation shield is exposed to quiescent ambient air and large surroundings, each at a temperature of  $20^\circ\text{C}$ , what is the temperature of the shield? What is the rate of heat loss from the tube per unit length?

**13.113** Consider the flat-plate solar collector of Problem 9.100. The absorber plate has a coating for which  $\varepsilon_1 = 0.96$ , and the cover plate has an emissivity of  $\varepsilon_2 = 0.92$ . With respect to radiation exchange, both plates may be approximated as diffuse, gray surfaces.


- For the conditions of Problem 9.100, what is the rate of heat transfer by free convection from the absorber plate and the net rate of radiation exchange between the plates?

- (b) The temperature of the absorber plate varies according to the flow rate of the working fluid routed through the coiled tube. With all other parameters remaining as prescribed, compute and plot the free convection and radiant heat rates as a function of the absorber plate temperature for  $50 \leq T_1 \leq 100^\circ\text{C}$ .

**13.114** The lower side of a 400-mm-diameter disk is heated by an electric furnace, while the upper side is exposed to quiescent, ambient air and surroundings at 300 K. The radiant furnace (negligible convection) is of circular construction with the bottom surface ( $\epsilon_1 = 0.6$ ) and cylindrical side surface ( $\epsilon_2 = 1.0$ ) maintained at  $T_1 = T_2 = 500$  K. The surface of the disk facing the radiant furnace is black ( $\epsilon_{d,1} = 1.0$ ), while the upper surface has an emissivity of  $\epsilon_{d,2} = 0.8$ . Assume the plate and furnace surfaces to be diffuse and gray.

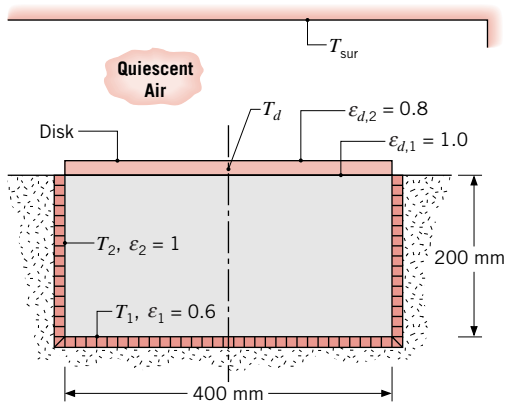


- (a) Determine the net heat transfer rate to the disk,  $q_{\text{net},d}$ , when  $T_d = 400$  K.
- (b) Plot  $q_{\text{net},d}$  as a function of the disk temperature for  $300 \leq T_d \leq 500$  K, with all other conditions remaining the same. What is the steady-state temperature of the disk?
- 13.115** The surface of a radiation shield facing a black hot wall at 400 K has a reflectivity of 0.95. Attached to the back side of the shield is a 25-mm-thick sheet of insulating material having a thermal conductivity of  $0.016 \text{ W/m} \cdot \text{K}$ . The overall heat transfer coefficient (convection and radiation) at the surface exposed to the ambient air and surroundings at 300 K is  $10 \text{ W/m}^2 \cdot \text{K}$ .
- (a) Assuming negligible convection in the region between the wall and the shield, estimate the heat loss per unit area from the hot wall.
- (b) Perform a parameter sensitivity analysis on the insulation system, considering the effects of

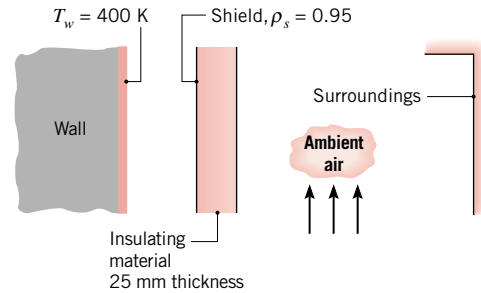

shield reflectivity,  $\rho_s$ , and insulation thermal conductivity,  $k$ . What influence do these parameters have on the heat loss from the hot wall? What is the effect of an increased overall coefficient on the heat loss? Show the results of your analysis in a graphical format.

- 13.116** The fire tube of a hot water heater consists of a long circular duct of diameter  $D = 0.07$  m and temperature  $T_s = 385$  K, through which combustion gases flow at a temperature of  $T_{m,g} = 900$  K. To enhance heat transfer from the gas to the tube, a thin partition is inserted along the midplane of the tube. The gases may be assumed to have the thermophysical properties of air and to be radiatively nonparticipating.

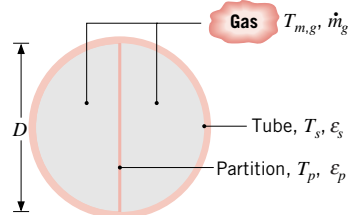

- (a) With no partition and a gas flow rate of  $\dot{m}_g = 0.05 \text{ kg/s}$ , what is the rate of heat transfer per unit length,  $q'$ , to the tube?
- (b) For a gas flow rate of  $\dot{m}_g = 0.05 \text{ kg/s}$  and emissivities of  $\epsilon_s = \epsilon_p = 0.5$ , determine the partition temperature  $T_p$  and the total rate of heat transfer  $q'$  to the tube.
- (c) For  $\dot{m}_g = 0.02, 0.05$ , and  $0.08 \text{ kg/s}$  and equivalent emissivities  $\epsilon_p = \epsilon_s \equiv \epsilon$ , compute and plot  $T_p$  and  $q'$  as a function of  $\epsilon$  for  $0.1 \leq \epsilon \leq 1.0$ . For  $\dot{m}_g = 0.05 \text{ kg/s}$  and equivalent emissivities, plot the convective and radiative contributions to  $q'$  as a function of  $\epsilon$ .
- 13.117** Consider Problem 9.95 with  $N = 4$  sheets of thin aluminum foil ( $\epsilon_f = 0.07$ ), equally spaced throughout the 50-mm gap so as to form five individual air gaps


each 10 mm thick. The hot and cold surfaces of the enclosure are characterized by  $\varepsilon = 0.85$ .

- Neglecting conduction or convection in the air, determine the heat flux through the system.
- Accounting for conduction but neglecting radiation, determine the heat flux through the system. The effect of variable properties is important. Calculate the air properties for each gap independently, based on the average gap temperature.
- Accounting for both conduction and radiation, determine the heat flux through the system. Calculate the air properties for each gap independently.
- Is natural convection negligible in part (c)? Explain why or why not.

**13.118** Consider the conditions of Problem 9.105. Accounting for radiation, as well as convection, across the helium-filled cavity, determine the mass rate at which gaseous nitrogen is vented from the system. The cavity surfaces are diffuse and gray with emissivities of  $\varepsilon_i = \varepsilon_o = 0.3$ . If the cavity is evacuated, how many surface conditions be altered to further reduce the evaporation? Support your recommendation with appropriate calculations.


**13.119** A special surface coating on a square panel that is 5 m by 5 m on a side is cured by placing the panel directly under a radiant heat source having the same dimensions. The heat source is diffuse and gray and operates with a power input of 75 kW. The top surface of the heater, as well as the bottom surface of the panel, may be assumed to be well insulated, and the arrangement exists in a large room with air and wall temperatures of 25°C. The surface coating is diffuse and gray, with an emissivity of 0.30 and an upper temperature limit of 400 K. Neglecting convection effects, what is the minimum spacing that may be maintained between the heater and the panel to ensure that the panel temperature will not exceed 400 K? Allowing for convection effects at the coated surface of the panel, what is the minimum spacing?

**13.120** A long rod heater of diameter  $D_1 = 10$  mm and emissivity  $\varepsilon_1 = 1.0$  is coaxial with a well-insulated, semi-cylindrical reflector of diameter  $D_2 = 1$  m. A long panel of width  $W = 1$  m is aligned with the reflector and is separated from the heater by a distance of  $H = 1$  m. The panel is coated with a special paint ( $\varepsilon_3 = 0.7$ ), which is cured by maintaining it at 400 K. The panel is well insulated on its back side, and the entire system is located in a large room where the walls and the atmospheric, quiescent air are at 300 K. Heat transfer by convection may be neglected for the reflector surface.

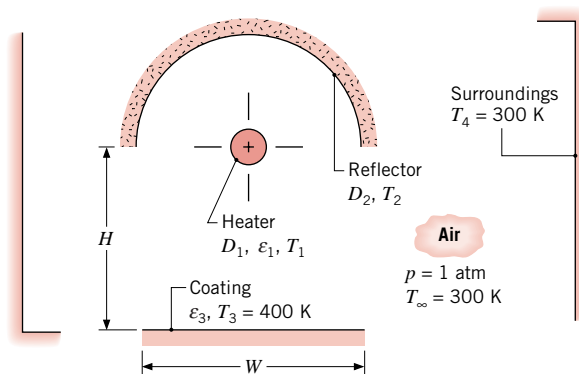

- Sketch the equivalent thermal circuit for the system and label all pertinent resistances and potentials.
- Expressing your results in terms of appropriate variables, write the system of equations needed to determine the heater and reflector temperatures,  $T_1$  and  $T_2$ , respectively. Determine these temperatures for the prescribed conditions.
- Determine the rate at which electrical power must be supplied per unit length of the rod heater.

**13.121** A radiant heater, which is used for surface treatment processes, consists of a long cylindrical heating element of diameter  $D_1 = 0.005$  m and emissivity  $\varepsilon_1 = 0.80$ . The heater is partially enveloped by a long, thin parabolic reflector whose inner and outer surface emissivities are  $\varepsilon_{2i} = 0.10$  and  $\varepsilon_{2o} = 0.80$ , respectively. Inner and outer surface areas per unit length of the reflector are each  $A'_{2i} = A'_{2o} = 0.20$  m, and the average convection coefficient for the combined inner and outer surfaces is  $\bar{h}_{2(i,o)} = 2$  W/m<sup>2</sup> · K. The system may be assumed to be in an infinite, quiescent

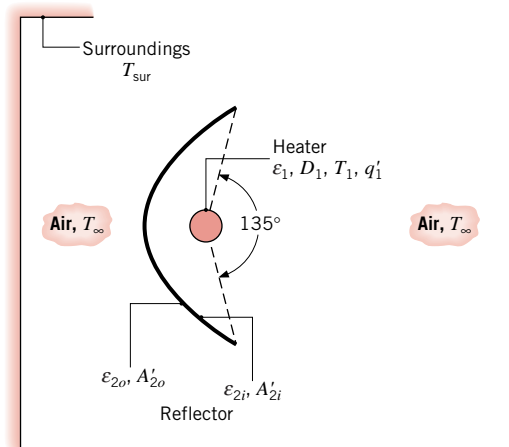




medium of atmospheric air at  $T_\infty = 300$  K and to be exposed to large surroundings at  $T_{\text{sur}} = 300$  K.

- Sketch the appropriate radiation circuit, and write expressions for each of the network resistances.
- If, under steady-state conditions, electrical power is dissipated in the heater at  $P'_1 = 1500$  W/m and the heater surface temperature is  $T_1 = 1200$  K, what is the *net* rate at which *radiant* energy is transferred from the heater?
- What is the net rate at which radiant energy is transferred from the heater to the surroundings?
- What is the temperature,  $T_2$ , of the reflector?


**13.122** A steam generator consists of an in-line array of tubes, each of outer diameter  $D = 10$  mm and length  $L = 1$  m. The longitudinal and transverse pitches are each  $S_L = S_T = 20$  mm, while the numbers of longitudinal and transverse rows are  $N_L = 20$  and  $N_T = 5$ . Saturated water (liquid) enters the tubes at a pressure of 2.5 bars, and its flow rate is adjusted to ensure that it leaves the tubes as saturated vapor. Boiling that occurs in the tubes maintains a uniform tube wall temperature of 400 K.

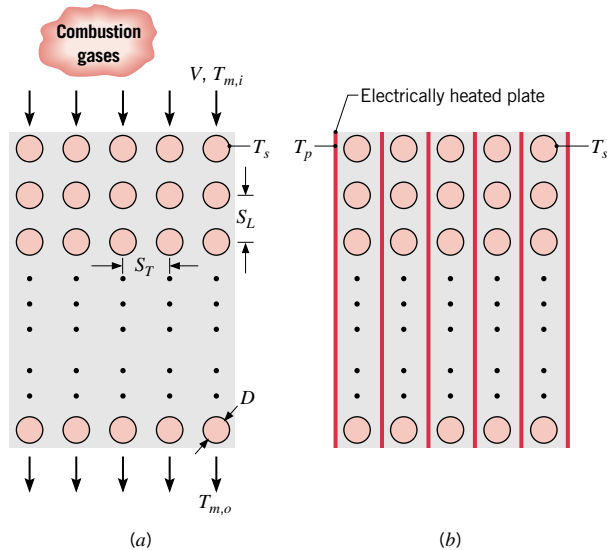

- Consider case (a) for which products of combustion *enter* the tube bank with velocity and temperature of  $V = 10$  m/s and  $T_{m,i} = 1200$  K, respectively. Determine the average gas-side convection coefficient, the gas outlet temperature, and the rate of steam production in kg/s. Properties of the gas may be approximated to be those of atmospheric air at an average temperature of 900 K.

- An alternative steam generator design, case (b), consists of the same tube arrangement, but the gas flow is replaced by an evacuated space with electrically heated plates inserted between each line of tubes. If the plates are maintained at a uniform temperature of  $T_p = 1200$  K, what is the rate of steam production? The plate and tube surfaces may be approximated as blackbodies.
- Consider conditions for which the plates are installed, as in case (b), and the high-temperature products of combustion flow over the tubes, as in case (a). The plates are no longer electrically heated, but their thermal conductivity is sufficiently large to ensure a uniform plate temperature. Comment on factors that influence the plate temperature and the gas temperature distribution. Contrast (qualitatively) the gas outlet temperature and the steam generation rate with the results of case (a).


**13.123** The sketch shows a gas-fired radiant tube of the single-ended recuperative (SER) type. A mixture of air and natural gas is injected at the left end of the central tube, and combustion is essentially complete while the gases are still in the inner tube. The products of combustion are exhausted through the annulus. Thermocouple measurements at a particular axial location indicate an inner tube wall temperature of 1200 K and a gas temperature of 1050 K in the annulus. The radiant tube is located in a furnace, the walls of which are 950 K, and the furnace atmosphere is quiescent and also at 950 K. The thin-walled tubes are made of silicon carbide with an emissivity of 0.6. The gas mass flow rate is 0.13 kg/s, and the gas pressure is 101.5 kPa.

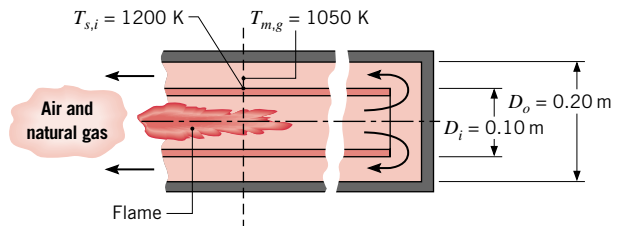

Calculate the temperature of the outer tube at the axial location where thermocouple measurements are being made. Assume the gas to be radiatively nonparticipating and to have the following thermophysical properties:  $\rho = 0.32$  kg/m<sup>3</sup>,  $\nu = 130 \times 10^{-6}$  m<sup>2</sup>/s,  $k = 70 \times 10^{-3}$  W/m · K, and  $Pr = 0.72$ .

**13.124** A wall-mounted natural gas heater uses combustion on a porous catalytic pad to maintain a ceramic plate of emissivity  $\epsilon_c = 0.95$  at a uniform temperature of  $T_c = 1000$  K. The ceramic plate is separated from a

glass plate by an air gap of thickness  $L = 50$  mm. The surface of the glass is diffuse, and its spectral transmissivity and absorptivity may be approximated as  $\tau_\lambda = 0$  and  $\alpha_\lambda = 1$  for  $0 \leq \lambda \leq 0.4 \mu\text{m}$ ,  $\tau_\lambda = 1$  and  $\alpha_\lambda = 0$  for  $0.4 < \lambda \leq 1.6 \mu\text{m}$ , and  $\tau_\lambda = 0$  and  $\alpha_\lambda = 0.9$  for  $\lambda > 1.6 \mu\text{m}$ . The exterior surface of the glass is exposed to quiescent ambient air and large surroundings for which  $T_\infty = T_{\text{sur}} = 300$  K. The height and width of the heater are  $H = W = 2$  m.

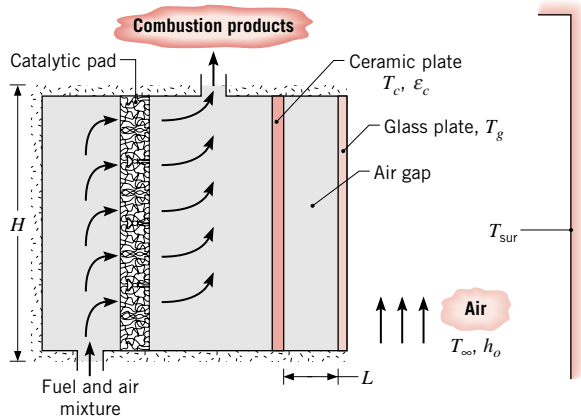

- What is the total transmissivity of the glass to irradiation from the ceramic plate? Can the glass be approximated as opaque and gray?
- For the prescribed conditions, evaluate the glass temperature,  $T_g$ , and the rate of heat transfer from the heater,  $q_h$ .
- A fan may be used to control the convection coefficient  $h_o$  at the exterior surface of the glass. Compute and plot  $T_g$  and  $q_h$  as a function of  $h_o$  for  $10 \leq h_o \leq 100 \text{ W/m}^2 \cdot \text{K}$ .

### Gaseous Radiation

**13.125** A furnace having a spherical cavity of 0.5-m diameter contains a gas mixture at 1 atm and 1400 K. The mixture consists of  $\text{CO}_2$  with a partial pressure of 0.25 atm and nitrogen with a partial pressure of 0.75 atm. If the cavity wall is black, what is the cooling rate needed to maintain its temperature at 500 K?


**13.126** A gas turbine combustion chamber may be approximated as a long tube of 0.4-m diameter. The combustion gas is at a pressure and temperature of 1 atm and  $1000^\circ\text{C}$ , respectively, while the chamber surface temperature is  $500^\circ\text{C}$ . If the combustion gas contains  $\text{CO}_2$  and water vapor, each with a mole fraction of 0.15, what is the net radiative heat flux between the gas and the chamber surface, which may be approximated as a blackbody?

**13.127** A flue gas at 1-atm total pressure and a temperature of 1400 K contains  $\text{CO}_2$  and water vapor at partial pressures of 0.05 and 0.10 atm, respectively. If the gas flows through a long flue of 1-m diameter and 400 K surface temperature, determine the net radiative heat flux from the gas to the surface. Blackbody behavior may be assumed for the surface.

**13.128** A furnace consists of two large parallel plates separated by 0.75 m. A gas mixture comprised of  $\text{O}_2$ ,  $\text{N}_2$ ,  $\text{CO}_2$ , and water vapor, with mole fractions of 0.20, 0.50, 0.15, and 0.15, respectively, flows between the plates at a total pressure of 2 atm and a temperature of 1300 K. If the plates may be approximated as blackbodies and are maintained at 500 K, what is the net radiative heat flux to the plates?

**13.129** In an industrial process, products of combustion at a temperature and pressure of 2000 K and 1 atm, respectively, flow through a long, 0.25-m-diameter pipe whose inner surface is black. The combustion gas contains  $\text{CO}_2$  and water vapor, each at a partial pressure of 0.10 atm. The gas may be assumed to have the thermophysical properties of atmospheric air and to be in fully developed flow with  $\dot{m} = 0.25$  kg/s. The pipe is cooled by passing water in cross flow over its outer surface. The upstream velocity and temperature of the water are 0.30 m/s and 300 K, respectively. Determine the pipe wall temperature and heat flux. *Hint:* Emission from the pipe wall may be neglected.


**13.130** Waste heat recovery from the exhaust (flue) gas of a melting furnace is accomplished by passing the gas through a vertical metallic tube and introducing saturated water (liquid) at the bottom of an annular region around the tube.

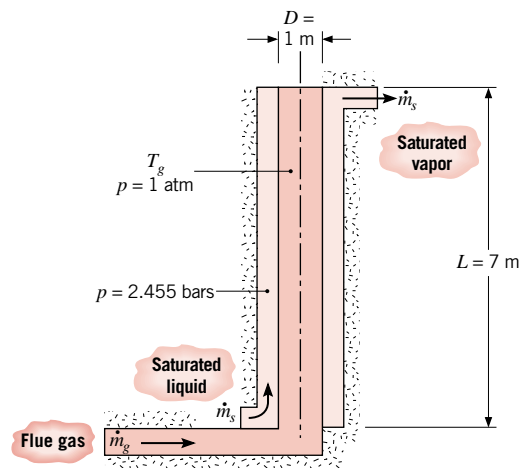

The tube length and inside diameter are 7 and 1 m, respectively, and the tube inner surface is black. The gas in the tube is at atmospheric pressure, with  $\text{CO}_2$  and  $\text{H}_2\text{O}(\text{v})$  partial pressures of 0.1 and 0.2 atm, respectively, and its mean temperature may be approximated as  $T_g = 1400$  K. The gas flow rate is  $\dot{m}_g = 2$  kg/s. If saturated water is introduced at a pressure of 2.455 bars, estimate the water flow rate  $\dot{m}_s$  for which there is complete conversion from saturated liquid at the inlet to saturated vapor at the outlet. Thermophysical properties of the gas may be approximated as  $\mu = 530 \times 10^{-7}$  kg/s · m,  $k = 0.091$  W/m · K, and  $Pr = 0.70$ .

### Heat and Mass Transfer


**13.131** A radiant oven for drying newsprint consists of a long duct ( $L = 20$  m) of semicircular cross section. The newsprint moves through the oven on a conveyor belt at a velocity of  $V = 0.2$  m/s. The newsprint has a water content of  $0.02$  kg/m<sup>2</sup> as it enters the oven and is completely dry as it exits. To assure quality, the newsprint must be maintained at room temperature (300 K) during drying. To aid in maintaining this condition, all system components and the air flowing through the oven have a temperature of 300 K. The inner surface of the semicircular duct, which is of emissivity 0.8 and temperature  $T_1$ , provides the radiant heat required to accomplish the drying. The wet surface of the newsprint can be considered to be black. Air entering the oven has a temperature of 300 K and a relative humidity of 20%.

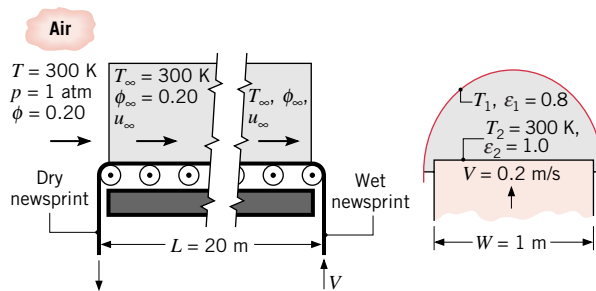

Since the velocity of the air is large, its temperature and relative humidity can be assumed to be constant over the entire duct length. Calculate the required evaporation rate, air velocity  $u_\infty$ , and temperature  $T_1$  that will ensure steady-state conditions for the process.


**13.132** A grain dryer consists of a long semicircular duct of radius  $R = 1$  m. One-half of the base surface consists of an electrically heated plate of emissivity  $\epsilon_p = 0.8$ , while the other half supports the grain to be dried,

which has an emissivity of  $\epsilon_g = 0.9$ . In a batch drying process for which the temperature of the grain is  $T_g = 330$  K, 2.50 kg of water are to be removed per meter of duct length over a 1-hour period.

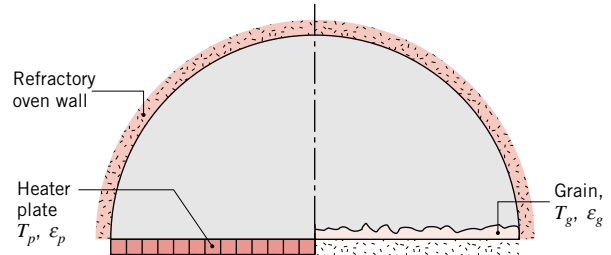

- Neglecting convection heat transfer, determine the required temperature  $T_p$  of the heater plate.
- If the water vapor is swept from the duct by the flow of dry air, what convection mass transfer coefficient  $h_m$  must be maintained by the flow?
- If the air is at 300 K, is the assumption of negligible convection justified?

**13.133** A novel *infrared recycler* has been proposed for reclaiming the millions of kilograms of waste plastics produced by the dismantling and shredding of automotive vehicles following their retirement. To address the problem of sorting mixed plastics into components such as polypropylene and polycarbonate, a washed stream of the mixed plastics is routed to an infrared heating system, where it is dried and subsequently heated to a temperature for which one of the components begins to soften, while the others remain rigid. The mixed stream is then routed through steel rollers, to which the softened plastic sticks and is removed from the stream. Heating of the stream is then continued to facilitate removal of a second component, and the heating/removal process is repeated until all of the components are separated.

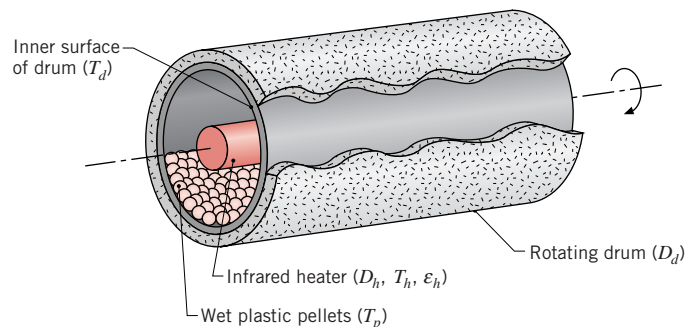

Consider the initial drying stage for a system comprised of a cylindrical heater aligned coaxially with a rotating drum of diameter  $D_d = 1$  m. Shortly after



entering the drum, wet plastic pellets may be assumed to fully cover the bottom semicylindrical section and to remain at a temperature of  $T_p = 325$  K during the drying process. The surface area of the pellets may be assumed to correspond to that of the semicylinder and to have an emissivity of  $\varepsilon_p = 0.95$ .


- (a) If the flow of dry air through the drum maintains a convection mass transfer coefficient of  $0.024$  m/s on the surface of the pellets, what is the evaporation rate per unit length of the drum?
- (b) Neglecting convection heat transfer, determine the temperature  $T_h$  that must be maintained by a heater of diameter  $D_h = 0.10$  m and emissivity

$\varepsilon_h = 0.8$  to sustain the foregoing evaporation rate. What is the corresponding value of the temperature  $T_d$  for the top surface of the drum? The outer surface of the drum is well insulated, and its length-to-diameter ratio is large. As applied to the top ( $d$ ) or bottom ( $p$ ) surface of the drum, the view factor of an infinitely long semicylinder to itself, in the presence of a concentric, coaxial cylinder, may be expressed as

$$F_{ii} = 1 - \frac{2}{\pi} \left\{ \left[ 1 - (D_h/D_d)^2 \right]^{1/2} + (D_h/D_d) \sin^{-1} (D_h/D_d) \right\}$$

# *C H A P T E R* **14**

## **Diffusion Mass Transfer**

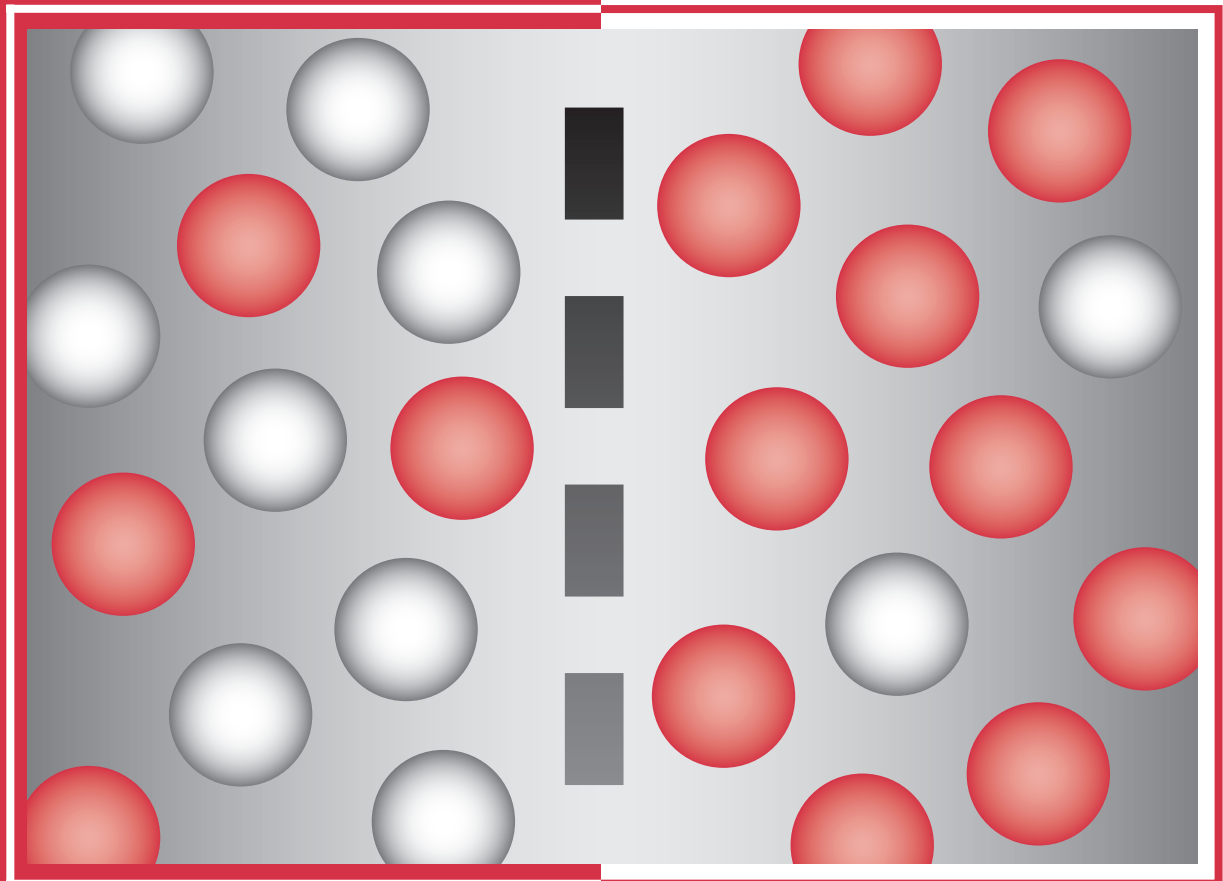

**W**e have learned that heat is transferred if there is a temperature difference in a medium. Similarly, if there is a difference in the concentration of some chemical species in a mixture, mass transfer *must* occur.<sup>1</sup>

*Mass transfer is mass in transit as the result of a species concentration difference in a mixture.*

Just as a *temperature gradient* constitutes the *driving potential* for heat transfer, a species *concentration gradient* in a mixture provides the *driving potential* for transport of that species.

It is important to clearly understand the context in which the term *mass transfer* is used. Although mass is certainly transferred whenever there is bulk fluid motion, this is not what we have in mind. For example, we do *not* use the term *mass transfer* to describe the motion of air that is induced by a fan or the motion of water being forced through a pipe. In both cases, there is gross or bulk fluid motion due to mechanical work. We do, however, use the term to describe the relative motion of species in a mixture due to the presence of concentration gradients. One example is the dispersion of oxides of sulfur released from a power plant smoke stack into the environment. Another example is the transfer of water vapor into dry air, as in a home humidifier.

There are *modes* of *mass transfer* that are similar to the conduction and convection modes of heat transfer. In Chapters 6 through 8 we considered mass transfer by convection, which is *analogous* to convection heat transfer; in this chapter we consider mass transfer by diffusion, which can be *analogous* to conduction heat transfer.

## 14.1


### Physical Origins and Rate Equations

From the standpoint of physical origins and the governing rate equations, strong analogies exist between heat and mass transfer by diffusion.

#### 14.1.1 Physical Origins

Consider a chamber in which two different gas species at the same temperature and pressure are initially separated by a partition. If the partition is removed, both species will be transported by diffusion. Figure 14.1 shows the situation as it might exist shortly after removal of the partition. A higher concentration means more molecules per unit volume, and the concentration of species A (light dots) decreases with increasing  $x$ , while the concentration of B increases with  $x$ . Since mass diffusion is in

<sup>1</sup>A *species* is an identifiable molecule, such as carbon dioxide, CO<sub>2</sub>, that can be transported by diffusion and advection and/or converted to some other form by a chemical reaction. A species may be a single atom or a complex polyatomic molecule. It can also be appropriate to identify a mixture (such as air) as a species.

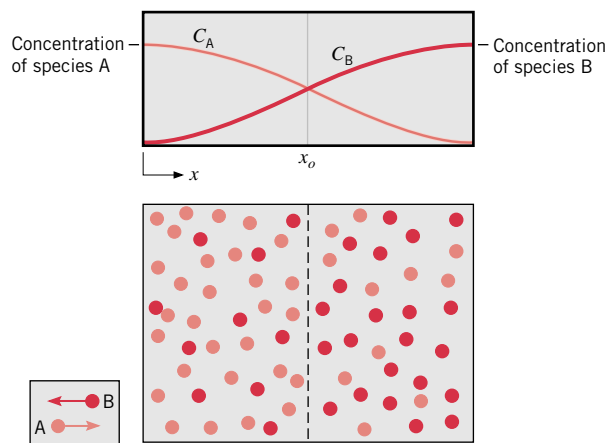

**FIGURE 14.1** Mass transfer by diffusion in a binary gas mixture.

the direction of decreasing concentration, there is net transport of species A to the right and of species B to the left. The physical mechanism may be explained by considering the imaginary plane shown as a dashed line at  $x_o$ . Since molecular motion is random, there is equal probability of any molecule moving to the left or the right. Accordingly, more molecules of species A cross the plane from the left (since this is the side of higher A concentration) than from the right. Similarly, the concentration of B molecules is higher to the right of the plane than to the left, and random motion provides for *net* transfer of species B to the left. Of course, after a sufficient time, uniform concentrations of A and B are achieved, and there is no *net* transport of species A or B across the imaginary plane.

Mass diffusion occurs in liquids and solids, as well as in gases. However, since mass transfer is strongly influenced by molecular spacing, diffusion occurs more readily in gases than in liquids and more readily in liquids than in solids. Examples of diffusion in gases, liquids, and solids, respectively, include nitrous oxide from an automobile exhaust in air, dissolved oxygen in water, and helium in Pyrex.

### 14.1.2 Mixture Composition

Throughout this chapter we will be concerned with the transfer of mass in mixtures. We first review various concepts from thermodynamics. A mixture consists of two or more chemical constituents (*species*), and the amount of any species  $i$  may be quantified in terms of its *mass density*  $\rho_i$  (kg/m<sup>3</sup>) or its *molar concentration*  $C_i$  (kmol/m<sup>3</sup>). The mass density and molar concentration are related through the species molecular weight,  $\mathcal{M}_i$  (kg/kmol), such that

$$\rho_i = \mathcal{M}_i C_i \quad (14.1)$$

With  $\rho_i$  representing the mass of species  $i$  per unit volume of the mixture, the mixture mass density is

$$\rho = \sum_i \rho_i \quad (14.2)$$

Similarly, the total number of moles per unit volume of the mixture is

$$C = \sum_i C_i \quad (14.3)$$

The amount of species  $i$  in a mixture may also be quantified in terms of its *mass fraction*

$$m_i = \frac{\rho_i}{\rho} \quad (14.4)$$

or its *mole fraction*

$$x_i = \frac{C_i}{C} \quad (14.5)^2$$

From Equations 14.2 and 14.3, it follows that

$$\sum_i m_i = 1 \quad (14.6)$$

and

$$\sum_i x_i = 1 \quad (14.7)$$

For a mixture of ideal gases, the mass density and molar concentration of any constituent are related to the partial pressure of the constituent through the ideal gas law. That is,

$$\rho_i = \frac{p_i}{R_i T} \quad (14.8)$$

and

$$C_i = \frac{p_i}{\mathcal{R}T} \quad (14.9)$$

where  $R_i$  is the gas constant for species  $i$  and  $\mathcal{R}$  is the universal gas constant. Using Equations 14.5 and 14.9 with *Dalton's law* of partial pressures,

$$p = \sum_i p_i \quad (14.10)$$

it follows that

$$x_i = \frac{C_i}{C} = \frac{p_i}{p} \quad (14.11)$$

### 14.1.3 Fick's Law of Diffusion

Since similar physical mechanisms are associated with heat and mass transfer by diffusion, it is not surprising that the corresponding rate equations are of the same form. The rate equation for mass diffusion is known as *Fick's law*, and for the

---

<sup>2</sup>Do not confuse  $x_i$ , the mole fraction of species  $i$ , with the spatial coordinate  $x$ . The former variable will always be subscripted with the species designation.

transfer of species A in a *binary mixture* of A and B, it may be expressed in vector form as

$$\mathbf{j}_A = -\rho D_{AB} \nabla m_A \quad (14.12)^3$$

or

$$\mathbf{J}_A^* = -CD_{AB} \nabla x_A \quad (14.13)^3$$

The form of these expressions is similar to that of Fourier's law, Equation 2.3. Moreover, just as Fourier's law serves to define one important transport property, the thermal conductivity, Fick's law defines a second important transport property, namely, the *binary diffusion coefficient* or *mass diffusivity*,  $D_{AB}$ .

The quantity  $\mathbf{j}_A$  ( $\text{kg/s} \cdot \text{m}^2$ ) is defined as the diffusive mass flux of species A. It is the amount of A that is transferred by diffusion per unit time and per unit area perpendicular to the direction of transfer, and it is proportional to the mixture mass density,  $\rho = \rho_A + \rho_B$  ( $\text{kg/m}^3$ ), and to the gradient in the species mass fraction,  $m_A = \rho_A/\rho$ . The species flux may also be evaluated on a molar basis, where  $\mathbf{J}_A^*$  ( $\text{kmol/s} \cdot \text{m}^2$ ) is the diffusive molar flux of species A. It is proportional to the total molar concentration of the mixture,  $C = C_A + C_B$  ( $\text{kmol/m}^3$ ), and to the gradient in the species mole fraction,  $x_A = C_A/C$ . The foregoing forms of Fick's law may be simplified when the total mass density  $\rho$  or the total molar concentration  $C$  is a constant.

### 14.1.4 Mass Diffusivity

Considerable attention has been given to predicting the mass diffusivity  $D_{AB}$  for the binary mixture of two gases, A and B. Assuming ideal gas behavior, kinetic theory may be used to show that

$$D_{AB} \sim p^{-1} T^{3/2} \quad (14.14)$$

where  $T$  is expressed in kelvins. This relation applies for restricted pressure and temperature ranges and is useful for estimating values of the mass diffusivity at conditions other than those for which data are available. Bird et al. [1–3] provide detailed discussions of available theoretical treatments and comparisons with experiment.

For binary liquid solutions, it is necessary to rely exclusively on experimental measurements. For small concentrations of A (the solute) in B (the solvent),  $D_{AB}$  is known to increase with increasing temperature. The mechanism of diffusion of gases, liquids, and solids in solids is extremely complicated and generalized theories are not available. Furthermore, only limited experimental results are available in the literature.

Data for binary diffusion in selected mixtures are presented in Table A.8. Skelland [4] and Poling et al. [5] provide more detailed treatments of this subject.

<sup>3</sup>Inherent in Equations 14.12 and 14.13 is the assumption that mass diffusion results only from a concentration gradient. In fact, mass diffusion may also result from a temperature gradient, a pressure gradient, or an external force. In most problems, these effects are negligible and the dominant driving potential is the species concentration gradient. This condition is referred to as *ordinary diffusion*. Treatment of the other (higher-order) effects is presented by Bird et al. [1–3].

**EXAMPLE 14.1**


Consider the diffusion of hydrogen (species A) in air, liquid water, or iron (species B) at  $T = 293$  K. Calculate the species flux on both molar and mass bases if the concentration gradient at a particular location is  $dC_A/dx = 1 \text{ kmol/m}^3 \cdot \text{m}$ . Compare the value of the mass diffusivity to the thermal diffusivity. The mole fraction of the hydrogen,  $x_A$ , is much less than unity.

**SOLUTION**

**Known:** Concentration gradient of hydrogen in air, liquid water, or iron at  $T = 293$  K.

**Find:** Molar and mass fluxes of hydrogen and the relative values of the mass and thermal diffusivities for the three cases.

**Schematic:**

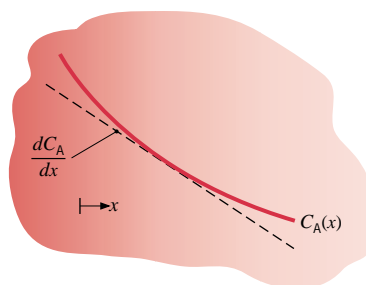

**Assumptions:** Steady-state conditions.

**Properties:** Table A.8, hydrogen–air (298 K):  $D_{AB} = 0.41 \times 10^{-4} \text{ m}^2/\text{s}$ , hydrogen–water (298 K):  $D_{AB} = 0.63 \times 10^{-8} \text{ m}^2/\text{s}$ , hydrogen–iron (293 K):  $D_{AB} = 0.26 \times 10^{-12} \text{ m}^2/\text{s}$ . Table A.4, air (293 K):  $\alpha = 21.6 \times 10^{-6} \text{ m}^2/\text{s}$ ; Table A.6, water (293 K):  $k = 0.603 \text{ W/m} \cdot \text{K}$ ,  $\rho = 998 \text{ kg/m}^3$ ,  $c_p = 4182 \text{ J/kg} \cdot \text{K}$ . Table A.1, iron (300 K):  $\alpha = 23.1 \times 10^{-6} \text{ m}^2/\text{s}$ .

**Analysis:** Using Equation 14.14, we find that the mass diffusivity of hydrogen in air at  $T = 293$  K is

$$D_{AB,T} = D_{AB,298\text{ K}} \times \left( \frac{T}{298\text{ K}} \right)^{3/2} = 0.41 \times 10^{-4} \text{ m}^2/\text{s} \times \left( \frac{293\text{ K}}{298\text{ K}} \right)^{3/2} = 0.40 \times 10^{-4} \text{ m}^2/\text{s}$$

For the case where hydrogen is a *dilute species*, that is,  $x_A \ll 1$ , the thermal properties of the medium can be taken to be those of the host medium consisting of species B. The thermal diffusivity of water is

$$\alpha = \frac{k}{\rho c_p} = \frac{0.603 \text{ W/m} \cdot \text{K}}{998 \text{ kg/m}^3 \cdot 4182 \text{ J/kg} \cdot \text{K}} = 0.144 \times 10^{-6} \text{ m}^2/\text{s}$$

The ratio of the thermal diffusivity to the mass diffusivity is the Lewis number,  $Le$ , defined in Equation 6.50.

The molar flux of hydrogen is described by Fick's law, Equation 14.13,

$$\mathbf{J}_A^* = -CD_{AB} \frac{dx_A}{dx}$$

The total molar concentration,  $C$ , is approximately constant since A is a dilute species; therefore

$$\mathbf{J}_A^* = -D_{AB} \frac{dC_A}{dx}$$

Hence, for the hydrogen–air mixture,

$$\mathbf{J}_A^* = -0.40 \times 10^{-4} \text{ m}^2/\text{s} \times 1 \frac{\text{kmol}}{\text{m}^3 \cdot \text{m}} = -4 \times 10^{-5} \frac{\text{kmol}}{\text{s} \cdot \text{m}^2}$$

The mass flux of hydrogen in air is found from the expression

$$\mathbf{j}_A = \mathcal{M}_A \mathbf{J}_A^* = 2 \frac{\text{kg}}{\text{kmol}} \times \left( -4 \times 10^{-5} \frac{\text{kmol}}{\text{s} \cdot \text{m}^2} \right) = -8 \times 10^{-5} \frac{\text{kg}}{\text{s} \cdot \text{m}^2}$$

The results for the three different mixtures are summarized in the following table.

Species B	$\alpha \times 10^6 \text{ (m}^2/\text{s)}$	$D_{AB} \times 10^6 \text{ (m}^2/\text{s)}$	$Le$	$\mathbf{j}_A \times 10^6 \text{ (kg/s} \cdot \text{m}^2)$
Air	21.6	40	0.54	80
Water	0.14	$6.3 \times 10^{-3}$	23	$13 \times 10^{-3}$
Iron	23.1	$260 \times 10^{-9}$	$89 \times 10^6$	$0.52 \times 10^{-6}$

### Comments:

1. The thermal diffusivities of the three media vary by two orders of magnitude. We saw in Chapter 5 that this relatively broad range of thermal diffusivities is responsible for the different rates at which objects respond thermally during transient conduction processes. In mass transfer, mass diffusivities can vary by 8 or more orders of magnitude, with the highest diffusivities associated with diffusion of gases in gases and the lowest diffusivities associated with diffusion in solids. Different materials respond to mass transfer at very different rates, depending on whether the host medium is a gas, liquid, or solid.
2. The ratio of the thermal diffusivity to the mass diffusivity, the Lewis number, is typically of order unity for gases. This implies that changes in the thermal and species distributions progress at approximately the same rates in gases that undergo simultaneous transient heat conduction and species diffusion processes. In solids or liquids, thermal energy is conducted much more readily than chemical species can be transferred by diffusion.

## 14.2

### Mass Transfer in Nonstationary Media<sup>4</sup>

#### 14.2.1 Absolute and Diffusive Species Fluxes

We have seen that diffusion mass transfer is similar to conduction heat transfer and that the diffusive fluxes, as given by Equations 14.12 and 14.13, are analogous to the heat flux as expressed by Fourier's law. If there is bulk motion, then, like heat

<sup>4</sup>If only problems involving stationary media are of interest, the reader may proceed directly to Section 14.3.



transfer, mass transfer can also occur by advection. Unlike conduction heat transfer, however, the diffusion of a species always involves the movement of molecules or atoms from one location to another. In many cases, this molecular scale motion results in bulk motion. In this section we define the total or *absolute flux* of a species, which includes both diffusive and advective components.

The absolute mass (or molar) flux of a species is defined as the total flux relative to a fixed coordinate system. To obtain an expression for the absolute mass flux, consider species A in a binary mixture of A and B. The absolute mass flux  $\mathbf{n}_A''$  is related to the species absolute velocity  $\mathbf{v}_A$  by

$$\mathbf{n}_A'' \equiv \rho_A \mathbf{v}_A \quad (14.15)$$

A value of  $\mathbf{v}_A$  may be associated with any point in the mixture, and it is interpreted as the average velocity of all the A particles in a small volume element about the point. An average, or aggregate, velocity may also be associated with the particles of species B, in which case

$$\mathbf{n}_B'' \equiv \rho_B \mathbf{v}_B \quad (14.16)$$

A *mass-average velocity for the mixture* may then be obtained from the requirement that

$$\rho \mathbf{v} = \mathbf{n}'' = \mathbf{n}_A'' + \mathbf{n}_B'' = \rho_A \mathbf{v}_A + \rho_B \mathbf{v}_B \quad (14.17)$$

giving

$$\mathbf{v} = m_A \mathbf{v}_A + m_B \mathbf{v}_B \quad (14.18)$$

It is important to note that we have defined the velocities ( $\mathbf{v}_A$ ,  $\mathbf{v}_B$ ,  $\mathbf{v}$ ) and the fluxes ( $\mathbf{n}_A''$ ,  $\mathbf{n}_B''$ ,  $\mathbf{n}''$ ) as *absolute* quantities. That is, they are referred to axes that are fixed in space. The mass-average velocity  $\mathbf{v}$  is a useful parameter of the binary mixture, for two reasons. First, it need only be multiplied by the total mass density to obtain the total mass flux with respect to fixed axes. Second, it is the mass-average velocity which is required in the equations expressing conservation of mass, momentum, and energy such as those presented and discussed in Chapter 6.

We may now define the *mass flux of species A relative to the mixture mass-average velocity* as

$$\mathbf{j}_A \equiv \rho_A (\mathbf{v}_A - \mathbf{v}) \quad (14.19)$$

Whereas  $\mathbf{n}_A''$  is the *absolute flux* of species A,  $\mathbf{j}_A$  is the *relative* or *diffusive flux* of the species and is the quantity previously given by Fick's law, Equation 14.12. It represents the motion of the species relative to the average motion of the mixture. It follows from Equations 14.15 and 14.19 that

$$\mathbf{n}_A'' = \mathbf{j}_A + \rho_A \mathbf{v} \quad (14.20)$$

This expression delineates the two contributions to the absolute flux of species A: a contribution due to *diffusion* (i.e., due to the motion of A *relative* to the mass-average motion of the mixture) and a contribution due to *advection* (i.e., due to motion of A *with* the mass-average motion of the mixture). Substituting from Equations 14.12 and 14.17, we obtain

$$\mathbf{n}_A'' = -\rho D_{AB} \nabla m_A + m_A (\mathbf{n}_A'' + \mathbf{n}_B'') \quad (14.21)$$

If the second term on the right-hand side of Equation 14.21 is zero, mass transfer of species A occurs purely by diffusion, and the situation is analogous to heat transfer purely by conduction. We will later identify special situations for which this occurs.

The foregoing considerations may be extended to species B. The *mass flux of B relative to the mixture mass-average velocity* (the *diffusive flux*) is

$$\mathbf{j}_B \equiv \rho_B(\mathbf{v}_B - \mathbf{v}) \quad (14.22)$$

where

$$\mathbf{j}_B = -\rho D_{BA} \nabla m_B \quad (14.23)$$

It follows from Equations 14.17, 14.19, and 14.22 that the diffusive fluxes in a binary mixture are related by

$$\mathbf{j}_A + \mathbf{j}_B = 0 \quad (14.24)$$

If Equations 14.12 and 14.23 are substituted into Equation 14.24, and it is recognized that  $\nabla m_A = -\nabla m_B$ , since  $m_A + m_B = 1$  for a binary mixture, it follows that

$$D_{BA} = D_{AB} \quad (14.25)$$

Hence, as in Equation 14.21, the *absolute* flux of species B may be expressed as

$$\mathbf{n}_B'' = -\rho D_{AB} \nabla m_B + m_B(\mathbf{n}_A'' + \mathbf{n}_B'') \quad (14.26)$$

Although the foregoing expressions pertain to *mass* fluxes, the same procedures can be used to obtain results on a *molar* basis. The absolute molar fluxes of species A and B may be expressed as

$$\mathbf{N}_A'' \equiv C_A \mathbf{v}_A \quad \text{and} \quad \mathbf{N}_B'' \equiv C_B \mathbf{v}_B \quad (14.27)$$

and a *molar-average velocity for the mixture*,  $\mathbf{v}^*$ , is obtained from the requirement that

$$\mathbf{N}'' = \mathbf{N}_A'' + \mathbf{N}_B'' = C \mathbf{v}^* = C_A \mathbf{v}_A + C_B \mathbf{v}_B \quad (14.28)$$

giving

$$\mathbf{v}^* = x_A \mathbf{v}_A + x_B \mathbf{v}_B \quad (14.29)$$

Note that the molar-average velocity is not the same as the mass-average velocity and is therefore not appropriate for use in the conservation equations of Chapter 6.

The significance of the molar-average velocity is that, when multiplied by the total molar concentration  $C$ , it provides the total molar flux  $\mathbf{N}''$  with respect to a fixed coordinate system. Equation 14.27 provides the *absolute molar flux* of species A and B. In contrast, the molar flux of A relative to the mixture molar average velocity  $\mathbf{J}_A^*$ , termed the *diffusive flux*, may be obtained from Equation 14.13 or from the expression

$$\mathbf{J}_A^* \equiv C_A(\mathbf{v}_A - \mathbf{v}^*) \quad (14.30)$$

To determine an expression similar in form to Equation 14.21, we combine Equations 14.27 and 14.30 to obtain

$$\mathbf{N}_A'' = \mathbf{J}_A^* + C_A \mathbf{v}^* \quad (14.31)$$

or, from Equations 14.13 and 14.28,

$$\mathbf{N}_A'' = -CD_{AB} \nabla x_A + x_A(\mathbf{N}_A'' + \mathbf{N}_B'') \quad (14.32)$$

Note that Equation 14.32 represents the absolute molar flux as the sum of a diffusive flux and an advective flux. Again, if the second term on the right-hand side is zero, mass transfer is purely by diffusion and is analogous to heat conduction, when formulated in molar quantities instead of mass quantities. For the binary mixture, it also follows that


$$\mathbf{J}_A^* + \mathbf{J}_B^* = 0 \quad (14.33)$$

### 14.2.2 Evaporation in a Column

Let us now consider diffusion in the binary gas mixture of Figure 14.2. Fixed species concentrations  $x_{A,L}$  and  $x_{B,L}$  are maintained at the top of a tube containing a liquid layer of species A, and the system is at constant pressure and temperature. Since equilibrium exists between the vapor and liquid phases at the liquid interface, the vapor concentration corresponds to saturated conditions. With  $x_{A,0} > x_{A,L}$ , species A *evaporates* from the liquid interface and is transferred upward by diffusion. For steady, one-dimensional conditions with no chemical reactions, species A cannot accumulate in the control volume of Figure 14.2, and the absolute molar flux of A must be constant throughout the column. Hence

$$\frac{dN''_{A,x}}{dx} = 0 \quad (14.34)$$

From the definition of the total molar concentration,  $C = C_A + C_B$ ,  $x_A + x_B = 1$  throughout the column. Knowing that  $x_{A,0} > x_{A,L}$ , we immediately conclude that  $x_{B,L} > x_{B,0}$ . Therefore,  $dx_B/dx$  is positive, and gas B must diffuse from the top of the column to the liquid interface. However, if species B cannot be absorbed into liquid A,

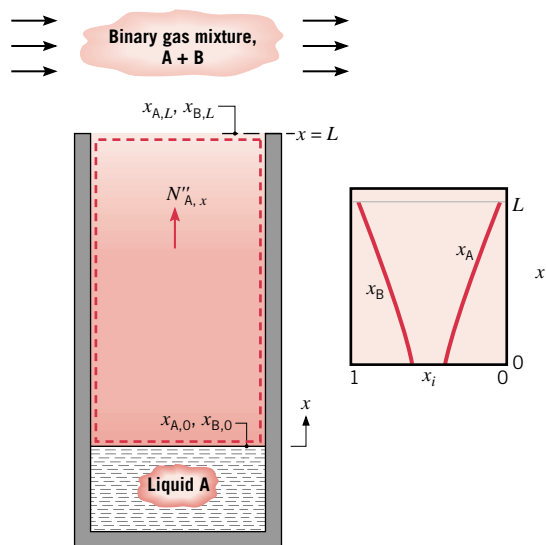

**FIGURE 14.2** Evaporation of liquid A into a binary gas mixture, A + B.

steady-state conditions can be maintained only if  $N''_{B,x} = 0$  everywhere within the control volume of Figure 14.2. The only way this can be possible is if the downward diffusion of gas B is exactly balanced by upward advection of gas B. The implication of this important conclusion is that we must account for the advection of the gases in the column in order to successfully predict the species distributions  $x_A(x)$  and  $x_B(x)$ , as well as the evaporation rate of liquid A. An appropriate expression for  $N''_{A,x}$  may be obtained by substituting the requirement that  $N''_{B,x} = 0$  into Equation 14.32, giving

$$N''_{A,x} = -CD_{AB} \frac{dx_A}{dx} + x_A N''_{A,x} \quad (14.35)$$

or, from Equation 14.28,

$$N''_{A,x} = -CD_{AB} \frac{dx_A}{dx} + C_A v_x^* \quad (14.36)$$

From this equation it is evident that the diffusive transport of species A  $[-CD_{AB}(dx_A/dx)]$  is augmented by bulk motion  $(C_A v_x^*)$ . Rearranging Equation 14.35, we obtain

$$N''_{A,x} = -\frac{CD_{AB}}{1-x_A} \frac{dx_A}{dx} \quad (14.37)$$

For constant  $p$  and  $T$ ,  $C$  and  $D_{AB}$  are also constant. Substituting Equation 14.37 into Equation 14.34, we then obtain

$$\frac{d}{dx} \left( \frac{1}{1-x_A} \frac{dx_A}{dx} \right) = 0$$

Integrating twice, we have

$$-\ln(1-x_A) = C_1 x + C_2$$

Applying the conditions  $x_A(0) = x_{A,0}$  and  $x_A(L) = x_{A,L}$ , the constants of integration may be evaluated and the concentration distribution becomes

$$\frac{1-x_A}{1-x_{A,0}} = \left( \frac{1-x_{A,L}}{1-x_{A,0}} \right)^{x/L} \quad (14.38)$$

Since  $1-x_A = x_B$ , we also obtain


$$\frac{x_B}{x_{B,0}} = \left( \frac{x_{B,L}}{x_{B,0}} \right)^{x/L} \quad (14.39)$$

To determine the evaporation rate of species A, Equation 14.38 is first used to evaluate the concentration gradient  $(dx_A/dx)$ . Substituting the result into Equation 14.37, it follows that

$$N''_{A,x} = \frac{CD_{AB}}{L} \ln \left( \frac{1-x_{A,L}}{1-x_{A,0}} \right) \quad (14.40)$$

### EXAMPLE 14.2

A water-resistant sheet used for water-proofing applications is formed from an impermeable polymeric material. The *microstructure* of the sheet is engineered to provide open pores of diameter  $D = 10\ \mu\text{m}$  that extend through the entire thickness of the  $L = 100\text{-}\mu\text{m}$ -thick sheet. The pore diameter is large enough to allow water vapor to be transferred through the pore but is sufficiently small to prohibit liquid water from penetrating through the sheet. Determine the rate at which water vapor is transmitted through a single pore when saturated liquid exists on the top of the sheet and moist air at  $\phi_\infty = 50\%$  relative humidity exists on the bottom side of the sheet. Evaluate the transfer rate at a temperature of  $T = 298\ \text{K}$  and a pressure of  $p = 1\ \text{atm}$ . Investigate the sensitivity of the transfer rate to the temperature, and compare the transfer rates to rates that are predicted by neglecting the molar-average motion of the mixture in the pore.

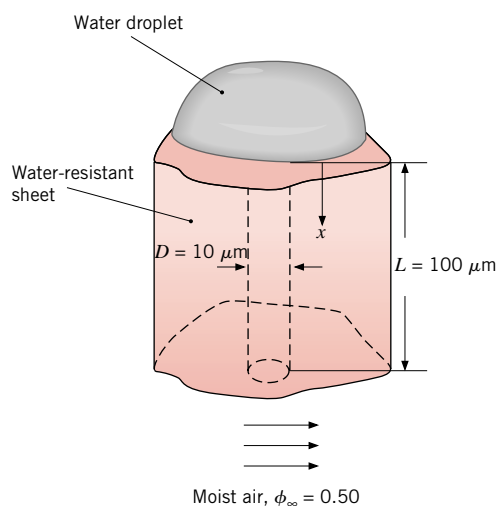

### SOLUTION

**Known:** Thickness and pore diameter of a porous sheet, thermal conditions, and humidity.

**Find:** Evaporation rate through a single pore.

#### Assumptions:

1. Steady-state, isothermal, one-dimensional conditions.
2. No chemical reactions.
3. Pore penetrates the thickness of the sheet in a perpendicular manner and is of circular cross section.
4. Binary system consisting of water vapor (A) and air (B).

**Properties:** Table A.6, saturated water, vapor (298 K):  $p_{\text{sat}} = 0.03165\ \text{bar}$ . Table A.8, water vapor–air (298 K):  $D_{\text{AB}} = 0.26 \times 10^{-4}\ \text{m}^2/\text{s}$ .

**Analysis:**

- Equation 14.40 may be used to determine the water vapor transferred through a single pore, accounting for the effects of the nonzero molar-averaged velocity. Hence,

$$N_{A,x} = A_{\text{pore}} N''_{A,x} = \frac{\pi D^2 C D_{AB}}{4L} \ln \left( \frac{1 - x_{A,L}}{1 - x_{A,0}} \right) \quad (1)$$

where the total concentration is

$$C = \frac{P}{RT} = \frac{1.0133 \text{ bar}}{8.314 \times 10^{-2} \frac{\text{m}^3 \cdot \text{bar}}{\text{kmol} \cdot \text{K}} \times 298 \text{ K}} = 40.9 \times 10^{-3} \text{ kmol/m}^3$$

From Section 6.7.2, the mole fraction at  $x = 0$  is

$$x_{A,0} = \frac{P_{A,\text{sat}}}{P} = \frac{0.03165 \text{ bar}}{1.0133 \text{ bar}} = 31.23 \times 10^{-3}$$

while at  $x = L$  the mole fraction is

$$x_{A,L} = \frac{\phi_{\infty} P_{A,\text{sat}}}{P} = \frac{0.5 \times 0.03165 \text{ bar}}{1.0133 \text{ bar}} = 15.62 \times 10^{-3}$$

Therefore, the evaporation rate per pore may be evaluated using Equation 1 as

$$\begin{aligned} N_{A,x} &= \frac{\pi \times (10 \times 10^{-6} \text{ m})^2 \times 40.9 \times 10^{-3} \text{ kmol/m}^3 \times 0.26 \times 10^{-4} \text{ m}^2/\text{s}}{4 \times 100 \times 10^{-6} \text{ m}} \\ &\quad \times \ln \left( \frac{1 - 15.62 \times 10^{-3}}{1 - 31.23 \times 10^{-3}} \right) \\ &= 13.4 \times 10^{-15} \text{ kmol/s} \end{aligned} \quad \triangleleft$$

- Neglecting the effects of the molar-averaged velocity, we see that Equation 14.32 reduces to

$$N''_{A,x} = -C D_{AB} \frac{dx_A}{dx}$$


where the total concentration,  $C$ , is constant, and the flux of water vapor is independent of  $x$ . Hence, the species transfer rate per pore may be expressed as

$$\begin{aligned} N_{A,x} &= A_{\text{pore}} N''_{A,x} = \frac{\pi D^2 C D_{AB}}{4L} (x_{A,0} - x_{A,L}) \\ &= \frac{\pi \times (10 \times 10^{-6} \text{ m})^2 \times 40.9 \times 10^{-3} \text{ kmol/m}^3 \times 0.26 \times 10^{-4} \text{ m}^2/\text{s}}{4 \times 100 \times 10^{-6} \text{ m}} \\ &\quad \times (31.23 \times 10^{-3} - 15.62 \times 10^{-3}) \\ &= 13.0 \times 10^{-15} \text{ kmol/s} \end{aligned} \quad \triangleleft$$

Advection effects associated with the nonzero molar-average velocity augment the diffusive flux, and a slightly increased evaporation rate is predicted to occur when advection is considered.

- The temperature dependence of the evaporation rate is determined by accounting for the sensitivity of the binary diffusion coefficient to temperature (Equation 14.14),  $D_{AB} \propto T^{3/2}$ , and repeating the calculations over the range  $300 < T < 360 \text{ K}$ . The results, shown below in graphical form, indicate a significant dependence of the evaporation rate on the temperature. This strong dependence is due

primarily to the significant variation of the saturation pressure of water vapor with temperature, as evident in Table A.6.

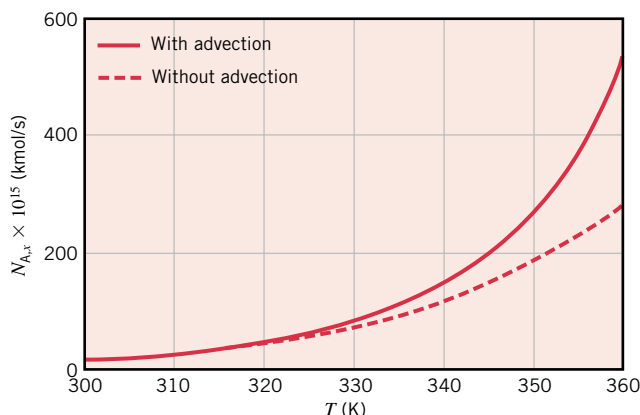

### Comments:

1. As the temperature and, in turn, the saturation pressure and mole fraction of the water vapor increase, the molar-average velocity becomes large, and advection effects become important. Alternatively, the molar-average velocity may be neglected when the concentration of water vapor is small. It is the existence of the two conditions  $N''_{B,x} \approx 0$  and  $x_A \ll 1$  that will be implied in future use of the *stationary medium approximation*.
2. The total evaporation rate per area of the packaging material could be determined by multiplying the number of pores per unit area by the evaporation rate per pore.
3. The pressure was assumed constant in developing this solution. Since the molar-average velocity is nonzero, there must be a pressure gradient to overcome friction at the pore walls. If the pore is oriented vertically, there is also a static pressure gradient. The pressure gradient to overcome friction can be estimated by first determining the mass-average velocity. From Equation 14.17

$$v_x = \frac{n''_{A,x} + n''_{B,x}}{\rho} = \frac{n''_{A,x}}{\rho} = \frac{N''_{A,x} \mathcal{M}_A}{\rho} = \frac{N_{A,x} \mathcal{M}_A}{A_{\text{pore}} \rho}$$

Then the pressure gradient can be estimated by treating the flow as if it were a fully developed flow in a circular pipe. From Equation 8.14

$$\left| \frac{dp}{dx} \right| = \frac{32\mu v_x}{D^2} = \frac{32v N_{A,x} \mathcal{M}_A}{A_{\text{pore}} D^2}$$

Since the mixture is mostly air, we use the kinematic viscosity of air. Then taking the worst case of  $T = 360$  K,  $N_{A,x} = 530 \times 10^{-15}$  kmol/s,

$$\begin{aligned} \left| \frac{dp}{dx} \right| &= \frac{32 \times 22.0 \times 10^{-6} \text{ m}^2/\text{s} \times 530 \times 10^{-15} \text{ kmol/s} \times 18 \text{ kg/kmol}}{\pi(10 \times 10^{-6} \text{ m})^4/4} \\ &= 860 \times 10^3 \text{ Pa/m} \end{aligned}$$

Thus the pressure drop to overcome friction is

$$\Delta p_{\text{friction}} = 860 \times 10^3 \text{ Pa/m} \times 100 \times 10^{-6} \text{ m} = 86 \text{ Pa}$$

If the pore is vertical, the static pressure drop is

$$\Delta p_{\text{static}} = \rho_{\text{air}} g L = 0.970 \text{ kg/m}^3 \times 9.8 \text{ m/s}^2 \times 100 \times 10^{-6} \text{ m} = 0.001 \text{ Pa}$$

Both of these pressure drops are negligible relative to atmospheric pressure, so the assumption of constant pressure was appropriate.

## 14.3

### The Stationary Medium Approximation

Fick's law for the diffusive flux of a species was introduced in Equations 14.12 and 14.13. In Section 14.2, we saw that the molecular motion associated with mass transfer can induce bulk motion within an otherwise stagnant fluid. In this case the total or absolute species flux (given by Equation 14.21 or 14.32) includes both a diffusive component (given by Equation 14.12 or 14.13) and an advective component associated with the bulk motion. In this section we consider a scenario for which it is appropriate to neglect the advective contribution to mass transfer.

When the diffusion of a very small amount of species A occurs within a stagnant species B, the molecular motion associated with the mass transfer will not induce significant bulk motion of the medium. This situation is common when one considers the diffusion of a *dilute* gas or liquid within a stagnant liquid or a solid *host medium*, such as when water vapor is transferred through the solid wall of a room. In these cases, the medium can be assumed to be *stationary*, and advection can be neglected. For situations where this *stationary medium approximation* is appropriate, the diffusive mass and molar fluxes of Equations 14.12 and 14.13 are identical to the absolute mass and molar fluxes.<sup>5</sup> That is,

$$\mathbf{n}_A'' = \mathbf{j}_A = -\rho D_{AB} \nabla m_A \quad (14.41)$$

$$\mathbf{N}_A'' = \mathbf{J}_A^* = -C D_{AB} \nabla x_A \quad (14.42)$$

Furthermore, since the concentration of species A is small, the total density ( $\rho$ ) or concentration ( $C$ ) is approximately that of the host medium, species B. The important conclusion is that the stationary medium approximation allows one to utilize the results of Chapters 2 through 5 by employing an *analogy* between conduction heat transfer and diffusion mass transfer.

<sup>5</sup>For readers who skipped Section 14.2 on mass transfer in *nonstationary* media, the absolute flux of species A measured relative to fixed coordinates is denoted by  $\mathbf{n}_A''$  (mass flux) or  $\mathbf{N}_A''$  (molar flux). For those who read Section 14.2, note that the stationary medium approximation is equivalent to saying that the host medium (B) is stationary,  $\mathbf{n}_B'' = 0$  and  $\mathbf{N}_B'' = 0$ , and species A is dilute,  $m_A \ll 1$  and  $x_A \ll 1$ . Thus, in Equations 14.21 and 14.32, the advective component is negligible, resulting in Equations 14.41 and 14.42.



## 14.4

### Conservation of Species for a Stationary Medium

Just as the first law of thermodynamics (the law of *conservation of energy*) plays an important role in heat transfer analyses, the law of *conservation of species* plays an important role in the analysis of mass transfer problems. In this section we consider a general statement of this law, as well as application of the law to species diffusion in a stationary medium.

#### 14.4.1 Conservation of Species for a Control Volume

A general formulation of the energy conservation requirement, Equation 1.11c, was expressed for the control volume of Figure 1.7b. We may now express an analogous species mass conservation requirement for the control volume of Figure 14.3.

*The rate at which the mass of some species enters a control volume, plus the rate at which the species mass is generated within the control volume, minus the rate at which this species mass leaves the control volume must equal the rate of increase of the species mass stored within the control volume.*


For example, any species A may enter and leave the control volume due to both fluid motion and diffusion across the control surface; these processes are *surface* phenomena represented by  $\dot{M}_{A,\text{in}}$  and  $\dot{M}_{A,\text{out}}$ . The same species A may also be generated,  $\dot{M}_{A,g}$ , and accumulated or stored,  $\dot{M}_{A,\text{st}}$ , *within* the control volume. The conservation equation may then be expressed on a rate basis as

$$\dot{M}_{A,\text{in}} + \dot{M}_{A,g} - \dot{M}_{A,\text{out}} = \frac{dM_A}{dt} \equiv \dot{M}_{A,\text{st}} \quad (14.43)$$


Species generation exists when chemical reactions occur in the system. For example, for a dissociation reaction of the form  $AB \rightarrow A + B$ , there would be net production of species A and B, as well as net reduction of the species AB.

#### 14.4.2 The Mass Diffusion Equation

The foregoing result may be used to obtain a mass, or species, diffusion equation that is analogous to the heat equation of Chapter 2. We will consider a medium that is a binary mixture of species A and B for which the *stationary medium approximation* holds. That is, mass transfer may be approximated as occurring only by diffusion

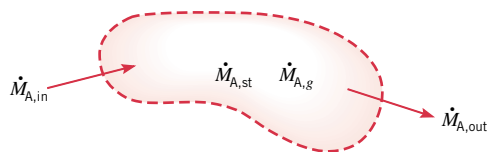

**FIGURE 14.3**  
Conservation of species for a control volume.

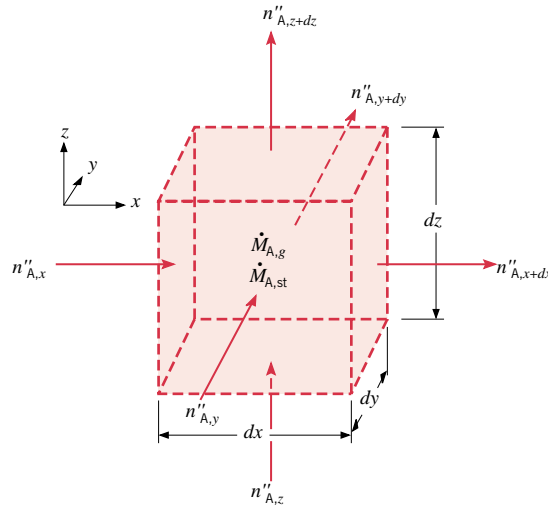

**FIGURE 14.4**

Differential control volume,  $dx \, dy \, dz$ , for species diffusion analysis in Cartesian coordinates.

because advection is negligible. The resulting equation could be solved for the species concentration distribution, which could, in turn, be used with Fick's law to determine the species diffusion rate at any point in the medium.

Allowing for concentration gradients in each of the  $x$ ,  $y$ , and  $z$  coordinate directions, we first define a differential control volume,  $dx \, dy \, dz$ , within the medium (Figure 14.4) and consider the processes that influence the distribution of species A. With the concentration gradients, diffusion must result in the transport of species A through the control surfaces. Moreover, relative to stationary coordinates, the species transport rates at opposite surfaces must be related by

$$n''_{A,x+dx} \, dy \, dz = n''_{A,x} \, dy \, dz + \frac{\partial [n''_{A,x} \, dy \, dz]}{\partial x} \, dx \quad (14.44a)$$

$$n''_{A,y+dy} \, dx \, dz = n''_{A,y} \, dx \, dz + \frac{\partial [n''_{A,y} \, dx \, dz]}{\partial y} \, dy \quad (14.44b)$$

$$n''_{A,z+dz} \, dx \, dy = n''_{A,z} \, dx \, dy + \frac{\partial [n''_{A,z} \, dx \, dy]}{\partial z} \, dz \quad (14.44c)$$

In addition, there may be volumetric (also referred to as *homogeneous*) chemical reactions occurring throughout the medium, perhaps nonuniformly. The rate at which species A is generated within the control volume due to such reactions may be expressed as

$$\dot{M}_{A,g} = \dot{n}_A \, dx \, dy \, dz \quad (14.45)$$

where  $\dot{n}_A$  is the rate of increase of the mass of species A per unit volume of the mixture ( $\text{kg/s} \cdot \text{m}^3$ ). Finally, these processes may change the mass of species A stored within the control volume, and the rate of change is

$$\dot{M}_{A,st} = \frac{\partial \rho_A}{\partial t} \, dx \, dy \, dz \quad (14.46)$$

With mass inflow rates determined by  $n''_{A,x}$ ,  $n''_{A,y}$ , and  $n''_{A,z}$  and the outflow rates determined by Equations 14.44, Equations 14.44 through 14.46 may be substituted into Equation 14.43 to obtain

$$-\frac{\partial n''_A}{\partial x} - \frac{\partial n''_A}{\partial y} - \frac{\partial n''_A}{\partial z} + \dot{n}_A = \frac{\partial \rho_A}{\partial t}$$

In the remainder of the chapter we restrict our attention to cases where the stationary medium approximation is appropriate. Then, substituting the  $x$ ,  $y$ , and  $z$  components of Equation 14.41, we obtain

$$\frac{\partial}{\partial x} \left( \rho D_{AB} \frac{\partial m_A}{\partial x} \right) + \frac{\partial}{\partial y} \left( \rho D_{AB} \frac{\partial m_A}{\partial y} \right) + \frac{\partial}{\partial z} \left( \rho D_{AB} \frac{\partial m_A}{\partial z} \right) + \dot{n}_A = \frac{\partial \rho_A}{\partial t} \quad (14.47a)$$

In terms of the molar concentration, a similar derivation yields

$$\frac{\partial}{\partial x} \left( C D_{AB} \frac{\partial x_A}{\partial x} \right) + \frac{\partial}{\partial y} \left( C D_{AB} \frac{\partial x_A}{\partial y} \right) + \frac{\partial}{\partial z} \left( C D_{AB} \frac{\partial x_A}{\partial z} \right) + \dot{N}_A = \frac{\partial C_A}{\partial t} \quad (14.48a)$$

In subsequent treatments of species diffusion phenomena, we shall work with simplified versions of the foregoing equations. In particular, if  $D_{AB}$  and  $\rho$  are constant, Equation 14.47a may be expressed as

$$\frac{\partial^2 \rho_A}{\partial x^2} + \frac{\partial^2 \rho_A}{\partial y^2} + \frac{\partial^2 \rho_A}{\partial z^2} + \frac{\dot{n}_A}{D_{AB}} = \frac{1}{D_{AB}} \frac{\partial \rho_A}{\partial t} \quad (14.47b)$$

Similarly, if  $D_{AB}$  and  $C$  are constant, Equation 14.48a may be expressed as

$$\frac{\partial^2 C_A}{\partial x^2} + \frac{\partial^2 C_A}{\partial y^2} + \frac{\partial^2 C_A}{\partial z^2} + \frac{\dot{N}_A}{D_{AB}} = \frac{1}{D_{AB}} \frac{\partial C_A}{\partial t} \quad (14.48b)$$

Equations 14.47b and 14.48b are analogous to the heat equation, Equation 2.19. As for the heat equation, two boundary conditions must be specified for each coordinate needed to describe the system. Conditions are also needed at an *initial time* if the problem of interest is transient. Hence it follows that, for analogous boundary and initial conditions, the solution to Equation 14.47b for  $\rho_A(x, y, z, t)$  or to Equation 14.48b for  $C_A(x, y, z, t)$  is of the same form as the solution to Equation 2.19 for  $T(x, y, z, t)$ .

The species diffusion equations may also be expressed in cylindrical and spherical coordinates. These alternative forms can be inferred from the analogous expressions for heat transfer, Equations 2.24 and 2.27, and in terms of the molar concentration have the following forms:

#### Cylindrical Coordinates:


$$\frac{1}{r} \frac{\partial}{\partial r} \left( C D_{AB} r \frac{\partial x_A}{\partial r} \right) + \frac{1}{r^2} \frac{\partial}{\partial \phi} \left( C D_{AB} \frac{\partial x_A}{\partial \phi} \right) + \frac{\partial}{\partial z} \left( C D_{AB} \frac{\partial x_A}{\partial z} \right) + \dot{N}_A = \frac{\partial C_A}{\partial t} \quad (14.49)$$

### Spherical Coordinates:

$$\begin{aligned} \frac{1}{r^2} \frac{\partial}{\partial r} \left( CD_{AB} r^2 \frac{\partial x_A}{\partial r} \right) + \frac{1}{r^2 \sin^2 \theta} \frac{\partial}{\partial \phi} \left( CD_{AB} \frac{\partial x_A}{\partial \phi} \right) \\ + \frac{1}{r^2 \sin \theta} \frac{\partial}{\partial \theta} \left( CD_{AB} \sin \theta \frac{\partial x_A}{\partial \theta} \right) + \dot{N}_A = \frac{\partial C_A}{\partial t} \end{aligned} \quad (14.50)$$

Simpler forms are, of course, associated with the absence of chemical reactions ( $\dot{N}_A = \dot{N}_A = 0$ ) and with one-dimensional, steady-state conditions.

### 14.4.3 Stationary Media with Specified Surface Concentrations



**FIGURE 14.5** Mass transfer in a stationary planar medium.

Consider, for example, one-dimensional diffusion of species A through a planar medium of A and B, as shown in Figure 14.5. For steady-state conditions with no homogeneous chemical reactions, the molar form of the species diffusion equation (14.48a) reduces to

$$\frac{d}{dx} \left( CD_{AB} \frac{dx_A}{dx} \right) = 0 \quad (14.51)$$

Assuming the total molar concentration and the diffusion coefficient to be constant, Equation 14.51 may be solved and the boundary conditions illustrated in Figure 14.5 may be applied to yield

$$x_A(x) = (x_{A,s2} - x_{A,s1}) \frac{x}{L} + x_{A,s1} \quad (14.52)$$

From Equation 14.42, it follows that

$$N''_{A,x} = -CD_{AB} \frac{x_{A,s2} - x_{A,s1}}{L} \quad (14.53)$$

Multiplying by the surface area  $A$  and substituting for  $x_A \equiv C_A/C$ , the molar rate is then

$$N_{A,x} = \frac{D_{AB} A}{L} (C_{A,s1} - C_{A,s2}) \quad (14.54)$$

From this expression we can define a resistance to species transfer by diffusion in a planar medium as




$$R_{m,dif} = \frac{C_{A,s1} - C_{A,s2}}{N_{A,x}} = \frac{L}{D_{AB} A} \quad (14.55)$$

Comparing the foregoing results with those obtained for one-dimensional, steady-state conduction in a plane wall with no generation (Section 3.1), it is evident that a direct analogy exists between heat and mass transfer by diffusion.

The analogy also applies to cylindrical and spherical systems. For one-dimensional, steady diffusion in a cylindrical, nonreacting medium, Equation 14.49 reduces to

$$\frac{d}{dr} \left( r CD_{AB} \frac{dx_A}{dr} \right) = 0 \quad (14.56)$$

**TABLE 14.1** Summary of Species Diffusion Solutions for Stationary Media with Specified Surface Concentrations<sup>a</sup>

Geometry	Species Concentration Distribution, $x_A(x)$ or $x_A(r)$	Species Diffusion Resistance, $R_{m,dif}$
	$x_A(x) = (x_{A,s2} - x_{A,s1}) \frac{x}{L} + x_{A,s1}$	$R_{m,dif} = \frac{L}{D_{AB}A}^b$
	$x_A(r) = \frac{x_{A,s1} - x_{A,s2}}{\ln(r_1/r_2)} \ln\left(\frac{r}{r_2}\right) + x_{A,s2}$	$R_{m,dif} = \frac{\ln(r_2/r_1)^c}{2\pi L D_{AB}}$
	$x_A(r) = \frac{x_{A,s1} - x_{A,s2}}{1/r_1 - 1/r_2} \left( \frac{1}{r} - \frac{1}{r_2} \right) + x_{A,s2}$	$R_{m,dif} = \frac{1}{4\pi D_{AB}} \left( \frac{1}{r_1} - \frac{1}{r_2} \right)^c$

<sup>a</sup>Assuming  $C$  and  $D_{AB}$  are constant.

<sup>b</sup> $N_{A,x} = (C_{A,s1} - C_{A,s2})/R_{m,dif}$ .

<sup>c</sup> $N_{A,r} = (C_{A,s1} - C_{A,s2})/R_{m,dif}$ .

Similarly, for a spherical medium,

$$\frac{d}{dr} \left( r^2 C D_{AB} \frac{dx_A}{dr} \right) = 0 \quad (14.57)$$

Equations 14.56 and 14.57, as well as Equation 14.51, dictate that the molar transfer rate,  $N_{A,r}$  or  $N_{A,x}$ , is constant in the direction of transfer ( $r$  or  $x$ ). Assuming  $C$  and  $D_{AB}$  to be constant, it is a simple matter to obtain general solutions to Equations 14.56 and 14.57. For prescribed surface species concentrations, the corresponding solutions and diffusion resistances are summarized in Table 14.1.

### EXAMPLE 14.3

The efficacy of pharmaceutical products is reduced by prolonged exposure to high temperature, light, and humidity. For water vapor–sensitive consumer products that are in tablet or capsule form, and might be stored in humid environments such as bathroom medicine cabinets, *blister packaging* is used to limit the direct exposure of the medicine to humid conditions until immediately before their use.


Consider tablets that are contained in a blister package composed of a flat *lidding sheet* and a second, *formed sheet* that includes troughs to hold each tablet. The formed sheet is  $L = 50 \mu\text{m}$  thick and is fabricated of a polymer material. Each trough is of diameter  $D = 5 \text{ mm}$  and depth  $h = 3 \text{ mm}$ . The lidding sheet is fabricated of aluminum foil. The binary diffusion coefficient for water vapor in the polymer is  $D_{AB} = 6 \times 10^{-14} \text{ m}^2/\text{s}$  while the aluminum may be assumed to be impermeable to water vapor. For molar concentrations of water vapor in the polymer at the outer and inner surfaces of  $C_{A,s1} = 4.5 \times 10^{-3} \text{ kmol/m}^3$  and  $C_{A,s2} = 0.5 \times 10^{-3} \text{ kmol/m}^3$ , respectively, determine the rate at which water vapor is transferred through the trough wall to the tablet.

### SOLUTION

**Known:** Molar concentrations of water vapor at the inner and outer surfaces of a polymer sheet and trough geometry.

**Find:** Rate of water vapor molar diffusive transfer through the trough wall.

**Schematic:**

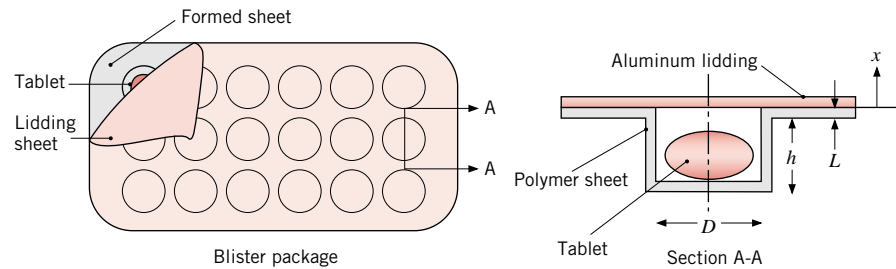

**Assumptions:**

1. Steady-state, one-dimensional conditions.
2. Stationary medium.
3. No chemical reactions.
4. Polymer sheet is thin relative to the dimensions of the trough, and diffusion may be analyzed as though it occurs through a plane wall.

**Analysis:**

The total water vapor transfer rate is the summation of the transfer rate through the cylindrical walls of the trough and the bottom, circular surface of the trough. From Equation 14.54 we may write

$$N_{A,x} = \frac{D_{AB}A}{L} (C_{A,s1} - C_{A,s2}) = \frac{D_{AB}}{L} \left( \frac{\pi D^2}{4} + \pi D h \right) (C_{A,s1} - C_{A,s2})$$

Hence

$$\begin{aligned} N_{A,x} &= \frac{6 \times 10^{-14} \text{ m}^2/\text{s}}{50 \times 10^{-6} \text{ m}} \left( \frac{\pi(5 \times 10^{-3} \text{ m})^2}{4} + \pi(5 \times 10^{-3} \text{ m})(3 \times 10^{-3} \text{ m}) \right) \\ &\quad \times (4.5 \times 10^{-3} - 0.5 \times 10^{-3}) \text{ kmol/m}^3 \\ &= 0.32 \times 10^{-15} \text{ kmol/s} \end{aligned}$$

**Comments:**

1. The mass diffusion rate of water vapor is  $n_{A,x} = \mathcal{M}_A N_{A,x} = 18 \text{ kg/kmol} \times 0.32 \times 10^{-15} \text{ kmol/s} = 5.8 \times 10^{-15} \text{ kg/s}$ .
2. The *shelf life* of the medicine is inversely proportional to the rate at which water vapor is transferred through the polymer sheet. Shelf life may be extended by increasing the thickness of the sheet, resulting in increased cost of the package. Specification of materials for use in blister packaging involves tradeoffs between shelf life, cost, formability, and recyclability of the polymer material.

**14.5****Boundary Conditions and Discontinuous Concentrations at Interfaces**

In the previous section, expressions for mass transfer resistances were developed by applying *constant surface concentration* boundary conditions. For a surface at  $x = 0$ , the constant surface species concentration boundary condition is expressed as

$$x_A(0, t) = x_{A,s} \quad (14.58)$$

We have already used Equation 14.58 in Examples 14.2 and 14.3. A constant surface concentration boundary condition can equivalently be expressed in terms of a mass or molar fraction or density. While the form of Equation 14.58 is simple, determination of the appropriate value of  $x_{A,s}$  can be complicated, as discussed below.

The second boundary condition that is analogous to the conduction heat transfer conditions of Table 2.2 is that of a constant species flux,  $J_{A,s}^*$ , at a surface. Using Fick's law, Equation 14.13, the condition is expressed for a surface at  $x = 0$  as

$$-CD_{AB} \left. \frac{\partial x_A}{\partial x} \right|_{x=0} = J_{A,s}^* \quad (14.59)$$

A special case of this condition corresponds to the *impermeable surface* for which  $\partial x_A / \partial x|_{x=0} = 0$  when a stationary medium is considered. A constant species flux boundary condition can also be expressed on a mass basis.

One phenomenon that makes mass transfer more complex than heat transfer is that species concentrations are typically *discontinuous* at the interface between two materials, whereas temperature is continuous. To take a familiar example, consider a pool of water that is exposed to air. If we are interested in determining the rate at which water vapor is transferred into the air, we would need to specify the water vapor concentration in the air at the air–water interface. We know that the mole fraction of water in the pool is essentially unity (neglecting the small amount of dissolved oxygen or nitrogen in the water). But it would be incorrect to specify  $x_{A,s} = 1$  for the water vapor mole fraction *in the air* at the interface. Clearly, the concentration of water is discontinuous across the interface. In general, concentration boundary conditions at the interface that separates two materials describe a *relationship* between the concentrations on either side of the interface. The relationships are either based on theory or are deduced from experiments. They can be expressed in a variety of forms, a few of which are now introduced.

### 14.5.1 Evaporation and Sublimation

A common mass transfer scenario is the transfer of a species A into a gas stream due to evaporation or sublimation from a liquid or solid surface, respectively (Figure 14.6a). Conditions *within the gas phase* are of interest, and the concentration (or partial pressure) of species A in the gas phase at the interface (located at  $x = 0$ ) may readily be determined from *Raoult's law*,

$$p_A(0) = x_A(0)p_{A,\text{sat}} \quad (14.60)$$


where  $p_A$  is the partial pressure of A *in the gas phase*,  $x_A$  is the mole fraction of species A *in the liquid or solid*, and  $p_{A,\text{sat}}$  is the saturation pressure of species A at the surface temperature. Raoult's law applies if the gas phase can be approximated as ideal and the liquid or solid phase has a high concentration of species A. If the liquid or solid is a pure species A, that is,  $x_A = 1$ , Equation 14.60 simplifies to  $p_A(0) = p_{A,\text{sat}}$ . That is, the partial pressure of the vapor at the interface corresponds to saturated conditions at the temperature of the interface and may be determined from standard thermodynamic tables. This boundary condition was utilized in the solution of Example 14.2 and in Section 6.7.2.

### 14.5.2 Solubility of Gases in Liquids and Solids

Another common mass transfer problem is similar to the evaporation or sublimation problem, except mass transfer *within the liquid or solid phase* is of interest. We consider the transfer of species A *from* a gas stream *into* a liquid or solid, species B (Figure 14.6b).

If species A is only weakly soluble ( $x_A$  is small) in a *liquid*, *Henry's law* may be used to relate the mole fraction of A in the liquid to the partial pressure of A in the gas phase outside the liquid:

$$x_A(0) = \frac{p_A(0)}{H} \quad (14.61)$$

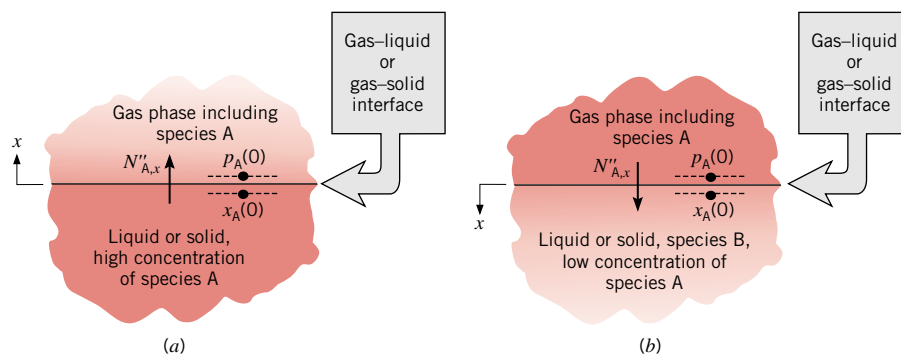

**FIGURE 14.6** Species concentration at a gas-liquid or gas-solid interface. (a) Evaporation or sublimation of species A from a liquid or solid into a gas. (b) Transfer of weakly soluble species A from the gas to a liquid or solid.



The coefficient  $H$  is known as *Henry's constant*, and values for selected aqueous solutions are listed in Table A.9. Although  $H$  depends on temperature, its pressure dependence may generally be neglected for values of  $p$  up to 5 bars.

Conditions at a *gas–solid* interface may also be determined if the gas, species A, dissolves in a solid, species B, and a solution is formed. In such cases mass transfer in the solid is independent of the structure of the solid and may be treated as a diffusion process. In contrast, there are many situations for which the porosity of the solid strongly influences gas transport through the solid. Treatment of such cases is left to more advanced texts [2, 4].

Treating the gas and solid as a solution, we can obtain the concentration of the gas in the solid at the interface through use of a property known as the *solubility*,  $S$ . It is defined by the expression

$$C_A(0) = Sp_A(0) \quad (14.62)$$

where  $p_A(0)$  is once again the partial pressure (bars) of the gas adjoining the interface. The molar concentration of A in the solid at the interface,  $C_A(0)$ , is in units of kilomoles of A per cubic meter of solid, in which case the units of  $S$  must be *kilomoles of A per cubic meter of solid per bar (or atm) partial pressure of A*. Values of  $S$  for several gas–solid combinations are given in Table A.10. Values of solubility are often presented in units of cubic meters of species A (at STP, Standard Temperature and Pressure, of 0°C and 1 atm) per cubic meter of solid per atm partial pressure of A. Denoting this solubility value as  $\tilde{S}$ , and recognizing that at STP one kilomole occupies 22.414 m<sup>3</sup>, we find that the unit conversion is given by  $S = \tilde{S}/(22.414 \text{ m}^3/\text{kmol})$ . (Additional conversion between bar and atm may be needed.)

#### EXAMPLE 14.4


Helium gas is stored at 20°C in a spherical container of fused silica (SiO<sub>2</sub>), which has a diameter of 0.20 m and a wall thickness of 2 mm. If the container is charged to an initial pressure of 4 bars, what is the rate at which this pressure decreases with time?

#### SOLUTION

**Known:** Initial pressure of helium in a spherical, fused silica container of prescribed diameter  $D$  and wall thickness  $L$ .

**Find:** The rate of change of the helium pressure,  $dp_A/dt$ .

**Schematic:**

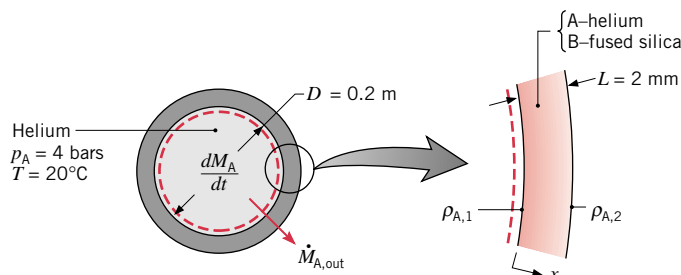

**Assumptions:**

1. Since  $D \gg L$ , diffusion may be approximated as being one-dimensional through a plane wall.
2. Quasisteady diffusion (pressure variation is sufficiently slow to permit assuming steady-state conditions for diffusion through the fused silica at any instant).
3. Stationary medium has uniform density  $\rho$ .
4. Pressure of helium in outside air is negligible.
5. Helium exhibits ideal gas behavior.

**Properties:** Table A.8, helium-fused silica (293 K):  $D_{AB} = 0.4 \times 10^{-13} \text{ m}^2/\text{s}$ . Table A.10, helium-fused silica (293 K):  $S = 0.45 \times 10^{-3} \text{ kmol/m}^3 \cdot \text{bar}$ .

**Analysis:** The rate of change of the helium pressure may be obtained by applying the species conservation requirement, Equation 14.43, to a control volume about the helium. It follows that

$$-\dot{M}_{A,\text{out}} = \dot{M}_{A,\text{st}}$$

or, since the helium outflow is due to diffusion through the fused silica,

$$\dot{M}_{A,\text{out}} = n''_{A,x} A$$

and the change in mass storage is

$$\dot{M}_{A,\text{st}} = \frac{dM_A}{dt} = \frac{d(\rho_A V)}{dt}$$

the species balance reduces to

$$-n''_{A,x} A = \frac{d(\rho_A V)}{dt}$$

Recognizing that  $\rho_A = \mathcal{M}_A C_A$  and applying the ideal gas law

$$C_A = \frac{P_A}{\mathcal{R}T}$$

the species balance becomes

$$\frac{dP_A}{dt} = -\frac{\mathcal{R}T}{\mathcal{M}_A V} A n''_{A,x}$$

For a stationary medium the absolute flux of species A through the fused silica is equal to the diffusion flux,  $n''_{A,x} = j_{A,x}$ , in which case, from Fick's law, Equation 14.12,

$$n''_{A,x} = -\rho D_{AB} \frac{dm_A}{dx} = -D_{AB} \frac{d\rho_A}{dx}$$

or, for the assumed conditions,

$$n''_{A,x} = D_{AB} \frac{\rho_{A,1} - \rho_{A,2}}{L}$$

The species densities  $\rho_{A,1}$  and  $\rho_{A,2}$  pertain to conditions *within* the fused silica at its inner and outer surfaces, respectively, and may be evaluated from knowledge of the solubility through Equation 14.62. Hence with  $\rho_A = \mathcal{M}_A C_A$ ,

$$\rho_{A,1} = \mathcal{M}_A S p_{A,i} = \mathcal{M}_A S p_A \quad \text{and} \quad \rho_{A,2} = \mathcal{M}_A S p_{A,o} = 0$$

where  $p_{A,i}$  and  $p_{A,o}$  are helium pressures at the inner and outer surfaces, respectively. Hence

$$n''_{A,x} = \frac{D_{AB} \mathcal{M}_A S p_A}{L}$$

and substituting into the species balance it follows that

$$\frac{dp_A}{dt} = -\frac{\mathcal{R} T D_{AB} S}{LV} p_A$$

or with  $A = \pi D^2$  and  $V = \pi D^3/6$

$$\frac{dp_A}{dt} = -\frac{6 \mathcal{R} T D_{AB} S}{LD} p_A$$

Substituting numerical values, the rate of change of the pressure is

$$\begin{aligned} \frac{dp_A}{dt} &= [-6(0.08314 \text{ m}^3 \cdot \text{bar/kmol} \cdot \text{K}) 293 \text{ K} (0.4 \times 10^{-13} \text{ m}^2/\text{s}) \\ &\quad \times 0.45 \times 10^{-3} \text{ kmol/m}^3 \cdot \text{bar} \times 4 \text{ bar}] \div [0.002 \text{ m} (0.2 \text{ m})] \\ \frac{dp_A}{dt} &= -2.63 \times 10^{-8} \text{ bar/s} \end{aligned}$$

**Comments:** The foregoing result provides the initial (maximum) leakage rate for the system. The leakage rate decreases as the inside pressure decreases. ◁

### EXAMPLE 14.5


Hydrogen gas is maintained at 3 bars and 1 bar on opposite sides of a plastic membrane, which is 0.3 mm thick. The temperature is 25°C, and the binary diffusion coefficient of hydrogen in the plastic is  $8.7 \times 10^{-8} \text{ m}^2/\text{s}$ . The solubility of hydrogen in the membrane is  $1.5 \times 10^{-3} \text{ kmol/m}^3 \cdot \text{bar}$ . What is the mass diffusive flux of hydrogen through the membrane?

### SOLUTION

**Known:** Pressure of hydrogen on opposite sides of a membrane.

**Find:** The hydrogen mass diffusive flux  $n''_{A,x}$  ( $\text{kg/s} \cdot \text{m}^2$ ).

**Schematic:**

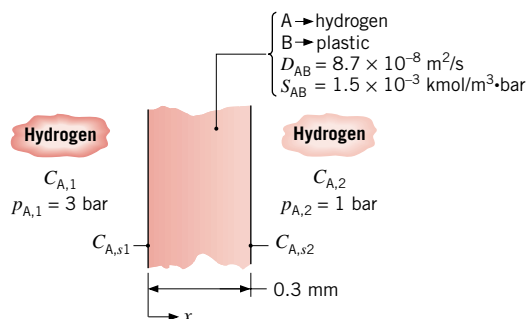

**Assumptions:**

1. Steady-state, one-dimensional conditions exist.
2. Membrane is a stationary, nonreacting medium of uniform total molar concentration.

**Analysis:** For the prescribed conditions, Equation 14.42 reduces to Equation 14.53, which may be expressed as

$$N''_{A,x} = CD_{AB} \frac{x_{A,s1} - x_{A,s2}}{L} = \frac{D_{AB}}{L} (C_{A,s1} - C_{A,s2})$$

The surface molar concentrations of hydrogen may be obtained from Equation 14.62, where

$$C_{A,s1} = 1.5 \times 10^{-3} \text{ kmol/m}^3 \cdot \text{bar} \times 3 \text{ bars} = 4.5 \times 10^{-3} \text{ kmol/m}^3$$

$$C_{A,s2} = 1.5 \times 10^{-3} \text{ kmol/m}^3 \cdot \text{bar} \times 1 \text{ bar} = 1.5 \times 10^{-3} \text{ kmol/m}^3$$

Hence

$$N''_{A,x} = \frac{8.7 \times 10^{-8} \text{ m}^2/\text{s}}{0.3 \times 10^{-3} \text{ m}} (4.5 \times 10^{-3} - 1.5 \times 10^{-3}) \text{ kmol/m}^3$$

$$N''_{A,x} = 8.7 \times 10^{-7} \text{ kmol/s} \cdot \text{m}^2$$

On a mass basis,

$$n''_{A,x} = N''_{A,x} \mathcal{M}_A$$

where the molecular weight of hydrogen is 2 kg/kmol. Hence

$$n''_{A,x} = 8.7 \times 10^{-7} \text{ kmol/s} \cdot \text{m}^2 \times 2 \text{ kg/kmol} = 1.74 \times 10^{-6} \text{ kg/s} \cdot \text{m}^2 \quad \triangleleft$$


**Comments:** The molar concentrations of hydrogen in the gas phase,  $C_{A,1}$  and  $C_{A,2}$ , differ from the surface concentrations in the membrane and may be calculated from the ideal gas equation of state

$$C_A = \frac{p_A}{\mathcal{R}T}$$

where  $\mathcal{R} = 8.314 \times 10^{-2} \text{ m}^3 \cdot \text{bar/kmol} \cdot \text{K}$ . It follows that  $C_{A,1} = 0.121 \text{ kmol/m}^3$  and  $C_{A,2} = 0.040 \text{ kmol/m}^3$ . Even though  $C_{A,s2} < C_{A,2}$ , hydrogen transport will occur from the membrane to the gas at  $p_{A,2} = 1 \text{ bar}$ . This seemingly anomalous result may be explained by recognizing that the two concentrations are based on *different* volumes; in one case the concentration is per unit volume of the membrane and in the other case it is per unit volume of the adjoining gas phase. For this reason it is not possible to infer the direction of hydrogen transport from a simple comparison of the numerical values of  $C_{A,s2}$  and  $C_{A,2}$ .

### 14.5.3 Catalytic Surface Reactions

Many mass transfer problems involve specification of the species flux, rather than the species concentration, at a surface. One such problem relates to the process of catalysis, which involves the use of special surfaces to promote *heterogeneous*

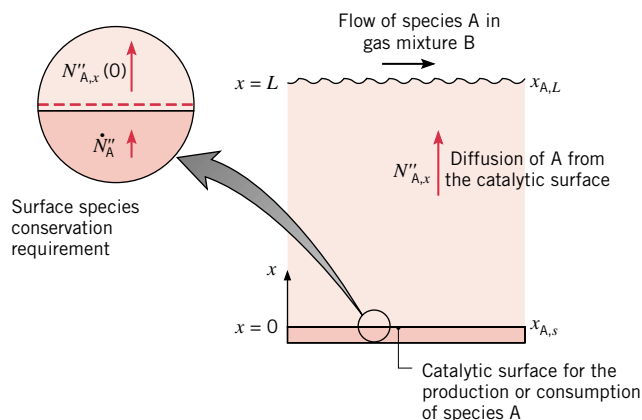

**FIGURE 14.7** One-dimensional diffusion with heterogeneous catalysis.

*chemical reactions.* A heterogeneous chemical reaction occurs at the surface of a material, can be viewed as a *surface phenomenon*, and can be treated as a boundary condition.<sup>6</sup> Often a one-dimensional diffusion analysis may be used to *approximate* the performance of a catalytic reactor.

Consider the system of Figure 14.7. A catalytic surface is placed in a gas stream to promote a heterogeneous chemical reaction involving species A. Assume that the reaction produces species A at a rate  $\dot{N}''_A$ , which is defined as the molar rate of production per unit surface area of the catalyst. Once steady-state conditions are reached, the rate of species transfer from the surface,  $N''_{A,x}$ , must equal the surface reaction rate:

$$N''_{A,x}(0) = \dot{N}''_A \quad (14.63)$$

It is also assumed that species A leaves the surface as a result of one-dimensional transfer through a thin film of thickness  $L$  and that no reactions occur within the film itself. Although bulk motion influences transfer of A through the film, it is reasonable to assume, as a first estimate, that the effect is negligible and that transfer occurs exclusively by diffusion. The mole fraction of A at  $x = L$ ,  $x_{A,L}$ , corresponds to conditions in the mainstream of the mixture and is presumed to be known. Representing the remaining species of the mixture as a single species B and assuming the medium to be stationary, Equation 14.48a reduces to

$$\frac{d}{dx} \left( CD_{AB} \frac{dx_A}{dx} \right) = 0 \quad (14.64)$$

where  $D_{AB}$  is the binary diffusion coefficient for A in B and B may be a multicomponent mixture. Assuming  $C$  and  $D_{AB}$  to be constant, Equation 14.64 may be solved subject to the conditions that

$$x_A(L) = x_{A,L}$$

<sup>6</sup>The generation terms that appear in Equations 14.47 through 14.50 are due to chemical reactions that occur *volumetrically*. These volumetric reactions are referred to as *homogeneous chemical reactions* and will be treated in Section 14.6.

and

$$N''_{A,x}(0) = -CD_{AB} \left. \frac{dx_A}{dx} \right|_{x=0} = \dot{N}''_A \quad (14.65)$$

This expression follows from Equation 14.63 and the substitution of Fick's law, Equation 14.42.

For a catalytic surface, the surface reaction rate  $\dot{N}''_A$  generally depends on the surface concentration  $C_A(0)$ . For a *first-order reaction* that results in species consumption at the surface, the reaction rate is of the form

$$\dot{N}''_A = -k''_1 C_A(0) \quad (14.66)$$

where  $k''_1$  (m/s) is the reaction rate constant. Accordingly, the surface boundary condition, Equation 14.65, reduces to

$$-D_{AB} \left. \frac{dx_A}{dx} \right|_{x=0} = -k''_1 x_A(0) \quad (14.67)$$

Solving Equation 14.64 subject to the above conditions, it is readily verified that the concentration distribution is linear and of the form

$$\frac{x_A(x)}{x_{A,L}} = \frac{1 + (xk''_1/D_{AB})}{1 + (Lk''_1/D_{AB})} \quad (14.68)$$

At the catalytic surface this result reduces to

$$\frac{x_A(0)}{x_{A,L}} = \frac{1}{1 + (Lk''_1/D_{AB})} \quad (14.69)$$

and the molar flux is

$$N''_A(0) = -CD_{AB} \left. \frac{dx_A}{dx} \right|_{x=0} = -k''_1 C x_A(0)$$

or

$$N''_A(0) = -\frac{k''_1 C x_{A,L}}{1 + (Lk''_1/D_{AB})} \quad (14.70)$$

The negative sign implies mass transfer *to* the surface.

Two limiting cases of the foregoing results are of special interest. For the limit  $k''_1 \rightarrow 0$ ,  $(Lk''_1/D_{AB}) \ll 1$  and Equations 14.69 and 14.70 reduce to

$$\frac{x_{A,s}}{x_{A,L}} \approx 1 \quad \text{and} \quad N''_A(0) \approx -k''_1 C x_{A,L}$$

In such cases the rate of reaction is controlled by the reaction rate constant, and the limitation due to diffusion is negligible. The process is said to be *reaction limited*. Conversely, for the limit  $k''_1 \rightarrow \infty$ ,  $(Lk''_1/D_{AB}) \gg 1$  and Equations 14.69 and 14.70 reduce to

$$x_{A,s} \approx 0 \quad \text{and} \quad N''_A(0) \approx -\frac{CD_{AB} x_{A,L}}{L}$$

In this case the reaction is controlled by the rate of diffusion to the surface, and the process is said to be *diffusion limited*.

## 14.6

### Mass Diffusion with Homogeneous Chemical Reactions

Just as heat diffusion may be influenced by internal sources of energy, species transfer by diffusion may be influenced by homogeneous chemical reactions. We restrict our attention to stationary media, in which case Equation 14.41 or 14.42 determines the absolute species flux. If we also assume steady, one-dimensional transfer in the  $x$  direction and that  $D_{AB}$  and  $C$  are constant, Equation 14.48b reduces to

$$D_{AB} \frac{d^2 C_A}{dx^2} + \dot{N}_A = 0 \quad (14.71)$$

The volumetric production rate,  $\dot{N}_A$ , is often described using one of the following forms.

#### Zero-Order Reaction:

$$\dot{N}_A = k_0$$

#### First-Order Reaction:

$$\dot{N}_A = k_1 C_A$$

That is, the reaction may occur at a constant rate (zero order) or at a rate that is proportional to the local concentration (first order). The units of  $k_0$  and  $k_1$  are  $\text{kmol/s} \cdot \text{m}^3$  and  $\text{s}^{-1}$ , respectively. If  $\dot{N}_A$  is positive, the reaction results in the generation of species A; if it is negative, it results in the consumption of A.

In many applications the species of interest is converted to another form through a first-order chemical reaction, and Equation 14.71 becomes

$$D_{AB} \frac{d^2 C_A}{dx^2} - k_1 C_A = 0 \quad (14.72)$$

This linear, homogeneous differential equation has the general solution


$$C_A(x) = C_1 e^{mx} + C_2 e^{-mx} \quad (14.73)$$

where  $m = (k_1/D_{AB})^{1/2}$  and the constants  $C_1$  and  $C_2$  depend on the prescribed boundary conditions. The form of this equation is identical to that characterizing heat conduction in an extended surface, Equation 3.66.

Consider the situation illustrated in Figure 14.8. Gas A is soluble in liquid B, where it is transferred by diffusion and experiences a first-order chemical reaction. The solution is dilute, and the concentration of A in the liquid at the interface is a known constant  $C_{A,0}$ . If the bottom of the container is impermeable to A, the boundary conditions are

$$C_A(0) = C_{A,0} \quad \text{and} \quad \left. \frac{dC_A}{dx} \right|_{x=L} = 0$$

These species boundary conditions are analogous to the thermal boundary conditions of case B in Table 3.4. Since Equation 14.73 is of the same form as Equation 3.66, it follows that

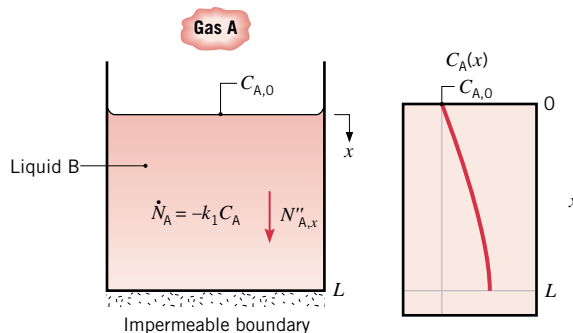

**FIGURE 14.8**  
Diffusion and homogeneous reaction of gas A in liquid B.

$$C_A(x) = C_{A,0} \frac{\cosh m(L-x)}{\cosh mL} \quad (14.74)$$

Quantities of special interest are the concentration of A at the bottom and the flux of A across the gas–liquid interface. Applying Equation 14.74 at  $x = L$ , we obtain

$$C_A(L) = \frac{C_{A,0}}{\cosh mL} \quad (14.75)$$

Moreover,

$$\begin{aligned} N''_{A,x}(0) &= -D_{AB} \left. \frac{dC_A}{dx} \right|_{x=0} \\ &= D_{AB} C_{A,0} m \left. \frac{\sinh m(L-x)}{\cosh mL} \right|_{x=0} \end{aligned}$$

or

$$N''_{A,x}(0) = D_{AB} C_{A,0} m \tanh mL \quad (14.76)$$

Results for a container with its bottom held at a fixed concentration or an infinitely deep container may be obtained by analogy to cases C and D, respectively, of Table 3.4.

### EXAMPLE 14.6

Biofilms, which are colonies of bacteria that can cling to living or inert surfaces, can cause a wide array of human infections. Infections caused by bacteria living within biofilms are often chronic because antibiotics that are applied to the surface of a biofilm have difficulty penetrating through the film thickness. Consider a biofilm that is associated with a skin infection. An antibiotic (species A) is applied to the top layer of a biofilm (species B) so that a fixed concentration of medication,  $C_{A,0} = 4 \times 10^{-3} \text{ kmol/m}^3$ , exists at the upper surface of the biofilm. The diffusion coefficient of the medication within the biofilm is  $D_{AB} = 2 \times 10^{-12} \text{ m}^2/\text{s}$ . The antibiotic is consumed by biochemical reactions within the film, and the consumption rate depends on the local concentration of medication expressed as  $\dot{N}_A = -k_1 C_A$  where  $k_1 = 0.1 \text{ s}^{-1}$ . To eradicate the bacteria, the antibiotic must be consumed at a rate of at least  $0.2 \times 10^{-3} \text{ kmol/s} \cdot \text{m}^3$  ( $\dot{N}_A \leq -0.2 \times 10^{-3} \text{ kmol/s} \cdot \text{m}^3$ ) since, at smaller absolute consumption rates, the bacteria will be able to grow back faster than it is destroyed. Determine the maximum thickness of a biofilm,  $L$ , that may be treated successfully by the antibiotic.




### SOLUTION

**Known:** Topical antibiotic and biofilm properties, surface concentration of the medication, and required minimum consumption rate of antibiotic.

**Find:** Maximum thickness of a bacteria-laden biofilm,  $L$ , that may be successfully treated.

**Schematic:**

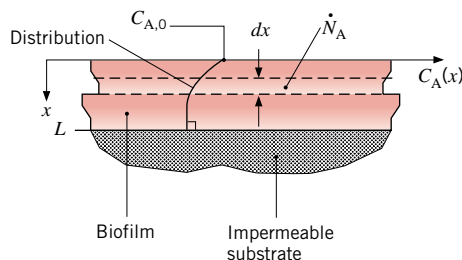

**Assumptions:**

1. Steady-state, one-dimensional conditions.
2. Stationary, homogeneous medium.
3. Constant properties.
4. Impermeable bottom of the biofilm.

**Analysis:** The absolute antibiotic consumption rate will be smallest at  $x = L$ , where the antibiotic concentration is smallest. Thus, we require  $\dot{N}_A(L) = -0.2 \times 10^{-3} \text{ kmol/s} \cdot \text{m}^3$ . The expression for the first-order reaction may be combined with Equation 14.74 to write

$$\dot{N}_A(L) = -k_1 C_A(L) = -k_1 \frac{C_{A,0}}{\cosh mL} \quad (1)$$

where

$$m = (k_1/D_{AB})^{1/2} = \left( \frac{0.1 \text{ s}^{-1}}{2 \times 10^{-12} \text{ m}^2/\text{s}} \right)^{1/2} = 2.24 \times 10^5 \text{ m}^{-1}$$

Equation 1 may be solved for the maximum allowable thickness:

$$L = m^{-1} \cosh^{-1}[-k_1 C_{A,0}/\dot{N}_A(L)] \quad (2)$$

Substituting values into Equation 2 yields

$$\begin{aligned} L &= (2.24 \times 10^5 \text{ m}^{-1})^{-1} \cosh^{-1}[-0.1 \text{ s}^{-1} \times 4 \times 10^{-3} \text{ kmol/m}^3 / \\ &\quad (-0.2 \times 10^{-3} \text{ kmol/s} \cdot \text{m}^3)] \\ &= 5.9 \times 10^{-6} \text{ m} = 5.9 \text{ } \mu\text{m} \end{aligned}$$

◁

**Comment:** The ability of the antibiotic agent to kill bacteria in thicker biofilms is hampered by the high rate at which the agent is consumed and the slow rate at which it can be diffused through the complex, polymeric matrix of the biofilm [6].

## 14.7

### Transient Diffusion

Results analogous to those of Chapter 5 may be obtained for the transient diffusion of a dilute species A in a stationary medium. Assuming no homogeneous reactions, constant  $D_{AB}$  and  $C$ , and one-dimensional transfer in the  $x$  direction, Equation 14.48b reduces to

$$D_{AB} \frac{\partial^2 C_A}{\partial x^2} = \frac{\partial C_A}{\partial t} \quad (14.77)$$

Assuming an initial uniform concentration,

$$C_A(x, 0) = C_{A,i} \quad (14.78)$$

Equation 14.77 may be solved for boundary conditions that depend on the particular geometry and surface conditions. If, for example, the geometry is a plane wall of thickness  $2L$  with surface convection, the boundary conditions are

$$\left. \frac{\partial C_A}{\partial x} \right|_{x=0} = 0 \quad (14.79)$$

$$C_A(L, t) = C_{A,s} \quad (14.80)$$

Equation 14.79 describes the symmetry requirement at the midplane. Equation 14.80 represents the surface convection condition if the *mass transfer Biot number*,  $Bi_m = h_m L / D_{AB}$ , is much larger than unity. In this case the resistance to species transfer by diffusion in the medium is much larger than the resistance to species transfer by convection at the surface. If this situation is taken to the limit of  $Bi_m \rightarrow \infty$ , or  $Bi_m^{-1} \rightarrow 0$ , it follows that the species concentration in the fluid is essentially uniform, equal to the free stream species concentration. Then  $C_{A,s}$ , the species concentration in the medium at its surface, can be found from Equation 14.60 or 14.61, where  $p_A$  is the free stream partial pressure of species A.

The analogy between heat and mass transfer may conveniently be applied if we nondimensionalize the above equations. Introducing a dimensionless concentration and time, as follows,

$$\gamma^* \equiv \frac{\gamma}{\gamma_i} = \frac{C_A - C_{A,s}}{C_{A,i} - C_{A,s}} \quad (14.81)$$

$$t_m^* \equiv \frac{D_{AB} t}{L^2} \equiv Fo_m \quad (14.82)$$

and substituting into Equation 14.77, we obtain

$$\frac{\partial^2 \gamma^*}{\partial x^{*2}} = \frac{\partial \gamma^*}{\partial Fo_m} \quad (14.83)$$

where  $x^* = x/L$ . Similarly, the initial and boundary conditions are

$$\gamma^*(x^*, 0) = 1 \quad (14.84)$$

$$\left. \frac{\partial \gamma^*}{\partial x^*} \right|_{x^*=0} = 0 \quad (14.85)$$

and

$$\gamma^*(1, t_m^*) = 0 \quad (14.86)$$

One need only compare Equations 14.83 through 14.86 with Equations 5.34 through 5.36 and Equation 5.37 for the case of  $Bi \rightarrow \infty$  to confirm the existence of the analogy. Note that for  $Bi \rightarrow \infty$ , Equation 5.37 reduces to  $\theta^*(1, t^*) = 0$ , which is analogous to Equation 14.86. Hence the two systems of equations must have equivalent solutions.

The correspondence between variables for transient heat and mass diffusion is summarized in Table 14.2. From this correspondence it is possible to use many of the previous heat transfer results to solve transient mass diffusion problems. For example, replacing  $\theta_o^*$  and  $Fo$  by  $\gamma_o^*$  and  $Fo_m$ , Equation 5.41 could be used, with  $Bi \rightarrow \infty$  ( $\zeta_1 = 1.5707$ ;  $C_1 = 1.2733$ ), to determine the midplane concentration  $C_{A,o}$ . The remaining equations may be applied in a similar fashion, along with results obtained for the semi-infinite solid.

The results of Sections 5.5 and 5.6 should be used with care because, as illustrated in Example 14.1 and in Table A.8, the mass diffusivities associated with many liquid and solid host media are extremely small relative to their thermal diffusivities. Therefore, values of the mass transfer Fourier number,  $Fo_m$ , are usually many orders of magnitude smaller than the values of the heat transfer Fourier number,  $Fo$ . Hence, the *approximate solutions* of Sections 5.5.2 and 5.6.2 are often of little value in analyzing mass transfer within stationary media, since the approximate solutions are valid only for  $Fo_m > 0.2$ . Recourse to solution of the *exact expressions* of Sections 5.5.1 and 5.6.1 may be required. The infinite series solutions of Equations 5.39, 5.47, and 5.48 may necessitate evaluation of many terms before convergence is obtained. The semi-infinite solid solutions of Section 5.7, on the other hand, are often applicable in mass transfer problems because of the slow diffusion rates of boundary condition information into the host medium. The approximate results of Section 5.8 are also applicable, since results are presented over the entire Fourier number range.

**TABLE 14.2** Correspondence Between Heat and Mass Transfer Variables for Transient Diffusion

Heat Transfer	Mass Transfer
$\theta^* = \frac{T - T_\infty}{T_i - T_\infty}$	$\gamma^* = \frac{C_A - C_{A,s}}{C_{A,i} - C_{A,s}}$
$1 - \theta^* = \frac{T - T_i}{T_\infty - T_i}$	$1 - \gamma^* = \frac{C_A - C_{A,i}}{C_{A,s} - C_{A,i}}$
$ Fo = \frac{\alpha t}{L^2}$	$ Fo_m = \frac{D_{AB} t}{L^2}$
$ Bi = \frac{hL}{k}$	$ Bi_m = \frac{h_m L}{D_{AB}}$
$\frac{x}{2\sqrt{\alpha t}}$	$\frac{x}{2\sqrt{D_{AB} t}}$

### EXAMPLE 14.7

Transdermal drug delivery involves the controlled time-release of medication through the skin to the bloodstream, usually from a *patch* that is adhered to the body. Advantages include steady and mild drug delivery rates that reduce shock to the system as might occur with intravenous infusions, the ability to deliver medication to nauseated or unconscious patients that would be otherwise delivered in oral form, and ease of use.

Consider a square patch of length and width  $L = 50$  mm that consists of a host medium containing an initial, uniform density of medication,  $\rho_{A,p,i} = 100$  kg/m<sup>3</sup>. The patch is applied to the skin, which contains an initial drug concentration of  $\rho_{A,s,i} = 0$ . At the patch–skin interface located at  $x = 0$ , the ratio of the medication density on the patch side to the medication density on the patient side is described by a *partition coefficient* of  $K = 0.5$ .


1. Determine the total amount of medication (dosage) delivered to the patient over a treatment period of one week. Nominal values of the diffusion coefficients of the medication within the patch and skin are  $D_{Ap} = 0.1 \times 10^{-12}$  m<sup>2</sup>/s and  $D_{As} = 0.2 \times 10^{-12}$  m<sup>2</sup>/s, respectively.
2. Investigate the sensitivity of the total dosage delivered to the patient to the mass diffusivity of the patch,  $D_{Ap}$ , and the mass diffusivity of the patient's skin,  $D_{As}$ .

### SOLUTION

**Known:** Initial densities of a drug within a transdermal patch, size of the patch, partition coefficient, and mass diffusivities.

**Find:** Total dosage of medicine delivered to the patient over a one-week time period, sensitivity of the dosage to the mass diffusivity of the patch and skin.

**Schematic:**

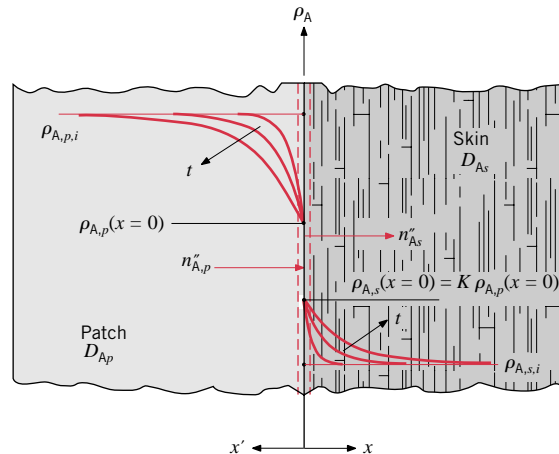

**Assumptions:**

1. One-dimensional conditions with constant properties.
2. Semi-infinite patch and skin.
3. No chemical reactions.
4. Stationary media.

**Analysis:**

1. The conservation of species equation applies to both the patch and skin. With the foregoing assumptions, Equation 14.47b becomes

$$\frac{\partial^2 \rho_A}{\partial x^2} = \frac{1}{D_{AB}} \frac{\partial \rho_A}{\partial t}$$

which is analogous to Equation 5.26. Moreover, the initial conditions

$$\rho_A(x < 0, t = 0) = \rho_{A,p,i}; \quad \rho_A(x > 0, t = 0) = \rho_{A,s,i}$$

boundary conditions

$$\rho_{A,p}(x \rightarrow -\infty) = \rho_{A,p,i}; \quad \rho_{A,s}(x \rightarrow +\infty) = \rho_{A,s,i} \quad (1a)$$

and interface condition

$$n''_{A,x,p}(x = 0) = n''_{A,x,s}(x = 0) \quad (1b)$$

are analogous to the situation in Figure 5.9 and Equation 5.61 where two semi-infinite solids are brought into thermal contact. In this problem, the partitioning of the species must also be accounted for. That is,

$$\rho_{A,s}(x = 0) = K \cdot \rho_{A,p}(x = 0) \quad (1c)$$

By analogy to Equation 5.62, we have

$$\frac{-D_{Ap}(\rho_{A,p}(x = 0) - \rho_{A,p,i})}{\sqrt{\pi D_{Ap} t}} = \frac{D_{As}(\rho_{A,s}(x = 0) - \rho_{A,s,i})}{\sqrt{\pi D_{As} t}}$$

which, after noting that  $\rho_{A,s,i} = 0$ , may be solved to yield

$$\rho_{A,s}(x = 0) = \rho_{A,p,i} \left( \frac{\sqrt{D_{Ap}}}{\sqrt{D_{As}} + \sqrt{D_{Ap}/K}} \right) \quad (2)$$

The instantaneous flux of medication to the patient may be determined by noting the analogy with Equation 5.58:

$$n''_A(x = 0, t) = \frac{D_{As} \rho_{A,s}(x = 0)}{\sqrt{\pi D_{As} t}} \quad (3)$$

Substituting Equation 2 into Equation 3 yields

$$n''_A(x = 0, t) = \frac{\rho_{A,p,i}}{\sqrt{\pi t}} \cdot \frac{\sqrt{D_{As} D_{Ap}}}{\sqrt{D_{As}} + \sqrt{D_{Ap}/K}}$$

The dosage,  $D$ , delivered to the patient from  $t = 0$  to a treatment time of  $t_i$  may be expressed as


$$\begin{aligned} D &= L^2 \int_{t=0}^{t_i} n''_A(x = 0, t) dt \\ D &= \frac{\rho_{A,p,i} L^2}{\sqrt{\pi}} \cdot \frac{\sqrt{D_{As} D_{Ap}}}{\sqrt{D_{As}} + \sqrt{D_{Ap}/K}} \int_{t=0}^{t_i} t^{-1/2} dt \\ &= \frac{2 \rho_{A,p,i} L^2}{\sqrt{\pi}} \cdot \frac{\sqrt{D_{As} D_{Ap}}}{\sqrt{D_{As}} + \sqrt{D_{Ap}/K}} \sqrt{t_i} \end{aligned} \quad (4)$$

For a total treatment time of  $t_i = 7 \text{ days} \times 24 \text{ h/day} \times 3600 \text{ s/h} = 605 \times 10^3 \text{ s}$ , the dosage is

$$D = \frac{2 \times 100 \text{ kg/m}^3 \times (50 \times 10^{-3} \text{ m})^2}{\sqrt{\pi}} \times \frac{\sqrt{0.2 \times 10^{-12} \text{ m}^2/\text{s} \times 0.1 \times 10^{-12} \text{ m}^2/\text{s}}}{\sqrt{0.2 \times 10^{-12} \text{ m}^2/\text{s}} + \sqrt{0.1 \times 10^{-12} \text{ m}^2/\text{s}/0.5}} \sqrt{605 \times 10^3 \text{ s}}$$

$$= 29 \times 10^{-6} \text{ kg} = 29 \text{ mg}$$

2. The sensitivity of the dosage to the patch and skin mass diffusivities may be evaluated by solving Equation 4 for different combinations of  $D_{Ap}$  and  $D_{As}$ . Results are shown in the following graphs for  $D_{Ap} = 0.1 \times 10^{-12} \text{ m}^2/\text{s}$  and  $0.01 \times 10^{-12} \text{ m}^2/\text{s}$  and for  $D_{As} = 0.1 \times 10^{-12} \text{ m}^2/\text{s}$ ,  $0.2 \times 10^{-12} \text{ m}^2/\text{s}$ , and  $0.4 \times 10^{-12} \text{ m}^2/\text{s}$ . Note that as either mass diffusivity is increased, the dosage increases.

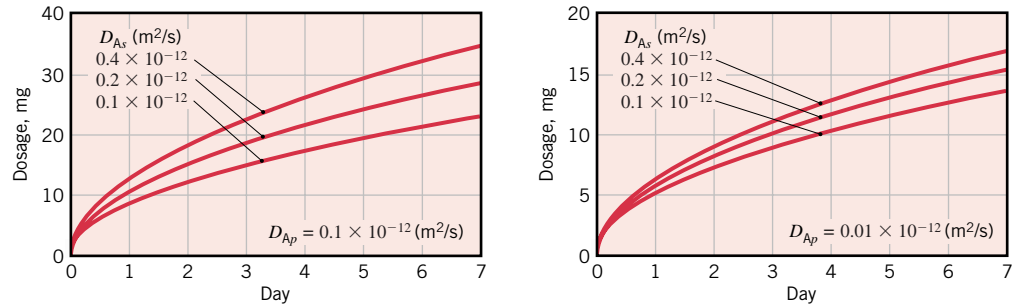

### Comments:

1. The function of the outer layer of the skin, the *epidermis*, is to protect the body from external contamination. Transdermal drug delivery is feasible only for medications characterized by extremely small molecules that can diffuse through the relatively impenetrable epidermis. Mass transfer considerations restrict the number of drugs that can be delivered transdermally. The skin diffusivity is variable from location to location on the body, and the patient is instructed where to apply the patch.
2. It is desirable to desensitize the dosage to variations in the skin diffusivity, since this parameter varies from patient to patient. Therefore, the host medium of the patch (called the *vehicle*) is designed so that it is the rate-limiting factor in controlling the dosage. The sensitivity of the dosage to the patient's skin diffusivity is reduced by decreasing the mass diffusivity in the vehicle, as evident by comparing the results of part 2 of the problem. In general, it is desirable to design the vehicle so that  $D_{Ap}/D_{As} \ll 1$ .
3. The patch is designed to deliver medication as though it is a semi-infinite medium. The required patch thickness for this assumption to be valid may be estimated by calculating the location where the density of the medication in the vehicle is reduced to 95% of the difference between  $\rho_{A,p,i}$  and  $\rho_{A,p}(x=0)$  over the treatment time. By analogy to Equation 5.57, the *species penetration depth*,  $x_s$ , associated with 5% depletion of the drug may be determined from

$$\frac{\rho_{A,p}(x') - \rho_{A,p}(x' = 0)}{\rho_{A,p,i} - \rho_{A,p}(x' = 0)} = 0.95 = \text{erf} \frac{x_s}{\sqrt{4D_{Ap}t_i}}$$

Evaluating this expression yields a species penetration depth of  $690 \times 10^{-6} \text{ m} = 0.69 \text{ mm}$ . The assumption of a semi-infinite patch is valid for a vehicle thickness greater than 0.69 mm.

4. If the vehicle is much thinner than the species penetration depth calculated in Comment 3, the actual dosage will fall below the desired dosage prior to the end of the one-week treatment period. Therefore, a tradeoff in the design of the patch involves (a) loading enough medication to assure semi-infinite behavior and (b) minimizing the cost of the patch. In practice, more than 95% of the medication remains in the vehicle after the treatment period, necessitating careful disposal of the patch after its use.

## 14.8

### Summary

In this chapter we focused on the analysis of species transfer by diffusion. Although transfer rates are generally small, particularly in liquids and solids, the process is germane to many technologies, as well as to the environmental and life sciences. You should test your understanding of fundamental issues by addressing the following questions.

- If a cube of sugar is placed in a cup of coffee, what is the driving potential for dispersion of the sugar in the coffee? What is the physical mechanism responsible for dispersion if the coffee is stagnant? What is the physical mechanism if the coffee is stirred?
- What is the relationship between the molar concentration and the mass density of a species in a mixture?
- How is the mass density of a mixture defined? The molar concentration of the mixture?
- In using *Fick's law* to determine the mass or molar flux of a species in a mixture, what specifically is being determined?
- Under what conditions does the species diffusion flux equal the absolute flux associated with transport of the species?
- What is the stationary medium approximation?
- Is the species flux  $N_A''$  independent of location for a stationary medium within which there is species transfer by diffusion and production (or consumption) by a homogeneous chemical reaction?
- Under what conditions may a diffusion resistance be used to determine the species flux from knowledge of the species concentrations at the inner and outer surfaces of a medium?
- In heat transfer, equilibrium dictates equivalent temperatures on the gas and liquid (or solid) sides of an interface between the two phases. Can the same be said about the concentration of a chemical species present in the gas and liquid (or solid) phases?

- What is *Henry's constant*? How does the concentration of a chemical species in a liquid vary with the partial pressure of the species in an adjoining gas? How does the concentration vary with the temperature of the liquid?
- What is the difference between a *homogeneous* and a *heterogeneous chemical reaction*?
- In heterogeneous catalysis, what is implied if the process is said to be *reaction limited*? What is implied if the process is said to be *diffusion limited*?
- What is a *zero-order reaction*? A *first-order reaction*?
- If convection mass transfer is associated with gas flow over a liquid or solid in which the gas is transferred by diffusion, what can be said about the ratio of convection to diffusion resistances? How is the *mass transfer Biot number* defined?
- In a transient diffusion process, what can be said about the mass transfer Biot number?

## References

1. Bird, R. B., *Adv. Chem. Eng.*, **1**, 170, 1956.
2. Bird, R. B., W. E. Stewart, and E. N. Lightfoot, *Transport Phenomena*, 2nd ed. Wiley, New York, 2002.
3. Hirschfelder, J. O., C. F. Curtiss, and R. B. Bird, *Molecular Theory of Gases and Liquids*, Wiley, New York, 1964.
4. Skelland, A. H. P., *Diffusional Mass Transfer*, Krieger, Malabar, FL, 1985.
5. Poling, B. E., J. M. Prausnitz, and J. O'Connell, *The Properties of Gases and Liquids*, 5th ed., McGraw-Hill, New York, 2001.
6. Costerton, J. W., P. S. Stewart, and E. P. Greenberg, *Science*, **284**, 1318, 1999.

## Problems

### Mixture Composition

- 14.1 Assuming air to be composed exclusively of  $O_2$  and  $N_2$ , with their partial pressures in the ratio 0.21:0.79, what are their mass fractions?
- 14.2 A mixture of  $CO_2$  and  $N_2$  is in a container at  $25^\circ C$ , with each species having a partial pressure of 1 bar. Calculate the molar concentration, the mass density, the mole fraction, and the mass fraction of each species.
- 14.3 A He-Xe mixture containing 0.75 mole fraction of helium is used for cooling of electronics in an avionics application. At a temperature of 300 K and atmospheric pressure, calculate the mass fraction of helium and the mass density, molar concentration, and molecular weight of the mixture. If the cooling system capacity is 10 liters, what is the mass of the coolant?
- 14.4 Consider an ideal gas mixture of  $n$  species.
  - (a) Derive an equation for determining the mass fraction of species  $i$  from knowledge of the mole fraction and the molecular weight of each of the  $n$  species. Derive an equation for determining the mole fraction of species  $i$  from knowledge of the

mass fraction and the molecular weight of each of the  $n$  species.

- (b) In a mixture containing equal mole fractions of  $O_2$ ,  $N_2$ , and  $CO_2$ , what is the mass fraction of each species? In a mixture containing equal mass fractions of  $O_2$ ,  $N_2$ , and  $CO_2$ , what is the mole fraction of each species?

### Fick's Law and Mass Diffusivity

- 14.5 Consider air in a closed, cylindrical container with its axis vertical and with opposite ends maintained at different temperatures. Assume that the total pressure of the air is uniform throughout the container.
  - (a) If the bottom surface is colder than the top surface, what is the nature of conditions within the container? For example, will there be vertical gradients of the species ( $O_2$  and  $N_2$ ) concentrations? Is there any motion of the air? Does mass transfer occur?
  - (b) What is the nature of conditions within the container if it is inverted (i.e., the warm surface is now at the bottom)?



**14.6** Estimate values of the mass diffusivity  $D_{AB}$  for binary mixtures of the following gases at 350 K and 1 atm: ammonia–air and hydrogen–air.

**14.7** A 100-mm-long, hollow iron cylinder is exposed to a 1000°C carburizing gas (a mixture of CO and CO<sub>2</sub>) at its inner and outer surfaces of radii 4.30 and 5.70 mm, respectively. Consider steady-state conditions for which carbon diffuses from the inner surface of the iron wall to the outer surface and the total transport amounts to  $3.6 \times 10^{-3}$  kg of carbon over 100 hours. The variation of the carbon composition (weight % carbon) with radius is tabulated for selected radii.

$r$ (mm)	4.49	4.66	4.79	4.91	5.16	5.27	5.40	5.53
Wt.C (%)	1.42	1.32	1.20	1.09	0.82	0.65	0.46	0.28

(a) Beginning with Fick's law and the assumption of a constant diffusion coefficient,  $D_{C-Fe}$ , show that  $d\rho_C/d(\ln r)$  is a constant. Sketch the carbon mass density,  $\rho_C(r)$ , as a function of  $\ln r$  for such a diffusion process.

(b) The foregoing table corresponds to measured distributions of the carbon mass density. Is  $D_{C-Fe}$  a constant for this diffusion process? If not, does  $D_{C-Fe}$  increase or decrease with an increasing carbon concentration?

(c) Using the experimental data, calculate and tabulate  $D_{C-Fe}$  for selected carbon compositions.

**14.8** An old-fashioned glass apothecary jar contains a patent medicine. The neck is closed with a rubber stopper that is 20 mm tall, with a diameter of 10 mm at the bottom end, widening to 20 mm at the top end. The molar concentration of medicine vapor in the stopper is  $2 \times 10^{-3}$  kmol/m<sup>3</sup> at the bottom surface and is negligible at the top surface. If the mass diffusivity of medicine vapor in rubber is  $0.2 \times 10^{-9}$  m<sup>2</sup>/s, find the rate (kmol/s) at which vapor exits through the stopper.


### Nonstationary Media: Column Evaporation

**14.9** Consider the evaporation of liquid A into a column containing a binary gas mixture of A and B. Species B cannot be absorbed in liquid A and the boundary conditions are the same as in Section 14.2.2. Show how the ratio of the molar-average velocity to the species velocity of A,  $v_x^*/v_{A,x}$ , varies with the mole fraction of species A.

**14.10** An open pan of diameter 0.2 m and height 80 mm (above water at 27°C) is exposed to ambient air at 27°C and 25% relative humidity. Determine the evaporation rate, assuming that only mass diffusion occurs. Determine the evaporation rate, considering bulk motion.


**14.11** A spherical droplet of liquid A and radius  $r_o$  evaporates into a stagnant layer of gas B. Derive an expression for the evaporation rate of species A in terms of the saturation pressure of species A,  $p_A(r_o) = p_{A,sat}$ , the partial pressure of species A at an arbitrary radius  $r$ ,  $p_A(r)$ , the total pressure  $p$ , and other pertinent quantities. Assume the droplet and the mixture are at a uniform pressure  $p$  and temperature  $T$ .

**14.12** The presence of a small amount of air may cause a significant reduction in the heat rate to a water-cooled steam condenser surface. For a clean surface with pure steam and the prescribed conditions, the condensate rate is 0.020 kg/m<sup>2</sup> · s. With the presence of stagnant air in the steam, the condensate surface temperature drops from 28 to 24°C and the condensate rate is reduced by a factor of 2.

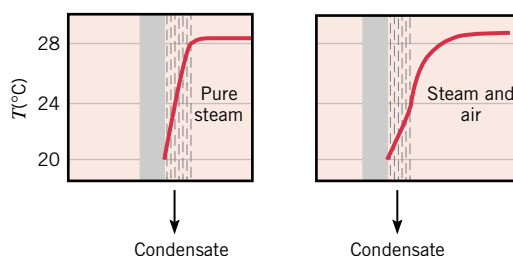

For the air–steam mixture, determine the partial pressure of air as a function of distance from the condensate film.

**14.13** A laboratory apparatus to measure the diffusion coefficient of vapor–gas mixtures consists of a vertical, small-diameter column containing the liquid phase that evaporates into the gas flowing over the mouth of the column. The gas flow rate is sufficient to maintain a negligible vapor concentration at the exit plane. The column is 150 mm high, and the pressure and temperature in the chamber are maintained at 0.25 atm and 320 K, respectively.

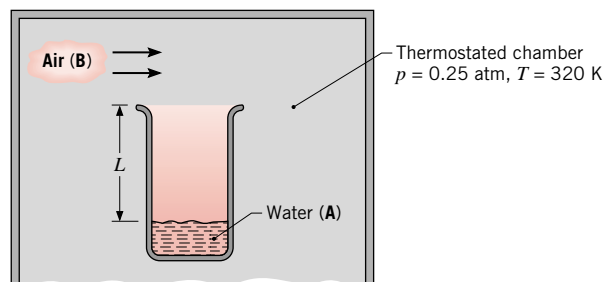

For calibration purposes, you've been asked to calculate the expected evaporation rate (kg/h · m<sup>2</sup>) for a test with water and air under the foregoing conditions, using the known value of  $D_{AB}$  for the vapor–air mixture.

### Stationary Media: Conservation of Species and Mass Diffusion Equation


- 14.14** Beginning with a differential control volume, derive the diffusion equation, on a molar basis, for species A in a three-dimensional (Cartesian coordinates), stationary medium, considering species generation with constant properties. Compare your result with Equation 14.48b.
- 14.15** Consider the radial diffusion of a gaseous species (A) through the wall of a plastic tube (B), and allow for chemical reactions that provide for the depletion of A at a rate  $\dot{N}_A$  (kmol/s  $\cdot$  m<sup>3</sup>). Derive a differential equation that governs the molar concentration of species A in the plastic.
- 14.16** Beginning with a differential control volume, derive the diffusion equation, on a molar basis, for species A in a one-dimensional, spherical, stationary medium, considering species generation. Compare your result with Equation 14.50.
- 14.17** Gaseous hydrogen at 10 bars and 27°C is stored in a 100-mm-diameter spherical tank having a steel wall 2 mm thick. The molar concentration of hydrogen in the steel is 1.50 kmol/m<sup>3</sup> at the inner surface and negligible at the outer surface, while the diffusion coefficient of hydrogen in steel is approximately  $0.3 \times 10^{-12}$  m<sup>2</sup>/s. What is the initial rate of mass loss of hydrogen by diffusion through the tank wall? What is the initial rate of pressure drop within the tank?
- 14.18** A thin plastic membrane is used to separate helium from a gas stream. Under steady-state conditions the concentration of helium in the membrane is known to be 0.02 and 0.005 kmol/m<sup>3</sup> at the inner and outer surfaces, respectively. If the membrane is 1 mm thick and the binary diffusion coefficient of helium with respect to the plastic is  $10^{-9}$  m<sup>2</sup>/s, what is the diffusive flux?
- 0.5 mm thick, and the entire system is at 25°C. What is the molar diffusive flux of O<sub>2</sub> through the membrane? What are the molar concentrations of O<sub>2</sub> on both sides of the membrane (outside the rubber)?
- 14.21** Insulation degrades (experiences an increase in thermal conductivity) if it is subjected to water vapor condensation. The problem may occur in home insulation during cold periods, when vapor in a humidified room diffuses through the dry wall (plaster board) and condenses in the adjoining insulation. Estimate the mass diffusion rate for a 3 m by 5 m wall, under conditions for which the vapor pressure is 0.03 bar in the room air and 0.0 bar in the insulation. The dry wall is 10 mm thick, and the solubility of water vapor in the wall material is approximately  $5 \times 10^{-3}$  kmol/m<sup>3</sup>  $\cdot$  bar. The binary diffusion coefficient for water vapor in the dry wall is approximately  $10^{-9}$  m<sup>2</sup>/s.
- 14.22** Helium gas at 25°C and 4 bars is contained in a glass cylinder of 100-mm inside diameter and 5-mm thickness. What is the rate of mass loss per unit length of the cylinder?
- 14.23** Helium gas at 25°C and 4 bars is stored in a spherical Pyrex container of 200-mm inside diameter and 10-mm thickness. What is the rate of mass loss from the container?
- 14.24** Hydrogen at a pressure of 2 atm flows within a tube of diameter 40 mm and wall thickness 0.5 mm. The outer surface is exposed to a gas stream for which the hydrogen partial pressure is 0.1 atm. The mass diffusivity and solubility of hydrogen in the tube material are  $1.8 \times 10^{-11}$  m<sup>2</sup>/s and 160 kmol/m<sup>3</sup>  $\cdot$  atm, respectively. When the system is at 500 K, what is the rate of hydrogen transfer through the tube per unit length (kg/s  $\cdot$  m)?
- 14.25** Consider the blister packaging material of Example 14.3.
- Under the same conditions as in the example, determine the solubility of the polymer material (kmol/m<sup>3</sup>  $\cdot$  bar) if the temperature is 295 K and the relative humidity inside and outside the package is  $\phi_2 = 0.1$  and  $\phi_1 = 0.9$ , respectively.
  - By selecting a different packaging material, the diffusivity of the film may be changed. Determine the total water vapor transfer rate associated with reducing the diffusivity to 10% of its original value.
  - The solubility of the material adjacent to its exposed surface may be modified by coating it with various thin films. Determine the water vapor transfer rate after coating both sides of the original polymer sheet and, in turn, reducing the solubility near both surfaces to 10% of the original value.
- 14.19** Consider the interface between atmospheric air and a body of water, both at 17°C.
- What are the mole and mass fractions of water at the air side of the interface? At the water side of the interface?
  - What are the mole and mass fractions of oxygen at the air side of the interface? At the water side of the interface? The atmospheric air may be assumed to contain 20.5% oxygen by volume.
- 14.20** Oxygen gas is maintained at pressures of 2 bars and 1 bar on opposite sides of a rubber membrane that is

- (d) Determine the water vapor transfer rate after coating the exterior of the original polymer sheet and reducing its solubility by a factor of 9, while leaving the interior surface untreated.

- 14.26** An experiment is designed to measure the *partition coefficient*,  $K$ , associated with the transfer of a pharmaceutical product through a polymer material. The partition coefficient is defined as the ratio of the densities of the species of interest (the pharmaceutical) on either side of an interface. In the experiment, liquid pharmaceutical ( $\rho_p = 1250 \text{ kg/m}^3$ ) is injected into a hollow polymer sphere of inner and outer diameters  $D_i = 5 \text{ mm}$  and  $D_o = 5.1 \text{ mm}$ , respectively. The sphere is exposed to convective conditions for which the density of the pharmaceutical at the outer surface is zero. After one week, the sphere's mass is reduced by  $\Delta M = 8.2 \text{ mg}$ . What is the value of the partition coefficient if the mass diffusivity is  $D_{AB} = 0.2 \times 10^{-11} \text{ m}^2/\text{s}$ ?
- 14.27** Ultra-pure hydrogen is required in applications ranging from the manufacturing of semiconductors to powering fuel cells. The crystalline structure of palladium allows only the transfer of atomic hydrogen (H) through its thickness, and therefore palladium membranes are used to filter hydrogen from contaminated streams containing mixtures of hydrogen and other gases. Hydrogen molecules ( $\text{H}_2$ ) are first adsorbed onto the palladium's surface and are then dissociated into atoms (H), which subsequently diffuse through the metal. The H atoms recombine on the opposite side of the membrane, forming pure  $\text{H}_2$ . The surface concentration of H takes the form  $C_H = K_s p_{\text{H}_2}^{0.5}$ , where  $K_s \approx 1.4 \text{ kmol/m}^3 \cdot \text{bar}^{0.5}$  is known as *Sievert's constant*. Consider an industrial hydrogen purifier consisting of an array of palladium tubes with one tube end connected to a collector plenum and the other end closed. The tube bank is inserted into a shell. Impure  $\text{H}_2$  at  $T = 600 \text{ K}$ ,  $p = 15 \text{ bars}$ ,  $x_{\text{H}_2} = 0.85$  is introduced into the shell while pure  $\text{H}_2$  at  $p = 6 \text{ bars}$ ,  $T = 600 \text{ K}$  is extracted through the tubes. Determine the production rate of pure hydrogen (kg/h) for  $N = 100$  tubes which are of inside diameter  $D_i = 1.6 \text{ mm}$ , wall thickness  $t = 75 \text{ }\mu\text{m}$ , and length  $L = 80 \text{ mm}$ . The mass diffusivity of hydrogen (H) in palladium at 600 K is approximately  $D_{AB} = 7 \times 10^{-9} \text{ m}^2/\text{s}$ .

## Catalytic Surface Reactions


- 14.28** Nitric oxide (NO) emissions from automobile exhaust can be reduced by using a catalytic converter, and the following reaction occurs at the catalytic surface:



The concentration of NO is reduced by passing the exhaust gases over the surface, and the rate of reduction at the catalyst is governed by a first-order reaction of the form given by Equation 14.66. As a first approximation it may be assumed that NO reaches the surface by one-dimensional diffusion through a thin gas film of thickness  $L$  that adjoins the surface. Referring to Figure 14.7, consider a situation for which the exhaust gas is at  $500^\circ\text{C}$  and 1.2 bars and the mole fraction of NO is  $x_{A,L} = 0.15$ . If  $D_{AB} = 10^{-4} \text{ m}^2/\text{s}$ ,  $k_1'' = 0.05 \text{ m/s}$ , and the film thickness is  $L = 1 \text{ mm}$ , what is the mole fraction of NO at the catalytic surface and what is the NO removal rate for a surface of area  $A = 200 \text{ cm}^2$ ?

- 14.29** Pulverized coal pellets, which may be approximated as carbon spheres of radius  $r_o = 1 \text{ mm}$ , are burned in a pure oxygen atmosphere at 1450 K and 1 atm. Oxygen is transferred to the particle surface by diffusion, where it is consumed in the reaction  $\text{C} + \text{O}_2 \rightarrow \text{CO}_2$ . The reaction rate is first order and of the form  $\dot{N}_{\text{O}_2}'' = -k_1'' C_{\text{O}_2}(r_o)$ , where  $k_1'' = 0.1 \text{ m/s}$ . Neglecting changes in  $r_o$ , determine the steady-state  $\text{O}_2$  molar consumption rate in kmol/s. At 1450 K, the binary diffusion coefficient for  $\text{O}_2$  and  $\text{CO}_2$  is  $1.71 \times 10^{-4} \text{ m}^2/\text{s}$ .

- 14.30** To enhance the effective surface, and hence the chemical reaction rate, catalytic surfaces often take the form of porous solids. One such solid may be visualized as consisting of a large number of cylindrical pores, each of diameter  $D$  and length  $L$ .

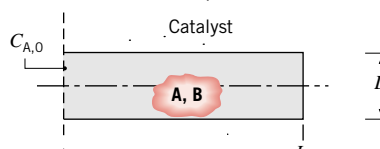

Consider conditions involving a gaseous mixture of A and B for which species A is chemically consumed at the catalytic surface. The reaction is known to be first order, and the rate at which it occurs per unit area of the surface may be expressed as  $k_1'' C_A$ , where  $k_1''$  (m/s) is the reaction rate constant and  $C_A$  (kmol/m<sup>3</sup>) is the local molar concentration of species A. Under steady-state conditions, flow over the porous solid is known to maintain a fixed value of the molar concentration  $C_{A,0}$  at the pore mouth. Beginning from fundamentals, obtain the differential equation that governs the variation of  $C_A$  with distance  $x$  along the pore. Applying appropriate boundary conditions, solve the equation to obtain an expression for  $C_A(x)$ .

- 14.31** A platinum catalytic reactor in an automobile is used to convert carbon monoxide to carbon dioxide in an

oxidation reaction of the form  $2\text{CO} + \text{O}_2 \rightarrow 2\text{CO}_2$ . Species transfer between the catalytic surface and the exhaust gases may be assumed to occur by diffusion in a film of thickness  $L = 10$  mm. Consider an exhaust gas that has a pressure of 1.2 bars, a temperature of  $500^\circ\text{C}$ , and a CO mole fraction of 0.0012. If the reaction rate constant of the catalyst is  $k_1'' = 0.005$  m/s and the diffusion coefficient of CO in the mixture is  $10^{-4}$  m<sup>2</sup>/s, what is the molar concentration of CO at the catalytic surface? What is the rate of removal of CO per unit area of the catalyst? What is the removal rate if  $k_1''$  is adjusted to render the process diffusion limited?

- 14.32** A novel process has been proposed to create a composite palladium tube for use as a hydrogen separation membrane in order to produce high-purity hydrogen. To fabricate the composite palladium tube, a gas containing palladium (species A) flows through a porous-walled tube, and the palladium deposits into the pores of the tube wall. The gas mass flow rate is  $\dot{m}$  and the inlet mass concentration of palladium is  $\rho_{A,m,i}$ . The mass transfer coefficient for transfer of palladium between the gas and the surface is  $h_m$ , and the deposition rate is proportional to the mass concentration of palladium at the tube surface, that is,  $-n_{A,s}'' = k_1 \rho_{A,s}$ . The palladium is a dilute species, so the total mass flow rate is approximately constant down the length of the tube.
- Building upon the convection mass transfer analysis presented in Section 8.9, derive an expression for the variation of the mean species density of palladium with distance from the tube entrance, and determine an expression for the local deposition rate ( $\text{kg}/\text{m}^2 \cdot \text{s}$ ) for a tube of diameter  $D$ . Neglect any leakage of gas through the porous tube walls.
  - If the tube is too long, the variation in deposit thickness will be unacceptably large. What is the ratio of the deposition rates at  $x = L$  and  $x = 0$ ?

### Homogeneous Chemical Reactions: Steady State

- 14.33** Consider combustion of hydrogen gas in a mixture of hydrogen and oxygen adjacent to the metal wall of a combustion chamber. Combustion occurs at constant temperature and pressure according to the chemical reaction  $2\text{H}_2 + \text{O}_2 \rightarrow 2\text{H}_2\text{O}$ . Measurements under steady-state conditions at a distance of 10 mm from the wall indicate that the molar concentrations of hydrogen, oxygen, and water vapor are 0.10, 0.10, and  $0.20 \text{ kmol}/\text{m}^3$ , respectively. The generation rate of water vapor is  $0.96 \times 10^{-2} \text{ kmol}/\text{m}^3 \cdot \text{s}$  throughout the

region of interest. The binary diffusion coefficient for each of the species ( $\text{H}_2$ ,  $\text{O}_2$ , and  $\text{H}_2\text{O}$ ) in the remaining species is  $0.6 \times 10^{-5} \text{ m}^2/\text{s}$ .

- Determine an expression for and make a qualitative plot of  $C_{\text{H}_2}$  as a function of distance from the wall.
- Determine the value of  $C_{\text{H}_2}$  at the wall.
- On the same coordinates used in part (a), sketch curves for the concentrations of oxygen and water vapor.
- What is the molar flux of water vapor at  $x = 10$  mm?

- 14.34** Consider a spherical organism of radius  $r_o$  within which respiration occurs at a uniform volumetric rate of  $\dot{N}_A = -k_0$ . That is, oxygen (species A) consumption is governed by a zero-order, homogeneous chemical reaction.

- If a molar concentration of  $C_A(r_o) = C_{A,o}$  is maintained at the surface of the organism, obtain an expression for the radial distribution of oxygen,  $C_A(r)$ , within the organism. From your solution, can you discern any limits on applicability of the result?
- Obtain an expression for the rate of oxygen consumption within the organism.
- Consider an organism of radius  $r_o = 0.10$  mm and a diffusion coefficient for oxygen transfer of  $D_{AB} = 10^{-8} \text{ m}^2/\text{s}$ . If  $C_{A,o} = 5 \times 10^{-5} \text{ kmol}/\text{m}^3$  and  $k_0 = 1.2 \times 10^{-4} \text{ kmol}/\text{s} \cdot \text{m}^3$ , what is the molar concentration of  $\text{O}_2$  at the center of the organism?

- 14.35** Referring to Problem 14.34, a more representative model of respiration in a spherical organism is one for which oxygen consumption is governed by a first-order reaction of the form  $\dot{N}_A = -k_1 C_A$ .

- If a molar concentration of  $C_A(r_o) = C_{A,o}$  is maintained at the surface of the organism, obtain an expression for the radial distribution of oxygen,  $C_A(r)$ , within the organism. *Hint:* To simplify solution of the species diffusion equation, invoke the transformation  $y \equiv rC_A$ .
- Obtain an expression for the rate of oxygen consumption within the organism.
- Consider an organism of radius  $r_o = 0.10$  mm and a diffusion coefficient of  $D_{AB} = 10^{-8} \text{ m}^2/\text{s}$ . If  $C_{A,o} = 5 \times 10^{-5} \text{ kmol}/\text{m}^3$  and  $k_1 = 20 \text{ s}^{-1}$ , estimate the corresponding value of the molar concentration at the center of the organism. What is the rate of oxygen consumption by the organism?

**14.36** Consider the problem of oxygen transfer from the interior lung cavity, across the lung tissue, to the network of blood vessels on the opposite side. The lung tissue (species B) may be approximated as a plane wall of thickness  $L$ . The inhalation process may be assumed to maintain a constant molar concentration  $C_A(0)$  of oxygen (species A) in the tissue at its inner surface ( $x = 0$ ), and assimilation of oxygen by the blood may be assumed to maintain a constant molar concentration  $C_A(L)$  of oxygen in the tissue at its outer surface ( $x = L$ ). There is oxygen consumption in the tissue due to metabolic processes, and the reaction is zero order, with  $\dot{N}_A = -k_0$ . Obtain expressions for the distribution of the oxygen concentration in the tissue and for the rate of assimilation of oxygen by the blood per unit tissue surface area.

**14.37** As an employee of the Los Angeles Air Quality Commission, you have been asked to develop a model for computing the distribution of  $\text{NO}_2$  in the atmosphere. The molar flux of  $\text{NO}_2$  at ground level,  $N''_{A,0}$ , is presumed known. This flux is attributed to automobile and smoke stack emissions. It is also known that the concentration of  $\text{NO}_2$  at a distance well above ground level is zero and that  $\text{NO}_2$  reacts chemically in the atmosphere. In particular,  $\text{NO}_2$  reacts with unburned hydrocarbons (in a process that is activated by sunlight) to produce PAN (peroxyacetylnitrate), the final product of photochemical smog. The reaction is first order, and the local rate at which it occurs may be expressed as  $\dot{N}_A = -k_1 C_A$ .

- Assuming steady-state conditions and a stagnant atmosphere, obtain an expression for the vertical distribution  $C_A(x)$  of the molar concentration of  $\text{NO}_2$  in the atmosphere.
- If an  $\text{NO}_2$  partial pressure of  $p_A = 2 \times 10^{-6}$  bar is sufficient to cause pulmonary damage, what is the value of the ground level molar flux for which you would issue a smog alert? You may assume an isothermal atmosphere at  $T = 300$  K, a reaction coefficient of  $k_1 = 0.03 \text{ s}^{-1}$ , and an  $\text{NO}_2$ -air diffusion coefficient of  $D_{AB} = 0.15 \times 10^{-4} \text{ m}^2/\text{s}$ .

### Transient Diffusion: Introductory

**14.38** In Problem 14.37,  $\text{NO}_2$  transport by diffusion in a stagnant atmosphere was considered for steady-state conditions. However, the problem is actually time dependent, and a more realistic approach would account for transient effects. Consider the ground level emission of  $\text{NO}_2$  to begin in the early morning (at  $t = 0$ ), when the  $\text{NO}_2$  concentration in the atmosphere is everywhere zero. Emission occurs throughout the day at a constant flux

$N''_{A,0}$ , and the  $\text{NO}_2$  again experiences a first-order photochemical reaction in the atmosphere ( $\dot{N}_A = -k_1 C_A$ ).

- For a differential element in the atmosphere, derive a differential equation that could be used to determine the molar concentration  $C_A(x, t)$ . State appropriate initial and boundary conditions.
- Obtain an expression for  $C_A(x, t)$  under the special condition for which photochemical reactions may be neglected. For this condition what are the molar concentrations of  $\text{NO}_2$  at ground level and at 100-m elevation 3 h after the start of the emissions, if  $N''_{A,0} = 3 \times 10^{-11} \text{ kmol/s} \cdot \text{m}^2$  and  $D_{AB} = 0.15 \times 10^{-4} \text{ m}^2/\text{s}$ ?

**14.39** A large sheet of material 40 mm thick contains dissolved hydrogen ( $\text{H}_2$ ) having a uniform concentration of  $3 \text{ kmol/m}^3$ . The sheet is exposed to a fluid stream that causes the concentration of the dissolved hydrogen to be reduced suddenly to zero at both surfaces. This surface condition is maintained constant thereafter. If the mass diffusivity of hydrogen is  $9 \times 10^{-7} \text{ m}^2/\text{s}$ , how much time is required to bring the density of dissolved hydrogen to a value of  $1.2 \text{ kg/m}^3$  at the center of the sheet?

**14.40** A common procedure for increasing the moisture content of air is to bubble it through a column of water. Assume the air bubbles to be spheres of radius  $r_o = 1 \text{ mm}$  and to be in thermal equilibrium with the water at  $25^\circ\text{C}$ . How long should the bubbles remain in the water to achieve a vapor concentration at the center that is 99% of the maximum possible (saturated) concentration? The air is dry when it enters the water.

**14.41** Steel is carburized in a high-temperature process that depends on the transfer of carbon by diffusion. The value of the diffusion coefficient is strongly temperature dependent and may be approximated as  $D_{C-S} (\text{m}^2/\text{s}) \approx 2 \times 10^{-5} \exp [-17,000/T (\text{K})]$ . If the process is effected at  $1000^\circ\text{C}$  and a carbon mole fraction of 0.02 is maintained at the surface of the steel, how much time is required to elevate the carbon content of the steel from an initial value of 0.1% to a value of 1.0% at a depth of 1 mm?

**14.42** A thick plate of pure iron at  $1000^\circ\text{C}$  is subjected to a carburization process in which the surface of the plate is suddenly exposed to a gas that induces a carbon concentration  $C_{C,s}$  at one surface. The average diffusion coefficient for carbon and iron at this temperature is  $D_{C-Fe} = 3 \times 10^{-11} \text{ m}^2/\text{s}$ . Use the correspondence between heat and mass transfer variables in addressing the following questions.


- Consider the heat transfer analog to the carburization problem. Sketch the mass and heat transfer



systems. Show and explain the correspondence between variables. Provide the analytical solutions to the heat and mass transfer problems.

- Determine the carbon concentration ratio,  $C_C(x, t)/C_{C,s}$ , at a depth of 10 mm after 1 hour of carburization.
- From the analogy, show that the time dependence of the mass flux of carbon into the plate may be expressed as  $n_C'' = \rho_{C,s}(D_{C-Fe}/\pi t)^{1/2}$ . Also, obtain an expression for the mass of carbon per unit area entering the iron plate over the time period  $t$ .
- Consider conditions for which the plate has a uniform carbon concentration of  $C_{C,o}$  and the surface concentration is suddenly reduced to a smaller value,  $C_{C,s}$ . Write an expression for the subsequent variation of the concentration with distance and time,  $C_C(x, t)$ .

- 14.43** A solar pond operates on the principle that heat losses from a shallow layer of water, which acts as a solar absorber, may be minimized by establishing a stable vertical salinity gradient in the water. In practice such a condition may be achieved by applying a layer of pure salt to the bottom and adding an overlying layer of pure water. The salt enters into solution at the bottom and is transferred through the water layer by diffusion, thereby establishing salt-stratified conditions.

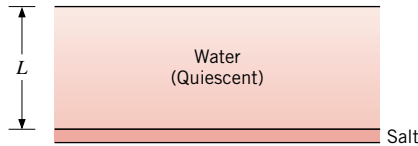


As a first approximation, the total mass density  $\rho$  and the diffusion coefficient for salt in water ( $D_{AB}$ ) may be assumed to be constant, with  $D_{AB} = 1.2 \times 10^{-9} \text{ m}^2/\text{s}$ .

- If a saturated density of  $\rho_{A,s}$  is maintained for salt in solution at the bottom of the water layer of thickness  $L = 1 \text{ m}$ , how long will it take for the mass density of salt at the top of the layer to reach 25% of saturation?
- In the time required to achieve 25% of saturation at the top of the layer, how much salt is transferred from the bottom into the water per unit surface area ( $\text{kg}/\text{m}^2$ )? The saturation density of salt in solution is  $\rho_{A,s} = 380 \text{ kg}/\text{m}^3$ .
- If the bottom is depleted of salt at the time that the salt density reaches 25% of saturation at the top, what is the final (steady-state) density of the salt at the bottom? What is the final density of the salt at the top?

- 14.44** If an amount of energy  $Q_o''$  ( $\text{J}/\text{m}^2$ ) is released instantaneously, as, for example, from a pulsed laser, and it is absorbed by the surface of a semi-infinite medium, with no attendant losses to the surroundings, the subsequent temperature distribution in the medium is

$$T(x, t) - T_i = \frac{Q_o''}{\rho c (\pi \alpha t)^{1/2}} \exp(-x^2/4\alpha t)$$

where  $T_i$  is the initial, uniform temperature of the medium. Consider an analogous mass transfer process involving deposition of a thin layer of phosphorous (P) on a silicon (Si) wafer at room temperature. If the wafer is placed in a furnace, the diffusion of P into Si is significantly enhanced by the high-temperature environment.

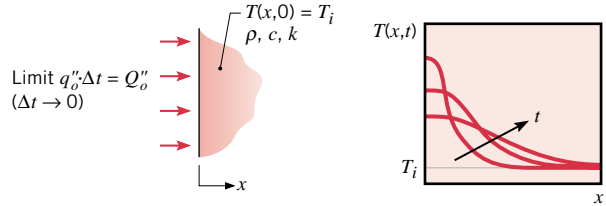

A Si wafer with  $1\text{-}\mu\text{m}$ -thick P film is suddenly placed in a furnace at  $1000^\circ\text{C}$ , and the resulting distribution of P is characterized by an expression of the form

$$C_P(x, t) = \frac{M_{P,o}''}{(\pi D_{P-Si} t)^{1/2}} \exp(-x^2/4D_{P-Si} t)$$

where  $M_{P,o}''$  is the molar area density ( $\text{kmol}/\text{m}^2$ ) of P associated with the film of concentration  $C_P$  and thickness  $d_o$ .

- Explain the correspondence between variables in the analogous temperature and concentration distributions.
- Determine the mole fraction of P at a depth of  $0.1 \mu\text{m}$  in the Si after 30 s. The diffusion coefficient is  $D_{P-Si} = 1.2 \times 10^{-17} \text{ m}^2/\text{s}$ . The mass densities of P and Si are  $2000$  and  $2300 \text{ kg}/\text{m}^3$ , respectively, and their molecular weights are  $30.97$  and  $28.09 \text{ kg}/\text{kmol}$ .


## Transient Diffusion: Advanced

- 14.45** The presence of  $\text{CO}_2$  in solution is essential to the growth of aquatic plant life, with  $\text{CO}_2$  used as a reactant in the photosynthesis. Consider a stagnant body of water in which the concentration of  $\text{CO}_2$  ( $\rho_A$ ) is everywhere zero. At time  $t = 0$ , the water is exposed to a source of  $\text{CO}_2$ , which maintains the surface ( $x = 0$ ) concentration

at a fixed value  $\rho_{A,0}$ . For time  $t > 0$ ,  $\text{CO}_2$  will begin to accumulate in the water, but the accumulation is inhibited by  $\text{CO}_2$  consumption due to photosynthesis. The time rate at which this consumption occurs per unit volume is equal to the product of a reaction rate constant  $k_1$  and the local  $\text{CO}_2$  concentration  $\rho_A(x, t)$ .

- Write (do not derive) a differential equation that could be used to determine  $\rho_A(x, t)$  in the water. What does each term in the equation represent physically?
- Write appropriate boundary conditions that could be used to obtain a particular solution, assuming a “deep” body of water. What would be the form of this solution for the special case of negligible  $\text{CO}_2$  consumption ( $k_1 \approx 0$ )?

**14.46** Hydrogen gas is used in a process to manufacture a sheet material of 6-mm thickness. At the end of the process,  $\text{H}_2$  remains in solution in the material with a uniform concentration of  $320 \text{ kmol/m}^3$ . To remove  $\text{H}_2$  from the material, both surfaces of the sheet are exposed to an air stream at 500 K and a total pressure of 3 atm. Due to contamination, the hydrogen partial pressure is 0.1 atm in the air stream, which provides a convection mass transfer coefficient of 1.5 m/h. The mass diffusivity and solubility of hydrogen (A) in the sheet material (B) are  $D_{AB} = 2.6 \times 10^{-8} \text{ m}^2/\text{s}$  and  $S_{AB} = 160 \text{ kmol/m}^3 \cdot \text{atm}$ , respectively.

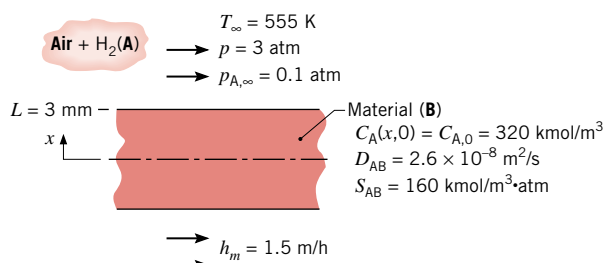

- If the sheet material is left exposed to the air stream for a long time, determine the final content of hydrogen in the material ( $\text{kg/m}^3$ ).
- Identify and evaluate the parameter that can be used to determine whether the transient mass diffusion process in the sheet can be assumed to be characterized by a uniform concentration at any time during the process. *Hint:* This situation is analogous to that used to determine the validity of the lumped-capacitance method for a transient heat transfer analysis.
- Determine the time required to reduce the hydrogen mass density at the center of the sheet to twice the limiting value calculated in part (a).

**14.47** Consider the hydrogen-removal process described in Problem 14.46, but under conditions for which the mass diffusivity of the hydrogen gas (A) in the sheet material (B) is  $D_{AB} = 1.8 \times 10^{-11} \text{ m}^2/\text{s}$  (instead of  $2.6 \times 10^{-8} \text{ m}^2/\text{s}$ ). With the smaller value of  $D_{AB}$ , a *uniform concentration* may no longer be assumed to exist in the material during the removal process.

- If the sheet material is left exposed to the air stream for a very long time, what is the final content of hydrogen in the material ( $\text{kg/m}^3$ )?
- Identify and evaluate the parameters that describe the transient mass diffusion process in the sheet. *Hint:* The situation is analogous to that of transient heat conduction in a plane wall.
- Determine the time required to reduce the hydrogen mass density at the center of the sheet to twice the limiting value calculated in part (a).
- Assuming a uniform concentration at any time during the removal process, calculate the time required to reach twice the limiting density calculated in part (a). Compare the result with that obtained from part (c), and explain the differences.

**14.48** A 1-mm-thick square ( $100 \text{ mm} \times 100 \text{ mm}$ ) sheet of polymer is suspended from a precision scale in a chamber characterized by a temperature and relative humidity of  $T = 300 \text{ K}$  and  $\phi = 0$ , respectively. Suddenly, at time  $t = 0$ , the chamber's relative humidity is raised to  $\phi = 0.95$ . The measured mass of the sheet increases by 0.012 mg over 24 hours and by 0.016 mg over 48 hours. Determine the solubility and mass diffusivity of water vapor in the polymer. Preliminary experiments have indicated that the mass diffusivity is greater than  $7 \times 10^{-13} \text{ m}^2/\text{s}$ .

**14.49** Consider a DVD similar to that of Problem 5.86. To protect sensitive information within the storage medium, a *very thin* film of reactive polymer is embedded within the polycarbonate at a distance  $d = 0.5 \text{ mm}$  from the surface. The thin film can undergo a chemical reaction with oxygen during which it is converted from a transparent material to an opaque material, rendering the information unreadable. The chemical reaction begins when the oxygen concentration at the reactive polymer reaches  $C_{\text{crit}} = 5 \times 10^{-5} \text{ kmol/m}^3$ . The DVD is shipped in an oxygen-proof pouch; determine the elapsed time after removal from the pouch before the DVD self-destructs. The solubility and diffusivity of oxygen in polycarbonate are  $S = 8.9 \times 10^{-3} \text{ kmol/m}^3 \cdot \text{bar}$  and  $D_{AB} = 6.5 \times 10^{-12} \text{ m}^2/\text{s}$ , respectively.

**14.50** Consider the DVD of Problem 14.49, except now the reacting polymer is blended uniformly with the

polycarbonate to reduce manufacturing costs. Assume that a first-order homogeneous chemical reaction takes place between the polymer and oxygen; the reaction rate is proportional to the oxygen molar concentration.

- (a) Write the governing equation, boundary conditions, and initial condition for the oxygen molar concentration after the DVD is removed from the oxygen-proof pouch, for a DVD of thickness  $2L$ . Do not solve.
  - (b) The DVD will gradually become more opaque over time as the reaction proceeds. The ability to read the DVD will depend on how well the laser light can penetrate through the thickness of the DVD. Therefore, it is important to know the volume-averaged molar concentration of product,  $\bar{C}_{\text{prod}}$ , as a function of time. Write an expression for  $\bar{C}_{\text{prod}}$  in terms of the oxygen molar concentration, assuming that every mole of oxygen that reacts with the polymer results in  $p$  moles of product.
- 14.51** A vitreous silica optical fiber of diameter  $100\ \mu\text{m}$  is used to send optical signals from a sensor placed deep inside a hydrogen chamber. The hydrogen is at a pressure of 20 bars. The mass diffusivity and solubility of the hydrogen in the glass fiber are  $D_{\text{AB}} = 2.88 \times 10^{-15}\ \text{m}^2/\text{s}$  and  $S = 4.15 \times 10^{-3}\ \text{kmol}/\text{m}^3 \cdot \text{bar}$ , respectively. Hydrogen diffusion into the fiber is undesirable, since it changes the spectral transmissivity and refractive index of the glass and can lead to failure of the detection system.
- (a) Determine the average hydrogen concentration in an uncoated optical fiber,  $\bar{C}$ , after 100 hours of operation in the hydrogen environment. Determine the corresponding change in the refractive index,  $\Delta n$ , of the fiber. For vitreous silica,  $\Delta n = (1.6 \times 10^{-3}\ \text{m}^3/\text{kmol}) \times \bar{C}$ .
  - (b) Determine the average hydrogen concentration and change in refractive index after 1 hour and 10 hours of operation in the hydrogen environment.
- 14.52** The surface of glass *quickly* develops very small *microcracks* when exposed to high humidity. Although

microcracks can be safely ignored in most applications, they can significantly decrease the mechanical strength of very small glass structures such as optical fibers. Consider a glass optical fiber of diameter  $D_i = 125\ \mu\text{m}$  that is coated with an acrylate polymer to form a coated fiber of outer diameter  $D_o = 250\ \mu\text{m}$ . A telecommunications engineer insists that the optical fiber be stored in a low-humidity environment prior to installation so that it is sufficiently strong to withstand rough treatment by technicians in the field. If installation of a roll of fiber requires several hot and humid days to complete, will careful storage beforehand prevent microcracking? The mass diffusivity of water vapor in the acrylate is  $D_{\text{AB}} = 5.5 \times 10^{-13}\ \text{m}^2/\text{s}$  while the glass can be considered impermeable.

- 14.53** A person applies an insect repellent onto an exposed area of  $A = 0.5\ \text{m}^2$  of their body. The mass of spray used is  $M = 10$  grams, and the spray contains 25% (by mass) active ingredient. The inactive ingredient quickly evaporates from the skin surface.
- (a) If the spray is applied uniformly and the density of the dried active ingredient is  $\rho = 2000\ \text{kg}/\text{m}^3$ , determine the initial thickness of the film of active ingredient on the skin surface. The temperature, molecular weight, and saturation pressure of the active ingredient are  $32^\circ\text{C}$ ,  $152\ \text{kg}/\text{kmol}$ , and  $1.2 \times 10^{-5}$  bars, respectively.
  - (b) If the convective mass transfer coefficient associated with sublimation of the active ingredient to the air is  $\bar{h}_m = 5 \times 10^{-3}\ \text{m}/\text{s}$ , the partition coefficient associated with the ingredient–skin interface is  $K = 0.05$ , and the mass diffusivity of the active ingredient in the skin is  $D_{\text{AB}} = 1 \times 10^{-13}\ \text{m}^2/\text{s}$ , determine how long the insect repellent remains effective. The partition coefficient is the ratio of the ingredient density in the skin to the ingredient density outside the skin.
  - (c) If the spray is reformulated so that the partition coefficient becomes very small, how long does the insect repellent remain effective?





# APPENDIX **A**

## *Thermophysical Properties of Matter*<sup>1</sup>

<i>Table</i>		<i>Page</i>
<b>A.1</b>	Thermophysical Properties of Selected Metallic Solids	929
<b>A.2</b>	Thermophysical Properties of Selected Nonmetallic Solids	933
<b>A.3</b>	Thermophysical Properties of Common Materials	935
	Structural Building Materials	935
	Insulating Materials and Systems	936
	Industrial Insulation	937
	Other Materials	939
<b>A.4</b>	Thermophysical Properties of Gases at Atmospheric Pressure	941
<b>A.5</b>	Thermophysical Properties of Saturated Fluids	946
	Saturated Liquids	946
	Saturated Liquid–Vapor, 1 atm	948
<b>A.6</b>	Thermophysical Properties of Saturated Water	949
<b>A.7</b>	Thermophysical Properties of Liquid Metals	951
<b>A.8</b>	Binary Diffusion Coefficients at One Atmosphere	952
<b>A.9</b>	Henry’s Constant for Selected Gases in Water at Moderate Pressure	953
<b>A.10</b>	The Solubility of Selected Gases and Solids	953

<sup>1</sup> The convention used to present numerical values of the properties is illustrated by this example:

$T$ (K)	$\nu \cdot 10^7$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)
300	0.349	521

where  $\nu = 0.349 \times 10^{-7}$  m<sup>2</sup>/s and  $k = 521 \times 10^{-3} = 0.521$  W/m · K at 300 K.

<b>A.11</b>	Total, Normal ( $n$ ) or Hemispherical ( $h$ ) Emissivity of Selected Surfaces	954
	Metallic Solids and Their Oxides	954
	Nonmetallic Substances	955
<b>A.12</b>	Solar Radiative Properties for Selected Materials	956
	References	957

---

TABLE A.1 Thermophysical Properties of Selected Metallic Solids<sup>a</sup>

Composition	Melting Point (K)	Properties at 300 K				Properties at Various Temperatures (K)														
		$\rho$ (kg/m <sup>3</sup> )	$c_p$ (J/kg · K)	$k$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$k$ (W/m · K)/ $c_p$ (J/kg · K)														
						100	200	400	600	800	1000	1200	1500	2000	2500					
Aluminum																				
Pure	933	2702	903	237	97.1	302	237	240	231	218										
Alloy 2024-T6 (4.5% Cu, 1.5% Mg, 0.6% Mn)	775	2770	875	177	73.0	482	798	949	1033	1146										
						65	163	186	186											
Alloy 195, Cast (4.5% Cu)						473	787	925	1042											
Beryllium	1550	1850	1825	200	59.2	990	301	161	126	106										
						203	1114	2191	2604	2823	3018	78.7								
Bismuth	545	9780	122	7.86	6.59	16.5	9.69	7.04												
						112	120	127												
Boron	2573	2500	1107	27.0	9.76	190	55.5	16.8	10.6	9.60	9.85									
						128	600	1463	1892	2160	2338									
Cadmium	594	8650	231	96.8	48.4	203	99.3	94.7												
						198	222	242												
Chromium	2118	7160	449	93.7	29.1	159	111	90.9	80.7	71.3	65.4	61.9	57.2	49.4						
						192	384	484	542	581	616	682	779	937						
Cobalt	1769	8862	421	99.2	26.6	167	122	85.4	67.4	58.2	52.1	49.3	42.5							
						236	379	450	503	550	628	733	674							
Copper																				
Pure	1358	8933	385	401	117	482	413	393	379	366	352	339								
						252	356	397	417	433	451	480								
Commercial bronze (90% Cu, 10% Al)	1293	8800	420	52	14		42	52	59											
Phosphor gear bronze (89% Cu, 11% Sn)	1104	8780	355	54	17		785	460	545											
							41	65	74											
Cartridge brass (70% Cu, 30% Zn)	1188	8530	380	110	33.9	75	—	—	—											
							95	137	149											
Constantan (55% Cu, 45% Ni)	1493	8920	384	23	6.71	17	360	395	425											
						237	362													
Germanium	1211	5360	322	59.9	34.7	232	96.8	43.2	27.3	19.8	17.4	17.4								
						190	290	337	348	357	375	395								

TABLE A.1 Continued

Composition		Melting Point (K)	Properties at 300 K				Properties at Various Temperatures (K)											
			$\rho$ (kg/m <sup>3</sup> )	$c_p$ (J/kg · K)	$k$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$k$ (W/m · K)/ $c_p$ (J/kg · K)											
							100	200	400	600	800	1000	1200	1500	2000	2500		
Gold		1336	19300	129	317	127	327	323	311	298	284	270	255					
Iridium		2720	22500	130	147	50.3	109	124	131	135	140	145	155					
Iron		1810	7870	447	80.2	23.1	134	94.0	69.5	54.7	43.3	32.8	28.3	32.1				
							216	384	490	574	680	975	609	654				
Armco (99.75% pure)			7870	447	72.7	20.7	95.6	80.6	65.7	53.1	42.2	32.3	28.7	31.4				
							215	384	490	574	680	975	609	654				
Carbon steels																		
Plain carbon (Mn $\leq$ 1%, Si $\leq$ 0.1%)			7854	434	60.5	17.7			56.7	48.0	39.2	30.0						
AISI 1010			7832	434	63.9	18.8			487	559	685	1168						
Carbon-silicon (Mn $\leq$ 1%, 0.1% < Si $\leq$ 0.6%)			7817	446	51.9	14.9			58.7	48.8	39.2	31.3						
									487	559	685	1168						
Carbon-manganese-silicon (1% < Mn $\leq$ 1.65%, 0.1% < Si $\leq$ 0.6%)			8131	434	41.0	11.6			49.8	44.0	37.4	29.3						
									501	582	699	971						
Chromium (low) steels ( $\frac{1}{2}$ Cr- $\frac{1}{4}$ Mo-Si (0.18% C, 0.65% Cr, 0.23% Mo, 0.6% Si))									42.2	39.7	35.0	27.6						
			7822	444	37.7	10.9			487	559	685	1090						
1 Cr- $\frac{1}{2}$ Mo (0.16% C, 1% Cr, 0.54% Mo, 0.39% Si)			7858	442	42.3	12.2			38.2	36.7	33.3	26.9						
									492	575	688	969						
1 Cr-V (0.2% C, 1.02% Cr, 0.15% V)			7836	443	48.9	14.1			42.0	39.1	34.5	27.4						
									492	575	688	969						
									46.8	42.1	36.3	28.2						
									492	575	688	969						

Stainless steels	AISI 302	8055	480		15.1	3.91			17.3	20.0	22.8	25.4								
									512	559	585	606								
	AISI 304	7900	477		14.9	3.95	9.2	12.6	16.6	19.8	22.6	25.4	28.0	31.7						
							272	402	515	557	582	611	640	682						
	AISI 316	8238	468		13.4	3.48			15.2	18.3	21.3	24.2								
									504	550	576	602								
	AISI 347	7978	480		14.2	3.71			15.8	18.9	21.9	24.7								
									513	559	585	606								
	Lead	601	11340	129	35.3	24.1	39.7	36.7	34.0	31.4										
							118	125	132	142										
	Magnesium	923	1740	1024	156	87.6	169	159	153	149	146									
							649	934	1074	1170	1267									
	Molybdenum	2894	10240	251	138	53.7	179	143	134	126	118	112	105	98	86					
							141	224	261	275	285	295	308	330	380	459				
	Nickel Pure	1728	8900	444	90.7	23.0	164	107	80.2	65.6	67.6	71.8	76.2	82.6						
							232	383	485	592	530	562	594	616						
	Nichrome (80% Ni, 20% Cr)	1672	8400	420	12	3.4			14	16	21									
	Inconel X-750 (73% Ni, 15% Cr, 6.7% Fe)	1665	8510	439	11.7	3.1	8.7	10.3	13.5	17.0	20.5	24.0	27.6	33.0	—					
							—	372	473	510	546	626	—	—	—					
	Niobium	2741	8570	265	53.7	23.6	55.2	52.6	55.2	58.2	61.3	64.4	67.5	72.1	79.1					
						188	249	274	283	292	301	310	324	347						
Palladium	1827	12020	244	71.8	24.5	76.5	71.6	73.6	79.7	86.9	94.2	102	110							
						168	227	251	261	271	281	291	307							
Platinum Pure	2045	21450	133	71.6	25.1	77.5	72.6	71.8	73.2	75.6	78.7	82.6	89.5	99.4						
						100	125	136	141	146	152	157	165	179						
Alloy 60Pt–40Rh (60% Pt, 40% Rh)	1800	16630	162	47	17.4			52	59	65	69	73	76							
Rhenium	3453	21100	136	47.9	16.7	58.9	51.0	—	—	—	—	—	—	—						
						97	127	139	145	151	156	162	171	186						
Rhodium	2236	12450	243	150	49.6	186	154	146	136	127	121	116	110	112						
						147	220	253	274	293	311	327	349	376						
Silicon	1685	2330	712	148	89.2	884	264	98.9	61.9	42.2	31.2	25.7	22.7							
						259	556	790	867	913	946	967	992							
Silver	1235	10500	235	429	174	444	430	425	412	396	379	361								
						187	225	239	250	262	277	292								
Tantalum	3269	16600	140	57.5	24.7	59.2	57.5	57.8	58.6	59.4	60.2	61.0	62.2	64.1	65.6					
						110	133	144	146	149	152	155	160	172	189					
Thorium	2023	11700	118	54.0	39.1	59.8	54.6	54.5	55.8	56.9	56.9	58.7								
						99	112	124	134	145	156	167								
Tin	505	7310	227	66.6	40.1	85.2	73.3	62.2												
						188	215	243												

TABLE A.1 Continued

Composition	Melting Point (K)	Properties at 300 K				Properties at Various Temperatures (K)									
		$\rho$ (kg/m <sup>3</sup> )	$c_p$ (J/kg · K)	$k$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$k$ (W/m · K)/ $c_p$ (J/kg · K)									
						100	200	400	600	800	1000	1200	1500	2000	2500
Titanium	1953	4500	522	21.9	9.32	30.5	24.5	20.4	19.4	19.7	20.7	22.0	24.5		
						300	465	551	591	633	675	620	686		
Tungsten	3660	19300	132	174	68.3	208	186	159	137	125	118	113	107	100	95
						87	122	137	142	145	148	152	157	167	176
Uranium	1406	19070	116	27.6	12.5	21.7	25.1	29.6	34.0	38.8	43.9	49.0			
						94	108	125	146	176	180	161			
Vanadium	2192	6100	489	30.7	10.3	35.8	31.3	31.3	33.3	35.7	38.2	40.8	44.6	50.9	
						258	430	515	540	563	597	645	714	867	
Zinc	693	7140	389	116	41.8	117	118	111	103						
						297	367	402	436						
Zirconium	2125	6570	278	22.7	12.4	33.2	25.2	21.6	20.7	21.6	23.7	26.0	28.8	33.0	
						205	264	300	322	342	362	344	344	344	

<sup>a</sup>Adapted from References 1–7.

TABLE A.2 Thermophysical Properties of Selected Nonmetallic Solids<sup>a</sup>

Composition	Melting Point (K)	Properties at 300 K				Properties at Various Temperatures (K)									
		$\rho$ (kg/m <sup>3</sup> )	$c_p$ (J/kg · K)	$k$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$k$ (W/m · K)/ $c_p$ (J/kg · K)									
						100	200	400	600	800	1000	1200	1500	2000	2500
Aluminum oxide, sapphire	2323	3970	765	46	15.1	450	82	32.4	18.9	13.0	10.5				
						—	—	940	1110	1180	1225				
Aluminum oxide, polycrystalline	2323	3970	765	36.0	11.9	133	55	26.4	15.8	10.4	7.85	6.55	5.66	6.00	
Beryllium oxide	2725	3000	1030	272	88.0	—	—	940	1110	1180	1225	—	—	—	
								196	111	70	47	33	21.5	15	
Boron	2573	2500	1105	27.6	9.99	190	52.5	18.7	11.3	8.1	6.3	5.2	2145	2750	
						—	—	1490	1880	2135	2350	2555			
Boron fiber epoxy (30% vol) composite	590	2080													
$k$ ,    to fibers				2.29		2.10	2.23	2.28							
$k$ , $\perp$ to fibers				0.59		0.37	0.49	0.60							
$c_p$			1122			364	757	1431							
Carbon															
Amorphous	1500	1950	—	1.60	—	0.67	1.18	1.89	2.19	2.37	2.53	2.84	3.48		
						—	—	—	—	—	—	—	—		
Diamond, type IIa insulator	—	3500	509	2300	—	10,000	4000	1540							
						21	194	853							
Graphite, pyrolytic	2273	2210													
$k$ ,    to layers				1950		4970	3230	1390	892	667	534	448	357	262	
$k$ , $\perp$ to layers				5.70		16.8	9.23	4.09	2.68	2.01	1.60	1.34	1.08	0.81	
$c_p$			709			136	411	992	1406	1650	1793	1890	1974	2043	
Graphite fiber epoxy (25% vol) composite	450	1400													
$k$ , heat flow    to fibers				11.1		5.7	8.7	13.0							
$k$ , heat flow $\perp$ to fibers				0.87		0.46	0.68	1.1							
$c_p$			935			337	642	1216							
Pyroceram, Corning 9606	1623	2600	808	3.98	1.89	5.25	4.78	3.64	3.28	3.08	2.96	2.87	2.79		
						—	—	908	1038	1122	1197	1264	1498		



TABLE A.2 Continued

Composition	Melting Point (K)	Properties at 300 K				Properties at Various Temperatures (K)									
		$\rho$ (kg/m <sup>3</sup> )	$c_p$ (J/kg · K)	$k$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$k$ (W/m · K)/ $c_p$ (J/kg · K)									
						100	200	400	600	800	1000	1200	1500	2000	2500
Silicon carbide	3100	3160	675	490	230	—	—	—	—	—	87	58	30	—	—
Silicon dioxide, crystalline (quartz) $k, \parallel$ to $c$ axis $k, \perp$ to $c$ axis $c_p$	1883	2650	745	10.4 6.21	—	39	16.4	7.6	5.0	4.2	—	—	—	—	—
						20.8	9.5	4.70	3.4	3.1	—	—	—	—	—
						—	—	885	1075	1250	—	—	—	—	—
Silicon dioxide, polycrystalline (fused silica)	1883	2220	745	1.38	0.834	0.69	1.14	1.51	1.75	2.17	2.87	4.00	—	—	—
Silicon nitride	2173	2400	691	16.0	9.65	—	—	13.9	11.3	9.88	8.76	8.00	7.16	6.20	—
Sulfur	392	2070	708	0.206	0.141	0.165	578	778	937	1063	1155	1226	1306	1377	—
Thorium dioxide	3573	9110	235	13	6.1	403	606	10.2	6.6	4.7	3.68	3.12	2.73	2.5	—
Titanium dioxide, polycrystalline	2133	4157	710	8.4	2.8	—	—	255	274	285	295	303	315	330	—
								7.01	5.02	3.94	3.46	3.28	—	—	—
								805	880	910	930	945	—	—	—

<sup>a</sup>Adapted from References 1, 2, 3, and 6.

**TABLE A.3** Thermophysical Properties of Common Materials<sup>a</sup>**Structural Building Materials**

Description/Composition	Typical Properties at 300 K		
	Density, $\rho$ (kg/m <sup>3</sup> )	Thermal Conductivity, $k$ (W/m · K)	Specific Heat, $c_p$ (J/kg · K)
<b>Building Boards</b>			
Asbestos–cement board	1920	0.58	—
Gypsum or plaster board	800	0.17	—
Plywood	545	0.12	1215
Sheathing, regular density	290	0.055	1300
Acoustic tile	290	0.058	1340
Hardboard, siding	640	0.094	1170
Hardboard, high density	1010	0.15	1380
Particle board, low density	590	0.078	1300
Particle board, high density	1000	0.170	1300
<b>Woods</b>			
Hardwoods (oak, maple)	720	0.16	1255
Softwoods (fir, pine)	510	0.12	1380
<b>Masonry Materials</b>			
Cement mortar	1860	0.72	780
Brick, common	1920	0.72	835
Brick, face	2083	1.3	—
Clay tile, hollow			
1 cell deep, 10 cm thick	—	0.52	—
3 cells deep, 30 cm thick	—	0.69	—
Concrete block, 3 oval cores			
Sand/gravel, 20 cm thick	—	1.0	—
Cinder aggregate, 20 cm thick	—	0.67	—
Concrete block, rectangular core			
2 cores, 20 cm thick, 16 kg	—	1.1	—
Same with filled cores	—	0.60	—
<b>Plastering Materials</b>			
Cement plaster, sand aggregate	1860	0.72	—
Gypsum plaster, sand aggregate	1680	0.22	1085
Gypsum plaster, vermiculite aggregate	720	0.25	—

TABLE A.3 Continued

*Insulating Materials and Systems*

Description/Composition	Typical Properties at 300 K		
	Density, $\rho$ (kg/m <sup>3</sup> )	Thermal Conductivity, $k$ (W/m · K)	Specific Heat, $c_p$ (J/kg · K)
Blanket and Batt			
Glass fiber, paper faced	16	0.046	—
	28	0.038	—
	40	0.035	—
Glass fiber, coated; duct liner	32	0.038	835
Board and Slab			
Cellular glass	145	0.058	1000
Glass fiber, organic bonded	105	0.036	795
Polystyrene, expanded			
Extruded (R-12)	55	0.027	1210
Molded beads	16	0.040	1210
Mineral fiberboard; roofing material	265	0.049	—
Wood, shredded/cemented	350	0.087	1590
Cork	120	0.039	1800
Loose Fill			
Cork, granulated	160	0.045	—
Diatomaceous silica, coarse	350	0.069	—
Powder	400	0.091	—
Diatomaceous silica, fine powder	200	0.052	—
	275	0.061	—
Glass fiber, poured or blown	16	0.043	835
Vermiculite, flakes	80	0.068	835
	160	0.063	1000
Formed/Foamed-in-Place			
Mineral wool granules with asbestos/inorganic binders, sprayed	190	0.046	—
Polyvinyl acetate cork mastic; sprayed or troweled	—	0.100	—
Urethane, two-part mixture; rigid foam	70	0.026	1045
Reflective			
Aluminum foil separating fluffy glass mats; 10–12 layers, evacuated; for cryogenic applications (150 K)	40	0.00016	—
Aluminum foil and glass paper laminate; 75–150 layers; evacuated; for cryogenic application (150 K)	120	0.000017	—
Typical silica powder, evacuated	160	0.0017	—

TABLE A.3 Continued

Industrial Insulation

Description/ Composition	Maximum Service Temperature (K)	Typical Density (kg/m <sup>3</sup> )	Typical Thermal Conductivity, <i>k</i> (W/m · K), at Various Temperatures (K)													
			200	215	230	240	255	270	285	300	310	365	420	530	645	750
Blankets																
Blanket, mineral fiber,	920	96–192									0.038	0.046	0.056	0.078		
metal reinforced	815	40–96									0.035	0.045	0.058	0.088		
Blanket, mineral fiber,	450	10	0.036	0.038	0.040	0.043	0.048				0.052	0.076				
glass; fine fiber,		12	0.035	0.036	0.039	0.042	0.046	0.049	0.069							
organic bonded		16	0.033	0.035	0.036	0.039	0.042	0.046	0.062							
		24	0.030	0.032	0.033	0.036	0.039	0.040	0.053							
		32	0.029	0.030	0.032	0.033	0.036	0.038	0.048							
		48	0.027	0.029	0.030	0.032	0.033	0.035	0.045							
Blanket, alumina– silica fiber	1530	48												0.071	0.105	0.150
		64												0.059	0.087	0.125
		96												0.052	0.076	0.100
		128												0.049	0.068	0.091
Felt, semirigid; organic bonded	480	50–125								0.035	0.036	0.038	0.039	0.051	0.063	
Felt, laminated; no binder	730	50	0.023	0.025	0.026	0.027	0.029	0.030	0.032	0.033	0.035	0.051	0.079			
Blocks, Boards, and Pipe Insulations	920	120											0.051	0.065	0.087	
Asbestos paper, laminated and corrugated																
4-ply	420	190								0.078	0.082	0.098				
6-ply	420	255								0.071	0.074	0.085				
8-ply	420	300								0.068	0.071	0.082				
Magnesia, 85%	590	185									0.051	0.055	0.061			
Calcium silicate	920	190									0.055	0.059	0.063	0.075	0.089	0.104

TABLE A.3 Continued

## Industrial Insulation (Continued)

Description/ Composition	Maximum Service Temperature (K)	Typical Density (kg/m <sup>3</sup> )	Typical Thermal Conductivity, <i>k</i> (W/m · K), at Various Temperatures (K)													
			200	215	230	240	255	270	285	300	310	365	420	530	645	750
Cellular glass	700	145			0.046	0.048	0.051	0.052	0.055	0.058	0.062	0.069	0.079			
Diatomaceous silica	1145	345												0.092	0.098	0.104
	1310	385												0.101	0.100	0.115
Polystyrene, rigid																
Extruded (R-12)	350	56	0.023	0.023	0.022	0.023	0.023	0.025	0.026	0.027	0.029					
Extruded (R-12)	350	35	0.023	0.023	0.023	0.025	0.025	0.026	0.027	0.029						
Molded beads	350	16	0.026	0.029	0.030	0.033	0.035	0.036	0.038	0.040						
Rubber, rigid																
foamed	340	70						0.029	0.030	0.032	0.033					
Insulating Cement																
Mineral fiber																
(rock, slag or glass)																
With clay binder	1255	430									0.071	0.079	0.088	0.105	0.123	
With hydraulic																
setting binder	922	560									0.108	0.115	0.123	0.137		
Loose Fill																
Cellulose, wood																
or paper pulp	—	45							0.038	0.039	0.042					
Perlite, expanded	—	105	0.036	0.039	0.042	0.043	0.046	0.049	0.051	0.053	0.056					
Vermiculite,																
expanded	—	122			0.056	0.058	0.061	0.063	0.065	0.068	0.071					
		80			0.049	0.051	0.055	0.058	0.061	0.063	0.066					

TABLE A.3 Continued

*Other Materials*

Description/ Composition	Temperature (K)	Density, $\rho$ (kg/m <sup>3</sup> )	Thermal Conductivity, $k$ (W/m · K)	Specific Heat, $c_p$ (J/kg · K)
Asphalt	300	2115	0.062	920
Bakelite	300	1300	1.4	1465
Brick, refractory				
Carborundum	872	—	18.5	—
	1672	—	11.0	—
Chrome brick	473	3010	2.3	835
	823		2.5	
	1173		2.0	
Diatomaceous silica, fired	478	—	0.25	—
	1145	—	0.30	
Fire clay, burnt 1600 K	773	2050	1.0	960
	1073	—	1.1	
	1373	—	1.1	
Fire clay, burnt 1725 K	773	2325	1.3	960
	1073		1.4	
	1373		1.4	
Fire clay brick	478	2645	1.0	960
	922		1.5	
	1478		1.8	
Magnesite	478	—	3.8	1130
	922	—	2.8	
	1478		1.9	
Clay	300	1460	1.3	880
Coal, anthracite	300	1350	0.26	1260
Concrete (stone mix)	300	2300	1.4	880
Cotton	300	80	0.06	1300
Foodstuffs				
Banana (75.7% water content)	300	980	0.481	3350
Apple, red (75% water content)	300	840	0.513	3600
Cake, batter	300	720	0.223	—
Cake, fully baked	300	280	0.121	—
Chicken meat, white (74.4% water content)	198	—	1.60	—
	233	—	1.49	
	253		1.35	
	263		1.20	
	273		0.476	
	283		0.480	
	293		0.489	
Glass				
Plate (soda lime)	300	2500	1.4	750
Pyrex	300	2225	1.4	835

**TABLE A.3** *Continued***Other Materials (Continued)**

Description/ Composition	Temperature (K)	Density, $\rho$ (kg/m <sup>3</sup> )	Thermal Conductivity, $k$ (W/m · K)	Specific Heat, $c_p$ (J/kg · K)
Ice	273	920	1.88	2040
	253	—	2.03	1945
Leather (sole)	300	998	0.159	—
Paper	300	930	0.180	1340
Paraffin	300	900	0.240	2890
Rock				
Granite, Barre	300	2630	2.79	775
Limestone, Salem	300	2320	2.15	810
Marble, Halston	300	2680	2.80	830
Quartzite, Sioux	300	2640	5.38	1105
Sandstone, Berea	300	2150	2.90	745
Rubber, vulcanized				
Soft	300	1100	0.13	2010
Hard	300	1190	0.16	—
Sand	300	1515	0.27	800
Soil	300	2050	0.52	1840
Snow	273	110	0.049	—
		500	0.190	—
Teflon	300	2200	0.35	—
	400		0.45	—
Tissue, human				
Skin	300	—	0.37	—
Fat layer (adipose)	300	—	0.2	—
Muscle	300	—	0.5	—
Wood, cross grain				
Balsa	300	140	0.055	—
Cypress	300	465	0.097	—
Fir	300	415	0.11	2720
Oak	300	545	0.17	2385
Yellow pine	300	640	0.15	2805
White pine	300	435	0.11	—
Wood, radial				
Oak	300	545	0.19	2385
Fir	300	420	0.14	2720

<sup>a</sup>Adapted from References 1 and 8–13.

**TABLE A.4** Thermophysical Properties  
of Gases at Atmospheric Pressure<sup>a</sup>

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^7$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$Pr$
<b>Air</b>							
100	3.5562	1.032	71.1	2.00	9.34	2.54	0.786
150	2.3364	1.012	103.4	4.426	13.8	5.84	0.758
200	1.7458	1.007	132.5	7.590	18.1	10.3	0.737
250	1.3947	1.006	159.6	11.44	22.3	15.9	0.720
300	1.1614	1.007	184.6	15.89	26.3	22.5	0.707
350	0.9950	1.009	208.2	20.92	30.0	29.9	0.700
400	0.8711	1.014	230.1	26.41	33.8	38.3	0.690
450	0.7740	1.021	250.7	32.39	37.3	47.2	0.686
500	0.6964	1.030	270.1	38.79	40.7	56.7	0.684
550	0.6329	1.040	288.4	45.57	43.9	66.7	0.683
600	0.5804	1.051	305.8	52.69	46.9	76.9	0.685
650	0.5356	1.063	322.5	60.21	49.7	87.3	0.690
700	0.4975	1.075	338.8	68.10	52.4	98.0	0.695
750	0.4643	1.087	354.6	76.37	54.9	109	0.702
800	0.4354	1.099	369.8	84.93	57.3	120	0.709
850	0.4097	1.110	384.3	93.80	59.6	131	0.716
900	0.3868	1.121	398.1	102.9	62.0	143	0.720
950	0.3666	1.131	411.3	112.2	64.3	155	0.723
1000	0.3482	1.141	424.4	121.9	66.7	168	0.726
1100	0.3166	1.159	449.0	141.8	71.5	195	0.728
1200	0.2902	1.175	473.0	162.9	76.3	224	0.728
1300	0.2679	1.189	496.0	185.1	82	238	0.719
1400	0.2488	1.207	530	213	91	303	0.703
1500	0.2322	1.230	557	240	100	350	0.685
1600	0.2177	1.248	584	268	106	390	0.688
1700	0.2049	1.267	611	298	113	435	0.685
1800	0.1935	1.286	637	329	120	482	0.683
1900	0.1833	1.307	663	362	128	534	0.677
2000	0.1741	1.337	689	396	137	589	0.672
2100	0.1658	1.372	715	431	147	646	0.667
2200	0.1582	1.417	740	468	160	714	0.655
2300	0.1513	1.478	766	506	175	783	0.647
2400	0.1448	1.558	792	547	196	869	0.630
2500	0.1389	1.665	818	589	222	960	0.613
3000	0.1135	2.726	955	841	486	1570	0.536
<b>Ammonia (NH<sub>3</sub>)</b>							
300	0.6894	2.158	101.5	14.7	24.7	16.6	0.887
320	0.6448	2.170	109	16.9	27.2	19.4	0.870
340	0.6059	2.192	116.5	19.2	29.3	22.1	0.872
360	0.5716	2.221	124	21.7	31.6	24.9	0.872
380	0.5410	2.254	131	24.2	34.0	27.9	0.869



TABLE A.4 Continued

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^7$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$Pr$
<b>Ammonia (NH<sub>3</sub>) (continued)</b>							
400	0.5136	2.287	138	26.9	37.0	31.5	0.853
420	0.4888	2.322	145	29.7	40.4	35.6	0.833
440	0.4664	2.357	152.5	32.7	43.5	39.6	0.826
460	0.4460	2.393	159	35.7	46.3	43.4	0.822
480	0.4273	2.430	166.5	39.0	49.2	47.4	0.822
500	0.4101	2.467	173	42.2	52.5	51.9	0.813
520	0.3942	2.504	180	45.7	54.5	55.2	0.827
540	0.3795	2.540	186.5	49.1	57.5	59.7	0.824
560	0.3708	2.577	193	52.0	60.6	63.4	0.827
580	0.3533	2.613	199.5	56.5	63.8	69.1	0.817
<b>Carbon Dioxide (CO<sub>2</sub>)</b>							
280	1.9022	0.830	140	7.36	15.20	9.63	0.765
300	1.7730	0.851	149	8.40	16.55	11.0	0.766
320	1.6609	0.872	156	9.39	18.05	12.5	0.754
340	1.5618	0.891	165	10.6	19.70	14.2	0.746
360	1.4743	0.908	173	11.7	21.2	15.8	0.741
380	1.3961	0.926	181	13.0	22.75	17.6	0.737
400	1.3257	0.942	190	14.3	24.3	19.5	0.737
450	1.1782	0.981	210	17.8	28.3	24.5	0.728
500	1.0594	1.02	231	21.8	32.5	30.1	0.725
550	0.9625	1.05	251	26.1	36.6	36.2	0.721
600	0.8826	1.08	270	30.6	40.7	42.7	0.717
650	0.8143	1.10	288	35.4	44.5	49.7	0.712
700	0.7564	1.13	305	40.3	48.1	56.3	0.717
750	0.7057	1.15	321	45.5	51.7	63.7	0.714
800	0.6614	1.17	337	51.0	55.1	71.2	0.716
<b>Carbon Monoxide (CO)</b>							
200	1.6888	1.045	127	7.52	17.0	9.63	0.781
220	1.5341	1.044	137	8.93	19.0	11.9	0.753
240	1.4055	1.043	147	10.5	20.6	14.1	0.744
260	1.2967	1.043	157	12.1	22.1	16.3	0.741
280	1.2038	1.042	166	13.8	23.6	18.8	0.733
300	1.1233	1.043	175	15.6	25.0	21.3	0.730
320	1.0529	1.043	184	17.5	26.3	23.9	0.730
340	0.9909	1.044	193	19.5	27.8	26.9	0.725
360	0.9357	1.045	202	21.6	29.1	29.8	0.725
380	0.8864	1.047	210	23.7	30.5	32.9	0.729
400	0.8421	1.049	218	25.9	31.8	36.0	0.719
450	0.7483	1.055	237	31.7	35.0	44.3	0.714
500	0.67352	1.065	254	37.7	38.1	53.1	0.710
550	0.61226	1.076	271	44.3	41.1	62.4	0.710
600	0.56126	1.088	286	51.0	44.0	72.1	0.707

TABLE A.4 Continued

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^7$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$Pr$
<b>Carbon Monoxide (CO) (continued)</b>							
650	0.51806	1.101	301	58.1	47.0	82.4	0.705
700	0.48102	1.114	315	65.5	50.0	93.3	0.702
750	0.44899	1.127	329	73.3	52.8	104	0.702
800	0.42095	1.140	343	81.5	55.5	116	0.705
<b>Helium (He)</b>							
100	0.4871	5.193	96.3	19.8	73.0	28.9	0.686
120	0.4060	5.193	107	26.4	81.9	38.8	0.679
140	0.3481	5.193	118	33.9	90.7	50.2	0.676
160	—	5.193	129	—	99.2	—	—
180	0.2708	5.193	139	51.3	107.2	76.2	0.673
200	—	5.193	150	—	115.1	—	—
220	0.2216	5.193	160	72.2	123.1	107	0.675
240	—	5.193	170	—	130	—	—
260	0.1875	5.193	180	96.0	137	141	0.682
280	—	5.193	190	—	145	—	—
300	0.1625	5.193	199	122	152	180	0.680
350	—	5.193	221	—	170	—	—
400	0.1219	5.193	243	199	187	295	0.675
450	—	5.193	263	—	204	—	—
500	0.09754	5.193	283	290	220	434	0.668
550	—	5.193	—	—	—	—	—
600	—	5.193	320	—	252	—	—
650	—	5.193	332	—	264	—	—
700	0.06969	5.193	350	502	278	768	0.654
750	—	5.193	364	—	291	—	—
800	—	5.193	382	—	304	—	—
900	—	5.193	414	—	330	—	—
1000	0.04879	5.193	446	914	354	1400	0.654
<b>Hydrogen (H<sub>2</sub>)</b>							
100	0.24255	11.23	42.1	17.4	67.0	24.6	0.707
150	0.16156	12.60	56.0	34.7	101	49.6	0.699
200	0.12115	13.54	68.1	56.2	131	79.9	0.704
250	0.09693	14.06	78.9	81.4	157	115	0.707
300	0.08078	14.31	89.6	111	183	158	0.701
350	0.06924	14.43	98.8	143	204	204	0.700
400	0.06059	14.48	108.2	179	226	258	0.695
450	0.05386	14.50	117.2	218	247	316	0.689
500	0.04848	14.52	126.4	261	266	378	0.691
550	0.04407	14.53	134.3	305	285	445	0.685

TABLE A.4 Continued

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^7$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$Pr$
<b>Hydrogen (H<sub>2</sub>) (continued)</b>							
600	0.04040	14.55	142.4	352	305	519	0.678
700	0.03463	14.61	157.8	456	342	676	0.675
800	0.03030	14.70	172.4	569	378	849	0.670
900	0.02694	14.83	186.5	692	412	1030	0.671
1000	0.02424	14.99	201.3	830	448	1230	0.673
1100	0.02204	15.17	213.0	966	488	1460	0.662
1200	0.02020	15.37	226.2	1120	528	1700	0.659
1300	0.01865	15.59	238.5	1279	568	1955	0.655
1400	0.01732	15.81	250.7	1447	610	2230	0.650
1500	0.01616	16.02	262.7	1626	655	2530	0.643
1600	0.0152	16.28	273.7	1801	697	2815	0.639
1700	0.0143	16.58	284.9	1992	742	3130	0.637
1800	0.0135	16.96	296.1	2193	786	3435	0.639
1900	0.0128	17.49	307.2	2400	835	3730	0.643
2000	0.0121	18.25	318.2	2630	878	3975	0.661
<b>Nitrogen (N<sub>2</sub>)</b>							
100	3.4388	1.070	68.8	2.00	9.58	2.60	0.768
150	2.2594	1.050	100.6	4.45	13.9	5.86	0.759
200	1.6883	1.043	129.2	7.65	18.3	10.4	0.736
250	1.3488	1.042	154.9	11.48	22.2	15.8	0.727
300	1.1233	1.041	178.2	15.86	25.9	22.1	0.716
350	0.9625	1.042	200.0	20.78	29.3	29.2	0.711
400	0.8425	1.045	220.4	26.16	32.7	37.1	0.704
450	0.7485	1.050	239.6	32.01	35.8	45.6	0.703
500	0.6739	1.056	257.7	38.24	38.9	54.7	0.700
550	0.6124	1.065	274.7	44.86	41.7	63.9	0.702
600	0.5615	1.075	290.8	51.79	44.6	73.9	0.701
700	0.4812	1.098	321.0	66.71	49.9	94.4	0.706
800	0.4211	1.22	349.1	82.90	54.8	116	0.715
900	0.3743	1.146	375.3	100.3	59.7	139	0.721
1000	0.3368	1.167	399.9	118.7	64.7	165	0.721
1100	0.3062	1.187	423.2	138.2	70.0	193	0.718
1200	0.2807	1.204	445.3	158.6	75.8	224	0.707
1300	0.2591	1.219	466.2	179.9	81.0	256	0.701
<b>Oxygen (O<sub>2</sub>)</b>							
100	3.945	0.962	76.4	1.94	9.25	2.44	0.796
150	2.585	0.921	114.8	4.44	13.8	5.80	0.766
200	1.930	0.915	147.5	7.64	18.3	10.4	0.737
250	1.542	0.915	178.6	11.58	22.6	16.0	0.723
300	1.284	0.920	207.2	16.14	26.8	22.7	0.711

**TABLE A.4** *Continued*

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^7$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^6$ (m <sup>2</sup> /s)	$Pr$
<b>Oxygen (O<sub>2</sub>) (continued)</b>							
350	1.100	0.929	233.5	21.23	29.6	29.0	0.733
400	0.9620	0.942	258.2	26.84	33.0	36.4	0.737
450	0.8554	0.956	281.4	32.90	36.3	44.4	0.741
500	0.7698	0.972	303.3	39.40	41.2	55.1	0.716
550	0.6998	0.988	324.0	46.30	44.1	63.8	0.726
600	0.6414	1.003	343.7	53.59	47.3	73.5	0.729
700	0.5498	1.031	380.8	69.26	52.8	93.1	0.744
800	0.4810	1.054	415.2	86.32	58.9	116	0.743
900	0.4275	1.074	447.2	104.6	64.9	141	0.740
1000	0.3848	1.090	477.0	124.0	71.0	169	0.733
1100	0.3498	1.103	505.5	144.5	75.8	196	0.736
1200	0.3206	1.115	532.5	166.1	81.9	229	0.725
1300	0.2960	1.125	588.4	188.6	87.1	262	0.721
<b>Water Vapor (Steam)</b>							
380	0.5863	2.060	127.1	21.68	24.6	20.4	1.06
400	0.5542	2.014	134.4	24.25	26.1	23.4	1.04
450	0.4902	1.980	152.5	31.11	29.9	30.8	1.01
500	0.4405	1.985	170.4	38.68	33.9	38.8	0.998
550	0.4005	1.997	188.4	47.04	37.9	47.4	0.993
600	0.3652	2.026	206.7	56.60	42.2	57.0	0.993
650	0.3380	2.056	224.7	66.48	46.4	66.8	0.996
700	0.3140	2.085	242.6	77.26	50.5	77.1	1.00
750	0.2931	2.119	260.4	88.84	54.9	88.4	1.00
800	0.2739	2.152	278.6	101.7	59.2	100	1.01
850	0.2579	2.186	296.9	115.1	63.7	113	1.02

<sup>a</sup>Adapted from References 8, 14, and 15.

**TABLE A.5** Thermophysical Properties of Saturated Fluids<sup>a</sup>*Saturated Liquids*

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^2$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^7$ (m <sup>2</sup> /s)	$Pr$	$\beta \cdot 10^3$ (K <sup>-1</sup> )
<b>Engine Oil (Unused)</b>								
273	899.1	1.796	385	4280	147	0.910	47,000	0.70
280	895.3	1.827	217	2430	144	0.880	27,500	0.70
290	890.0	1.868	99.9	1120	145	0.872	12,900	0.70
300	884.1	1.909	48.6	550	145	0.859	6400	0.70
310	877.9	1.951	25.3	288	145	0.847	3400	0.70
320	871.8	1.993	14.1	161	143	0.823	1965	0.70
330	865.8	2.035	8.36	96.6	141	0.800	1205	0.70
340	859.9	2.076	5.31	61.7	139	0.779	793	0.70
350	853.9	2.118	3.56	41.7	138	0.763	546	0.70
360	847.8	2.161	2.52	29.7	138	0.753	395	0.70
370	841.8	2.206	1.86	22.0	137	0.738	300	0.70
380	836.0	2.250	1.41	16.9	136	0.723	233	0.70
390	830.6	2.294	1.10	13.3	135	0.709	187	0.70
400	825.1	2.337	0.874	10.6	134	0.695	152	0.70
410	818.9	2.381	0.698	8.52	133	0.682	125	0.70
420	812.1	2.427	0.564	6.94	133	0.675	103	0.70
430	806.5	2.471	0.470	5.83	132	0.662	88	0.70
<b>Ethylene Glycol [C<sub>2</sub>H<sub>4</sub>(OH)<sub>2</sub>]</b>								
273	1130.8	2.294	6.51	57.6	242	0.933	617	0.65
280	1125.8	2.323	4.20	37.3	244	0.933	400	0.65
290	1118.8	2.368	2.47	22.1	248	0.936	236	0.65
300	1114.4	2.415	1.57	14.1	252	0.939	151	0.65
310	1103.7	2.460	1.07	9.65	255	0.939	103	0.65
320	1096.2	2.505	0.757	6.91	258	0.940	73.5	0.65
330	1089.5	2.549	0.561	5.15	260	0.936	55.0	0.65
340	1083.8	2.592	0.431	3.98	261	0.929	42.8	0.65
350	1079.0	2.637	0.342	3.17	261	0.917	34.6	0.65
360	1074.0	2.682	0.278	2.59	261	0.906	28.6	0.65
370	1066.7	2.728	0.228	2.14	262	0.900	23.7	0.65
373	1058.5	2.742	0.215	2.03	263	0.906	22.4	0.65
<b>Glycerin [C<sub>3</sub>H<sub>5</sub>(OH)<sub>3</sub>]</b>								
273	1276.0	2.261	1060	8310	282	0.977	85,000	0.47
280	1271.9	2.298	534	4200	284	0.972	43,200	0.47
290	1265.8	2.367	185	1460	286	0.955	15,300	0.48
300	1259.9	2.427	79.9	634	286	0.935	6780	0.48
310	1253.9	2.490	35.2	281	286	0.916	3060	0.49
320	1247.2	2.564	21.0	168	287	0.897	1870	0.50

TABLE A.5 Continued

## Saturated Liquids (Continued)

$T$ (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\mu \cdot 10^2$ (N · s/m <sup>2</sup> )	$\nu \cdot 10^6$ (m <sup>2</sup> /s)	$k \cdot 10^3$ (W/m · K)	$\alpha \cdot 10^7$ (m <sup>2</sup> /s)	$Pr$	$\beta \cdot 10^3$ (K <sup>-1</sup> )
<b>Refrigerant-134a (C<sub>2</sub>H<sub>2</sub>F<sub>4</sub>)</b>								
230	1426.8	1.249	0.04912	0.3443	112.1	0.629	5.5	2.02
240	1397.7	1.267	0.04202	0.3006	107.3	0.606	5.0	2.11
250	1367.9	1.287	0.03633	0.2656	102.5	0.583	4.6	2.23
260	1337.1	1.308	0.03166	0.2368	97.9	0.560	4.2	2.36
270	1305.1	1.333	0.02775	0.2127	93.4	0.537	4.0	2.53
280	1271.8	1.361	0.02443	0.1921	89.0	0.514	3.7	2.73
290	1236.8	1.393	0.02156	0.1744	84.6	0.491	3.5	2.98
300	1199.7	1.432	0.01905	0.1588	80.3	0.468	3.4	3.30
310	1159.9	1.481	0.01680	0.1449	76.1	0.443	3.3	3.73
320	1116.8	1.543	0.01478	0.1323	71.8	0.417	3.2	4.33
330	1069.1	1.627	0.01292	0.1209	67.5	0.388	3.1	5.19
340	1015.0	1.751	0.01118	0.1102	63.1	0.355	3.1	6.57
350	951.3	1.961	0.00951	0.1000	58.6	0.314	3.2	9.10
360	870.1	2.437	0.00781	0.0898	54.1	0.255	3.5	15.39
370	740.3	5.105	0.00580	0.0783	51.8	0.137	5.7	55.24
<b>Refrigerant-22 (CHClF<sub>2</sub>)</b>								
230	1416.0	1.087	0.03558	0.2513	114.5	0.744	3.4	2.05
240	1386.6	1.100	0.03145	0.2268	109.8	0.720	3.2	2.16
250	1356.3	1.117	0.02796	0.2062	105.2	0.695	3.0	2.29
260	1324.9	1.137	0.02497	0.1884	100.7	0.668	2.8	2.45
270	1292.1	1.161	0.02235	0.1730	96.2	0.641	2.7	2.63
280	1257.9	1.189	0.02005	0.1594	91.7	0.613	2.6	2.86
290	1221.7	1.223	0.01798	0.1472	87.2	0.583	2.5	3.15
300	1183.4	1.265	0.01610	0.1361	82.6	0.552	2.5	3.51
310	1142.2	1.319	0.01438	0.1259	78.1	0.518	2.4	4.00
320	1097.4	1.391	0.01278	0.1165	73.4	0.481	2.4	4.69
330	1047.5	1.495	0.01127	0.1075	68.6	0.438	2.5	5.75
340	990.1	1.665	0.00980	0.0989	63.6	0.386	2.6	7.56
350	920.1	1.997	0.00831	0.0904	58.3	0.317	2.8	11.35
360	823.4	3.001	0.00668	0.0811	53.1	0.215	3.8	23.88
<b>Mercury (Hg)</b>								
273	13,595	0.1404	0.1688	0.1240	8180	42.85	0.0290	0.181
300	13,529	0.1393	0.1523	0.1125	8540	45.30	0.0248	0.181
350	13,407	0.1377	0.1309	0.0976	9180	49.75	0.0196	0.181
400	13,287	0.1365	0.1171	0.0882	9800	54.05	0.0163	0.181
450	13,167	0.1357	0.1075	0.0816	10,400	58.10	0.0140	0.181
500	13,048	0.1353	0.1007	0.0771	10,950	61.90	0.0125	0.182
550	12,929	0.1352	0.0953	0.0737	11,450	65.55	0.0112	0.184
600	12,809	0.1355	0.0911	0.0711	11,950	68.80	0.0103	0.187

**TABLE A.5** Continued*Saturated Liquid–Vapor, 1 atm<sup>b</sup>*

Fluid	$T_{\text{sat}}$ (K)	$h_{fg}$ (kJ/kg)	$\rho_f$ (kg/m <sup>3</sup> )	$\rho_g$ (kg/m <sup>3</sup> )	$\sigma \cdot 10^3$ (N/m)
Ethanol	351	846	757	1.44	17.7
Ethylene glycol	470	812	1111 <sup>c</sup>	—	32.7
Glycerin	563	974	1260 <sup>c</sup>	—	63.0 <sup>c</sup>
Mercury	630	301	12,740	3.90	417
Refrigerant R-134a	247	217	1377	5.26	15.4
Refrigerant R-22	232	234	1409	4.70	18.1

<sup>a</sup>Adapted from References 15–19.<sup>b</sup>Adapted from References 8, 20, and 21.<sup>c</sup>Property value corresponding to 300 K.

TABLE A.6 Thermophysical Properties of Saturated Water<sup>a</sup>

Temperature, <i>T</i> (K)	Specific Volume (m <sup>3</sup> /kg)		Heat of Vaporization, <i>h<sub>fg</sub></i> (kJ/kg)	Specific Heat (kJ/kg · K)		Viscosity (N · s/m <sup>2</sup> )		Thermal Conductivity (W/m · K)		Prandtl Number		Surface Tension, $\sigma_f \cdot 10^3$ (N/m)	Expansion Coeff., $\beta_f \cdot 10^6$ (K <sup>-1</sup> )	Temperature, <i>T</i> (K)
	<i>p</i> (bars) <sup>b</sup>	<i>v<sub>f</sub></i> · 10 <sup>3</sup>	<i>v<sub>g</sub></i>	<i>c<sub>p,f</sub></i>	<i>c<sub>p,g</sub></i>	$\mu_f \cdot 10^6$	$\mu_g \cdot 10^6$	<i>k<sub>f</sub></i> · 10 <sup>3</sup>	<i>k<sub>g</sub></i> · 10 <sup>3</sup>	<i>Pr<sub>f</sub></i>	<i>Pr<sub>g</sub></i>			
273.15	0.00611	1.000	206.3	4.217	1.854	1750	8.02	569	18.2	12.99	0.815	75.5	-68.05	273.15
275	0.00697	1.000	181.7	4.211	1.855	1652	8.09	574	18.3	12.22	0.817	75.3	-32.74	275
280	0.00990	1.000	130.4	4.198	1.858	1422	8.29	582	18.6	10.26	0.825	74.8	46.04	280
285	0.01387	1.000	99.4	4.189	1.861	1225	8.49	590	18.9	8.81	0.833	74.3	114.1	285
290	0.01917	1.001	69.7	4.184	1.864	1080	8.69	598	19.3	7.56	0.841	73.7	174.0	290
295	0.02617	1.002	51.94	4.181	1.868	959	8.89	606	19.5	6.62	0.849	72.7	227.5	295
300	0.03531	1.003	39.13	4.179	1.872	855	9.09	613	19.6	5.83	0.857	71.7	276.1	300
305	0.04712	1.005	29.74	4.178	1.877	769	9.29	620	20.1	5.20	0.865	70.9	320.6	305
310	0.06221	1.007	22.93	4.178	1.882	695	9.49	628	20.4	4.62	0.873	70.0	361.9	310
315	0.08132	1.009	17.82	4.179	1.888	631	9.69	634	20.7	4.16	0.883	69.2	400.4	315
320	0.1053	1.011	13.98	4.180	1.895	577	9.89	640	21.0	3.77	0.894	68.3	436.7	320
325	0.1351	1.013	11.06	4.182	1.903	528	10.09	645	21.3	3.42	0.901	67.5	471.2	325
330	0.1719	1.016	8.82	4.184	1.911	489	10.29	650	21.7	3.15	0.908	66.6	504.0	330
335	0.2167	1.018	7.09	4.186	1.920	453	10.49	656	22.0	2.88	0.916	65.8	535.5	335
340	0.2713	1.021	5.74	4.188	1.930	420	10.69	660	22.3	2.66	0.925	64.9	566.0	340
345	0.3372	1.024	4.683	4.191	1.941	389	10.89	668	22.6	2.45	0.933	64.1	595.4	345
350	0.4163	1.027	3.846	4.195	1.954	365	11.09	668	23.0	2.29	0.942	63.2	624.2	350
355	0.5100	1.030	3.180	4.199	1.968	343	11.29	671	23.3	2.14	0.951	62.3	652.3	355
360	0.6209	1.034	2.645	4.203	1.983	324	11.49	674	23.7	2.02	0.960	61.4	697.9	360
365	0.7514	1.038	2.212	4.209	1.999	306	11.69	677	24.1	1.91	0.969	60.5	707.1	365
370	0.9040	1.041	1.861	4.214	2.017	289	11.89	679	24.5	1.80	0.978	59.5	728.7	370
373.15	1.0133	1.044	1.679	4.217	2.029	279	12.02	680	24.8	1.76	0.984	58.9	750.1	373.15
375	1.0815	1.045	1.574	4.220	2.036	274	12.09	681	24.9	1.70	0.987	58.6	761	375
380	1.2869	1.049	1.337	4.226	2.057	260	12.29	683	25.4	1.61	0.999	57.6	788	380
385	1.5233	1.053	1.142	4.232	2.080	248	12.49	685	25.8	1.53	1.004	56.6	814	385
390	1.794	1.058	0.980	4.239	2.104	237	12.69	686	26.3	1.47	1.013	55.6	841	390
400	2.455	1.067	0.731	4.256	2.158	217	13.05	688	27.2	1.34	1.033	53.6	896	400
410	3.302	1.077	0.553	4.278	2.221	200	13.42	688	28.2	1.24	1.054	51.5	952	410
420	4.370	1.088	0.425	4.302	2.291	185	13.79	688	29.8	1.16	1.075	49.4	1010	420
430	5.699	1.099	0.331	4.331	2.369	173	14.14	685	30.4	1.09	1.10	47.2		430



TABLE A.6 Continued

Temperature, $T$ (K)	Pressure, $p$ (bars) <sup>b</sup>	Specific Volume (m <sup>3</sup> /kg)		Heat of Vaporization, $h_{fg}$ (kJ/kg)	Specific Heat (kJ/kg · K)		Viscosity (N · s/m <sup>2</sup> )		Thermal Conductivity (W/m · K)		Prandtl Number		Surface Tension, $\sigma_f \cdot 10^3$ (N/m)	Expansion Coefficient, $\beta_f \cdot 10^6$ (K <sup>-1</sup> )	Temperature, $T$ (K)
		$v_f \cdot 10^3$	$v_g$		$c_{p,f}$	$c_{p,g}$	$\mu_f \cdot 10^6$	$\mu_g \cdot 10^6$	$k_f \cdot 10^3$	$k_g \cdot 10^3$	$Pr_f$	$Pr_g$			
440	7.333	1.110	0.261	2059	4.36	2.46	162	14.50	682	31.7	1.04	1.12	45.1	—	440
450	9.319	1.123	0.208	2024	4.40	2.56	152	14.85	678	33.1	0.99	1.14	42.9	—	450
460	11.71	1.137	0.167	1989	4.44	2.68	143	15.19	673	34.6	0.95	1.17	40.7	—	460
470	14.55	1.152	0.136	1951	4.48	2.79	136	15.54	667	36.3	0.92	1.20	38.5	—	470
480	17.90	1.167	0.111	1912	4.53	2.94	129	15.88	660	38.1	0.89	1.23	36.2	—	480
490	21.83	1.184	0.0922	1870	4.59	3.10	124	16.23	651	40.1	0.87	1.25	33.9	—	490
500	26.40	1.203	0.0766	1825	4.66	3.27	118	16.59	642	42.3	0.86	1.28	31.6	—	500
510	31.66	1.222	0.0631	1779	4.74	3.47	113	16.95	631	44.7	0.85	1.31	29.3	—	510
520	37.70	1.244	0.0525	1730	4.84	3.70	108	17.33	621	47.5	0.84	1.35	26.9	—	520
530	44.58	1.268	0.0445	1679	4.95	3.96	104	17.72	608	50.6	0.85	1.39	24.5	—	530
540	52.38	1.294	0.0375	1622	5.08	4.27	101	18.1	594	54.0	0.86	1.43	22.1	—	540
550	61.19	1.323	0.0317	1564	5.24	4.64	97	18.6	580	58.3	0.87	1.47	19.7	—	550
560	71.08	1.355	0.0269	1499	5.43	5.09	94	19.1	563	63.7	0.90	1.52	17.3	—	560
570	82.16	1.392	0.0228	1429	5.68	5.67	91	19.7	548	76.7	0.94	1.59	15.0	—	570
580	94.51	1.433	0.0193	1353	6.00	6.40	88	20.4	528	76.7	0.99	1.68	12.8	—	580
590	108.3	1.482	0.0163	1274	6.41	7.35	84	21.5	513	84.1	1.05	1.84	10.5	—	590
600	123.5	1.541	0.0137	1176	7.00	8.75	81	22.7	497	92.9	1.14	2.15	8.4	—	600
610	137.3	1.612	0.0115	1068	7.85	11.1	77	24.1	467	103	1.30	2.60	6.3	—	610
620	159.1	1.705	0.0094	941	9.35	15.4	72	25.9	444	114	1.52	3.46	4.5	—	620
625	169.1	1.778	0.0085	858	10.6	18.3	70	27.0	430	121	1.65	4.20	3.5	—	625
630	179.7	1.856	0.0075	781	12.6	22.1	67	28.0	412	130	2.0	4.8	2.6	—	630
635	190.9	1.935	0.0066	683	16.4	27.6	64	30.0	392	141	2.7	6.0	1.5	—	635
640	202.7	2.075	0.0057	560	26	42	59	32.0	367	155	4.2	9.6	0.8	—	640
645	215.2	2.351	0.0045	361	90	—	54	37.0	331	178	12	26	0.1	—	645
647.3 <sup>c</sup>	221.2	3.170	0.0032	0	∞	∞	45	45.0	238	238	∞	∞	0.0	—	647.3 <sup>c</sup>

<sup>a</sup>Adapted from Reference 22.

<sup>b</sup>1 bar = 10<sup>5</sup> N/m<sup>2</sup>.

<sup>c</sup>Critical temperature.

**TABLE A.7** Thermophysical Properties of Liquid Metals<sup>a</sup>

Composition	Melting Point (K)	<i>T</i> (K)	$\rho$ (kg/m <sup>3</sup> )	$c_p$ (kJ/kg · K)	$\nu \cdot 10^7$ (m <sup>2</sup> /s)	<i>k</i> (W/m · K)	$\alpha \cdot 10^5$ (m <sup>2</sup> /s)	<i>Pr</i>
Bismuth	544	589	10,011	0.1444	1.617	16.4	0.138	0.0142
		811	9739	0.1545	1.133	15.6	1.035	0.0110
		1033	9467	0.1645	0.8343	15.6	1.001	0.0083
Lead	600	644	10,540	0.159	2.276	16.1	1.084	0.024
		755	10,412	0.155	1.849	15.6	1.223	0.017
		977	10,140	—	1.347	14.9	—	—
Potassium	337	422	807.3	0.80	4.608	45.0	6.99	0.0066
		700	741.7	0.75	2.397	39.5	7.07	0.0034
		977	674.4	0.75	1.905	33.1	6.55	0.0029
Sodium	371	366	929.1	1.38	7.516	86.2	6.71	0.011
		644	860.2	1.30	3.270	72.3	6.48	0.0051
		977	778.5	1.26	2.285	59.7	6.12	0.0037
NaK, (45%/55%)	292	366	887.4	1.130	6.522	25.6	2.552	0.026
		644	821.7	1.055	2.871	27.5	3.17	0.0091
		977	740.1	1.043	2.174	28.9	3.74	0.0058
NaK, (22%/78%)	262	366	849.0	0.946	5.797	24.4	3.05	0.019
		672	775.3	0.879	2.666	26.7	3.92	0.0068
		1033	690.4	0.883	2.118	—	—	—
PbBi, (44.5%/55.5%)	398	422	10,524	0.147	—	9.05	0.586	—
		644	10,236	0.147	1.496	11.86	0.790	0.189
		922	9835	—	1.171	—	—	—
Mercury	234	See Table A.5						

<sup>a</sup>Adapted from Reference 23.

**TABLE A.8** Binary Diffusion Coefficients at One Atmosphere<sup>a,b</sup>

Substance A	Substance B	<i>T</i> (K)	<i>D</i> <sub>AB</sub> (m <sup>2</sup> /s)
<b>Gases</b>			
NH <sub>3</sub>	Air	298	$0.28 \times 10^{-4}$
H <sub>2</sub> O	Air	298	$0.26 \times 10^{-4}$
CO <sub>2</sub>	Air	298	$0.16 \times 10^{-4}$
H <sub>2</sub>	Air	298	$0.41 \times 10^{-4}$
O <sub>2</sub>	Air	298	$0.21 \times 10^{-4}$
Acetone	Air	273	$0.11 \times 10^{-4}$
Benzene	Air	298	$0.88 \times 10^{-5}$
Naphthalene	Air	300	$0.62 \times 10^{-5}$
Ar	N <sub>2</sub>	293	$0.19 \times 10^{-4}$
H <sub>2</sub>	O <sub>2</sub>	273	$0.70 \times 10^{-4}$
H <sub>2</sub>	N <sub>2</sub>	273	$0.68 \times 10^{-4}$
H <sub>2</sub>	CO <sub>2</sub>	273	$0.55 \times 10^{-4}$
CO <sub>2</sub>	N <sub>2</sub>	293	$0.16 \times 10^{-4}$
CO <sub>2</sub>	O <sub>2</sub>	273	$0.14 \times 10^{-4}$
O <sub>2</sub>	N <sub>2</sub>	273	$0.18 \times 10^{-4}$
<b>Dilute Solutions</b>			
Caffeine	H <sub>2</sub> O	298	$0.63 \times 10^{-9}$
Ethanol	H <sub>2</sub> O	298	$0.12 \times 10^{-8}$
Glucose	H <sub>2</sub> O	298	$0.69 \times 10^{-9}$
Glycerol	H <sub>2</sub> O	298	$0.94 \times 10^{-9}$
Acetone	H <sub>2</sub> O	298	$0.13 \times 10^{-8}$
CO <sub>2</sub>	H <sub>2</sub> O	298	$0.20 \times 10^{-8}$
O <sub>2</sub>	H <sub>2</sub> O	298	$0.24 \times 10^{-8}$
H <sub>2</sub>	H <sub>2</sub> O	298	$0.63 \times 10^{-8}$
N <sub>2</sub>	H <sub>2</sub> O	298	$0.26 \times 10^{-8}$
<b>Solids</b>			
O <sub>2</sub>	Rubber	298	$0.21 \times 10^{-9}$
N <sub>2</sub>	Rubber	298	$0.15 \times 10^{-9}$
CO <sub>2</sub>	Rubber	298	$0.11 \times 10^{-9}$
He	SiO <sub>2</sub>	293	$0.4 \times 10^{-13}$
H <sub>2</sub>	Fe	293	$0.26 \times 10^{-12}$
Cd	Cu	293	$0.27 \times 10^{-18}$
Al	Cu	293	$0.13 \times 10^{-33}$

<sup>a</sup>Adapted with permission from References 24, 25, and 26.<sup>b</sup>Assuming ideal gas behavior, the pressure and temperature dependence of the diffusion coefficient for a binary mixture of gases may be estimated from the relation

$$D_{AB} \propto p^{-1} T^{3/2}$$

**TABLE A.9** Henry's Constant for Selected Gases in Water at Moderate Pressure<sup>a</sup>

$H = p_{A,i}/x_{A,i}$ (bars)								
$T$ (K)	NH <sub>3</sub>	Cl <sub>2</sub>	H <sub>2</sub> S	SO <sub>2</sub>	CO <sub>2</sub>	CH <sub>4</sub>	O <sub>2</sub>	H <sub>2</sub>
273	21	265	260	165	710	22,880	25,500	58,000
280	23	365	335	210	960	27,800	30,500	61,500
290	26	480	450	315	1300	35,200	37,600	66,500
300	30	615	570	440	1730	42,800	45,700	71,600
310	—	755	700	600	2175	50,000	52,500	76,000
320	—	860	835	800	2650	56,300	56,800	78,600
323	—	890	870	850	2870	58,000	58,000	79,000

<sup>a</sup>Adapted with permission from Reference 27.**TABLE A.10** The Solubility of Selected Gases and Solids<sup>a</sup>

Gas	Solid	$T$ (K)	$S = C_{A,i}/p_{A,i}$ (kmol/m <sup>3</sup> · bar)
O <sub>2</sub>	Rubber	298	$3.12 \times 10^{-3}$
N <sub>2</sub>	Rubber	298	$1.56 \times 10^{-3}$
CO <sub>2</sub>	Rubber	298	$40.15 \times 10^{-3}$
He	SiO <sub>2</sub>	293	$0.45 \times 10^{-3}$
H <sub>2</sub>	Ni	358	$9.01 \times 10^{-3}$

<sup>a</sup>Adapted with permission from Reference 26.

TABLE A.11 Total, Normal (*n*) or Hemispherical (*h*) Emissivity of Selected Surfaces

Metallic Solids and Their Oxides <sup>a</sup>												
Description/Composition	Emissivity, $\epsilon_n$ or $\epsilon_h$ , at Various Temperatures (K)											
	100	200	300	400	600	800	1000	1200	1500	2000	2500	
Aluminum												
Highly polished, film	( <i>h</i> )	0.02	0.03	0.04	0.05	0.06						
Foil, bright	( <i>h</i> )	0.06	0.06	0.07								
Anodized	( <i>h</i> )			0.82	0.76							
Chromium												
Polished or plated	( <i>n</i> )	0.05	0.07	0.10	0.12	0.14						
Copper												
Highly polished	( <i>h</i> )			0.03	0.03	0.04	0.04	0.04				
Stably oxidized	( <i>h</i> )					0.50	0.58	0.80				
Gold												
Highly polished or film	( <i>h</i> )	0.01	0.02	0.03	0.03	0.04	0.05	0.06				
Foil, bright	( <i>h</i> )	0.06	0.07	0.07								
Molybdenum												
Polished	( <i>h</i> )					0.06	0.08	0.10	0.12	0.15	0.21	
Shot-blasted, rough	( <i>h</i> )					0.25	0.28	0.31	0.35	0.42		
Stably oxidized	( <i>h</i> )					0.80	0.82				0.26	
Nickel												
Polished	( <i>h</i> )					0.09	0.11	0.14	0.17			
Stably oxidized	( <i>h</i> )					0.40	0.49	0.57				
Platinum												
Polished	( <i>h</i> )						0.10	0.13	0.15	0.18		
Silver												
Polished	( <i>h</i> )			0.02	0.02	0.03	0.05	0.08				
Stainless steels												
Typical, polished	( <i>n</i> )			0.17	0.17	0.19	0.23	0.30				
Typical, cleaned	( <i>n</i> )			0.22	0.22	0.24	0.28	0.35				
Typical, lightly oxidized	( <i>n</i> )						0.33	0.40				
Typical, highly oxidized	( <i>n</i> )						0.67	0.70	0.76			
AISI 347, stably oxidized	( <i>n</i> )					0.87	0.88	0.89	0.90			
Tantalum												
Polished	( <i>h</i> )								0.11	0.17	0.23	
Tungsten												
Polished	( <i>h</i> )							0.10	0.13	0.18	0.25	
											0.29	

**TABLE A.11** *Continued***Nonmetallic Substances<sup>b</sup>**

Description/Composition		Temperature (K)	Emissivity $\epsilon$
Aluminum oxide	(n)	600	0.69
		1000	0.55
		1500	0.41
Asphalt pavement	(h)	300	0.85–0.93
Building materials			
Asbestos sheet	(h)	300	0.93–0.96
Brick, red	(h)	300	0.93–0.96
Gypsum or plaster board	(h)	300	0.90–0.92
Wood	(h)	300	0.82–0.92
Cloth	(h)	300	0.75–0.90
Concrete	(h)	300	0.88–0.93
Glass, window	(h)	300	0.90–0.95
Ice	(h)	273	0.95–0.98
Paints			
Black (Parsons)	(h)	300	0.98
White, acrylic	(h)	300	0.90
White, zinc oxide	(h)	300	0.92
Paper, white	(h)	300	0.92–0.97
Pyrex	(n)	300	0.82
		600	0.80
		1000	0.71
		1200	0.62
Pyroceram	(n)	300	0.85
		600	0.78
		1000	0.69
		1500	0.57
Refractories (furnace liners)			
Alumina brick	(n)	800	0.40
		1000	0.33
		1400	0.28
		1600	0.33
Magnesia brick	(n)	800	0.45
		1000	0.36
		1400	0.31
		1600	0.40
Kaolin insulating brick	(n)	800	0.70
		1200	0.57
		1400	0.47
		1600	0.53
Sand	(h)	300	0.90
Silicon carbide	(n)	600	0.87
		1000	0.87
		1500	0.85
Skin	(h)	300	0.95
Snow	(h)	273	0.82–0.90

**TABLE A.11** Continued**Nonmetallic Substances<sup>b</sup>**

Description/Composition		Temperature (K)	Emissivity $\epsilon$
Soil	(h)	300	0.93–0.96
Rocks	(h)	300	0.88–0.95
Teflon	(h)	300	0.85
		400	0.87
		500	0.92
Vegetation	(h)	300	0.92–0.96
Water	(h)	300	0.96

<sup>a</sup>Adapted from Reference 1.<sup>b</sup>Adapted from References 1, 9, 28, and 29.**TABLE A.12** Solar Radiative Properties for Selected Materials<sup>a</sup>

Description/Composition	$\alpha_s$	$\epsilon^b$	$\alpha_s/\epsilon$	$\tau_s$
Aluminum				
Polished	0.09	0.03	3.0	
Anodized	0.14	0.84	0.17	
Quartz overcoated	0.11	0.37	0.30	
Foil	0.15	0.05	3.0	
Brick, red (Purdue)	0.63	0.93	0.68	
Concrete	0.60	0.88	0.68	
Galvanized sheet metal				
Clean, new	0.65	0.13	5.0	
Oxidized, weathered	0.80	0.28	2.9	
Glass, 3.2-mm thickness				
Float or tempered				0.79
Low iron oxide type				0.88
Metal, plated				
Black sulfide	0.92	0.10	9.2	
Black cobalt oxide	0.93	0.30	3.1	
Black nickel oxide	0.92	0.08	11	
Black chrome	0.87	0.09	9.7	
Mylar, 0.13-mm thickness				0.87
Paints				
Black (Parsons)	0.98	0.98	1.0	
White, acrylic	0.26	0.90	0.29	
White, zinc oxide	0.16	0.93	0.17	
Plexiglas, 3.2-mm thickness				0.90
Snow				
Fine particles, fresh	0.13	0.82	0.16	
Ice granules	0.33	0.89	0.37	
Tedlar, 0.10-mm thickness				0.92
Teflon, 0.13-mm thickness				0.92

<sup>a</sup>Adapted with permission from Reference 29.<sup>b</sup>The emissivity values in this table correspond to a surface temperature of approximately 300 K.

## References

1. Touloukian, Y. S., and C. Y. Ho, Eds., *Thermophysical Properties of Matter*, Vol. 1, *Thermal Conductivity of Metallic Solids*; Vol. 2, *Thermal Conductivity of Non-metallic Solids*; Vol. 4, *Specific Heat of Metallic Solids*; Vol. 5, *Specific Heat of Nonmetallic Solids*; Vol. 7, *Thermal Radiative Properties of Metallic Solids*; Vol. 8, *Thermal Radiative Properties of Nonmetallic Solids*; Vol. 9, *Thermal Radiative Properties of Coatings*, Plenum Press, New York, 1972.
2. Touloukian, Y. S., and C. Y. Ho, Eds., *Thermophysical Properties of Selected Aerospace Materials*, Part I: Thermal Radiative Properties; Part II: Thermophysical Properties of Seven Materials. Thermophysical and Electronic Properties Information Analysis Center, CINDAS, Purdue University, West Lafayette, IN, 1976.
3. Ho, C. Y., R. W. Powell, and P. E. Liley, *J. Phys. Chem. Ref. Data*, **3**, Supplement 1, 1974.
4. Desai, P. D., T. K. Chu, R. H. Bogaard, M. W. Ackermann, and C. Y. Ho, Part I: Thermophysical Properties of Carbon Steels; Part II: Thermophysical Properties of Low Chromium Steels; Part III: Thermophysical Properties of Nickel Steels; Part IV: Thermophysical Properties of Stainless Steels. CINDAS Special Report, Purdue University, West Lafayette, IN, September 1976.
5. American Society for Metals, *Metals Handbook*, Vol. 1, *Properties and Selection of Metals*, 8th ed., ASM, Metals Park, OH, 1961.
6. Hultgren, R., P. D. Desai, D. T. Hawkins, M. Gleiser, K. K. Kelley, and D. D. Wagman, *Selected Values of the Thermodynamic Properties of the Elements*, American Society of Metals, Metals Park, OH, 1973.
7. Hultgren, R., P. D. Desai, D. T. Hawkins, M. Gleiser, and K. K. Kelley, *Selected Values of the Thermodynamic Properties of Binary Alloys*, American Society of Metals, Metals Park, OH, 1973.
8. American Society of Heating, Refrigerating and Air Conditioning Engineers, *ASHRAE Handbook of Fundamentals*, ASHRAE, New York, 1981.
9. Mallory, J. F., *Thermal Insulation*, Van Nostrand Reinhold, New York, 1969.
10. Hanley, E. J., D. P. DeWitt, and R. E. Taylor, "The Thermal Transport Properties at Normal and Elevated Temperature of Eight Representative Rocks," *Proceedings of the Seventh Symposium on Thermophysical Properties*, American Society of Mechanical Engineers, New York, 1977.
11. Sweat, V. E., "A Miniature Thermal Conductivity Probe for Foods," American Society of Mechanical Engineers, Paper 76-HT-60, August 1976.
12. Kothandaraman, C. P., and S. Subramanyan, *Heat and Mass Transfer Data Book*, Halsted Press/Wiley, New York, 1975.
13. Chapman, A. J., *Heat Transfer*, 4th ed., Macmillan, New York, 1984.
14. Vargaftik, N. B., *Tables of Thermophysical Properties of Liquids and Gases*, 2nd ed., Hemisphere Publishing, New York, 1975.
15. Eckert, E. R. G., and R. M. Drake, *Analysis of Heat and Mass Transfer*, McGraw-Hill, New York, 1972.
16. Vukalovich, M. P., A. I. Ivanov, L. R. Fokin, and A. T. Yakovelev, *Thermophysical Properties of Mercury*, State Committee on Standards, State Service for Standards and Handbook Data, Monograph Series No. 9, Izd. Standartov, Moscow, 1971.
17. Tillner-Roth, R., and H. D. Baehr, *J. Phys. Chem. Ref. Data*, **23**, 657, 1994.
18. Kamei, A., S. W. Beyerlein, and R. T. Jacobsen, *Int. J. Thermophysics*, **16**, 1155, 1995.
19. Lemmon, E. W., M. O. McLinden, and M. L. Huber, *NIST Standard Reference Database 23: Reference Fluid Thermodynamic and Transport Properties-REFPROP*, Version 7.0 National Institute of Standards and Technology, Standard Reference Data Program, Gaithersburg, 2002.
20. Bolz, R. E., and G. L. Tuve, Eds., *CRC Handbook of Tables for Applied Engineering Science*, 2nd ed., CRC Press, Boca Raton, FL, 1979.
21. Liley, P. E., private communication, School of Mechanical Engineering, Purdue University, West Lafayette, IN, May 1984.
22. Liley, P. E., Steam Tables in SI Units, private communication, School of Mechanical Engineering, Purdue University, West Lafayette, IN, March 1984.
23. *Liquid Materials Handbook*, 23rd ed., The Atomic Energy Commission, Department of the Navy, Washington, DC, 1952.
24. Perry, J. H., Ed., *Chemical Engineer's Handbook*, 4th ed., McGraw-Hill, New York, 1963.
25. Geankoplis, C. J., *Mass Transport Phenomena*, Holt, Rinehart & Winston, New York, 1972.
26. Barrer, R. M., *Diffusion in and Through Solids*, Macmillan, New York, 1941.
27. Spalding, D. B., *Convective Mass Transfer*, McGraw-Hill, New York, 1963.
28. Gubareff, G. G., J. E. Janssen, and R. H. Torborg, *Thermal Radiation Properties Survey*, Minneapolis-Honeywell Regulator Company, Minneapolis, MN, 1960.
29. Kreith, F., and J. F. Kreider, *Principles of Solar Energy*, Hemisphere Publishing, New York, 1978.





## APPENDIX **B**

# *Mathematical Relations and Functions*

---

<i>Section</i>	<i>Page</i>
<b>B.1</b> Hyperbolic Functions	960
<b>B.2</b> Gaussian Error Function	961
<b>B.3</b> The First Four Roots of the Transcendental Equation, $\xi_n \tan \xi_n = Bi$ , for Transient Conduction in a Plane Wall	962
<b>B.4</b> Bessel Functions of the First Kind	963
<b>B.5</b> Modified Bessel Functions of the First and Second Kinds	964

**B.1****Hyperbolic Functions<sup>1</sup>**

$x$	$\sinh x$	$\cosh x$	$\tanh x$	$x$	$\sinh x$	$\cosh x$	$\tanh x$
0.00	0.0000	1.0000	0.00000	2.00	3.6269	3.7622	0.96403
0.10	0.1002	1.0050	0.09967	2.10	4.0219	4.1443	0.97045
0.20	0.2013	1.0201	0.19738	2.20	4.4571	4.5679	0.97574
0.30	0.3045	1.0453	0.29131	2.30	4.9370	5.0372	0.98010
0.40	0.4108	1.0811	0.37995	2.40	5.4662	5.5569	0.98367
0.50	0.5211	1.1276	0.46212	2.50	6.0502	6.1323	0.98661
0.60	0.6367	1.1855	0.53705	2.60	6.6947	6.7690	0.98903
0.70	0.7586	1.2552	0.60437	2.70	7.4063	7.4735	0.99101
0.80	0.8881	1.3374	0.66404	2.80	8.1919	8.2527	0.99263
0.90	1.0265	1.4331	0.71630	2.90	9.0596	9.1146	0.99396
1.00	1.1752	1.5431	0.76159	3.00	10.018	10.068	0.99505
1.10	1.3356	1.6685	0.80050	3.50	16.543	16.573	0.99818
1.20	1.5095	1.8107	0.83365	4.00	27.290	27.308	0.99933
1.30	1.6984	1.9709	0.86172	4.50	45.003	45.014	0.99975
1.40	1.9043	2.1509	0.88535	5.00	74.203	74.210	0.99991
1.50	2.1293	2.3524	0.90515	6.00	201.71	201.72	0.99999
1.60	2.3756	2.5775	0.92167	7.00	548.32	548.32	1.0000
1.70	2.6456	2.8283	0.93541	8.00	1490.5	1490.5	1.0000
1.80	2.9422	3.1075	0.94681	9.00	4051.5	4051.5	1.0000
1.90	3.2682	3.4177	0.95624	10.000	11013	11013	1.0000

<sup>1</sup>The hyperbolic functions are defined as

$$\sinh x = \frac{1}{2}(e^x - e^{-x}) \quad \cosh x = \frac{1}{2}(e^x + e^{-x}) \quad \tanh x = \frac{e^x - e^{-x}}{e^x + e^{-x}} = \frac{\sinh x}{\cosh x}$$

The derivatives of the hyperbolic functions of the variable  $u$  are given as

$$\frac{d}{dx}(\sinh u) = (\cosh u) \frac{du}{dx} \quad \frac{d}{dx}(\cosh u) = (\sinh u) \frac{du}{dx} \quad \frac{d}{dx}(\tanh u) = \left( \frac{1}{\cosh^2 u} \right) \frac{du}{dx}$$

**B.2****Gaussian Error Function<sup>1</sup>**

$w$	$\text{erf } w$	$w$	$\text{erf } w$	$w$	$\text{erf } w$
0.00	0.00000	0.36	0.38933	1.04	0.85865
0.02	0.02256	0.38	0.40901	1.08	0.87333
0.04	0.04511	0.40	0.42839	1.12	0.88679
0.06	0.06762	0.44	0.46622	1.16	0.89910
0.08	0.09008	0.48	0.50275	1.20	0.91031
0.10	0.11246	0.52	0.53790	1.30	0.93401
0.12	0.13476	0.56	0.57162	1.40	0.95228
0.14	0.15695	0.60	0.60386	1.50	0.96611
0.16	0.17901	0.64	0.63459	1.60	0.97635
0.18	0.20094	0.68	0.66378	1.70	0.98379
0.20	0.22270	0.72	0.69143	1.80	0.98909
0.22	0.24430	0.76	0.71754	1.90	0.99279
0.24	0.26570	0.80	0.74210	2.00	0.99532
0.26	0.28690	0.84	0.76514	2.20	0.99814
0.28	0.30788	0.88	0.78669	2.40	0.99931
0.30	0.32863	0.92	0.80677	2.60	0.99976
0.32	0.34913	0.96	0.82542	2.80	0.99992
0.34	0.36936	1.00	0.84270	3.00	0.99998

<sup>1</sup>The Gaussian error function is defined as

$$\text{erf } w = \frac{2}{\sqrt{\pi}} \int_0^w e^{-v^2} dv$$

The complementary error function is defined as

$$\text{erfc } w \equiv 1 - \text{erf } w$$

**B.3**

***The First Four Roots of the Transcendental  
Equation,  $\xi_n \tan \xi_n = Bi$ , for Transient  
Conduction in a Plane Wall***

$Bi = \frac{hL}{k}$	$\xi_1$	$\xi_2$	$\xi_3$	$\xi_4$
0	0	3.1416	6.2832	9.4248
0.001	0.0316	3.1419	6.2833	9.4249
0.002	0.0447	3.1422	6.2835	9.4250
0.004	0.0632	3.1429	6.2838	9.4252
0.006	0.0774	3.1435	6.2841	9.4254
0.008	0.0893	3.1441	6.2845	9.4256
0.01	0.0998	3.1448	6.2848	9.4258
0.02	0.1410	3.1479	6.2864	9.4269
0.04	0.1987	3.1543	6.2895	9.4290
0.06	0.2425	3.1606	6.2927	9.4311
0.08	0.2791	3.1668	6.2959	9.4333
0.1	0.3111	3.1731	6.2991	9.4354
0.2	0.4328	3.2039	6.3148	9.4459
0.3	0.5218	3.2341	6.3305	9.4565
0.4	0.5932	3.2636	6.3461	9.4670
0.5	0.6533	3.2923	6.3616	9.4775
0.6	0.7051	3.3204	6.3770	9.4879
0.7	0.7506	3.3477	6.3923	9.4983
0.8	0.7910	3.3744	6.4074	9.5087
0.9	0.8274	3.4003	6.4224	9.5190
1.0	0.8603	3.4256	6.4373	9.5293
1.5	0.9882	3.5422	6.5097	9.5801
2.0	1.0769	3.6436	6.5783	9.6296
3.0	1.1925	3.8088	6.7040	9.7240
4.0	1.2646	3.9352	6.8140	9.8119
5.0	1.3138	4.0336	6.9096	9.8928
6.0	1.3496	4.1116	6.9924	9.9667
7.0	1.3766	4.1746	7.0640	10.0339
8.0	1.3978	4.2264	7.1263	10.0949
9.0	1.4149	4.2694	7.1806	10.1502
10.0	1.4289	4.3058	7.2281	10.2003
15.0	1.4729	4.4255	7.3959	10.3898
20.0	1.4961	4.4915	7.4954	10.5117
30.0	1.5202	4.5615	7.6057	10.6543
40.0	1.5325	4.5979	7.6647	10.7334
50.0	1.5400	4.6202	7.7012	10.7832
60.0	1.5451	4.6353	7.7259	10.8172
80.0	1.5514	4.6543	7.7573	10.8606
100.0	1.5552	4.6658	7.7764	10.8871
$\infty$	1.5708	4.7124	7.8540	10.9956

**B.4*****Bessel Functions of the First Kind***

---

$x$	$J_0(x)$	$J_1(x)$
0.0	1.0000	0.0000
0.1	0.9975	0.0499
0.2	0.9900	0.0995
0.3	0.9776	0.1483
0.4	0.9604	0.1960
0.5	0.9385	0.2423
0.6	0.9120	0.2867
0.7	0.8812	0.3290
0.8	0.8463	0.3688
0.9	0.8075	0.4059
1.0	0.7652	0.4400
1.1	0.7196	0.4709
1.2	0.6711	0.4983
1.3	0.6201	0.5220
1.4	0.5669	0.5419
1.5	0.5118	0.5579
1.6	0.4554	0.5699
1.7	0.3980	0.5778
1.8	0.3400	0.5815
1.9	0.2818	0.5812
2.0	0.2239	0.5767
2.1	0.1666	0.5683
2.2	0.1104	0.5560
2.3	0.0555	0.5399
2.4	0.0025	0.5202

**B.5*****Modified Bessel Functions<sup>1</sup> of  
the First and Second Kinds***


---

$x$	$e^{-x}I_0(x)$	$e^{-x}I_1(x)$	$e^xK_0(x)$	$e^xK_1(x)$
0.0	1.0000	0.0000	$\infty$	$\infty$
0.2	0.8269	0.0823	2.1407	5.8334
0.4	0.6974	0.1368	1.6627	3.2587
0.6	0.5993	0.1722	1.4167	2.3739
0.8	0.5241	0.1945	1.2582	1.9179
1.0	0.4657	0.2079	1.1445	1.6361
1.2	0.4198	0.2152	1.0575	1.4429
1.4	0.3831	0.2185	0.9881	1.3010
1.6	0.3533	0.2190	0.9309	1.1919
1.8	0.3289	0.2177	0.8828	1.1048
2.0	0.3085	0.2153	0.8416	1.0335
2.2	0.2913	0.2121	0.8056	0.9738
2.4	0.2766	0.2085	0.7740	0.9229
2.6	0.2639	0.2046	0.7459	0.8790
2.8	0.2528	0.2007	0.7206	0.8405
3.0	0.2430	0.1968	0.6978	0.8066
3.2	0.2343	0.1930	0.6770	0.7763
3.4	0.2264	0.1892	0.6579	0.7491
3.6	0.2193	0.1856	0.6404	0.7245
3.8	0.2129	0.1821	0.6243	0.7021
4.0	0.2070	0.1787	0.6093	0.6816
4.2	0.2016	0.1755	0.5953	0.6627
4.4	0.1966	0.1724	0.5823	0.6453
4.6	0.1919	0.1695	0.5701	0.6292
4.8	0.1876	0.1667	0.5586	0.6142
5.0	0.1835	0.1640	0.5478	0.6003
5.2	0.1797	0.1614	0.5376	0.5872
5.4	0.1762	0.1589	0.5279	0.5749
5.6	0.1728	0.1565	0.5188	0.5633
5.8	0.1696	0.1542	0.5101	0.5525
6.0	0.1666	0.1520	0.5019	0.5422
6.4	0.1611	0.1479	0.4865	0.5232
6.8	0.1561	0.1441	0.4724	0.5060
7.2	0.1515	0.1405	0.4595	0.4905
7.6	0.1473	0.1372	0.4476	0.4762
8.0	0.1434	0.1341	0.4366	0.4631
8.4	0.1398	0.1312	0.4264	0.4511
8.8	0.1365	0.1285	0.4168	0.4399
9.2	0.1334	0.1260	0.4079	0.4295
9.6	0.1305	0.1235	0.3995	0.4198
10.0	0.1278	0.1213	0.3916	0.4108

---

<sup>1</sup> $I_{n+1}(x) = I_{n-1}(x) - (2n/x)I_n(x)$

## APPENDIX **C**


# *Thermal Conditions Associated with Uniform Energy Generation in One-Dimensional, Steady-State Systems*

---



In Section 3.5 the problem of conduction with thermal energy generation is considered for one-dimensional, steady-state conditions. The form of the heat equation differs, according to whether the system is a plane wall, a cylindrical shell, or a spherical shell (Figure C.1). In each case, there are several options for the boundary condition at each surface, and hence a greater number of possibilities for specific forms of the temperature distribution and heat rate (or heat flux).

An alternative to solving the heat equation for each possible combination of boundary conditions involves obtaining a solution by prescribing *boundary conditions of the first kind*, Equation 2.24, at both surfaces and then applying an energy balance to each surface at which the temperature is unknown. For the geometries of Figure C.1, with uniform temperatures  $T_{s,1}$  and  $T_{s,2}$  prescribed at each surface, solutions to appropriate forms of the heat equation are readily obtained and are summarized in Table C.1. The temperature distributions may be used with Fourier's law to obtain corresponding distributions for the heat flux and heat rate. If  $T_{s,1}$  and  $T_{s,2}$  are both known for a particular problem, the expressions of Table C.1 provide all that is needed to completely determine related thermal conditions. If  $T_{s,1}$  and/or  $T_{s,2}$  are not known, the results may still be used with surface energy balances to determine the desired thermal conditions.

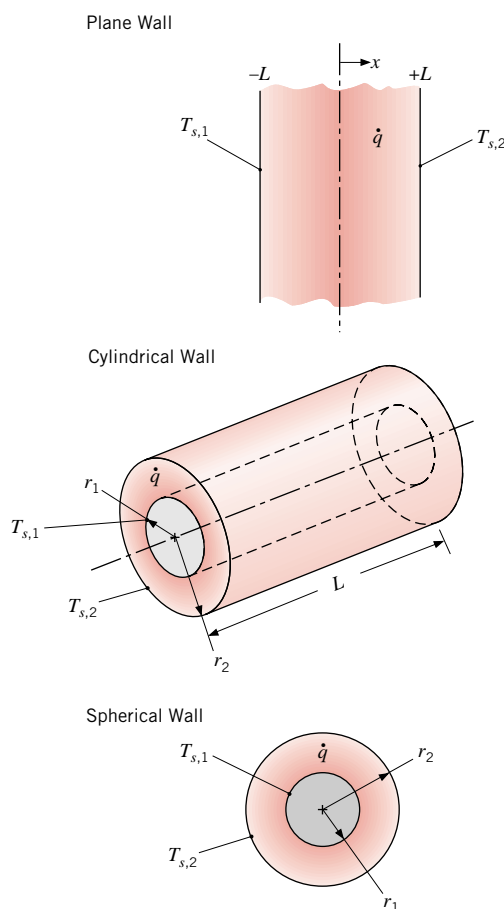

**FIGURE C.1**

One-dimensional conduction systems with uniform thermal energy generation: a plane wall with asymmetric surface conditions, a cylindrical shell, and a spherical shell.

**TABLE C.1** One-Dimensional, Steady-State Solutions to the Heat Equation for Plane, Cylindrical, and Spherical Walls with Uniform Generation and Asymmetrical Surface Conditions

Temperature Distribution	
Plane Wall	$T(x) = \frac{\dot{q}L^2}{2k} \left( 1 - \frac{x^2}{L^2} \right) + \frac{T_{s,2} - T_{s,1}}{2} \frac{x}{L} + \frac{T_{s,1} + T_{s,2}}{2} \quad (\text{C.1})$
Cylindrical Wall	$T(r) = T_{s,2} + \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r^2}{r_2^2} \right) - \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right] \frac{\ln(r_2/r)}{\ln(r_2/r_1)} \quad (\text{C.2})$
Spherical Wall	$T(r) = T_{s,2} + \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r^2}{r_2^2} \right) - \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right] \frac{(1/r) - (1/r_2)}{(1/r_1) - (1/r_2)} \quad (\text{C.3})$
Heat Flux	
Plane Wall	$q''(x) = \dot{q}x - \frac{k}{2L} (T_{s,2} - T_{s,1}) \quad (\text{C.4})$
Cylindrical Wall	$q''(r) = \frac{\dot{q}r}{2} - \frac{k \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r \ln(r_2/r_1)} \quad (\text{C.5})$
Spherical Wall	$q''(r) = \frac{\dot{q}r}{3} - \frac{k \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r^2 [(1/r_1) - (1/r_2)]} \quad (\text{C.6})$
Heat Rate	
Plane Wall	$q(x) = \left[ \dot{q}x - \frac{k}{2L} (T_{s,2} - T_{s,1}) \right] A_x \quad (\text{C.7})$
Cylindrical Wall	$q(r) = \dot{q}\pi L r^2 - \frac{2\pi L k}{\ln(r_2/r_1)} \cdot \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right] \quad (\text{C.8})$
Spherical Wall	$q(r) = \frac{\dot{q}4\pi r^3}{3} - \frac{4\pi k \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{(1/r_1) - (1/r_2)} \quad (\text{C.9})$

Alternative surface conditions could involve specification of a uniform surface heat flux (*boundary condition of the second kind*, Equation 2.25 or 2.26) or a convection condition (*boundary condition of the third kind*, Equation 2.27). In each case, the surface temperature would not be known but could be determined by applying a surface energy balance. The forms that such balances may take are summarized in Table C.2. Note that, to accommodate situations for which a surface of interest may adjoin a composite wall in which there is no generation, the boundary condition of the third kind has been applied by using the overall heat transfer coefficient  $U$  in lieu of the convection coefficient  $h$ .

**TABLE C.2** Alternative Surface Conditions and Energy Balances for One-Dimensional, Steady-State Solutions to the Heat Equation for Plane, Cylindrical, and Spherical Walls with Uniform Generation

**Plane Wall**

*Uniform Surface Heat Flux*

$$x = -L: \quad q''_{s,1} = -\dot{q}L - \frac{k}{2L}(T_{s,2} - T_{s,1}) \quad (\text{C.10})$$

$$x = +L: \quad q''_{s,2} = \dot{q}L - \frac{k}{2L}(T_{s,2} - T_{s,1}) \quad (\text{C.11})$$

*Prescribed Transport Coefficient and Ambient Temperature*

$$x = -L: \quad U_1(T_{\infty,1} - T_{s,1}) = -\dot{q}L - \frac{k}{2L}(T_{s,2} - T_{s,1}) \quad (\text{C.12})$$

$$x = +L: \quad U_2(T_{s,2} - T_{\infty,2}) = \dot{q}L - \frac{k}{2L}(T_{s,2} - T_{s,1}) \quad (\text{C.13})$$

**Cylindrical Wall**

*Uniform Surface Heat Flux*

$$r = r_1: \quad q''_{s,1} = \frac{\dot{q}r_1}{2} - \frac{k \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_1 \ln(r_2/r_1)} \quad (\text{C.14})$$

$$r = r_2: \quad q''_{s,2} = \frac{\dot{q}r_2}{2} - \frac{k \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_2 \ln(r_2/r_1)} \quad (\text{C.15})$$

*Prescribed Transport Coefficient and Ambient Temperature*

$$r = r_1: \quad U_1(T_{\infty,1} - T_{s,1}) = \frac{\dot{q}r_1}{2} - \frac{k \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_1 \ln(r_2/r_1)} \quad (\text{C.16})$$

$$r = r_2: \quad U_2(T_{s,2} - T_{\infty,2}) = \frac{\dot{q}r_2}{2} - \frac{k \left[ \frac{\dot{q}r_2^2}{4k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_2 \ln(r_2/r_1)} \quad (\text{C.17})$$

**Spherical Wall**

*Uniform Surface Heat Flux*

$$r = r_1: \quad q''_{s,1} = \frac{\dot{q}r_1}{3} - \frac{k \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_1^2[(1/r_1) - (1/r_2)]} \quad (\text{C.18})$$

$$r = r_2: \quad q''_{s,2} = \frac{\dot{q}r_2}{3} - \frac{k \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_2^2[(1/r_1) - (1/r_2)]} \quad (\text{C.19})$$

**TABLE C.2** Continued


*Prescribed Transport Coefficient and Ambient Temperature*

$$r = r_1: \quad U_1(T_{\infty,1} - T_{s,1}) = \frac{\dot{q}r_1}{3} - \frac{k \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_1^2[(1/r_1) - (1/r_2)]} \quad (\text{C.20})$$

$$r = r_2: \quad U_2(T_{s,2} - T_{\infty,2}) = \frac{\dot{q}r_2}{3} - \frac{k \left[ \frac{\dot{q}r_2^2}{6k} \left( 1 - \frac{r_1^2}{r_2^2} \right) + (T_{s,2} - T_{s,1}) \right]}{r_2^2[(1/r_1) - (1/r_2)]} \quad (\text{C.21})$$

As an example, consider a plane wall for which a uniform (known) surface temperature  $T_{s,1}$  is prescribed at  $x = -L$  and a uniform heat flux  $q''_{s,2}$  is prescribed at  $x = +L$ . Equation C.11 may be used to evaluate  $T_{s,2}$ , and Equations C.1, C.4, and C.7 may then be used to determine the temperature, heat flux, and heat rate distributions, respectively.

Special cases of the foregoing configurations involve a plane wall with one adiabatic surface, a solid cylinder (a circular rod), and a sphere (Figure C.2). Subject to the requirements that  $dT/dx|_{x=0} = 0$  and  $dT/dr|_{r=0} = 0$ , the corresponding forms of the heat equation may be solved to obtain Equations C.22 through C.24 of Table C.3.

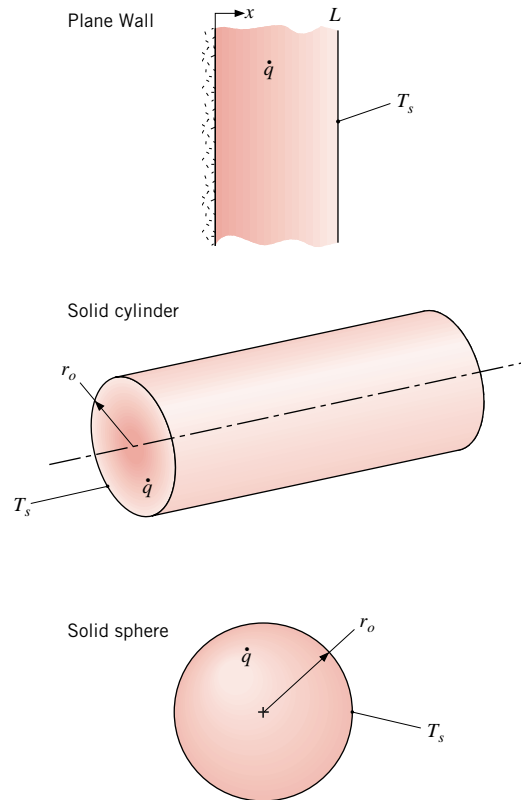

**FIGURE C.2**

One-dimensional conduction systems with uniform thermal energy generation: a plane wall with one adiabatic surface, a cylindrical rod, and a sphere.

**TABLE C.3** One-Dimensional, Steady-State Solutions to the Heat Equation for Uniform Generation in a Plane Wall with One Adiabatic Surface, a Solid Cylinder, and a Solid Sphere

Temperature Distribution		
Plane Wall	$T(x) = \frac{\dot{q}L^2}{2k} \left( 1 - \frac{x^2}{L^2} \right) + T_s$	(C.22)
Circular Rod	$T(r) = \frac{\dot{q}r_o^2}{4k} \left( 1 - \frac{r^2}{r_o^2} \right) + T_s$	(C.23)
Sphere	$T(r) = \frac{\dot{q}r_o^2}{6k} \left( 1 - \frac{r^2}{r_o^2} \right) + T_s$	(C.24)
Heat Flux		
Plane Wall	$q''(x) = \dot{q}x$	(C.25)
Circular Rod	$q''(r) = \frac{\dot{q}r}{2}$	(C.26)
Sphere	$q''(r) = \frac{\dot{q}r}{3}$	(C.27)
Heat Rate		
Plane Wall	$q(x) = \dot{q}xA_x$	(C.28)
Circular Rod	$q(r) = \dot{q}\pi Lr^2$	(C.29)
Sphere	$q(r) = \frac{\dot{q}4\pi r^3}{3}$	(C.30)

**TABLE C.4** Alternative Surface Conditions and Energy Balances for One-Dimensional, Steady-State Solutions to the Heat Equation for Uniform Generation in a Plane Wall with One Adiabatic Surface, a Solid Cylinder, and a Solid Sphere

*Prescribed Transport Coefficient and Ambient Temperature*

**Plane Wall**

$$x = L: \quad \dot{q}L = U(T_s - T_\infty) \quad (\text{C.31})$$

**Circular Rod**

$$r = r_o: \quad \frac{\dot{q}r_o}{2} = U(T_s - T_\infty) \quad (\text{C.32})$$

**Sphere**

$$r = r_o: \quad \frac{\dot{q}r_o}{3} = U(T_s - T_\infty) \quad (\text{C.33})$$

The solutions are based on prescribing a uniform temperature  $T_s$  at  $x = L$  and  $r = r_o$ . Using Fourier's law with the temperature distributions, the heat flux (Equations C.25 through C.27) and heat rate (Equations C.28 through C.30) distributions may also be obtained. If  $T_s$  is not known, it may be determined by applying a surface energy balance, appropriate forms of which are summarized in Table C.4.



## APPENDIX **D**

# *The Convection Transfer Equations*

---



In Chapter 2 we considered a stationary substance in which heat is transferred by conduction and developed means for determining the temperature distribution within the substance. We did so by applying *conservation of energy* to a differential control volume (Figure 2.11) and deriving a differential equation that was termed the *heat equation*. For a prescribed geometry and boundary conditions, the equation may be solved to determine the corresponding temperature distribution.

If the substance is not stationary, conditions become more complex. For example, if conservation of energy is applied to a differential control volume in a moving fluid, the effects of fluid motion (*advection*) on energy transfer across the surfaces of the control volume must be considered, along with those of conduction. The resulting differential equation, which provides the basis for predicting the temperature distribution, now requires knowledge of the velocity equations derived by applying *conservation of mass* and *Newton's second law of motion* to a differential control volume.

In this appendix we consider conditions involving flow of a *viscous fluid* in which there is concurrent *heat* and *mass transfer*. We restrict our attention to the *steady, two-dimensional flow* of an *incompressible fluid* with *constant properties* in the  $x$  and  $y$  directions of a Cartesian coordinate system, and present the differential equations that may be used to predict velocity, temperature, and species concentration fields within the fluid. These equations can be derived by applying Newton's second law of motion and conservation of mass, energy, and species to a differential control volume in the fluid.

⊗ These equations are derived in Section 6S.1.

## D.1

### Conservation of Mass

---

One conservation law that is pertinent to the flow of a viscous fluid is that matter can be neither created nor destroyed. For steady flow, this law requires that *the net rate at which mass enters a control volume (inflow – outflow) must equal zero*. Applying this law to a differential control volume in the flow yields

$$\frac{\partial u}{\partial x} + \frac{\partial v}{\partial y} = 0 \quad (\text{D.1})$$

where  $u$  and  $v$  are the  $x$  and  $y$  components of the *mass average velocity*.

Equation D.1, the *continuity equation*, is a general expression of the *overall mass* conservation requirement, and it must be satisfied at every point in the fluid. The equation applies for a single species fluid, as well as for mixtures in which species diffusion and chemical reactions may be occurring, provided that the fluid can be approximated as *incompressible*, that is, constant density.

## D.2

### Newton's Second Law of Motion

---

The second fundamental law that is pertinent to the flow of a viscous fluid is *Newton's second law of motion*. For a differential control volume in the fluid, under steady conditions, this requirement states that *the sum of all forces acting on the*

control volume must equal the net rate at which momentum leaves the control volume (outflow – inflow).

Two kinds of forces may act on the fluid: *body forces*, which are proportional to the volume, and *surface forces*, which are proportional to area. Gravitational, centrifugal, magnetic, and/or electric fields may contribute to the total body force, and we designate the  $x$  and  $y$  components of this force per unit volume of fluid as  $X$  and  $Y$ , respectively. The surface forces are due to the fluid static pressure as well as to *viscous stresses*.

Applying Newton's second law of motion (in the  $x$ - and  $y$ -directions) to a differential control volume in the fluid, accounting for body and surface forces, yields

$$\rho \left( u \frac{\partial u}{\partial x} + v \frac{\partial u}{\partial y} \right) = -\frac{\partial p}{\partial x} + \mu \left( \frac{\partial^2 u}{\partial x^2} + \frac{\partial^2 u}{\partial y^2} \right) + X \quad (\text{D.2})$$

$$\rho \left( u \frac{\partial v}{\partial x} + v \frac{\partial v}{\partial y} \right) = -\frac{\partial p}{\partial y} + \mu \left( \frac{\partial^2 v}{\partial x^2} + \frac{\partial^2 v}{\partial y^2} \right) + Y \quad (\text{D.3})$$

where  $p$  is the pressure and  $\mu$  is the fluid viscosity.

We should not lose sight of the physics represented by Equations D.2 and D.3. The two terms on the left-hand side of each equation represent the *net* rate of momentum flow from the control volume. The terms on the right-hand side, taken in order, account for the net pressure force, the net viscous forces, and the body force. These equations must be satisfied at each point in the fluid, and with Equation D.1 they may be solved for the velocity field.

### D.3

#### Conservation of Energy

As mentioned at the beginning of this Appendix, in Chapter 2 we considered a stationary substance in which heat is transferred by conduction and applied conservation of energy to a differential control volume (Figure 2.11) to derive the heat equation. When conservation of energy is applied to a differential control volume *in a moving fluid* under steady conditions, it expresses that the net rate at which energy enters the control volume, plus the rate at which heat is added, minus the rate at which work is done by the fluid in the control volume, is equal to zero. After much manipulation, the result can be rewritten as a *thermal energy equation*. For steady, two-dimensional flow of an incompressible fluid with constant properties, the resulting differential equation is

$$\rho c_p \left( u \frac{\partial T}{\partial x} + v \frac{\partial T}{\partial y} \right) = k \left( \frac{\partial^2 T}{\partial x^2} + \frac{\partial^2 T}{\partial y^2} \right) + \mu \Phi + \dot{q} \quad (\text{D.4})$$

where  $T$  is the temperature,  $c_p$  is the specific heat at constant pressure,  $k$  is the thermal conductivity,  $\dot{q}$  is the volumetric rate of thermal energy generation, and  $\mu \Phi$ , the *viscous dissipation*, is defined as

$$\mu \Phi \equiv \mu \left\{ \left( \frac{\partial u}{\partial y} + \frac{\partial v}{\partial x} \right)^2 + 2 \left[ \left( \frac{\partial u}{\partial x} \right)^2 + \left( \frac{\partial v}{\partial y} \right)^2 \right] \right\} \quad (\text{D.5})$$

The same form of the thermal energy equation, Equation D.4, also applies to an ideal gas with negligible pressure variation.

In Equation D.4, the terms on the left-hand side account for the net rate at which thermal energy leaves the control volume due to bulk fluid motion (advection), while the terms on the right-hand side account for net inflow of energy due to conduction, viscous dissipation, and generation. Viscous dissipation represents the net rate at which mechanical work is irreversibly converted to thermal energy due to viscous effects in the fluid. The generation term characterizes conversion from other forms of energy (such as chemical, electrical, electromagnetic, or nuclear) to thermal energy.


## D.4

### Conservation of Species

---

If the viscous fluid consists of a binary mixture in which there are species concentration gradients, there will be *relative* transport of the species, and *species conservation* must be satisfied at each point in the fluid. For steady flow, this law requires that *the net rate at which species A enters a control volume (inflow – outflow) plus the rate at which species A is produced in the control volume (by chemical reactions) must equal zero*. Applying this law to a differential control volume in the flow yields the following differential equation, which has been expressed on a molar basis:

$$u \frac{\partial C_A}{\partial x} + v \frac{\partial C_A}{\partial y} = D_{AB} \left( \frac{\partial^2 C_A}{\partial x^2} + \frac{\partial^2 C_A}{\partial y^2} \right) + \dot{N}_A \quad (\text{D.6})$$

 An example problem involving the solution of the convection transfer equations is included in Section 6S.1.

where  $C_A$  is the molar concentration of species A,  $D_{AB}$  is the binary diffusion coefficient, and  $\dot{N}_A$  is the molar rate of production of species A per unit volume. Again, this equation has been derived assuming an incompressible fluid with constant properties. Terms on the left-hand side account for net transport of species A due to bulk fluid motion (advection), while terms on the right-hand side account for net inflow due to diffusion and production due to chemical reactions.

## APPENDIX **E**

# *Boundary Layer Equations for Turbulent Flow*

---

It has been noted in Section 6.3 that turbulent flow is inherently *unsteady*. This behavior is shown in Figure E.1, where the variation of an arbitrary flow property  $P$  is plotted as a function of time at some location in a turbulent boundary layer. The property  $P$  could be a velocity component, the fluid temperature, or a species concentration, and at any instant it may be represented as the sum of a *time-mean* value  $\bar{P}$  and a fluctuating component  $P'$ . The average is taken over a time that is large compared with the period of a typical fluctuation, and if  $\bar{P}$  is independent of time, the time-mean flow is said to be *steady*.

Since engineers are typically concerned with the time-mean properties,  $\bar{P}$ , the difficulty of solving the time-dependent governing equations is often eliminated by averaging the equations over time. For steady (in the mean), incompressible, constant property, boundary layer flow with negligible viscous dissipation, using well-established time-averaging procedures [1], the following forms of the continuity,  $x$ -momentum, energy, and species conservation equations may be obtained:

$$\frac{\partial \bar{u}}{\partial x} + \frac{\partial \bar{v}}{\partial y} = 0 \quad (\text{E.1})$$

$$\bar{u} \frac{\partial \bar{u}}{\partial x} + \bar{v} \frac{\partial \bar{u}}{\partial y} = -\frac{1}{\rho} \frac{d\bar{p}_\infty}{dx} + \frac{1}{\rho} \frac{\partial}{\partial y} \left( \mu \frac{\partial \bar{u}}{\partial y} - \rho \overline{u'v'} \right) \quad (\text{E.2})$$

$$\bar{u} \frac{\partial \bar{T}}{\partial x} + \bar{v} \frac{\partial \bar{T}}{\partial y} = \frac{1}{\rho c_p} \frac{\partial}{\partial y} \left( k \frac{\partial \bar{T}}{\partial y} - \rho c_p \overline{v'T'} \right) \quad (\text{E.3})$$

$$\bar{u} \frac{\partial \bar{C}_A}{\partial x} + \bar{v} \frac{\partial \bar{C}_A}{\partial y} = \frac{\partial}{\partial y} \left( D_{AB} \frac{\partial \bar{C}_A}{\partial y} - \overline{v'C'_A} \right) \quad (\text{E.4})$$


The equations are like those for the laminar boundary layer, Equations 6.27 through 6.30 (after neglecting viscous dissipation), except for the presence of additional terms of the form  $\overline{a'b'}$ . These terms account for the effect of the turbulent fluctuations on momentum, energy, and species transport.

On the basis of the foregoing results, it is customary to speak of a *total* shear stress and *total* heat and species fluxes, which are defined as

$$\tau_{\text{tot}} = \left( \mu \frac{\partial \bar{u}}{\partial y} - \rho \overline{u'v'} \right) \quad (\text{E.5})$$

$$q''_{\text{tot}} = - \left( k \frac{\partial \bar{T}}{\partial y} - \rho c_p \overline{v'T'} \right) \quad (\text{E.6})$$

$$N''_{A, \text{tot}} = - \left( D_{AB} \frac{\partial \bar{C}_A}{\partial y} - \overline{v'C'_A} \right) \quad (\text{E.7})$$

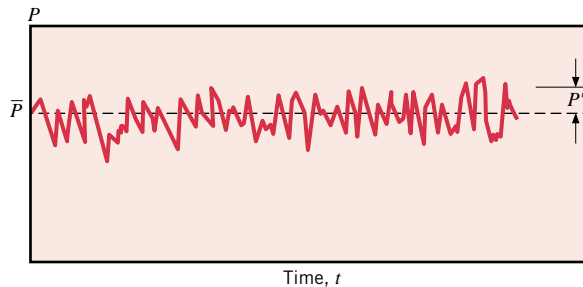

**FIGURE E.1**

Property variation with time at some point in a turbulent boundary layer.

and consist of contributions due to molecular diffusion and turbulent mixing. From the form of these equations we see how momentum, energy, and species transfer rates are enhanced by the existence of turbulence. The term  $-\rho \overline{u'v'}$  appearing in Equation E.5 represents the momentum flux due to the turbulent fluctuations, and it is often termed the *Reynolds stress*. The terms  $\rho c_p \overline{v'T'}$  and  $\overline{v'C'_A}$  in Equations E.6 and E.7, respectively, represent the heat and species fluxes due to the turbulent fluctuations. Unfortunately, these new terms introduced by the time-averaging process are additional unknowns, so that the number of unknowns exceeds the number of equations. Resolving this problem is the subject of the field of *turbulence modeling* [2].

## References

---

1. Hinze, J. O. *Turbulence*, 2nd ed., McGraw-Hill, New York, 1975.
2. Wilcox, D. C., *Turbulence Modeling for CFD*, 2nd ed., DCW Industries, La Cañada, 1998.



## APPENDIX **F**

# *An Integral Laminar Boundary Layer Solution for Parallel Flow over a Flat Plate*

---



An alternative approach to solving the boundary layer equations involves the use of an approximate *integral* method. The approach was originally proposed by von Kármán [1] in 1921 and first applied by Pohlhausen [2]. It is without the mathematical complications inherent in the *exact (similarity)* method of Section 7.2.1; yet it can be used to obtain reasonably accurate results for the key boundary layer parameters ( $\delta$ ,  $\delta_i$ ,  $\delta_c$ ,  $C_f$ ,  $h$ , and  $h_m$ ). Although the method has been used with some success for a variety of flow conditions, we restrict our attention to parallel flow over a flat plate, subject to the same restrictions enumerated in Section 7.2.1, that is, *incompressible laminar flow with constant fluid properties and negligible viscous dissipation*.

To use the method, the boundary layer equations, Equations 7.4 through 7.7, must be cast in integral form. These forms are obtained by integrating the equations in the  $y$  direction across the boundary layer. For example, integrating Equation 7.4, we obtain

$$\int_0^\delta \frac{\partial u}{\partial x} dy + \int_0^\delta \frac{\partial v}{\partial y} dy = 0 \quad (\text{F.1})$$

or, since  $v = 0$  at  $y = 0$ ,

$$v(y = \delta) = - \int_0^\delta \frac{\partial u}{\partial x} dy \quad (\text{F.2})$$

Similarly, from Equation 7.5, we obtain

$$\int_0^\delta u \frac{\partial u}{\partial x} dy + \int_0^\delta v \frac{\partial u}{\partial y} dy = \nu \int_0^\delta \frac{\partial}{\partial y} \left( \frac{\partial u}{\partial y} \right) dy$$

or, integrating the second term on the left-hand side by parts,

$$\int_0^\delta u \frac{\partial u}{\partial x} dy + uv \Big|_0^\delta - \int_0^\delta u \frac{\partial v}{\partial y} dy = \nu \frac{\partial u}{\partial y} \Big|_0^\delta$$

Substituting from Equations 7.4 and F.2, we obtain

$$\int_0^\delta u \frac{\partial u}{\partial x} dy - u_\infty \int_0^\delta \frac{\partial u}{\partial x} dy + \int_0^\delta u \frac{\partial u}{\partial x} dy = - \nu \frac{\partial u}{\partial y} \Big|_{y=0}$$

or

$$u_\infty \int_0^\delta \frac{\partial u}{\partial x} dy - \int_0^\delta 2u \frac{\partial u}{\partial x} dy = \nu \frac{\partial u}{\partial y} \Big|_{y=0}$$

Therefore

$$\int_0^\delta \frac{\partial}{\partial x} (u_\infty \cdot u - u \cdot u) dy = \nu \frac{\partial u}{\partial y} \Big|_{y=0}$$

Rearranging, we then obtain

$$\frac{d}{dx} \left[ \int_0^\delta (u_\infty - u)u dy \right] = \nu \frac{\partial u}{\partial y} \Big|_{y=0} \quad (\text{F.3})$$

Equation F.3 is the integral form of the boundary layer momentum equation. In a similar fashion, the following integral forms of the boundary layer energy and species continuity equations may be obtained:

$$\frac{d}{dx} \left[ \int_0^{\delta_i} (T_\infty - T)u dy \right] = \alpha \frac{\partial T}{\partial y} \Big|_{y=0} \quad (\text{F.4})$$

$$\frac{d}{dx} \left[ \int_0^{\delta_c} (\rho_{A,\infty} - \rho_A) u \, dy \right] = D_{AB} \frac{\partial \rho_A}{\partial y} \Big|_{y=0} \quad (\text{F.5})$$

Equations F.3 through F.5 satisfy the  $x$  momentum, the energy, and the species conservation requirements in an *integral* (or *average*) fashion over the entire boundary layer. In contrast, the original conservation equations, (7.5) through (7.7), satisfy the conservation requirements *locally*, that is, at each point in the boundary layer.

The integral equations can be used to obtain *approximate* boundary layer solutions. The procedure involves first *assuming* reasonable functional forms for the unknowns  $u$ ,  $T$ , and  $\rho_A$  in terms of the corresponding (*unknown*) boundary layer thicknesses. The assumed forms must satisfy appropriate boundary conditions. Substituting these forms into the integral equations, expressions for the boundary layer thicknesses may be determined and the assumed functional forms may then be completely specified. Although this method is approximate, it frequently leads to accurate results for the surface parameters.

Consider the hydrodynamic boundary layer, for which appropriate boundary conditions are

$$u(y=0) = \frac{\partial u}{\partial y} \Big|_{y=0} = 0 \quad \text{and} \quad u(y=\delta) = u_\infty$$

From Equation 7.5 it also follows that, since  $u = v = 0$  at  $y = 0$ ,

$$\frac{\partial^2 u}{\partial y^2} \Big|_{y=0} = 0$$

With the foregoing conditions, we could approximate the velocity profile as a third-degree polynomial of the form

$$\frac{u}{u_\infty} = a_1 + a_2 \left( \frac{y}{\delta} \right) + a_3 \left( \frac{y}{\delta} \right)^2 + a_4 \left( \frac{y}{\delta} \right)^3$$

and apply the conditions to determine the coefficients  $a_1$  to  $a_4$ . It is easily verified that  $a_1 = a_3 = 0$ ,  $a_2 = \frac{3}{2}$  and  $a_4 = -\frac{1}{2}$ , in which case

$$\frac{u}{u_\infty} = \frac{3}{2} \frac{y}{\delta} - \frac{1}{2} \left( \frac{y}{\delta} \right)^3 \quad (\text{F.6})$$

The velocity profile is then specified in terms of the unknown boundary layer thickness  $\delta$ . This unknown may be determined by substituting Equation F.6 into F.3 and integrating over  $y$  to obtain

$$\frac{d}{dx} \left( \frac{39}{280} u_\infty^2 \delta \right) = \frac{3}{2} \frac{\nu u_\infty}{\delta}$$

Separating variables and integrating over  $x$ , we obtain

$$\frac{\delta^2}{2} = \frac{140}{13} \frac{\nu x}{u_\infty} + \text{constant}$$

However, since  $\delta = 0$  at the leading edge of the plate ( $x = 0$ ), the integration constant must be zero and

$$\delta = 4.64 \left( \frac{\nu x}{u_\infty} \right)^{1/2} = \frac{4.64x}{Re_x^{1/2}} \quad (\text{F.7})$$

Substituting Equation F.7 into Equation F.6 and evaluating  $\tau_s = \mu(\partial u / \partial y)_s$ , we also obtain

$$C_{f,x} = \frac{\tau_s}{\rho u_\infty^2 / 2} = \frac{0.646}{Re_x^{1/2}} \quad (\text{F.8})$$

Despite the approximate nature of the foregoing procedure, Equations F.7 and F.8 compare quite well with results obtained from the exact solution, Equations 7.19 and 7.20.

In a similar fashion one could assume a temperature profile of the form

$$T^* = \frac{T - T_s}{T_\infty - T_s} = b_1 + b_2 \left( \frac{y}{\delta_t} \right) + b_3 \left( \frac{y}{\delta_t} \right)^2 + b_4 \left( \frac{y}{\delta_t} \right)^3$$

and determine the coefficients from the conditions

$$\begin{aligned} T^*(y=0) &= \frac{\partial T^*}{\partial y} \bigg|_{y=\delta_t} = 0 \\ T^*(y=\delta_t) &= 1 \end{aligned}$$

as well as

$$\frac{\partial^2 T^*}{\partial y^2} \bigg|_{y=0} = 0$$

which is inferred from the energy equation (7.6). We then obtain

$$T^* = \frac{3}{2} \frac{y}{\delta_t} - \frac{1}{2} \left( \frac{y}{\delta_t} \right)^3 \quad (\text{F.9})$$

Substituting Equations F.6 and F.9 into Equation F.4, we obtain, after some manipulation and assuming  $Pr \gtrsim 1$ ,

$$\frac{\delta_t}{\delta} = \frac{Pr^{-1/3}}{1.026} \quad (\text{F.10})$$

This result is in good agreement with that obtained from the exact solution, Equation 7.24. Moreover, the heat transfer coefficient may be then computed from

$$h = \frac{-k \partial T / \partial y|_{y=0}}{T_s - T_\infty} = \frac{3}{2} \frac{k}{\delta_t}$$

Substituting from Equations F.7 and F.10, we obtain

$$Nu_x = \frac{hx}{k} = 0.332 Re_x^{1/2} Pr^{1/3} \quad (\text{F.11})$$

This result agrees precisely with that obtained from the exact solution, Equation 7.23. Using the same procedures, analogous results may be obtained for the concentration boundary layer.

## References

1. von Kármán, T., *Z. Angew. Math. Mech.*, **1**, 232, 1921.
2. Pohlhausen, K., *Z. Angew. Math. Mech.*, **1**, 252, 1921.

# Index

---

NOTE: Page references preceded by a “W” refer to those pages that can be located on the Web site [www.wiley.com/college/incropera](http://www.wiley.com/college/incropera).

## A

Absolute species flux, 886, 893  
 Absolute temperature, 9  
 Absorption, 777  
     gaseous, 843–847  
     volumetric, 843  
 Absorptivity, 10, 754–755, 777  
 Adiabats, 202, W1  
 Adiabatic surfaces, 78  
 Advection, 6, 14, 886, 974, W26  
 American Society of  
     Mechanical Engineers  
     (ASME), 36  
 Analogy:  
     conduction and diffusive mass  
         transfer, 893  
     heat and mass transfer, to boundary  
         layers, 377–381  
     Reynolds, 384–385  
 Anemometer, hot-wire, 43  
 Annular fins, 140, 150–151  
 ASME (American Society of Mechanical  
     Engineers), 36  
 Azimuth angle, 728

## B

Band emission, 739–744  
 Base units, 35  
 Beds, external flow through packed,  
     452–453  
 Beer’s law, 843  
 Bessel equations, modified, 151  
 Bessel functions:  
     of the first kind (table), 963  
     modified, of the first and second kinds  
         (table), 964

Binary diffusion coefficients, 883  
     for one atmosphere (table), 952  
 Bioheat equation, 162–166  
 Biot number, 260–261, 376  
 Blackbodies, 9, 10, 777  
 Blackbody radiation, 736–752  
     and band emission, 739–752  
     and emissivity, 744–752  
     exchange, blackbody radiation,  
         830–831  
     and Planck distribution, 737  
     and Stefan–Boltzmann law, 738–739  
     and Wien’s displacement law,  
         737–738  
 Body forces, 975, W22  
 Boiling, 7, 8, 16, 620–640.  
     *See also* Condensation  
     definition of, 621  
     dimensionless parameters in, 620–621  
     forced convection, 636–640  
         defined, 636  
         external flow, 637  
         in microchannels, 640  
         two-phase flow, 637–640  
     pool, 622–636  
         and boiling curve, 622–626  
         defined, 622  
         film boiling, 626–626, 630–631  
         free convection boiling, 624–625  
         minimum heat flux for, 629–630  
         nucleate boiling, 625, 627–629  
         parametric effects on, 631–632  
         transition boiling, 625, 629–630  
     process of, 621  
         subcooled vs. saturated, 622  
 Bond number, 376

- Boundary conditions, 77–78
    - discontinuous, 900
    - mass diffusion, 900–907
      - catalytic surface reactions, 905–907
      - evaporation, 901
      - solubility of gases in liquids, 901–905
      - solubility of gases in solids, 901–905
      - sublimation, 901
    - of the second kind, 134
    - of the third kind, 134
  - Boundary layer(s), 348–374
    - approximations, boundary layer, 365
    - concentration boundary layer, 350–352
    - dimensionless parameters, physical
      - significance of, 374–377
    - equations, 364–367, 977–979
    - and evaporative cooling, 381–384
    - external flow
      - cylinder in cross flow, 423–425
      - mixed boundary layer conditions, 411–412
    - heat and mass transfer analogy to, 377–381
    - hydrodynamic, 6
    - laminar boundary layers, 359–364
    - mixed boundary layer conditions,
      - external flow with, 411–412
    - normalized equations, 367–374
      - similarity parameters, boundary layer, 368–372
      - solutions, function form of, 368–372
    - and Reynolds number, 360–361
    - significance of, 352
    - thermal, 6, 349–350
    - transition, laminar–turbulent flow, 359–361
    - turbulence, effects of, 361–364, 978–979
    - turbulent boundary layers, 359
    - velocity boundary layer, 348–349
  - Boussinesq approximation, 564
  - British thermal unit (Btu), 36
  - Bubble diameter, 627
  - Bulk (macroscopic) motion, 3, 6
  - Bulk temperature, 492
  - Buoyancy forces, 8, 560–562
  - Buoyant jets, 561
- C**
- Carbon nanotube, 109
  - Catalytic surface reactions, 905–907
  - Celsius, 37
  - Characteristic length, 208, 261, 290, 368
  - Chemical component of internal energy, 14
  - Chemical reactions, 905–910
    - heterogeneous, 905–907
    - homogeneous, 908–910
      - first order, 908
      - zero order, 908
  - Chilton–Colburn analogies, 385
  - Circular fins, 152
  - Circular tubes, *see* Tubes
  - Closed systems, 13
  - Coefficient matrix, 222
  - Coefficient of friction, 349, 376
  - Coherent structures, 360
  - Coiled tubes, 521–524
  - Colburn factor, 376, 385
  - Cold plates, 80
  - Column, evaporation in, 888–893
  - Column vectors, 223
  - Compact heat exchangers, 671–672, 683–686, 700–705
  - Complementary error function, 286
  - Composite walls, conduction with, 99–101
  - Concentration boundary layer, 350–352
  - Concentration gradient, 880
  - Concentric cylinders, free convection with, 590–591
  - Concentric spheres, free convection with, 591–592
  - Concentric tube annulus, 518–521
  - Concentric tube heat exchangers, 670
  - Condensation, 7, 8, 16, 642–655. *See also* Boiling
    - dimensionless parameters in, 620–621
    - dropwise, 641–642, 655
    - film
      - defined, 641
      - in horizontal tubes, 654
      - laminar, 643–646
      - on radial systems, 651–654
      - turbulent, 646–651
  - Conduction, 2–5, 58–82
    - and boundary/initial conditions, 77, 78
    - and Fourier’s law, 58–60
    - with generation of thermal energy, *see* Thermal energy generation, conduction with
    - and heat diffusion equation, 70–77
      - microscale effects, 77
    - mechanisms of, 3–5
    - one-dimensional steady-state, *see* One-dimensional steady-state conduction

- shape factors, conduction, 207–212, W3–W5
  - and thermal properties of matter, 60–69
  - transient, *see* Transient conduction
  - two-dimensional steady-state, *see* Two-dimensional steady-state conduction
  - Conduction rate equation (Fourier's law), 58–60
  - Conservation of energy, 13–29, 975–976, W26–W28
    - for control volume, 13–25
    - internal flow, 497–504
      - general considerations related to, 497–498
      - surface heat flux, constant, 498–501
      - surface temperature, constant, 501–504
    - and methodology for application of conservation laws, 29
    - and surface energy balance, 25–28
  - Conservation of mass, 974, W21–W22
  - Conservation of species, 894–897, 976, W28–W29
    - for control volume, 894, W28
    - and mass diffusion equation, 895–897, W29
  - Contact resistance, thermal, 101–103
  - Continuity equation, W22
  - Control surface, 14
  - Control volumes:
    - conservation of energy for, 13–25
    - differential, 29, 70
  - Convection, 2, 6–9, 348–387. *See also* External flow; Internal flow
    - boundary layers.
      - approximations, boundary layer, 365
      - concentration boundary layer, 350–352
      - dimensionless parameters, physical significance of, 374–377
      - equations, 364–367, 977–979
      - and evaporative cooling, 381–384
      - heat and mass transfer analogy to, 377–381
      - laminar boundary layers, 359–364
      - normalized equations, 367–374
      - and Reynolds number, 360–361
      - significance of, 352
      - thermal boundary layer, 349–350
      - turbulence, effects of, 361–364, 978–979
      - turbulent boundary layers, 359
      - velocity boundary layer, 348–349
    - coefficients, convection, 352–355, 385
    - forced, 7–8, 402
    - free, *see* Free convection
    - mass transfer by, 528–530
    - mechanisms of, 6–9
    - mixed, 7, 8, 593–594
    - problem of, 355
    - Reynolds analogy to, 384–385
  - Confinement number, 629, 640
  - Convection coefficients, 352–355, 385
  - Convection heat transfer coefficient, 8
  - Convection mass transfer coefficient, 353–354
  - Cooling:
    - evaporative, 381–384
    - Newton's law of, 8, 350
  - Cooling curve, 623
  - Counterflow heat exchangers, 679
  - Creeping flow, 433
  - Critical film thickness for conduction, 63
  - Critical heat flux, 625, 629
  - Cross-flow heat exchangers, 671, 680, 692, W38–W39
  - Curvilinear squares, W1–W2
  - Cylinder(s):
    - in cross flow, 423–433
      - flow considerations, 423–425
      - and heat and mass transfer, 425–433
    - free convection with
      - concentric cylinders, 590–591
      - long horizontal cylinder, 579–582
    - graphical representation of transient conduction in, W10–W11
    - one-dimensional steady-state conduction in, 116–121
- D**
- Darcy friction factor, 490
  - Density gradients, 560
  - Derived units, 37–38
  - Differential control volumes, 29, 70
  - Diffuse emitters, 730
  - Diffusion:
    - of energy, 3, 4
    - mass, *see* Mass diffusion
  - Diffusion-limited processes, 907
  - Diffusive species flux, 886–888, 893
  - Dilute gas or liquid, 893
  - Dimensions, 35
  - Dimensionless conduction heat rate, 207–212

Dimensionless parameters, 376–377  
     boiling, 620–621  
     boundary layers, 374–377  
     condensation, 620–621h  
     free convection, 565  
 Direct radiation, 772  
 Dirichlet conditions, 78  
 Discontinuous boundary conditions, 900  
 Discretization of heat equation:  
     explicit method of, 302–310  
     implicit method of, 310–317  
 Dittus–Boelter equation, 514  
 Double-pipe heat exchangers, 670  
 Drag coefficient, 425  
 Dropwise condensation, 641–642, 655

**E**

Eckert number, 376–377  
 Effectiveness–NTU method, 686–699  
 Electrical energy, conversion to thermal  
     energy from, 126  
 Electromagnetic spectrum, 725, 726  
 Electromagnetic waves, 725  
 Elements (of coefficient matrix), 222  
 Emission:  
     band, 739–744  
     definition of, 777  
     gaseous, 843–847  
     and radiation intensity, 728–733  
 Emissive power, 9, 729, 777  
 Emissivity, 10, 744–752  
     of selected solids (table), 954–956  
 Empirical correlations, 404  
 Enclosed fluids, free convection with,  
     587–593  
     cylinders, concentric, 590–591  
     rectangular cavities, 587–590  
     spheres, concentric, 591–592  
 Energy, diffusion of, 3, 4  
 Energy balance method, 215–222  
 Energy carriers, 61  
 Energy changes, 14  
 Energy generation, 15  
 Energy sinks, 71  
 Energy sources, 71  
 Energy storage, 71  
 English system of units, 35–38  
 Enhancement surfaces, 632  
 Enhancement devices, 521–524  
 Entry region, 512–513  
 Environmental radiation, 770–776  
 Equilibrium states, 12–13  
 Error function, 961

Evaporation, 16  
     in column, 888–893  
     process of, 901  
 Excess temperature, 621  
 Extended surfaces, heat transfer from:  
     and fin effectiveness, 147–149  
     general conduction analysis for,  
         139–141  
     nonuniform cross-sectional area, fins of,  
         150–153  
     and overall surface efficiency, 153–158  
     uniform cross-sectional area, fins of,  
         141–147  
 External flow, 402–457  
     across banks of tubes, 436–447  
     cylinder in cross flow, 423–433  
         flow considerations, 423–425  
         and heat and mass transfer, 425–433  
     empirical approach to, 403–404,  
         415–420  
     flat plate in parallel flow, 405–414  
         laminar flow, 405–410  
         with mixed boundary layer  
             conditions, 411–412  
         applied heat flux conditions, 413–414  
         unheated starting length, 412–413  
         turbulent flow, 410–411  
     forced convection boiling, 636–640  
     free convection, 571–584  
         cylinder, long horizontal, 579–582  
         inclined/horizontal plates, 574–579  
         spheres, 583–584  
     methodology for calculation of,  
         414–415  
     over a sphere, 433–436  
     parallel flow, flat plate in, *see* subhead:  
         flat plate in parallel flow  
     through impinging jets, 447–452  
         considerations with, 447–449  
         and heat and mass transfer, 449–452  
     through packed beds, 452–453

**F**

Fanning friction factor, 490  
 Fiber-type insulations, 66  
 Fick's law, 882–883  
 Film boiling, 625–626, 630–631  
 Film condensation:  
     defined, 641  
     in horizontal tubes, 654  
     laminar, 643–646  
     on radial systems, 651–654  
     turbulent, 646–651

- Film temperature, 404
- Finite control volumes, 29
- Finite-difference methods:
  - transient conduction, 302–317
    - explicit method of discretization of heat equation, 302–310
    - implicit method of discretization of heat equation, 310–317
  - two-dimensional steady-state conduction, 212–234
    - and energy balance method, 215–222
    - and Gauss–Seidel iteration, 223–229
    - heat equation, finite-difference form of, 214–215
    - and matrix inversion method, 222–223
    - nodal points, selection of, 214
    - temperature distribution, determination of, 222
    - verification of numerical solutions, 229–230
- Fins, 137–139
  - annular, 140, 150–151
  - circular, 152
  - evaluating performance of, 147–150
  - of nonuniform cross-sectional area, 150–153
  - overall surface efficiency of, 150–158
  - parabolic, 152–153
  - pin, 140, 152
  - straight, 140, 152
  - triangular, 140, 152
  - of uniform cross-sectional area, 141–147
- First law of thermodynamics, 13
- First order chemical reaction, 908
- Flake-type insulations, 66
- Flat plate, parallel flow over, 405–414
  - integral laminar boundary layer, solution for, 982–984
  - laminar flow, 405–410
  - with mixed boundary layer conditions, 411–412
  - applied heat flux conditions, 413–414
  - unheated starting length, 412–413
  - turbulent flow, 410–411
- Flow, *see* External flow; Internal flow
- Flow work, 16
- Fluids, thermal conductivity of, 64–65
- Fluidized beds, 453
- Flux plots, 203, W1–W2
- Foamed systems, 66
- Forced convection, 7–8, 402
  - combined free and, 593–594
- Forced convection boiling, 636–640
  - defined, 636
  - external flow, 637
  - two-phase flow phenomena, 637–640
- Form drag, 424
- Fourier number, 376
- Fourier's law, 4, 58–60
- Free convection, 7–8, 560–597
  - boiling, free convection, 624–625
  - buoyancy forces in, 560–562
  - combined forced and free, 593–594
  - dimensionless parameters governing, 565
  - with enclosed fluids, 587–593
    - cylinders, concentric, 590–591
    - rectangular cavities, 587–590
    - spheres, concentric, 591–592
  - equations governing, 563–564
  - external flows, 571–584
    - cylinder, long horizontal, 579–582
    - inclined/horizontal plates, 574–579
    - spheres, 583–584
  - laminar free convection on vertical surface, 566–568
  - and mass transfer, 594–595
  - with parallel plate channels, 584–587
    - inclined channels, 587
    - vertical channels, 585–587
  - physical considerations with, 560–562
  - turbulence, effects of, 568–570
  - vertical surface, laminar free convection on, 566–568
- Free convection boiling, 624–625
- Free jets, 448
- Freezing, 16
- Friction coefficient, 349, 376, 490
- Friction drag, 424
- Froude number, 639
- Fully developed regions, 488–491
- G**
- Gas(es):
  - conduction in, 3–4
  - solubility of (table), 953
  - thermophysical properties of, at atmospheric pressure, 941–945
- Gaseous radiation, 842–847
  - emission and absorption, gaseous, 843–847
  - volumetric absorption, 843
- Gaussian error function (table), 961



- Gauss–Seidel iteration, 223–229
- Generation of thermal energy, conduction
  - with, *see* Thermal energy
  - generation, conduction with
- Graphical method (two-dimensional steady-state conduction), W1–W6
  - and conduction shape factors, W3–W5
  - flux plot, construction of, W1–W2
  - heat transfer rate, determination of, W2–W3
- Grashof number, 376, 565
- Gray surfaces, 10
  - radiation exchange between diffuse, in enclosure, 822–839
    - black surfaces, 830–831
    - reradiating surfaces, 835–839
    - shields, radiation, 832–835
  - at surface, net radiation exchange, 823–824
  - between surfaces, net radiation exchange, 824–830
  - two-surface enclosures, 831–832
  - radiation from, 764–770
- H**
- Heat capacity, volumetric, 67
- Heat diffusion equation (heat equation), 70–77
  - discretization of
    - explicit method of, 302–310
    - implicit method of, 310–317
  - finite-difference form of, 214–215
  - microscale effects, 77
- Heat exchangers, 670–706
  - compact, 671–672, 683–686, 700–705
  - concentric tube, 670
  - design problems, 694–695
  - effectiveness–NTU method for
    - analysis of, 680–699
  - effectiveness of, 687
  - log mean temperature difference for
    - analysis of, 675–686
  - counterflow heat exchangers, 679
  - multipass and cross-flow heat exchangers, W37–W41
  - parallel-flow heat exchangers, 676–678
  - special conditions, operation under, 679–680
  - overall heat transfer coefficient for, 673–675
  - performance problems, 694–695
  - shell-and-tube, 670–672
    - types of, 670–672
- Heat flow lines, 202
- Heat flux, 4–5, 8, 59, 353
  - critical, 625, 629
  - pool boiling, 627–634
- Heating curve, 622–623
- Heat rate, 5, 59
- Heat sinks, 33
- Heat transfer:
  - and convection heat transfer
    - coefficient, 8
  - definition of, 2
  - determining rate of (two dimensional steady-state conduction), W2–W3
  - enhancement of, with internal flows, 521–524
  - from extended surfaces
    - and fin effectiveness, 147–149
  - general conduction analysis for, 139–141
  - nonuniform cross-sectional area, fins of, 150–153
  - and overall surface efficiency, 153–158
  - uniform cross-sectional area, fins of, 141–147
  - multimode, 839–841
  - physical mechanisms of, 3–11
  - practical relevance of, 32–35
  - problems, methodology for analysis of, 29–30
  - and radiation heat transfer
    - coefficient, 10
  - thermodynamics vs., 12–13
- Hemispherical emissive power, 729
- Henry’s constant, 902
  - for selected gases in water at moderate pressure (table), 953
- Heterogeneous chemical reactions, 905–907
- Homogeneous chemical reactions, 908–910
- Host medium, 893
- Hot-wire anemometer, 43
- Hydraulic diameter, 518
- Hydrodynamic boundary layer, 6
- Hydrodynamic factors:
  - with impinging jets, 447–449
  - with internal flow, 486–491
  - flow conditions, 486–487
  - friction factor, 490–491
  - in fully developed regions, 488–491

mean velocity, 487–488  
velocity profile, 488–490  
Hyperbolic functions (table), 960

**I**

Ideal gas, 17  
Impingement zone, 448  
Impinging jets, 447–452  
    convection heat and mass transfer with, 449–452  
    hydrodynamic/geometric considerations with, 447–449  
Incident radiation, 10  
Incompressible liquids, 18  
Initial conditions, 77–78  
Insulation systems, thermal conductivity of, 66–67  
Integral laminar boundary layer solution, 981–984  
Intensity, 777  
Internal energy, 14  
Internal flow, 486–534  
    circular tubes  
        laminar flow in, 505–513  
        turbulent flow in, 514–518  
    coiled tubes, 521–524  
    energy balance in, 497–504  
        general considerations related to, 497–498  
        surface heat flux, constant, 498–501  
        surface temperature, constant, 501–504  
    heat transfer enhancement in, 521–524  
    hydrodynamic considerations with, 486–491  
        flow conditions, 486–487  
        friction factor, 490–491  
        in fully developed regions, 488–491  
        mean velocity, 487–488  
        velocity profile, 488–490  
    mass transfer by convection in, 528–530  
    microscale effects in, 524–528  
        hydrodynamic conditions, 524  
        thermal conditions, 525  
    thermal considerations in, 491–497  
        with fully developed conditions, 493–497  
        mean temperature, 492–493  
        Newton's law of cooling, 493  
Irradiation, 10, 733–735, 752–753, 777  
Isotherms, 59, 202  
Isothermal surfaces, 59  
Isotropic media, 60

**J**

Jakob number, 376  
Jets:  
    buoyant, 561  
    impinging, *see* Impinging jets  
Joule heating, 126

**K**

Kelvin, 37  
Kilogram-mol, 37  
Kirchhoff's law, 762–763, 777

**L**

Laminar boundary layers, 359–364  
Laminar film condensation, 636–646  
Laminar flow:  
    in circular tubes, 505–513  
        entry region, 511–513  
        fully developed region, 505–511  
    flat plate, parallel flow over, 405–410  
Latent component of internal energy, 15  
Latent heat, 620  
Latent heat exchange, 8  
Latent heat of fusion, 24  
Lattice waves, 4  
Leidenfrost point, 625  
Length, 35  
Lewis number, 375–376  
Liquids:  
    conduction in, 4  
    incompressible, 18  
Liquid metals, 410  
    thermophysical properties of, 951  
LMTD method, *see* Log mean temperature difference method  
Local heat flux, 350  
Log mean temperature difference (LMTD) method, 675–686  
    counterflow heat exchangers, 679  
    multipass and cross-flow heat exchangers, W37–W41  
    parallel-flow heat exchangers, 676–678  
    special conditions, operation under, 679–680  
Longitudinal pitch, 437  
Lumped capacitance method, 256–270  
    assumption of, 256–257  
    and general lumped capacitance analysis, 263–270  
    theoretical basis of, 256–257  
    validity of, 259–263

**M**

Macroscopic (bulk) motion, 3, 6  
 Mass, 35  
 Mass diffusion, 880–917  
   boundary conditions and discontinuous concentrations, 900–907  
   catalytic surface reactions, 905–907  
   evaporation, 901  
   solubility of gases in liquids, 901–905  
   solubility of gases in solids, 901–905  
   sublimation, 901  
   homogenous chemical reactions, 908–910  
   in nonstationary media, 885–893  
     absolute species flux, 886  
     diffusive species flux, 886  
     evaporation in a column, 888–893  
     mass-average velocity, 887  
     molar-average velocity, 887  
   in stationary media  
     conservation of species, 894–897  
       for control volume, 894  
     mass diffusion equation, 894–897  
     with specified surface concentrations, 897–900  
   physical mechanisms of, 880–881  
     Fick's law, 882–883  
     mass diffusivity, 883  
     mixture composition, 881–882  
   stationary medium approximation, 893  
   transient diffusion, 911–916  
     analogy to heat transfer, 911  
 Mass diffusion equation, 894–897  
 Mass diffusivity, 883  
 Mass flow rate, 17  
 Mass transfer, 860. *See also*  
   Mass diffusion  
   and boundary layers, 350–352  
   by convection, 528–530, 594–595  
   with external flow  
     cylinder in cross flow, 425–433  
     through impinging jets, 449–452  
 Matrix inversion method, 222–223  
 Mean free path, 61  
 Mean temperature, 492–493  
 Mean velocity (internal flow), 487–488  
 Melting, 16  
 Metabolic heat generation, 162  
 Metals, thermophysical properties of  
   liquid, 951  
 Metallic solids:  
   emissivity of, 959  
   thermophysical properties of, 929–932

Micro- and nanoscale effects in  
   conduction, 62–67  
   fluid state thermal conductivity, 65–66  
   heat diffusion equation, 77  
   insulation, 67  
   solid state thermal conductivity, 62–64  
 Microscale effects in convection, 524–528  
   hydrodynamic conditions, 524  
   thermal conditions, 525  
 Mie scattering, 772  
 Mixed boundary layer conditions,  
   external flow with, 411–412  
 Mixed convection, 7, 8, 593–594  
 Mixtures, composition of, 881–882  
 Mode(s) of heat transfer, 2  
 Modified Bessel equations, 151  
 Molar concentration, 881  
 Mole, 37  
 Molecular weight, 37  
 Moody diagrams, 491  
 Moody friction factor, 490  
 Multipass heat exchangers, 680, 689–691,  
   W37–W38

**N**

Nano- and microscale effects in  
   conduction, 62–67  
   fluid state thermal conductivity, 65–66  
   heat diffusion equation, 77  
   insulation, 67  
   solid state thermal conductivity, 62–64  
 Nanoshell, 293  
 Nanospring, 193  
 Nanostructured materials, 63  
 Nanotube, carbon, 109  
 Nanowire, 190  
 Natural convection, *see* Free convection  
 Neumann conditions, 78  
 Newton's law of cooling, 8, 493  
 Newton's second law of motion, 974,  
   W22–W26  
 Nodal networks, 213–214  
 Nodal points (nodes), 213–214  
 Noncircular tubes, 518–519  
 Nonmetallic solids:  
   emissivity of, 955–956  
   thermophysical properties of,  
     933–934  
 Nonparticipating medium, 842  
 Nonstationary media, 885–893  
   absolute species flux, 886  
   diffusive species flux, 886  
   evaporation in a column, 888–893

mass-average velocity, 887  
 molar-average velocity, 887  
 Nuclear component of internal energy, 15  
 Nucleate boiling, 625, 627–629  
 Nusselt numbers, 371, 376

**O**

Ohmic heating, 126  
 One-dimensional steady-state conduction, 96–168  
   alternative approach, 112–116  
   bioheat equation, 162–168  
   extended surfaces, heat transfer from, 137–162  
     applicability, 137  
     and fin effectiveness, 147–149  
     general conduction analysis for, 139–141  
     nonuniform cross-sectional area, fins of, 150–153  
     and overall surface efficiency, 153–158  
     uniform cross-sectional area, fins of, 141–147  
 in plane wall systems, 96–116  
   composite walls, 99–101  
   and contact resistance, 101–103  
   standard approach, 96–112  
   temperature distribution, determination of, 96–99  
   thermal energy generation, conduction with, 126–132  
   thermal resistance, determination of, 98–99  
 in radial systems, 116–125  
   cylinder, 116–121  
   sphere, 121–125  
   thermal energy generation, conduction with, 132–137  
 thermal energy generation, conduction with, 126–137  
   plane wall systems, 126–132  
   in radial systems, 132–137  
 uniform energy generation, thermal conditions associated with, 966–971  
 Opaque surfaces, 10  
 Open systems, 14–18  
 Ordinary diffusion, 883

**P**

Packed beds, external flow through, 452–453

Parabolic fins, 152–153  
 Parallel-flow heat exchangers, 676–678  
 Parallel flow over flat plate, *see* Flat plate, parallel flow over  
 Parallel plate channels, free convection with, 584–587  
   inclined channels, 587  
   vertical channels, 585–587  
 Parameter sensitivity study, 28  
 Partition coefficient, 913  
 Peclet number, 237, 376  
 Penetration depth, thermal, 299  
 Pennes equation, 162  
 Perfusion, 162  
 Phase changes, 15–16  
 Phonons, 61  
 Photons, 725  
 Physical mechanisms of heat transfer, 3–12  
 Pin fins, 140–152  
 Pitch, 437, 523  
 Planck distribution, 737  
 Planck's law, 777  
 Plane wall systems:  
   one-dimensional steady-state conduction in, 96–116  
     composite walls, 99–101  
     and contact resistance, 101–103  
     standard approach, 96–112  
     temperature distribution, determination of, 96–99  
     thermal energy generation, conduction with, 126–132  
     thermal resistance, determination of, 98–99  
   transient conduction in, 272–275  
     approximate solution, 273–274  
     exact solution, 272–273  
     graphical representation of, W8–W9  
     roots of transcendental equation for (table), 962  
     and total energy transfer, 274–275  
 Plumes, 561  
 Pool boiling, 622–636  
   and boiling curve, 622–636  
   defined, 622  
   film boiling, 625–626, 630–631  
   free convection boiling, 624–625  
   minimum heat flux for, 629–630  
   nucleate boiling, 625, 627–629  
   parametric effects on, 631–632  
   transition boiling, 625, 629–630  
 Porosity, 453  
 Powder-type insulations, 66

Power-controlled heating, 622  
 Prandtl number, 368, 369, 371, 376  
 Pressure drag, 424  
 Problems, methodology for analysis  
   of, 29–30

**Q**

Quality of fluid, 638  
 Quanta, 61, 701  
 Quenching, 256  
 Quiescent fluid, 561

**R**

Radial systems:  
   film condensation in, 651–654  
   one-dimensional steady-state conduction  
     in, 116–125  
     cylinder, 116–121  
     sphere, 121–125  
     thermal energy generation,  
       conduction with, 132–137  
   transient conduction in, 276–283  
     approximate solutions, 277–278  
     exact solutions, 276  
     and total energy transfer, 277–278  
 Radiation, 724–780. *See also* Radiation  
   exchange  
   and absorptivity, 754–755  
   blackbody, 736–752  
     and band emission, 739–744  
     and emissivity, 744–752  
     and Planck distribution, 737  
     and Stefan–Boltzmann law, 738–739  
     and Wien’s displacement law,  
       737–738  
   concepts related to, 724–726  
   direct, 772  
   environmental, 770–776  
   gaseous, 842–847  
     emission and absorption, gaseous,  
       843–847  
     volumetric absorption, 843  
   with gray surfaces, 764–770  
   incident, 10  
   intensity of, 727–735  
     defined, 728–729  
     and emission, 728–733  
     and irradiation, 733–735  
     and radiosity, 735  
   and Kirchhoff’s law, 762–763  
   and reflectivity, 755–756  
   surfaces, special consideration with,  
     757–758

thermal, *see* Thermal radiation  
 and transmissivity, 756–757  
 Radiation exchange, 812–849  
   Beer’s law, 843  
   between diffuse gray surfaces in  
     enclosure, 822–839  
     blackbody, 830–831  
     reradiating surfaces, 835–839  
     shields, radiation, 832–835  
   at surface, net radiation exchange,  
     823–824  
   between surfaces, net radiation  
     exchange, 824–830  
   two-surface enclosures, 831–832  
   gaseous radiation, 842–847  
     emission and absorption, gaseous,  
       843–847  
     volumetric absorption, 843  
   and multimode heat transfer, 839–842  
   and view factor, 812–822  
     integral, view factor, 812–813  
     relations, view factor, 813–822  
 Radiation heat transfer coefficient, 10  
 Radiosity, 735, 777  
 Random motion, 4  
 Raoult’s law, 901  
 Rate basis, 13  
 Rate equations, 4  
 Rayleigh number, 569  
 Rayleigh scattering, 772  
 Reaction-limited processes, 907  
 Reciprocity relation, 813  
 Rectangular cavities, 587–590  
 Reflection, 10, 777  
 Reflective insulations, 66  
 Reflectivity, 755–756, 777  
 Relative species flux, 886  
 Reradiating surfaces, 832–835  
 Resistance:  
   contact, 101–103  
   thermal, 98–99  
 Resistance heating, 126  
 Reynolds analogy, 384–385  
 Reynolds number, 360–361, 368, 377  
 Reynolds stress, 979  
 Right-hand side vectors, 223

**S**

Saturated boiling, 622  
 Schmidt number, 368, 369, 372, 377  
 Semi-infinite solid, transient conduction in,  
   283–290, 292  
 Semitransparent media, 55

- Semitransparent surfaces, 10
  - Sensible energy, 8
  - Sensitivity study, parameter, 28
  - Separation of variables, method of, 203–207
  - Shape factors, conduction, 207–212, W3–W5
  - Shell-and-tube heat exchangers, 670–672, W37–W38
  - Sherwood number, 371–372, 377
  - Shields, radiation, 832–835
  - Similarity solutions, 406
  - Similarity variables, 406
  - Sinks, energy, 71
  - SI system, 36–37
  - Solar radiation, 812–814
  - Solar radiative properties of selected materials (table), 956
  - Solids:
    - emissivity of selected, 954–955
    - solubility of (table), 953
    - thermal conductivity of, 60–64
    - thermophysical properties of metallic, 929–932
    - thermophysical properties of nonmetallic, 933–934
  - Solidification, 16
  - Solubility, 901–905
  - Solution vectors, 223
  - Sources, energy, 71
  - Species, 880
  - Species flux, absolute, 886, 893
  - Species flux, diffusive, 886
  - Species flux, relative, 886
  - Specific heat, 17
  - Spectral absorptivity, 754–755
  - Spectral distribution, 778
  - Spectral emissive power, 730
  - Spectral irradiation, 733, 752
  - Spectral radiosity, 735
  - Sphere(s):
    - external flow over a
      - forced convection, 433–436
      - free convection, 583–584
    - free convection with
      - concentric spheres, 591–592
      - external flows, 583–584
    - graphical representation of transient conduction in, W11–W12
    - one-dimensional steady-state conduction in, 121–125
  - Spines, 139
  - Stagnation point, 450
  - Stagnation zone, 448
  - Stanton number, 377, 384–385
  - Stationary media
    - conservation of species, 894–897
      - for control volume, 894
      - mass diffusion equation, 894–897
      - with specified surface concentrations, 897–900
  - Stationary medium approximation, 893
  - Steady-state conditions, 4, 15
  - Stefan–Boltzmann law, 9, 738–739, 778
  - Stefan–Boltzmann constant, 9
  - Straight fins, 140
  - Streaks, 360
  - Stress(es):
    - Reynolds, 979
    - tensile, W23
    - viscous, W22
  - Subcooled boiling, 622
  - Sublimation, 901
  - Summation rule, 814
  - Surface(s):
    - conservation of energy at, 25–26
    - enhancement, 632
    - net radiation exchange at, 823–824
    - opaque, 10
    - radiation exchange between, 824–830
      - reradiating, 835–839
      - semitransparent, 10
  - Surface forces, W22
  - Surface phenomena, 16
  - Surface tension, 620
  - Surroundings, 10
- T**
- Temperature, 35, 37
    - and conduction, 3–4
    - excess, 621
    - film, 404
    - mean, 492–493
  - Temperature distribution, 70
    - one-dimensional steady-state conduction, 96–98
    - two-dimensional steady-state conduction, 207, 212
  - Temperature field, 70
  - Temperature gradient, 4, 59
  - Tensile stresses, W23
  - Thermal boundary layer, 6, 349–350
  - Thermal capacitance, 258
  - Thermal component of internal energy, 14–15

- Thermal conductivity, 4, 60–67
    - bulk, 62
    - definition of, 60
    - effective, 66
    - of fluids, 64–66
      - micro- and nanoscale effects, 65–66
    - of insulation systems, 66–67
    - of isotropic materials, 60
    - of solids, 60–64
      - micro- and nanoscale effects, 62–64
      - and state of matter, 60
  - Thermal contact resistance, 101–103
  - Thermal diffusivity, 68, 72
  - Thermal energy generation, conduction
    - with, 126–137
      - plane wall systems, 126–132
      - in radial systems, 132–137
  - Thermal expansion (volumetric)
    - coefficient, 563
  - Thermal penetration depth, 299
  - Thermal radiation, 3, 726, 778
    - mechanisms of, 9
  - Thermal resistance for conduction (plane wall), 98–99
  - Thermodynamics, 2
    - heat transfer vs., 12–13
  - Thermodynamic properties, 67
  - Thermophysical properties, 67
    - of common materials, 935–940
    - of gases at atmospheric pressure, 941–945
    - of liquid metals, 951
    - of metallic solids, 929–932
    - of nonmetallic solids, 933–934
    - of saturated fluids, 946–948
    - of saturated water, 949–950
  - Thermoregulation, 26
  - Thin film, 63
  - Time, 35
  - Time instant, 14
  - Time interval, 14
  - Total emissive power, 730
  - Total irradiation, 733, 752
  - Transient conduction, 256–319
    - finite-difference methods with, 302–317
      - explicit method of discretization of heat equation, 302–310
      - implicit method of discretization of heat equation, 310–314
    - graphical representation of one-dimensional, W8–W12
    - lumped capacitance method with, 256–270
      - assumption of, 256, 257
      - general lumped capacitance analysis, 263–270
      - theoretical basis of, 256–257
      - validity, method, 259–263
    - multidimensional effects with, W13–W18
      - plane wall approximation with, 272–275
    - approximate solution, 273–274
    - exact solution, 272–273
    - roots of transcendental equation for (table), 962
  - objects with constant surface heat flux, 292–294
    - approximate solutions, 293–294
    - exterior heat transfer, 293
    - interior heat transfer, 292–293
    - semi-infinite solid, 292
  - objects with constant surface temperature, 290–292, 293, 295
    - approximate solutions, 293, 295
    - exterior heat transfer, 291–292
    - interior heat transfer, 291
    - semi-infinite solid, 290–291
  - periodic heating, 299–301
  - and total energy transfer, 274–275
  - with radial systems, 276–283
    - approximate solutions, 277–278
    - exact solutions, 276
    - and total energy transfer, 277–278
  - with semi-infinite solid, 283–292
  - spatial effects with, W13–W18
- Transient diffusion, 911–916
  - analogy to heat transfer, 911
- Transition boiling, 625, 629–630
- Transition, laminar–turbulent flow, 359–361
- Transmission, 10, 778
- Transmissivity, 756–757, 778
- Transport properties, 67
- Transverse pitch, 437
- Triangular fins, 152–153
- Tubes:
  - aligned vs. staggered arrangement of, 437
  - coiled, 522–524
  - concentric, 519–521
  - external flow across banks of, 436–447
  - film condensation in horizontal, 654
  - heat exchangers, shell-and-tube, 670–672, W37–W38
  - laminar flow in circular, 505–513

- entry region, 511–513
  - fully developed region, 505–511
  - noncircular, 518–519
  - turbulent flow in circular, 511–518
- Turbulence:
  - effects of, on boundary layers, 359–364
  - and free convection, 568–570
  - modeling, 979
- Turbulent boundary layers, 359
- Turbulent film condensation, 646–651
- Turbulent flow:
  - in circular tubes, 511–518
  - flat plate, parallel flow over, 410–411
- Two-dimensional steady-state conduction, 202–235
  - alternative approaches with, 202–203
  - conduction shape factor, 207–212
  - dimensionless conduction heat rate, 207–212
  - finite-difference, method with, 212–235
    - and energy balance method, 215–222
    - and Gauss–Seidel iteration, 223–229
    - heat equation, finite-difference form of, 214–215
    - and matrix inversion method, 222–223
    - nodal points, selection of, 214
    - temperature distribution,
      - determination of, 207, 212
    - verification of numerical solutions, 229–230
  - graphical method with, W1–W6
    - and conduction shape factors, W3–W5
    - flux plot, construction of, W1–W2
    - heat transfer rate, determination of, W2–W3
  - separation of variables method with, 203–207
- Two-phase flow, 637–640
  - in microchannels, 640
- U**
  - Unheated starting length, 412–413
- Units, 35–38
  - derived, 37, 38
  - English system of, 35–38
  - SI system, 35–38
- Unit mass, 17
- V**
  - Vapor blanket, 625
  - Vaporization, 16
  - Velocity boundary layer, 348–349
  - Velocity profile (internal flow), 488–490
  - View factor (radiation exchange), 812–822
    - integral, view factor, 812–813
    - relations, view factor, 813–822
  - Viscous dissipation, 18
  - Viscous stresses, W22
  - Void fraction, 453
  - Volumetric absorption, 843
  - Volumetric flow rate, 18
  - Volumetric heat capacity, 67
  - Volumetric phenomena, 16
  - Volumetric thermal expansion coefficient, 563
- W**
  - Weber number, 377
  - Wien's displacement law, 737–738, 778
- Z**
  - Zenith angle, 728, 771
  - Zero order chemical reaction, 908





# Conversion Factors

Acceleration	1 m/s <sup>2</sup>	= 4.2520 × 10 <sup>7</sup> ft/h <sup>2</sup>
Area	1 m <sup>2</sup>	= 1550.0 in. <sup>2</sup> = 10.764 ft <sup>2</sup>
Density	1 kg/m <sup>3</sup>	= 0.06243 lb <sub>m</sub> /ft <sup>3</sup>
Energy	1 J (0.2388 cal)	= 9.4782 × 10 <sup>-4</sup> Btu
Force	1 N	= 0.22481 lb <sub>f</sub>
Heat transfer rate	1 W	= 3.4121 Btu/h
Heat flux	1 W/m <sup>2</sup>	= 0.3170 Btu/h · ft <sup>2</sup>
Heat generation rate	1 W/m <sup>3</sup>	= 0.09662 Btu/h · ft <sup>3</sup>
Heat transfer coefficient	1 W/m <sup>2</sup> · K	= 0.17611 Btu/h · ft <sup>2</sup> · °F
Kinematic viscosity and diffusivities	1 m <sup>2</sup> /s	= 3.875 × 10 <sup>4</sup> ft <sup>2</sup> /h
Latent heat	1 J/kg	= 4.2992 × 10 <sup>-4</sup> Btu/lb <sub>m</sub>
Length	1 m	= 39.370 in. = 3.2808 ft = 0.62137 mile
Mass	1 kg	= 2.2046 lb <sub>m</sub>
Mass density	1 kg/m <sup>3</sup>	= 0.06243 lb <sub>m</sub> /ft <sup>3</sup>
Mass flow rate	1 kg/s	= 7936.6 lb <sub>m</sub> /h
Mass transfer coefficient	1 m/s	= 1.1811 × 10 <sup>4</sup> ft/h
Power	1 kW	= 3412.1 Btu/h = 1.341 hp
Pressure and stress <sup>1</sup>	1 N/m <sup>2</sup> (1 Pa)	= 0.020885 lb <sub>f</sub> /ft <sup>2</sup> = 1.4504 × 10 <sup>-4</sup> lb <sub>f</sub> /in. <sup>2</sup> = 4.015 × 10 <sup>-3</sup> in. water = 2.953 × 10 <sup>-4</sup> in. Hg = 1 standard atmosphere
	1.0133 × 10 <sup>5</sup> N/m <sup>2</sup>	= 1 bar
	1 × 10 <sup>5</sup> N/m <sup>2</sup>	= 1 bar
Specific heat	1 kJ/kg · K	= 0.2388 Btu/lb <sub>m</sub> · °F
Temperature	K	= (5/9)°R = (5/9)(°F + 459.67) = °C + 273.15
Temperature difference	1 K	= 1°C = (9/5)°R = (9/5)°F
Thermal conductivity	1 W/m · K	= 0.57779 Btu/h · ft · °F
Thermal resistance	1 K/W	= 0.52753 °F/h · Btu
Viscosity (dynamic) <sup>2</sup>	1 N · s/m <sup>2</sup>	= 2419.1 lb <sub>m</sub> /ft · h = 5.8015 × 10 <sup>-6</sup> lb <sub>f</sub> · h/ft <sup>2</sup>
Volume	1 m <sup>3</sup>	= 6.1023 × 10 <sup>4</sup> in. <sup>3</sup> = 35.315 ft <sup>3</sup> = 264.17 gal (U.S.)
Volume flow rate	1 m <sup>3</sup> /s	= 1.2713 × 10 <sup>5</sup> ft <sup>3</sup> /h = 2.1189 × 10 <sup>3</sup> ft <sup>3</sup> /min = 1.5850 × 10 <sup>4</sup> gal/min

<sup>1</sup> The SI name for the quantity pressure is pascal (Pa) having units N/m<sup>2</sup> or kg/m · s<sup>2</sup>.

<sup>2</sup> Also expressed in equivalent units of kg/s · m.

# Physical Constants

---

Universal Gas Constant:

$$\begin{aligned}\mathcal{R} &= 8.205 \times 10^{-2} \text{ m}^3 \cdot \text{atm/kmol} \cdot \text{K} \\ &= 8.314 \times 10^{-2} \text{ m}^3 \cdot \text{bar/kmol} \cdot \text{K} \\ &= 8.315 \text{ kJ/kmol} \cdot \text{K} \\ &= 1545 \text{ ft} \cdot \text{lb}_f/\text{lbmole} \cdot ^\circ\text{R} \\ &= 1.986 \text{ Btu/lbmole} \cdot ^\circ\text{R}\end{aligned}$$

Avogadro's Number:

$$\mathcal{N} = 6.024 \times 10^{23} \text{ molecules/mol}$$

Planck's Constant:

$$h = 6.626 \times 10^{-34} \text{ J} \cdot \text{s}$$

Boltzmann's Constant:

$$k = 1.381 \times 10^{-23} \text{ J/K}$$

Speed of Light in Vacuum:

$$c_o = 2.998 \times 10^8 \text{ m/s}$$

Stefan-Boltzmann Constant:

$$\sigma = 5.670 \times 10^{-8} \text{ W/m}^2 \cdot \text{K}^4$$

Blackbody Radiation Constants:

$$C_1 = 3.742 \times 10^8 \text{ W} \cdot \mu\text{m}^4/\text{m}^2$$

$$C_2 = 1.439 \times 10^4 \mu\text{m} \cdot \text{K}$$

$$C_3 = 2898 \mu\text{m} \cdot \text{K}$$

Gravitational Acceleration (Sea Level):

$$g = 9.807 \text{ m/s}^2 = 32.174 \text{ ft/s}^2$$

Standard Atmospheric Pressure:

$$p = 101,325 \text{ N/m}^2 = 101.3 \text{ kPa}$$

Heat of Fusion of Water at Atmospheric Pressure:

$$h_{sf} = 333.7 \text{ kJ/kg}$$

Heat of Vaporization of Water at Atmospheric Pressure:

$$h_{fg} = 2257 \text{ kJ/kg}$$